
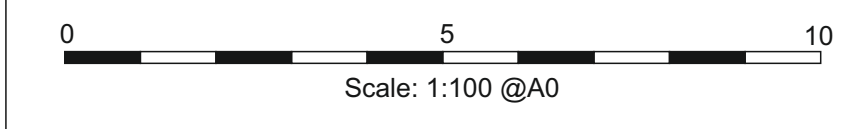
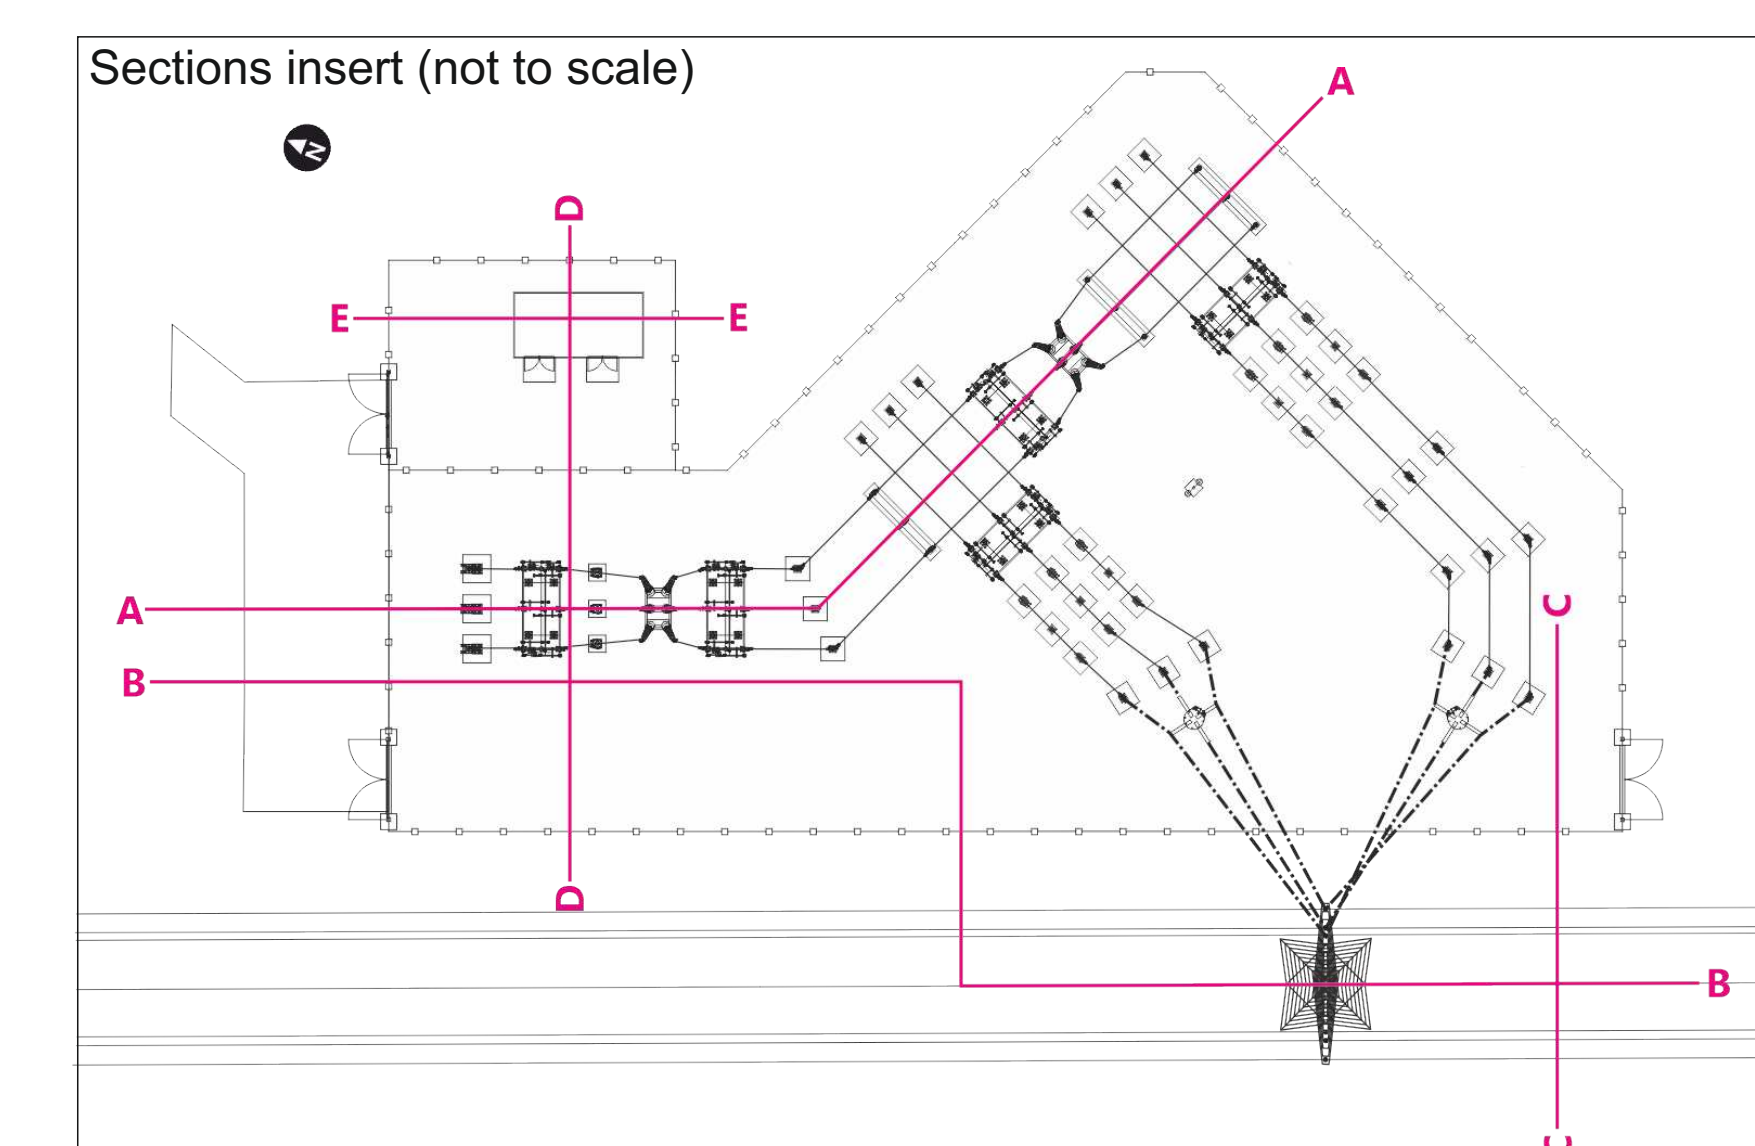
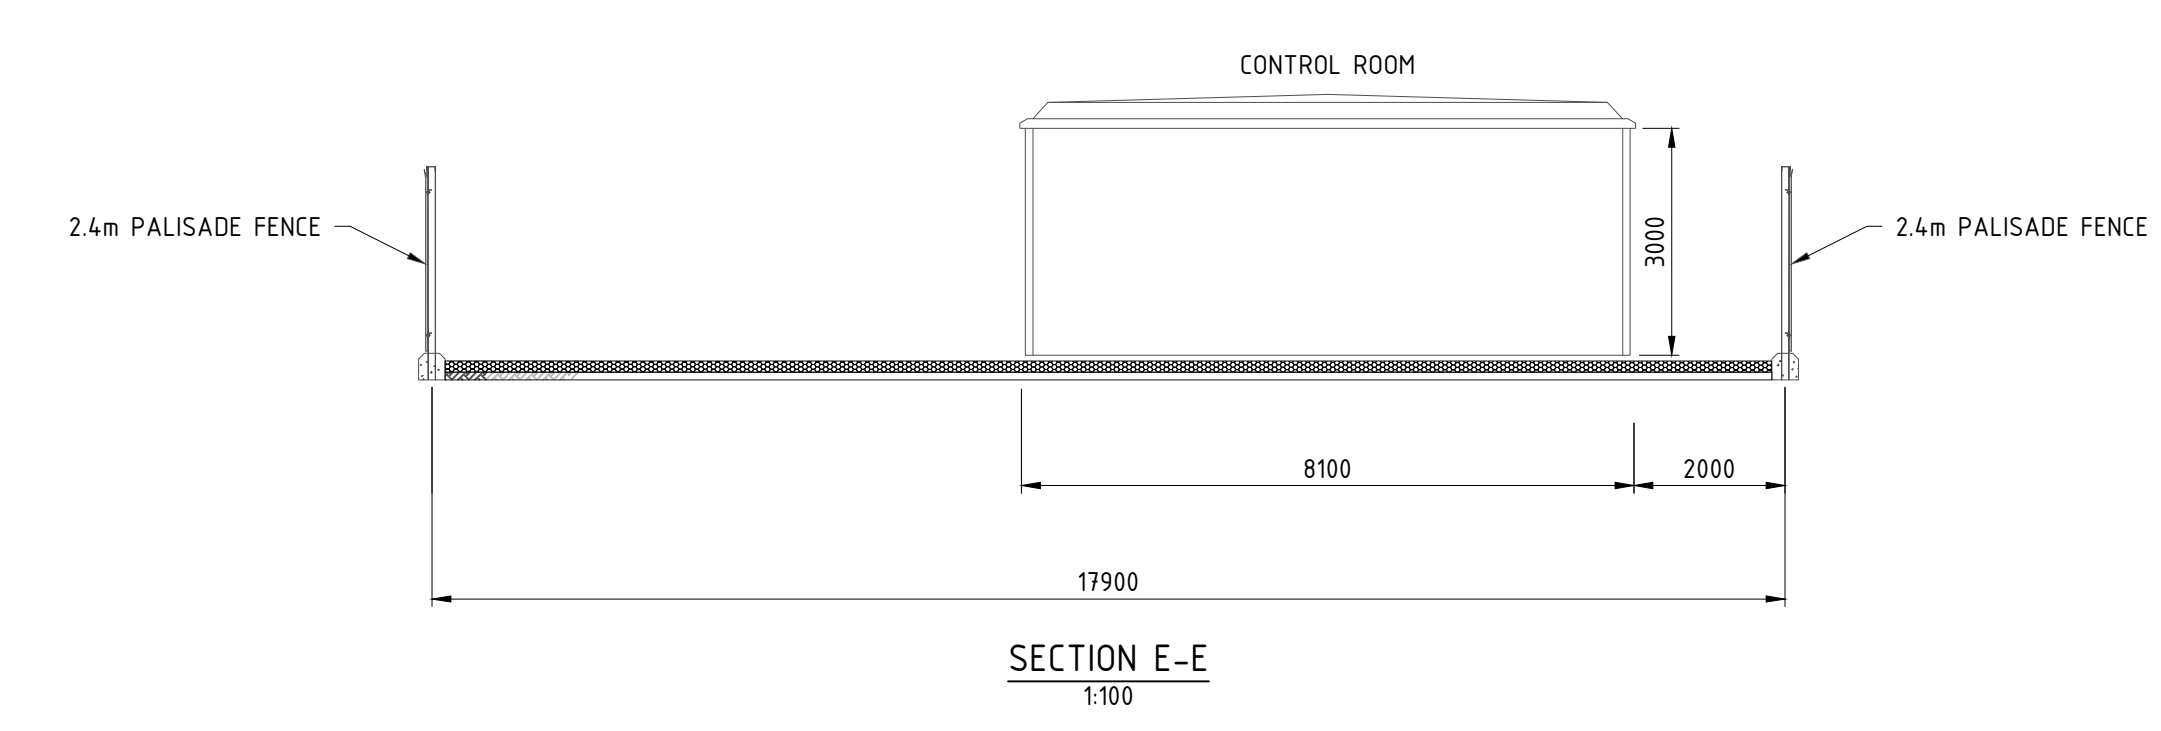
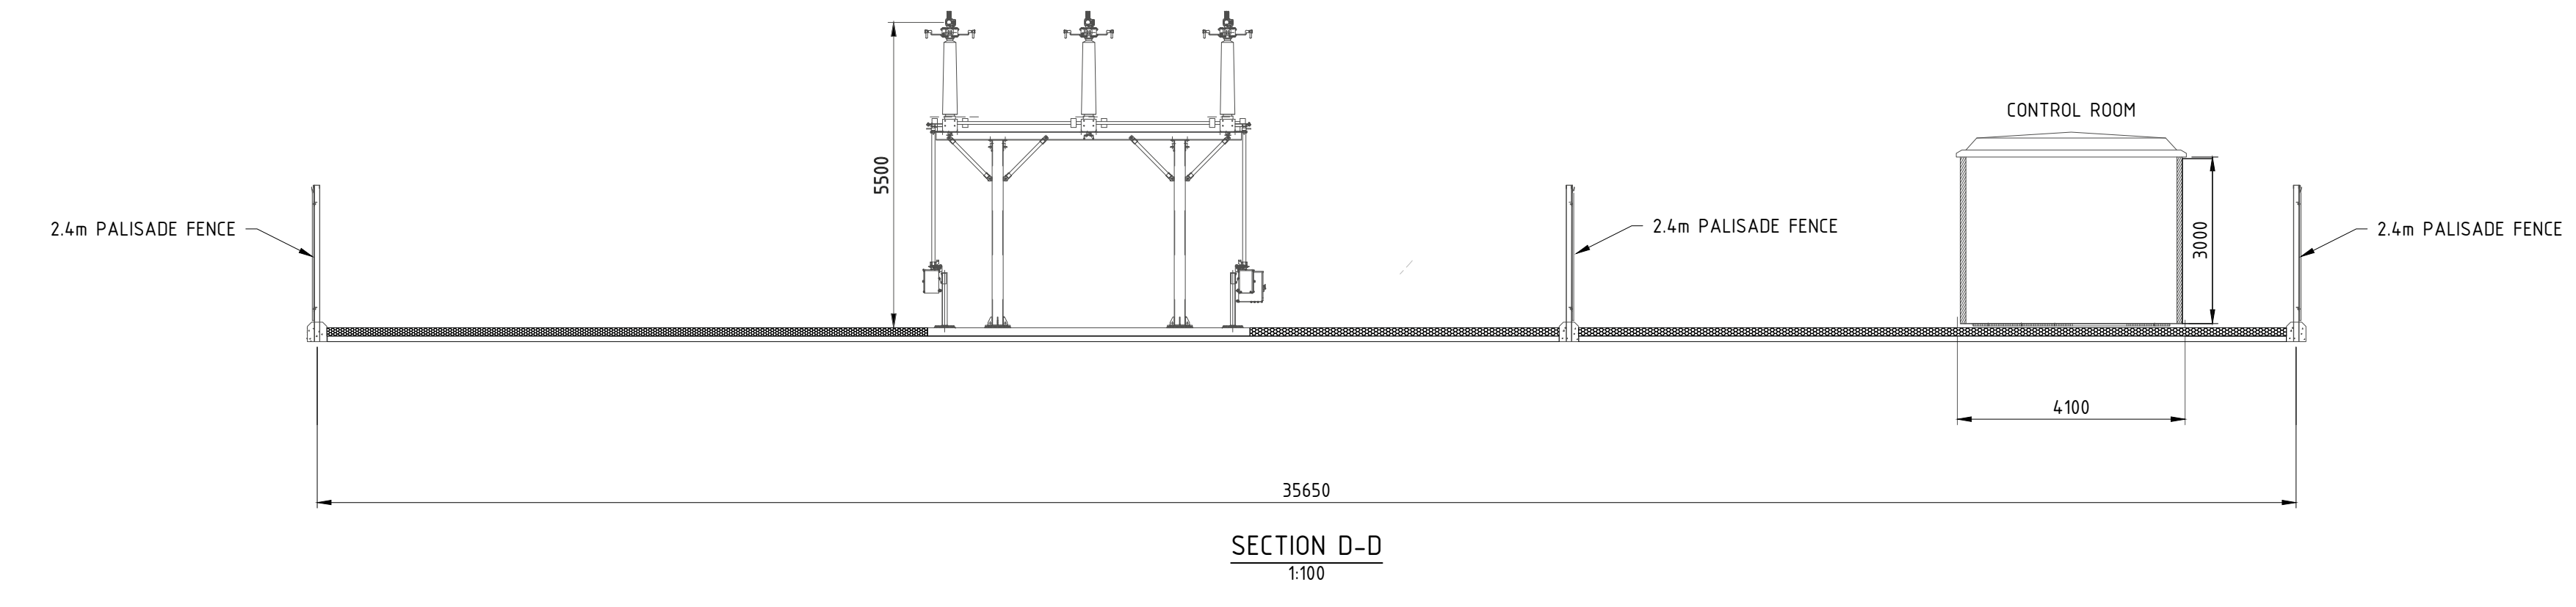
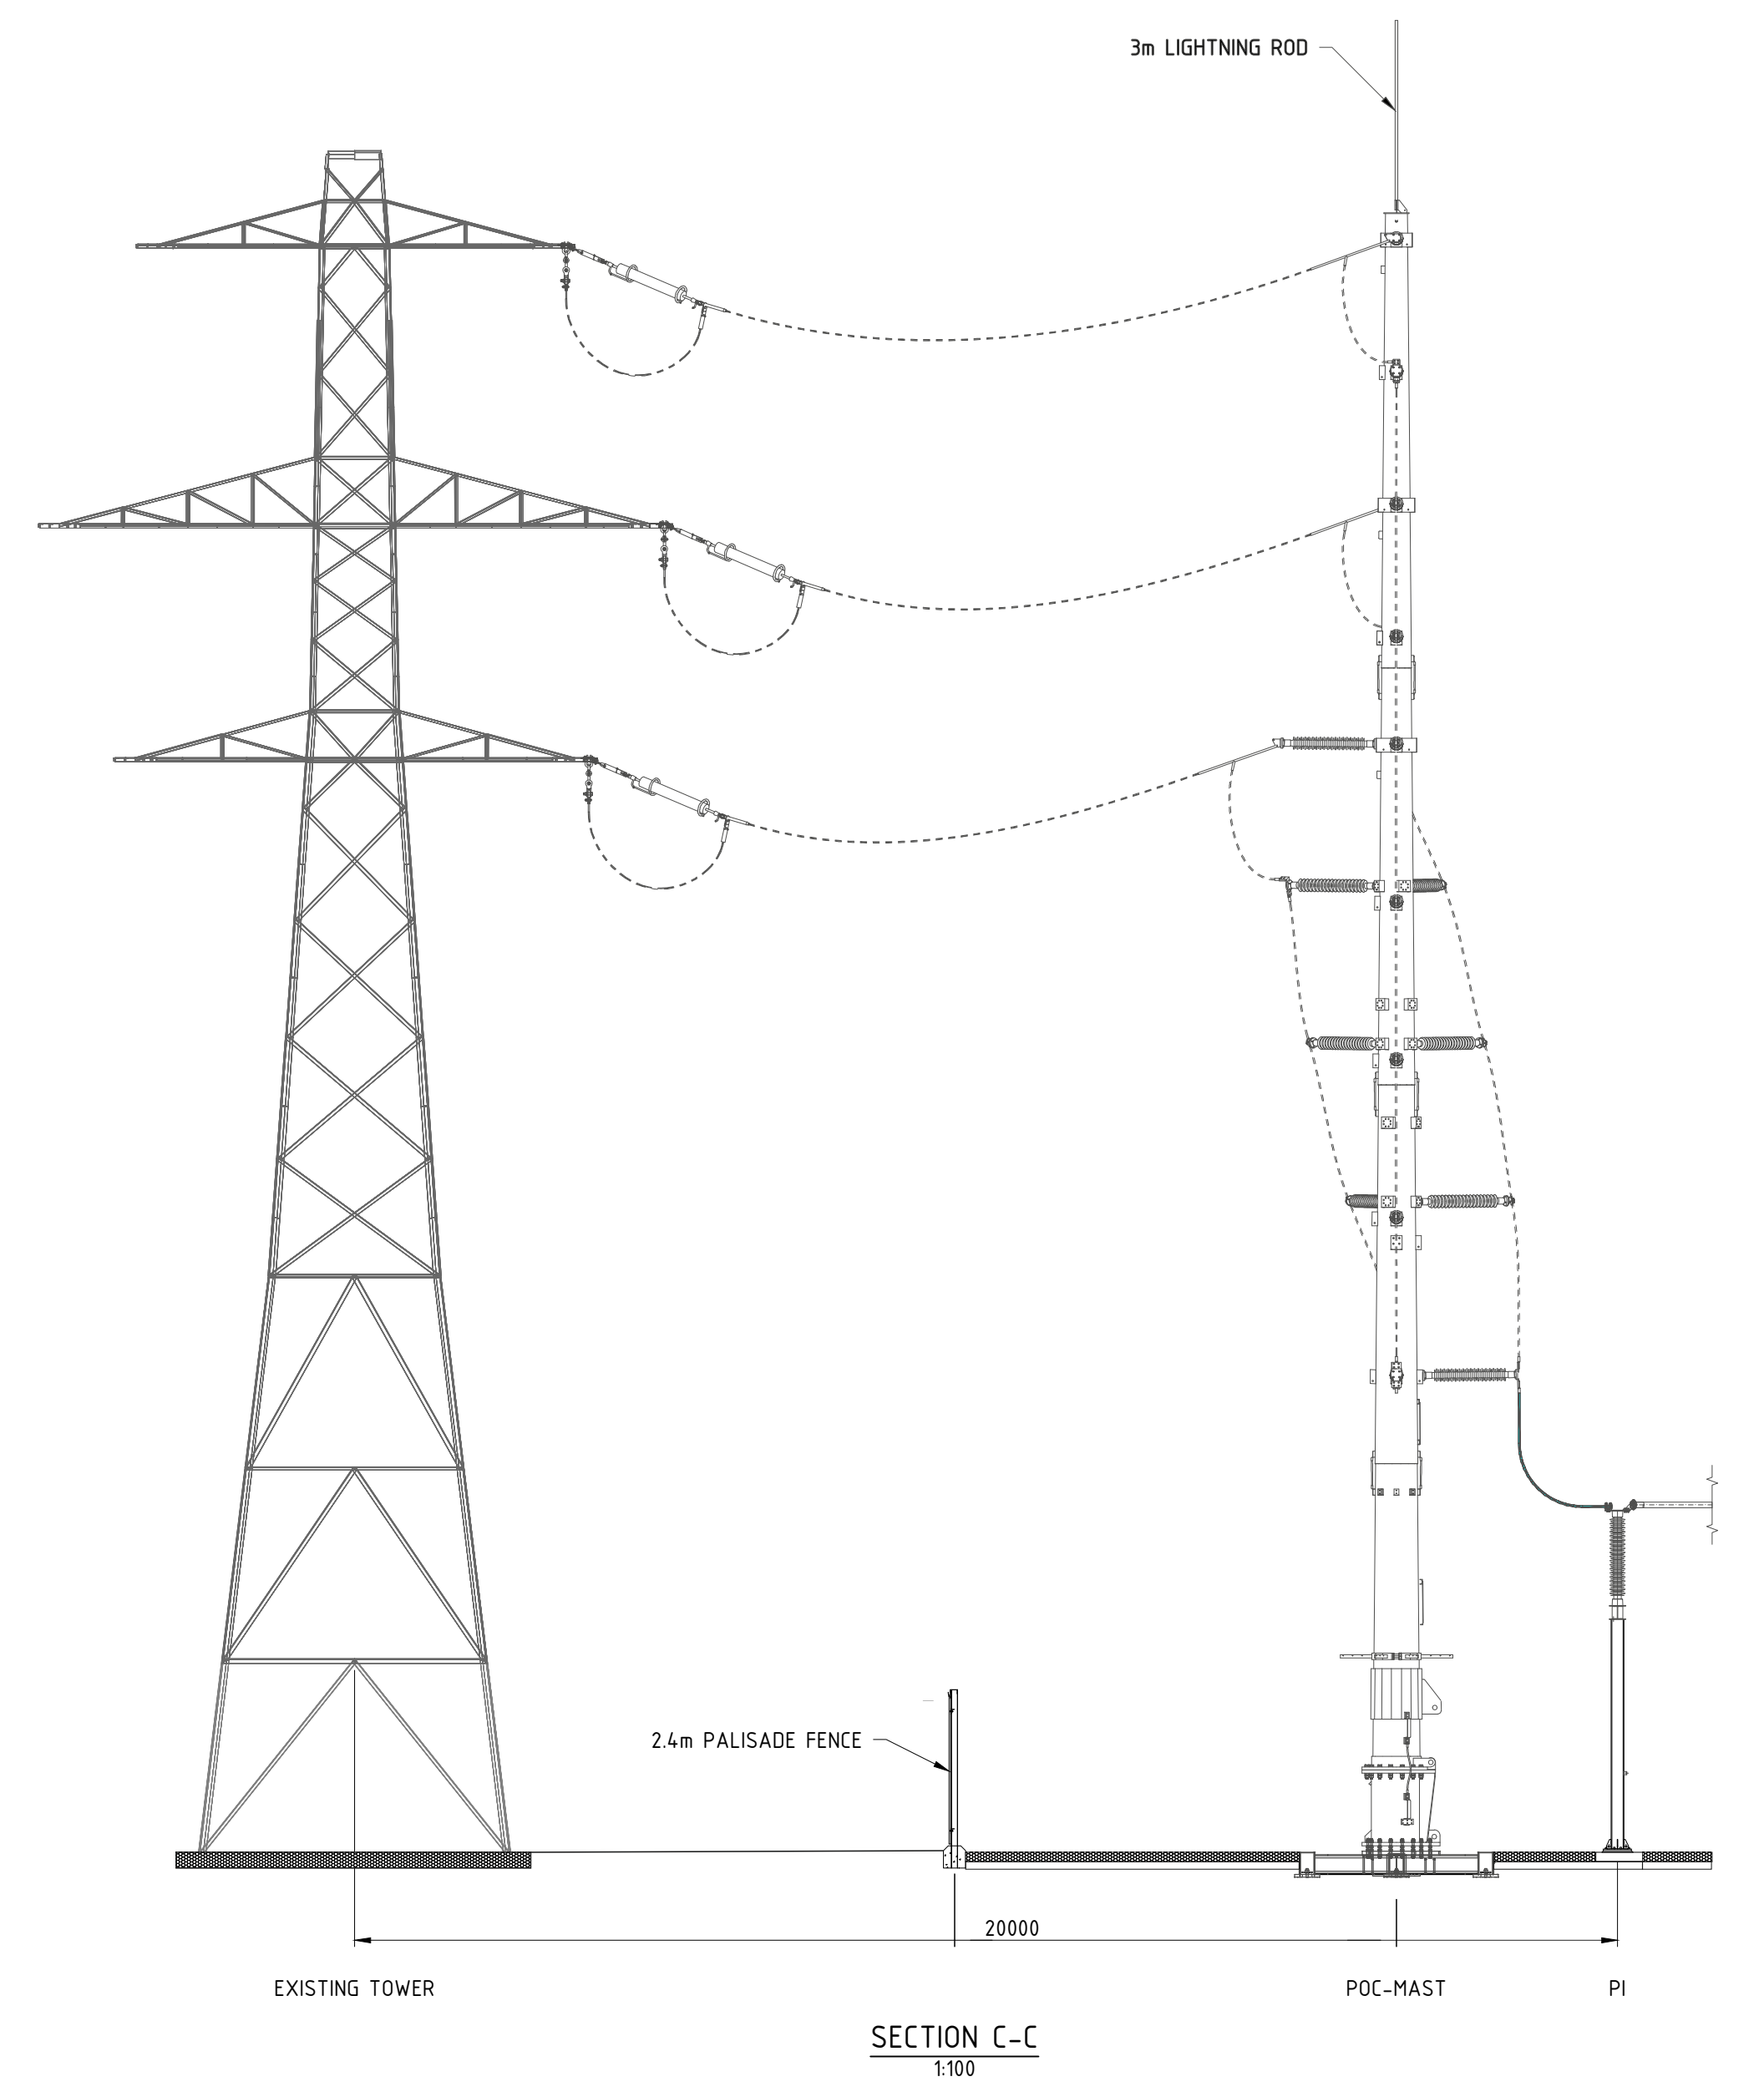
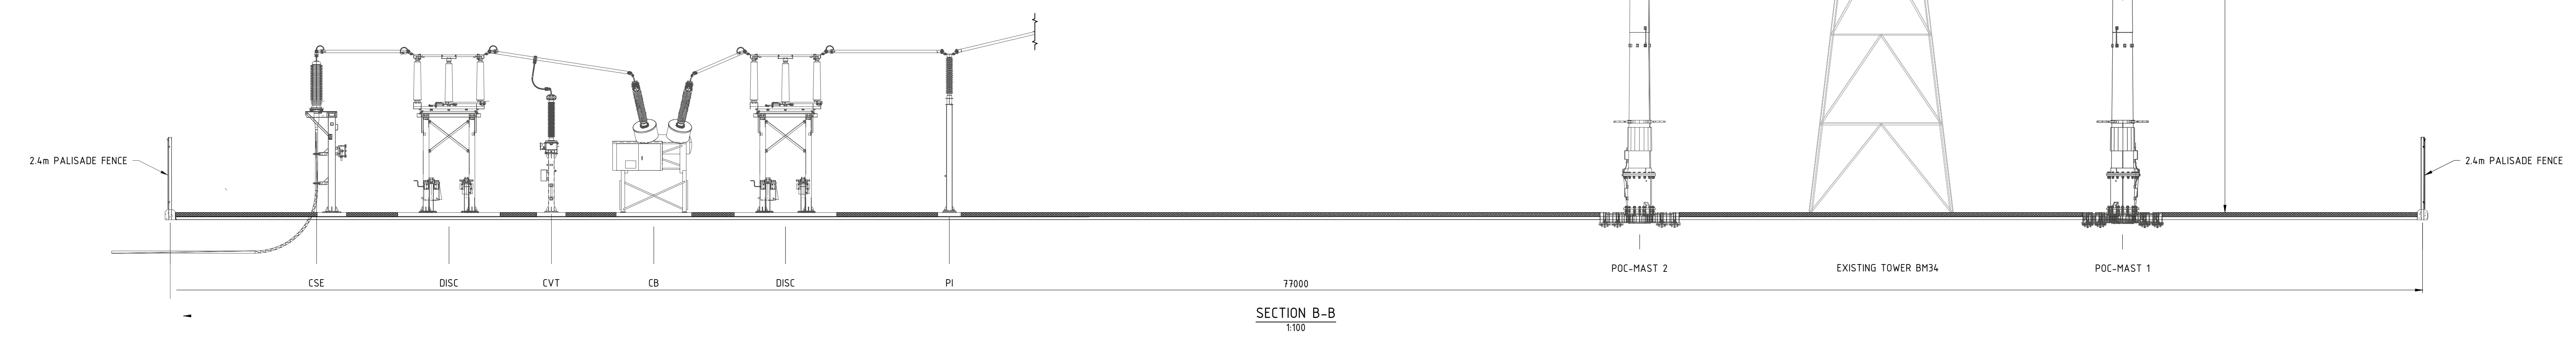
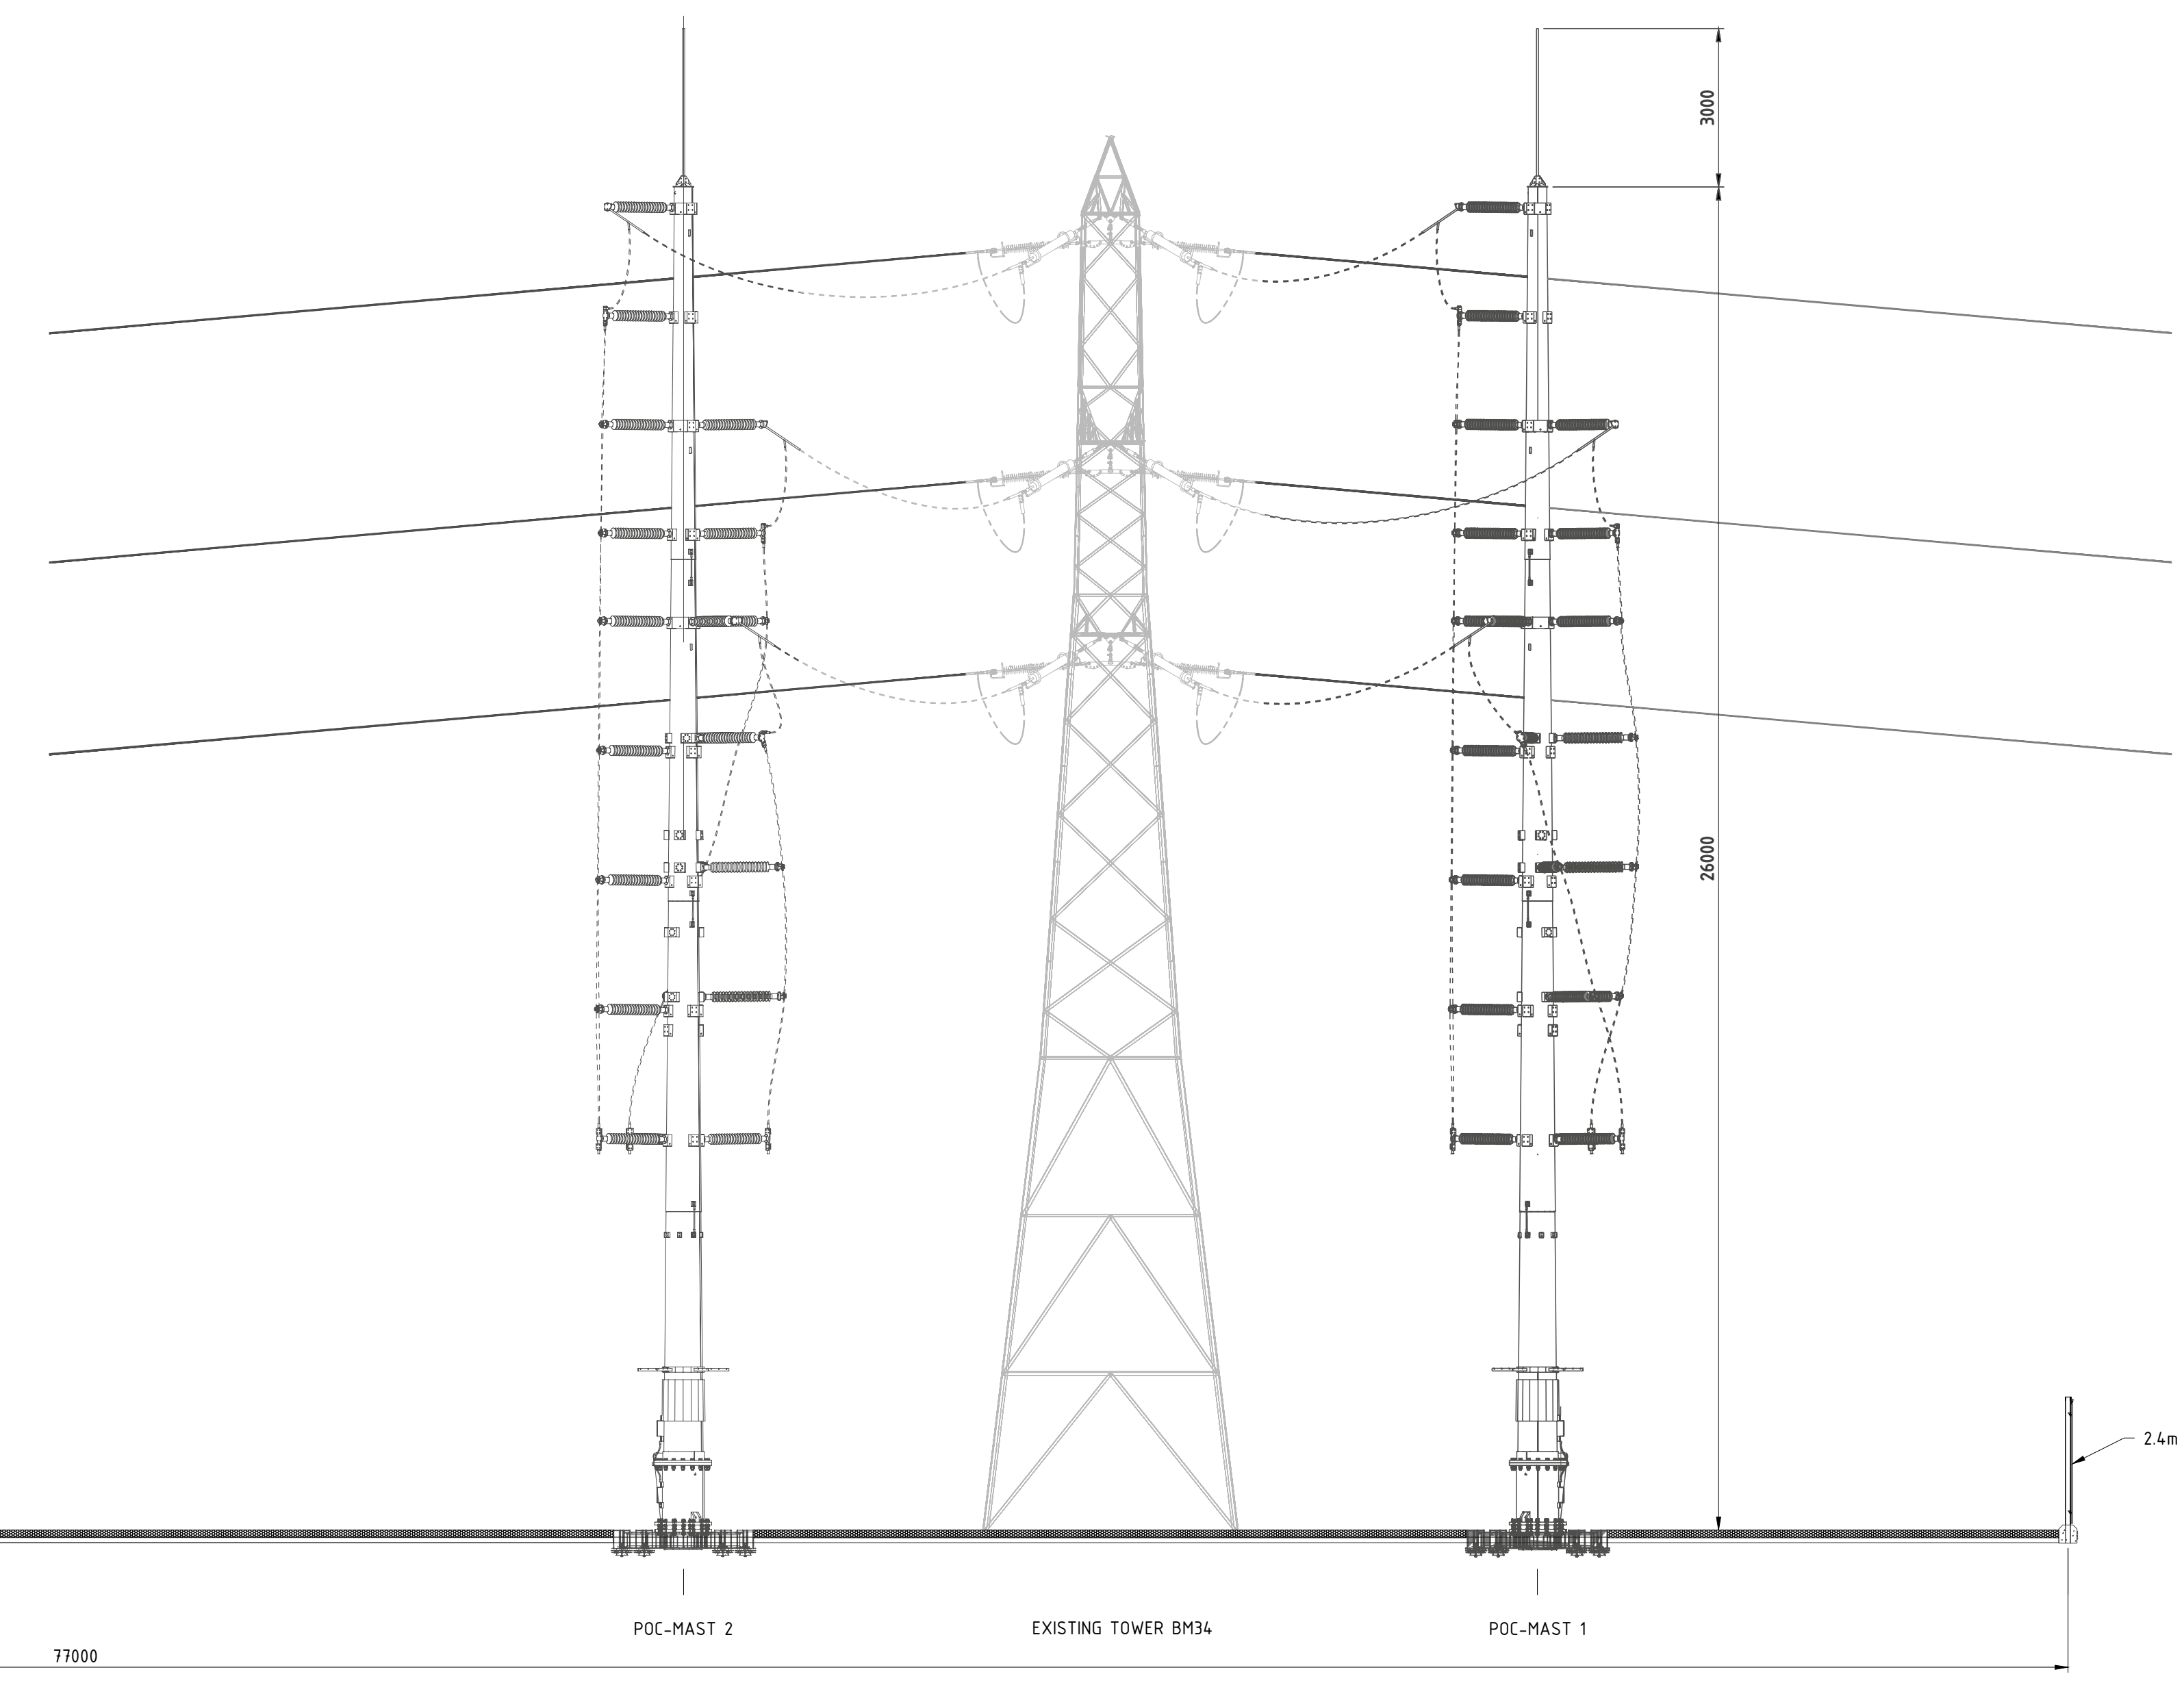


NOTES:

PRELIMINARY DESIGN FOR PLANNING.
SUBJECT TO FINALISATION AND AGREEMENT WITH THE DNO.
POC MAST PFL 45.0M AOD.

ABBREVIATIONS:

- CB - CIRCUIT BREAKER
- CSE - CABLE SEALING END
- CVT - CAPACITIVE VOLTAGE TRANSFORMER
- DISC - DISCONNECTOR
- DISC-HL - DISCONNECTOR HIGH LEVEL
- ES - EARTH SWITCH
- LC - LIGHTING COLUMN
- HW - MARSHALLING HOOD
- PI - POST INSULATOR
- PI-HL - POST INSULATOR HIGH LEVEL
- SA - SURGE ARRESTER
- VT - VOLTAGE TRANSFORMER

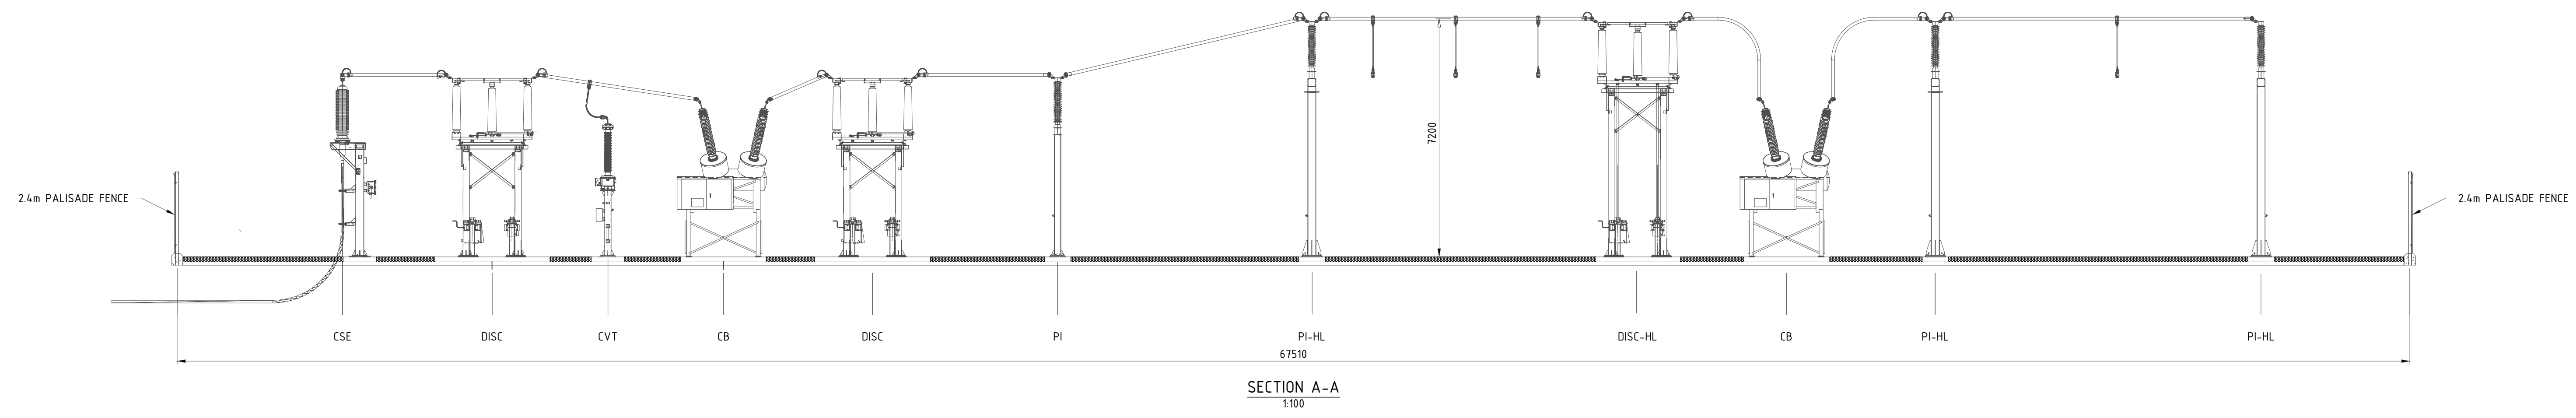

MVV Environment Limited
Canford Energy from Waste Combined Heat
and Power Facility

DNC Compound Sections

July 2023

MVV_005_Rev_1