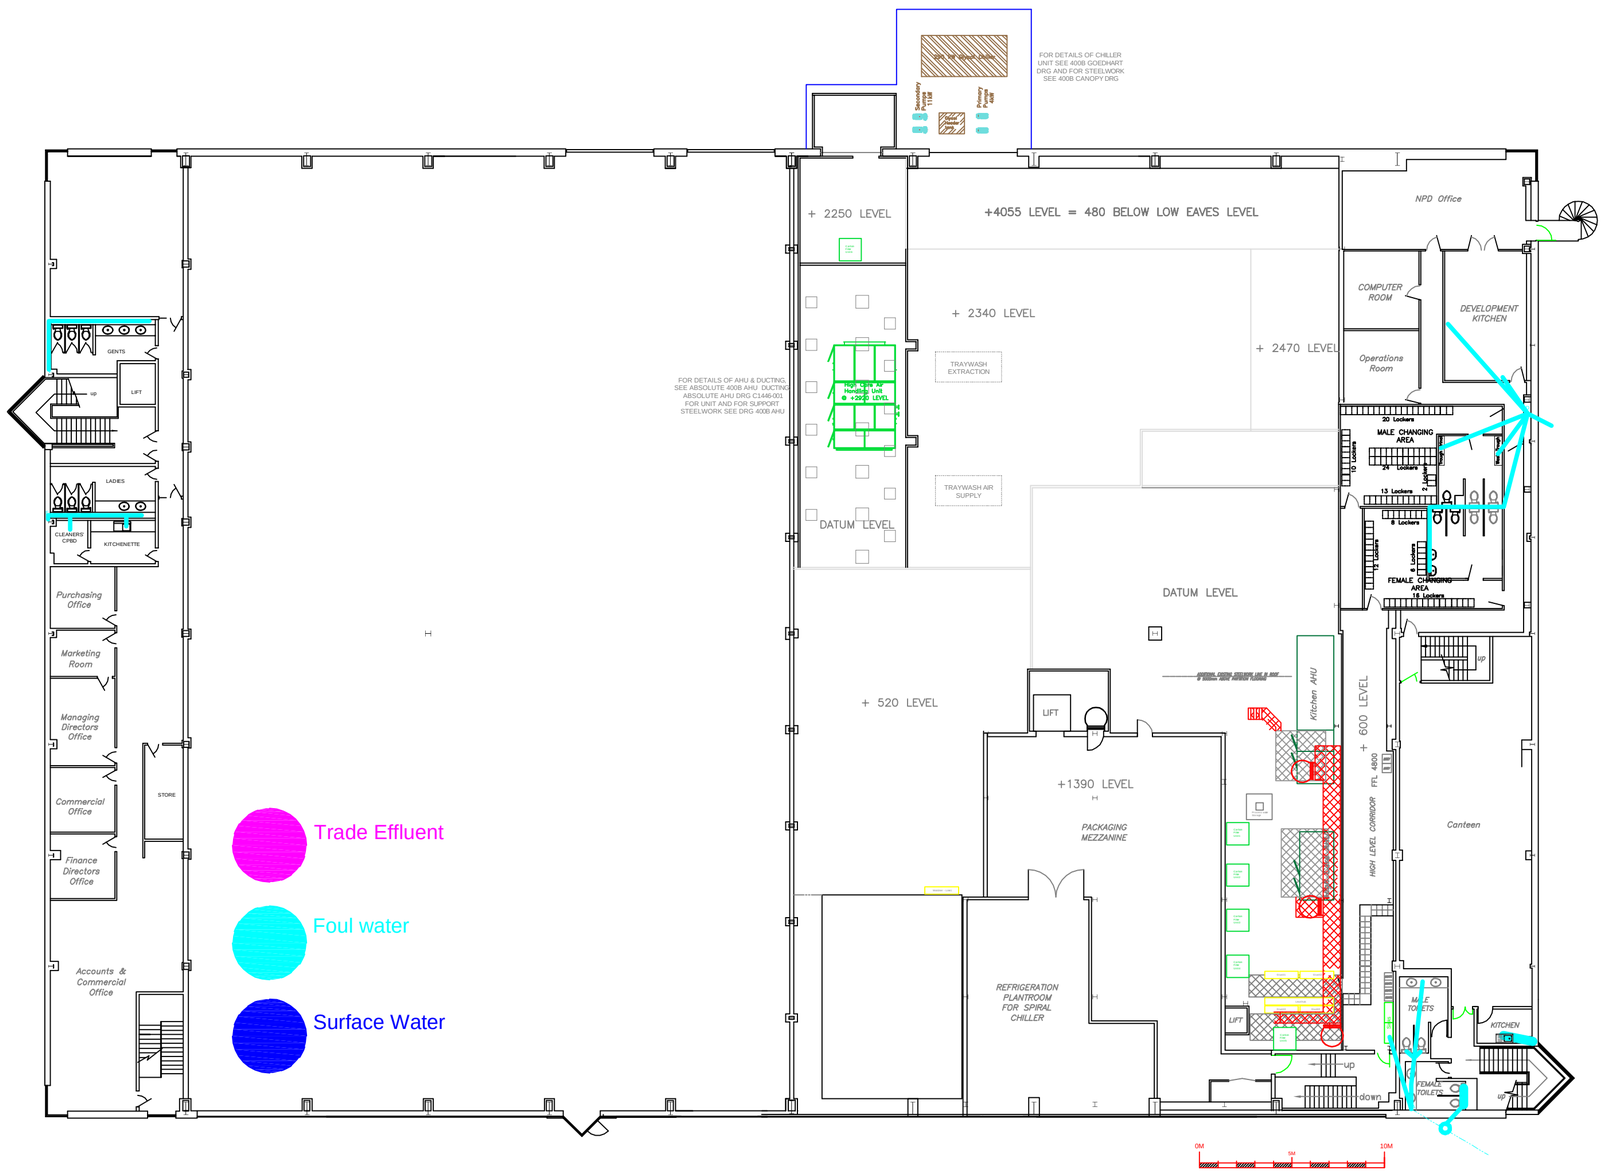
+ 2250 LEVEL
+4055 LEVEL = 480 BELOW LOW EAVES LEVEL
+ 2340 LEVEL
+ 2470 LEVEL
DATUM LEVEL
+ 520 LEVEL
+1390 LEVEL
PACKAGING MEZZANINE
REFRIGERATION PLANTROOM FOR SPIRAL CHILLER
NPD Office
COMPUTER ROOM
DEVELOPMENT KITCHEN
Operations Room
MALE CHANGING AREA
FEMALE CHANGING AREA
Canteen
KITCHEN
Purchasing Office
Marketing Room
Managing Directors Office
Commercial Office
Finance Directors Office
Accounts & Commercial Office
Trade Effluent
Foul water
Surface Water

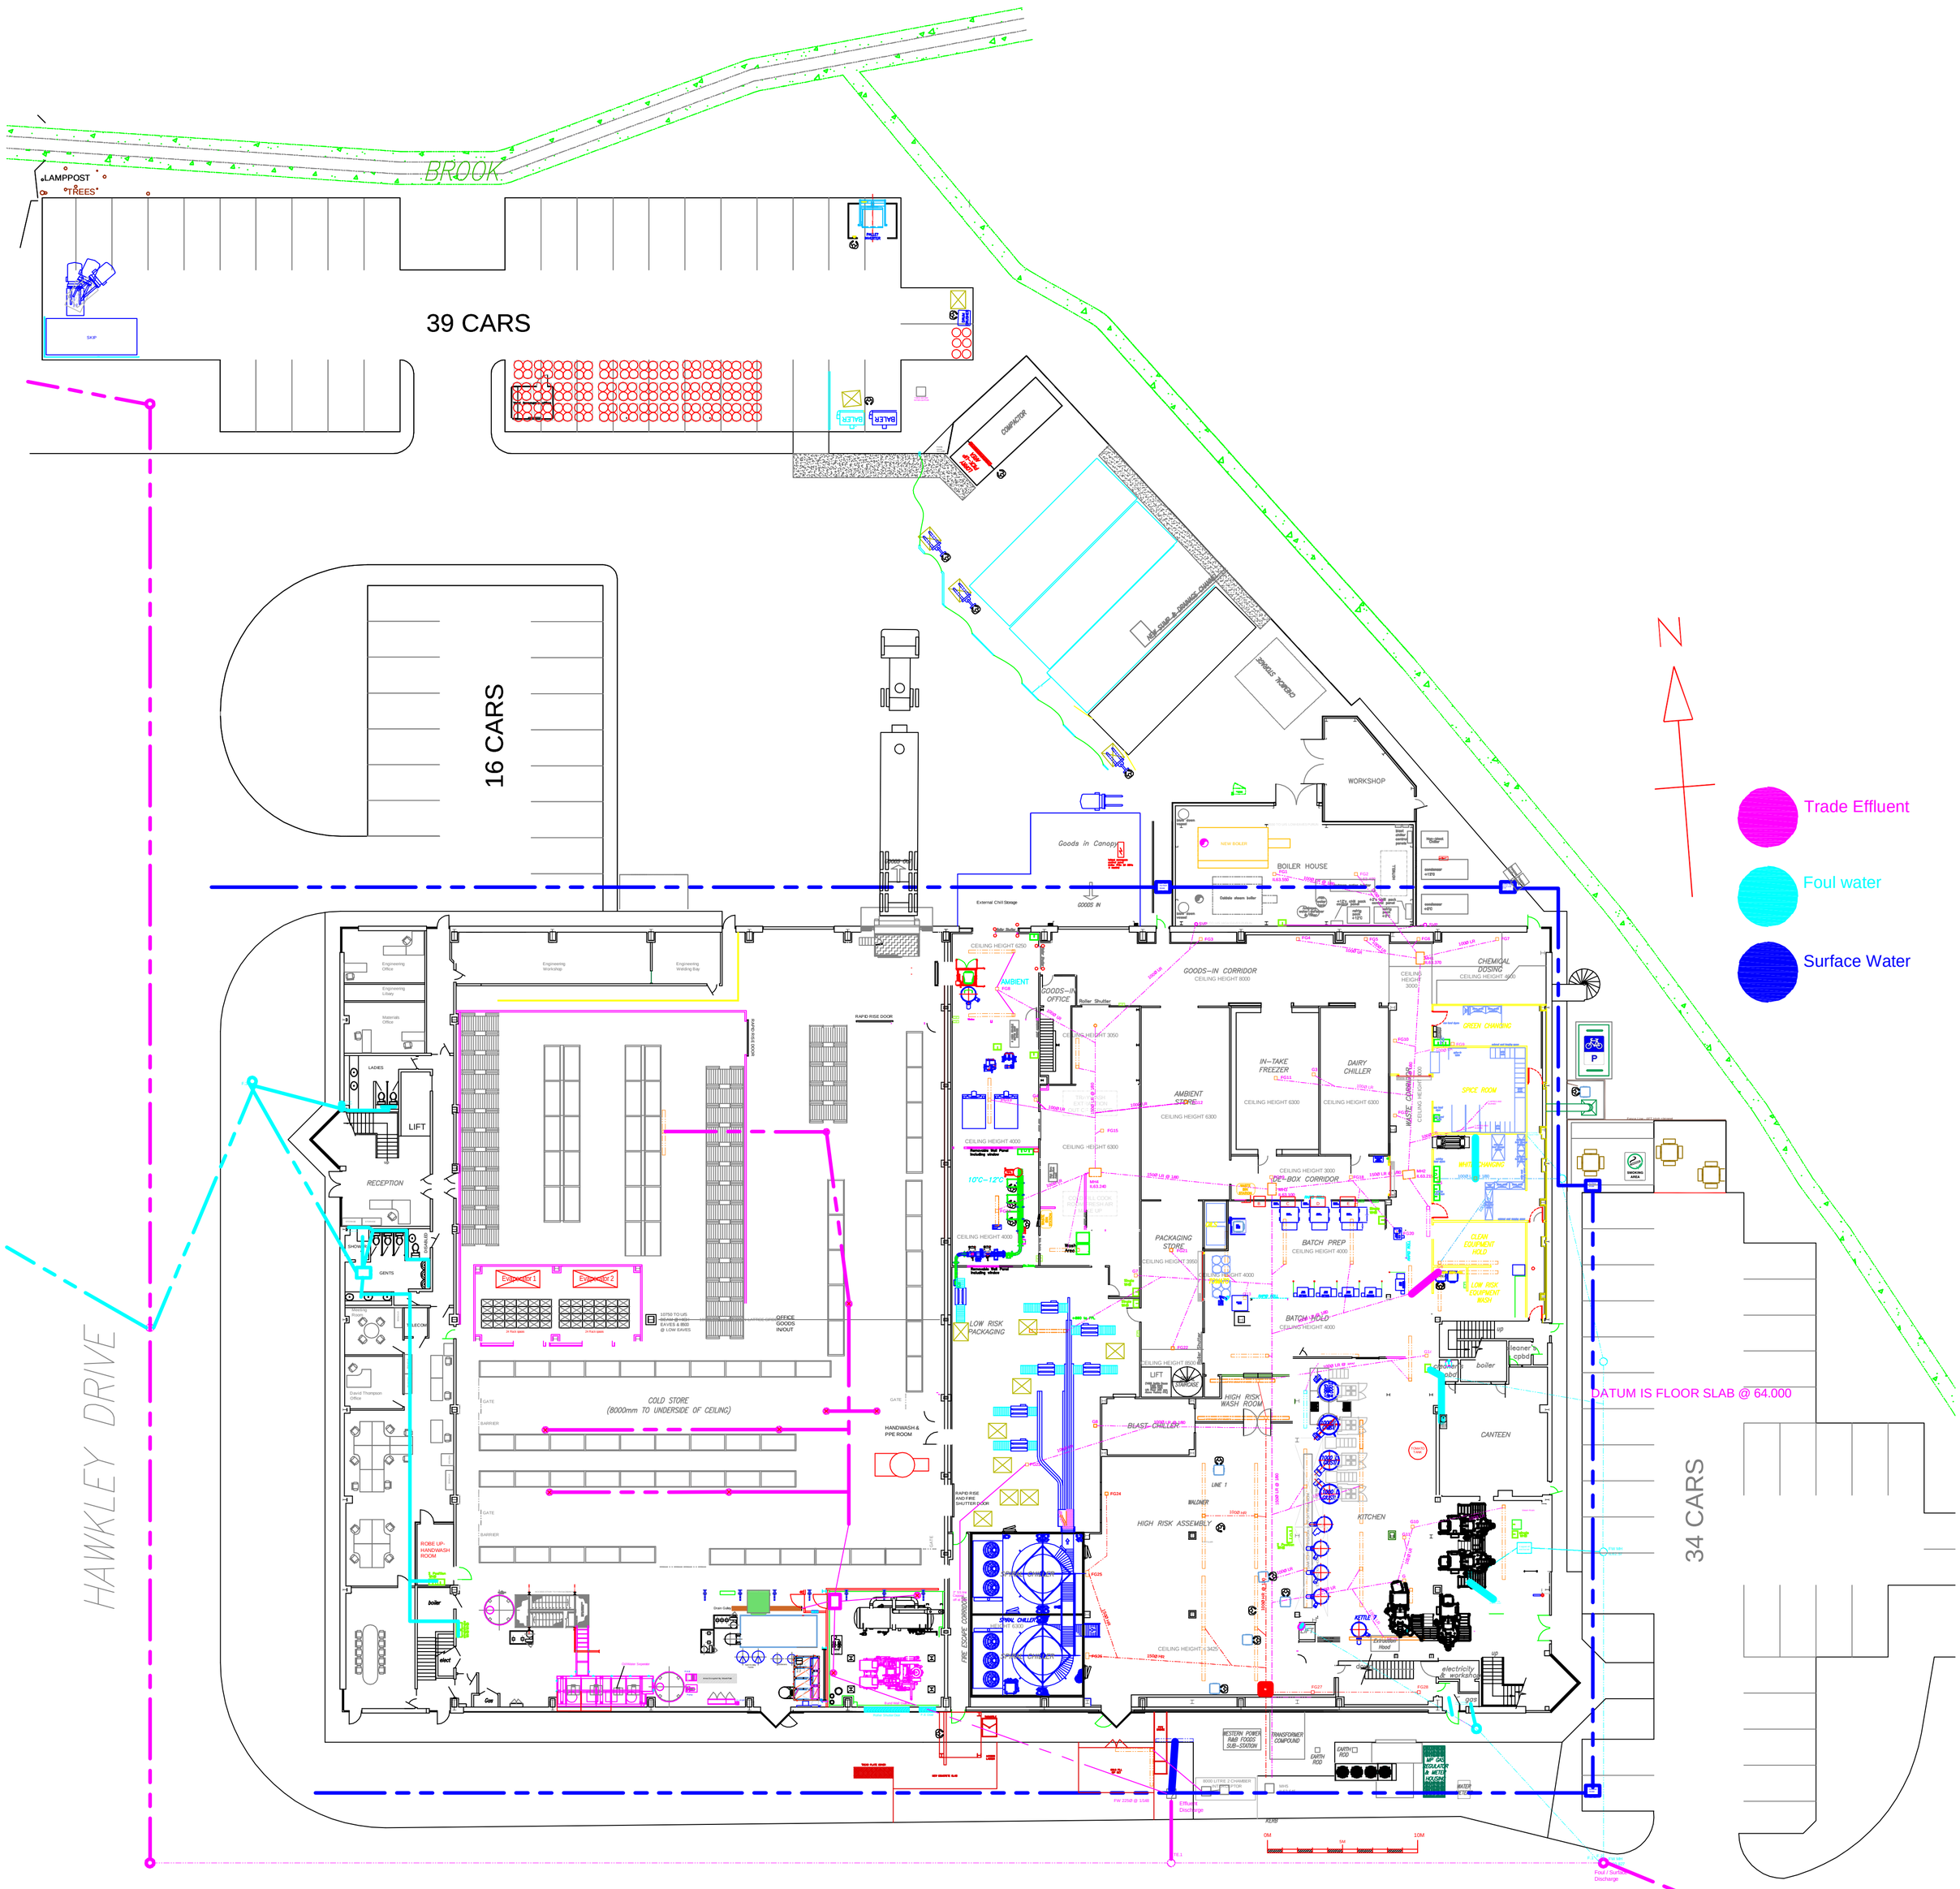
BROOK
39 CARS
16 CARS
34 CARS
HAWKLEY DRIVE
WORKSHOP
BOILER HOUSE
Goods in Canopy
GOODS IN
GOODS-IN CORRIDOR
CHEMICAL DOSING
IN-TAKE FREEZER
DAIRY CHILLER
AMBIENT STORE
PACKAGING STORE
BATCH PREP
BATCH HOLD
CANTEEN
KITCHEN
RECEPTION
COLD STORE (8000mm TO UNDERSIDE OF CEILING)
HIGH RISK ASSEMBLY
BLAST CHILLER
HIGH RISK WASH ROOM
LOW RISK PACKAGING
DATUM IS FLOOR SLAB @ 64.000
Trade Effluent
Foul water
Surface Water