



HRG-ODC-03-WWT -
Simplified Water Process
Flow Diagram - Pumps,
Valves, Mixers Omitted


Discharge to
Humber Estuary via
pipeline under
consent and
Environmental
permit

Tankered offsite to
3rd party WWT
Works or Treatment
Plant



Non-potable
Anglian Water
Supply


12 - HTTT BUILDING

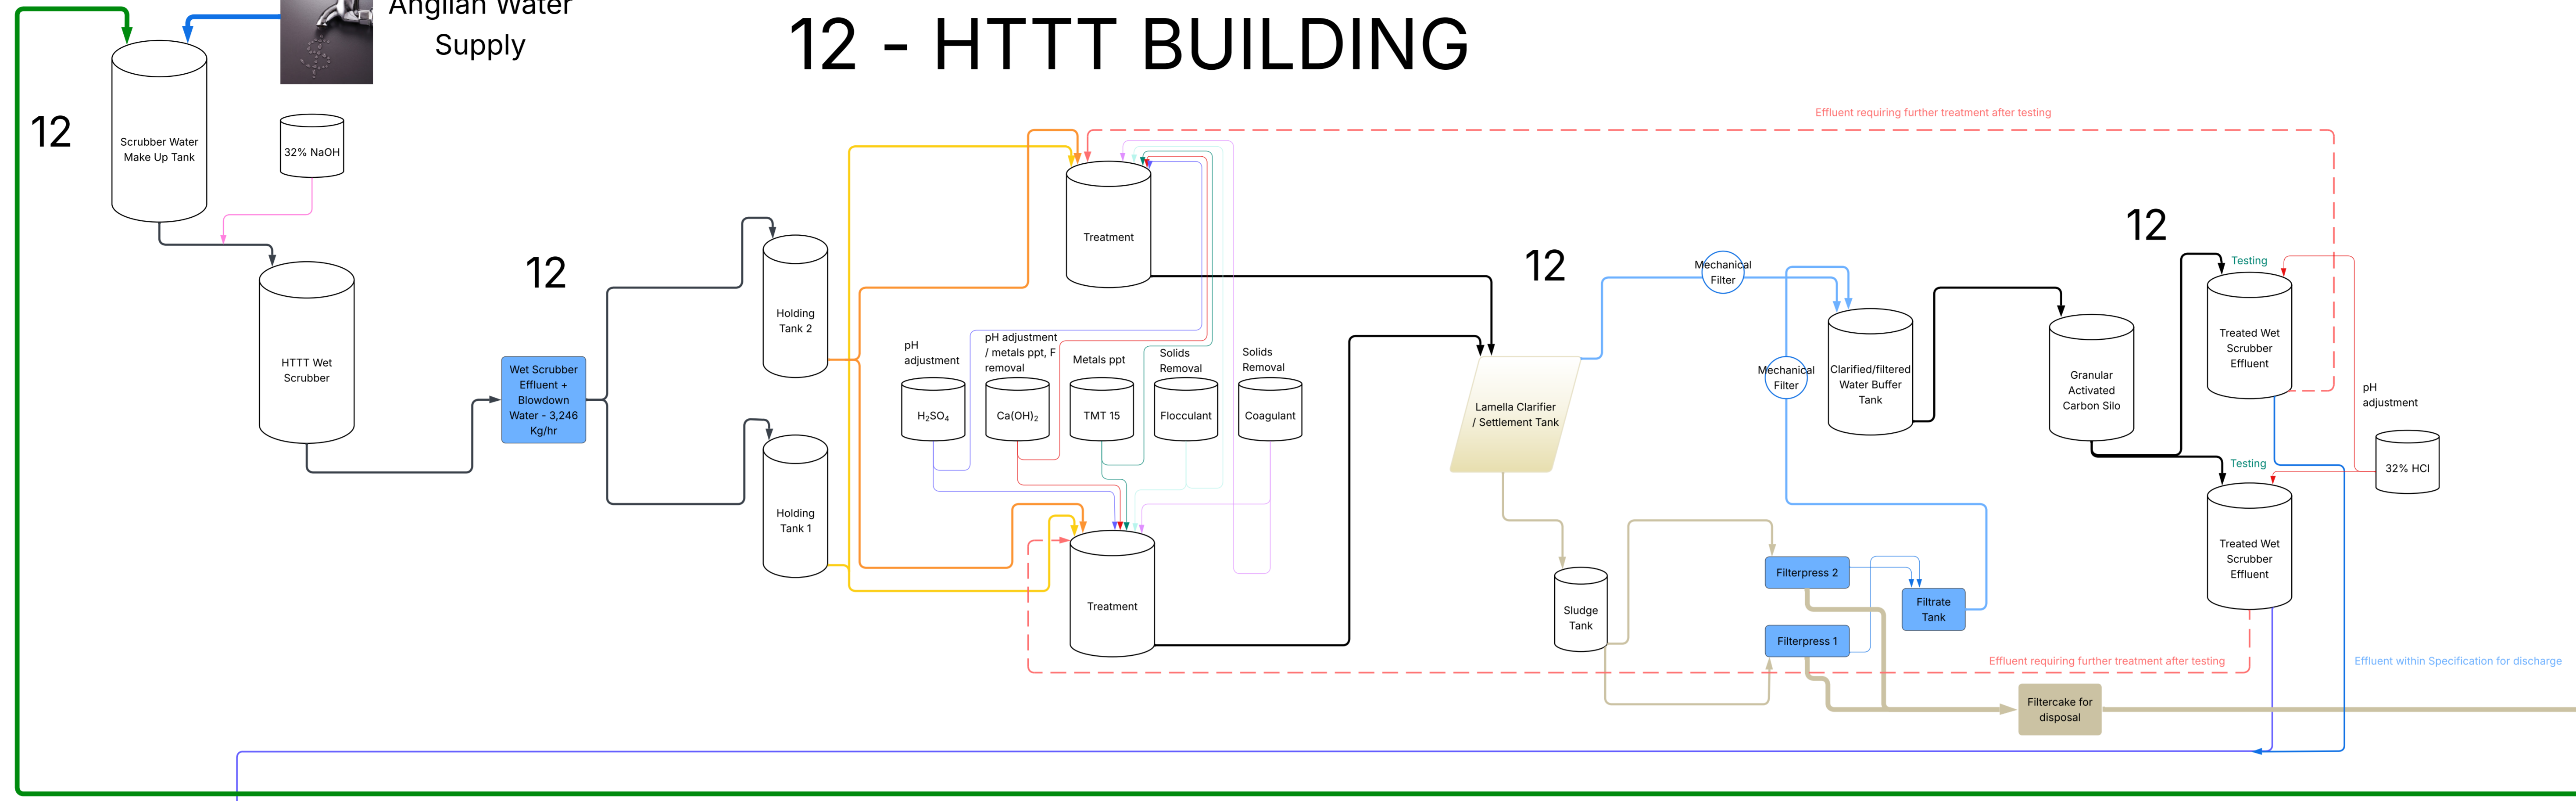

Transfer to third party
Haz Landfill / Treatment
Process 19 01 05* in
Ro-Ro/Artic Tipper

29 - Ash &
Air Pollution
Control Residues
Building

2 - WATER TREATMENT BUILDING

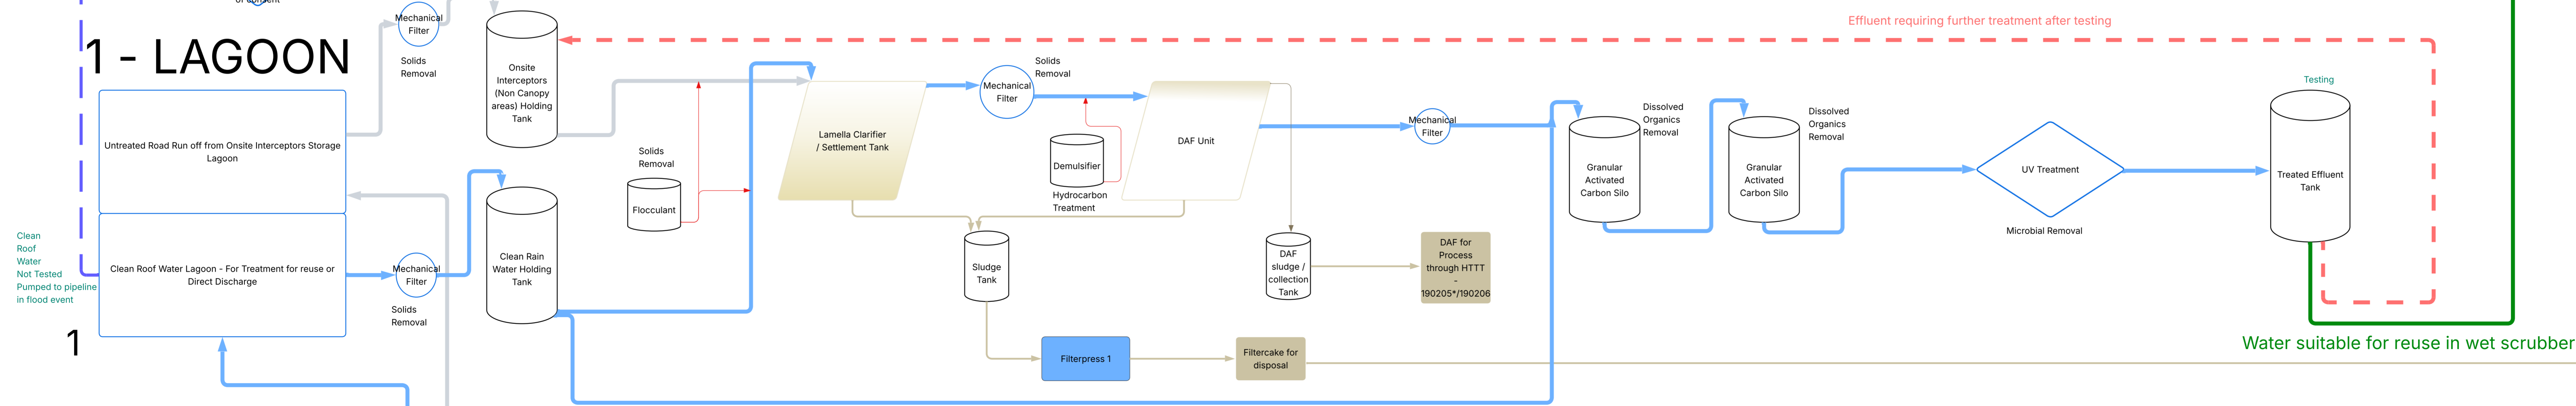

Water suitable for reuse in wet scrubber

Water from 4 x
Onsite 3-Stage
Interceptors from
roadways / non process
areas / Non-Canopy
Rainwater
Harvesting from all
Canopies / Roofs - 4
local tanks - Local 1mm
rotary drum screens on
all roof water

All HTTT
Rainfall



1

2

12

12