

DO NOT SCALE



HEALTH AND SAFETY GUIDANCE NOTES

RESIDUAL HEALTH AND SAFETY RISK

- H01.
- H02.
- H03.
- H04.
- H05.

RESIDUAL ECOLOGICAL RISK

- E01.
- E02.
- E03.
- E04.
- E05.

REFER TO THE PROJECT HAZARD SUMMARY SHEET FOR FURTHER DETAILS OF RESIDUAL RISKS

NOTES

- THE DRAWING IS INTENDED AS A GUIDE ONLY TO REFLECT AQUABIO'S REQUIREMENTS.
- ANY QUERIES SHOULD BE DIRECTED TO THE AQUABIO DESIGN OFFICE.
- ALL LEVELS AND DIMENSIONS SHOWN ARE TO BE USED FOR GUIDANCE ONLY.
- ALL DIMENSIONS ARE IN mm.
- THE MECHANICAL INSTALLATION (M.I.) CONTRACTOR IS RESPONSIBLE FOR CONDUCTING THEIR OWN SITE SURVEY PRIOR TO FABRICATION, ASSESSING SITE CONDITIONS AND FABRICATING TO THEIR OWN MEASUREMENTS, CUTTING ALLOWANCE TO BE BUILT INTO PIPEWORK WHERE APPLICABLE AND FINAL LENGTHS TO BE DETERMINED ON SITE BY M.I. CONTRACTOR.
- ANY PIPE SUPPORTS SHOWN ARE INTENDED AS A GUIDE ONLY. THE M.I. CONTRACTOR IS RESPONSIBLE FOR THE FINAL DESIGN, FABRICATION, QUANTITY & POSITIONING OF ALL SUPPORTS.
- FLANGE POSITIONS ARE INDICATED FOR GUIDANCE ONLY - FINAL POSITIONS TO BE DETERMINED BY THE M.I. CONTRACTOR.
- ALL PIPEWORK AND FABRICATIONS ARE TO BE SMOOTH AND FREE FROM BURRS.
- ELECTRICAL INSTALLER TO UNDERTAKE SITE SURVEY PRIOR TO FABRICATION TO CONFIRM ACCESS ROUTES AND DESIGN FEASIBILITY.
- CABLE LADDER TRAY ROUTES ARE INDICATIVE ONLY. FINAL DESIGN AND ROUTE TO BE CONFIRMED BY ELECTRICAL INSTALLER ON-SITE FOLLOWING SITE SURVEY.

PIPEWORK
ALL PIPEWORK TO BE SS 316 (UNLESS OTHERWISE NOTED)

GLASS COATED STEEL TANKS
EXTERNAL COLOUR: RAL6005 GREY OLIVE

SPECIFICATION
REFER TO AQUABIO MECHANICAL INSTALLATION SPECIFICATION (M.I.S. REV 6)

HOLDS

- AREA SHOWN IN CLOUD AS PROVISIONAL SUM IS SUBJECT TO CHANGE. FINAL DETAILS TO BE CONFIRMED.
- ROAD DESIGN TO BE REVIEWED BY CIVILS AND SUITABILITY FOR VEHICULAR ACCESS, UNLOADING, LOADING AND EGRESS CONFIRMED. OVERALL SITE DIMENSIONS TO BE CONFIRMED IN LINE WITH THIS.
- CHEMICAL DELIVERY AREA DESIGN TO BE CONFIRMED BY CIVILS.
- EXISTING PIPE BRIDGE DETAILS TO BE CONFIRMED.



FOR INFORMATION

Rev. No.	Revision Notes	Date	By	Approved
3	DESIGN ISSUE LATEST SUPPLIER INFORMATION ADDED	31/03/2023	AH	DT
2	DESIGN ISSUE LATEST SUPPLIER INFORMATION ADDED	13/03/2023	AH	DT
1	DESIGN ISSUE OCU REMOVED	07/02/2023	AH	DT
0	ISSUED FOR INFORMATION	30/10/2022	ANF	DT

Aquabio Limited
Ball Mill Top Business Park, Hallow,
Worcester, WR2 6LS
Tel:- +44(0) 1905 641966
email:- info@aquabio.co.uk


Aquabio Ltd is part of the Freudenberg
Technology group of companies

This document contains proprietary information and is the property of Aquabio Ltd. It shall not be copied, reproduced, transmitted or in any other way disseminated without the prior written permission in writing of Aquabio Ltd.
Aquabio Ltd - Registered No 3279754 England

Client: LENZING FIBRES, GRIMSBY

Site Plan

Model Number: FEDERATED MODEL	Drawing No: J6285 - GA001	Rev: 3	Sheet: 1	Scale: 1:200	A1
-------------------------------	---------------------------	--------	----------	--------------	----

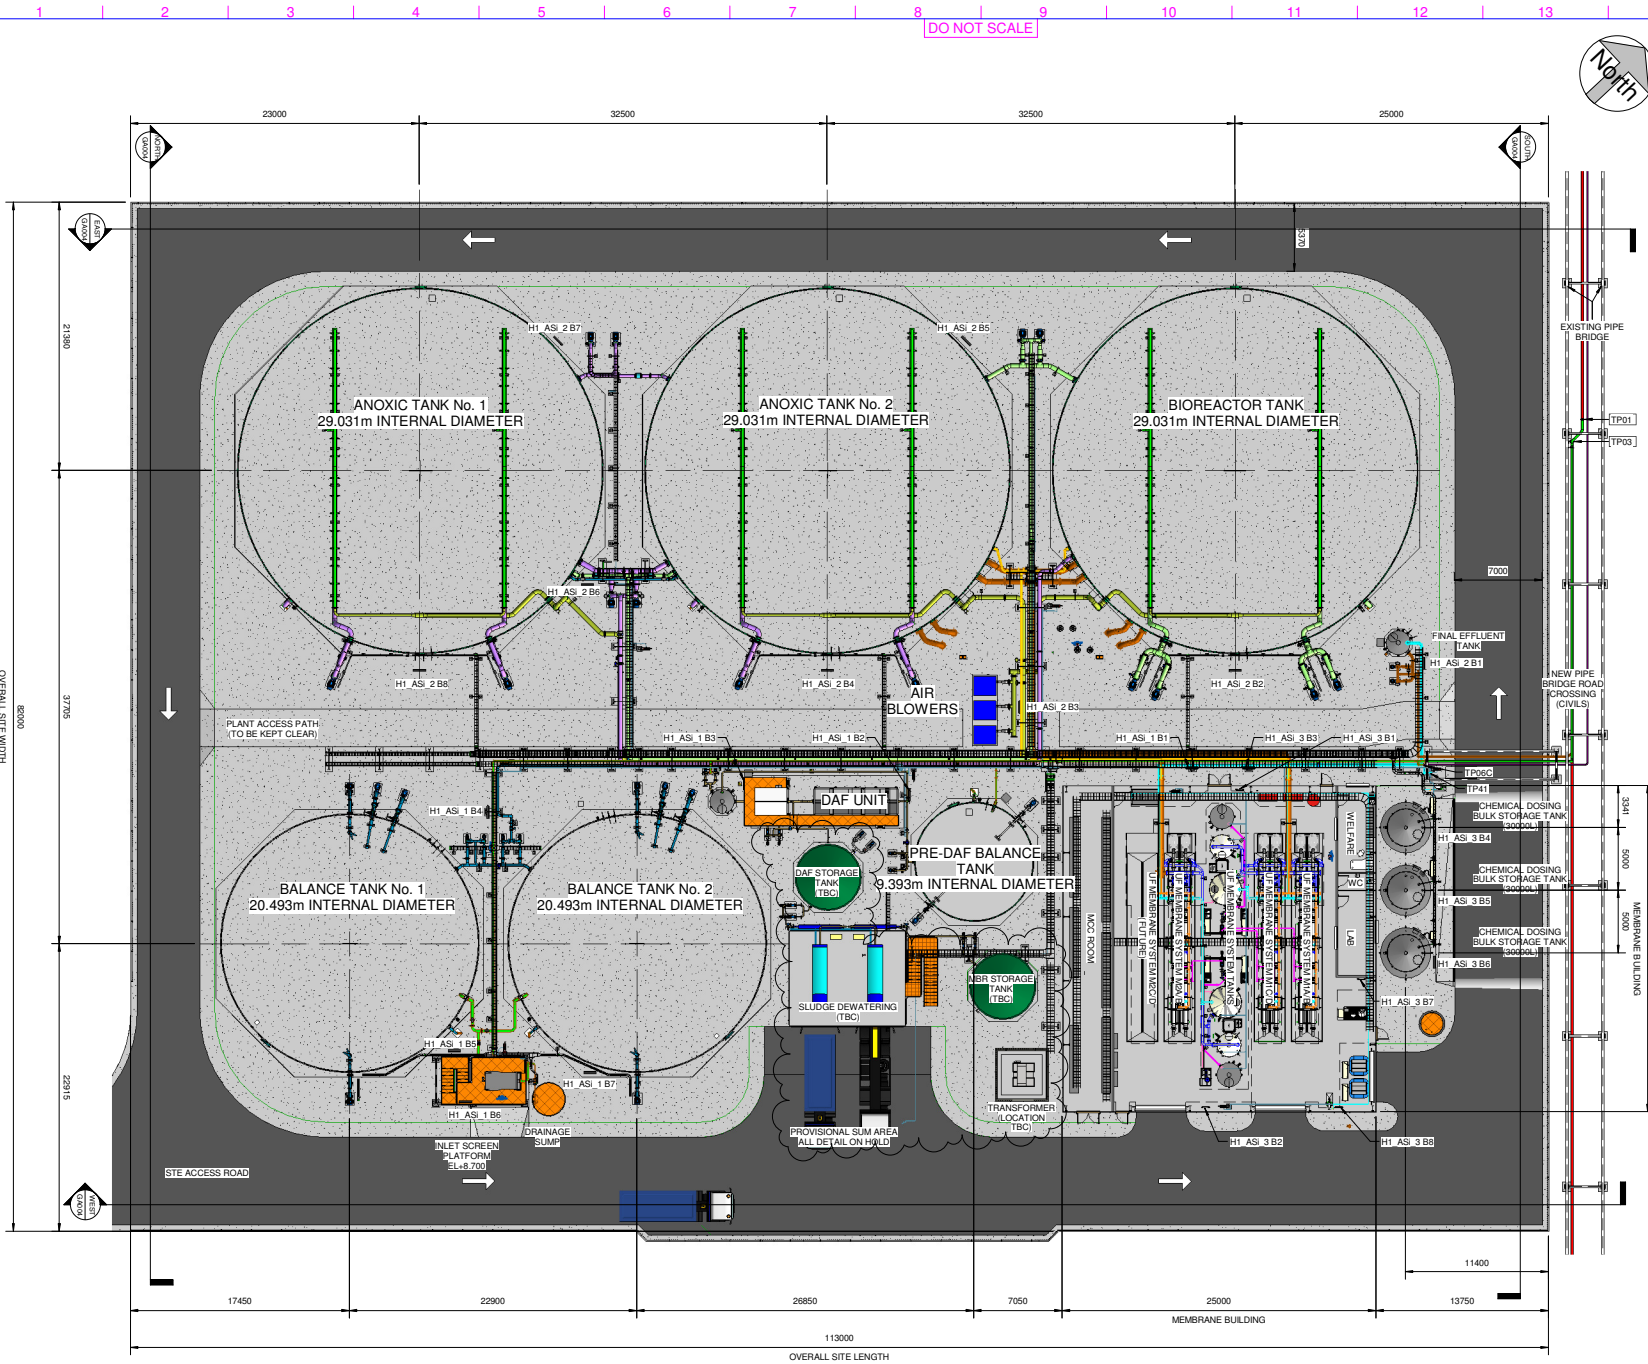

Overall Site Width: 80000

Overall Site Length: 113000

Membrane Building: 11400