



- KEY:**
- Installation Boundary
 - Tanks Excluded from Permit Scope
 - Air Emission Point
 - Liquor Transfer Point
 - Return Liquor Sampling Point

- A1 - CHP Engine 1
- A2 - Boiler 1
- A3 - Boiler 2
- A4 - Emergency Flare
- A5 - Biogas Holder PRV
- A6 - Primary Digester PRV
- A7 - Primary Digester PRV
- A8 - Emergency Flare
- A9 - Biogas Holder PRV
- T1 - Primary Sludge Dewatering Liquors, SAS Thickening Liquors, Biogas Condensate, Surface Water Run Off
- T2 - Digested Sludge Dewatering Liquors, Surface Water Run Off
- T3 - Head of Works Imports, Surface Water Run Off
- S1 - Primary Sludge Dewatering Liquors, SAS Thickening Liquors, Biogas Condensate, Surface Water Run Off
- S2 - Digested Sludge Dewatering Liquors, Surface Water Run Off
- S3 - Head of Works Imports



P06	NOV. 2024	FOR INFORMATION	AR	MM	JK	MM
P05	NOV. 2023	FOR INFORMATION	LC	MM	JK	MM
P04	OCT. 2023	FOR INFORMATION	LC	MM	JK	MM
P03	OCT. 2023	FOR INFORMATION	LC	MM	JK	MM
Rev	Rev. Date	Purpose of revision	Drawn	Checked	Rev'd	Apprv'd

Jacobs
 Jacobs House, Shrewsbury Business Park, SY2 6GG
 Tel: +44(0)1743 284 8000 Fax: +44(0)1743 284 800
 www.jacobs.com

Client

Project
**STC IED PERMIT
 AYLESBURY STW**


Drawing title
**FIGURE 2
 INSTALLATION BOUNDARY
 AND AIR EMISSION POINTS**

Drawing status
PERMITTING

Scale
 1:2000 @A3
 DO NOT SCALE

Jacobs No. B22849AZ
 Client no. P06

Drawing number
B22849AZ-JAC-ABY-DR-0002

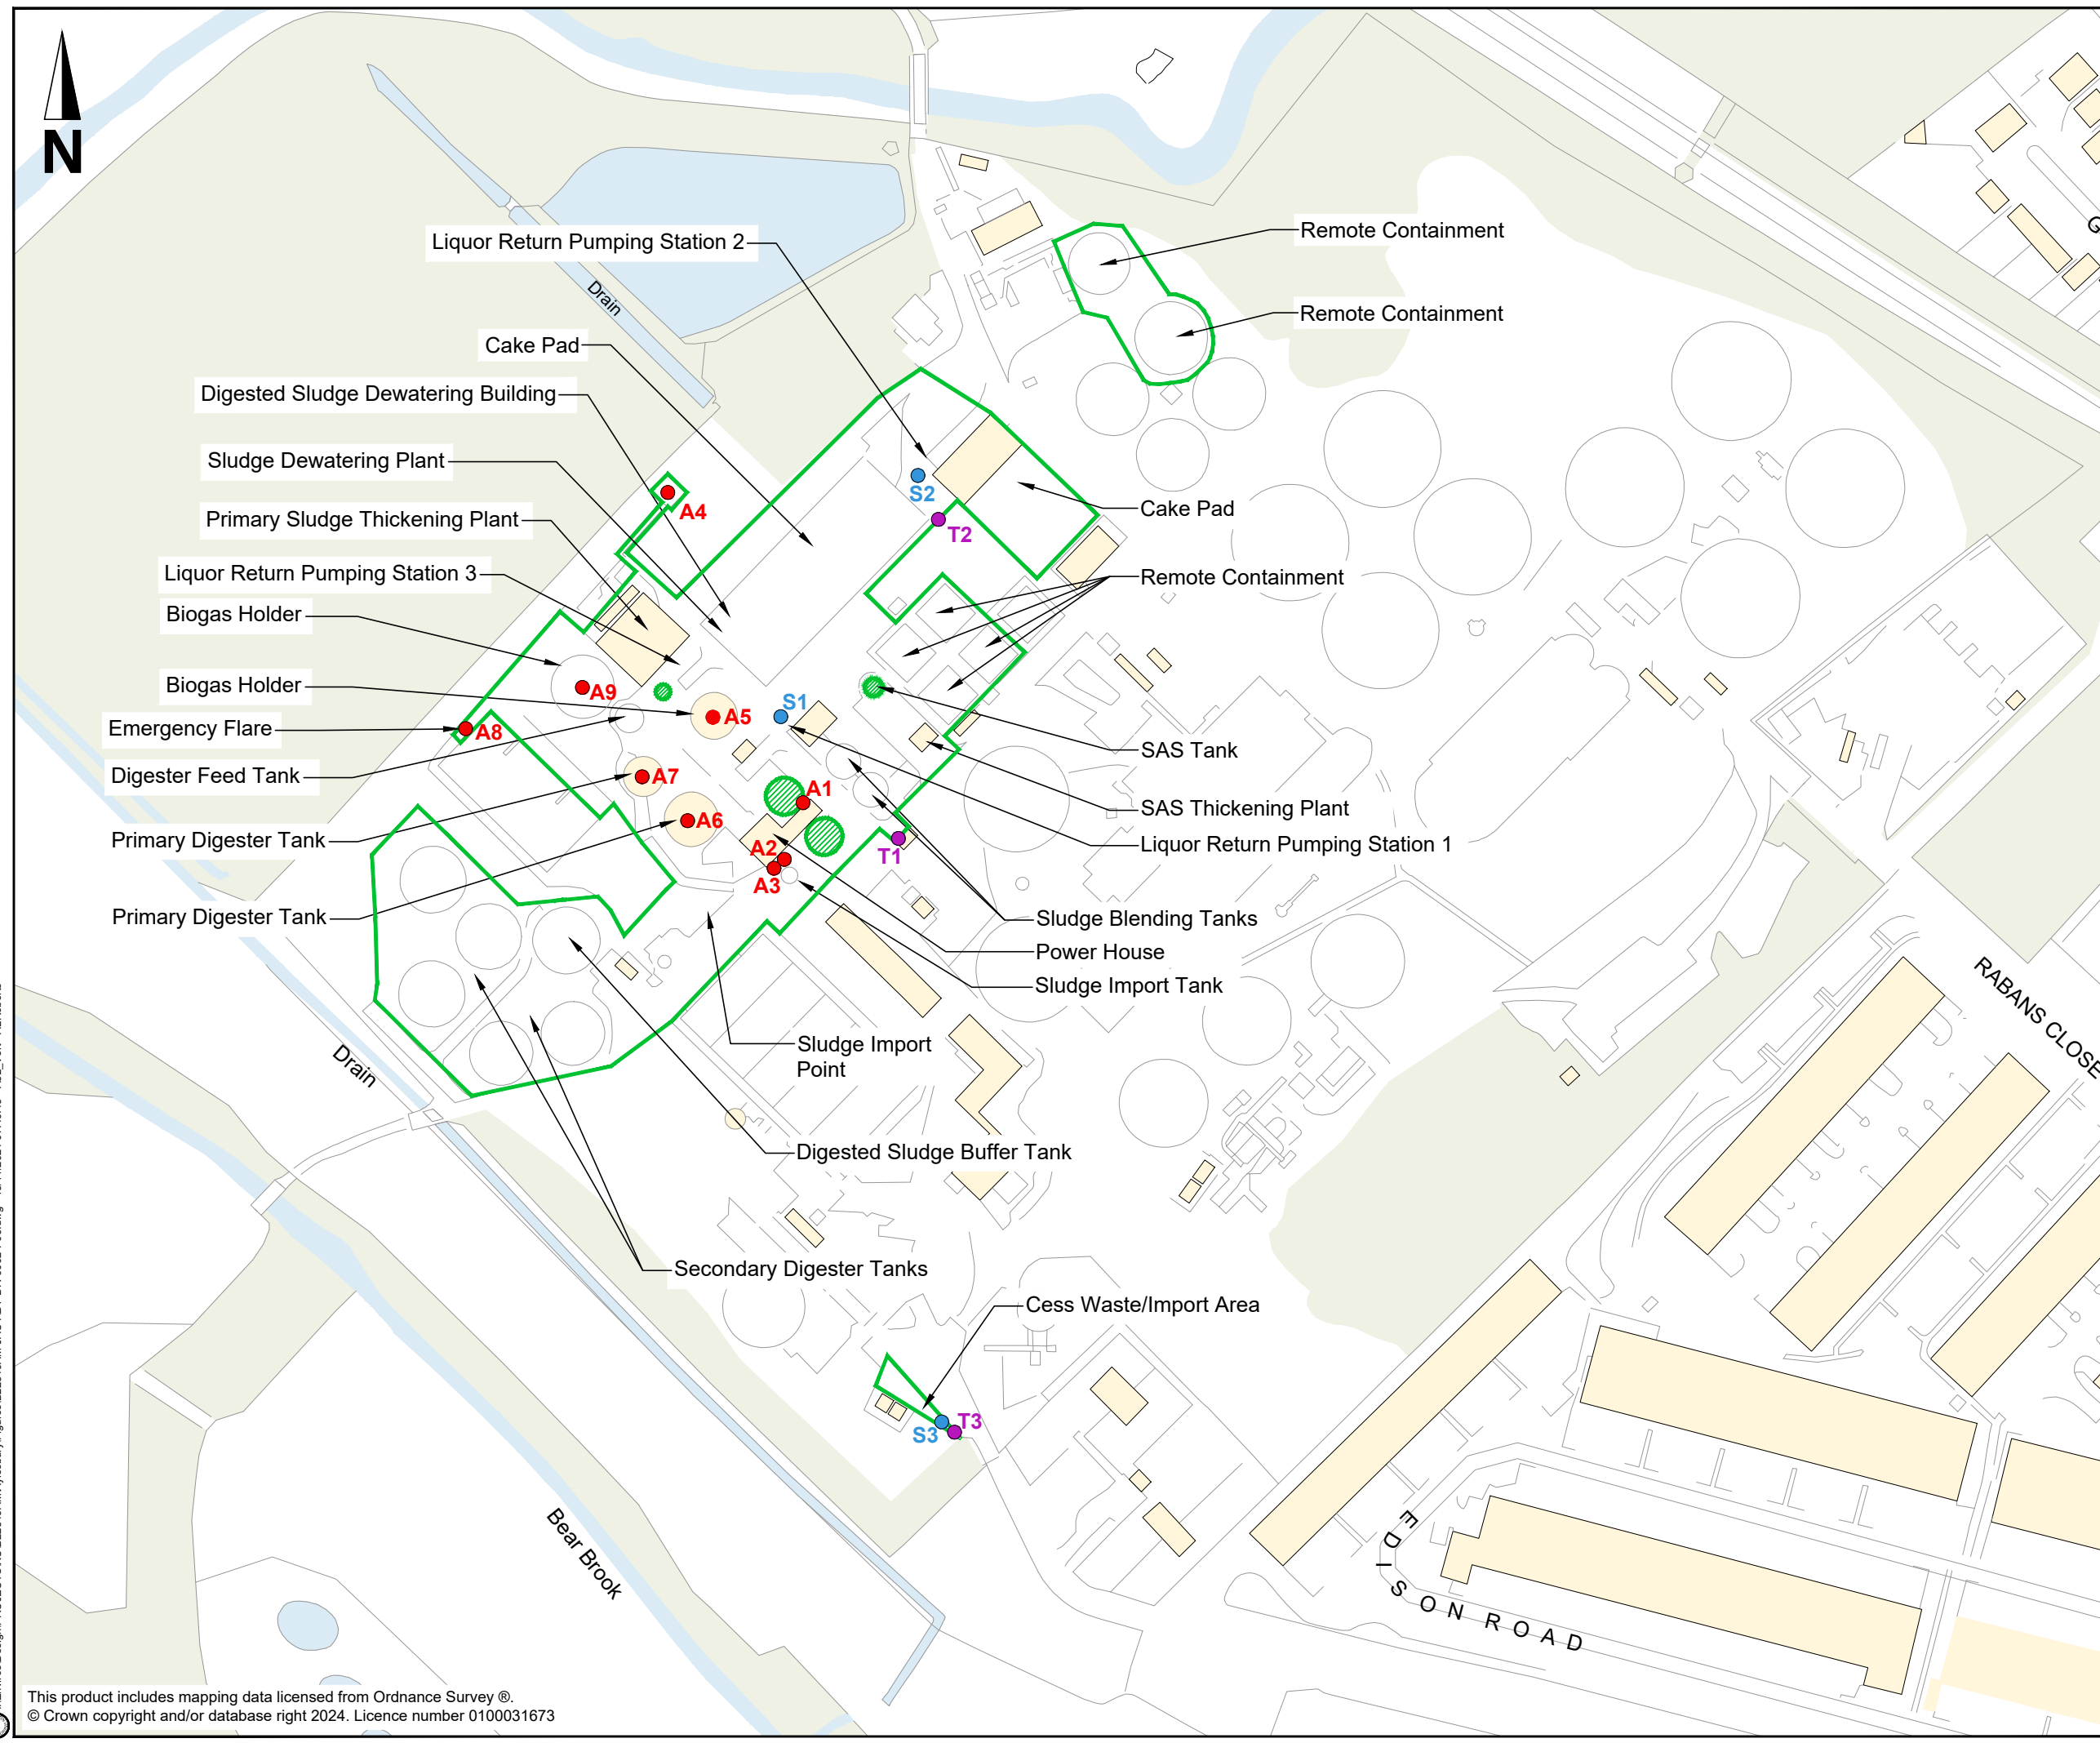

I:\enviros\Design\PROJECTS\KUIB22849A\Aylesbury\Figures\B22849AZ-JAC-ABY-DR-0002-P06.dwg - 13/11/2024 07:49:43 - A3_Vent - AL.Roberts