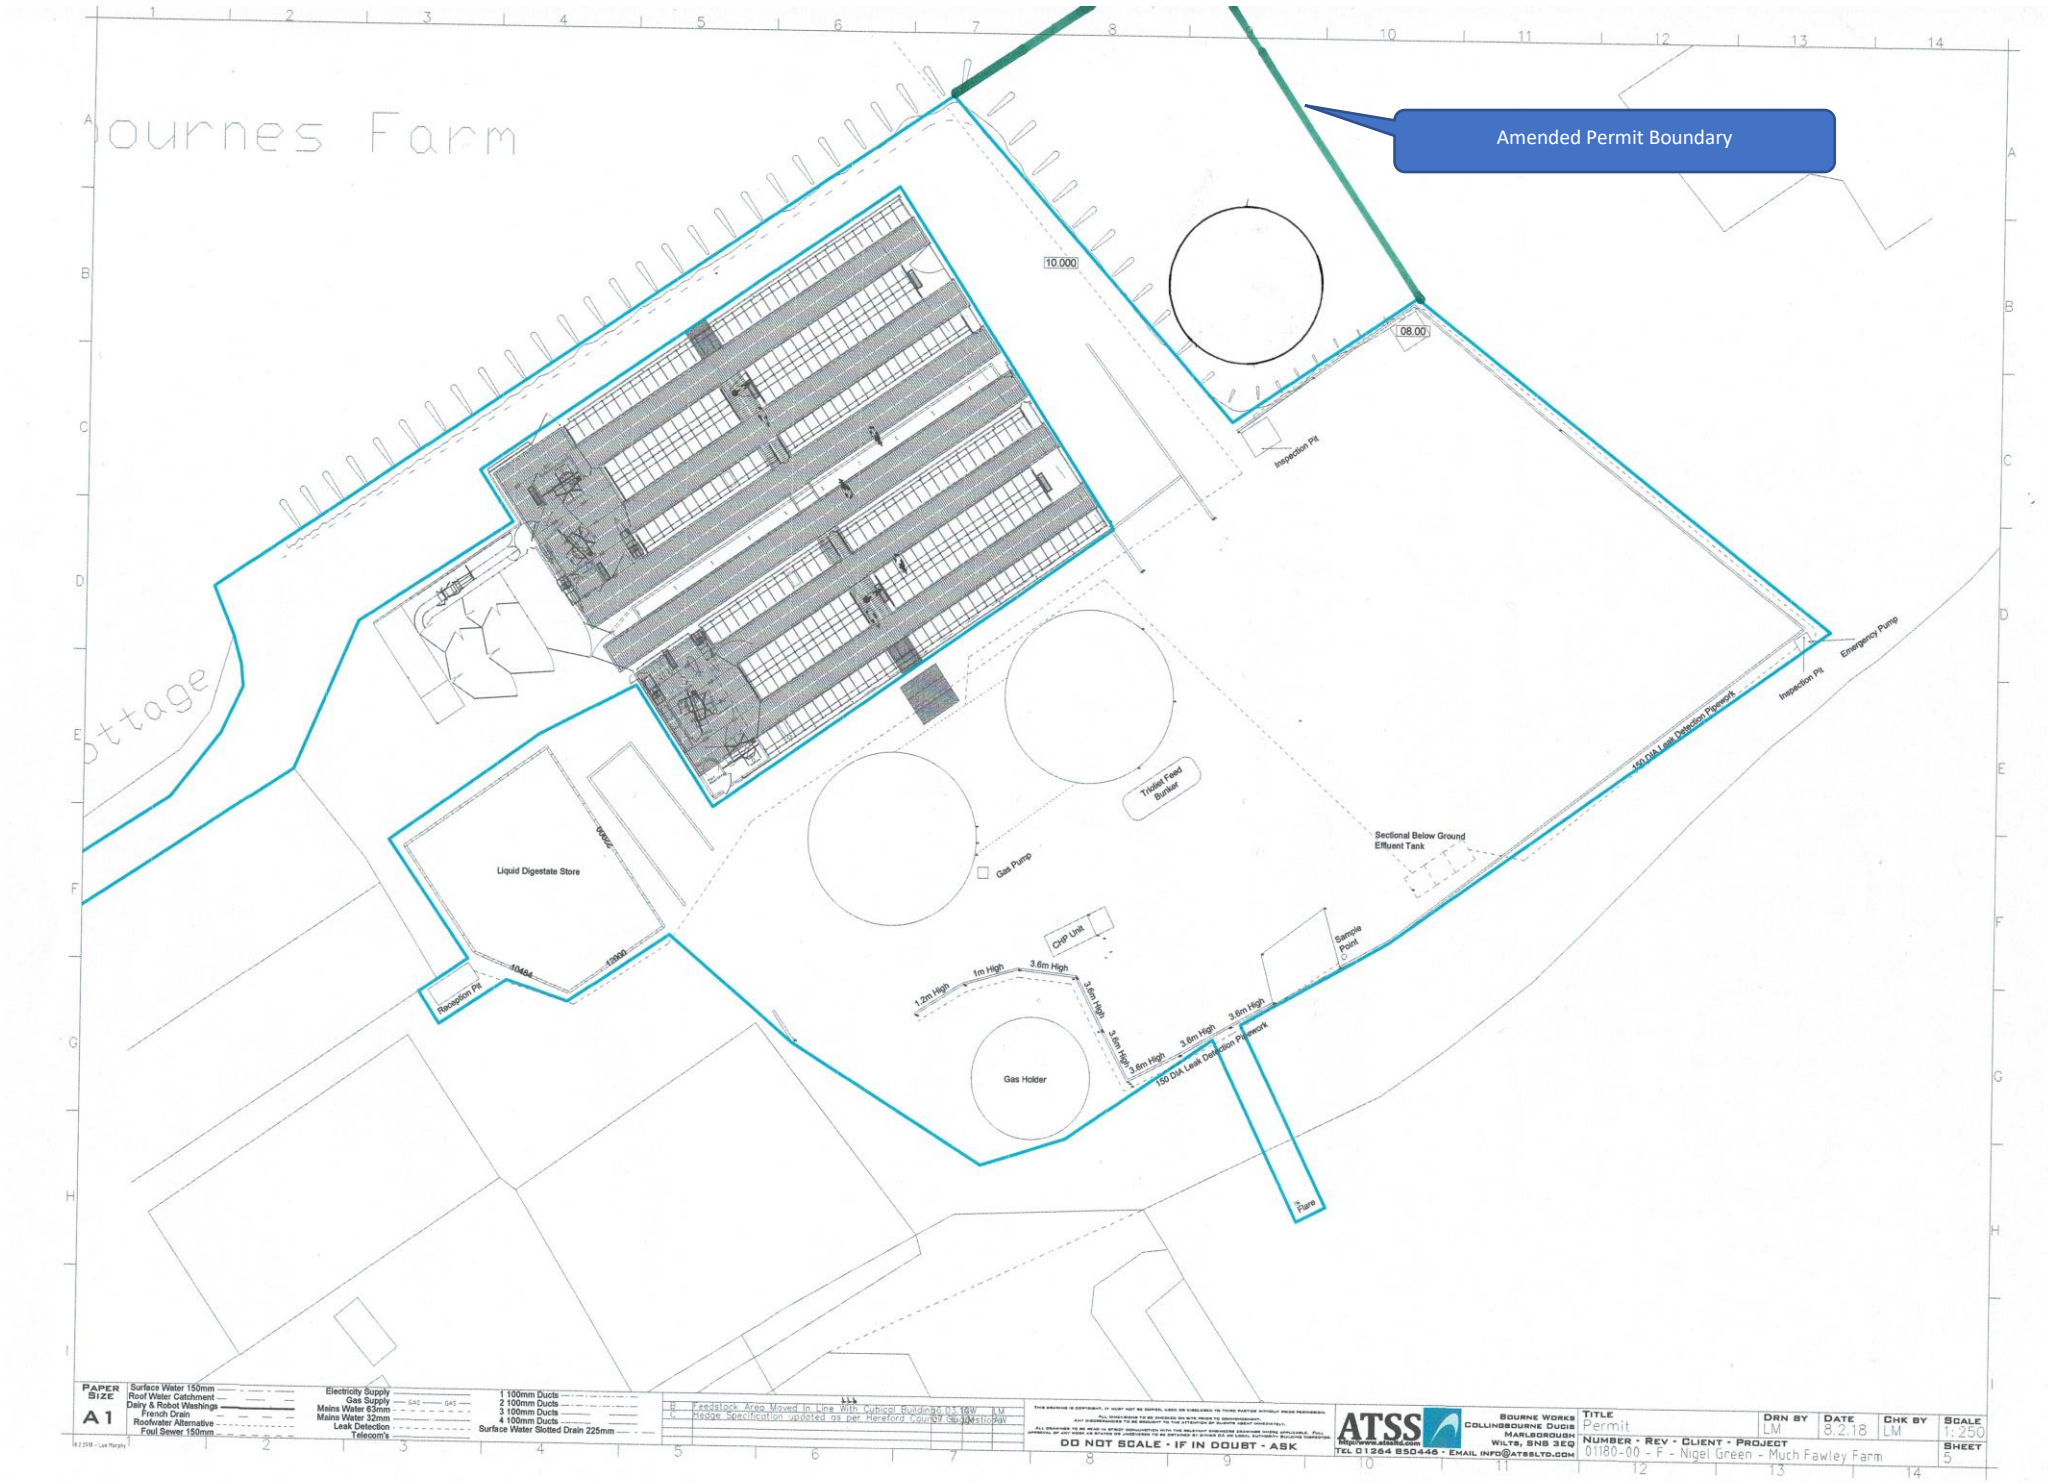
Amended Permit Boundary
Liquid Digestate Store
Reception Pit
Inspection Pit
Trident Feed Burtiser
Gas Pump
CHP Unit
Sample Point
Sectional Below Ground Effluent Tank
Emergency Pump
150 DIA Leak Detection Pipework
Gas Holder
Flare
10.000
08.00
1.2m High
1m High
3.6m High
3.6m High
3.6m High
3.6m High
3.6m High
3.6m High
Surface Water 150mm
Roof Water Catchment
Dairy & Robot Washings
French Drain
Roofwater Alternative
Foul Sewer 150mm
Electricity Supply
Gas Supply
Mains Water 63mm
Mains Water 32mm
Leak Detection
Telecom's
1 100mm Ducts
2 100mm Ducts
3 100mm Ducts
4 100mm Ducts
Surface Water Slotted Drain 225mm
B Feedstock Area Moved In Line With Cubicol Building 26.03.18 LM
A Sledge Specification updated as per Hereford County Council 16.10.17 LM
DO NOT SCALE - IF IN DOUBT - ASK
ATSS
Bourne Works
Collingbourne Ducis
Marlborough
Wilts, SN8 3EQ
Tel 01264 850446 - Email info@atsslto.com
PAPER SIZE A1
TITLE Permit
DRN BY LM
DATE 8.2.18
CHK BY LM
SCALE 1:250
NUMBER - REV - CLIENT - PROJECT 01180-00 - F - Nigel Green - Much Fawley Farm
SHEET 5