


INFORMATION
AIR HANDLING SYSTEM

- R1 = RETURN AIR DUCT, SPIRAL
- E1 = ALUZINC UNINSULATED
- E2 = RETURN AIR DUCT, SPIRAL
- E2 = ALUZINC UNINSULATED
- RD1 = RETURN AIR DUCT, RECTANGULAR
- DI1 = END CAP WITH NET, RETURN AIR
- OWL1 = OUTER WALL LOUVER
- FR1 = FAN, RETURN AIR

AIR FLOW ARE SHOWN IN m³/h
THE DUCT SYSTEM AND ALL COMPONENTS
SHOULD BE MOUNTED ACCORDING TO
THE MANUFACTURERS INSTRUCTION

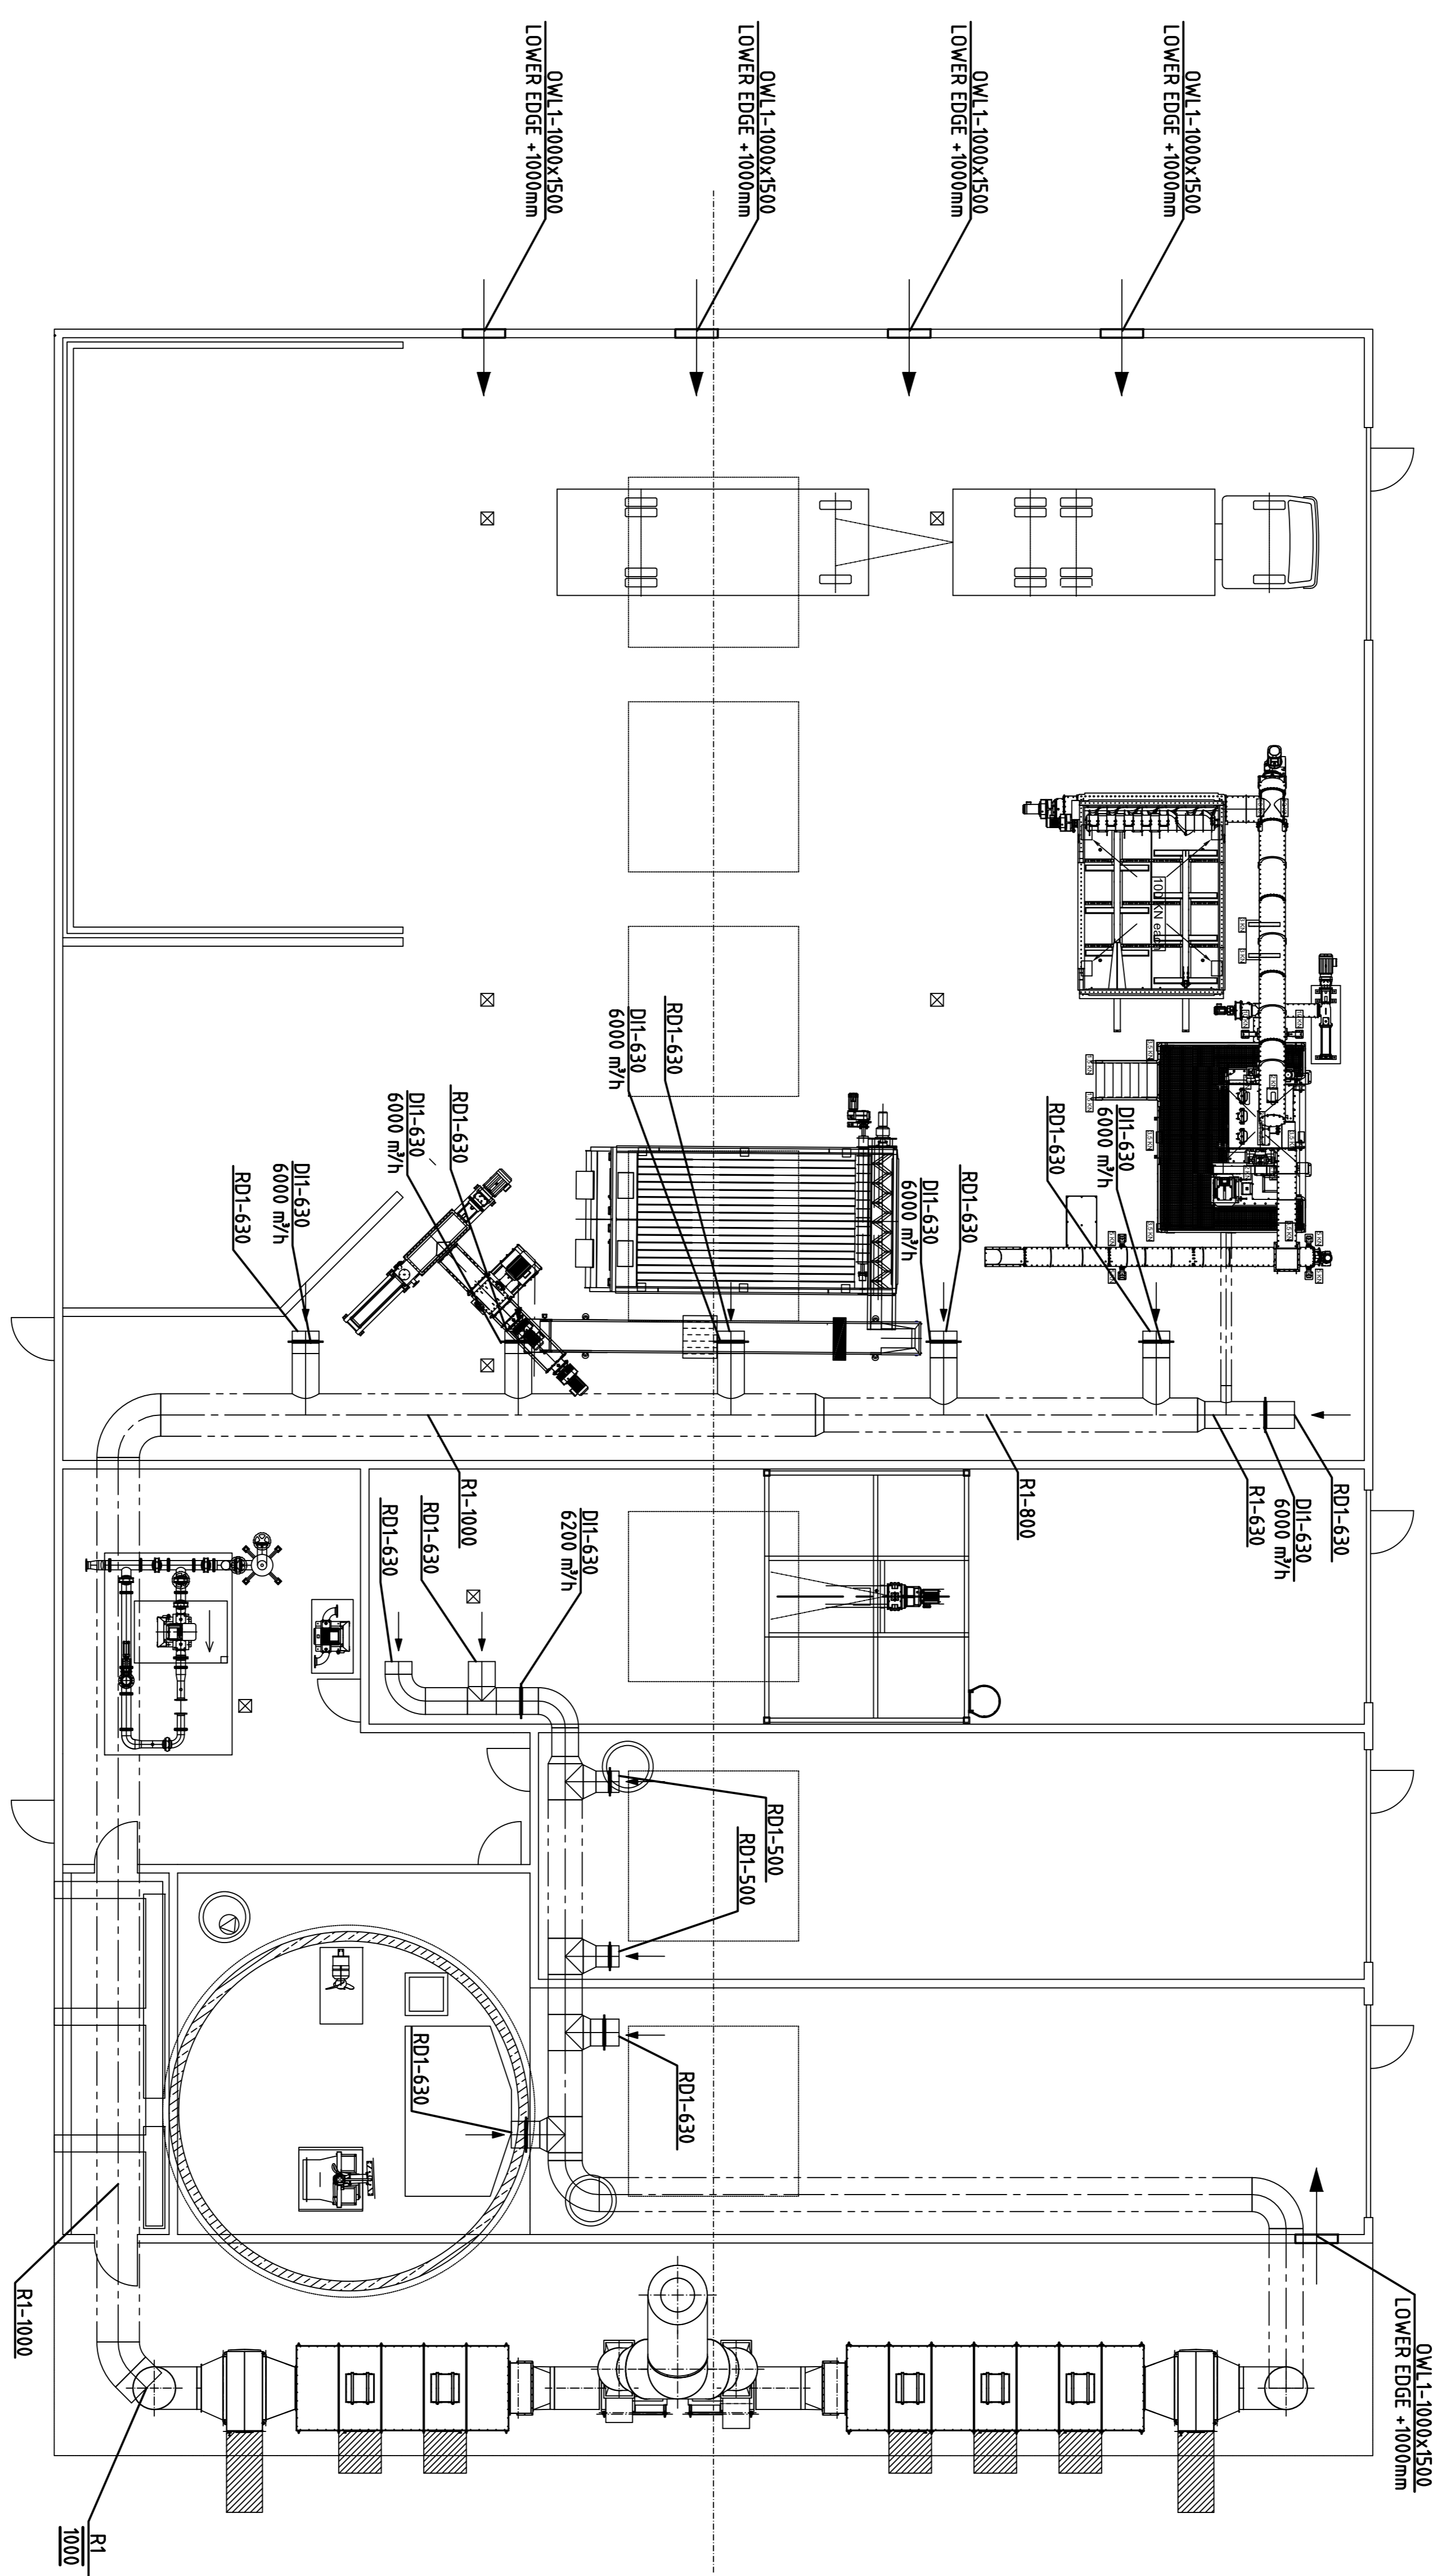

BET	ANT	ANDRINGS AVSER	DATUM	SIGN

CONSTRUCTION DOCUMENT

ENERGIPROJEKT AB
 VEDERHÄLLERSGÅRDEN 4A, 141 31 SVENSKERUDEN
 141 31 SVENSKERUDEN
 TEL: +46 (0)8 737 10 00
 FAX: +46 (0)8 737 10 01
 E-MAIL: info@energiprojekt.se
 WWW: www.energiprojekt.se

DATE	REVISION	HANDLEDIGARE
2019-07-2X <td>REVISION <td>OH </td></td>	REVISION <td>OH </td>	OH
BLÅISE AIR HANDLING SYSTEM DUCT INSTALLATIONS LAYOUT DRAWING SKA NUMBER (A1) 1:100 V-57.1-100		