


ALL INFORMATION ON THIS DRAWING IS INDICATIVE ONLY, AND
MAY BE SUBJECT TO
FURTHER DESIGN DEVELOPMENT.
DO NOT SCALE

- NOTES**
- INSTALLATION BOUNDARY
 - APPROXIMATE LOCATION OF FIRE HYDRANTS 12m FROM THE BUILDING, NO GREATER THAN 90m APART.

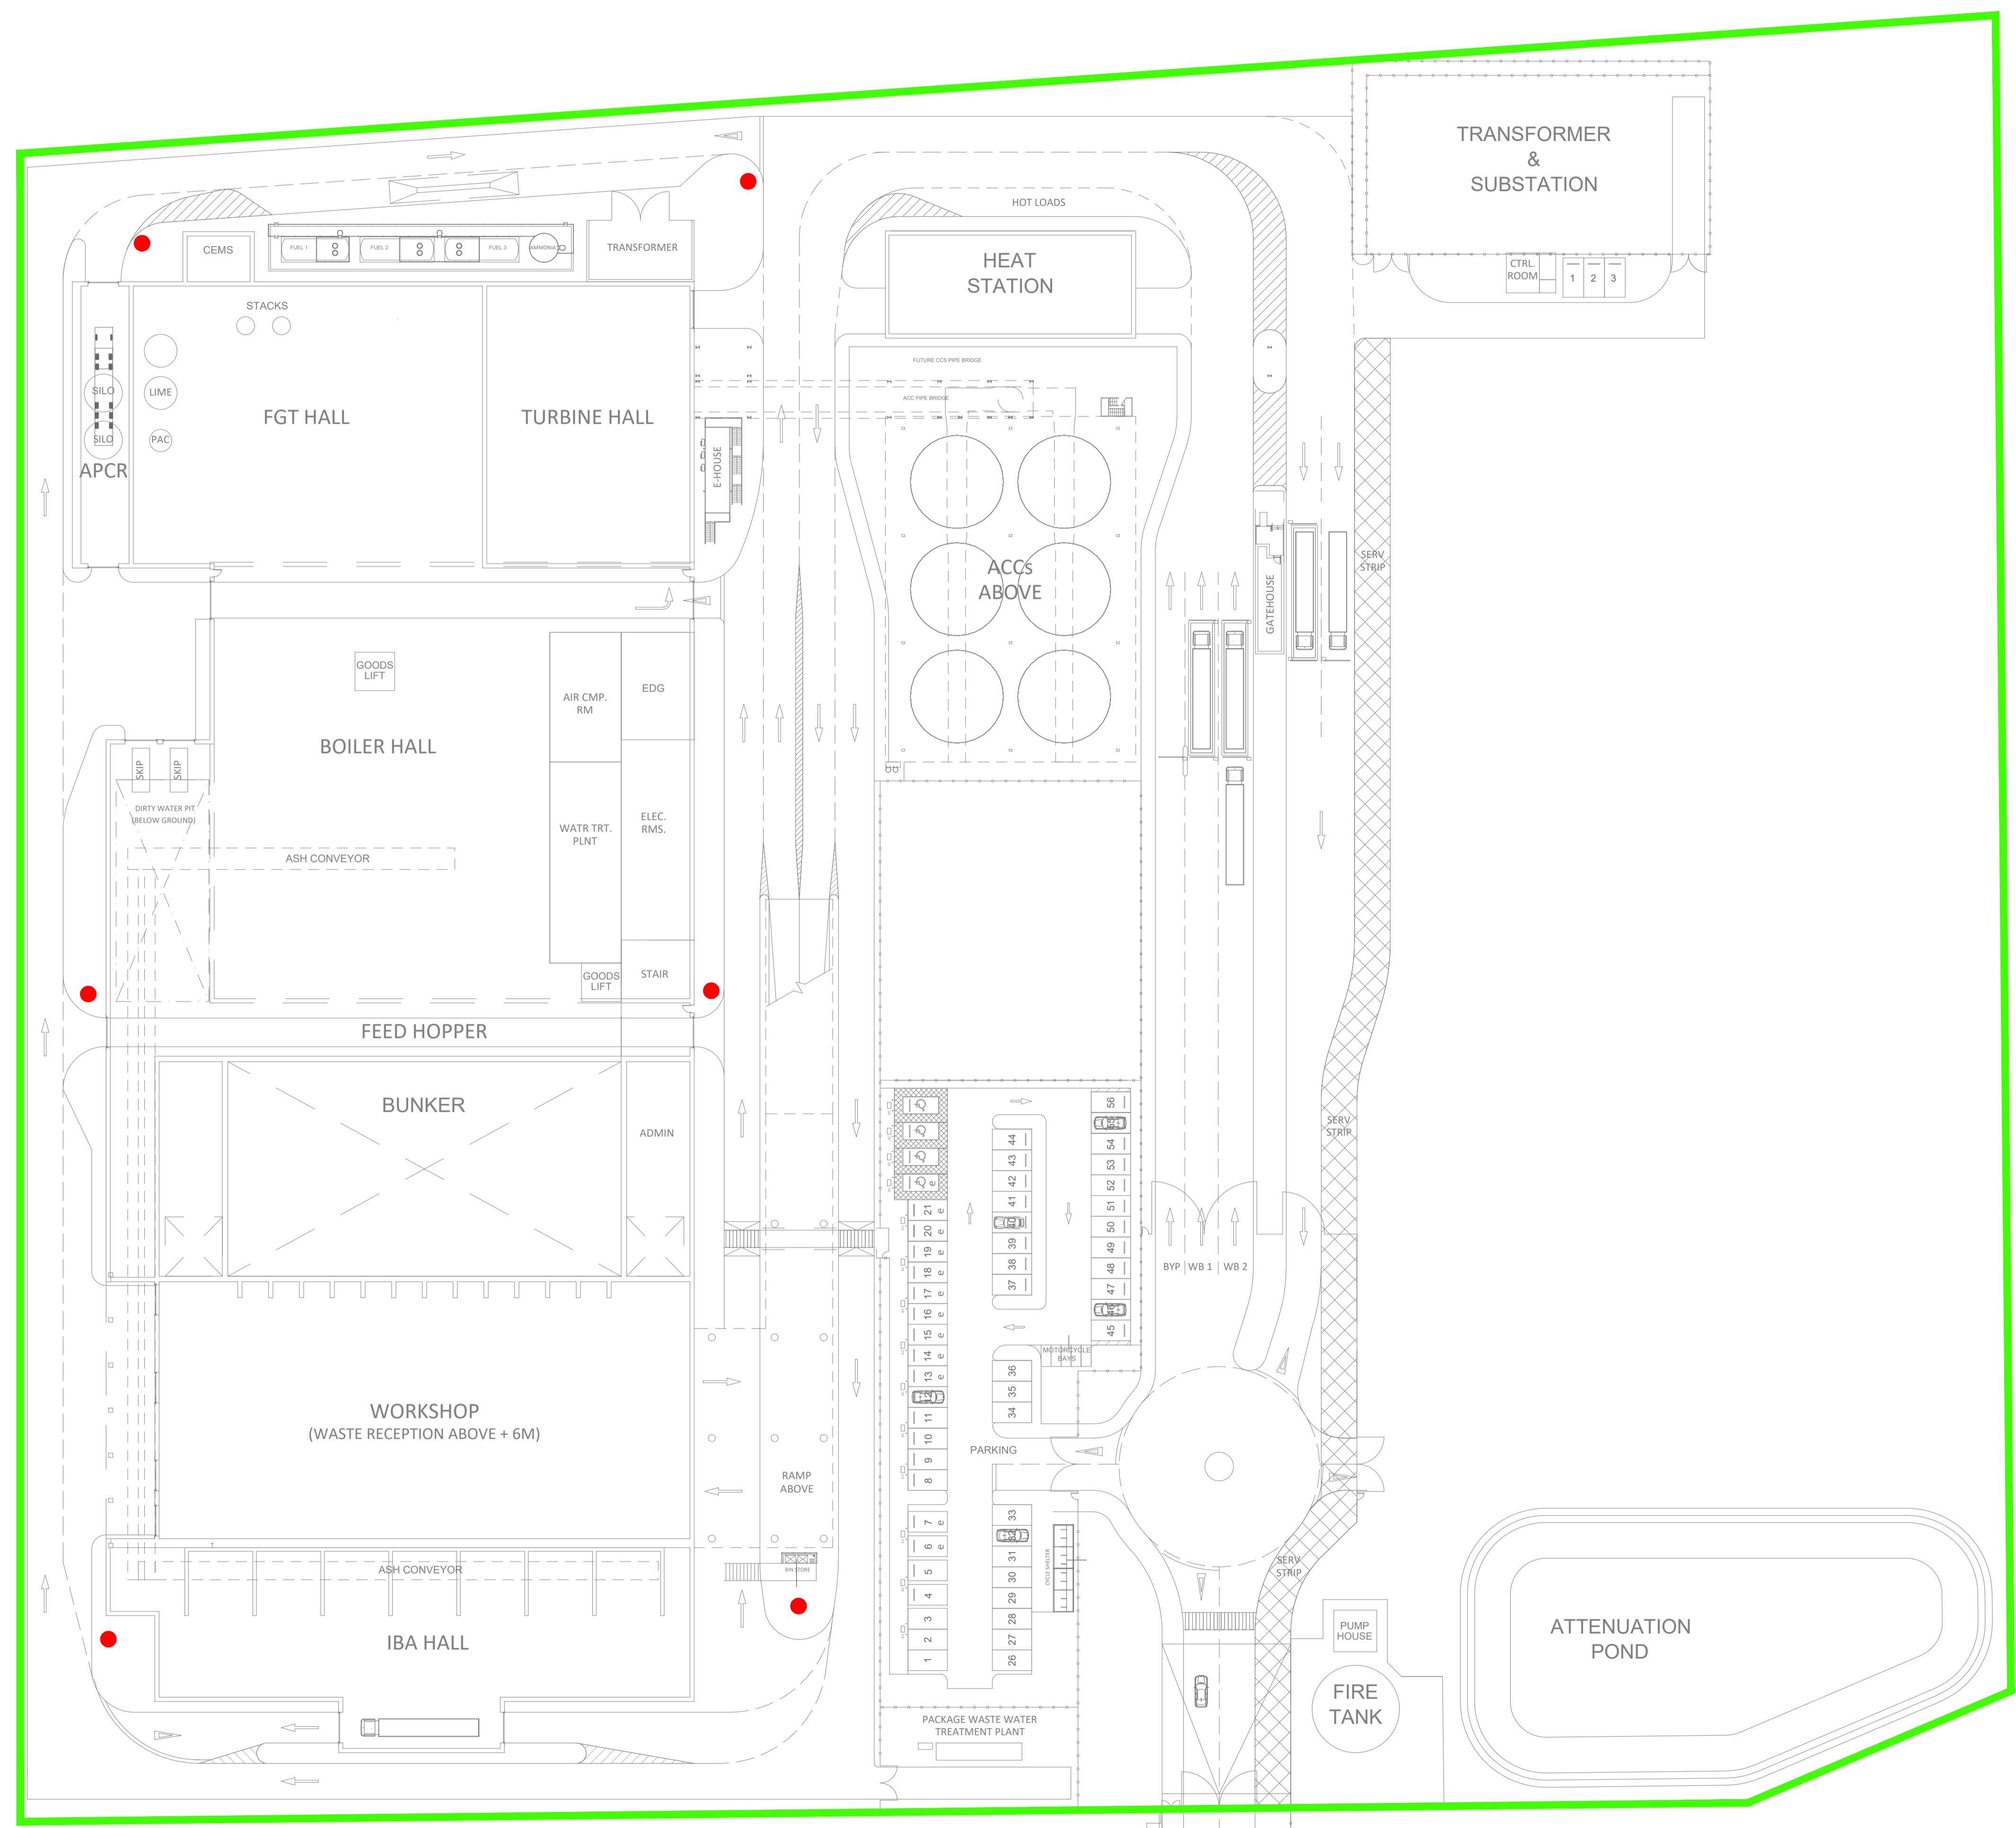

R1.0	PRELIMINARY	AO1	DTW	JRS	19.11.23
REV.	DETAILS OF REVISION	DRAWN	CHKD	APR	DATE

FICHTNER
CONSULTING ENGINEERS LIMITED
Kingsgate, Wellington Road North,
Stockport, Cheshire, SK4 1LW, UK Tel:
0161 476 0032
Website: www.fichtner.co.uk

CLIENT: **MEDWAY ENERGY RECOVERY LIMITED**

SITE: **MEDWAY ONE ENERGY HUB**

PROJECT: **MEDWAY ERF**

TITLE: **INDICATIVE FIRE HYDRANTS**

DRAWING STATUS:		PRELIMINARY	
DRAWN BY:	AO1	DATE:	19.12.23
CHECKED BY:	DTW	DATE:	19.12.23
APPROVED BY:	JRS	DATE:	19.12.23
FILENAME:	S3899-8310-0004A01 INDICATIVE FIRE HYDRANTS R1.0		
OFFICE OF ISSUE:	STOCKPORT		
SHEET SIZE:	A1	SCALE:	1:500
DRAWING No.:	S3899-8310-0004		REVISION:

