


ALL INFORMATION ON THIS DRAWING IS INDICATIVE ONLY, AND
MAY BE SUBJECT TO
FURTHER DESIGN DEVELOPMENT.
DO NOT SCALE

- NOTES
- INSTALLATION BOUNDARY
 - INDICATIVE FIREWATER CONTAINMENT
 - INDICATIVE FIREWATER STORAGE

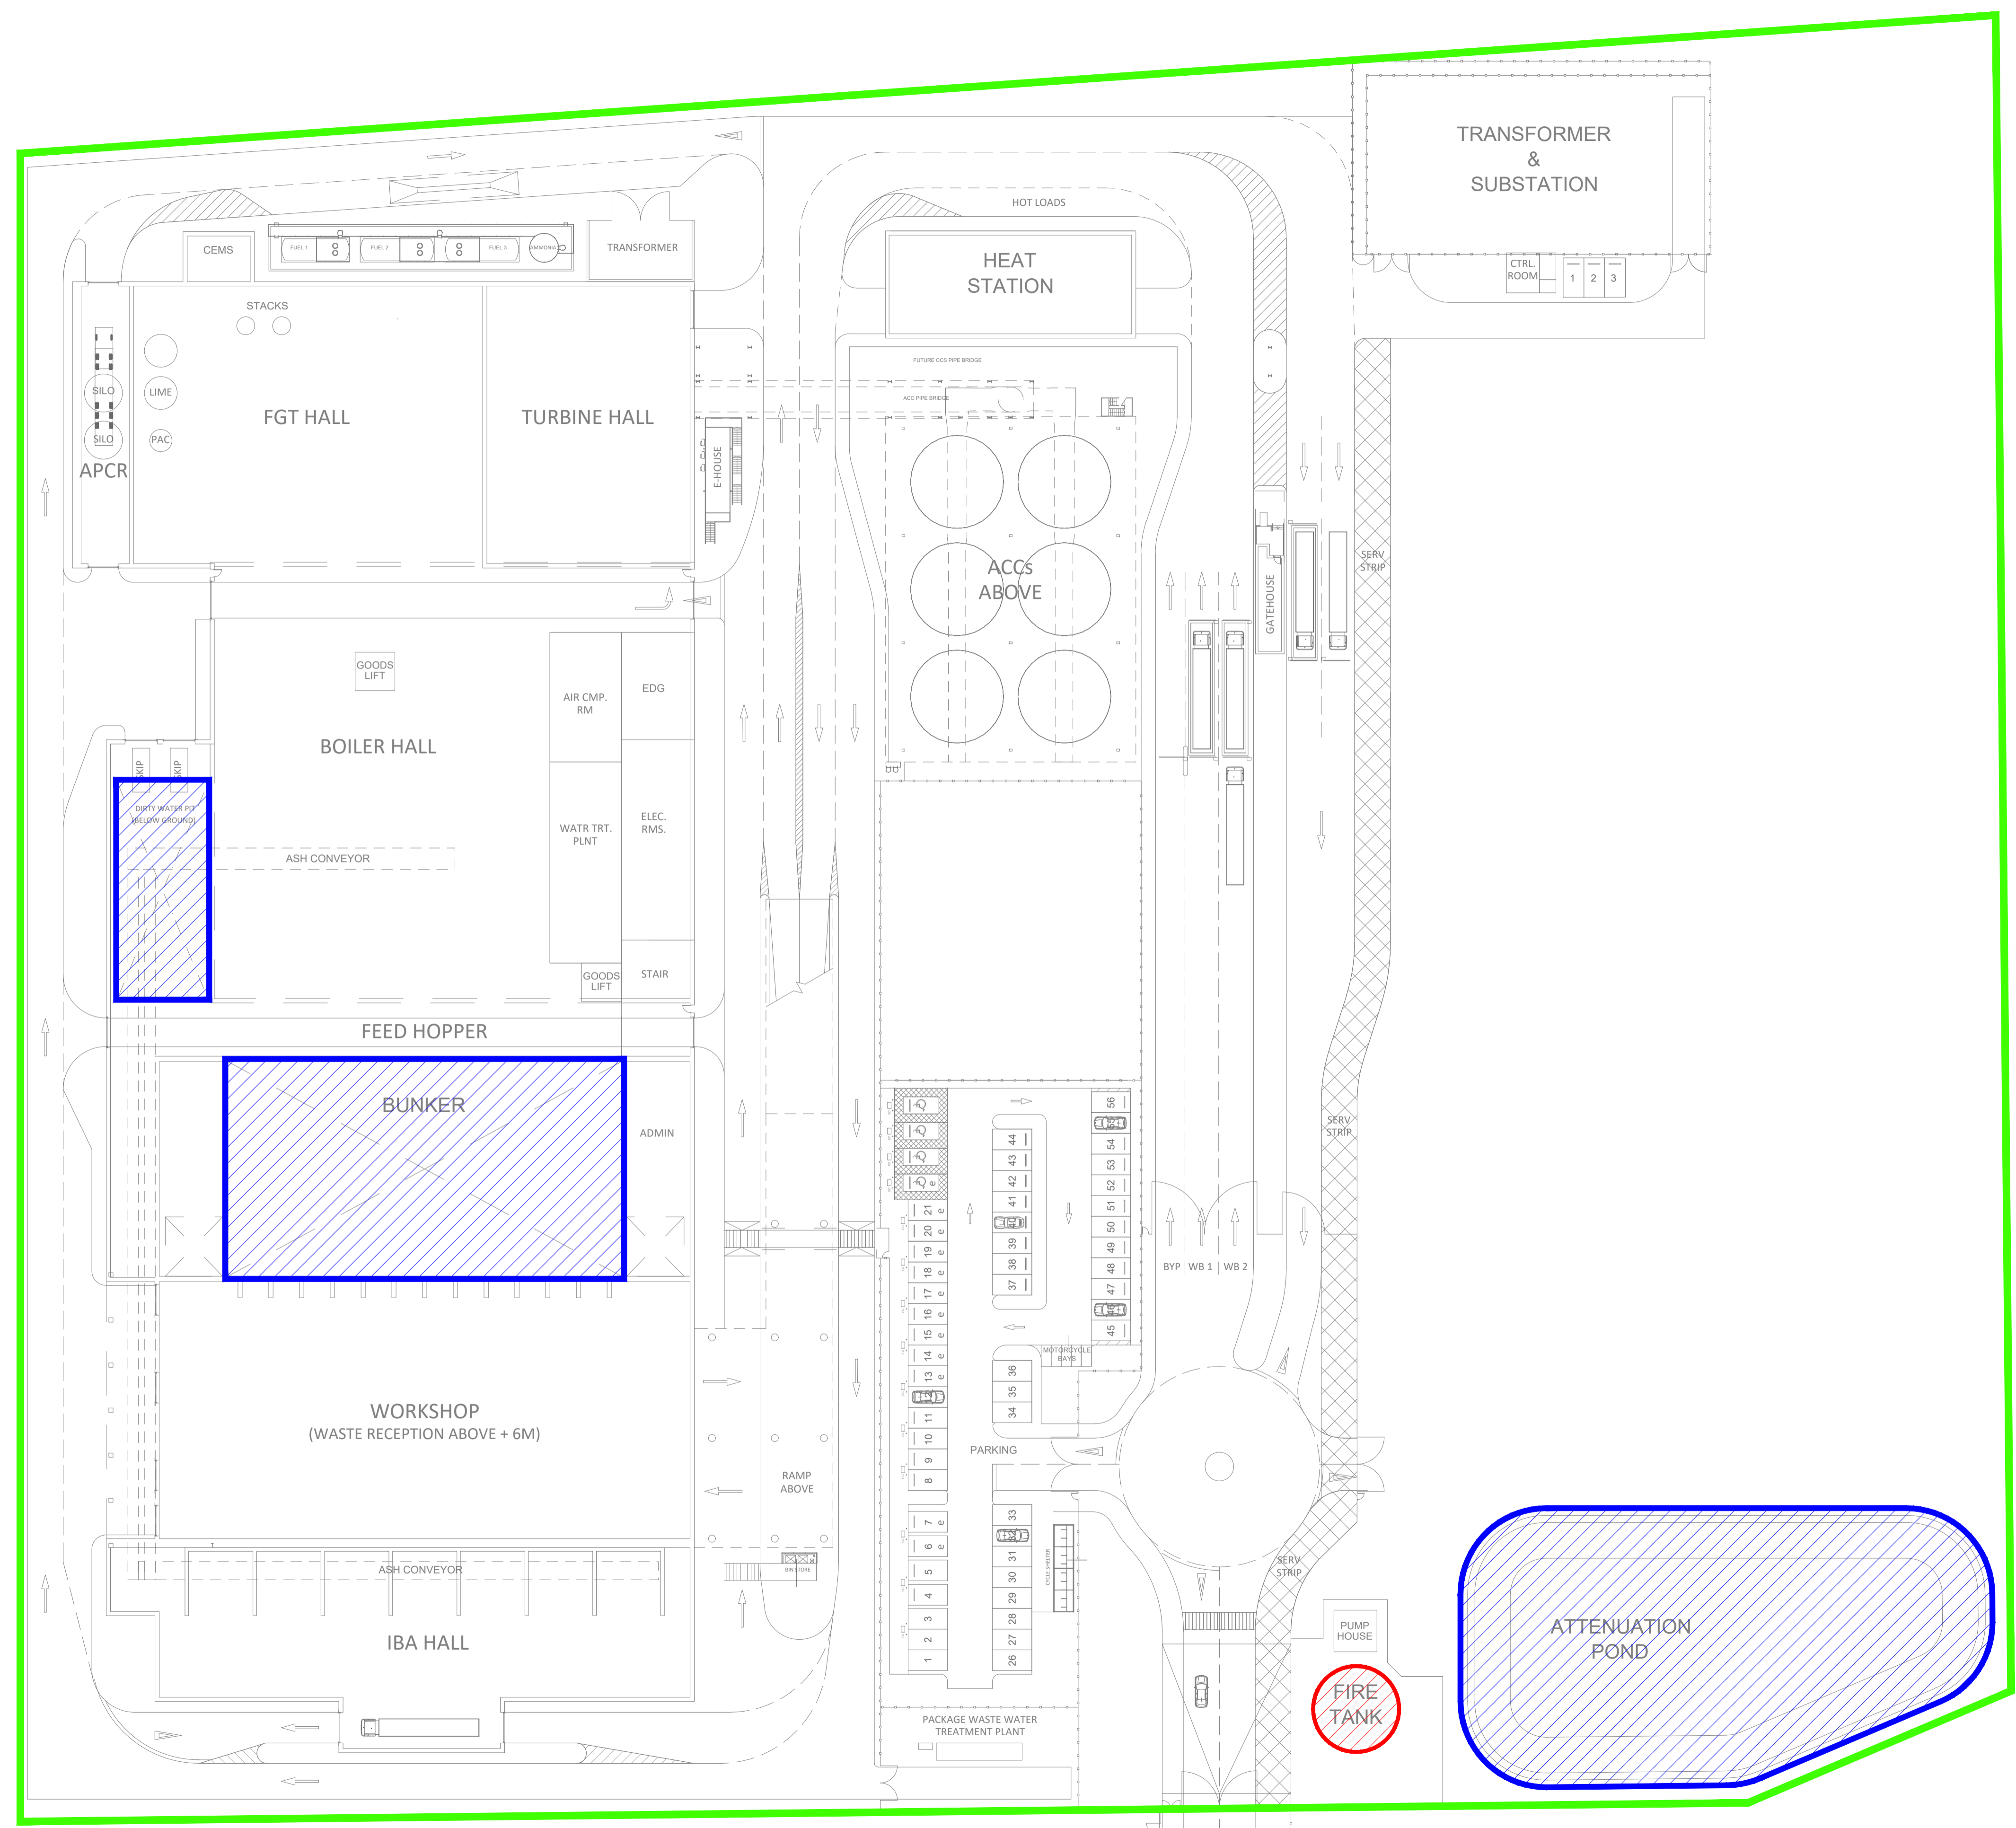

R1.0	PRELIMINARY	AO1	DTW	JRS	19.11.23
REV.	DETAILS OF REVISION	DRAWN	CHKD	APR	DATE

FICHTNER
CONSULTING ENGINEERS LIMITED
Kingsgate, Wellington Road North,
Stockport, Cheshire, SK4 1LW, UK Tel:
0161 476 0032
Website: www.fichtner.co.uk

CLIENT: **LOW CARBON**
SITE: **MEDWAY ONE ENERGY HUB**
PROJECT: **MEDWAY ERF**
TITLE: **INDICATIVE FIREWATER STORAGE AND CONTAINMENT**

DRAWING STATUS: PRELIMINARY	
DRAWN BY: AO1	DATE: 19.12.23
CHECKED BY: DTW	DATE: 19.12.23
APPROVED BY: JRS	DATE: 19.12.23
FILENAME: S3899-8310-000801 INDICATIVE FIREWATER STORAGE AND CONTAINMENT PLO	OFFICE OF ISSUE: STOCKPORT
SHEET SIZE: A1	SCALE: 1:500
DRAWING No.: S3899-8310-0009	REVISION: R1.0

