

Quarantine Area
(Fire wall bay constructed from Legio blocks)

Fire Hydrant

Access for Forklifts

Access for Firefighting Vehicles


Impermeable Surface with Sealed Drainage

Impermeable Surface

Interceptor Tank with Penstop Valve

Access for Firefighting Vehicles

Impermeable Surface with Sealed Drainage

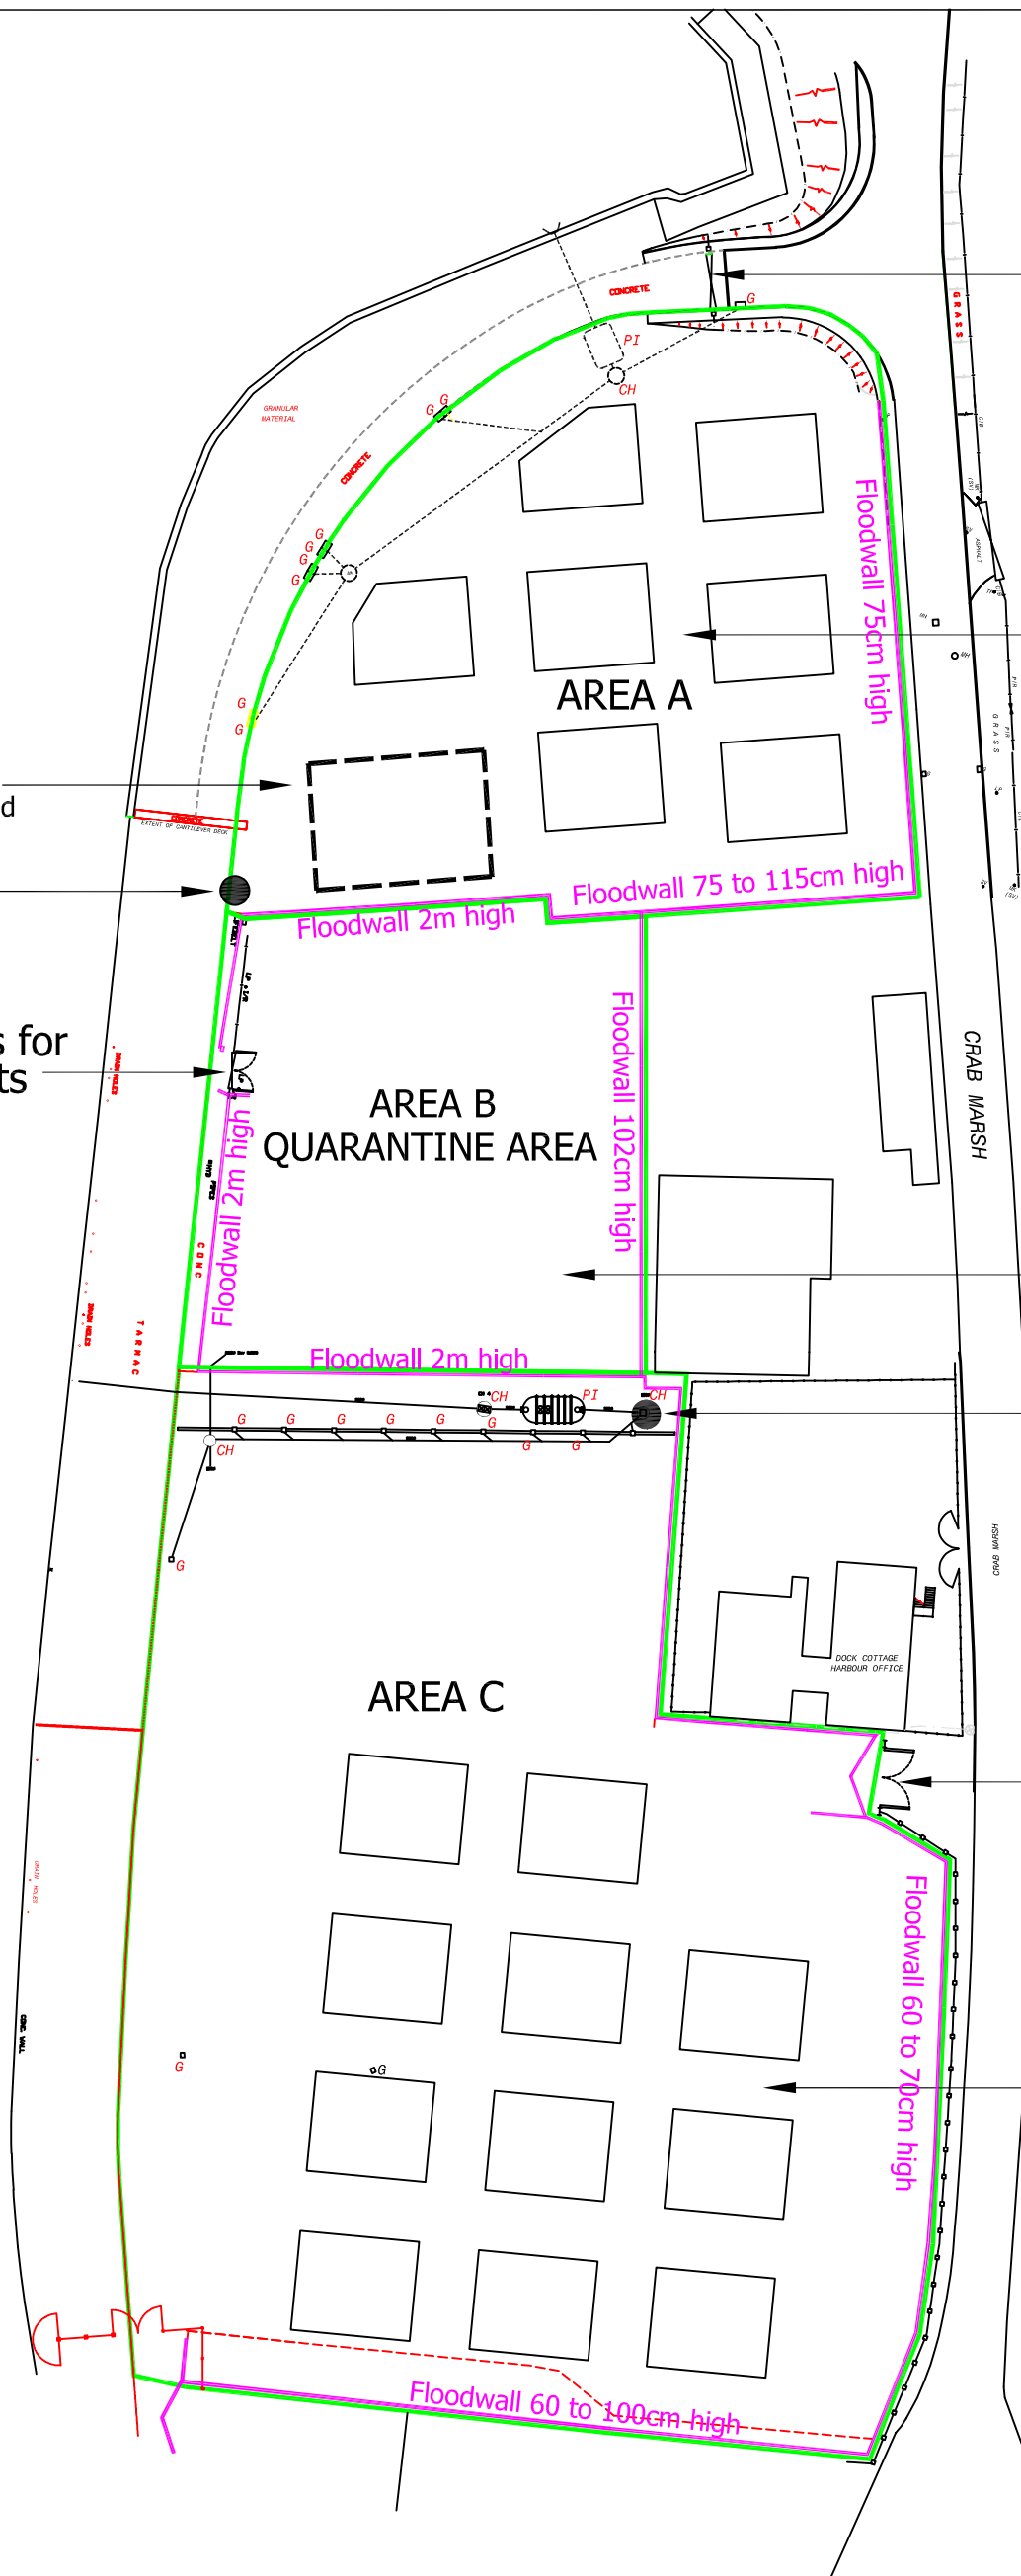

- Notes:-
- No firewalls, all 6m between piles of 450m3
 - No Buildings
 - No storage of hazardous or flammable materials e.g. fuels, gas cylinders
 - No ignition sources
 - No storage of vehicles or mobile plant
 - Spill kits stored outside of permitted area at Port of Wisbech offices to the south

This drawing should solely be used for permitting purposes, it is not intended as a design drawing.

REV	DESCRIPTION	BY	CHK	APP	DATE
Port of Wisbech Nene Parade, Wisbech Cambridgeshire PE13 3BB					
Tetra Tech Leeds 3 Sovereign Square, Sovereign Street, Leeds, United Kingdom, LS1 4ER Tel: +44 (0)11 3278 7111 www.tetrateteurope.com					
Project: PORT OF WISBECH PERMIT APPLICATION					
Drawing Title: PERMIT BOUNDARY AND LOCATION OF RDF STOCKPILES					
Scale @ A3 1:750	Drawn MJ	Date 16.2.24	Checked LS	Date 19.2.24	Approved AB
Project No. B059539	Office 784	Type ENV	Drawing No. PER-01		Revision -