


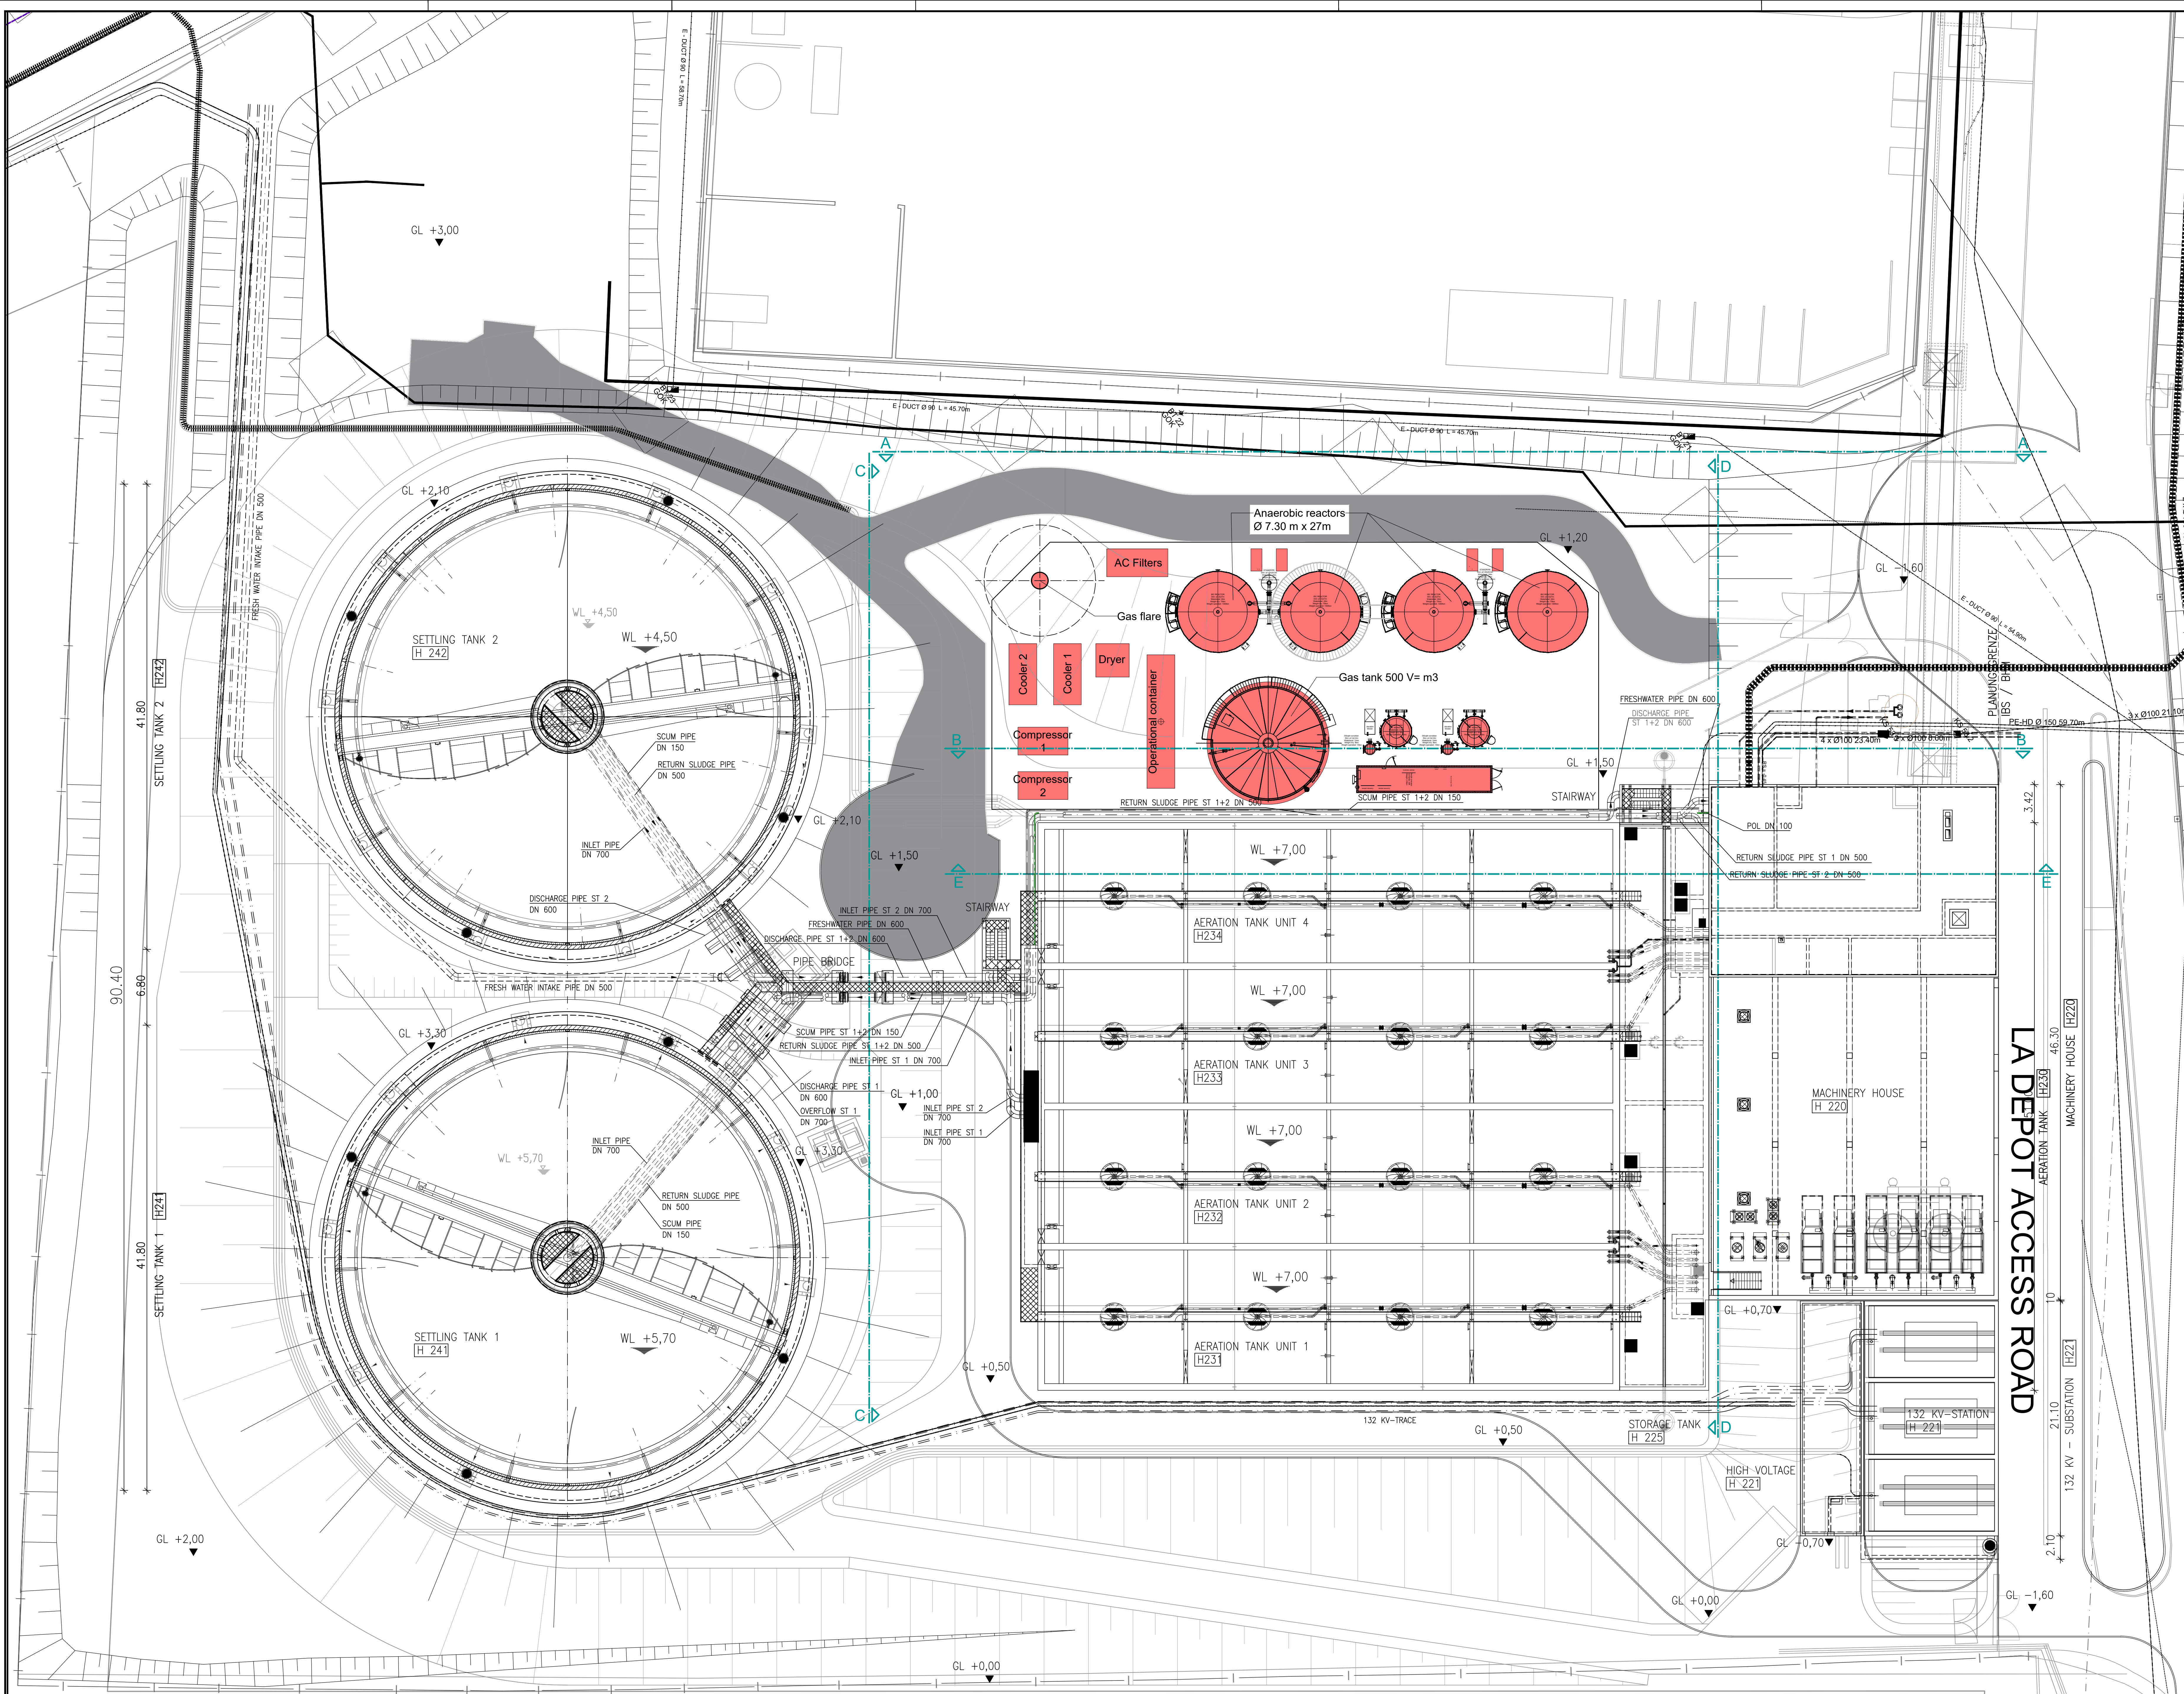

0 50m 100m

Scale 1:200

41.80 21.40 52.25 8.00 26.00 7.50

SETTLINGS TANKS [H240] V = 2 x 5565 m3 A = 2 x 1320 m2

AERATION TANK [H230] Vtotal = 4 x 5100 m3 = 20400 m3


STORAGE TANKS [H225]

MACHINERY HOUSE [H220]

149.69

MILL SITE ZERO (MSZ) = 5.00 m AOD (LOCAL REFERENCE FRAME) (ABOVE ORDNANCE DATUM)			
REVISION	COMMENT	DATE	NAME

21.11.2025	LYNN PM 7	1001	0000	BAU	1100	00
DATE	PROJECT / FIELD	SUBJECT VE	FIELD	DR. NO.	REV.	

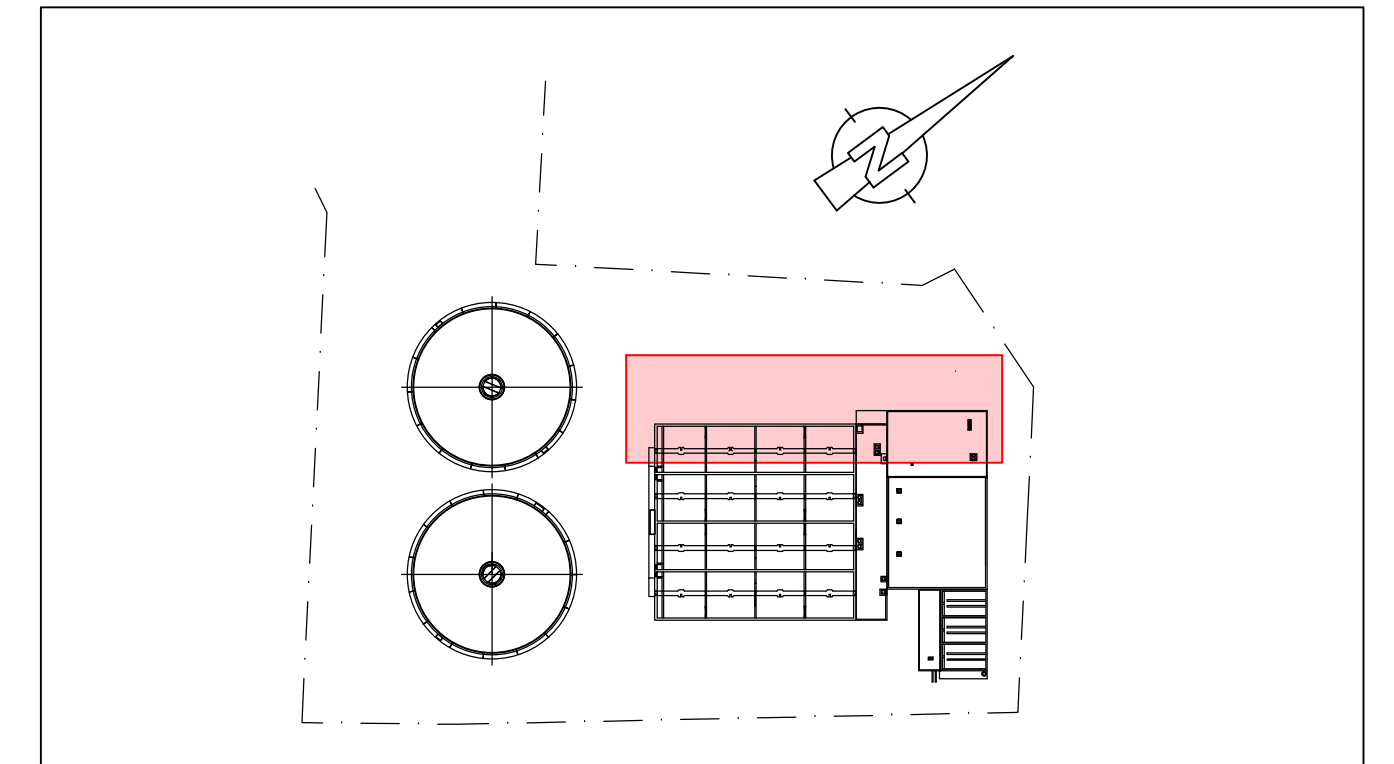

**PAPER MILL LYNN PM 7**
WATER TREATMENT PLANT

SUBJECT
OPTIMIZING THE EXISTING WWTP
VIA ANAEROBIC TREATMENT

DESIGN
PRELIMINARY DESIGN

KIND OF
PLAN
LAYOUT

ENGINEER
**SCHLEGEL**
Consulting Engineers
59039 Muenster, Germany (+49 89 17 90 2-0)

DATE
21.11.2025

CHECKED
Al-Azzawi

DRAWN
Tamang

CHECKED
Al-Azzawi

CLIENT
**PALM PAPER LIMITED**
King's Lynn
Norfolk PE30 5EJ

DATE

SCALE
1:200
SIZE
1189x841