


Power Logger Survey

Site -Vector Building 110


Current

Friday 03/01/2025 09:30:00 - Monday 13/01/2025 11:00:00

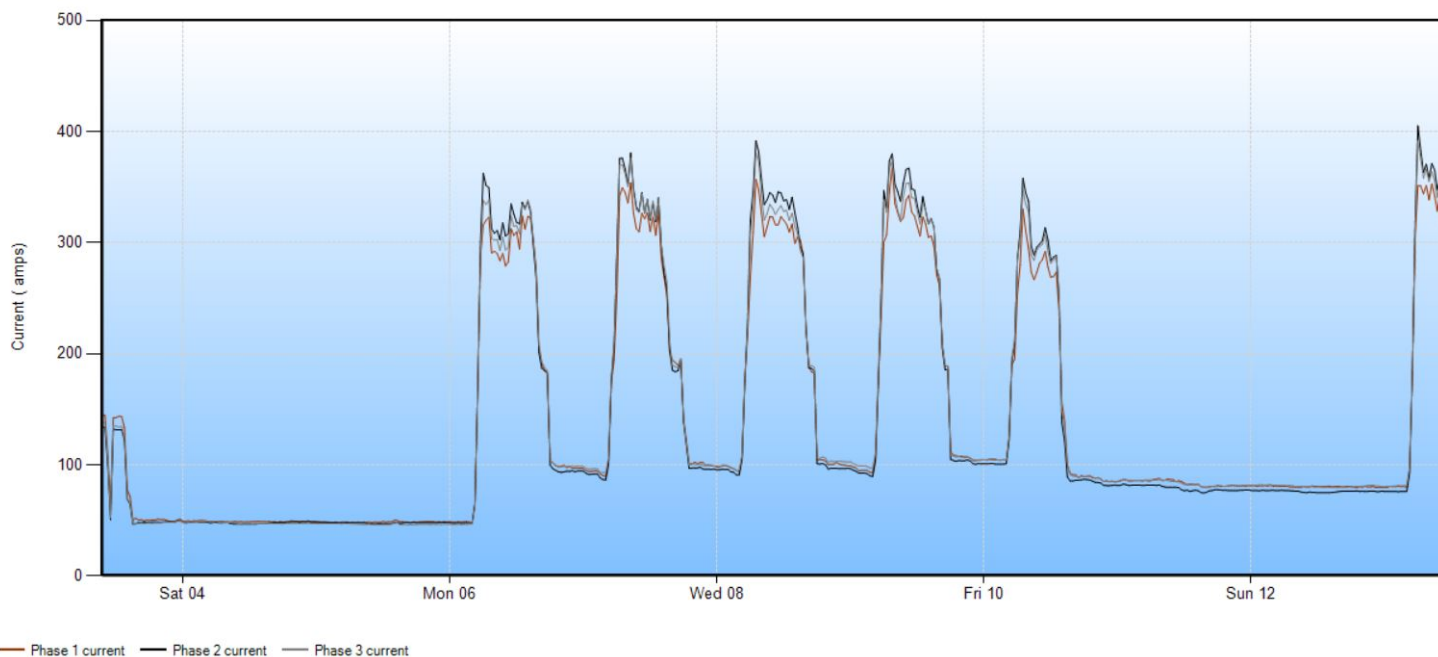

KWh

Friday 03/01/2025 09:30:00 - Monday 13/01/2025 11:00:00

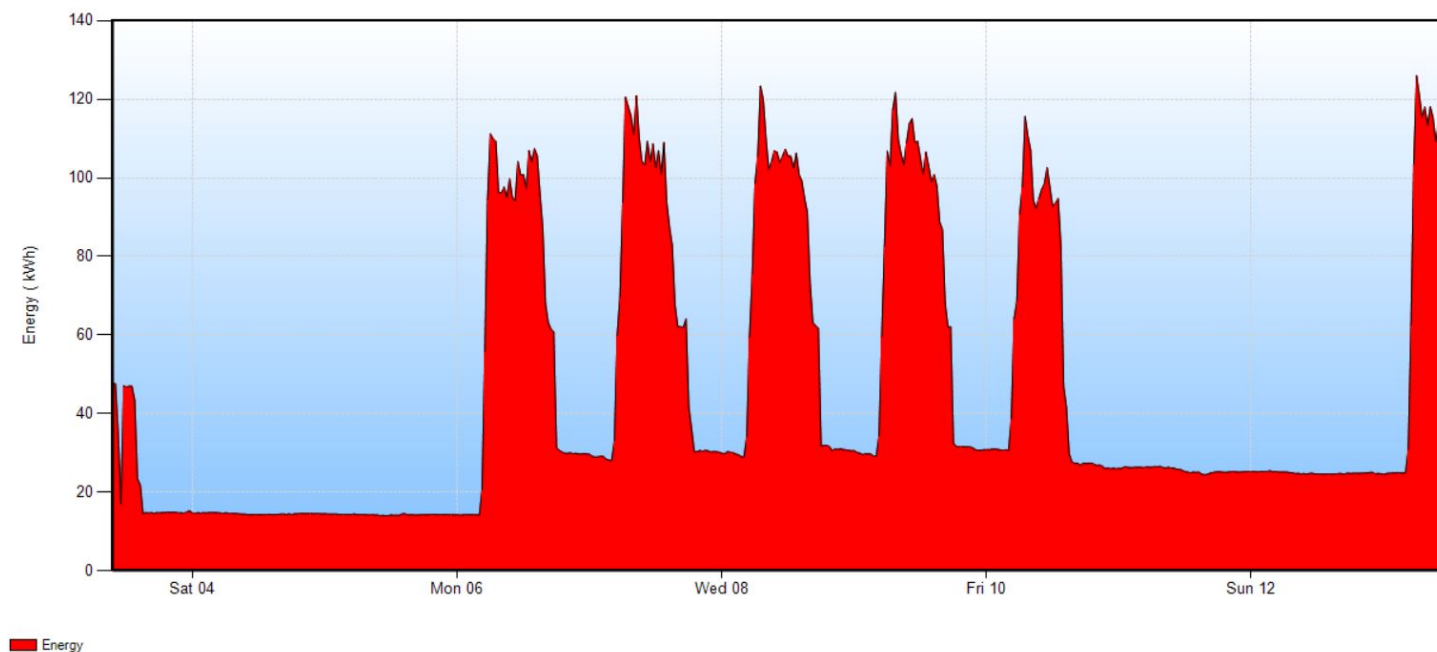

Stats

From:	03/01/2025 09:00:00						
To:	13/01/2025 11:30:00						
Duration:	10 days 2 hours 30 minutes						
Interval:	30 minutes						
Data Points:	485						
Item:	Current 1 (amps)	Current 2 (amps)	Current 3 (amps)	Power Factor	Voltage (volts)	Energy (kWh)	Power (kW)
Mean Value:	135.7	137.9	138.6	0.88	238.71	43.71	87.7
Median Value:	207.6	225.8	218.6	0.89	236.59	70.00	140.0
Maximum Value:	367.4	405.0	391.4	0.96	242.66	125.95	251.9
Time of Maximum:	09/01/2025 08:00:00	13/01/2025 06:30:00	13/01/2025 06:30:00	03/01/2025 09:30:00	04/01/2025 21:00:00	13/01/2025 06:30:00	13/01/2025 06:30:00
Minimum Value:	47.8	46.5	45.8	0.82	230.52	14.04	28.1
Time of Minimum:	06/01/2025 04:30:00	05/01/2025 11:00:00	05/01/2025 17:30:00	09/01/2025 21:30:00	09/01/2025 09:00:00	05/01/2025 12:00:00	05/01/2025 12:00:00
Mean to Peak Ratio:	0.4	0.3	0.4	0.91	0.98	0.35	0.3
Standard Deviation:	4.6	5.0	4.8	0.00	0.13	1.57	3.1
Overall Value:	135.7	137.9	138.6	0.90	238.71	21200.56	87.7

One company,
five specialist divisions



0845 6439 222
www.2teck.co.uk