


Power Logger Survey


Site - Vector Boiler House

Current

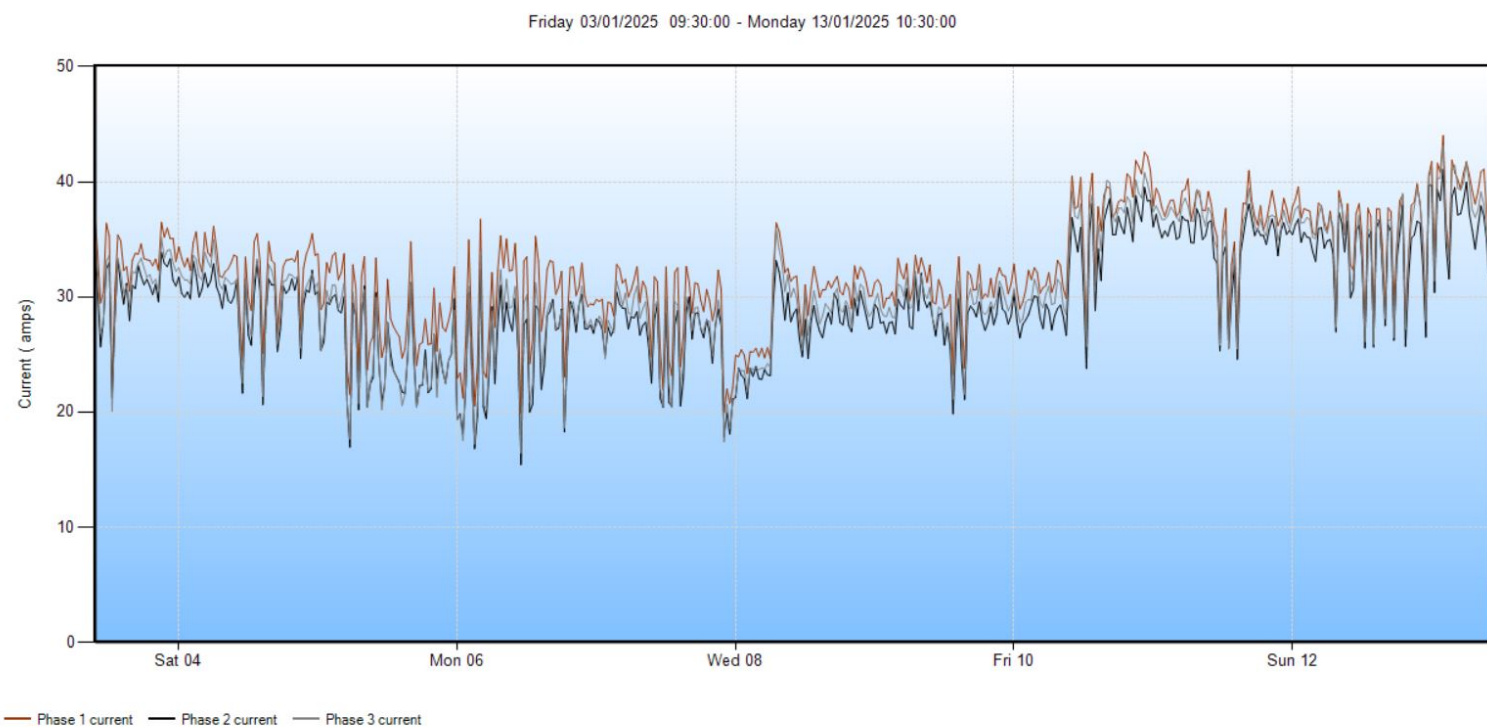

KWh

Friday 03/01/2025 09:30:00 - Monday 13/01/2025 10:30:00

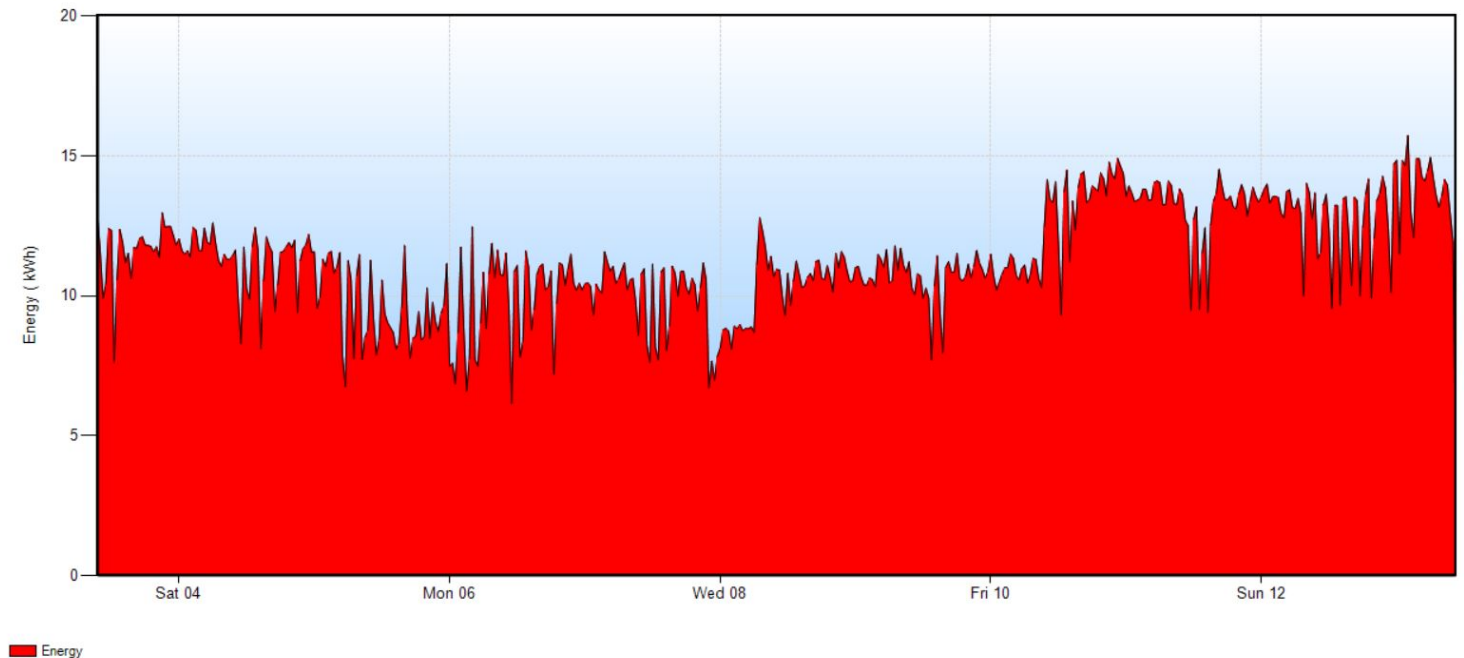

Stats

From:	03/01/2025 09:00:00						
To:	13/01/2025 11:00:00						
Duration:	10 days 2 hours						
Interval:	30 minutes						
Data Points:	484						
Item:	Current 1 (amps)	Current 2 (amps)	Current 3 (amps)	Power Factor	Voltage (volts)	Energy (kWh)	Power (kW)
Mean Value:	32.4	29.6	30.6	0.97	250.70	11.26	22.6
Median Value:	32.0	28.3	29.8	0.97	249.92	9.30	21.9
Maximum Value:	44.0	41.1	43.2	0.98	254.54	15.74	31.5
Time of Maximum:	13/01/2025 02:30:00	13/01/2025 02:30:00	13/01/2025 02:30:00	13/01/2025 09:00:00	11/01/2025 18:30:00	13/01/2025 02:30:00	13/01/2025 02:30:00
Minimum Value:	19.9	15.4	16.4	0.96	245.30	2.87	12.3
Time of Minimum:	06/01/2025 11:30:00	06/01/2025 11:30:00	06/01/2025 11:30:00	05/01/2025 06:00:00	13/01/2025 09:00:00	13/01/2025 11:00:00	06/01/2025 11:30:00
Mean to Peak Ratio:	0.7	0.7	0.7	0.99	0.98	0.72	0.7
Standard Deviation:	0.2	0.2	0.2	0.00	0.08	0.09	0.2
Overall Value:	32.4	29.6	30.6	0.98	250.70	5447.51	22.6

One company,
five specialist divisions



0845 6439 222
www.2teck.co.uk