



- KEY:**
- Installation Boundary
 - Tanks Excluded from Permit Scope
 - Air Emission Point
 - Liquor Transfer Point
 - Return Liquor Sampling Point

- A1 - CHP Engine 1
 - A2 - Boiler
 - A3 - Emergency Flare
 - A4 - Primary Digester Tank PRV
 - A5 - Primary Digester Tank PRV
 - A6 - Biogas Storage PRV
 - A7 - OCU 1
-
- T1 - Primary Sludge Thickening Liquor, SAS Thickening Liquor, Digested Sludge Dewatering Liquor, Biogas Condensate, OCU Waste Water, Surface Water Run Off
 - T2 - Head of Works Imports
-
- S1 - Primary Sludge Thickening Liquor, SAS Thickening Liquor, Digested Sludge Dewatering Liquor, Biogas Condensate, OCU Waste Water, Surface Water Run Off
 - S2 - Head of Works Imports



POS	NOV 2024	FOR INFORMATION	AR	MM	JK	MM
P04	NOV 2023	FOR INFORMATION	AR	MM	JK	MM
P03	NOV 2023	FOR INFORMATION	AR	MM	JK	MM
Rev	Rev. Date	Purpose of revision	Drawn	Checked	Rev'd	Apprv'd

Jacobs
 1180 Eakdale Road, Wokingham, Wokingham, RG42 5TU
 Tel: +44(0)118 946 7000
 www.jacobs.com

Client

Project

**STC IED PERMIT
WARGRAVE STW**

Drawing title

**FIGURE 2
INSTALLATION BOUNDARY
AND AIR EMISSION POINTS**

Drawing status


PERMITTING

Scale	1:1000	DO NOT SCALE
Jacobs No.	B22849AZ	Rev
Client no.		P05

Drawing number

B22849AZ-JAC-WGE-DR-0002

© Copyright 2022 Jacobs U.K. Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of, the Client. Jacobs accepts no liability or responsibility whatsoever for or in respect of any use of, or reliance upon, this drawing by any third party.

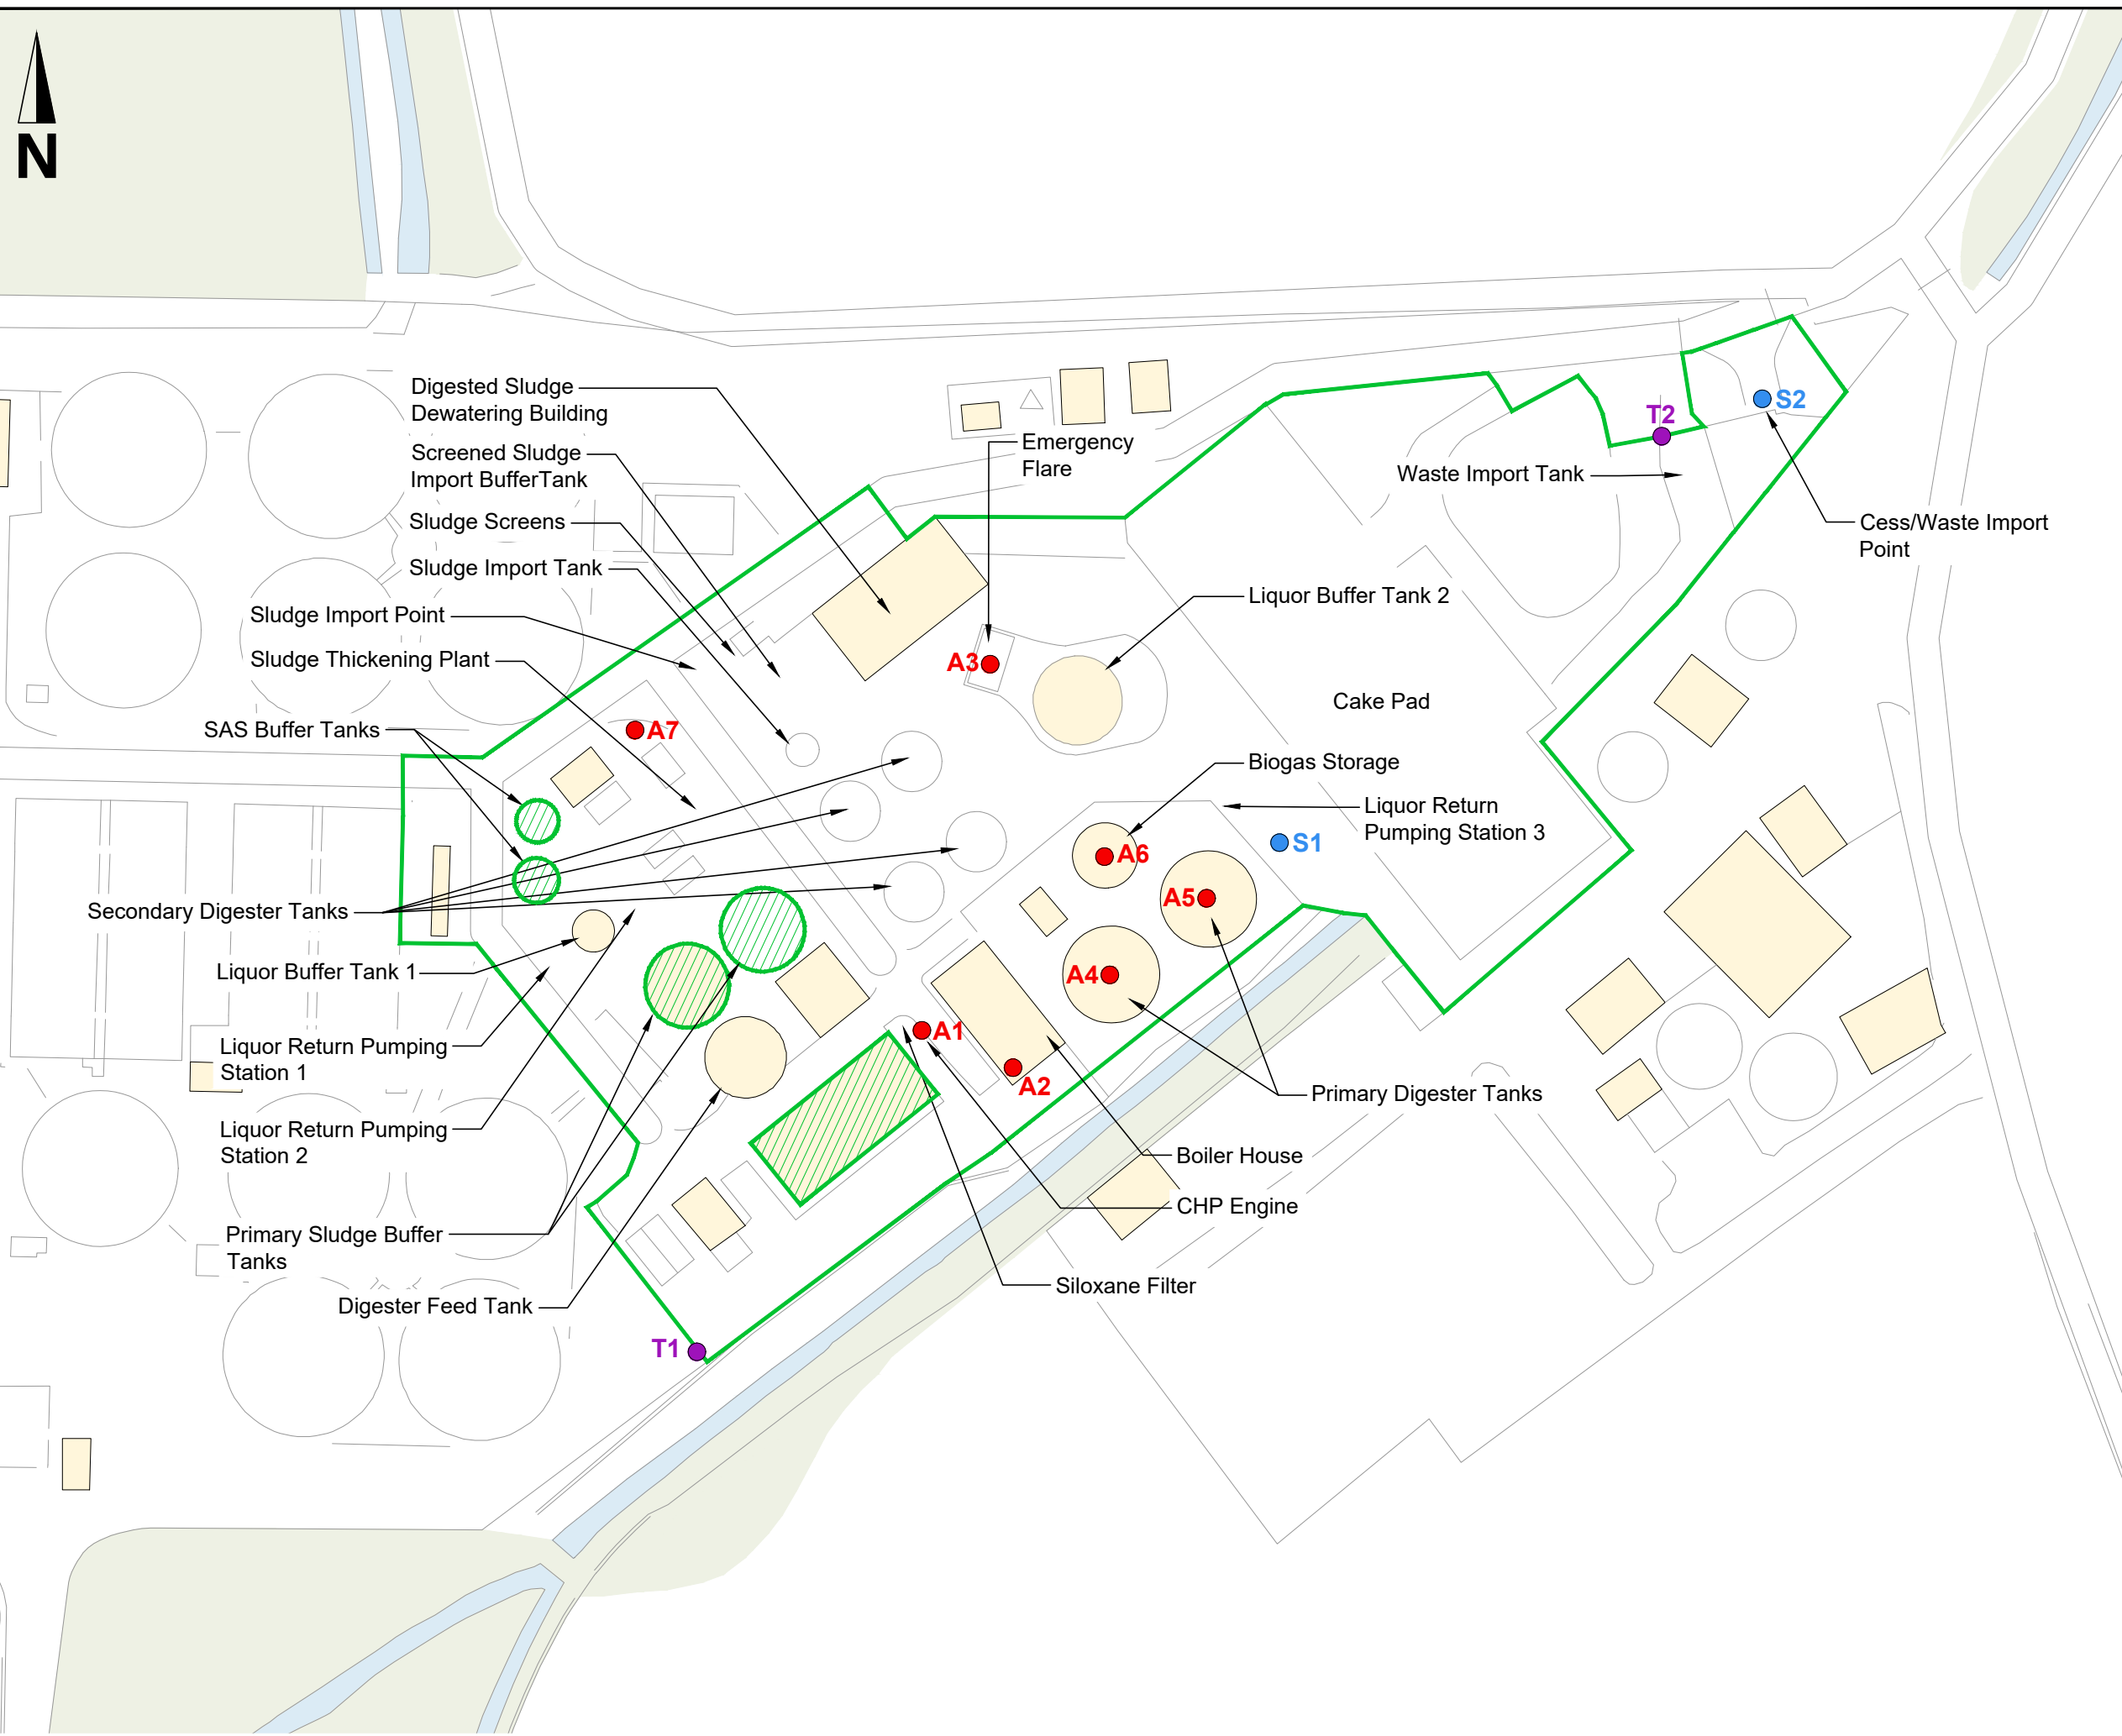

I:\enviros\Design\PROJECTS\KUIB22849AZ\Wargrave\Figures\B22849AZ-JAC-WGE-DR-0002-P05.dwg - 13/11/2024 15:06:24 - A3L_Ver - Al.Roberts