


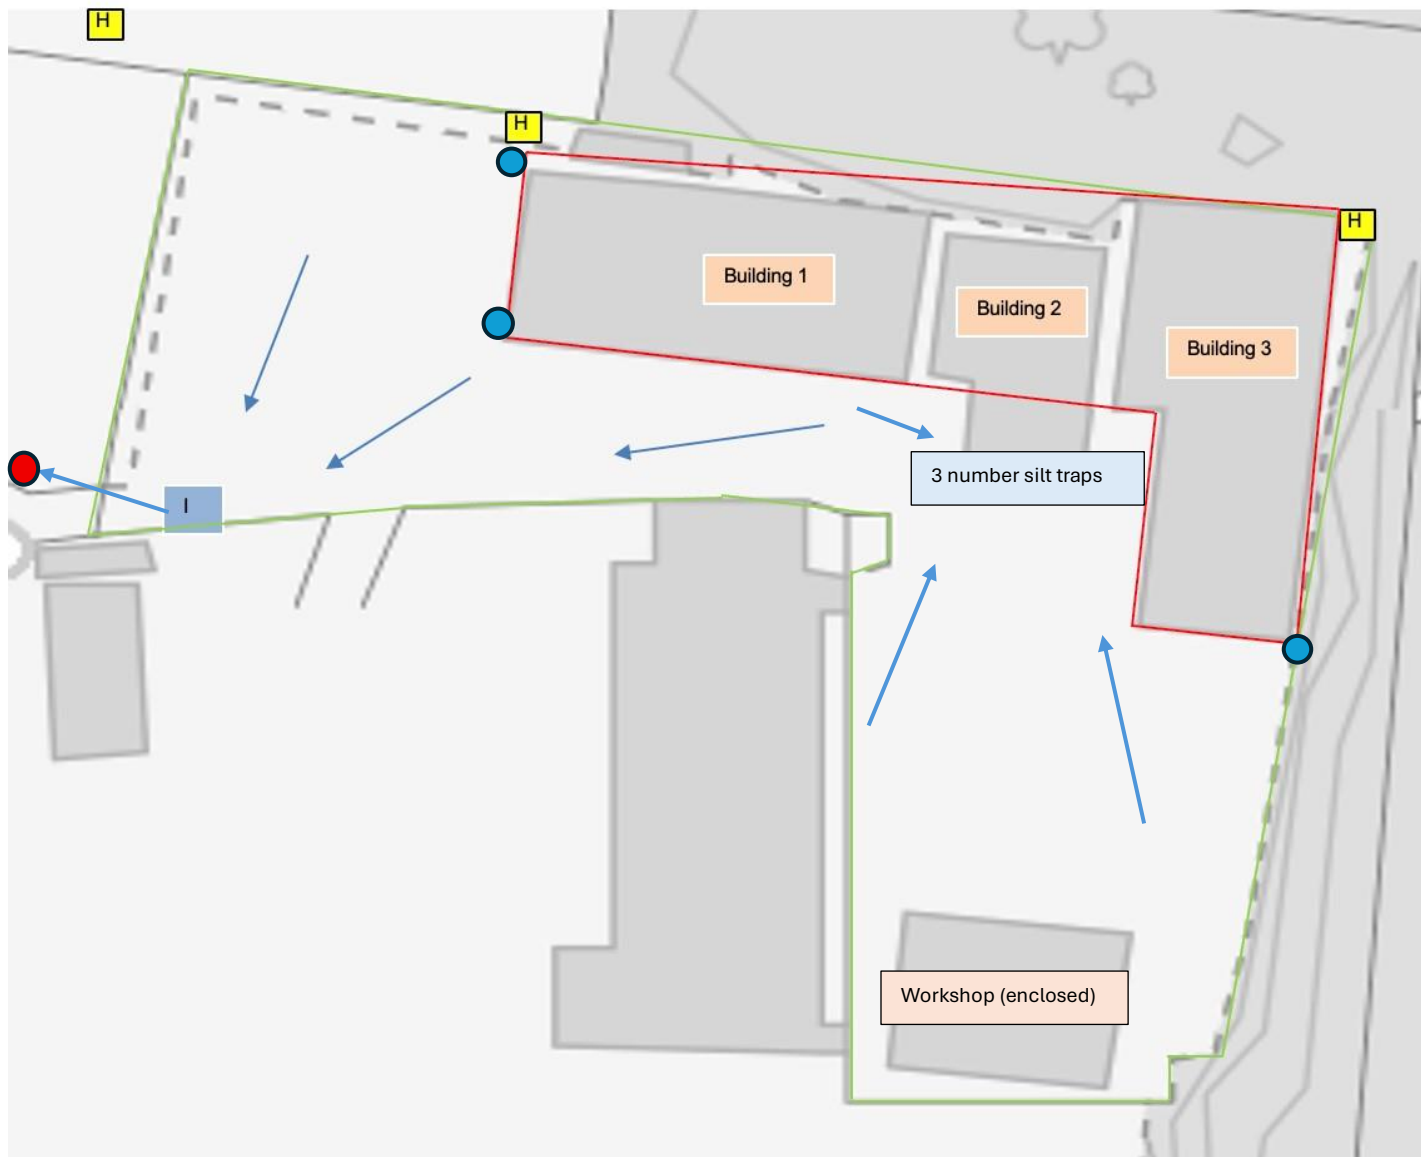

External area of the site is concreted throughout with falls to the full retention interceptor that complies with PPG3 [historical] requirements.

Roof water drains to grey water storage tanks, shown in blue on the drawing, and surplus roof water drains to soakaway.

Key (Scale 1:500 at A4)

Site boundary in green

Site surfacing impermeably surfaced with falls to interceptor
H — Fire hydrant; 300mm external supply; see Annex I for details

H — Fire Hydrant; 76mm internal supply for building

F — Water supplies; Fire reels; 30m length

WT — Water tank; 100m³

I — Interceptor


D — Dust suppression sprays

G — Gas bottle store [1m³]

Q — quarantine; 150m³

Concrete walls to 4m shown in black

Mobile plant parking (overnight)

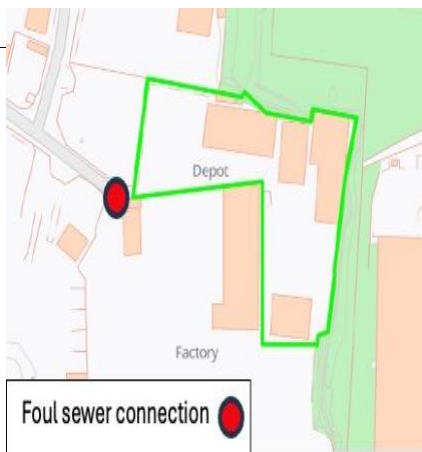

Foul sewer connection

Foul sewer pathways