© 2020 RPS Group

Notes

1. This drawing has been prepared in accordance with the scope of RPS's appointment with its client and is subject to the terms and conditions of that appointment. RPS accepts no liability for any use of this document other than by its client and only for the purposes for which it was prepared and provided.
2. If received electronically it is the recipients responsibility to print to correct scale. Only written dimensions should be used.
3. This drawing should be read in conjunction with all other relevant drawings and specifications.

Fire Safety Key

SYMBOL	ITEM
	120 minutes fire rated wall
	Line of personnel travel escape distance

SYMBOL	ITEM
SC	Self closing device fitted to door complying with BS EN 1154: Door closer's
VP	Vision panel (clear)
PB	Emergency opening device fitted to door complying with BS EN 1125
	Illuminated external emergency bulkhead - 3 hour duration
	Illuminated exit sign with directional arrow / running man - 3 hour duration
	Break glass unit (located at 1400mm above FFL)
FAP	Main fire alarm panel

SIGNAGE
All 'fire exit route' signs are to be illuminated (in accordance with BS 5499-1:2002) unless a photo luminescent option is agreed. Exit route sign sizes are to be approx 200mm (H) x 400mm (L).

All fire doors MUST be signed using one of the following standard signs. As a minimum it is recommended 80mmx80mm stainless steel sign but other styles may be provided appropriate to door design and surface.
All signs to be positioned at eye level (1600mm above FFL)

S12	Fire action sign to be located adjacent each call point
S20	Fire escape keep clear
S25	Push bar to open
S26	Sign - Directional arrow / running man

FIRE EXIT SIGNS (INTERIOR SIDE)

Fire exit	Fire exit with downward arrow/running man (change of level)

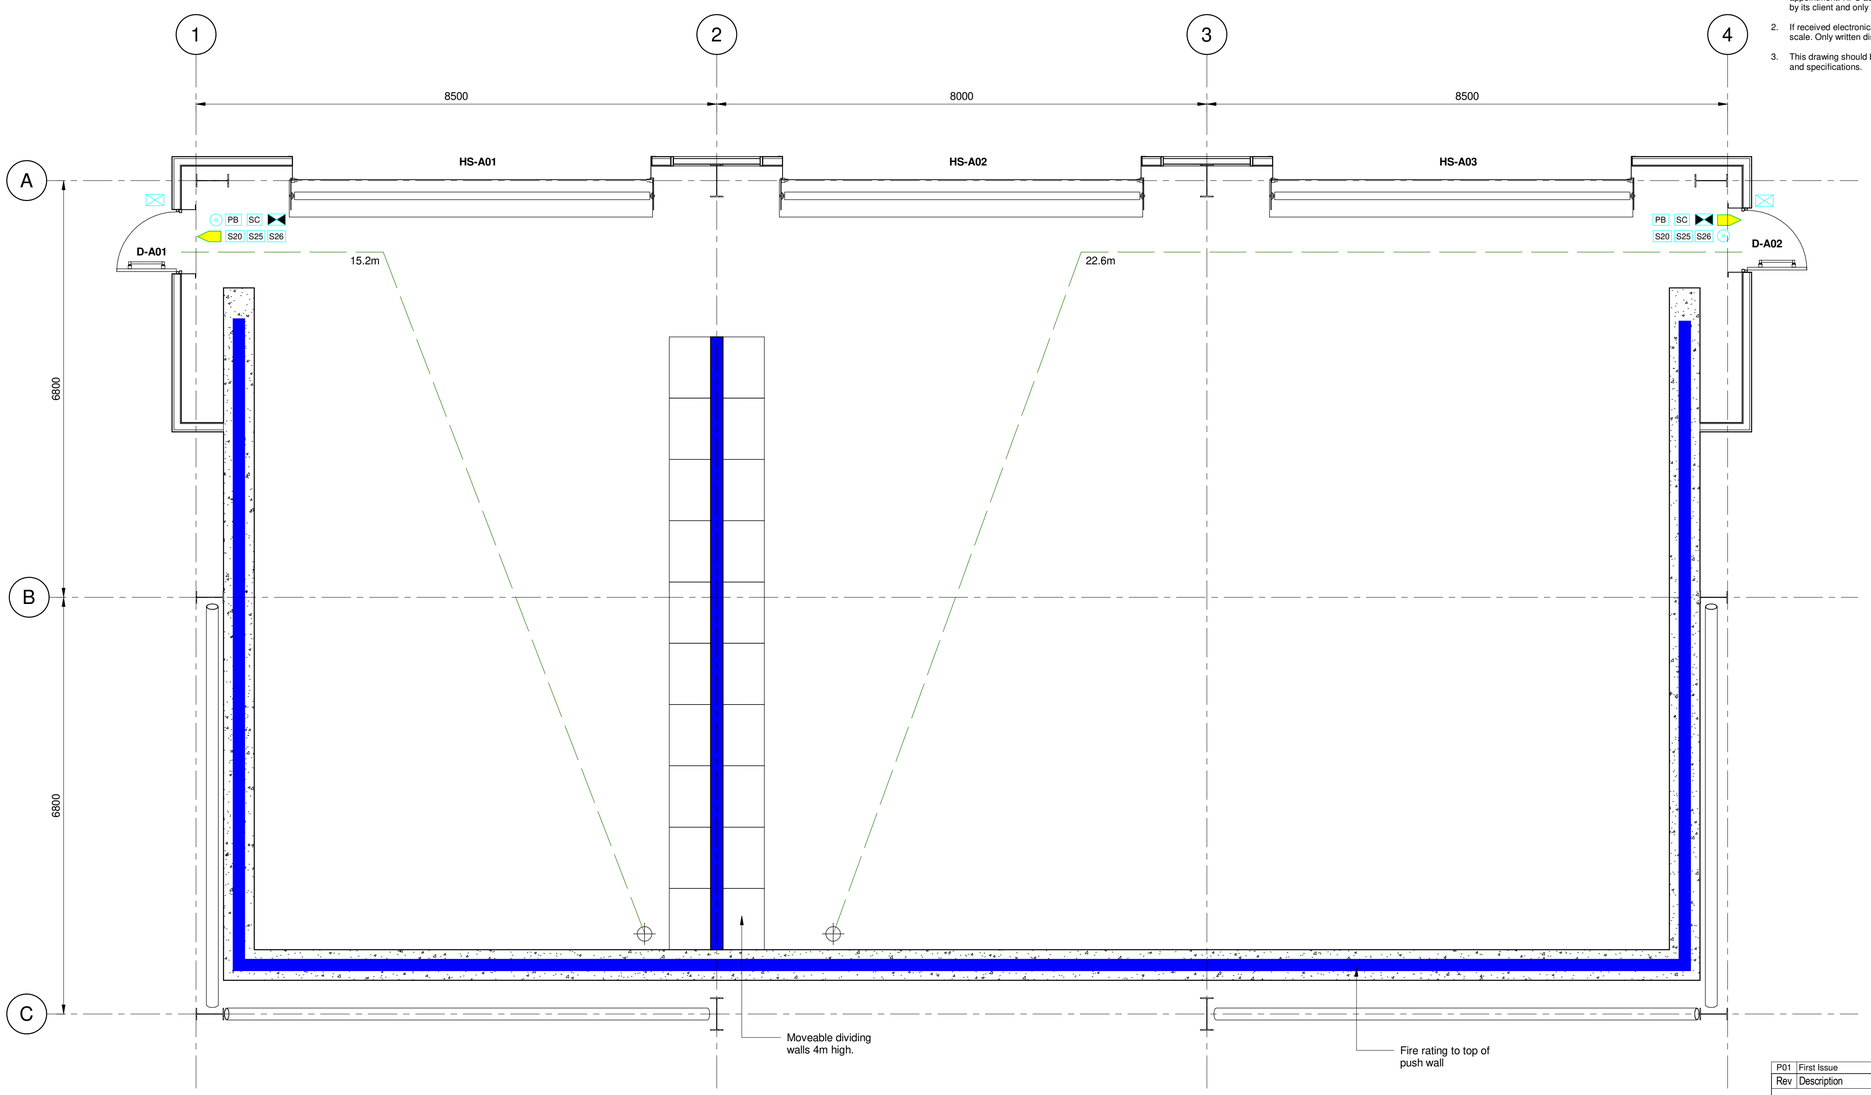

Proposed Ground Floor Plan
1 : 50

1m SCALE 1:50

Rev	Description	By	Ckd	Date
P01	First Issue	JJD	SG	17/12/21

MAKING COMPLEX EASY

321 Bradford Street
Birmingham
B5 6ET
T:+44 (0) 121 622 8520

Client
Balfour Beatty
Hertfordshire

Project: Ware Waste Transfer Station

Title: Fire Safety Plan - Additional Building

RPS Project Number	Scale	Date Created
NK020027	As indicated	17/12/2021

Task Team Manager	Information Author	Task Information Manager
SG	JJD	SG

Status
S2 (Suitable for Information)

Document Number: 020027-RPS-AB-00-DR-A-9031
Project Code - Originator - VolSys - Level/Loc - Type - Role - Drawing Number

Revision: P01

rpsgroup.com