Early Years Water Demand and Supply TCA Borehole

Project	**SZC: Sizewell C**	Teamcenter ID	**101504622**
Teamcenter Contract	**Early Works EWXXXX_098_01**		
Client	**NNB Generation Co.**	Contractor Reference	**SZC-EW0300-ATK-XX-SEI-00XXXX-NOT-UTI-900001**
Contractor	**AtkinsRéalis**	Contractor Rev	**P04**
Purpose of Issue	**P1 - Published for Implementation**		
Supplier	**AtkinsRéalis**	Originators Ref	**5213850-SNC-00-XX-TTCN-Z-900002**
Prepared by	**J.Page**	Role	**Graduate Mechanical Engineer**
Reviewed by	**A.Fernihough**	Role	**Associate Director**
Approved by	**C.McBride**	Role	**Associate Director**

REVISION HISTORY

Revision	Purpose	Amendment	Prepared By	Date
P04	P1 - Published for Implementation	Updated Water Construction Demand	JP	24/03/26
P03	P1P1Published for Implementation	Expansion of water demand build up level of detail.	PH	24/07/25
P02	P1Published for Implementation	Detailed Water Demand Breakdown	PH	03/07/25
P01	P1Published for Implementation	First Revision	PH	13/05/25

Notice

This document and its contents have been prepared and are intended solely as information for Sizewell C Limited (SZC Ltd.) and use in relation to the Sizewell C project.

AtkinsRéalis assumes no responsibility to any other party in respect of or arising out of or in connection with this document and/or its contents.

Document history

Client Doc Code: SZC-EW0300-ATK-XX-SEI-00XXXX-NOT-UTI-900001
Document title: Early Years Water Demand and Supply TCA Borehole

Rev	Status	Purpose Description	Originated	Checked	Reviewed	Authorised	Date
P04	S3	P1 - Updated Water Construction Demand	JP	GR	AF	CM	24/03/26
P03	S3	P1 - Expansion of water demand build up level of detail.	PH	GR	AF	SF	24/07/25
P02	S3	P1 - Detailed Water Demand Breakdown	PH	GR	AF	AP	03/07/25
P01	S3	P1 - First Revision	PH	AF	CM	AP	13/05/25
		-					
		-					

Contents

1. Introduction **5**

2. Industrial Water Overview **5**

2.1 Demand 5
2.1.1 Concrete Batching 5
2.1.2 Marine and Tunnelling (M&T) 5
2.1.3 Ground Improvement 5
2.1.4 Bentonite Slurry 6
2.2 Supply 6
2.3 Storage 7

3. Summary **8**

1. Introduction

This memorandum outlines the breakdown of the activities creating the demand for industrial water and justifies the need for abstraction from the Temporary Construction Area (TCA) Borehole.

2. Industrial Water Overview

2.1 Demand

- Initial demands for industrial water in the early years (2026-2027) are driven by Concrete batching, Marine and Tunnelling (M&T), Ground Improvements, and Bentonite Slurry.
- These activities create peak demands of 1600 m^3/day in July of 2026 and in March of 2027.
- Industrial water accounts for about 95% of the overall water demand, while potable water makes up the remaining 5%. Potable water will be supplied using tankers during this period and does not form part of the TCA Borehole demand profile.
- Peak demands will be provided using stored water. Daily peak demand values need to be accommodated, rather than monthly averages.

2.1.1 Concrete Batching

- Concrete batching (400 m3/day at peak) as defined by the Civil Works Alliance (CWA) Water Forecast Demand data. This demand is driven by site establishment construction activities.
- This leads to a total water demand of 29,708m3 of water between April 2026 and March of 2027.

2.1.2 Marine and Tunnelling (M&T)

- Marine and Tunnelling (M&T) (356 m3/day at peak) as defined by the CWA Interface Control Document: M&T/EW300 – Supply and Discharge of Tunnelling Water. This demand is split between activities involving the Combined Discharge Outfall (CDO) and the Tunnel Boring Machine (TBM).
- The CDO creates a daily water demand of 45m3 until the end of April 2026.
- The Tunnel Boring Machine (TBM) general activity begins in July of 2026 and generates a daily water demand of 168m3, driven by a 20m3/h water demand for the TBM cooling plant and 7m3/h water demand for general TBM usage.
- This leads to a total water demand of 50,206m3.

2.1.3 Ground Improvement

- Ground Improvement (1279m3/day at peak) as defined by the CWA Water Forecast Demand data. This demand is driven by site establishment construction activities.
- This leads to a water demand of around 176,048m3 of water between April 2026 and March of 2027.

2.1.4 Bentonite Slurry

- Bentonite Slurry (353m^3/day at peak) as defined by the Civil Works Alliance (CWA) Water Forecast Demand data. This demand is driven by site establishment construction activities.
- This leads to a water demand of around 24,198m^3 of water between April 2026 and March of 2027.

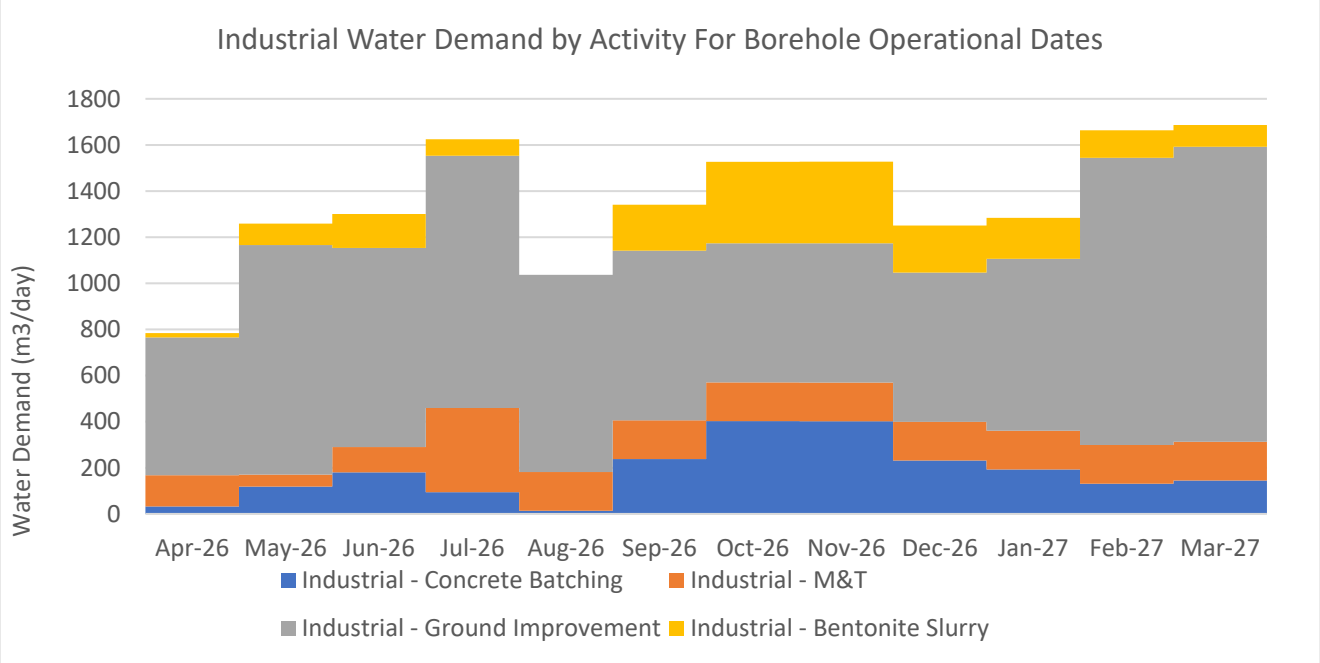


Figure 1: Industrial Water Demand by Activity

2.2 Supply

- Currently the site is supplied from Authorised Anglian water tankering filling points with up to 750m3/day, but from May 2026, this will transition to SZC's water sourcing facility Orwell Logistics Park, supplying up to 500 m3/d.
- The TCA borehole abstraction is planned to be utilised from April of 2026 up until the start of operation of the desalination plant.
- A volume of 600m3/day is proposed for the abstraction from the TCA borehole based on the existing third-party licensed capacity of 600m3/day which is to be acquired through license trading.
- The desalination plant is planned to commence at in July 2027 and supply potable quality water up to 4950 m3/day. This will support the potable water sourced from the water sourcing facility at Orwell Logistics Park to meet the demands on site.

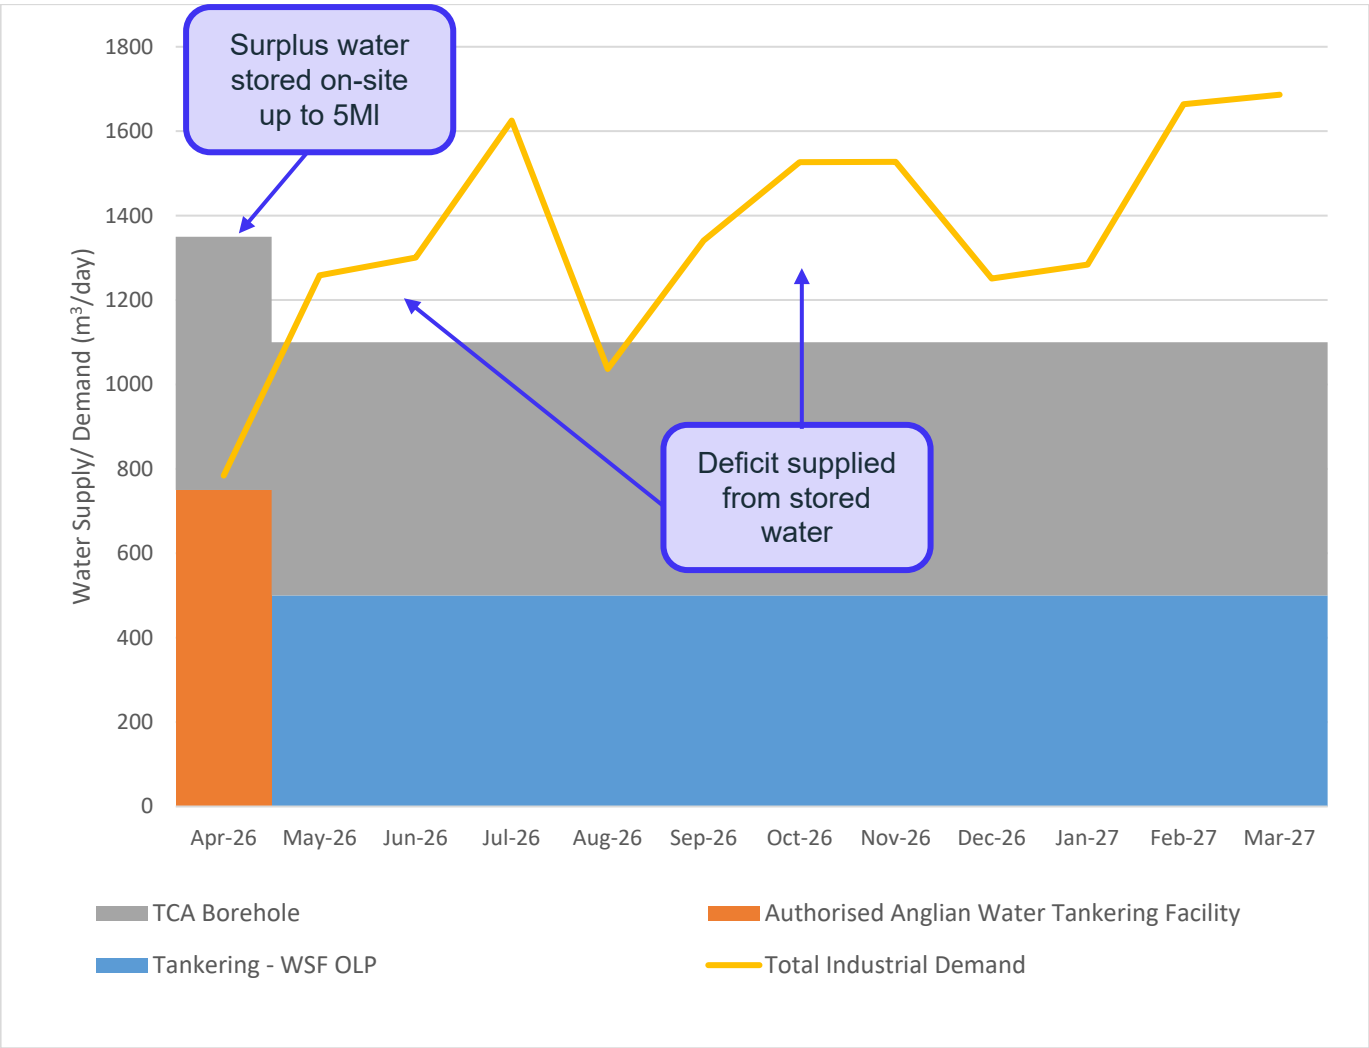


Figure 2: TCA Borehole Supply/Demand

2.3 Storage

- 4no. 25m³ storage tanks have been constructed in the Water Transfer Facility, which is the slab and stone area constructed beside the TCA Borehole. These tanks will be used for buffering of the daily tankering on site as well as peak demand storage.
- 1no. 1000m³ storage tank in planned for construction within the permanent concrete batcher (CWA).
- 4no. 30m³ is planned for construction within the MCA (CWA).
- Total 60m³ planned for construction within the in Mobile concrete batcher (CWA).

Additional storage to accommodate peak water demands is being designed and will be confirmed.

3. Summary

In summary the TCA borehole abstraction will be utilised for the key demands listed in the previous sections, majority of the abstracted water supporting the Concrete Batching, M&T, Ground Improvement and Bentonite Slurry, totalling 280,160m3 compared to a borehole total abstraction volume at 600m3 for 365 days totalling 219,000 m3 over the annual operation period of the TCA borehole. This results a deficit of 61,160 m3 during the operational period.

AtkinsRéalis

AtkinsRéalis
Woodcote Grove,
Ashley Road,
Epsom,
Surrey.
KT18 5BW

© AtkinsRéalis except where stated otherwise

Early Years Water Demand and Supply TCA Borehole

Project	**SZC: Sizewell C**	Teamcenter ID	**101504622**
Teamcenter Contract	**Early Works EWXXXX_098_01**		
Client	**NNB Generation Co.**	Contractor Reference	**SZC-EW0300-ATK-XX-SEI-00XXXX-NOT-UTI-900001**
Contractor	**AtkinsRéalis**	Contractor Rev	**P04**
Purpose of Issue	**P1 - Published for Implementation**		
Supplier	**AtkinsRéalis**	Originators Ref	**5213850-SNC-00-XX-TTCN-Z-900002**
Prepared by	**J.Page**	Role	**Graduate Mechanical Engineer**
Reviewed by	**A.Fernihough**	Role	**Associate Director**
Approved by	**C.McBride**	Role	**Associate Director**

REVISION HISTORY

Revision	Purpose	Amendment	Prepared By	Date
P04	P1 - Published for Implementation	Updated Water Construction Demand	JP	24/03/26
P03	P1P1Published for Implementation	Expansion of water demand build up level of detail.	PH	24/07/25
P02	P1Published for Implementation	Detailed Water Demand Breakdown	PH	03/07/25
P01	P1Published for Implementation	First Revision	PH	13/05/25

Notice

This document and its contents have been prepared and are intended solely as information for Sizewell C Limited (SZC Ltd.) and use in relation to the Sizewell C project.

AtkinsRéalis assumes no responsibility to any other party in respect of or arising out of or in connection with this document and/or its contents.

Document history

Client Doc Code: SZC-EW0300-ATK-XX-SEI-00XXXX-NOT-UTI-900001
Document title: Early Years Water Demand and Supply TCA Borehole

Rev	Status	Purpose Description	Originated	Checked	Reviewed	Authorised	Date
P04	S3	P1 - Updated Water Construction Demand	JP	GR	AF	CM	24/03/26
P03	S3	P1 - Expansion of water demand build up level of detail.	PH	GR	AF	SF	24/07/25
P02	S3	P1 - Detailed Water Demand Breakdown	PH	GR	AF	AP	03/07/25
P01	S3	P1 - First Revision	PH	AF	CM	AP	13/05/25
		-					
		-					

Contents

1. Introduction 5

2. Industrial Water Overview 5

2.1 Demand 5
2.1.1 Concrete Batching 5
2.1.2 Marine and Tunnelling (M&T) 5
2.1.3 Ground Improvement 5
2.1.4 Bentonite Slurry 6
2.2 Supply 6
2.3 Storage 7

3. Summary 8

1. Introduction

This memorandum outlines the breakdown of the activities creating the demand for industrial water and justifies the need for abstraction from the Temporary Construction Area (TCA) Borehole.

2. Industrial Water Overview

2.1 Demand

- Initial demands for industrial water in the early years (2026-2027) are driven by Concrete batching, Marine and Tunnelling (M&T), Ground Improvements, and Bentonite Slurry.
- These activities create peak demands of 1600 m^3/day in July of 2026 and in March of 2027.
- Industrial water accounts for about 95% of the overall water demand, while potable water makes up the remaining 5%. Potable water will be supplied using tankers during this period and does not form part of the TCA Borehole demand profile.
- Peak demands will be provided using stored water. Daily peak demand values need to be accommodated, rather than monthly averages.

2.1.1 Concrete Batching

- Concrete batching (400 m3/day at peak) as defined by the Civil Works Alliance (CWA) Water Forecast Demand data. This demand is driven by site establishment construction activities.
- This leads to a total water demand of 29,708m3 of water between April 2026 and March of 2027.

2.1.2 Marine and Tunnelling (M&T)

- Marine and Tunnelling (M&T) (356 m3/day at peak) as defined by the CWA Interface Control Document: M&T/EW300 – Supply and Discharge of Tunnelling Water. This demand is split between activities involving the Combined Discharge Outfall (CDO) and the Tunnel Boring Machine (TBM).
- The CDO creates a daily water demand of 45m3 until the end of April 2026.
- The Tunnel Boring Machine (TBM) general activity begins in July of 2026 and generates a daily water demand of 168m3, driven by a 20m3/h water demand for the TBM cooling plant and 7m3/h water demand for general TBM usage.
- This leads to a total water demand of 50,206m3.

2.1.3 Ground Improvement

- Ground Improvement (1279m3/day at peak) as defined by the CWA Water Forecast Demand data. This demand is driven by site establishment construction activities.
- This leads to a water demand of around 176,048m3 of water between April 2026 and March of 2027.

2.1.4 Bentonite Slurry

- Bentonite Slurry (353m^3/day at peak) as defined by the Civil Works Alliance (CWA) Water Forecast Demand data. This demand is driven by site establishment construction activities.
- This leads to a water demand of around 24,198m^3 of water between April 2026 and March of 2027.

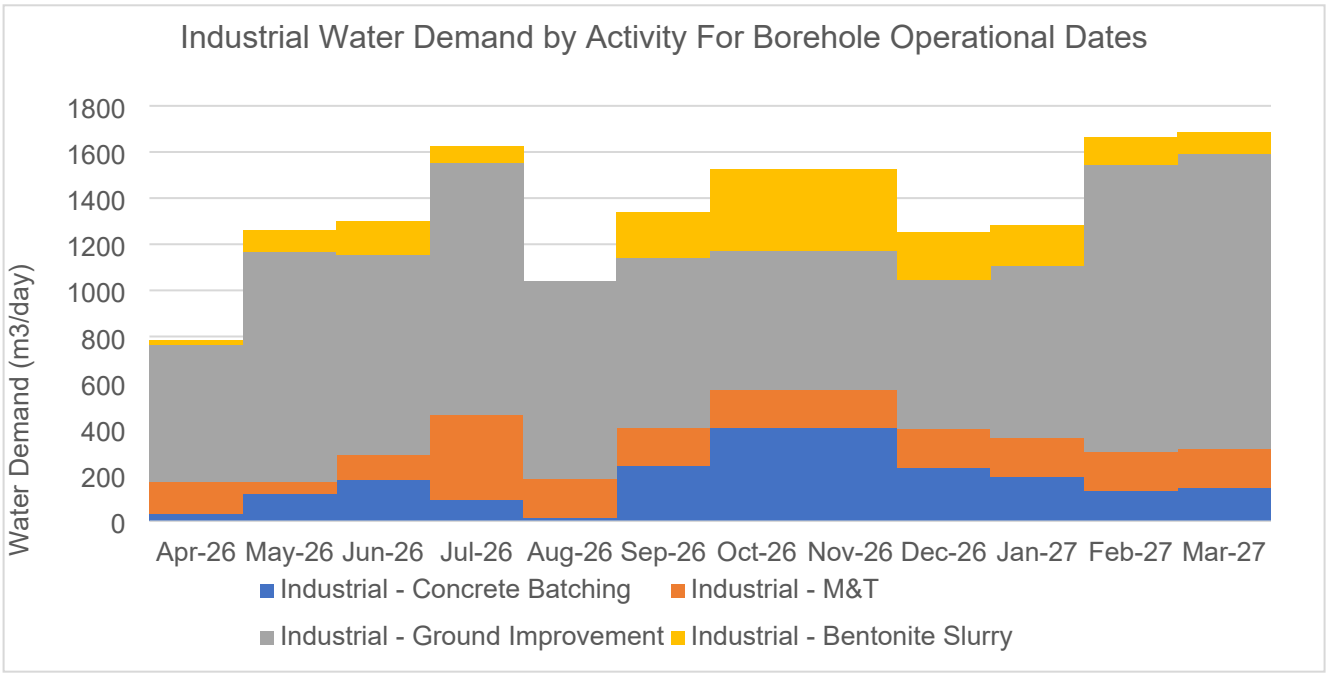


Figure 1: Industrial Water Demand by Activity

2.2 Supply

- Currently the site is supplied from Authorised Anglian water tankering filling points with up to 750m3/day, but from May 2026, this will transition to SZC's water sourcing facility Orwell Logistics Park, supplying up to 500 m3/d.
- The TCA borehole abstraction is planned to be utilised from April of 2026 up until the start of operation of the desalination plant.
- A volume of 600m3/day is proposed for the abstraction from the TCA borehole based on the existing third-party licensed capacity of 600m3/day which is to be acquired through license trading.
- The desalination plant is planned to commence at in July 2027 and supply potable quality water up to 4950 m3/day. This will support the potable water sourced from the water sourcing facility at Orwell Logistics Park to meet the demands on site.

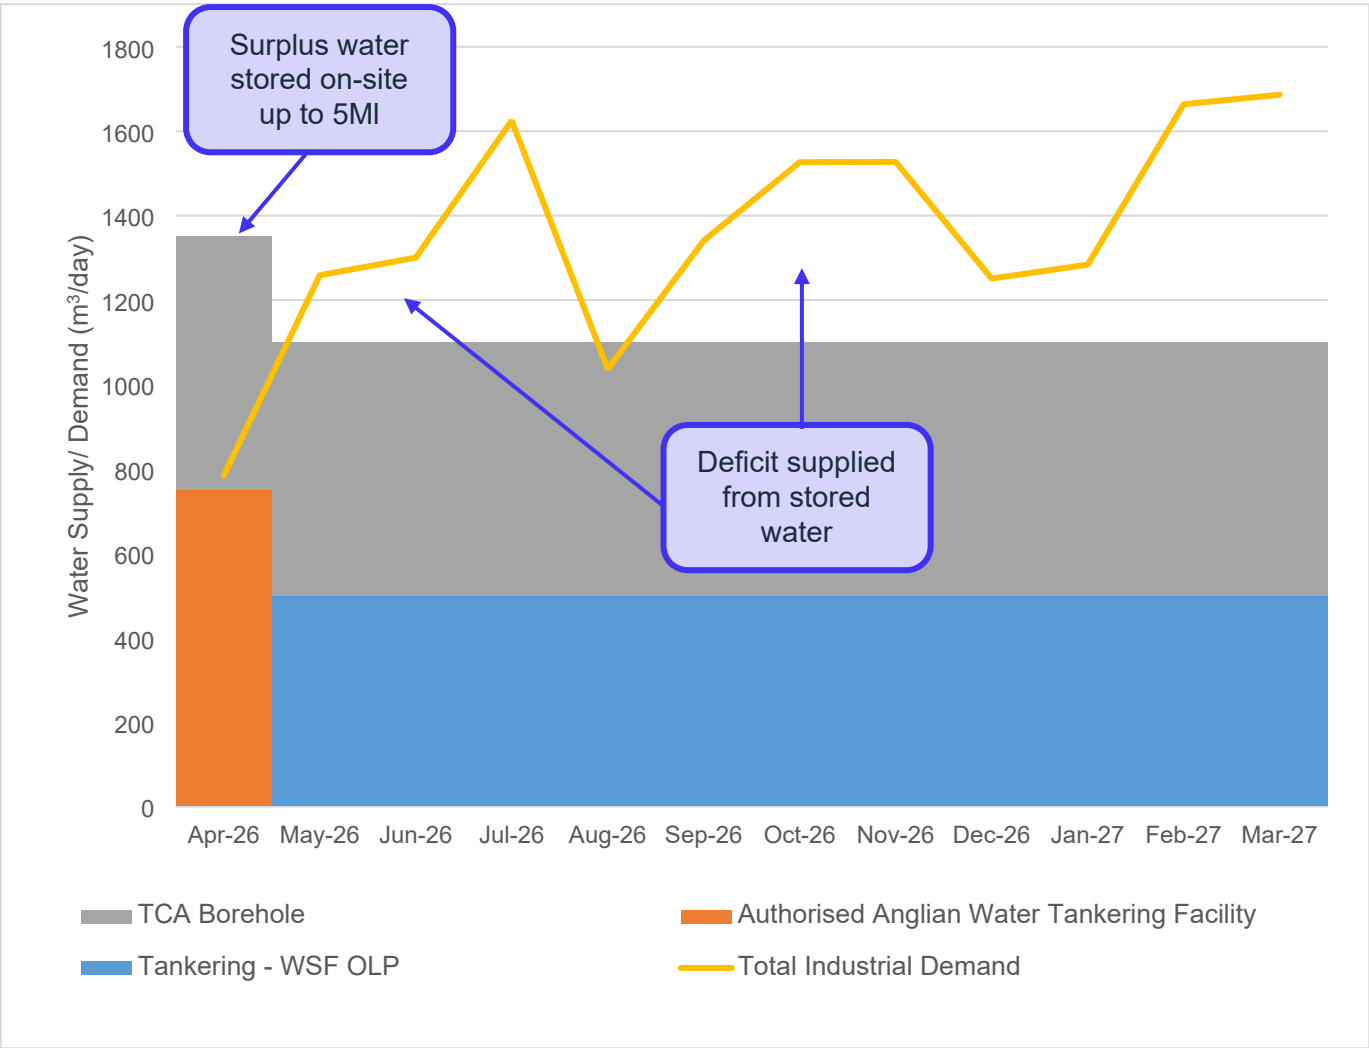


Figure 2: TCA Borehole Supply/Demand

2.3 Storage

- 4no. 25m³ storage tanks have been constructed in the Water Transfer Facility, which is the slab and stone area constructed beside the TCA Borehole. These tanks will be used for buffering of the daily tankering on site as well as peak demand storage.
- 1no. 1000m³ storage tank in planned for construction within the permanent concrete batcher (CWA).
- 4no. 30m³ is planned for construction within the MCA (CWA).
- Total 60m³ planned for construction within the in Mobile concrete batcher (CWA).

Additional storage to accommodate peak water demands is being designed and will be confirmed.

3. Summary

In summary the TCA borehole abstraction will be utilised for the key demands listed in the previous sections, majority of the abstracted water supporting the Concrete Batching, M&T, Ground Improvement and Bentonite Slurry, totalling 280,160m3 compared to a borehole total abstraction volume at 600m3 for 365 days totalling 219,000 m3 over the annual operation period of the TCA borehole. This results a deficit of 61,160 m3 during the operational period.

AtkinsRéalis

AtkinsRéalis
Woodcote Grove,
Ashley Road,
Epsom,
Surrey.
KT18 5BW

© AtkinsRéalis except where stated otherwise

101572347
Revision 02

Sizewell C Project
TCA/WRA/16 Water Monitoring Technical Note

© Copyright 2025 Sizewell C Limited. All rights reserved.

DOCUMENT CONTROL

This document is stored and approved in the Electronic Document and Records Management System (EDRMS).

Prepared by:	[redacted]
Verified by:	[redacted]
Reviewed by:	[redacted]
Approved by:	[redacted]

REVISION HISTORY

Rev	Status	Amendment	Prepared By	Date
01	Final	For issue	[redacted]	24/07/2025
02	Final	Update following EA comments	[redacted]	05/08/2025

CONTENTS

1 INTRODUCTION 4
1.1 Purpose 4
1.2 Scope 4
1.3 Definitions 4
1.4 Sensitive Receptors 5
1.5 Assessment Locations 5
2 MONITORING LOCATIONS 7
2.1 Existing Monitoring Locations 7
2.2 Proposed monitoring points 8
2.3 Historic monitoring records 12
3 TRIGGER LEVELS 14
4 MANAGEMENT ACTIONS 17
5 CONCLUSIONS 18
ANNEX A BOREHOLE LOGS 19
ANNEX B HISTORIC WATER LEVEL MONITORING GRAPHS 20

1 INTRODUCTION

1.1 Purpose

As part of the development of the Nuclear Power Station at Sizewell C, construction and use of a new groundwater abstraction in the Temporary Construction Area (TCA) is planned.

Sizewell C Limited (SZC) has applied for a Water Abstraction Licence (Ref NPS/WR/040323 | TCA/WRA/16) which presents the details of the new abstraction location. This document is in support of the permit application. The permit application was submitted in April 2025, expected determination is mid-September 2025 and the supporting information contained herein is required as part of the determination process.

1.2 Scope

The scope of this document is to:

- identify existing monitoring locations that could be used to monitor water levels in proximity to sensitive receptors; and
- agree trigger levels at compliance monitoring points in relation to the TCA borehole.

Where monitoring locations are identified, historical monitoring data, where available, has been utilised to determine appropriate trigger levels. Monitoring of these levels will be undertaken to prove no impact to environmental receptors during the operational phase of the TCA borehole.

The supporting documentation to the Water Abstraction Licence noted in **Section 1.1**, indicates that impact on the water environment due the new abstraction is not expected. The proposed monitoring, set out in this document, is an additional measure to confirm the real-world response to abstraction from the TCA borehole. A proposed response via stipulated management actions, if the abstraction effects are greater than anticipated, is provided.

1.3 Definitions

Term / Abbreviation	Definition
CSM	Conceptual Site Model
DCO	Development Consent Order
EA	Environment Agency
EDRMS	Electronic Document and Records Management System
HRA	Habitat Regulations Assessment
NEAC	North-East Anglian Chalk
SAC	Special Area of Conservation
SPA	Special Protection Area
SSSI	Site of Special Scientific Interest
SZC	Sizewell C
TCA	Temporary Construction Area
WMMP	Water Monitoring and Management Plan

1.4 Sensitive Receptors

The following Sites of Special Scientific Interest (SSSIs), Special Areas of Conservation (SACs), Special Protection Areas (SPAs) and Ramsar sites have been identified as sensitive receptors in the submitted Habitats Regulation Assessment (HRA)[1] with this application.

Sensitive Receptor Site	Distance from Permit location
Sizewell Marshes SSSI	0.68km SE from abstraction point
Minsmere to Walberswick SSSI	0.63km N from abstraction point
Minsmere to Walberswick Heaths and Marshes SAC	1.25km N from abstraction point
Minsmere-Walberswick SPA	1.25km N from abstraction point
Minsmere-Walberswick Ramsar site	1.25km N from abstraction point

The designated sites are wetland habitats therefore operation of the TCA borehole should not cause an impact on their function. The mechanism by which there could be an impact is through drawdown of water levels in the Crag resulting in a change in the hydrogeological and hydrological regime. The designated sites contain ecological features of interest supported by the current hydraulic function. If monitoring can demonstrate that the zone of influence of the TCA borehole does not extend within the boundaries of the designated sites, this shows there is no impact to these sites.


In addition to the above sensitive receptors, the Marsh Harrier compensation habitat is also considered of importance. The proposed groundwater level monitoring will ensure that the effects of abstraction at the TCA borehole do not extend to the Marsh Harrier Lake and that there is no unacceptable change in Crag groundwater levels beneath the compensation habitat. For a location plan including the Marsh Harrier compensation habitat, please refer to enclosed TCA/WRA/16 Monitoring Location Plan (EDRMS ref: 101572348)

1.5 Assessment Locations

Compliance points have been set out as per the North-East Anglian Chalk (NEAC) groundwater model to assess the potential impact from the new TCA abstraction. These locations are shown on **Figure 1** and were requested by the Environment Agency (EA) for inclusion in the pumping test analysis and comparison with the model predicted impact. The same locations have been used to identify and select the most suitable monitoring points during the operational phase of the TCA borehole.

[1] Package to Inform Countryside Rights of Way (CRoW) Act Assessment and Habitats Regulations Assessment, Permit TCA/WRA/16, Version 001, EDRMS Reference Number 101497983

Figure 1 – Assessment locations

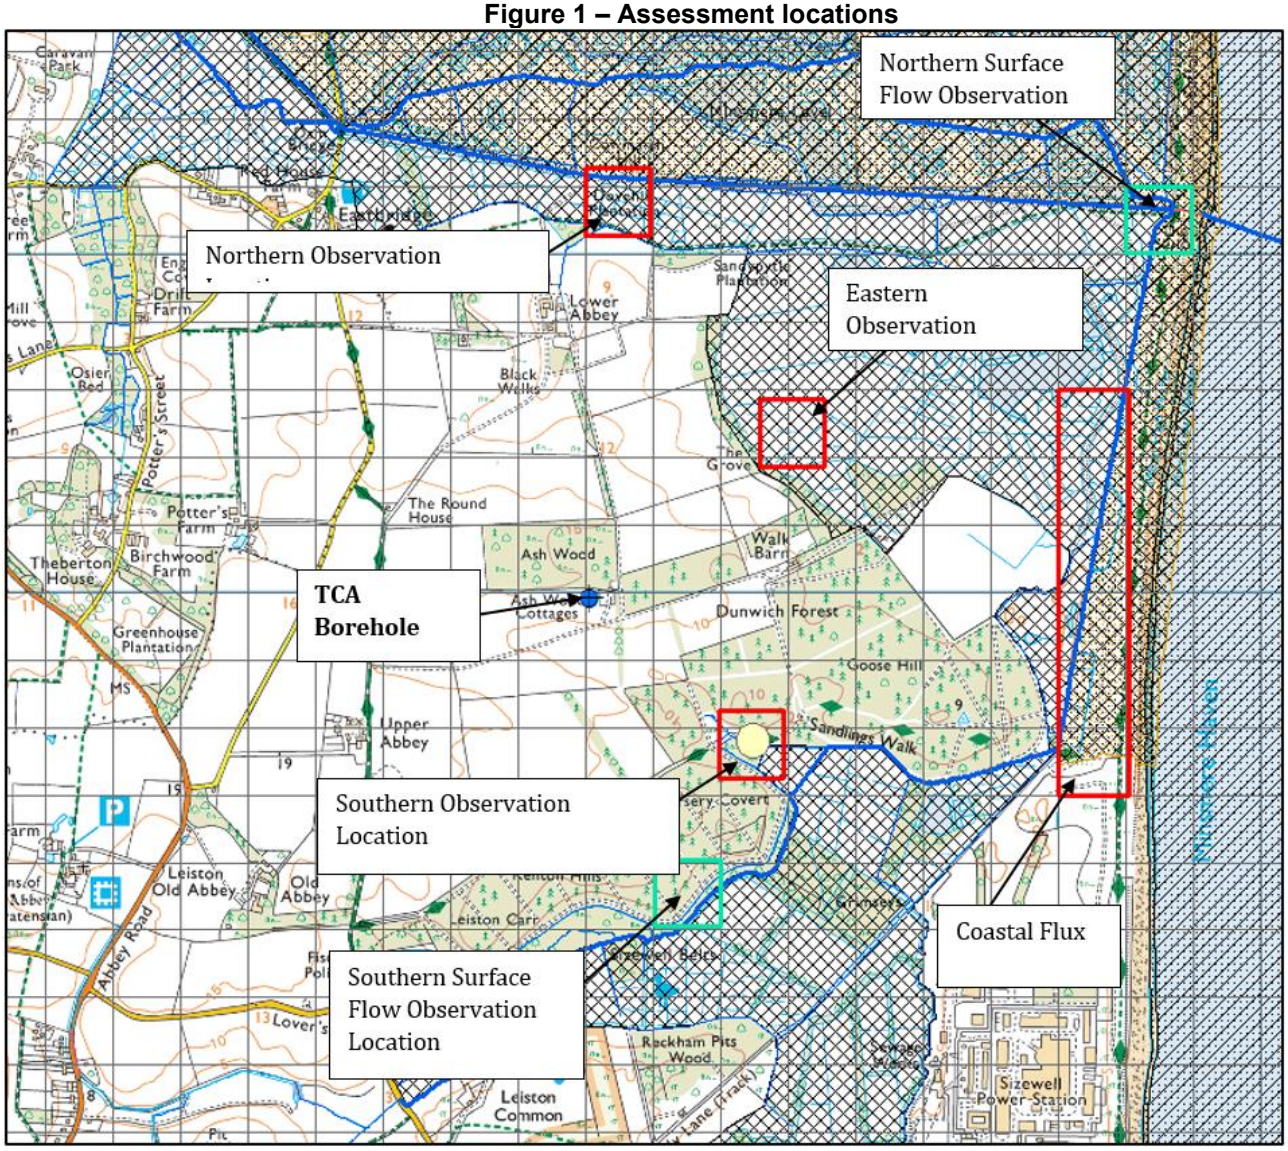

The locations used in modelling assessment are represented **Figure 1** are represented as the following:


- 2 surface water cells as turquoise squares;
- 3 SSSI single model cells as red squares; and
- Coastal flux row cells as red rectangle.

2 MONITORING LOCATIONS

2.1 Existing Monitoring Locations

Figure 2 shows existing monitoring points with respect to the TCA borehole (shown as PB01). Some locations were installed as part of the monitoring network for the TCA borehole pumping test (e.g. PT01, PT01, PT05), whilst others represent pre-existing monitoring points (e.g. PZ2009_20, C3D). All points presented in **Figure 2** represent the available locations at which monitoring can be undertaken.

Figure 2 – Existing Monitoring Locations

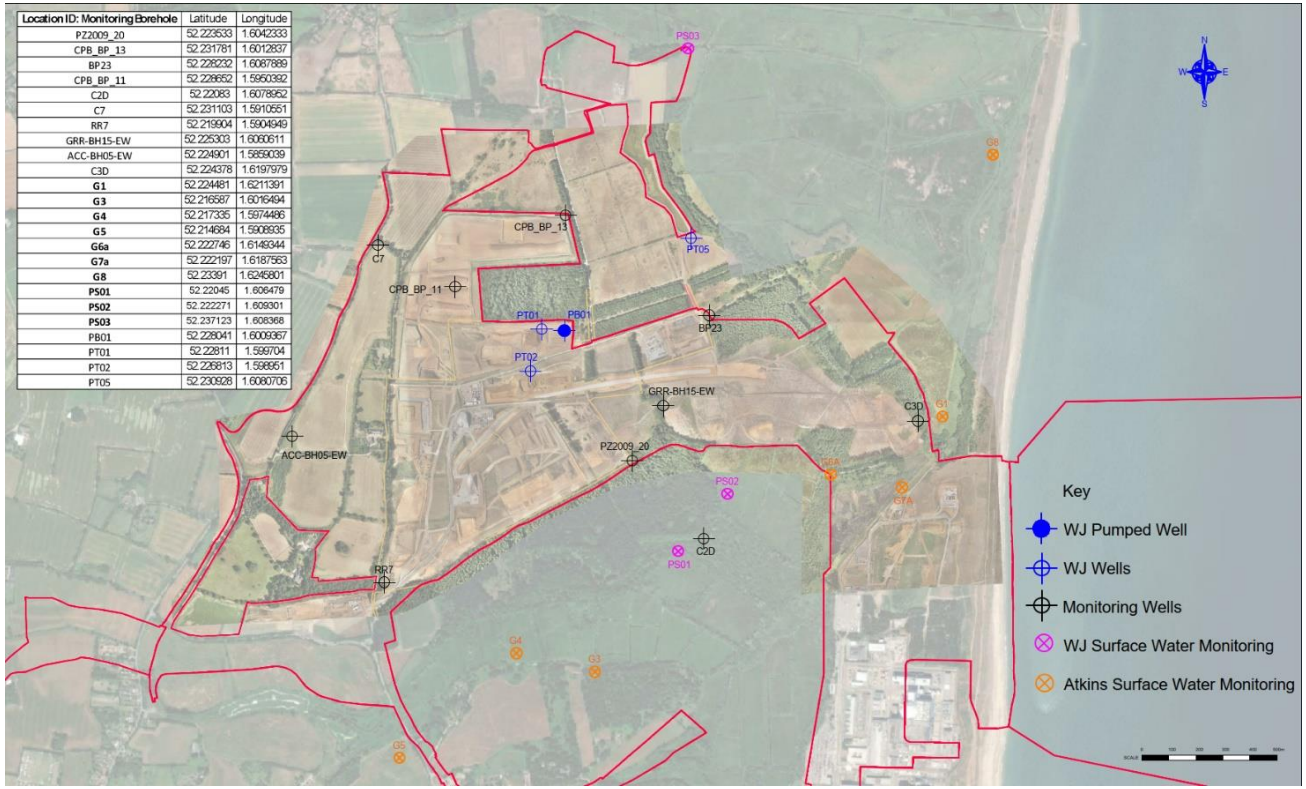

2.2 Proposed monitoring points

Based on the location of the available monitoring points and the compliance points, the monitoring locations listed in **Table 1** have been selected. Monitoring points CPB_BP11, CPB_BP_13 and GRR-BH15-EW are no longer available as they have been removed during the construction activity in the area. Alternative monitoring points at a comparable distance from the point of abstraction have been proposed to allow distance-drawdown effects to be assessed. Surface water monitoring point G8 is already monitored as part of the Water Monitoring and Management Plan (WMMP) so is therefore not included as part of this monitoring proposal. It has been included in the table below for completeness.

Table 1 – Proposed Monitoring Points

Monitoring Point	Surface water or Groundwater	Easting	Northing	Depth (m bgl)	Proposed Monitoring Method	Comments / Rationale
PB01*	Groundwater	646010	264972	40.0	Datalogger	Groundwater abstraction in the Crag for which abstraction licence is being applied for (Ref NPS/WR/040323 | TCA/WRA/16). Maximum drawdown of 0.75m at the pumping well PB01 was recorded during the pumping test performed in February – March 2025.
PT01	Groundwater	645927	264978	15.0	Datalogger	PT01 monitors the groundwater within the Crag and it is the closest point to the abstraction borehole (marked as PB01 in Figure 1). It gives a good indication of how the cone of depression evolves around the abstraction borehole.
PT02	Groundwater	645885	264824	10.91	Datalogger	PT02 is proposed as a monitoring point to help define the extent of cone of depression of the abstraction as it is the second closest borehole to the abstraction after PT01.
PT05	Groundwater	646479	265315	15.0	Datalogger	PT05 monitors the groundwater within the Crag. This point is located between the abstraction borehole and the Eastern Observation Location which could be used as for ensuring no significant impact from the abstraction occurs at the Eastern Observation Location. The location of PT05 is half the distance from PB01 to the Northern Observation Location (see Figure 1) and it is proposed for monitoring the groundwater level to track potential water change in this location. It could also serve as a monitoring point for the latter, given that CPB_BP_13 is not available for monitoring purposes. PT05 is also selected as it is located at the southerly extent of the Marsh Harrier lagoon, at its closest point to the abstraction

Monitoring Point	Surface water or Groundwater	Easting	Northing	Depth (m bgl)	Proposed Monitoring Method	Comments / Rationale
						borehole (PB01). If no decrease below trigger level due to pumping is identified at this location, it would indicate that the lagoon and compensation habitat are not impacted.
C3D	Groundwater	647320	264639	24.0	Datalogger (to include recording of Electrical Conductivity)	C3D extends within the Alluvium Deposits and the Crag Formation. This monitoring point is proposed for assessment of the potential for reversing the flow and inland saline intrusion, as per the coastal flux compliance point shown on Figure 1.
PZ2009_20 (GW4)	Groundwater	646261	264492	10.7	Datalogger	PZ2009_20 (also known as GW4) is proposed to monitor change in the groundwater levels from the pumping which could show impact at the Southern Observation Location marked on Figure 1, as it is located between the abstraction point and the observation location.
C2D	Groundwater	646527	264204	24.0	Datalogger	This groundwater monitoring point is proposed to be used for the Southern Surface Flow Observation Location indicated on Figure 1 due to its proximity with PS01 and the flow observation location. It is also on the boundary of the Sizewell Marshes SSSI. If no decrease below trigger level due to pumping is identified at this location, it would indicate that the SSSI is not impacted.
G8	Surface Water	647593	265715	N/A	Automatic loggers recording water level with monthly downloads and manual measurements where feasible.	Surface water monitoring providing the means of demonstrating the lack of effect downstream of the MCA. The reach is influenced by tide locking at Minsmere Sluice, which can only fully be separated from the fluvial influence by using both gates.

Monitoring Point	Surface water or Groundwater	Easting	Northing	Depth (m bgl)	Proposed Monitoring Method	Comments / Rationale
					Monthly water quality.	

It should be noted that even though the proposed groundwater monitoring locations are within the Crag, they are considered valid for monitoring and assessing impact within the nearby SSSI locations and the superficial peat deposits. This is because, if significant changes occur in the Crag due to abstraction, the groundwater levels in the monitoring boreholes (which are monitoring the Crag) will be detected before changes are observed within the peat. Peat levels will be monitored via the P series monitoring points in addition as part of our DCO Requirement 11 Water Monitoring and Management Plan. These results can also be reviewed for effect if changes in the Crag are observed.

2.3 Historic monitoring records

The historic monitoring records of water levels are available for the site at the locations listed in **Table 2** below. The available monitoring datasets at BP_23, C2D, C3D, C7, CPB_BP_11, CPB_BP_13, PZ2009_20 and G8 have been collected during the Development Consent Order (DCO) stage (October 2013 – June 2019), the post-DCO monitoring (January 2019 – October 2021) and during the TCA borehole pumping test (February 2025 – March 2025).

G8 is included in the WMMP for continuous monitoring and has associated trigger level developed already.

Table 2 –Historic Water Level Monitoring Records Near the TCA Abstraction

Monitoring Point	Surface Water or Groundwater	Min Water level (mAOD)	Max water level (mAOD)	Average Water Level (mAOD)	Monitoring Period
PB01*	Groundwater	0.18	1.54	1.15	11/02/2025 – 12/03/2025
PT01	Groundwater	1.38	1.58	1.48	11/02/2025 – 12/03/2025
PT02	Groundwater	1.48	1.64	1.57	11/02/2025 – 12/03/2025
PT05	Groundwater	0.95	1.02	0.99	04/02/2025 – 13/03/2025
BP_23	Groundwater	1.07	1.13	1.10	11/02/2025 – 12/03/2025
		0.996	1.132	1.073	20/10/2021 – 10/05/2022
		0.803	1.33	1.06	31/01/2019 – 20/10/2021
		0.724	1.270	1.011	21/08/2014 - 04/06/2019
C2D	Groundwater	0.685	0.898	0.794	20/10/2021 - 11/05/2022
		0.528	0.972	0.762	31/01/2019 - 20/10/2021
		0.396	0.892	0.696	14/10/2013 – 05/06/2019
C3D	Groundwater	0.37	1.11	0.73	17/04/2024 – 11/06/2025
		0.504	0.952	0.745	04/06/2019 – 20/10/2021
		0.361	0.864	0.685	18/10/2013 – 05/06/2019
C7	Groundwater	1.93	1.99	1.96	04/02/2025 – 13/03/2025
		1.99	2.65	2.26	30/01/2019 - 21/10/2021
		2.04	2.61	2.27	21/08/2014 - 06/06/2019
CPB_BP_11	Groundwater	1.64	1.71	1.67	04/02/2025 – 13/03/2025
		1.07	2.17	1.79	30/01/2019 - 21/10/2021

Monitoring Point	Surface Water or Groundwater	Min Water level (mAOD)	Max water level (mAOD)	Average Water Level (mAOD)	Monitoring Period
		1.58	1.91	1.70	20/08/2015 - 30/04/2019
CPB_BP_13	Groundwater	1.25	1.34	1.29	04/02/2025 – 13/03/2025
		0.97	1.57	1.23	28/01/2019 - 21/10/2021
		0.97	1.31	1.18	20/08/2015 - 06/06/2019
PZ2009_20 (GW4)	Groundwater	1.23	1.29	1.26	04/02/2025 – 13/03/2025
		1.033	1.486	1.268	02/05/2019 – 20/10/2021
		0.910	1.435	1.224	18/10/2013 – 02/05/2019
PS01	Surface Water	0.52	0.94	0.74	04/02/2025 – 13/03/2025
G8	Surface Water	0.18	0.89	0.53	06/11/2024 - 13/03/2025
		-0.172	0.628	0.124	03/03/2015 - 04/09/2019

*Data includes pumped levels during recorded period.

In addition to the historic monitoring of water levels data is also available for monitoring point C3D for Electrical Conductivity for the period 2013 to 2014. Groundwater in C3D was shown to have low Electrical Conductivity (<500s/cm) with little variation over time during the monitoring period. The historic data will be made available for new monitoring data to be compared against.

3 TRIGGER LEVELS

Following similar logic to that used in the WMMP, trigger levels have been determined from the historical data sets available for the proposed monitoring points.

Monitoring points that are located between the TCA borehole and the designated sites have been selected to allow identification of any influence on groundwater from the operation of the abstraction before it reaches the closest boundary of a designated site.

The trigger levels for monitoring points which have a long-term record have been set using location specific data. Where a monitoring point has been more recently established (as part of the pumping test for the TCA borehole) analogue data from cross-gradient boreholes have been used to determine the trigger level. The baseline analogue data is as established in the groundwater Conceptual Site Model (CSM)[2] and it shows that groundwater levels in the Crag are parallel to the coast in the area of the TCA borehole.

The trigger levels (**Figure 1** and **Table 3**) have been set at the 70th centile of the historical monitoring record, i.e. the level at which water levels are above 70% of the time on the full dataset of records for that monitoring location, i.e. 30 % of water level records are lower than the 70th centile. This allows timely intervention if a trigger level is passed.

For the borehole locations closest to the TCA abstraction borehole, with no proxy borehole with full historical record, the observed drawdown during the pump test was applied to the inferred typical groundwater level for an average year from the DCO CSM to calculate the trigger level. The contours used to infer the typical groundwater level were generated using industry standard techniques for interpolating between point measurements to create a plot of the groundwater table via kriging. During the DCO Examination period the EA set out in their Statement of Common Ground[3] that there were no areas of disagreement on the groundwater conceptualisation, which includes the groundwater contours generated from the monitoring data.

[2] The Sizewell C Project, 6.3 Volume 2 Main Development Site, Chapter 19 Groundwater and Surface Water, Appendix 19B: Sizewell C Conceptual Site Model of the Hydrogeological Regime Part 1 of 5, May 2020
EN010012-001920-SZC_Bk6_ES_V2_Ch19_Groundwater_and_Surface_Water_Appx19B_Part_1_of_5.pdf

[3] The Sizewell C Project, 9.10.4 Statement of Common Ground – Environment Agency, October 2021
EN010012-008186-Sizewell C Project - Final SoCG 27.pdf

Figure 3 – Indicative location of monitoring points, DCO groundwater contours for an average year and 70th centile of points with long-term monitoring data

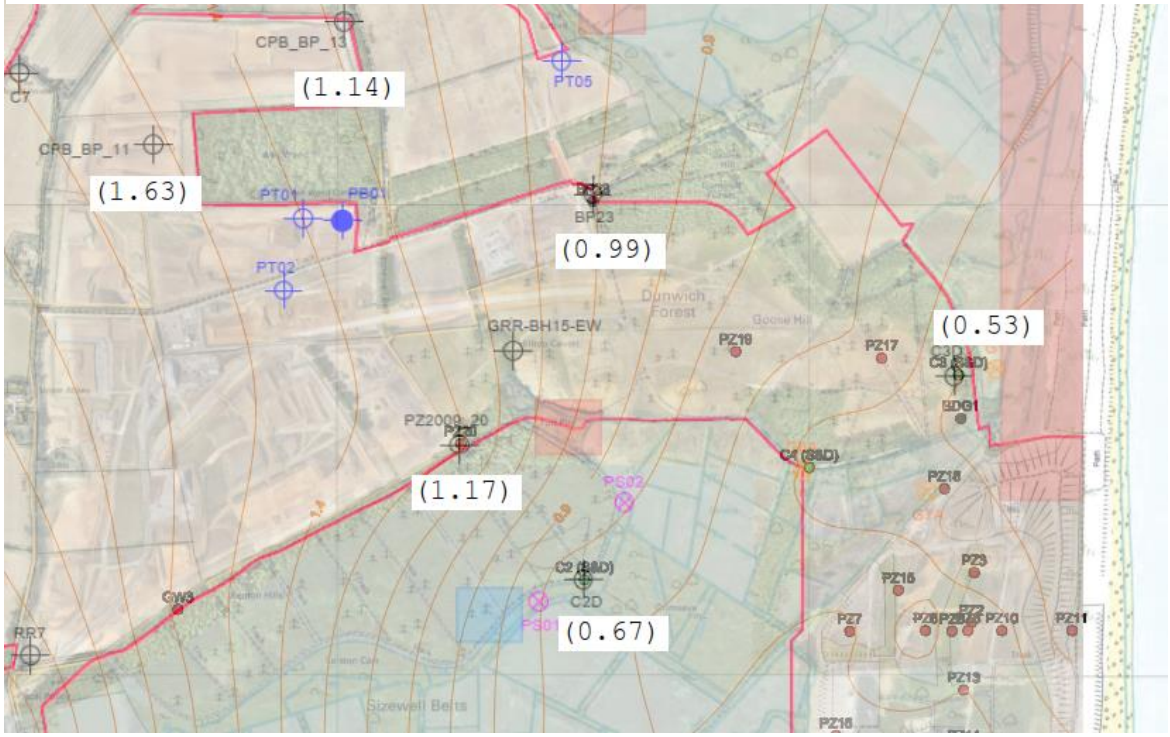


Table 3 – Proposed Trigger Levels

Location	Ground level (mAOD)	Monitoring period	Typical Groundwater level inferred from DCO contour map	Observed DD (m) from pump test	Trigger level (mAOD)	Rationale
PB01	13	11/02/2025 – 12/03/2025	1.35	0.75	**n/a**	no trigger level as it is a pumping borehole, monitoring of groundwater levels and abstracted volumes will be via flowmeter
PT01	13.5	11/02/2025 – 12/03/2025	1.4	0.1	**n/a**	Monitoring at this point will be used to define the extent of the cone of depression for the TCA abstraction.
PT02	10.9	11/02/2025 – 12/03/2025	1.45	0.1	**n/a**	Monitoring at this point will be used to define the extent of the cone of depression for the TCA abstraction.
PT05	3.53	11/02/2025 – 12/03/2025	1.05	n/a	**0.94**	Average year groundwater level at DCO as per PT01 and PT02; same distance from PB01 as BP23, so correlation with BP23 70th drop in dataset

Location	Ground level (mAOD)	Monitoring period	Typical Groundwater level inferred from DCO contour map	Observed DD (m) from pump test	Trigger level (mAOD)	Rationale
C2D	1.77	14/10/2013 - 11/05/2022	0.77	n/a	**0.67**	70th centile of full dataset, excluding pump test data
C3D	2.77	18/10/2013 - 11/06/2025	0.5	n/a	**0.53**	70th centile of full dataset
PZ2009_20 (GW4)	7.17	18/10/2013 - 13/03/2025	1.31	n/a	**1.17**	70th centile of full dataset

n/a not applicable for trigger levels

The logger installed at C3D will also record Electrical Conductivity but no trigger value is proposed for this parameter. A reduction in water levels at this location below the 70th centile will allow sufficient time for intervention before a significant reversal in hydraulic gradient occurs leading to inland movement of the saline interface.

Prior to commencement of abstraction a manual dip measurement will be taken in late summer to record water level at each monitoring point. This will allow an appraisal of the effect of an extended period of dry weather on the Crag water level following completion of the pumping test carried out in February 2025.

Data will be captured using dataloggers installed at each monitoring point to record water levels. The loggers will record data at a 15-minute frequency and will either be telemetered or downloaded on a monthly basis. The data will be reviewed monthly to determine if a trigger level has been passed. The frequency of the review reflects the nature of the designated sites and the potential for impact. The pumping test showed that over a 10-day period of continuous operation a drawdown no greater than 0.1m was observed in the monitoring points closest to the TCA borehole (within 200m).

4 MANAGEMENT ACTIONS

On passing a trigger level, a review will be undertaken of trends in the monitoring points identified in **Section 2.2**, plus other available monitoring locations in the surrounding area to determine whether the fall in water levels is related to the abstraction or reflects natural variation in response to prevailing climatic conditions. Additional data sources include monitoring undertaken under the WMMP and data from the EA's monitoring network.

Review of the monitoring data will allow the cause of the reduced levels to be determined. Indications of a natural cause include the following:

- water levels in the Crag show a consistent long-term downward trend;
- surface water flows show a consistent downward trend;
- there has been an extended period of little or no rainfall;
- lower trigger levels in the peat monitoring points in the WMMP are being passed; and
- drought conditions have been formally declared.

In the cases above, if there is no evidence that the abstraction is causing additional reduction in water levels, then there will be no corrective action needed and the borehole can continue to be operated, with regular reviews of the monitoring data. It is proposed that monthly reviews of the wider dataset continue to be undertaken until the water levels recover to be above the trigger level.

Evidence that the reduction in water levels is a consequence of the operation of the TCA borehole include:

- a clear signal showing the evolution of drawdown at the monitoring point following commencement of pumping. This would manifest as a drawdown curve;
- rising or stable water levels in the wider water environment; and
- the reduction in water levels being limited to one or more monitoring points, with reduced levels being greatest in the monitoring points closest to the abstraction borehole.

If the cause of groundwater levels falling below the trigger level can be attributed to the operation of the abstraction, an assessment of the significance will be undertaken. It is proposed that as long as the water levels at the monitoring point indicate the hydrogeological regime is within a tolerable range for the designated sites despite the additional drawdown induced by pumping then operation can continue. The frequency of monitoring level data reviews will increase to fortnightly until levels return to be above the trigger level, when they will revert to monthly.

5 CONCLUSIONS

The proposed monitoring locations have taken into account the sensitive receptors included in the HRA and the assessment locations specified by the EA for the pump test analysis. The monitoring points were set between the TCA abstraction (PB01) and the designated site boundaries, so that changes in groundwater levels due to abstraction in the TCA borehole can be detected before the impact propagates to the designated sites.

Available water level record datasets have been analysed and used to determine the 70th centile water level from the available extended groundwater monitoring datasets at key locations. This, along with information for the typical water level contours for an average year in the area derived during the DCO and data from proxy boreholes (where available) were used to determine trigger levels where records of the water levels are limited. The trigger levels will allow for timely intervention to determine whether changes in water levels are due to pumping from the TCA borehole.

If a drop in groundwater levels is detected below the trigger levels, further analysis and review will be undertaken to determine whether the drop in water level is related to the abstraction. If abstraction is not the cause of the water level drop, then cessation of pumping would not be required as it would not result in significant change in water levels.

If the analysis of the cause of groundwater level drop determines that the low groundwater levels are a consequence of abstraction, there will be an increased frequency of data review. If review of the monitoring data indicates the hydrogeological regime is within a tolerable range for the designated sites, despite the additional drawdown induced by pumping, then operation can continue until levels are deemed unacceptable. This will ensure that there is no impact at designated sites.

If reduced levels resulting from drawdown induced by pumping at the TCA borehole are identified at a monitoring point, corrective action such as reduction in abstraction rates or cessation of pumping will be applied until levels recover.

ANNEX A BOREHOLE LOGS

Provided separately as 101574057 TCA/WRA/16 Water Monitoring Technical Note Annex A

ANNEX B HISTORIC WATER LEVEL MONITORING GRAPHS

Provided separately as 101574058 TCA/WRA/16 Water Monitoring Technical Note Annex B

Sizewell C
The power of good for Britain

Sizewell C Project

Appendix C: Package to Inform Countryside and Rights of Way Act Assessment and Habitats Regulations Assessment

Permit reference TCA/WRA/16

© Copyright 2025 Sizewell C Limited. All rights reserved.

DOCUMENT CONTROL

This document is stored and approved in the Electronic Document and Records Management System (EDRMS).

Prepared by:	[redacted] Graduate Ecologist
Verified by:	[redacted] Technical Director (Ecology)
Reviewed by:	[redacted] Environmental Permitting Delivery Lead
Approved by:	[redacted] Sizewell C Environment Manager - Construction Permits and Consents

REVISION HISTORY

Rev	Status	Amendment	Prepared By	Date
0.1	Draft	Drafting initial document	[redacted]	05/03/25
0.2	Final	Final document following SZC and Environment Agency comments	[redacted]	31/03/25
1.0	Updated final	Final document following SZC and Environment Agency comments	[redacted]	23/04/25

CONTENTS

1 INTRODUCTION 4

1.1 Overview 4

1.2 Key Definitions 4

1.3 References 5

1.4 Permit Details 6

1.5 SSSI and Habitat Sites 6

2 TECHNICAL INFORMATION 7

2.1 Permit TCA/WRA/16 7

2.1.1 Details of abstraction method; pump type and location (including national grid references), borehole specifics etc 7

2.1.2 Fish screening details; type, size, etc 7

2.1.3 Groundwater investigation consent details if applicable 7

2.1.4 Pump test results if applicable 7

2.1.5 Groundwater modelling if applicable 8

2.1.6 Surface water modelling if applicable 9

2.1.7 Impoundment details and details of intended operation of impoundment structure 10

2.1.8 Maps and drawings 10

2.1.9 Fish pass detail; type, size, any action being taken to enable fish utilisation 11

2.1.10 Non-native invasive species surveys 11

2.1.11 Protected species surveys 11

2.1.12 Estimation of any habitat loss 11

2.1.13 Details of proposed quantities and abstraction period 11

2.1.14 Hydrological impact assessment if applicable 11

2.1.15 Details of any water level/flow monitoring undertaken including location(s) of monitoring, frequency and data acquired 12

2.1.16 Details of water quality of any water intending to be discharged as part of a dewatering operation 12

2.1.17 Details/assessment of prevailing environmental conditions 13

2.1.18 Details of any mitigation 13

3 INFORMATION TO INFORM THE IN-COMBINATION ASSESSMENT 15

3.1 Other plans and projects 15

APPENDIX A: EA RISKS RELEVANT TO PERMIT TCA/WRA/16 21

A.1 EA Risks Relevant to Permit TCA/WRA/16 and Sizewell Marshes SSSI 21

A.2 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere to Walberswick Heaths and Marshes SSSI 23

A.3 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere to Walberswick Heaths and Marshes SAC 25

A.4 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere-Walberswick SPA 26

A.5 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere-Walberswick Ramsar 28

1 INTRODUCTION

1.1 Overview

1.1.1.1 The Sizewell C Project ('SZC Project') is a proposed nuclear power station in respect of which certain planning permission has been granted via Development Consent Order 2022 (the "DCO") [1]. The SZC Project will comprise two UK European Pressurised Reactors™ located north of the existing Sizewell B power station in Suffolk. The DCO was made and came into force in 2022 [2]. The DCO was granted based on assessment work (underpinned by extensive baseline surveys and studies) submitted to the Secretary of State. The Secretary of State's (SoS) Habitats Regulations Assessment (HRA) (hereafter referred to as the 'SoS HRA') [3] records his decision on the potential for adverse effects on the integrity of habitat sites as a result of the SZC Project.

1.1.1.2 The SZC Project is currently preparing construction permit applications. These permits are required for several of the works and construction activities. Through the Environment Agency (EA) Screening Tool, a risk has been identified to Sizewell Marshes Site of Special Scientific Interest (SSSI) and Minsmere to Walberswick Heath and Marshes SSSI from permit TCA/WRA/16. A risk has also been identified to Minsmere to Walberswick Heaths & Marshes Special Area of Conservation (SAC) and Minsmere-Walberswick Special Protection Area (SPA) and Ramsar site. Therefore, this package has been put together to aid the EA in completing their HRA and Countryside and Rights of Way Act (CRoW) assessments for this permit.

1.2 Key Definitions

Term / Abbreviation	Definition
AOD	Above Ordnance Datum
CRoW	Countryside and Rights of Way Act
CWDA	Construction Water Discharge Activity
DCO	Development Consent Order 2022
EA	Environment Agency
ES	Environmental Statement
FPA	Fish Pass Approval
FRAP	Flood Risk Activity Permit
GIC	Ground Investigation Consent
HDPE	High Density Polyethylene
HRA	Habitats Regulations Assessment
LDC	Land Drainage Consent
MCA	Main Construction Area
MDS	Main Development Site
mm	Millimetre
NGR	National Grid Reference
SAC	Special Area of Conservation
SoS	Secretary of State
SPA	Special Protection Area

Term / Abbreviation	Definition
SSSI	Site of Special Scientific Interest
SZC Project	The Sizewell C Project
TCA	Temporary Construction Area
TSD	Temporary Sea Defence
WMMP	Water Monitoring and Management Plan
WRAL	Water Resource Abstraction Licence
WRIL	Water Resources Impoundment Licence

1.3 References

Ref	Title	Location	Document No. / Link
[1]	The Sizewell C (Nuclear Generating Station) Order 2022	Online	https://www.legislation.gov.uk/uksi/2022/853/contents/made
[2]	The Sizewell C (Nuclear Generating Station) Order 2022. Made 20th July 2022, Coming into force 11th August 2022	Online	https://infrastructure.planninginspectorate.gov.uk/wp-content/ipc/uploads/projects/EN010012/EN010012-011165-SZC-DCO.pdf
[3]	Secretary of State (Department for Business, Energy and Industrial Strategy) (2022). Habitats Regulations Assessment for an Application Under the Planning Act 2008: Sizewell C New Nuclear Power Station	Online	https://infrastructure.planninginspectorate.gov.uk/wp-content/ipc/uploads/projects/EN010012/EN010012-011167-SZC-HRA.pdf
[4]	Draft Water Monitoring and Management Plan (September 2021)	Online	https://infrastructure.planninginspectorate.gov.uk/wp-content/ipc/uploads/projects/EN010012/EN010012-007610-Sizewell%20C%20Project%20-%20Other-%20SZC%20Bk9%209.87(A)%20Draft%20Water%20Monitoring%20and%20Management%20Plan%20Clean%20Version.pdf
[5]	Environment Agency – Statement of Common Ground (October 2018)	Online	https://infrastructure.planninginspectorate.gov.uk/wp-content/ipc/uploads/projects/EN010012/EN010012-008186-Sizewell%20C%20Project%20-%20Final%20SoCG%2027.pdf#page=13
[6]	Atkins, Hyder, Royal Haskoning DHV. 2015. Sizewell C SSSI Crossings: Environmental appraisal of options under consideration. November 2015	Unpublished but available on request	Unpublished but available on request
[7]	The Sizewell C Project 6.3 Main Development Site Terrestrial Ecology and Ornithology Appendix 14B1 – Plants and Habitats Synthesis Report, Revision 1.0, May 2020, DCO Examination Library Reference APP-250	Online	EN010012-001871-SZC_Bk6_ES_V2_Ch14_Terrestrial_Ecology_Ornithology_Appx14B1_Plants_Habitats_Synthesis.pdf (planninginspectorate.gov.uk)

Ref	Title	Location	Document No. / Link
[8]	Groundwater and surface water DCO ES chapter	Online	EN010012-001912-SZC_Bk6_ES_V2_Ch19_Groundwater_and_Surface_Water.pdf (planninginspectorate.gov.uk)
[9]	Sizewell C, Comments on Written Representations – Appendices, June 2021	Online	EN010012-005470-D3 - The Sizewell C Project - Comments on WRs Appendices.pdf (planninginspectorate.gov.uk)

1.4 Permit Details

1.4.1.1 The permit application with reference number TCA/WRA/16 is an application for a Water Resource Abstraction Licence (WRAL), proposed to enable the abstraction of groundwater through a borehole within the temporary construction area. This abstracted water is then to be utilised for process water and dust suppression.

1.5 SSSI and Habitat Sites

1.5.1.1 The following SSSI, SACs, SPAs and Ramsar sites have the potential to be affected by the EA's pre-identified risks according to initial EA screening.

Table 1.1 Sensitive Receptor Sites

Sensitive Receptor Site	Distance from Permit location
Sizewell Marshes SSSI	Permit activities are located circa 0.7km northwest of this SSSI
Minsmere to Walberswick SSSI	Permit activities are located circa 2.1km west of this SSSI. The Leiston Drain flows through the SSSI.
Minsmere to Walberswick Heaths and Marshes SAC	Permit activities are located circa 2.2km west of this SAC. The Leiston Drain flows through the SAC.
Minsmere-Walberswick SPA	Permit activities are located circa 2.2km west of this SPA. The Leiston Drain flows through the SPA.
Minsmere-Walberswick Ramsar site	Permit activities are located circa 2.2km west of this Ramsar site. The Leiston Drain flows through the Ramsar site.

2 TECHNICAL INFORMATION

2.1 Permit TCA/WRA/16

2.1.1 Details of abstraction method; pump type and location (including national grid references), borehole specifics etc

2.1.1.1 The proposed methodology is to abstract groundwater from the Crag formation. This abstraction will take place via a borehole to be located at TM 4601264982.

2.1.1.2 The abstraction point is a 300mm diameter borehole screened to allow abstraction of groundwater from the Crag. The daily limit for abstraction is 600m^3, with abstraction taking place throughout the year.

2.1.1.3 The maximum yearly abstraction is to be 101,495m^3, with a maximum hourly abstraction of 25m^3. The maximum flow rate for this abstraction is to be 7 litres per second.

2.1.1.4 The borehole is to be 40 metres deep with a High Density Polyethylene (HDPE) plastic liner. Figures 1 and 2 in the Appendix show the borehole within the context of designated sites, Wild Aldhurst and the Marsh Harrier Compensation Area for the SZC DCO.

2.1.2 Fish screening details; type, size, etc

2.1.2.1 No fish screening required as the abstractions will not be from a watercourse but from groundwater within the Crag formation.

2.1.3 Groundwater investigation consent details if applicable

2.1.3.1 Ground Investigation Consent (GIC) No. 7/35/3 SZC Crag Borehole (Plan B) V.5 (updated discharge location) has been obtained in accordance with the received pre-application advice AN/035/0003/016 (dated 09/02/2024). The outcome of the GIC is presented in a Pumping Test Technical Note (SZC_Pumping Test TN, Rev02, TC 101492743).

2.1.4 Pump test results if applicable

2.1.4.1 The outcome of the pumping test is presented in a Pumping Test Technical Note (SZC_Pumping Test TN, Rev02, TC 101492743). A constant rate test of 11 days was undertaken. A steady flow rate of 7l/s (equivalent to 600m^3/d) was maintained during the test and monitoring of water levels showed a maximum drawdown of 0.75m in the pumped well. Following an initially rapid change in water level within the pumped borehole, related to wellbore storage effects, the water level stabilised within 2 hours of the start of pumping and showed little variation for the remainder of the pumping stage of the test. A drawdown no greater than 0.1m was observed in the monitoring points closest to the Temporary Construction Area (TCA) borehole (within 200m). None of the observation points further than 200m from the TCA borehole that were monitored during the test, in accordance with the GIC, showed an observable response to the pumping. Regarding Sizewell Marshes SSSI, the groundwater level was recorded at 3.10m AOD in the Crag aquifer prior to the beginning of the pump test and 3.11m AOD at the end of the pump test. The total variation in groundwater water level is an increase of 0.01m which shows no impact of the pumping test at this location. Within the Peat, the variation of the groundwater level in P9 before and immediately after the pumping test is a similarly negligible

decrease of 0.01m. With regard to Mismere & Walberswick Heaths and Marshes SSSI, groundwater does not show any decrease in water levels as a result of the abstraction.

2.1.4.2 The pumping tests confirmed that the real-world response is less than that predicted by either numerical model. It is considered appropriate to use the predicted changes in the numerical models to assess potential impacts as they are more conservative than the results of the pumping test.

2.1.5 Groundwater modelling if applicable

2.1.5.1 The impact of this abstraction has been assessed using results from the two available numerical groundwater models in the area, which are the Environment Agency's NEAC model and the SZC-specific groundwater model developed for the DCO. The EA NEAC model is a regional model, but the DCO model is a site-specific groundwater model specifically created to assess the impacts at the area near the proposed works. It is therefore the most detailed model to apply.

2.1.5.2 Abstraction is anticipated to occur from September 1st 2025 to 31st March 2027 however, modelling under the DCO model was conducted for each of the four years following the start of abstraction (with year 2 including the Main Development Site (MDS) Cut-off Wall and year 3 being the start of MDS dewatering). The data presented are for the locations requested by the EA, located at the edge of the SSSIs in the vicinity of the abstraction (names north, east and south).

2.1.5.3 The modelling data shows that the drawdown at the location of abstraction is generally stable between 0.59 m and 0.63 m in the Crag at the four reported model times. The modelled drawdown at the three observation locations, in the Peat, is lower than the drawdown reported at the abstraction location. The maximum drawdown in the peat after four years of abstraction is 0.12 m at the eastern observation location, 0.09 m at the northern observation location and 0.13 m at the southern observation location.

2.1.5.4 Comparison of modelled values show that the dewatering of the MDS has a limited combined impact on the eastern and northern observation locations with a minor increase in drawdown of 0.02 and 0.01 m respectively. The drawdown at the abstraction location itself is also generally similar with a maximum increase of 0.03 m.

2.1.5.5 The southern observation location reports the largest increase with the Peat reporting a difference of 0.06 m and the Crag (top and bottom) reporting a 0.1 m increase. The southern observation location is the closest observation location to the MDS dewatering, located on the edge of the Sizewell Marshes, and so has the most potential for combined interaction with the dewatering. The final drawdown plot (Year 4 with the impact of the dewatering included) shows that the drawdown across the Peat of the Sizewell Marshes SSSI generally remains below 0.1 m with a small number of highly localised islands with drawdown above 0.1m yet still below 0.2m. These islands may reflect a model artefact rather than acting as a specific predictor of locations where drawdown will exceed 0.1m. This is comparable to the distribution of drawdowns reported in the baseline DCO modelling across the Sizewell Marshes.

2.1.5.6 Further details of the groundwater modelling are included in section 3.1 of the supporting information document included with this permit application.

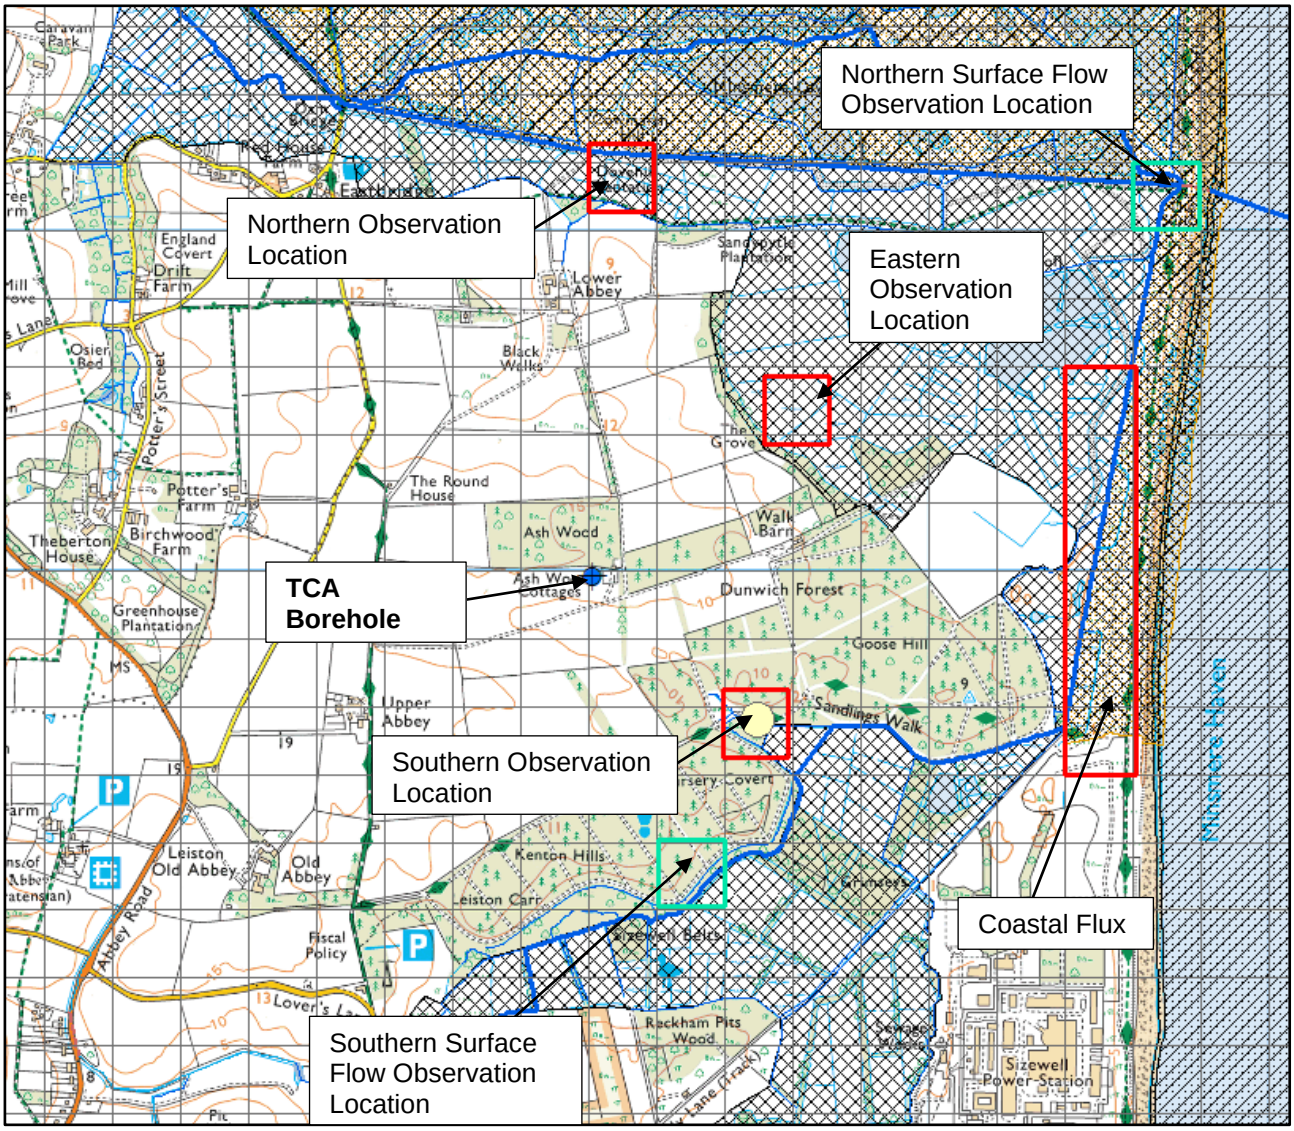


Figure 1 – Model assessment point locations

2.1.6 Surface water modelling if applicable

2.1.6.1 The surface flow/groundwater interaction data has been modelled and analysed and is summarised in **Table 2**, below.

Table 2 - Surface Flow Data

Discharge Parameter (m^3/s unless specified)	Northern Surface Flow Observation Location		Southern Surface Flow Observation Location	
	DCO	Proposed Abstraction	DCO	Proposed Abstraction
Q95^	0.002	0.00078	0.025	0.025
Q95^ (Ml/d)	0.173	0.067	2.177	2.143
Minimum	-0.26	-0.27	-0.07	-0.06

Maximum	0.46	0.46	0.34	0.35
Total Discharge*	527.42	517.45	475.47	472.61
Total Positive Discharge*	546.71	537.65	475.72	472.96
Total Negative Discharge*	-19.29	-20.19	-0.25	-0.35

^Q95 for dry model run (4 years).
*Total discharge is the cumulative discharge (m^3/s) across the four years of model run
Negative discharge values indicate modelled periods of reversed, upstream, flow at the selected location. These may occur due to e.g. sea level change and inundation or storm events.

2.1.6.2 The modelled Q95 values are not directly comparable to assessment values provided by the EA, because of the location of measurement points, the nature of the model setup (running of a dry model scenario) and associated model calibration and constraints. The original model objectives were not to model flow rates within surface water courses and, whilst calibration of such was undertaken, they could be subject to significant errors (as discussed in the 2020 numerical modelling report *Atkins Limited. March 2020*[1]). As such, a comparison between the baseline (DCO) and scenario (DCO plus proposed abstraction) model has been undertaken. The modelled data indicates that the abstraction will have little impact on surface water-groundwater interaction at the Sizewell Marshes SSSI.

2.1.6.3 The observation locations discussed below are the locations of the green squares as requested by the EA (see Figure 1, in section 2.1.5 of this document). The reported data and calculated Q95 show that the proposed abstraction will have little impact on the southern surface flow observation location (Leiston Drain, located in the Sizewell Marshes SSSI) with the data suggesting almost no change in Q95 and similar minimum and maximum flow values. The northern surface water flow observation location (representing the confluence of the Leiston Drain and Minsmere New Cut) reports a slightly greater change with a slight reduction in the calculated Q95. However, the minimum and maximum flow rates at the northern location remain similar.

2.1.6.4 The northern location is considered less representative of the area in the vicinity of the MDS and is likely to be less well represented in the model as it is close to/at the northern edge of the model domain. This northern location is therefore less likely to be a reliable representation of flow, as was acknowledged in the 2020 numerical modelling report[1]. The Minsmere River and its flow is not included in the model and the model boundary conditions may have a large impact on the conditions at this location.

2.1.6.5 As stated above, the modelled data indicates that the abstraction will have little impact on surface water-groundwater interaction at the Sizewell Marshes SSSI, which is considered to be the more reliable and representative data point for the purposes of this assessment.

2.1.7 Impoundment details and details of intended operation of impoundment structure

2.1.7.1 There is no anticipated impoundment of water resources that will take place under this permit.

2.1.8 Maps and drawings

2.1.8.1 The abstraction point is to be located as shown on **Figure 1**.

[1] *Sizewell C Numerical Modelling Report, R04 (Volume 2, Chapter 19 Appendix A, Groundwater and Surface water: Numerical Modelling Report*

2.1.9 Fish pass detail; type, size, any action being taken to enable fish utilisation

2.1.9.1 No fish pass is required since there is no impoundment of any watercourse.

2.1.10 Non-native invasive species surveys

2.1.10.1 No non-native invasive species surveys have been undertaken for the abstraction and none are relevant since the abstraction will take place entirely from groundwater.

2.1.11 Protected species surveys

2.1.11.1 Protected species surveys are not relevant to this abstraction application, or to the assessment of abstraction impacts on designated sites.

2.1.12 Estimation of any habitat loss

2.1.12.1 Limited temporary habitat loss is anticipated as part of the overall TCA works but there will be no loss within Sizewell Marshes SSSI or from Wild Aldhurst; moreover, abstraction works form a limited part of the overall scheme.

2.1.13 Details of proposed quantities and abstraction period

2.1.13.1 Estimated abstraction volumes are a maximum value of 600m^3/day. The maximum yearly abstraction is to be 101,495m^3, with a maximum hourly abstraction of 25m^3. The maximum flow rate for this abstraction is to be 7 litres per second. Abstraction will occur year-round. Abstraction is expected to take place from September 1st 2025 to 31st March 2027.

2.1.13.2 The maximum value is calculated based on the water supply strategy.

2.1.14 Hydrological impact assessment if applicable

2.1.14.1 A full hydrological impact assessment is included within the supporting information document supplied with this permit application. It's conclusions regarding potential effects at receptors are reproduced below

2.1.14.2 Given the small magnitude of change predicted outside the abstraction borehole it is not considered that there is a mechanism for impact on any of the identified receptors. The DCO modelling indicated that the expected drawdown within the Crag resulting from a maximum abstraction rate of 600m^3/d in the TCA borehole would result in a drawdown of less than 0.1m at all existing licenced abstractions except for 7/35/03/*G/0045 and 7/35/03/*G/0051 where the maximum drawdown would be between 0.1m and 0.2m.

2.1.14.3 The EA numerical modelling also indicates that there is no potential impact on surface water.

2.1.14.4 Given the magnitude of the drawdown in both the Crag and the overlying Peat designated sites, as well as the nearby surface water bodies, are not likely to be significantly affected by the abstraction at the new TCA borehole. Additionally, the operation of the TCA borehole is anticipated to be limited to a few years, from September 1st 2025 to 31st March 2027 after which a new desalination plant will be used to supply industrial process water.

2.1.14.5 Taking into account the small magnitude of change predicted outside the abstraction borehole, it is not considered that there is a credible mechanism for effect at any of the identified receptors.

2.1.15 Details of any water level/flow monitoring undertaken including location(s) of monitoring, frequency and data acquired

2.1.15.1 In support of the DCO a numerical model was developed to represent the groundwater and surface water regime in the area of the SZC development. The area covered by the model domain is approximately 60 km^2. The numerical model was based on a robust conceptual understanding of the groundwater and surface water flow regimes based on extensive ground investigation and monitoring data. The SZC model was developed to allow appropriate interface with the EA's regional model (the NEAC model). This meant that suitable boundary conditions could be determined, and model predictions validated against the NEAC model, particularly within the Sizewell Marshes SSSI. Within the domain of the SZC model the grid was refined around areas of interest to allow greater resolution in assessing change. In the Sizewell Marshes SSSI grid cells reduce to be less than 1m in scale. The model includes a coupled representation of groundwater and surface water in the Sizewell Marshes SSSI, which allows change in the interaction between groundwater and surface water to be assessed at each timestep in the model runs.

2.1.15.2 The numerical model was calibrated against real world monitoring data to demonstrate that there is a high degree of correlation between the model behaviour and observed groundwater and surface water responses. Once the baseline model had been developed and validated against real world data as being suitably representative a series of model runs were undertaken to allow the change associated with individual aspects of the SZC project to be assessed.

2.1.15.3 During the DCO Examination period the EA set out in their Statement of Common Ground [5] that:

- The SZC numerical model was an appropriate tool to use in assessing change resulting from the construction and operation of SZC (MDS_GW1)
- The groundwater conceptualisation on which the numerical model was based is appropriate (MDS_GW2)
- The surface water conceptualisation on which the numerical model was based is appropriate (MDS_GW3)
- The assessment of predicted impacts is appropriate (MDS_GW6)
- The proposed Water Monitoring and Management Plan (WMMP) (which includes the control structure on the realigned stretch of Sizewell Drain) is appropriate (MDS_GW8)
- The proposed terrestrial ecology assessment methodology, identified impacts, and mitigations is appropriate.

2.1.15.4 The Draft WMMP [4] outlined existing monitoring efforts, consisting of 86 borehole locations to monitor groundwater, Velocity and stage monitoring at 7 locations to monitor surface water and a weather station to monitor rainfall. This plan also sets out further monitoring locations as detailed in plate and table 6.1. This draft was agreed with the EA in the Statement of Common Ground (MDS_GW8).

2.1.15.5 Subsequent to the DCO monitoring of water levels and flows within the Sizewell Marshes has continued. During the revision of the Water Monitoring and Management Plan, more recent (post-DCO) monitoring data was compared to that used during the DCO assessments. This comparison showed that the characterisation of baseline conditions in the Sizewell Marshes SSSI established prior to the DCO remains valid, with no significant deviation in monitoring data. This is set out in para. 4.2.11 of the WMMP recently approved to discharge Requirement 11 of the DCO.

2.1.16 Details of water quality of any water intending to be discharged as part of a dewatering operation

2.1.16.1 Groundwater abstracted under this permit is not being abstracted as part of a dewatering operation. The water abstracted is to be used as process water and dust suppression.

2.1.17 Details/assessment of prevailing environmental conditions

2.1.17.1 During the DCO Examination a note was produced [16] that sets out the water balance in the Sizewell Marshes. Paras. 1.4.14-15 of this note state that (in summary) the majority of the surface water levels and flows within the Sizewell Marshes are comparable between baseline and development model runs through the year. The exception is in the Sizewell Drain at the downstream end of the Sizewell Marshes. Here, there is a small increase in the maximum predicted flow rate, and the frequency at which it occurs. This is associated with the realigned Sizewell Drain. There is little or no change predicted in the Leiston Drain, downstream of the SSSI.

2.1.17.2 The assessment made during the DCO was based on data and evidence collected prior to submission of the DCO and supporting documentation. This included the draft WMMP [4]. This draft was agreed with the EA in the Statement of Common Ground (MDS_GW8).

2.1.17.3 Subsequent to the DCO monitoring of water levels and flows within the Sizewell Marshes has continued. During the recent revision of the Water Monitoring and Management Plan more recent (post-DCO) monitoring data was compared to that used during the DCO assessments. This comparison showed that the characterisation of baseline conditions in the Sizewell Marshes SSSI established prior to the DCO remains valid, with no significant deviation in monitoring data.

2.1.18 Details of any mitigation

2.1.18.1 Measures are being implemented to address the impacts of the overall project (e.g. via the DCO). No mitigation is proposed regarding protecting SSSIs or designated habitat sites.

2.1.18.2 To avoid undue harm to the groundwater supply, this abstraction is to trade abstraction rights with local farmers to ensure the overall level of abstraction is not increased. This measure is not implemented to specifically mitigate impacts on SSSI, SAC, SPA and Ramsar sites as the shift in abstraction location could still lead to localised changes.

2.1.18.3 Agreement has been reached with the existing licence holders to enter into a trading arrangement starting on September 1st 2025. The end date for the licence trades will be 31 March 2027. The new abstraction in the TCA is downgradient from the location of the donor licences meaning that for the period of the trade there will be no abstraction from these licences offering benefit to the upstream environment. Information regarding the license trading is included in section 2 of the Supporting information document and in **Table 3** below.

Table 3 – Licence trading

Licence Reference	Licence Details	Licence Purpose	Licence Limit (m3/yr)	Recent Actual Abstraction (m^3/yr)	Trade Type
7/35/03/*G/0052	N J Bacon Farms	Spray irrigation	107,900	77,392.66	Temporary
7/35/03/*G/0073	Theberton Grange	Spray irrigation	45,640	14,582	Temporary
7/35/3/GS/51	J R Poll	Spray irrigation	47,600	9,520.8	Temporary

2.1.18.4 It is proposed to use existing monitoring infrastructure within the Sizewell Marshes SSSI to identify whether there is any unanticipated change in water levels outside the abstraction borehole monitoring of water levels is currently undertaken in accordance with the WMMP, secured under Requirement 11 of the DCO, which was discharged on 09/04/24. Water levels are monitored at 15-minute intervals at

several locations across the Sizewell Marshes SSSI as set out in the WMMP. The scope of this ongoing monitoring is overseen by the Water Management Working Group, which includes representation from the EA. Following initiation of abstraction, water level monitoring data from the locations identified in the WMMP will be reviewed to identify any deviation from baseline pre-abstraction conditions.

3 INFORMATION TO INFORM THE IN-COMBINATION ASSESSMENT

3.1 Other plans and projects

3.1.1.1 The permit has the potential to interact in combination with other aspects of the SZC project. However, for key risks this has been factored into the overall assessment work undertaken for the DCO. For example:

- offsetting habitat creation for habitat loss in the Sizewell Marshes SSSI from SZC as a whole has already been undertaken at Aldhurst Farm, through the fen meadow plan, and in an area of wet woodland to the west of the Grove through the wet woodland plan. There is no significant habitat loss under this permit which will therefore not affect the plant, invertebrate or bird interest features of the SSSI.
- the Environmental Appraisal of the SSSI crossing options [6] (summarised in Appendix 14B1 – Plants and Habitat Synthesis paragraph 1.3.104 and 1.3.105 [7]), details a modelling exercise that was undertaken to assess the predicted changes in water levels within Leiston Drain as a result of actually constructing the SSSI crossing. This modelling predicted only a very small, highly localised effect, such that during construction, there would be a temporary 2cm reduction in water levels to the east of the crossing and a 1cm reduction to the west. This effect would rapidly diminish over distance, not being apparent beyond a radius of 90m. During the operational phase, water levels would stabilise, and long-term changes are predicted to be less than a 1cm increase in levels to the west of the crossing (i.e. up-gradient), with a corresponding reduction to the east, with no change apparent 60m from the SSSI crossing on both sides; and
- the construction of the Main Construction Area (MCA) platform (including excavating the temporary ditch diversion and infilling the existing ditch, stockpiling arisings, installation of sheet piles, and improvement for the approach embankment) would result in a loss of part of the existing functional floodplain associated with Sizewell Marshes SSSI. However, compensatory flood storage has already been created, and advice from the EA in the DCO Environmental Statement (ES) when this was considered alongside floodplain loss due to the MCA identifies that when comparing the maximum water levels for the baseline with the development scheme scenarios, the loss contributes to a maximum relative difference of less than 15mm across the floodplain. As such, compensation would not be required due to the small magnitude, and as floodplain connectivity will not be at risk (Paragraph 19.6.70 Sizewell C ES Volume 2, Chapter 19 Groundwater and Surface Water [8]).

3.1.1.2 A summary of related permits granted and sought in respect of the SZC Project is provided below.

Table 3.1 Other related SZC MDS permits, licences and consents

Permit type	SZC permit application reference	Regulator	Regulator permit reference	Activities covered	Status	Location	Timing	Further information
Construction Water Discharge Activity (CWDA)	MDS/CWDA/90	EA	EPR/DB3946KP/A001	Water discharge from three outfall linked in the TCA of the MDS.	In determination	TM 47217 64922 TM 46876 64559 TM 46556 64549	October 2025 – end TCA construction	The need for each outfall will be intermittent over this period depending on rainfall and sequencing of work. The EA will be kept updated of any changes to the planned discharge durations.
CWDA	MDS/CWDA/89	EA	EPR/WB3145KB	Discharge of rainfall dependant surface water during the construction of the Sizewell Link Road. The permit covers 24 outfall locations.	In determination	March 2025 – October 2027	TM 38582 67084 to TM 44494 64905	CWDA
Flood Risk Activity Permit (FRAP)	MDS/FRA/61	EA	EPR/TB3157GQ	Installation of security fencing for the foreshore	Obtained	TM 476 640 to TM 476 637	Now implemented	To facilitate subsequent foreshore and marine consents
FRAP (variation)	MDS/FRA/91	EA	EPR/TB3157GQ/V001	Variation for EPR/TB3157GQ.	Obtained	N/a	Now implemented	N/A – Admin change only
FRAP	MDS/FRA/50	EA	EPR/BB3590JX	Construction of temporary site access tracks for SSSI vegetation clearance (including tree stump removal). Erection of fencing (security and ecological), water voles habitat destruction, including vegetation clearance	Obtained and being implemented	Centroid of MDS: TM473640 SSSI Clearance within the 'SSSI triangle' corners: TM 46972 64083 TM 46996 64446 TM 47392 64532 Water Vole displacement area: Upstream- TM 47298 64506 Downstream- TM 47339 64518	Now implemented	This is to facilitate the SSSI crossing works and ensures that the vegetation within the footprint of the crossing has already been cleared.
FRAP	MCA/FRA/12	EA	EPR/DB3147LF	Construction of the temporary sea defence (TSD) within the MCA of the SZC project. Works include vegetation removal, topsoil stripping, construction of a piling platform and piling of the TSD.	In determination	Construction - January 2025 to end of Q1 2027. Decommission Q4 2034	TM 47627 64317 to TM 47581 63701	
FRAP (variation)	MDS/FRA/73	EA	EPR/BB3590JX/V001	Variation for BB3590JX for name change from NNB Generation Company (SZC) Limited to Sizewell C Limited.	Obtained	N/A	N/A	N/A – Admin change only
FRAP	MCA/FRA/53	EA	EPR/BB3590JX/V002	Variation for SSSI vegetation clearance consent	Obtained	TM 47298 64506 to TM 47339 64518	Now implemented	This is to facilitate the SSSI crossing works and ensures that the vegetation

Permit type	SZC permit application reference	Regulator	Regulator permit reference	Activities covered	Status	Location	Timing	Further information
				(EPR_BB3590JX), extension of water vole clearance dates				within the footprint of the crossing has already been cleared.
FRAP (Variation)	MDS/FRA/56	EA	EPR/BB3590JX/V003	SSSI UXO and vegetation clearance	Obtained and being implemented	Centroid of MDS: TM473640	Now implemented	This is to facilitate the SSSI crossing works and ensures that the vegetation within the footprint of the crossing has already been cleared.
Land Drainage Consent (LDC)	MDS/LDC/21 MDS/LDC/40 MDS/LDC/41 MDS/LDC/42	ESWMB	22_07411_C 22_07412_C 22_07413_C 22_07414_C 22_07415_C 23_07743_C 23_23639_C 23_23643_C 23_24431_C 23_24434_C 24_26691_C	Mink trapping and monitoring raft. Installing culverts for access. Erection of fencing (security and ecology). Retainment of existing culvert. Installation of silt curtains.	Obtained	MDS/LDC/21 SSSI Clearance within the 'SSSI triangle' corners: TM 46972 64083, TM 46996 64446, TM 47392 64532 Also around Drain Realignment area: Upstream- TM 46972 64083, Downstream- TM 47003 63625 Water Vole displacement area: Upstream- TM 49695 64071, Downstream- TM 47395 64529 MDS/LDC/40 647071 264181 +/- 10m 647178 264299 647033 263738 or 647017 263722 MDS/LDC/41 From 646954 263284 to 647400 264541 MDS/LDC/42 From 646954 263284 to 647400 to 647400 264541	Now implemented	This is to facilitate the SSSI crossing works and ensures that the vegetation within the footprint of the crossing has already been cleared.
FRAP	MCA/FRA/2	EA	To be confirmed – application not yet submitted	Construction of SSSI Crossing including bridge over Leiston Drain and temporary realignment of Leiston Drain.	Obtained	southern end: TM 47339 64432; northern end: TM 47296 64563.	January to March 2025	Similar water quality protection measures will be implemented as standard for the SZC project. Clear span bridge avoiding works within the Leiston Drain.
WRAL	MCA/WRA/7	EA	To be confirmed – application not yet submitted	Construction of SSSI Crossing – including bridge over Leiston Drain. Dewatering for piling headscap, to create foundation for the new bridge structures to	Submitted	**Crossing:** southern end: TM 47339 64432;	Winter 2024/2025	Dewatering of the cofferdams for installation of the pile caps on the SSSI bridge abutments is integral to delivering

Permit type	SZC permit application reference	Regulator	Regulator permit reference	Activities covered	Status	Location	Timing	Further information
				build upon. Sheet piling driven in to the ground, concrete piling used for trench in between.		northern end: TM 47296 64563. **<u>Corners of cofferdams to be dewatered:</u>** Northern cofferdam: 47283 54512, 47284 64508, 47351 64534, 47353 64530 Southern cofferdam: 47293 64482, 47294 64477, 47361 64504, 47363 64500 **<u>Water course activities:</u>** upstream point: TM 47281 64500; downstream point: TM 47347 64522.		the SSSI Crossing and will be undertaken simultaneously.
LDC	MCA/LDC/1	ESWMB	ESWMB-SZC-21832Y	SSSI Crossing - Temporary diversion and infilling of former course of Sizewell Drain to facilitate SSSI Crossing earthworks Installation of temporary construction access culverts.	In determination	Winter 2024/25	National Grid Reference (NGR) of upstream connection with Sizewell Drain: TM 47293 64503 NGR of downstream connection with Leiston Drain: TM 47295 264427 NGR of culvert crossings: Point 3.1 TM 47019 64123 Point 3.2 TM 47202 64332 Point 3.3 TM 47319 64464 Eastings and Northings of isolation points at Sizewell Drain to allow permanent realignment construction: 2A Easting – 647378.334 Northing – 264516.957 2B Easting – 647294.163 Northing – 264430.150	LDC

Permit type	SZC permit application reference	Regulator	Regulator permit reference	Activities covered	Status	Location	Timing	Further information
CWDA	MDS/CWDA/18	EA	EPR/RP3820SH	Early site drainage, surface water discharges from MCA/TCA/ACA.	In determination	E01 NGR: TM 47654 64054 DW01 NGR: TM 47349 64530 O5 NGR: TM 46463 65940 O7 NGR: TM 46528 63491 O6a NGR: TM 45443 63501 O6b NGR: TM 45442 63495 O6c NGR: TM 45474 63488 O8a NGR: TM 44614 64000 O8 NGR: TM 44466 63737	Estimated from October 2024 to December 2036	
FRAP	MCA/FRA/8	EA	To be confirmed - application not yet submitted	Sizewell Drain realignment – connection into Leiston Drain including headwall installation and works in/ loss of floodplain due to installation of MCA environmental sheet pile barrier	In preparation	NGR for the reach of Sizewell Drain being realigned: from TM 47021 63731 to TM 47394 64540. NGR for new connection point of Sizewell Drain into Leiston Drain: TM 47038 64437.	Winter 2024/25	Permanent connection to Leiston Drain following realignment will replace the temporary connection created for the SSSI Crossing and will be undertaken later (not simultaneously).
LDC	MCA/LDC/5	ESWMB	To be confirmed - application not yet submitted	Sizewell Drain realignment	In preparation	NGR for the reach of Sizewell Drain being realigned: from TM 47021 63731 to TM 47394 64540. NGR for new connection point of Sizewell Drain into Leiston Drain: TM 47038 64437.	Winter 2024/25	Permanent connection to Leiston Drain following realignment will replace the temporary connection created for the SSSI Crossing and will be undertaken later (not simultaneously).
Fish Pass Approval (FPA)	MCA/FPA/1	EA	To be confirmed – application not yet submitted	Sizewell Drain realignment – fish/eel pass	In preparation	NGR for the reach of Sizewell Drain being realigned from TM 47021	Winter 2024/25	Fish pass is ecologically positive and will not have negative effects in combination

Permit type	SZC permit application reference	Regulator	Regulator permit reference	Activities covered	Status	Location	Timing	Further information
						63731 to TM 47394 64540.		with other works (which will not involve any in channel works).
Water Resources Impoundment Licence (WRIL)	MCA/WRIL/2	EA	To be confirmed – application not yet submitted	Sizewell Drain realignment – permanent level control structure -– weir and control structures on connecting lateral drains	In preparation	Approx NGR: TM 47392 64524.	Winter 2024/2025	The structure is proposed to be set back from the confluence of Sizewell Drain and Leiston Drain by a short distance (ideally by 5 m to 10 m up Sizewell Drain). This weir is being included as a positive structure to enable better control of flows in the Sizewell Drain when and if desired. It is therefore environmentally positive. Blocking of lateral drains being undertaken to enable Sizewell Drain permanent realignment and to prevent hydrological or water quality impacts on Sizewell Marshes SSSI (and thus its role as supporting habitat for birds of Minsmere-Walberswick SPA). These works will therefore work to avoid adverse effects. Hydrological modelling of the straightening of the Sizewell Drain itself (which will be subject to a Land Drainage Consent application) was undertaken for the DCO and will be discussed and presented in the permit to be submitted for the permanent realignment. Modelling confirmed no impact on water quality or hydrology in Sizewell Marshes following drain realignment. Therefore no in combination effects. Similar water quality protection measures will be implemented as standard for the SZC project.
FRAP	AD6/FRA/1	EA	To be confirmed – application not yet submitted	Construction of crossing of Leiston Drain including works within the floodplain (e.g. mammal tunnel) for bridleway AD6	In preparation	Approximately TM 45444 63497	January to February 2025 then resuming in September 2025 to avoid bird nesting season.	Will be undertaken over the same timescale to the dewatering works covered by this permit and is directly linked as the dewatering is for the pile caps for the bridleway crossing of Leiston Drain. Similar water quality protection measures will be implemented as standard for the SZC project. Clear span bridge avoiding works within the Leiston Drain.

APPENDIX A: EA RISKS RELEVANT TO PERMIT TCA/WRA/16

The following appendices set out SZC Limited's assessment of EA risks for each permit for each SSSI or Habitat site.

A.1 EA Risks Relevant to Permit TCA/WRA/16 and Sizewell Marshes SSSI

EA Risk	Assemblage of breeding and wintering birds	Ditches	Floodplain fen and lowland mire	Invertebrate assemblages [2]	Lowland mire grassland and rush pasture	Vascular plants	Justification
Reduced dilution capacity	**X**	**X**	**X**	**X**	**X**	**X**	Changes in the flow or the velocity regime of a watercourse, or in groundwater levels, could result in an inability to dilute and manage discharges into the same habitat. Reduced dilution capacity could have a direct effect on some of the interest features for which the SSSI is partly designated (notably the ditch habitat and invertebrate populations) as well as indirectly on other SSSI features through potential effects on prey fish and invertebrates, although the Leiston Drain is only one of many watercourses within the foraging distances of relevant SSSI birds. Abstraction of groundwater related to this permit application have been shown to have minimal impact on water levels and quality in surface water flows and thus won't affect dilution capacity. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. There will be no effects on the SSSI habitats, plants or invertebrates.
Habitat Loss	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not cause habitat loss in Leiston Drain or elsewhere in the SSSI (i.e. through drying out of fen and mire) due to the small drawdown levels. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. As a result, there will be no drying out of SSSI habitats or those that support SSSI plants or invertebrate species, or fish on which some SSSI birds feed.
Entrapment/ impingement	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction from ground will not result in any entrapment or impingement of fish species on which SSSI birds might prey and would therefore have no indirect effect on the ability of the SSSI to meet its conservation objectives.
Changes in water levels or table	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not cause reduction in water levels in SSSI fen or mire habitats due to the small drawdown in water levels. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. As a result there will be no change in water levels in Leiston Drain or other SSSI features and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which some SSSI birds feed. There will be no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in flow or velocity regime	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not cause any change in the flow or velocity regime in Leiston Drain, or other SSSI watercourse, due to the small drawdown in water levels. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI below this and with minimal change to surface water flows. As a result there will be no change in flow or velocity in Leiston Drain and therefore no effect on SSSI habitats, plants or fauna dependent on flows in Leiston Drain or Sizewell Drain.

[2] W211 – Open water on disturbed sediments and W314 reed-fen & pools

EA Risk	Assemblage of breeding and wintering birds	Ditches	Floodplain fen and lowland mire	Invertebrate assemblages [2]	Lowland mire grassland and rush pasture	Vascular plants	Justification
Changes in surface water flooding	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not cause any change in surface water flooding within Sizewell Marshes SSSI due to the small drawdown in water levels. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. As a result there will be no change in flooding in the SSSI and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed, or habitats on which SSSI birds might roost in the SSSI. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in water chemistry	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not affect water chemistry in the surrounding area or Leiston Drain. As a result, there will be no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed, or habitats on which SSSI birds might roost in the SSSI. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in salinity regime	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not cause any change in the salinity regime in Leiston Drain or other watercourses in the SSSI due to the small drawdown in water levels and the fact that groundwater and surface water are in continuity. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. As a result, there will be no change in salinity regime in SSSI watercourses.
Change in freshwater flows to estuary	**X**	**X**	**X**	**X**	**X**	**X**	The abstraction will not significantly affect flows in the Leiston Drain as results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. Additionally, there is no estuarine component to Sizewell Marshes SSSI.

A.2 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere to Walberswick Heaths and Marshes SSSI

EA Risk	Aggregations of breeding and non-breeding birds[3]	Habitats [4]	Invertebrate assemblages[5]	Botanical interest and vascular plant assemblage[6]	Justification
Reduced dilution capacity	**X**	**X**	**X**	**X**	Changes in the flow or the velocity regime of a watercourse could result in an inability to dilute and manage discharges into the same habitat. Reduced dilution capacity could have an indirect effect on some of the interest features for which the SSSI is partly designated through potential effects on prey fish and invertebrates, although the Leiston Drain is only one of many watercourses within the foraging distances of relevant SSSI birds. Abstraction of ground water related to this permit application have been shown to have minimal on water levels and quality in surface water flows and thus won't affect dilution capacity. Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. There will be no effects on the SSSI habitats, plants or invertebrates.
Habitat Loss	**X**	**X**	**X**	**X**	Abstraction will not cause habitat loss due to the small drawdown levels. Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. As a result there will be no drying out of habitats that would support wetland fish or invertebrate species, or aquatic plants, on which some SSSI birds feed. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Entrapment/impingement	**X**	**X**	**X**	**X**	Abstraction from ground will not result in any entrapment or impingement of fish species on which SSSI birds might prey and would therefore have no indirect effect on the ability of the SSSI to meet its conservation objectives. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Changes in water levels or table	**X**	**X**	**X**	**X**	Abstraction will not cause reduction in water levels in Leiston Drain due to the small drawdown in water levels and the fact that groundwater and surface water are in continuity. Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. As a result there will be no change in water levels in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which some SSSI birds feed. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in flow or velocity regime	**X**	**X**	**X**	**X**	Abstraction will not cause any change in the flow or velocity regime in Leiston Drain due to the small drawdown in water levels outside the sheet piling retaining wall and the fact that groundwater and surface water are in continuity Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. As a result there will be no change in flow or velocity in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Changes in surface water flooding					Abstraction will not cause any change in surface water flooding within Sizewell Marshes SSSI due to the small drawdown in water levels Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. As a result there will be no change in flooding in the SSSI and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI

[3] See section 3.3 for the full list of avian features
[4] See section 3.3 for the full list of designated habitats
[5] See section 3.3 for the full list of invertebrate assemblage features
[6] See section 3.3 for the full list of designated botanical interest features, including vascular plant assemblage.

EA Risk	Aggregations of breeding and non-breeding birds[3]	Habitats [4]	Invertebrate assemblages[5]	Botanical interest and vascular plant assemblage[6]	Justification
					birds feed, or habitats on which SSSI birds might roost in the SSSI. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in water chemistry	**X**	**X**	**X**	**X**	Abstraction will not affect water chemistry in the surrounding area or Leiston Drain. As a result there will be no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed, or habitats on which SSSI birds might roost in the SSSI. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in salinity regime					Abstraction will not cause any change in the salinity regime in Leiston Drain due to the small drawdown in water levels Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. As a result there will be no change in salinity regime in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in freshwater flows to estuary	**X**	**X**	**X**	**X**	The abstraction will not substantially affect flows in the Leiston Drain. There is no estuary that would be affected by abstraction or discharges via Leiston Drain. The Leiston Drain ultimately drains to the sea via a control structure on Minsmere New Cut. Therefore there will be no change in freshwater flows to sea.

A.3 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere to Walberswick Heaths and Marshes SAC

EA Risk	Annual vegetation of drift lines	European dry heaths	Perennial vegetation on stony banks	Justification
Reduced dilution capacity	**X**	**X**	**X**	All three SAC habitats are dry habitats that rely on freely draining substrates and are not dependent on flowing or standing water, or a high-water table.
Habita Loss	**X**	**X**	**X**	
Entrapment/impingement	**X**	**X**	**X**	
Changes in water levels or table	**X**	**X**	**X**	
Change in flow or velocity regime	**X**	**X**	**X**	
Changes in surface water flooding	**X**	**X**	**X**	
Change in water chemistry	**X**	**X**	**X**	
Change in salinity regime	**X**	**X**	**X**	
Change in freshwater flows to estuary	**X**	**X**	**X**	

A.4 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere-Walberswick SPA

EA Risk	Aggregations of breeding and non-breeding birds[7]	Justification
Reduced dilution capacity	**X**	Changes in the flow or the velocity regime of a watercourse could result in an inability to dilute and manage discharges into the same habitat. Reduced dilution capacity could have an indirect effect on some of the interest features for which the SPA is designated through potential effects on prey fish and invertebrates, although the Leiston Drain is only one of many watercourses within the foraging distances of relevant SPA birds. Drawdown won't affect levels in Leiston drain and thus won't affect dilution capacity, as groundwater is in hydraulic continuity with the Leiston Drain and water will be returned to the drain. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows.
Habitat Loss	**X**	Abstraction will not cause habitat loss in Leiston Drain due to the small drawdown levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no drying out of habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed. There will be no direct effects on the SPA itself.
Entrapment/impingement	**X**	Since it is abstraction from groundwater and will result in negligible change in water levels or flows, abstraction will not result in any entrapment or impingement of fish species on which SPA birds might prey and would therefore have no indirect effect on the ability of the SPA to meet its conservation objectives. There will be no direct effects on the SPA itself.
Changes in water levels or table	**X**	Abstraction will not cause reduction in water levels in Leiston Drain due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in water levels in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed. There will be no direct effects on the SPA itself.
Change in flow or velocity regime	**X**	Abstraction will not cause any change in the flow or velocity regime in Leiston Drain due to the small drawdown in water levels outside the sheet piling retaining wall , Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no significant change in flow or velocity in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed. There will be no direct effects on the SPA itself.
Changes in surface water flooding	**X**	Abstraction will not cause any change in surface water flooding within Sizewell Marshes SSSI due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in flooding in the SSSI and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed, or habitats on which SPA birds might roost in the SSSI. There will be no direct effects on the SPA itself.
Change in water chemistry	**X**	Abstraction will not affect water chemistry in the surrounding area or Leiston Drain. As a result there will be no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed, or habitats on which SPA birds might roost in the SSSI. There will be no direct effects on the SPA itself.
Change in salinity regime	**X**	Abstraction will not cause any change in the salinity regime in Leiston Drain due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in salinity regime in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed. There will be no direct effects on the SPA itself.

[7] See section 3.5 for the full list of avian features

EA Risk	Aggregations of breeding and non-breeding birds[7]	Justification
Change in freshwater flows to estuary	**X**	The abstraction will not affect flows in the Leiston Drain. There is no estuary that would be affected by abstraction or discharges via Leiston Drain. The Leiston Drain ultimately drains to the sea via a control structure on Minsmere New Cut. Therefore there will be no change in freshwater flows to sea.

A.5 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere-Walberswick Ramsar

EA Risk	Criterion 1 (habitats[8])	Criterion 2 (plants, breeding birds and invertebrates[9])	Justification
Reduced dilution capacity	**X**	**X**	Changes in the flow or the velocity regime of a watercourse could result in an inability to dilute and manage discharges into the same habitat. Reduced dilution capacity could have an indirect effect on some of the interest features for which the Ramsar is partly designated through potential effects on prey fish and invertebrates, although the Leiston Drain is only one of many watercourses within the foraging distances of relevant Ramsar birds. Drawdown won't affect levels in Leiston drain and thus won't affect dilution capacity, as groundwater is in hydraulic continuity with the Leiston Drain and water will be returned to the drain. Moreover, a sheet piling retaining wall will be in place to limit hydraulic connection to the wider groundwater body. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Habitat Loss	**X**	**X**	Abstraction will not cause habitat loss in Leiston Drain due to the small drawdown levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no drying out of habitats that would support wetland fish or invertebrate species, or aquatic plants, on which some Ramsar birds feed. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Entrapment/impingement	**X**	**X**	Since it is abstraction of groundwater and will result in negligible change in water levels or flows, abstraction will not result in any entrapment or impingement of fish species on which Ramsar birds might prey and would therefore have no indirect effect on the ability of the Ramsar to meet its conservation objectives. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Changes in water levels or table	**X**	**X**	Abstraction will not cause reduction in water levels in Leiston Drain due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in water levels in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which some Ramsar birds feed. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Change in flow or velocity regime	**X**	**X**	Abstraction will not cause any change in the flow or velocity regime in Leiston Drain due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result, there will be no change in flow or velocity in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which Ramsar birds feed. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Changes in surface water flooding	**X**	**X**	Abstraction will not cause any change in surface water flooding within Sizewell Marshes SSSI due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in flooding in the SSSI and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which Ramsar birds feed, or habitats on which Ramsar birds might roost in the SSSI. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.

[8] Ramsar Criterion 1: The site contains a mosaic of marine, freshwater, marshland and associated habitats, complete with transition areas in between. Contains the largest continuous stand of reedbeds in England and Wales and rare transition in grazing marsh ditch plants from brackish to fresh water.
[9] Ramsar Criterion 2: This site supports nine nationally scarce plants and at least 26 red data book invertebrates. Supports a population of the mollusc *Vertigo angustior* (Habitats Directive Annex II; British Red Data Book Endangered), recently discovered on the Blyth estuary river walls. An important assemblage of rare breeding birds associated with marshland and reedbeds including: *Botaurus stellaris, Anas strepera, Anas crecca, Anas clypeata, Circus aeruginosus, Recurvirostra avosetta, Panurus biarmicus*

EA Risk	Criterion 1 (habitats[8])	Criterion 2 (plants, breeding birds and invertebrates[9])	Justification
Change in water chemistry	**X**	**X**	Abstraction will not affect water chemistry in the surrounding area or Leiston Drain. As a result there will be no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which Ramsar birds feed, or habitats on which Ramsar birds might roost in the SSSI. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Change in salinity regime	**X**	**X**	Abstraction will not cause any change in the salinity regime in Leiston Drain due to the small drawdown in water levels Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in salinity regime in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which Ramsar birds feed. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Change in freshwater flows to estuary	**X**	**X**	The abstraction will not affect flows in the Leiston Drain. There is no estuary that would be affected by abstraction or discharges via Leiston Drain. The Leiston Drain ultimately drains to the sea via a control structure on Minsmere New Cut. Therefore there will be no change in freshwater flows to sea.

TCA/WRA/16 - Supporting Information

Contents

1. Introduction 2
2. Licence Trading 2
3. Hydrogeological Impact Assessment 3
   3.1 GROUNDWATER MODELLING OUTPUTS 3
   3.2 GROUND INVESTIGATION AND PUMPING TESTS 11
   3.3 RECEPTORS FOR POTENTIAL EFFECTS 11
   3.4 POTENTIAL EFFECTS FROM THE WATER ABSTRACTION ACTIVITY 12
   3.5 POTENTIAL EFFECTS AT RECEPTORS 12
   3.6. MANAGING POTENTIAL EFFECTS AT RECEPTORS 13
4. References 14
Annexure A – DCO modelling Technical Note 15
Annexure B – NEAC modelling Technical Note 16
Annexure C – Pumping test results 17
Annexure D – HRA/CRoW Assessment 18

TCA/WRA/16 - Supporting Information

1. Introduction

As part of the development of the proposed new nuclear power station at Sizewell, use of a newly constructed groundwater abstraction in the Temporary Construction Area (TCA) of the Sizewell C project is planned to provide a local water supply to support construction activities in the early years.

This Technical Note presents an assessment of potential effects from the new groundwater abstraction at the TCA in support of permit application TCA/WRA/16 which is required as part of Sizewell C Limited's strategy for supplying non-potable and industrial water during construction of the power station.

Abstracted water will be temporarily stored in buffer tanks to allow instantaneous demand to be met smoothly. Additionally, any abstracted water that is not immediately required will be stored in proprietary above ground storage tanks to allow its use in subsequent days/weeks. This storage is to allow for smoothing of fluctuations in daily demand e.g. potential reduction in water requirements during weekend working. It is not intended to carry out longer term storage. At this stage the final sizing and position of the tank storage is being developed. Once details become available, they will be shared with the EA.

Written pre-application advice from the Environment Agency (AN/035/0003/016) dated 09/02/2024 stipulates that risks of impacts of the proposed groundwater abstraction to the local protected species and habitats need to be considered.

This Hydrogeological Impact Assessment (HIA) summarises the findings of the available groundwater numerical modelling and aquifer testing of the new groundwater abstraction source to determine and assess the likely impact on the groundwater levels to the surrounding environment. The variation in groundwater levels is used as the basis for determining the potential impact on the local protected species and habitats, which is reported separately in Annexure D.

Details of the new abstraction borehole are provided in the application forms this HIA supports, however the abstraction point briefly comprises a 285mm diameter borehole screened to allow abstraction of groundwater from the Crag. The daily limit for abstraction is 0.6Ml, with abstraction taking place throughout the year. The location of the abstraction point is shown on the TCA Abstraction Borehole Location Plan (101477639), enclosed in this application.

The flow rate applied for as part of the abstraction licence application is based on the revised water demand strategy which was changed taking into account the recent actuals provided in the EA pre-application advice Ref. AN/035/0003/016. The EA pre-application advice was used to estimate the available water trading quantities required to satisfy the water demand during the early years of the construction of SZC.

Due to the local constraints on new abstractions from groundwater the application includes a trading agreement with three existing licences. The trading arrangements are discussed further in Section 2, and separate applications to vary the donor licences are being submitted in parallel.

2. Licence Trading

Due to the existing licences in the area and wider imbalance between aquifer recharge and abstraction no new consumptive abstraction licences can be granted. SZC are therefore seeking to trade with local licence holders to allow the operation of the new abstraction in the TCA. The licences with which a trade is being sought are summarised in Table 1, below. The information presented is taken from the pre-application advice letter dated 09/02/2024 (EA reference AN/035/0003/016).

TCA/WRA/16 - Supporting Information

Table 1 – Licence trading

Licence Reference	Licence Details	Licence Purpose	Licence Limit (m3/yr)	Recent Actual Abstraction (m^3/yr)	Trade Type
7/35/03/*G/0052	N J Bacon Farms	Spray irrigation	107,900	**77,392.66**	Temporary
7/35/03/*G/0073	Theberton Grange	Spray irrigation	45,640	**14,582**	Temporary
7/35/3/GS/51	J R Poll	Spray irrigation	47,600	**9,520.8**	Temporary

NOTE: **Bold text** indicates the trade being sought for this application.

Agreement has been reached with the existing licence holders to enter into a trading arrangement starting on September 1st 2025. The end date for the licence trades will be 31 March 2027. All three licences being considered for trading are currently "licences of right", and will retain their "licence of right" status following the end of the trade period. It is anticipated that after the temporary trade period a desalination plant will have been commissioned to provide a dedicated water supply to the project.

The current licences are currently conditioned to allow abstraction during the summer months only. For the period of the trade, it is sought to vary the operational period of the licence to allow abstraction throughout the year. The results of numerical modelling to assess the potential impacts of this change, as well as the findings of a pumping test to assess the local effect of abstracting at 0.6Ml/d, indicate that there would be no detrimental impact to the water environment around the new TCA borehole from year-round abstraction. The modelling and pumping test results are discussed in subsequent sections of this document. Further, the new abstraction in the TCA is downgradient from the location of the donor licences meaning that for the period of the trade there will be no abstraction from these licences offering benefit to the upstream environment.

3. Hydrogeological Impact Assessment

3.1 GROUNDWATER MODELLING OUTPUTS

3.1.1 OVERVIEW

This impact assessment uses results from the two available numerical groundwater models in the area, which are the Environment Agency's NEAC model and the SZC-specific groundwater model developed as part of the application for the Sizewell C project's Development Consent Order (DCO). Whilst the EA NEAC model is a regional model, the DCO model is a site-specific groundwater model, which was created to assess the impacts at the area near the proposed works.

Both existing models were updated to include a representation of the new TCA abstraction borehole. The DCO model was used to undertake an initial scoping assessment with a maximum abstraction rate of 1.1 Ml/day. Following this scoping assessment a second modelling exercise was carried out using both the DCO model and the NEAC model to represent the TCA borehole operating at 0.6Ml/day.

To allow model results to be compared assessment points were agreed, as shown on Figure 1, below.

TCA/WRA/16 - Supporting Information

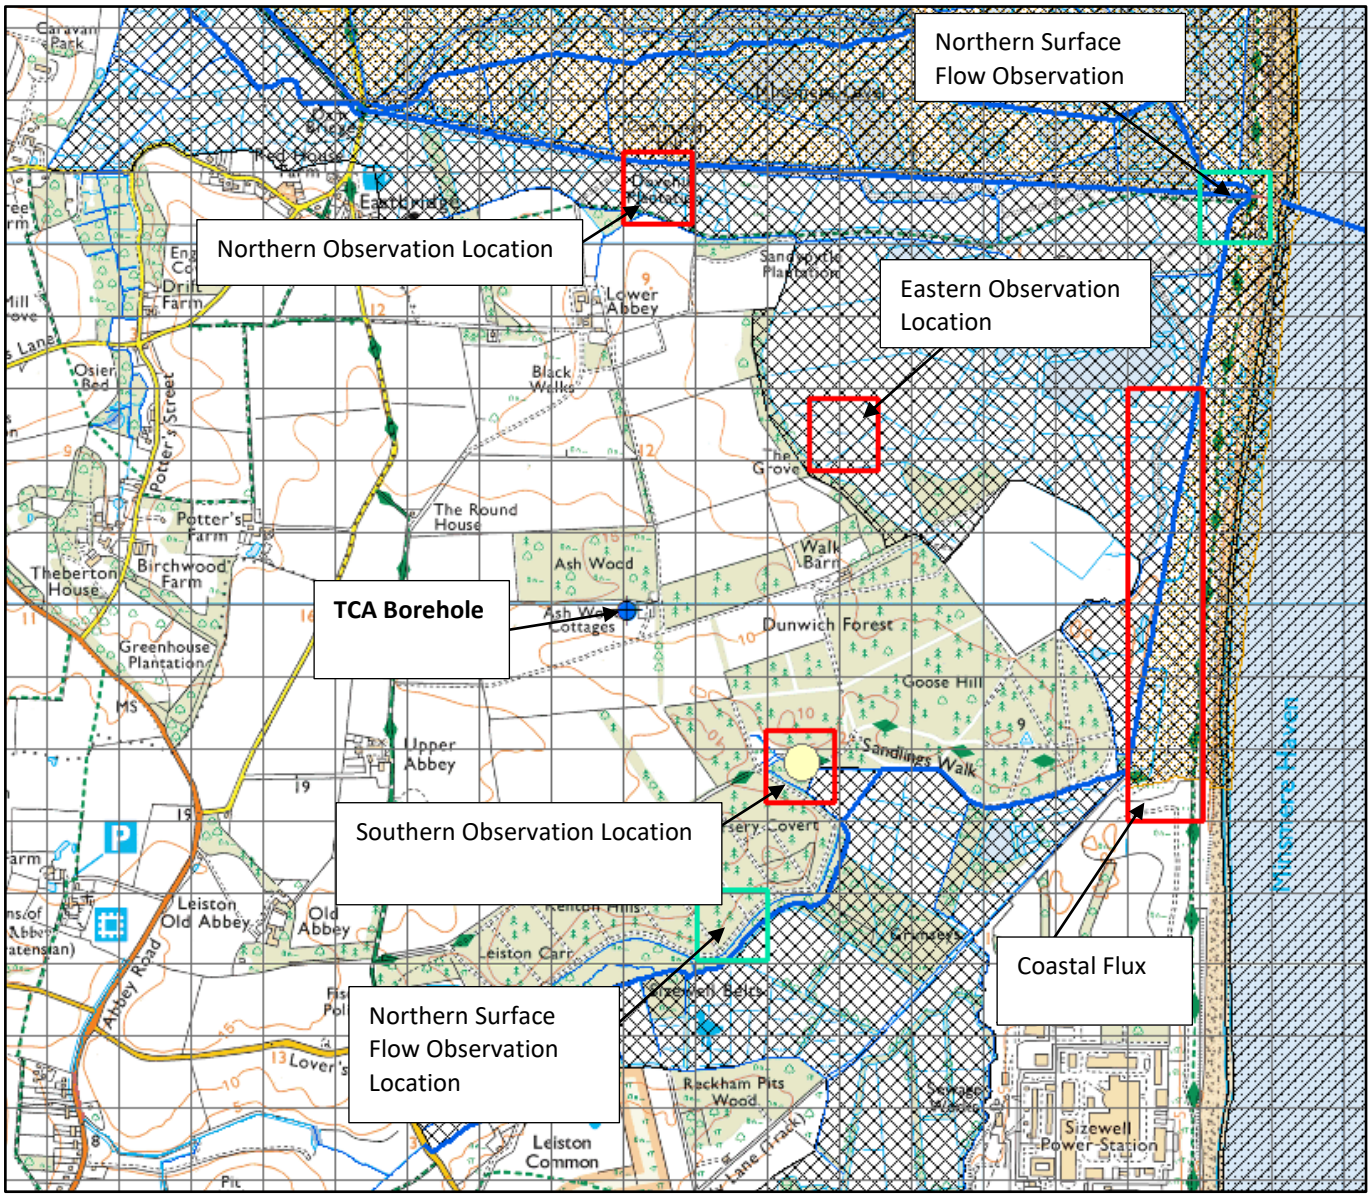


Figure 1 – Model assessment point locations

3.1.2 DCO MODELLING

During early options appraisal for the siting of a new on-site abstraction borehole a preliminary scoping modelling exercise was undertaken by AtkinsRéalis using the Development Consent Order (DCO) numerical groundwater model. This model was approved as being a suitable tool for assessing change to the water environment by the Environment Agency (REP-068 in DCO Examination Library at https://national-infrastructure-consenting.planninginspectorate.gov.uk/projects/EN010012/documents). The results of this preliminary modelling indicated

TCA/WRA/16 - Supporting Information

that an abstraction rate of 1.1Ml/day from the new TCA borehole would have no significant impact on groundwater in the Crag or the overlying Peat.

After refinement of the water supply strategy, the required maximum abstraction rate within the TCA borehole was decreased from 1.1Ml/day to 0.6Ml/day. The DCO model results are reported in a standalone Technical Note included as Annexure A and are summarised below.

The DCO model was run for the following scenarios as agreed with the EA (email dated 19/03/24):

- EA "naturalised" (all abstractions removed)
- DCO (baseline)
- DCO + 0.6 ML/d abstraction (Scenario)

These scenarios represent an approximation of groundwater conditions in the absence of any abstractions, the existing baseline condition with currently licensed abstractions, and the addition of a new abstraction from the TCA borehole. Using these scenarios allows a comparison to be made to determine the relative change in the water environment resulting from the new abstraction.

The modelling indicated that the Crag has the capacity to support a year-round abstraction of 0.6Ml/day. The maximum drawdown within the Crag, at the point of the abstraction, was 0.63 m after four years of operation. This maximum drawdown was reached within approximately three months of pumping commencing. After this time the drawdown generally remained stable with minor fluctuations related to seasonal variation in recharge across the model run.

Comparison between the baseline DCO and scenario groundwater levels allows for calculation of the drawdown resulting from the pumping of the TCA borehole abstraction. Modelled drawdown is summarised to two decimal places for each of the four years following the start of abstraction (year 2 is the inclusion of the Main Development Site Cut-off Wall and year 3 is the start of Main Development Site dewatering) in Table 2, below. The data presented are for the locations requested by the EA, located at the edge of the SSSIs in the vicinity of the abstraction (names north, east and south).

Table 2 – Summary of Modelled Drawdown

Modelled time	Drawdown (m)			
	Abstraction Location*	Eastern Observation Location	Northern Observation Location	Southern Observation Location
Peat (Top active layer)				
Year 1	0.57	0.12	<0.01	0.08
Year 2	0.56	0.07	<0.01	0.07
Year 3	0.58	0.11	<0.01	0.06
Year 4	0.57	0.12	0.01	0.08
Top of Crag (Slice 6)				
Year 1	0.62	0.12	0.03	0.13

TCA/WRA/16 - Supporting Information

Modelled time	Drawdown (m)			
	Abstraction Location*	Eastern Observation Location	Northern Observation Location	Southern Observation Location
Year 2	0.62	0.11	0.04	0.10
Year 3	0.61	0.11	0.02	0.11
Year 4	0.62	0.12	0.02	0.12
Base of Crag (Slice 12)				
Year 1	0.62	0.12	0.03	0.13
Year 2	0.62	0.11	0.04	0.10
Year 3	0.61	0.11	0.02	0.11
Year 4	0.63	0.12	0.02	0.13

* Peat is not present at the proposed location of abstraction. 'Top active layer' presents drawdown at the top of the Red Crag Formation for the location of abstraction.
Year 2 is when the Main Development Site Cut-off Wall is included in the model.
Year 3 is when dewatering within the Main Development Site Cut-off Wall begins within the model.

The modelling results indicate that the northern observation location reports the least drawdown and the southern observation location reports the most. This is likely related to the proportional distance between the abstraction and the observation locations, as well as the shape of the modelled geology.

The data show that the drawdown at the location of abstraction is generally stable between 0.59 m and 0.63 m in the Crag at the four reported model times. The modelled drawdown at the three observation locations, in the Peat, is lower than the drawdown reported at the abstraction location. The maximum drawdown in the peat after four years of abstraction is 0.12 m at the eastern observation location, 0.09 m at the northern observation location and 0.13 m at the southern observation location.

The data show that while the edges of the southern and eastern SSSI closest to the TCA abstraction will experience drawdown of approximately 0.1 m but the contour plots, see Figure 2 below, show that drawdown does not extend any appreciable distance into the SSSIs.

TCA/WRA/16 - Supporting Information

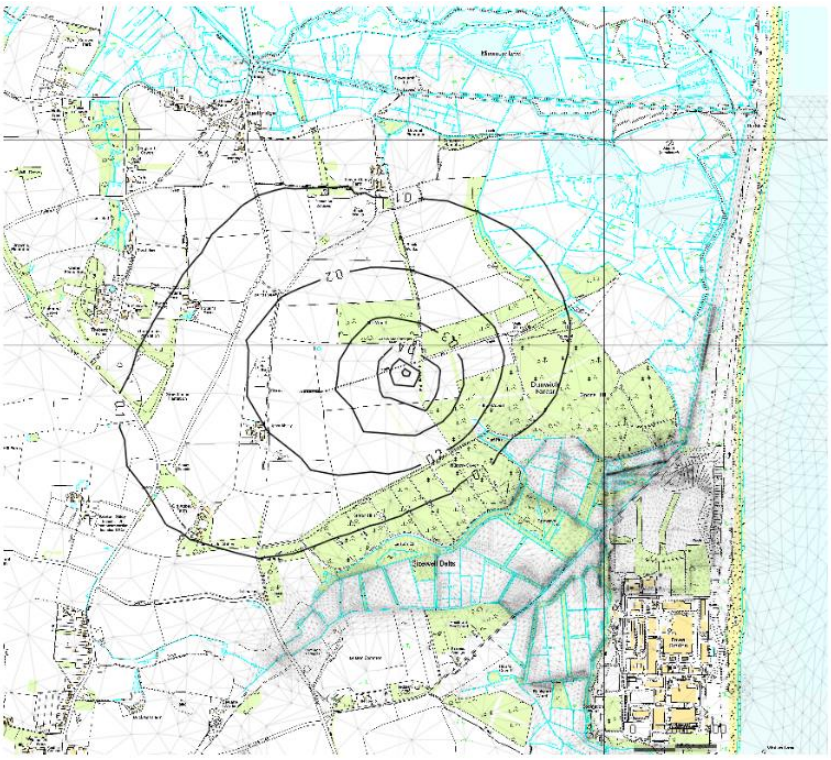


Figure 2 – DCO model drawdown results for top of Crag using abstraction rate of 0.6 Ml/d at the TCA Borehole

Year 2 drawdown, Northern Observation Location, Peat

The maximum drawdown (0.09 m) reported in the Peat at the northern observation location is reported after the second year of modelling, after which the drawdown decreases to between 0.02 and 0.04 m. The reason for this is expected to be the fact that the data for slice 1 at the northern observation location in the Peat is heavily controlled by surface water head boundary conditions that are present around the Minsmere River, which are very close to the location of this observation location. Other locations do not have quite as significant head control at the surface of the model.

Combined impact of Main Development Site dewatering and abstraction:

Comparison of modelled values show that the dewatering of the Main Development Site has a limited combined impact on the eastern and northern observation locations with a minor increase in drawdown of 0.02 and 0.01 m respectively. The drawdown at the abstraction location itself is also generally similar with a maximum increase of 0.03 m.

The southern observation location reports the largest increase with the Peat reporting a difference of 0.06 m and the Crag (top and bottom) reporting 0.1 m increase. The southern observation location is the closest observation location to the Main Development Site dewatering, located on the edge of the Sizewell Marshes, and so has the most potential for combined interaction with the dewatering. The final drawdown plot above (Year 4 with the impact of the dewatering included) shows that the drawdown across the Peat of the Sizewell Marshes SSSI generally remains below 0.1 m with a small number of islands with drawdown above 0.1 m. This is comparable to the distribution of drawdowns reported in the baseline DCO modelling across the Sizewell Marshes (Atkins, 2020).

TCA/WRA/16 - Supporting Information

Surface water/groundwater interaction:
The surface flow/groundwater interaction data has been modelled and analysed and is summarised in Table 3 - Surface Flow Data, below.

Table 3 - Surface Flow Data

Discharge Parameter (m^3/s unless specified)	Northern Surface Flow Observation Location		Southern Surface Flow Observation Location	
	DCO	Proposed Abstraction	DCO	Proposed Abstraction
Q95^	0.002	0.00078	0.025	0.025
Q95^ (Ml/d)	0.173	0.067	2.177	2.143
Minimum	-0.26	-0.27	-0.07	-0.06
Maximum	0.46	0.46	0.34	0.35
Total Discharge*	527.42	517.45	475.47	472.61
Total Positive Discharge*	546.71	537.65	475.72	472.96
Total Negative Discharge*	-19.29	-20.19	-0.25	-0.35

^Q95 for dry model run (4 years).
*Total discharge is the cumulative discharge (m^3/s) across the four years of model run
Negative discharge values indicate modelled periods of reversed, upstream, flow at the selected location. These may occur due to e.g. sea level change and inundation or storm events.

The modelled Q95 values are not directly comparable to assessment values provided by the EA, because of the location of measurement points, the nature of the model setup (running of a dry model scenario) and associated model calibration and constraints. The original model objectives were not to model flow rates within surface water courses and, whilst calibration of such was undertaken, they could be subject to significant errors (as discussed in the 2020 numerical modelling report *Atkins Limited. March 2020*[1]). As such, a comparison between the baseline (DCO) and scenario (DCO plus proposed abstraction) model has been undertaken. The modelled data indicates that the abstraction will have little impact on surface water-groundwater interaction at the Sizewell Marshes SSSI.

The observation locations discussed below are the locations of the green squares as requested by the EA (see Figure 1)). The reported data and calculated Q95 show that the proposed abstraction will have little impact on the southern surface flow observation location (Leiston Drain, located in the Sizewell Marshes SSSI) with the data suggesting almost no change in Q95 and similar minimum and maximum flow values. The northern surface water flow observation location (representing the confluence of the Leiston Drain and Minsmere New Cut) reports a slightly greater change with a slight reduction in the calculated Q95. However, the minimum and maximum flow rates at the northern location remain similar.

[1] *Sizewell C Numerical Modelling Report, R04 (Volume 2, Chapter 19 Appendix A, Groundwater and Surface water: Numerical Modelling Report*

TCA/WRA/16 - Supporting Information

The northern location is considered less representative of the area in the vicinity of the Main Development Site and is likely to be less well represented in the model as it is close to/at the northern edge of the model domain. This northern location is therefore less likely to be a reliable representation of flow, as was acknowledged in the 2020 numerical modelling report[1]. The Minsmere River and its flow is not included in the model and the model boundary conditions may have a large impact on the conditions at this location.

As stated above, the modelled data indicates that the abstraction will have little impact on surface water-groundwater interaction at the Sizewell Marshes SSSI, which is considered to be the more reliable and representative data point for the purposes of this assessment.

The data at the assessment point for coastal flux show that the proposed abstraction has a maximum of a 5.6 % change in flow at the selected nodes with no impact on the flux over the majority of the modelled period. The time periods of greater identified difference between baseline and scenario tend to fall within winter periods and are therefore anticipated to be related to modelled seasonal variation and potential storm events. This demonstrates there is no potential for significant change in coastal flux as a result of the new abstraction.

3.1.3. NEAC MODELLING

NEAC regional model was updated in December 2024 in order to inform the potential impact of the new abstraction. The results are presented in a standalone Technical Note included as Annexure B.

The model results at key locations have been inspected and compares with the baseline modelling (i.e. without abstraction). Dry periods were selected for the modelling with nearby licences modelled as abstracting to their full licenced limit. Additionally, the licence trading has not been taken into account in the model run meaning the TCA borehole is represented as a new abstraction in addition to the traded licences rather than instead of them. This is considered a conservative approach as it over-represents the amount of abstraction that would actually be occurring.

Summary of the model results are presented in Table 4 and the inspected location of these results are indicated in Figure 1.

Table 4 – Modelling Results of the NEAC model scenario with TCA abstraction.

Location	Change from baseline
Southern Observation Location: Sizewell Marshes SSSI	Maximum drawdown of 0.14m in the Superficial Deposits (L1). Maximum drawdown of 0.25m in the Crag (L3)
Eastern Observation Location: Minsmere Walberswick Heaths SSSI (The Grove)	Maximum drawdown of 0.28m in the Superficial Deposits (L1). Maximum drawdown of 0.38m in the Crag (L3)
Northern Observation Location: Minsmere Walberswick Heaths SSSI (Dovehill Plantation)	Maximum drawdown of 0.03m in the Superficial Deposits (L1). Maximum drawdown of 0.07m in the Crag (L3)
Northern Surface Flow Observation Location: Confluence of the Leiston Drain and Minsmere New Cut	No observable change
Southern Surface Flow Observation Location: Leiston Drain at Sizewell Marshes SSSI	No observable change
Coastal Flux	No observable change

TCA/WRA/16 - Supporting Information

The NEAC model uses a uniform grid with a cell size of 200m x 200m. This limits the ability to determine changes at greater resolution as the groundwater head within each cell is uniform. This magnifies the effects of the abstraction and the radius of influence from the single point abstractions within a cell and therefore the model results from the NEAC model are inherently conservative. However, even though the modelled drawdowns close to the cell containing the TCA abstraction borehole are overestimated the results are broadly similar to those from the DCO model. The proximity of the eastern assessment point to the cell containing the TCA abstraction borehole demonstrates this effect as the degree of drawdown is higher compared with the DCO model results. The northern and southern assessment points, which have more intervening model cells, produce comparable predictions of drawdown.

Comparison between the baseline model run and the scenario including the TCA borehole indicate that there is no observable change to the surface water/groundwater interaction. This means that the inclusion of a new abstraction point within the TCA does not cause any derogation to surface water baseflows. There is no difference predicted throughout the year, meaning that abstracting from the TCA borehole at a rate of 0.6Ml/d does not alter the surface water environment relative to present day baseline conditions.

An assessment of the borehole operating without licence trades in place indicates there may be a risk of saline intrusion being induced. It is considered that this is, at least in part, a function of the numerical model grid which effectively moves the maximum drawdown (i.e. within the borehole) closer to the coast. Additionally, the resolution of the model grid means that the extent of drawdown is overestimated. Representation of the new abstraction operating with the licence trades in place shows that there is a reduction in the flux of water across the coastal boundary to the east and no risk of saline water being drawn inland.

3.1.4. MODELLING RESULTS DISCUSSION

The modelling results show a small degree of change in both the Crag and Peat groundwater in close proximity to the TCA abstraction borehole. It is considered that the DCO model provides a better representation of change in the groundwater environment, due to its greater resolution in areas of interest and inclusion of other development aspects such as the Main Development Site dewatering. The predicted degree of change in groundwater levels is small, and is the same magnitude as that deemed acceptable during DCO. The model outputs show that there is not an in-combination effect that increases drawdown beneath sensitive receptors if the TCA borehole is operated at the same time as Main Site Dewatering is occurring. Despite the limitations of the NEAC model in estimating changes in water level over shorter distances (due to the 200m x 200m grid squares) the predicted drawdowns at the assessment points are similar in magnitude to those predicted by the DCO model.

It is considered that the predictions of surface water change resulting from the TCA borehole abstraction produced by the NEAC model are more appropriate for use in this assessment due to the representation of surface water/groundwater interaction. The NEAC model results show that there is no discernible change in surface water/groundwater interaction across the year.

The NEAC model indicates there is potential risk of saline intrusion, however this is considered to be a function of the model grid spacing and the position of the new abstraction close to the coast being represented as a 200m x 200m square rather than a discrete point. The DCO model has a more refined mesh in this area, which allows changes over shorter distances to be more accurately represented. The DCO model shows that there is no significant change to the coastal flux when the abstraction is operating at 0.6Ml/d, and that any changes in flux tend to fall within winter periods and are therefore anticipated to be related to modelled seasonal variation and potential storm events.

TCA/WRA/16 - Supporting Information

3.2 GROUND INVESTIGATION AND PUMPING TESTS

Groundwater Investigation Consent (GIC) to conduct groundwater testing at the TCA abstraction borehole was obtained on 08/05/2024, Consent No. 7/35/3 SZC Crag Borehole (Plan B) V.4 (updated monitoring).

A constant rate test of 11 days was undertaken as the tenth day of pumping fell on a Sunday meaning the contractor could not cease pumping and commence the recovery test. Pumping commenced at 9am on 20/02/2025 and ceased at 9am on 03/03/2025 to determine the drawdown within the abstraction borehole as well as the surrounding monitoring points. A steady flow rate of 7l/s (equivalent to 0.6Ml/d) was maintained during the test and monitoring of water levels showed a maximum drawdown of 0.75m in the pumped well. Following an initially rapid change in water level within the pumped borehole, related to wellbore storage effects, the water level stabilised within 2 hours of the start of pumping and showed little variation for the remainder of the pumping stage of the test. None of the observation points monitored during the test, in accordance with the GIC, showed an observable response to the pumping.

Recovery was monitored for 5 days, with water levels in the pumped well recovering almost fully within minutes of the cessation of pumping. This is considered to be a function of well loss induced drawdown during the pumping rather than a reflection of water levels in the Crag immediately outside the pumped well. Groundwater levels within the pumped well continued to recover to be in line with pre-test readings withwith a difference of 5 cm.

The pumping test factual report can be found in Annexure C – Pumping test results.

3.3 RECEPTORS FOR POTENTIAL EFFECTS

The following receptors that may be sensitive to changes in the water environment have been identified within 2 km of the proposed abstraction activity:

- Sizewell Marshes SSSI
- Minsmere and Walberswick Heaths and Marshes SSSI
- Minsmere-Walberswick SPA/Ramsar site
- Minsmere New Cut
- Leiston Drain
- Licensed groundwater abstractions
    - 7/35/03/*G/0045 (potentially revoked)
    - 7/35/03/*G/0074 (potentially revoked)
    - 7/35/03/*G/0051
    - 7/35/03/*G/0046
    - An/035/0003/007 (4 records)
    - 7/35/03/*G/0089
    - 7/35/03/*G/0049
    - An/035/0003/009
    - 7/35/03/*G/044
    - An/035/0003/003 (6 records)
    - 7/35/03/*G/0065 (potentially revoked)

TCA/WRA/16 - Supporting Information

  - 7/35/03/*G/0025
  - 7/35/03/*G/0064
  - 7/35/03/*G/0051
- Licensed surface water abstractions:
  - 7/35/03/*S/0051 (southern abstraction at Rackham Pits)
  - 7/35/03/*S/0075 (northern abstraction at Two Penny Bridge)
- Marsh Harrier compensation habitat
- Surface water bodies – various dams, reservoirs and lakes
- Groundwater body – Crag aquifer (water body from which abstraction is proposed)

3.4 POTENTIAL EFFECTS FROM THE WATER ABSTRACTION ACTIVITY

The water abstraction at the TCA borehole has the potential to cause the following effects on the water environment:

- A reduction in groundwater levels in the Crag aquifer and also in overlying deposits (Peat) for the duration of the dewatering.
- Reduction in groundwater levels could affect the discharge of baseflow from the aquifer to surface water.
- Reduction in groundwater levels could affect existing abstractions

3.5 POTENTIAL EFFECTS AT RECEPTORS

Given the small magnitude of change predicted outside the abstraction borehole it is not considered that there is a mechanism for impact on any of the identified receptors.

The DCO modelling indicated that the expected drawdown within the Crag resulting from a maximum abstraction rate of 0.6Ml/d in the TCA borehole would result in a drawdown of less than 0.1m at all existing licenced abstractions except for 7/35/03/*G/0045 and 7/35/03/*G/0051 where the maximum drawdown would be between 0.1m and 0.2m.

The pumping tests confirmed that the real-world response is less than that predicted by either numerical models. It is considered appropriate to use the predicted changes in the numerical models to assess potential impacts as they are more conservative than the results of the pumping test.

Given the magnitude of the drawdown in both the Crag and the overlying Peat designated sites, as well as the nearby surface water bodies, are not likely to be significantly affected by the abstraction at the new TCA borehole. Additionally, the operation of the TCA borehole is anticipated to be limited to a few years, after which a new desalination plant will be used to supply industrial process water.

Taking into account the small magnitude of change predicted outside the abstraction borehole, it is not considered that there is a credible mechanism for effect at any of the identified receptors.

TCA/WRA/16 - Supporting Information

3.6. MANAGING POTENTIAL EFFECTS AT RECEPTORS

Whilst there is no credible mechanism for observable change at the identified receptors, the potential effects considered in Section 3.5 are based on the predicted change during abstraction from the numerical modelling reported in Section 2.

It is proposed to use existing monitoring infrastructure within the Sizewell Marshes SSSI to identify whether there is any unanticipated change in water levels outside the abstraction borehole. Monitoring of water levels is currently undertaken in accordance with the Water Monitoring and Management Plan (WMMP), secured under Requirement 11 of the DCO, which was discharged on 09/04/24. Water levels are monitored at 15-minute intervals at several locations across the Sizewell Marshes SSSI as set out in the WMMP. The scope of this ongoing monitoring is overseen by the Water Management Working Group, which includes representation from the Environment Agency.

Following initiation of the abstraction, water level monitoring data from the locations identified in the WMMP will be reviewed to identify any deviation from baseline pre-abstraction conditions.

TCA/WRA/16 - Supporting Information

4. References

Atkins. (2020). Sizewell C Groundwater Modelling Report prepared for EDF NNB GenCo , January 2020.

TCA/WRA/16 - Supporting Information

Annexure A – DCO modelling Technical Note

Technical Note Groundwater Abstraction Modelling Early Years 0.6 Ml/d

Project	**SZC: Sizewell C**	Teamcenter ID	**101305037**
Teamcenter Contract	**Early Works EWXXXX_098_01**		
Client	**NNB Generation Co.**	Contractor Reference	**SZC-EW0400-ATK-XX-000-XXXXXX-REP-CIV-900004**
Contractor	**AtkinsRéalis**	Contractor Rev	**P01.01**
Purpose of Issue	**P3 - Published for Tender**		
Supplier	**AtkinsRéalis**	Originators Ref	**5213850-SNC-XX-XX-TREP-Z-900114**
Prepared by	**F.PanichickalWilson**	Role	**Hydrogeologist**
Reviewed by	**D.Cartwright2**	Role	**Associate Director**
Approved by	**---**	Role	**Insert Role**

REVISION HISTORY

Revision	Purpose	Amendment	Prepared By	Date
P01.01	P3 - Published for Tender		FP	---
	-			

Notice

This document and its contents have been prepared and are intended solely as information for Sizewell C Limited (SZC Ltd.) and use in relation to the Sizewell C project.

AtkinsRéalis assumes no responsibility to any other party in respect of or arising out of or in connection with this document and/or its contents.

Document history

Client Doc Code: SZC-EW0400-ATK-XX-000-XXXXXX-REP-CIV-900004
Document title: Technical Note Groundwater Abstraction Modelling Early Years 0.6 Ml/d

Rev	Status	Purpose Description	Originated	Checked	Reviewed	Authorised	Date
P01.01		P3 – First Revision	FB	BP	DC	---	---
		-					

Contents

1. Introduction 6
1.1 Background 6
1.2 Modelling Scope 6
1.3 Modelling Setup 7
2. Modelling Results 9
2.1 Drawdown due to Abstraction 9
2.2 Area of Influence 13
2.3 Change in Groundwater Flow 14
2.4 Change in Coastal Flux 14
2.5 Change in Surface Water Flow. 15
3. Conclusions 19
4. References 20
Appendix A. Groundwater Contour Plots 21
Appendix B. Drawdown Contour Plots 34

Tables

Table 2-1 - Summary of Modelled Groundwater Drawdown due to Abstraction at Location 5 10

Table 2-2 - Summary of Modelled Drawdown with MDS Dewatering 13

Table 2-3 - Vertical Flow Data (Slice 6) 14

Table 2-4 - Surface Flow Data 15

Figures

Figure 1-1- Possible Locations for Early Years Abstraction 7

Figure 1-2 - Map of Abstraction Location and Observation Locations 9

Figure 2-1- Graphs of Groundwater Elevation (m AOD) vs Date within top and base of Peat (Slice 1 and 5) and top and base of Red Crag Formation (Slice 6 and 12) for proposed abstraction (0.6 Ml/d) at Groundwater Observation Locations 11

Figure 2-2 - Graph of Flow (m^3/d) and Percentage difference across Coastal Flux Observation Points 15

Figure 2-3 - Graph of Flow-Duration for Surface Flow Observation Points 17

Figure 2-4 - South Flow Observation Point 18

Figure 2-5 - North Flow Observation Point 19

1. Introduction

1.1 Background

A groundwater abstraction is required to support the Sizewell C (SZC) site within the early years of the construction phase. Further information on the abstraction requirements are presented in the overarching document to which this Technical Note supports: Statues Update – Sourcing Strategy for Early Water Delivery, issued July 2023 (Jacobs, July 2023).

Nine possible abstraction locations were initially screened for suitability, based on hydrogeological, environmental, and operational factors. The most suitable location, Location 5 as shown on Figure 1-1, was selected for further assessment and modelling, as per discussions in meetings on 26 July, 2 August 2023 and prior to February 2024. Location 5 was selected as preferential location due to feasibility from an operational perspective, that it is a sufficient distance from the coast to reduce the risk of saline intrusion and it is a sufficient distance to sensitive environmental receptors such that drawdown impact would likely be minimised.

A number of sensitive ecological/environmental receptors are present in the vicinity of SZC. These include sites of special scientific interest (SSSI); the Sizewell Marshes, located west of the SZC facility, and the Minsemere-Walberswick Heaths and Marshes, located north of the SZC facility. Additionally, a number of existing abstractions are present in the vicinity of SZC. The locations of these sensitive receptors are outlined in the Groundwater Modelling Report (Atkins Limited, March 2020).

1.2 Modelling Scope

The purpose of this study was to model the specific proposed groundwater abstraction to confirm its viability for providing water to SZC during the early-years construction phase.

The modelling was undertaken using the Development Consent Order (DCO) numerical groundwater model as approved by the Environment Agency. Details on the development and final setup of the model are presented within the Groundwater Modelling Report (Atkins Limited, March 2020). This technical note should be read in conjunction with this report to fully understand the modelled representation of groundwater behaviour. The DCO groundwater model has been approved by the Environment Agency as part of the DCO process.

The primary objective of the modelling is to confirm that the Red Crag Formation bedrock has sufficient capacity to provide the required abstraction rate whilst not negatively impacting nearby, pre-existing, abstractions or sensitive receptors.

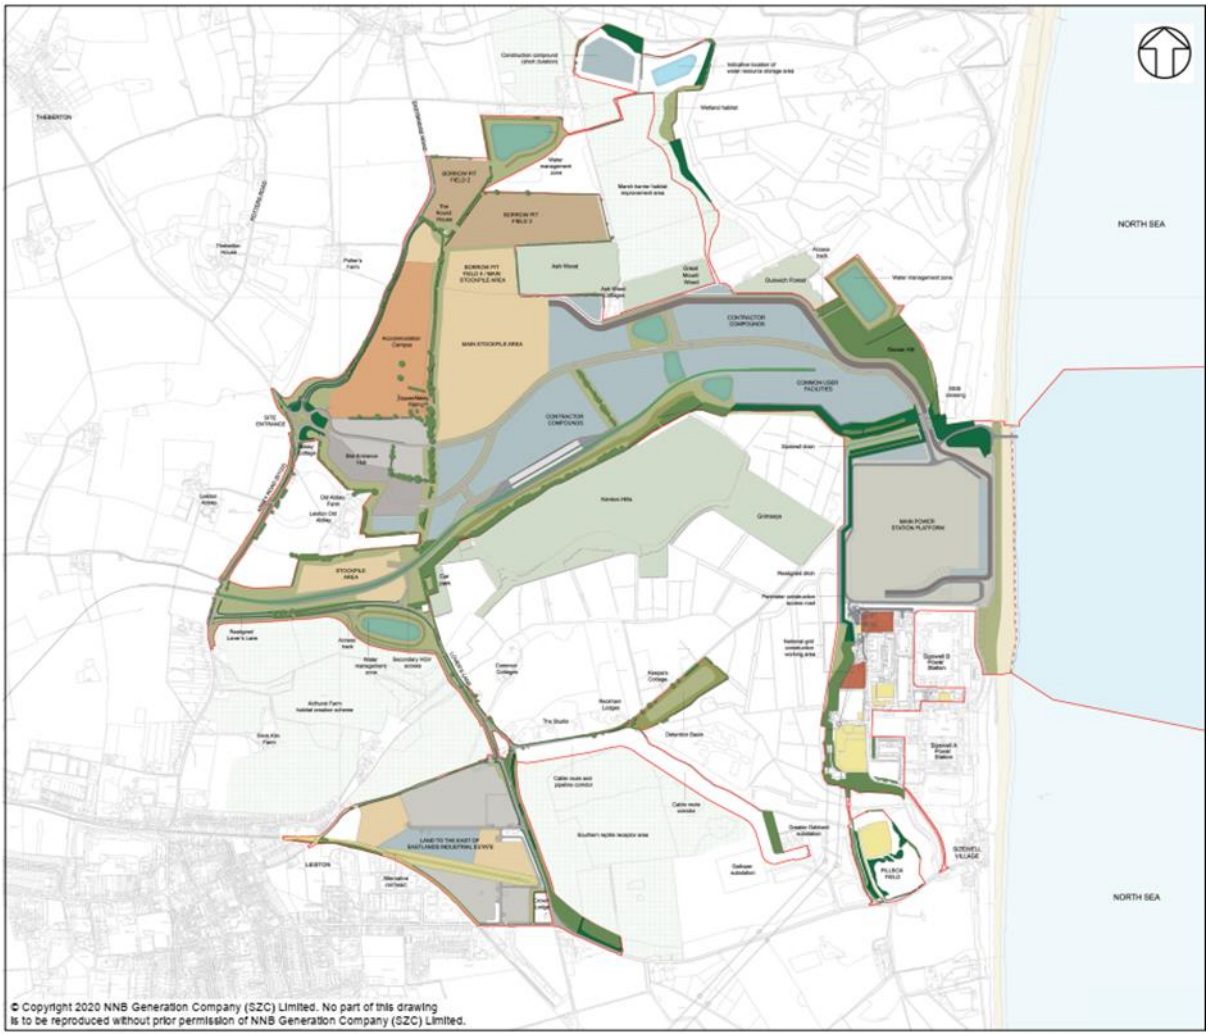


Figure 1-1- Possible Locations for Early Years Abstraction

1.3 Modelling Setup

The DCO model has been used as the baseline model to identify the potential impact of the proposed abstraction.

The maximum allowed abstraction rate for the proposed abstraction is understood to be 600 cubic meters per day (600 m^3/d, or 0.6 Ml/d). This proposed abstraction rate was included within the scenario model as a multi-layer well boundary condition with installation within the Red Crag Formation (Slices 10 to 13 in the DCO model, between approximate elevations of 0.1 meters above ordnance datum (m AOD) and -25.6 m AOD.

The modelling of the abstraction was set to start at three years prior to the start of construction dewatering of the SZC main development site (MDS).

Both baseline and scenario models have been run for four years. The models represent the local area around the SZC MDS and models two years of conditions prior to the construction of the cut-off wall (CoW). The start of dewatering of the MDS occurs one year after the construction of the CoW and has been modelled for one year. Contour plots for the groundwater elevation of the baseline DCO model for two years and four years of modelling are presented in Appendix A4.Appendix A.

The DCO model is considered representative of general current site conditions and sufficient for assessment of the potential drawdown associated with the proposed abstraction, so no update to the modelling date(s) has been implemented.

As per the Environment Agency's request (received from Jackie James via email on 19 March 2024) a number of model runs and specific output requirements, including specific observation points related to the nearby sensitive receptors, have been undertaken. The observation locations and data requested are presented in Figure 1-2 and the results are presented in Section 2.

The EA also requested that a 'naturalised' DCO model was to be run where all existing abstractions are removed from the model (no abstractions of any kind, including the proposed 0.6 Ml/d abstraction). Contour plots for the second year of modelling for this 'naturalised' model have been presented in Appendix A. It should be highlighted that this model is purely theoretical as the original DCO model was calibrated with the existing abstractions in place and as such any findings associated with the 'naturalised' model scenario should be treated with caution. Contour plots for the groundwater elevation of the naturalised DCO model for year two of modelling are presented in Appendix A as a representation of the naturalised conditions.

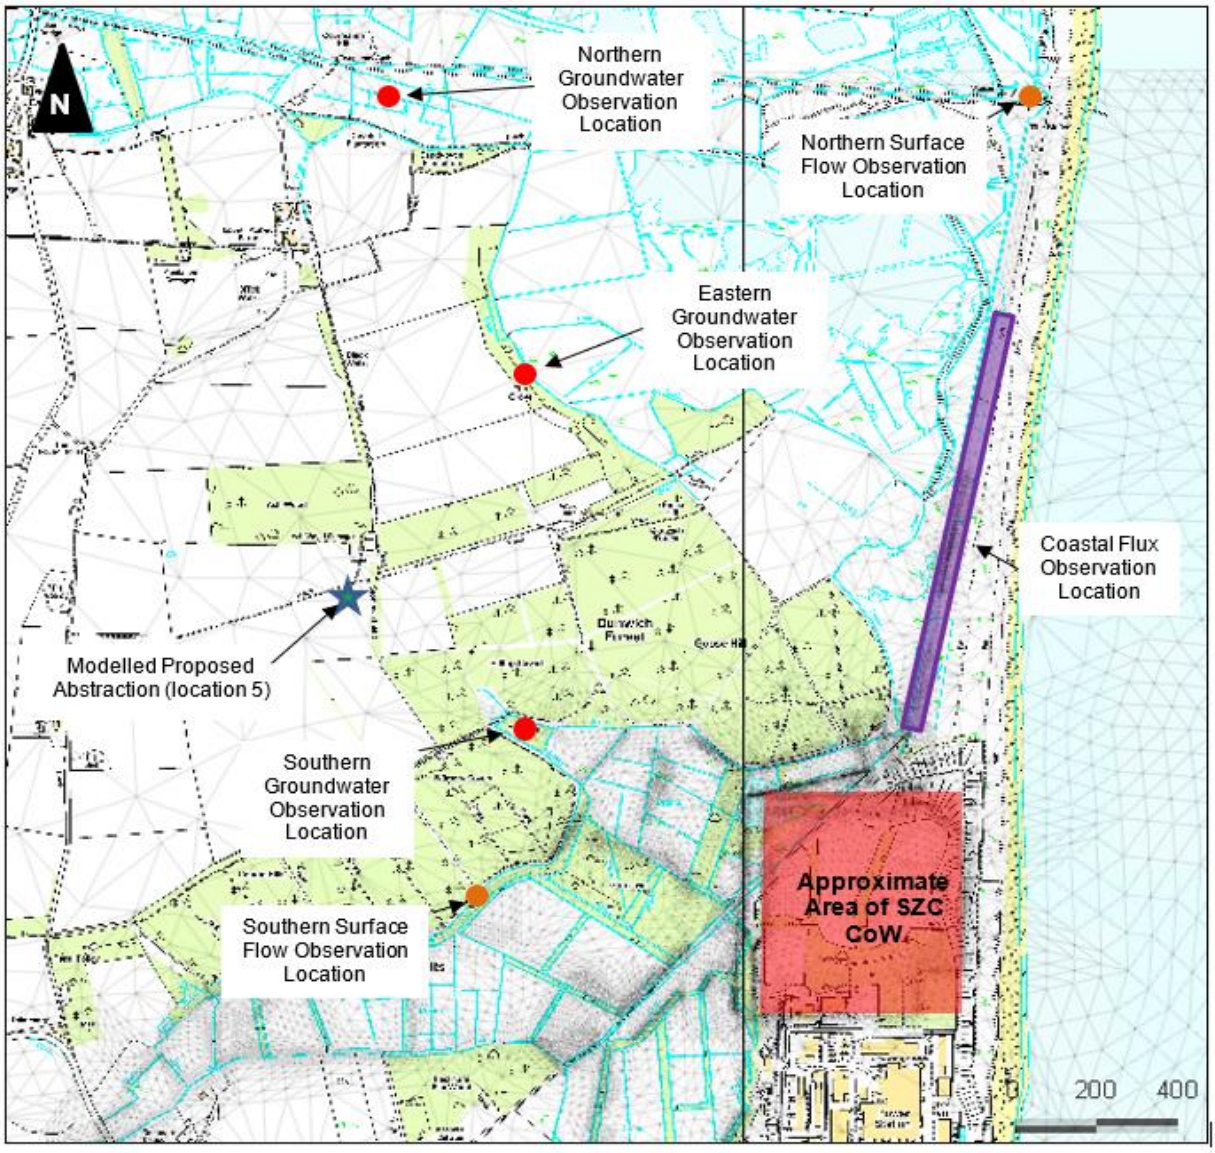


Figure 1-2 - Map of Abstraction Location and Observation Locations

2. Modelling Results

The modelling reported that the Red Crag Formation would have the necessary capacity to provide the modelled 0.6 Ml/d abstraction rate.

2.1 Drawdown due to Abstraction

The modelling indicates that the maximum drawdown within the Red Crag Formation, at the point of the abstraction, is 0.63 m. This maximum drawdown was reached within approximately three months of pumping. After this point the drawdown does not increase at the same rate and generally remains stable, with minor fluctuation related to, for example, seasonal variation in recharge.

Figure 2-1 presents graphs for the groundwater monitoring locations near to each sensitive receptor as requested by the EA. The graphs present the modelled groundwater elevation in m AOD across the peat (Slice 1 and 5) and Red Crag Formation (Slice 6 and 12).

Comparison between the baseline DCO and abstraction scenario groundwater levels allows for calculation of the modelled drawdown resulting from the pumping of the abstraction. Modelled drawdown is summarised to two decimal places for the four years following the start of abstraction) in Table 2-1, below.

Table 2-1 - Summary of Modelled Groundwater Drawdown due to Abstraction at Location 5

Modelled time	Drawdown (m)			
	Abstraction Location*	Eastern Observation Location	Northern Observation Location	Southern Observation Location
Top of Peat (Slice 1)				
Year 1	0.57	0.12	<0.01	0.08
Year 2	0.56	0.07	<0.01	0.07
Year 3	0.58	0.11	<0.01	0.06
Year 4	0.57	0.12	0.01	0.08
Base of Peat (Slice 5)				
Year 1	0.62	0.12	0.02	0.11
Year 2	0.62	0.11	0.05	0.09
Year 3	0.60	0.11	0.02	0.09
Year 4	0.62	0.12	0.02	0.11
Top of Red Crag (Slice 6)				
Year 1	0.62	0.12	0.03	0.13
Year 2	0.62	0.11	0.04	0.10
Year 3	0.61	0.11	0.02	0.11
Year 4	0.62	0.12	0.02	0.12
Base of Red Crag (Slice 12)				
Year 1	0.62	0.12	0.03	0.13
Year 2	0.62	0.11	0.04	0.10
Year 3	0.61	0.11	0.02	0.11
Year 4	0.63	0.12	0.02	0.13


* Peat is not present at the proposed location of abstraction. Slice 1 presents drawdown at the top of the Red Crag Formation for the location of abstraction.

Year 2 is when the MDS CoW is included in the model.

Year 3 is when dewatering of the MDS CoW begins within the model.

The data suggests that equilibrium with the impact of the abstraction is reached within the first year at all locations. The northern observation location reports the lowest magnitude of drawdown, and the southern observation location reports the highest.

Table 2-1 and Figure 2-1 show that the absolute magnitude of drawdown varies across the model period at each location. This is due to the changes in model conditions over the model period, including, for example, climatic and seasonal changes in recharge and sea level.

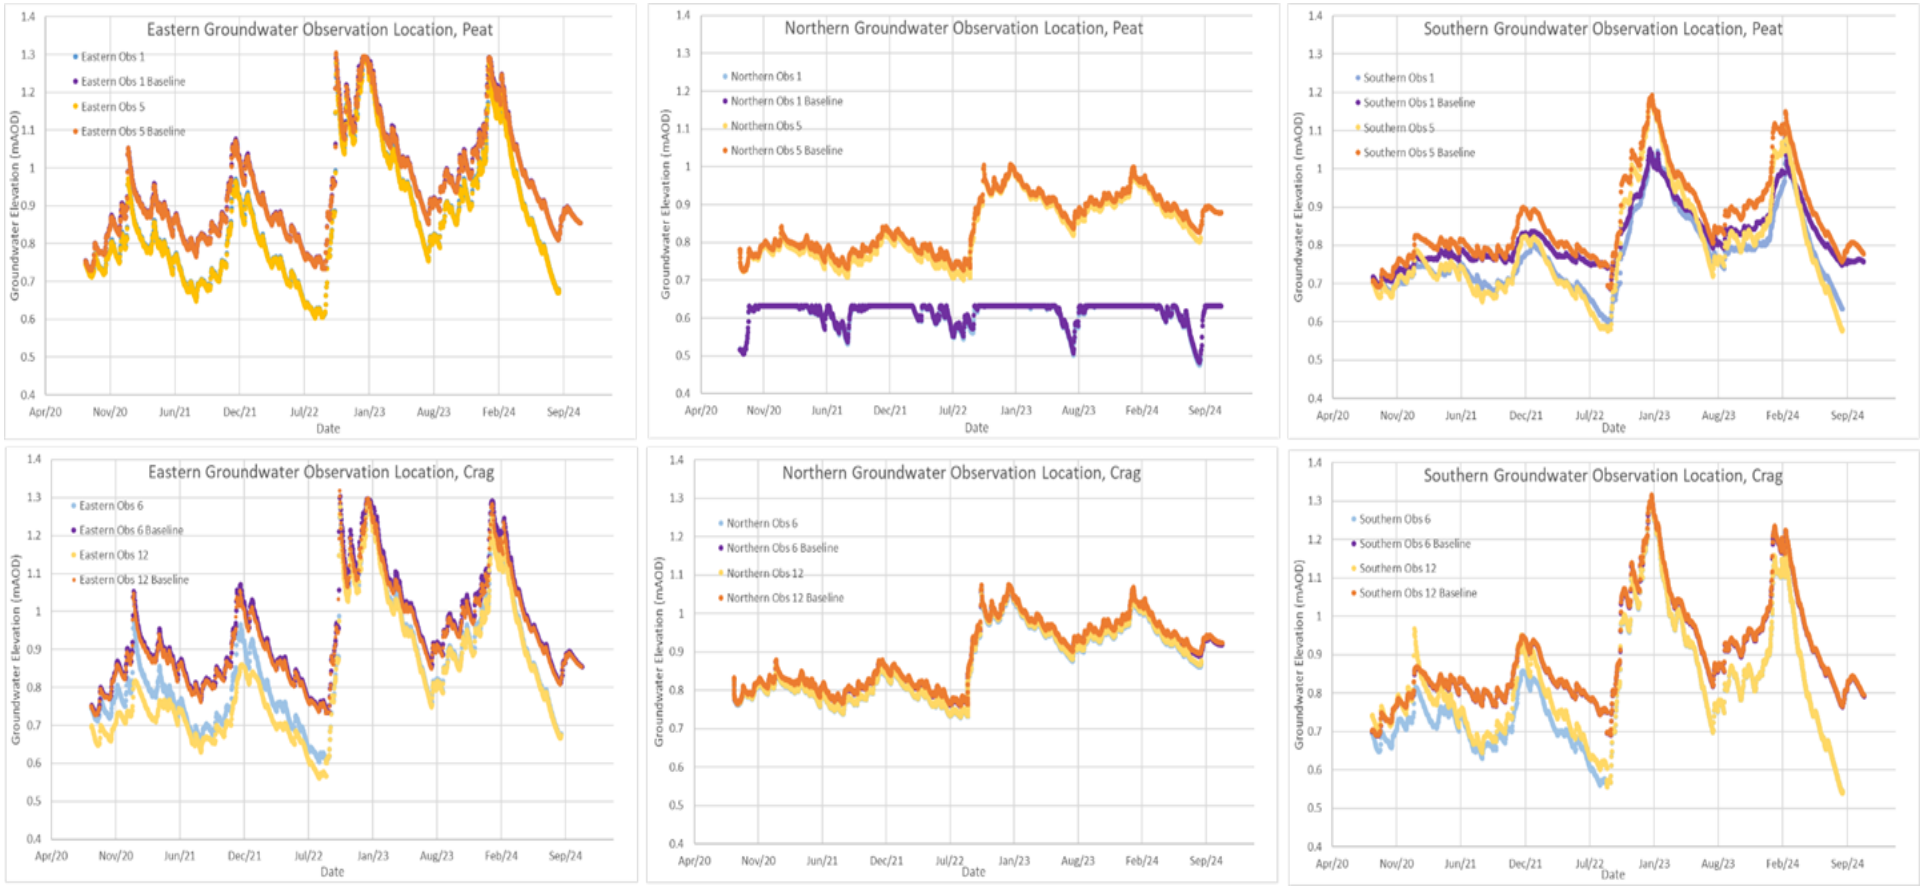

Blue line = CoW present in model

Black line = start of MDS dewatering

Figure 2-1- Graphs of Groundwater Elevation (m AOD) vs Date within top and base of Peat (Slice 1 and 5) and top and base of Red Crag Formation (Slice 6 and 12) for proposed abstraction (0.6 Ml/d) at Groundwater Observation Locations

The data show that the drawdown at the location of abstraction is generally stable between 0.57 m and 0.63 m in the Red Crag Formation at the four reported model times. The modelled drawdown at the three observation locations is lower than the drawdown reported at the abstraction location (in accordance with expectations), with a maximum drawdown after four years of 0.12 m at the eastern observation location, 0.02 m at the northern observation location and 0.13 m at the southern observation location.

The drawdown reported at the northern observation location is 0.02 and 0.04 m. As visible on the graph for the northern observation location in the Peat, the data for Slice 1 is different than the other slices at this location. This is expected to be a result of the infiltration and surface water head boundary conditions that are present around the Minsmere River and SSSI, which are very close to the location of this observation location.

Drawdown across all three observation locations remains generally similar across the four years of modelled abstraction, with some variation as discussed above. The data indicates that equilibrium will be reached at the observation locations within the first year.

MDS Dewatering

The dewatering of the MDS, dewatering to -18.9 m AOD, results in a small amount of drawdown across the area around the MDS, as summarised in the numerical modelling report (Atkins Limited, March 2020). As such the combined impact of the proposed abstraction and MDS dewatering may result in a greater combined drawdown at the observation locations.

To assess this, the modelled drawdown at the observation locations for year four, with and without the impact of the MDS dewatering, is presented in Table 2-2.

Table 2-2 - Summary of Modelled Drawdown with MDS Dewatering

Modelled time	Drawdown at Year 4 (m)			
	Abstraction Location	Eastern Observation Location	Northern Observation Location	Southern Observation Location
Drawdown - including impact of MDS dewatering (as per Table 2-1)				
Slice 1	0.57	0.12	0.01	0.08
Slice 5	0.62	0.12	0.02	0.11
Slice 6	0.62	0.12	0.02	0.12
Slice 12	0.63	0.12	0.02	0.13
Drawdown - impact of MDS dewatering removed				
Slice 1	0.54	0.10	0.01	0.05
Slice 5	0.60	0.10	0.02	0.04
Slice 6	0.60	0.10	0.02	0.03
Slice 12	0.60	0.10	0.02	0.03
Difference in drawdown - impact of MDS dewatering				
Slice 1	0.03	0.02	<0.01	0.04
Slice 5	0.03	0.02	<0.01	0.07
Slice 6	0.03	0.02	<0.01	0.10
Slice 12	0.02	0.02	0.01	0.10

All values presented to 2 decimal places

The data in Table 2-2 shows that the dewatering of the MDS has a limited impact on the eastern and northern observation locations with a minor increase in drawdown of 0.02 m and 0.01 m respectively. The drawdown at the abstraction location itself is also generally similar with a maximum difference of 0.03 m. The southern observation location reports the largest increases between 0.04 m and 0.10 m, with the Peat (Slices 1 and 5) reporting less of a difference than the Red Crag Formation (Slices 6 and 12). The southern observation location is the closest observation location to the MDS dewatering, located on the edge of the Sizewell Marshes.

2.2 Area of Influence

Contour plots for drawdown at year 2 and year 4 and all slices (slice 1, 5, 6 and 12) are presented in Appendix A. Separate contour plots have been presented for year 4 with one set including the dewatering of the MDS CoW and one without the impact of this additional drawdown. This allows for presentation of the combined drawdown impact, as well as the drawdown related to the proposed abstraction only.

In general, the drawdown is limited to areas outside of the sensitive receptors with only small areas of >0.1 m entering the southern and eastern SSSIs. This is limited to a few tens of meters before reducing to an impact of below 0.1 m.

When combined with the MDS dewatering, the results are similar to the baseline DCO dewatering results, with small, isolated patches of drawdown of 0.1 m across the top of the peat (Atkins Limited, March 2020).

2.3 Change in Groundwater Flow

The EA requested information on the modelled change in vertical groundwater flux from the Crag to overlying peat at the three observation locations in Figure 1-2.

Vertical darcy flux (m/d) has been extracted from the model at the four year-marks following the start of abstraction in the baseline and scenario model to allow comparison and calculation of relative percentage difference. The data is presented in Table 2-3, below.

Table 2-3 - Vertical Flow Data (Slice 6)

	Observation Location	Date			
		Year 1	Year 2	Year 3	Year 4
Baseline	North	2.0	2.0	4.8	5.4
	East	-2.5	-2.2	-2.7	-1.8
	South	1.2	0.3	3.1	-1.4
Scenario	North	1.7	1.8	4.2	5.1
	East	-1.9	-1.7	-2.4	-2.2
	South	-0.6	-1.0	1.4	-2.9
Difference	North	-0.3	-0.2	-0.5	-0.3
	East	0.6	0.5	0.2	-0.3
	South	-1.8	-1.2	-1.7	-1.5
RPD (%)	North	18.3	10.0	12.0	5.9
	East	26.0	26.7	9.8	16.6
	South	583.3	340.6	75.2	68.1

Values in 10^{-4} m/d unless specified
RPD = relative percentage difference

Within the baseline model both positive and negative results are reported at the selected nodes in slice 6. The positive and negative values represent upward and downward vertical flow at the node respectively. The data suggests that the abstraction has a generally consistent impact on the modelled vertical flow which aligns with the maximum drawdown being reached within approximately 3 months of operation (as discussed in Section 2.1).

The results suggest a minor decrease in the upward flow at the northern and downward flow at eastern locations. Both data sets show that the flow remains in the same overall direction across the four-year data points, upward flow for the northern location and downward flow for the eastern. The southern location reports the largest difference as well as a change from upwards vertical flow to downward flow. The relative percentage difference at the southern location decreases over the modelled period even though the absolute difference in flow remains generally similar.

2.4 Change in Coastal Flux

The EA requested a comparison of the modelled change in coastal flux at a linear set of locations, located sub-parallel to the coast, north of the SZC MDS, as shown on Figure 1-2.

The flow data has been extracted from the model for a linear set of nodes present along the location requested and compared between baseline and scenario models. The data show that the proposed abstraction has a maximum of a 5.6 % change in flow at the selected nodes with no impact on the flux over the majority of the modelled period. The time periods of greater identified difference between baseline and scenario tend to fall within winter periods and are therefore anticipated to be related to modelled seasonal variation and potential storm events. The extracted data is presented in Figure 2-2, below.

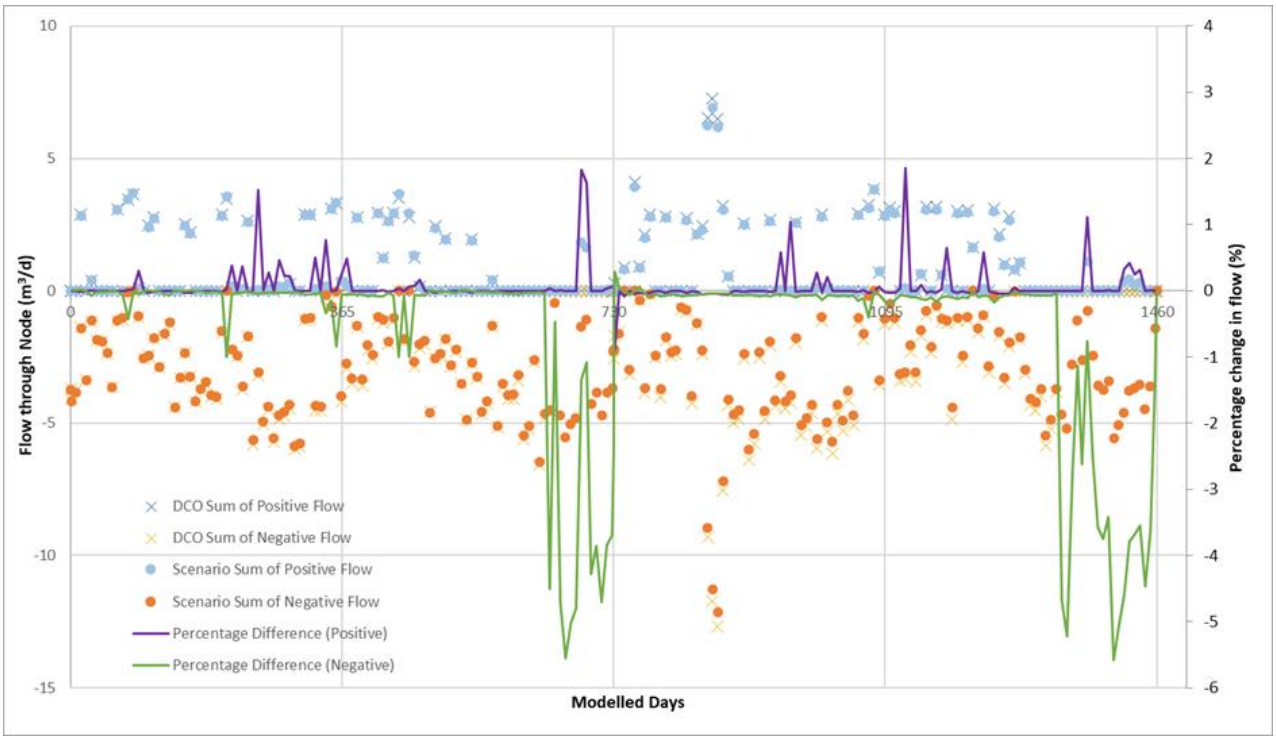


Figure 2-2 - Graph of Flow (m^3/d) and Percentage difference across Coastal Flux Observation Points

The data report that the model results vary by less than a difference of 0.1 % over 65% of the modelled time and vary by less than 1 % over 84 % of the model time.

2.5 Change in Surface Water Flow.

The EA also requested to review the potential impact the proposed abstraction on surface water/groundwater interaction and flow at locations presented in Figure 1-2.

The model runs with an integrated plugin for MIKE11, surface water modelling software. This allows for modelling of interaction between groundwater and surface water channels providing water level and discharge data. The data from the baseline and scenario models were compared and are presented in Table 2-4, below.

Table 2-4 - Surface Flow Data

	Northern Surface Flow Observation Location	Southern Surface Flow Observation Location

Discharge Parameter (m^3/s unless specified)	DCO	Proposed Abstraction	DCO	Proposed Abstraction
Q95^	0.002	0.00078	0.025	0.025
Q95^ (Ml/d)	0.173	0.067	2.177	2.143
Minimum	-0.26	-0.27	-0.07	-0.06
Maximum	0.46	0.46	0.34	0.35
Total Discharge*	527.42	517.45	475.47	472.61
Total Positive Discharge*	546.71	537.65	475.72	472.96
Total Negative Discharge*	-19.29	-20.19	-0.25	-0.35

^Q95 for dry model run (4 years).

*Total discharge is the cumulative discharge across the four years of model run

Negative discharge values indicate modelled periods of reversed, upstream, flow at the selected location. These may occur due to e.g. sea level change and inundation or storm events.

The modelled Q95 values are not comparable to reported physical data because of the location of measurement points, the nature of the model setup (running of a dry model scenario) and associated model calibration and constraints. Fundamentally, the original model objectives were not to model flow rates within surface water courses and, whilst calibration of such was undertaken, they could be subject to significant errors (Atkins Limited, March 2020). As such a comparison between the baseline and scenario model has been undertaken. The modelled data indicates that the abstraction will have little impact on surface water-groundwater interaction at the Sizewell Marshes SSSI.

The observation locations discussed below are the locations of the green squares as requested by the EA. The reported data and calculated Q95 show that the proposed abstraction will have little impact on the southern surface flow observation location (on the Sizewell Marshes SSSI) with the data suggesting almost no change in Q95 and similar minimum and maximum flow values. The northern surface water flow observation location (representing the confluence of the Leiston Drain and Minsmere New Cut) reports a slightly greater change with a slight reduction in the calculated Q95. However, the minimum and maximum flow rates at the northern location remain similar.

The northern location is considered less representative of the area in the vicinity of the SZC MDS as it is close to the northern edge of the model. This northern location is therefore less likely to be a reliable representation of flow, as was acknowledged in the 2020 numerical modelling report with up to 100% errors at this location. The Minsmere River and its flow is not included in the model and the model boundary conditions may have a large impact on the conditions at this location.

A graph presenting flow-duration percentage exceedances for both north and south observation locations for baseline and proposed abstraction models, showing little difference between the plotted lines, is presented in Figure 2-3, below.

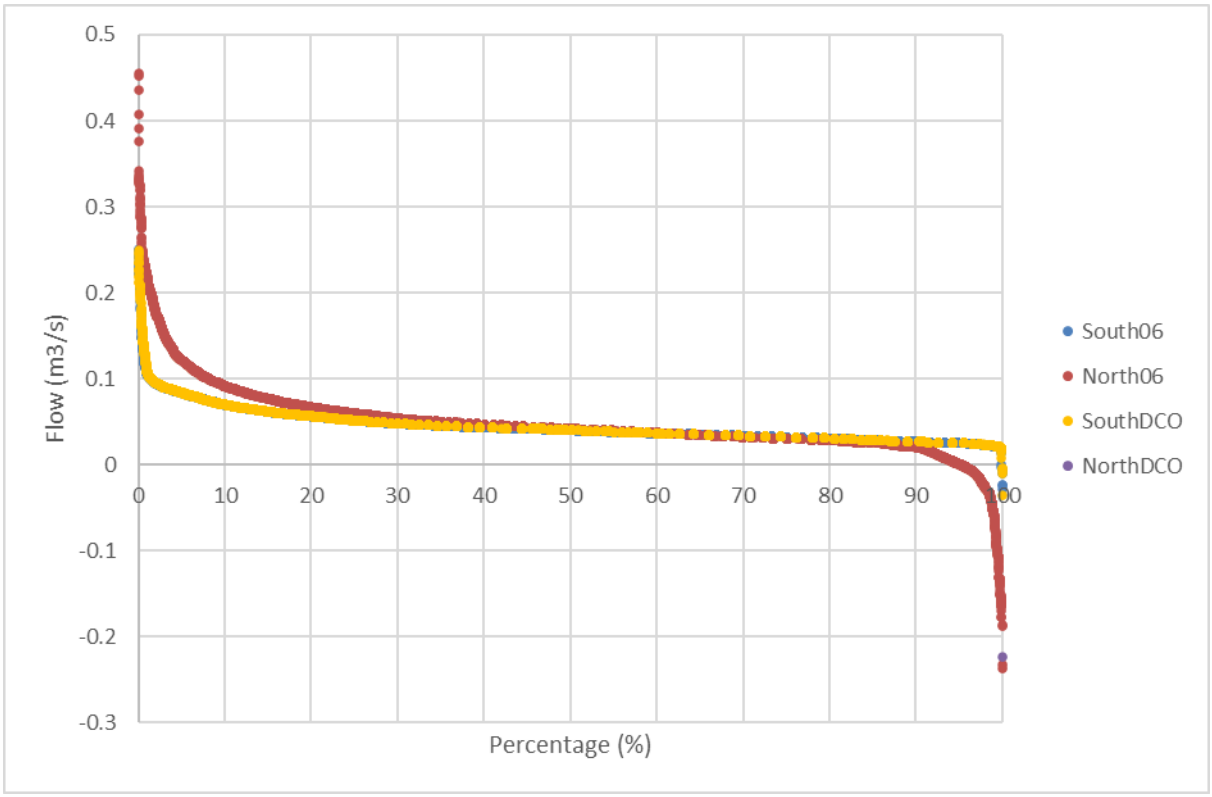


Figure 2-3 - Graph of Flow-Duration for Surface Flow Observation Points

Graphs of discharge are presented for both locations in Figure 2-4 and Figure 2-5, below. The data within the graph of the southern location shows that the modelled discharge is generally similar across the modelling, other than at a small number of extreme events where more variation is present in both baseline and scenario data. During these extreme events the variation in discharge is high and so the differences during these points is considered likely to relate to the ability of the models to represent this highly variable data, rather than a distinct variation between models.

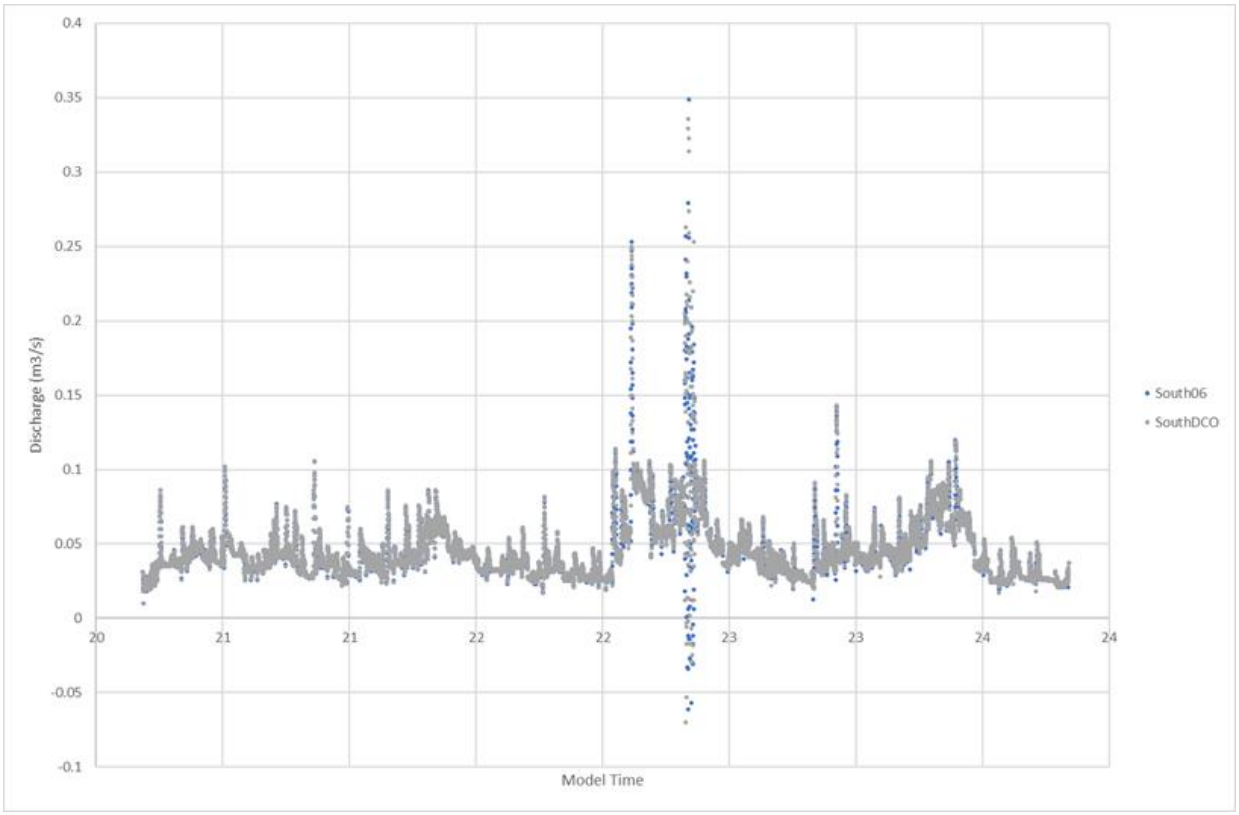


Figure 2-4 - South Flow Observation Point

Data for the northern point is, in general, more variable than for the southern location, with more variation from the general baseline discharge. In general, the discharge is still considered to be similar, and the same conclusions as above apply to the areas of larger variation.

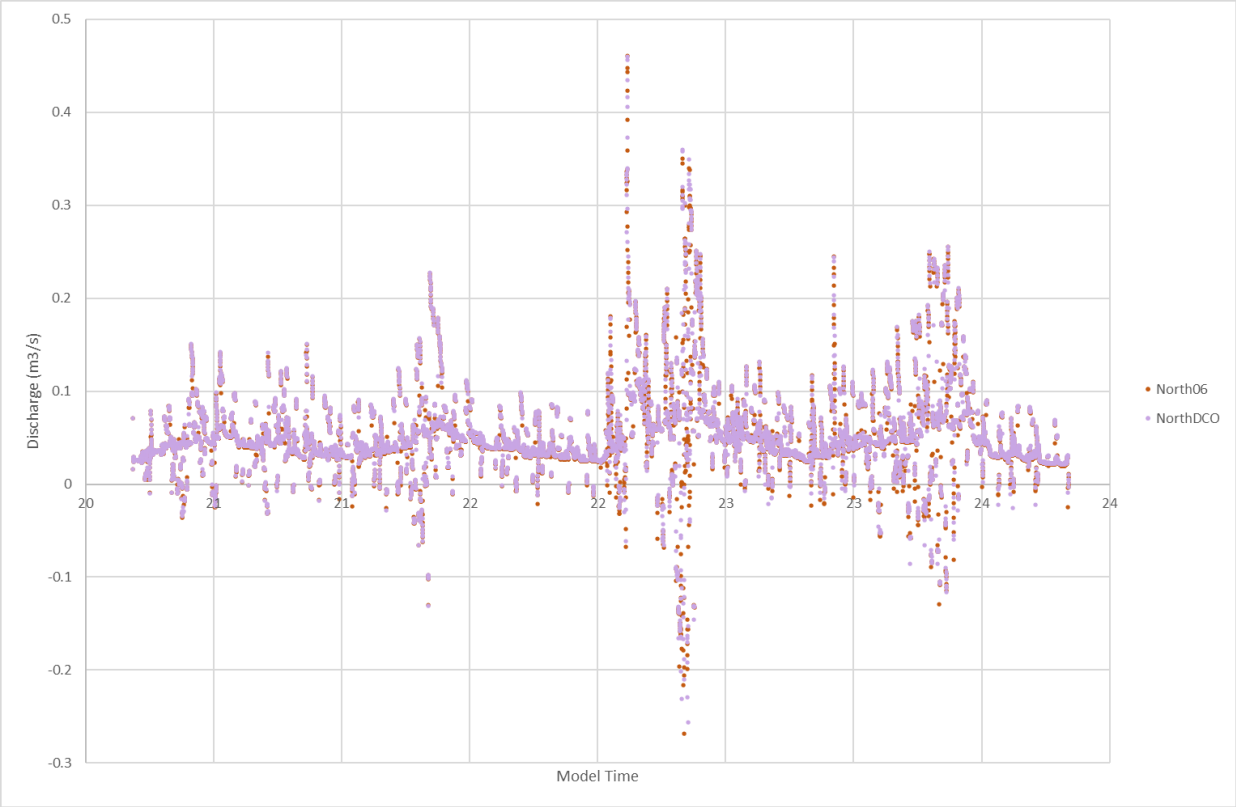


Figure 2-5 - North Flow Observation Point

3. Conclusions

The modelling reports that the Red Crag Formation has the necessary capacity to provide the modelled 0.6 Ml/d abstraction rate. At the proposed location the maximum drawdown is 0.63 m within the Red Crag Formation, which is reached within approximately 3 months of abstraction and then remains generally consistent.

Drawdown at the edge of the nearby SSSI locations is modelled at a maximum of approximately 0.12 m and is shown not to extend any major distance into any of the SSSI themselves.

The modelling indicates that the abstraction should have limited combined impact on the modelled drawdown associated with the dewatering of the MDS. Following one year of dewatering of the MDS (4 years of abstraction), the drawdown at the Sizewell Marshes SSSI is generally less than 0.1 m with occasional limited areas of drawdown above this. This aligns with the modelled impact of the dewatering across the majority of the Sizewell Marshes (Atkins Limited, March 2020).

Should the proposed rate of abstraction be lower than the 0.6 Ml/d, additional modelling could be undertaken to assess the resulting differences to the identified drawdown/impact to groundwater. However, lower rates of abstraction are likely to result in less impact to the modelled conditions.


4. References

Atkins Limited, March 2020. *Sizewell C Numerical Modelling Report, R04 (Volume 2,Chapter 19 Appendix A,Groundwater and Surface water:Numerical Modelling Report)*.

Jacobs, July 2023. *Status Update - Sourcing Strategy for Early Water Delivery. Teamcenter Ref: 101124011*.

Appendix A. Groundwater Contour Plots

A-1 : Year 2 DCO model - baseline (0.6Ml/d abstraction not present), Slice 1

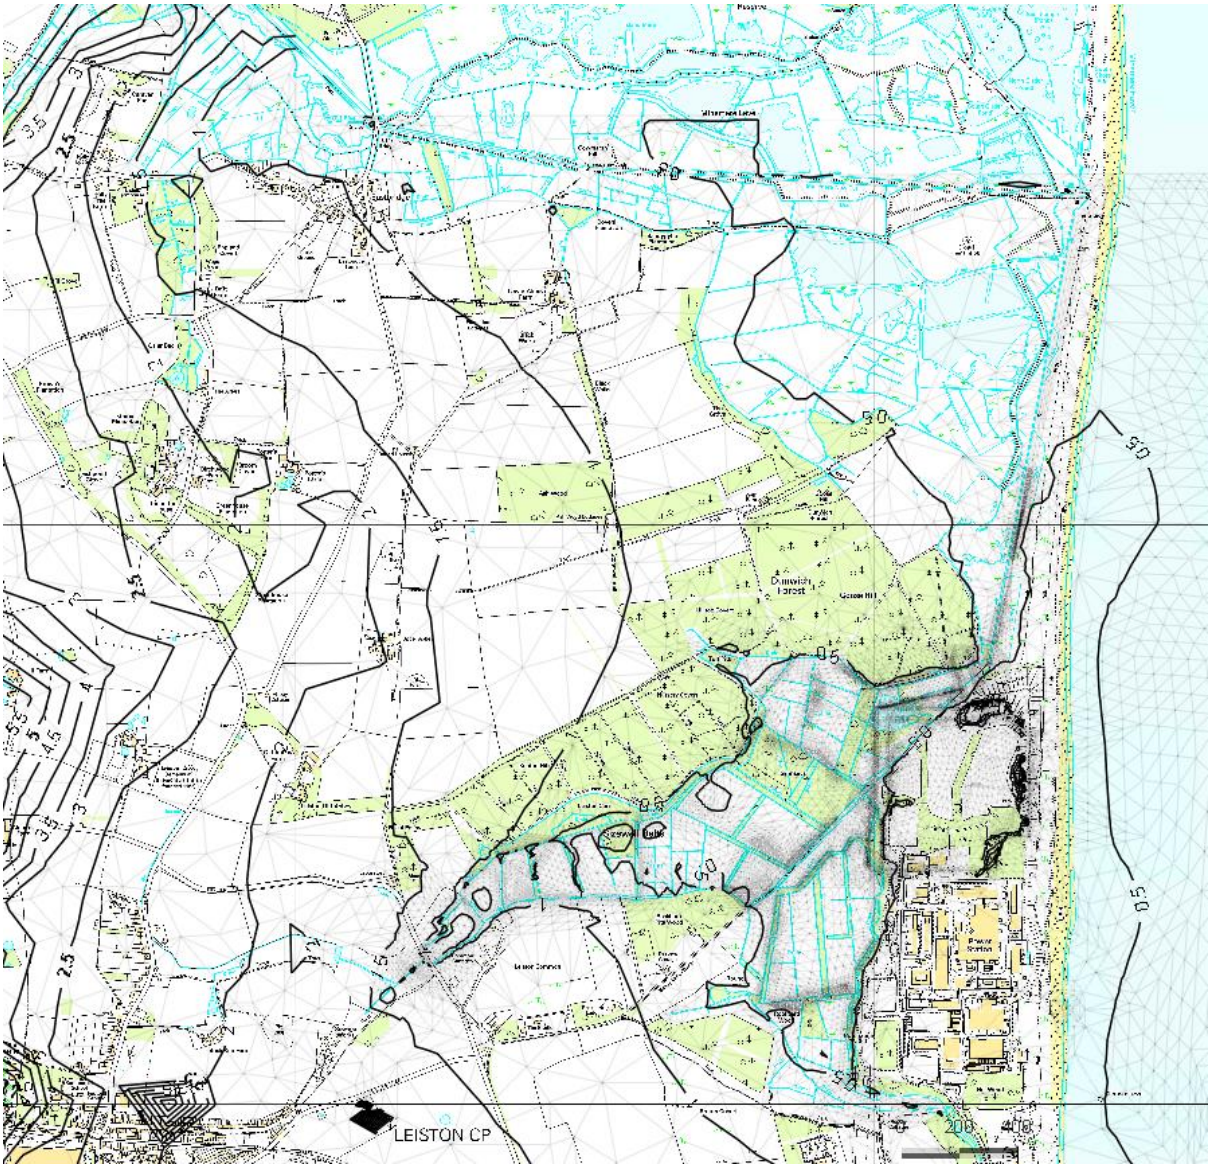

A-2 : Year 2 DCO model - baseline (0.6Ml/d abstraction not present), Slice 5



A-3 : Year 2 DCO model - baseline (0.6Ml/d abstraction not present), Slice 6



A-4 : Year 2 DCO model - baseline (0.6Ml/d abstraction not present), Slice 12



A-5 : Year 4 DCO model with MDS dewatering, Baseline (0.6Ml/d abstraction not present), Slice 1



A-6 : Year 4 DCO model with MDS dewatering, Baseline (0.6Ml/d abstraction not present), Slice 5




A-7 : Year 4 DCO model with MDS dewatering, Baseline (0.6Ml/d abstraction not present), Slice 6




A-8 : Year 4 DCO model with MDS dewatering, Baseline (0.6Ml/d abstraction not present), Slice 12




A-9 : 'Naturalised' DCO model - EA request for removal of all abstractions, Slice 1

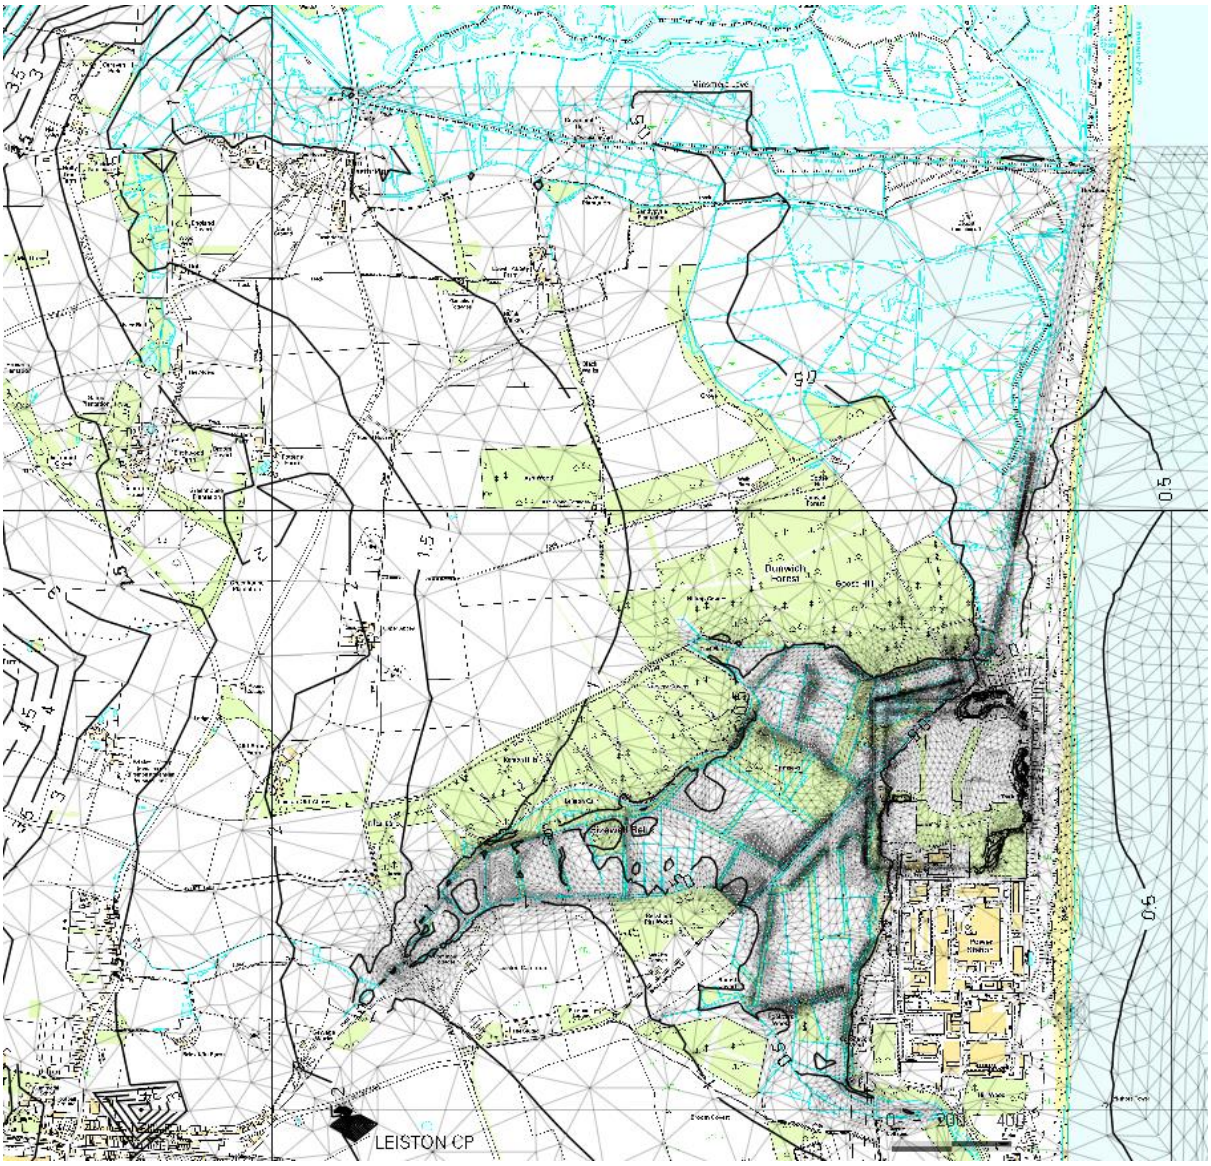


A-10 : 'Naturalised' DCO model - EA request for removal of all abstractions, Slice 5

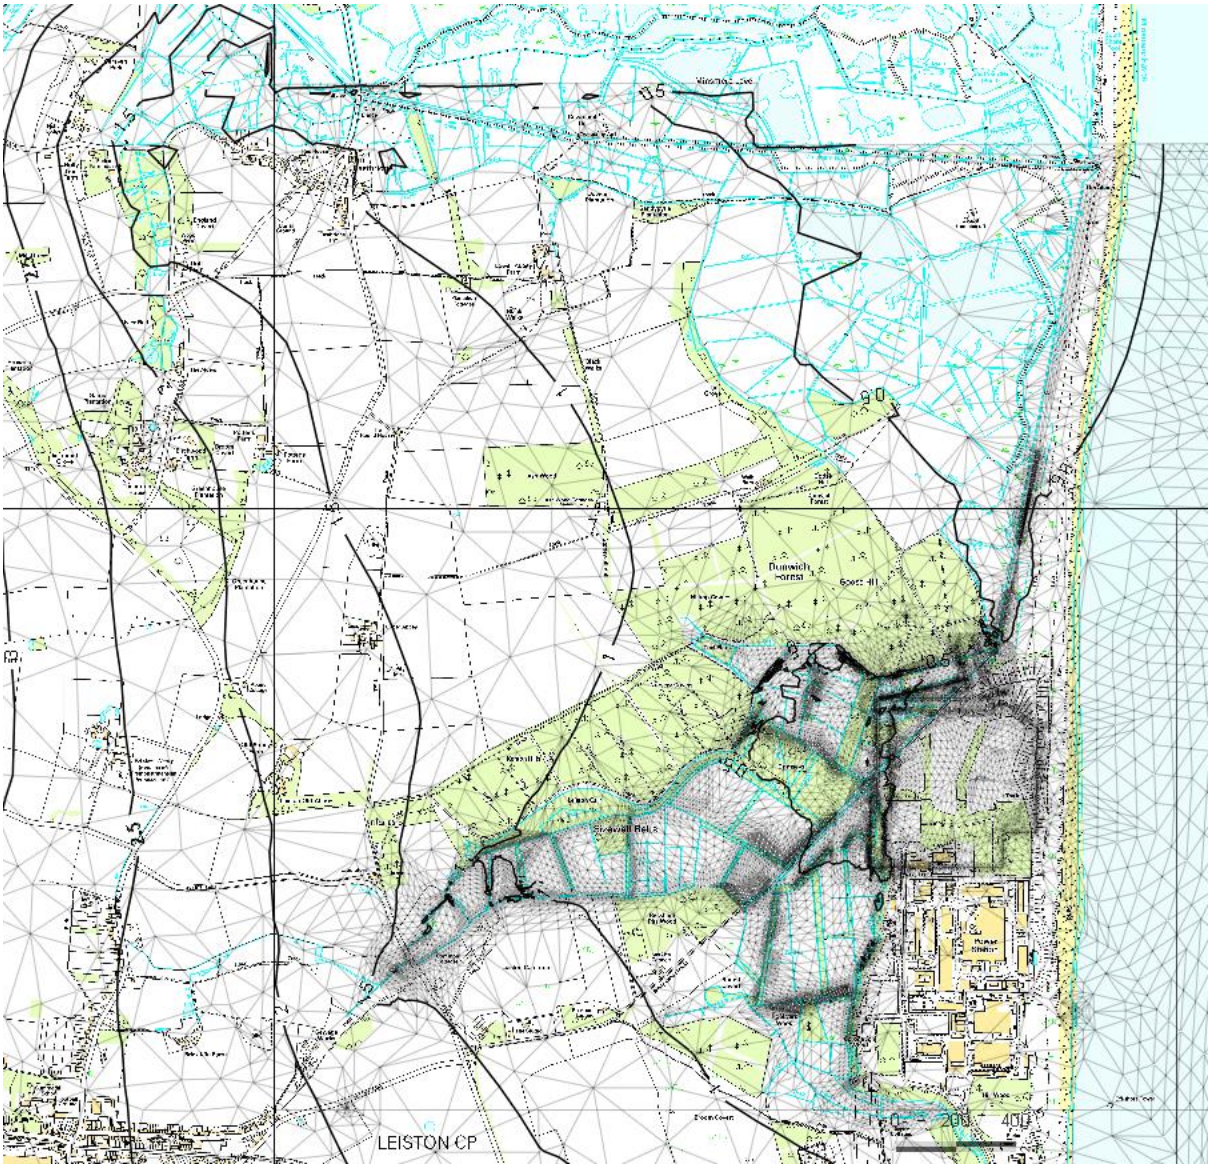

A-11 : 'Naturalised' DCO model - EA request for removal of all abstractions, Slice 6

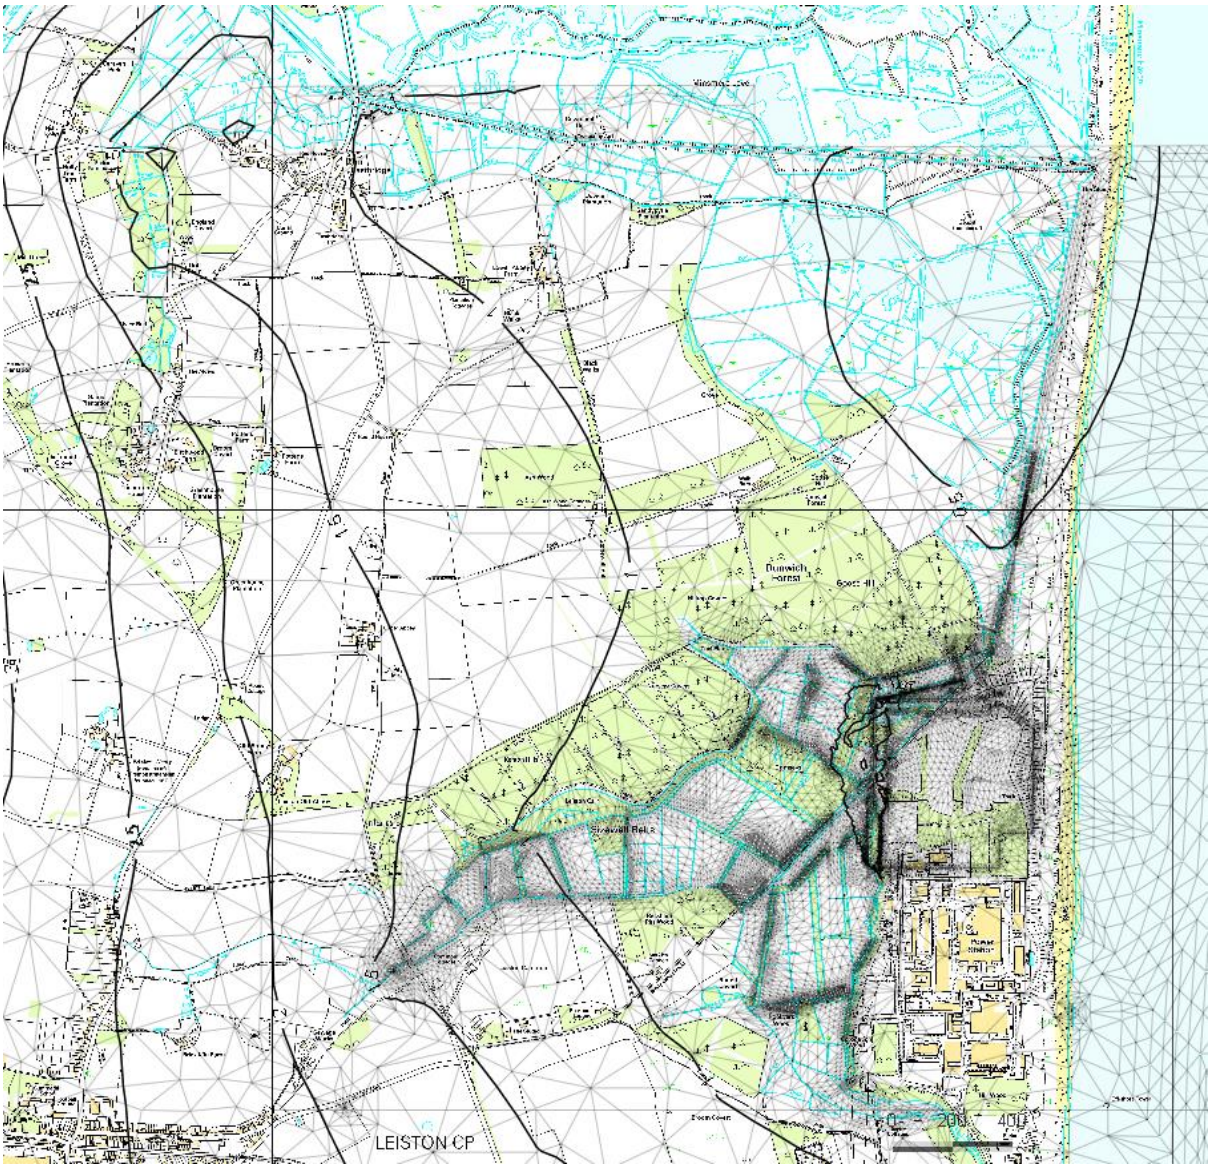


A-12 : 'Naturalised' DCO model - EA request for removal of all abstractions, Slice 12

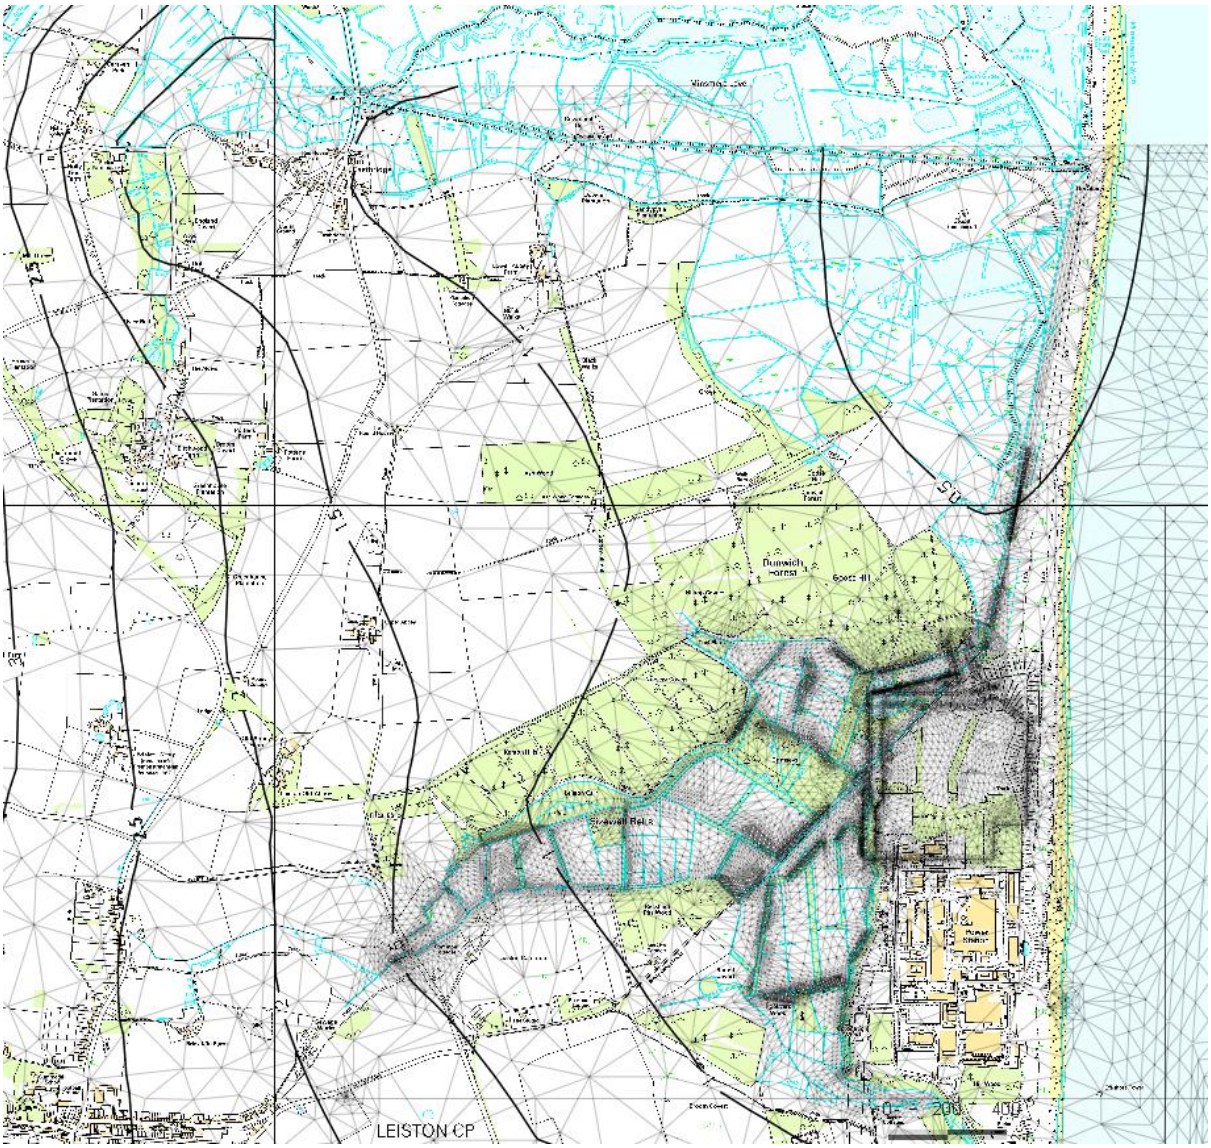


Appendix B. Drawdown Contour Plots


B-1 : Year 2 Drawdown, Slice 1

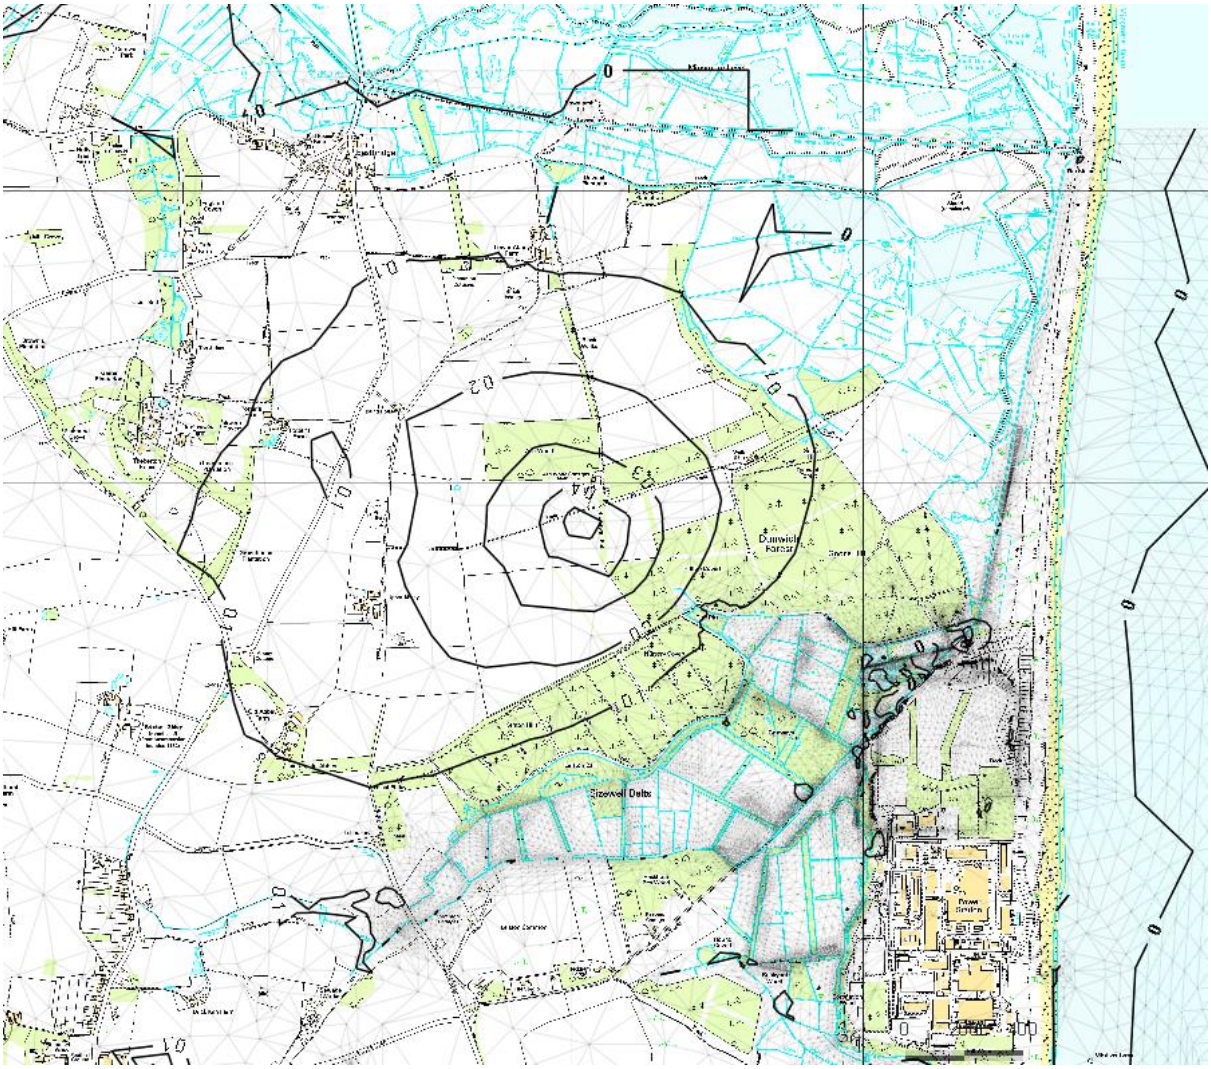


B-2 : Year 2 Drawdown, Slice 5

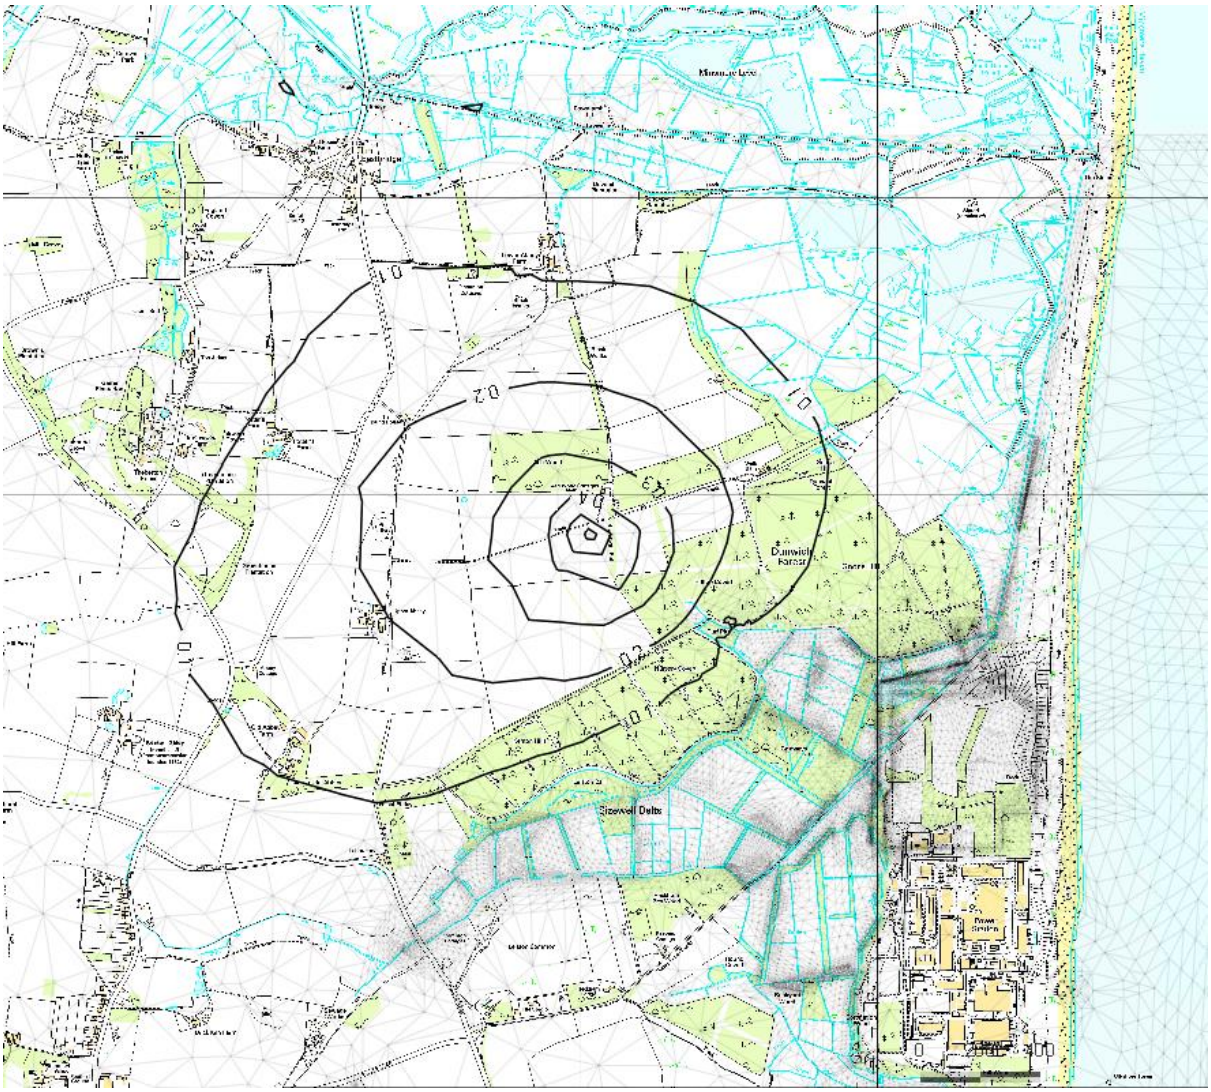


B-3 : Year 2 Drawdown, Slice 6

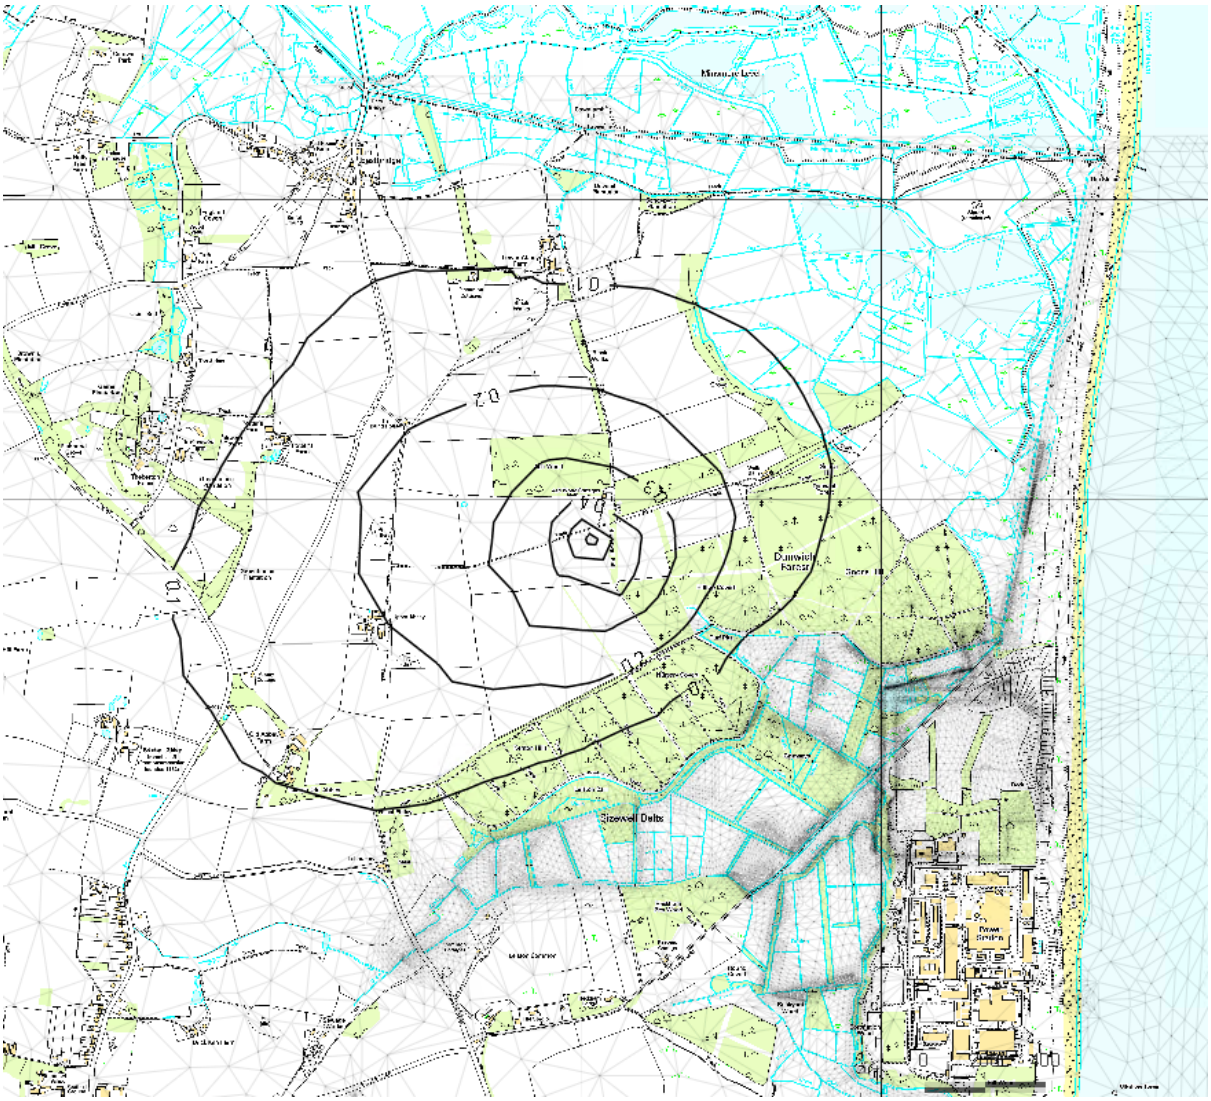

B-4 : Year 2 Drawdown, Slice 12

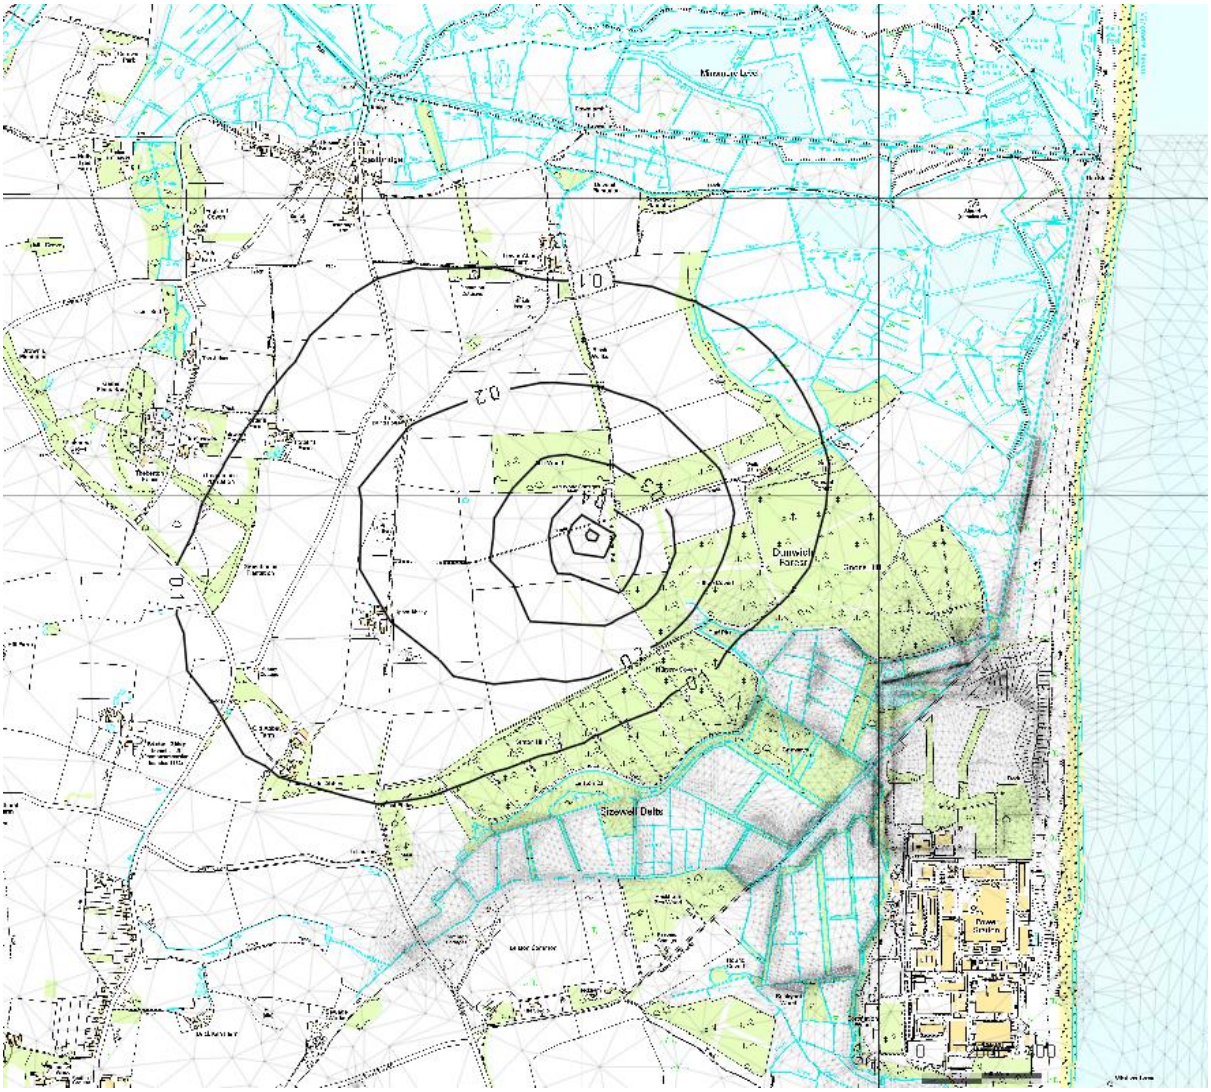

B-5 : Year 4, Impact of proposed abstraction only (impact of MDS dewatering removed), Slice 1

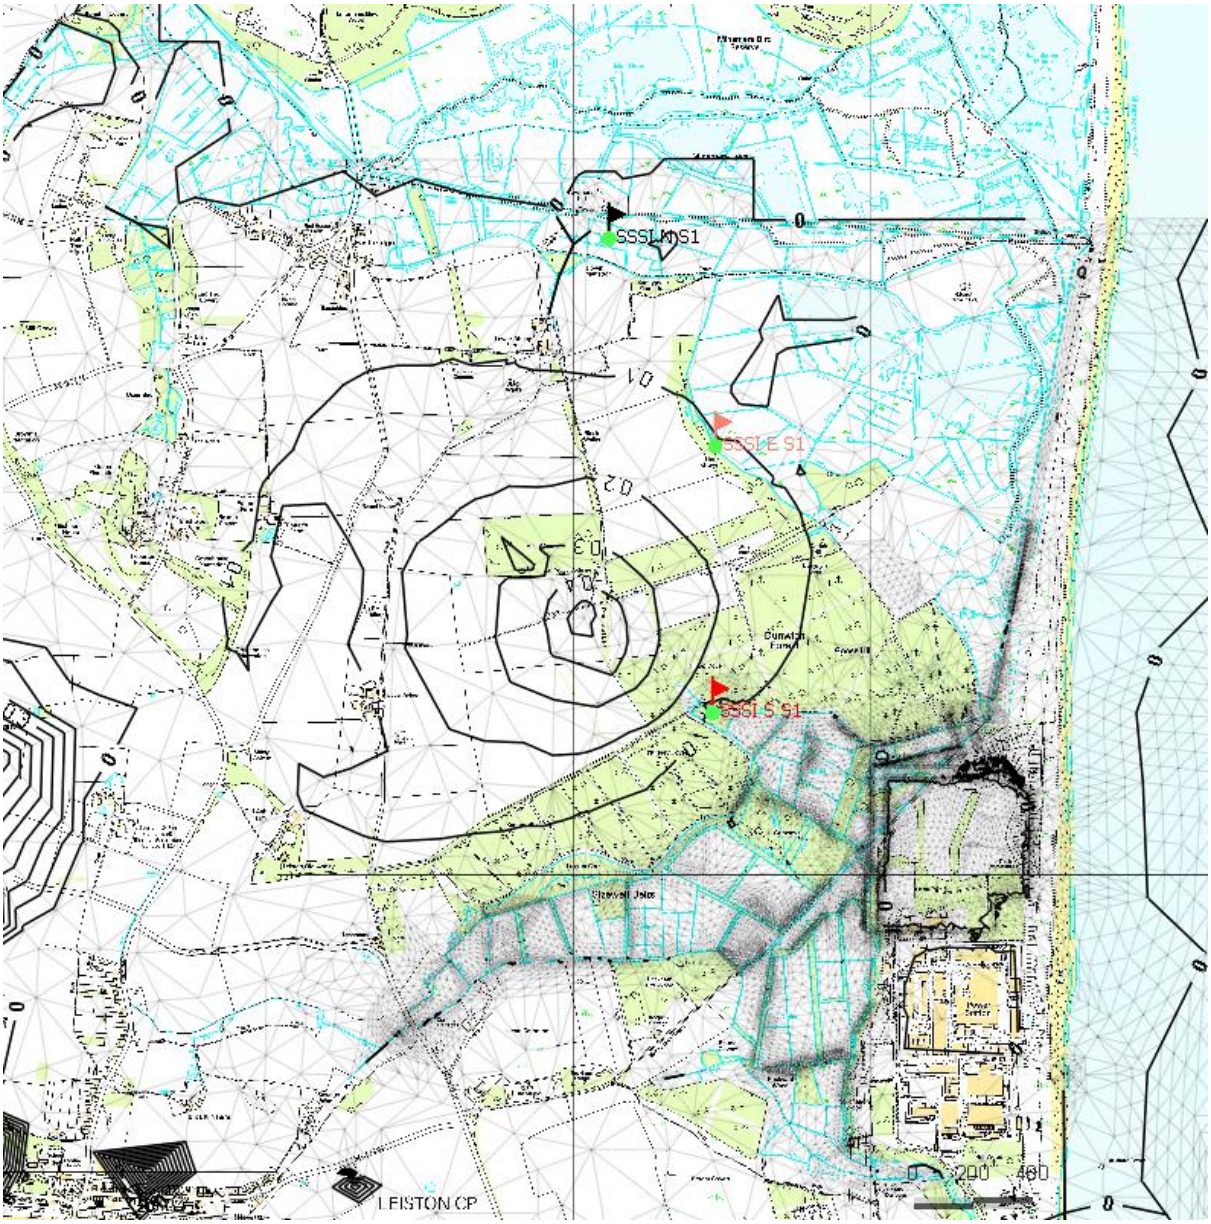


B-6 : Year 4, Impact of proposed abstraction only (impact of MDS dewatering removed), Slice 5




B-7 : Year 4, Impact of proposed abstraction only (impact of MDS dewatering removed), Slice 6



B-8 : Year 4, Impact of proposed abstraction only (impact of MDS dewatering removed), Slice 12

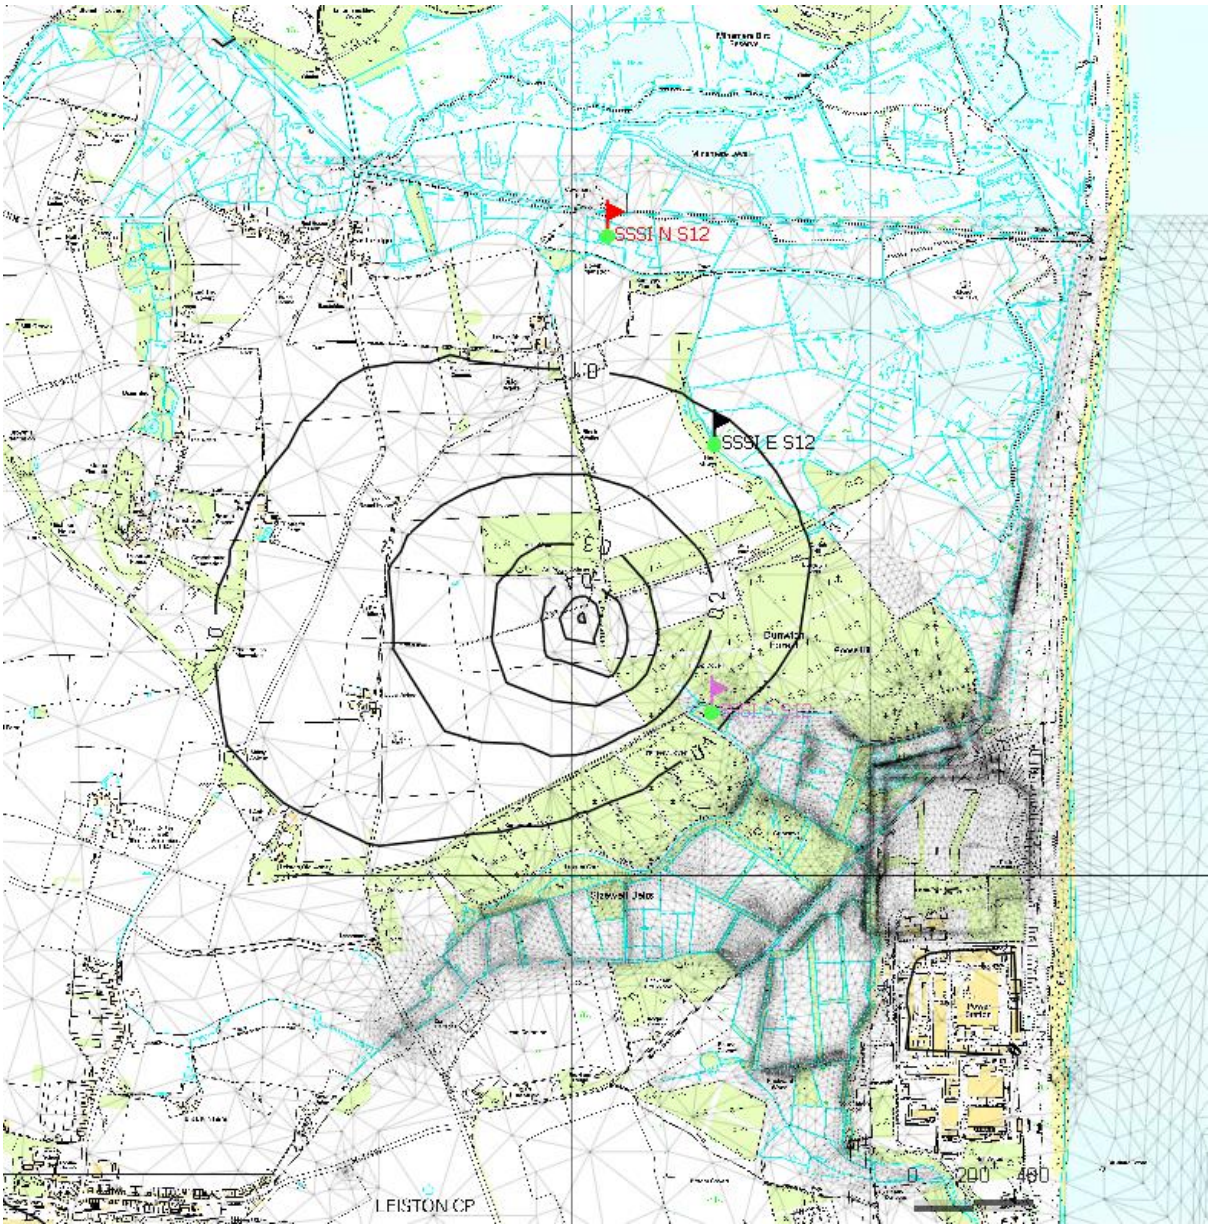

B-9 : Year 4, Combined impact of proposed abstraction and MDS dewatering, Slice 1

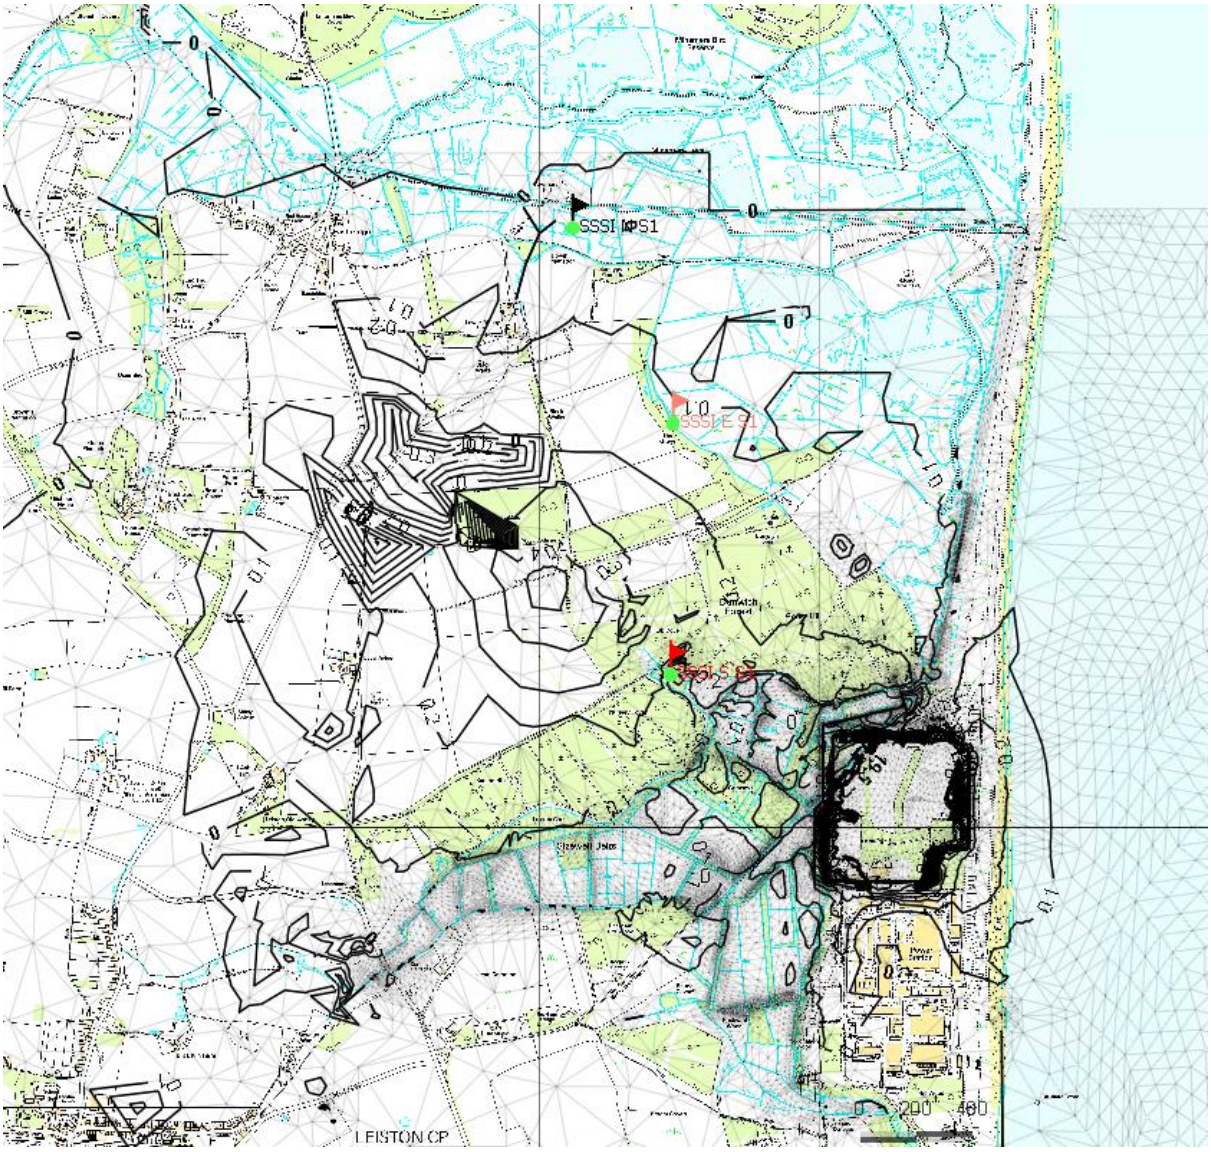


B-10 : Year 4, Combined impact of proposed abstraction and MDS dewatering, Slice 5



B-11 : Year 4, Combined impact of proposed abstraction and MDS dewatering, Slice 6



B-12 : Year 4, Combined impact of proposed abstraction and MDS dewatering, Slice 12

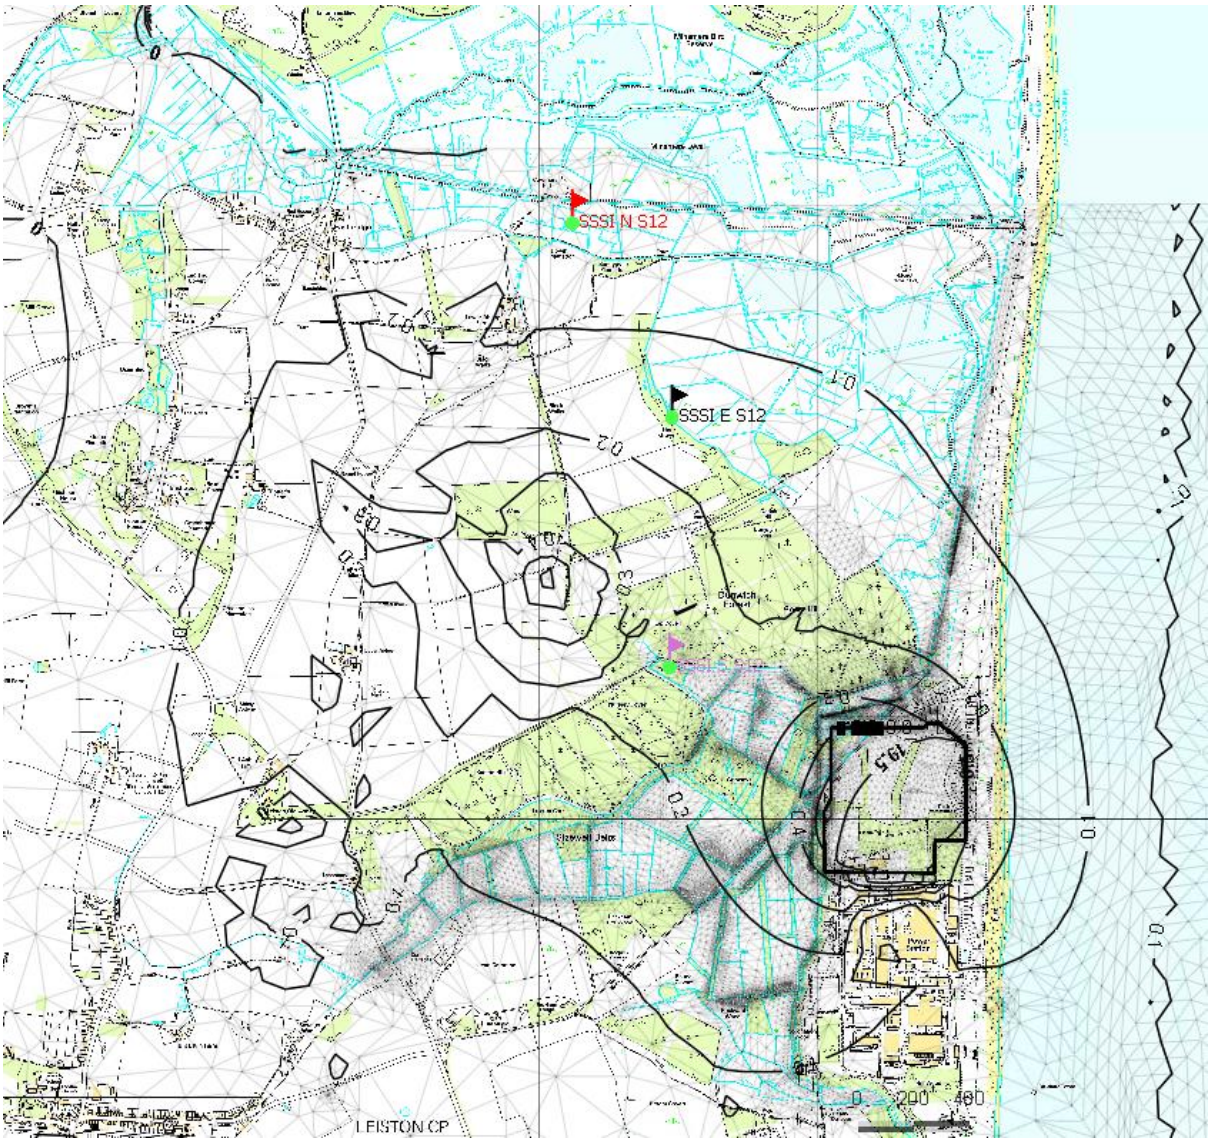

AtkinsRéalis



TCA/WRA/16 - Supporting Information

Annexure B – NEAC modelling Technical Note

TECHNICAL NOTE

DATE:	04 March 2025	**CONFIDENTIALITY:**	Confidential
SUBJECT:	Sizewell Model Scenarios		
PROJECT:	UK0039226.5995 Task 600	**AUTHOR:**	Hollie Whild
CHECKED:	Joshua Hall	**APPROVED:**	Joshua Hall

INTRODUCTION

This technical note describes two scenarios constructed using the North-East Anglian Chalk (NEAC) groundwater model, representing a trade of abstraction license quantities and a potential new water abstraction to the north of the Sizewell nuclear site in Suffolk. WSP undertook this modelling in February 2025 on behalf of the Environment Agency (EA).

The two scenarios are based on the current Fully Licensed standard scenario (6nea1003) with abstraction assigned to a new Crag borehole at TM 46012 64982. The abstraction quantity for the new borehole was provided by the Environment Agency.

Results are presented spatially for Q95 flow compliance and key period groundwater level drawdowns, and as timeseries at selected locations for vertical and lateral aspects of groundwater flow as well as timeseries of drawdown. The accompanying result pack comprises:

- The GIS Results Pack (UK0039226-WSP-FIG-0071-v01-SizewellSpatialData.mxd), an ArcGIS project containing maps of the spatial results.
- A Saline Intrusion and Upward Flow Excel workbook (UK0039226-WSP-SST-0069-v01-Sizewell_SalineIntrusionandUpflow.xlsx), containing all groundwater flux results.
- A Timeseries Heads Excel workbook (UK0039226-WSP-SST-0070-v01-Sizewell_TimeseriesHeads.xlsx), containing timeseries groundwater level plots for three selected model cells.


Also accompanying this technical note is a PDF pack of figures (UK0039226-WSP-FIG-0071-v01-SizewellTechnoteFigures.pdf) which are referred to throughout and which draw on the data in the GIS Results Pack.

Results are presented for three points within the SSSI, for a short a strip of coast immediately east of the SSSI, and spatially for Q95 flow compliance and key period groundwater level drawdowns. **Figure 1** below shows the location of these cells and of the abstraction locations as given in the EA's work instruction.

TECHNICAL NOTE

DATE:	04 March 2025	**CONFIDENTIALITY:**	Confidential
SUBJECT:	Sizewell Model Scenarios		
PROJECT:	UK0039226.5995 Task 600	**AUTHOR:**	Hollie Whild
CHECKED:	Joshua Hall	**APPROVED:**	Joshua Hall

Figure 1 – Location Map

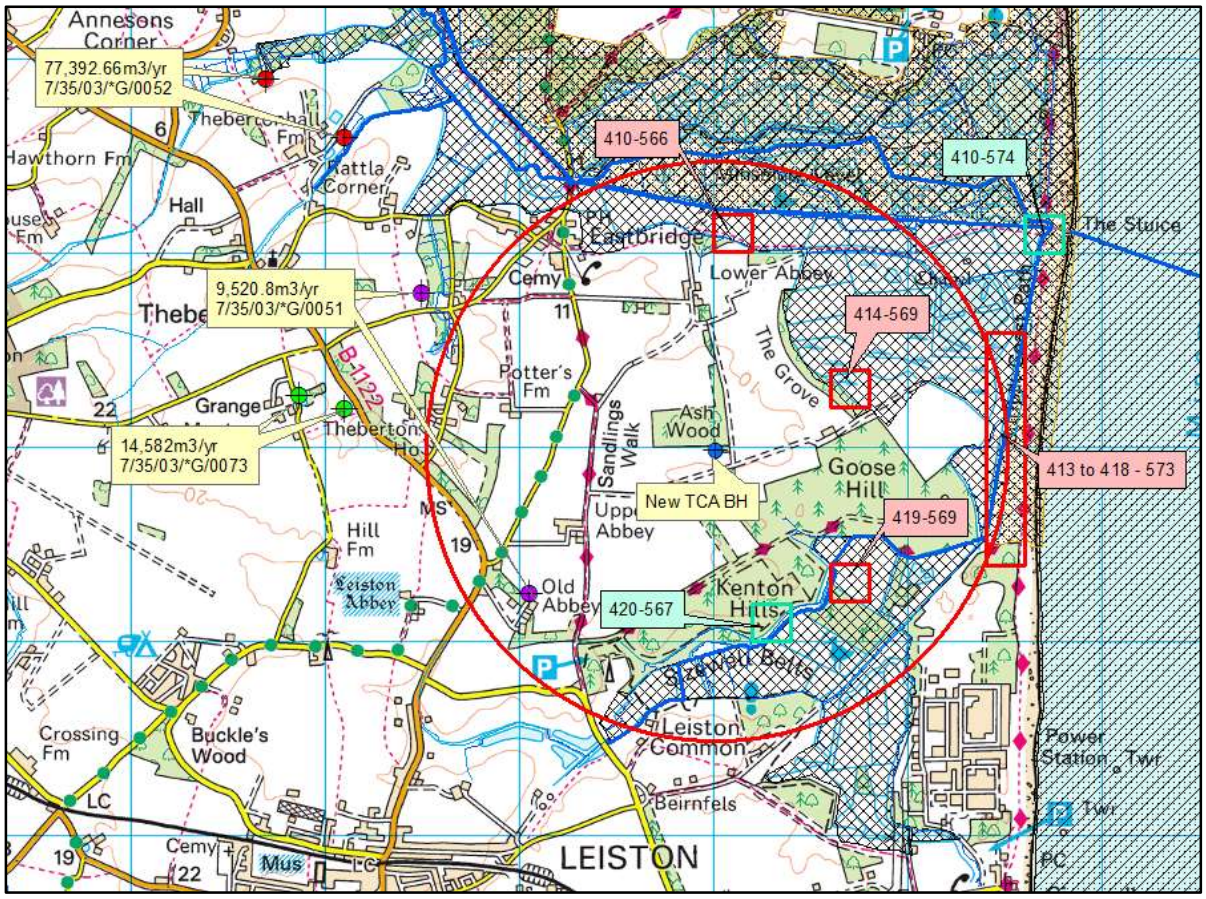

SCENARIO DESIGN

The baseline for all model scenarios is the **current Fully Licensed** (6nea1003). Only the abstractions for trade licences 7/35/03/*G/0052, 7/35/03/*G/0073 and 7/35/03/*G/0051 and the new borehole are modified in these scenarios.

All other abstractions operate at the same Fully Licensed levels throughout.

Scenario definitions were provided by the Environment Agency:

- In **Scenario 1 (6nea1219)**, three traded licences (Ash Yard 7/35/03/*G/0052, Theberton Grange 7/35/03/*G/0073, and Leiston/Old Abbey Farm 7/35/03/*G/0051) are left active while the new Crag abstraction is included at a rate of 0.6Ml/d.
- In **Scenario 2 (6nea1227)** the three traded licences are removed, while the new Crag abstraction is included at a rate of 0.3Ml/d.

TECHNICAL NOTE

DATE:	04 March 2025	**CONFIDENTIALITY:**	Confidential
SUBJECT:	Sizewell Model Scenarios		
PROJECT:	UK0039226.5995 Task 600	**AUTHOR:**	Hollie Whild
CHECKED:	Joshua Hall	**APPROVED:**	Joshua Hall

RESULTS

Figures 2 to 9 in the accompanying book show **spatial groundwater level impacts** between scenarios and the FL baseline. Impacts are shown for both the Top Active Layer (representing Alluvium or Sands and Gravels) and the Crag. Note that for the Crag, there are some instabilities in this part of the NEAC model, which manifest as small regions of drawdown and recovery unconnected to the abstractions modified by these scenarios. Impacts are shown for a 'dry' stress period (August 1991) and a 'wet' stress period (March 2001).

Expected drawdowns and (in Scenario 2) recoveries associated with the variations in abstractions modelled are seen. Both scenarios demonstrate drawdown relative to the FL baseline around the location of the new Crag borehole and recovery at locations where abstraction from the trade licenses has been removed. **Table 1** details the GWL impacts seen in the model at the location of the new borehole and the three SSSI cells for each of the modelled scenarios compared with the FL baseline.

Table 1 – Dry Period (August 1991) GWL Impacts

Borehole / SSSI Cell	Scenario 1 (6nea1219) minus FL (6nea1003), Alluvium/Sands and Gravels (m)	Scenario 1 (6nea1219) minus FL (6nea1003), Crag (m)	Scenario 2 (6nea1227) minus FL (6nea1003) Alluvium/Sands and Gravels (m)	Scenario 2 (6nea1227) minus FL (6nea1003), Crag (m)
New Crag borehole at TM 46012 64982	Crag is uppermost	-1.64	Crag is uppermost	-0.79
Cell R410 C566	-0.03	-0.07	-0.01	-0.03
Cell R414 C569	-0.26	-0.26	-0.12	-0.12
Cell R419 C569	-0.09	-0.11	-0.04	-0.05

Figures 10, 11 and 12 show **Q95 flow compliance** for every stream cell. Full FlowMaps results for key flow percentiles are provided in the accompanying MXD. **Table 2** below gives the Q95 flows and associated compliance colours for the Yox and Minsmere AP point. In both instances the FL baseline and all scenarios are consistently compliant. Note that because of modelled routing, the cell used to represent the Yox and Minsmere AP is not the same as would appear from the map in Figure 1.


TECHNICAL NOTE

DATE:	04 March 2025	**CONFIDENTIALITY:**	Confidential
SUBJECT:	Sizewell Model Scenarios		
PROJECT:	UK0039226.5995 Task 600	**AUTHOR:**	Hollie Whild
CHECKED:	Joshua Hall	**APPROVED:**	Joshua Hall

Table 2 – Q95 Flows (Ml/d) and Compliance Colours – River Yox AP

Q95 Flow (Ml/d)	Naturalised (6nea1001)	FL Baseline (6nea1003)	Scenario 1(6nea1219)	Scenario 2(6nea1227)
AP4 River Yox - Tidal Limit	12.1	12.5	12.1	12.7

Key to Compliance colours:

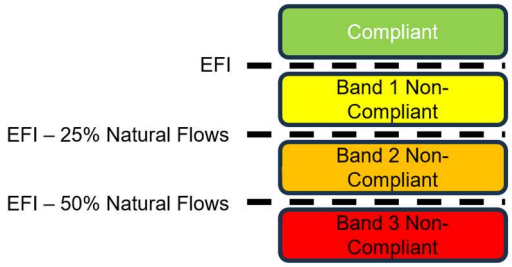

Figures 13 and 14 present the changes in GWSW interaction for both scenarios compared with the FL baseline for the dry stress period. There are local changes as expected in areas where GWL impacts are seen. Scenario 1 leads to a maximum reduction in GW-SW flow of 0.02Ml/d to the north-east of the new Crag borehole. Scenario 2 leads to a maximum reduction at the same cell of 0.01Ml/d, and a maximum increase in GW-SW flow of 0.07Ml/d at the location of the trade licence borehole 07/35/03/*G/0052 / 29994. At the River Yox AP there are negligible changes in GWSW interaction for both scenarios.

Two analyses of **groundwater flux** are given in the **Saline Intrusion and Upward Flow** Excel workbook (UK0039226-WSP-SST-0069-v01-Sizewell_SalineIntrusionandUpflow.xlsx). For each scenario**, upward flow to the surface** (Layer 1) is given for three key cells, the locations of which are shown in the **Overview Map** of that workbook and in **Figure 1** above.

At both the northernmost cell (R410 C566) and the southernmost cell (R419 C569), Scenario 1 sees a small reduction in upwards flow to Layer 1. Scenario 2 results in a similar but smaller reduction. At the central cell (R414 C569), minimal change to upflow is observed. There is a baseline vertical gradient that alternates between upwards and downwards – this is maintained in both scenarios.

The northernmost cell R410 C566 sees reductions in upflow to L1 of between -7.0% and -31.0% in Scenario 1 and between -3.5% and -12.5 in Scenario 2. The southernmost cell R419 C569 sees a range between -13.5% and -53.0% in Scenario 1 and between -7.5% and -22.0% in Scenario 2. Due to the central cell (R414 C569) experiencing a fluctuating upflow/downflow vertical gradient in the FL and both scenarios, percentage changes when gradients tend to zero increase exponentially and are uninformative.

TECHNICAL NOTE

DATE:	04 March 2025	**CONFIDENTIALITY:**	Confidential
SUBJECT:	Sizewell Model Scenarios		
PROJECT:	UK0039226.5995 Task 600	**AUTHOR:**	Hollie Whild
CHECKED:	Joshua Hall	**APPROVED:**	Joshua Hall

Upward flow to Layer 1 in the identified locations is therefore reduced by up to a maximum of 12.6m3/d in Scenario 1 (27.7%) and 5.4m3/d in Scenario 2 (19.6%). In no instance is a downward gradient established where it did not previously exist.

For both scenarios, **lateral groundwater flux towards the sea** is presented for the line of 6 model cells shown in the Overview Map. In both cases the new abstraction results in a reduction in net flow towards the coast. Scenario 1 however does result in a larger reduction in groundwater flux towards the sea, and on three occasions (October 1990, September 1996 and November 1997) leads to the reversal of the gradient, suggesting a possible saline intrusion risk.

The model therefore suggests that a new Crag borehole with an abstraction of 0.3Ml/d in combination with the setting of the three trade licences to zero is unlikely to create a risk of saline intrusion, however an abstraction of 0.6Ml/d without loss of abstraction at the trade licences may carry a saline intrusion risk.

Fig. 2

Scenario 1 minus FL Baseline L1
(Alluvium/Upper Sands & Gravels)
GWL Differences - Dry Stress Period

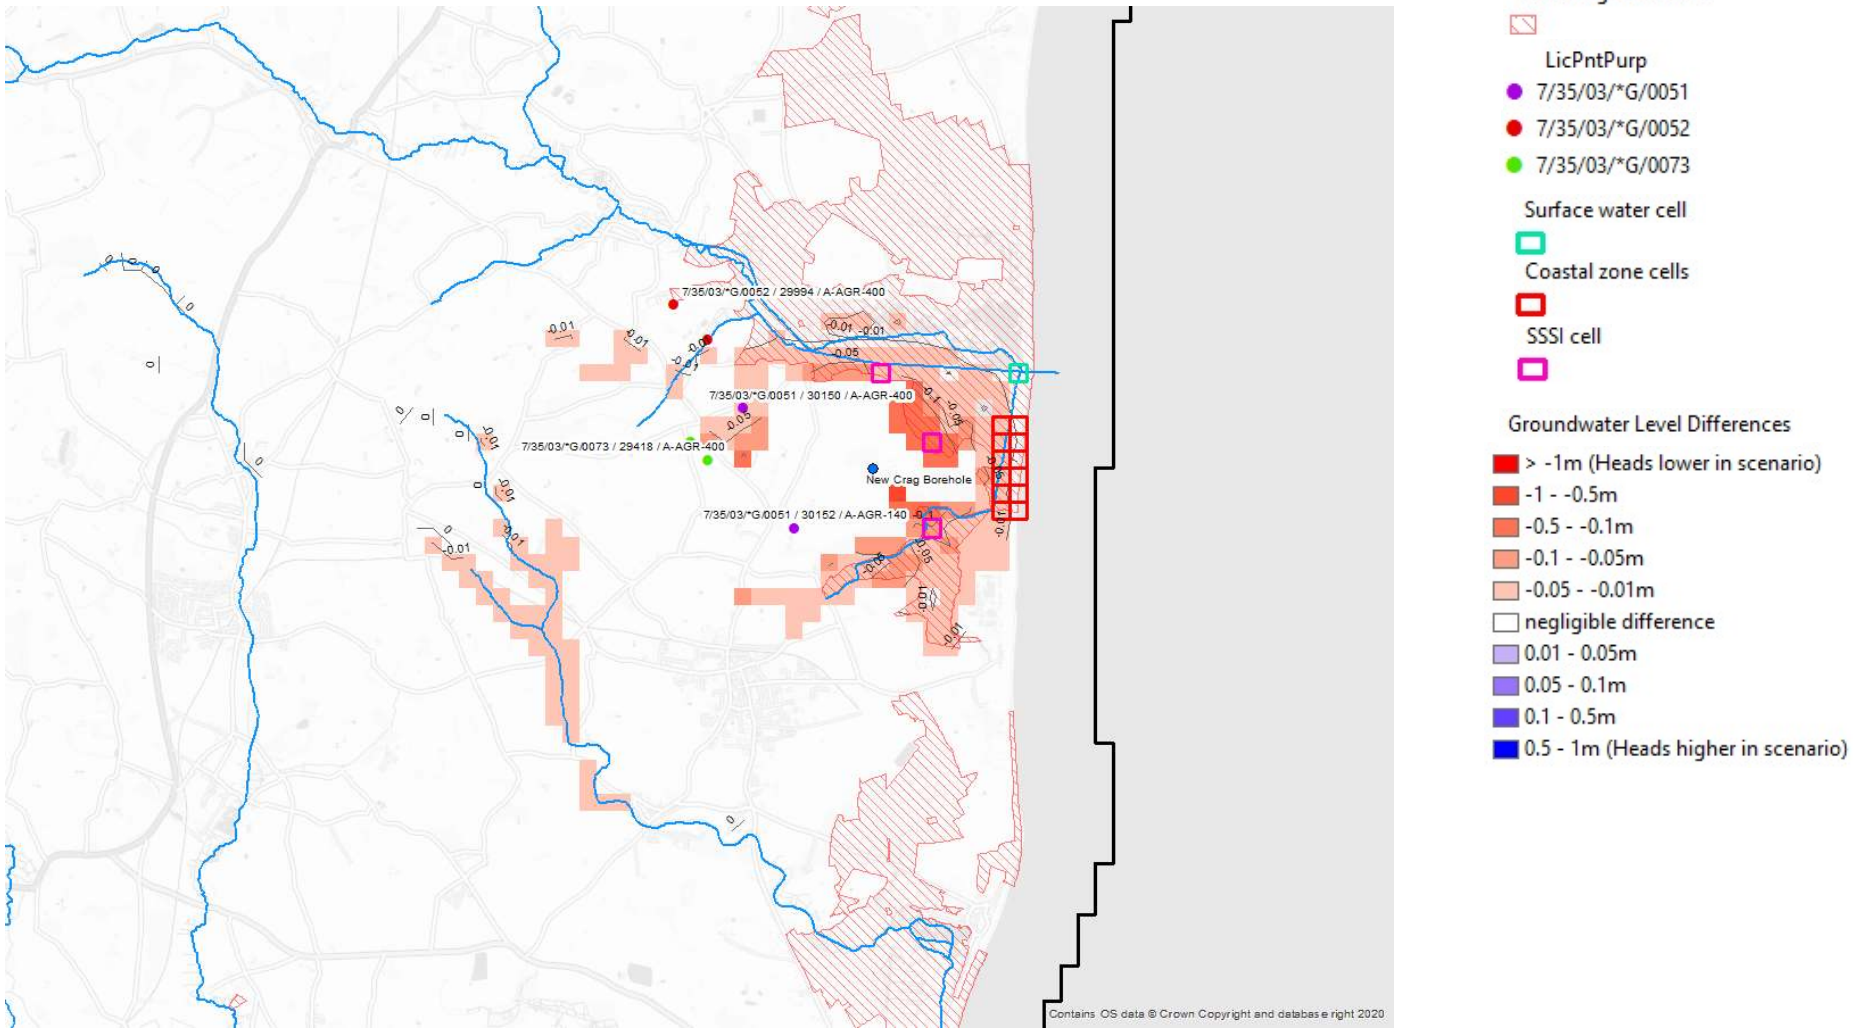


Fig. 3

Scenario 1 minus FL Baseline L3 (Crag) GWL Differences - Dry Stress Period

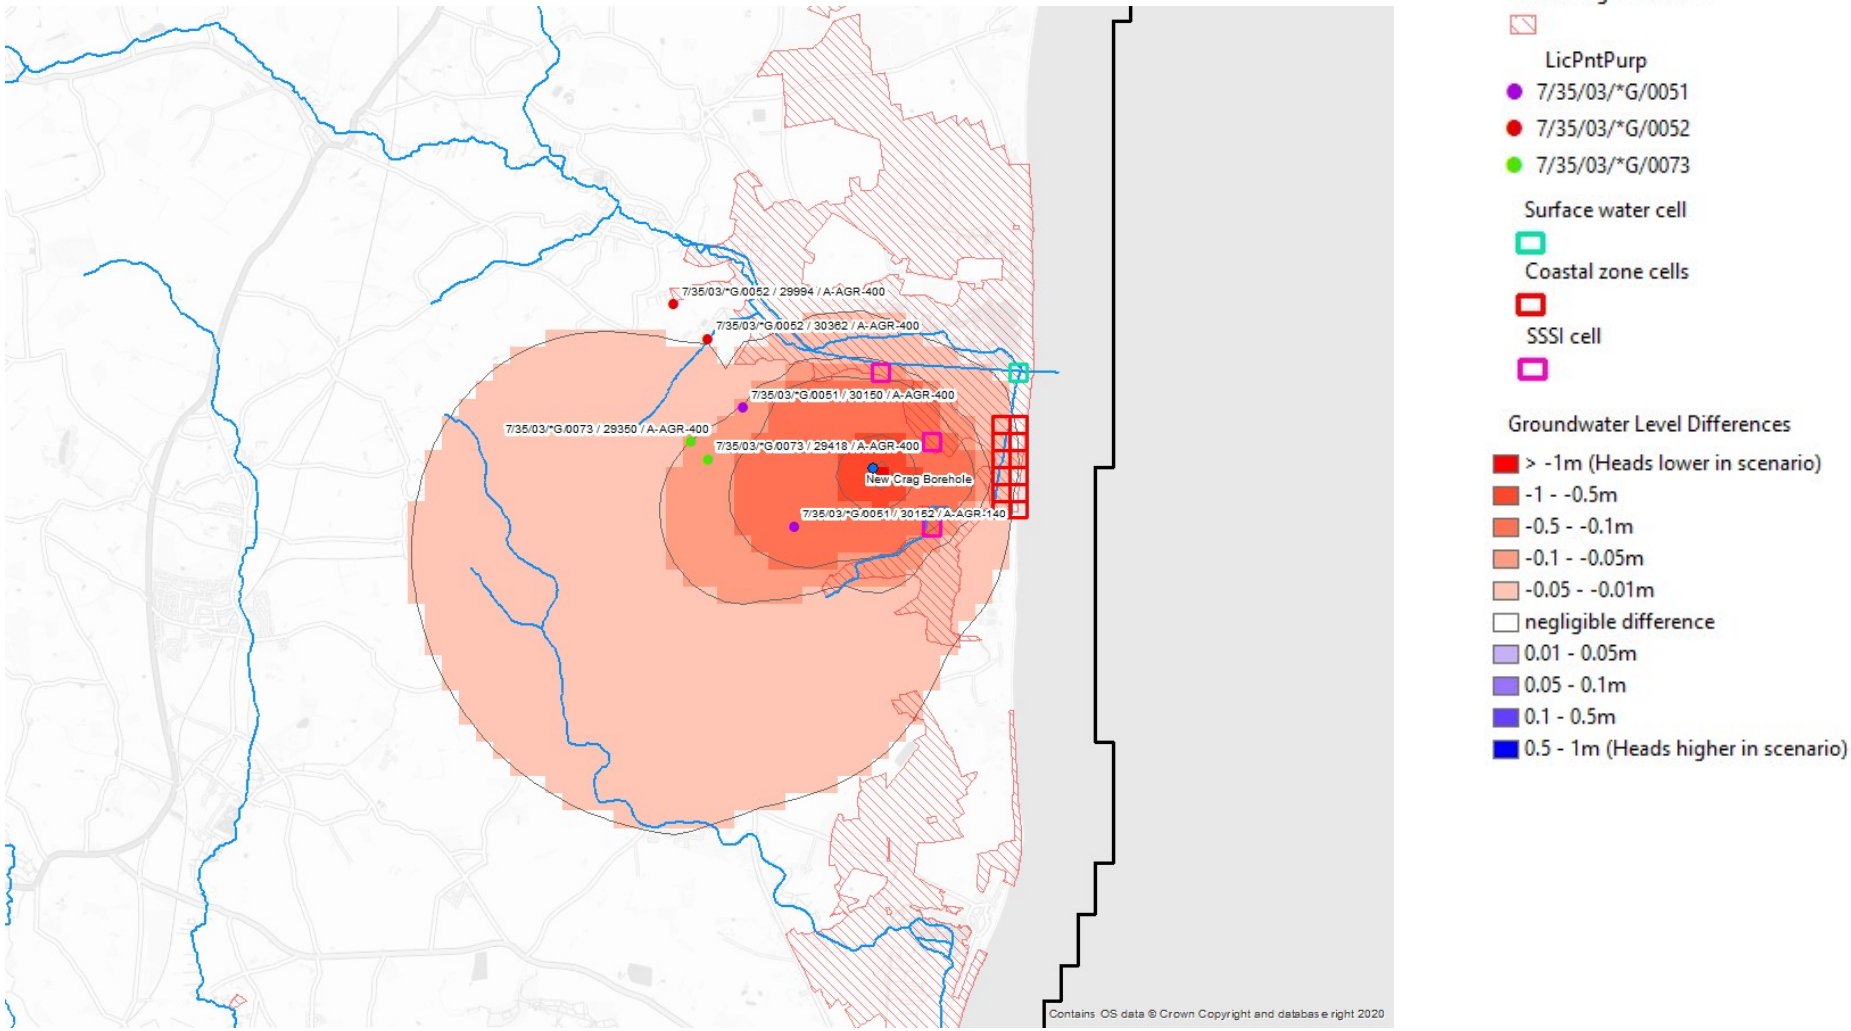


Fig. 4

Scenario 1 minus FL Baseline L1
(Alluvium/Upper Sands & Gravels)
GWL Differences - Wet Stress Period

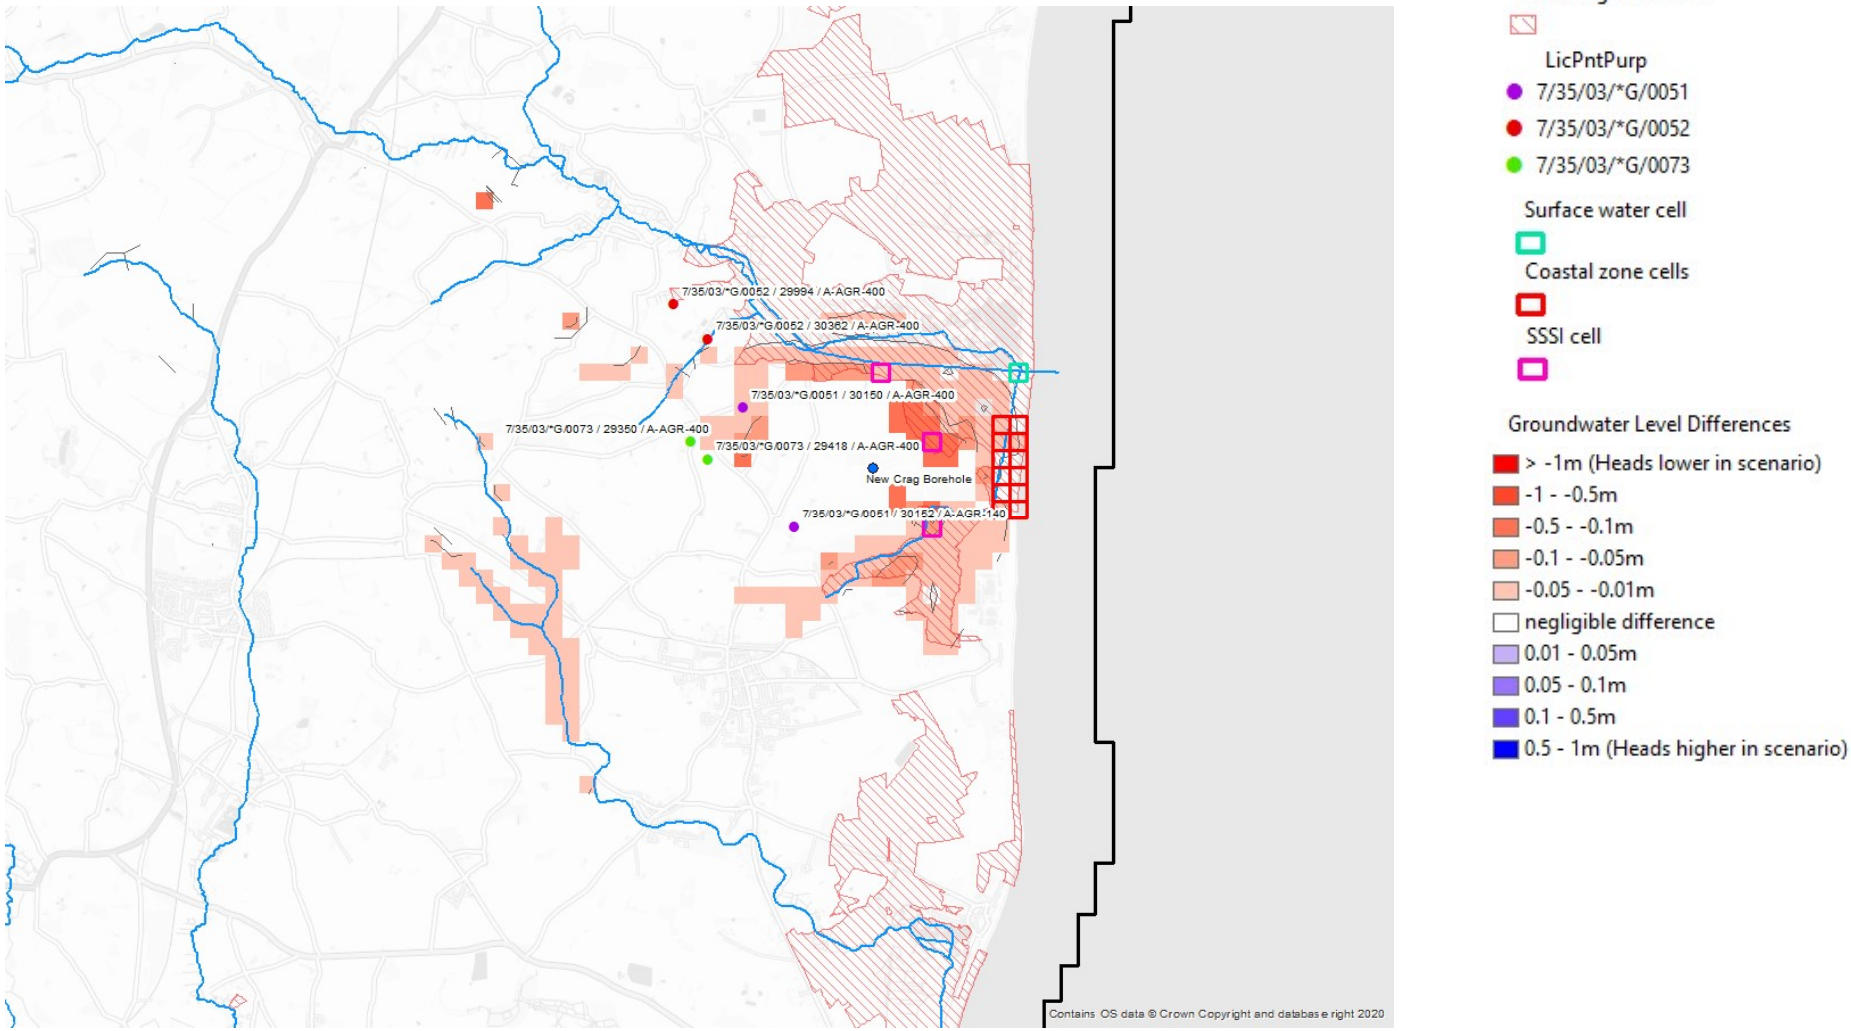


Fig. 5

Scenario 1 minus FL Baseline L3 (Crag) GWL Differences - Wet Stress Period

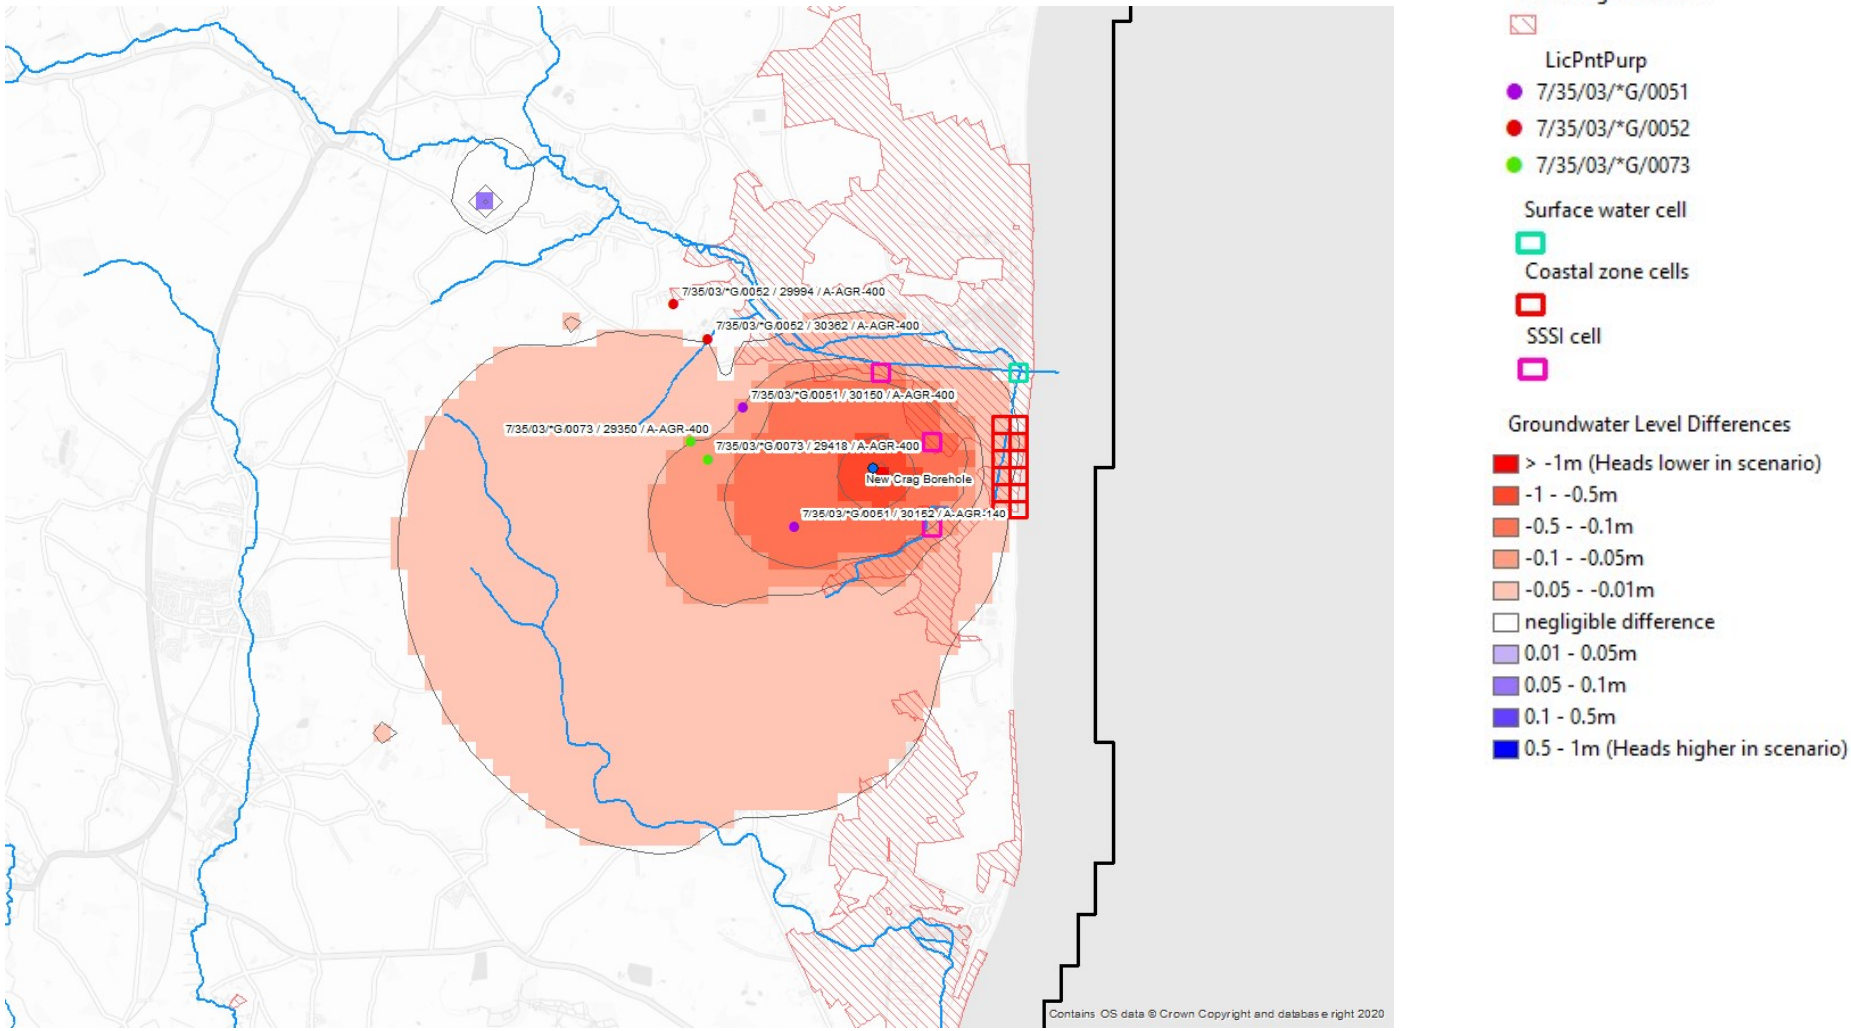


Fig. 6

Scenario 2 minus FL Baseline L1
(Alluvium/Upper Sands & Gravels)
GWL Differences - Dry Stress Period

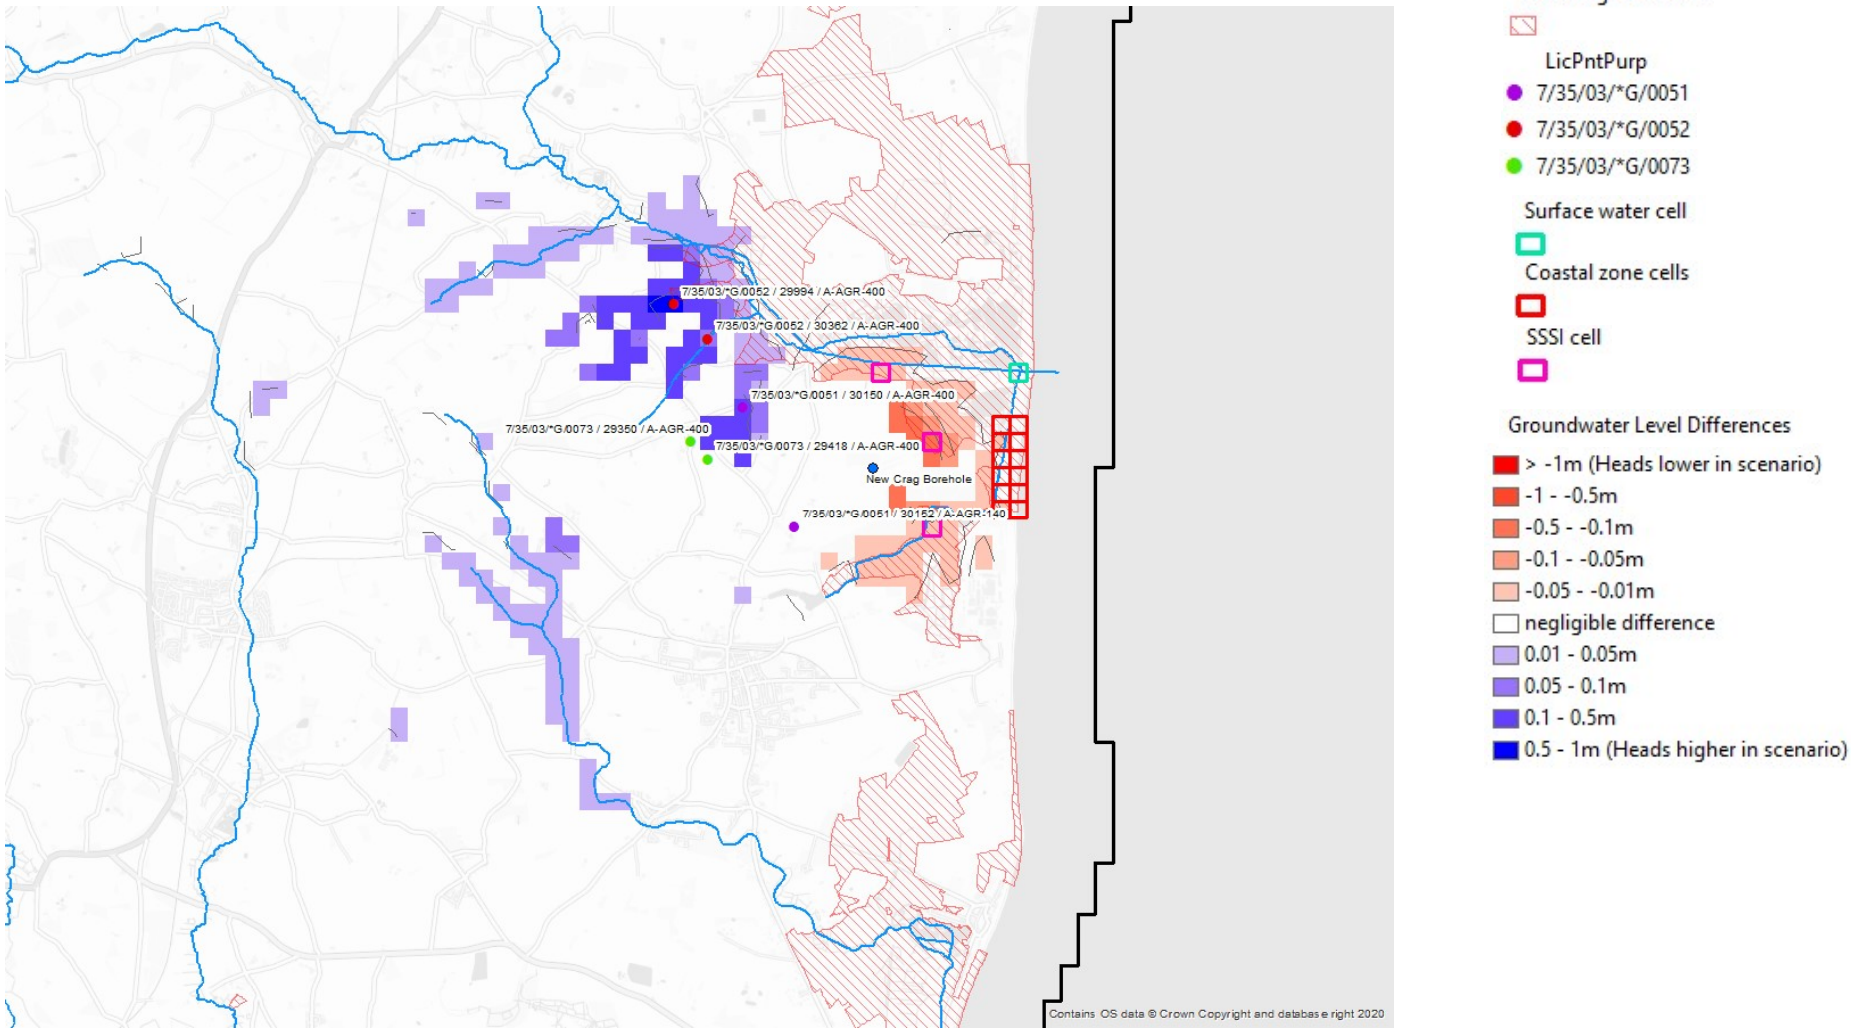


Fig. 7

Scenario 2 minus FL Baseline L3 (Crag) GWL Differences - Dry Stress Period

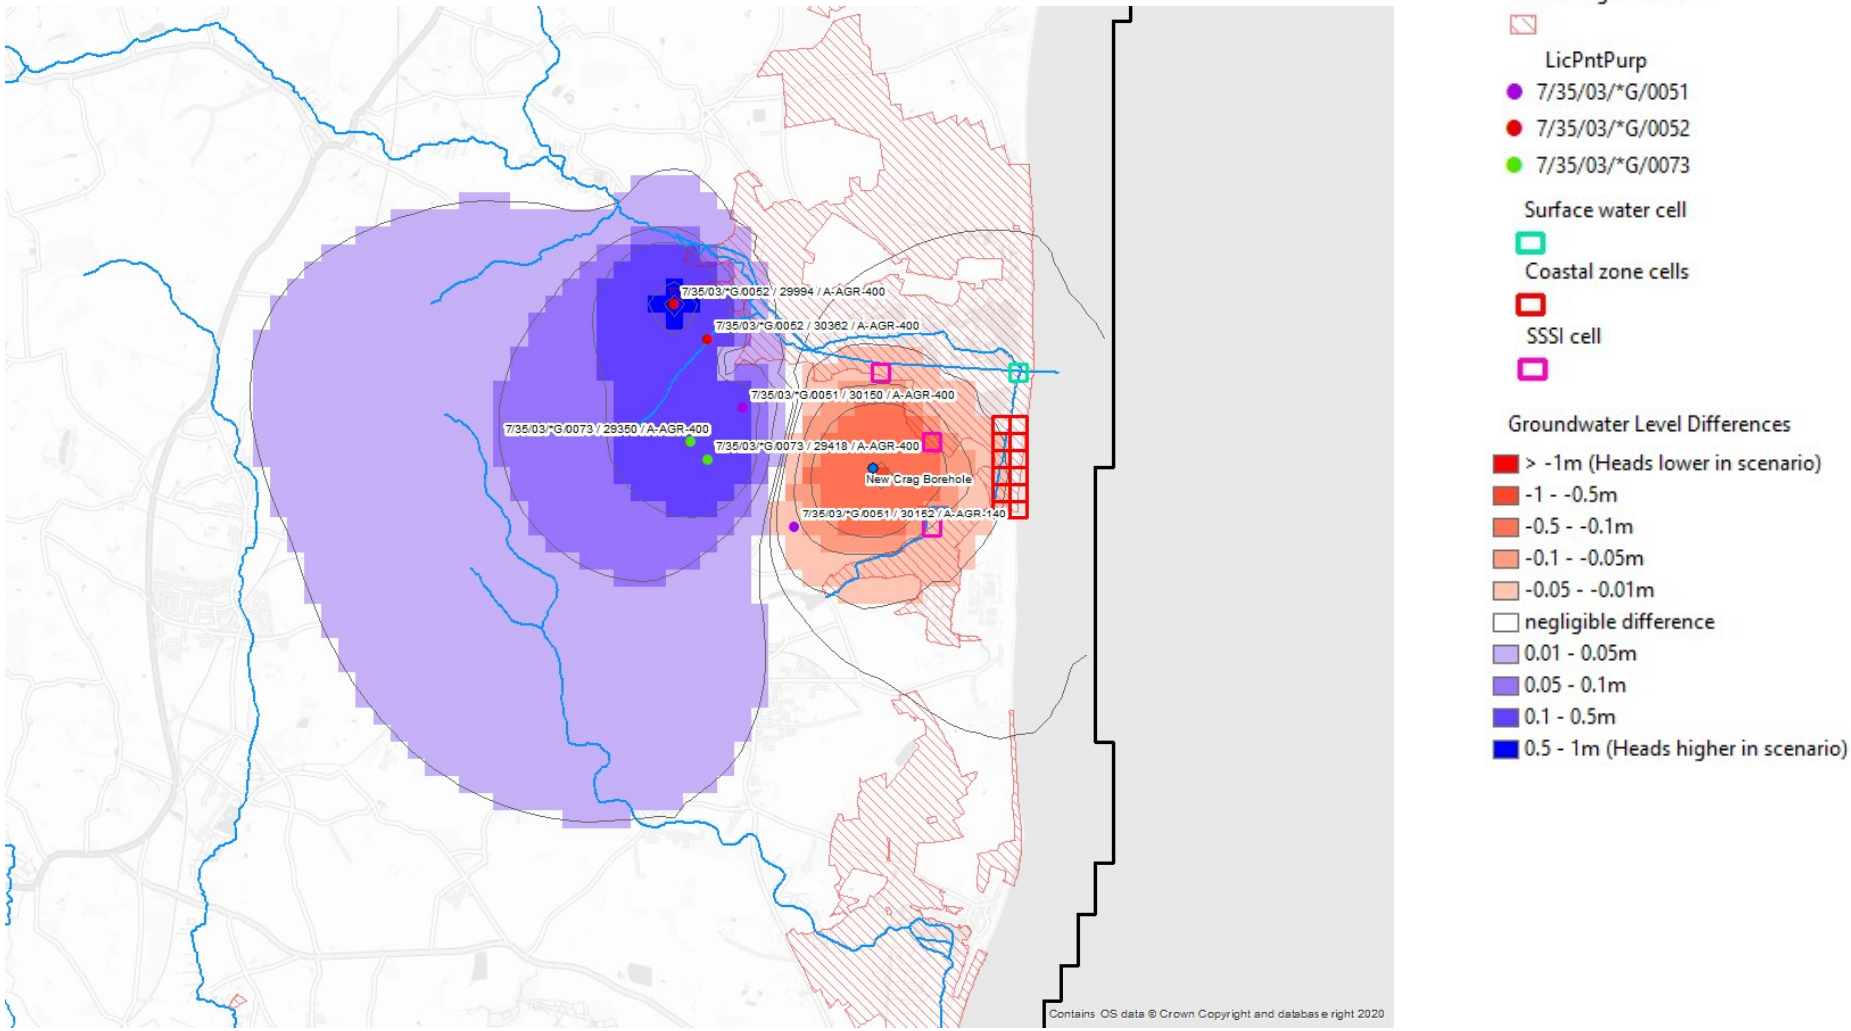


Fig. 8

Scenario 2 minus FL Baseline L1
(Alluvium/Upper Sands & Gravels)
GWL Differences - Wet Stress Period

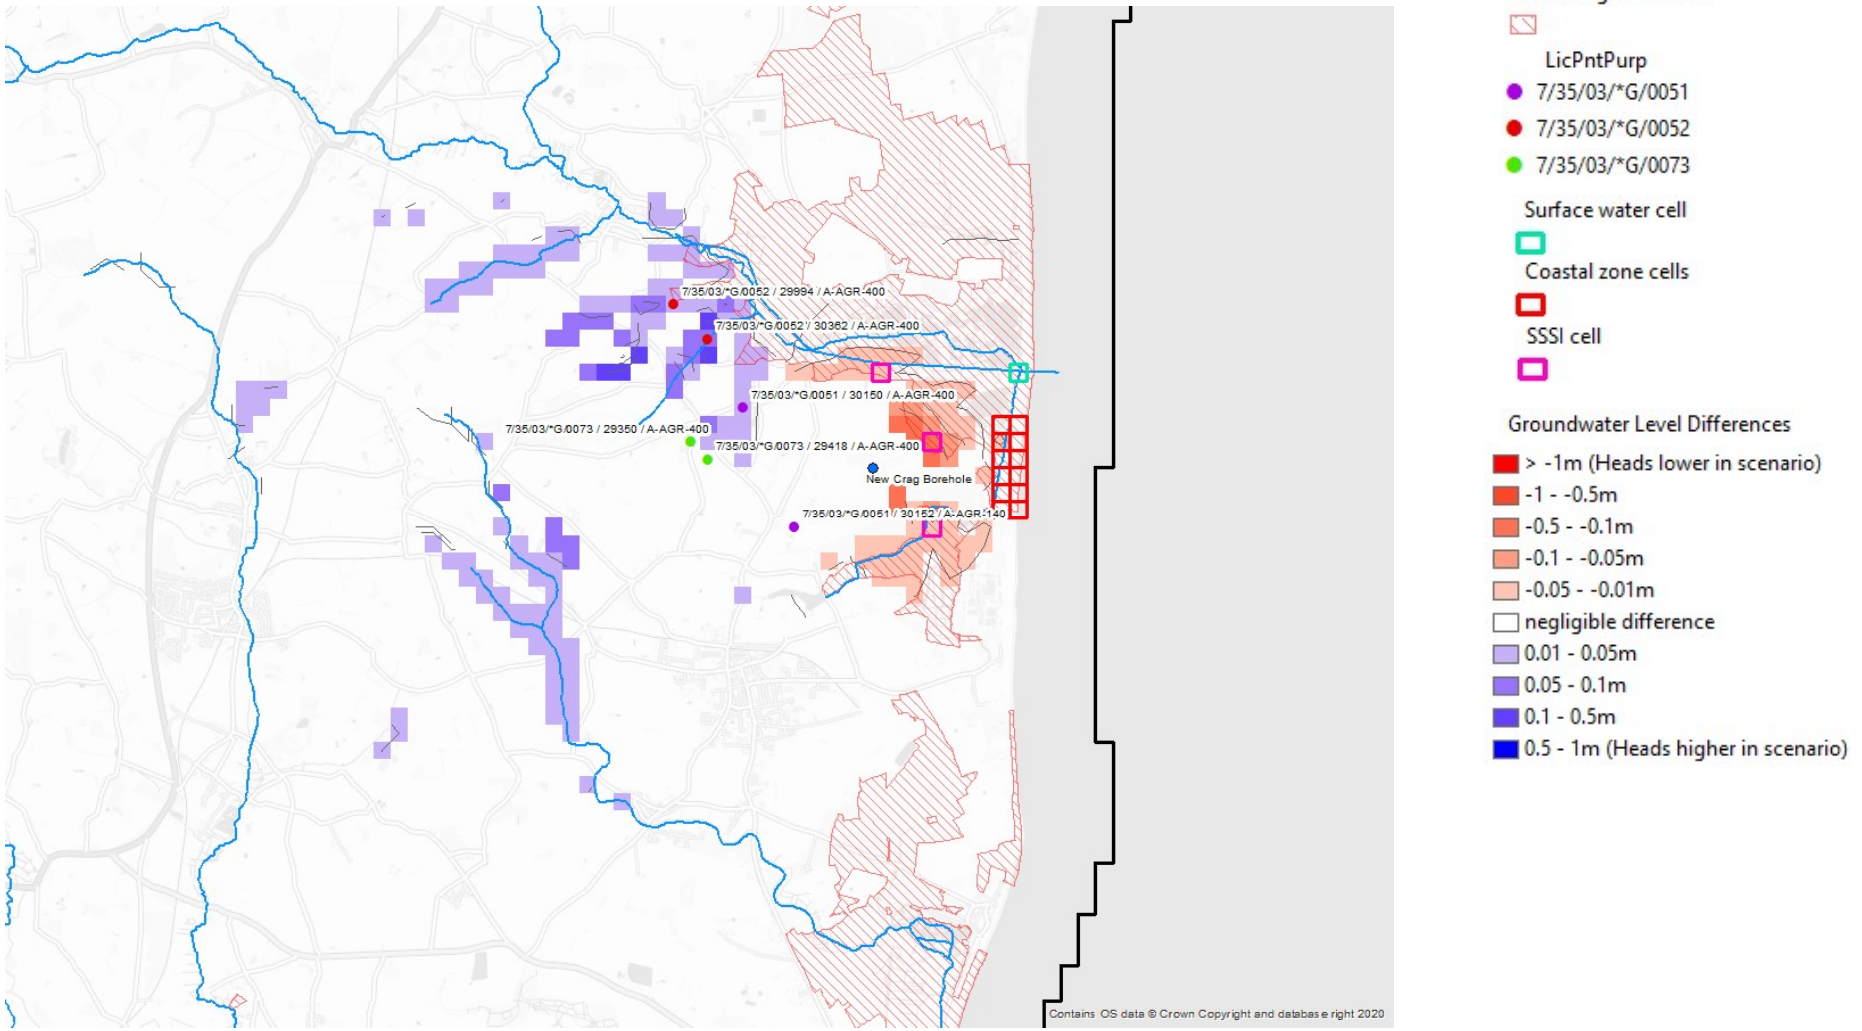


Fig. 9

Scenario 2 minus FL Baseline L3 (Crag) GWL Differences - Wet Stress Period

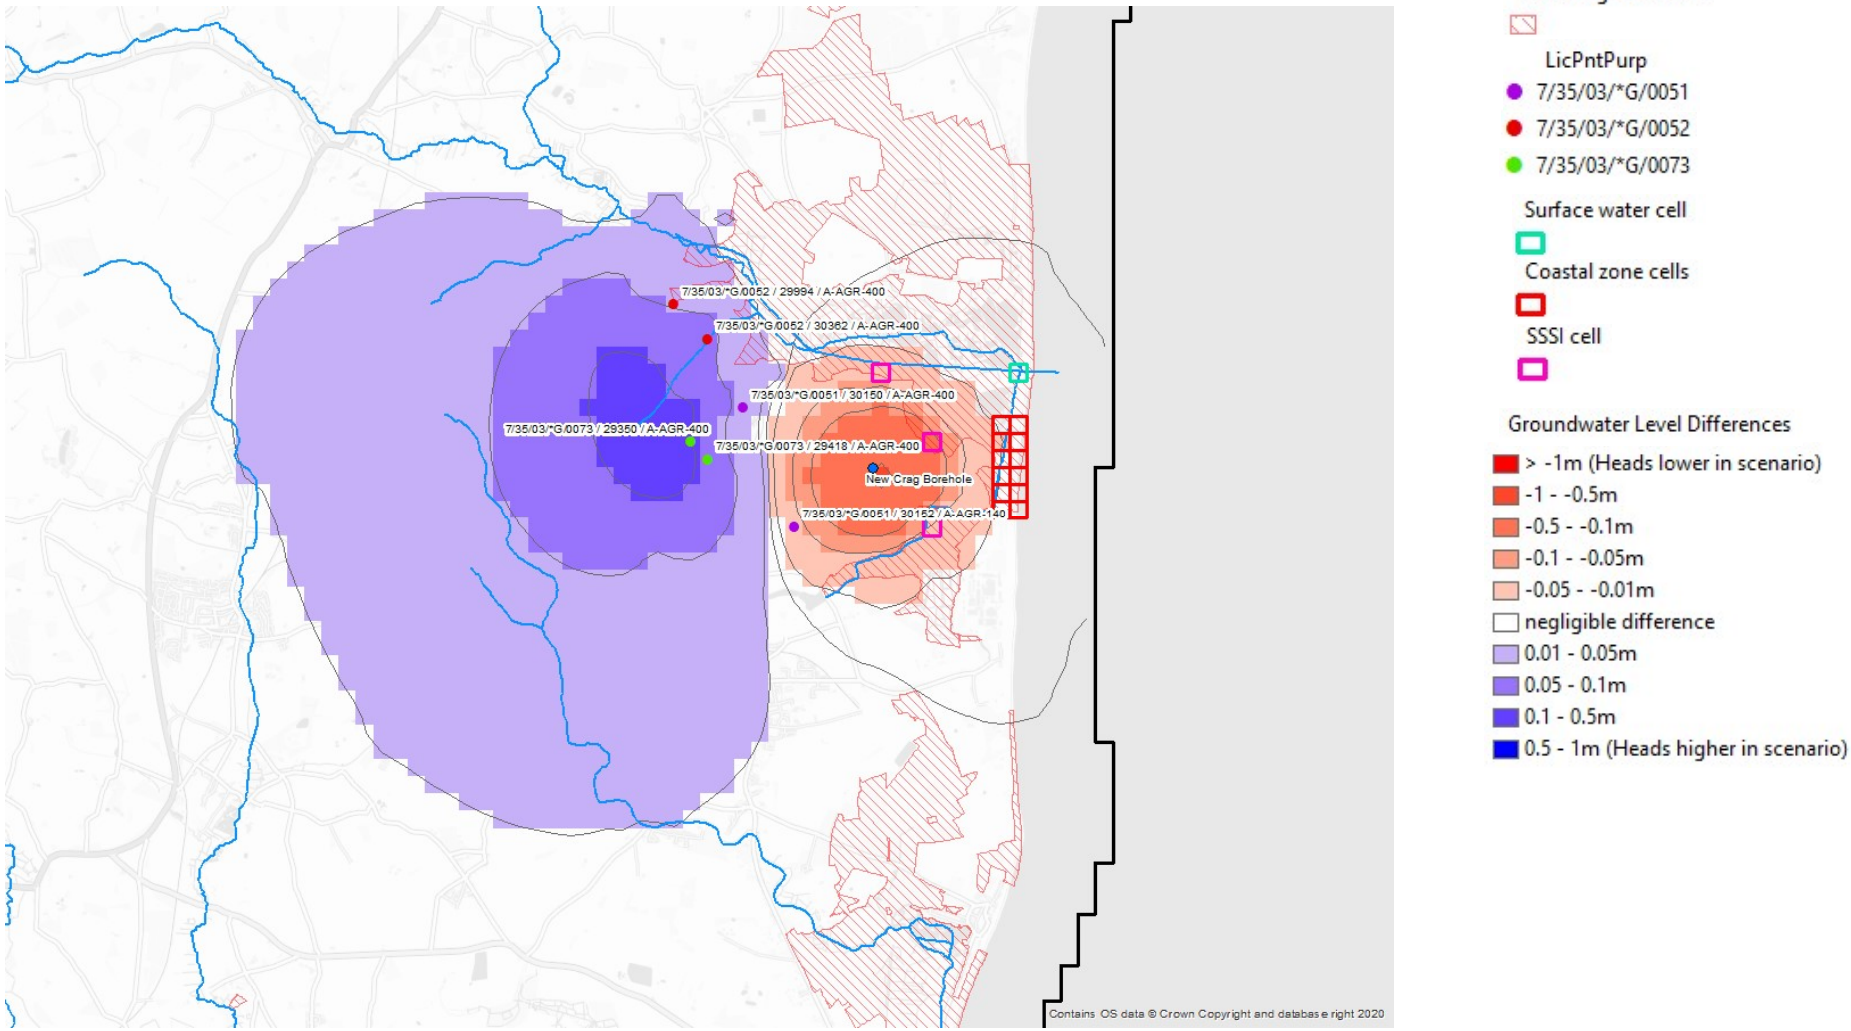


Fig. 10

FL Baseline Q95 Stream Cell Compliance

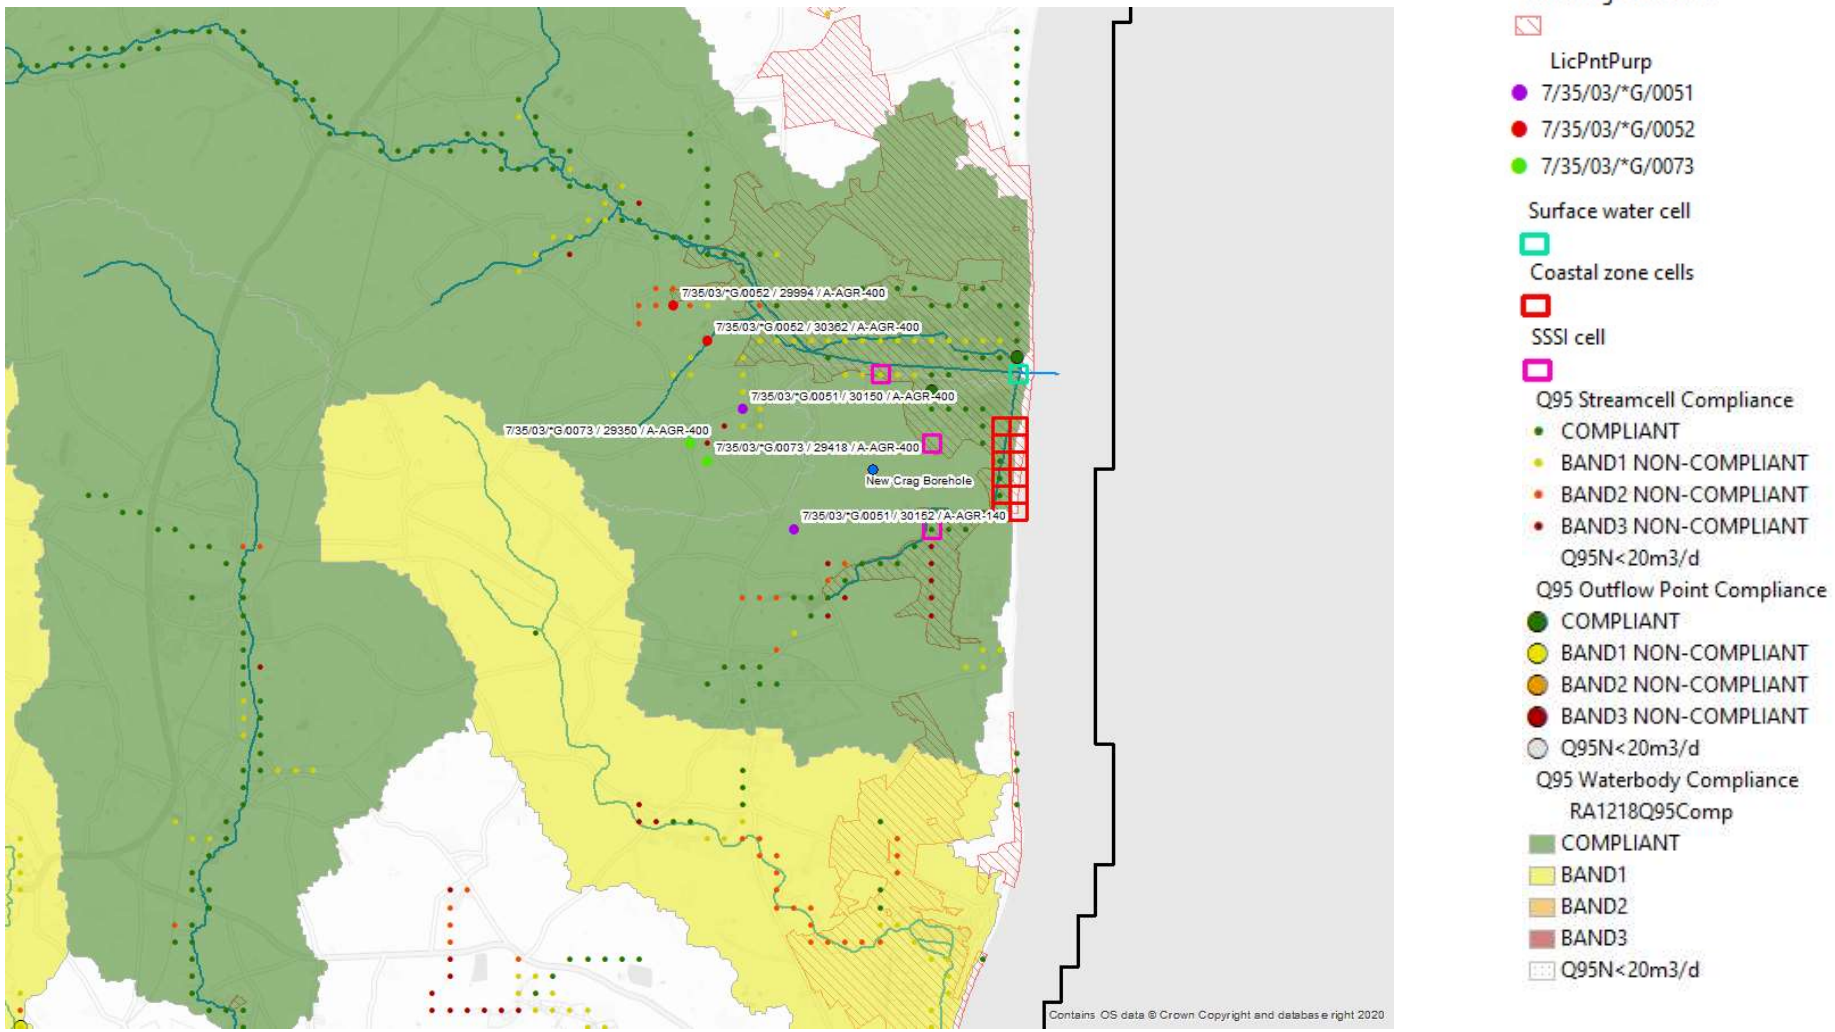


Fig. 11

Scenario 1 Q95 Stream Cell Compliance

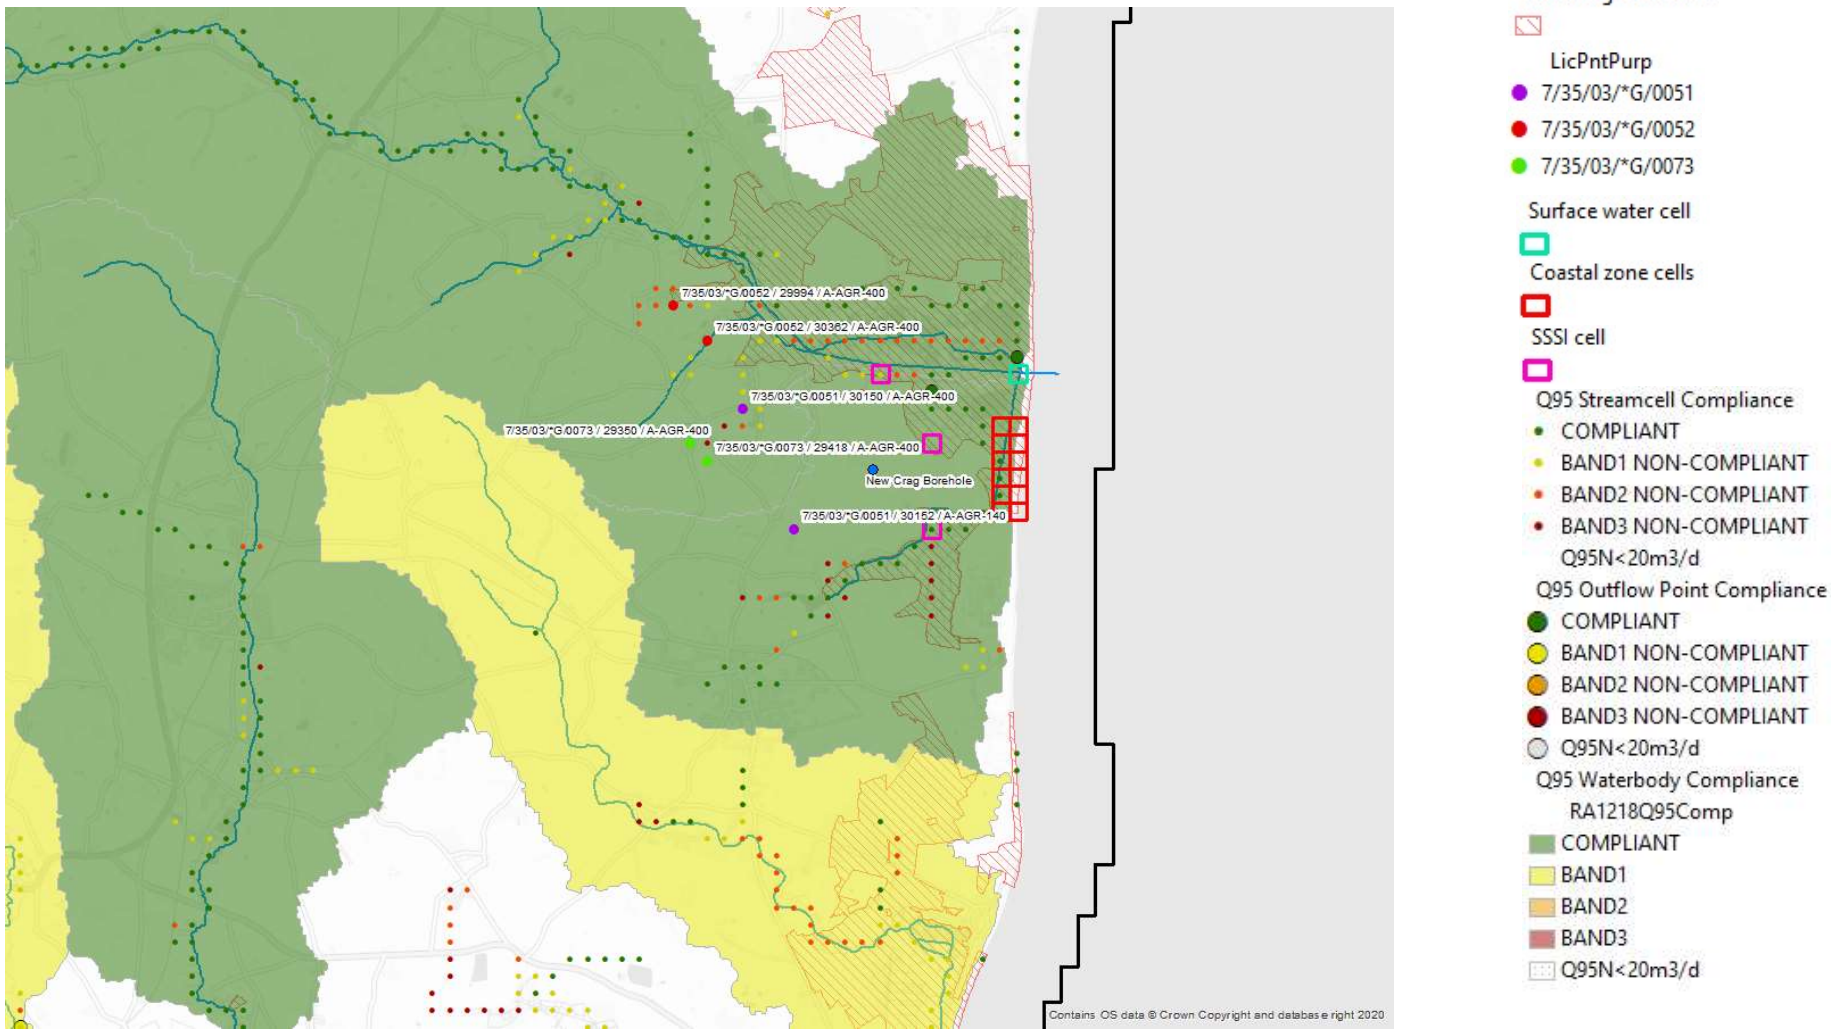


Fig. 12

Scenario 2 Q95 Stream Cell Compliance

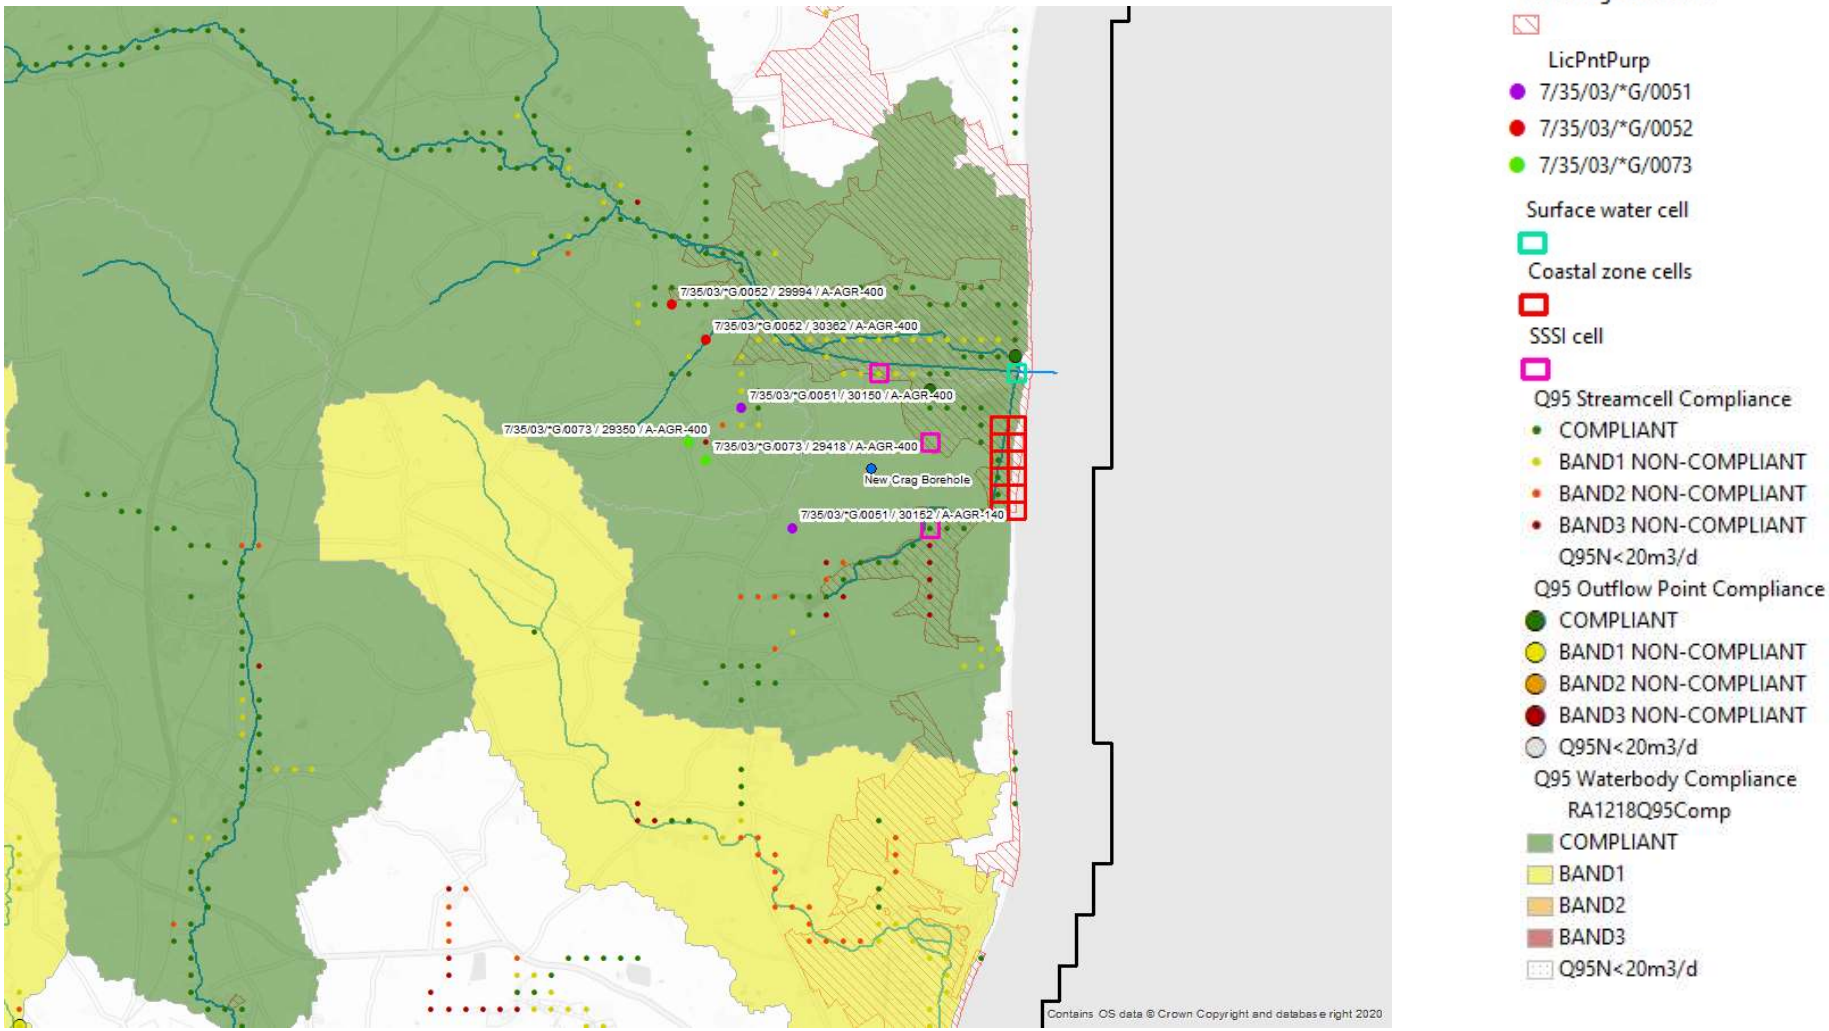


Fig. 13

Scenario 1 Change in GW-SW interaction compared with FL Baseline – Dry Stress Period


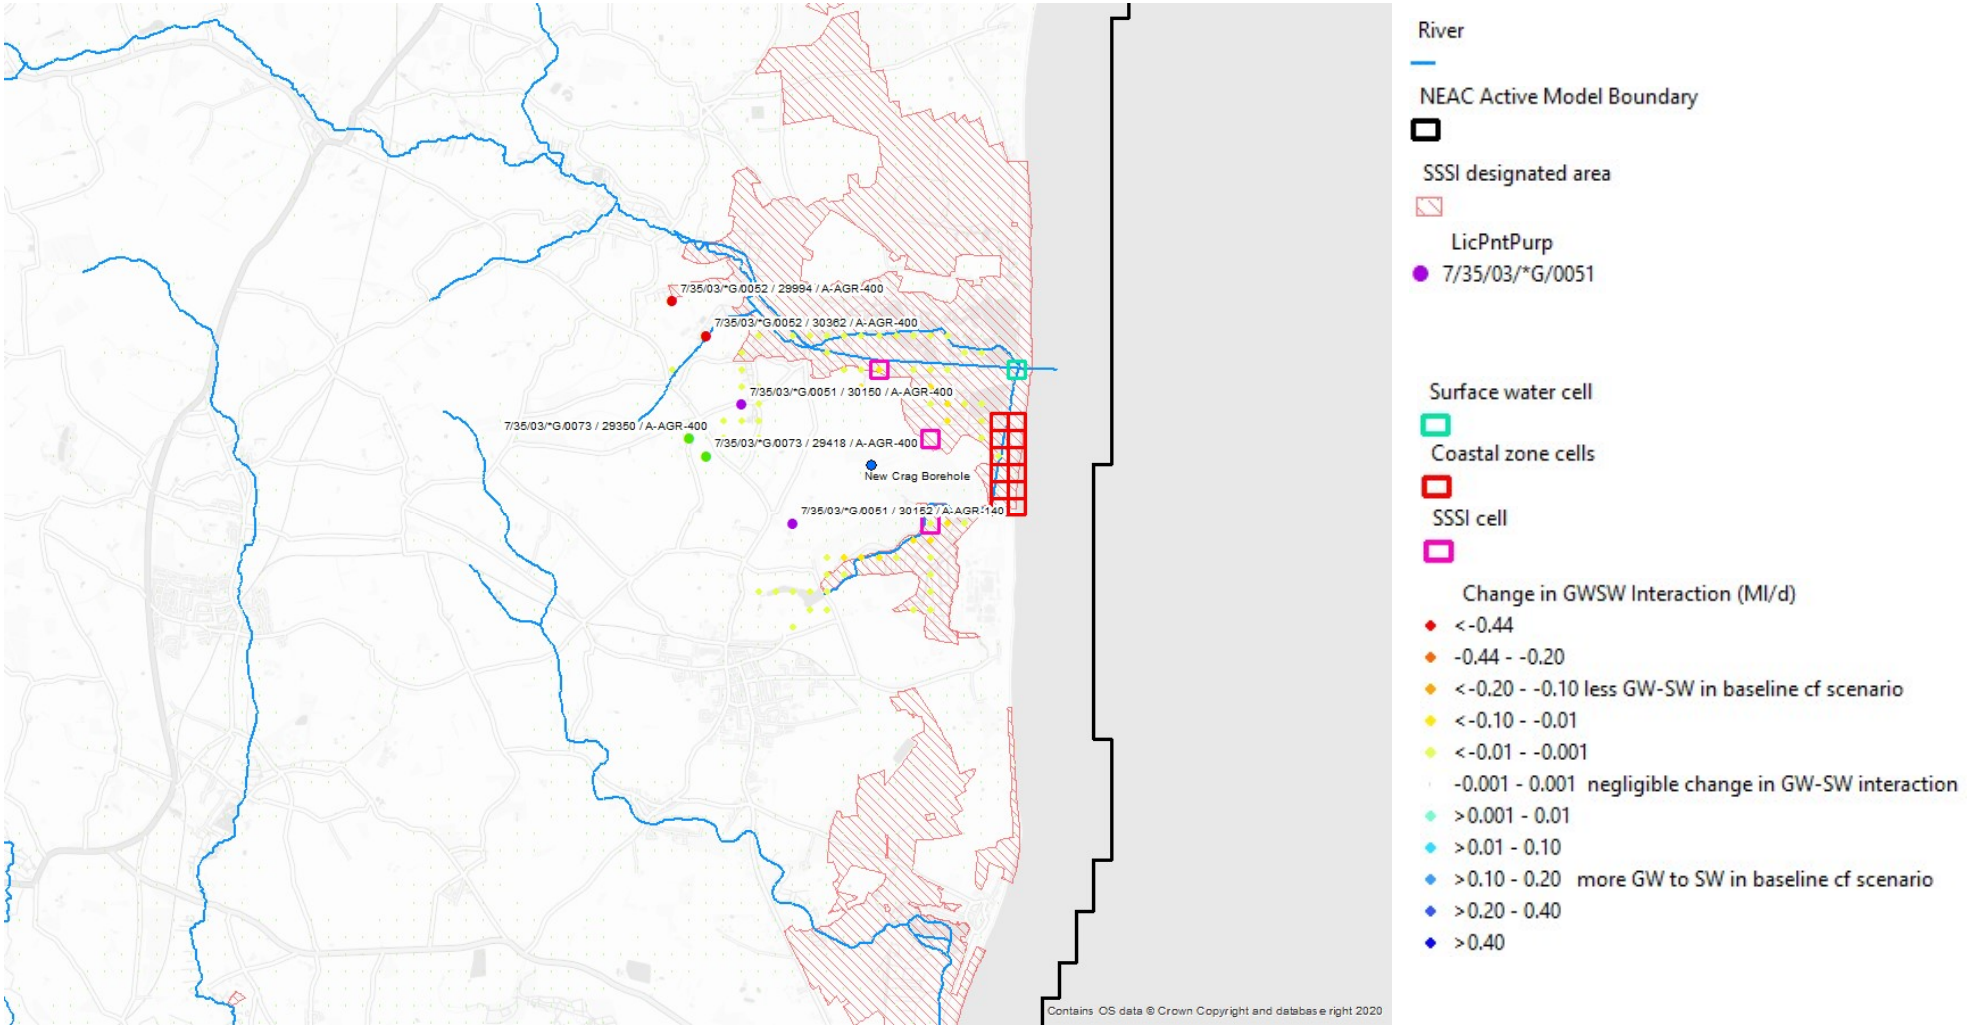


Fig. 14

Scenario 2 Change in GW-SW interaction compared with FL Baseline – Dry Stress Period

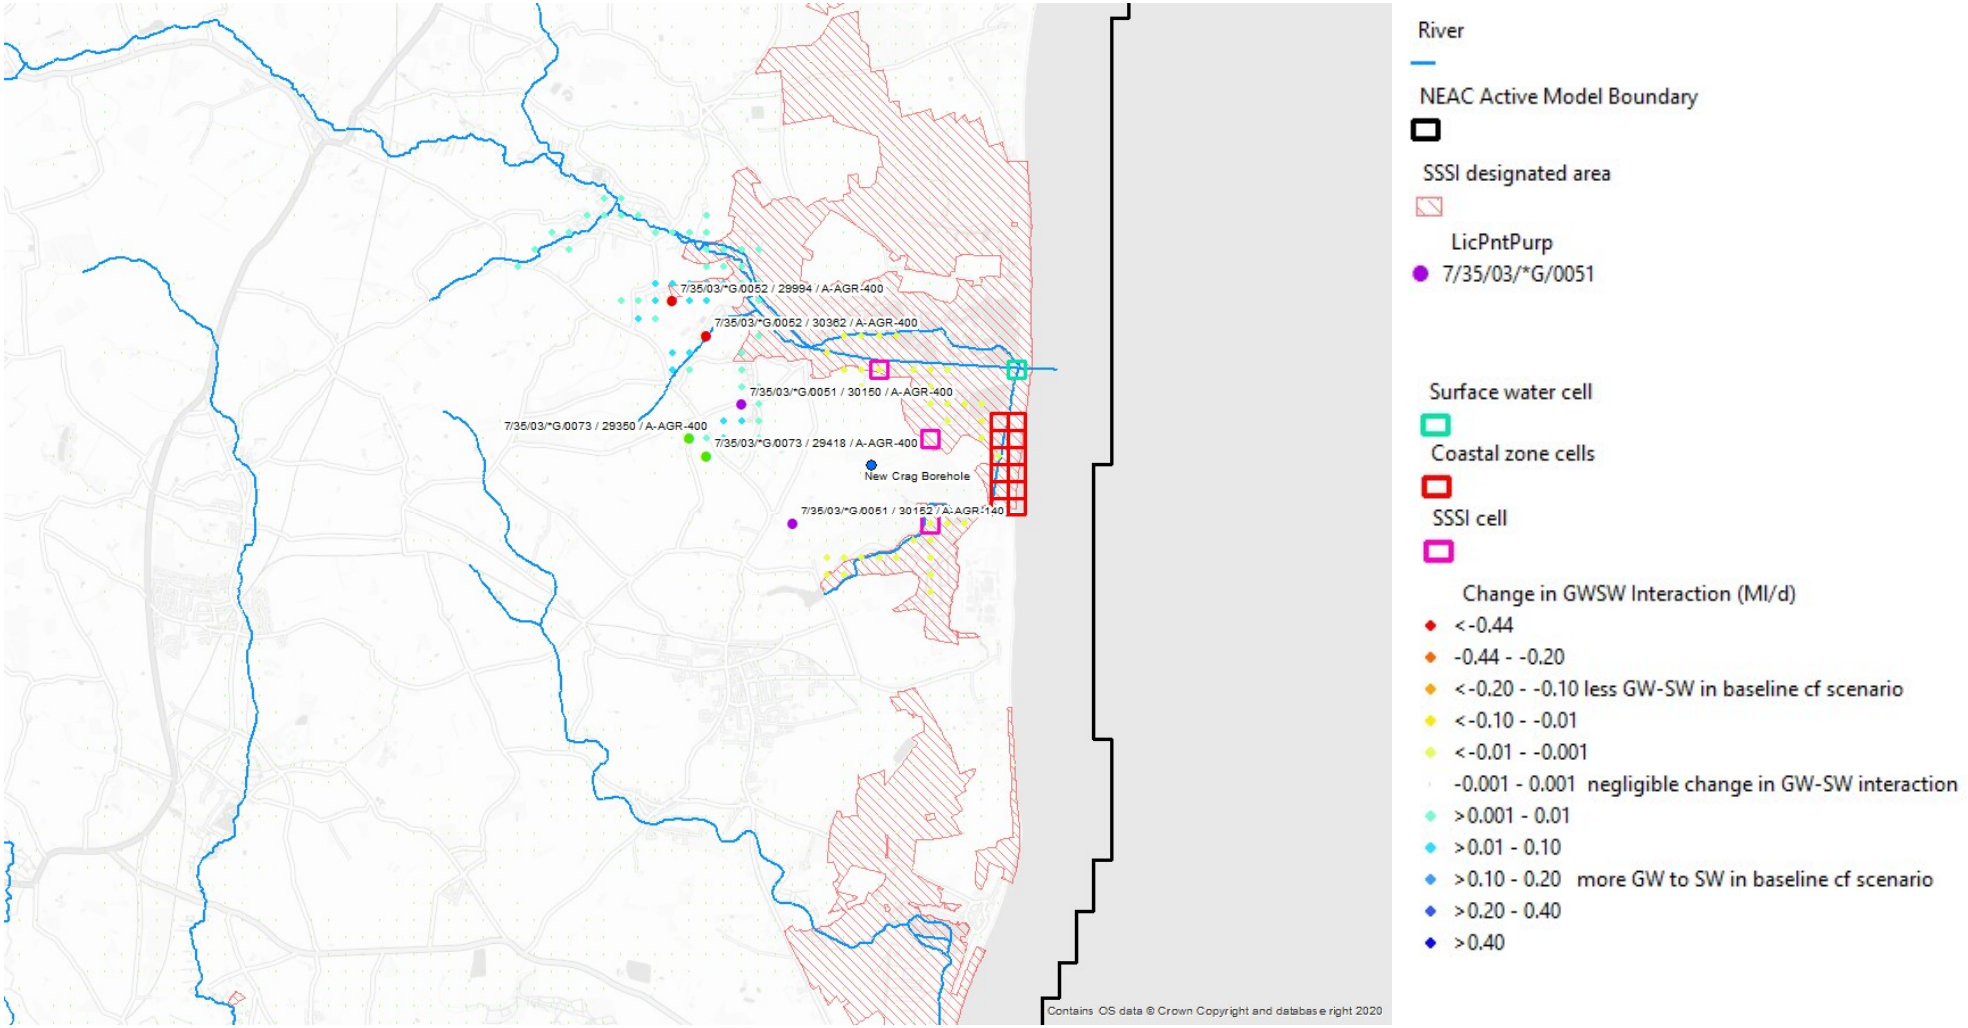

TCA/WRA/16 - Supporting Information

Annexure C – Pumping test results

WJ UK

Expert in Water Management

WORK WELL • LIVE WELL

Pumping Test Factual Report

Project Name: Sizewell C TCA Pumping Test


Client: Sizewell C Limited

Project No: P3465

© WJ UK

t +44 (0)20 8950 7256 | info@wjgl.com | f +44 (0)20 8950 7959 | wjgl.com
Registered Office; Unit 5, Abbots Business Park, Primrose Hill, Kings Langley, Herts, WD4 8FR
Registered in England and Wales No: 1586827 VAT Number GB 367004564

CONFIDENCE PRIDE TRUST CONSCIENTIOUS

WJ Document Control				
Document Reference & Revision	**Issued:**	**Prepared:**	**Checked:**	**Approved:**
P3465-643-001 Rev0 Sizewell C TCA Pumping Test Factual Report	26/03/2025	CD 	ER 	UM 

Amendment Record				
Date:	**Rev No.**	**Section No:**	**Change Description:**	**Changed By:**

TABLE OF CONTENTS

1. Project Information 1
1.1. Introduction 1
1.2. Site and Ground Conditions 1
2. Field Work 1
2.1. Drilling 1
2.2. Well Development 2
2.3. Pumping Tests 2
3. Pumping Test Results 3
3.1. Step Test 4
3.2. Constant Rate Test 4
3.3. Surface Water Monitoring 5
4. In-Situ Groundwater Testing 5
5. Groundwater Sampling 6
Tables & Figures 7
Table 1: Well and Piezometer Schedule 8
Table 2: Discharge Multiparameter Testing Results 9
Table 3: Water Quality Testing Results 10
Figure 1: Site Location 11
Figure 2: Site Layout Plan 12
Figure 3: Pumped Well Layout Plan 13
Figure 4: All Water Level and Flow Data 14
Figure 5: PB01 Step Test 15
Figure 6: PB01 Constant Rate Test 16
Figure 7: Surface Water Levels and Flow Data 17
Figure 8: Atkins Surface Water Monitoring – G1 18
Figure 9: Atkins Surface Water Monitoring – G3 19
Figure 10: Atkins Surface Water Monitoring – G4 20

Figure 11: Atkins Surface Water Monitoring – G5 21
Figure 12: Atkins Surface Water Monitoring – G6a 22
Figure 13: Atkins Surface Water Monitoring – G8 23
Figure 14: In-Situ Groundwater Testing Results 24
Appendix A: Borehole Logs 25
Appendix B: Datalogged Water Level and Flow Data 33
Appendix C: Diver Data 50
Appendix D: Manual Dip Data 79
Appendix E: Atkins Surface Water Monitoring Data 85
Appendix F: Water Sample Certificates 348

1. PROJECT INFORMATION

1.1. Introduction

In May 2024 WJ Groundwater Limited (WJ) were appointed by Sizewell C Limited (SZC) to carry out a pumping test at Sizewell Temporary Construction Area (TCA), Suffolk. The site is designated for development to support the construction of the proposed Sizewell C Power Plant, including workforce housing, concrete batching, and a desalination plant. The purpose of the test was to assess the feasibility of using the abstraction well as a long-term water supply and to evaluate the potential impact of abstraction on neighbouring sites of environmental and scientific importance.

The abstraction well, PB01, along with piezometers, PT01, PT02 and PT05 were installed by WJ. Additional monitoring wells were installed by others prior to WJ mobilising to site. These locations were monitored throughout the test to provide drawdown data over a range of distances from the abstraction well. Surface water monitoring locations were also monitored, as outlined by the Environment Agency per the Ground Investigation Consent issued to SZC. This factual report is limited to detailing the site work carried out and the presentation of the data obtained.

1.2. Site and Ground Conditions

The site is located north of the Sizewell Belts Site of Special Scientific Interest (SSSI) and comprises agricultural land and forested areas within the SSSI. It is bordered by the Minsmere New Cut land drain to the north, the North Sea to the east, Sizewell Belts to the south, and additional agricultural fields to the west. A location plan is provided in Figure 1.

Ground conditions at the site are typically as follows:

Strata	Thickness (m)
Made Ground (and Topsoil)	0-4.0
Recent Deposits	0-3.4
Lowestoft Deposits	0-2.0
Crag Group	36.0-40.0

The Crag group is water bearing with standing groundwater levels in the vicinity of the test area between approximately +1.0 to +2.0mOD.

2. FIELD WORK

2.1. Drilling

A rotary drilling rig was mobilized to the site on 15 January 2025, with drilling of the abstraction well (PB01) and monitoring well (PT01) commencing on 21 January 2025. PB01 was drilled using rotary water-flush

reverse circulation techniques, while PT01 was drilled using rotary conventional water-flush techniques. A cable percussion drilling rig was mobilized on 20 January 2025, with drilling of monitoring wells PT02 and PT05 beginning the same day. All drilling activities were completed by 28 January 2025. The other monitoring installations had been completed by others prior to WJ mobilising to site.

The layout of all monitored piezometers is shown in Figure 2, with a close-up of the pumping well and WJ-installed monitoring wells in Figure 3. Well logs are provided in Appendix A, and installation details are listed in Table 1.

2.2. Well Development

Prior to pump installation, the abstraction well was developed using eduction techniques. The well was developed using an airline and 100mm eduction pipe with water discharged to the drilling tank until the discharge became clear of fines.

Additionally, the functionality of the monitoring wells was verified by adding 15 litres of water to each well and measuring the time required for the water level to return to its natural level.

2.3. Pumping Tests

An electric submersible pump (Grundfos SP77/4, 15.0 kW) with a capacity of approximately 23 l/s at 4-bar pressure head was installed in PB01 at a depth of 39 m below ground level. The pump was powered by a diesel generator and connected to the surface via a 100 mm nominal diameter riser. A valve was incorporated into the headworks to control the pumping rate. Water discharge was directed through a 100 mm pipeline into a nearby holding pond (WMZ4) via a V-notch tank.

Water level monitoring in the pumped well and PT01 was carried out using vibrating wire transducers, connected to a multi-channel datalogger, other piezometers were monitored using 'Diver' type downhole data loggers. A 100 mm electromagnetic flowmeter was connected to the datalogger in order to monitor the abstraction flow rate.

Surface water levels were monitored using 'Diver' type downhole data loggers installed in stilling wells, which consisted of slotted 63 mm OD pipes secured to anchor points.

Manual dipping was carried out in monitoring standpipes and stilling wells to allow calibration of transducers and downhole loggers and the confirmation of water levels.

The streamflow measurements at locations G1, G3, G4, G5, G6a, G7a and G8 (otherwise referred to as "the G series") were undertaken by Atkins Realis. The data, provided to WJ Groundwater in Excel format, was incorporated into the pumping test report without further processing. The monitoring locations are summarized in table below:

Surface Water ID	Surface Water Location	Equipment installed
G1	Leiston Drain (D/S of Sizewell Marshes)	Pressure Transducer & Velocity Sensor
G3	Sizewell Drain Weir (U/S of Sizewell Marshes)	Pressure Transducer
G4	Leiston Drain Weir (U/S of Sizewell Marshes)	Pressure Transducer
G5	Leiston Drain with Aldhurst Farm (U/S of Sizewell Marshes)	Pressure Transducer & Velocity Sensor
G6a	Leiston Drain (D/S)	Pressure Transducer & Velocity Sensor
G8	D/S of Sizewell Marshes	Pressure Transducer & Velocity Sensor

The planned pumping test regime comprised of a brief equipment test followed by a step test and a 10-day constant rate test. The test duration was extended to 11 days to avoid switching off over a weekend. The programme of the works is summarised as follows:

Activity	From	To
Rotary drilling rig mobilised to site	15/01/2025	15/01/2025
Cable percussion drilling rig mobilised	20/01/2025	20/01/2025
Drilling of monitoring well PT05	20/01/2025	23/01/2025
Drilling of monitoring well PT01	21/01/2025	22/01/2025
Drilling of abstraction PB01	23/01/2025	28/01/2025
Drilling of monitoring well PT02	23/01/2025	27/01/2025
Rotary drilling rig demobilised	28/01/2025	28/01/2025
Development of abstraction well	29/01/2025	29/01/2025
Background Monitoring	04/02/2025	11/02/2025
PB01 Equipment Test	14/02/2025	14/02/2025
PB01 Step Test	18/02/2025 08:00	18/02/2025 16:20
PB01 Constant Rate Test	20/02/2025 08:00	03/03/2025 09:00
Recovery Monitoring Period	03/03/2025	13/03/2025

3. PUMPING TEST RESULTS

The datalogged water level and flow data for the whole testing period are presented in Appendices B and C. Manual dips are presented in Appendix D. The water level and flow data for the whole testing period are shown in Figure 4. The pre-pumping water levels in the test area in the Crag Group ranged between +3.0

and +1.0 mOD. However, the water level measured at ACC-BH05-EW was higher, between +8.95 and +9.0 mOD, likely due to the elevated ground level in that area. Monitoring well C3D, located approximately 200 m from the shore, exhibited tidal responses, with water levels fluctuating between +0.5 mOD and +1.0 mOD during the monitoring period.

3.1. Step Test

A step test was conducted on PB01 on 14 February 2025, consisting of five steps, each lasting 100 minutes, with pumping rates increasing from 2.8 l/s to 14 l/s, as shown in Figure 5. The cumulative drawdown in the well has been calculated as follows:

Step	Flow Rate (l/s)	Water Level at End of Step (mOD)	Cumulative Drawdown (m)
Standing WL	-	1.46	-
1	2.80	1.19	0.27
2	5.55	0.98	0.48
3	8.35	0.74	0.72
4	11.15	0.47	0.99
5	13.96	0.18	1.28

3.2. Constant Rate Test

The well PB01 was pumped for 11 days from 08:00 on 20 February until 09:00 on 03 March 2025, at a flow rate of approximately 6.95 l/s, as shown in Figure 6. The drawdown generated in the Crag Group has been calculated using water level data prior to pumping and those just before the pump was switched off, as follows.

Well/Piezometer	Distance from PB01 (m)	Water level 07:45 20/02/25 (mOD)	Water level 08:45 03/03/25 (mOD)	Drawdown/ Rise (m)
PB01 (abstraction well)	0.00	1.23	0.76	0.47
PT01	83.20	1.51	1.38	0.13
PT02	194.73	1.60	1.50	0.10
CPB_BP_13	411.50	1.28	1.26	0.02
GRR-BH15-EW	464.02	1.16	1.15	0.01
CPB_BP_11	470.59	1.67	1.66	0.01
BP23	534.22	1.08	1.08	0.00
PZ2009_20	542.18	1.26	1.24	0.02
PT05*	581.54	0.99	0.97	0.02
C7	762.87	1.96	1.95	0.01

Well/Piezometer	Distance from PB01 (m)	Water level 07:45 20/02/25 (mOD)	Water level 08:45 03/03/25 (mOD)	Drawdown/ Rise (m)
C2D	925.73	3.10	3.11	-0.01
ACC-BH05-EW	1080.77	8.99	8.97	0.02
RR7	1145.16	2.00	1.99	0.01
C3D**	1351.01	0.75	0.91	-0.16

* Due to the instrument issue, data between 18/02/25 and 27/02/25 was removed from PT05. A manual dip taken on 19 February 2025 13:59 has been used to calculate drawdown.

**C3D is close to the coast and the water level at this location is influenced by the tide. Drawdown has been calculated using the tidal peak water levels before the start of pumping and before the pump was switched off. However, it should be noted that tide was rising over the testing period.

The influence of pumping on the monitoring points was minimal and monitoring points beyond 200 m from the pumped well did not appear to be affected by abstraction from the Crag Deposits.

3.3. Surface Water Monitoring

Water level monitoring was undertaken in stilling wells is shown in Figure 7. Surface water monitoring points were likely influenced by external factors such as precipitation and did not show significant impacts from pumping at PB01, as summarised in table below:

Stilling Well	Distance from PB01 (m)	Water level 07:45 20/02/25 (mOD)	Water level 08:45 03/03/25 (mOD)	Drawdown/ Rise (m)
PS01	953.94	2.85	2.85	0.0
PS02	869.12	1.14	1.13	0.01
PS03	1144.14	2.27	2.40	-0.13

Additional monitoring was undertaken by Atkins, for the six water features on site. This data is found in Appendix E and shown in Figures 8 to 13.

4. IN-SITU GROUNDWATER TESTING

Water-quality testing was undertaken on the discharge from PB01. Samples were collected from the V-notch tank before discharge into the holding pond. An Aqua-probe AP800 with a readout unit was used and results are presented in Table 2 and Figure 14.

5. GROUNDWATER SAMPLING

During the constant rate test multiple water samples were obtained. On the first day of pumping, five samples were taken, followed by two samples per day until 01 March 2025. The results are summarised in Table 3 and laboratory certificates are provided in Appendix F.

Christian Denny

For and on behalf of

WJ GROUNDWATER LIMITED

Urszula Markowicz

For and on behalf of

WJ GROUNDWATER LIMITED

TABLES & FIGURES

Table 1: Well and Piezometer Schedule

Borehole	Easting	Northing	Ground Level	Top of well liner	Offset	Borehole depth (tagged level from top of pipe)	Borehole depth	Response Zone		Response Zone		Response Strata	Instrument Type	Comments
								Top	Base	Top	Base			
	m	m	mOD	mOD	m	mbsu	mOD	mbgl	mbgl	mOD	mOD			
PB01	646010.28	264972.67	13.00	13.47	0.47	40.62	-27.15	11.00	40.00	2.00	-27.00	Crag Group	Transducer	Offest changed from 0.47 to 0.10 at 12:00 on 05/03/25
PT01	645927.28	264978.52	13.50	13.94	0.44	14.53	-0.58	11.00	15.00	2.50	-1.50	Crag Group	Transducer	
PT02	645885.03	264823.57	10.91	11.91	1.00	13.96	-2.05	9.30	13.30	1.61	-2.39	Crag Group	Downhole logger	
PT05	646479.76	265315.86	3.53	4.66	1.13	14.13	-9.48	10.00	15.00	-6.47	-11.47	Crag Group	Downhole logger	
ACC-BH05-EW	645002.66	264581.80	18.57	19.11	0.54	10.22	8.89	3.90	10.00	14.67	8.57	Lowestoft and Crag Group	Downhole logger	Atkins-Realis Monitoring Well
BP23	646543.39	265006.99	8.64	8.95	0.31	12.13	-3.18	6.00	12.00	2.64	-3.36	Crag Group	Downhole logger	
C2D	646526.31	264204.11	4.05	4.46	0.41	19.67	-15.22	Install info not shown on log				Crag Group	Downhole logger	
C3D	647319.31	264638.52	2.84	3.24	0.40	20.69	-17.45					Crag Group	Downhole logger	Tidally influenced
C7	645315.38	265287.44	15.30	15.47	0.18	19.60	-4.13	14.00	20.00	1.30	-4.70	Crag Group	Downhole logger	
CPB_BP_11	645573.57	265148.01	17.34	17.46	0.12	19.64	-2.18	No access to site investigation report				Crag Group	Downhole logger	
CPB_BP_13	646008.23	265384.17	12.07	12.26	0.19	19.98	-7.72	(SZC-SZ0100-XX-000-REP-100006)				Crag Group	Downhole logger	
GRR-BH15-EW	646379.12	264691.12	7.34	7.67	0.33	10.28	-2.61	1.50	10.00	5.84	-2.66	Crag Group	Downhole logger	Atkins-Realis Monitoring Well
PZ2009_20	646261.48	264492.19	7.18	8.08	0.90	11.63	-3.55	3.50	10.70	3.84	-3.36	Crag Group	Downhole logger	Possibly listed as GW4 in SZC-SZ0100-XX-000-REP-100005
RR7	645342.26	264042.54	9.08	9.34	0.26	10.10	-0.76	4.00	10.00	3.34	-2.66	Crag Group	Downhole logger	
PS01	646429.46	264115.77	3.32	3.32	0.00	1.01	2.32	N/A	N/A	N/A	N/A	Surface Water Monitoring Point - Leiston Drain	Downhole logger	WJ Monitoring Point
PS02	646617.94	264351.29	1.72	1.72	0.00	1.01	0.71	N/A	N/A	N/A	N/A	Surface Water Monitoring Point - Leiston Drain	Downhole logger	WJ Monitoring Point
PS03	646474.83	266018.25	3.05	3.05	0.00	1.04	2.01	N/A	N/A	N/A	N/A	Surface Water Monitoring Point - IDB Drain No.7	Downhole logger	WJ Monitoring Point
G1	647411.00	264655.00	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Surface Water Monitoring Point - D/S Sizewell Drain	Pressure transducer, velocity sensor	Atkins-Realis Monitoring point
G3	646124.00	263711.00	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Surface Water Monitoring Point - Trib of Sizewell Drain	Pressure transducer	Atkins-Realis Monitoring point
G4	645833.00	263780.00	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Surface Water Monitoring Point - Trib of Leiston Drain	Pressure transducer	Atkins-Realis Monitoring point
G5	645400.00	263393.00	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Surface Water Monitoring Point - Leiston Drain	Pressure transducer, velocity sensor	Atkins-Realis Monitoring point
G6A	646997.00	264441.00	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Surface Water Monitoring Point - Leiston Drain	Pressure transducer, velocity sensor	Atkins-Realis Monitoring point
G8	647598.00	265624.00	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Surface Water Monitoring Point - D/S Sizewell Drain	Pressure transducer, velocity sensor	Atkins-Realis Monitoring point

Table 2: Discharge Multiparameter Testing Results

Location ID	Sampling Date & Time	Sampling Description (Colour/Odour)	Temperature (oC)	ORP (mV)	pH	DO(% Sat)	DO(mg/l)	Specific Conductivity@25C (uS/cm)	TDS (mg/l)	Salinity	SSG (st)	Turb(NTU)
V Notch Tank	20/02/25 08:34	Clear no Odour	11.50	-26.3	7.3	29.4	3.22	1080	702	0.51	0	0.0
V Notch Tank	20/02/25 10:15	Clear no Odour	11.00	-20.3	7.31	8.7	0.97	1045	679	0.49	0	0.0
V Notch Tank	20/02/25 12:07	Clear no Odour	11.30	-36.1	7.34	19.4	2.13	1151	748	0.54	0	0.0
V Notch Tank	20/02/25 14:11	Clear no Odour	11.20	-36.3	7.32	12.2	1.35	1143	742	0.54	0	0.0
V Notch Tank	20/02/25 16:15	Clear no Odour	11.28	-40.3	7.32	38.4	4.22	1128	733	0.53	0	0.0
V Notch Tank	21/02/25 08:16	Clear no Odour	11.30	-54.5	6.89	13.4	1.48	1067	693	0.5	0	0.0
V Notch Tank	21/02/25 17:06	Clear no Odour	11.50	-44.4	7.07	39.4	4.28	1065	692	0.5	0	0.0
V Notch Tank	22/02/25 16:42	Clear no Odour	11.60	-55.3	7.12	34.6	3.78	1025	666	0.48	0	0.0
V Notch Tank	23/02/25 08:09	Clear/slight odour	10.80	-85.0	6.85	7.7	0.86	1012	657	0.48	0	0.0
V Notch Tank	23/02/25 16:52	Clear no Odour	11.10	-33.0	6.96	39.2	4.35	989	642	0.41	0	0.0
V Notch Tank	24/02/25 08:17	Clear no Odour	11.50	-67.5	7.5	7.9	0.85	1002	651	0.47	0	0.0
V Notch Tank	24/02/25 16:24	Clear	11.83	-51.7	7.09	11.1	1.19	1063	690	0.5	0	0.0
V Notch Tank	25/02/25 14:07	Clear no Odour	12.50	-79.5	7.18	43.8	4.67	937	609	0.39	0	0.0
V Notch Tank	25/02/25 14:48	Clear no Odour	11.50	-56.7	7.11	11.2	1.22	921	598	0.39	0	0.0
V Notch Tank	26/02/25 09:03	Clear no Odour	10.50	-65.5	7.01	63.8	7.14	908	590	0.38	0	0.0
V Notch Tank	26/02/25 16:46	Clear no Odour	10.80	-48.6	7.05	22.5	2.48	904	587	0.38	0	0.0
V Notch Tank	27/02/25 09:06	Clear no Odour	11.00	-79.3	6.96	19.2	2.13	793	515	0.33	0	0.0
V Notch Tank	27/02/25 16:30	Clear no Odour	12.10	-54.0	7.06	15.8	1.72	915	594	0.38	0	0.0
V Notch Tank	28/02/25 09:06	Clear no Odour	10.80	-64.7	6.99	42.3	4.78	1020	663	0.48	0	0.0
V Notch Tank	28/02/25 16:22	Clear no Odour	12.40	-56.5	7.11	8	0.88	945	614	0.4	0	0.0
V Notch Tank	01/03/25 10:14	Clear no Odour	9.90	-75.6	6.92	39.1	4.54	882	573	0.37	0	0.0
V Notch Tank	01/03/25 13:38	Clear no Odour	11.75	-74.5	7.05	25.7	2.85	898	583	0.38	0	0.0

Table 3: Water Qaulity Testing Results

		Lab Number	250224-30	250224-30	250224-30	250224-30	250224-30	250226-20	250226-21
		Sample Number	31121266	31121283	31121451	31121490	31121534	31127573	31127595
		Sample Location	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank
		Sample Depth							
		Sample Medium	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER
		Sample Date	20/02/2025	20/02/2025	20/02/2025	20/02/2025	20/02/2025	21/02/2025	21/02/2025
Determinand	Unit	LoD							
Alkalinity, Total as CaCO3	mg/l	3	326	321	322	328	302	327	329
Ammoniacal Nitrogen as N (low level)	mg/l	0.01	0.018	<0.01	<0.01	<0.01	0.026	<0.01	0.01
Ammoniacal Nitrogen Low as NH4	mg/l	0.01	0.0231	<0.01	<0.01	<0.01	0.0334	<0.01	0.0129
Arsenic (diss.filt)	µg/l	0.5	1.76	2.29	1.87	1.78	1.53	1.87	1.79
Arsenic (tot.unfilt)	µg/l	2	<2	2.16	<2	<2	<2	<2	<2
Boron (diss.filt)	µg/l	10	29.2	34.8	30.2	28.7	25.9	32.6	30.4
Boron (tot.unfilt)	µg/l	20	38.8	35.6	31.8	32	29.1	28.9	34.9
Cadmium (diss.filt)	µg/l	0.08	<0.08	<0.08	<0.08	<0.08	<0.08	<0.08	<0.08
Cadmium (tot.unfilt)	µg/l	0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
Calcium (Dis.Filt)	mg/l	0.2	160	169	160	161	159	178	174
Calcium (Tot. Unfilt.)	mg/l	0.057	166	166	166	166	166	167	168
Chloride	mg/l	0.08	61	63.3	60.6	60.9	64	60.5	60.4
Chromium (diss.filt)	µg/l	1	<1	<1	<1	<1	<1	<1	<1
Chromium (tot.unfilt)	µg/l	3	<3	<3	<3	<3	<3	<3	<3
Conductivity @ 20 deg.C	mS/cm	0.02	0.887	0.883	0.877	0.886	0.881	0.899	0.898
Copper (diss.filt)	µg/l	0.3	<0.3	4.86	2.23	0.432	1.96	0.393	1.68
Copper (tot.unfilt)	µg/l	1	1.3	8.52	5.52	<1	18.5	1.57	2.5
Cyanide, Free (low level)	µg/l	2.5	<2.5	<2.5	<2.5	<2.5	<2.5	<2.5	<2.5
Iron (Dis.Filt)	mg/l	0.019	0.95	0.643	0.765	1.04	0.205	2.09	2.27
Iron (Tot. Unfilt.)	mg/l	0.024	1.03	0.725	0.831	1.08	0.446	2.04	2.24
Lead (diss.filt)	µg/l	0.2	<0.2	0.362	0.242	<0.2	0.5	<0.2	0.432
Lead (tot.unfilt)	µg/l	1	<1	1.5	1.14	<1	8.51	<1	<1
Magnesium (Dis.Filt)	mg/l	0.036	8.23	9.04	8.26	8.25	6.9	9.73	9.57
Magnesium (Tot. Unfilt.)	mg/l	0.05	8.63	8.59	8.54	8.69	7.35	8.72	8.78
Manganese (diss.filt)	µg/l	3	162	147	151	167	170	184	179
Manganese (tot.unfilt)	µg/l	1	173	149	158	173	182	181	182
Mercury (diss.filt)	µg/l	0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01
Nickel (diss.filt)	µg/l	0.4	2.58	9.41	6.38	2.41	3.55	1.66	2.18
Nickel (tot.unfilt)	µg/l	1	3.05	9.84	7.15	2.4	8.65	1.82	2.23
Nitrate as N	mg/l	0.02	7.26	7.35	7.3	7.18	10.3	6.87	6.89
Nitrite as N	mg/l	0.01	0.0265	0.0298	0.0402	0.038	0.0593	0.0173	<0.01
Nitrogen, Total	mg/l		7.77	7.51	7.48	7.36	10.8	7.45	7.39
pH	pH Units	1	7.45	7.54	7.65	7.5	7.53	7.49	7.59
Phosphate (Ortho as P)	mg/l	0.02	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02
Phosphorus (diss.filt)	µg/l	10	<10	10.8	11.4	<10	<10	14.2	10.6
Potassium (Dis.Filt)	mg/l	0.2	2.08	2.32	2.19	2.11	1.78	2.16	2.19
Potassium (Tot. Unfilt.)	mg/l	0.2	2.18	2.31	2.27	2.13	2.58	2.04	2.08
Sodium (Dis.Filt)	mg/l	0.076	20.4	22.9	20.7	20.8	19.3	23.8	23.2
Sodium (Tot. Unfilt.)	mg/l	0.047	21.4	21.9	21.4	21.7	21.7	21.3	21.8
Sulphate as S	mg/l	0.04	27.8	28.1	27.8	28.2	28.2	28	28.1
Suspended solids, Total	mg/l	2	<2	<2	<2	<2	362	4.3	4.6
Total Oxidised Nitrogen as N	mg/l	0.2	7.3	7.38	7.27	7.18	10.1	6.98	6.99
Zinc (diss.filt)	µg/l	1	9.83	81	48	9.81	30	8.76	29.6
Zinc (tot.unfilt)	µg/l	5	10.8	84.8	50.8	8.2	92.4	7.4	12.9

Table 3: Water Qaulity Testing Results

250226-22	250226-23	250226-24	250226-25	250226-35	250226-38	250227-43	250227-45	250228-43	250228-45
31127601	31127622	31127634	31127640	31127930	31128013	31133791	31133814	31140475	31140588
TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank
GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER
22/02/2025	22/02/2025	23/02/2025	23/02/2025	24/02/2025	24/02/2025	25/02/2025	25/02/2025	26/02/2025	26/02/2025
329	329	330	329	327	327	327	326	330	331
0.027	<0.01	0.058	<0.01	<0.01	0.011	0.027	0.011	0.013	0.019
0.0347	<0.01	0.0746	<0.01	<0.01	0.0141	0.0347	0.0141	0.0167	0.0244
1.7	1.72	1.76	1.56	1.63	1.46	1.37	1.42	1.32	1.37
<2	<2	<2	<2	<2	<2	<2	<2	<2	<2
28.9	29.1	36.2	29.5	33.2	34.3	32.8	31.7	27.2	25.7
27.8	29.6	30.1	31.3	27.8	29.3	33.9	32.3	35.2	40.7
<0.08	<0.08	<0.08	<0.08	<0.08	<0.08	<0.08	<0.08	<0.08	<0.08
<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
178	176	175	176	173	174	175	174	171	169
167	167	164	167	170	170	176	176	179	181
60.4	60.6	61.1	60.3	60.4	60	59.7	59.7	60.5	60.4
<1	<1	<1	<1	<1	<1	<1	<1	<1	<1
<3	<3	<3	<3	<3	<3	<3	<3	<3	<3
0.894	0.898	0.901	0.896	0.9	0.898	0.899	0.9	0.893	0.893
<0.3	0.749	0.824	0.424	0.506	<0.3	0.478	0.777	<0.3	<0.3
<1	3.69	<1	3.62	2.86	2.82	5.84	3.09	4.69	1.51
<2.5	<2.5	<2.5	<2.5	<2.5	<2.5	<2.5	<2.5	<2.5	<2.5
2.53	2.55	2.58	2.58	2.79	2.8	2.72	2.72	2.66	2.64
2.51	2.56	2.59	2.65	2.75	2.77	3.06	3.12	2.85	2.79
<0.2	0.209	<0.2	<0.2	0.219	<0.2	0.391	0.223	<0.2	<0.2
<1	<1	<1	<1	<1	<1	1.32	<1	<1	<1
9.67	9.82	9.69	9.66	9.59	9.6	9.71	9.66	8.87	8.74
8.64	8.69	8.69	8.83	8.93	8.97	9.68	9.64	10.2	10.1
171	167	169	170	176	181	172	170	168	164
171	169	166	170	168	171	174	172	175	174
<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01
2.66	22.6	1.05	17.8	3.56	1.66	101	102	42.7	1.18
2.7	22.5	<1	18.3	4.07	2.3	101	20.3	46	2.24
7.01	6.96	7.04	7.12	7.16	7.18	7.13	7.08	7.26	7.32
<0.01	<0.01	<0.01	<0.01	0.0207	0.0259	0.0441	0.0359	0.088	0.0819
7.56	7.5	7.65	7.82	7.69	7.63	7.44	7.84	8.29	8.39
7.5	7.46	7.61	7.48	7.47	7.5	7.47	7.53	7.42	7.39
<0.02	<0.02	0.0884	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02
16.7	19.6	1140	<10	23.1	28.5	28.6	23.6	34.9	28.1
2.15	2.19	3.34	2.12	2.16	2.08	2.1	2.16	2.04	1.98
2.05	2.06	3.14	2.07	2.15	2.14	2.36	2.16	2.21	2.23
23.4	23.8	25.2	23.4	23.1	23.1	23.3	23.4	23.2	22.2
21.3	21.4	22.9	21.6	22.5	22.3	23.2	23.3	24.3	24.2
28.3	28.4	28.2	28.3	28.4	28.3	28.2	28.1	28.5	28.5
7.1	5.05	7.8	5.5	5.7	2.6	5.7	4.5	3.7	4.8
7.28	7.08	7.27	7.22	7.28	7.45	7.37	7.34	7.54	7.57
8.05	73.2	17.1	42.7	11.4	5.94	147	147	44.5	4.02
8.24	72.6	15.8	46	14.9	12.4	167	43	56.5	7.83


Table 3: Water Qaulity Testing Results

250303-7	250303-8	250304-32	250304-33	250304-31	250304-31
31151176	31151220	31156935	31156958	31156912	31157043
TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank	TCA V-Notch Tank
GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER	GROUND_WATER
27/02/2025	27/02/2025	28/02/2025	28/02/2025	01/03/2025	01/03/2025
335	335	329	329	332	330
0.01	0.016	0.017	0.025	0.027	0.015
0.0129	0.0206	0.0219	0.0321	0.0347	0.0193
1.14	1.17	1.45	1.3	<0.5	<0.5
<2	<2	<2	<2	<2	<2
29.9	29.2	29.4	28.3	28.7	28.7
29.4	28.7	33.8	33.9	27.6	31.1
<0.08	<0.08	<0.08	<0.08	<0.08	<0.08
<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
167	165	181	181	175	177
177	175	170	171	177	180
62.3	62.4	61.7	61.6	61.6	62.3
<1	<1	<1	<1	<1	<1
<3	<3	<3	<3	<3	<3
0.896	0.896	0.894	0.893	0.895	0.895
<0.3	<0.3	<0.3	<0.3	<0.3	0.473
3.13	2.49	1.51	2.14	1	1.47
<2.5	<2.5	<2.5	<2.5	<2.5	<2.5
2.53	2.52	2.64	2.41	<0.019	<0.019
2.85	4.21	2.62	2.85	4.22	2.7
<0.2	<0.2	<0.2	<0.2	<0.2	0.33
<1	<1	<1	<1	<1	<1
9.08	9.03	8.93	8.86	8.9	9.12
9.3	9.29	9.24	9.31	9.17	9.36
166	163	168	167	158	164
170	167	172	173	167	175
<0.01	<0.01	<0.01	<0.01	<0.01	<0.01
40.1	2.27	2.11	102	2.18	194
43.7	2.98	2.57	107	2.69	214
7.48	7.53	7.49	7.37	7.39	7.44
0.116	0.106	0.159	0.187	0.213	0.225
8.17	7.96	7.92	7.8	8.1	8.07
7.36	7.4	7.49	7.45	7.37	7.34
<0.02	<0.02	<0.02	<0.02	<0.02	<0.02
37	25.7	27.1	23.9	<10	<10
2.04	2	2.12	2.1	2.04	2.04
2.09	2.09	2.12	2.11	2.04	2.08
22.4	22.2	22.3	22.1	22.9	22.5
24.4	24.1	22.9	22.8	23.9	24.5
29.3	29.4	28.9	28.7	28.9	29.1
5.3	6.75	4.55	3.55	8.55	5.1
7.54	7.63	7.65	7.62	7.67	7.61
40.3	4.76	7.91	51.1	6.12	64.5
42.8	12.4	9.77	50.9	7.12	76.5

Figure 1: Site Location



Location ID: Monitoring Borehole	Latitude	Longitude
PZ2009_20	52.223533	1.6042333
CPB_BP_13	52.231781	1.6012837
BP23	52.228232	1.6087889
CPB_BP_11	52.228652	1.5950392
C2D	52.22083	1.6078952
C7	52.231103	1.5910551
RR7	52.219904	1.5904949
GRR-BH15-EW	52.225303	1.6060611
ACC-BH05-EW	52.224901	1.5859039
C3D	52.224378	1.6197979
G1	52.224481	1.6211391
G3	52.216587	1.6016494
G4	52.217335	1.5974486
G5	52.214684	1.5908935
G6a	52.222746	1.6149344
G7a	52.222197	1.6187563
G8	52.23391	1.6245801
PS01	52.22045	1.606479
PS02	52.222271	1.609301
PS03	52.237123	1.608368
PB01	52.228041	1.6009367
PT01	52.22811	1.599704
PT02	52.226813	1.598951
PT05	52.230928	1.6080706

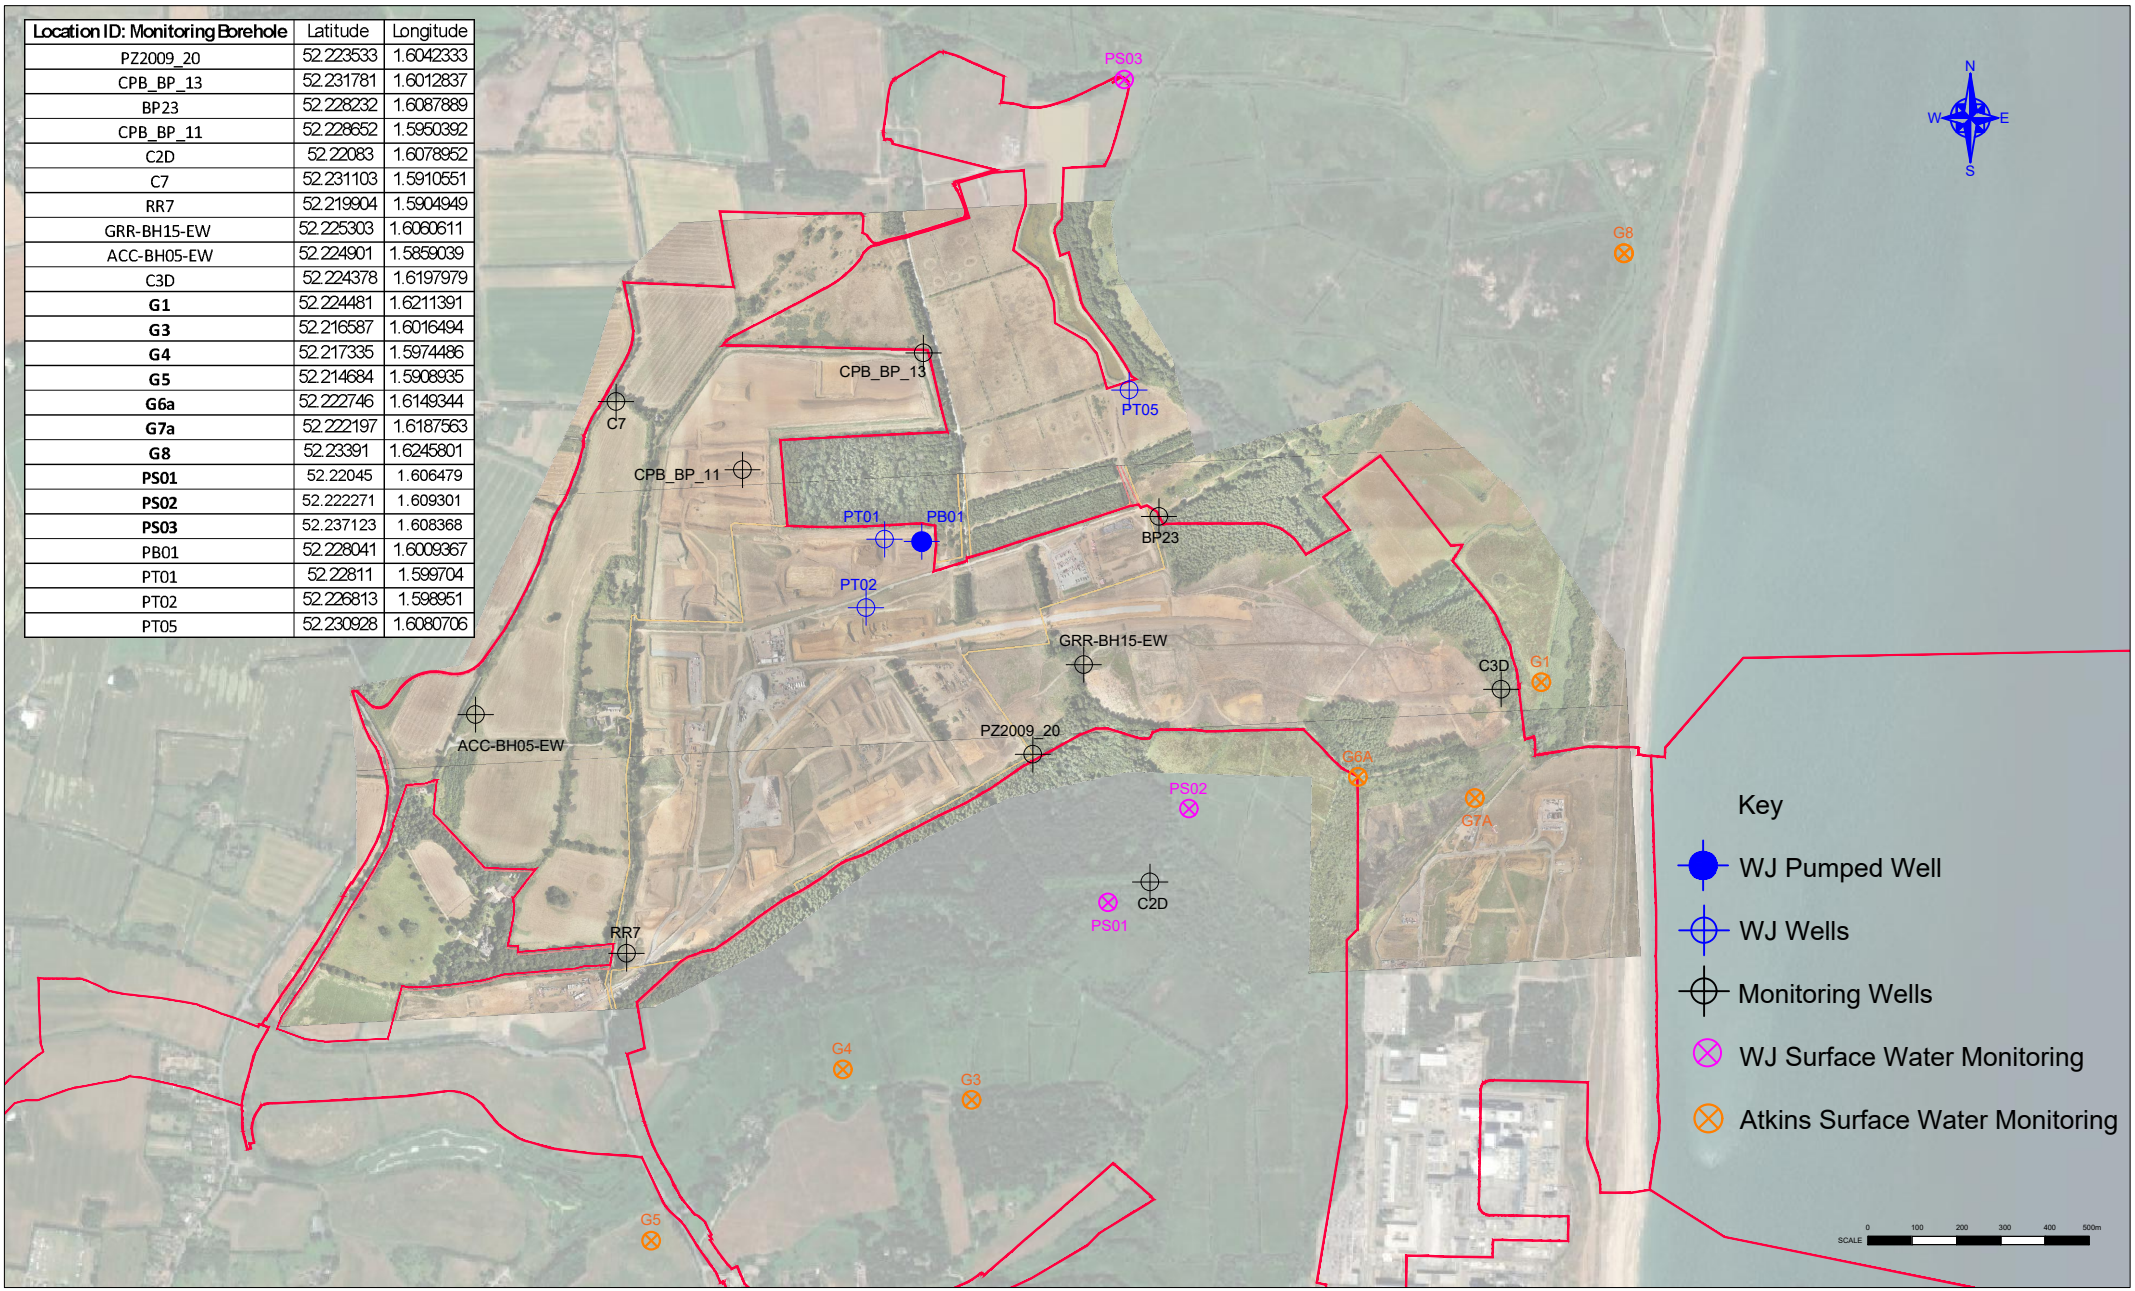

WJ UK
Expert in Water Management

Notes:


Rev No	Drawn by	Check by	Date	Reason for revision
00	RT	ER	17/03/2025	Issue for Review

Project Name:
TCA Pumping Tests

Drawing Title:
Monitoring & Drilling Locations
Figure 2

Drawing No: P3465/022 | Scale:NTS

Location ID: Monitoring Borehole	Latitude	Longitude
PZ2009_20	52.223533	1.6042333
CPB_BP_13	52.231781	1.6012837
BP23	52.228232	1.6087889
CPB_BP_11	52.228652	1.5950392
C2D	52.22083	1.6078952
C7	52.231103	1.5910551
RR7	52.219904	1.5904949
GRR-BH15-EW	52.225303	1.6060611
ACC-BH05-EW	52.224901	1.5859039
C3D	52.224378	1.6197979
G1	52.224481	1.6211391
G3	52.216587	1.6016494
G4	52.217335	1.5974486
G5	52.214684	1.5908935
G6a	52.222746	1.6149344
G7a	52.222197	1.6187563
G8	52.23391	1.6245801
PS01	52.22045	1.606479
PS02	52.222271	1.609301
PS03	52.237123	1.608368
PB01	52.228041	1.6009367
PT01	52.22811	1.599704
PT02	52.226813	1.598951
PT05	52.230928	1.6080706

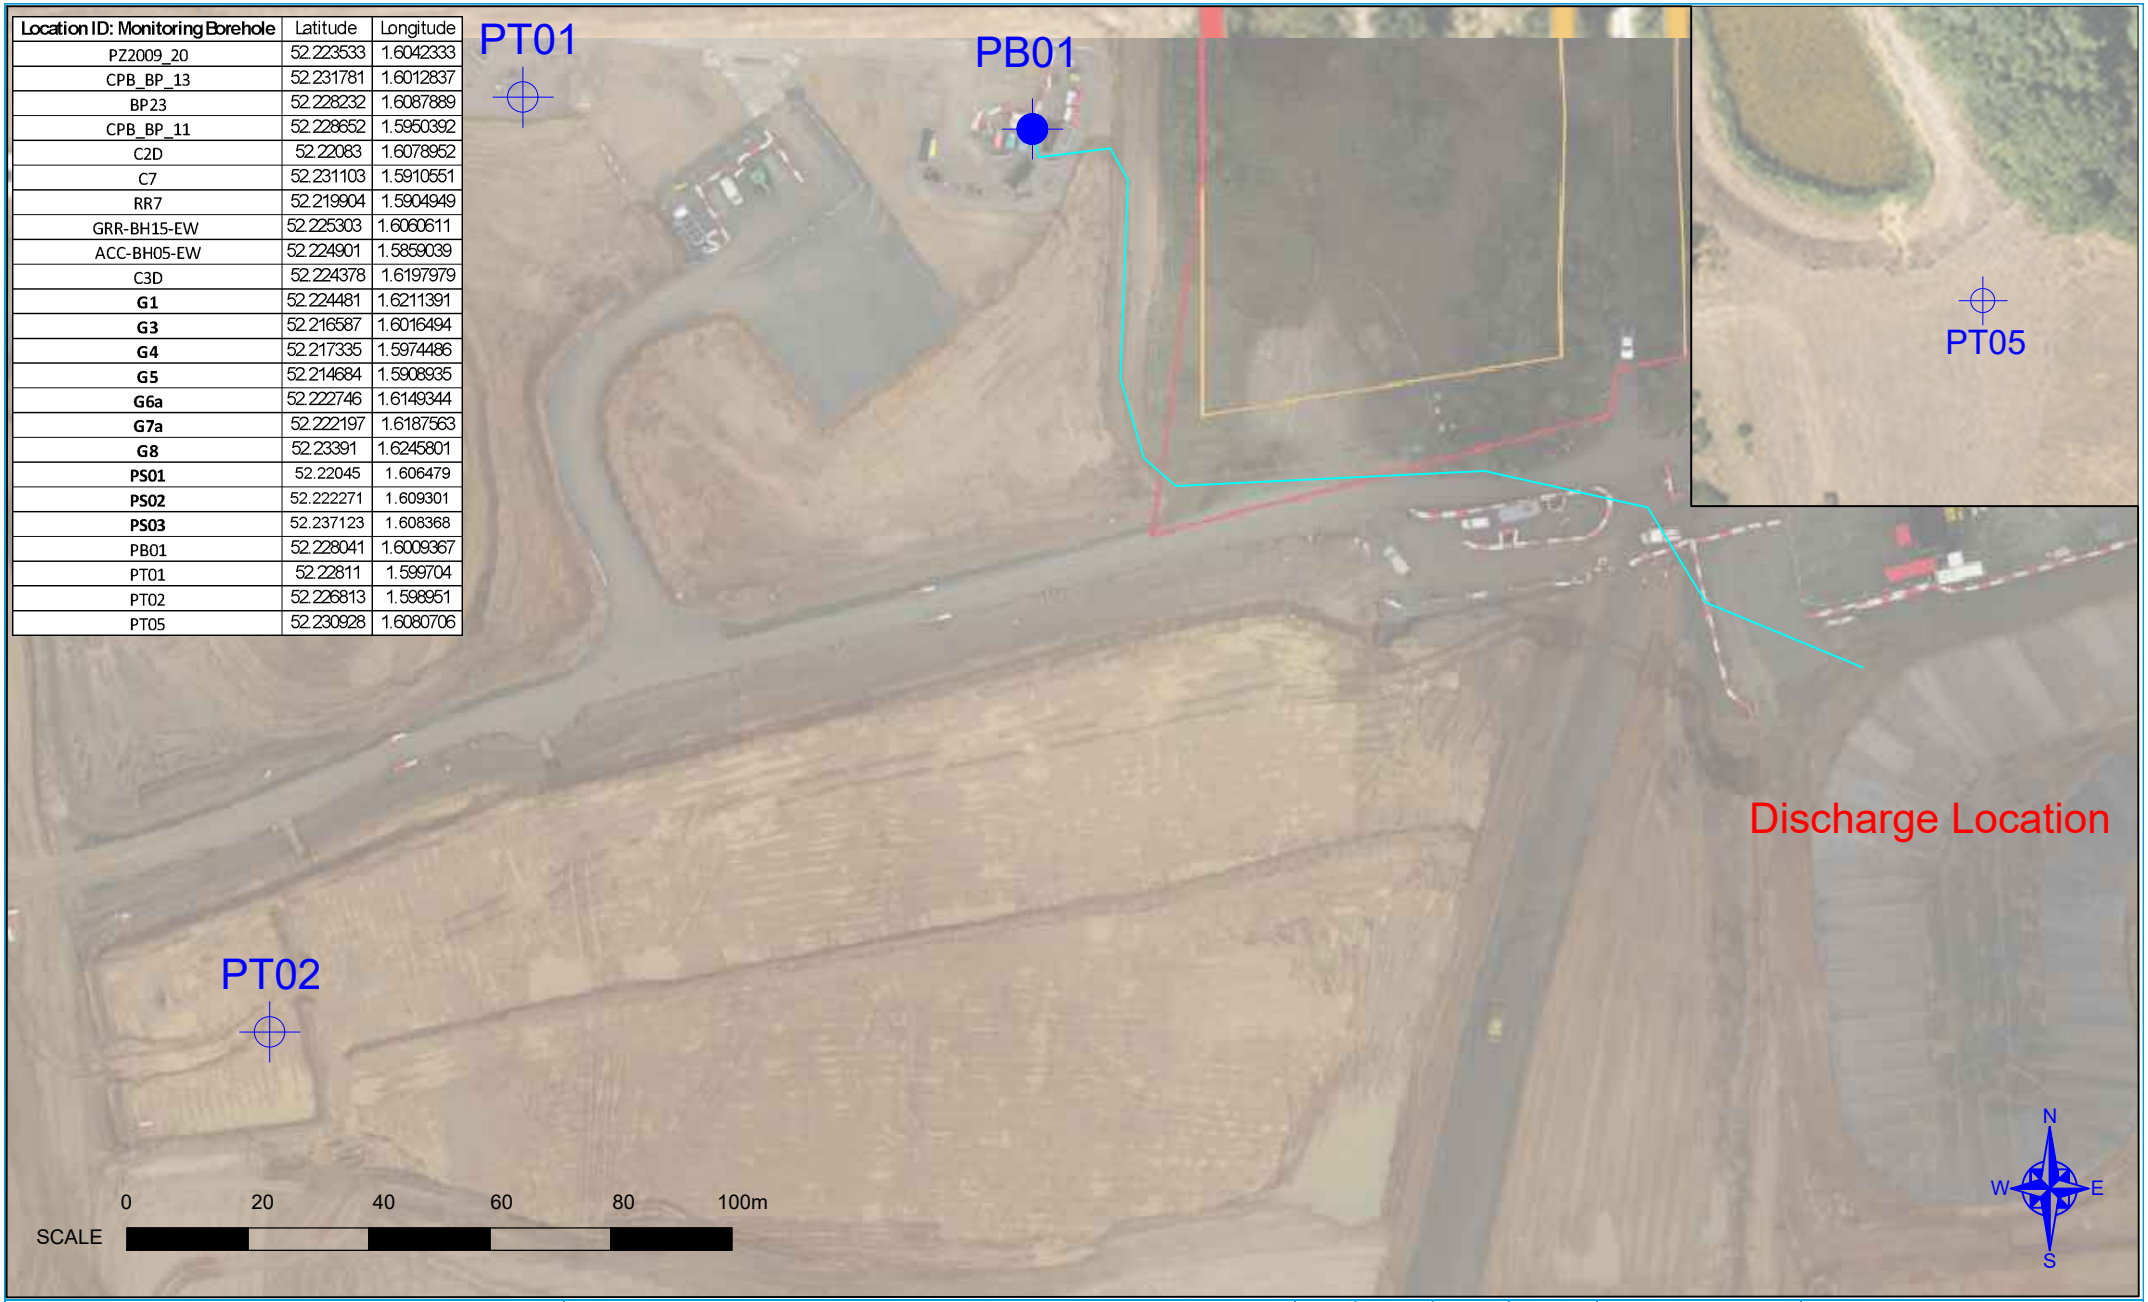

WJ UK
Expert in Water Management

Notes:

Rev No	Drawn by	Check by	Date	Reason for revision
00	RT	ER	17/03/2025	Issue for Review

Project Name:
TCA Pumping Tests

Drawing Title:
Monitoring & Drilling Locations
Figure 3

Drawing No: P3465/022

Scale:As Shown

Figure 4: All Water Levels and Flow Data

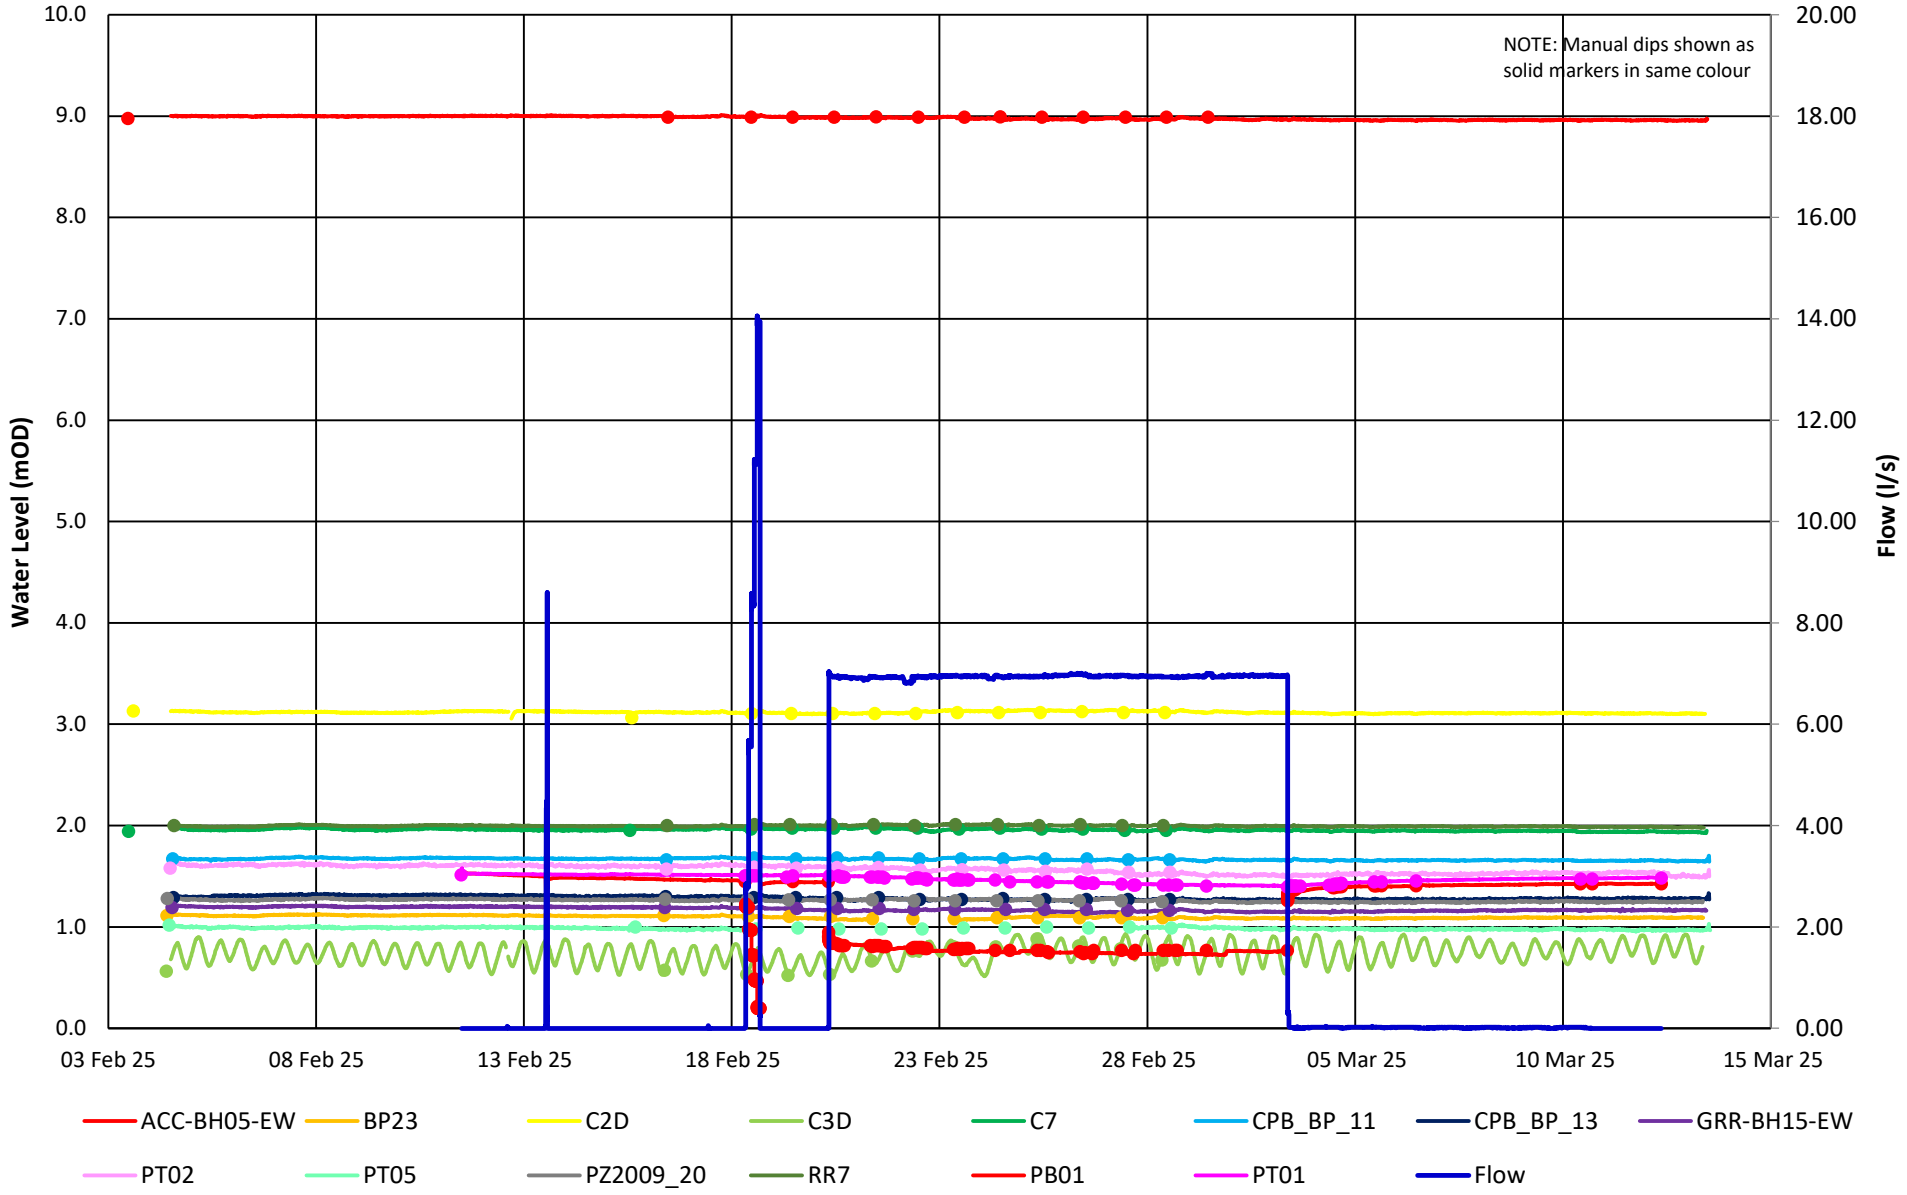


Figure 5: PB01 Step Test

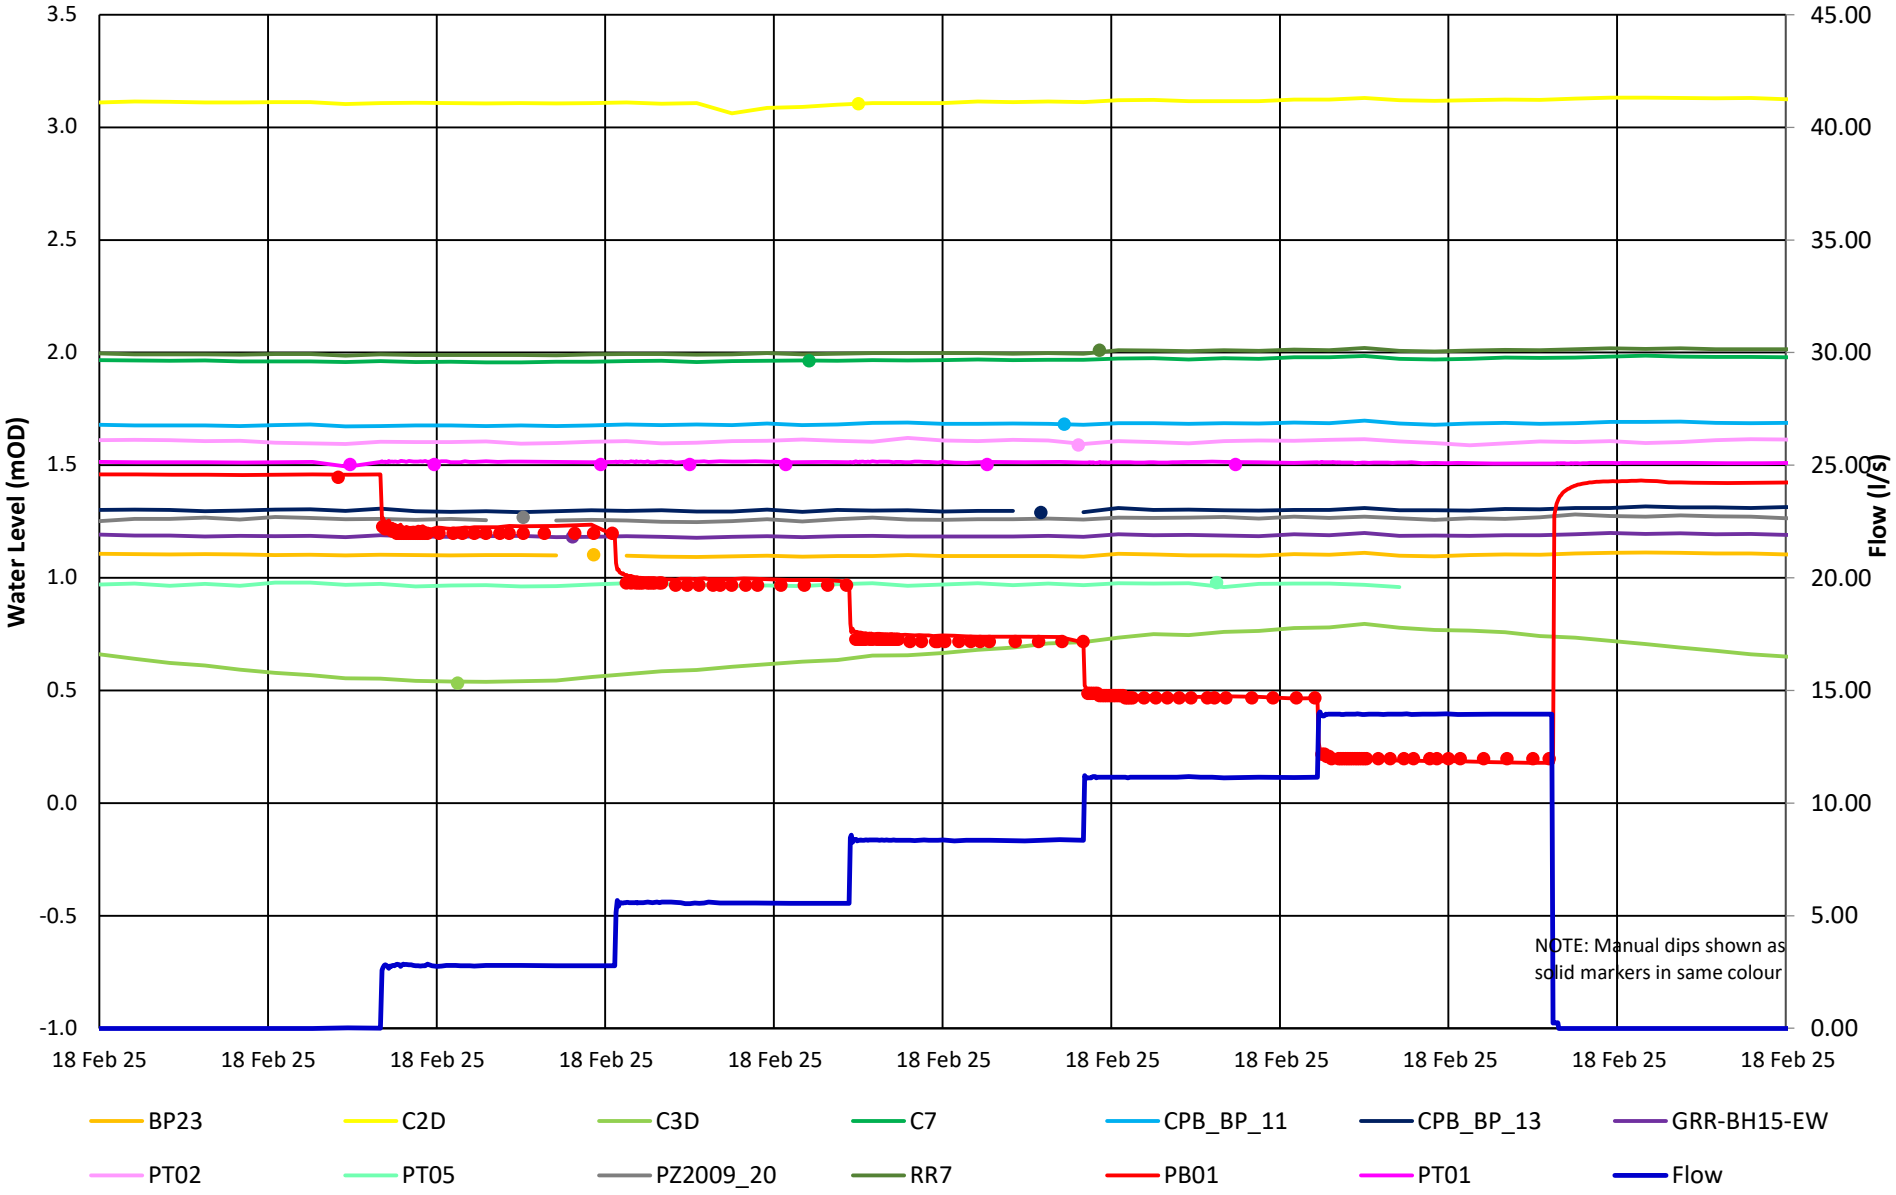


Figure 6: PB01 Constant Rate Test

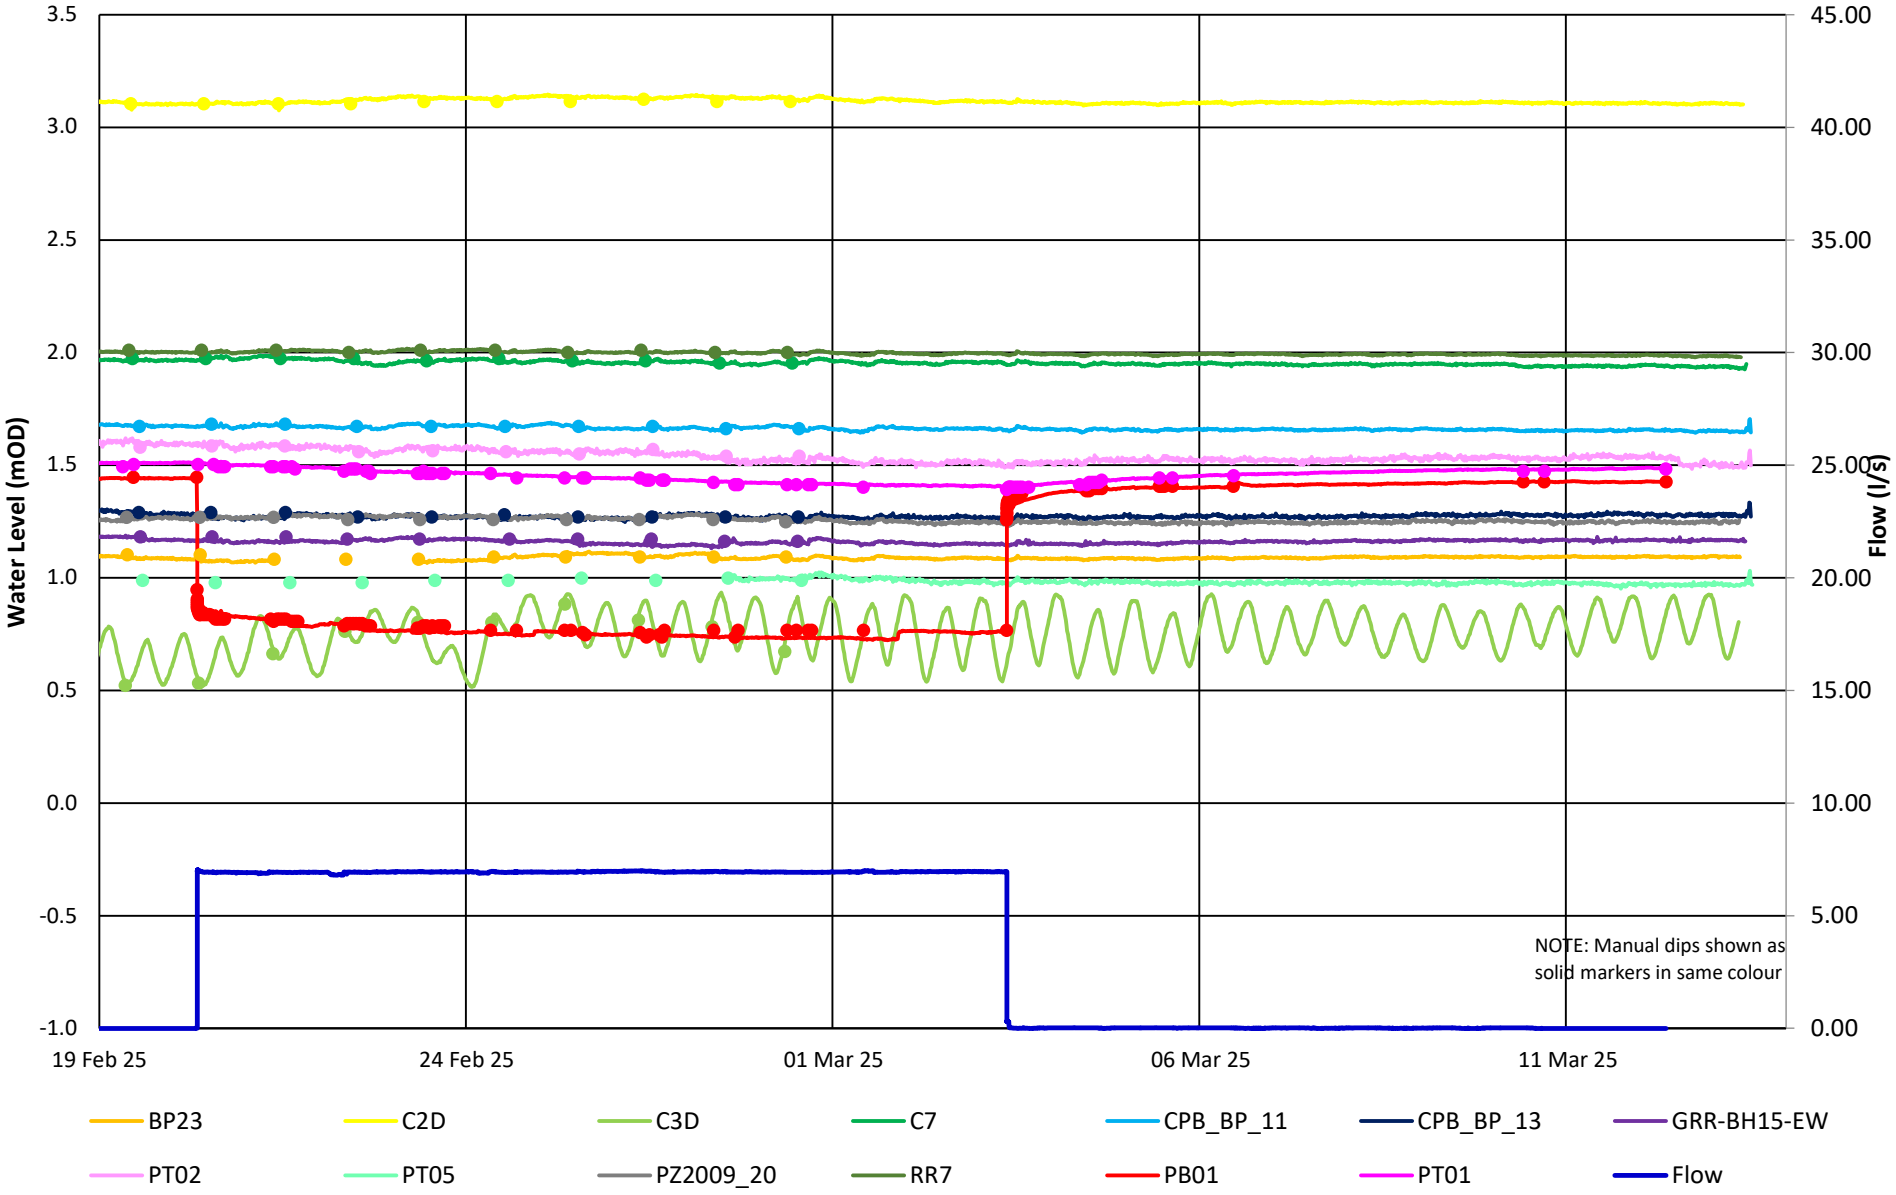


Figure 7: Surface Water levels and Flow Data



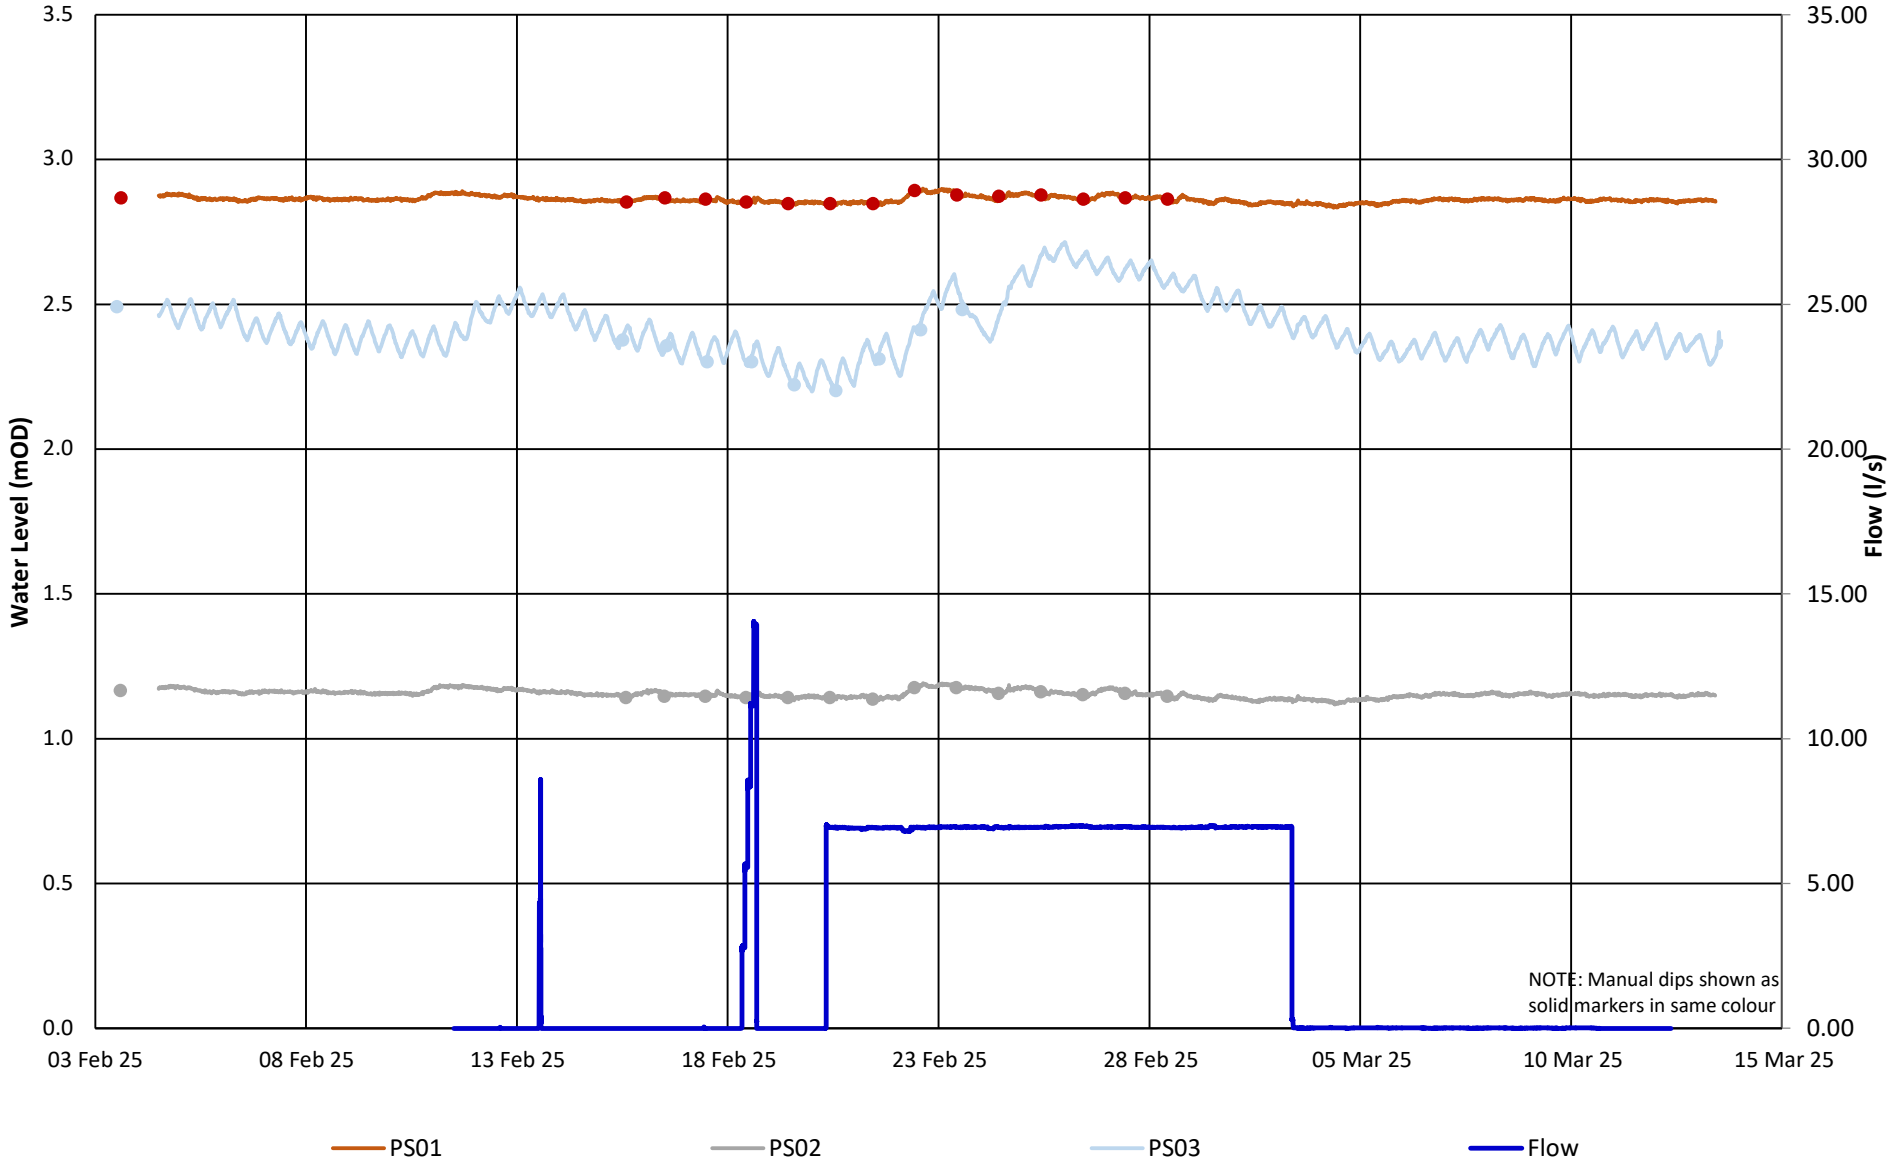


Figure 8: Atkins Surface Water Monitoring - G1

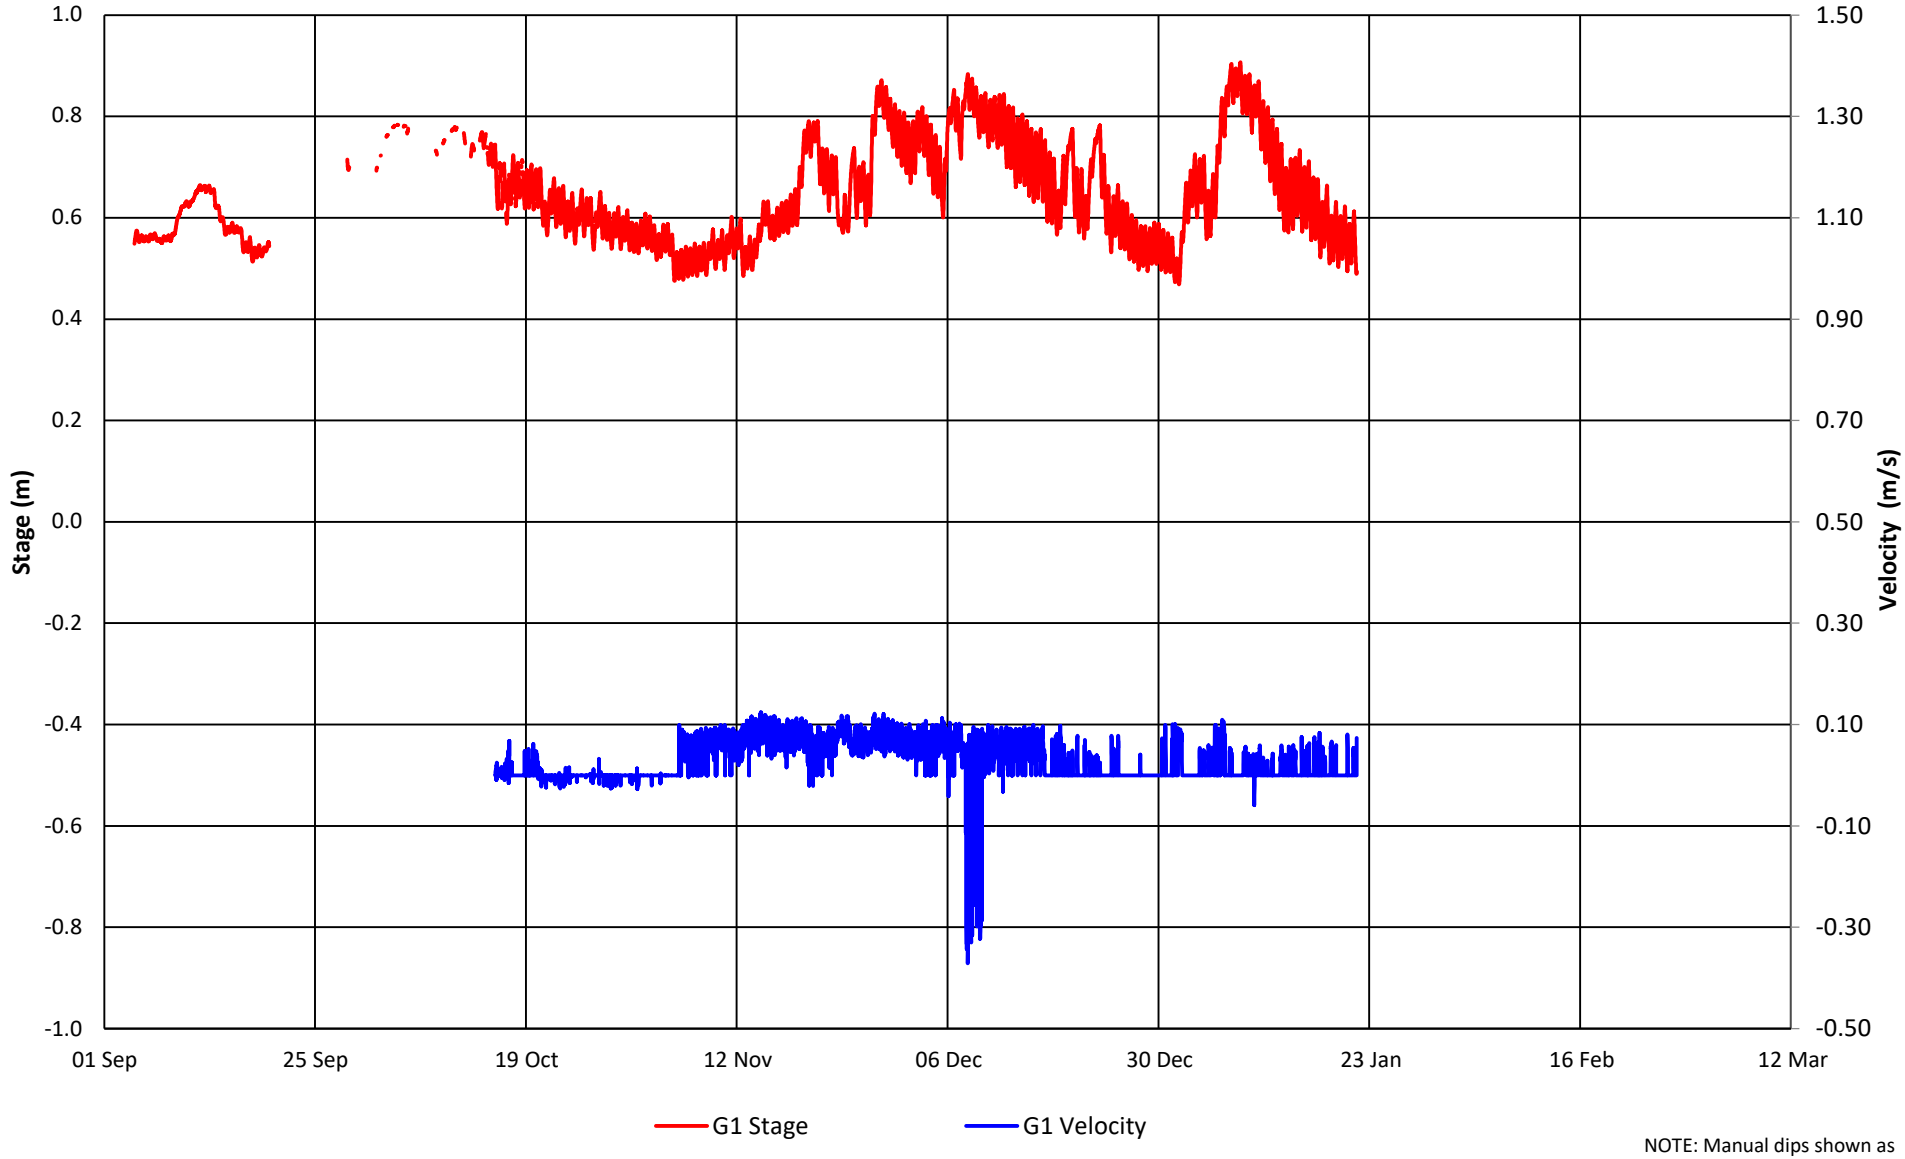


NOTE: Manual dips shown as solid markers in same colour

Figure 9: Atkins Surface Water Monitoring - G3

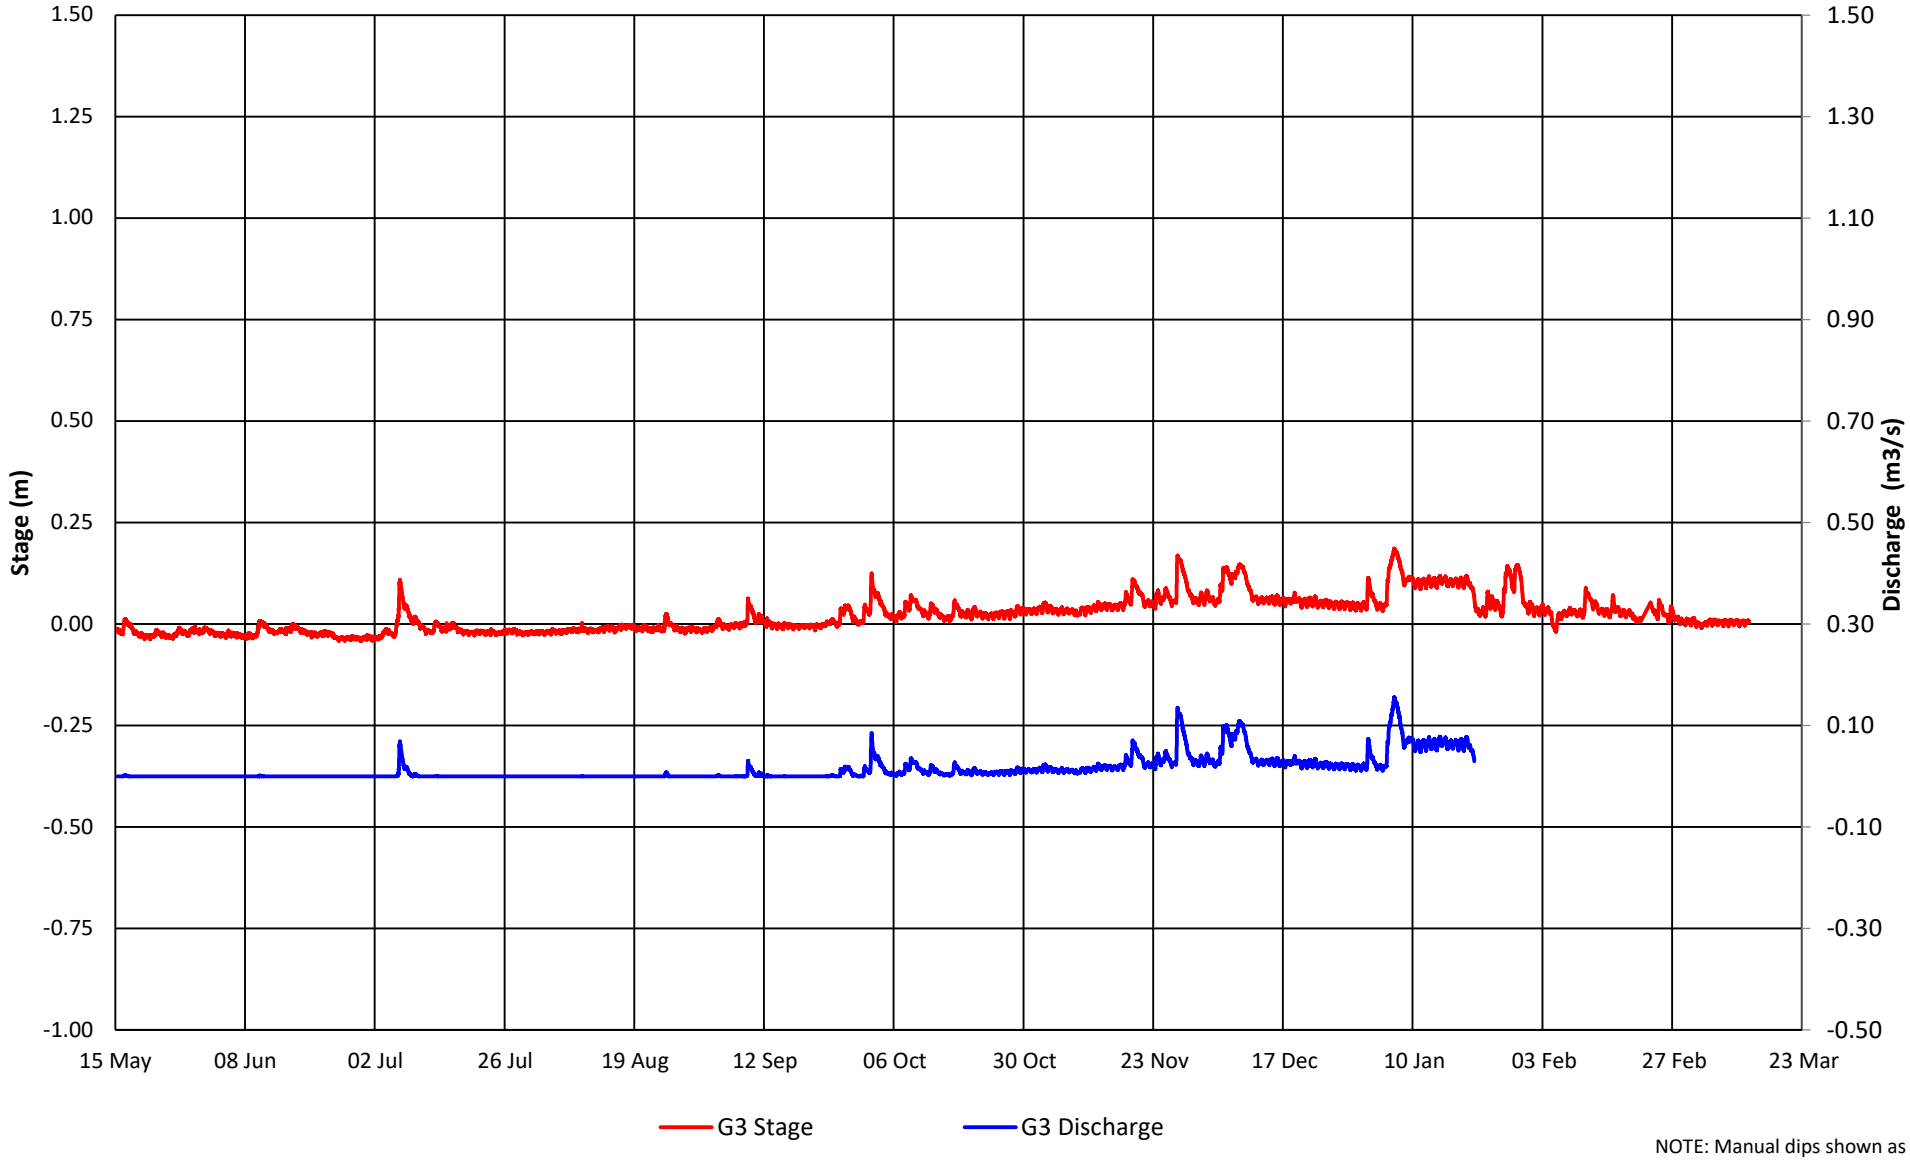


NOTE: Manual dips shown as solid markers in same colour

Figure 10: Atkins Surface Water Monitoring - G4

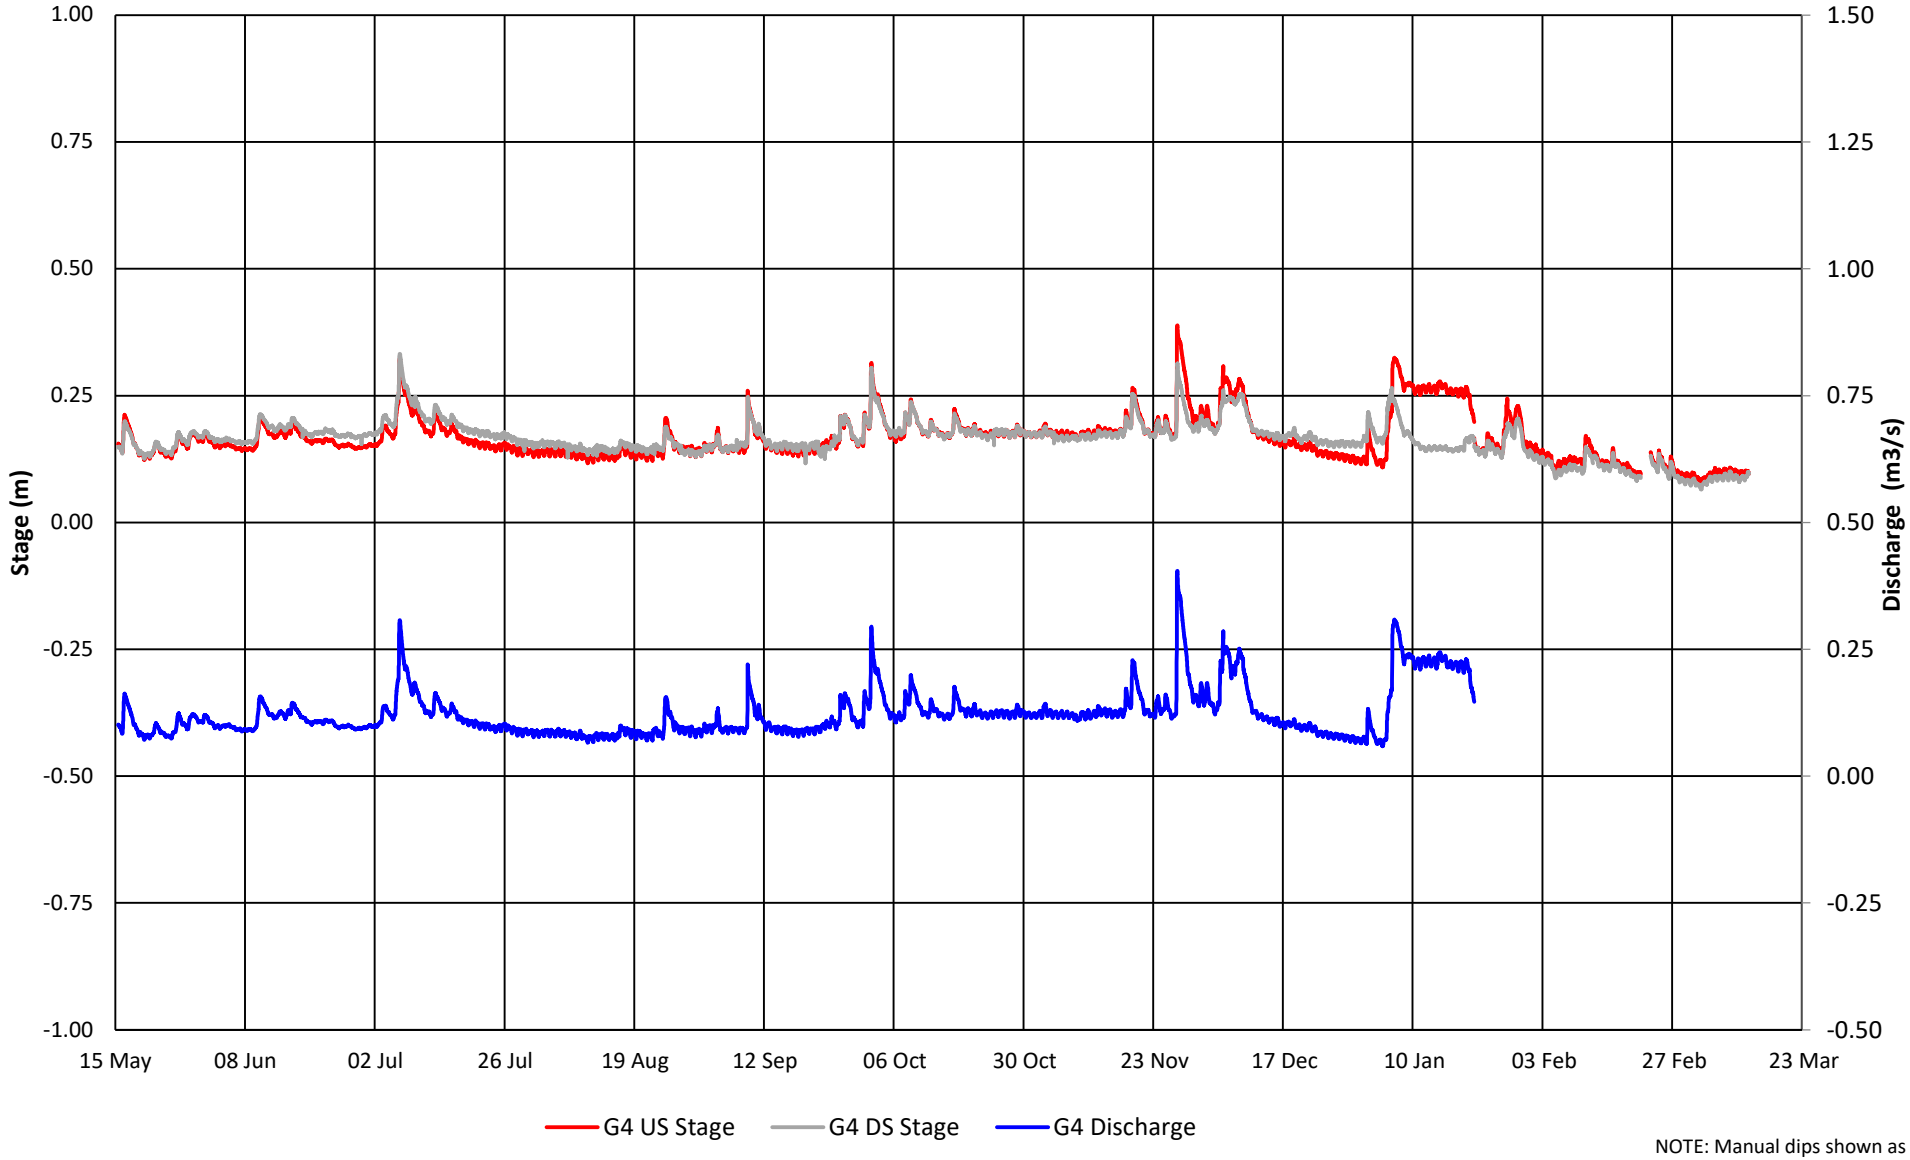


NOTE: Manual dips shown as solid markers in same colour

Figure 11: Atkins Surface Water Monitoring - G5

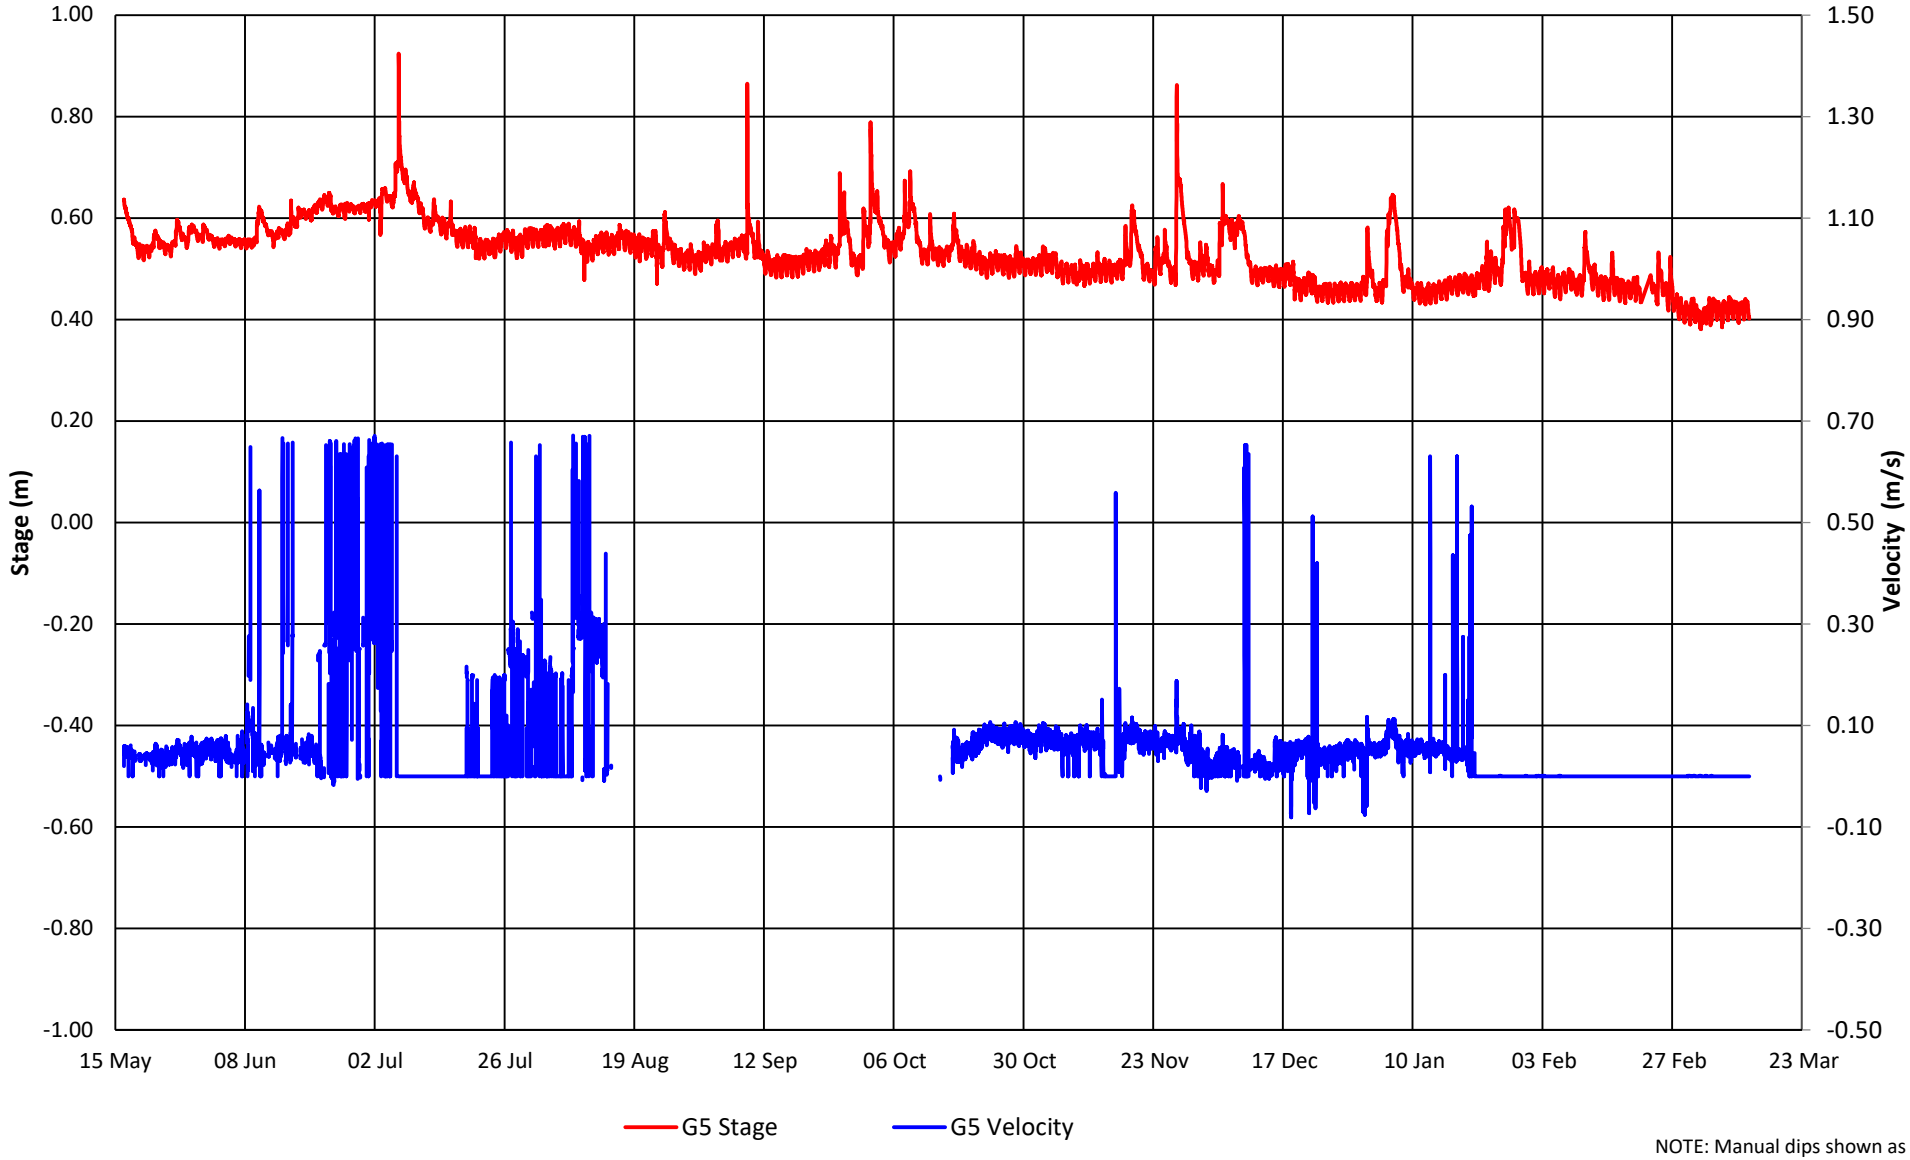


NOTE: Manual dips shown as solid markers in same colour

Figure 12: Atkins Surface Water Monitoring - G6a

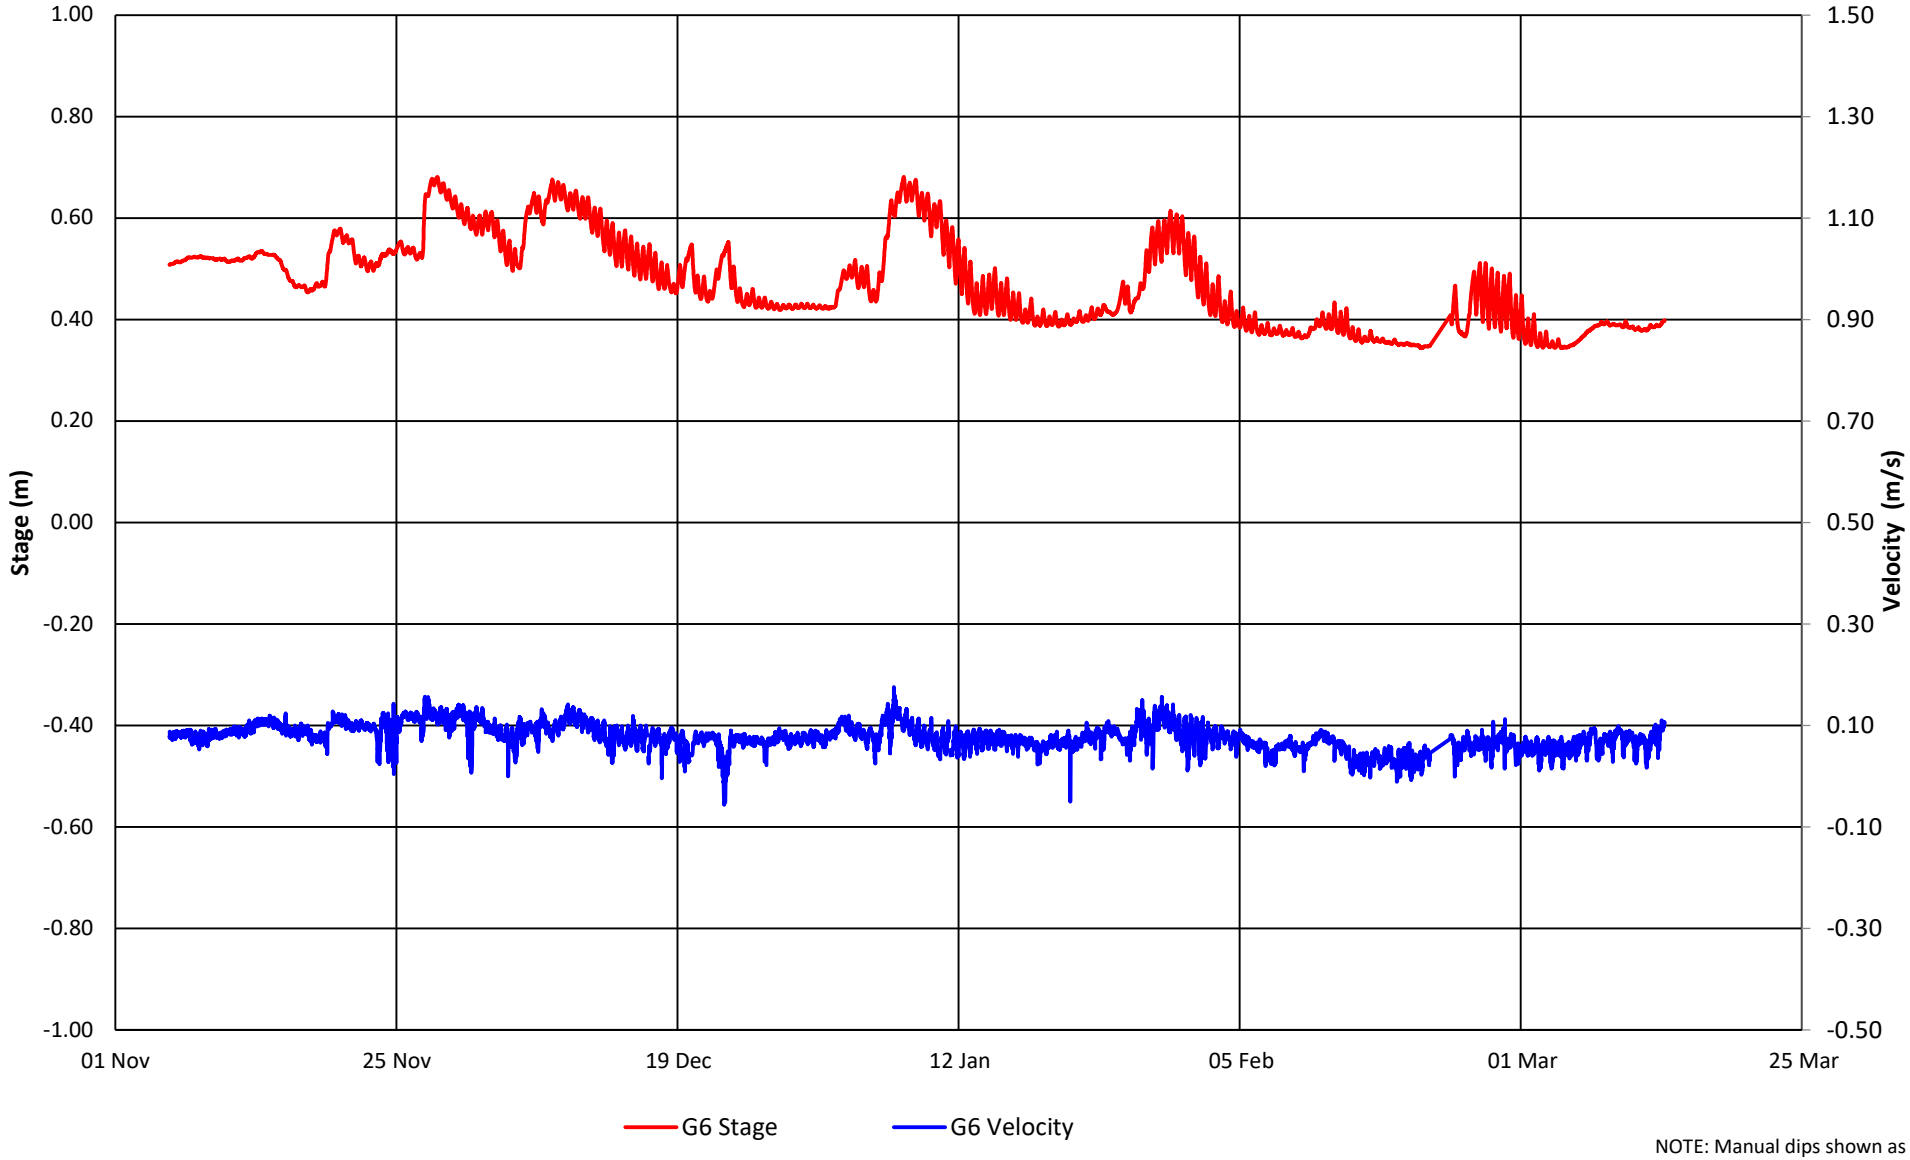


NOTE: Manual dips shown as solid markers in same colour

Figure 13: Atkins Surface Water Monitoring - G8

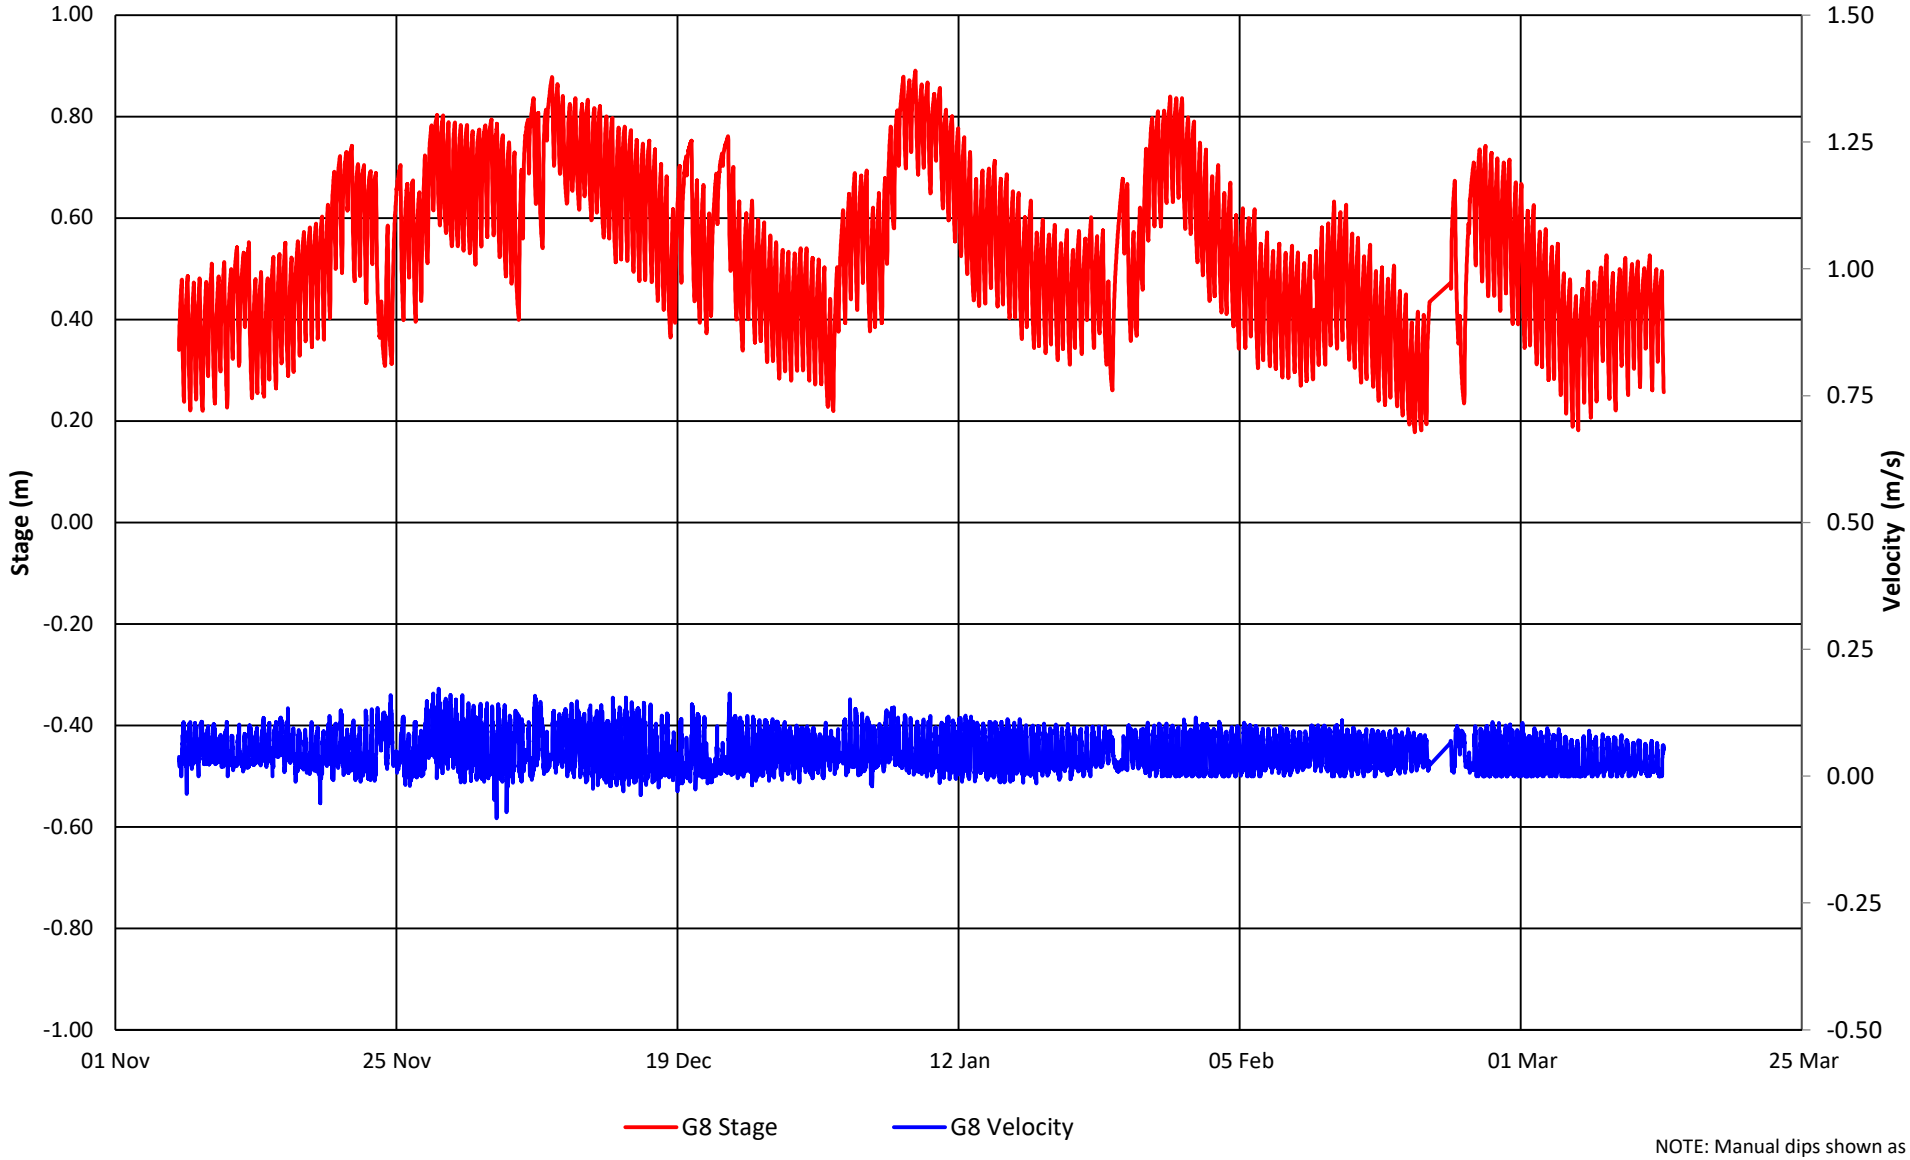

NOTE: Manual dips shown as solid markers in same colour

Figure 14: Discharge Multiparameter Testing Results

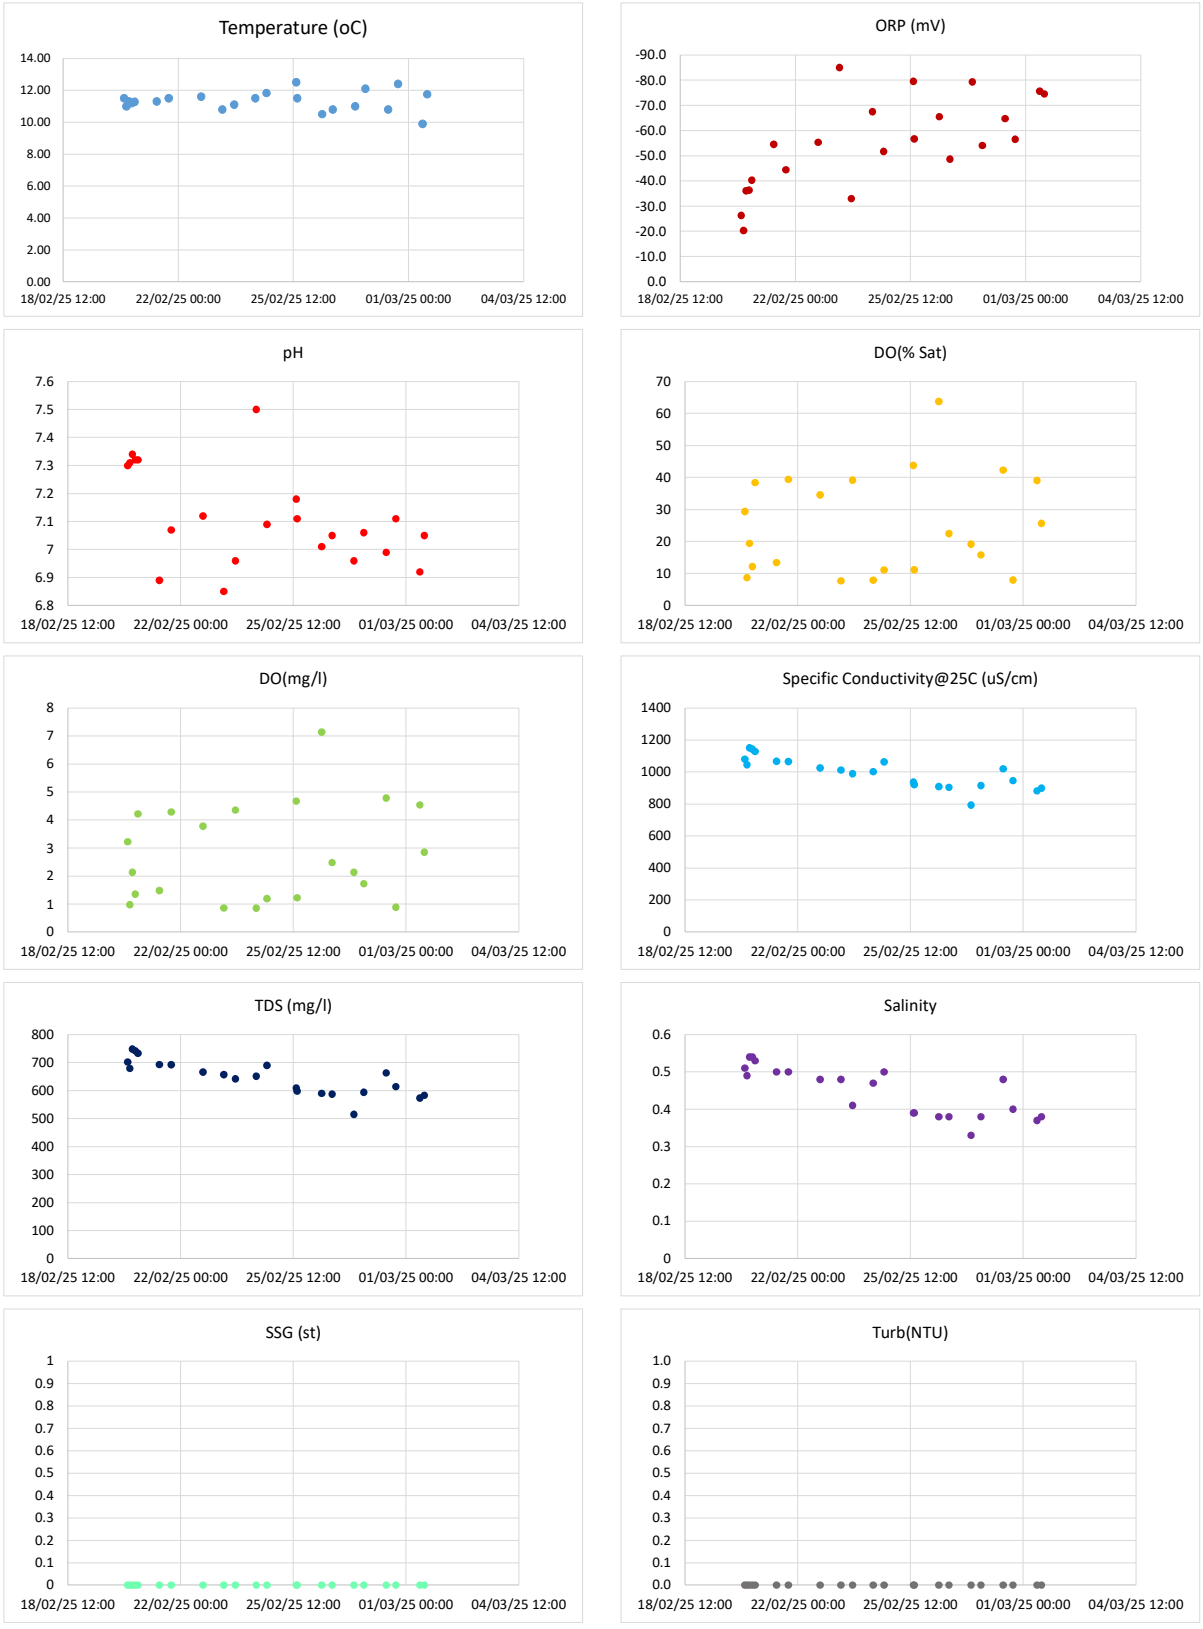

APPENDIX A: BOREHOLE LOGS

WJ UK
Expert in Water Management

Tel: +44 (0)20 8950 7256 www.wjgl.com

Borehole Number PB01

Project	Ground Level	Easting	Northing	Drilling Method
TCA Pumping Test	12.997mOD	646010.28	264972.67	Rotary open hole

Client	Drilling Contractor	Location	Scale	
Sizewell C	WJ Groundwater	Sizewell	1:139	Sheet 1 of 2

INSTALLATION | BOREHOLE RECORD

Water Strike	Well	Depth (m)	Thickness (m)	Level (mAOD)	Key	Description
			(0.60)	12.397		Made Ground
		5	(7.40)			Sand
				4.997		Sand
		10	(8.00)			
		15		-3.003		Sand with frequent shells
		20				

Backfill Details

Depth Top	Depth Base	Description
0.00	9.60	Bentonite
9.60	40.00	Sand

Hole Diameter

Depth Base (mbgl)	Diameter (mm)
40.00	508

Remarks:
Flush was reverse circulated.

Casing (OD): 508mm	Liner Size (OD/ID): 300/280mm	Slot Size: 0.5mm	Rig: Conrad C500	Prepared By: C Denny
Drilling Start: 23/01/2025	Drilling End: 28/01/2025	Lead Driller: D Ashton	Checked By: E Riley	Approved By: U Markowicz

WJ UK
Expert in Water Management

Tel: +44 (0)20 8950 7256 www.wjgl.com

Borehole Number PB01

Project	Ground Level	Easting	Northing	Drilling Method
TCA Pumping Test	12.997mOD	646010.28	264972.67	Rotary open hole

Client	Drilling Contractor	Location	Scale	
Sizewell C	WJ Groundwater	Sizewell	1:139	Sheet 2 of 2

INSTALLATION | BOREHOLE RECORD

Water Strike	Well	Depth (m)	Thickness (m)	Level (mAOD)	Key	Description
			(24.00)			Sand with frequent shells
		30				
		35				
		40		-27.003		End of Borehole at 40 m.
		45				

Backfill Details

Depth Top	Depth Base	Description
0.00	9.60	Bentonite
9.60	40.00	Sand

Hole Diameter

Depth Base (mbgl)	Diameter (mm)
40.00	508

Remarks:
Flush was reverse circulated.

Casing (OD): 508mm	Liner Size (OD/ID): 300/280mm	Slot Size: 0.5mm	Rig: Conrad C500	Prepared By: C Denny
Drilling Start: 23/01/2025	Drilling End: 28/01/2025	Lead Driller: D Ashton	Checked By: E Riley	Approved By: U Markowicz

WJ UK
Expert in Water Management

Tel: +44 (0)20 8950 7256 www.wjgl.com

Borehole Number PT01

Project	Ground Level	Easting	Northing	Drilling Method
TCA Pumping Test	13.5mOD	645927.28	264978.52	Rotary open hole

Client	Drilling Contractor	Location	Scale	
Sizewell C	WJ Groundwater	Sizewell	1:139	Sheet 1 of 1

INSTALLATION | BOREHOLE RECORD

Water Strike	Well	Depth (m)	Thickness (m)	Level (mAOD)	Key	Description
			(0.60)	12.9		Made Ground
						Sand
		5				
			(14.40)			
		10				
		15		-1.5		End of Borehole at 15 m.
		20				

Backfill Details

Depth Top	Depth Base	Description
0.00	10.00	Bentonite
10.00	15.00	Sand

Hole Diameter

Depth Base (mbgl)	Diameter (mm)
15.00	200

Remarks:
Flush was circulated conventionally.

Casing (OD): 200mm	Liner Size (OD/ID): 60/52mm	Slot Size: 1mm	Rig: Conrad C500	Prepared By: C Denny
Drilling Start: 21/01/2025	Drilling End: 22/01/2025	Lead Driller: D Ashton	Checked By: E Riley	Approved By: U Markowicz

WJ UK
Expert in Water Management

Tel: +44 (0)20 8950 7256 www.wjgl.com

Location ID


PT02

Project	Ground Level	Easting	Northing	Drilling Method
TCA Pumping Test	10.91mOD	645885.03	264823.57	Cable Percussion

Client	Location	Scale	
Sizewell C	Sizewell	1:112	Sheet 1 of 1

INSTALLATION | SAMPLES | BOREHOLE RECORD

Strike	Well	Depth (m)	Depth/Type (m)	Thickness (m)	Level (mAOD)	Key	Description
				(4.10)			Medium dense brownish orange clayey fine to medium SAND.
					+6.81		Medium dense brownish orange slightly gravelly fine to medium SAND. Gravel is fine to medium of angular flint.
				(9.40)			
					+-2.59		End of Borehole at 13.5 m.

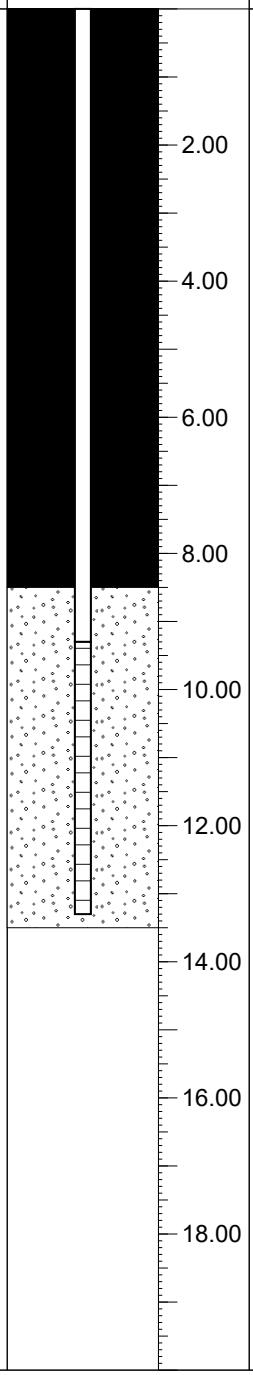

Backfill:

Depth Top	Depth Base	Description
0.00	8.50	Bentonite
8.50	13.50	Gravel

Waterstrike:

Time Elapsed (mins)	Depth Water (m)

Remarks:

Bore Size:	200mm	Liner Size:	60mm	Slot Size:	1mm	Contractor:	Wheeler Site Investigation
Drilling Start:	23/01/2025	Drilling End:	27/01/2025	Prepared By:	C Denny	Rig: Dando 2000	Lead Driller: M Barrett
						Checked By: E Riley	Approved By: U Markowicz

WJ UK
Expert in Water Management


Tel: +44 (0)20 8950 7256 www.wjgl.com

Location ID

PT05

Project	Ground Level	Easting	Northing	Drilling Method
TCA Pumping Test	3.53mOD	646479.76	265315.86	Cable Percussion

Client	Location	Scale	
Sizewell C	Sizewell	1:112	Sheet 1 of 1

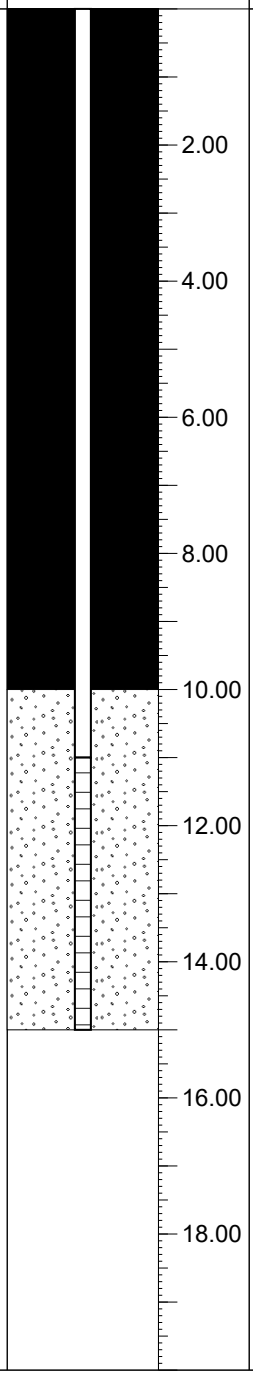

Strike	Well	Depth (m)	Depth/Type (m)	Thickness (m)	Level (mAOD)	Key	Description
				(2.15)	+1.38		Loose orangish brown fine to medium SAND.
				(2.95)	+-1.57		Medium dense brownish orange slightly gravelly fine to medium SAND. Gravel is fine to medium of angular flint.
				(4.65)	+-6.22		Medium dense brownish orange gravelly fine to medium SAND. Gravel is medium to coarse subangular to angular flint.
				(2.45)	+-8.67		Medium dense brownish orange fine to medium SAND
				(2.80)	+-11.47		Medium dense reddish orange slightly silty fine to medium SAND.
							End of Borehole at 15 m.

Backfill:

Depth Top	Depth Base	Description
0.00	10.00	Bentonite
10.00	15.00	Gravel

Waterstrike:

Time Elapsed (mins)	Depth Water (m)

Remarks:

Contractor:

Bore Size:	200mm	Liner Size:	60mm	Slot Size:	1mm	Rig:	Dando 2000	Lead Driller:	M Barrett
Drilling Start:	20/01/2025	Drilling End:	23/01/2025	Prepared By:	C Denny	Checked By:	E Riley	Approved By:	U Markowicz

APPENDIX B: DATALOGGED WATER LEVEL AND FLOW DATA

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	**l/s**	
Units	mOD	mOD	l/s	
11/02/2025 12:00	1.53	1.53	0.00	
11/02/2025 12:00	1.53	1.53	0.00	
11/02/2025 12:01	1.53	1.53	0.00	
11/02/2025 12:01	1.53	1.53	0.00	
11/02/2025 12:02	1.53	1.53	0.00	
11/02/2025 12:02	1.53	1.53	0.00	
11/02/2025 12:03	1.53	1.53	0.00	
11/02/2025 12:03	1.53	1.53	0.00	
11/02/2025 12:04	1.53	1.53	0.00	
11/02/2025 12:04	1.53	1.53	0.00	
11/02/2025 12:05	1.53	1.53	0.00	
11/02/2025 12:05	1.53	1.53	0.00	
11/02/2025 12:06	1.53	1.53	0.00	
11/02/2025 12:06	1.53	1.53	0.00	
11/02/2025 12:07	1.53	1.53	0.00	
11/02/2025 12:07	1.53	1.53	0.00	
11/02/2025 12:08	1.53	1.53	0.00	
11/02/2025 12:08	1.53	1.53	0.00	
11/02/2025 12:09	1.53	1.53	0.00	
11/02/2025 12:09	1.53	1.53	0.00	
11/02/2025 12:10	1.53	1.53	0.00	
11/02/2025 12:11	1.53	1.53	0.00	
11/02/2025 12:12	1.53	1.58	0.00	
11/02/2025 12:13	1.53	1.53	0.00	
11/02/2025 12:14	1.53	1.53	0.00	
11/02/2025 12:15	1.53	1.53	0.00	
11/02/2025 12:16	1.53	1.53	0.00	
11/02/2025 12:17	1.53	1.53	0.00	
11/02/2025 12:18	1.53	1.53	0.00	
11/02/2025 12:19	1.53	1.53	0.00	
11/02/2025 12:20	1.53	1.53	0.00	
11/02/2025 12:22	1.53	1.53	0.00	
11/02/2025 12:24	1.53	1.53	0.00	
11/02/2025 12:26	1.53	1.53	0.00	
11/02/2025 12:28	1.53	1.53	0.00	
11/02/2025 12:30	1.53	1.53	0.00	
11/02/2025 12:32	1.53	1.53	0.00	
11/02/2025 12:34	1.53	1.53	0.00	
11/02/2025 12:36	1.53	1.53	0.00	
11/02/2025 12:38	1.53	1.53	0.00	
11/02/2025 12:40	1.53	1.53	0.00	
11/02/2025 12:45	1.53	1.53	0.00	
11/02/2025 12:50	1.53	1.53	0.00	
11/02/2025 12:55	1.53	1.53	0.00	
11/02/2025 13:00	1.53	1.53	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
11/02/2025 13:15	1.53	1.53	0.00	
11/02/2025 13:30	1.53	1.53	0.00	
11/02/2025 13:45	1.53	1.53	0.00	
11/02/2025 14:00	1.53	1.53	0.00	
11/02/2025 14:15	1.54	1.53	0.00	
11/02/2025 14:30	1.53	1.53	0.00	
11/02/2025 14:45	1.53	1.53	0.00	
11/02/2025 15:00	1.53	1.53	0.00	
11/02/2025 15:15	1.53	1.53	0.00	
11/02/2025 15:30	1.53	1.53	0.00	
11/02/2025 15:45	1.53	1.53	0.00	
11/02/2025 16:00	1.53	1.53	0.00	
11/02/2025 16:15	1.53	1.53	0.00	
11/02/2025 16:30	1.53	1.53	0.00	
11/02/2025 16:45	1.53	1.53	0.00	
11/02/2025 17:00	1.53	1.53	0.00	
11/02/2025 17:15	1.53	1.53	0.00	
11/02/2025 17:30	1.53	1.53	0.00	
11/02/2025 17:45	1.53	1.53	0.00	
11/02/2025 18:00	1.53	1.53	0.00	
11/02/2025 18:15	1.53	1.53	0.00	
11/02/2025 18:30	1.53	1.53	0.00	
11/02/2025 18:45	1.53	1.53	0.00	
11/02/2025 19:00	1.53	1.53	0.00	
11/02/2025 19:15	1.53	1.53	0.00	
11/02/2025 19:30	1.53	1.53	0.00	
11/02/2025 19:45	1.53	1.53	0.00	
11/02/2025 20:00	1.53	1.53	0.00	
11/02/2025 20:15	1.53	1.53	0.00	
11/02/2025 20:30	1.53	1.53	0.00	
11/02/2025 20:45	1.53	1.53	0.00	
11/02/2025 21:00	1.53	1.53	0.00	
11/02/2025 21:15	1.52	1.53	0.00	
11/02/2025 21:30	1.53	1.53	0.00	
11/02/2025 21:45	1.53	1.53	0.00	
11/02/2025 22:00	1.52	1.53	0.00	
11/02/2025 22:15	1.52	1.52	0.00	
11/02/2025 22:30	1.52	1.53	0.00	
11/02/2025 22:45	1.52	1.53	0.00	
11/02/2025 23:00	1.52	1.53	0.00	
11/02/2025 23:15	1.52	1.53	0.00	
11/02/2025 23:30	1.53	1.53	0.00	
11/02/2025 23:45	1.53	1.53	0.00	
12/02/2025 00:00	1.52	1.53	0.00	
12/02/2025 00:15	1.52	1.53	0.00	
12/02/2025 00:30	1.53	1.53	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
12/02/2025 00:45	1.52	1.53	0.00	
12/02/2025 01:00	1.52	1.53	0.00	
12/02/2025 01:15	1.52	1.53	0.00	
12/02/2025 01:30	1.52	1.53	0.00	
12/02/2025 01:45	1.52	1.53	0.00	
12/02/2025 02:00	1.52	1.53	0.00	
12/02/2025 02:15	1.52	1.53	0.00	
12/02/2025 02:30	1.52	1.53	0.00	
12/02/2025 02:45	1.52	1.53	0.00	
12/02/2025 03:00	1.52	1.53	0.00	
12/02/2025 03:15	1.52	1.53	0.00	
12/02/2025 03:30	1.52	1.53	0.00	
12/02/2025 03:45	1.52	1.53	0.00	
12/02/2025 04:00	1.52	1.53	0.00	
12/02/2025 04:15	1.52	1.53	0.00	
12/02/2025 04:30	1.52	1.53	0.00	
12/02/2025 04:45	1.52	1.53	0.00	
12/02/2025 05:00	1.52	1.53	0.00	
12/02/2025 05:15	1.52	1.53	0.00	
12/02/2025 05:30	1.52	1.53	0.00	
12/02/2025 05:45	1.52	1.53	0.00	
12/02/2025 06:00	1.52	1.53	0.00	
12/02/2025 06:15	1.52	1.53	0.00	
12/02/2025 06:30	1.52	1.53	0.00	
12/02/2025 06:45	1.52	1.53	0.00	
12/02/2025 07:00	1.52	1.53	0.00	
12/02/2025 07:15	1.52	1.53	0.00	
12/02/2025 07:30	1.52	1.52	0.00	
12/02/2025 07:45	1.52	1.53	0.00	
12/02/2025 08:00	1.52	1.52	0.00	
12/02/2025 08:15	1.52	1.53	0.00	
12/02/2025 08:30	1.52	1.53	0.00	
12/02/2025 08:45	1.52	1.52	0.00	
12/02/2025 09:00	1.52	1.52	0.00	
12/02/2025 09:15	1.52	1.52	0.00	
12/02/2025 09:30	1.52	1.52	0.00	
12/02/2025 09:45	1.52	1.52	0.00	
12/02/2025 10:00	1.52	1.52	0.00	
12/02/2025 10:15	1.52	1.52	0.00	
12/02/2025 10:30	1.52	1.52	0.00	
12/02/2025 10:45	1.52	1.52	0.00	
12/02/2025 11:00	1.52	1.52	0.00	
12/02/2025 11:15	1.52	1.52	0.00	
12/02/2025 11:30	1.52	1.52	0.00	
12/02/2025 11:45	1.52	1.53	0.00	
12/02/2025 12:00	1.52	1.53	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
12/02/2025 12:15	1.52	1.53	0.00	
12/02/2025 12:30	1.52	1.53	0.00	
12/02/2025 12:45	1.52	1.53	0.00	
12/02/2025 13:00	1.52	1.52	0.00	
12/02/2025 13:15	1.52	1.53	0.00	
12/02/2025 13:30	1.52	1.52	0.00	
12/02/2025 13:45	1.52	1.53	0.00	
12/02/2025 14:00	1.52	1.52	0.00	
12/02/2025 14:15	1.52	1.52	0.04	
12/02/2025 14:30	1.51	1.52	0.02	
12/02/2025 14:45	1.52	1.52	0.02	
12/02/2025 15:00	1.51	1.52	0.01	
12/02/2025 15:15	1.51	1.52	0.00	
12/02/2025 15:30	1.51	1.52	0.00	
12/02/2025 15:45	1.51	1.52	0.00	
12/02/2025 16:00	1.51	1.52	0.00	
12/02/2025 16:15	1.51	1.52	0.00	
12/02/2025 16:30	1.51	1.52	0.00	
12/02/2025 16:45	1.51	1.52	0.00	
12/02/2025 17:00	1.51	1.52	0.00	
12/02/2025 17:15	1.51	1.52	0.00	
12/02/2025 17:30	1.51	1.52	0.00	
12/02/2025 17:45	1.51	1.52	0.00	
12/02/2025 18:00	1.51	1.52	0.00	
12/02/2025 18:15	1.51	1.52	0.00	
12/02/2025 18:30	1.51	1.52	0.00	
12/02/2025 18:45	1.51	1.52	0.00	
12/02/2025 19:00	1.51	1.52	0.00	
12/02/2025 19:15	1.51	1.52	0.00	
12/02/2025 19:30	1.51	1.52	0.00	
12/02/2025 19:45	1.51	1.52	0.00	
12/02/2025 20:00	1.51	1.52	0.00	
12/02/2025 20:15	1.51	1.52	0.00	
12/02/2025 20:30	1.51	1.52	0.00	
12/02/2025 20:45	1.51	1.52	0.00	
12/02/2025 21:00	1.51	1.52	0.00	
12/02/2025 21:15	1.51	1.52	0.00	
12/02/2025 21:30	1.51	1.52	0.00	
12/02/2025 21:45	1.51	1.52	0.00	
12/02/2025 22:00	1.51	1.52	0.00	
12/02/2025 22:15	1.51	1.52	0.00	
12/02/2025 22:30	1.51	1.52	0.00	
12/02/2025 22:45	1.51	1.52	0.00	
12/02/2025 23:00	1.51	1.52	0.00	
12/02/2025 23:15	1.51	1.52	0.00	
12/02/2025 23:30	1.51	1.52	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
12/02/2025 23:45	1.51	1.52	0.00	
13/02/2025 00:00	1.51	1.52	0.00	
13/02/2025 00:15	1.51	1.52	0.00	
13/02/2025 00:30	1.51	1.52	0.00	
13/02/2025 00:45	1.51	1.52	0.00	
13/02/2025 01:00	1.51	1.52	0.00	
13/02/2025 01:15	1.51	1.52	0.00	
13/02/2025 01:30	1.51	1.52	0.00	
13/02/2025 01:45	1.51	1.52	0.00	
13/02/2025 02:00	1.51	1.52	0.00	
13/02/2025 02:15	1.51	1.52	0.00	
13/02/2025 02:30	1.51	1.52	0.00	
13/02/2025 02:45	1.51	1.52	0.00	
13/02/2025 03:00	1.51	1.52	0.00	
13/02/2025 03:15	1.51	1.52	0.00	
13/02/2025 03:30	1.51	1.52	0.00	
13/02/2025 03:45	1.51	1.52	0.00	
13/02/2025 04:00	1.51	1.52	0.00	
13/02/2025 04:15	1.51	1.52	0.00	
13/02/2025 04:30	1.50	1.52	0.00	
13/02/2025 04:45	1.50	1.52	0.00	
13/02/2025 05:00	1.50	1.52	0.00	
13/02/2025 05:15	1.50	1.52	0.00	
13/02/2025 05:30	1.50	1.52	0.00	
13/02/2025 05:45	1.50	1.52	0.00	
13/02/2025 06:00	1.50	1.52	0.00	
13/02/2025 06:15	1.50	1.52	0.00	
13/02/2025 06:30	1.50	1.52	0.00	
13/02/2025 06:45	1.50	1.52	0.00	
13/02/2025 07:00	1.50	1.52	0.00	
13/02/2025 07:15	1.50	1.52	0.00	
13/02/2025 07:30	1.50	1.52	0.00	
13/02/2025 07:45	1.50	1.52	0.00	
13/02/2025 08:00	1.50	1.52	0.00	
13/02/2025 08:15	1.50	1.52	0.00	
13/02/2025 08:30	1.50	1.52	0.00	
13/02/2025 08:45	1.50	1.52	0.00	
13/02/2025 09:00	1.50	1.52	0.00	
13/02/2025 09:15	1.50	1.52	0.00	
13/02/2025 09:30	1.50	1.52	0.00	
13/02/2025 09:45	1.50	1.52	0.00	
13/02/2025 10:00	1.50	1.52	0.00	
13/02/2025 10:15	1.50	1.52	0.00	
13/02/2025 10:30	1.50	1.52	0.00	
13/02/2025 10:45	1.50	1.52	0.00	
13/02/2025 11:00	1.50	1.52	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
13/02/2025 11:15	1.50	1.52	0.00	
13/02/2025 11:30	1.50	1.52	0.00	
13/02/2025 11:45	1.50	1.52	0.00	
13/02/2025 12:00	1.50	1.52	0.00	
13/02/2025 12:15	1.50	1.52	0.04	
13/02/2025 12:30	1.50	1.52	0.02	
13/02/2025 12:45	1.14	1.52	4.35	
13/02/2025 13:00	1.12	1.52	4.33	
13/02/2025 13:11	1.11	1.52	4.40	
13/02/2025 13:11	1.11	1.52	4.39	
13/02/2025 13:12	1.11	1.52	4.39	
13/02/2025 13:12	1.11	1.52	4.38	
13/02/2025 13:13	1.10	1.52	4.47	
13/02/2025 13:13	1.11	1.52	4.47	
13/02/2025 13:14	1.10	1.52	4.48	
13/02/2025 13:14	1.11	1.52	4.49	
13/02/2025 13:15	1.11	1.52	4.48	
13/02/2025 13:15	1.10	1.52	4.47	
13/02/2025 13:16	1.10	1.52	4.49	
13/02/2025 13:16	1.10	1.52	4.47	
13/02/2025 13:17	1.10	1.52	4.48	
13/02/2025 13:17	1.11	1.52	4.47	
13/02/2025 13:18	1.10	1.52	4.46	
13/02/2025 13:18	1.11	1.52	4.47	
13/02/2025 13:19	1.11	1.52	4.46	
13/02/2025 13:19	1.10	1.52	4.48	
13/02/2025 13:20	1.11	1.52	4.48	
13/02/2025 13:20	1.12	1.52	4.39	
13/02/2025 13:21	1.15	1.52	3.72	
13/02/2025 13:22	1.21	1.52	2.87	
13/02/2025 13:23	1.23	1.52	2.78	
13/02/2025 13:24	0.83	1.52	8.60	
13/02/2025 13:25	1.21	1.52	2.97	
13/02/2025 13:26	1.22	1.52	3.24	
13/02/2025 13:27	1.24	1.52	2.77	
13/02/2025 13:28	1.25	1.52	2.77	
13/02/2025 13:29	1.25	1.52	2.76	
13/02/2025 13:31	1.33	1.52	2.76	
13/02/2025 13:31	1.46	1.52	0.32	
13/02/2025 13:32	1.47	1.52	0.31	
13/02/2025 13:32	1.48	1.52	0.31	
13/02/2025 13:33	1.48	1.52	0.31	
13/02/2025 13:33	1.49	1.52	0.31	
13/02/2025 13:34	1.49	1.52	0.18	
13/02/2025 13:34	1.49	1.52	0.43	
13/02/2025 13:35	1.49	1.52	0.24	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
13/02/2025 13:35	1.49	1.52	0.18	
13/02/2025 13:36	1.49	1.52	0.14	
13/02/2025 13:36	1.49	1.52	0.12	
13/02/2025 13:37	1.49	1.52	0.09	
13/02/2025 13:37	1.49	1.52	0.06	
13/02/2025 13:38	1.49	1.52	0.05	
13/02/2025 13:38	1.49	1.52	0.02	
13/02/2025 13:39	1.49	1.52	0.01	
13/02/2025 13:39	1.49	1.52	0.01	
13/02/2025 13:40	1.49	1.52	0.01	
13/02/2025 13:40	1.49	1.52	0.00	
13/02/2025 13:41	1.49	1.52	0.00	
13/02/2025 13:42	1.48	1.52	0.00	
13/02/2025 13:43	1.48	1.52	0.00	
13/02/2025 13:44	1.48	1.52	0.00	
13/02/2025 13:45	1.48	1.52	0.00	
13/02/2025 13:46	1.48	1.52	0.00	
13/02/2025 13:47	1.48	1.52	0.00	
13/02/2025 13:48	1.48	1.52	0.00	
13/02/2025 13:49	1.48	1.52	0.00	
13/02/2025 13:50	1.48	1.52	0.00	
13/02/2025 13:51	1.48	1.52	0.00	
13/02/2025 13:53	1.48	1.52	0.00	
13/02/2025 13:55	1.48	1.52	0.00	
13/02/2025 13:57	1.48	1.52	0.00	
13/02/2025 13:59	1.48	1.52	0.00	
13/02/2025 14:01	1.48	1.52	0.00	
13/02/2025 14:03	1.48	1.52	0.00	
13/02/2025 14:05	1.48	1.52	0.00	
13/02/2025 14:07	1.47	1.52	0.00	
13/02/2025 14:09	1.47	1.52	0.00	
13/02/2025 14:11	1.47	1.52	0.00	
13/02/2025 14:16	1.47	1.52	0.00	
13/02/2025 14:21	1.47	1.52	0.00	
13/02/2025 14:26	1.47	1.52	0.00	
13/02/2025 14:31	1.47	1.52	0.00	
13/02/2025 14:46	1.48	1.52	0.00	
13/02/2025 15:01	1.48	1.52	0.00	
13/02/2025 15:16	1.48	1.52	0.00	
13/02/2025 15:31	1.48	1.52	0.00	
13/02/2025 15:46	1.48	1.52	0.00	
13/02/2025 16:01	1.48	1.52	0.00	
13/02/2025 16:16	1.48	1.52	0.00	
13/02/2025 16:31	1.48	1.52	0.00	
13/02/2025 16:46	1.48	1.52	0.00	
13/02/2025 17:01	1.48	1.52	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
13/02/2025 17:16	1.48	1.52	0.00	
13/02/2025 17:31	1.48	1.52	0.00	
13/02/2025 17:46	1.48	1.52	0.00	
13/02/2025 18:01	1.48	1.52	0.00	
13/02/2025 18:16	1.48	1.52	0.00	
13/02/2025 18:31	1.48	1.52	0.00	
13/02/2025 18:46	1.49	1.52	0.00	
13/02/2025 19:01	1.48	1.52	0.00	
13/02/2025 19:16	1.48	1.52	0.00	
13/02/2025 19:31	1.49	1.52	0.00	
13/02/2025 19:46	1.49	1.52	0.00	
13/02/2025 20:01	1.49	1.52	0.00	
13/02/2025 20:16	1.49	1.52	0.00	
13/02/2025 20:31	1.49	1.52	0.00	
13/02/2025 20:46	1.49	1.52	0.00	
13/02/2025 21:01	1.49	1.52	0.00	
13/02/2025 21:16	1.49	1.52	0.00	
13/02/2025 21:31	1.49	1.52	0.00	
13/02/2025 21:46	1.49	1.52	0.00	
13/02/2025 22:01	1.49	1.52	0.00	
13/02/2025 22:16	1.49	1.52	0.00	
13/02/2025 22:31	1.49	1.52	0.00	
13/02/2025 22:46	1.49	1.52	0.00	
13/02/2025 23:01	1.49	1.52	0.00	
13/02/2025 23:16	1.49	1.52	0.00	
13/02/2025 23:31	1.49	1.52	0.00	
13/02/2025 23:46	1.49	1.52	0.00	
14/02/2025 00:01	1.49	1.52	0.00	
14/02/2025 00:16	1.49	1.52	0.00	
14/02/2025 00:31	1.49	1.52	0.00	
14/02/2025 00:46	1.49	1.52	0.00	
14/02/2025 01:01	1.49	1.52	0.00	
14/02/2025 01:16	1.49	1.52	0.00	
14/02/2025 01:31	1.49	1.52	0.00	
14/02/2025 01:46	1.49	1.52	0.00	
14/02/2025 02:01	1.49	1.52	0.00	
14/02/2025 02:16	1.49	1.52	0.00	
14/02/2025 02:31	1.49	1.52	0.00	
14/02/2025 02:46	1.49	1.52	0.00	
14/02/2025 03:01	1.49	1.52	0.00	
14/02/2025 03:16	1.49	1.52	0.00	
14/02/2025 03:31	1.49	1.52	0.00	
14/02/2025 03:46	1.49	1.52	0.00	
14/02/2025 04:01	1.49	1.52	0.00	
14/02/2025 04:16	1.49	1.52	0.00	
14/02/2025 04:31	1.49	1.52	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
14/02/2025 04:46	1.49	1.52	0.00	
14/02/2025 05:01	1.49	1.52	0.00	
14/02/2025 05:16	1.49	1.52	0.00	
14/02/2025 05:31	1.49	1.52	0.00	
14/02/2025 05:46	1.49	1.52	0.00	
14/02/2025 06:01	1.49	1.52	0.00	
14/02/2025 06:16	1.49	1.52	0.00	
14/02/2025 06:31	1.49	1.52	0.00	
14/02/2025 06:46	1.48	1.51	0.00	
14/02/2025 07:01	1.48	1.51	0.00	
14/02/2025 07:16	1.48	1.51	0.00	
14/02/2025 07:31	1.48	1.51	0.00	
14/02/2025 07:46	1.48	1.51	0.00	
14/02/2025 08:01	1.48	1.52	0.00	
14/02/2025 08:16	1.48	1.52	0.00	
14/02/2025 08:31	1.48	1.52	0.00	
14/02/2025 08:46	1.48	1.52	0.00	
14/02/2025 09:01	1.48	1.52	0.00	
14/02/2025 09:16	1.48	1.51	0.00	
14/02/2025 09:31	1.48	1.52	0.00	
14/02/2025 09:46	1.48	1.51	0.00	
14/02/2025 10:01	1.48	1.52	0.00	
14/02/2025 10:16	1.48	1.51	0.00	
14/02/2025 10:31	1.48	1.51	0.00	
14/02/2025 10:46	1.48	1.52	0.00	
14/02/2025 11:01	1.48	1.52	0.00	
14/02/2025 11:16	1.48	1.52	0.00	
14/02/2025 11:31	1.48	1.52	0.00	
14/02/2025 11:46	1.49	1.52	0.00	
14/02/2025 12:01	1.48	1.52	0.00	
14/02/2025 12:16	1.48	1.52	0.00	
14/02/2025 12:31	1.48	1.52	0.00	
14/02/2025 12:46	1.48	1.52	0.00	
14/02/2025 13:01	1.48	1.52	0.00	
14/02/2025 13:16	1.49	1.52	0.00	
14/02/2025 13:31	1.49	1.52	0.00	
14/02/2025 13:46	1.49	1.52	0.00	
14/02/2025 14:01	1.49	1.52	0.00	
14/02/2025 14:16	1.49	1.52	0.00	
14/02/2025 14:31	1.49	1.52	0.00	
14/02/2025 14:46	1.49	1.52	0.00	
14/02/2025 15:01	1.49	1.52	0.00	
14/02/2025 15:16	1.49	1.52	0.00	
14/02/2025 15:31	1.49	1.52	0.00	
14/02/2025 15:46	1.48	1.52	0.00	
14/02/2025 16:01	1.48	1.52	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
14/02/2025 16:16	1.49	1.52	0.00	
14/02/2025 16:31	1.49	1.52	0.00	
14/02/2025 16:46	1.49	1.52	0.00	
14/02/2025 17:01	1.49	1.52	0.00	
14/02/2025 17:16	1.48	1.52	0.00	
14/02/2025 17:31	1.48	1.52	0.00	
14/02/2025 17:46	1.48	1.52	0.00	
14/02/2025 18:01	1.48	1.52	0.00	
14/02/2025 18:16	1.48	1.52	0.00	
14/02/2025 18:31	1.48	1.51	0.00	
14/02/2025 18:46	1.48	1.52	0.00	
14/02/2025 19:01	1.48	1.52	0.00	
14/02/2025 19:16	1.48	1.52	0.00	
14/02/2025 19:31	1.48	1.52	0.00	
14/02/2025 19:46	1.48	1.52	0.00	
14/02/2025 20:01	1.48	1.52	0.00	
14/02/2025 20:16	1.48	1.52	0.00	
14/02/2025 20:31	1.48	1.52	0.00	
14/02/2025 20:46	1.48	1.52	0.00	
14/02/2025 21:01	1.48	1.52	0.00	
14/02/2025 21:16	1.48	1.52	0.00	
14/02/2025 21:31	1.48	1.52	0.00	
14/02/2025 21:46	1.48	1.52	0.00	
14/02/2025 22:01	1.48	1.52	0.00	
14/02/2025 22:16	1.48	1.52	0.00	
14/02/2025 22:31	1.48	1.52	0.00	
14/02/2025 22:46	1.48	1.52	0.00	
14/02/2025 23:01	1.48	1.52	0.00	
14/02/2025 23:16	1.48	1.52	0.00	
14/02/2025 23:31	1.48	1.52	0.00	
14/02/2025 23:46	1.48	1.52	0.00	
15/02/2025 00:01	1.49	1.52	0.00	
15/02/2025 00:16	1.48	1.52	0.00	
15/02/2025 00:31	1.48	1.52	0.00	
15/02/2025 00:46	1.48	1.52	0.00	
15/02/2025 01:01	1.48	1.52	0.00	
15/02/2025 01:16	1.48	1.52	0.00	
15/02/2025 01:31	1.48	1.52	0.00	
15/02/2025 01:46	1.48	1.52	0.00	
15/02/2025 02:01	1.49	1.52	0.00	
15/02/2025 02:16	1.48	1.52	0.00	
15/02/2025 02:31	1.49	1.52	0.00	
15/02/2025 02:46	1.48	1.52	0.00	
15/02/2025 03:01	1.48	1.52	0.00	
15/02/2025 03:16	1.48	1.52	0.00	
15/02/2025 03:31	1.48	1.52	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
15/02/2025 03:46	1.48	1.52	0.00	
15/02/2025 04:01	1.48	1.52	0.00	
15/02/2025 04:16	1.48	1.52	0.00	
15/02/2025 04:31	1.48	1.52	0.00	
15/02/2025 04:46	1.48	1.52	0.00	
15/02/2025 05:01	1.48	1.52	0.00	
15/02/2025 05:16	1.48	1.52	0.00	
15/02/2025 05:31	1.48	1.52	0.00	
15/02/2025 05:46	1.48	1.52	0.00	
15/02/2025 06:01	1.48	1.52	0.00	
15/02/2025 06:16	1.48	1.52	0.00	
15/02/2025 06:31	1.48	1.52	0.00	
15/02/2025 06:46	1.48	1.52	0.00	
15/02/2025 07:01	1.48	1.52	0.00	
15/02/2025 07:16	1.48	1.52	0.00	
15/02/2025 07:31	1.48	1.52	0.00	
15/02/2025 07:46	1.48	1.52	0.00	
15/02/2025 08:01	1.48	1.52	0.00	
15/02/2025 08:16	1.48	1.52	0.00	
15/02/2025 08:31	1.48	1.52	0.00	
15/02/2025 08:46	1.48	1.52	0.00	
15/02/2025 09:01	1.48	1.52	0.00	
15/02/2025 09:16	1.48	1.52	0.00	
15/02/2025 09:31	1.48	1.52	0.00	
15/02/2025 09:46	1.48	1.52	0.00	
15/02/2025 10:01	1.48	1.52	0.00	
15/02/2025 10:16	1.48	1.52	0.00	
15/02/2025 10:31	1.48	1.52	0.00	
15/02/2025 10:46	1.48	1.52	0.00	
15/02/2025 11:01	1.48	1.52	0.00	
15/02/2025 11:16	1.48	1.52	0.00	
15/02/2025 11:31	1.48	1.52	0.00	
15/02/2025 11:46	1.48	1.52	0.00	
15/02/2025 12:01	1.48	1.52	0.00	
15/02/2025 12:16	1.48	1.52	0.00	
15/02/2025 12:31	1.48	1.52	0.00	
15/02/2025 12:46	1.48	1.52	0.00	
15/02/2025 13:01	1.48	1.52	0.00	
15/02/2025 13:16	1.48	1.52	0.00	
15/02/2025 13:31	1.48	1.52	0.00	
15/02/2025 13:46	1.48	1.52	0.00	
15/02/2025 14:01	1.48	1.52	0.00	
15/02/2025 14:16	1.48	1.52	0.00	
15/02/2025 14:31	1.48	1.52	0.00	
15/02/2025 14:46	1.48	1.52	0.00	
15/02/2025 15:01	1.48	1.52	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
15/02/2025 15:16	1.48	1.52	0.00	
15/02/2025 15:31	1.48	1.52	0.00	
15/02/2025 15:46	1.48	1.52	0.00	
15/02/2025 16:01	1.48	1.52	0.00	
15/02/2025 16:16	1.48	1.52	0.00	
15/02/2025 16:31	1.48	1.52	0.00	
15/02/2025 16:46	1.48	1.52	0.00	
15/02/2025 17:01	1.48	1.52	0.00	
15/02/2025 17:16	1.48	1.52	0.00	
15/02/2025 17:31	1.48	1.52	0.00	
15/02/2025 17:46	1.48	1.52	0.00	
15/02/2025 18:01	1.48	1.52	0.00	
15/02/2025 18:16	1.48	1.52	0.00	
15/02/2025 18:31	1.48	1.52	0.00	
15/02/2025 18:46	1.48	1.52	0.00	
15/02/2025 19:01	1.48	1.52	0.00	
15/02/2025 19:16	1.48	1.52	0.00	
15/02/2025 19:31	1.48	1.52	0.00	
15/02/2025 19:46	1.48	1.52	0.00	
15/02/2025 20:01	1.48	1.52	0.00	
15/02/2025 20:16	1.48	1.52	0.00	
15/02/2025 20:31	1.48	1.52	0.00	
15/02/2025 20:46	1.48	1.52	0.00	
15/02/2025 21:01	1.47	1.52	0.00	
15/02/2025 21:16	1.48	1.52	0.00	
15/02/2025 21:31	1.48	1.52	0.00	
15/02/2025 21:46	1.48	1.52	0.00	
15/02/2025 22:01	1.47	1.52	0.00	
15/02/2025 22:16	1.47	1.52	0.00	
15/02/2025 22:31	1.47	1.52	0.00	
15/02/2025 22:46	1.47	1.52	0.00	
15/02/2025 23:01	1.48	1.52	0.00	
15/02/2025 23:16	1.48	1.52	0.00	
15/02/2025 23:31	1.48	1.52	0.00	
15/02/2025 23:46	1.47	1.52	0.00	
16/02/2025 00:01	1.47	1.52	0.00	
16/02/2025 00:16	1.47	1.52	0.00	
16/02/2025 00:31	1.47	1.52	0.00	
16/02/2025 00:46	1.47	1.52	0.00	
16/02/2025 01:01	1.47	1.52	0.00	
16/02/2025 01:16	1.47	1.52	0.00	
16/02/2025 01:31	1.47	1.52	0.00	
16/02/2025 01:46	1.47	1.52	0.00	
16/02/2025 02:01	1.47	1.52	0.00	
16/02/2025 02:16	1.47	1.52	0.00	
16/02/2025 02:31	1.47	1.52	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
16/02/2025 02:46	1.47	1.52	0.00	
16/02/2025 03:01	1.47	1.52	0.00	
16/02/2025 03:16	1.47	1.52	0.00	
16/02/2025 03:31	1.48	1.52	0.00	
16/02/2025 03:46	1.47	1.52	0.00	
16/02/2025 04:01	1.47	1.52	0.00	
16/02/2025 04:16	1.47	1.52	0.00	
16/02/2025 04:31	1.47	1.52	0.00	
16/02/2025 04:46	1.47	1.52	0.00	
16/02/2025 05:01	1.47	1.52	0.00	
16/02/2025 05:16	1.47	1.52	0.00	
16/02/2025 05:31	1.47	1.52	0.00	
16/02/2025 05:46	1.47	1.52	0.00	
16/02/2025 06:01	1.47	1.52	0.00	
16/02/2025 06:16	1.47	1.52	0.00	
16/02/2025 06:31	1.47	1.52	0.00	
16/02/2025 06:46	1.47	1.52	0.00	
16/02/2025 07:01	1.47	1.52	0.00	
16/02/2025 07:16	1.47	1.52	0.00	
16/02/2025 07:31	1.47	1.52	0.00	
16/02/2025 07:46	1.47	1.52	0.00	
16/02/2025 08:01	1.47	1.52	0.00	
16/02/2025 08:16	1.47	1.52	0.00	
16/02/2025 08:31	1.47	1.52	0.00	
16/02/2025 08:46	1.47	1.52	0.00	
16/02/2025 09:01	1.47	1.52	0.00	
16/02/2025 09:16	1.47	1.52	0.00	
16/02/2025 09:31	1.47	1.52	0.00	
16/02/2025 09:46	1.47	1.52	0.00	
16/02/2025 10:01	1.47	1.52	0.00	
16/02/2025 10:16	1.47	1.52	0.00	
16/02/2025 10:31	1.47	1.51	0.00	
16/02/2025 10:46	1.47	1.51	0.00	
16/02/2025 11:01	1.47	1.51	0.00	
16/02/2025 11:16	1.47	1.52	0.00	
16/02/2025 11:31	1.47	1.52	0.00	
16/02/2025 11:46	1.47	1.52	0.00	
16/02/2025 12:01	1.47	1.52	0.00	
16/02/2025 12:16	1.47	1.52	0.00	
16/02/2025 12:31	1.47	1.52	0.00	
16/02/2025 12:46	1.47	1.52	0.00	
16/02/2025 13:01	1.47	1.52	0.00	
16/02/2025 13:16	1.47	1.52	0.00	
16/02/2025 13:31	1.47	1.52	0.00	
16/02/2025 13:46	1.47	1.52	0.00	
16/02/2025 14:01	1.47	1.52	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
16/02/2025 14:16	1.47	1.52	0.00	
16/02/2025 14:31	1.47	1.52	0.00	
16/02/2025 14:46	1.47	1.52	0.00	
16/02/2025 15:01	1.47	1.52	0.00	
16/02/2025 15:16	1.47	1.52	0.00	
16/02/2025 15:31	1.47	1.52	0.00	
16/02/2025 15:46	1.47	1.52	0.00	
16/02/2025 16:01	1.47	1.52	0.00	
16/02/2025 16:16	1.47	1.52	0.00	
16/02/2025 16:31	1.47	1.52	0.00	
16/02/2025 16:46	1.47	1.52	0.00	
16/02/2025 17:01	1.47	1.51	0.00	
16/02/2025 17:16	1.47	1.52	0.00	
16/02/2025 17:31	1.47	1.52	0.00	
16/02/2025 17:46	1.47	1.52	0.00	
16/02/2025 18:01	1.47	1.52	0.00	
16/02/2025 18:16	1.47	1.52	0.00	
16/02/2025 18:31	1.47	1.52	0.00	
16/02/2025 18:46	1.47	1.52	0.00	
16/02/2025 19:01	1.47	1.52	0.00	
16/02/2025 19:16	1.47	1.52	0.00	
16/02/2025 19:31	1.47	1.52	0.00	
16/02/2025 19:46	1.47	1.52	0.00	
16/02/2025 20:01	1.47	1.52	0.00	
16/02/2025 20:16	1.47	1.51	0.00	
16/02/2025 20:31	1.46	1.51	0.00	
16/02/2025 20:46	1.47	1.52	0.00	
16/02/2025 21:01	1.46	1.51	0.00	
16/02/2025 21:16	1.47	1.52	0.00	
16/02/2025 21:31	1.47	1.51	0.00	
16/02/2025 21:46	1.46	1.51	0.00	
16/02/2025 22:01	1.47	1.52	0.00	
16/02/2025 22:16	1.47	1.52	0.00	
16/02/2025 22:31	1.46	1.51	0.00	
16/02/2025 22:46	1.46	1.51	0.00	
16/02/2025 23:01	1.46	1.51	0.00	
16/02/2025 23:16	1.46	1.51	0.00	
16/02/2025 23:31	1.47	1.52	0.00	
16/02/2025 23:46	1.46	1.51	0.00	
17/02/2025 00:01	1.47	1.51	0.00	
17/02/2025 00:16	1.47	1.52	0.00	
17/02/2025 00:31	1.46	1.51	0.00	
17/02/2025 00:46	1.47	1.52	0.00	
17/02/2025 01:01	1.46	1.51	0.00	
17/02/2025 01:16	1.46	1.51	0.00	
17/02/2025 01:31	1.46	1.51	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	PT01	Flow	COMMENTS
Top of well Level (mOD)	13.47	13.94	l/s	
17/02/2025 01:46	1.46	1.51	0.00	
17/02/2025 02:01	1.46	1.51	0.00	
17/02/2025 02:16	1.46	1.52	0.00	
17/02/2025 02:31	1.47	1.52	0.00	
17/02/2025 02:46	1.47	1.52	0.00	
17/02/2025 03:01	1.46	1.51	0.00	
17/02/2025 03:16	1.46	1.51	0.00	
17/02/2025 03:31	1.47	1.52	0.00	
17/02/2025 03:46	1.47	1.52	0.00	
17/02/2025 04:01	1.46	1.51	0.00	
17/02/2025 04:16	1.46	1.51	0.00	
17/02/2025 04:31	1.46	1.51	0.00	
17/02/2025 04:46	1.46	1.52	0.00	
17/02/2025 05:01	1.46	1.52	0.00	
17/02/2025 05:16	1.47	1.52	0.00	
17/02/2025 05:31	1.47	1.52	0.00	
17/02/2025 05:46	1.47	1.52	0.00	
17/02/2025 06:01	1.47	1.52	0.00	
17/02/2025 06:16	1.47	1.52	0.00	
17/02/2025 06:31	1.46	1.51	0.00	
17/02/2025 06:46	1.46	1.51	0.00	
17/02/2025 07:01	1.46	1.51	0.00	
17/02/2025 07:16	1.46	1.51	0.00	
17/02/2025 07:31	1.46	1.51	0.00	
17/02/2025 07:46	1.46	1.51	0.00	
17/02/2025 08:01	1.46	1.51	0.00	
17/02/2025 08:16	1.46	1.51	0.00	
17/02/2025 08:31	1.46	1.51	0.00	
17/02/2025 08:46	1.46	1.51	0.00	
17/02/2025 09:01	1.46	1.51	0.00	
17/02/2025 09:16	1.46	1.51	0.00	
17/02/2025 09:31	1.46	1.51	0.00	
17/02/2025 09:46	1.46	1.51	0.00	
17/02/2025 10:01	1.46	1.51	0.00	
17/02/2025 10:16	1.46	1.51	0.06	
17/02/2025 10:31	1.46	1.52	0.02	
17/02/2025 10:46	1.46	1.51	0.01	
17/02/2025 11:01	1.46	1.51	0.01	
17/02/2025 11:16	1.46	1.51	0.00	
17/02/2025 11:31	1.46	1.51	0.01	
17/02/2025 11:46	1.48	1.52	0.00	
17/02/2025 12:01	1.46	1.52	0.00	
17/02/2025 12:16	1.46	1.52	0.00	
17/02/2025 12:31	1.46	1.52	0.00	
17/02/2025 12:46	1.46	1.52	0.00	
17/02/2025 13:01	1.46	1.51	0.00	

Appendix B: Datalogged Water Level and Flow Data

	PB01	**PT01**	**Flow**	COMMENTS
Top of well Level (mOD)	13.47	13.94	**l/s**	
17/02/2025 13:16	1.46	1.51	0.00	
17/02/2025 13:31	1.46	1.51	0.00	
17/02/2025 13:46	1.46	1.51	0.00	
17/02/2025 14:01	1.46	1.52	0.00	
17/02/2025 14:16	1.46	1.51	0.00	
17/02/2025 14:31	1.46	1.51	0.00	
17/02/2025 14:46	1.46	1.52	0.00	
17/02/2025 15:01	1.46	1.51	0.00	
17/02/2025 15:16	1.46	1.51	0.00	
17/02/2025 15:31	1.46	1.51	0.00	
17/02/2025 15:46	1.46	1.51	0.00	
17/02/2025 16:01	1.46	1.51	0.00	
17/02/2025 16:16	1.46	1.51	0.00	

APPENDIX C: DIVER WATER LEVEL DATA

Appendix C: Diver Water Level Data

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
Units	mOD	mOD	mOD	mOD	mOD	mOD	mOD	mOD	mOD	mOD	9.34	mOD	mOD	mOD	mOD	
04/02/2025 12:00	9.00	1.13	3.13	0.68	1.97		1.32	1.21		1.02	1.28	2.88	1.17	2.46	2.01	
04/02/2025 12:15	9.00	1.13	3.13	0.69	1.98		1.32	1.21		1.01	1.28	2.88	1.18	2.46	2.01	
04/02/2025 12:30	9.00	1.13	3.13	0.71	1.98		1.33	1.20	1.64	1.02	1.28	2.88	1.18	2.46	2.01	
04/02/2025 12:45	9.00	1.13	3.13	0.72	1.98		1.32		1.63	1.02	1.28	2.88	1.18	2.47	2.01	
04/02/2025 13:00	9.00	1.12	3.13	0.74	1.98		1.32	1.21	1.64	1.01	1.28	2.87	1.18	2.47	2.01	
04/02/2025 13:15	9.00	1.12	3.13	0.75	1.98		1.32	1.21	1.63	1.02	1.28	2.88	1.18	2.47	2.01	
04/02/2025 13:30	9.00	1.12	3.13	0.76	1.98		1.31	1.21	1.63	1.01	1.28	2.88	1.18	2.47	2.00	
04/02/2025 13:45	9.00	1.13	3.13	0.77	1.98		1.30	1.21	1.63	1.01	1.28	2.88	1.18	2.48	2.01	
04/02/2025 14:00	9.01	1.13	3.13	0.79	1.98	1.68	1.30	1.21	1.62	1.00	1.28	2.88	1.18	2.48	2.00	
04/02/2025 14:15	9.00	1.13	3.13	0.79	1.98	1.68	1.30	1.21	1.64	1.00	1.28	2.87	1.18	2.48	2.00	
04/02/2025 14:30	9.01	1.13	3.14	0.81	1.98	1.68	1.30	1.21	1.63	1.01	1.28	2.88	1.18	2.49	2.01	
04/02/2025 14:45	9.00	1.12	3.13	0.82	1.98	1.68	1.30	1.21	1.64	1.01	1.28	2.88	1.18	2.49	2.00	
04/02/2025 15:00	9.00	1.12	3.13	0.82	1.97	1.67	1.30	1.21	1.63	1.01	1.27	2.87	1.17	2.49	2.00	
04/02/2025 15:15	9.00	1.12	3.13	0.83	1.98	1.68	1.30	1.21	1.63	1.01	1.28	2.87	1.18	2.50	2.00	
04/02/2025 15:30	9.01	1.12	3.13	0.84	1.98	1.68	1.30	1.21	1.63	1.01	1.28	2.87	1.18	2.50	2.00	
04/02/2025 15:45	9.00	1.12	3.13	0.84	1.98	1.68	1.30	1.21	1.63	1.01	1.28	2.88	1.18	2.50	2.00	
04/02/2025 16:00	9.00	1.12	3.13	0.85	1.97	1.68	1.30	1.21	1.63	1.01	1.28	2.88	1.18	2.51	2.00	
04/02/2025 16:15	9.00	1.12	3.13	0.83	1.98	1.68	1.30	1.21	1.62	1.01	1.28	2.88	1.18	2.51	2.00	
04/02/2025 16:30	9.00	1.12	3.13	0.83	1.98	1.68	1.30	1.21	1.62	1.01	1.28	2.88	1.18	2.51	2.00	
04/02/2025 16:45	9.00	1.12	3.13	0.81	1.98	1.68	1.30	1.21	1.62	1.01	1.28	2.88	1.18	2.52	2.00	
04/02/2025 17:00	9.00	1.12	3.13	0.80	1.97	1.68	1.31	1.21	1.61	1.01	1.28	2.88	1.18	2.52	2.00	
04/02/2025 17:15	9.00	1.13	3.13	0.78	1.98	1.68	1.30	1.21	1.63	1.01	1.28	2.88	1.18	2.51	2.00	
04/02/2025 17:30	9.00	1.13	3.13	0.76	1.98	1.68	1.30	1.21	1.62	1.01	1.28	2.88	1.18	2.51	2.00	
04/02/2025 17:45	9.00	1.12	3.13	0.75	1.97	1.67	1.30	1.21	1.61	1.00	1.28	2.88	1.18	2.50	2.00	
04/02/2025 18:00	9.00	1.12	3.13	0.73	1.97	1.68	1.30	1.21	1.61	1.01	1.28	2.88	1.18	2.50	2.00	
04/02/2025 18:15	9.00	1.12	3.13	0.71	1.97	1.67	1.30	1.21	1.62	1.01	1.28	2.88	1.18	2.49	2.00	
04/02/2025 18:30	9.00	1.12	3.13	0.70	1.97	1.67	1.30	1.21	1.61	1.00	1.28	2.88	1.18	2.49	2.00	
04/02/2025 18:45	9.00	1.12	3.13	0.68	1.98	1.67	1.30	1.21	1.62	1.01	1.28	2.88	1.18	2.48	2.00	
04/02/2025 19:00	9.00	1.12	3.13	0.67	1.97	1.67	1.30	1.21	1.61	1.00	1.27	2.88	1.18	2.48	2.00	
04/02/2025 19:15	9.00	1.12	3.13	0.66	1.97	1.67	1.30	1.21	1.61	1.00	1.27	2.88	1.18	2.47	2.00	
04/02/2025 19:30	9.00	1.12	3.13	0.64	1.97	1.68	1.30	1.21	1.62	1.00	1.27	2.88	1.18	2.47	2.00	
04/02/2025 19:45	9.00	1.12	3.13	0.63	1.97	1.67	1.30	1.21	1.62	1.00	1.27	2.88	1.18	2.46	2.00	
04/02/2025 20:00	9.00	1.12	3.13	0.62	1.97	1.67	1.30	1.21	1.62	1.00	1.28	2.88	1.18	2.46	2.00	
04/02/2025 20:15	9.00	1.12	3.13	0.61	1.97	1.67	1.30	1.20	1.62	1.00	1.28	2.88	1.18	2.46	2.00	
04/02/2025 20:30	9.00	1.12	3.13	0.60	1.97	1.67	1.30	1.21	1.62	1.00	1.27	2.88	1.18	2.45	2.00	
04/02/2025 20:45	9.00	1.12	3.13	0.59	1.97	1.67	1.29	1.20	1.61	1.00	1.27	2.88	1.18	2.45	1.99	
04/02/2025 21:00	9.00	1.12	3.13	0.59	1.97	1.67	1.30	1.20	1.61	1.00	1.27	2.88	1.18	2.45	2.00	
04/02/2025 21:15	9.00	1.12	3.13	0.59	1.97	1.67	1.30	1.20	1.61	1.00	1.27	2.88	1.18	2.44	2.00	
04/02/2025 21:30	9.00	1.12	3.13	0.60	1.96	1.67	1.30	1.21	1.60	1.00	1.27	2.88	1.17	2.44	1.99	
04/02/2025 21:45	9.00	1.12	3.13	0.61	1.96	1.67	1.29	1.20	1.60	1.00	1.27	2.88	1.18	2.43	1.99	
04/02/2025 22:00	9.00	1.12	3.13	0.62	1.96	1.67	1.29	1.20	1.60	1.00	1.27	2.88	1.18	2.43	1.99	
04/02/2025 22:15	9.00	1.12	3.13	0.63	1.97	1.67	1.30	1.21	1.62	1.00	1.27	2.88	1.18	2.43	2.00	
04/02/2025 22:30	9.00	1.12	3.13	0.64	1.96	1.67	1.30	1.20	1.62	1.00	1.27	2.88	1.18	2.42	1.99	
04/02/2025 22:45	9.00	1.12	3.13	0.66	1.97	1.67	1.29	1.20	1.61	1.00	1.27	2.88	1.18	2.42	2.00	
04/02/2025 23:00	9.00	1.12	3.13	0.67	1.96	1.67	1.29	1.20	1.60	0.99	1.27	2.88	1.18	2.42	2.00	
04/02/2025 23:15	9.00	1.12	3.13	0.69	1.96	1.67	1.29	1.20	1.60	1.01	1.28	2.88	1.18	2.42	1.99	
04/02/2025 23:30	9.00	1.12	3.13	0.70	1.96	1.67	1.30	1.21	1.61	1.01	1.27	2.88	1.18	2.42	2.00	
04/02/2025 23:45	9.00	1.12	3.13	0.71	1.96	1.67	1.30	1.20	1.60	1.00	1.28	2.88	1.18	2.43	1.99	
05/02/2025 00:00	9.01	1.12	3.13	0.73	1.96	1.67	1.30	1.21	1.61	1.00	1.28	2.88	1.18	2.43	2.00	
05/02/2025 00:15	9.00	1.12	3.13	0.75	1.96	1.67	1.29	1.21	1.62	1.01	1.27	2.88	1.17	2.43	1.99	
05/02/2025 00:30	9.00	1.12	3.13	0.76	1.96	1.67	1.30	1.20	1.60	1.00	1.28	2.88	1.18	2.44	1.99	
05/02/2025 00:45	9.00	1.12	3.13	0.78	1.96	1.67	1.29	1.20	1.60	1.00	1.27	2.88	1.18	2.45	1.99	
05/02/2025 01:00	9.00	1.12	3.12	0.79	1.95	1.67	1.30	1.20	1.61	0.99	1.27	2.88	1.18	2.45	1.99	
05/02/2025 01:15	9.00	1.12	3.13	0.81	1.96	1.67	1.30	1.20	1.62	1.00	1.27	2.88	1.18	2.45	2.00	
05/02/2025 01:30	9.00	1.12	3.13	0.83	1.96	1.67	1.30	1.21	1.61	1.00	1.28	2.88	1.18	2.46	2.00	
05/02/2025 01:45	9.00	1.12	3.13	0.84	1.97	1.67	1.30	1.20	1.61	1.00	1.27	2.88	1.18	2.46	1.99	
05/02/2025 02:00	9.00	1.12	3.13	0.85	1.96	1.67	1.30	1.20	1.60	1.00	1.27	2.88	1.18	2.46	1.99	
05/02/2025 02:15	9.00	1.12	3.13	0.87	1.96	1.67	1.30	1.20	1.60	1.00	1.27	2.88	1.18	2.47	1.99	
05/02/2025 02:30	9.01	1.12	3.13	0.88	1.96	1.67	1.30	1.20	1.60	1.01	1.27	2.88	1.18	2.47	2.00	
05/02/2025 02:45	9.00	1.11	3.13	0.88	1.96	1.67	1.30	1.20	1.62	1.00	1.27	2.88	1.18	2.47	1.99	
05/02/2025 03:00	9.00	1.12	3.13	0.89	1.96	1.67	1.29	1.20	1.61	1.01	1.27	2.88	1.18	2.48	2.00	
05/02/2025 03:15	9.00	1.12	3.12	0.89	1.97	1.67	1.30	1.20	1.60	1.00	1.27	2.88	1.17	2.48	1.99	
05/02/2025 03:30	9.00	1.12	3.13	0.90	1.96	1.67	1.30	1.20	1.61	1.00	1.27	2.88	1.18	2.48	1.99	
05/02/2025 03:45	9.00	1.11	3.13	0.90	1.96	1.67	1.30	1.20	1.61	1.00	1.27	2.88	1.17	2.49	1.99	
05/02/2025 04:00	9.00	1.12	3.13	0.90	1.96	1.67	1.29	1.20	1.60	1.00	1.28	2.88	1.18	2.49	1.99	
05/02/2025 04:15	9.00	1.11	3.12	0.90	1.96	1.67	1.30	1.20	1.61	1.00	1.27	2.87	1.17	2.49	1.99	
05/02/2025 04:30	9.00	1.11	3.13	0.90	1.96	1.67	1.29	1.20	1.60	1.00	1.26	2.87	1.18	2.49	1.99	
05/02/2025 04:45	9.00	1.12	3.13	0.90	1.96	1.67	1.30	1.20	1.59	1.00	1.27	2.88	1.18	2.50	1.99	
05/02/2025 05:00	9.00	1.11	3.12	0.89	1.95	1.67	1.30	1.20	1.60	1.00	1.27	2.87	1.18	2.50	1.99	
05/02/2025 05:15	9.00	1.12	3.13	0.88	1.96	1.67	1.30	1.20	1.60	1.00	1.28	2.88	1.18	2.51	1.99	
05/02/2025 05:30	9.00	1.12	3.13	0.86	1.96	1.67	1.30	1.20	1.60	1.00	1.27	2.87	1.17	2.51	1.99	
05/02/2025 05:45	9.00	1.12	3.13	0.85	1.96	1.67	1.30	1.20	1.61	0.99	1.28	2.87	1.18	2.52	1.99	
05/02/2025 06:00	9.00	1.12	3.12	0.83	1.96	1.67	1.29	1.20	1.60	1.00	1.27	2.87	1.17	2.52	1.99	
05/02/2025 06:15	9.00	1.12	3.13	0.81	1.96	1.67	1.30	1.20	1.60	1.00	1.27	2.87	1.17	2.52	1.99	
05/02/2025 06:30	9.00	1.12	3.13	0.80	1.97	1.67	1.29	1.20	1.60	1.00	1.27	2.87	1.18	2.52	1.99	
05/02/2025 06:45	9.00	1.12	3.13	0.78	1.96	1.67	1.30	1.20	1.60	1.00	1.27	2.87	1.17	2.51	1.99	
05/02/2025 07:00	9.00	1.12	3.13	0.77	1.96	1.67	1.30	1.20	1.60	0.99	1.27	2.87	1.17	2.51	1.99	
05/02/2025 07:15	9.00	1.12	3.13	0.75	1.96	1.67	1.30	1.20	1.60	1.00	1.27	2.87	1.17	2.50	1.99	
05/02/2025 07:30	9.00	1.12	3.12	0.73	1.96	1.67	1.29	1.20	1.60	1.00	1.27	2.87	1.17	2.49	1.99	
05/02/2025 07:45	9.00	1.11	3.12	0.72	1.96	1.67	1.30	1.20	1.61	1.00	1.27	2.87	1.17	2.49	1.99	
05/02/2025 08:00	9.00	1.11	3.12	0.70	1.95	1.67	1.30	1.20	1.59	1.00	1.27	2.87	1.17	2.49	1.99	
05/02/2025 08:15	9.00	1.12	3.12	0.69	1.96	1.67	1.30	1.20	1.60	1.00	1.28	2.87	1.17	2.48	1.99	
05/02/2025 08:30	9.00	1.11	3.12	0.67	1.96	1.67	1.29	1.19	1.61	1.00	1.27	2.87	1.17	2.47	1.99	
05/02/2025 08:45	9.00	1.11	3.12	0.66	1.96	1.67	1.30	1.20	1.61	1.00	1.27	2.87	1.17	2.47	1.99	
05/02/2025 09:00	9.00	1.11	3.12	0.64	1.96	1.67	1.30	1.20	1.61	0.99	1.27	2.87	1.17	2.47	1.99	
05/02/2025 09:15	9.00	1.12	3.12	0.63	1.96	1.67	1.30	1.20	1.61	0.99	1.27	2.87	1.17	2.46	1.99	
05/02/2025 09:30	9.00	1.11	3.12	0.63	1.96	1.67	1.29	1.20	1.60	0.98	1.27	2.87	1.17	2.46	1.99	
05/02/2025 09:45	9.00	1.11	3.12	0.62	1.96	1.67	1.30	1.20	1.60	0.99	1.27	2.87	1.17	2.45	1.99	
05/02/2025 10:00	9.00	1.11	3.12	0.62	1.95	1.66	1.29	1.20	1.60	0.98	1.27	2.86	1.17	2.44	1.99	
05/02/2025 10:15	9.00	1.11	3.12	0.62	1.96	1.66	1.29	1.20	1.60	0.99	1.27	2.87	1.17	2.44	1.99	
05/02/2025 10:30	9.00	1.11	3.12	0.62	1.96	1.67	1.29	1.20	1.61	0.99	1.26	2.87	1.17	2.44	1.99	
05/02/2025 10:45	9.00	1.11	3.12	0.62	1.96	1.66	1.30	1.20	1.61	0.99	1.27	2.87	1.17	2.43	1.99	
05/02/2025 11:00	9.00	1.11	3.12	0.63	1.95	1.65	1.29	1.20	1.61	0.98	1.26	2.86	1.17	2.43	1.99	
05/02/2025 11:15	9.00	1.11	3.12	0.64	1.96	1.66	1.30	1.20	1.61	0.99	1.26	2.86	1.17	2.42	1.99	
05/02/2025 11:30	9.00	1.11	3.12	0.65	1.96	1.67	1.29	1.20	1.60	0.99	1.26	2.86	1.17	2.42	1.99	
05/02/2025 11:45	9.00	1.11	3.12	0.66	1.96	1.67	1.31	1.20	1.60	1.00	1.27	2.86	1.17	2.42	1.99	
05/02/2025 12:00	9.00	1.11	3.12	0.67	1.96	1.67	1.30	1.20	1.60	0.99	1.27	2.87	1.17	2.42	1.99	
05/02/2025 12:15	9.00	1.11	3.12	0.68	1.96	1.67	1.31	1.19	1.60	0.99	1.26	2.86	1.16	2.41	1.99	
05/02/2025 12:30	9.00	1.11	3.12	0.69	1.97	1.67	1.31	1.20	1.60	0.99	1.27	2.87	1.16	2.41	1.99	
05/02/2025 12:45	9.00	1.11	3.12	0.70	1.96	1.67	1.31	1.19	1.61	0.99	1.27	2.87	1.17	2.42	1.99	
05/02/2025 13:00	9.00	1.11	3.12	0.72	1.95	1.67	1.31	1.20	1.61	0.99	1.26	2.86	1.16	2.42	1.99	
05/02/2025 13:15	9.00	1.11	3.12	0.73	1.96	1.67	1.31	1.19	1.61	0.99	1.26	2.87	1.16	2.42	1.99	
05/02/2025 13:30	9.00	1.11	3.12	0.74	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.87	1.17	2.43	1.99	
05/02/2025 13:45	9.00	1.11	3.12	0.76	1.96	1.67	1.31	1.20	1.61	1.00	1.26	2.87	1.17	2.44	1.99	
05/02/2025 14:00	9.00	1.11	3.12	0.78	1.96	1.67	1.31	1.20	1.61	0.99	1.26	2.87	1.17	2.44	1.99	
05/02/2025 14:15	9.00	1.11	3.12	0.78	1.96	1.66	1.31	1.20	1.61	1.00	1.26	2.87	1.16	2.44	1.99	
05/02/2025 14:30	9.00	1.11	3.12	0.80	1.96	1.67	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.45	1.99	
05/02/2025 14:45	9.00	1.11	3.12	0.81	1.97	1.67	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.45	1.99	
05/02/2025 15:00	9.00	1.11	3.12	0.82	1.96	1.67	1.31	1.20	1.60	1.00	1.27	2.86	1.17	2.46	1.99	
05/02/2025 15:15	9.00	1.11	3.12	0.83	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.46	1.99	
05/02/2025 15:30	9.00	1.11	3.12	0.84	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.46	1.99	
05/02/2025 15:45	9.00	1.11	3.12	0.85	1.96	1.67	1.31	1.20	1.62	1.01	1.27	2.86	1.16	2.47	1.99	
05/02/2025 16:00	9.00	1.11	3.12	0.85	1.95	1.67	1.31	1.20	1.61	1.00	1.26	2.86	1.16	2.47	1.99	
05/02/2025 16:15	9.00	1.11	3.12	0.86	1.96	1.67	1.31	1.19	1.61	0.99	1.27	2.86	1.16	2.47	1.99	
05/02/2025 16:30	9.00	1.11	3.12	0.87	1.96	1.67	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.48	1.99	
05/02/2025 16:45	9.00	1.11	3.12	0.87	1.96	1.67	1.30	1.19	1.62	1.00	1.27	2.86	1.16	2.48	1.99	
05/02/2025 17:00	9.00	1.11	3.12	0.87	1.96	1.67	1.31	1.20	1.62	1.00	1.26	2.87	1.16	2.48	1.99	
05/02/2025 17:15	9.00	1.11	3.12	0.87	1.96	1.66	1.31	1.20	1.60	1.00	1.26	2.86	1.16	2.48	1.99	
05/02/2025 17:30	9.00	1.11	3.12	0.86	1.96	1.67	1.31	1.20	1.61	0.99	1.26	2.86	1.16	2.49	1.99	
05/02/2025 17:45	9.00	1.11	3.12	0.85	1.96	1.67	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.49	1.99	
05/02/2025 18:00	9.00	1.11	3.12	0.84	1.95	1.67	1.31	1.19	1.61	0.99	1.26	2.86	1.16	2.50	1.99	
05/02/2025 18:15	9.00	1.11	3.12	0.83	1.96	1.67	1.31	1.20	1.60	1.00	1.26	2.86	1.16	2.50	1.99	
05/02/2025 18:30	9.00	1.11	3.12	0.81	1.96	1.67	1.31	1.20	1.60	1.00	1.26	2.86	1.16	2.50	1.99	
05/02/2025 18:45	9.00	1.11	3.12	0.80	1.96	1.67	1.31	1.19	1.60	0.99	1.27	2.86	1.16	2.50	1.99	
05/02/2025 19:00	9.00	1.11	3.12	0.79	1.95	1.67	1.31	1.20	1.61	1.00	1.26	2.86	1.16	2.50	1.99	
05/02/2025 19:15	9.00	1.11	3.12	0.77	1.96	1.67	1.31	1.20	1.62	0.99	1.26	2.86	1.16	2.50	1.99	
05/02/2025 19:30	9.00	1.11	3.12	0.76	1.96	1.67	1.31	1.20	1.60	1.00	1.26	2.86	1.16	2.49	1.99	
05/02/2025 19:45	9.00	1.11	3.12	0.75	1.96	1.67	1.31	1.20	1.62	0.99	1.26	2.86	1.16	2.49	1.99	

Appendix C: Diver Water Level Data

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
05/02/2025 20:00	9.00	1.11	3.12	0.73	1.95	1.67	1.31	1.20	1.61	0.99	1.26	2.87	1.16	2.49	1.99	
05/02/2025 20:15	9.00	1.11	3.12	0.72	1.96	1.67	1.30	1.20	1.61	1.00	1.26	2.86	1.16	2.48	1.99	
05/02/2025 20:30	9.00	1.11	3.12	0.71	1.96	1.66	1.31	1.20	1.62	1.00	1.26	2.86	1.16	2.47	1.99	
05/02/2025 20:45	9.00	1.11	3.12	0.70	1.96	1.67	1.31	1.20	1.60	1.00	1.27	2.86	1.16	2.47	1.99	
05/02/2025 21:00	9.01	1.11	3.12	0.69	1.96	1.67	1.30	1.20	1.62	1.00	1.27	2.86	1.16	2.46	1.99	
05/02/2025 21:15	9.00	1.11	3.12	0.68	1.96	1.67	1.31	1.20	1.62	1.00	1.27	2.86	1.16	2.46	1.99	
05/02/2025 21:30	9.00	1.11	3.12	0.67	1.97	1.67	1.31	1.20	1.62	1.00	1.27	2.86	1.16	2.45	1.99	
05/02/2025 21:45	9.00	1.11	3.12	0.67	1.96	1.67	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.45	1.99	
05/02/2025 22:00	9.00	1.11	3.12	0.67	1.96	1.67	1.32	1.20	1.61	1.00	1.26	2.86	1.16	2.44	1.99	
05/02/2025 22:15	9.00	1.11	3.12	0.67	1.96	1.67	1.31	1.20	1.62	1.01	1.26	2.86	1.16	2.44	1.99	
05/02/2025 22:30	9.00	1.11	3.12	0.67	1.96	1.67	1.31	1.20	1.61	1.00	1.26	2.87	1.16	2.43	1.99	
05/02/2025 22:45	9.00	1.11	3.12	0.68	1.97	1.67	1.32	1.20	1.62	1.00	1.26	2.87	1.16	2.43	1.99	
05/02/2025 23:00	9.00	1.11	3.12	0.69	1.96	1.67	1.30	1.20	1.62	1.00	1.27	2.86	1.16	2.43	1.99	
05/02/2025 23:15	9.00	1.11	3.12	0.70	1.96	1.67	1.31	1.20	1.61	1.00	1.27	2.87	1.16	2.42	1.99	
05/02/2025 23:30	9.00	1.11	3.12	0.71	1.97	1.67	1.31	1.20	1.62	1.00	1.26	2.87	1.16	2.42	1.99	
05/02/2025 23:45	9.00	1.11	3.12	0.72	1.96	1.67	1.31	1.20	1.61	1.01	1.27	2.87	1.16	2.43	1.99	
06/02/2025 00:00	9.00	1.11	3.12	0.73	1.96	1.67	1.31	1.20	1.60	1.00	1.26	2.86	1.16	2.43	1.99	
06/02/2025 00:15	9.00	1.11	3.12	0.74	1.97	1.67	1.31	1.20	1.62	1.00	1.26	2.86	1.17	2.43	1.99	
06/02/2025 00:30	9.00	1.11	3.12	0.75	1.96	1.67	1.31	1.20	1.62	1.00	1.26	2.86	1.16	2.44	1.99	
06/02/2025 00:45	9.00	1.12	3.12	0.77	1.97	1.67	1.32	1.20	1.62	1.01	1.27	2.87	1.17	2.44	1.99	
06/02/2025 01:00	9.00	1.11	3.12	0.78	1.96	1.67	1.31	1.20	1.63	1.00	1.26	2.86	1.16	2.45	1.99	
06/02/2025 01:15	9.00	1.11	3.12	0.79	1.97	1.67	1.31	1.20	1.62	1.00	1.27	2.86	1.17	2.45	1.99	
06/02/2025 01:30	9.00	1.11	3.12	0.80	1.97	1.67	1.31	1.20	1.61	1.00	1.27	2.87	1.16	2.45	1.99	
06/02/2025 01:45	9.00	1.11	3.12	0.81	1.97	1.67	1.31	1.20	1.62	1.00	1.26	2.86	1.16	2.46	1.99	
06/02/2025 02:00	9.00	1.11	3.12	0.82	1.96	1.67	1.31	1.20	1.62	1.00	1.26	2.86	1.16	2.46	1.99	
06/02/2025 02:15	9.00	1.11	3.12	0.84	1.97	1.67	1.31	1.20	1.62	1.00	1.27	2.87	1.16	2.46	1.99	
06/02/2025 02:30	9.00	1.11	3.12	0.85	1.97	1.67	1.31	1.20	1.61	1.00	1.26	2.86	1.16	2.46	1.99	
06/02/2025 02:45	9.00	1.11	3.11	0.85	1.97	1.67	1.32	1.20	1.63	1.00	1.27	2.87	1.16	2.47	2.00	
06/02/2025 03:00	9.01	1.11	3.12	0.86	1.96	1.67	1.31	1.20	1.63	1.00	1.26	2.86	1.16	2.47	1.99	
06/02/2025 03:15	9.00	1.11	3.12	0.87	1.97	1.67	1.31	1.20	1.63	1.00	1.27	2.87	1.16	2.47	1.99	
06/02/2025 03:30	9.00	1.11	3.12	0.88	1.97	1.67	1.31	1.19	1.63	1.00	1.27	2.87	1.16	2.48	1.99	
06/02/2025 03:45	9.00	1.11	3.12	0.88	1.97	1.67	1.31	1.19	1.61	1.00	1.27	2.86	1.16	2.48	1.99	
06/02/2025 04:00	9.00	1.11	3.12	0.88	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.17	2.48	1.99	
06/02/2025 04:15	9.00	1.11	3.12	0.88	1.97	1.68	1.31	1.20	1.62	0.99	1.27	2.87	1.16	2.49	1.99	
06/02/2025 04:30	9.00	1.11	3.11	0.87	1.96	1.67	1.31	1.19	1.61	0.99	1.25	2.86	1.16	2.49	1.99	
06/02/2025 04:45	9.00	1.11	3.12	0.88	1.96	1.67	1.31	1.19	1.60	0.99	1.26	2.86	1.16	2.49	1.99	
06/02/2025 05:00	9.00	1.11	3.12	0.87	1.96	1.67	1.31	1.20	1.62	0.99	1.26	2.87	1.16	2.50	1.99	
06/02/2025 05:15	9.00	1.11	3.12	0.86	1.97	1.67	1.31	1.19	1.62	1.00	1.26	2.86	1.16	2.50	1.99	
06/02/2025 05:30	9.00	1.11	3.12	0.86	1.96	1.67	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.50	1.99	
06/02/2025 05:45	9.00	1.11	3.12	0.86	1.97	1.67	1.32	1.20	1.62	0.99	1.26	2.86	1.16	2.51	1.99	
06/02/2025 06:00	9.00	1.11	3.12	0.84	1.96	1.67	1.32	1.20	1.62	0.98	1.27	2.86	1.16	2.51	1.99	
06/02/2025 06:15	9.00	1.11	3.12	0.83	1.97	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.51	1.99	
06/02/2025 06:30	9.00	1.11	3.12	0.82	1.97	1.67	1.31	1.20	1.61	0.99	1.26	2.87	1.16	2.52	1.99	
06/02/2025 06:45	9.00	1.11	3.12	0.80	1.96	1.67	1.31	1.20	1.62	0.99	1.27	2.87	1.16	2.51	1.99	
06/02/2025 07:00	9.00	1.11	3.12	0.79	1.96	1.67	1.31	1.20	1.61	1.00	1.26	2.86	1.16	2.51	1.99	
06/02/2025 07:15	9.00	1.11	3.12	0.77	1.96	1.67	1.31	1.20	1.61	0.99	1.26	2.86	1.16	2.50	1.99	
06/02/2025 07:30	9.00	1.11	3.12	0.75	1.96	1.67	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.50	1.99	
06/02/2025 07:45	9.00	1.11	3.12	0.73	1.96	1.67	1.31	1.20	1.62	1.00	1.27	2.86	1.16	2.49	1.99	
06/02/2025 08:00	9.00	1.11	3.12	0.72	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.48	1.99	
06/02/2025 08:15	9.00	1.11	3.12	0.70	1.96	1.67	1.31	1.19	1.62	0.99	1.26	2.86	1.16	2.48	1.99	
06/02/2025 08:30	9.00	1.11	3.12	0.69	1.97	1.67	1.32	1.19	1.61	1.00	1.27	2.86	1.16	2.48	1.99	
06/02/2025 08:45	9.00	1.11	3.12	0.67	1.96	1.67	1.32	1.19	1.61	0.99	1.27	2.86	1.16	2.47	1.99	
06/02/2025 09:00	9.00	1.11	3.11	0.66	1.95	1.67	1.31	1.20	1.62	0.99	1.26	2.86	1.16	2.46	1.99	
06/02/2025 09:15	9.00	1.11	3.12	0.64	1.96	1.67	1.31	1.19	1.61	0.99	1.26	2.85	1.16	2.46	1.99	
06/02/2025 09:30	9.00	1.11	3.12	0.63	1.97	1.67	1.31	1.20	1.62	0.99	1.27	2.86	1.16	2.45	1.99	
06/02/2025 09:45	9.00	1.11	3.11	0.62	1.97	1.67	1.31	1.19	1.62	0.98	1.26	2.86	1.16	2.45	1.99	
06/02/2025 10:00	9.00	1.11	3.11	0.61	1.96	1.67	1.31	1.20	1.62	0.98	1.26	2.86	1.16	2.44	1.99	
06/02/2025 10:15	9.00	1.11	3.12	0.60	1.97	1.67	1.32	1.19	1.62	0.99	1.27	2.86	1.16	2.44	1.99	
06/02/2025 10:30	8.99	1.11	3.11	0.59	1.97	1.67	1.31	1.19	1.62	0.98	1.27	2.86	1.16	2.43	1.99	
06/02/2025 10:45	9.00	1.11	3.12	0.59	1.96	1.67	1.30	1.19	1.62	0.98	1.27	2.86	1.16	2.43	1.99	
06/02/2025 11:00	9.00	1.11	3.11	0.58	1.96	1.67	1.31	1.20	1.62	0.98	1.26	2.86	1.16	2.42	1.99	
06/02/2025 11:15	8.99	1.11	3.11	0.58	1.97	1.67	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.42	1.99	
06/02/2025 11:30	9.00	1.11	3.11	0.58	1.96	1.67	1.31	1.19	1.62	0.99	1.26	2.86	1.16	2.41	1.99	
06/02/2025 11:45	9.00	1.11	3.11	0.58	1.97	1.68	1.31	1.20	1.63	0.99	1.26	2.86	1.15	2.41	1.99	
06/02/2025 12:00	9.00	1.11	3.11	0.59	1.96	1.67	1.30	1.20	1.62	0.99	1.26	2.86	1.16	2.41	1.99	
06/02/2025 12:15	9.00	1.10	3.11	0.59	1.97	1.67	1.30	1.19	1.62	0.98	1.26	2.86	1.16	2.40	1.99	
06/02/2025 12:30	8.99	1.11	3.11	0.60	1.97	1.67	1.30	1.19	1.62	0.98	1.27	2.86	1.15	2.40	1.99	
06/02/2025 12:45	9.00	1.11	3.11	0.61	1.97	1.67	1.31	1.19	1.61	0.99	1.27	2.86	1.15	2.40	1.99	
06/02/2025 13:00	9.00	1.11	3.11	0.62	1.96	1.67	1.30	1.20	1.60	0.99	1.26	2.86	1.15	2.39	1.99	
06/02/2025 13:15	8.99	1.11	3.11	0.63	1.97	1.67	1.31	1.19	1.61	0.99	1.26	2.86	1.15	2.39	1.99	
06/02/2025 13:30	9.00	1.11	3.12	0.64	1.97	1.68	1.30	1.20	1.61	0.99	1.26	2.86	1.16	2.39	1.99	
06/02/2025 13:45	9.00	1.11	3.12	0.66	1.97	1.68	1.32	1.20	1.61	0.99	1.27	2.86	1.16	2.39	1.99	
06/02/2025 14:00	9.00	1.11	3.11	0.66	1.96	1.67	1.31	1.20	1.60	0.99	1.26	2.86	1.16	2.38	1.99	
06/02/2025 14:15	8.99	1.11	3.11	0.67	1.97	1.67	1.31	1.19	1.60	0.99	1.26	2.86	1.16	2.38	1.99	
06/02/2025 14:30	9.00	1.11	3.11	0.68	1.97	1.67	1.31	1.19	1.61	0.99	1.26	2.85	1.16	2.38	1.99	
06/02/2025 14:45	9.00	1.11	3.11	0.69	1.97	1.67	1.30	1.19	1.60	0.99	1.26	2.86	1.16	2.38	1.99	
06/02/2025 15:00	9.00	1.11	3.11	0.71	1.96	1.67	1.30	1.20	1.60	0.99	1.26	2.86	1.16	2.39	1.99	
06/02/2025 15:15	9.00	1.11	3.11	0.72	1.97	1.67	1.31	1.20	1.59	0.99	1.27	2.86	1.16	2.39	1.99	
06/02/2025 15:30	9.00	1.11	3.12	0.74	1.97	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.40	2.00	
06/02/2025 15:45	9.00	1.11	3.12	0.74	1.97	1.67	1.31	1.20	1.61	0.99	1.26	2.86	1.16	2.40	1.99	
06/02/2025 16:00	9.00	1.11	3.12	0.76	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.41	1.99	
06/02/2025 16:15	9.00	1.11	3.12	0.76	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.41	2.00	
06/02/2025 16:30	9.00	1.11	3.12	0.77	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.41	2.00	
06/02/2025 16:45	9.00	1.11	3.12	0.78	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.42	2.00	
06/02/2025 17:00	9.01	1.12	3.12	0.79	1.96	1.67	1.31	1.20	1.61	0.99	1.26	2.87	1.16	2.42	2.00	
06/02/2025 17:15	9.00	1.12	3.12	0.80	1.97	1.67	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.42	2.00	
06/02/2025 17:30	9.00	1.11	3.12	0.80	1.97	1.68	1.31	1.20	1.60	1.00	1.27	2.86	1.16	2.43	2.00	
06/02/2025 17:45	9.00	1.12	3.12	0.81	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.43	2.00	
06/02/2025 18:00	9.00	1.11	3.12	0.81	1.96	1.68	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.43	2.00	
06/02/2025 18:15	9.00	1.11	3.12	0.81	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.44	2.00	
06/02/2025 18:30	9.00	1.12	3.12	0.80	1.97	1.68	1.31	1.20	1.61	0.99	1.28	2.86	1.16	2.44	2.00	
06/02/2025 18:45	9.00	1.12	3.12	0.80	1.97	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.44	2.00	
06/02/2025 19:00	9.00	1.12	3.12	0.79	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.45	2.00	
06/02/2025 19:15	9.00	1.12	3.12	0.78	1.97	1.68	1.32	1.20	1.60	0.99	1.27	2.87	1.16	2.45	2.00	
06/02/2025 19:30	9.00	1.12	3.12	0.77	1.97	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.45	2.00	
06/02/2025 19:45	9.00	1.12	3.12	0.76	1.98	1.68	1.31	1.20	1.61	0.99	1.28	2.87	1.16	2.45	2.00	
06/02/2025 20:00	9.01	1.12	3.12	0.75	1.97	1.68	1.32	1.21	1.61	1.00	1.27	2.87	1.16	2.45	2.00	
06/02/2025 20:15	9.00	1.12	3.12	0.74	1.98	1.68	1.31	1.20	1.62	0.99	1.27	2.87	1.16	2.45	2.00	
06/02/2025 20:30	9.00	1.12	3.12	0.72	1.98	1.68	1.32	1.20	1.61	1.00	1.27	2.87	1.16	2.44	2.00	
06/02/2025 20:45	9.01	1.12	3.12	0.72	1.98	1.68	1.32	1.20	1.62	0.99	1.27	2.87	1.16	2.44	2.00	
06/02/2025 21:00	9.00	1.12	3.12	0.71	1.97	1.68	1.32	1.21	1.62	1.00	1.27	2.87	1.16	2.43	2.00	
06/02/2025 21:15	9.00	1.12	3.12	0.69	1.98	1.69	1.32	1.20	1.61	1.00	1.27	2.87	1.16	2.43	2.00	
06/02/2025 21:30	9.00	1.12	3.12	0.68	1.98	1.68	1.32	1.20	1.62	0.99	1.27	2.87	1.16	2.42	2.00	
06/02/2025 21:45	9.00	1.12	3.12	0.67	1.98	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.16	2.41	2.00	
06/02/2025 22:00	9.00	1.12	3.12	0.66	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.41	2.00	
06/02/2025 22:15	9.00	1.12	3.12	0.66	1.98	1.69	1.32	1.20	1.61	1.00	1.27	2.87	1.16	2.41	2.00	
06/02/2025 22:30	9.00	1.12	3.12	0.65	1.98	1.69	1.32	1.21	1.63	0.99	1.27	2.87	1.16	2.40	2.00	
06/02/2025 22:45	9.00	1.12	3.12	0.64	1.98	1.69	1.31	1.20	1.61	1.00	1.27	2.87	1.16	2.40	2.00	
06/02/2025 23:00	9.00	1.12	3.12	0.64	1.97	1.68	1.32	1.21	1.62	0.99	1.27	2.87	1.17	2.39	2.00	
06/02/2025 23:15	9.00	1.12	3.12	0.64	1.98	1.68	1.32	1.21	1.62	1.00	1.27	2.87	1.16	2.39	2.00	
06/02/2025 23:30	9.00	1.12	3.12	0.65	1.98	1.68	1.32	1.20	1.61	1.00	1.28	2.87	1.16	2.39	2.00	
06/02/2025 23:45	9.00	1.12	3.12	0.65	1.98	1.68	1.32	1.20	1.62	0.99	1.27	2.87	1.16	2.38	2.00	
07/02/2025 00:00	9.00	1.12	3.12	0.66	1.97	1.68	1.32	1.21	1.61	0.99	1.28	2.86	1.16	2.38	2.00	
07/02/2025 00:15	9.00	1.12	3.12	0.67	1.98	1.68	1.32	1.21	1.62	0.99	1.28	2.87	1.17	2.38	2.00	
07/02/2025 00:30	9.00	1.12	3.12	0.67	1.98	1.69	1.32	1.20	1.62	0.99	1.28	2.87	1.16	2.37	2.01	
07/02/2025 00:45	9.00	1.12	3.13	0.68	1.98	1.69	1.32	1.20	1.62	0.99	1.28	2.87	1.17	2.37	2.01	
07/02/2025 01:00	9.00	1.12	3.12	0.69	1.97	1.69	1.32	1.21	1.60	0.99	1.27	2.87	1.16	2.37	2.01	
07/02/2025 01:15	9.00	1.12	3.12	0.70	1.98	1.69	1.32	1.20	1.61	1.00	1.27	2.87	1.16	2.37	2.00	
07/02/2025 01:30	9.00	1.12	3.12	0.71	1.98	1.68	1.31	1.20	1.62	1.00	1.28	2.86	1.16	2.37	2.00	
07/02/2025 01:45	9.00	1.12	3.12	0.72	1.98	1.68	1.32	1.20	1.62	0.99	1.27	2.86	1.16	2.38	2.00	
07/02/2025 02:00	9.00	1.12	3.12	0.73	1.97	1.68	1.32	1.21	1.62	0.99	1.28	2.87	1.16	2.37	2.01	
07/02/2025 02:15	9.00	1.12	3.12	0.74	1.98	1.69	1.31	1.20	1.62	0.99	1.27	2.87	1.16	2.38	2.00	
07/02/2025 02:30	9.00	1.12	3.12	0.76	1.98	1.68	1.32	1.20	1.63	0.99	1.28	2.86	1.16	2.38	2.00	
07/02/2025 02:45	9.00	1.12	3.12	0.77	1.98	1.68	1.32	1.21	1.62	1.00	1.28	2.86	1.17	2.39	2.01	
07/02/2025 03:00	9.00	1.12	3.12	0.78	1.97	1.69	1.32	1.21	1.62	0.99	1.27	2.86	1.17	2.40	2.01	
07/02/2025 03:15	9.00	1.12	3.12	0.79	1.98	1.68	1.32	1.20	1.62	0.99	1.27	2.86	1.16	2.40	2.00	
07/02/2025 03:30	9.00	1.12	3.12	0.80	1.98	1.68	1.31	1.20	1.63	0.99	1.26	2.87	1.17	2.40	2.01	
07/02/2025 03:45	9.00	1.12	3.13	0.82	1.98	1.69	1.32	1.21	1.62	1.00	1.27	2.87	1.16	2.41	2.01	
07/02/2025 04:00	9.01	1.12	3.13	0.83	1.98	1.68	1.32	1.21	1.61	1.00	1.27	2.87	1.17	2.41	2.01	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
07/02/2025 04:15	9.00	1.12	3.12	0.84	1.98	1.69	1.32	1.20	1.62	0.99	1.27	2.87	1.17	2.41	2.01	
07/02/2025 04:30	9.00	1.12	3.12	0.85	1.98	1.68	1.32	1.20	1.62	0.99	1.28	2.87	1.16	2.42	2.01	
07/02/2025 04:45	9.00	1.12	3.12	0.85	1.98	1.68	1.32	1.20	1.61	0.99	1.27	2.87	1.17	2.42	2.00	
07/02/2025 05:00	9.01	1.12	3.12	0.86	1.97	1.69	1.31	1.21	1.61	0.99	1.28	2.86	1.17	2.43	2.01	
07/02/2025 05:15	9.00	1.12	3.13	0.86	1.98	1.69	1.31	1.20	1.63	1.00	1.27	2.87	1.16	2.43	2.01	
07/02/2025 05:30	9.00	1.12	3.12	0.87	1.98	1.68	1.32	1.20	1.61	1.00	1.27	2.87	1.16	2.43	2.00	
07/02/2025 05:45	9.00	1.12	3.12	0.87	1.99	1.68	1.32	1.21	1.61	0.99	1.27	2.87	1.17	2.44	2.01	
07/02/2025 06:00	9.00	1.12	3.12	0.87	1.97	1.69	1.31	1.21	1.62	0.99	1.28	2.86	1.17	2.44	2.01	
07/02/2025 06:15	9.00	1.12	3.12	0.87	1.98	1.68	1.31	1.20	1.62	1.00	1.28	2.87	1.16	2.44	2.00	
07/02/2025 06:30	9.00	1.12	3.12	0.87	1.98	1.68	1.32	1.21	1.62	1.00	1.28	2.87	1.16	2.45	2.01	
07/02/2025 06:45	9.00	1.12	3.12	0.86	1.99	1.69	1.32	1.20	1.61	1.00	1.28	2.87	1.16	2.45	2.01	
07/02/2025 07:00	9.00	1.12	3.12	0.85	1.97	1.69	1.32	1.21	1.63	1.00	1.28	2.87	1.16	2.45	2.01	
07/02/2025 07:15	9.00	1.12	3.12	0.84	1.98	1.69	1.31	1.20	1.62	1.00	1.28	2.86	1.16	2.46	2.01	
07/02/2025 07:30	9.00	1.12	3.12	0.83	1.98	1.69	1.32	1.21	1.62	1.00	1.28	2.87	1.17	2.46	2.01	
07/02/2025 07:45	9.00	1.12	3.13	0.82	1.98	1.69	1.32	1.20	1.62	1.00	1.28	2.86	1.16	2.46	2.01	
07/02/2025 08:00	9.00	1.12	3.12	0.81	1.98	1.68	1.32	1.21	1.62	0.99	1.27	2.86	1.16	2.47	2.01	
07/02/2025 08:15	9.00	1.12	3.12	0.80	1.98	1.68	1.32	1.21	1.63	1.01	1.28	2.86	1.16	2.47	2.00	
07/02/2025 08:30	9.00	1.13	3.13	0.79	1.98	1.69	1.32	1.21	1.62	0.99	1.28	2.86	1.16	2.47	2.01	
07/02/2025 08:45	9.00	1.12	3.12	0.78	1.98	1.68	1.32	1.20	1.62	1.00	1.28	2.86	1.16	2.46	2.01	
07/02/2025 09:00	9.00	1.12	3.12	0.76	1.97	1.68	1.32	1.21	1.62	1.00	1.28	2.86	1.16	2.46	2.01	
07/02/2025 09:15	9.00	1.12	3.12	0.75	1.98	1.69	1.33	1.21	1.63	1.00	1.28	2.86	1.16	2.46	2.01	
07/02/2025 09:30	9.00	1.12	3.12	0.74	1.98	1.69	1.32	1.20	1.61	0.99	1.27	2.86	1.16	2.45	2.00	
07/02/2025 09:45	9.00	1.12	3.12	0.72	1.99	1.69	1.32	1.21	1.62	0.99	1.28	2.86	1.17	2.45	2.01	
07/02/2025 10:00	9.00	1.12	3.12	0.71	1.97	1.69	1.32	1.21	1.63	1.00	1.28	2.86	1.17	2.44	2.01	
07/02/2025 10:15	9.00	1.12	3.12	0.70	1.98	1.69	1.32	1.20	1.63	1.00	1.27	2.86	1.16	2.44	2.01	
07/02/2025 10:30	9.00	1.12	3.12	0.69	1.99	1.69	1.32	1.20	1.62	1.00	1.28	2.86	1.16	2.43	2.01	
07/02/2025 10:45	9.00	1.12	3.12	0.68	1.99	1.69	1.32	1.20	1.62	1.00	1.28	2.86	1.16	2.43	2.01	
07/02/2025 11:00	9.00	1.13	3.12	0.67	1.98	1.69	1.31	1.21	1.61	1.00	1.27	2.87	1.16	2.42	2.01	
07/02/2025 11:15	9.00	1.12	3.12	0.66	1.98	1.68	1.32	1.21	1.63	1.00	1.27	2.86	1.16	2.41	2.01	
07/02/2025 11:30	9.00	1.12	3.12	0.66	1.98	1.69	1.32	1.20	1.63	0.99	1.27	2.86	1.16	2.41	2.01	
07/02/2025 11:45	9.01	1.12	3.12	0.65	1.99	1.69	1.32	1.20	1.62	1.00	1.28	2.86	1.16	2.41	2.01	
07/02/2025 12:00	9.00	1.13	3.12	0.65	1.98	1.69	1.32	1.21	1.62	0.99	1.28	2.87	1.16	2.40	2.01	
07/02/2025 12:15	9.00	1.12	3.13	0.65	1.99	1.69	1.32	1.21	1.62	1.00	1.28	2.87	1.16	2.40	2.01	
07/02/2025 12:30	9.00	1.12	3.13	0.65	1.99	1.69	1.32	1.21	1.63	1.00	1.28	2.87	1.16	2.40	2.01	
07/02/2025 12:45	9.00	1.12	3.13	0.65	1.99	1.69	1.32	1.20	1.63	1.00	1.28	2.86	1.16	2.39	2.01	
07/02/2025 13:00	9.00	1.13	3.12	0.65	1.98	1.69	1.32	1.21	1.63	0.99	1.28	2.86	1.16	2.39	2.01	
07/02/2025 13:15	9.01	1.12	3.12	0.65	1.99	1.69	1.32	1.21	1.63	1.00	1.27	2.86	1.16	2.38	2.01	
07/02/2025 13:30	9.01	1.12	3.13	0.66	1.99	1.69	1.32	1.21	1.63	1.01	1.28	2.86	1.16	2.39	2.01	
07/02/2025 13:45	9.00	1.12	3.12	0.66	1.99	1.69	1.32	1.21	1.62	1.00	1.28	2.86	1.16	2.38	2.01	
07/02/2025 14:00	9.00	1.12	3.12	0.67	1.98	1.69	1.32	1.21	1.62	0.99	1.27	2.86	1.16	2.37	2.01	
07/02/2025 14:15	9.01	1.12	3.12	0.67	1.99	1.69	1.33	1.21	1.63	1.00	1.28	2.87	1.16	2.37	2.01	
07/02/2025 14:30	9.00	1.12	3.12	0.69	1.99	1.70	1.32	1.21	1.62	1.00	1.27	2.86	1.16	2.37	2.01	
07/02/2025 14:45	9.00	1.12	3.12	0.70	1.99	1.70	1.32	1.21	1.62	1.00	1.27	2.87	1.17	2.36	2.01	
07/02/2025 15:00	9.00	1.12	3.12	0.70	1.98	1.69	1.32	1.21	1.61	1.00	1.27	2.87	1.16	2.36	2.01	
07/02/2025 15:15	9.00	1.12	3.12	0.72	1.99	1.69	1.33	1.21	1.63	1.00	1.27	2.87	1.16	2.36	2.01	
07/02/2025 15:30	9.01	1.12	3.12	0.73	1.99	1.70	1.33	1.21	1.62	1.00	1.28	2.87	1.16	2.37	2.01	
07/02/2025 15:45	9.01	1.12	3.12	0.73	1.99	1.69	1.32	1.21	1.62	1.00	1.27	2.87	1.16	2.37	2.01	
07/02/2025 16:00	9.01	1.12	3.12	0.75	1.98	1.69	1.32	1.22	1.64	1.00	1.28	2.86	1.16	2.38	2.01	
07/02/2025 16:15	9.00	1.12	3.12	0.75	1.98	1.69	1.31	1.21	1.63	1.00	1.28	2.86	1.16	2.37	2.01	
07/02/2025 16:30	9.00	1.12	3.12	0.76	1.99	1.69	1.31	1.21	1.62	1.00	1.27	2.86	1.16	2.37	2.01	
07/02/2025 16:45	9.00	1.12	3.12	0.77	1.99	1.69	1.32	1.21	1.62	1.00	1.28	2.86	1.16	2.38	2.01	
07/02/2025 17:00	9.00	1.12	3.12	0.78	1.98	1.69	1.32	1.21	1.60	1.00	1.28	2.86	1.16	2.39	2.01	
07/02/2025 17:15	9.00	1.12	3.12	0.79	1.99	1.69	1.32	1.21	1.62	1.01	1.27	2.86	1.16	2.39	2.01	
07/02/2025 17:30	9.00	1.12	3.12	0.80	1.98	1.68	1.32	1.20	1.63	1.01	1.28	2.86	1.16	2.39	2.01	
07/02/2025 17:45	9.00	1.12	3.12	0.81	1.98	1.68	1.32	1.21	1.62	1.00	1.27	2.86	1.16	2.40	2.01	
07/02/2025 18:00	9.00	1.12	3.12	0.81	1.97	1.68	1.32	1.21	1.61	1.00	1.27	2.87	1.16	2.40	2.01	
07/02/2025 18:15	9.00	1.12	3.12	0.82	1.99	1.68	1.31	1.21	1.62	1.00	1.27	2.86	1.16	2.41	2.00	
07/02/2025 18:30	9.00	1.12	3.12	0.82	1.98	1.68	1.32	1.20	1.62	1.00	1.27	2.86	1.16	2.41	2.01	
07/02/2025 18:45	9.00	1.12	3.12	0.82	1.98	1.69	1.32	1.21	1.61	1.01	1.28	2.86	1.16	2.41	2.01	
07/02/2025 19:00	9.00	1.12	3.12	0.83	1.97	1.69	1.32	1.21	1.62	1.00	1.28	2.86	1.16	2.42	2.01	
07/02/2025 19:15	9.00	1.12	3.13	0.83	1.98	1.69	1.32	1.21	1.61	1.00	1.28	2.87	1.16	2.41	2.01	
07/02/2025 19:30	9.00	1.12	3.12	0.82	1.98	1.69	1.32	1.21	1.61	1.00	1.28	2.86	1.16	2.42	2.01	
07/02/2025 19:45	9.00	1.12	3.12	0.82	1.98	1.69	1.32	1.21	1.63	1.01	1.28	2.87	1.16	2.43	2.01	
07/02/2025 20:00	9.00	1.12	3.12	0.81	1.97	1.68	1.32	1.21	1.61	0.99	1.27	2.86	1.16	2.43	2.01	
07/02/2025 20:15	9.00	1.12	3.12	0.81	1.99	1.69	1.32	1.21	1.61	1.00	1.28	2.86	1.16	2.44	2.01	
07/02/2025 20:30	9.00	1.12	3.12	0.80	1.99	1.69	1.32	1.21	1.62	1.00	1.28	2.87	1.16	2.44	2.01	
07/02/2025 20:45	9.00	1.12	3.12	0.78	1.99	1.69	1.32	1.21	1.62	1.00	1.28	2.86	1.16	2.44	2.01	
07/02/2025 21:00	9.00	1.12	3.12	0.77	1.98	1.69	1.32	1.21	1.61	1.00	1.28	2.86	1.16	2.44	2.01	
07/02/2025 21:15	9.00	1.12	3.13	0.76	1.98	1.69	1.32	1.21	1.61	1.01	1.28	2.86	1.16	2.44	2.01	
07/02/2025 21:30	9.00	1.12	3.12	0.75	1.99	1.69	1.32	1.21	1.62	1.01	1.28	2.86	1.16	2.43	2.01	
07/02/2025 21:45	9.00	1.12	3.12	0.73	1.98	1.69	1.33	1.21	1.62	1.00	1.28	2.86	1.16	2.43	2.01	
07/02/2025 22:00	9.00	1.13	3.12	0.72	1.98	1.68	1.32	1.21	1.61	1.01	1.29	2.87	1.16	2.42	2.01	
07/02/2025 22:15	9.00	1.12	3.12	0.71	1.99	1.68	1.32	1.20	1.61	1.01	1.29	2.86	1.16	2.42	2.01	
07/02/2025 22:30	9.00	1.12	3.12	0.70	1.99	1.68	1.32	1.21	1.61	1.01	1.29	2.86	1.16	2.41	2.01	
07/02/2025 22:45	9.00	1.12	3.12	0.69	1.98	1.69	1.32	1.21	1.62	1.00	1.27	2.87	1.16	2.41	2.01	
07/02/2025 23:00	9.00	1.12	3.12	0.68	1.98	1.69	1.32	1.21	1.62	1.00	1.28	2.87	1.16	2.41	2.01	
07/02/2025 23:15	9.00	1.12	3.12	0.67	1.99	1.69	1.32	1.21	1.62	1.00	1.28	2.87	1.16	2.40	2.01	
07/02/2025 23:30	9.00	1.12	3.12	0.66	1.98	1.69	1.32	1.20	1.60	1.00	1.28	2.87	1.16	2.40	2.01	
07/02/2025 23:45	9.00	1.12	3.13	0.66	1.99	1.69	1.33	1.21	1.62	1.01	1.28	2.87	1.16	2.39	2.01	
08/02/2025 00:00	9.00	1.13	3.13	0.65	1.98	1.69	1.32	1.21	1.61	1.01	1.28	2.86	1.16	2.39	2.01	
08/02/2025 00:15	9.00	1.12	3.12	0.64	1.99	1.69	1.33	1.21	1.62	1.01	1.28	2.87	1.17	2.38	2.01	
08/02/2025 00:30	9.00	1.12	3.12	0.64	1.99	1.69	1.32	1.21	1.63	1.00	1.28	2.87	1.16	2.38	2.01	
08/02/2025 00:45	9.00	1.13	3.12	0.64	1.98	1.68	1.32	1.21	1.62	1.00	1.28	2.87	1.16	2.38	2.01	
08/02/2025 01:00	9.00	1.12	3.12	0.65	1.98	1.69	1.32	1.21	1.61	1.00	1.29	2.87	1.16	2.37	2.01	
08/02/2025 01:15	9.00	1.13	3.12	0.65	1.98	1.69	1.32	1.21	1.61	1.00	1.28	2.87	1.16	2.37	2.01	
08/02/2025 01:30	9.00	1.13	3.12	0.65	1.99	1.69	1.32	1.21	1.62	1.01	1.29	2.87	1.16	2.37	2.01	
08/02/2025 01:45	9.00	1.12	3.12	0.66	1.99	1.69	1.32	1.21	1.61	1.01	1.28	2.87	1.17	2.36	2.01	
08/02/2025 02:00	9.00	1.13	3.12	0.67	1.98	1.69	1.32	1.21	1.63	1.01	1.28	2.87	1.16	2.36	2.01	
08/02/2025 02:15	9.00	1.13	3.12	0.67	1.99	1.69	1.33	1.21	1.63	1.00	1.29	2.87	1.16	2.36	2.01	
08/02/2025 02:30	9.00	1.12	3.13	0.69	1.99	1.69	1.32	1.21	1.63	1.00	1.29	2.87	1.17	2.35	2.01	
08/02/2025 02:45	9.00	1.12	3.12	0.69	1.99	1.69	1.32	1.21	1.63	0.99	1.28	2.87	1.17	2.35	2.01	
08/02/2025 03:00	9.00	1.12	3.13	0.70	1.98	1.69	1.32	1.21	1.63	1.00	1.28	2.87	1.16	2.35	2.01	
08/02/2025 03:15	9.00	1.13	3.12	0.72	1.99	1.69	1.32	1.21	1.62	1.00	1.28	2.87	1.17	2.35	2.01	
08/02/2025 03:30	9.00	1.12	3.12	0.72	1.99	1.69	1.32	1.20	1.62	1.00	1.28	2.87	1.17	2.35	2.01	
08/02/2025 03:45	9.00	1.12	3.12	0.73	1.98	1.68	1.31	1.20	1.63	0.99	1.29	2.86	1.16	2.35	2.01	
08/02/2025 04:00	9.00	1.12	3.12	0.74	1.98	1.69	1.31	1.21	1.61	0.99	1.28	2.87	1.17	2.36	2.01	
08/02/2025 04:15	9.00	1.13	3.12	0.76	1.99	1.69	1.32	1.21	1.61	1.00	1.29	2.86	1.16	2.36	2.01	
08/02/2025 04:30	9.00	1.12	3.13	0.77	1.99	1.69	1.33	1.21	1.62	1.00	1.28	2.87	1.17	2.37	2.01	
08/02/2025 04:45	9.00	1.12	3.12	0.77	1.98	1.69	1.32	1.21	1.62	1.00	1.29	2.87	1.17	2.37	2.01	
08/02/2025 05:00	9.00	1.13	3.13	0.79	1.98	1.69	1.33	1.21	1.62	1.00	1.29	2.87	1.17	2.38	2.01	
08/02/2025 05:15	9.00	1.12	3.12	0.80	1.98	1.69	1.32	1.21	1.62	1.00	1.29	2.87	1.17	2.38	2.01	
08/02/2025 05:30	9.00	1.12	3.12	0.80	1.98	1.69	1.33	1.21	1.62	0.99	1.28	2.87	1.17	2.39	2.01	
08/02/2025 05:45	9.00	1.12	3.12	0.81	1.98	1.69	1.33	1.21	1.62	1.00	1.28	2.86	1.16	2.39	2.01	
08/02/2025 06:00	9.00	1.12	3.12	0.82	1.97	1.68	1.33	1.21	1.63	1.00	1.28	2.87	1.16	2.39	2.01	
08/02/2025 06:15	9.00	1.12	3.12	0.83	1.98	1.68	1.32	1.21	1.62	1.00	1.28	2.87	1.17	2.40	2.01	
08/02/2025 06:30	9.00	1.12	3.12	0.83	1.98	1.68	1.32	1.20	1.63	1.00	1.28	2.87	1.16	2.40	2.00	
08/02/2025 06:45	9.00	1.12	3.12	0.84	1.98	1.68	1.33	1.20	1.62	0.99	1.28	2.87	1.16	2.40	2.00	
08/02/2025 07:00	9.00	1.12	3.12	0.84	1.97	1.68	1.32	1.21	1.63	0.99	1.28	2.87	1.16	2.41	2.01	
08/02/2025 07:15	9.00	1.12	3.12	0.84	1.98	1.68	1.32	1.21	1.62	1.00	1.29	2.87	1.16	2.41	2.00	
08/02/2025 07:30	9.00	1.12	3.12	0.84	1.98	1.68	1.32	1.20	1.62	1.01	1.28	2.87	1.16	2.42	2.00	
08/02/2025 07:45	9.00	1.12	3.12	0.85	1.98	1.68	1.32	1.20	1.62	1.01	1.28	2.87	1.16	2.42	2.00	
08/02/2025 08:00	9.00	1.12	3.12	0.84	1.97	1.68	1.32	1.20	1.60	0.99	1.28	2.87	1.16	2.42	2.00	
08/02/2025 08:15	9.00	1.12	3.12	0.84	1.98	1.68	1.32	1.20	1.62	0.99	1.28	2.87	1.16	2.43	2.00	
08/02/2025 08:30	9.00	1.12	3.12	0.83	1.98	1.68	1.32	1.20	1.62	1.00	1.28	2.87	1.16	2.43	2.00	
08/02/2025 08:45	9.00	1.12	3.12	0.82	1.98	1.68	1.32	1.20	1.61	0.99	1.28	2.87	1.16	2.43	2.00	
08/02/2025 09:00	9.00	1.12	3.12	0.81	1.97	1.68	1.32	1.21	1.60	1.00	1.28	2.87	1.16	2.44	2.00	
08/02/2025 09:15	9.00	1.12	3.12	0.80	1.98	1.68	1.32	1.20	1.60	1.01	1.28	2.87	1.16	2.44	2.00	
08/02/2025 09:30	9.00	1.12	3.12	0.79	1.98	1.68	1.32	1.20	1.61	1.00	1.29	2.86	1.17	2.44	2.00	
08/02/2025 09:45	9.00	1.12	3.12	0.77	1.98	1.69	1.32	1.20	1.62	0.99	1.28	2.87	1.16	2.44	2.00	
08/02/2025 10:00	9.00	1.12	3.12	0.76	1.97	1.68	1.32	1.21	1.62	1.00	1.28	2.86	1.16	2.44	2.00	
08/02/2025 10:15	9.00	1.12	3.12	0.75	1.98	1.68	1.33	1.20	1.62	1.00	1.28	2.86	1.17	2.43	2.00	
08/02/2025 10:30	9.00	1.12	3.12	0.73	1.98	1.68	1.32	1.20	1.61	1.00	1.28	2.86	1.16	2.43	2.00	
08/02/2025 10:45	9.00	1.12	3.12	0.72	1.97	1.68	1.32	1.20	1.61	0.99	1.28	2.86	1.16	2.42	2.00	
08/02/2025 11:00	9.00	1.12	3.12	0.70	1.97	1.68	1.32	1.21	1.62	0.99	1.28	2.86	1.17	2.42	2.00	
08/02/2025 11:15	9.00	1.12	3.12	0.69	1.98	1.68	1.32	1.20	1.62	0.99	1.28	2.86	1.16	2.42	2.00	
08/02/2025 11:30	9.00	1.12	3.12	0.68	1.97	1.68	1.32	1.20	1.60	1.00	1.28	2.86	1.16	2.41	2.00	
08/02/2025 11:45	9.00	1.12	3.12	0.67	1.97	1.68	1.32	1.20	1.60	0.99	1.28	2.86	1.16	2.41	2.00	
08/02/2025 12:00	9.00	1.12	3.12	0.66	1.97	1.68	1.32	1.21	1.61	1.00	1.28	2.86	1.16	2.40	2.00	
08/02/2025 12:15	8.99	1.12	3.12	0.65	1.97	1.68	1.32	1.20	1.60	0.99	1.28	2.87	1.16	2.39	2.00	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
08/02/2025 12:30	9.00	1.12	3.12	0.64	1.97	1.68	1.32	1.20	1.60	1.00	1.28	2.86	1.16	2.39	2.00	
08/02/2025 12:45	9.00	1.12	3.12	0.64	1.97	1.69	1.32	1.20	1.60	1.00	1.28	2.87	1.16	2.39	2.00	
08/02/2025 13:00	9.00	1.12	3.12	0.63	1.96	1.68	1.33	1.20	1.60	0.99	1.27	2.86	1.16	2.38	2.00	
08/02/2025 13:15	9.00	1.12	3.12	0.62	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.86	1.16	2.38	2.00	
08/02/2025 13:30	9.00	1.12	3.12	0.61	1.97	1.68	1.32	1.20	1.61	1.00	1.27	2.86	1.16	2.37	2.00	
08/02/2025 13:45	9.00	1.12	3.12	0.62	1.97	1.68	1.32	1.20	1.61	0.99	1.27	2.86	1.16	2.37	2.00	
08/02/2025 14:00	9.00	1.12	3.11	0.62	1.97	1.68	1.31	1.21	1.60	0.99	1.28	2.86	1.16	2.37	2.00	
08/02/2025 14:15	9.00	1.12	3.11	0.62	1.97	1.68	1.31	1.20	1.60	0.99	1.28	2.86	1.16	2.36	2.00	
08/02/2025 14:30	9.00	1.12	3.12	0.62	1.97	1.68	1.32	1.19	1.61	0.99	1.28	2.86	1.16	2.36	2.00	
08/02/2025 14:45	9.00	1.12	3.11	0.62	1.97	1.68	1.31	1.20	1.60	0.98	1.28	2.86	1.16	2.35	2.00	
08/02/2025 15:00	9.00	1.12	3.12	0.63	1.96	1.68	1.31	1.20	1.59	0.99	1.28	2.86	1.16	2.35	2.00	
08/02/2025 15:15	9.00	1.12	3.11	0.64	1.97	1.68	1.32	1.20	1.61	0.99	1.28	2.86	1.16	2.35	2.00	
08/02/2025 15:30	9.00	1.12	3.12	0.64	1.97	1.68	1.31	1.20	1.60	0.99	1.28	2.86	1.16	2.34	2.00	
08/02/2025 15:45	9.00	1.12	3.11	0.65	1.97	1.68	1.32	1.20	1.59	0.99	1.27	2.86	1.16	2.33	2.00	
08/02/2025 16:00	9.00	1.11	3.12	0.66	1.96	1.68	1.32	1.20	1.60	0.99	1.27	2.86	1.16	2.34	2.00	
08/02/2025 16:15	9.00	1.12	3.12	0.67	1.97	1.68	1.33	1.20	1.61	0.99	1.28	2.86	1.15	2.33	1.99	
08/02/2025 16:30	8.99	1.11	3.11	0.68	1.97	1.68	1.32	1.19	1.61	0.99	1.27	2.86	1.16	2.33	1.99	
08/02/2025 16:45	9.00	1.12	3.12	0.70	1.97	1.68	1.32	1.20	1.60	0.99	1.28	2.86	1.16	2.33	2.00	
08/02/2025 17:00	9.00	1.12	3.11	0.71	1.96	1.68	1.31	1.20	1.60	0.99	1.28	2.86	1.16	2.34	2.00	
08/02/2025 17:15	9.00	1.12	3.11	0.72	1.97	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.34	2.00	
08/02/2025 17:30	9.00	1.12	3.11	0.73	1.97	1.68	1.32	1.19	1.61	0.99	1.27	2.86	1.16	2.34	2.00	
08/02/2025 17:45	9.00	1.12	3.12	0.75	1.97	1.68	1.32	1.20	1.60	0.99	1.28	2.87	1.16	2.35	2.00	
08/02/2025 18:00	9.00	1.12	3.12	0.76	1.96	1.68	1.31	1.20	1.61	0.99	1.28	2.86	1.16	2.35	2.00	
08/02/2025 18:15	8.99	1.11	3.11	0.77	1.96	1.67	1.32	1.19	1.60	0.99	1.27	2.86	1.16	2.36	1.99	
08/02/2025 18:30	9.00	1.11	3.11	0.78	1.97	1.67	1.31	1.20	1.59	0.99	1.27	2.86	1.16	2.36	2.00	
08/02/2025 18:45	9.00	1.12	3.11	0.79	1.96	1.68	1.31	1.19	1.59	0.99	1.28	2.86	1.16	2.37	2.00	
08/02/2025 19:00	9.00	1.11	3.12	0.80	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.37	1.99	
08/02/2025 19:15	9.00	1.11	3.11	0.81	1.97	1.68	1.31	1.20	1.60	1.00	1.27	2.86	1.16	2.38	1.99	
08/02/2025 19:30	9.00	1.11	3.12	0.82	1.97	1.67	1.31	1.19	1.59	1.00	1.27	2.86	1.16	2.38	1.99	
08/02/2025 19:45	9.00	1.12	3.12	0.82	1.97	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.39	2.00	
08/02/2025 20:00	9.00	1.12	3.11	0.83	1.96	1.67	1.31	1.20	1.61	0.99	1.28	2.86	1.16	2.39	1.99	
08/02/2025 20:15	9.00	1.12	3.12	0.83	1.97	1.67	1.32	1.20	1.60	0.99	1.28	2.87	1.16	2.40	1.99	
08/02/2025 20:30	9.00	1.11	3.11	0.83	1.96	1.67	1.32	1.20	1.60	0.99	1.27	2.86	1.16	2.40	1.99	
08/02/2025 20:45	9.00	1.12	3.12	0.83	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.40	2.00	
08/02/2025 21:00	9.00	1.12	3.12	0.83	1.95	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.41	1.99	
08/02/2025 21:15	9.00	1.12	3.12	0.83	1.96	1.67	1.31	1.20	1.60	0.99	1.28	2.87	1.16	2.42	1.99	
08/02/2025 21:30	9.00	1.11	3.11	0.82	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.42	1.99	
08/02/2025 21:45	9.00	1.12	3.12	0.81	1.97	1.68	1.31	1.20	1.59	1.00	1.28	2.86	1.16	2.42	2.00	
08/02/2025 22:00	9.00	1.12	3.11	0.80	1.95	1.67	1.31	1.20	1.60	0.98	1.27	2.86	1.16	2.43	2.00	
08/02/2025 22:15	9.00	1.12	3.12	0.79	1.97	1.68	1.31	1.20	1.60	0.99	1.27	2.87	1.16	2.43	2.00	
08/02/2025 22:30	9.00	1.12	3.12	0.78	1.97	1.68	1.31	1.20	1.60	1.00	1.28	2.86	1.16	2.43	2.00	
08/02/2025 22:45	9.00	1.12	3.12	0.76	1.97	1.68	1.31	1.20	1.61	0.99	1.28	2.86	1.16	2.43	2.00	
08/02/2025 23:00	9.00	1.12	3.11	0.75	1.96	1.67	1.31	1.20	1.60	1.00	1.27	2.86	1.16	2.42	2.00	
08/02/2025 23:15	9.00	1.12	3.12	0.73	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.42	2.00	
08/02/2025 23:30	9.00	1.12	3.12	0.72	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.42	2.00	
08/02/2025 23:45	9.00	1.11	3.12	0.71	1.96	1.67	1.31	1.20	1.60	0.99	1.26	2.86	1.16	2.41	1.99	
09/02/2025 00:00	9.00	1.12	3.11	0.69	1.96	1.68	1.31	1.20	1.59	1.00	1.27	2.86	1.16	2.40	1.99	
09/02/2025 00:15	9.00	1.11	3.11	0.68	1.96	1.68	1.31	1.20	1.60	1.00	1.28	2.86	1.16	2.40	1.99	
09/02/2025 00:30	9.00	1.11	3.11	0.67	1.96	1.68	1.31	1.20	1.60	1.00	1.28	2.86	1.16	2.39	1.99	
09/02/2025 00:45	9.00	1.12	3.11	0.66	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.39	1.99	
09/02/2025 01:00	9.00	1.12	3.12	0.65	1.95	1.68	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.38	2.00	
09/02/2025 01:15	9.00	1.12	3.12	0.64	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.16	2.38	2.00	
09/02/2025 01:30	9.00	1.12	3.12	0.63	1.96	1.68	1.32	1.20	1.61	0.99	1.28	2.87	1.17	2.38	2.00	
09/02/2025 01:45	9.00	1.11	3.11	0.63	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.86	1.16	2.37	1.99	
09/02/2025 02:00	9.00	1.12	3.12	0.62	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.36	1.99	
09/02/2025 02:15	9.00	1.12	3.12	0.62	1.97	1.68	1.32	1.20	1.60	1.00	1.27	2.86	1.16	2.36	1.99	
09/02/2025 02:30	9.00	1.12	3.11	0.62	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.36	1.99	
09/02/2025 02:45	9.00	1.12	3.12	0.63	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.35	1.99	
09/02/2025 03:00	9.00	1.12	3.11	0.63	1.96	1.68	1.32	1.20	1.61	0.99	1.27	2.87	1.16	2.35	1.99	
09/02/2025 03:15	9.00	1.12	3.11	0.64	1.96	1.68	1.31	1.20	1.61	1.00	1.28	2.87	1.16	2.35	2.00	
09/02/2025 03:30	9.00	1.12	3.12	0.65	1.97	1.68	1.31	1.20	1.62	1.00	1.27	2.86	1.16	2.34	2.00	
09/02/2025 03:45	9.00	1.12	3.12	0.65	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.34	2.00	
09/02/2025 04:00	9.00	1.12	3.12	0.67	1.96	1.68	1.30	1.20	1.60	1.00	1.27	2.87	1.16	2.34	2.00	
09/02/2025 04:15	9.01	1.12	3.12	0.68	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.33	2.00	
09/02/2025 04:30	9.00	1.11	3.12	0.68	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.16	2.33	2.00	
09/02/2025 04:45	9.00	1.12	3.11	0.70	1.96	1.68	1.32	1.20	1.62	1.00	1.27	2.86	1.16	2.33	1.99	
09/02/2025 05:00	9.00	1.12	3.11	0.71	1.96	1.68	1.31	1.21	1.61	0.99	1.27	2.86	1.16	2.34	2.00	
09/02/2025 05:15	9.00	1.12	3.12	0.72	1.97	1.68	1.32	1.20	1.61	1.00	1.27	2.87	1.16	2.34	2.00	
09/02/2025 05:30	9.00	1.11	3.12	0.73	1.97	1.68	1.31	1.20	1.60	1.00	1.27	2.86	1.16	2.34	2.00	
09/02/2025 05:45	9.00	1.11	3.11	0.75	1.97	1.67	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.35	2.00	
09/02/2025 06:00	9.00	1.12	3.12	0.76	1.96	1.68	1.31	1.20	1.60	1.00	1.27	2.87	1.16	2.36	2.00	
09/02/2025 06:15	9.00	1.12	3.11	0.77	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.16	2.36	2.00	
09/02/2025 06:30	9.00	1.12	3.11	0.78	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.87	1.16	2.37	2.00	
09/02/2025 06:45	9.00	1.12	3.12	0.80	1.97	1.68	1.32	1.20	1.60	1.00	1.27	2.86	1.16	2.37	1.99	
09/02/2025 07:00	9.00	1.12	3.11	0.81	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.87	1.16	2.38	2.00	
09/02/2025 07:15	9.00	1.12	3.11	0.82	1.96	1.68	1.31	1.20	1.60	1.00	1.27	2.87	1.16	2.38	2.00	
09/02/2025 07:30	9.00	1.12	3.12	0.83	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.16	2.39	2.00	
09/02/2025 07:45	9.00	1.12	3.12	0.84	1.96	1.68	1.31	1.20	1.60	1.00	1.27	2.87	1.16	2.39	2.00	
09/02/2025 08:00	9.00	1.11	3.11	0.85	1.95	1.67	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.39	1.99	
09/02/2025 08:15	9.00	1.12	3.12	0.85	1.96	1.68	1.31	1.20	1.60	1.00	1.27	2.86	1.16	2.39	1.99	
09/02/2025 08:30	9.00	1.11	3.12	0.86	1.96	1.67	1.31	1.19	1.60	1.00	1.27	2.86	1.16	2.40	1.99	
09/02/2025 08:45	9.00	1.12	3.12	0.86	1.96	1.68	1.32	1.20	1.60	1.00	1.27	2.86	1.16	2.40	2.00	
09/02/2025 09:00	9.00	1.12	3.12	0.86	1.96	1.68	1.32	1.20	1.60	1.00	1.27	2.86	1.16	2.41	2.00	
09/02/2025 09:15	9.00	1.11	3.12	0.86	1.96	1.68	1.31	1.19	1.61	1.00	1.27	2.86	1.16	2.41	1.99	
09/02/2025 09:30	9.00	1.11	3.12	0.86	1.96	1.68	1.31	1.19	1.60	1.00	1.28	2.86	1.16	2.42	1.99	
09/02/2025 09:45	9.00	1.12	3.12	0.86	1.96	1.68	1.31	1.20	1.62	1.00	1.27	2.86	1.16	2.42	1.99	
09/02/2025 10:00	9.00	1.11	3.12	0.85	1.95	1.67	1.31	1.20	1.60	1.00	1.27	2.86	1.16	2.42	1.99	
09/02/2025 10:15	9.00	1.11	3.11	0.84	1.96	1.67	1.31	1.19	1.60	1.00	1.27	2.86	1.16	2.43	1.99	
09/02/2025 10:30	9.00	1.12	3.11	0.83	1.96	1.67	1.31	1.19	1.60	1.00	1.28	2.86	1.15	2.43	1.99	
09/02/2025 10:45	9.00	1.12	3.12	0.82	1.96	1.67	1.31	1.20	1.59	1.00	1.27	2.86	1.16	2.43	1.99	
09/02/2025 11:00	9.00	1.11	3.11	0.81	1.95	1.67	1.30	1.20	1.59	1.00	1.27	2.86	1.16	2.44	1.99	
09/02/2025 11:15	9.00	1.11	3.12	0.79	1.96	1.67	1.31	1.20	1.60	0.99	1.28	2.86	1.16	2.44	1.99	
09/02/2025 11:30	9.00	1.11	3.11	0.78	1.96	1.67	1.31	1.20	1.61	1.00	1.28	2.86	1.15	2.44	1.99	
09/02/2025 11:45	9.00	1.11	3.11	0.77	1.96	1.67	1.31	1.19	1.59	1.00	1.27	2.86	1.15	2.44	1.99	
09/02/2025 12:00	9.00	1.11	3.11	0.76	1.95	1.67	1.31	1.20	1.59	0.99	1.27	2.86	1.16	2.44	1.99	
09/02/2025 12:15	9.00	1.11	3.11	0.74	1.96	1.67	1.31	1.19	1.60	1.00	1.27	2.86	1.15	2.43	1.99	
09/02/2025 12:30	9.00	1.11	3.11	0.73	1.96	1.67	1.31	1.19	1.62	1.00	1.27	2.86	1.16	2.42	1.99	
09/02/2025 12:45	9.00	1.11	3.11	0.72	1.96	1.67	1.31	1.19	1.60	1.00	1.27	2.86	1.16	2.42	1.99	
09/02/2025 13:00	9.00	1.11	3.11	0.71	1.95	1.67	1.32	1.20	1.60	1.00	1.27	2.86	1.16	2.42	2.00	
09/02/2025 13:15	9.00	1.12	3.11	0.69	1.96	1.67	1.32	1.19	1.59	1.00	1.27	2.86	1.15	2.41	1.99	
09/02/2025 13:30	9.00	1.11	3.11	0.68	1.96	1.67	1.31	1.19	1.60	1.00	1.27	2.86	1.15	2.40	1.99	
09/02/2025 13:45	9.00	1.11	3.11	0.67	1.96	1.68	1.31	1.19	1.61	0.98	1.27	2.86	1.15	2.40	1.99	
09/02/2025 14:00	9.00	1.11	3.11	0.67	1.95	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.40	1.99	
09/02/2025 14:15	9.00	1.11	3.12	0.65	1.96	1.67	1.30	1.19	1.60	1.00	1.27	2.86	1.16	2.39	1.99	
09/02/2025 14:30	9.00	1.11	3.12	0.65	1.96	1.67	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.39	1.99	
09/02/2025 14:45	9.00	1.12	3.12	0.64	1.96	1.67	1.31	1.19	1.61	1.00	1.27	2.86	1.16	2.38	1.99	
09/02/2025 15:00	9.00	1.12	3.11	0.64	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.37	1.99	
09/02/2025 15:15	9.00	1.11	3.11	0.64	1.96	1.67	1.31	1.20	1.61	0.99	1.28	2.86	1.15	2.37	1.99	
09/02/2025 15:30	9.00	1.11	3.11	0.63	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.15	2.37	1.99	
09/02/2025 15:45	9.00	1.11	3.11	0.64	1.96	1.67	1.31	1.19	1.61	1.00	1.27	2.86	1.16	2.36	2.00	
09/02/2025 16:00	9.00	1.11	3.11	0.64	1.95	1.68	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.36	2.00	
09/02/2025 16:15	9.00	1.11	3.12	0.65	1.96	1.67	1.31	1.19	1.60	0.99	1.26	2.86	1.15	2.35	1.99	
09/02/2025 16:30	9.00	1.11	3.11	0.65	1.97	1.67	1.31	1.19	1.61	1.00	1.27	2.86	1.16	2.35	1.99	
09/02/2025 16:45	9.00	1.11	3.12	0.66	1.97	1.67	1.30	1.19	1.60	1.00	1.27	2.86	1.16	2.35	1.99	
09/02/2025 17:00	9.00	1.11	3.12	0.68	1.95	1.67	1.31	1.20	1.61	0.98	1.27	2.86	1.16	2.34	1.99	
09/02/2025 17:15	9.00	1.12	3.11	0.69	1.96	1.67	1.31	1.19	1.61	0.99	1.27	2.86	1.15	2.34	1.99	
09/02/2025 17:30	9.00	1.11	3.12	0.70	1.97	1.67	1.31	1.19	1.60	0.99	1.28	2.86	1.16	2.34	1.99	
09/02/2025 17:45	9.00	1.11	3.11	0.71	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.35	1.99	
09/02/2025 18:00	9.00	1.11	3.11	0.72	1.95	1.67	1.31	1.20	1.60	0.98	1.27	2.86	1.15	2.35	1.99	
09/02/2025 18:15	9.00	1.11	3.11	0.73	1.96	1.67	1.30	1.20	1.60	0.99	1.28	2.86	1.15	2.35	1.99	
09/02/2025 18:30	9.00	1.11	3.11	0.74	1.96	1.67	1.31	1.19	1.61	0.99	1.28	2.86	1.16	2.35	1.99	
09/02/2025 18:45	9.00	1.11	3.11	0.76	1.96	1.67	1.30	1.20	1.60	0.99	1.28	2.86	1.16	2.36	1.99	
09/02/2025 19:00	9.00	1.11	3.11	0.77	1.95	1.67	1.31	1.20	1.59	1.00	1.27	2.86	1.16	2.36	1.99	
09/02/2025 19:15	9.00	1.11	3.11	0.78	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.37	1.99	
09/02/2025 19:30	9.00	1.11	3.12	0.79	1.96	1.67	1.31	1.20	1.59	1.00	1.28	2.86	1.15	2.37	2.00	
09/02/2025 19:45	9.00	1.11	3.11	0.80	1.97	1.68	1.32	1.20	1.60	1.00	1.27	2.86	1.16	2.38	2.00	
09/02/2025 20:00	9.00	1.11	3.11	0.81	1.95	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.38	1.99	
09/02/2025 20:15	9.00	1.12	3.11	0.82	1.97	1.68	1.32	1.20	1.61	0.99	1.27	2.86	1.16	2.39	2.00	
09/02/2025 20:30	9.00	1.11	3.11	0.82	1.96	1.67	1.32	1.20	1.60	0.99	1.27	2.86	1.16	2.39	2.00	

Appendix C: Diver Water Level Data

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
09/02/2025 20:45	9.00	1.11	3.12	0.83	1.96	1.67	1.32	1.20	1.60	0.99	1.27	2.86	1.16	2.40	2.00	
09/02/2025 21:00	9.00	1.12	3.12	0.84	1.96	1.67	1.32	1.20	1.61	0.99	1.27	2.86	1.16	2.40	2.00	
09/02/2025 21:15	9.00	1.11	3.12	0.83	1.96	1.68	1.31	1.20	1.59	0.99	1.27	2.86	1.16	2.40	2.00	
09/02/2025 21:30	9.00	1.11	3.12	0.84	1.97	1.67	1.32	1.20	1.60	0.99	1.27	2.86	1.16	2.40	2.00	
09/02/2025 21:45	9.00	1.12	3.12	0.84	1.97	1.68	1.31	1.20	1.60	0.99	1.28	2.86	1.16	2.41	2.00	
09/02/2025 22:00	9.00	1.12	3.12	0.83	1.96	1.68	1.31	1.20	1.60	0.99	1.28	2.86	1.15	2.41	2.00	
09/02/2025 22:15	9.00	1.11	3.11	0.83	1.97	1.68	1.31	1.20	1.60	0.99	1.28	2.86	1.15	2.42	2.00	
09/02/2025 22:30	9.00	1.11	3.12	0.82	1.97	1.68	1.32	1.20	1.61	0.99	1.27	2.87	1.15	2.42	2.00	
09/02/2025 22:45	9.00	1.11	3.11	0.82	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.87	1.16	2.42	2.00	
09/02/2025 23:00	9.00	1.11	3.11	0.81	1.96	1.68	1.30	1.20	1.60	0.99	1.27	2.86	1.16	2.43	2.00	
09/02/2025 23:15	9.00	1.12	3.11	0.79	1.97	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.43	1.99	
09/02/2025 23:30	9.00	1.11	3.12	0.78	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.43	2.00	
09/02/2025 23:45	9.00	1.11	3.11	0.77	1.97	1.67	1.31	1.19	1.60	0.99	1.27	2.86	1.16	2.42	2.00	
10/02/2025 00:00	9.00	1.11	3.12	0.75	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.15	2.42	2.00	
10/02/2025 00:15	9.00	1.11	3.11	0.74	1.97	1.68	1.31	1.20	1.59	0.99	1.28	2.86	1.16	2.42	2.00	
10/02/2025 00:30	9.00	1.11	3.12	0.72	1.97	1.68	1.31	1.20	1.59	1.00	1.27	2.86	1.16	2.42	2.00	
10/02/2025 00:45	9.00	1.12	3.12	0.71	1.97	1.68	1.31	1.20	1.59	1.00	1.28	2.87	1.16	2.41	2.00	
10/02/2025 01:00	9.00	1.12	3.11	0.70	1.96	1.68	1.31	1.21	1.61	0.99	1.27	2.86	1.16	2.41	2.00	
10/02/2025 01:15	9.00	1.12	3.12	0.68	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.40	2.00	
10/02/2025 01:30	9.00	1.11	3.12	0.67	1.97	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.40	2.00	
10/02/2025 01:45	9.00	1.11	3.12	0.66	1.98	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.15	2.39	2.00	
10/02/2025 02:00	9.00	1.11	3.12	0.64	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.39	2.00	
10/02/2025 02:15	9.00	1.12	3.12	0.63	1.97	1.68	1.32	1.20	1.60	1.00	1.27	2.87	1.15	2.38	2.00	
10/02/2025 02:30	9.00	1.12	3.12	0.62	1.97	1.68	1.32	1.20	1.60	0.99	1.27	2.86	1.16	2.38	2.00	
10/02/2025 02:45	9.00	1.12	3.11	0.61	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.37	2.00	
10/02/2025 03:00	9.00	1.12	3.11	0.60	1.96	1.68	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.37	2.00	
10/02/2025 03:15	9.00	1.12	3.12	0.60	1.97	1.68	1.31	1.20	1.59	0.99	1.27	2.87	1.16	2.36	2.00	
10/02/2025 03:30	9.00	1.12	3.12	0.59	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.86	1.16	2.36	2.00	
10/02/2025 03:45	9.00	1.11	3.12	0.60	1.97	1.68	1.31	1.20	1.60	0.99	1.27	2.87	1.16	2.35	2.00	
10/02/2025 04:00	9.00	1.12	3.12	0.59	1.96	1.68	1.31	1.21	1.61	0.99	1.27	2.87	1.16	2.35	2.00	
10/02/2025 04:15	9.00	1.11	3.12	0.60	1.97	1.68	1.30	1.20	1.62	1.00	1.27	2.86	1.16	2.34	2.00	
10/02/2025 04:30	9.00	1.12	3.11	0.61	1.97	1.68	1.31	1.20	1.62	0.99	1.28	2.87	1.16	2.34	2.00	
10/02/2025 04:45	9.00	1.12	3.12	0.62	1.98	1.68	1.32	1.20	1.61	0.99	1.27	2.87	1.16	2.34	2.00	
10/02/2025 05:00	9.00	1.12	3.12	0.62	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.15	2.33	2.00	
10/02/2025 05:15	9.00	1.12	3.12	0.64	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.87	1.16	2.33	2.00	
10/02/2025 05:30	9.00	1.11	3.11	0.65	1.97	1.68	1.31	1.20	1.60	0.99	1.28	2.87	1.16	2.33	2.00	
10/02/2025 05:45	9.00	1.12	3.12	0.66	1.98	1.68	1.31	1.20	1.61	0.99	1.28	2.87	1.16	2.32	2.00	
10/02/2025 06:00	9.00	1.12	3.12	0.67	1.96	1.68	1.31	1.21	1.60	0.98	1.27	2.86	1.16	2.32	2.00	
10/02/2025 06:15	9.00	1.11	3.12	0.69	1.98	1.68	1.31	1.20	1.62	1.00	1.27	2.86	1.16	2.32	2.00	
10/02/2025 06:30	9.00	1.12	3.12	0.70	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.86	1.16	2.32	2.00	
10/02/2025 06:45	9.00	1.12	3.12	0.71	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.86	1.16	2.33	2.00	
10/02/2025 07:00	9.00	1.12	3.12	0.73	1.96	1.68	1.31	1.21	1.60	0.98	1.27	2.86	1.16	2.33	2.00	
10/02/2025 07:15	9.00	1.12	3.12	0.74	1.97	1.68	1.31	1.20	1.62	0.99	1.28	2.86	1.16	2.33	2.00	
10/02/2025 07:30	9.00	1.12	3.11	0.75	1.97	1.68	1.31	1.20	1.62	1.00	1.27	2.86	1.16	2.33	2.00	
10/02/2025 07:45	9.00	1.12	3.12	0.77	1.97	1.68	1.32	1.20	1.61	0.99	1.28	2.86	1.16	2.35	2.00	
10/02/2025 08:00	9.01	1.12	3.12	0.78	1.96	1.68	1.31	1.21	1.60	1.00	1.28	2.86	1.15	2.35	2.00	
10/02/2025 08:15	9.00	1.12	3.12	0.79	1.97	1.68	1.30	1.20	1.61	0.99	1.27	2.86	1.16	2.35	2.00	
10/02/2025 08:30	9.00	1.11	3.12	0.80	1.97	1.68	1.31	1.20	1.60	0.99	1.28	2.86	1.16	2.36	2.00	
10/02/2025 08:45	9.00	1.12	3.12	0.81	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.86	1.16	2.36	2.00	
10/02/2025 09:00	9.00	1.12	3.12	0.82	1.97	1.68	1.31	1.20	1.61	0.99	1.28	2.86	1.16	2.36	2.00	
10/02/2025 09:15	9.00	1.12	3.12	0.82	1.97	1.68	1.32	1.20	1.61	0.99	1.27	2.86	1.15	2.37	2.00	
10/02/2025 09:30	9.00	1.12	3.11	0.83	1.97	1.68	1.32	1.20	1.62	0.99	1.27	2.86	1.16	2.37	2.00	
10/02/2025 09:45	9.00	1.12	3.11	0.84	1.97	1.68	1.32	1.19	1.61	0.99	1.27	2.86	1.16	2.37	2.00	
10/02/2025 10:00	9.00	1.12	3.12	0.84	1.97	1.68	1.31	1.21	1.60	1.00	1.27	2.86	1.16	2.38	2.00	
10/02/2025 10:15	9.00	1.11	3.12	0.84	1.98	1.69	1.32	1.20	1.61	0.99	1.28	2.86	1.16	2.38	2.00	
10/02/2025 10:30	9.00	1.12	3.11	0.84	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.86	1.15	2.39	2.00	
10/02/2025 10:45	9.00	1.12	3.12	0.84	1.97	1.68	1.32	1.20	1.60	0.99	1.27	2.86	1.16	2.39	2.00	
10/02/2025 11:00	9.00	1.11	3.11	0.83	1.96	1.68	1.31	1.20	1.61	0.98	1.27	2.86	1.15	2.39	2.00	
10/02/2025 11:15	9.01	1.12	3.12	0.83	1.98	1.68	1.32	1.20	1.61	0.99	1.28	2.86	1.16	2.40	2.00	
10/02/2025 11:30	9.00	1.12	3.12	0.82	1.97	1.69	1.32	1.20	1.62	0.99	1.28	2.86	1.15	2.40	2.00	
10/02/2025 11:45	9.00	1.12	3.12	0.81	1.98	1.68	1.32	1.20	1.61	1.00	1.28	2.86	1.16	2.40	2.00	
10/02/2025 12:00	9.00	1.12	3.12	0.80	1.97	1.69	1.31	1.21	1.61	0.99	1.27	2.86	1.16	2.41	2.00	
10/02/2025 12:15	9.00	1.12	3.12	0.78	1.98	1.68	1.32	1.20	1.62	1.00	1.28	2.86	1.15	2.41	2.00	
10/02/2025 12:30	9.00	1.12	3.11	0.77	1.97	1.68	1.31	1.20	1.61	0.99	1.28	2.86	1.15	2.41	2.00	
10/02/2025 12:45	9.00	1.12	3.12	0.75	1.98	1.69	1.32	1.20	1.61	0.98	1.28	2.86	1.15	2.40	2.00	
10/02/2025 13:00	9.00	1.12	3.12	0.74	1.97	1.69	1.32	1.20	1.61	0.99	1.28	2.86	1.15	2.40	2.00	
10/02/2025 13:15	9.00	1.12	3.12	0.73	1.98	1.69	1.32	1.20	1.62	0.99	1.27	2.86	1.16	2.40	2.00	
10/02/2025 13:30	9.00	1.12	3.11	0.72	1.98	1.69	1.32	1.20	1.63	1.00	1.27	2.86	1.16	2.40	2.01	
10/02/2025 13:45	9.00	1.12	3.11	0.70	1.98	1.69	1.32	1.20	1.62	0.99	1.28	2.86	1.15	2.39	2.00	
10/02/2025 14:00	9.00	1.12	3.12	0.70	1.97	1.69	1.32	1.21	1.62	1.00	1.27	2.86	1.15	2.39	2.01	
10/02/2025 14:15	9.00	1.12	3.12	0.68	1.98	1.69	1.32	1.20	1.63	0.99	1.27	2.86	1.15	2.38	2.00	
10/02/2025 14:30	9.00	1.12	3.12	0.67	1.98	1.68	1.32	1.20	1.62	0.99	1.28	2.86	1.15	2.38	2.00	
10/02/2025 14:45	9.00	1.12	3.12	0.66	1.98	1.69	1.32	1.20	1.62	0.99	1.28	2.86	1.16	2.38	2.01	
10/02/2025 15:00	9.00	1.12	3.12	0.65	1.97	1.69	1.32	1.21	1.62	0.99	1.28	2.86	1.15	2.36	2.01	
10/02/2025 15:15	9.00	1.12	3.12	0.64	1.98	1.69	1.32	1.20	1.62	1.00	1.28	2.86	1.15	2.36	2.01	
10/02/2025 15:30	9.00	1.12	3.12	0.63	1.98	1.69	1.32	1.21	1.61	1.00	1.28	2.86	1.16	2.36	2.01	
10/02/2025 15:45	9.00	1.12	3.12	0.63	1.98	1.69	1.32	1.20	1.61	0.99	1.28	2.86	1.15	2.35	2.01	
10/02/2025 16:00	9.00	1.12	3.12	0.63	1.97	1.68	1.32	1.21	1.62	1.00	1.28	2.86	1.16	2.35	2.01	
10/02/2025 16:15	9.00	1.12	3.12	0.63	1.98	1.69	1.31	1.20	1.61	1.00	1.28	2.86	1.15	2.35	2.01	
10/02/2025 16:30	9.00	1.12	3.12	0.63	1.98	1.68	1.32	1.20	1.61	1.00	1.27	2.86	1.15	2.34	2.00	
10/02/2025 16:45	9.00	1.12	3.12	0.64	1.98	1.68	1.32	1.20	1.63	0.99	1.28	2.86	1.15	2.34	2.01	
10/02/2025 17:00	9.00	1.12	3.12	0.65	1.97	1.68	1.31	1.21	1.60	0.99	1.27	2.87	1.16	2.33	2.01	
10/02/2025 17:15	9.00	1.12	3.12	0.66	1.98	1.68	1.32	1.20	1.61	1.00	1.27	2.87	1.15	2.33	2.01	
10/02/2025 17:30	9.00	1.12	3.12	0.67	1.98	1.68	1.31	1.20	1.61	0.99	1.28	2.87	1.16	2.33	2.01	
10/02/2025 17:45	9.01	1.12	3.12	0.68	1.98	1.69	1.32	1.20	1.61	1.00	1.27	2.87	1.16	2.33	2.01	
10/02/2025 18:00	9.01	1.12	3.12	0.69	1.97	1.69	1.32	1.21	1.61	0.99	1.28	2.87	1.16	2.33	2.01	
10/02/2025 18:15	9.00	1.12	3.12	0.70	1.98	1.69	1.32	1.21	1.61	0.99	1.28	2.87	1.16	2.32	2.01	
10/02/2025 18:30	9.00	1.12	3.12	0.71	1.98	1.68	1.32	1.20	1.61	0.99	1.26	2.87	1.15	2.32	2.00	
10/02/2025 18:45	9.00	1.11	3.12	0.72	1.98	1.68	1.32	1.20	1.61	0.98	1.27	2.86	1.16	2.32	2.00	
10/02/2025 19:00	9.00	1.12	3.12	0.73	1.97	1.69	1.32	1.21	1.60	1.00	1.28	2.87	1.16	2.33	2.01	
10/02/2025 19:15	9.00	1.12	3.12	0.75	1.98	1.69	1.32	1.20	1.61	0.99	1.28	2.87	1.16	2.33	2.01	
10/02/2025 19:30	9.00	1.12	3.12	0.76	1.98	1.69	1.32	1.20	1.61	1.00	1.28	2.87	1.16	2.34	2.01	
10/02/2025 19:45	9.00	1.12	3.12	0.77	1.98	1.68	1.32	1.20	1.62	0.99	1.28	2.87	1.16	2.35	2.01	
10/02/2025 20:00	9.00	1.12	3.12	0.78	1.97	1.68	1.32	1.21	1.60	1.00	1.28	2.87	1.16	2.35	2.01	
10/02/2025 20:15	9.00	1.12	3.12	0.79	1.98	1.68	1.32	1.20	1.62	0.99	1.28	2.87	1.16	2.35	2.01	
10/02/2025 20:30	9.00	1.12	3.12	0.80	1.98	1.68	1.31	1.20	1.62	0.99	1.28	2.87	1.17	2.36	2.01	
10/02/2025 20:45	9.00	1.12	3.12	0.81	1.98	1.68	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.36	2.00	
10/02/2025 21:00	9.00	1.12	3.12	0.82	1.97	1.68	1.31	1.21	1.60	0.99	1.28	2.87	1.16	2.37	2.01	
10/02/2025 21:15	9.00	1.12	3.12	0.83	1.98	1.69	1.32	1.20	1.59	0.99	1.28	2.88	1.17	2.38	2.01	
10/02/2025 21:30	9.00	1.12	3.12	0.83	1.98	1.69	1.32	1.20	1.61	1.00	1.28	2.88	1.17	2.38	2.01	
10/02/2025 21:45	9.00	1.12	3.12	0.83	1.98	1.69	1.32	1.20	1.61	0.99	1.28	2.88	1.16	2.38	2.00	
10/02/2025 22:00	9.00	1.12	3.12	0.84	1.97	1.69	1.32	1.21	1.60	0.99	1.27	2.88	1.16	2.39	2.01	
10/02/2025 22:15	9.00	1.12	3.12	0.84	1.98	1.69	1.32	1.20	1.60	0.99	1.27	2.88	1.16	2.39	2.01	
10/02/2025 22:30	9.00	1.12	3.12	0.84	1.98	1.69	1.31	1.20	1.60	1.00	1.28	2.87	1.17	2.40	2.00	
10/02/2025 22:45	9.00	1.12	3.12	0.84	1.98	1.68	1.32	1.20	1.60	1.00	1.28	2.88	1.17	2.40	2.01	
10/02/2025 23:00	9.00	1.12	3.12	0.83	1.97	1.68	1.31	1.21	1.60	0.99	1.28	2.88	1.16	2.41	2.01	
10/02/2025 23:15	9.00	1.12	3.12	0.83	1.98	1.69	1.32	1.20	1.61	0.99	1.28	2.88	1.17	2.41	2.01	
10/02/2025 23:30	9.00	1.12	3.12	0.82	1.98	1.68	1.32	1.20	1.60	1.00	1.28	2.88	1.17	2.41	2.00	
10/02/2025 23:45	9.00	1.12	3.13	0.82	1.98	1.69	1.32	1.20	1.60	1.00	1.28	2.88	1.17	2.42	2.01	
11/02/2025 00:00	9.00	1.12	3.12	0.80	1.97	1.69	1.31	1.21	1.60	1.00	1.28	2.88	1.17	2.42	2.01	
11/02/2025 00:15	9.00	1.12	3.12	0.79	1.98	1.68	1.31	1.20	1.61	1.01	1.28	2.88	1.18	2.42	2.01	
11/02/2025 00:30	9.01	1.12	3.13	0.78	1.98	1.69	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.42	2.01	
11/02/2025 00:45	9.00	1.12	3.13	0.76	1.98	1.68	1.32	1.20	1.60	1.00	1.28	2.88	1.18	2.42	2.01	
11/02/2025 01:00	9.01	1.12	3.13	0.74	1.97	1.68	1.31	1.21	1.60	1.00	1.28	2.89	1.18	2.42	2.01	
11/02/2025 01:15	9.00	1.12	3.12	0.72	1.98	1.68	1.31	1.20	1.61	1.01	1.28	2.88	1.18	2.41	2.00	
11/02/2025 01:30	9.00	1.12	3.13	0.70	1.98	1.68	1.32	1.20	1.61	1.00	1.28	2.89	1.18	2.41	2.01	
11/02/2025 01:45	9.00	1.12	3.13	0.69	1.98	1.68	1.31	1.20	1.60	1.00	1.28	2.89	1.18	2.40	2.01	
11/02/2025 02:00	9.00	1.12	3.13	0.67	1.97	1.68	1.32	1.21	1.61	1.00	1.28	2.89	1.18	2.40	2.01	
11/02/2025 02:15	9.00	1.12	3.13	0.66	1.98	1.68	1.32	1.20	1.60	0.99	1.27	2.89	1.17	2.39	2.00	
11/02/2025 02:30	9.00	1.12	3.13	0.64	1.97	1.68	1.32	1.20	1.60	1.00	1.28	2.89	1.18	2.39	2.00	
11/02/2025 02:45	9.00	1.12	3.12	0.63	1.98	1.68	1.32	1.20	1.61	1.00	1.28	2.89	1.18	2.38	2.00	
11/02/2025 03:00	9.00	1.12	3.13	0.61	1.97	1.68	1.32	1.21	1.60	1.00	1.28	2.88	1.18	2.37	2.01	
11/02/2025 03:15	9.00	1.12	3.12	0.60	1.98	1.68	1.32	1.20	1.61	1.01	1.28	2.88	1.18	2.37	2.00	
11/02/2025 03:30	9.00	1.12	3.12	0.59	1.98	1.68	1.31	1.20	1.61	1.00	1.28	2.88	1.18	2.37	2.00	
11/02/2025 03:45	9.01	1.12	3.13	0.58	1.98	1.68	1.31	1.20	1.60	0.99	1.27	2.88	1.18	2.36	2.00	
11/02/2025 04:00	9.00	1.12	3.12	0.57	1.97	1.68	1.32	1.20	1.61	1.00	1.27	2.89	1.19	2.36	2.01	
11/02/2025 04:15	9.00	1.12	3.12	0.57	1.98	1.68	1.32	1.20	1.60	1.00	1.28	2.88	1.18	2.36	2.00	
11/02/2025 04:30	9.00	1.12	3.13	0.57	1.98	1.68	1.32	1.20	1.61	1.00	1.28	2.89	1.18	2.35	2.01	
11/02/2025 04:45	9.00	1.12	3.12	0.57	1.98	1.68	1.32	1.19	1.60	1.00	1.28	2.88	1.18	2.35	2.00	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
11/02/2025 05:00	9.00	1.12	3.13	0.58	1.97	1.68	1.32	1.21	1.60	1.00	1.27	2.89	1.18	2.35	2.01	
11/02/2025 05:15	9.00	1.12	3.13	0.58	1.98	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.34	2.01	
11/02/2025 05:30	9.00	1.12	3.13	0.59	1.98	1.69	1.32	1.20	1.60	1.00	1.28	2.89	1.18	2.34	2.01	
11/02/2025 05:45	9.00	1.12	3.13	0.60	1.98	1.69	1.31	1.20	1.60	1.00	1.28	2.88	1.18	2.34	2.00	
11/02/2025 06:00	9.00	1.12	3.12	0.62	1.96	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.33	2.00	
11/02/2025 06:15	9.00	1.12	3.13	0.63	1.98	1.68	1.32	1.20	1.62	1.00	1.28	2.88	1.18	2.33	2.00	
11/02/2025 06:30	9.00	1.12	3.13	0.64	1.98	1.68	1.32	1.20	1.60	1.00	1.27	2.88	1.18	2.33	2.00	
11/02/2025 06:45	9.00	1.12	3.13	0.66	1.98	1.68	1.32	1.20	1.61	1.00	1.29	2.88	1.18	2.32	2.01	
11/02/2025 07:00	9.00	1.12	3.13	0.67	1.97	1.68	1.32	1.21	1.61	1.00	1.28	2.88	1.18	2.33	2.00	
11/02/2025 07:15	9.00	1.12	3.13	0.68	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.33	2.00	
11/02/2025 07:30	9.00	1.12	3.13	0.69	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.32	2.00	
11/02/2025 07:45	9.00	1.12	3.13	0.71	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.33	2.00	
11/02/2025 08:00	9.01	1.12	3.13	0.72	1.96	1.68	1.32	1.21	1.61	0.99	1.28	2.89	1.18	2.33	2.01	
11/02/2025 08:15	9.00	1.12	3.13	0.73	1.98	1.68	1.32	1.20	1.62	1.00	1.28	2.88	1.18	2.34	2.00	
11/02/2025 08:30	9.00	1.12	3.13	0.75	1.97	1.68	1.31	1.20	1.62	0.99	1.28	2.88	1.18	2.34	2.00	
11/02/2025 08:45	9.00	1.12	3.13	0.76	1.98	1.68	1.31	1.20	1.62	1.00	1.28	2.88	1.18	2.35	2.00	
11/02/2025 09:00	9.00	1.12	3.13	0.77	1.96	1.68	1.32	1.21	1.61	0.99	1.27	2.88	1.18	2.35	2.00	
11/02/2025 09:15	9.00	1.12	3.13	0.79	1.97	1.68	1.31	1.20	1.62	0.99	1.28	2.88	1.18	2.36	2.00	
11/02/2025 09:30	9.00	1.12	3.13	0.80	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.88	1.18	2.37	2.00	
11/02/2025 09:45	9.00	1.12	3.13	0.81	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.19	2.37	2.00	
11/02/2025 10:00	9.00	1.12	3.13	0.82	1.96	1.68	1.32	1.21	1.61	1.00	1.28	2.88	1.18	2.38	2.00	
11/02/2025 10:15	9.00	1.12	3.13	0.83	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.38	2.00	
11/02/2025 10:30	9.00	1.12	3.13	0.84	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.89	1.18	2.39	2.00	
11/02/2025 10:45	9.00	1.12	3.13	0.84	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.40	2.00	
11/02/2025 11:00	9.01	1.12	3.13	0.85	1.96	1.68	1.32	1.21	1.61	0.99	1.28	2.88	1.18	2.40	2.00	
11/02/2025 11:15	9.00	1.12	3.13	0.85	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.89	1.18	2.40	2.00	
11/02/2025 11:30	9.00	1.12	3.13	0.84	1.97	1.68	1.33	1.20	1.61	1.00	1.27	2.89	1.18	2.41	2.00	
11/02/2025 11:45	9.01	1.12	3.13	0.84	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.89	1.18	2.42	2.00	
11/02/2025 12:00	9.00	1.11	3.13	0.83	1.96	1.68	1.31	1.20	1.62	0.99	1.27	2.88	1.18	2.42	2.00	
11/02/2025 12:15	9.00	1.12	3.13	0.82	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.88	1.18	2.42	2.00	
11/02/2025 12:30	9.00	1.12	3.13	0.80	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.88	1.18	2.43	2.00	
11/02/2025 12:45	9.00	1.12	3.13	0.79	1.97	1.68	1.32	1.20	1.62	1.00	1.28	2.88	1.18	2.44	2.00	
11/02/2025 13:00	9.01	1.12	3.13	0.78	1.97	1.68	1.31	1.21	1.62	1.00	1.28	2.89	1.18	2.44	2.00	
11/02/2025 13:15	9.00	1.12	3.13	0.76	1.97	1.68	1.32	1.20	1.61	1.00	1.27	2.89	1.18	2.43	2.00	
11/02/2025 13:30	9.00	1.12	3.13	0.74	1.98	1.68	1.31	1.20	1.62	1.00	1.28	2.88	1.18	2.43	2.00	
11/02/2025 13:45	9.01	1.12	3.13	0.73	1.98	1.68	1.32	1.21	1.62	1.00	1.28	2.89	1.18	2.43	2.01	
11/02/2025 14:00	9.01	1.12	3.13	0.71	1.97	1.68	1.32	1.21	1.62	1.00	1.28	2.88	1.18	2.42	2.01	
11/02/2025 14:15	9.00	1.12	3.13	0.69	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.41	2.00	
11/02/2025 14:30	9.00	1.12	3.13	0.67	1.97	1.68	1.32	1.20	1.61	0.99	1.27	2.88	1.17	2.41	2.00	
11/02/2025 14:45	9.00	1.12	3.13	0.66	1.97	1.68	1.31	1.20	1.62	1.00	1.27	2.88	1.18	2.41	2.00	
11/02/2025 15:00	9.00	1.12	3.13	0.64	1.96	1.68	1.30	1.21	1.61	0.99	1.27	2.88	1.18	2.41	2.00	
11/02/2025 15:15	9.00	1.12	3.13	0.64	1.98	1.68	1.31	1.20	1.61	0.99	1.28	2.88	1.18	2.40	2.01	
11/02/2025 15:30	9.00	1.12	3.13	0.63	1.98	1.68	1.31	1.20	1.61	1.00	1.28	2.89	1.18	2.40	2.00	
11/02/2025 15:45	9.00	1.12	3.13	0.62	1.97	1.69	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.40	2.00	
11/02/2025 16:00	9.01	1.12	3.13	0.61	1.96	1.68	1.31	1.21	1.62	0.99	1.27	2.89	1.18	2.39	2.00	
11/02/2025 16:15	9.00	1.12	3.13	0.60	1.97	1.68	1.32	1.20	1.62	0.99	1.28	2.88	1.18	2.39	2.00	
11/02/2025 16:30	9.00	1.12	3.13	0.60	1.97	1.68	1.32	1.21	1.62	1.00	1.28	2.89	1.18	2.39	2.00	
11/02/2025 16:45	9.01	1.12	3.13	0.61	1.98	1.68	1.31	1.21	1.62	1.00	1.28	2.89	1.19	2.39	2.01	
11/02/2025 17:00	9.01	1.12	3.13	0.61	1.96	1.68	1.31	1.21	1.62	1.00	1.28	2.89	1.18	2.39	2.01	
11/02/2025 17:15	9.00	1.12	3.13	0.62	1.97	1.68	1.32	1.21	1.62	1.00	1.28	2.89	1.18	2.39	2.01	
11/02/2025 17:30	9.00	1.12	3.13	0.62	1.97	1.68	1.32	1.20	1.62	1.00	1.28	2.88	1.18	2.38	2.00	
11/02/2025 17:45	9.01	1.12	3.13	0.63	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.38	2.01	
11/02/2025 18:00	9.01	1.12	3.13	0.65	1.97	1.68	1.31	1.21	1.62	1.00	1.28	2.89	1.19	2.38	2.01	
11/02/2025 18:15	9.01	1.12	3.13	0.66	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.88	1.18	2.38	2.00	
11/02/2025 18:30	9.00	1.11	3.13	0.67	1.97	1.68	1.30	1.20	1.62	1.00	1.28	2.88	1.18	2.38	2.00	
11/02/2025 18:45	9.00	1.12	3.13	0.68	1.97	1.68	1.32	1.20	1.60	1.00	1.27	2.88	1.18	2.38	2.00	
11/02/2025 19:00	9.00	1.12	3.13	0.70	1.96	1.68	1.31	1.21	1.61	1.00	1.28	2.88	1.18	2.38	2.00	
11/02/2025 19:15	9.01	1.12	3.13	0.71	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.88	1.18	2.38	2.00	
11/02/2025 19:30	9.00	1.12	3.13	0.72	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.39	2.00	
11/02/2025 19:45	9.01	1.12	3.13	0.73	1.97	1.68	1.31	1.20	1.62	1.00	1.27	2.88	1.18	2.39	2.00	
11/02/2025 20:00	9.00	1.12	3.13	0.74	1.96	1.68	1.30	1.20	1.61	0.99	1.28	2.88	1.18	2.40	2.00	
11/02/2025 20:15	9.00	1.12	3.13	0.76	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.88	1.18	2.40	2.00	
11/02/2025 20:30	9.01	1.12	3.13	0.78	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.88	1.18	2.41	2.00	
11/02/2025 20:45	9.00	1.12	3.13	0.79	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.88	1.18	2.42	2.00	
11/02/2025 21:00	9.00	1.12	3.13	0.80	1.96	1.68	1.31	1.21	1.61	1.00	1.28	2.88	1.18	2.43	2.00	
11/02/2025 21:15	9.00	1.12	3.13	0.81	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.88	1.18	2.43	2.00	
11/02/2025 21:30	9.00	1.12	3.13	0.82	1.97	1.68	1.32	1.20	1.62	1.00	1.28	2.88	1.18	2.44	2.00	
11/02/2025 21:45	9.01	1.12	3.13	0.83	1.97	1.68	1.32	1.20	1.62	1.00	1.28	2.89	1.18	2.45	2.00	
11/02/2025 22:00	9.01	1.12	3.13	0.83	1.96	1.68	1.31	1.21	1.63	1.00	1.28	2.88	1.18	2.46	2.00	
11/02/2025 22:15	9.00	1.12	3.13	0.84	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.89	1.18	2.46	2.00	
11/02/2025 22:30	9.00	1.12	3.13	0.84	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.88	1.18	2.47	2.00	
11/02/2025 22:45	9.00	1.12	3.13	0.84	1.97	1.68	1.32	1.20	1.61	0.99	1.28	2.88	1.18	2.47	2.00	
11/02/2025 23:00	9.01	1.12	3.13	0.84	1.96	1.68	1.31	1.21	1.61	1.00	1.28	2.88	1.18	2.48	2.01	
11/02/2025 23:15	9.00	1.12	3.13	0.84	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.88	1.18	2.48	2.00	
11/02/2025 23:30	9.00	1.12	3.13	0.84	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.49	2.00	
11/02/2025 23:45	9.00	1.12	3.13	0.83	1.97	1.68	1.32	1.20	1.61	1.01	1.28	2.88	1.18	2.49	2.00	
12/02/2025 00:00	9.01	1.12	3.13	0.83	1.96	1.68	1.31	1.20	1.61	1.00	1.28	2.88	1.18	2.50	2.00	
12/02/2025 00:15	9.00	1.12	3.13	0.82	1.97	1.68	1.32	1.20	1.60	1.01	1.28	2.88	1.18	2.50	2.00	
12/02/2025 00:30	9.00	1.12	3.13	0.81	1.97	1.68	1.31	1.20	1.61	1.01	1.28	2.88	1.18	2.51	2.00	
12/02/2025 00:45	9.00	1.12	3.13	0.79	1.97	1.68	1.31	1.20	1.61	1.01	1.28	2.88	1.18	2.51	2.00	
12/02/2025 01:00	9.00	1.12	3.13	0.77	1.96	1.68	1.31	1.21	1.62	1.00	1.27	2.88	1.18	2.51	2.00	
12/02/2025 01:15	9.00	1.12	3.13	0.75	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.50	2.00	
12/02/2025 01:30	9.01	1.12	3.13	0.74	1.97	1.68	1.32	1.20	1.60	1.00	1.27	2.88	1.18	2.50	2.00	
12/02/2025 01:45	9.00	1.12	3.13	0.72	1.97	1.68	1.32	1.20	1.62	1.00	1.28	2.88	1.18	2.50	2.00	
12/02/2025 02:00	9.01	1.12	3.13	0.70	1.96	1.68	1.32	1.21	1.62	1.00	1.28	2.88	1.18	2.49	2.00	
12/02/2025 02:15	9.00	1.12	3.13	0.68	1.97	1.68	1.32	1.20	1.62	1.00	1.28	2.88	1.18	2.49	2.00	
12/02/2025 02:30	9.00	1.12	3.13	0.66	1.97	1.68	1.31	1.20	1.61	0.99	1.28	2.88	1.18	2.49	2.00	
12/02/2025 02:45	9.00	1.11	3.13	0.64	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.87	1.18	2.47	2.00	
12/02/2025 03:00	9.00	1.12	3.13	0.62	1.96	1.68	1.31	1.21	1.60	0.99	1.28	2.88	1.18	2.47	2.00	
12/02/2025 03:15	9.00	1.12	3.13	0.61	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.88	1.18	2.48	2.00	
12/02/2025 03:30	9.00	1.12	3.13	0.59	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.88	1.18	2.47	2.00	
12/02/2025 03:45	9.00	1.11	3.13	0.58	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.87	1.18	2.47	2.00	
12/02/2025 04:00	9.00	1.12	3.13	0.57	1.96	1.68	1.31	1.21	1.60	1.00	1.28	2.88	1.18	2.47	2.00	
12/02/2025 04:15	9.00	1.12	3.13	0.56	1.97	1.68	1.32	1.20	1.61	1.01	1.27	2.88	1.18	2.47	2.00	
12/02/2025 04:30	9.00	1.12	3.13	0.55	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.88	1.17	2.46	2.00	
12/02/2025 04:45	9.01	1.11	3.13	0.54	1.97	1.68	1.32	1.20	1.61	1.00	1.27	2.88	1.17	2.46	2.00	
12/02/2025 05:00	9.00	1.12	3.13	0.54	1.96	1.68	1.31	1.21	1.62	0.99	1.28	2.88	1.17	2.45	2.00	
12/02/2025 05:15	9.01	1.12	3.13	0.53	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.88	1.18	2.45	2.00	
12/02/2025 05:30	9.00	1.12	3.13	0.54	1.97	1.68	1.31	1.20	1.60	1.00	1.27	2.88	1.17	2.45	2.00	
12/02/2025 05:45	9.00	1.11	3.13	0.54	1.97	1.68	1.31	1.20	1.60	1.00	1.27	2.88	1.18	2.45	2.00	
12/02/2025 06:00	9.00	1.12	3.13	0.55	1.96	1.68	1.31	1.21	1.61	1.00	1.27	2.87	1.17	2.45	2.00	
12/02/2025 06:15	9.00	1.12	3.13	0.56	1.97	1.68	1.32	1.20	1.61	1.00	1.27	2.88	1.17	2.44	2.00	
12/02/2025 06:30	9.00	1.11	3.13	0.57	1.97	1.68	1.32	1.20	1.60	1.00	1.28	2.87	1.17	2.44	2.00	
12/02/2025 06:45	9.00	1.11	3.13	0.58	1.96	1.68	1.31	1.20	1.61	1.00	1.28	2.87	1.17	2.44	2.00	
12/02/2025 07:00	9.00	1.12	3.13	0.60	1.96	1.68	1.31	1.20	1.62	1.00	1.27	2.88	1.18	2.44	2.00	
12/02/2025 07:15	9.00	1.12	3.13	0.61	1.97	1.68	1.32	1.20	1.61	1.00	1.27	2.87	1.17	2.44	2.00	
12/02/2025 07:30	9.00	1.12	3.13	0.63	1.97	1.68	1.31	1.20	1.60	0.99	1.28	2.87	1.17	2.44	2.00	
12/02/2025 07:45	9.00	1.11	3.13	0.64	1.97	1.68	1.32	1.20	1.60	1.00	1.27	2.88	1.17	2.44	2.00	
12/02/2025 08:00	9.01	1.12	3.13	0.66	1.96	1.68	1.31	1.21	1.60	1.00	1.27	2.88	1.17	2.44	2.00	
12/02/2025 08:15	9.01	1.12	3.13	0.67	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.88	1.17	2.44	2.00	
12/02/2025 08:30	9.00	1.12	3.13	0.69	1.97	1.67	1.32	1.20	1.60	1.00	1.27	2.87	1.17	2.44	2.00	
12/02/2025 08:45	9.00	1.11	3.13	0.70	1.97	1.67	1.31	1.20	1.61	1.00	1.28	2.88	1.17	2.44	2.00	
12/02/2025 09:00	9.00	1.11	3.13	0.71	1.96	1.68	1.30	1.20	1.61	0.99	1.27	2.87	1.17	2.44	2.00	
12/02/2025 09:15	9.01	1.11	3.13	0.73	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.45	2.00	
12/02/2025 09:30	9.00	1.11	3.13	0.75	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.45	2.00	
12/02/2025 09:45	9.00	1.11	3.12	0.76	1.96	1.67	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.46	2.00	
12/02/2025 10:00	9.00	1.11	3.13	0.78	1.96	1.68	1.30	1.20	1.60	1.00	1.27	2.87	1.17	2.46	2.00	
12/02/2025 10:15	9.00	1.11	3.13	0.79	1.97	1.68	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.47	2.00	
12/02/2025 10:30	9.01	1.11	3.13	0.80	1.96	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.47	2.00	
12/02/2025 10:45	9.00	1.12	3.13	0.82	1.96	1.67	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.48	2.00	
12/02/2025 11:00	9.01	1.11	3.13	0.82	1.95	1.67	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.48	2.00	
12/02/2025 11:15	9.01	1.11	3.13	0.84	1.96	1.68	1.31	1.20	1.62	1.00	1.27	2.88	1.17	2.49	2.00	
12/02/2025 11:30	9.00	1.12	3.13	0.85	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.87	1.17	2.49	2.00	
12/02/2025 11:45	9.00	1.11	3.13	0.85	1.97	1.67	1.31	1.20	1.62	1.00	1.27	2.87	1.17	2.49	2.00	
12/02/2025 12:00	9.00	1.11	3.12	0.85	1.96	1.68	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.50	2.00	
12/02/2025 12:15	9.00	1.11	3.12	0.85	1.97	1.68	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.51	2.00	
12/02/2025 12:30	9.00	1.11	3.13	0.84	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.51	2.00	
12/02/2025 12:45	9.00	1.11	3.13	0.84	1.97	1.68	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.52	2.00	
12/02/2025 13:00	9.00	1.11	3.13	0.83	1.95	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.16	2.52	2.00	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
12/02/2025 13:15	9.00	1.11	3.13	0.82	1.97	1.68	1.32	1.20	1.60	1.00	1.27	2.87	1.17	2.52	2.00	
12/02/2025 13:30	9.00	1.11	3.13	0.80	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.52	2.00	
12/02/2025 13:45	9.00	1.11	3.13		1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.53	2.00	
12/02/2025 14:00	9.00	1.11	3.12		1.96	1.67	1.32	1.20	1.61	0.99	1.27	2.87	1.17	2.52	2.00	
12/02/2025 14:15	8.99	1.11	3.12		1.96	1.68	1.31	1.20	1.61	1.01	1.27	2.87	1.17	2.52	1.99	
12/02/2025 14:30	9.00	1.11	3.12		1.97	1.67	1.32	1.20	1.61	0.99	1.27	2.87	1.17	2.52	2.00	
12/02/2025 14:45	9.00	1.11	3.12	0.71	1.97	1.68	1.32	1.20	1.62	1.00	1.27	2.87	1.17	2.51	2.00	
12/02/2025 15:00	9.00	1.11	3.13	0.70	1.96	1.68	1.31	1.21	1.61	1.00	1.27	2.87	1.17	2.51	2.00	
12/02/2025 15:15	9.00	1.11		0.68	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.51	2.00	
12/02/2025 15:30	9.00	1.12		0.67	1.97	1.68	1.32	1.20	1.61	1.00	1.28	2.87	1.17	2.51	2.00	
12/02/2025 15:45	9.01	1.12		0.66	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.88	1.17	2.50	2.00	
12/02/2025 16:00	9.01	1.12		0.64	1.96	1.67	1.32	1.21	1.60	1.00	1.27	2.87	1.17	2.50	2.00	
12/02/2025 16:15	9.00	1.11		0.63	1.97	1.68	1.31	1.20	1.63	1.00	1.28	2.87	1.17	2.49	2.00	
12/02/2025 16:30	9.01	1.12		0.62	1.97	1.68	1.31	1.20	1.62	1.00	1.27	2.88	1.18	2.50	2.00	
12/02/2025 16:45	9.01	1.12	3.06	0.62	1.97	1.68	1.31	1.20	1.62	1.01	1.28	2.88	1.17	2.50	2.00	
12/02/2025 17:00	9.01	1.12	3.07	0.62	1.96	1.68	1.32	1.21	1.61	1.00	1.27	2.88	1.18	2.49	2.00	
12/02/2025 17:15	9.01	1.12	3.08	0.61	1.97	1.68	1.32	1.21	1.62	1.00	1.28	2.88	1.18	2.49	2.00	
12/02/2025 17:30	9.01	1.11	3.09	0.61	1.97	1.67	1.31	1.20	1.61	1.00	1.27	2.88	1.17	2.48	2.00	
12/02/2025 17:45	9.00	1.12	3.10	0.62	1.97	1.67	1.32	1.20	1.60	1.00	1.28	2.88	1.17	2.48	2.00	
12/02/2025 18:00	9.01	1.12	3.10	0.63	1.96	1.67	1.31	1.21	1.60	1.00	1.28	2.88	1.17	2.47	2.00	
12/02/2025 18:15	9.01	1.12	3.12	0.64	1.97	1.68	1.31	1.20	1.62	0.99	1.28	2.88	1.17	2.48	2.00	
12/02/2025 18:30	9.00	1.11	3.12	0.65	1.97	1.68	1.31	1.20	1.60	0.99	1.28	2.87	1.18	2.47	2.00	
12/02/2025 18:45	9.00	1.11	3.12	0.66	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.88	1.17	2.47	2.00	
12/02/2025 19:00	9.01	1.12	3.12	0.68	1.96	1.68	1.31	1.21	1.61	0.99	1.28	2.87	1.17	2.47	2.00	
12/02/2025 19:15	9.00	1.12	3.13	0.69	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.88	1.17	2.47	2.00	
12/02/2025 19:30	9.01	1.12	3.13	0.70	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.88	1.17	2.47	2.00	
12/02/2025 19:45	9.01	1.12	3.13	0.72	1.97	1.68	1.30	1.20	1.60	1.00	1.27	2.88	1.17	2.47	2.00	
12/02/2025 20:00	9.01	1.12	3.13	0.73	1.96	1.68	1.31	1.21	1.61	0.99	1.27	2.88	1.17	2.48	2.00	
12/02/2025 20:15	9.01	1.12	3.13	0.75	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.88	1.18	2.49	2.00	
12/02/2025 20:30	9.01	1.12	3.13	0.76	1.97	1.68	1.31	1.20	1.62	0.99	1.27	2.88	1.17	2.48	2.00	
12/02/2025 20:45	9.00	1.12	3.13	0.77	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.88	1.18	2.49	2.00	
12/02/2025 21:00	9.01	1.12	3.13	0.79	1.96	1.68	1.31	1.21	1.62	1.00	1.27	2.88	1.17	2.49	2.00	
12/02/2025 21:15	9.01	1.12	3.13	0.80	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.88	1.17	2.50	2.00	
12/02/2025 21:30	9.00	1.11	3.13	0.82	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.87	1.17	2.50	2.00	
12/02/2025 21:45	9.00	1.11	3.13	0.83	1.97	1.68	1.31	1.20	1.61	1.01	1.27	2.88	1.17	2.51	2.00	
12/02/2025 22:00	9.00	1.11	3.13	0.84	1.95	1.68	1.30	1.20	1.61	1.00	1.27	2.87	1.17	2.51	2.00	
12/02/2025 22:15	9.00	1.11	3.13	0.85	1.97	1.68	1.31	1.20	1.62	0.99	1.27	2.88	1.17	2.51	2.00	
12/02/2025 22:30	9.00	1.11	3.13	0.86	1.96	1.67	1.30	1.20	1.60	0.99	1.28	2.88	1.17	2.52	2.00	
12/02/2025 22:45	9.00	1.11	3.13	0.86	1.96	1.68	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.52	2.00	
12/02/2025 23:00	9.00	1.11	3.13	0.86	1.95	1.67	1.31	1.20	1.60	0.99	1.27	2.87	1.17	2.52	2.00	
12/02/2025 23:15	9.00	1.11	3.13	0.86	1.96	1.67	1.31	1.19	1.61	0.99	1.27	2.87	1.17	2.52	1.99	
12/02/2025 23:30	9.00	1.11	3.13	0.86	1.96	1.67	1.31	1.20	1.62	1.00	1.27	2.87	1.17	2.53	2.00	
12/02/2025 23:45	9.00	1.11	3.13	0.86	1.97	1.67	1.31	1.20	1.60	0.99	1.28	2.87	1.17	2.53	2.00	
13/02/2025 00:00	9.00	1.11	3.13	0.86	1.96	1.67	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.53	2.00	
13/02/2025 00:15	9.00	1.11	3.13	0.86	1.97	1.68	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.54	2.00	
13/02/2025 00:30	9.00	1.11	3.13	0.85	1.96	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.54	2.00	
13/02/2025 00:45	9.00	1.11	3.13	0.85	1.96	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.54	2.00	
13/02/2025 01:00	9.00	1.11	3.13	0.84	1.96	1.68	1.31	1.21	1.61	1.00	1.28	2.87	1.17	2.55	2.00	
13/02/2025 01:15	9.00	1.11	3.13	0.82	1.96	1.68	1.31	1.19	1.61	0.99	1.27	2.87	1.17	2.55	2.00	
13/02/2025 01:30	9.00	1.11	3.13	0.81	1.97	1.67	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.56	2.00	
13/02/2025 01:45	9.00	1.11	3.13	0.79	1.96	1.68	1.31	1.20	1.61	1.00	1.28	2.87	1.17	2.56	2.00	
13/02/2025 02:00	9.00	1.11	3.13	0.77	1.96	1.68	1.31	1.21	1.61	1.00	1.27	2.87	1.17	2.56	2.00	
13/02/2025 02:15	9.00	1.12	3.13	0.75	1.97	1.68	1.31	1.20	1.61	1.00	1.28	2.87	1.17	2.55	2.00	
13/02/2025 02:30	9.00	1.11	3.13	0.73	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.54	2.00	
13/02/2025 02:45	9.00	1.12	3.13	0.72	1.97	1.68	1.31	1.20	1.61	0.99	1.28	2.87	1.17	2.54	2.00	
13/02/2025 03:00	9.00	1.11	3.13	0.70	1.96	1.68	1.31	1.21	1.61	0.99	1.28	2.87	1.17	2.53	2.00	
13/02/2025 03:15	9.00	1.12	3.13	0.68	1.97	1.68	1.31	1.20	1.62	1.00	1.28	2.87	1.17	2.53	2.00	
13/02/2025 03:30	9.00	1.11	3.13	0.66	1.97	1.67	1.31	1.20	1.61	1.00	1.28	2.87	1.17	2.53	2.00	
13/02/2025 03:45	9.00	1.11	3.13	0.64	1.97	1.67	1.31	1.20	1.62	0.99	1.27	2.87	1.17	2.52	2.00	
13/02/2025 04:00	9.01	1.12	3.13	0.63	1.96	1.68	1.31	1.20	1.61	1.00	1.28	2.87	1.17	2.51	2.00	
13/02/2025 04:15	9.00	1.12	3.13	0.61	1.96	1.67	1.32	1.20	1.61	1.00	1.28	2.87	1.17	2.51	2.00	
13/02/2025 04:30	9.00	1.11	3.13	0.59	1.97	1.67	1.31	1.20	1.61	1.00	1.28	2.87	1.17	2.51	2.00	
13/02/2025 04:45	9.00	1.11	3.13	0.58	1.96	1.67	1.30	1.20	1.60	1.00	1.27	2.87	1.17	2.50	2.00	
13/02/2025 05:00	9.00	1.11	3.13	0.57	1.95	1.67	1.31	1.20	1.62	0.99	1.27	2.87	1.17	2.50	2.00	
13/02/2025 05:15	9.01	1.11	3.13	0.56	1.96	1.68	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.50	2.00	
13/02/2025 05:30	9.00	1.11	3.13	0.56	1.96	1.67	1.32	1.20	1.61	0.99	1.27	2.87	1.17	2.49	2.00	
13/02/2025 05:45	9.00	1.11	3.13	0.55	1.97	1.67	1.31	1.20	1.60	1.00	1.27	2.87	1.17	2.48	2.00	
13/02/2025 06:00	9.00	1.11	3.13	0.56	1.95	1.67	1.30	1.20	1.60	0.99	1.27	2.87	1.17	2.48	2.00	
13/02/2025 06:15	9.00	1.11	3.13	0.56	1.96	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.17	2.48	2.00	
13/02/2025 06:30	9.00	1.11	3.13	0.57	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.87	1.17	2.47	2.00	
13/02/2025 06:45	9.00	1.11	3.13	0.58	1.96	1.67	1.32	1.20	1.61	1.00	1.27	2.87	1.17	2.47	2.00	
13/02/2025 07:00	9.00	1.11	3.13	0.59	1.95	1.67	1.31	1.20	1.61	0.99	1.27	2.87	1.17	2.47	2.00	
13/02/2025 07:15	9.01	1.12	3.13	0.61	1.96	1.67	1.31	1.20	1.61	1.00	1.28	2.87	1.17	2.47	2.00	
13/02/2025 07:30	9.01	1.11	3.13	0.63	1.96	1.67	1.31	1.20	1.62	1.00	1.27	2.87	1.17	2.46	2.00	
13/02/2025 07:45	9.00	1.11	3.13	0.64	1.96	1.67	1.31	1.20	1.61	0.99	1.28	2.87	1.16	2.46	2.00	
13/02/2025 08:00	9.00	1.11	3.13	0.66	1.95	1.67	1.31	1.20	1.60	0.99	1.27	2.87	1.16	2.46	2.00	
13/02/2025 08:15	9.00	1.12	3.13	0.67	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.46	2.00	
13/02/2025 08:30	9.00	1.11	3.13	0.68	1.96	1.67	1.31	1.20	1.59	0.99	1.27	2.87	1.16	2.46	2.00	
13/02/2025 08:45	9.00	1.11	3.13	0.70	1.96	1.67	1.31	1.20	1.60	1.00	1.27	2.87	1.16	2.46	2.00	
13/02/2025 09:00	9.00	1.11	3.13	0.71	1.95	1.67	1.31	1.20	1.60	0.99	1.27	2.87	1.17	2.46	2.00	
13/02/2025 09:15	9.01	1.11	3.13	0.73	1.96	1.67	1.32	1.20	1.61	1.00	1.27	2.87	1.17	2.47	2.00	
13/02/2025 09:30	9.00	1.11	3.13	0.74	1.96	1.67	1.31	1.20	1.60	1.00	1.26	2.87	1.16	2.47	2.00	
13/02/2025 09:45	9.00	1.11	3.13	0.76	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.17	2.47	2.00	
13/02/2025 10:00	9.00	1.11	3.13	0.78	1.96	1.67	1.31	1.20	1.60	0.99	1.28	2.87	1.16	2.47	2.00	
13/02/2025 10:15	9.00	1.11	3.13	0.80	1.96	1.68	1.31	1.20	1.60	1.01	1.27	2.86	1.16	2.48	2.00	
13/02/2025 10:30	9.00	1.11	3.13	0.80	1.96	1.67	1.31	1.20	1.59	1.00	1.28	2.86	1.16	2.48	2.00	
13/02/2025 10:45	9.00	1.11	3.13	0.82	1.96	1.67	1.30	1.19	1.59	1.00	1.28	2.86	1.16	2.49	2.00	
13/02/2025 11:00	9.00	1.11	3.13	0.83	1.95	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.49	2.00	
13/02/2025 11:15	9.00	1.11	3.13	0.84	1.96	1.67	1.30	1.20	1.60	0.99	1.28	2.87	1.16	2.49	1.99	
13/02/2025 11:30	9.00	1.12	3.13	0.85	1.97	1.68	1.32	1.20	1.61	1.01	1.27	2.87	1.16	2.50	2.00	
13/02/2025 11:45	9.00	1.11	3.13	0.85	1.96	1.67	1.31	1.19	1.60	1.00	1.27	2.86	1.16	2.50	2.00	
13/02/2025 12:00	9.00	1.11	3.13	0.86	1.95	1.68	1.30	1.20	1.61	1.00	1.27	2.86	1.16	2.50	2.00	
13/02/2025 12:15	9.00	1.11	3.13	0.87	1.96	1.67	1.31	1.19	1.59	1.00	1.27	2.86	1.16	2.50	1.99	
13/02/2025 12:30	9.00	1.11	3.12	0.87	1.96	1.67	1.31	1.19	1.60	1.00	1.27	2.86	1.16	2.50	1.99	
13/02/2025 12:45	9.01	1.11	3.13	0.88	1.96	1.68	1.31	1.20	1.61	1.00	1.27	2.87	1.16	2.52	2.00	
13/02/2025 13:00	9.01	1.11	3.13	0.88	1.96	1.68	1.31	1.20	1.62	1.00	1.27	2.87	1.16	2.52	2.00	
13/02/2025 13:15	9.01	1.11	3.13	0.87	1.96	1.68	1.30	1.20	1.62	1.00	1.27	2.86	1.16	2.52	2.00	
13/02/2025 13:30	9.00	1.11	3.13	0.85	1.96	1.67	1.30	1.19	1.61	0.99	1.27	2.86	1.16	2.52	2.00	
13/02/2025 13:45	9.01	1.11	3.13	0.84	1.96	1.68	1.30	1.19	1.61	1.00	1.28	2.86	1.16	2.53	2.00	
13/02/2025 14:00	9.01	1.11	3.13	0.82	1.96	1.68	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.53	2.00	
13/02/2025 14:15	9.01	1.12	3.13	0.81	1.97	1.68	1.32	1.20	1.62	1.00	1.28	2.86	1.16	2.53	2.00	
13/02/2025 14:30	9.01	1.11	3.13	0.80	1.96	1.68	1.32	1.20	1.61	1.00	1.26	2.87	1.16	2.54	2.00	
13/02/2025 14:45	9.01	1.12	3.13	0.78	1.97	1.68	1.32	1.20	1.62	1.01	1.27	2.87	1.16	2.53	2.00	
13/02/2025 15:00	9.00	1.11	3.13	0.77	1.95	1.68	1.32	1.21	1.61	1.00	1.27	2.86	1.16	2.53	2.00	
13/02/2025 15:15	9.01	1.11	3.13	0.74	1.97	1.68	1.31	1.20	1.62	1.00	1.27	2.86	1.16	2.52	2.00	
13/02/2025 15:30	9.00	1.12	3.13	0.73	1.97	1.68	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.51	2.00	
13/02/2025 15:45	9.01	1.11	3.13	0.71	1.96	1.68	1.31	1.19	1.62	1.00	1.27	2.87	1.17	2.51	2.00	
13/02/2025 16:00	9.01	1.11	3.13	0.70	1.95	1.68	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.51	2.00	
13/02/2025 16:15	9.00	1.11	3.13	0.68	1.97	1.67	1.32	1.20	1.63	1.00	1.27	2.86	1.16	2.50	2.00	
13/02/2025 16:30	9.01	1.11	3.13	0.67	1.96	1.68	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.50	2.00	
13/02/2025 16:45	9.01	1.11	3.13	0.65	1.96	1.68	1.32	1.20	1.61	1.00	1.27	2.87	1.16	2.49	2.00	
13/02/2025 17:00	9.00	1.11	3.12	0.64	1.96	1.68	1.32	1.20	1.60	1.00	1.27	2.86	1.16	2.49	2.00	
13/02/2025 17:15	9.01	1.11	3.13	0.63	1.97	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.48	2.00	
13/02/2025 17:30	9.01	1.11	3.13	0.63	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.87	1.16	2.48	2.00	
13/02/2025 17:45	9.01	1.11	3.13	0.62	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.47	2.00	
13/02/2025 18:00	9.00	1.11	3.13	0.62	1.95	1.68	1.30	1.20	1.60	0.99	1.27	2.86	1.16	2.47	2.00	
13/02/2025 18:15	9.01	1.11	3.13	0.62	1.96	1.67	1.31	1.19	1.60	1.00	1.27	2.86	1.16	2.47	2.00	
13/02/2025 18:30	9.00	1.11	3.13	0.64	1.96	1.67	1.31	1.20	1.60	1.00	1.27	2.86	1.16	2.46	2.00	
13/02/2025 18:45	9.01	1.11	3.13	0.65	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.46	1.99	
13/02/2025 19:00	9.00	1.11	3.13	0.67	1.95	1.67	1.30	1.20	1.60	1.00	1.27	2.86	1.16	2.46	2.00	
13/02/2025 19:15	9.00	1.11	3.13	0.68	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.46	2.00	
13/02/2025 19:30	9.00	1.11	3.13	0.70	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.46	2.00	
13/02/2025 19:45	9.00	1.11	3.13	0.71	1.96	1.67	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.46	2.00	
13/02/2025 20:00	9.01	1.12	3.13	0.72	1.96	1.68	1.31	1.20	1.62	1.00	1.28	2.86	1.17	2.46	2.00	
13/02/2025 20:15	9.01	1.11	3.13	0.74	1.96	1.68	1.30	1.20	1.61	1.00	1.28	2.86	1.16	2.46	2.00	
13/02/2025 20:30	9.00	1.11	3.13	0.75	1.96	1.67	1.31	1.20	1.62	1.00	1.27	2.86	1.16	2.47	2.00	
13/02/2025 20:45	9.01	1.11	3.13	0.76	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.47	2.00	
13/02/2025 21:00	9.01	1.11	3.12	0.78	1.95	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.47	2.00	
13/02/2025 21:15	9.01	1.11	3.13	0.79	1.96	1.68	1.31	1.20	1.61	1.00	1.27	2.86	1.16	2.48	2.00	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
13/02/2025 21:30	9.00	1.11	3.13	0.80	1.96	1.67	1.31	1.20	1.60	0.99	1.26	2.86	1.16	2.48	1.99	
13/02/2025 21:45	9.00	1.11	3.13	0.82	1.96	1.68	1.30	1.19	1.60	0.99	1.27	2.86	1.16	2.48	2.00	
13/02/2025 22:00	9.00	1.11	3.12	0.83	1.95	1.67	1.31	1.20	1.61	0.99	1.26	2.86	1.16	2.48	2.00	
13/02/2025 22:15	9.00	1.11	3.13	0.85	1.96	1.68	1.31	1.20	1.60	1.00	1.26	2.87	1.16	2.49	2.00	
13/02/2025 22:30	9.00	1.11	3.13	0.85	1.96	1.68	1.30	1.20	1.61	0.99	1.27	2.86	1.16	2.49	2.00	
13/02/2025 22:45	9.01	1.11	3.12	0.87	1.96	1.68	1.30	1.20	1.60	1.00	1.26	2.87	1.16	2.50	2.00	
13/02/2025 23:00	9.00	1.11	3.13	0.87	1.95	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.49	2.00	
13/02/2025 23:15	9.00	1.11	3.13	0.88	1.96	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.50	2.00	
13/02/2025 23:30	9.00	1.11	3.13	0.88	1.96	1.67	1.30	1.20	1.61	0.99	1.27	2.86	1.16	2.51	2.00	
13/02/2025 23:45	9.00	1.11	3.13	0.88	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.51	1.99	
14/02/2025 00:00	9.00	1.11	3.12	0.88	1.95	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.51	2.00	
14/02/2025 00:15	9.00	1.11	3.13	0.88	1.96	1.68	1.31	1.19	1.60	0.99	1.27	2.86	1.16	2.51	2.00	
14/02/2025 00:30	9.01	1.11	3.13	0.87	1.96	1.68	1.31	1.20	1.59	0.99	1.27	2.86	1.16	2.52	2.00	
14/02/2025 00:45	9.00	1.11	3.13	0.87	1.96	1.68	1.31	1.19	1.61	0.99	1.27	2.86	1.16	2.52	2.00	
14/02/2025 01:00	9.00	1.11	3.13	0.87	1.95	1.67	1.30	1.20	1.61	0.99	1.27	2.86	1.16	2.52	2.00	
14/02/2025 01:15	9.00	1.11	3.13	0.86	1.96	1.67	1.30	1.19	1.60	1.00	1.27	2.86	1.16	2.52	2.00	
14/02/2025 01:30	9.01	1.11	3.13	0.86	1.96	1.67	1.31	1.19	1.60	1.00	1.27	2.86	1.16	2.53	2.00	
14/02/2025 01:45	9.00	1.11	3.13	0.85	1.96	1.68	1.31	1.19	1.61	0.99	1.27	2.86	1.16	2.53	2.00	
14/02/2025 02:00	9.00	1.11	3.12	0.83	1.95	1.67	1.30	1.20	1.60	0.99	1.27	2.86	1.16	2.53	2.00	
14/02/2025 02:15	9.00	1.12	3.13	0.81	1.96	1.67	1.30	1.20	1.60	0.99	1.27	2.86	1.16	2.54	2.00	
14/02/2025 02:30	9.01	1.11	3.13	0.79	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.53	2.00	
14/02/2025 02:45	9.00	1.11	3.13	0.77	1.96	1.68	1.31	1.20	1.61	1.00	1.28	2.86	1.16	2.52	2.00	
14/02/2025 03:00	9.01	1.11	3.13	0.75	1.95	1.68	1.31	1.20	1.62	0.99	1.27	2.86	1.16	2.52	2.00	
14/02/2025 03:15	9.00	1.11	3.13	0.73	1.96	1.67	1.30	1.19	1.60	0.99	1.27	2.86	1.16	2.52	2.00	
14/02/2025 03:30	9.00	1.11	3.13	0.71	1.96	1.68	1.30	1.19	1.61	0.99	1.27	2.86	1.16	2.51	2.00	
14/02/2025 03:45	9.00	1.11	3.12	0.69	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.50	2.00	
14/02/2025 04:00	9.01	1.11	3.12	0.67	1.95	1.67	1.30	1.20	1.61	1.00	1.27	2.86	1.16	2.50	2.00	
14/02/2025 04:15	9.00	1.11	3.12	0.65	1.96	1.67	1.30	1.19	1.60	1.00	1.27	2.86	1.16	2.50	2.00	
14/02/2025 04:30	9.00	1.11	3.13	0.63	1.96	1.68	1.31	1.19	1.60	1.00	1.27	2.86	1.16	2.49	2.00	
14/02/2025 04:45	9.00	1.11	3.13	0.61	1.96	1.68	1.31	1.19	1.60	0.99	1.27	2.86	1.16	2.48	2.00	
14/02/2025 05:00	9.00	1.11	3.13	0.60	1.95	1.67	1.31	1.20	1.59	0.99	1.26	2.86	1.17	2.47	2.00	
14/02/2025 05:15	9.00	1.11	3.13	0.58	1.96	1.68	1.31	1.20	1.60	1.00	1.26	2.86	1.16	2.47	2.00	
14/02/2025 05:30	9.00	1.11	3.13	0.57	1.96	1.67	1.30	1.20	1.60	0.99	1.26	2.86	1.16	2.47	2.00	
14/02/2025 05:45	9.01	1.11	3.13	0.56	1.96	1.67	1.30	1.19	1.60	0.99	1.27	2.86	1.16	2.47	2.00	
14/02/2025 06:00	9.00	1.11	3.12	0.55	1.95	1.67	1.30	1.20	1.59	0.99	1.26	2.86	1.16	2.46	2.00	
14/02/2025 06:15	9.00	1.11	3.13	0.55	1.96	1.67	1.30	1.19	1.60	0.99	1.27	2.86	1.16	2.46	2.00	
14/02/2025 06:30	9.00	1.11	3.13	0.54	1.96	1.67	1.30	1.20	1.61	0.99	1.27	2.86	1.16	2.45	2.00	
14/02/2025 06:45	9.00	1.11	3.12	0.54	1.96	1.67	1.30	1.19	1.60	0.99	1.26	2.87	1.16	2.44	1.99	
14/02/2025 07:00	9.00	1.11	3.12	0.55	1.95	1.67	1.30	1.20	1.61	0.99	1.26	2.86	1.16	2.45	1.99	
14/02/2025 07:15	9.00	1.11	3.12	0.56	1.96	1.67	1.30	1.19	1.59	0.99	1.27	2.86	1.16	2.44	2.00	
14/02/2025 07:30	9.00	1.11	3.12	0.57	1.96	1.67	1.30	1.19	1.60	0.99	1.26	2.87	1.16	2.44	1.99	
14/02/2025 07:45	9.00	1.11	3.13	0.59	1.96	1.67	1.30	1.19	1.61	0.99	1.27	2.86	1.16	2.43	1.99	
14/02/2025 08:00	9.00	1.11	3.12	0.60	1.95	1.67	1.31	1.20	1.59	0.99	1.27	2.86	1.16	2.43	1.99	
14/02/2025 08:15	9.00	1.11	3.13	0.61	1.96	1.67	1.30	1.19	1.60	0.99	1.27	2.86	1.16	2.43	2.00	
14/02/2025 08:30	9.00	1.11	3.13	0.62	1.96	1.67	1.30	1.19	1.60	1.00	1.27	2.86	1.15	2.42	1.99	
14/02/2025 08:45	9.00	1.11	3.12	0.64	1.96	1.67	1.30	1.19	1.61	0.98	1.27	2.86	1.16	2.42	2.00	
14/02/2025 09:00	9.00	1.11	3.12	0.65	1.94	1.67	1.29	1.20	1.58	0.99	1.27	2.86	1.16	2.42	1.99	
14/02/2025 09:15	9.00	1.11	3.12	0.66	1.95	1.67	1.30	1.19	1.60	0.99	1.27	2.86	1.15	2.41	1.99	
14/02/2025 09:30	9.00	1.11	3.13	0.68	1.96	1.67	1.30	1.20	1.60	0.99	1.27	2.86	1.16	2.42	1.99	
14/02/2025 09:45	9.00	1.11	3.12	0.69	1.96	1.67	1.29	1.19	1.61	0.99	1.27	2.86	1.15	2.41	1.99	
14/02/2025 10:00	9.00	1.11	3.12	0.70	1.95	1.67	1.30	1.20	1.59	0.99	1.27	2.86	1.16	2.42	1.99	
14/02/2025 10:15	9.00	1.11	3.12	0.72	1.96	1.67	1.30	1.19	1.60	0.99	1.27	2.86	1.15	2.42	1.99	
14/02/2025 10:30	9.00	1.11	3.12	0.73	1.97	1.67	1.30	1.19	1.60	1.00	1.27	2.86	1.16	2.43	1.99	
14/02/2025 10:45	9.00	1.11	3.12	0.75	1.96	1.67	1.30	1.19	1.60	1.00	1.27	2.86	1.16	2.43	1.99	
14/02/2025 11:00	9.00	1.11	3.12	0.78	1.95	1.67	1.30	1.20	1.60	0.99	1.26	2.86	1.16	2.43	1.99	
14/02/2025 11:15	9.00	1.11	3.12	0.80	1.96	1.67	1.30	1.19	1.60	1.00	1.26	2.86	1.16	2.44	1.99	
14/02/2025 11:30	9.00	1.11	3.12	0.80	1.96	1.68	1.30	1.19	1.60	1.00	1.27	2.86	1.16	2.44	1.99	
14/02/2025 11:45	9.00	1.11	3.12	0.80	1.96	1.68	1.30	1.19	1.61	1.00	1.27	2.86	1.15	2.45	2.00	
14/02/2025 12:00	9.00	1.11	3.12	0.81	1.95	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.45	1.99	
14/02/2025 12:15	9.00	1.11	3.12	0.82	1.96	1.68	1.31	1.20	1.61	1.00	1.26	2.86	1.16	2.45	2.00	
14/02/2025 12:30	9.00	1.11	3.12	0.82	1.96	1.67	1.30	1.19	1.61	1.00	1.27	2.86	1.16	2.45	1.99	
14/02/2025 12:45	9.00	1.10	3.12	0.82	1.96	1.67	1.31	1.19	1.59	0.98	1.27	2.85	1.15	2.45	1.99	
14/02/2025 13:00	9.00	1.11	3.12	0.83	1.95	1.67	1.30	1.20	1.61	0.99	1.27	2.86	1.15	2.46	1.99	
14/02/2025 13:15	9.00	1.11	3.12	0.83	1.96	1.67	1.31	1.19	1.60	0.99	1.27	2.85	1.15	2.47	2.00	
14/02/2025 13:30	9.00	1.11	3.12	0.83	1.96	1.67	1.30	1.19	1.60	1.00	1.27	2.85	1.15	2.47	1.99	
14/02/2025 13:45	9.00	1.11	3.12	0.82	1.96	1.67	1.30	1.19	1.60	0.99	1.27	2.86	1.15	2.48	1.99	
14/02/2025 14:00	9.00	1.11	3.12	0.81	1.95	1.67	1.30	1.19	1.59	0.99	1.26	2.85	1.15	2.48	1.99	
14/02/2025 14:15	9.00	1.11	3.12	0.79	1.96	1.68	1.30	1.19	1.61	0.99	1.27	2.85	1.15	2.47	1.99	
14/02/2025 14:30	9.00	1.11	3.12	0.78	1.96	1.67	1.30	1.19	1.60	0.99	1.27	2.86	1.15	2.48	1.99	
14/02/2025 14:45	9.00	1.11	3.12	0.76	1.97	1.68	1.30	1.19	1.60	0.99	1.27	2.86	1.15	2.48	1.99	
14/02/2025 15:00	9.00	1.10	3.12	0.74	1.96	1.67	1.30	1.20	1.61	0.99	1.27	2.85	1.15	2.47	1.99	
14/02/2025 15:15	9.00	1.11	3.12	0.73	1.96	1.67	1.30	1.19	1.60	0.99	1.27	2.86	1.15	2.47	1.99	
14/02/2025 15:30	9.00	1.11	3.12	0.71	1.96	1.68	1.30	1.19	1.60	0.99	1.27	2.86	1.15	2.47	1.99	
14/02/2025 15:45	9.00	1.11	3.12	0.70	1.97	1.68	1.30	1.19	1.61	0.99	1.27	2.86	1.15	2.46	2.00	
14/02/2025 16:00	9.00	1.11	3.12	0.68	1.95	1.67	1.31	1.20	1.61	0.99	1.28	2.85	1.15	2.46	2.00	
14/02/2025 16:15	9.00	1.11	3.12	0.66	1.96	1.67	1.31	1.19	1.61	1.00	1.27	2.86	1.15	2.45	1.99	
14/02/2025 16:30	9.00	1.11	3.12	0.65	1.96	1.67	1.30	1.20	1.60	0.99	1.27	2.86	1.15	2.44	2.00	
14/02/2025 16:45	9.00	1.11	3.12	0.63	1.96	1.68	1.31	1.19	1.60	0.99	1.27	2.86	1.15	2.44	2.00	
14/02/2025 17:00	9.00	1.11	3.12	0.62	1.95	1.67	1.30	1.20	1.59	1.00	1.27	2.86	1.15	2.43	2.00	
14/02/2025 17:15	9.00	1.11	3.12	0.61	1.96	1.68	1.30	1.20	1.60	0.99	1.27	2.86	1.15	2.43	2.00	
14/02/2025 17:30	9.00	1.11	3.12	0.59	1.96	1.68	1.30	1.19	1.60	1.00	1.27	2.86	1.15	2.42	2.00	
14/02/2025 17:45	9.00	1.11	3.12	0.58	1.96	1.67	1.30	1.19	1.60	0.98	1.27	2.86	1.15	2.42	1.99	
14/02/2025 18:00	9.00	1.11	3.12	0.58	1.95	1.67	1.29	1.20	1.59	0.98	1.27	2.85	1.15	2.41	1.99	
14/02/2025 18:15	9.00	1.11	3.12	0.57	1.96	1.67	1.30	1.19	1.61	1.00	1.27	2.86	1.16	2.41	1.99	
14/02/2025 18:30	9.00	1.11	3.12	0.57	1.96	1.67	1.30	1.19	1.60	0.98	1.27	2.86	1.15	2.40	1.99	
14/02/2025 18:45	9.00	1.11	3.12	0.57	1.96	1.67	1.30	1.19	1.60	0.98	1.27	2.86	1.15	2.40	1.99	
14/02/2025 19:00	9.00	1.11	3.12	0.58	1.95	1.67	1.30	1.20	1.58	0.99	1.27	2.86	1.15	2.40	1.99	
14/02/2025 19:15	9.00	1.11	3.12	0.59	1.96	1.67	1.30	1.19	1.59	0.99	1.28	2.86	1.15	2.40	2.00	
14/02/2025 19:30	9.00	1.11	3.12	0.61	1.96	1.67	1.30	1.19	1.59	0.98	1.27	2.86	1.15	2.39	1.99	
14/02/2025 19:45	9.00	1.11	3.12	0.63	1.96	1.67	1.31	1.19	1.60	0.99	1.27	2.86	1.15	2.39	2.00	
14/02/2025 20:00	9.00	1.11	3.12	0.64	1.95	1.67	1.31	1.20	1.59	0.99	1.27	2.86	1.15	2.38	2.00	
14/02/2025 20:15	9.00	1.10	3.12	0.65	1.96	1.67	1.30	1.19	1.60	0.98	1.27	2.86	1.15	2.38	2.00	
14/02/2025 20:30	9.00	1.11	3.12	0.67	1.96	1.67	1.30	1.20	1.59	0.99	1.26	2.86	1.15	2.38	2.00	
14/02/2025 20:45	9.00	1.11	3.12	0.67	1.96	1.67	1.30	1.19	1.60	0.98	1.27	2.86	1.15	2.38	2.00	
14/02/2025 21:00	9.00	1.11	3.12	0.69	1.95	1.67	1.30	1.20	1.60	0.98	1.27	2.86	1.15	2.39	2.00	
14/02/2025 21:15	9.01	1.11	3.12	0.70	1.96	1.67	1.30	1.19	1.60	0.98	1.27	2.86	1.15	2.39	2.00	
14/02/2025 21:30	9.00	1.11	3.12	0.72	1.96	1.68	1.30	1.20	1.60	0.99	1.27	2.86	1.16	2.40	2.00	
14/02/2025 21:45	9.00	1.11	3.12	0.73	1.96	1.67	1.31	1.19	1.60	0.98	1.27	2.86	1.15	2.40	2.00	
14/02/2025 22:00	9.00	1.11	3.12	0.75	1.95	1.67	1.30	1.20	1.60	0.99	1.26	2.86	1.15	2.40	2.00	
14/02/2025 22:15	9.00	1.11	3.12	0.76	1.96	1.67	1.31	1.19	1.60	0.99	1.27	2.86	1.15	2.41	1.99	
14/02/2025 22:30	9.00	1.11	3.12	0.77	1.96	1.67	1.30	1.19	1.60	0.98	1.27	2.86	1.15	2.41	1.99	
14/02/2025 22:45	9.00	1.11	3.12	0.79	1.96	1.67	1.31	1.19	1.60	0.98	1.27	2.86	1.15	2.41	2.00	
14/02/2025 23:00	9.00	1.10	3.12	0.80	1.95	1.67	1.31	1.20	1.58	0.98	1.26	2.86	1.15	2.42	2.00	
14/02/2025 23:15	9.00	1.11	3.12	0.81	1.96	1.67	1.31	1.19	1.59	0.98	1.27	2.86	1.15	2.42	2.00	
14/02/2025 23:30	9.00	1.11	3.12	0.82	1.96	1.68	1.31	1.19	1.60	0.98	1.27	2.86	1.15	2.43	2.00	
14/02/2025 23:45	9.00	1.11	3.12	0.83	1.96	1.68	1.31	1.20	1.61	0.98	1.27	2.86	1.15	2.43	2.00	
15/02/2025 00:00	9.00	1.11	3.12	0.83	1.95	1.68	1.31	1.20	1.61	0.98	1.27	2.86	1.15	2.43	2.00	
15/02/2025 00:15	9.00	1.11	3.12	0.84	1.97	1.68	1.32	1.19	1.62	0.99	1.27	2.86	1.16	2.44	2.00	
15/02/2025 00:30	9.00	1.11	3.12	0.83	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.15	2.44	2.00	
15/02/2025 00:45	9.00	1.11	3.12	0.83	1.96	1.68	1.31	1.19	1.60	0.98	1.26	2.86	1.15	2.44	2.00	
15/02/2025 01:00	9.00	1.11	3.12	0.83	1.95	1.68	1.30	1.20	1.60	0.99	1.27	2.86	1.15	2.45	2.00	
15/02/2025 01:15	9.00	1.11	3.12	0.83	1.96	1.68	1.31	1.20	1.60	0.98	1.27	2.86	1.15	2.45	2.00	
15/02/2025 01:30	9.00	1.11	3.12	0.83	1.97	1.68	1.31	1.19	1.60	0.98	1.27	2.86	1.15	2.45	2.00	
15/02/2025 01:45	9.00	1.11	3.12	0.82	1.96	1.68	1.30	1.19	1.59	0.99	1.27	2.86	1.15	2.45	1.99	
15/02/2025 02:00	9.00	1.11	3.12	0.82	1.95	1.68	1.30	1.20	1.60	0.99	1.27	2.86	1.15	2.46	2.00	
15/02/2025 02:15	9.00	1.11	3.12	0.81	1.97	1.68	1.30	1.19	1.61	0.98	1.27	2.86	1.15	2.46	2.00	
15/02/2025 02:30	9.00	1.11	3.12	0.79	1.97	1.68	1.30	1.19	1.61	0.98	1.27	2.86	1.15	2.46	2.00	
15/02/2025 02:45	9.00	1.11	3.12	0.77	1.97	1.68	1.31	1.19	1.61	0.99	1.27	2.86	1.15	2.46	2.00	
15/02/2025 03:00	9.01	1.11	3.12	0.76	1.95	1.68	1.30	1.20	1.61	0.99	1.27	2.86	1.15	2.46	2.00	
15/02/2025 03:15	9.00	1.11	3.12	0.74	1.96	1.68	1.30	1.20	1.61	0.99	1.27	2.86	1.15	2.46	2.00	
15/02/2025 03:30	9.00	1.11	3.12	0.72	1.97	1.68	1.30	1.20	1.62	0.99	1.27	2.86	1.15	2.45	2.00	
15/02/2025 03:45	9.00	1.11	3.12	0.70	1.97	1.68	1.30	1.20	1.60	0.99	1.26	2.86	1.15	2.44	2.00	
15/02/2025 04:00	9.00	1.11	3.12	0.68	1.96	1.67	1.30	1.20	1.60	0.99	1.26	2.86	1.15	2.44	2.00	
15/02/2025 04:15	9.00	1.11	3.12	0.66	1.96	1.67	1.31	1.19	1.62	0.99	1.27	2.86	1.15	2.43	2.00	
15/02/2025 04:30	9.00	1.11	3.12	0.64	1.96	1.68	1.31	1.20	1.61	0.99	1.27	2.86	1.15	2.43	2.00	
15/02/2025 04:45	9.00	1.11	3.12	0.63	1.96	1.68	1.30	1.19	1.60	0.98	1.27	2.86	1.15	2.42	2.00	
15/02/2025 05:00	9.00	1.11	3.12	0.61	1.96	1.67	1.30	1.20	1.60	0.99	1.27	2.86	1.15	2.42	2.00	
15/02/2025 05:15	9.00	1.11	3.12	0.60	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.15	2.41	2.00	
15/02/2025 05:30	9.00	1.11	3.12	0.58	1.96	1.68	1.30	1.19	1.61	1.00	1.27	2.86	1.15	2.41	2.00	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
15/02/2025 05:45	9.00	1.11	3.12	0.57	1.96	1.68	1.30	1.19	1.61	0.99	1.27	2.86	1.15	2.40	2.00	
15/02/2025 06:00	9.00	1.11	3.12	0.55	1.96	1.67	1.30	1.20	1.59	0.99	1.26	2.86	1.15	2.40	2.00	
15/02/2025 06:15	9.00	1.11	3.12	0.54	1.96	1.67	1.30	1.19	1.61	0.98	1.27	2.86	1.15	2.39	2.00	
15/02/2025 06:30	9.00	1.11	3.12	0.53	1.97	1.68	1.31	1.19	1.61	0.99	1.27	2.86	1.15	2.39	2.00	
15/02/2025 06:45	9.00	1.11	3.12	0.53	1.96	1.67	1.31	1.19	1.60	0.99	1.27	2.86	1.15	2.39	2.00	
15/02/2025 07:00	9.00	1.11	3.12	0.53	1.96	1.67	1.29	1.20	1.60	0.99	1.27	2.86	1.15	2.38	2.00	
15/02/2025 07:15	9.00	1.11	3.12	0.53	1.97	1.67	1.31	1.19	1.60	0.98	1.26	2.86	1.15	2.38	2.00	
15/02/2025 07:30	9.01	1.11	3.12	0.54	1.97	1.68	1.31	1.20	1.61	0.98	1.27	2.86	1.15	2.37	2.00	
15/02/2025 07:45	9.00	1.11	3.12	0.55	1.96	1.67	1.31	1.19	1.59	0.99	1.27	2.86	1.15	2.37	2.00	
15/02/2025 08:00	9.00	1.11	3.12	0.57	1.95	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.15	2.37	2.00	
15/02/2025 08:15	9.00	1.11	3.12	0.58	1.97	1.68	1.31	1.19	1.61	0.99	1.27	2.86	1.15	2.37	2.00	
15/02/2025 08:30	9.01	1.11	3.13	0.59	1.96	1.68	1.31	1.20	1.61	0.98	1.27	2.86	1.15	2.36	2.00	
15/02/2025 08:45	9.00	1.11	3.12	0.60	1.97	1.68	1.31	1.20	1.61	0.99	1.28	2.86	1.16	2.36	2.00	
15/02/2025 09:00	9.01	1.11	3.12	0.62	1.96	1.68	1.31	1.20	1.61	0.99	1.27	2.86	1.15	2.36	2.00	
15/02/2025 09:15	9.00	1.11	3.12	0.63	1.96	1.68	1.30	1.19	1.61	0.99	1.27	2.86	1.15	2.35	2.00	
15/02/2025 09:30	9.01	1.11	3.12	0.65	1.96	1.68	1.31	1.19	1.61	0.98	1.26	2.86	1.15	2.35	2.00	
15/02/2025 09:45	9.00	1.11	3.12	0.66	1.96	1.67	1.31	1.19	1.60	0.99	1.27	2.86	1.15	2.35	2.00	
15/02/2025 10:00	9.01	1.11	3.12	0.67	1.95	1.67	1.31	1.20	1.60	0.98	1.26	2.86	1.15	2.35	2.00	
15/02/2025 10:15	9.01	1.11	3.12	0.69	1.96	1.67	1.31	1.19	1.59	0.99	1.27	2.86	1.15	2.36	2.00	
15/02/2025 10:30	9.00	1.11	3.12	0.70	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.15	2.36	2.00	
15/02/2025 10:45	9.00	1.11	3.12	0.72	1.96	1.67	1.31	1.19	1.60	0.99	1.27	2.86	1.15	2.36	2.00	
15/02/2025 11:00	9.00	1.11	3.12	0.73	1.96	1.68	1.30	1.20	1.60	0.99	1.27	2.86	1.15	2.36	2.00	
15/02/2025 11:15	9.00	1.11	3.12	0.75	1.97	1.68	1.30	1.19	1.59	0.99	1.27	2.85	1.15	2.37	2.00	
15/02/2025 11:30	9.00	1.11	3.12	0.76	1.97	1.68	1.31	1.20	1.61	0.99	1.27	2.86	1.15	2.37	2.00	
15/02/2025 11:45	9.00	1.11	3.12	0.77	1.97	1.67	1.30	1.19	1.60	0.98	1.27	2.86	1.15	2.38	2.00	
15/02/2025 12:00	9.00	1.11	3.12	0.79	1.96	1.67	1.31	1.20	1.60	0.99	1.27	2.85	1.15	2.38	2.00	
15/02/2025 12:15	9.00	1.11	3.12	0.80	1.96	1.68	1.31	1.20	1.60	0.99	1.27	2.86	1.14	2.39	2.00	
15/02/2025 12:30	9.00	1.11	3.12	0.81	1.97	1.68	1.31	1.19	1.61	0.98	1.28	2.85	1.15	2.39	2.00	
15/02/2025 12:45	9.00	1.11	3.12	0.81	1.97	1.68	1.31	1.19	1.60	0.96	1.27	2.85	1.15	2.40	2.00	
15/02/2025 13:00	9.00	1.11	3.12	0.82	1.96	1.67	1.31	1.20	1.59	1.01	1.27	2.85	1.15	2.40	2.00	
15/02/2025 13:15	9.00	1.11	3.12	0.83	1.96	1.68	1.31	1.19	1.60	1.01	1.27	2.86	1.15	2.41	2.00	
15/02/2025 13:30	9.00	1.11	3.12	0.83	1.97	1.68	1.31	1.19	1.60	1.01	1.28	2.86	1.15	2.41	2.00	
15/02/2025 13:45	9.01	1.11	3.12	0.83	1.97	1.68	1.31	1.20	1.60	1.01	1.27	2.85	1.15	2.41	2.00	
15/02/2025 14:00	9.00	1.11	3.12	0.83	1.98	1.67	1.31	1.20	1.59	1.01	1.27	2.85	1.15	2.42	2.00	
15/02/2025 14:15	9.00	1.11	3.07	0.82	1.97	1.68	1.30	1.19	1.60	1.00	1.28	2.85	1.15	2.42	2.00	
15/02/2025 14:30	9.00	1.11	3.08	0.81	1.97	1.68	1.31	1.19	1.60	1.00	1.27	2.85	1.15	2.42	2.00	
15/02/2025 14:45	9.00	1.11	3.10	0.80	1.97	1.68	1.30	1.19	1.60	0.99	1.27	2.85	1.15	2.42	2.00	
15/02/2025 15:00	9.01	1.11	3.11	0.78	1.97	1.68	1.31	1.20	1.60	0.99	1.26	2.86	1.15	2.43	2.00	
15/02/2025 15:15	9.00	1.11	3.11	0.76	1.97	1.68	1.30	1.19	1.60	0.99	1.26	2.86	1.15	2.43	2.00	
15/02/2025 15:30	9.00	1.11	3.11	0.75	1.97	1.67	1.31	1.19	1.61	1.00	1.28	2.86	1.15	2.42	1.99	
15/02/2025 15:45	9.00	1.11	3.11	0.73	1.97	1.67	1.31	1.19	1.60	0.99	1.27	2.85	1.14	2.42	2.00	
15/02/2025 16:00	9.00	1.11	3.11	0.71	1.97	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.15	2.42	2.00	
15/02/2025 16:15	9.00	1.11	3.12	0.70	1.97	1.68	1.30	1.19	1.59	0.99	1.28	2.86	1.15	2.42	2.00	
15/02/2025 16:30	9.00	1.11	3.12	0.68	1.97	1.67	1.31	1.19	1.60	0.99	1.27	2.85	1.15	2.40	1.99	
15/02/2025 16:45	9.00	1.10	3.12	0.67	1.97	1.67	1.31	1.19	1.59	0.99	1.28	2.86	1.14	2.40	2.00	
15/02/2025 17:00	9.00	1.11	3.12	0.66	1.97	1.68	1.30	1.20	1.59	0.99	1.27	2.86	1.15	2.40	2.00	
15/02/2025 17:15	9.00	1.11	3.12	0.64	1.97	1.67	1.30	1.19	1.60	0.99	1.27	2.86	1.15	2.39	2.00	
15/02/2025 17:30	9.00	1.11	3.12	0.62	1.97	1.67	1.31	1.19	1.60	0.99	1.27	2.86	1.15	2.38	2.00	
15/02/2025 17:45	9.00	1.11	3.12	0.61	1.97	1.67	1.31	1.19	1.59	0.99	1.27	2.86	1.15	2.38	1.99	
15/02/2025 18:00	9.00	1.11	3.12	0.61	1.97	1.67	1.31	1.20	1.59	0.98	1.27	2.86	1.15	2.38	2.00	
15/02/2025 18:15	9.00	1.10	3.12	0.60	1.97	1.67	1.31	1.19	1.60	1.00	1.27	2.86	1.15	2.37	2.00	
15/02/2025 18:30	9.01	1.11	3.12	0.59	1.97	1.67	1.31	1.19	1.59	1.00	1.27	2.86	1.15	2.37	2.00	
15/02/2025 18:45	9.00	1.11	3.12	0.58	1.97	1.67	1.31	1.19	1.61	0.99	1.28	2.86	1.15	2.36	2.00	
15/02/2025 19:00	9.00	1.11	3.12	0.59	1.97	1.67	1.31	1.20	1.61	0.99	1.27	2.86	1.16	2.36	2.00	
15/02/2025 19:15	9.00	1.11	3.12	0.59	1.97	1.67	1.30	1.19	1.62	0.99	1.28	2.86	1.15	2.36	2.00	
15/02/2025 19:30	9.00	1.11	3.12	0.60	1.97	1.68	1.31	1.19	1.61	0.98	1.27	2.86	1.15	2.35	2.00	
15/02/2025 19:45	9.00	1.11	3.12	0.61	1.97	1.67	1.31	1.19	1.61	0.98	1.28	2.86	1.16	2.35	2.00	
15/02/2025 20:00	9.00	1.11	3.12	0.63	1.97	1.67	1.31	1.20	1.60	0.98	1.27	2.86	1.16	2.35	2.00	
15/02/2025 20:15	9.00	1.11	3.12	0.65	1.97	1.67	1.31	1.19	1.60	0.98	1.27	2.86	1.15	2.34	2.00	
15/02/2025 20:30	9.00	1.11	3.12	0.65	1.97	1.67	1.31	1.19	1.60	0.98	1.27	2.86	1.15	2.34	2.00	
15/02/2025 20:45	9.00	1.11	3.12	0.67	1.96	1.67	1.31	1.19	1.60	0.98	1.27	2.86	1.15	2.34	2.00	
15/02/2025 21:00	9.00	1.11	3.12	0.69	1.97	1.67	1.31	1.20	1.60	0.99	1.27	2.86	1.16	2.35	2.00	
15/02/2025 21:15	9.00	1.11	3.12	0.70	1.97	1.67	1.31	1.19	1.60	0.99	1.27	2.86	1.16	2.35	2.00	
15/02/2025 21:30	9.00	1.11	3.12	0.71	1.97	1.67	1.32	1.19	1.60	0.98	1.27	2.86	1.15	2.35	1.99	
15/02/2025 21:45	9.00	1.11	3.12	0.73	1.97	1.68	1.31	1.19	1.61	0.98	1.27	2.86	1.15	2.36	2.00	
15/02/2025 22:00	9.00	1.11	3.12	0.74	1.97	1.67	1.30	1.20	1.59	0.98	1.26	2.86	1.15	2.37	2.00	
15/02/2025 22:15	9.00	1.11	3.12	0.75	1.97	1.67	1.30	1.19	1.60	0.98	1.27	2.86	1.16	2.37	2.00	
15/02/2025 22:30	9.00	1.11	3.12	0.77	1.97	1.67	1.30	1.19	1.60	0.98	1.27	2.86	1.16	2.38	1.99	
15/02/2025 22:45	9.00	1.11	3.12	0.78	1.97	1.67	1.31	1.19	1.61	0.99	1.27	2.86	1.15	2.38	2.00	
15/02/2025 23:00	9.00	1.11	3.12	0.80	1.97	1.68	1.31	1.20	1.60	0.98	1.27	2.86	1.16	2.39	2.00	
15/02/2025 23:15	9.00	1.11	3.12	0.82	1.97	1.67	1.31	1.19	1.60	0.99	1.27	2.87	1.16	2.39	2.00	
15/02/2025 23:30	9.00	1.11	3.12	0.83	1.97	1.67	1.31	1.19	1.60	0.99	1.27	2.86	1.16	2.39	1.99	
15/02/2025 23:45	9.00	1.11	3.12	0.84	1.97	1.68	1.31	1.19	1.59	0.98	1.27	2.87	1.16	2.40	2.00	
16/02/2025 00:00	9.00	1.11	3.12	0.85	1.97	1.67	1.31	1.20	1.61	0.98	1.26	2.87	1.16	2.40	2.00	
16/02/2025 00:15	9.00	1.11	3.12	0.86	1.97	1.67	1.31	1.20	1.61	0.99	1.27	2.87	1.16	2.41	1.99	
16/02/2025 00:30	9.00	1.10	3.12	0.86	1.96	1.67	1.30	1.19	1.60	0.99	1.27	2.87	1.16	2.41	1.99	
16/02/2025 00:45	9.00	1.11	3.12	0.86	1.97	1.67	1.31	1.19	1.60	0.99	1.26	2.87	1.16	2.41	2.00	
16/02/2025 01:00	9.00	1.10	3.12	0.86	1.97	1.67	1.30	1.20	1.59	0.99	1.26	2.87	1.16	2.41	1.99	
16/02/2025 01:15	9.00	1.11	3.12	0.86	1.96	1.67	1.31	1.19	1.60	0.98	1.27	2.87	1.16	2.42	1.99	
16/02/2025 01:30	9.00	1.11	3.12	0.86	1.97	1.67	1.31	1.19	1.60	0.99	1.27	2.87	1.16	2.42	1.99	
16/02/2025 01:45	9.00	1.11	3.12	0.86	1.97	1.67	1.30	1.19	1.60	0.99	1.27	2.87	1.16	2.43	1.99	
16/02/2025 02:00	9.00	1.11	3.12	0.85	1.97	1.68	1.32	1.20	1.60	0.98	1.27	2.87	1.17	2.43	2.00	
16/02/2025 02:15	9.00	1.11	3.12	0.85	1.96	1.67	1.30	1.19	1.60	0.98	1.26	2.87	1.16	2.43	1.99	
16/02/2025 02:30	9.00	1.11	3.12	0.84	1.97	1.67	1.31	1.19	1.60	0.98	1.26	2.87	1.16	2.44	2.00	
16/02/2025 02:45	9.00	1.10	3.12	0.83	1.97	1.67	1.30	1.19	1.60	0.98	1.27	2.87	1.16	2.44	1.99	
16/02/2025 03:00	9.00	1.10	3.12	0.82	1.97	1.67	1.31	1.20	1.60	0.98	1.26	2.87	1.16	2.44	1.99	
16/02/2025 03:15	9.00	1.11	3.12	0.80	1.97	1.67	1.30	1.20	1.60	0.98	1.27	2.87	1.16	2.45	2.00	
16/02/2025 03:30	9.00	1.11	3.12	0.78	1.97	1.67	1.30	1.19	1.60	0.98	1.27	2.87	1.16	2.45	2.00	
16/02/2025 03:45	9.00	1.11	3.12	0.76	1.97	1.67	1.30	1.19	1.61	0.99	1.27	2.87	1.16	2.44	1.99	
16/02/2025 04:00	9.00	1.11	3.13	0.74	1.97	1.67	1.30	1.20	1.61	0.98	1.27	2.87	1.17	2.44	2.00	
16/02/2025 04:15	9.00	1.11	3.13	0.72	1.97	1.67	1.31	1.19	1.58	0.98	1.27	2.87	1.16	2.43	2.00	
16/02/2025 04:30	9.00	1.11	3.13	0.70	1.96	1.67	1.31	1.19	1.59	0.98	1.27	2.87	1.16	2.43	1.99	
16/02/2025 04:45	9.00	1.11	3.12	0.68	1.97	1.67	1.31	1.19	1.60	0.98	1.28	2.87	1.16	2.43	1.99	
16/02/2025 05:00	9.00	1.11	3.12	0.67	1.97	1.67	1.31	1.20	1.60	0.98	1.27	2.87	1.17	2.42	1.99	
16/02/2025 05:15	9.00	1.11	3.12	0.64	1.97	1.67	1.31	1.19	1.59	0.97	1.27	2.87	1.16	2.41	2.00	
16/02/2025 05:30	9.00	1.11	3.12	0.63	1.97	1.68	1.31	1.19	1.61	0.98	1.27	2.87	1.16	2.41	2.00	
16/02/2025 05:45	9.00	1.11	3.13	0.61	1.97	1.68	1.30	1.20	1.59	0.98	1.27	2.87	1.16	2.41	2.00	
16/02/2025 06:00	9.00	1.11	3.12	0.59	1.97	1.67	1.30	1.20	1.59	0.98	1.27	2.87	1.17	2.40	1.99	
16/02/2025 06:15	9.00	1.11	3.13	0.58	1.97	1.67	1.31	1.20	1.59	0.98	1.28	2.87	1.17	2.39	2.00	
16/02/2025 06:30	9.00	1.11	3.12	0.56	1.97	1.67	1.31	1.20	1.59	0.97	1.28	2.87	1.16	2.39	2.00	
16/02/2025 06:45	9.00	1.11	3.12	0.55	1.97	1.67	1.31	1.20	1.59	0.98	1.27	2.87	1.17	2.39	1.99	
16/02/2025 07:00	9.00	1.11	3.12	0.54	1.97	1.68	1.30	1.20	1.58	0.97	1.27	2.87	1.17	2.38	2.00	
16/02/2025 07:15	9.00	1.11	3.12	0.54	1.97	1.67	1.31	1.20	1.58	0.98	1.28	2.87	1.17	2.37	1.99	
16/02/2025 07:30	9.00	1.11	3.12	0.53	1.96	1.67	1.31	1.19	1.59	0.98	1.27	2.87	1.16	2.37	1.99	
16/02/2025 07:45	9.00	1.11	3.12	0.53	1.96	1.67	1.31	1.19	1.58	0.97	1.27	2.86	1.17	2.37	1.99	
16/02/2025 08:00	9.01	1.11	3.12	0.53	1.97	1.67	1.30	1.20	1.59	0.98	1.27	2.87	1.16	2.36	1.99	
16/02/2025 08:15	9.00	1.11	3.12	0.54	1.96	1.67	1.30	1.19	1.59	0.98	1.27	2.87	1.16	2.36	1.99	
16/02/2025 08:30	9.00	1.11	3.12	0.55	1.96	1.67	1.30	1.19	1.59	0.99	1.27	2.87	1.16	2.35	1.99	
16/02/2025 08:45	9.00	1.11	3.12	0.56	1.96	1.67	1.31	1.19	1.59	0.98	1.27	2.87	1.17	2.35	1.99	
16/02/2025 09:00	9.00	1.11	3.12	0.57	1.96	1.67	1.30	1.20	1.59	0.97	1.27	2.87	1.17	2.34	1.99	
16/02/2025 09:15	9.00	1.11	3.12	0.58	1.96	1.67	1.30	1.19	1.58	0.98	1.27	2.86	1.16	2.34	1.99	
16/02/2025 09:30	9.00	1.11	3.12	0.60	1.96	1.67	1.31	1.20	1.59	0.98	1.26	2.86	1.16	2.34	1.99	
16/02/2025 09:45	9.00	1.11	3.12	0.61	1.96	1.67	1.30	1.19	1.58	0.98	1.27	2.87	1.16	2.34	1.99	
16/02/2025 10:00	9.00	1.11	3.12	0.62	1.96	1.67	1.30	1.19	1.60	0.97	1.27	2.86	1.16	2.33	1.99	
16/02/2025 10:15	9.00	1.11	3.12	0.63	1.96	1.68	1.29	1.19	1.59	0.98	1.26	2.86	1.16	2.33	1.99	
16/02/2025 10:30	9.00	1.11	3.12	0.64	1.96	1.68	1.30	1.19	1.60	0.98	1.27	2.86	1.16	2.33		
16/02/2025 10:45	9.00	1.11	3.12	0.65	1.96	1.67	1.29	1.19	1.61	0.98	1.26	2.86	1.16	2.33	1.99	
16/02/2025 11:00	9.00	1.11	3.12	0.67	1.96	1.68	1.29	1.19	1.61	0.98	1.26	2.87	1.16	2.33	1.99	
16/02/2025 11:15	8.99	1.11	3.12	0.68	1.96	1.68	1.30	1.19	1.60	0.98	1.26	2.87	1.16	2.33	1.99	
16/02/2025 11:30	8.99	1.10	3.12	0.69	1.96	1.68	1.29	1.19	1.59	0.97	1.26	2.86	1.16	2.33	1.99	
16/02/2025 11:45	8.99	1.11	3.12	0.71	1.96	1.68	1.29	1.19	1.60	0.97	1.26	2.86	1.15	2.33	1.99	
16/02/2025 12:00	8.99	1.11	3.12	0.72	1.96	1.68	1.29	1.19	1.61	0.98	1.27	2.86	1.16	2.35	1.99	
16/02/2025 12:15	8.99	1.11	3.12	0.73	1.96	1.68	1.29	1.19	1.60	0.98	1.26	2.86	1.15	2.35	1.99	
16/02/2025 12:30	8.99	1.10	3.12	0.74	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.35	1.99	
16/02/2025 12:45	8.99	1.10	3.12	0.75	1.96	1.68	1.29	1.19	1.60	0.98	1.26	2.86	1.15	2.36	1.99	
16/02/2025 13:00	9.00	1.11	3.12	0.76	1.97	1.68	1.30	1.19	1.59	0.98	1.27	2.86	1.16	2.36	1.99	
16/02/2025 13:15	8.99	1.11	3.12	0.77	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.37	1.99	
16/02/2025 13:30	9.00	1.11	3.12	0.77	1.96	1.68	1.29	1.19	1.59	0.98	1.26	2.86	1.15	2.38	1.99	
16/02/2025 13:45	8.99	1.11	3.12	0.78	1.97	1.68	1.30	1.19	1.61	0.98	1.27	2.86	1.15	2.38	1.99	

Appendix C: Diver Water Level Data

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
16/02/2025 14:00	8.99	1.10	3.11	0.78	1.96	1.68	1.29	1.19	1.61	0.98	1.26	2.86	1.15	2.38	1.99	
16/02/2025 14:15	8.99	1.11	3.12	0.79	1.96	1.68	1.29	1.19	1.61	0.98	1.26	2.86	1.15	2.38	1.99	
16/02/2025 14:30	8.99	1.11	3.12	0.78	1.96	1.68	1.29	1.19	1.61	0.98	1.26	2.86	1.15	2.39	1.99	
16/02/2025 14:45	8.99	1.10	3.12	0.77	1.96	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.39	1.99	
16/02/2025 15:00	8.99	1.11	3.12	0.76	1.96	1.68	1.29	1.19	1.61	0.97	1.26	2.86	1.16	2.39	1.99	
16/02/2025 15:15	8.99	1.10	3.12	0.75	1.96	1.68	1.30	1.19	1.61	0.97	1.26	2.86	1.15	2.40	1.99	
16/02/2025 15:30	9.00	1.11	3.12	0.73	1.96	1.68	1.29	1.19	1.60	0.98	1.26	2.86	1.15	2.40	1.99	
16/02/2025 15:45	9.00	1.11	3.12	0.72	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.40	1.99	
16/02/2025 16:00	8.99	1.11	3.12	0.70	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.16	2.40	1.99	
16/02/2025 16:15	9.00	1.11	3.12	0.68	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.39	1.99	
16/02/2025 16:30	8.99	1.11	3.12	0.66	1.96	1.68	1.30	1.19	1.60	0.97	1.27	2.86	1.15	2.38	1.99	
16/02/2025 16:45	8.99	1.10	3.12	0.65	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.38	1.99	
16/02/2025 17:00	8.99	1.11	3.12	0.64	1.97	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.37	1.99	
16/02/2025 17:15	8.99	1.11	3.12	0.62	1.96	1.68	1.30	1.19	1.59	0.98	1.26	2.86	1.15	2.37	1.99	
16/02/2025 17:30	8.99	1.11	3.12	0.61	1.96	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.36	1.99	
16/02/2025 17:45	8.99	1.11	3.12	0.59	1.96	1.68	1.30	1.19	1.59	0.97	1.25	2.86	1.15	2.35	1.99	
16/02/2025 18:00	8.99	1.11	3.12	0.58	1.97	1.68	1.29	1.19	1.61	0.97	1.26	2.86	1.15	2.35	1.99	
16/02/2025 18:15	8.99	1.11	3.12	0.57	1.96	1.68	1.30	1.19	1.59	0.98	1.26	2.86	1.15	2.34	1.99	
16/02/2025 18:30	8.99	1.10	3.12	0.56	1.96	1.68	1.30	1.19	1.59	0.97	1.26	2.86	1.15	2.34	1.99	
16/02/2025 18:45	8.99	1.11	3.12	0.55	1.96	1.68	1.29	1.19	1.59	0.97	1.26	2.86	1.15	2.34	1.99	
16/02/2025 19:00	8.99	1.11	3.12	0.55	1.97	1.68	1.29	1.19	1.60	0.98	1.26	2.86	1.15	2.33	1.99	
16/02/2025 19:15	8.99	1.11	3.12	0.54	1.96	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.33	1.99	
16/02/2025 19:30	8.99	1.10	3.11	0.54	1.96	1.68	1.29	1.19	1.60	0.97	1.26	2.86	1.15	2.32	1.99	
16/02/2025 19:45	8.99	1.10	3.12	0.55	1.97	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.32	1.99	
16/02/2025 20:00	9.00	1.10	3.12	0.56	1.96	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.32	1.99	
16/02/2025 20:15	8.99	1.11	3.12	0.57	1.96	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.32	1.99	
16/02/2025 20:30	8.99	1.10	3.12	0.58	1.96	1.68	1.29	1.19	1.60	0.97	1.26	2.86	1.16	2.31	1.99	
16/02/2025 20:45	8.99	1.10	3.12	0.59	1.96	1.68	1.30	1.19	1.59	0.98	1.25	2.86	1.15	2.30	1.99	
16/02/2025 21:00	8.99	1.10	3.11	0.61	1.96	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.16	2.30	1.99	
16/02/2025 21:15	8.99	1.10	3.11	0.62	1.96	1.68	1.29	1.19	1.60	0.97	1.27	2.86	1.15	2.30	1.99	
16/02/2025 21:30	8.99	1.10	3.11	0.64	1.96	1.68	1.29	1.19	1.59	0.97	1.26	2.86	1.15	2.30	1.99	
16/02/2025 21:45	8.99	1.10	3.12	0.65	1.96	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.30	1.99	
16/02/2025 22:00	8.99	1.10	3.11	0.66	1.96	1.68	1.29	1.19	1.60	0.96	1.26	2.86	1.15	2.30	1.99	
16/02/2025 22:15	8.99	1.11	3.12	0.67	1.96	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.31	1.99	
16/02/2025 22:30	8.99	1.11	3.12	0.69	1.96	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.31	1.99	
16/02/2025 22:45	8.99	1.11	3.12	0.70	1.96	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.31	1.99	
16/02/2025 23:00	8.99	1.10	3.12	0.71	1.96	1.68	1.29	1.19	1.61	0.97	1.26	2.86	1.16	2.32	1.99	
16/02/2025 23:15	9.00	1.11	3.12	0.73	1.97	1.68	1.30	1.19	1.60	0.97	1.25	2.86	1.15	2.32	1.99	
16/02/2025 23:30	8.99	1.11	3.12	0.74	1.96	1.68	1.29	1.19	1.59	0.97	1.26	2.86	1.15	2.33	1.99	
16/02/2025 23:45	8.99	1.10	3.12	0.76	1.96	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.33	1.99	
17/02/2025 00:00	8.99	1.10	3.11	0.77	1.96	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.34	1.99	
17/02/2025 00:15	9.00	1.11	3.12	0.79	1.97	1.68	1.30	1.19	1.61	0.97	1.27	2.86	1.15	2.34	1.99	
17/02/2025 00:30	8.99	1.11	3.11	0.80	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.35	1.99	
17/02/2025 00:45	8.99	1.11	3.11	0.80	1.96	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.35	1.99	
17/02/2025 01:00	9.00	1.11	3.11	0.81	1.97	1.68	1.29	1.19	1.60	0.98	1.26	2.86	1.15	2.36	1.99	
17/02/2025 01:15	9.00	1.10	3.11	0.81	1.96	1.68	1.29	1.19	1.61	0.98	1.26	2.86	1.15	2.36	1.99	
17/02/2025 01:30	8.99	1.11	3.12	0.81	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.37	1.99	
17/02/2025 01:45	9.00	1.11	3.12	0.81	1.97	1.68	1.30	1.18	1.60	0.98	1.26	2.86	1.15	2.37	1.99	
17/02/2025 02:00	9.00	1.10	3.11	0.81	1.96	1.68	1.29	1.19	1.60	0.97	1.26	2.86	1.15	2.38	1.99	
17/02/2025 02:15	8.99	1.11	3.12	0.81	1.97	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.38	1.99	
17/02/2025 02:30	8.99	1.11	3.12	0.81	1.97	1.68	1.30	1.19	1.60	0.98	1.27	2.86	1.15	2.39	1.99	
17/02/2025 02:45	8.99	1.11	3.12	0.81	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.39	1.99	
17/02/2025 03:00	8.99	1.11	3.12	0.80	1.97	1.68	1.30	1.19	1.60	0.98	1.25	2.86	1.15	2.39	1.99	
17/02/2025 03:15	8.99	1.10	3.12	0.79	1.97	1.68	1.31	1.19	1.60	0.98	1.26	2.86	1.15	2.40	2.00	
17/02/2025 03:30	8.99	1.10	3.12	0.77	1.96	1.68	1.31	1.19	1.60	0.98	1.26	2.86	1.15	2.40	1.99	
17/02/2025 03:45	8.99	1.11	3.12	0.76	1.96	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.40	1.99	
17/02/2025 04:00	8.99	1.11	3.12	0.74	1.97	1.68	1.30	1.19	1.60	0.98	1.25	2.86	1.15	2.40	1.99	
17/02/2025 04:15	9.00	1.11	3.12	0.73	1.97	1.68	1.30	1.19	1.61	0.99	1.26	2.86	1.15	2.40	1.99	
17/02/2025 04:30	8.99	1.10	3.12	0.71	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.39	1.99	
17/02/2025 04:45	8.99	1.11	3.12	0.69	1.97	1.68	1.31	1.19	1.61	0.98	1.26	2.86	1.15	2.39	2.00	
17/02/2025 05:00	8.99	1.11	3.12	0.68	1.97	1.68	1.30	1.19	1.60	0.99	1.26	2.86	1.15	2.39	1.99	
17/02/2025 05:15	8.99	1.11	3.12	0.66	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.38	1.99	
17/02/2025 05:30	8.99	1.11	3.12	0.64	1.96	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.37	1.99	
17/02/2025 05:45	8.99	1.10	3.12	0.62	1.96	1.68	1.31	1.19	1.61	0.98	1.26	2.86	1.15	2.36	1.99	
17/02/2025 06:00	8.99	1.11	3.11	0.61	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.36	1.99	
17/02/2025 06:15	9.00	1.10	3.12	0.59	1.97	1.68	1.31	1.19	1.61	0.97	1.26	2.86	1.15	2.35	2.00	
17/02/2025 06:30	8.99	1.11	3.12	0.58	1.96	1.68	1.29	1.19	1.60	0.98	1.27	2.86	1.15	2.35	1.99	
17/02/2025 06:45	8.99	1.11	3.12	0.56	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.35	1.99	
17/02/2025 07:00	8.99	1.10	3.11	0.55	1.97	1.68	1.29	1.19	1.59	0.98	1.26	2.86	1.15	2.35	1.99	
17/02/2025 07:15	9.00	1.11	3.12	0.54	1.96	1.68	1.30	1.19	1.61	0.97	1.26	2.86	1.15	2.34	1.99	
17/02/2025 07:30	9.00	1.10	3.12	0.54	1.96	1.68	1.29	1.18	1.60	0.97	1.27	2.86	1.15	2.33	1.99	
17/02/2025 07:45	8.99	1.10	3.12	0.53	1.96	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.33	1.99	
17/02/2025 08:00	9.00	1.11	3.11	0.53	1.96	1.68	1.29	1.19	1.59	0.97	1.27	2.86	1.15	2.32	1.99	
17/02/2025 08:15	8.99	1.11	3.11	0.53	1.96	1.68	1.30	1.19	1.61	0.97	1.26	2.86	1.15	2.32	1.99	
17/02/2025 08:30	9.00	1.11	3.11	0.54	1.96	1.68	1.30	1.19	1.60	0.97	1.26	2.85	1.15	2.32	1.99	
17/02/2025 08:45	9.00	1.10	3.11	0.55	1.96	1.68	1.30	1.19	1.61	0.97	1.26	2.85	1.15	2.31	1.99	
17/02/2025 09:00	9.00	1.11	3.11	0.56	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.31	1.99	
17/02/2025 09:15	9.00	1.11	3.12	0.58	1.96	1.68	1.30	1.19	1.62	0.98	1.26	2.86	1.15	2.31	2.00	
17/02/2025 09:30	9.00	1.11	3.12	0.59	1.96	1.68	1.31	1.19	1.61	0.98	1.26	2.86	1.15	2.30	1.99	
17/02/2025 09:45	9.00	1.11	3.12	0.60	1.96	1.68	1.29	1.19	1.60	0.98	1.27	2.86	1.15	2.30	2.00	
17/02/2025 10:00	9.00	1.11	3.12	0.61	1.96	1.68	1.29	1.19	1.62	0.97	1.26	2.86	1.15	2.30	2.00	
17/02/2025 10:15	9.00	1.11	3.11	0.62	1.96	1.69	1.30	1.19	1.61	0.98	1.27	2.86	1.15	2.30	1.99	
17/02/2025 10:30	8.99	1.10	3.11	0.64	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.29	1.99	
17/02/2025 10:45	8.99	1.10	3.11	0.65	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.29	1.99	
17/02/2025 11:00	9.00	1.10	3.12	0.66	1.96	1.68	1.29	1.19	1.61	0.98	1.26	2.86	1.15	2.30	1.99	
17/02/2025 11:15	8.99	1.10	3.12	0.67	1.96	1.68	1.29	1.19	1.61	0.98	1.26	2.86	1.14	2.30	1.99	
17/02/2025 11:30	8.99	1.11	3.11	0.69	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.85	1.15	2.30	2.00	
17/02/2025 11:45	9.00	1.11	3.12	0.70	1.97	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.30	2.00	
17/02/2025 12:00	9.00	1.11	3.12	0.72	1.97	1.68	1.31	1.20	1.61	0.98	1.26	2.86	1.15	2.32	2.00	
17/02/2025 12:15	9.00	1.11	3.12	0.73	1.97	1.69	1.30	1.20	1.60	0.98	1.27	2.86	1.15	2.32	2.00	
17/02/2025 12:30	9.00	1.11	3.12	0.75	1.97	1.69	1.31	1.19	1.62	0.98	1.27	2.86	1.15	2.33	2.00	
17/02/2025 12:45	9.00	1.11	3.12	0.76	1.97	1.69	1.31	1.19	1.61	0.97	1.27	2.86	1.15	2.33	2.00	
17/02/2025 13:00	9.00	1.11	3.12	0.77	1.98	1.69	1.30	1.20	1.61	0.98	1.27	2.86	1.16	2.34	2.00	
17/02/2025 13:15	9.00	1.11	3.12	0.78	1.97	1.69	1.31	1.19	1.61	0.98	1.27	2.86	1.15	2.34	2.00	
17/02/2025 13:30	9.00	1.11	3.12	0.79	1.97	1.69	1.31	1.19	1.61	0.98	1.27	2.86	1.15	2.34	2.00	
17/02/2025 13:45	9.00	1.11	3.12	0.79	1.97	1.69	1.31	1.19	1.61	0.98	1.27	2.86	1.15	2.35	2.00	
17/02/2025 14:00	9.00	1.11	3.12	0.80	1.97	1.69	1.30	1.19	1.62	0.98	1.27	2.86	1.15	2.35	2.00	
17/02/2025 14:15	9.00	1.11	3.12	0.80	1.98	1.69	1.29	1.19	1.61	0.99	1.27	2.86	1.15	2.36	2.00	
17/02/2025 14:30	9.00	1.11	3.12	0.81	1.98	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.37	2.00	
17/02/2025 14:45	9.00	1.12	3.12	0.82	1.98	1.69	1.30	1.20	1.62	0.99	1.27	2.86	1.15	2.37	2.00	
17/02/2025 15:00	9.01	1.12	3.12	0.81	1.98	1.69	1.30	1.20	1.63	0.98	1.26	2.86	1.15	2.38	2.00	
17/02/2025 15:15	9.00	1.11	3.12	0.80	1.98	1.69	1.31	1.19	1.61	0.98	1.26	2.86	1.15	2.38	2.00	
17/02/2025 15:30	9.00	1.11	3.12	0.80	1.97	1.69	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.38	2.00	
17/02/2025 15:45	9.00	1.11	3.12	0.78	1.97	1.69	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.38	2.00	
17/02/2025 16:00	9.00	1.11	3.12	0.77	1.97	1.68	1.30	1.19	1.61	0.97	1.26	2.86	1.15	2.38	2.00	
17/02/2025 16:15	9.00	1.11	3.12	0.75	1.97	1.68	1.30	1.19	1.62	0.98	1.26	2.86	1.15	2.39	2.00	
17/02/2025 16:30	9.00	1.11	3.12	0.74	1.97	1.68	1.30	1.19	1.60	0.98	1.26	2.86	1.15	2.39	2.00	
17/02/2025 16:45	9.00	1.11	3.12	0.72	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.38	2.00	
17/02/2025 17:00	9.00	1.11	3.12	0.71	1.97	1.69	1.30	1.19	1.62	0.97	1.26	2.86	1.15	2.38	2.00	
17/02/2025 17:15	9.00	1.11	3.12	0.69	1.97	1.68	1.29	1.19	1.61	0.98	1.26	2.86	1.15	2.38	2.00	
17/02/2025 17:30	9.01	1.12	3.13	0.69	1.98	1.69	1.31	1.20	1.62	0.98	1.27	2.87	1.16	2.38	2.01	
17/02/2025 17:45	9.01	1.12	3.13	0.68	1.98	1.70	1.31	1.20	1.63	1.00	1.28	2.87	1.16	2.38	2.01	
17/02/2025 18:00	9.01	1.12	3.13	0.67	1.98	1.69	1.31	1.21	1.62	0.99	1.28	2.87	1.17	2.37	2.01	
17/02/2025 18:15	9.01	1.12	3.13	0.65	1.98	1.69	1.31	1.20	1.63	0.99	1.27	2.87	1.16	2.37	2.01	
17/02/2025 18:30	9.01	1.12	3.13	0.64	1.98	1.69	1.31	1.20	1.62	0.98	1.28	2.87	1.16	2.36	2.01	
17/02/2025 18:45	9.01	1.12	3.13	0.62	1.98	1.69	1.31	1.20	1.62	0.99	1.28	2.87	1.16	2.35	2.01	
17/02/2025 19:00	9.01	1.12	3.13	0.61	1.97	1.69	1.30	1.20	1.63	0.99	1.27	2.87	1.16	2.35	2.01	
17/02/2025 19:15	9.01	1.12	3.13	0.60	1.98	1.69	1.31	1.20	1.63	0.99	1.28	2.87	1.16	2.34	2.00	
17/02/2025 19:30	9.01	1.12	3.13	0.60	1.98	1.69	1.31	1.20	1.62	0.99	1.28	2.87	1.16	2.34	2.01	
17/02/2025 19:45	9.01	1.12	3.13	0.60	1.98	1.69	1.30	1.20	1.62	0.99	1.28	2.86	1.16	2.33	2.00	
17/02/2025 20:00	9.00	1.12	3.12	0.59	1.97	1.69	1.30	1.20	1.61	0.98	1.27	2.86	1.16	2.32	2.00	
17/02/2025 20:15	9.01	1.11	3.12	0.60	1.97	1.69	1.30	1.20	1.62	0.99	1.27	2.86	1.16	2.32	2.00	
17/02/2025 20:30	9.01	1.12	3.12	0.61	1.97	1.69	1.31	1.20	1.62	0.98	1.27	2.86	1.15	2.32	2.00	
17/02/2025 20:45	9.00	1.11	3.12	0.62	1.98	1.69	1.30	1.19	1.61	0.98	1.28	2.86	1.16	2.31	2.00	
17/02/2025 21:00	9.01	1.11	3.12	0.63	1.97	1.69	1.30	1.19	1.61	0.99	1.28	2.86	1.15	2.30	2.00	
17/02/2025 21:15	9.00	1.11	3.12	0.64	1.97	1.69	1.31	1.19	1.61	0.98	1.27	2.86	1.15	2.30	2.00	
17/02/2025 21:30	9.00	1.11	3.12	0.66	1.97	1.69	1.30	1.20	1.62	0.99	1.27	2.86	1.15	2.30	2.00	
17/02/2025 21:45	9.00	1.11	3.11	0.66	1.97	1.69	1.31	1.19	1.62	0.98	1.27	2.86	1.15	2.30	2.00	
17/02/2025 22:00	9.00	1.11	3.11	0.67	1.97	1.68	1.30	1.19	1.61	0.97	1.27	2.86	1.15	2.30	1.99	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
17/02/2025 22:15	9.00	1.11	3.11	0.68	1.97	1.68	1.30	1.19	1.62	0.98	1.26	2.85	1.15	2.31	2.00	
17/02/2025 22:30	9.00	1.11	3.12	0.70	1.97	1.69	1.30	1.19	1.62	0.97	1.27	2.85	1.15	2.31	2.00	
17/02/2025 22:45	9.00	1.11	3.11	0.71	1.97	1.68	1.30	1.19	1.63	0.98	1.27	2.86	1.15	2.32	2.00	
17/02/2025 23:00	9.00	1.11	3.11	0.72	1.97	1.68	1.30	1.19	1.61	0.98	1.27	2.85	1.15	2.32	1.99	
17/02/2025 23:15	9.00	1.11	3.11	0.73	1.97	1.68	1.29	1.19	1.60	0.98	1.27	2.85	1.15	2.33	1.99	
17/02/2025 23:30	9.00	1.11	3.12	0.74	1.97	1.68	1.30	1.19	1.62	0.98	1.26	2.86	1.15	2.33	1.99	
17/02/2025 23:45	8.99	1.11	3.11	0.76	1.97	1.68	1.29	1.19	1.61	0.97	1.26	2.85	1.15	2.34	1.99	
18/02/2025 00:00	9.00	1.11	3.11	0.77	1.97	1.68	1.30	1.19	1.61	0.97	1.26	2.85	1.15	2.34	1.99	
18/02/2025 00:15	8.99	1.11	3.11	0.78	1.97	1.68	1.30	1.19	1.61	0.97	1.26	2.85	1.15	2.34	1.99	
18/02/2025 00:30	9.00	1.10	3.12	0.80	1.96	1.68	1.30	1.19	1.61	0.97	1.26	2.86	1.15	2.35	1.99	
18/02/2025 00:45	9.00	1.10	3.11	0.81	1.96	1.68	1.30	1.19	1.60	0.97	1.27	2.86	1.15	2.36	1.99	
18/02/2025 01:00	9.00	1.11	3.11	0.82	1.97	1.68	1.31	1.19	1.61	0.97	1.26	2.86	1.15	2.36	2.00	
18/02/2025 01:15	9.00	1.11	3.11	0.82	1.97	1.68	1.30	1.19	1.60	0.97	1.26	2.86	1.15	2.37	2.00	
18/02/2025 01:30	9.00	1.11	3.11	0.83	1.97	1.68	1.29	1.19	1.61	0.97	1.26	2.86	1.15	2.37	1.99	
18/02/2025 01:45	9.00	1.11	3.12	0.83	1.97	1.68	1.30	1.19	1.62	0.97	1.27	2.86	1.15	2.37	2.00	
18/02/2025 02:00	9.00	1.11	3.11	0.83	1.97	1.68	1.29	1.19	1.60	0.97	1.26	2.86	1.15	2.37	2.00	
18/02/2025 02:15	9.00	1.11	3.12	0.83	1.97	1.69	1.30	1.19	1.63	0.98	1.26	2.86	1.15	2.38	2.00	
18/02/2025 02:30	9.00	1.11	3.12	0.83	1.97	1.68	1.30	1.19	1.62	0.97	1.27	2.86	1.15	2.38	2.00	
18/02/2025 02:45	8.99	1.10	3.11	0.83	1.97	1.68	1.30	1.19	1.61	0.97	1.27	2.86	1.15	2.39	1.99	
18/02/2025 03:00	8.99	1.10	3.11	0.83	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.86	1.15	2.39	2.00	
18/02/2025 03:15	9.00	1.11	3.11	0.82	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.85	1.15	2.39	1.99	
18/02/2025 03:30	9.00	1.11	3.11	0.82	1.97	1.68	1.30	1.19	1.61	0.98	1.27	2.86	1.15	2.40	1.99	
18/02/2025 03:45	9.00	1.11	3.11	0.81	1.97	1.68	1.30	1.19	1.61	0.98	1.26	2.85	1.15	2.40	2.00	
18/02/2025 04:00	9.00	1.11	3.12	0.79	1.97	1.68	1.30	1.19	1.60	0.97	1.26	2.85	1.15	2.41	2.00	
18/02/2025 04:15	8.99	1.11	3.11	0.78	1.97	1.68	1.29	1.19	1.60	0.97	1.27	2.85	1.15	2.41	1.99	
18/02/2025 04:30	9.00	1.11	3.12	0.76	1.97	1.68	1.30	1.19	1.60	0.97	1.26	2.85	1.15	2.40	2.00	
18/02/2025 04:45	8.99	1.11	3.12	0.74	1.97	1.68	1.30	1.19	1.60	0.97	1.26	2.85	1.15	2.40	2.00	
18/02/2025 05:00	9.00	1.11	3.11	0.72	1.97	1.68	1.29	1.19	1.60	0.96	1.26	2.85	1.15	2.40	1.99	
18/02/2025 05:15	9.00	1.11	3.12	0.71	1.97	1.68	1.30	1.19	1.61	0.97	1.26	2.86	1.15	2.39	1.99	
18/02/2025 05:30	9.00	1.10	3.11	0.69	1.97	1.68	1.30	1.19	1.62	0.97	1.27	2.85	1.14	2.39	1.99	
18/02/2025 05:45	9.00	1.10	3.11	0.68	1.97	1.68	1.30	1.19	1.61	0.97	1.26	2.85	1.14	2.38	1.99	
18/02/2025 06:00	9.00	1.11	3.11	0.66	1.97	1.68	1.30	1.19	1.61	0.97	1.25	2.86	1.15	2.38	2.00	
18/02/2025 06:15	9.00	1.11	3.12	0.64	1.97	1.68	1.30	1.19	1.61	0.97	1.26	2.85	1.15	2.37	1.99	
18/02/2025 06:30	9.00	1.10	3.11	0.62	1.96	1.68	1.30	1.19	1.61	0.97	1.26	2.85	1.15	2.37	1.99	
18/02/2025 06:45	9.00	1.11	3.11	0.61	1.97	1.68	1.30	1.18	1.61	0.97	1.27	2.85	1.15	2.36	1.99	
18/02/2025 07:00	9.00	1.10	3.11	0.59	1.96	1.67	1.30	1.19	1.61	0.96	1.26	2.85	1.15	2.36	1.99	
18/02/2025 07:15	8.99	1.10	3.11	0.58	1.96	1.68	1.30	1.19	1.60	0.98	1.27	2.85	1.14	2.35	1.99	
18/02/2025 07:30	8.99	1.10	3.11	0.57	1.96	1.68	1.30	1.19	1.60	0.98	1.27	2.85	1.14	2.34	1.99	
18/02/2025 07:45	8.99	1.10	3.10	0.55	1.96	1.67	1.30	1.18	1.59	0.97	1.26	2.85	1.14	2.34	1.99	
18/02/2025 08:00	8.99	1.10	3.11	0.55	1.96	1.67	1.31	1.19	1.60	0.97	1.26	2.85	1.14	2.34	1.99	
18/02/2025 08:15	8.99	1.10	3.11	0.54	1.96	1.68	1.30	1.18	1.60	0.96	1.26	2.85	1.14	2.33	1.99	
18/02/2025 08:30	8.99	1.10	3.11	0.54	1.96	1.68	1.29	1.18	1.60	0.97	1.26	2.85	1.14	2.33	1.99	
18/02/2025 08:45	8.99	1.10	3.11	0.54	1.96	1.67	1.30	1.19	1.61	0.97	1.26	2.85	1.14	2.32	1.99	
18/02/2025 09:00	8.99	1.10	3.11	0.54	1.96	1.68	1.29	1.19	1.60	0.96		2.85	1.14	2.31	1.99	
18/02/2025 09:15	8.99	1.10	3.11	0.54	1.96	1.67	1.30	1.18	1.60	0.96	1.26	2.85	1.14	2.31	1.99	
18/02/2025 09:30	8.99		3.11	0.56	1.96	1.68	1.30	1.18	1.61	0.97	1.26	2.85	1.14	2.31	1.99	
18/02/2025 09:45	9.00	1.10	3.11	0.57	1.96	1.68	1.30	1.19	1.61	0.98	1.26	2.85	1.15	2.31	1.99	
18/02/2025 10:00	9.00	1.10	3.11	0.59	1.96	1.68	1.30	1.18	1.60	0.97	1.25	2.85	1.14	2.30	1.99	
18/02/2025 10:15	8.99	1.09	3.11	0.59	1.96	1.68	1.30	1.18	1.60	0.97	1.25	2.85	1.14	2.29	1.99	
18/02/2025 10:30	8.99	1.10	3.06	0.61	1.96	1.68	1.29	1.18	1.61	0.96	1.25	2.85	1.14	2.30	1.99	
18/02/2025 10:45	9.00	1.10	3.09	0.62	1.96	1.69	1.30	1.18	1.61	0.97	1.26	2.85	1.15	2.30	2.00	
18/02/2025 11:00	9.00	1.09	3.09	0.63	1.97	1.68	1.29	1.18	1.61	0.96	1.25	2.85	1.14	2.29	1.99	
18/02/2025 11:15	9.00	1.10	3.10	0.63	1.96	1.68	1.30	1.19	1.61	0.97	1.26	2.85	1.14	2.29	2.00	
18/02/2025 11:30	9.00	1.10	3.11	0.66	1.97	1.69	1.30	1.19	1.61	0.98	1.27	2.86	1.14	2.29	2.00	
18/02/2025 11:45	8.99	1.10	3.11	0.66	1.97	1.69	1.30	1.18	1.62	0.97	1.26	2.85	1.15	2.29	2.00	
18/02/2025 12:00	9.00	1.10	3.11	0.67	1.97	1.68	1.30	1.18	1.61	0.97	1.26	2.85	1.15	2.29	2.00	
18/02/2025 12:15	9.00	1.10	3.12	0.68	1.97	1.68	1.30	1.18	1.61	0.98	1.26	2.85	1.14	2.29	2.00	
18/02/2025 12:30	9.00	1.10	3.11	0.69	1.97	1.69	1.30	1.18	1.61	0.97	1.26	2.85	1.14	2.30	2.00	
18/02/2025 12:45	9.00	1.10	3.12	0.71	1.97	1.68		1.19	1.61	0.98	1.26	2.85	1.15	2.30	2.00	
18/02/2025 13:00	9.00	1.10	3.11	0.72	1.97	1.68	1.29	1.18	1.59	0.97	1.26	2.85	1.14	2.30	2.00	
18/02/2025 13:15	9.00	1.11	3.12	0.74	1.97	1.69	1.31	1.19	1.61	0.98	1.27	2.86	1.16	2.32	2.01	
18/02/2025 13:30	9.00	1.10	3.12	0.75	1.98	1.69	1.30	1.19	1.60	0.97	1.27	2.86	1.15	2.32	2.01	
18/02/2025 13:45	9.00	1.10	3.12	0.75	1.97	1.68	1.30	1.19	1.60	0.98	1.27	2.85	1.15	2.32	2.01	
18/02/2025 14:00	9.00	1.10	3.12	0.76	1.98	1.69	1.30	1.19	1.61	0.96	1.27	2.86	1.15	2.33	2.01	
18/02/2025 14:15	8.99	1.10	3.12	0.76	1.97	1.69	1.30	1.19	1.61	0.97	1.26	2.86	1.15	2.33	2.01	
18/02/2025 14:30	9.00	1.11	3.12	0.78	1.98	1.69	1.30	1.19	1.61	0.97	1.27	2.86	1.15	2.34	2.01	
18/02/2025 14:45	9.00	1.10	3.12	0.78	1.98	1.69	1.30	1.19	1.61	0.98	1.27	2.86	1.15	2.35	2.01	
18/02/2025 15:00	9.01	1.11	3.13	0.80	1.99	1.70	1.31	1.20	1.62	0.97	1.27	2.87	1.16	2.36	2.02	
18/02/2025 15:15	9.00	1.10	3.12	0.78	1.97	1.69	1.30	1.19	1.61	0.96	1.27	2.85	1.15	2.36	2.01	
18/02/2025 15:30	9.00	1.10	3.12	0.77	1.97	1.68	1.30	1.19	1.60		1.26	2.85	1.14	2.35	2.01	Data removed from PT05 due to instrument issues
18/02/2025 15:45	9.00	1.10	3.12	0.77	1.97	1.69	1.30	1.19	1.59		1.27	2.86	1.15	2.36	2.01	Data removed from PT05 due to instrument issues
18/02/2025 16:00	9.00	1.11	3.12	0.76	1.98	1.69	1.31	1.19	1.60		1.26	2.86	1.16	2.37	2.01	Data removed from PT05 due to instrument issues
18/02/2025 16:15	9.00	1.10	3.12	0.74	1.98	1.68	1.30	1.19	1.61		1.27	2.86	1.15	2.37	2.01	Data removed from PT05 due to instrument issues
18/02/2025 16:30	9.01	1.11	3.13	0.74	1.98	1.69	1.31	1.19	1.60		1.28	2.87	1.16	2.37	2.02	Data removed from PT05 due to instrument issues
18/02/2025 16:45	9.01	1.11	3.13	0.72	1.98	1.69	1.31	1.20	1.61		1.28	2.87	1.16	2.37	2.02	Data removed from PT05 due to instrument issues
18/02/2025 17:00	9.01	1.11	3.13	0.71	1.99	1.69	1.32	1.20	1.60		1.27	2.87	1.16	2.37	2.02	Data removed from PT05 due to instrument issues
18/02/2025 17:15	9.01	1.11	3.13	0.69	1.98	1.69	1.31	1.20	1.60		1.28	2.87	1.16	2.36	2.02	Data removed from PT05 due to instrument issues
18/02/2025 17:30	9.01	1.11	3.13	0.68	1.98	1.69	1.31	1.19	1.61		1.27	2.87	1.16	2.36	2.02	Data removed from PT05 due to instrument issues
18/02/2025 17:45	9.01	1.11	3.13	0.66	1.98	1.69	1.31	1.20	1.62		1.27	2.86	1.16	2.35	2.02	Data removed from PT05 due to instrument issues
18/02/2025 18:00	9.00	1.10	3.13	0.65	1.98	1.69	1.31	1.19	1.61		1.27	2.86	1.16	2.34	2.02	Data removed from PT05 due to instrument issues
18/02/2025 18:15	9.00	1.10	3.12	0.63	1.98	1.69	1.31	1.19	1.60		1.27	2.86	1.16	2.34	2.01	Data removed from PT05 due to instrument issues
18/02/2025 18:30	9.00	1.10	3.12	0.62	1.97	1.69	1.31	1.19	1.61		1.27	2.86	1.15	2.33	2.01	Data removed from PT05 due to instrument issues
18/02/2025 18:45	9.00	1.10	3.12	0.61	1.97	1.68	1.31	1.19	1.60		1.26	2.86	1.15	2.32	2.01	Data removed from PT05 due to instrument issues
18/02/2025 19:00	9.00	1.10	3.12	0.60	1.97	1.69	1.30	1.19	1.61		1.26	2.86	1.15	2.32	2.01	Data removed from PT05 due to instrument issues
18/02/2025 19:15	9.00	1.10	3.12	0.58	1.97	1.68	1.30	1.18	1.60		1.27	2.85	1.15	2.31	2.01	Data removed from PT05 due to instrument issues
18/02/2025 19:30	9.00	1.10	3.12	0.57	1.97	1.68	1.30	1.19	1.61		1.26	2.85	1.15	2.31	2.01	Data removed from PT05 due to instrument issues
18/02/2025 19:45	9.00	1.10	3.12	0.57	1.97	1.68	1.30	1.18	1.60		1.27	2.85	1.15	2.30	2.01	Data removed from PT05 due to instrument issues
18/02/2025 20:00	9.00	1.10	3.11	0.56	1.97	1.68	1.30	1.19	1.60		1.26	2.86	1.15	2.30	2.00	Data removed from PT05 due to instrument issues
18/02/2025 20:15	9.00	1.10	3.11	0.56	1.97	1.68	1.31	1.18	1.60		1.26	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
18/02/2025 20:30	8.99	1.10	3.11	0.56	1.97	1.68	1.30	1.18	1.60		1.26	2.85	1.15	2.29	2.00	Data removed from PT05 due to instrument issues
18/02/2025 20:45	9.00	1.10	3.11	0.56	1.97	1.68	1.30	1.19	1.59		1.26	2.85	1.15	2.28	2.00	Data removed from PT05 due to instrument issues
18/02/2025 21:00	9.00	1.10	3.11	0.56	1.97	1.68	1.30	1.18	1.60		1.26	2.85	1.15	2.28	2.01	Data removed from PT05 due to instrument issues
18/02/2025 21:15	9.00	1.10	3.11	0.57	1.97	1.68	1.30	1.18	1.60		1.26	2.85	1.15	2.28	2.01	Data removed from PT05 due to instrument issues
18/02/2025 21:30	8.99	1.10	3.11	0.58	1.97	1.68	1.30	1.18	1.61		1.26	2.85	1.15	2.27	2.01	Data removed from PT05 due to instrument issues
18/02/2025 21:45	8.99	1.10	3.12	0.59	1.97	1.68	1.29	1.18	1.60		1.26	2.85	1.15	2.27	2.01	Data removed from PT05 due to instrument issues
18/02/2025 22:00	9.00	1.10	3.11	0.60	1.97	1.68	1.30	1.19	1.60		1.26	2.85	1.15	2.26	2.00	Data removed from PT05 due to instrument issues
18/02/2025 22:15	8.99	1.10	3.12	0.61	1.97	1.68	1.30	1.18	1.60		1.26	2.86	1.15	2.26	2.01	Data removed from PT05 due to instrument issues
18/02/2025 22:30	9.00	1.10	3.11	0.62	1.97	1.68	1.30	1.19	1.60		1.27	2.85	1.15	2.26	2.00	Data removed from PT05 due to instrument issues
18/02/2025 22:45	8.99	1.10	3.11	0.63	1.97	1.68	1.29	1.18	1.60		1.26	2.85	1.15	2.25	2.00	Data removed from PT05 due to instrument issues
18/02/2025 23:00	8.99	1.10	3.11	0.64	1.97	1.68	1.29	1.18	1.59		1.26	2.86	1.15	2.26	2.00	Data removed from PT05 due to instrument issues
18/02/2025 23:15	8.99	1.10	3.11	0.65	1.97	1.68	1.30	1.18	1.60		1.26	2.85	1.15	2.25	2.00	Data removed from PT05 due to instrument issues
18/02/2025 23:30	8.99	1.09	3.11	0.66	1.96	1.68	1.30	1.18	1.60		1.26	2.86	1.15	2.25	2.00	Data removed from PT05 due to instrument issues
18/02/2025 23:45	8.99	1.09	3.12	0.67	1.97	1.68	1.30	1.18	1.60		1.25	2.85	1.14	2.26	2.01	Data removed from PT05 due to instrument issues
19/02/2025 00:00	8.99	1.10	3.11	0.69	1.97	1.68	1.30	1.18	1.61		1.26	2.85	1.15	2.26	2.01	Data removed from PT05 due to instrument issues
19/02/2025 00:15	8.99	1.10	3.11	0.70	1.97	1.68	1.30	1.18	1.59		1.26	2.85	1.15	2.26	2.00	Data removed from PT05 due to instrument issues
19/02/2025 00:30	9.00	1.10	3.12	0.71	1.97	1.68	1.30	1.18	1.60		1.26	2.86	1.15	2.27	2.01	Data removed from PT05 due to instrument issues
19/02/2025 00:45	8.99	1.10	3.11	0.72	1.97	1.68	1.30	1.18	1.60		1.26	2.85	1.15	2.28	2.00	Data removed from PT05 due to instrument issues
19/02/2025 01:00	8.99	1.09	3.11	0.73	1.97	1.68	1.30	1.18	1.58		1.26	2.85	1.15	2.28	2.00	Data removed from PT05 due to instrument issues
19/02/2025 01:15	9.00	1.10	3.11	0.74	1.97	1.68	1.30	1.18	1.61		1.26	2.86	1.15	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 01:30	8.99	1.10	3.11	0.75	1.97	1.68	1.29	1.18	1.60		1.26	2.86	1.15	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 01:45	8.99	1.10	3.11	0.76	1.97	1.68	1.30	1.18	1.59		1.26	2.85	1.15	2.30	2.00	Data removed from PT05 due to instrument issues
19/02/2025 02:00	8.99	1.09	3.11	0.77	1.97	1.68	1.29	1.18	1.60		1.25	2.86	1.15	2.30	2.01	Data removed from PT05 due to instrument issues
19/02/2025 02:15	8.99	1.10	3.11	0.77	1.97	1.68	1.30	1.18	1.60		1.26	2.86	1.15	2.31	2.01	Data removed from PT05 due to instrument issues
19/02/2025 02:30	8.99	1.10	3.11	0.77	1.97	1.68	1.31	1.18	1.60		1.26	2.86	1.15	2.32	2.00	Data removed from PT05 due to instrument issues
19/02/2025 02:45	9.00	1.10	3.12	0.78	1.97	1.68	1.30	1.18	1.61		1.26	2.85	1.15	2.32	2.01	Data removed from PT05 due to instrument issues
19/02/2025 03:00	9.00	1.10	3.12	0.79	1.97	1.68	1.30	1.19	1.60		1.26	2.86	1.15	2.33	2.01	Data removed from PT05 due to instrument issues
19/02/2025 03:15	9.00	1.10	3.12	0.78	1.97	1.68	1.30	1.18	1.60		1.26	2.86	1.15	2.33	2.00	Data removed from PT05 due to instrument issues
19/02/2025 03:30	9.00	1.10	3.11	0.78	1.97	1.68	1.30	1.18	1.61		1.26	2.86	1.15	2.33	2.01	Data removed from PT05 due to instrument issues
19/02/2025 03:45	8.99	1.10	3.11	0.78	1.97	1.68	1.30	1.18	1.61		1.25	2.85	1.15	2.34	2.00	Data removed from PT05 due to instrument issues
19/02/2025 04:00	9.00	1.10	3.11	0.77	1.97	1.68	1.30	1.18	1.60		1.25	2.86	1.15	2.34	2.01	Data removed from PT05 due to instrument issues
19/02/2025 04:15	8.99	1.10	3.11	0.76	1.97	1.68	1.29	1.18	1.60		1.25	2.86	1.15	2.34	2.00	Data removed from PT05 due to instrument issues
19/02/2025 04:30	8.99	1.10	3.12	0.74	1.97	1.68	1.29	1.18	1.61		1.25	2.85	1.15	2.35	2.00	Data removed from PT05 due to instrument issues
19/02/2025 04:45	8.99	1.10	3.11	0.73	1.97	1.68	1.29	1.18	1.61		1.25	2.85	1.15	2.35	2.00	Data removed from PT05 due to instrument issues
19/02/2025 05:00	9.00	1.10	3.12	0.72	1.97	1.68	1.30	1.18	1.61		1.25	2.86	1.15	2.35	2.01	Data removed from PT05 due to instrument issues
19/02/2025 05:15	8.99	1.10	3.12	0.70	1.97	1.68	1.30	1.18	1.61		1.25	2.86	1.15	2.35	2.00	Data removed from PT05 due to instrument issues
19/02/2025 05:30	8.99	1.10	3.11	0.69	1.97	1.68	1.29	1.18	1.60		1.26	2.85	1.15	2.34	2.01	Data removed from PT05 due to instrument issues
19/02/2025 05:45	8.99	1.09	3.12	0.67	1.97	1.68	1.30	1.18	1.61		1.25	2.85	1.15	2.34	2.01	Data removed from PT05 due to instrument issues
19/02/2025 06:00	9.00	1.10	3.11	0.66	1.97	1.68	1.29	1.18	1.60		1.26	2.86	1.15	2.33	2.01	Data removed from PT05 due to instrument issues
19/02/2025 06:15	8.99	1.09	3.11	0.64	1.97	1.68	1.30	1.18	1.61		1.26	2.85	1.14	2.33	2.00	Data removed from PT05 due to instrument issues

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
19/02/2025 06:30	8.99	1.09	3.11	0.63	1.97	1.68	1.29	1.18	1.61		1.26	2.85	1.14	2.32	2.00	Data removed from PT05 due to instrument issues
19/02/2025 06:45	8.99	1.09	3.11	0.61	1.97	1.68	1.29	1.19	1.60		1.25	2.85	1.14	2.31	2.01	Data removed from PT05 due to instrument issues
19/02/2025 07:00	9.00	1.10	3.11	0.60	1.97	1.68	1.29	1.18	1.61		1.25	2.85	1.15	2.31	2.00	Data removed from PT05 due to instrument issues
19/02/2025 07:15	8.99	1.09	3.11	0.59	1.96	1.68	1.29	1.18	1.60		1.25	2.85	1.14	2.31	2.00	Data removed from PT05 due to instrument issues
19/02/2025 07:30	8.99	1.10	3.11	0.57	1.96	1.67	1.29	1.18	1.60		1.25	2.85	1.14	2.30	2.00	Data removed from PT05 due to instrument issues
19/02/2025 07:45	8.99	1.09	3.11	0.56	1.96	1.67	1.29	1.18	1.59		1.25	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 08:00	8.99	1.09	3.11	0.55	1.96	1.67	1.29	1.18	1.60		1.26	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 08:15	8.99	1.10	3.11	0.55	1.97	1.68	1.29	1.18	1.61		1.25	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 08:30	8.99	1.09	3.11	0.54	1.97	1.68	1.29	1.19	1.62		1.26	2.85	1.15	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 08:45	8.99	1.09	3.11	0.53	1.97	1.68	1.29	1.18	1.61			2.85	1.15	2.28	2.00	Data removed from PT05 due to instrument issues
19/02/2025 09:00	8.99	1.09	3.11	0.53	1.96	1.68	1.30	1.18	1.60		1.26	2.85	1.14	2.27	2.00	Data removed from PT05 due to instrument issues
19/02/2025 09:15	8.99	1.09	3.11	0.53	1.96	1.68	1.29	1.18	1.61		1.26	2.85	1.15	2.27	2.00	Data removed from PT05 due to instrument issues
19/02/2025 09:30	8.99	1.09	3.11	0.53	1.97	1.68	1.30	1.19	1.60		1.26	2.85	1.14	2.27	2.00	Data removed from PT05 due to instrument issues
19/02/2025 09:45	8.99	1.09	3.11	0.53	1.96	1.68	1.30	1.18	1.61		1.26	2.85	1.14	2.26	2.00	Data removed from PT05 due to instrument issues
19/02/2025 10:00	8.99	1.09	3.11	0.54	1.97	1.68	1.30	1.18	1.62		1.27	2.85	1.14	2.26	2.01	Data removed from PT05 due to instrument issues
19/02/2025 10:15	8.99	1.09	3.11	0.54	1.96	1.68	1.30	1.18	1.61		1.26	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
19/02/2025 10:30	8.99	1.09	3.08	0.55	1.96	1.68	1.29	1.18	1.61		1.26	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
19/02/2025 10:45	8.99	1.09	3.09	0.56	1.96	1.67	1.29	1.18	1.62		1.26	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
19/02/2025 11:00	8.99	1.09	3.09	0.56	1.96	1.68	1.29	1.18	1.61		1.26	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
19/02/2025 11:15	8.99	1.09	3.09	0.57	1.96	1.68	1.30	1.18	1.60		1.26	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
19/02/2025 11:30	8.99	1.09	3.10	0.58	1.97	1.68	1.29	1.18	1.60		1.26	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
19/02/2025 11:45	8.99	1.09	3.10	0.59	1.97	1.68	1.30	1.19	1.60		1.27	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
19/02/2025 12:00	8.99	1.09	3.10	0.60	1.97	1.68	1.30	1.18	1.61		1.26	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
19/02/2025 12:15	8.99	1.08	3.10	0.61	1.96	1.68	1.29	1.18	1.60		1.26	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
19/02/2025 12:30	8.99	1.09	3.10	0.61	1.97	1.68	1.29	1.18	1.60		1.26	2.84	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
19/02/2025 12:45	8.99	1.09	3.10	0.63	1.97	1.68	1.29	1.18	1.61		1.26	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
19/02/2025 13:00	8.99	1.08	3.10	0.64	1.97	1.68		1.18	1.61		1.26	2.85	1.14	2.22	2.00	Data removed from PT05 due to instrument issues
19/02/2025 13:15	8.98	1.09	3.10	0.65	1.97	1.68	1.29	1.18	1.59		1.27	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
19/02/2025 13:30	8.99	1.08	3.10	0.66	1.97	1.67	1.28	1.17			1.26	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
19/02/2025 13:45	8.99	1.09	3.10	0.67	1.97	1.67	1.29	1.17	1.59		1.26	2.85	1.13	2.23	2.00	Data removed from PT05 due to instrument issues
19/02/2025 14:00	8.99	1.08	3.10	0.68	1.97	1.67	1.28	1.17	1.60		1.26	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
19/02/2025 14:15	8.98	1.09	3.10	0.69	1.97	1.67	1.28	1.17	1.60		1.27	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
19/02/2025 14:30	8.98	1.08	3.10	0.70	1.97	1.67	1.28	1.16	1.59		1.27	2.84	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
19/02/2025 14:45	8.99	1.09	3.10	0.71	1.96	1.68	1.29	1.17	1.60		1.27	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
19/02/2025 15:00	8.99	1.09	3.11	0.72	1.97	1.68	1.29	1.17	1.60		1.27	2.85	1.14	2.26	2.01	Data removed from PT05 due to instrument issues
19/02/2025 15:15	8.99	1.09	3.11	0.72	1.97	1.68	1.29	1.18	1.59		1.27	2.85	1.14	2.27	2.01	Data removed from PT05 due to instrument issues
19/02/2025 15:30	8.99	1.09	3.10	0.72	1.97	1.68	1.28	1.17	1.60		1.27	2.85	1.14	2.28	2.00	Data removed from PT05 due to instrument issues
19/02/2025 15:45	8.99	1.09	3.11	0.73	1.97	1.68	1.29	1.17	1.60		1.27	2.85	1.14	2.28	2.00	Data removed from PT05 due to instrument issues
19/02/2025 16:00	8.99	1.09	3.10	0.72	1.97	1.67	1.28	1.17	1.59		1.26	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 16:15	8.98	1.09	3.10	0.71	1.96	1.67	1.29	1.17	1.61		1.26	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 16:30	8.99	1.09	3.10	0.70	1.97	1.68	1.28	1.17	1.60		1.27	2.85	1.15	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 16:45	8.99	1.09	3.10	0.69	1.97	1.67	1.29	1.17	1.59		1.26	2.85	1.14	2.30	2.00	Data removed from PT05 due to instrument issues
19/02/2025 17:00	8.99	1.08	3.10	0.67	1.97	1.67	1.28	1.17	1.60		1.26	2.85	1.15	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 17:15	8.99	1.09	3.10	0.66	1.97	1.67	1.28	1.17	1.59		1.27	2.85	1.15	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 17:30	8.99	1.09	3.10	0.64	1.97	1.68	1.28	1.17	1.59		1.26	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
19/02/2025 17:45	8.99	1.09	3.10	0.63	1.96	1.67	1.28	1.17	1.59		1.26	2.85	1.14	2.28	2.00	Data removed from PT05 due to instrument issues
19/02/2025 18:00	8.99	1.09	3.10	0.62	1.97	1.67	1.28	1.17	1.58		1.26	2.85	1.15	2.28	2.00	Data removed from PT05 due to instrument issues
19/02/2025 18:15	8.98	1.09	3.10	0.60	1.96	1.67	1.28	1.17	1.59		1.27	2.85	1.14	2.28	2.00	Data removed from PT05 due to instrument issues
19/02/2025 18:30	8.99	1.09	3.10	0.59	1.96	1.67	1.28	1.17	1.58		1.27	2.85	1.15	2.27	2.00	Data removed from PT05 due to instrument issues
19/02/2025 18:45	8.99	1.09	3.11	0.58	1.96	1.67	1.28	1.17	1.60		1.27	2.85	1.15	2.27	2.00	Data removed from PT05 due to instrument issues
19/02/2025 19:00	8.99	1.09	3.10	0.57	1.97	1.67	1.28	1.17	1.60		1.27	2.85	1.15	2.27	2.00	Data removed from PT05 due to instrument issues
19/02/2025 19:15	8.99	1.09	3.11	0.56	1.97	1.67	1.28	1.17	1.59		1.27	2.85	1.14	2.26	2.00	Data removed from PT05 due to instrument issues
19/02/2025 19:30	8.99	1.09	3.10	0.55	1.96	1.67	1.28	1.17	1.59		1.27	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
19/02/2025 19:45	8.99	1.09	3.11	0.54	1.97	1.68	1.28	1.17	1.60		1.27	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
19/02/2025 20:00	8.99	1.08	3.10	0.54	1.97	1.67	1.28	1.17	1.60		1.27	2.86	1.15	2.24	2.00	Data removed from PT05 due to instrument issues
19/02/2025 20:15	8.99	1.09	3.11	0.53	1.97	1.68	1.29	1.17	1.61		1.27	2.85	1.15	2.24	2.01	Data removed from PT05 due to instrument issues
19/02/2025 20:30	8.99	1.09	3.10	0.53	1.97	1.68	1.28	1.17	1.59		1.26	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
19/02/2025 20:45	8.99	1.09	3.10	0.52	1.96	1.67	1.28	1.17	1.59		1.26	2.85	1.15	2.24	2.00	Data removed from PT05 due to instrument issues
19/02/2025 21:00	8.99	1.09	3.10	0.53	1.97	1.67	1.29	1.17	1.60		1.27	2.86	1.15	2.23	2.00	Data removed from PT05 due to instrument issues
19/02/2025 21:15	8.99	1.08	3.10	0.53	1.97	1.67	1.28	1.17	1.59		1.27	2.85	1.15	2.23	2.00	Data removed from PT05 due to instrument issues
19/02/2025 21:30	8.99	1.09	3.10	0.53	1.97	1.68	1.29	1.17	1.60		1.27	2.85	1.15	2.22	2.00	Data removed from PT05 due to instrument issues
19/02/2025 21:45	8.99	1.09	3.11	0.54	1.97	1.68	1.28	1.17	1.59		1.27	2.85	1.15	2.22	2.00	Data removed from PT05 due to instrument issues
19/02/2025 22:00	8.99	1.09	3.10	0.55	1.97	1.68	1.28	1.17	1.59		1.27	2.85	1.15	2.22	2.00	Data removed from PT05 due to instrument issues
19/02/2025 22:15	8.99	1.08	3.10	0.55	1.96	1.68	1.29	1.17	1.60		1.27	2.85	1.14	2.21	2.00	Data removed from PT05 due to instrument issues
19/02/2025 22:30	8.99	1.09	3.10	0.56	1.97	1.68	1.29	1.17	1.59		1.27	2.85	1.15	2.22	2.00	Data removed from PT05 due to instrument issues
19/02/2025 22:45	8.99	1.09	3.10	0.57	1.97	1.67	1.29	1.17	1.59		1.26	2.85	1.15	2.21	2.00	Data removed from PT05 due to instrument issues
19/02/2025 23:00	8.99	1.08	3.10	0.58	1.97	1.67	1.28	1.17	1.60		1.27	2.85	1.15	2.21	2.00	Data removed from PT05 due to instrument issues
19/02/2025 23:15	8.99	1.09	3.11	0.59	1.97	1.67	1.29	1.17	1.60		1.27	2.86	1.15	2.21	2.00	Data removed from PT05 due to instrument issues
19/02/2025 23:30	8.99	1.09	3.10	0.60	1.97	1.67	1.29	1.17	1.59		1.26	2.85	1.15	2.20	2.00	Data removed from PT05 due to instrument issues
19/02/2025 23:45	8.99	1.08	3.10	0.61	1.96	1.67	1.29	1.17	1.59		1.26	2.85	1.14	2.20	2.00	Data removed from PT05 due to instrument issues
20/02/2025 00:00	8.99	1.09	3.10	0.62	1.97	1.67	1.28	1.17	1.59		1.27	2.86	1.15	2.20	2.00	Data removed from PT05 due to instrument issues
20/02/2025 00:15	8.99	1.09	3.10	0.63	1.96	1.67	1.29	1.17	1.60		1.27	2.85	1.15	2.20	2.00	Data removed from PT05 due to instrument issues
20/02/2025 00:30	8.99	1.09	3.10	0.64	1.97	1.68	1.29	1.17	1.60		1.27	2.85	1.14	2.21	2.00	Data removed from PT05 due to instrument issues
20/02/2025 00:45	8.99	1.08	3.10	0.66	1.97	1.68	1.28	1.17	1.59		1.27	2.85	1.15	2.22	2.00	Data removed from PT05 due to instrument issues
20/02/2025 01:00	8.99	1.08	3.10	0.67	1.97	1.68	1.28	1.17	1.59		1.26	2.85	1.15	2.22	2.00	Data removed from PT05 due to instrument issues
20/02/2025 01:15	8.98	1.08	3.10	0.68	1.96	1.68	1.29	1.17	1.60		1.26	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
20/02/2025 01:30	8.99	1.08	3.10	0.69	1.96	1.68	1.29	1.17	1.60		1.27	2.86	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
20/02/2025 01:45	8.99	1.08	3.11	0.70	1.97	1.68	1.29	1.17	1.59		1.27	2.86	1.15	2.24	2.00	Data removed from PT05 due to instrument issues
20/02/2025 02:00	8.99	1.08	3.10	0.72	1.97	1.67	1.28	1.17	1.60		1.26	2.86	1.15	2.25	2.00	Data removed from PT05 due to instrument issues
20/02/2025 02:15	8.99	1.08	3.11	0.72	1.97	1.68	1.28	1.17	1.59		1.26	2.85	1.14	2.26	2.00	Data removed from PT05 due to instrument issues
20/02/2025 02:30	8.99	1.08	3.11	0.73	1.97	1.68	1.29	1.17	1.60		1.26	2.85	1.15	2.26	2.00	Data removed from PT05 due to instrument issues
20/02/2025 02:45	8.99	1.08	3.11	0.74	1.97	1.68	1.29	1.17	1.60		1.26	2.85	1.15	2.27	2.00	Data removed from PT05 due to instrument issues
20/02/2025 03:00	8.99	1.09	3.11	0.75	1.97	1.68	1.28	1.17	1.60		1.26	2.86	1.15	2.28	2.00	Data removed from PT05 due to instrument issues
20/02/2025 03:15	8.99	1.08	3.11	0.75	1.97	1.67	1.28	1.17	1.60		1.27	2.85	1.14	2.28	2.00	Data removed from PT05 due to instrument issues
20/02/2025 03:30	8.99	1.08	3.10	0.75	1.97	1.67	1.29	1.17	1.59		1.26	2.85	1.15	2.28	2.00	Data removed from PT05 due to instrument issues
20/02/2025 03:45	8.99	1.08	3.10	0.75	1.97	1.67	1.29	1.16	1.59		1.26	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
20/02/2025 04:00	8.99	1.08	3.10	0.75	1.97	1.67	1.28	1.17	1.59		1.26	2.85	1.15	2.29	2.00	Data removed from PT05 due to instrument issues
20/02/2025 04:15	8.99	1.09	3.11	0.75	1.97	1.68	1.28	1.17	1.59		1.26	2.85	1.14	2.30	2.00	Data removed from PT05 due to instrument issues
20/02/2025 04:30	8.99	1.08	3.10	0.74	1.97	1.67	1.29	1.17	1.59		1.26	2.85	1.14	2.30	2.00	Data removed from PT05 due to instrument issues
20/02/2025 04:45	8.98	1.08	3.10	0.73	1.97	1.68	1.29	1.17	1.59		1.27	2.85	1.15	2.30	2.00	Data removed from PT05 due to instrument issues
20/02/2025 05:00	8.99	1.08	3.10	0.71	1.97	1.67	1.28	1.17	1.60		1.26	2.85	1.14	2.31	2.00	Data removed from PT05 due to instrument issues
20/02/2025 05:15	8.99	1.08	3.10	0.70	1.97	1.67	1.28	1.17	1.59		1.26	2.85	1.14	2.31	2.00	Data removed from PT05 due to instrument issues
20/02/2025 05:30	8.99	1.09	3.11	0.69	1.96	1.67	1.28	1.17	1.60		1.26	2.85	1.14	2.31	2.00	Data removed from PT05 due to instrument issues
20/02/2025 05:45	8.98	1.08	3.10	0.68	1.96	1.67	1.28	1.16	1.59		1.26	2.85	1.14	2.30	2.00	Data removed from PT05 due to instrument issues
20/02/2025 06:00	8.99	1.08	3.11	0.66	1.97	1.67	1.28	1.17	1.59		1.26	2.85	1.14	2.30	2.00	Data removed from PT05 due to instrument issues
20/02/2025 06:15	8.98	1.08	3.11	0.65	1.96	1.67	1.28	1.17	1.59		1.26	2.85	1.15	2.30	2.00	Data removed from PT05 due to instrument issues
20/02/2025 06:30	8.99	1.08	3.11	0.63	1.97	1.67	1.29	1.17	1.59		1.26	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
20/02/2025 06:45	8.99	1.08	3.10	0.62	1.96	1.67	1.28	1.17	1.60		1.27	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
20/02/2025 07:00	8.99	1.08	3.10	0.61	1.97	1.67	1.28	1.16	1.60		1.26	2.85	1.15	2.29	2.00	Data removed from PT05 due to instrument issues
20/02/2025 07:15	8.99	1.08	3.10	0.59	1.96	1.67	1.28	1.17	1.60		1.27	2.85	1.14	2.28	2.00	Data removed from PT05 due to instrument issues
20/02/2025 07:30	8.98	1.08	3.10	0.58	1.96	1.67	1.29	1.16	1.59		1.26	2.84	1.14	2.28	2.00	Data removed from PT05 due to instrument issues
20/02/2025 07:45	8.99	1.08	3.10	0.57	1.96	1.67	1.28	1.16	1.60		1.26	2.85	1.14	2.27	2.00	Data removed from PT05 due to instrument issues
20/02/2025 08:00	8.99	1.09	3.10	0.56	1.97	1.68	1.28	1.17	1.60		1.26	2.85	1.14	2.27	2.00	Data removed from PT05 due to instrument issues
20/02/2025 08:15	8.99	1.09	3.11	0.55	1.97	1.67	1.28	1.17	1.59		1.27	2.85	1.14	2.26	2.00	Data removed from PT05 due to instrument issues
20/02/2025 08:30	8.99	1.08	3.11	0.54	1.97	1.67	1.28	1.16	1.60		1.27	2.85	1.15	2.26	2.00	Data removed from PT05 due to instrument issues
20/02/2025 08:45	8.99	1.08	3.10	0.53	1.97	1.67	1.28	1.16	1.59		1.26	2.85	1.14	2.26	2.00	Data removed from PT05 due to instrument issues
20/02/2025 09:00	8.99	1.08	3.10	0.53	1.97	1.67	1.29	1.17	1.59			2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
20/02/2025 09:15	8.99	1.07	3.11	0.52	1.96	1.67	1.28	1.16	1.59		1.26	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
20/02/2025 09:30	8.99	1.07	3.10	0.52	1.97	1.67	1.28	1.16	1.59		1.27	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
20/02/2025 09:45	8.99	1.07	3.11	0.52	1.97	1.67	1.28	1.17	1.58		1.28	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
20/02/2025 10:00	8.99	1.07	3.10	0.52	1.97	1.68	1.29	1.16	1.60		1.27	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
20/02/2025 10:15	8.99	1.08	3.11	0.53	1.97	1.67	1.29	1.17	1.61		1.27	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
20/02/2025 10:30	8.99	1.08	3.11	0.53	1.97	1.68	1.28	1.17	1.59		1.26	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
20/02/2025 10:45	8.99	1.07	3.11	0.53	1.96	1.67	1.29	1.17	1.59		1.27	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
20/02/2025 11:00	8.99	1.07	3.11	0.54		1.67	1.28	1.17	1.58		1.26	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
20/02/2025 11:15	8.98	1.08	3.11	0.54	1.97	1.67	1.28	1.16	1.59		1.26	2.85	1.14	2.22	2.00	Data removed from PT05 due to instrument issues
20/02/2025 11:30	8.98	1.07	3.11	0.55	1.98	1.67	1.29	1.16	1.60		1.26	2.85	1.14	2.22	2.00	Data removed from PT05 due to instrument issues
20/02/2025 11:45	8.98	1.07	3.11	0.56	1.97	1.67	1.28	1.16	1.59		1.27	2.84	1.14	2.21	2.00	Data removed from PT05 due to instrument issues
20/02/2025 12:00	8.98	1.08	3.11	0.57	1.98	1.68	1.28	1.17	1.59		1.26	2.85	1.15	2.22	2.00	Data removed from PT05 due to instrument issues
20/02/2025 12:15	8.98	1.07	3.11	0.58	1.97	1.68	1.29	1.17	1.61		1.27	2.85	1.14	2.21	2.00	Data removed from PT05 due to instrument issues
20/02/2025 12:30	8.98	1.07	3.11	0.59	1.98	1.68	1.29	1.17	1.59		1.26	2.85	1.14	2.21	2.00	Data removed from PT05 due to instrument issues
20/02/2025 12:45	8.98	1.07	3.11	0.60	1.97	1.67	1.26	1.17			1.27	2.85	1.14	2.21	2.00	Data removed from PT05 due to instrument issues
20/02/2025 13:00	8.98	1.07	3.10	0.61	1.98	1.67	1.26	1.16	1.59		1.27	2.85	1.14	2.21	2.00	Data removed from PT05 due to instrument issues
20/02/2025 13:15	8.98	1.07	3.11	0.62	1.98	1.67	1.27	1.16	1.59		1.27	2.85	1.14	2.21	2.00	Data removed from PT05 due to instrument issues
20/02/2025 13:30	8.98	1.07	3.11	0.64	1.98	1.67	1.27	1.16	1.60		1.26	2.85	1.14	2.21	2.00	Data removed from PT05 due to instrument issues
20/02/2025 13:45	8.98	1.07	3.11	0.65	1.98	1.67	1.26	1.16	1.57		1.26	2.84	1.14	2.22	2.00	Data removed from PT05 due to instrument issues
20/02/2025 14:00	8.98	1.07	3.11	0.66	1.98	1.67	1.26	1.16	1.59		1.26	2.84	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
20/02/2025 14:15	8.99	1.08	3.11	0.68	1.98	1.67	1.26	1.16	1.61		1.28	2.85	1.15	2.24	2.01	Data removed from PT05 due to instrument issues
20/02/2025 14:30	8.99	1.08	3.12	0.69	1.98	1.68	1.27	1.17	1.60		1.27	2.85	1.15	2.25	2.01	Data removed from PT05 due to instrument issues

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
20/02/2025 14:45	8.99	1.08	3.11	0.70	1.98	1.67	1.26	1.16	1.60		1.27	2.85	1.15	2.25	2.00	Data removed from PT05 due to instrument issues
20/02/2025 15:00	8.99	1.08	3.11	0.71	1.98	1.67	1.26	1.16	1.59		1.27	2.85	1.15	2.26	2.01	Data removed from PT05 due to instrument issues
20/02/2025 15:15	8.98	1.08	3.11	0.72	1.98	1.67	1.27	1.16	1.60		1.27	2.85	1.15	2.27	2.00	Data removed from PT05 due to instrument issues
20/02/2025 15:30	8.99	1.08	3.11	0.72	1.98	1.68	1.27	1.17	1.61		1.27	2.85	1.14	2.27	2.01	Data removed from PT05 due to instrument issues
20/02/2025 15:45	8.99	1.08	3.11	0.74	1.99	1.69	1.27	1.17	1.60		1.27	2.85	1.15	2.28	2.01	Data removed from PT05 due to instrument issues
20/02/2025 16:00	8.99	1.08	3.11	0.73	1.99	1.68	1.27	1.16	1.60		1.26	2.85	1.15	2.29	2.01	Data removed from PT05 due to instrument issues
20/02/2025 16:15	8.99	1.08	3.11	0.74	1.98	1.67	1.27	1.16	1.60		1.27	2.85	1.14	2.30	2.01	Data removed from PT05 due to instrument issues
20/02/2025 16:30	8.98	1.07	3.11	0.73	1.97	1.67	1.27	1.16	1.59		1.27	2.85	1.14	2.30	2.00	Data removed from PT05 due to instrument issues
20/02/2025 16:45	8.98	1.08	3.11	0.72	1.98	1.67	1.27	1.16	1.58		1.27	2.85	1.15	2.30	2.01	Data removed from PT05 due to instrument issues
20/02/2025 17:00	8.99	1.08	3.11	0.72	1.98	1.67	1.27	1.16	1.58		1.27	2.85	1.15	2.31	2.00	Data removed from PT05 due to instrument issues
20/02/2025 17:15	8.98	1.08	3.11	0.71	1.98	1.68	1.27	1.17	1.59		1.27	2.85	1.15	2.31	2.01	Data removed from PT05 due to instrument issues
20/02/2025 17:30	8.99	1.08	3.11	0.70	1.99	1.68	1.27	1.17	1.59		1.27	2.85	1.15	2.31	2.01	Data removed from PT05 due to instrument issues
20/02/2025 17:45	8.99	1.08	3.11	0.68	1.98	1.68	1.27	1.17	1.59		1.27	2.86	1.14	2.31	2.01	Data removed from PT05 due to instrument issues
20/02/2025 18:00	8.99	1.08	3.11	0.67	1.98	1.67	1.27	1.17	1.59		1.27	2.86	1.14	2.31	2.00	Data removed from PT05 due to instrument issues
20/02/2025 18:15	8.99	1.08	3.11	0.66	1.98	1.67	1.27	1.17	1.59		1.27	2.85	1.15	2.30	2.00	Data removed from PT05 due to instrument issues
20/02/2025 18:30	8.98	1.08	3.11	0.64	1.98	1.67	1.26	1.16	1.58		1.26	2.85	1.14	2.30	2.00	Data removed from PT05 due to instrument issues
20/02/2025 18:45	8.98	1.07	3.11	0.63	1.97	1.66	1.27	1.16	1.58		1.27	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
20/02/2025 19:00	8.99	1.07	3.11	0.63	1.97	1.66	1.26	1.16	1.57		1.26	2.85	1.15	2.29	2.00	Data removed from PT05 due to instrument issues
20/02/2025 19:15	8.98	1.07	3.11	0.62	1.97	1.66	1.26	1.16	1.58		1.26	2.85	1.14	2.28	2.00	Data removed from PT05 due to instrument issues
20/02/2025 19:30	8.98	1.07	3.11	0.60	1.97	1.66	1.26	1.16	1.58		1.26	2.85	1.14	2.28	2.00	Data removed from PT05 due to instrument issues
20/02/2025 19:45	8.98	1.07	3.10	0.60	1.97	1.67	1.26	1.16	1.57		1.27	2.85	1.14	2.28	2.00	Data removed from PT05 due to instrument issues
20/02/2025 20:00	8.98	1.07	3.10	0.59	1.97	1.66	1.26	1.15	1.58		1.26	2.85	1.14	2.27	2.00	Data removed from PT05 due to instrument issues
20/02/2025 20:15	8.98	1.07	3.10	0.58	1.97	1.66	1.27	1.16	1.57		1.26	2.85	1.14	2.26	2.00	Data removed from PT05 due to instrument issues
20/02/2025 20:30	8.98	1.07	3.11	0.58	1.97	1.67	1.26	1.16	1.56		1.27	2.85	1.14	2.26	2.00	Data removed from PT05 due to instrument issues
20/02/2025 20:45	8.98	1.07	3.11	0.57	1.97	1.67	1.27	1.16	1.57		1.27	2.85	1.14	2.26	2.00	Data removed from PT05 due to instrument issues
20/02/2025 21:00	8.99	1.07	3.10	0.57	1.97	1.67	1.27	1.15	1.58		1.26	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
20/02/2025 21:15	8.99	1.07	3.11	0.57	1.97	1.67	1.27	1.16	1.57		1.26	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
20/02/2025 21:30	8.98	1.07	3.10	0.57	1.97	1.67	1.26	1.16	1.58		1.27	2.85	1.15	2.24	2.00	Data removed from PT05 due to instrument issues
20/02/2025 21:45	8.98	1.07	3.11	0.57	1.97	1.67	1.26	1.16	1.57		1.26	2.84	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
20/02/2025 22:00	8.99	1.07	3.11	0.57	1.98	1.67	1.27	1.16	1.58		1.27	2.85	1.15	2.24	2.00	Data removed from PT05 due to instrument issues
20/02/2025 22:15	8.99	1.08	3.11	0.58	1.97	1.68	1.26	1.16	1.59		1.27	2.85	1.15	2.24	2.00	Data removed from PT05 due to instrument issues
20/02/2025 22:30	8.99	1.07	3.11	0.58	1.97	1.67	1.26	1.16	1.59		1.27	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
20/02/2025 22:45	8.99	1.07	3.11	0.59	1.98	1.67	1.26	1.16	1.58		1.27	2.85	1.14	2.23	2.00	Data removed from PT05 due to instrument issues
20/02/2025 23:00	8.98	1.07	3.10	0.59	1.97	1.67	1.26	1.16	1.57		1.26	2.85	1.15	2.22	2.00	Data removed from PT05 due to instrument issues
20/02/2025 23:15	8.98	1.07	3.10	0.61	1.97	1.67	1.26	1.16	1.58		1.27	2.85	1.14	2.22	2.00	Data removed from PT05 due to instrument issues
20/02/2025 23:30	8.99	1.08	3.11	0.62	1.98	1.68	1.26	1.16	1.59		1.27	2.86	1.15	2.22	2.00	Data removed from PT05 due to instrument issues
20/02/2025 23:45	8.98	1.07	3.10	0.63	1.98	1.67	1.27	1.16	1.58		1.27	2.85	1.14	2.22	2.00	Data removed from PT05 due to instrument issues
21/02/2025 00:00	8.98	1.08	3.10	0.64	1.98	1.67	1.27	1.16	1.58		1.27	2.85	1.15	2.22	2.00	Data removed from PT05 due to instrument issues
21/02/2025 00:15	8.99	1.08	3.11	0.65	1.97	1.67	1.26	1.16	1.59		1.27	2.85	1.15	2.23	2.00	Data removed from PT05 due to instrument issues
21/02/2025 00:30	8.99	1.08	3.11	0.67	1.98	1.67	1.27	1.16	1.59		1.27	2.85	1.14	2.24	2.00	Data removed from PT05 due to instrument issues
21/02/2025 00:45	8.99	1.08	3.11	0.67	1.97	1.67	1.27	1.16	1.58		1.27	2.85	1.14	2.25	2.00	Data removed from PT05 due to instrument issues
21/02/2025 01:00	8.98	1.07	3.10	0.69	1.98	1.67	1.26	1.16	1.58		1.27	2.85	1.15	2.26	2.00	Data removed from PT05 due to instrument issues
21/02/2025 01:15	8.98	1.07	3.11	0.70	1.97	1.67	1.27	1.16	1.58		1.27	2.85	1.14	2.27	2.00	Data removed from PT05 due to instrument issues
21/02/2025 01:30	8.98	1.07	3.11	0.72	1.98	1.67	1.27	1.16	1.58		1.27	2.85	1.14	2.27	2.00	Data removed from PT05 due to instrument issues
21/02/2025 01:45	8.99	1.08	3.11	0.73	1.98	1.68	1.26	1.16	1.58		1.27	2.85	1.14	2.28	2.01	Data removed from PT05 due to instrument issues
21/02/2025 02:00	8.99	1.08	3.11	0.74	1.98	1.68	1.27	1.16	1.59		1.27	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
21/02/2025 02:15	8.98	1.08	3.11	0.76	1.98	1.68	1.27	1.16	1.58		1.26	2.85	1.14	2.29	2.00	Data removed from PT05 due to instrument issues
21/02/2025 02:30	8.98	1.07	3.11	0.77	1.98	1.68	1.28	1.16	1.59		1.27	2.85	1.15	2.30	2.01	Data removed from PT05 due to instrument issues
21/02/2025 02:45	8.98	1.07	3.10	0.78	1.98	1.68	1.27	1.16	1.59		1.27	2.85	1.15	2.30	2.00	Data removed from PT05 due to instrument issues
21/02/2025 03:00	8.98	1.07	3.10	0.79	1.98	1.67	1.26	1.16	1.57		1.26	2.85	1.14	2.30	2.00	Data removed from PT05 due to instrument issues
21/02/2025 03:15	8.99	1.07	3.11	0.80	1.98	1.68	1.26	1.16	1.58		1.27	2.85	1.14	2.31	2.00	Data removed from PT05 due to instrument issues
21/02/2025 03:30	8.99	1.07	3.11	0.81	1.98	1.68	1.27	1.17	1.58		1.27	2.86	1.14	2.32	2.01	Data removed from PT05 due to instrument issues
21/02/2025 03:45	8.99	1.07	3.11	0.82	1.98	1.68	1.27	1.17	1.60		1.27	2.85	1.15	2.32	2.01	Data removed from PT05 due to instrument issues
21/02/2025 04:00	8.99	1.08	3.11	0.82	1.99	1.68	1.27	1.16	1.59		1.26	2.85	1.15	2.33	2.01	Data removed from PT05 due to instrument issues
21/02/2025 04:15	9.00	1.08	3.11	0.83	1.99	1.69	1.27	1.17	1.59		1.28	2.86	1.15	2.33	2.01	Data removed from PT05 due to instrument issues
21/02/2025 04:30	8.99	1.08	3.11	0.83	1.98	1.68	1.27	1.16	1.60		1.27	2.85	1.15	2.34	2.01	Data removed from PT05 due to instrument issues
21/02/2025 04:45	8.99	1.08	3.11	0.83	1.99	1.68	1.27	1.16	1.58		1.27	2.85	1.15	2.34	2.01	Data removed from PT05 due to instrument issues
21/02/2025 05:00	8.99	1.07	3.11	0.83	1.99	1.68	1.26	1.16	1.58		1.27	2.85	1.15	2.34	2.01	Data removed from PT05 due to instrument issues
21/02/2025 05:15	8.99	1.08	3.11	0.83	1.99	1.68	1.27	1.16	1.60		1.27	2.85	1.15	2.35	2.01	Data removed from PT05 due to instrument issues
21/02/2025 05:30	8.98	1.08	3.11	0.82	1.98	1.68	1.27	1.16	1.59		1.27	2.85	1.15	2.35	2.01	Data removed from PT05 due to instrument issues
21/02/2025 05:45	8.99	1.07	3.11	0.81	1.98	1.68	1.26	1.16	1.59		1.27	2.85	1.14	2.36	2.01	Data removed from PT05 due to instrument issues
21/02/2025 06:00	8.99	1.07	3.11	0.80	1.99	1.68	1.27	1.16	1.59		1.27	2.85	1.15	2.35	2.01	Data removed from PT05 due to instrument issues
21/02/2025 06:15	8.99	1.08	3.12	0.80	1.99	1.68	1.27	1.16	1.59		1.26	2.85	1.15	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 06:30	8.99	1.08	3.11	0.79	1.99	1.68	1.26	1.16	1.58		1.27	2.85	1.15	2.36	2.01	Data removed from PT05 due to instrument issues
21/02/2025 06:45	8.99	1.08	3.11	0.78	1.98	1.68	1.27	1.16	1.59		1.27	2.85	1.15	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 07:00	8.99	1.08	3.11	0.77	1.99	1.68	1.27	1.16	1.58		1.26	2.85	1.14	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 07:15	8.99	1.08	3.11	0.76	1.98	1.68	1.27	1.17	1.59		1.27	2.85	1.15	2.38	2.01	Data removed from PT05 due to instrument issues
21/02/2025 07:30	8.99	1.08	3.11	0.74	1.98	1.67	1.28	1.16	1.58		1.26	2.85	1.14	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 07:45	8.99	1.07	3.11	0.73	1.98	1.68	1.27	1.16	1.59		1.27	2.85	1.15	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 08:00	8.99	1.08	3.11	0.72	1.99	1.68	1.27	1.16	1.60		1.27	2.86	1.15	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 08:15	8.99	1.07	3.11	0.70	1.98	1.68	1.26	1.16	1.59		1.27	2.85	1.14	2.36	2.01	Data removed from PT05 due to instrument issues
21/02/2025 08:30	8.99	1.08	3.11	0.70	1.98	1.68	1.27	1.16	1.59		1.27	2.85	1.14	2.36	2.01	Data removed from PT05 due to instrument issues
21/02/2025 08:45	8.99	1.07	3.11	0.69	1.98	1.68	1.27	1.16	1.59		1.27	2.85	1.14	2.35	2.01	Data removed from PT05 due to instrument issues
21/02/2025 09:00	8.99	1.08	3.11	0.67	1.98	1.68	1.27	1.16	1.59			2.85	1.14	2.35	2.01	Data removed from PT05 due to instrument issues
21/02/2025 09:15	8.98		3.11	0.67	1.98	1.68	1.27	1.16	1.59		1.27	2.85	1.14	2.34	2.01	Data removed from PT05 due to instrument issues
21/02/2025 09:30	8.98		3.11	0.66	1.98	1.68	1.27	1.16	1.59		1.27	2.84	1.14	2.34	2.01	Data removed from PT05 due to instrument issues
21/02/2025 09:45	8.99		3.11	0.66	1.99	1.69	1.27	1.17	1.60		1.27	2.85	1.15	2.34	2.01	Data removed from PT05 due to instrument issues
21/02/2025 10:00	8.99		3.11	0.66	1.99	1.69	1.27	1.16	1.59		1.27	2.85	1.15	2.34	2.01	Data removed from PT05 due to instrument issues
21/02/2025 10:15	8.98		3.11	0.65	1.98	1.68	1.26	1.16	1.59		1.27	2.85	1.15	2.33	2.01	Data removed from PT05 due to instrument issues
21/02/2025 10:30	8.98		3.11	0.64	1.98	1.68	1.26	1.16	1.59		1.27	2.84	1.14	2.32	2.00	Data removed from PT05 due to instrument issues
21/02/2025 10:45	8.98		3.08	0.65	1.98	1.68	1.27	1.16	1.59		1.27	2.84	1.14	2.31	2.01	Data removed from PT05 due to instrument issues
21/02/2025 11:00	8.98		3.08	0.64	1.98	1.68	1.27	1.15	1.58		1.27	2.84	1.13	2.31	2.00	Data removed from PT05 due to instrument issues
21/02/2025 11:15	8.98		3.09	0.64		1.68	1.27	1.16	1.58		1.27	2.84	1.13	2.31	2.00	Data removed from PT05 due to instrument issues
21/02/2025 11:30	8.98		3.10	0.65	1.97	1.68	1.26	1.16	1.59		1.28	2.85	1.13	2.30	2.01	Data removed from PT05 due to instrument issues
21/02/2025 11:45	8.98		3.10	0.65	1.97	1.68	1.27	1.16	1.60		1.28	2.85	1.14	2.30	2.01	Data removed from PT05 due to instrument issues
21/02/2025 12:00	8.98		3.10	0.66	1.97	1.68	1.26	1.16	1.59		1.27	2.85	1.14	2.29	2.01	Data removed from PT05 due to instrument issues
21/02/2025 12:15	8.98		3.11	0.67	1.97	1.68	1.27	1.17	1.59		1.28	2.85	1.13	2.30	2.01	Data removed from PT05 due to instrument issues
21/02/2025 12:30	8.98		3.10	0.68	1.97	1.68	1.26	1.16	1.59		1.28	2.84	1.14	2.29	2.01	Data removed from PT05 due to instrument issues
21/02/2025 12:45	8.98		3.10	0.68	1.97	1.68	1.26	1.16	1.58		1.27	2.84	1.13	2.30	2.01	Data removed from PT05 due to instrument issues
21/02/2025 13:00	8.98		3.11	0.69	1.97	1.67	1.27	1.16	1.59		1.28	2.85	1.13	2.31	2.01	Data removed from PT05 due to instrument issues
21/02/2025 13:15	8.98		3.11	0.70	1.97	1.67	1.28	1.16	1.58		1.27	2.84	1.13	2.31	2.01	Data removed from PT05 due to instrument issues
21/02/2025 13:30	8.98		3.11	0.71	1.97	1.67	1.28	1.16	1.58		1.28	2.84	1.13	2.32	2.01	Data removed from PT05 due to instrument issues
21/02/2025 13:45	8.98		3.11	0.72	1.97	1.67	1.28	1.16	1.57		1.28	2.84	1.13	2.33	2.01	Data removed from PT05 due to instrument issues
21/02/2025 14:00	8.98		3.11	0.73	1.98	1.67	1.28	1.16	1.58		1.27	2.85	1.14	2.33	2.01	Data removed from PT05 due to instrument issues
21/02/2025 14:15	8.98		3.11	0.74	1.97	1.67	1.28	1.16	1.57		1.28	2.85	1.13		2.01	Data removed from PT05 due to instrument issues
21/02/2025 14:30	8.98		3.11	0.74	1.97	1.67	1.28	1.16	1.58		1.28	2.85	1.14	2.34	2.01	Data removed from PT05 due to instrument issues
21/02/2025 14:45	8.98		3.11	0.75	1.98	1.68	1.28	1.17	1.58		1.28	2.85	1.14	2.35	2.01	Data removed from PT05 due to instrument issues
21/02/2025 15:00	8.99		3.11	0.76	1.98	1.68	1.29	1.16	1.59		1.28	2.85	1.15	2.36	2.01	Data removed from PT05 due to instrument issues
21/02/2025 15:15	8.98		3.11	0.76	1.97	1.67	1.28	1.17	1.57		1.27	2.85	1.14	2.36	2.01	Data removed from PT05 due to instrument issues
21/02/2025 15:30	8.98		3.11	0.77	1.97	1.67	1.28	1.16	1.59		1.28	2.84	1.14	2.36	2.01	Data removed from PT05 due to instrument issues
21/02/2025 15:45	8.98		3.11	0.77	1.98	1.68	1.29	1.16	1.58		1.28	2.85	1.14	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 16:00	8.99		3.11	0.78	1.98	1.67	1.28	1.16	1.58		1.28	2.85	1.14	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 16:15	8.98		3.11	0.78	1.97	1.67	1.28	1.16	1.57		1.28	2.85	1.14	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 16:30	8.99		3.11	0.78	1.98	1.67	1.28	1.16	1.58		1.27	2.85	1.14	2.38	2.01	Data removed from PT05 due to instrument issues
21/02/2025 16:45	8.98		3.11	0.77	1.97	1.67	1.29	1.16	1.58		1.27	2.85	1.14	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 17:00	8.98		3.11	0.77	1.98	1.67	1.28	1.16	1.57		1.28	2.85	1.14	2.38	2.01	Data removed from PT05 due to instrument issues
21/02/2025 17:15	8.99		3.12	0.77	1.97	1.67	1.29	1.17	1.59		1.28	2.85	1.14	2.39	2.01	Data removed from PT05 due to instrument issues
21/02/2025 17:30	8.99		3.12	0.76	1.98	1.67	1.29	1.17	1.57		1.28	2.86	1.14	2.39	2.01	Data removed from PT05 due to instrument issues
21/02/2025 17:45	8.99		3.11	0.75	1.97	1.67	1.29	1.17	1.57		1.27	2.85	1.14	2.39	2.01	Data removed from PT05 due to instrument issues
21/02/2025 18:00	8.99		3.11	0.74	1.98	1.67	1.29	1.17	1.59		1.27	2.86	1.14	2.40	2.01	Data removed from PT05 due to instrument issues
21/02/2025 18:15	8.99		3.12	0.73	1.97	1.67	1.28	1.17	1.57		1.28	2.86	1.14	2.40	2.01	Data removed from PT05 due to instrument issues
21/02/2025 18:30	8.99		3.12	0.72	1.97	1.67	1.29	1.17	1.58		1.28	2.86	1.15	2.39	2.01	Data removed from PT05 due to instrument issues
21/02/2025 18:45	8.99		3.12	0.71	1.97	1.67	1.28	1.17	1.58		1.28	2.86	1.15	2.39	2.01	Data removed from PT05 due to instrument issues
21/02/2025 19:00	8.99		3.11	0.70	1.98	1.67	1.29	1.16	1.57		1.28	2.85	1.15	2.39	2.01	Data removed from PT05 due to instrument issues
21/02/2025 19:15	8.99		3.11	0.69	1.97	1.67	1.28	1.16	1.59		1.28	2.86	1.14	2.38	2.01	Data removed from PT05 due to instrument issues
21/02/2025 19:30	8.99		3.12	0.67	1.97	1.67	1.28	1.16	1.58		1.28	2.85	1.14	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 19:45	8.99		3.12	0.66	1.97	1.67	1.29	1.17	1.60		1.28	2.85	1.15	2.37	2.01	Data removed from PT05 due to instrument issues
21/02/2025 20:00	8.98		3.11	0.65	1.97	1.67	1.28	1.17	1.58		1.28	2.86	1.15	2.36	2.01	Data removed from PT05 due to instrument issues
21/02/2025 20:15	8.99		3.11	0.64	1.98	1.67	1.29	1.17	1.59		1.28	2.86	1.15	2.36	2.01	Data removed from PT05 due to instrument issues
21/02/2025 20:30	8.99		3.11	0.63	1.98	1.67	1.29	1.16	1.59		1.28	2.86	1.14	2.35	2.01	Data removed from PT05 due to instrument issues
21/02/2025 20:45	8.99		3.11	0.62	1.97	1.67	1.28	1.17	1.58		1.28	2.86	1.14	2.34	2.01	Data removed from PT05 due to instrument issues
21/02/2025 21:00	8.99		3.11	0.61	1.97	1.67	1.28	1.16	1.58		1.28	2.86	1.14	2.34	2.01	Data removed from PT05 due to instrument issues
21/02/2025 21:15	8.98		3.11	0.60	1.97	1.67	1.28	1.16	1.59		1.27	2.85	1.14	2.33	2.01	Data removed from PT05 due to instrument issues
21/02/2025 21:30	8.98		3.11	0.59	1.97	1.67	1.27	1.16	1.59		1.28	2.85	1.14	2.32	2.01	Data removed from PT05 due to instrument issues
21/02/2025 21:45	8.98		3.11	0.58	1.97	1.67	1.28	1.16	1.58		1.27	2.85	1.15	2.32	2.01	Data removed from PT05 due to instrument issues
21/02/2025 22:00	8.99		3.11	0.58	1.97	1.67	1.27	1.16	1.59		1.27	2.85	1.14	2.31	2.01	Data removed from PT05 due to instrument issues
21/02/2025 22:15	8.99		3.11	0.58	1.97	1.67	1.28	1.16	1.58		1.28	2.85	1.14	2.31	2.01	Data removed from PT05 due to instrument issues
21/02/2025 22:30	8.99		3.11	0.57	1.97	1.67	1.28	1.16	1.58		1.28	2.85	1.14	2.31	2.01	Data removed from PT05 due to instrument issues
21/02/2025 22:45	8.99		3.11	0.57	1.97	1.67	1.28	1.16	1.58		1.28	2.85	1.14	2.31	2.01	Data removed from PT05 due to instrument issues

Appendix C: Diver Water Level Data

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
21/02/2025 23:00	8.99		3.11	0.57	1.97	1.67	1.29	1.16	1.58		1.27	2.86	1.15	2.29	2.01	Data removed from PT05 due to instrument issues
21/02/2025 23:15	8.99		3.11	0.56	1.97	1.67	1.28	1.16	1.59		1.28	2.86	1.14	2.29	2.01	Data removed from PT05 due to instrument issues
21/02/2025 23:30	8.99		3.11	0.57	1.97	1.67	1.28	1.16	1.59		1.27	2.85	1.14	2.29	2.01	Data removed from PT05 due to instrument issues
21/02/2025 23:45	8.99		3.11	0.57	1.97	1.67	1.28	1.16	1.59		1.28	2.85	1.15	2.28	2.01	Data removed from PT05 due to instrument issues
22/02/2025 00:00	8.99		3.11	0.57	1.97	1.68	1.28	1.16	1.59		1.27	2.86	1.15	2.28	2.01	Data removed from PT05 due to instrument issues
22/02/2025 00:15	8.98		3.11	0.57	1.97	1.68	1.28	1.16	1.59		1.27	2.85	1.14	2.28	2.01	Data removed from PT05 due to instrument issues
22/02/2025 00:30	8.99		3.11	0.58	1.97	1.67	1.28	1.16	1.57		1.27	2.85	1.14	2.27	2.01	Data removed from PT05 due to instrument issues
22/02/2025 00:45	8.98		3.11	0.58	1.97	1.67	1.27	1.16	1.58		1.27	2.85	1.14	2.26	2.01	Data removed from PT05 due to instrument issues
22/02/2025 01:00	8.99		3.11	0.59	1.97	1.67	1.28	1.16	1.58		1.27	2.85	1.14	2.26	2.01	Data removed from PT05 due to instrument issues
22/02/2025 01:15	8.99		3.11	0.61	1.97	1.67	1.28	1.16	1.58		1.27	2.86	1.14	2.26	2.01	Data removed from PT05 due to instrument issues
22/02/2025 01:30	8.98		3.11	0.61	1.97	1.67	1.28	1.16	1.59		1.27	2.85	1.14	2.26	2.01	Data removed from PT05 due to instrument issues
22/02/2025 01:45	8.99		3.11	0.62	1.97	1.67	1.28	1.16	1.59		1.28	2.85	1.14	2.25	2.01	Data removed from PT05 due to instrument issues
22/02/2025 02:00	8.99		3.11	0.64	1.97	1.67	1.28	1.16	1.58		1.27	2.85	1.14	2.25	2.01	Data removed from PT05 due to instrument issues
22/02/2025 02:15	8.99		3.11	0.65	1.97	1.67	1.29	1.16	1.58		1.27	2.86	1.14	2.25	2.01	Data removed from PT05 due to instrument issues
22/02/2025 02:30	8.98		3.11	0.66	1.97	1.67	1.28	1.16	1.58		1.27	2.85	1.14	2.26	2.01	Data removed from PT05 due to instrument issues
22/02/2025 02:45	8.99		3.11	0.68	1.97	1.67	1.29	1.16	1.58		1.27	2.85	1.15	2.26	2.01	Data removed from PT05 due to instrument issues
22/02/2025 03:00	8.98		3.11	0.69	1.98	1.67	1.28	1.16	1.59		1.27	2.86	1.15	2.27	2.01	Data removed from PT05 due to instrument issues
22/02/2025 03:15	8.98		3.11	0.71	1.97	1.67	1.27	1.16	1.58		1.28	2.86	1.15	2.28	2.01	Data removed from PT05 due to instrument issues
22/02/2025 03:30	8.98		3.11	0.72	1.97	1.67	1.28	1.16	1.58		1.28	2.86	1.14	2.28	2.01	Data removed from PT05 due to instrument issues
22/02/2025 03:45	8.98		3.11	0.73	1.97	1.67	1.28	1.16	1.58		1.28	2.86	1.15	2.29	2.01	Data removed from PT05 due to instrument issues
22/02/2025 04:00	8.98		3.11	0.75	1.97	1.67	1.27	1.16	1.57		1.27	2.86	1.16	2.30	2.01	Data removed from PT05 due to instrument issues
22/02/2025 04:15	8.99		3.12	0.76	1.97	1.67	1.28	1.16	1.58		1.28	2.86	1.15	2.30	2.01	Data removed from PT05 due to instrument issues
22/02/2025 04:30	8.98		3.12	0.77	1.97	1.67	1.28	1.16	1.57		1.28	2.87	1.15	2.31	2.01	Data removed from PT05 due to instrument issues
22/02/2025 04:45	8.98		3.11	0.79	1.97	1.67	1.27	1.16	1.57		1.28	2.87	1.15	2.31	2.01	Data removed from PT05 due to instrument issues
22/02/2025 05:00	8.99		3.12	0.80	1.97	1.67	1.28	1.16	1.58		1.27	2.87	1.16	2.32	2.01	Data removed from PT05 due to instrument issues
22/02/2025 05:15	8.99		3.11	0.80	1.97	1.67	1.28	1.16	1.56		1.27	2.87	1.16	2.33	2.01	Data removed from PT05 due to instrument issues
22/02/2025 05:30	8.98		3.11	0.81	1.97	1.67	1.27	1.16	1.57		1.27	2.87	1.16	2.33	2.01	Data removed from PT05 due to instrument issues
22/02/2025 05:45	8.98		3.12	0.82	1.97	1.67	1.28	1.16	1.58		1.27	2.87	1.16	2.34	2.01	Data removed from PT05 due to instrument issues
22/02/2025 06:00	8.99		3.11	0.82	1.97	1.67	1.28	1.16	1.57		1.28	2.87	1.16	2.34	2.01	Data removed from PT05 due to instrument issues
22/02/2025 06:15	8.98		3.11	0.81	1.96	1.67	1.27	1.16	1.57		1.27	2.87	1.16	2.35	2.01	Data removed from PT05 due to instrument issues
22/02/2025 06:30	8.98		3.12	0.82	1.96	1.67	1.27	1.16	1.58		1.28	2.88	1.16	2.35	2.01	Data removed from PT05 due to instrument issues
22/02/2025 06:45	8.99		3.11	0.81	1.96	1.67	1.28	1.16	1.56		1.27	2.88	1.16	2.36	2.00	Data removed from PT05 due to instrument issues
22/02/2025 07:00	8.98		3.11	0.81	1.96	1.67	1.28	1.16	1.57		1.27	2.88	1.17	2.36	2.00	Data removed from PT05 due to instrument issues
22/02/2025 07:15	8.98		3.12	0.80	1.96	1.67	1.28	1.15	1.57		1.27	2.88	1.16	2.37	2.00	Data removed from PT05 due to instrument issues
22/02/2025 07:30	8.98		3.12	0.80	1.96	1.66	1.28	1.16	1.57		1.27	2.88	1.17	2.37	2.00	Data removed from PT05 due to instrument issues
22/02/2025 07:45	8.99		3.12	0.80	1.96	1.66	1.28	1.16	1.57		1.27	2.88	1.17	2.38	2.00	Data removed from PT05 due to instrument issues
22/02/2025 08:00	8.99		3.12	0.79	1.96	1.67	1.28	1.16	1.57		1.27	2.89	1.17	2.39	2.00	Data removed from PT05 due to instrument issues
22/02/2025 08:15	8.99		3.12	0.79	1.96	1.67	1.28	1.16	1.57		1.27	2.89	1.17	2.39	2.01	Data removed from PT05 due to instrument issues
22/02/2025 08:30	8.99		3.12	0.78	1.97	1.67	1.28	1.16	1.57		1.28	2.89	1.18	2.40	2.01	Data removed from PT05 due to instrument issues
22/02/2025 08:45	8.99		3.13	0.78	1.96	1.67	1.27	1.16	1.58		1.28	2.89	1.18	2.40	2.01	Data removed from PT05 due to instrument issues
22/02/2025 09:00	8.99		3.13	0.77	1.96	1.67	1.28	1.16	1.58		1.27	2.89	1.18	2.41	2.01	Data removed from PT05 due to instrument issues
22/02/2025 09:15	8.99		3.13	0.77	1.96	1.67	1.28	1.18	1.58		1.28	2.89	1.18	2.41	2.01	Data removed from PT05 due to instrument issues
22/02/2025 09:30	8.99		3.13	0.76	1.96	1.67	1.28	1.17	1.57		1.27	2.89	1.18	2.42	2.01	Data removed from PT05 due to instrument issues
22/02/2025 09:45	8.99		3.13	0.75	1.97	1.67	1.28	1.18	1.58		1.27	2.89	1.18	2.42	2.01	Data removed from PT05 due to instrument issues
22/02/2025 10:00	8.99		3.13	0.75	1.97	1.67	1.29	1.18	1.59		1.27	2.90	1.19	2.42	2.01	Data removed from PT05 due to instrument issues
22/02/2025 10:15	8.99		3.12	0.74	1.96	1.67	1.28	1.17	1.59		1.28	2.89	1.18	2.42	2.01	Data removed from PT05 due to instrument issues
22/02/2025 10:30	8.99		3.13	0.73	1.96	1.66	1.27	1.17	1.58		1.27	2.89	1.18	2.42	2.01	Data removed from PT05 due to instrument issues
22/02/2025 10:45	8.99		3.12	0.72	1.95	1.66	1.27	1.17	1.58		1.28	2.89	1.18	2.41	2.01	Data removed from PT05 due to instrument issues
22/02/2025 11:00	8.99		3.12	0.72	1.96	1.66	1.27	1.17	1.58		1.28	2.89	1.19	2.41	2.01	Data removed from PT05 due to instrument issues
22/02/2025 11:15	8.98		3.12	0.72	1.96	1.66	1.28	1.17	1.58		1.28	2.89	1.18	2.41	2.01	Data removed from PT05 due to instrument issues
22/02/2025 11:30	8.99		3.12	0.72		1.66	1.27	1.17	1.58		1.28	2.89	1.18	2.41	2.01	Data removed from PT05 due to instrument issues
22/02/2025 11:45	8.98		3.12	0.72	1.96	1.66	1.27	1.17	1.58		1.27	2.89	1.18	2.40	2.00	Data removed from PT05 due to instrument issues
22/02/2025 12:00	8.98		3.12	0.72	1.96	1.66	1.27	1.17	1.57		1.27	2.89	1.18	2.40	2.00	Data removed from PT05 due to instrument issues
22/02/2025 12:15	8.98		3.12	0.72	1.96	1.66	1.28	1.17	1.56		1.27	2.89	1.18	2.40	2.00	Data removed from PT05 due to instrument issues
22/02/2025 12:30	8.98		3.12	0.72	1.95	1.67	1.27	1.16	1.57		1.27	2.89	1.18	2.40	2.00	Data removed from PT05 due to instrument issues
22/02/2025 12:45	8.98		3.12	0.72	1.95	1.67	1.27	1.17	1.57		1.27	2.89	1.18	2.40	2.00	Data removed from PT05 due to instrument issues
22/02/2025 13:00	8.98		3.12	0.73	1.96	1.67	1.27	1.17	1.57		1.27	2.89	1.19	2.41	2.01	Data removed from PT05 due to instrument issues
22/02/2025 13:15	8.98		3.13	0.73	1.96	1.67	1.27	1.17	1.56		1.28	2.89	1.18	2.43	2.01	Data removed from PT05 due to instrument issues
22/02/2025 13:30	8.99		3.13	0.74	1.96	1.67	1.27	1.17	1.56		1.28	2.89	1.18	2.43	2.01	Data removed from PT05 due to instrument issues
22/02/2025 13:45	8.98		3.12	0.74	1.95	1.67	1.26	1.17	1.55		1.27	2.89	1.18	2.43	2.00	Data removed from PT05 due to instrument issues
22/02/2025 14:00	8.99		3.13	0.75	1.95	1.67	1.27	1.17	1.56		1.27	2.89	1.19	2.44	2.01	Data removed from PT05 due to instrument issues
22/02/2025 14:15	8.99		3.13	0.77	1.95	1.67	1.28	1.17	1.57		1.27	2.89	1.19	2.45	2.01	Data removed from PT05 due to instrument issues
22/02/2025 14:30	8.98		3.13	0.77	1.95	1.67	1.28	1.17	1.56		1.28	2.90	1.18	2.45	2.01	Data removed from PT05 due to instrument issues
22/02/2025 14:45	8.99		3.13	0.79	1.95	1.67	1.27	1.18	1.56		1.28	2.90	1.19	2.46	2.01	Data removed from PT05 due to instrument issues
22/02/2025 15:00	8.99		3.13	0.80	1.96	1.67	1.28	1.17	1.56		1.27	2.90	1.19	2.46	2.01	Data removed from PT05 due to instrument issues
22/02/2025 15:15	8.99		3.13	0.81	1.96	1.67	1.28	1.18	1.57		1.28	2.90	1.19	2.47	2.01	Data removed from PT05 due to instrument issues
22/02/2025 15:30	8.99		3.13	0.81	1.96	1.67	1.27	1.17	1.56		1.28	2.90	1.19	2.47	2.01	Data removed from PT05 due to instrument issues
22/02/2025 15:45	8.98		3.13	0.82	1.95	1.67	1.27	1.17	1.56		1.28	2.89	1.19	2.47	2.01	Data removed from PT05 due to instrument issues
22/02/2025 16:00	8.99		3.13	0.83	1.95	1.67	1.27	1.17	1.56		1.28	2.89	1.19	2.47	2.01	Data removed from PT05 due to instrument issues
22/02/2025 16:15	8.99		3.13	0.83	1.95	1.67	1.27	1.18	1.56		1.28	2.90	1.19	2.48	2.01	Data removed from PT05 due to instrument issues
22/02/2025 16:30	8.99		3.13	0.84	1.95	1.67	1.28	1.18	1.55		1.27	2.89	1.19	2.48	2.01	Data removed from PT05 due to instrument issues
22/02/2025 16:45	8.99		3.13	0.85	1.96	1.67	1.28	1.18	1.55		1.28	2.90	1.19	2.49	2.01	Data removed from PT05 due to instrument issues
22/02/2025 17:00	8.98		3.12	0.85	1.95	1.66	1.27	1.17	1.55		1.27	2.89	1.18	2.48	2.00	Data removed from PT05 due to instrument issues
22/02/2025 17:15	8.98		3.12	0.85	1.95	1.66	1.26	1.17	1.55		1.27	2.89	1.18	2.49	2.00	Data removed from PT05 due to instrument issues
22/02/2025 17:30	8.98		3.13	0.85	1.94	1.66	1.27	1.17	1.55		1.27	2.88	1.18	2.49	2.00	Data removed from PT05 due to instrument issues
22/02/2025 17:45	8.98		3.13	0.86	1.94	1.66	1.27	1.17	1.55		1.28	2.89	1.19	2.50	2.00	Data removed from PT05 due to instrument issues
22/02/2025 18:00	8.98		3.12	0.86	1.94	1.66	1.27	1.17	1.54		1.27	2.89	1.18	2.50	2.00	Data removed from PT05 due to instrument issues
22/02/2025 18:15	8.98		3.12	0.86	1.94	1.66	1.26	1.16	1.55		1.27	2.89	1.18	2.50	2.00	Data removed from PT05 due to instrument issues
22/02/2025 18:30	8.98		3.13	0.86	1.94	1.67	1.27	1.17	1.55		1.27	2.89	1.18	2.51	2.00	Data removed from PT05 due to instrument issues
22/02/2025 18:45	8.98		3.12	0.85	1.94	1.66	1.26	1.17	1.55		1.26	2.89	1.18	2.51	2.00	Data removed from PT05 due to instrument issues
22/02/2025 19:00	8.98		3.12	0.85	1.94	1.66	1.27	1.16	1.54		1.27	2.89	1.18	2.51	2.00	Data removed from PT05 due to instrument issues
22/02/2025 19:15	8.98		3.13	0.85	1.94	1.66	1.27	1.16	1.54		1.28	2.89	1.18	2.52	2.00	Data removed from PT05 due to instrument issues
22/02/2025 19:30	8.98		3.12	0.84	1.94	1.66	1.26	1.17	1.56		1.27	2.88	1.18	2.52	2.00	Data removed from PT05 due to instrument issues
22/02/2025 19:45	8.98		3.13	0.83	1.94	1.66	1.27	1.17	1.56		1.28	2.89	1.18	2.53	2.00	Data removed from PT05 due to instrument issues
22/02/2025 20:00	8.99		3.12	0.82	1.95	1.66	1.27	1.17	1.55		1.28	2.89	1.18	2.53	2.00	Data removed from PT05 due to instrument issues
22/02/2025 20:15	8.98		3.13	0.81	1.94	1.66	1.27	1.17	1.55		1.27	2.89	1.18	2.54	2.00	Data removed from PT05 due to instrument issues
22/02/2025 20:30	8.99		3.13	0.81	1.95	1.67	1.27	1.17	1.56		1.27	2.89	1.18	2.54	2.00	Data removed from PT05 due to instrument issues
22/02/2025 20:45	8.98		3.13	0.79	1.94	1.67	1.27	1.17	1.56		1.27	2.89	1.18	2.54	2.00	Data removed from PT05 due to instrument issues
22/02/2025 21:00	8.98		3.12	0.79	1.95	1.66	1.27	1.16	1.56		1.26	2.89	1.18	2.55	2.00	Data removed from PT05 due to instrument issues
22/02/2025 21:15	8.98		3.13	0.78	1.94	1.66	1.27	1.17	1.56		1.27	2.89	1.18	2.54	2.00	Data removed from PT05 due to instrument issues
22/02/2025 21:30	8.98		3.13	0.77	1.94	1.66	1.27	1.17	1.55		1.27	2.89	1.18	2.54	2.00	Data removed from PT05 due to instrument issues
22/02/2025 21:45	8.99		3.12	0.76	1.94	1.67	1.26	1.17	1.56		1.27	2.89	1.18	2.53	2.00	Data removed from PT05 due to instrument issues
22/02/2025 22:00	8.99		3.13	0.76	1.94	1.67	1.27	1.17	1.55		1.27	2.89	1.18	2.53	2.00	Data removed from PT05 due to instrument issues
22/02/2025 22:15	8.99		3.13	0.75	1.94	1.67	1.27	1.17	1.56		1.27	2.89	1.18	2.52	2.01	Data removed from PT05 due to instrument issues
22/02/2025 22:30	8.99		3.13	0.74	1.95	1.67	1.27	1.17	1.56		1.27	2.89	1.18	2.52	2.01	Data removed from PT05 due to instrument issues
22/02/2025 22:45	8.99		3.13	0.74	1.95	1.67	1.27	1.17	1.56		1.27	2.89	1.18	2.52	2.01	Data removed from PT05 due to instrument issues
22/02/2025 23:00	8.99		3.13	0.73	1.95	1.67	1.27	1.17	1.56		1.27	2.89	1.18	2.52	2.01	Data removed from PT05 due to instrument issues
22/02/2025 23:15	8.99		3.13	0.73	1.95	1.67	1.27	1.17	1.56		1.27	2.89	1.18	2.51	2.01	Data removed from PT05 due to instrument issues
22/02/2025 23:30	8.99		3.13	0.72	1.95	1.68	1.27	1.17	1.56		1.27	2.89	1.19	2.51	2.01	Data removed from PT05 due to instrument issues
22/02/2025 23:45	8.99		3.13	0.72	1.95	1.67	1.28	1.17	1.56		1.28	2.89	1.18	2.50	2.01	Data removed from PT05 due to instrument issues
23/02/2025 00:00	8.99		3.13	0.72	1.95	1.67	1.28	1.17	1.56		1.27	2.90	1.19	2.50	2.01	Data removed from PT05 due to instrument issues
23/02/2025 00:15	8.99		3.13	0.72	1.95	1.67	1.27	1.17	1.56		1.28	2.89	1.19	2.50	2.01	Data removed from PT05 due to instrument issues
23/02/2025 00:30	8.99		3.13	0.72	1.95	1.67	1.28	1.18	1.56		1.28	2.89	1.19	2.50	2.01	Data removed from PT05 due to instrument issues
23/02/2025 00:45	8.99		3.13	0.72	1.95	1.67	1.28	1.18	1.57		1.28	2.90	1.18	2.49	2.01	Data removed from PT05 due to instrument issues
23/02/2025 01:00	8.99		3.13	0.72	1.96	1.68	1.27	1.18	1.57		1.27	2.90	1.19	2.49	2.01	Data removed from PT05 due to instrument issues
23/02/2025 01:15	8.99		3.14	0.72	1.96	1.68	1.28	1.18	1.57		1.28	2.90	1.19	2.48	2.01	Data removed from PT05 due to instrument issues
23/02/2025 01:30	8.99		3.13	0.73	1.95	1.68	1.28	1.18	1.57		1.28	2.90	1.19	2.49	2.01	Data removed from PT05 due to instrument issues
23/02/2025 01:45	8.99		3.14	0.74	1.96	1.68	1.27	1.18	1.57		1.28	2.90	1.19	2.48	2.01	Data removed from PT05 due to instrument issues
23/02/2025 02:00	9.00		3.14	0.74	1.96	1.68	1.28	1.18	1.57		1.28	2.90	1.19	2.49	2.01	Data removed from PT05 due to instrument issues
23/02/2025 02:15	8.99		3.14	0.75	1.96	1.68	1.28	1.18	1.58		1.27	2.90	1.18	2.50	2.01	Data removed from PT05 due to instrument issues
23/02/2025 02:30	8.99		3.14	0.76	1.96	1.68	1.28	1.18	1.57		1.28	2.90	1.19	2.51	2.01	Data removed from PT05 due to instrument issues
23/02/2025 02:45	8.99		3.14	0.77	1.96	1.68	1.28	1.18	1.57		1.28	2.90	1.19	2.51	2.02	Data removed from PT05 due to instrument issues
23/02/2025 03:00	8.99		3.13	0.77	1.96	1.68	1.27	1.18	1.57		1.28	2.89	1.19	2.52	2.01	Data removed from PT05 due to instrument issues
23/02/2025 03:15	8.99		3.14	0.79	1.96	1.68	1.28	1.18	1.56		1.28	2.90	1.19	2.52	2.01	Data removed from PT05 due to instrument issues
23/02/2025 03:30	8.99		3.14	0.80	1.96	1.68	1.27	1.18	1.57		1.27	2.89	1.19	2.53	2.01	Data removed from PT05 due to instrument issues
23/02/2025 03:45	8.99		3.14	0.81	1.96	1.68	1.28	1.18	1.58		1.28	2.90	1.19	2.54	2.01	Data removed from PT05 due to instrument issues
23/02/2025 04:00	8.99		3.13	0.81	1.96	1.68	1.27	1.18	1.57		1.28	2.89	1.19	2.54	2.01	Data removed from PT05 due to instrument issues
23/02/2025 04:15	8.99		3.14	0.82	1.96	1.68	1.27	1.18	1.58		1.28	2.90	1.19	2.54	2.01	Data removed from PT05 due to instrument issues
23/02/2025 04:30	9.00		3.14	0.83	1.96	1.68	1.28	1.18	1.58		1.28	2.89	1.19	2.55	2.02	Data removed from PT05 due to instrument issues
23/02/2025 04:45	9.00		3.14	0.84	1.97	1.69	1.28	1.18	1.58		1.28	2.90	1.19	2.55	2.02	Data removed from PT05 due to instrument issues
23/02/2025 05:00	8.99		3.14	0.84	1.96	1.68	1.27	1.18	1.59		1.28	2.89	1.19	2.55	2.01	Data removed from PT05 due to instrument issues
23/02/2025 05:15	9.00		3.14	0.85	1.96	1.68	1.28	1.18	1.59		1.28	2.89	1.19	2.56	2.02	Data removed from PT05 due to instrument issues
23/02/2025 05:30	8.99		3.14	0.85	1.96	1.68	1.28	1.18	1.57		1.28	2.90	1.18	2.56	2.01	Data removed from PT05 due to instrument issues
23/02/2025 05:45	8.99		3.14	0.86	1.96	1.68	1.27	1.18	1.57		1.28	2.90	1.19	2.57	2.01	Data removed from PT05 due to instrument issues
23/02/2025 06:00	8.99		3.14	0.86	1.96	1.68	1.27	1.18	1.58		1.28	2.90	1.19	2.57	2.01	Data removed from PT05 due to instrument issues
23/02/2025 06:15	9.00		3.14	0.87	1.96	1.68	1.29	1.18	1.59		1.29	2.89	1.19	2.58	2.02	Data removed from PT05 due to instrument issues
23/02/2025 06:30	9.00		3.14	0.87	1.96	1.69	1.28	1.18	1.58		1.28	2.89	1.19	2.58	2.01	Data removed from PT05 due to instrument issues
23/02/2025 06:45	9.00		3.14	0.87	1.96	1.68	1.28	1.18	1.58		1.28	2.89	1.19	2.58	2.02	Data removed from PT05 due to instrument issues
23/02/2025 07:00	9.00		3.14	0.86	1.97	1.68	1.28	1.18	1.58		1.27	2.89	1.19	2.58	2.02	Data removed from PT05 due to instrument issues

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
23/02/2025 07:15	9.00		3.14	0.86	1.96	1.68	1.28	1.18	1.57		1.28	2.89	1.18	2.59	2.01	Data removed from PT05 due to instrument issues
23/02/2025 07:30	8.99		3.13	0.86	1.96	1.68	1.28	1.18	1.58		1.28	2.89	1.18	2.59	2.01	Data removed from PT05 due to instrument issues
23/02/2025 07:45	8.99		3.14	0.86	1.96	1.69	1.28	1.18	1.58		1.28	2.89	1.19	2.59	2.02	Data removed from PT05 due to instrument issues
23/02/2025 08:00	9.00		3.14	0.85	1.97	1.68	1.28	1.18	1.59		1.28	2.89	1.19	2.60	2.02	Data removed from PT05 due to instrument issues
23/02/2025 08:15	9.00		3.14	0.84	1.96	1.69	1.28	1.18	1.58		1.28	2.90	1.18	2.60	2.02	Data removed from PT05 due to instrument issues
23/02/2025 08:30	8.99		3.14	0.83	1.96	1.69	1.28	1.18	1.59		1.28	2.89	1.18	2.60	2.02	Data removed from PT05 due to instrument issues
23/02/2025 08:45	8.99	1.08	3.14	0.82	1.96	1.68	1.27	1.18	1.58		1.28	2.89	1.18	2.61	2.01	Data removed from PT05 due to instrument issues
23/02/2025 09:00	9.00	1.08	3.13	0.81	1.96	1.68	1.28	1.17	1.57		1.27	2.89	1.18	2.60	2.01	Data removed from PT05 due to instrument issues
23/02/2025 09:15	8.99	1.08	3.13	0.80	1.96	1.68	1.28	1.17	1.57		1.27	2.89	1.18	2.60	2.01	Data removed from PT05 due to instrument issues
23/02/2025 09:30	8.99	1.08	3.13	0.79	1.96	1.68	1.27	1.17	1.58		1.27	2.89	1.18	2.59	2.01	Data removed from PT05 due to instrument issues
23/02/2025 09:45	8.99	1.07	3.13	0.77	1.96	1.67	1.27	1.17	1.56		1.27	2.88	1.17	2.57	2.00	Data removed from PT05 due to instrument issues
23/02/2025 10:00	8.98	1.07	3.12	0.75	1.95	1.67	1.27	1.16	1.56		1.26	2.88	1.17	2.57	2.00	Data removed from PT05 due to instrument issues
23/02/2025 10:15	8.98	1.07	3.13	0.74	1.95	1.67	1.26	1.17	1.58		1.27	2.88	1.17	2.56	2.00	Data removed from PT05 due to instrument issues
23/02/2025 10:30	8.98	1.07	3.13	0.73	1.95	1.67	1.27	1.16	1.57		1.26	2.87	1.17	2.56	2.00	Data removed from PT05 due to instrument issues
23/02/2025 10:45	8.98	1.07	3.12	0.72	1.96	1.67	1.27	1.16	1.57		1.27	2.87	1.17	2.55	2.00	Data removed from PT05 due to instrument issues
23/02/2025 11:00	8.98	1.07	3.12	0.71	1.95	1.68	1.26	1.16	1.58		1.26	2.87	1.18	2.55	2.00	Data removed from PT05 due to instrument issues
23/02/2025 11:15	8.98	1.07	3.12	0.69		1.67	1.26	1.16	1.57		1.26	2.87	1.17	2.54	2.00	Data removed from PT05 due to instrument issues
23/02/2025 11:30	8.99	1.07	3.13	0.69	1.96	1.68	1.28	1.17	1.58		1.27	2.88	1.18	2.54	2.00	Data removed from PT05 due to instrument issues
23/02/2025 11:45	8.98	1.07	3.12	0.68	1.95	1.68	1.27	1.17	1.58		1.27	2.87	1.18	2.54	2.00	Data removed from PT05 due to instrument issues
23/02/2025 12:00	8.99	1.08	3.13	0.67	1.96	1.68	1.28	1.17	1.58		1.27	2.88	1.18	2.54	2.01	Data removed from PT05 due to instrument issues
23/02/2025 12:15	8.98	1.07	3.13	0.66	1.96	1.68	1.27	1.17	1.58		1.26	2.87	1.18	2.52	2.00	Data removed from PT05 due to instrument issues
23/02/2025 12:30	8.98	1.07	3.13	0.65	1.96	1.68	1.29	1.17	1.58		1.27	2.87	1.18	2.52	2.00	Data removed from PT05 due to instrument issues
23/02/2025 12:45	8.98	1.07	3.13	0.65	1.96	1.67	1.27	1.17	1.58		1.26	2.88	1.17	2.51	2.00	Data removed from PT05 due to instrument issues
23/02/2025 13:00	8.98	1.07	3.13	0.63	1.96	1.67	1.26	1.17	1.58		1.26	2.87	1.17	2.51	2.00	Data removed from PT05 due to instrument issues
23/02/2025 13:15	8.98	1.07	3.13	0.63	1.95	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.51	2.00	Data removed from PT05 due to instrument issues
23/02/2025 13:30	8.98	1.07	3.13	0.63	1.96	1.67	1.26	1.17	1.57		1.27	2.87	1.17	2.51	2.01	Data removed from PT05 due to instrument issues
23/02/2025 13:45	8.99	1.08	3.13	0.63	1.96	1.68	1.26	1.17	1.58		1.28	2.87	1.17	2.50	2.01	Data removed from PT05 due to instrument issues
23/02/2025 14:00	8.99	1.07	3.13	0.63	1.96	1.68	1.27	1.17	1.57		1.26	2.88	1.18	2.50	2.01	Data removed from PT05 due to instrument issues
23/02/2025 14:15	8.99	1.08	3.13	0.62	1.96	1.68	1.28	1.17	1.57		1.27	2.87	1.17	2.50	2.01	Data removed from PT05 due to instrument issues
23/02/2025 14:30	8.97	1.08	3.13	0.62	1.97	1.68	1.27	1.17	1.57		1.27	2.88	1.17	2.49	2.01	Data removed from PT05 due to instrument issues
23/02/2025 14:45	8.98	1.08	3.13	0.62	1.96	1.68	1.27	1.17	1.59		1.28	2.87	1.18	2.49	2.01	Data removed from PT05 due to instrument issues
23/02/2025 15:00	8.98	1.08	3.13	0.62	1.97	1.68	1.27	1.17	1.58		1.27	2.88	1.17	2.49	2.01	Data removed from PT05 due to instrument issues
23/02/2025 15:15	8.98	1.08	3.14	0.63	1.97	1.68	1.27	1.18	1.58		1.27	2.88	1.18	2.49	2.01	Data removed from PT05 due to instrument issues
23/02/2025 15:30	8.98	1.07	3.13	0.63	1.97	1.68	1.28	1.17	1.58		1.27	2.88	1.18	2.49	2.01	Data removed from PT05 due to instrument issues
23/02/2025 15:45	8.98	1.08	3.14	0.64	1.97	1.68	1.27	1.18	1.58		1.27	2.88	1.18	2.48	2.01	Data removed from PT05 due to instrument issues
23/02/2025 16:00	8.98	1.07	3.13	0.64	1.97	1.68	1.27	1.17	1.58		1.27	2.88	1.18	2.48	2.01	Data removed from PT05 due to instrument issues
23/02/2025 16:15	8.98	1.08	3.13	0.65	1.97	1.68	1.28	1.17	1.57		1.27	2.88	1.18	2.48	2.01	Data removed from PT05 due to instrument issues
23/02/2025 16:30	8.98	1.08	3.13	0.65	1.97	1.68	1.28	1.17	1.58		1.28	2.88	1.18	2.48	2.01	Data removed from PT05 due to instrument issues
23/02/2025 16:45	8.98	1.08	3.13	0.66	1.97	1.68	1.27	1.17	1.57		1.27	2.88	1.18	2.47	2.01	Data removed from PT05 due to instrument issues
23/02/2025 17:00	8.98	1.08	3.14	0.67	1.98	1.68	1.28	1.18	1.58		1.28	2.88	1.18	2.47	2.01	Data removed from PT05 due to instrument issues
23/02/2025 17:15	8.98	1.07	3.13	0.67	1.96	1.67	1.28	1.17	1.57		1.27	2.88	1.18	2.47	2.01	Data removed from PT05 due to instrument issues
23/02/2025 17:30	8.97	1.08	3.13	0.68	1.96	1.67	1.27	1.17	1.57		1.27	2.88	1.17	2.47	2.01	Data removed from PT05 due to instrument issues
23/02/2025 17:45	8.98	1.08	3.13	0.68	1.97	1.67	1.27	1.17	1.57		1.27	2.88	1.17	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 18:00	8.97	1.08	3.13	0.69	1.97	1.67	1.26	1.17	1.57		1.26	2.88	1.18	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 18:15	8.98	1.07	3.13	0.69	1.97	1.67	1.27	1.17	1.57		1.27	2.87	1.18	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 18:30	8.98	1.08	3.13	0.69	1.97	1.67	1.27	1.17	1.57		1.27	2.87	1.18	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 18:45	8.97	1.08	3.13	0.70	1.96	1.67	1.27	1.17	1.57		1.27	2.87	1.17	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 19:00	8.98	1.08	3.13	0.70	1.97	1.68	1.27	1.17	1.57		1.27	2.88	1.18	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 19:15	8.98	1.07	3.13	0.70	1.97	1.68	1.27	1.17	1.58		1.27	2.87	1.17	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 19:30	8.98	1.08	3.13	0.70	1.96	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 19:45	8.98	1.08	3.13	0.70	1.97	1.68	1.27	1.18	1.58		1.27	2.87	1.17	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 20:00	8.97	1.07	3.13	0.69	1.97	1.67	1.27	1.17	1.57		1.27	2.88	1.18	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 20:15	8.98	1.08	3.13	0.69	1.97	1.68	1.27	1.17	1.57		1.27	2.88	1.17	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 20:30	8.98	1.08	3.13	0.68	1.97	1.68	1.28	1.18	1.59		1.27	2.87	1.18	2.46	2.01	Data removed from PT05 due to instrument issues
23/02/2025 20:45	8.98	1.08	3.13	0.67	1.97	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.45	2.01	Data removed from PT05 due to instrument issues
23/02/2025 21:00	8.98	1.08	3.13	0.66	1.97	1.68	1.27	1.17	1.58		1.26	2.87	1.18	2.45	2.01	Data removed from PT05 due to instrument issues
23/02/2025 21:15	8.98	1.08	3.13	0.65	1.97	1.68	1.27	1.17	1.58		1.27	2.87	1.17	2.45	2.01	Data removed from PT05 due to instrument issues
23/02/2025 21:30	8.98	1.08	3.13	0.64	1.97	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.45	2.01	Data removed from PT05 due to instrument issues
23/02/2025 21:45	8.98	1.08	3.13	0.63	1.97	1.68	1.27	1.17	1.58		1.27	2.87	1.17	2.45	2.01	Data removed from PT05 due to instrument issues
23/02/2025 22:00	8.97	1.08	3.13	0.62	1.97	1.68	1.27	1.17	1.57		1.27	2.87	1.18	2.44	2.01	Data removed from PT05 due to instrument issues
23/02/2025 22:15	8.98	1.07	3.13	0.61	1.96	1.67	1.26	1.17	1.57		1.27	2.87	1.17	2.44	2.01	Data removed from PT05 due to instrument issues
23/02/2025 22:30	8.98	1.08	3.13	0.60	1.97	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.44	2.01	Data removed from PT05 due to instrument issues
23/02/2025 22:45	8.98	1.08	3.13	0.59	1.96	1.68	1.27	1.17	1.57		1.28	2.87	1.17	2.43	2.01	Data removed from PT05 due to instrument issues
23/02/2025 23:00	8.97	1.08	3.13	0.58	1.97	1.68	1.27	1.17	1.58		1.27	2.87	1.17	2.43	2.01	Data removed from PT05 due to instrument issues
23/02/2025 23:15	8.98	1.08	3.13	0.57	1.97	1.68	1.28	1.17	1.58		1.27	2.87	1.17	2.43	2.01	Data removed from PT05 due to instrument issues
23/02/2025 23:30	8.98	1.08	3.13	0.56	1.97	1.68	1.28	1.17	1.57		1.28	2.87	1.18	2.42	2.01	Data removed from PT05 due to instrument issues
23/02/2025 23:45	8.98	1.08	3.13	0.55	1.97	1.68	1.28	1.17	1.58		1.27	2.87	1.17	2.42	2.01	Data removed from PT05 due to instrument issues
24/02/2025 00:00	8.98	1.08	3.13	0.55	1.97	1.68	1.27	1.18	1.58		1.28	2.88	1.17	2.42	2.01	Data removed from PT05 due to instrument issues
24/02/2025 00:15	8.98	1.08	3.13	0.54	1.97	1.68	1.28	1.18	1.59		1.27	2.88	1.17	2.42	2.01	Data removed from PT05 due to instrument issues
24/02/2025 00:30	8.98	1.08	3.13	0.53	1.97	1.68	1.27	1.17	1.58		1.27	2.87	1.17	2.41	2.01	Data removed from PT05 due to instrument issues
24/02/2025 00:45	8.98	1.08	3.13	0.53	1.97	1.68	1.27	1.18	1.58		1.28	2.88	1.17	2.41	2.01	Data removed from PT05 due to instrument issues
24/02/2025 01:00	8.98	1.08	3.13	0.53	1.97	1.68	1.27	1.17	1.57		1.28	2.87	1.18	2.41	2.01	Data removed from PT05 due to instrument issues
24/02/2025 01:15	8.98	1.08	3.13	0.52	1.97	1.68	1.27	1.17	1.58		1.27	2.87	1.17	2.41	2.01	Data removed from PT05 due to instrument issues
24/02/2025 01:30	8.98	1.08	3.13	0.52	1.97	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.40	2.01	Data removed from PT05 due to instrument issues
24/02/2025 01:45	8.98	1.07	3.13	0.52	1.97	1.68	1.27	1.17	1.59		1.27	2.87	1.17	2.40	2.01	Data removed from PT05 due to instrument issues
24/02/2025 02:00	8.97	1.08	3.13	0.52	1.98	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.40	2.01	Data removed from PT05 due to instrument issues
24/02/2025 02:15	8.98	1.08	3.13	0.52	1.97	1.68	1.28	1.17	1.58		1.27	2.87	1.16	2.40	2.01	Data removed from PT05 due to instrument issues
24/02/2025 02:30	8.98	1.08	3.13	0.52	1.97	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.39	2.01	Data removed from PT05 due to instrument issues
24/02/2025 02:45	8.98	1.08	3.13	0.53	1.97	1.68	1.27	1.18	1.57		1.27	2.87	1.17	2.39	2.01	Data removed from PT05 due to instrument issues
24/02/2025 03:00	8.98	1.08	3.13	0.53	1.97	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.39	2.01	Data removed from PT05 due to instrument issues
24/02/2025 03:15	8.97	1.08	3.13	0.54	1.97	1.68	1.27	1.17	1.58		1.28	2.86	1.16	2.39	2.01	Data removed from PT05 due to instrument issues
24/02/2025 03:30	8.98	1.08	3.13	0.55	1.97	1.68	1.27	1.17	1.58		1.27	2.87	1.17	2.39	2.01	Data removed from PT05 due to instrument issues
24/02/2025 03:45	8.98	1.08	3.13	0.57	1.97	1.68	1.27	1.17	1.59		1.28	2.87	1.17	2.38	2.02	Data removed from PT05 due to instrument issues
24/02/2025 04:00	8.98	1.08	3.13	0.58	1.97	1.68	1.27	1.17	1.58		1.28	2.87	1.17	2.38	2.02	Data removed from PT05 due to instrument issues
24/02/2025 04:15	8.98	1.08	3.13	0.59	1.97	1.68	1.27	1.17	1.58		1.28	2.87	1.17	2.38	2.02	Data removed from PT05 due to instrument issues
24/02/2025 04:30	8.98	1.08	3.13	0.61	1.97	1.68	1.27	1.17	1.58		1.28	2.87	1.17	2.38	2.02	Data removed from PT05 due to instrument issues
24/02/2025 04:45	8.98	1.08	3.13	0.62	1.97	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.38	2.02	Data removed from PT05 due to instrument issues
24/02/2025 05:00	8.98	1.08	3.13	0.64	1.97	1.68	1.27	1.17	1.57		1.28	2.87	1.17	2.37	2.01	Data removed from PT05 due to instrument issues
24/02/2025 05:15	8.98	1.08	3.13	0.65	1.97	1.68	1.27	1.17	1.57		1.27	2.86	1.17	2.37	2.01	Data removed from PT05 due to instrument issues
24/02/2025 05:30	8.98	1.08	3.13	0.67	1.97	1.68	1.27	1.17	1.57		1.27	2.86	1.17	2.37	2.02	Data removed from PT05 due to instrument issues
24/02/2025 05:45	8.98	1.08	3.13	0.68	1.97	1.68	1.27	1.17	1.58		1.27	2.87	1.17	2.38	2.02	Data removed from PT05 due to instrument issues
24/02/2025 06:00	8.98	1.08	3.13	0.70	1.97	1.68	1.27	1.17	1.57		1.27	2.86	1.17	2.38	2.01	Data removed from PT05 due to instrument issues
24/02/2025 06:15	8.98	1.08	3.13	0.71	1.97	1.68	1.27	1.17	1.57		1.27	2.86	1.16	2.38	2.01	Data removed from PT05 due to instrument issues
24/02/2025 06:30	8.98	1.08	3.13	0.73	1.97	1.68	1.27	1.17	1.57		1.27	2.86	1.16	2.39	2.01	Data removed from PT05 due to instrument issues
24/02/2025 06:45	8.98	1.08	3.13	0.75	1.97	1.68	1.27	1.17	1.57		1.27	2.87	1.17	2.39	2.01	Data removed from PT05 due to instrument issues
24/02/2025 07:00	8.98	1.08	3.13	0.76	1.97	1.67	1.26	1.17	1.56		1.27	2.87	1.17	2.40	2.01	Data removed from PT05 due to instrument issues
24/02/2025 07:15	8.98	1.08	3.13	0.77	1.97	1.67	1.27	1.17	1.57		1.27	2.86	1.16	2.40	2.01	Data removed from PT05 due to instrument issues
24/02/2025 07:30	8.97	1.08	3.13	0.79	1.97	1.67	1.27	1.17	1.55		1.27	2.86	1.16	2.40	2.01	Data removed from PT05 due to instrument issues
24/02/2025 07:45	8.97	1.08	3.13	0.80	1.96	1.67	1.27	1.17	1.56		1.26	2.86	1.17	2.41	2.01	Data removed from PT05 due to instrument issues
24/02/2025 08:00	8.98	1.08	3.12	0.81	1.96	1.67	1.27	1.17	1.56		1.26	2.86	1.16	2.41	2.01	Data removed from PT05 due to instrument issues
24/02/2025 08:15	8.98	1.08	3.13	0.82	1.96	1.67	1.27	1.17	1.57		1.27	2.86	1.16	2.42	2.01	Data removed from PT05 due to instrument issues
24/02/2025 08:30	8.97	1.07	3.12	0.82	1.96	1.67	1.26	1.17	1.57		1.27	2.86	1.16	2.42	2.01	Data removed from PT05 due to instrument issues
24/02/2025 08:45	8.97	1.08	3.13	0.83	1.96	1.67	1.26	1.17	1.57		1.27	2.86	1.16	2.43	2.01	Data removed from PT05 due to instrument issues
24/02/2025 09:00	8.98	1.08	3.13	0.84	1.97	1.68	1.27	1.17	1.56		1.27	2.86	1.17	2.44	2.01	Data removed from PT05 due to instrument issues
24/02/2025 09:15	8.97		3.13	0.84	1.96	1.67	1.27	1.17	1.57		1.28	2.86	1.16	2.44	2.01	Data removed from PT05 due to instrument issues
24/02/2025 09:30	8.97	1.09	3.13	0.84	1.96	1.67	1.26	1.16	1.56		1.27	2.86	1.16	2.44	2.01	Data removed from PT05 due to instrument issues
24/02/2025 09:45	8.97	1.09	3.13	0.84	1.96	1.67	1.26	1.17	1.56		1.26	2.86	1.16	2.45	2.00	Data removed from PT05 due to instrument issues
24/02/2025 10:00	8.97	1.09	3.13	0.83	1.96	1.67	1.26	1.16	1.57		1.26	2.86	1.16	2.45	2.00	Data removed from PT05 due to instrument issues
24/02/2025 10:15	8.97	1.09	3.12	0.83	1.96	1.66	1.26	1.17	1.56		1.26	2.86	1.16	2.46	2.00	Data removed from PT05 due to instrument issues
24/02/2025 10:30	8.97	1.09	3.13	0.83	1.96	1.66	1.27	1.17	1.56		1.26	2.86	1.16	2.46	2.01	Data removed from PT05 due to instrument issues
24/02/2025 10:45	8.97	1.09	3.12	0.82	1.96	1.66	1.26	1.16	1.56		1.26	2.86	1.15	2.46	2.00	Data removed from PT05 due to instrument issues
24/02/2025 11:00	8.97	1.09	3.12	0.82	1.96	1.67	1.27	1.17	1.55		1.26	2.86	1.16	2.47	2.01	Data removed from PT05 due to instrument issues
24/02/2025 11:15	8.96	1.09	3.13	0.81	1.96	1.66	1.26	1.16	1.56		1.27	2.87	1.15	2.48	2.00	Data removed from PT05 due to instrument issues
24/02/2025 11:30	8.96	1.09	3.13	0.80	1.96	1.66	1.26	1.16	1.56		1.26	2.87	1.16	2.48	2.00	Data removed from PT05 due to instrument issues
24/02/2025 11:45	8.96	1.09	3.12	0.79	1.96	1.66	1.26	1.17	1.56		1.27	2.86	1.15	2.48	2.00	Data removed from PT05 due to instrument issues
24/02/2025 12:00	8.97	1.09	3.12	0.79	1.95	1.66	1.26	1.16	1.56		1.26	2.87	1.16	2.48	2.00	Data removed from PT05 due to instrument issues
24/02/2025 12:15	8.96	1.09	3.13	0.78	1.96	1.67	1.26	1.16	1.57		1.27	2.87	1.16	2.49	2.00	Data removed from PT05 due to instrument issues
24/02/2025 12:30	8.97	1.09	3.13	0.78	1.96	1.67	1.26	1.17	1.57		1.27	2.87	1.16	2.50	2.00	Data removed from PT05 due to instrument issues
24/02/2025 12:45	8.97	1.09	3.13	0.77	1.96	1.67	1.27	1.17	1.56		1.26	2.87	1.16	2.50	2.00	Data removed from PT05 due to instrument issues
24/02/2025 13:00	8.97	1.09	3.13	0.77	1.96	1.67	1.26	1.17	1.56		1.27	2.87	1.16	2.51	2.00	Data removed from PT05 due to instrument issues
24/02/2025 13:15	8.97	1.09	3.13	0.76	1.96	1.67	1.27	1.17	1.57		1.26	2.87	1.16	2.51	2.00	Data removed from PT05 due to instrument issues
24/02/2025 13:30	8.97	1.09	3.13	0.75	1.95	1.67	1.26	1.16	1.56		1.27	2.87	1.16	2.50	2.00	Data removed from PT05 due to instrument issues
24/02/2025 13:45	8.97	1.09	3.13	0.75	1.96	1.67	1.26	1.16	1.57		1.27	2.87	1.16	2.50	2.00	Data removed from PT05 due to instrument issues
24/02/2025 14:00	8.96	1.09	3.13	0.75	1.96	1.67	1.26	1.16	1.55		1.26	2.87	1.16	2.50	2.00	Data removed from PT05 due to instrument issues
24/02/2025 14:15	8.96	1.09	3.13	0.75	1.96	1.67	1.26	1.16	1.56		1.26	2.87	1.16	2.50	2.00	Data removed from PT05 due to instrument issues
24/02/2025 14:30	8.97	1.09	3.14	0.76	1.96	1.68	1.26	1.16	1.57		1.27	2.88	1.16	2.51	2.01	Data removed from PT05 due to instrument issues
24/02/2025 14:45	8.96	1.09	3.13	0.75	1.96	1.67	1.27	1.16	1.56		1.26	2.87	1.16	2.52	2.00	Data removed from PT05 due to instrument issues
24/02/2025 15:00	8.97	1.09	3.13	0.75	1.96	1.67	1.26	1.16	1.56		1.26	2.88	1.17	2.52	2.00	Data removed from PT05 due to instrument issues
24/02/2025 15:15	8.97	1.10	3.14	0.77	1.97	1.68	1.27	1.17	1.57		1.27	2.88	1.17	2.54	2.01	Data removed from PT05 due to instrument issues

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
24/02/2025 15:30	8.97	1.10	3.13	0.77	1.96	1.68	1.27	1.16	1.56		1.27	2.89	1.17	2.55	2.01	Data removed from PT05 due to instrument issues
24/02/2025 15:45	8.97	1.10	3.14	0.78	1.96	1.68	1.27	1.17	1.56		1.27	2.88	1.17	2.55	2.01	Data removed from PT05 due to instrument issues
24/02/2025 16:00	8.98	1.10	3.14	0.79	1.97	1.68	1.27	1.17	1.57		1.27	2.89	1.19	2.56	2.01	Data removed from PT05 due to instrument issues
24/02/2025 16:15	8.97	1.10	3.14	0.80	1.96	1.68	1.27	1.17	1.56		1.27	2.88	1.18	2.56	2.01	Data removed from PT05 due to instrument issues
24/02/2025 16:30	8.97	1.10	3.13	0.80	1.96	1.67	1.27	1.16	1.55		1.26	2.88	1.17	2.56	2.00	Data removed from PT05 due to instrument issues
24/02/2025 16:45	8.96	1.09	3.13	0.81	1.96	1.67	1.27	1.16	1.55		1.26	2.87	1.17	2.56	2.00	Data removed from PT05 due to instrument issues
24/02/2025 17:00	8.97	1.09	3.13	0.82	1.96	1.67	1.27	1.16	1.54		1.26	2.88	1.17	2.56	2.00	Data removed from PT05 due to instrument issues
24/02/2025 17:15	8.97	1.09	3.14	0.83	1.96	1.68	1.27	1.16	1.56		1.26	2.88	1.17	2.57	2.00	Data removed from PT05 due to instrument issues
24/02/2025 17:30	8.97	1.09	3.14	0.84	1.95	1.67	1.28	1.16	1.55		1.27	2.88	1.17	2.57	2.00	Data removed from PT05 due to instrument issues
24/02/2025 17:45	8.97	1.10	3.14	0.85	1.96	1.67	1.27	1.16	1.55		1.27	2.88	1.17	2.58	2.00	Data removed from PT05 due to instrument issues
24/02/2025 18:00	8.97	1.09	3.13	0.87	1.96	1.67	1.27	1.16	1.55		1.26	2.88	1.17	2.58	2.01	Data removed from PT05 due to instrument issues
24/02/2025 18:15	8.97	1.09	3.13	0.88	1.95	1.67	1.27	1.16	1.55		1.27	2.88	1.17	2.58	2.00	Data removed from PT05 due to instrument issues
24/02/2025 18:30	8.97	1.09	3.14	0.88	1.95	1.67	1.26	1.16	1.55		1.26	2.87	1.17	2.58	2.00	Data removed from PT05 due to instrument issues
24/02/2025 18:45	8.97	1.09	3.13	0.89	1.95	1.67	1.27	1.16	1.55		1.26	2.88	1.17	2.58	2.01	Data removed from PT05 due to instrument issues
24/02/2025 19:00	8.97	1.09	3.13	0.90	1.96	1.67	1.27	1.16	1.56		1.26	2.88	1.18	2.59	2.00	Data removed from PT05 due to instrument issues
24/02/2025 19:15	8.97	1.09	3.13	0.91	1.95	1.67	1.27	1.16	1.57		1.27	2.88	1.17	2.59	2.00	Data removed from PT05 due to instrument issues
24/02/2025 19:30	8.97	1.10	3.14	0.91	1.96	1.68	1.27	1.16	1.56		1.27	2.88	1.17	2.59	2.01	Data removed from PT05 due to instrument issues
24/02/2025 19:45	8.97	1.09	3.13	0.92	1.96	1.67	1.27	1.16	1.55		1.27	2.88	1.17	2.60	2.01	Data removed from PT05 due to instrument issues
24/02/2025 20:00	8.97	1.09	3.13	0.92	1.96	1.67	1.27	1.16	1.56		1.26	2.88	1.17	2.60	2.00	Data removed from PT05 due to instrument issues
24/02/2025 20:15	8.97	1.10	3.13	0.92	1.96	1.67	1.27	1.16	1.55		1.26	2.87	1.18	2.60	2.00	Data removed from PT05 due to instrument issues
24/02/2025 20:30	8.97	1.10	3.13	0.92	1.96	1.68	1.27	1.16	1.56		1.26	2.88	1.17	2.60	2.01	Data removed from PT05 due to instrument issues
24/02/2025 20:45	8.97	1.10	3.14	0.92	1.96	1.67	1.27	1.16	1.56		1.26	2.88	1.17	2.60	2.01	Data removed from PT05 due to instrument issues
24/02/2025 21:00	8.98	1.10	3.14	0.92	1.96	1.68	1.27	1.17	1.56		1.27	2.88	1.18	2.61	2.01	Data removed from PT05 due to instrument issues
24/02/2025 21:15	8.97	1.10	3.14	0.92	1.96	1.68	1.27	1.16	1.56		1.27	2.87	1.18	2.61	2.01	Data removed from PT05 due to instrument issues
24/02/2025 21:30	8.97	1.10	3.14	0.92	1.96	1.68	1.27	1.16	1.56		1.27	2.88	1.18	2.61	2.01	Data removed from PT05 due to instrument issues
24/02/2025 21:45	8.98	1.10	3.14	0.92	1.96	1.68	1.27	1.16	1.57		1.27	2.88	1.18	2.62	2.01	Data removed from PT05 due to instrument issues
24/02/2025 22:00	8.98	1.10	3.14	0.92	1.96	1.68	1.27	1.16	1.57		1.27	2.88	1.18	2.62	2.01	Data removed from PT05 due to instrument issues
24/02/2025 22:15	8.97	1.09	3.14	0.91	1.96	1.68	1.27	1.16	1.56		1.26	2.88	1.18	2.62	2.01	Data removed from PT05 due to instrument issues
24/02/2025 22:30	8.97	1.10	3.14	0.89	1.96	1.68	1.27	1.16	1.56		1.27	2.88	1.17	2.62	2.01	Data removed from PT05 due to instrument issues
24/02/2025 22:45	8.98	1.10	3.14	0.89	1.96	1.68	1.27	1.17	1.56		1.27	2.88	1.18	2.62	2.01	Data removed from PT05 due to instrument issues
24/02/2025 23:00	8.98	1.10	3.14	0.88	1.96	1.68	1.27	1.16	1.56		1.27	2.88	1.18	2.62	2.01	Data removed from PT05 due to instrument issues
24/02/2025 23:15	8.98	1.10	3.14	0.87	1.96	1.68	1.26	1.17	1.57		1.27	2.88	1.18	2.63	2.01	Data removed from PT05 due to instrument issues
24/02/2025 23:30	8.98	1.10	3.14	0.86	1.96	1.68	1.27	1.17	1.56		1.27	2.88	1.18	2.63	2.01	Data removed from PT05 due to instrument issues
24/02/2025 23:45	8.98	1.10	3.14	0.85	1.97	1.68	1.27	1.17	1.55		1.27	2.88	1.18	2.63	2.01	Data removed from PT05 due to instrument issues
25/02/2025 00:00	8.98	1.10	3.14	0.84	1.97	1.68	1.27	1.16	1.55		1.27	2.88	1.18	2.63	2.01	Data removed from PT05 due to instrument issues
25/02/2025 00:15	8.98	1.10	3.14	0.82	1.97	1.68	1.28	1.17	1.56		1.27	2.89	1.18	2.63	2.01	Data removed from PT05 due to instrument issues
25/02/2025 00:30	8.98	1.10	3.14	0.81	1.97	1.68	1.28	1.16	1.57		1.27	2.88	1.18	2.62	2.01	Data removed from PT05 due to instrument issues
25/02/2025 00:45	8.98	1.10	3.14	0.80	1.97	1.68	1.27	1.17	1.56		1.27	2.89	1.18	2.61	2.01	Data removed from PT05 due to instrument issues
25/02/2025 01:00	8.98	1.10	3.14	0.79	1.97	1.68	1.27	1.17	1.57		1.28	2.89	1.18	2.61	2.01	Data removed from PT05 due to instrument issues
25/02/2025 01:15	8.98	1.10	3.14	0.78	1.97	1.69	1.27	1.17	1.56		1.27	2.88	1.18	2.60	2.01	Data removed from PT05 due to instrument issues
25/02/2025 01:30	8.98	1.10	3.14	0.77	1.97	1.68	1.27	1.17	1.55		1.27	2.88	1.18	2.60	2.01	Data removed from PT05 due to instrument issues
25/02/2025 01:45	8.98	1.10	3.14	0.76	1.97	1.69	1.27	1.17	1.56		1.27	2.89	1.18	2.59	2.01	Data removed from PT05 due to instrument issues
25/02/2025 02:00	8.98	1.10	3.14	0.76	1.97	1.68	1.28	1.17	1.56		1.27	2.88	1.18	2.58	2.01	Data removed from PT05 due to instrument issues
25/02/2025 02:15	8.97	1.10	3.14	0.75	1.97	1.69	1.27	1.17	1.56		1.27	2.88	1.18	2.58	2.01	Data removed from PT05 due to instrument issues
25/02/2025 02:30	8.98	1.10	3.14	0.74	1.97	1.69	1.27	1.17	1.57		1.28	2.88	1.18	2.58	2.01	Data removed from PT05 due to instrument issues
25/02/2025 02:45	8.98	1.10	3.15	0.74	1.97	1.69	1.28	1.17	1.56		1.28	2.89	1.18	2.57	2.01	Data removed from PT05 due to instrument issues
25/02/2025 03:00	8.98	1.10	3.14	0.74	1.97	1.69	1.27	1.17	1.56		1.28	2.89	1.18	2.57	2.01	Data removed from PT05 due to instrument issues
25/02/2025 03:15	8.97	1.10	3.14	0.74	1.97	1.69	1.27	1.17	1.56		1.28	2.88	1.17	2.57	2.01	Data removed from PT05 due to instrument issues
25/02/2025 03:30	8.98	1.10	3.14	0.74	1.97	1.69	1.27	1.17	1.57		1.27	2.88	1.18	2.56	2.01	Data removed from PT05 due to instrument issues
25/02/2025 03:45	8.98	1.10	3.14	0.74	1.97	1.69	1.27	1.17	1.56		1.28	2.88	1.18	2.56	2.01	Data removed from PT05 due to instrument issues
25/02/2025 04:00	8.98	1.10	3.14	0.75	1.97	1.68	1.27	1.17	1.57		1.28	2.88	1.18	2.56	2.01	Data removed from PT05 due to instrument issues
25/02/2025 04:15	8.97	1.10	3.14	0.75	1.96	1.68	1.27	1.17	1.56		1.27	2.88	1.18	2.56	2.01	Data removed from PT05 due to instrument issues
25/02/2025 04:30	8.98	1.10	3.14	0.77	1.97	1.69	1.27	1.17	1.57		1.27	2.88	1.18	2.57	2.01	Data removed from PT05 due to instrument issues
25/02/2025 04:45	8.98	1.10	3.14	0.77	1.97	1.69	1.28	1.17	1.56		1.27	2.88	1.18	2.58	2.01	Data removed from PT05 due to instrument issues
25/02/2025 05:00	8.97	1.10	3.14	0.78	1.96	1.68	1.26	1.17	1.57		1.27	2.88	1.18	2.58	2.01	Data removed from PT05 due to instrument issues
25/02/2025 05:15	8.98	1.10	3.14	0.80	1.97	1.69	1.28	1.17	1.56		1.28	2.88	1.17	2.59	2.01	Data removed from PT05 due to instrument issues
25/02/2025 05:30	8.97	1.10	3.14	0.80	1.97	1.68	1.27	1.17	1.57		1.27	2.88	1.18	2.59	2.01	Data removed from PT05 due to instrument issues
25/02/2025 05:45	8.97	1.10	3.14	0.81	1.96	1.68	1.27	1.17	1.56		1.28	2.88	1.17	2.59	2.01	Data removed from PT05 due to instrument issues
25/02/2025 06:00	8.97	1.10	3.14	0.83	1.97	1.68	1.27	1.17	1.56		1.28	2.88	1.17	2.60	2.01	Data removed from PT05 due to instrument issues
25/02/2025 06:15	8.97	1.10	3.14	0.84	1.96	1.68	1.27	1.17	1.56		1.28	2.88	1.17	2.60	2.01	Data removed from PT05 due to instrument issues
25/02/2025 06:30	8.97	1.10	3.14	0.85	1.96	1.68	1.27	1.17	1.57		1.27	2.88	1.17	2.61	2.01	Data removed from PT05 due to instrument issues
25/02/2025 06:45	8.97	1.10	3.14	0.86	1.96	1.68	1.26	1.17	1.55		1.27	2.88	1.17	2.61	2.01	Data removed from PT05 due to instrument issues
25/02/2025 07:00	8.97	1.10	3.14	0.87	1.96	1.68	1.27	1.16	1.56		1.27	2.88	1.17	2.61	2.01	Data removed from PT05 due to instrument issues
25/02/2025 07:15	8.97	1.10	3.14	0.88	1.96	1.68	1.27	1.16	1.56		1.27	2.88	1.17	2.62	2.01	Data removed from PT05 due to instrument issues
25/02/2025 07:30	8.97	1.09	3.14	0.89	1.96	1.67	1.27	1.16	1.56		1.27	2.87	1.17	2.62	2.00	Data removed from PT05 due to instrument issues
25/02/2025 07:45	8.97	1.10	3.14	0.89	1.96	1.67	1.27	1.16	1.56		1.27	2.88	1.17	2.63	2.01	Data removed from PT05 due to instrument issues
25/02/2025 08:00	8.97	1.10	3.13	0.90	1.96	1.68	1.27	1.16	1.56		1.27	2.88	1.17	2.63	2.01	Data removed from PT05 due to instrument issues
25/02/2025 08:15	8.98	1.10	3.14	0.91	1.96	1.68	1.27	1.16	1.56		1.27	2.88	1.17	2.64	2.01	Data removed from PT05 due to instrument issues
25/02/2025 08:30	8.97	1.10	3.14	0.92	1.96	1.68	1.28	1.16	1.56		1.27	2.87	1.17	2.64	2.01	Data removed from PT05 due to instrument issues
25/02/2025 08:45	8.97	1.11	3.14	0.92	1.96	1.68	1.27	1.17	1.56		1.28	2.87	1.17	2.65	2.01	Data removed from PT05 due to instrument issues
25/02/2025 09:00	8.98	1.12	3.14	0.93	1.97	1.68	1.27	1.16	1.57		1.27	2.87	1.17	2.65	2.01	Data removed from PT05 due to instrument issues
25/02/2025 09:15	8.98	1.12	3.14	0.93	1.96	1.68	1.28	1.17	1.57		1.27	2.87	1.17	2.66	2.01	Data removed from PT05 due to instrument issues
25/02/2025 09:30	8.98	1.11	3.14	0.93	1.96	1.68	1.27	1.16	1.56		1.27	2.88	1.17	2.66	2.00	Data removed from PT05 due to instrument issues
25/02/2025 09:45	8.98	1.11	3.14	0.93	1.96	1.68	1.27	1.16	1.56		1.27	2.87	1.17	2.67	2.01	Data removed from PT05 due to instrument issues
25/02/2025 10:00	8.98	1.11	3.13	0.93	1.96	1.68	1.27	1.16	1.56		1.27	2.87	1.17	2.67	2.01	Data removed from PT05 due to instrument issues
25/02/2025 10:15	8.97	1.11	3.14	0.92	1.96	1.68	1.27	1.16	1.55		1.26	2.87	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
25/02/2025 10:30	8.97	1.11	3.13	0.91	1.96	1.67	1.26	1.16	1.55		1.26	2.87	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
25/02/2025 10:45	8.97	1.11	3.14	0.90	1.96	1.67	1.26	1.16	1.55		1.26	2.87	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
25/02/2025 11:00	8.97	1.11	3.13	0.89	1.95	1.67	1.26	1.16	1.55		1.26	2.87	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
25/02/2025 11:15	8.96	1.10	3.13	0.88	1.95	1.67	1.26	1.16	1.55		1.26	2.87	1.15	2.68	2.00	Data removed from PT05 due to instrument issues
25/02/2025 11:30	8.96	1.11	3.13	0.87	1.95	1.67	1.26	1.15	1.55		1.26	2.87	1.16	2.68	2.00	Data removed from PT05 due to instrument issues
25/02/2025 11:45	8.96	1.11	3.13	0.86	1.95	1.67	1.26	1.15	1.54		1.26	2.87	1.16	2.69	2.00	Data removed from PT05 due to instrument issues
25/02/2025 12:00	8.96	1.11	3.13	0.85	1.95	1.67	1.26	1.16	1.54		1.26	2.87	1.15	2.69	2.00	Data removed from PT05 due to instrument issues
25/02/2025 12:15	8.97	1.11	3.14	0.83	1.96	1.68	1.27	1.16	1.55		1.26	2.87	1.16	2.70	2.00	Data removed from PT05 due to instrument issues
25/02/2025 12:30	8.96	1.11	3.13	0.82	1.95	1.67	1.26	1.16	1.55		1.26	2.86	1.15	2.68	2.00	Data removed from PT05 due to instrument issues
25/02/2025 12:45	8.97	1.11	3.13	0.81	1.95	1.67		1.15	1.55		1.26	2.86	1.16	2.69	2.00	Data removed from PT05 due to instrument issues
25/02/2025 13:00	8.97	1.11	3.13	0.80	1.96	1.66	1.27	1.15	1.55		1.26	2.87	1.16	2.68	2.00	Data removed from PT05 due to instrument issues
25/02/2025 13:15	8.96	1.11	3.13	0.78	1.95	1.66	1.26	1.14	1.55		1.26	2.87	1.16	2.68	2.00	Data removed from PT05 due to instrument issues
25/02/2025 13:30	8.96	1.11	3.13	0.76	1.95	1.66	1.26	1.15	1.55		1.26	2.87	1.16	2.68	2.00	Data removed from PT05 due to instrument issues
25/02/2025 13:45	8.97	1.11	3.13	0.75	1.95	1.66	1.26	1.15	1.55		1.26	2.87	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
25/02/2025 14:00	8.96	1.11	3.14	0.74	1.96	1.66	1.26	1.15	1.55		1.26	2.87	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
25/02/2025 14:15	8.96	1.11	3.14	0.72	1.95	1.66	1.26	1.14	1.57		1.26	2.86	1.15	2.66	2.00	Data removed from PT05 due to instrument issues
25/02/2025 14:30	8.96	1.11	3.13	0.71	1.96	1.66	1.26	1.15	1.55		1.26	2.87	1.16	2.66	2.00	Data removed from PT05 due to instrument issues
25/02/2025 14:45	8.97	1.11	3.14	0.71	1.96	1.66	1.26	1.15	1.56		1.27	2.88	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
25/02/2025 15:00	8.97	1.11	3.13	0.70	1.96	1.66	1.26	1.14	1.56		1.26	2.87	1.15	2.66	2.00	Data removed from PT05 due to instrument issues
25/02/2025 15:15	8.97	1.11	3.14	0.70	1.96	1.67	1.27	1.15	1.57		1.27	2.88	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
25/02/2025 15:30	8.97	1.11	3.14	0.69	1.96	1.67	1.27	1.15	1.57		1.27	2.88	1.16	2.66	2.01	Data removed from PT05 due to instrument issues
25/02/2025 15:45	8.98	1.11	3.14	0.69	1.96	1.67	1.27	1.15	1.57		1.28	2.88	1.16	2.66	2.01	Data removed from PT05 due to instrument issues
25/02/2025 16:00	8.98	1.12	3.14	0.70	1.97	1.67	1.27	1.15	1.58		1.27	2.88	1.17	2.66	2.01	Data removed from PT05 due to instrument issues
25/02/2025 16:15	8.97	1.12	3.14	0.70	1.96	1.67	1.27	1.15	1.57		1.28	2.88	1.16	2.66	2.01	Data removed from PT05 due to instrument issues
25/02/2025 16:30	8.97	1.11	3.14	0.70	1.96	1.67	1.27	1.16	1.57		1.27	2.88	1.16	2.66	2.01	Data removed from PT05 due to instrument issues
25/02/2025 16:45	8.97	1.11	3.13	0.71	1.96	1.66	1.26	1.15	1.56		1.27	2.87	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
25/02/2025 17:00	8.97	1.11	3.14	0.72	1.96	1.66	1.27	1.15	1.57		1.27	2.88	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
25/02/2025 17:15	8.97	1.11	3.13	0.72	1.96	1.66	1.26	1.15	1.57		1.26	2.87	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
25/02/2025 17:30	8.97	1.11	3.14	0.73	1.96	1.66	1.26	1.16	1.56		1.27	2.88	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
25/02/2025 17:45	8.97	1.11	3.14	0.74	1.95	1.66	1.26	1.15	1.56		1.27	2.88	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
25/02/2025 18:00	8.97	1.11	3.14	0.75	1.96	1.66	1.26	1.15	1.56		1.27	2.88	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
25/02/2025 18:15	8.97	1.11	3.14	0.76	1.96	1.66	1.26	1.15	1.55		1.27	2.88	1.16	2.66	2.00	Data removed from PT05 due to instrument issues
25/02/2025 18:30	8.97	1.11	3.13	0.78	1.95	1.66	1.26	1.15	1.56		1.27	2.88	1.16	2.66	2.00	Data removed from PT05 due to instrument issues
25/02/2025 18:45	8.97	1.11	3.14	0.79	1.95	1.66	1.26	1.15	1.57		1.26	2.87	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
25/02/2025 19:00	8.97	1.11	3.14	0.80	1.96	1.66	1.26	1.15	1.56		1.27	2.88	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
25/02/2025 19:15	8.97	1.11	3.14	0.81	1.96	1.66	1.26	1.15	1.56		1.27	2.87	1.16	2.68	2.00	Data removed from PT05 due to instrument issues
25/02/2025 19:30	8.97	1.11	3.14	0.82	1.95	1.67	1.27	1.15	1.56		1.26	2.87	1.16	2.68	2.00	Data removed from PT05 due to instrument issues
25/02/2025 19:45	8.97	1.11	3.14	0.83	1.96	1.66	1.27	1.15	1.55		1.27	2.87	1.16	2.68	2.00	Data removed from PT05 due to instrument issues
25/02/2025 20:00	8.97	1.11	3.14	0.84	1.96	1.66	1.27	1.15	1.56		1.27	2.87	1.16	2.69	2.00	Data removed from PT05 due to instrument issues
25/02/2025 20:15	8.97	1.11	3.14	0.85	1.95	1.66	1.26	1.15	1.55		1.27	2.87	1.16	2.69	2.00	Data removed from PT05 due to instrument issues
25/02/2025 20:30	8.97	1.11	3.14	0.86	1.95	1.66	1.26	1.15	1.55		1.26	2.87	1.16	2.69	2.00	Data removed from PT05 due to instrument issues
25/02/2025 20:45	8.97	1.11	3.14	0.87	1.95	1.66	1.27	1.15	1.56		1.26	2.87	1.16	2.69	2.00	Data removed from PT05 due to instrument issues
25/02/2025 21:00	8.97	1.11	3.13	0.88	1.95	1.66	1.27	1.15	1.56		1.26	2.88	1.16	2.70	2.00	Data removed from PT05 due to instrument issues
25/02/2025 21:15	8.97	1.11	3.14	0.88	1.95	1.66	1.27	1.15	1.56		1.26	2.87	1.16	2.70	2.00	Data removed from PT05 due to instrument issues
25/02/2025 21:30	8.97	1.11	3.14	0.89	1.95	1.66	1.27	1.15	1.55		1.27	2.87	1.16	2.70	2.00	Data removed from PT05 due to instrument issues
25/02/2025 21:45	8.97	1.11	3.14	0.89	1.95	1.66	1.27	1.15	1.55		1.27	2.87	1.16	2.70	2.00	Data removed from PT05 due to instrument issues
25/02/2025 22:00	8.97	1.11	3.14	0.89	1.96	1.66	1.27	1.15	1.56		1.27	2.87	1.16	2.71	2.00	Data removed from PT05 due to instrument issues
25/02/2025 22:15	8.97	1.11	3.14	0.89	1.95	1.66	1.26	1.15	1.56		1.27	2.87	1.16	2.71	2.00	Data removed from PT05 due to instrument issues
25/02/2025 22:30	8.97	1.11	3.14	0.89	1.96	1.66	1.27	1.15	1.57		1.27	2.87	1.16	2.71	2.00	Data removed from PT05 due to instrument issues
25/02/2025 22:45	8.97	1.11	3.13	0.88	1.95	1.66	1.26	1.15	1.56		1.26	2.87	1.16	2.71	2.00	Data removed from PT05 due to instrument issues
25/02/2025 23:00	8.97	1.11	3.13	0.88	1.95	1.66	1.26	1.15	1.55		1.26	2.87	1.16	2.71	2.00	Data removed from PT05 due to instrument issues
25/02/2025 23:15	8.97	1.11	3.13	0.86	1.95	1.66	1.26	1.15	1.56		1.26	2.87	1.15	2.71	2.00	Data removed from PT05 due to instrument issues
25/02/2025 23:30	8.97	1.11	3.13	0.85	1.95	1.66	1.27	1.15	1.56		1.26	2.87	1.15	2.71	2.00	Data removed from PT05 due to instrument issues

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
25/02/2025 23:45	8.97	1.11	3.13	0.84	1.95	1.66	1.27	1.15	1.56		1.26	2.87	1.16	2.72	2.00	Data removed from PT05 due to instrument issues
26/02/2025 00:00	8.97	1.11	3.13	0.83	1.96	1.66	1.26	1.15	1.55		1.26	2.87	1.16	2.72	2.00	Data removed from PT05 due to instrument issues
26/02/2025 00:15	8.97	1.11	3.13	0.81	1.95	1.66	1.26	1.15	1.56		1.26	2.87	1.16	2.71	2.00	Data removed from PT05 due to instrument issues
26/02/2025 00:30	8.97	1.11	3.13	0.80	1.95	1.66	1.26	1.15	1.55		1.26	2.87	1.16	2.70	2.00	Data removed from PT05 due to instrument issues
26/02/2025 00:45	8.97	1.11	3.13	0.78	1.95	1.66	1.27	1.15	1.56		1.26	2.87	1.16	2.70	2.00	Data removed from PT05 due to instrument issues
26/02/2025 01:00	8.97	1.11	3.13	0.77	1.96	1.66	1.26	1.15	1.56		1.27	2.87	1.16	2.70	2.00	Data removed from PT05 due to instrument issues
26/02/2025 01:15	8.97	1.11	3.13	0.75	1.96	1.67	1.27	1.15	1.57		1.26	2.87	1.16	2.69	2.00	Data removed from PT05 due to instrument issues
26/02/2025 01:30	8.97	1.11	3.13	0.74	1.96	1.66	1.26	1.15	1.56		1.26	2.87	1.15	2.68	2.00	Data removed from PT05 due to instrument issues
26/02/2025 01:45	8.97	1.11	3.13	0.73	1.96	1.66	1.27	1.15	1.55		1.26	2.87	1.16	2.68	2.00	Data removed from PT05 due to instrument issues
26/02/2025 02:00	8.97	1.11	3.13	0.71	1.96	1.66	1.26	1.15	1.57		1.26	2.87	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 02:15	8.97	1.11	3.13	0.70	1.95	1.66	1.26	1.15	1.56		1.26	2.87	1.15	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 02:30	8.97	1.11	3.13	0.69	1.96	1.66	1.26	1.15	1.57		1.26	2.87	1.16	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 02:45	8.97	1.11	3.13	0.68	1.95	1.66	1.26	1.15	1.56		1.26	2.87	1.15	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 03:00	8.97	1.11	3.13	0.67	1.96	1.66	1.26	1.15	1.56		1.27	2.87	1.16	2.66	2.00	Data removed from PT05 due to instrument issues
26/02/2025 03:15	8.97	1.11	3.14	0.66	1.95	1.66	1.27	1.15	1.57		1.26	2.87	1.15	2.66	2.00	Data removed from PT05 due to instrument issues
26/02/2025 03:30	8.97	1.11	3.13	0.65	1.96	1.66	1.25	1.15	1.56		1.26	2.87	1.15	2.66	2.00	Data removed from PT05 due to instrument issues
26/02/2025 03:45	8.97	1.11	3.14	0.65	1.96	1.66	1.26	1.15	1.56		1.26	2.87	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 04:00	8.97	1.11	3.13	0.65	1.96	1.67	1.25	1.15	1.56		1.26	2.87	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 04:15	8.97	1.11	3.13	0.65	1.96	1.66	1.26	1.15	1.57		1.27	2.87	1.15	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 04:30	8.97	1.11	3.14	0.66	1.96	1.66	1.27	1.15	1.57		1.27	2.87	1.15	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 04:45	8.97	1.11	3.13	0.66	1.95	1.66	1.26	1.15	1.56		1.26	2.87	1.15	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 05:00	8.98	1.11	3.13	0.67	1.96	1.67	1.26	1.15	1.56		1.27	2.87	1.16	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 05:15	8.97	1.11	3.13	0.68	1.96	1.67	1.27	1.15	1.56		1.27	2.87	1.15	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 05:30	8.97	1.11	3.13	0.69	1.95	1.66	1.26	1.15	1.57		1.27	2.87	1.15	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 05:45	8.97	1.11	3.13	0.70	1.95	1.66	1.26	1.15	1.56		1.26	2.87	1.15	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 06:00	8.97	1.11	3.13	0.71	1.95	1.66	1.26	1.15	1.57		1.26	2.87	1.16	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 06:15	8.97	1.11	3.13	0.72	1.95	1.66	1.27	1.15	1.55		1.26	2.86	1.15	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 06:30	8.97	1.10	3.13	0.74	1.95	1.66	1.26	1.14	1.56		1.26	2.86	1.15	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 06:45	8.97	1.11	3.13	0.75	1.95	1.66	1.26	1.15	1.56		1.26	2.86	1.15	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 07:00	8.97	1.10	3.13	0.76	1.96	1.66	1.25	1.15	1.55		1.26	2.86	1.15	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 07:15	8.97	1.10	3.13	0.77	1.95	1.66	1.26	1.15	1.54		1.26	2.86	1.15	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 07:30	8.97	1.11	3.13	0.79	1.95	1.66	1.26	1.15	1.56		1.26	2.86	1.15	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 07:45	8.96	1.11	3.13	0.80	1.95	1.66	1.25	1.15	1.56		1.26	2.86	1.14	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 08:00	8.97	1.11	3.13	0.82	1.95	1.66	1.26	1.15	1.57		1.26	2.86	1.15	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 08:15	8.97	1.11	3.13	0.83	1.95	1.66	1.26	1.15	1.55		1.26	2.86	1.15	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 08:30	8.97	1.11	3.13	0.84	1.95	1.66	1.26	1.15	1.56		1.27	2.86	1.15	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 08:45	8.96	1.11	3.13	0.85	1.95	1.66	1.26	1.15	1.56		1.26	2.86	1.14	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 09:00	8.96		3.13	0.86	1.95	1.66	1.26	1.15	1.56		1.27	2.86	1.15	2.66	2.00	Data removed from PT05 due to instrument issues
26/02/2025 09:15	8.96	1.09	3.13	0.87	1.95	1.66	1.26	1.14	1.55		1.26	2.86	1.14	2.66	2.00	Data removed from PT05 due to instrument issues
26/02/2025 09:30	8.96	1.09	3.13	0.88	1.95	1.66	1.26	1.15	1.56		1.27	2.86	1.14	2.66	2.00	Data removed from PT05 due to instrument issues
26/02/2025 09:45	8.97	1.09	3.13	0.88	1.96	1.67	1.27	1.15	1.56		1.27	2.86	1.15	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 10:00	8.97	1.10	3.13	0.89	1.96	1.67	1.26	1.15	1.56		1.26	2.86	1.15	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 10:15	8.97	1.09	3.13	0.90	1.95	1.66	1.26	1.15	1.56		1.27	2.86	1.15	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 10:30	8.96	1.09	3.12	0.90	1.95	1.66	1.25	1.15	1.56		1.26	2.85	1.15	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 10:45	8.96	1.09	3.13	0.90	1.95	1.66	1.26	1.17	1.57		1.27	2.85	1.14	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 11:00	8.97	1.09	3.12	0.90	1.96	1.66	1.26	1.15	1.55		1.26	2.85	1.15	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 11:15	8.97	1.09	3.13	0.89	1.95	1.66	1.26	1.14	1.55		1.27	2.85	1.15	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 11:30	8.97	1.09	3.13	0.88	1.96	1.67	1.26	1.16	1.57		1.27	2.86	1.15	2.68	2.00	Data removed from PT05 due to instrument issues
26/02/2025 11:45	8.97	1.09	3.13	0.87	1.96	1.67	1.27	1.15	1.56		1.27	2.86	1.15	2.68	2.00	Data removed from PT05 due to instrument issues
26/02/2025 12:00	8.97	1.09	3.13	0.86	1.97	1.67	1.26	1.15	1.57		1.27	2.85	1.15	2.68	2.00	Data removed from PT05 due to instrument issues
26/02/2025 12:15	8.97	1.10	3.13	0.85	1.96	1.67	1.26	1.15	1.57		1.27	2.86	1.15	2.68	2.00	Data removed from PT05 due to instrument issues
26/02/2025 12:30	8.97	1.09	3.13	0.83	1.96	1.67	1.26	1.15	1.57		1.27	2.86	1.14	2.68	2.00	Data removed from PT05 due to instrument issues
26/02/2025 12:45	8.97	1.09	3.13	0.81	1.96	1.67	1.26	1.14	1.56		1.27	2.86	1.15	2.68	2.00	Data removed from PT05 due to instrument issues
26/02/2025 13:00	8.97	1.09	3.13	0.80	1.96	1.67		1.14	1.57		1.27	2.85	1.15	2.67	2.00	Data removed from PT05 due to instrument issues
26/02/2025 13:15	8.97	1.09	3.12	0.79	1.96	1.67	1.27	1.14	1.56		1.27	2.86	1.15	2.66	2.00	Data removed from PT05 due to instrument issues
26/02/2025 13:30	8.97	1.09	3.13	0.77	1.97	1.67	1.28	1.14	1.56		1.27	2.86	1.15	2.66	2.00	Data removed from PT05 due to instrument issues
26/02/2025 13:45	8.97	1.10	3.13	0.76	1.97	1.67	1.28	1.14	1.56		1.27	2.86	1.15	2.66	2.01	Data removed from PT05 due to instrument issues
26/02/2025 14:00	8.97	1.10	3.13	0.75	1.97	1.68	1.29	1.14	1.55		1.27	2.86	1.15	2.65	2.01	Data removed from PT05 due to instrument issues
26/02/2025 14:15	8.97	1.10	3.13	0.73	1.97	1.68	1.28	1.14	1.56		1.28	2.86	1.15	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 14:30	8.98	1.10	3.13	0.72	1.97	1.68	1.28	1.15	1.55		1.28	2.86	1.15	2.65	2.01	Data removed from PT05 due to instrument issues
26/02/2025 14:45	8.97	1.10	3.13	0.71	1.98	1.68	1.28	1.15	1.56		1.28	2.87	1.16	2.64	2.01	Data removed from PT05 due to instrument issues
26/02/2025 15:00	8.97	1.10	3.13	0.70	1.97	1.67	1.28	1.14	1.55		1.27	2.87	1.16	2.64	2.01	Data removed from PT05 due to instrument issues
26/02/2025 15:15	8.97	1.10	3.13	0.68	1.96	1.67	1.28	1.14	1.55		1.28	2.87	1.16	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 15:30	8.98	1.10	3.14	0.67	1.97	1.67	1.29	1.15	1.55		1.28	2.86	1.16	2.64	2.01	Data removed from PT05 due to instrument issues
26/02/2025 15:45	8.97	1.09	3.13	0.66	1.96	1.66	1.27	1.14	1.55		1.27	2.87	1.16	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 16:00	8.97	1.09	3.13	0.66	1.96	1.66	1.27	1.14	1.55		1.28	2.87	1.16	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 16:15	8.97	1.09	3.13	0.65	1.96	1.66	1.27	1.14	1.56		1.27	2.86	1.16	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 16:30	8.97	1.10	3.13	0.66	1.96	1.66	1.27	1.14	1.54		1.28	2.86	1.16	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 16:45	8.97	1.09	3.13	0.66	1.96	1.66	1.27	1.14	1.55		1.27	2.86	1.15	2.62	2.00	Data removed from PT05 due to instrument issues
26/02/2025 17:00	8.97	1.09	3.13	0.67	1.96	1.66	1.28	1.14	1.54		1.28	2.87	1.16	2.62	2.00	Data removed from PT05 due to instrument issues
26/02/2025 17:15	8.97	1.09	3.13	0.67	1.96	1.66	1.28	1.14	1.54		1.27	2.87	1.15	2.62	2.00	Data removed from PT05 due to instrument issues
26/02/2025 17:30	8.98	1.10	3.13	0.69	1.96	1.66	1.28	1.14	1.54		1.28	2.87	1.16	2.61	2.00	Data removed from PT05 due to instrument issues
26/02/2025 17:45	8.97	1.09	3.13	0.69	1.96	1.66	1.28	1.14	1.55		1.26	2.87	1.16	2.61	2.00	Data removed from PT05 due to instrument issues
26/02/2025 18:00	8.97	1.09	3.13	0.70	1.96	1.66	1.28	1.14	1.54		1.26	2.87	1.16	2.60	2.00	Data removed from PT05 due to instrument issues
26/02/2025 18:15	8.97	1.09	3.13	0.72	1.96	1.66	1.28	1.14	1.55		1.27	2.87	1.16	2.61	2.00	Data removed from PT05 due to instrument issues
26/02/2025 18:30	8.97	1.09	3.13	0.73	1.96	1.66	1.29	1.14	1.54		1.28	2.88	1.16	2.61	2.00	Data removed from PT05 due to instrument issues
26/02/2025 18:45	8.98	1.10	3.14	0.74	1.96	1.67	1.28	1.14	1.55		1.27	2.88	1.16	2.61	2.00	Data removed from PT05 due to instrument issues
26/02/2025 19:00	8.97	1.10	3.13	0.75	1.96	1.67	1.28	1.14	1.55		1.27	2.88	1.17	2.62	2.00	Data removed from PT05 due to instrument issues
26/02/2025 19:15	8.97	1.09	3.13	0.76	1.96	1.66	1.27	1.14	1.55		1.27	2.87	1.16	2.62	2.00	Data removed from PT05 due to instrument issues
26/02/2025 19:30	8.97	1.09	3.13	0.78	1.96	1.66	1.28	1.14	1.55		1.27	2.88	1.17	2.62	2.00	Data removed from PT05 due to instrument issues
26/02/2025 19:45	8.98	1.10	3.13	0.79	1.96	1.67	1.28	1.14	1.55		1.27	2.88	1.17	2.62	2.00	Data removed from PT05 due to instrument issues
26/02/2025 20:00	8.98	1.09	3.13	0.81	1.96	1.66	1.28	1.14	1.55		1.28	2.88	1.17	2.62	2.00	Data removed from PT05 due to instrument issues
26/02/2025 20:15	8.97	1.10	3.13	0.82	1.96	1.66	1.28	1.14	1.55		1.28	2.88	1.17	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 20:30	8.98	1.10	3.13	0.83	1.96	1.66	1.28	1.14	1.54		1.27	2.88	1.16	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 20:45	8.98	1.10	3.14	0.84	1.96	1.66	1.28	1.14	1.55		1.28	2.88	1.17	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 21:00	8.98	1.10	3.13	0.85	1.96	1.66	1.28	1.15	1.55		1.28	2.88	1.17	2.63	2.00	Data removed from PT05 due to instrument issues
26/02/2025 21:15	8.97	1.10	3.14	0.86	1.96	1.66	1.28	1.14	1.56		1.27	2.88	1.17	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 21:30	8.98	1.11	3.14	0.87	1.96	1.67	1.29	1.15	1.55		1.28	2.88	1.17	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 21:45	8.98	1.11	3.13	0.88	1.96	1.66	1.28	1.15	1.55		1.28	2.88	1.17	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 22:00	8.98	1.11	3.14	0.89	1.96	1.66	1.28	1.15	1.55		1.28	2.88	1.17	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 22:15	8.98	1.11	3.14	0.89	1.96	1.66	1.29	1.15	1.55		1.28	2.88	1.17	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 22:30	8.97	1.10	3.13	0.89	1.96	1.66	1.28	1.14	1.54		1.27	2.88	1.17	2.64	2.00	Data removed from PT05 due to instrument issues
26/02/2025 22:45	8.98	1.10	3.14	0.89	1.96	1.67	1.28	1.15	1.56		1.28	2.88	1.17	2.65	2.00	Data removed from PT05 due to instrument issues
26/02/2025 23:00	8.98	1.10	3.14	0.89	1.96	1.67	1.28	1.15	1.55		1.28	2.88	1.18	2.66	2.01	Data removed from PT05 due to instrument issues
26/02/2025 23:15	8.98	1.10	3.14	0.89	1.96	1.67	1.28	1.15	1.55		1.28	2.89	1.17	2.66	2.00	Data removed from PT05 due to instrument issues
26/02/2025 23:30	8.98	1.10	3.14	0.89	1.96	1.67	1.29	1.15	1.55		1.28	2.88	1.17	2.66	2.01	Data removed from PT05 due to instrument issues
26/02/2025 23:45	8.98	1.10	3.14	0.88	1.96	1.67	1.28	1.15	1.56		1.28	2.88	1.17	2.66	2.00	Data removed from PT05 due to instrument issues
27/02/2025 00:00	8.98	1.11	3.14	0.87	1.96	1.67	1.28	1.15	1.54		1.28	2.88	1.17	2.66	2.00	Data removed from PT05 due to instrument issues
27/02/2025 00:15	8.98	1.11	3.14	0.85	1.96	1.66	1.29	1.14	1.55		1.29	2.88	1.17	2.66	2.00	Data removed from PT05 due to instrument issues
27/02/2025 00:30	8.98	1.11	3.14	0.84	1.96	1.67	1.29	1.15	1.56		1.28	2.88	1.17	2.66	2.00	Data removed from PT05 due to instrument issues
27/02/2025 00:45	8.98	1.11	3.14	0.82	1.96	1.67	1.29	1.15	1.55		1.28	2.88	1.18	2.66	2.00	Data removed from PT05 due to instrument issues
27/02/2025 01:00	8.98	1.11	3.14	0.81	1.96	1.67	1.29	1.15	1.55		1.28	2.89	1.18	2.65	2.01	Data removed from PT05 due to instrument issues
27/02/2025 01:15	8.98	1.10	3.14	0.78	1.96	1.67	1.28	1.15	1.55		1.28	2.88	1.17	2.64	2.00	Data removed from PT05 due to instrument issues
27/02/2025 01:30	8.98	1.11	3.14	0.77	1.96	1.67	1.29	1.15	1.55		1.28	2.88	1.18	2.64	2.01	Data removed from PT05 due to instrument issues
27/02/2025 01:45	8.98	1.11	3.14	0.76	1.96	1.67	1.29	1.15	1.56		1.28	2.89	1.18	2.64	2.01	Data removed from PT05 due to instrument issues
27/02/2025 02:00	8.98	1.11	3.14	0.74	1.96	1.67	1.28	1.15	1.55		1.28	2.88	1.18	2.63	2.01	Data removed from PT05 due to instrument issues
27/02/2025 02:15	8.98	1.11	3.14	0.73	1.96	1.67	1.29	1.15	1.55		1.28	2.88	1.17	2.63	2.00	Data removed from PT05 due to instrument issues
27/02/2025 02:30	8.99	1.11	3.14	0.71	1.96	1.67	1.29	1.15	1.56		1.28	2.88	1.17	2.62	2.00	Data removed from PT05 due to instrument issues
27/02/2025 02:45	8.99	1.11	3.14	0.70	1.96	1.67	1.28	1.15	1.56		1.28	2.88	1.18	2.62	2.01	Data removed from PT05 due to instrument issues
27/02/2025 03:00	8.98	1.11	3.14	0.68	1.97	1.67	1.28	1.15	1.55		1.28	2.89	1.18	2.62	2.01	Data removed from PT05 due to instrument issues
27/02/2025 03:15	8.98	1.11	3.14	0.67	1.96	1.67	1.29	1.15	1.55		1.28	2.88	1.17	2.61	2.01	Data removed from PT05 due to instrument issues
27/02/2025 03:30	8.98	1.11	3.15	0.66	1.96	1.67	1.28	1.15	1.56		1.29	2.88	1.17	2.61	2.01	Data removed from PT05 due to instrument issues
27/02/2025 03:45	8.98	1.11	3.14	0.65	1.96	1.67	1.28	1.15	1.54		1.28	2.88	1.17	2.61	2.00	Data removed from PT05 due to instrument issues
27/02/2025 04:00	8.98	1.11	3.14	0.64	1.96	1.66	1.28	1.15	1.54		1.28	2.88	1.17	2.60	2.00	Data removed from PT05 due to instrument issues
27/02/2025 04:15	8.98	1.11	3.14	0.63	1.96	1.67	1.29	1.15	1.55		1.28	2.88	1.17	2.60	2.00	Data removed from PT05 due to instrument issues
27/02/2025 04:30	8.98	1.11	3.14	0.63	1.96	1.67	1.28	1.15	1.54		1.28	2.88	1.17	2.60	2.00	Data removed from PT05 due to instrument issues
27/02/2025 04:45	8.98	1.11	3.14	0.63	1.96	1.67	1.28	1.15	1.54		1.28	2.88	1.17	2.60	2.01	Data removed from PT05 due to instrument issues
27/02/2025 05:00	8.98	1.11	3.14	0.64	1.97	1.66	1.27	1.15	1.53		1.27	2.88	1.17	2.60	2.00	Data removed from PT05 due to instrument issues
27/02/2025 05:15	8.98	1.11	3.14	0.64	1.96	1.66	1.28	1.15	1.53		1.28	2.88	1.17	2.59	2.00	Data removed from PT05 due to instrument issues
27/02/2025 05:30	8.98	1.11	3.14	0.66	1.96	1.66	1.28	1.15	1.55		1.28	2.88	1.17	2.59	2.00	Data removed from PT05 due to instrument issues
27/02/2025 05:45	8.98	1.11	3.14	0.66	1.96	1.66	1.28	1.14	1.53		1.28	2.88	1.17	2.59	2.00	Data removed from PT05 due to instrument issues
27/02/2025 06:00	8.98	1.11	3.14	0.68	1.96	1.66	1.28	1.14	1.55		1.28	2.88	1.17	2.58	2.00	Data removed from PT05 due to instrument issues
27/02/2025 06:15	8.98	1.11	3.14	0.69	1.96	1.66	1.28	1.14	1.54		1.28	2.88	1.17	2.58	2.00	Data removed from PT05 due to instrument issues
27/02/2025 06:30	8.98	1.11	3.14	0.70	1.96	1.66	1.29	1.15	1.53		1.28	2.87	1.17	2.58	2.00	Data removed from PT05 due to instrument issues
27/02/2025 06:45	8.98	1.10	3.14	0.71	1.96	1.66	1.29	1.14	1.54		1.28	2.87	1.16	2.58	2.00	Data removed from PT05 due to instrument issues
27/02/2025 07:00	8.98	1.11	3.14	0.73	1.96	1.66	1.28	1.14	1.53		1.28	2.88	1.17	2.58	2.00	Data removed from PT05 due to instrument issues
27/02/2025 07:15	8.98	1.11	3.14	0.74	1.96	1.66	1.28	1.15	1.54		1.28	2.87	1.17	2.59	2.00	Data removed from PT05 due to instrument issues
27/02/2025 07:30	8.98	1.11	3.14	0.76	1.95	1.66	1.28	1.14	1.53		1.28	2.88	1.17	2.59	2.00	Data removed from PT05 due to instrument issues
27/02/2025 07:45	8.98	1.11	3.14	0.77	1.95	1.66	1.29	1.14	1.53		1.27	2.87	1.17	2.59	2.00	Data removed from PT05 due to instrument issues

Appendix C: Diver Water Level Data

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
27/02/2025 08:00	8.98	1.10	3.13	0.78	1.96	1.65	1.28	1.14	1.53		1.28	2.87	1.17	2.59	2.00	Data removed from PT05 due to instrument issues
27/02/2025 08:15	8.98	1.11	3.13	0.80	1.95	1.66	1.29	1.13	1.53		1.27	2.87	1.17	2.60	1.99	Data removed from PT05 due to instrument issues
27/02/2025 08:30	8.98	1.11	3.13	0.82	1.95	1.66	1.28	1.14	1.54		1.27	2.87	1.16	2.60	2.00	Data removed from PT05 due to instrument issues
27/02/2025 08:45	8.98	1.11	3.14	0.83	1.95	1.66	1.28	1.15	1.53		1.28	2.88	1.17	2.61	2.00	Data removed from PT05 due to instrument issues
27/02/2025 09:00	8.98	1.11	3.13	0.84	1.96	1.66	1.28	1.14	1.54		1.26	2.87	1.16	2.61	2.00	Data removed from PT05 due to instrument issues
27/02/2025 09:15	8.98	1.08	3.13	0.86	1.95	1.66	1.28	1.14	1.53		1.26	2.87	1.16	2.61	2.00	Data removed from PT05 due to instrument issues
27/02/2025 09:30	8.98	1.08	3.13	0.87	1.95	1.65	1.27	1.14	1.53		1.26	2.87	1.16	2.61	2.00	Data removed from PT05 due to instrument issues
27/02/2025 09:45	8.98	1.09	3.14	0.88	1.95	1.66	1.27	1.14	1.54		1.26	2.87	1.16	2.62	2.00	Data removed from PT05 due to instrument issues
27/02/2025 10:00	8.98	1.09	3.13	0.90	1.95	1.66	1.28	1.14	1.53		1.26	2.87	1.16	2.62	2.00	Data removed from PT05 due to instrument issues
27/02/2025 10:15	8.98	1.09	3.13	0.90	1.95	1.66	1.28	1.14	1.54		1.26	2.87	1.16	2.62	2.00	Data removed from PT05 due to instrument issues
27/02/2025 10:30	8.98	1.08	3.13	0.91	1.95	1.66	1.28	1.14	1.53		1.27	2.87	1.15	2.63	2.00	Data removed from PT05 due to instrument issues
27/02/2025 10:45	8.98	1.09	3.13	0.92	1.95	1.65	1.27	1.14	1.54		1.26	2.87	1.15	2.63	2.00	Data removed from PT05 due to instrument issues
27/02/2025 11:00	8.98	1.09	3.13	0.93	1.95	1.66	1.27	1.14	1.54		1.26	2.87	1.16	2.63	2.00	Data removed from PT05 due to instrument issues
27/02/2025 11:15	8.98	1.09	3.13	0.93		1.66	1.28	1.14	1.53		1.26	2.87	1.16	2.63	2.00	Data removed from PT05 due to instrument issues
27/02/2025 11:30	8.97	1.09	3.14	0.94	1.95	1.66	1.28	1.14	1.54		1.26	2.87	1.15	2.63	2.00	Data removed from PT05 due to instrument issues
27/02/2025 11:45	8.96	1.08	3.13	0.92	1.95	1.66	1.27	1.14	1.53		1.25	2.86	1.16	2.63	2.00	Data removed from PT05 due to instrument issues
27/02/2025 12:00	8.96	1.08	3.13	0.92	1.95	1.66	1.28	1.14	1.53		1.25	2.87	1.16	2.64	2.00	Data removed from PT05 due to instrument issues
27/02/2025 12:15	8.97	1.08	3.14	0.91	1.95	1.66	1.28	1.14	1.54		1.26	2.87	1.16	2.64	2.00	Data removed from PT05 due to instrument issues
27/02/2025 12:30	8.97	1.08	3.13	0.90	1.95	1.66	1.28	1.15	1.53		1.26	2.87	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
27/02/2025 12:45	8.97	1.09	3.13	0.89	1.95	1.66	1.28	1.16	1.54		1.26	2.86	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
27/02/2025 13:00	8.97	1.08	3.13	0.87	1.95	1.66	1.27	1.15	1.53		1.25	2.87	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
27/02/2025 13:15	8.97	1.08	3.13	0.86	1.95	1.67	1.27	1.15	1.51		1.26	2.87	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
27/02/2025 13:30	8.97	1.09	3.13	0.84	1.95	1.67	1.27	1.15	1.51		1.25	2.87	1.16	2.65	2.00	Data removed from PT05 due to instrument issues
27/02/2025 13:45	8.96	1.08	3.13	0.82	1.95	1.67	1.26	1.15	1.52		1.26	2.87	1.15	2.64	2.00	Data removed from PT05 due to instrument issues
27/02/2025 14:00	8.97	1.08	3.13	0.81	1.95	1.67	1.27	1.15	1.52	1.00	1.25	2.87	1.15	2.64	2.00	
27/02/2025 14:15	8.97	1.09	3.14	0.80	1.95	1.67	1.27	1.16	1.51	1.01	1.26	2.87	1.15	2.64	2.00	
27/02/2025 14:30	8.97	1.09	3.14	0.78	1.95	1.67	1.27	1.17	1.52	1.01	1.26	2.87	1.16	2.64	2.00	
27/02/2025 14:45	8.98	1.09	3.14	0.76	1.96	1.68	1.27	1.16	1.52	1.01	1.27	2.87	1.16	2.63	2.01	
27/02/2025 15:00	8.97	1.09	3.13	0.75	1.96	1.68	1.27	1.16	1.52	1.00	1.26	2.87	1.16	2.63	2.00	
27/02/2025 15:15	8.97	1.09	3.14	0.73	1.95	1.68	1.27	1.16	1.52	1.00	1.26	2.87	1.16	2.63	2.00	
27/02/2025 15:30	8.97	1.09	3.14	0.72	1.95	1.67	1.27	1.18	1.52	1.01	1.26	2.87	1.16	2.62	2.01	
27/02/2025 15:45	8.97	1.09	3.14	0.71	1.96	1.67	1.27	1.17	1.52	1.01	1.26	2.87	1.16	2.62	2.00	
27/02/2025 16:00	8.97	1.09	3.14	0.71	1.96	1.68	1.27	1.17	1.52	1.01	1.26	2.88	1.17	2.62	2.01	
27/02/2025 16:15	8.97	1.08	3.13	0.69	1.95	1.67	1.28	1.16	1.52	1.00	1.26	2.87	1.16	2.61	2.00	
27/02/2025 16:30	8.97	1.09	3.13	0.68	1.95	1.67	1.27	1.16	1.51	0.99	1.26	2.87	1.15	2.60	2.00	
27/02/2025 16:45	8.97	1.09	3.13	0.68	1.95	1.67	1.28	1.16	1.53	1.00	1.26	2.87	1.15	2.60	2.00	
27/02/2025 17:00	8.97	1.09	3.13	0.68	1.95	1.67	1.27	1.15	1.51	1.00	1.26	2.87	1.16	2.60	2.00	
27/02/2025 17:15	8.96	1.08	3.13	0.68	1.95	1.67	1.27	1.15	1.52	1.00	1.26	2.87	1.15	2.59	2.00	
27/02/2025 17:30	8.97	1.09	3.13	0.69	1.95	1.67	1.27	1.15	1.50	0.99	1.26	2.87	1.15	2.59	2.00	
27/02/2025 17:45	8.97	1.08	3.13	0.71	1.94	1.67	1.27	1.15	1.51	1.00	1.26	2.87	1.16	2.59	2.00	
27/02/2025 18:00	8.97	1.08	3.13	0.71	1.95	1.66	1.26	1.15	1.51	0.99	1.26	2.87	1.15	2.59	2.00	
27/02/2025 18:15	8.97	1.08	3.13	0.73	1.95	1.67	1.27	1.15	1.51	0.99	1.26	2.87	1.15	2.59	2.00	
27/02/2025 18:30	8.97	1.08	3.13	0.74	1.95	1.66	1.26	1.15	1.53	0.98	1.26	2.87	1.15	2.59	2.00	
27/02/2025 18:45	8.96	1.09	3.13	0.75	1.95	1.67	1.27	1.15	1.51	0.99	1.26	2.87	1.15	2.59	2.00	
27/02/2025 19:00	8.97	1.08	3.13	0.76	1.95	1.67	1.27	1.15	1.51	0.99	1.26	2.87	1.15	2.60	2.00	
27/02/2025 19:15	8.97	1.09	3.13	0.78	1.95	1.67	1.26	1.15	1.53	0.99	1.26	2.87	1.15	2.60	2.00	
27/02/2025 19:30	8.97	1.08	3.13	0.79	1.95	1.67	1.27	1.16	1.50	0.99	1.26	2.87	1.15	2.60	2.00	
27/02/2025 19:45	8.97	1.08	3.13	0.81	1.95	1.67	1.26	1.16	1.52	0.99	1.26	2.87	1.15	2.60	2.00	
27/02/2025 20:00	8.97	1.08	3.13	0.82	1.95	1.67	1.27	1.15	1.53	0.99	1.26	2.87	1.15	2.61	2.00	
27/02/2025 20:15	8.97	1.08	3.13	0.83	1.95	1.67	1.27	1.15	1.50	0.99	1.26	2.87	1.15	2.61	2.00	
27/02/2025 20:30	8.97	1.09	3.13	0.85	1.95	1.67	1.27	1.16	1.51	0.98	1.26	2.87	1.15	2.62	2.00	
27/02/2025 20:45	8.96	1.09	3.13	0.86	1.95	1.67	1.27	1.15	1.51	1.00	1.26	2.87	1.15	2.62	2.00	
27/02/2025 21:00	8.97	1.08	3.13	0.87	1.95	1.67	1.27	1.15	1.52	1.00	1.26	2.87	1.15	2.62	2.00	
27/02/2025 21:15	8.97	1.09	3.13	0.88	1.95	1.67	1.26	1.16	1.50	1.00	1.26	2.87	1.15	2.62	2.00	
27/02/2025 21:30	8.97	1.08	3.13	0.89	1.94	1.67	1.26	1.15	1.51	0.99	1.25	2.86	1.15	2.62	2.00	
27/02/2025 21:45	8.97	1.09	3.13	0.90	1.95	1.67	1.27	1.16	1.51	0.99	1.25	2.87	1.15	2.63	2.00	
27/02/2025 22:00	8.97	1.08	3.13	0.91	1.95	1.67	1.27	1.16	1.52	0.99	1.26	2.87	1.15	2.63	2.00	
27/02/2025 22:15	8.97	1.09	3.13	0.91	1.95	1.67	1.26	1.15	1.52	0.99	1.26	2.86	1.15	2.63	2.00	
27/02/2025 22:30	8.97	1.09	3.13	0.91	1.95	1.67	1.26	1.15	1.52	0.99	1.26	2.87	1.15	2.63	2.00	
27/02/2025 22:45	8.97	1.09	3.13	0.91	1.95	1.67	1.26	1.16	1.52	0.99	1.26	2.87	1.15	2.64	2.00	
27/02/2025 23:00	8.97	1.09	3.13	0.91	1.95	1.67	1.27	1.15	1.51	0.99	1.26	2.87	1.15	2.64	2.00	
27/02/2025 23:15	8.97	1.09	3.13	0.91	1.95	1.67	1.26	1.15	1.52	1.00	1.26	2.87	1.15	2.64	2.00	
27/02/2025 23:30	8.97	1.09	3.13	0.91	1.95	1.67	1.27	1.15	1.52	1.00	1.26	2.87	1.15	2.64	2.00	
27/02/2025 23:45	8.97	1.08	3.13	0.90	1.94	1.67	1.26	1.16	1.52	0.99	1.26	2.86	1.15	2.64	2.00	
28/02/2025 00:00	8.97	1.09	3.13	0.89	1.95	1.67	1.26	1.15	1.52	0.99	1.25	2.87	1.15	2.64	2.00	
28/02/2025 00:15	8.97	1.08	3.13	0.89	1.95	1.67	1.26	1.15	1.52	1.00	1.25	2.87	1.15	2.64	2.00	
28/02/2025 00:30	8.96	1.09	3.13	0.88	1.95	1.67	1.27	1.15	1.51	1.00	1.26	2.86	1.15	2.65	2.00	
28/02/2025 00:45	8.97	1.09	3.13	0.86	1.95	1.67	1.26	1.15	1.52	1.00	1.26	2.87	1.15	2.65	2.00	
28/02/2025 01:00	8.97	1.09	3.13	0.85	1.95	1.67	1.25	1.15	1.53	0.99	1.26	2.87	1.16	2.65	2.00	
28/02/2025 01:15	8.97	1.09	3.13	0.83	1.95	1.67	1.26	1.15	1.52	1.00	1.26	2.87	1.15	2.65	2.00	
28/02/2025 01:30	8.97	1.09	3.13	0.81	1.95	1.67	1.26	1.15	1.53	1.00	1.26	2.87	1.15	2.65	2.00	
28/02/2025 01:45	8.97	1.09	3.13	0.79	1.95	1.67	1.27	1.15	1.52	1.00	1.26	2.87	1.15	2.64	2.00	
28/02/2025 02:00	8.97	1.09	3.13	0.78	1.95	1.67	1.26	1.15	1.51	0.99	1.25	2.87	1.16	2.63	2.00	
28/02/2025 02:15	8.97	1.09	3.13	0.76	1.95	1.67	1.27	1.15	1.52	1.00	1.26	2.87	1.15	2.63	2.00	
28/02/2025 02:30	8.97	1.09	3.14	0.74	1.95	1.68	1.26	1.16	1.52	1.00	1.26	2.87	1.15	2.63	2.00	
28/02/2025 02:45	8.97	1.09	3.13	0.72	1.95	1.67	1.27	1.15	1.51	1.00	1.26	2.87	1.15	2.62	2.00	
28/02/2025 03:00	8.97	1.09	3.13	0.70	1.95	1.67	1.27	1.16	1.51	0.99	1.26	2.87	1.16	2.62	2.00	
28/02/2025 03:15	8.97	1.10	3.14	0.68	1.95	1.68	1.28	1.16	1.52	1.00	1.26	2.87	1.15	2.62	2.00	
28/02/2025 03:30	8.97	1.10	3.14	0.66	1.95	1.68	1.27	1.16	1.53	1.00	1.26	2.87	1.15	2.61	2.01	
28/02/2025 03:45	8.97	1.10	3.14	0.64	1.95	1.68	1.28	1.16	1.52	1.00	1.27	2.87	1.15	2.61	2.00	
28/02/2025 04:00	8.98	1.09	3.13	0.63	1.96	1.68	1.27	1.16	1.53	1.00	1.27	2.87	1.16	2.60	2.01	
28/02/2025 04:15	8.98	1.10	3.14	0.62	1.96	1.68	1.27	1.16	1.52	1.00	1.27	2.87	1.16	2.60	2.01	
28/02/2025 04:30	8.98	1.10	3.14	0.60	1.96	1.68	1.28	1.16	1.52	1.00	1.27	2.87	1.16	2.60	2.01	
28/02/2025 04:45	8.98	1.10	3.14	0.59	1.96	1.68	1.28	1.16	1.53	0.99	1.27	2.87	1.16	2.60	2.01	
28/02/2025 05:00	8.97	1.10	3.13	0.58	1.96	1.68	1.28	1.16	1.52	1.00	1.26	2.87	1.16	2.59	2.01	
28/02/2025 05:15	8.98	1.10	3.14	0.58	1.96	1.68	1.27	1.16	1.52	1.00	1.27	2.87	1.16	2.59	2.01	
28/02/2025 05:30	8.98	1.10	3.13	0.58	1.96	1.68	1.27	1.16	1.53	1.00	1.27	2.87	1.16	2.59	2.01	
28/02/2025 05:45	8.97	1.10	3.13	0.58	1.96	1.68	1.28	1.16	1.52	1.00	1.27	2.87	1.16	2.59	2.01	
28/02/2025 06:00	8.98	1.10	3.13	0.59	1.96	1.68	1.27	1.16	1.52	1.01	1.27	2.87	1.16	2.58	2.01	
28/02/2025 06:15	8.97	1.10	3.13	0.60	1.96	1.68	1.28	1.16	1.52	1.00	1.27	2.87	1.16	2.58	2.01	
28/02/2025 06:30	8.97	1.10	3.14	0.61	1.96	1.68	1.28	1.16	1.54	1.00	1.27	2.87	1.16	2.58	2.01	
28/02/2025 06:45	8.97	1.09	3.13	0.62	1.96	1.68	1.27	1.16	1.52	1.00	1.27	2.87	1.16	2.57	2.01	
28/02/2025 07:00	8.97	1.09	3.13	0.64	1.96	1.67	1.27	1.15	1.52	0.99	1.26	2.87	1.16	2.57	2.00	
28/02/2025 07:15	8.97	1.09	3.13	0.65	1.95	1.67	1.27	1.16	1.53	1.00	1.26	2.87	1.15	2.57	2.00	
28/02/2025 07:30	8.97	1.09	3.13	0.66	1.95	1.67	1.27	1.16	1.51	0.99	1.26	2.87	1.15	2.56	2.00	
28/02/2025 07:45	8.97	1.09	3.13	0.68	1.95	1.67	1.28	1.16	1.52	1.00	1.26	2.87	1.15	2.56	2.00	
28/02/2025 08:00	8.98	1.10	3.13	0.69	1.95	1.67	1.27	1.16	1.52	1.00	1.26	2.87	1.16	2.56	2.00	
28/02/2025 08:15	8.97	1.09	3.13	0.71	1.95	1.67	1.28	1.16	1.52	1.00	1.26	2.87	1.15	2.56	2.00	
28/02/2025 08:30	8.97	1.09	3.13	0.72	1.95	1.67	1.27	1.16	1.53	1.00	1.26	2.87	1.15	2.56	2.00	
28/02/2025 08:45	8.97	1.09	3.13	0.74	1.95	1.68	1.28	1.16	1.53	1.00	1.26	2.87	1.15	2.56	2.00	
28/02/2025 09:00	8.97		3.13	0.77	1.95	1.67	1.27	1.15	1.52	1.00	1.25	2.86	1.15	2.57	2.00	
28/02/2025 09:15	8.97	1.09	3.13	0.79	1.95	1.67	1.27	1.15	1.53	1.00	1.26	2.86	1.15	2.57	2.00	
28/02/2025 09:30	8.97	1.08	3.13	0.80	1.95	1.67	1.27	1.15	1.52	1.00	1.25	2.86	1.15	2.57	1.99	
28/02/2025 09:45	8.97	1.08	3.13	0.81	1.95	1.67	1.27	1.15	1.52	0.99	1.25	2.86	1.15	2.57	1.99	
28/02/2025 10:00	8.97	1.08	3.12	0.83	1.95	1.67	1.26	1.15	1.52	0.99	1.25	2.86	1.14	2.57	1.99	
28/02/2025 10:15	8.96	1.08	3.12	0.84	1.94	1.67	1.26	1.15	1.52	0.99	1.25	2.86	1.14	2.57	1.99	
28/02/2025 10:30	8.97	1.08	3.12	0.85	1.94	1.67	1.27	1.15	1.52	0.99	1.25	2.86	1.14	2.58	1.99	
28/02/2025 10:45	8.97	1.08	3.12	0.86	1.95	1.67	1.26	1.16	1.53	1.00	1.26	2.86	1.14	2.58	1.99	
28/02/2025 11:00	8.98	1.08	3.12	0.86		1.67	1.26	1.15	1.52	0.99	1.25	2.85	1.14	2.58	1.99	
28/02/2025 11:15	8.97	1.08	3.12	0.88	1.95	1.67	1.26	1.15	1.51	0.99	1.25	2.85	1.14	2.58	1.99	
28/02/2025 11:30	8.97	1.08	3.12	0.88	1.95	1.67	1.26	1.15	1.52	1.00	1.26	2.86	1.14	2.59	1.99	
28/02/2025 11:45	8.97	1.08	3.12	0.89	1.95	1.67	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.59	1.99	
28/02/2025 12:00	8.97	1.08	3.12	0.90	1.96	1.67	1.27	1.15	1.51	0.99	1.25	2.86	1.14	2.59	1.99	
28/02/2025 12:15	8.97	1.08	3.12	0.90	1.96	1.67	1.27	1.16	1.51	0.99	1.25	2.86	1.14	2.60	1.99	
28/02/2025 12:30	8.97	1.08	3.12	0.92	1.96	1.67	1.26	1.15	1.51	0.99	1.25	2.86	1.14	2.60	1.99	
28/02/2025 12:45	8.97	1.08	3.12	0.89	1.95	1.67	1.26	1.16	1.52	0.99	1.25	2.85	1.14	2.60	1.99	
28/02/2025 13:00	8.97	1.08	3.12	0.87	1.95	1.65	1.26	1.16	1.51	0.99	1.25	2.85	1.14	2.60	1.99	
28/02/2025 13:15	8.97	1.08	3.12	0.86	1.95	1.65	1.26	1.15	1.52	0.98	1.25	2.85	1.14	2.60	1.99	
28/02/2025 13:30	8.97	1.08	3.12	0.84	1.96	1.65	1.26	1.15	1.53	0.99	1.25	2.86	1.14	2.61	1.99	
28/02/2025 13:45	8.97	1.08	3.12	0.83	1.96	1.66	1.26	1.16	1.52	0.99	1.26	2.86	1.14	2.60	1.99	
28/02/2025 14:00	8.97	1.08	3.12	0.81	1.96	1.66	1.26	1.16	1.52	1.01	1.25	2.86	1.14	2.60	1.99	
28/02/2025 14:15	8.97	1.08	3.12	0.79	1.95	1.65	1.26	1.15	1.52	1.01	1.25	2.86	1.13	2.60	1.99	
28/02/2025 14:30	8.97	1.08	3.13	0.78	1.96	1.66	1.27	1.16	1.51	1.01	1.25	2.86	1.14	2.59	2.00	
28/02/2025 14:45	8.97	1.08	3.13	0.76	1.96	1.66	1.26	1.16	1.51	1.01	1.25	2.86	1.14	2.59	1.99	
28/02/2025 15:00	8.97	1.08	3.12	0.74	1.96	1.66	1.26	1.16	1.52	1.01	1.24	2.86	1.14	2.58	1.99	
28/02/2025 15:15	8.97	1.08	3.12	0.72	1.96	1.65	1.26	1.15	1.52	1.00	1.25	2.85	1.14	2.58	1.99	
28/02/2025 15:30	8.97	1.08	3.12	0.71	1.95	1.65	1.26	1.15	1.51	1.00	1.25	2.85	1.14	2.57	1.99	
28/02/2025 15:45	8.97	1.08	3.12	0.69	1.95	1.65	1.26	1.15	1.51	1.01	1.25	2.86	1.14	2.57	1.99	
28/02/2025 16:00	8.97	1.08	3.12	0.68	1.96	1.65	1.26	1.15	1.52	1.00	1.25	2.86	1.14	2.57	1.99	

Appendix C: Diver Water Level Data

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
28/02/2025 16:15	8.97	1.09	3.13	0.67	1.96	1.66	1.27	1.17	1.51	1.01	1.25	2.86	1.14	2.56	2.00	
28/02/2025 16:30	8.98	1.09	3.13	0.66	1.97	1.67	1.28	1.17	1.54	1.01	1.25	2.87	1.15	2.57	2.00	
28/02/2025 16:45	8.98	1.09	3.13	0.64	1.97	1.66	1.28	1.16	1.53	1.01	1.25	2.86	1.15	2.56	2.00	
28/02/2025 17:00	8.98	1.09	3.13	0.64	1.97	1.66	1.27	1.17	1.53	1.00	1.25	2.87	1.15	2.56	2.00	
28/02/2025 17:15	8.98	1.10	3.13	0.64	1.97	1.66	1.27	1.17	1.54	1.01	1.26	2.87	1.15	2.56	2.00	
28/02/2025 17:30	8.99	1.10	3.13	0.63	1.97	1.66	1.27	1.17	1.52	1.01	1.26	2.87	1.15	2.56	2.01	
28/02/2025 17:45	8.98	1.10	3.13	0.64	1.97	1.66	1.27	1.17	1.53	1.01	1.26	2.87	1.15	2.55	2.00	
28/02/2025 18:00	8.99	1.10	3.14	0.65	1.97	1.67	1.27	1.17	1.51	1.02	1.27	2.87	1.16	2.55	2.01	
28/02/2025 18:15	8.98	1.10	3.14	0.66	1.97	1.67	1.28	1.17	1.54	1.02	1.26	2.87	1.15	2.55	2.01	
28/02/2025 18:30	8.99	1.10	3.14	0.68	1.97	1.67	1.28	1.18	1.54	1.02	1.27	2.88	1.16	2.55	2.01	
28/02/2025 18:45	8.99	1.10	3.14	0.70	1.97	1.67	1.28	1.18	1.54	1.01	1.27	2.88	1.16	2.55	2.01	
28/02/2025 19:00	8.99	1.10	3.14	0.71	1.97	1.67	1.28	1.17	1.54	1.02	1.26	2.87	1.16	2.55	2.01	
28/02/2025 19:15	8.99	1.10	3.14	0.73	1.97	1.67	1.28	1.18	1.53	1.02	1.27	2.87	1.16	2.54	2.01	
28/02/2025 19:30	8.99	1.10	3.14	0.74	1.98	1.67	1.28	1.18	1.54	1.03	1.27	2.87	1.16	2.55	2.01	
28/02/2025 19:45	8.99	1.10	3.14	0.76	1.97	1.67	1.28	1.18	1.55	1.01	1.27	2.87	1.15	2.55	2.01	
28/02/2025 20:00	8.99	1.10	3.14	0.77	1.97	1.67	1.28	1.17	1.53	1.02	1.26	2.87	1.15	2.55	2.01	
28/02/2025 20:15	8.99	1.10	3.14	0.79	1.97	1.67	1.29	1.18	1.55	1.02	1.27	2.87	1.15	2.56	2.01	
28/02/2025 20:30	8.99	1.10	3.14	0.80	1.97	1.67	1.28	1.17	1.53	1.02	1.26	2.87	1.15	2.56	2.01	
28/02/2025 20:45	8.99	1.10	3.14	0.82	1.97	1.67	1.28	1.17	1.53	1.02	1.26	2.87	1.15	2.56	2.01	
28/02/2025 21:00	8.99	1.09	3.14	0.83	1.97	1.67	1.28	1.17	1.53	1.01	1.26	2.87	1.15	2.56	2.01	
28/02/2025 21:15	8.99	1.09	3.13	0.84	1.97	1.67	1.28	1.17	1.53	1.02	1.26	2.87	1.15	2.56	2.00	
28/02/2025 21:30	8.98	1.09	3.13	0.86	1.97	1.67	1.28	1.17	1.53	1.02	1.26	2.86	1.15	2.56	2.00	
28/02/2025 21:45	8.99	1.09	3.13	0.87	1.97	1.67	1.28	1.17	1.53	1.01	1.26	2.87	1.15	2.57	2.00	
28/02/2025 22:00	8.98	1.09	3.13	0.88	1.97	1.67	1.27	1.17	1.53	1.01	1.26	2.86	1.15	2.57	2.00	
28/02/2025 22:15	8.98	1.09	3.13	0.89	1.97	1.66	1.27	1.17	1.54	1.01	1.26	2.87	1.15	2.57	2.00	
28/02/2025 22:30	8.98	1.09	3.13	0.90	1.97	1.66	1.28	1.17	1.53	1.01	1.26	2.86	1.15	2.58	2.00	
28/02/2025 22:45	8.99	1.09	3.13	0.91	1.96	1.66	1.28	1.17	1.54	1.01	1.26	2.86	1.15	2.58	2.00	
28/02/2025 23:00	8.99	1.09	3.13	0.91	1.97	1.66	1.27	1.17	1.53	1.01	1.26	2.86	1.15	2.58	2.00	
28/02/2025 23:15	8.98	1.09	3.13	0.91	1.96	1.66	1.27	1.17	1.53	1.01	1.26	2.86	1.15	2.58	2.00	
28/02/2025 23:30	8.98	1.09	3.13	0.91	1.96	1.66	1.26	1.17	1.53	1.01	1.26	2.86	1.15	2.58	2.00	
28/02/2025 23:45	8.98	1.09	3.13	0.90	1.96	1.66	1.28	1.17	1.52	1.00	1.25	2.86	1.15	2.59	2.00	
01/03/2025 00:00	8.98	1.09	3.13	0.90	1.96	1.66	1.27	1.16	1.53	1.00	1.25	2.86	1.14	2.59	2.00	
01/03/2025 00:15	8.98	1.09	3.13	0.90	1.96	1.66	1.27	1.16	1.53	1.01	1.25	2.86	1.15	2.59	2.00	
01/03/2025 00:30	8.98	1.09	3.13	0.89	1.96	1.66	1.27	1.17	1.52	1.01	1.25	2.86	1.14	2.59	2.00	
01/03/2025 00:45	8.98	1.09	3.13	0.89	1.96	1.66	1.27	1.16	1.53	1.00	1.25	2.86	1.14	2.59	2.00	
01/03/2025 01:00	8.98	1.09	3.13	0.88	1.96	1.66	1.27	1.16	1.53	1.01	1.25	2.86	1.14	2.60	2.00	
01/03/2025 01:15	8.98	1.09	3.13	0.86	1.96	1.66	1.27	1.16	1.53	1.01	1.26	2.86	1.15	2.60	2.00	
01/03/2025 01:30	8.98	1.09	3.12	0.85	1.96	1.66	1.27	1.16	1.52	1.00	1.25	2.86	1.14	2.60	2.00	
01/03/2025 01:45	8.98	1.09	3.12	0.83	1.96	1.66	1.27	1.16	1.52	1.01	1.25	2.86	1.14	2.60	2.00	
01/03/2025 02:00	8.98	1.09	3.12	0.81	1.96	1.66	1.27	1.16	1.53	1.00	1.26	2.86	1.14	2.60	2.00	
01/03/2025 02:15	8.98	1.09	3.13	0.79	1.96	1.66	1.27	1.16	1.53	1.01	1.25	2.86	1.15	2.59	2.00	
01/03/2025 02:30	8.98	1.09	3.13	0.77	1.97	1.66	1.26	1.16	1.53	1.01	1.25	2.86	1.14	2.59	2.00	
01/03/2025 02:45	8.98	1.09	3.12	0.75	1.96	1.66	1.27	1.16	1.52	1.01	1.26	2.86	1.14	2.58	2.00	
01/03/2025 03:00	8.98	1.09	3.12	0.73	1.97	1.66	1.27	1.16	1.53	1.01	1.25	2.86	1.15	2.58	2.00	
01/03/2025 03:15	8.98	1.09	3.12	0.70	1.96	1.66	1.27	1.16	1.53	1.01	1.25	2.86	1.14	2.57	2.00	
01/03/2025 03:30	8.98	1.08	3.12	0.68	1.96	1.66	1.27	1.16	1.52	1.00	1.25	2.86	1.15	2.56	2.00	
01/03/2025 03:45	8.98	1.09	3.12	0.67	1.96	1.66	1.27	1.16	1.53	1.01	1.25	2.86	1.14	2.56	2.00	
01/03/2025 04:00	8.98	1.08	3.12	0.64	1.96	1.65	1.27	1.16	1.53	0.99	1.25	2.86	1.14	2.55	2.00	
01/03/2025 04:15	8.98	1.09	3.12	0.63	1.96	1.66	1.27	1.16	1.52	1.01	1.25	2.86	1.14	2.55	2.00	
01/03/2025 04:30	8.98	1.09	3.12	0.61	1.96	1.66	1.27	1.16	1.52	1.00	1.25	2.86	1.14	2.54	2.00	
01/03/2025 04:45	8.98	1.08	3.12	0.59	1.96	1.66	1.27	1.16	1.52	1.00	1.25	2.86	1.14	2.54	2.00	
01/03/2025 05:00	8.98	1.08	3.12	0.57	1.96	1.66	1.27	1.16	1.52	1.00	1.25	2.86	1.14	2.53	1.99	
01/03/2025 05:15	8.98	1.08	3.13	0.56	1.96	1.65	1.27	1.16	1.52	1.00	1.25	2.86	1.14	2.53	2.00	
01/03/2025 05:30	8.97	1.08	3.12	0.55	1.96	1.65	1.27	1.16	1.52	1.00	1.25	2.86	1.14	2.53	1.99	
01/03/2025 05:45	8.98	1.08	3.12	0.54	1.96	1.65	1.27	1.16	1.51	0.99	1.24	2.86	1.14	2.52	1.99	
01/03/2025 06:00	8.98	1.08	3.12	0.54	1.96	1.65	1.27	1.16	1.51	0.99	1.24	2.86	1.14	2.52	1.99	
01/03/2025 06:15	8.97	1.08	3.12	0.54	1.96	1.65	1.27	1.16	1.51	0.99	1.24	2.86	1.14	2.51	1.99	
01/03/2025 06:30	8.98	1.08	3.12	0.55	1.96	1.65	1.27	1.16	1.52	0.99	1.24	2.86	1.14	2.51	1.99	
01/03/2025 06:45	8.97	1.08	3.12	0.56	1.96	1.65	1.27	1.16	1.51	0.99	1.24	2.85	1.14	2.51	1.99	
01/03/2025 07:00	8.98	1.08	3.12	0.58	1.96	1.65	1.27	1.16	1.51	0.99	1.24	2.86	1.14	2.51	1.99	
01/03/2025 07:15	8.98	1.08	3.12	0.59	1.96	1.65	1.27	1.16	1.51	0.99	1.25	2.86	1.14	2.50	1.99	
01/03/2025 07:30	8.98	1.08	3.12	0.61	1.96	1.65	1.27	1.16	1.51	1.00	1.24	2.86	1.14	2.50	1.99	
01/03/2025 07:45	8.98	1.08	3.12	0.62	1.95	1.65	1.26	1.16	1.51	1.00	1.24	2.86	1.14	2.49	1.99	
01/03/2025 08:00	8.97	1.08	3.11	0.63	1.95	1.65	1.26	1.15	1.51	0.99	1.24	2.86	1.14	2.49	1.99	
01/03/2025 08:15	8.98	1.08	3.12	0.65	1.95	1.65	1.27	1.16	1.51	1.00	1.25	2.86	1.14	2.49	1.99	
01/03/2025 08:30	8.97	1.08	3.12	0.66	1.96	1.65	1.26	1.15	1.51	0.99	1.25	2.86	1.14	2.48	1.99	
01/03/2025 08:45	8.97	1.08	3.12	0.68	1.95	1.65	1.26	1.15	1.51	0.98		2.85	1.14	2.48	1.99	
01/03/2025 09:00	8.97	1.08	3.11	0.69	1.95	1.64	1.26	1.15		0.99	1.25	2.85	1.14	2.48	1.99	
01/03/2025 09:15	8.97	1.08	3.11	0.71	1.95	1.65	1.25	1.14	1.50	1.00	1.24	2.85	1.13	2.48	1.99	
01/03/2025 09:30	8.98	1.09	3.12	0.73	1.96	1.65	1.26	1.15	1.51	1.00	1.25	2.86	1.14	2.49	1.99	
01/03/2025 09:45	8.97	1.08	3.11	0.74	1.95	1.65	1.26	1.15	1.50	0.98	1.24	2.85	1.13	2.49	1.99	
01/03/2025 10:00	8.97	1.08	3.11	0.76	1.95	1.65	1.25	1.15	1.49	0.99	1.24	2.85	1.13	2.49	1.99	
01/03/2025 10:15	8.97	1.08	3.11	0.78	1.95	1.65	1.25	1.15	1.50	0.99	1.25	2.85	1.14	2.49	1.99	
01/03/2025 10:30	8.97	1.08	3.11	0.80	1.95	1.65	1.26	1.15	1.50	1.00	1.24	2.85	1.13	2.50	1.99	
01/03/2025 10:45	8.97	1.08	3.12	0.81	1.95	1.66	1.26	1.15	1.51	1.00	1.25	2.85	1.14	2.50	1.99	
01/03/2025 11:00	8.97	1.08	3.12	0.83	1.95	1.65	1.26	1.15	1.50	1.00	1.24	2.85	1.14	2.50	1.99	
01/03/2025 11:15	8.96	1.08	3.12	0.84	1.94	1.65	1.25	1.15	1.51	1.00	1.25	2.85	1.14	2.51	1.99	
01/03/2025 11:30	8.96	1.08	3.12	0.85	1.94	1.65	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.51	1.99	
01/03/2025 11:45	8.97	1.08	3.12	0.86	1.94	1.66	1.27	1.15	1.51	0.99	1.24	2.85	1.13	2.52	1.99	
01/03/2025 12:00	8.96	1.08	3.12	0.86	1.95	1.66	1.26	1.15	1.51	0.99	1.24	2.85	1.13	2.52	1.99	
01/03/2025 12:15	8.96	1.08	3.12	0.87	1.95	1.66	1.26	1.15	1.52	0.99	1.24	2.85	1.13	2.52	1.99	
01/03/2025 12:30	8.97	1.09	3.12	0.87	1.95	1.66	1.26	1.15	1.51	0.99	1.25	2.85	1.13	2.52	1.99	
01/03/2025 12:45	8.97	1.09	3.12	0.88	1.95	1.66	1.26	1.15	1.52	0.99	1.25	2.85	1.14	2.53	2.00	
01/03/2025 13:00	8.96	1.09	3.12	0.89	1.95	1.66	1.26	1.15	1.51	0.99	1.25	2.85	1.14	2.54	1.99	
01/03/2025 13:15	8.96	1.08	3.12	0.88	1.95	1.66	1.26	1.15	1.52	1.01	1.25	2.85	1.14	2.53	1.99	
01/03/2025 13:30	8.97	1.08	3.12	0.87	1.95	1.66	1.26	1.15	1.51	1.00	1.25	2.85	1.13	2.53	1.99	
01/03/2025 13:45	8.97	1.09	3.13	0.87	1.96	1.67	1.27	1.16	1.53	1.00	1.25	2.86	1.14	2.55	2.00	
01/03/2025 14:00	8.98	1.09	3.13	0.85	1.96	1.67	1.27	1.16	1.53	1.00	1.26	2.86	1.14	2.55	2.00	
01/03/2025 14:15	8.98	1.10	3.13	0.83	1.96	1.67	1.27	1.16	1.52	1.01	1.25	2.86	1.14	2.56	2.00	
01/03/2025 14:30	8.98	1.10	3.13	0.82	1.96	1.67	1.28	1.16	1.52	0.99	1.26	2.86	1.14	2.56	2.00	
01/03/2025 14:45	8.98	1.10	3.13	0.80	1.96	1.67	1.27	1.16	1.52	1.01	1.26	2.86	1.14	2.55	2.00	
01/03/2025 15:00	8.98	1.10	3.13	0.79	1.96	1.67	1.27	1.16	1.52	1.00	1.26	2.86	1.15	2.55	2.01	
01/03/2025 15:15	8.97	1.10	3.13	0.76	1.96	1.67	1.27	1.16	1.52	1.00	1.26	2.86	1.15	2.54	2.00	
01/03/2025 15:30	8.98	1.10	3.13	0.75	1.96	1.67	1.28	1.16	1.52	1.01	1.26	2.86	1.15	2.54	2.00	
01/03/2025 15:45	8.98	1.10	3.13	0.73	1.96	1.67	1.28	1.16	1.53	1.00	1.26	2.86	1.15	2.53	2.00	
01/03/2025 16:00	8.98	1.10	3.13	0.71	1.97	1.67	1.28	1.16	1.51	1.00	1.26	2.86	1.15	2.53	2.00	
01/03/2025 16:15	8.97	1.10	3.13	0.69	1.96	1.67	1.27	1.16	1.53	1.00	1.26	2.86	1.15	2.53	2.00	
01/03/2025 16:30	8.98	1.10	3.13	0.68	1.97	1.67	1.27	1.16	1.52	1.00	1.26	2.86	1.15	2.52	2.00	
01/03/2025 16:45	8.98	1.10	3.13	0.66	1.96	1.67	1.27	1.16	1.52	1.00	1.25	2.86	1.15	2.51	2.00	
01/03/2025 17:00	8.98	1.09	3.13	0.65	1.96	1.67	1.27	1.16	1.50	0.99	1.25	2.86	1.15	2.51	2.00	
01/03/2025 17:15	8.98	1.09	3.13	0.63	1.96	1.67	1.27	1.16	1.51	1.00	1.25	2.86	1.15	2.51	2.00	
01/03/2025 17:30	8.98	1.10	3.13	0.62	1.96	1.67	1.27	1.16	1.52	1.00	1.26	2.87	1.15	2.51	2.00	
01/03/2025 17:45	8.98	1.09	3.12	0.62	1.96	1.66	1.27	1.15	1.51	0.99	1.25	2.86	1.14	2.50	2.00	
01/03/2025 18:00	8.98	1.09	3.12	0.61	1.96	1.67	1.27	1.16	1.51	1.00	1.25	2.86	1.15	2.50	2.00	
01/03/2025 18:15	8.98	1.09	3.13	0.62	1.96	1.67	1.27	1.16	1.51	1.00	1.25	2.86	1.15	2.49	2.00	
01/03/2025 18:30	8.98	1.09	3.13	0.63	1.96	1.67	1.28	1.16	1.52	1.00	1.26	2.86	1.15	2.49	2.00	
01/03/2025 18:45	8.98	1.09	3.13	0.64	1.96	1.67	1.28	1.16	1.52	1.00	1.25	2.86	1.14	2.49	2.00	
01/03/2025 19:00	8.98	1.09	3.13	0.67	1.96	1.67	1.27	1.16	1.51	1.00	1.26	2.87	1.15	2.49	2.00	
01/03/2025 19:15	8.98	1.09	3.13	0.68	1.96	1.67	1.28	1.16	1.51	1.00	1.25	2.86	1.15	2.48	2.00	
01/03/2025 19:30	8.98	1.09	3.13	0.70	1.96	1.68	1.28	1.16	1.52	0.99	1.26	2.86	1.15	2.48	2.00	
01/03/2025 19:45	8.97	1.09	3.13	0.71	1.96	1.67	1.29	1.16	1.51	0.98	1.25	2.86	1.15	2.48	2.00	
01/03/2025 20:00	8.98	1.09	3.12	0.74	1.97	1.67	1.28	1.16	1.52	0.99	1.25	2.86	1.15	2.48	2.00	
01/03/2025 20:15	8.97	1.09	3.12	0.74	1.96	1.67	1.27	1.16	1.52	0.99	1.25	2.86	1.15	2.48	2.00	
01/03/2025 20:30	8.97	1.09	3.12	0.76	1.96	1.67	1.27	1.16	1.51	1.00	1.25	2.86	1.15	2.48	2.00	
01/03/2025 20:45	8.97	1.09	3.12	0.78	1.95	1.66	1.27	1.15	1.51	0.99	1.25	2.86	1.14	2.49	2.00	
01/03/2025 21:00	8.98	1.09	3.12	0.79	1.96	1.67	1.27	1.16	1.51	0.99	1.25	2.86	1.15	2.49	2.00	
01/03/2025 21:15	8.98	1.09	3.13	0.81	1.96	1.67	1.27	1.16	1.51	0.99	1.25	2.86	1.15	2.49	2.00	
01/03/2025 21:30	8.98	1.09	3.12	0.82	1.95	1.66	1.27	1.16	1.51	0.99	1.25	2.86	1.14	2.50	2.00	
01/03/2025 21:45	8.97	1.09	3.13	0.84	1.95	1.67	1.28	1.16	1.52	1.00	1.25	2.86	1.14	2.50	2.00	
01/03/2025 22:00	8.98	1.09	3.12	0.86	1.96	1.67	1.27	1.16	1.52	0.99	1.25	2.86	1.14	2.51	2.00	
01/03/2025 22:15	8.97	1.09	3.12	0.87	1.95	1.67	1.27	1.16	1.52	1.00	1.25	2.86	1.14	2.51	2.00	
01/03/2025 22:30	8.97	1.09	3.13	0.89	1.96	1.67	1.28	1.16	1.53	1.00	1.25	2.86	1.14	2.51	2.00	
01/03/2025 22:45	8.97	1.09	3.12	0.90	1.95	1.67	1.27	1.16	1.51	0.99	1.25	2.85	1.14	2.51	2.00	
01/03/2025 23:00	8.97	1.09	3.12	0.91	1.96	1.67	1.27	1.16	1.52	0.99	1.25	2.86	1.15	2.51	2.00	
01/03/2025 23:15	8.97	1.09	3.12	0.92	1.95	1.67	1.28	1.16	1.51	1.00	1.25	2.86	1.14	2.52	2.00	
01/03/2025 23:30	8.97	1.09	3.12	0.92	1.95	1.67	1.27	1.16	1.52	0.99	1.25	2.86	1.14	2.52	2.00	
01/03/2025 23:45	8.97	1.09	3.12	0.92	1.95	1.67	1.28	1.16	1.51	0.99	1.25	2.85	1.14	2.52	2.00	
02/03/2025 00:00	8.97	1.09	3.12	0.92	1.96	1.66	1.26	1.15	1.52	0.98	1.25	2.86	1.14	2.53	2.00	
02/03/2025 00:15	8.97	1.09	3.13	0.92	1.96	1.67	1.27	1.16	1.52	0.99	1.25	2.86	1.14	2.53	2.00	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
02/03/2025 00:30	8.97	1.09	3.12	0.91	1.95	1.66	1.27	1.15	1.52	0.99	1.25	2.86	1.14	2.53	2.00	
02/03/2025 00:45	8.97	1.09	3.12	0.91	1.95	1.67	1.28	1.15	1.52	0.99	1.25	2.86	1.14	2.54	2.00	
02/03/2025 01:00	8.97	1.09	3.12	0.91	1.96	1.66	1.26	1.16	1.51	0.98	1.25	2.85	1.15	2.54	2.00	
02/03/2025 01:15	8.97	1.09	3.12	0.90	1.95	1.66	1.27	1.15	1.52	0.99	1.25	2.85	1.14	2.54	2.00	
02/03/2025 01:30	8.97	1.09	3.12	0.90	1.96	1.67	1.27	1.16	1.52	0.99	1.25	2.86	1.14	2.54	2.00	
02/03/2025 01:45	8.98	1.09	3.12	0.89	1.96	1.66	1.27	1.16	1.51	0.98	1.25	2.85	1.14	2.55	2.00	
02/03/2025 02:00	8.97	1.09	3.12	0.88	1.96	1.67	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.55	2.00	
02/03/2025 02:15	8.97	1.09	3.12	0.85	1.96	1.67	1.27	1.15	1.52	1.00	1.24	2.85	1.14	2.55	2.00	
02/03/2025 02:30	8.97	1.09	3.12	0.84	1.95	1.66	1.28	1.15	1.51	0.99	1.25	2.86	1.14	2.55	2.00	
02/03/2025 02:45	8.97	1.09	3.12	0.81	1.95	1.66	1.27	1.15	1.51	0.99	1.25	2.86	1.14	2.54	1.99	
02/03/2025 03:00	8.97	1.09	3.12	0.79	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.86	1.14	2.54	1.99	
02/03/2025 03:15	8.97	1.09	3.12	0.77	1.95	1.66	1.27	1.15	1.49	0.99	1.25	2.86	1.14	2.54	1.99	
02/03/2025 03:30	8.97	1.09	3.12	0.75	1.95	1.66	1.27	1.15	1.51	0.99	1.24	2.85	1.14	2.53	1.99	
02/03/2025 03:45	8.97	1.09	3.12	0.73	1.95	1.66	1.27	1.15	1.51	0.99	1.24	2.85	1.14	2.52	1.99	
02/03/2025 04:00	8.97	1.09	3.12	0.71	1.96	1.66	1.27	1.15	1.51	0.99	1.24	2.85	1.14	2.52	1.99	
02/03/2025 04:15	8.97	1.09	3.12	0.68	1.95	1.66	1.26	1.15	1.51	0.99	1.24	2.85	1.14	2.51	1.99	
02/03/2025 04:30	8.97	1.09	3.12	0.66	1.95	1.66	1.27	1.15	1.50	1.00	1.25	2.85	1.14	2.51	2.00	
02/03/2025 04:45	8.97	1.09	3.12	0.64	1.95	1.66	1.27	1.15	1.51	0.98	1.24	2.85	1.14	2.50	1.99	
02/03/2025 05:00	8.97	1.09	3.12	0.62	1.95	1.66	1.27	1.15	1.52	0.99	1.24	2.85	1.14	2.50	2.00	
02/03/2025 05:15	8.97	1.09	3.12	0.60	1.95	1.66	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.49	1.99	
02/03/2025 05:30	8.97	1.09	3.12	0.58	1.95	1.66	1.27	1.15	1.50	0.99	1.25	2.85	1.14	2.49	1.99	
02/03/2025 05:45	8.97	1.09	3.12	0.57	1.95	1.66	1.26	1.15	1.51	0.99	1.24	2.85	1.14	2.48	1.99	
02/03/2025 06:00	8.97	1.09	3.12	0.55	1.96	1.66	1.27	1.15	1.51	0.98	1.24	2.85	1.14	2.48	1.99	
02/03/2025 06:15	8.97	1.09	3.12	0.55	1.96	1.66	1.27	1.15	1.50	0.99	1.24	2.85	1.14	2.48	2.00	
02/03/2025 06:30	8.97	1.09	3.12	0.54	1.95	1.66	1.27	1.15	1.51	0.99	1.24	2.85	1.14	2.47	1.99	
02/03/2025 06:45	8.97	1.09	3.12	0.54	1.96	1.66	1.27	1.15	1.50	0.98	1.24	2.85	1.14	2.47	2.00	
02/03/2025 07:00	8.97	1.09	3.11	0.54	1.95	1.66	1.26	1.15	1.50	0.98	1.25	2.85	1.14	2.46	1.99	
02/03/2025 07:15	8.97	1.09	3.12	0.55	1.95	1.66	1.27	1.15	1.51	0.99	1.25	2.85	1.13	2.46	1.99	
02/03/2025 07:30	8.97	1.09	3.11	0.56	1.95	1.66	1.27	1.15	1.50	0.98	1.24	2.85	1.13	2.46	1.99	
02/03/2025 07:45	8.96	1.08	3.11	0.58	1.95	1.66	1.27	1.15	1.50	0.98	1.24	2.85	1.13	2.46	1.99	
02/03/2025 08:00	8.97	1.09	3.11	0.59	1.95	1.66	1.27	1.15	1.50	0.98	1.25	2.85	1.14	2.45	1.99	
02/03/2025 08:15	8.97	1.08	3.11	0.61	1.95	1.66	1.27	1.15	1.51	0.97	1.25	2.85	1.13	2.45	1.99	
02/03/2025 08:30	8.96	1.08	3.11	0.62	1.95	1.66	1.26	1.15	1.51	0.98	1.25	2.84	1.13	2.44	1.99	
02/03/2025 08:45	8.97	1.08	3.11	0.64	1.95	1.66	1.27	1.15	1.51	0.98	1.24	2.84	1.13	2.44	1.99	
02/03/2025 09:00	8.97	1.08	3.11	0.65	1.95	1.66	1.26	1.14	1.50	0.98	1.24	2.84	1.13	2.43	1.99	
02/03/2025 09:15	8.97	1.09	3.11	0.67	1.95	1.66	1.27	1.15	1.51	0.99	1.24	2.85	1.13	2.44	1.99	
02/03/2025 09:30	8.96	1.08	3.11	0.68	1.95	1.66	1.26	1.15	1.50	0.98	1.23	2.84	1.13	2.43	1.99	
02/03/2025 09:45	8.96	1.08	3.11	0.70	1.95	1.66	1.27	1.15	1.51	0.98	1.24	2.84	1.13	2.43	1.99	
02/03/2025 10:00	8.96	1.09	3.11	0.71	1.95	1.66	1.27	1.15	1.50	0.98	1.24	2.84	1.13	2.43	1.99	
02/03/2025 10:15	8.96	1.08	3.11	0.73	1.95	1.66	1.27	1.15	1.50	0.97	1.24	2.84	1.13	2.44	1.99	
02/03/2025 10:30	8.96	1.08	3.11	0.75	1.95	1.66	1.27	1.15	1.50	0.98	1.24	2.84	1.13	2.44	1.99	
02/03/2025 10:45	8.96	1.08	3.11	0.76	1.95	1.66	1.26	1.14	1.50	0.97	1.24	2.84	1.13	2.44	1.99	
02/03/2025 11:00	8.96	1.08	3.11	0.78	1.95	1.66	1.27	1.14	1.50	0.97	1.24	2.84	1.13	2.45	1.99	
02/03/2025 11:15	8.97	1.08	3.11	0.80	1.95	1.66	1.27	1.14	1.50	0.97	1.24	2.85	1.13	2.45	1.99	
02/03/2025 11:30	8.97	1.08	3.11	0.81	1.95	1.66	1.26	1.15	1.51	0.98	1.24	2.85	1.13	2.45	1.99	
02/03/2025 11:45	8.96	1.08	3.11	0.82	1.95	1.66	1.27	1.15	1.50	0.97	1.24	2.84	1.13	2.45	1.99	
02/03/2025 12:00	8.96	1.08	3.11	0.84	1.95	1.66	1.26	1.15	1.50	0.98	1.24	2.84	1.13	2.46	1.99	
02/03/2025 12:15	8.97	1.08	3.11	0.85	1.95	1.66	1.27	1.15	1.50	0.98	1.25	2.84	1.13	2.46	1.99	
02/03/2025 12:30	8.96	1.08	3.11	0.85	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.84	1.13	2.46	1.99	
02/03/2025 12:45	8.96	1.08	3.11	0.85	1.95	1.66	1.27	1.15	1.51	0.98	1.24	2.85	1.13	2.47	1.99	
02/03/2025 13:00	8.97	1.09	3.11	0.86	1.96	1.66	1.27	1.15	1.52	0.98	1.24	2.85	1.13	2.47	1.99	
02/03/2025 13:15	8.97	1.09	3.11	0.87	1.96	1.67	1.27	1.15	1.51	0.98	1.24	2.85	1.13	2.47	1.99	
02/03/2025 13:30	8.96	1.09	3.11	0.87	1.95	1.66	1.27	1.15	1.52	0.98	1.25	2.84	1.13	2.48	1.99	
02/03/2025 13:45	8.96	1.08	3.11	0.87	1.95	1.66	1.26	1.15	1.52	0.97	1.24	2.85	1.13	2.48	1.99	
02/03/2025 14:00	8.97	1.09	3.11	0.87	1.96	1.66	1.26	1.15	1.51	0.98	1.25	2.85	1.13	2.49	2.00	
02/03/2025 14:15	8.97	1.09	3.12	0.85	1.96	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.13	2.49	2.00	
02/03/2025 14:30	8.97	1.09	3.12	0.84	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.49	1.99	
02/03/2025 14:45	8.96	1.09	3.12	0.82	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.49	1.99	
02/03/2025 15:00	8.97	1.09	3.12	0.81	1.96	1.66	1.28	1.15	1.52	0.98	1.24	2.85	1.14	2.50	2.00	
02/03/2025 15:15	8.97	1.09	3.12	0.79	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.49	2.00	
02/03/2025 15:30	8.97	1.09	3.12	0.77	1.96	1.66	1.27	1.15	1.52	0.99	1.24	2.85	1.13	2.49	2.00	
02/03/2025 15:45	8.97	1.09	3.12	0.75	1.96	1.66	1.27	1.15	1.52	0.99	1.24	2.85	1.13	2.49	2.00	
02/03/2025 16:00	8.97	1.09	3.12	0.73	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.48	2.00	
02/03/2025 16:15	8.97	1.08	3.12	0.71	1.96	1.66	1.27	1.15	1.51	0.98	1.24	2.85	1.13	2.48	1.99	
02/03/2025 16:30	8.97	1.09	3.12	0.70	1.96	1.66	1.27	1.15	1.51	0.98	1.24	2.85	1.13	2.47	2.00	
02/03/2025 16:45	8.97	1.09	3.12	0.68	1.96	1.67	1.28	1.15	1.51	0.98	1.25	2.85	1.13	2.47	2.00	
02/03/2025 17:00	8.97	1.09	3.12	0.66	1.96	1.66	1.27	1.15	1.53	0.98	1.25	2.85	1.14	2.47	2.00	
02/03/2025 17:15	8.97	1.09	3.12	0.65	1.96	1.66	1.27	1.15	1.52	0.97	1.24	2.85	1.13	2.46	2.00	
02/03/2025 17:30	8.97	1.09	3.12	0.63	1.96	1.66	1.27	1.15	1.52	0.99	1.25	2.85	1.13	2.46	2.00	
02/03/2025 17:45	8.97	1.09	3.12	0.62	1.96	1.66	1.28	1.15	1.52	0.99	1.25	2.85	1.14	2.45	2.00	
02/03/2025 18:00	8.97	1.09	3.12	0.60	1.96	1.66	1.27	1.15	1.52	0.97	1.25	2.85	1.14	2.45	2.00	
02/03/2025 18:15	8.97	1.09	3.12	0.60	1.96	1.66	1.27	1.15	1.51	0.98	1.24	2.85	1.14	2.45	2.00	
02/03/2025 18:30	8.97	1.09	3.12	0.59	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.45	2.00	
02/03/2025 18:45	8.97	1.09	3.12	0.59	1.96	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.14	2.44	2.00	
02/03/2025 19:00	8.98	1.09	3.12	0.59	1.96	1.66	1.28	1.15	1.52	0.98	1.26	2.85	1.14	2.44	2.00	
02/03/2025 19:15	8.97	1.09	3.12	0.61	1.96	1.66	1.27	1.15	1.52	0.98	1.25	2.86	1.14	2.43	2.00	
02/03/2025 19:30	8.97	1.09	3.12	0.62	1.96	1.67	1.28	1.16	1.53	0.99	1.24	2.86	1.13	2.43	2.00	
02/03/2025 19:45	8.97	1.09	3.12	0.64	1.96	1.67	1.28	1.15	1.51	0.98	1.25	2.85	1.14	2.43	2.00	
02/03/2025 20:00	8.98	1.09	3.11	0.66	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.42	2.00	
02/03/2025 20:15	8.98	1.09	3.12	0.68	1.96	1.67	1.27	1.15	1.52	0.98	1.25	2.86	1.14	2.42	2.00	
02/03/2025 20:30	8.97	1.09	3.12	0.70	1.96	1.66	1.27	1.16	1.52	0.99	1.25	2.85	1.14	2.43	2.00	
02/03/2025 20:45	8.97	1.09	3.12	0.71	1.96	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.14	2.42	2.00	
02/03/2025 21:00	8.98	1.09	3.11	0.73	1.96	1.66	1.27	1.15	1.51	0.98	1.24	2.86	1.14	2.43	2.00	
02/03/2025 21:15	8.98	1.09	3.12	0.74	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.42	2.00	
02/03/2025 21:30	8.97	1.09	3.12	0.76	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.43	2.00	
02/03/2025 21:45	8.98	1.09	3.12	0.77	1.95	1.66	1.27	1.16	1.50	0.99	1.25	2.86	1.14	2.43	2.00	
02/03/2025 22:00	8.97	1.09	3.12	0.79	1.96	1.66	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.43	2.00	
02/03/2025 22:15	8.97	1.09	3.12	0.81	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.44	2.00	
02/03/2025 22:30	8.97	1.09	3.12	0.83	1.96	1.66	1.28	1.15	1.51	0.98	1.24	2.85	1.14	2.44	2.00	
02/03/2025 22:45	8.98	1.09	3.12	0.84	1.96	1.67	1.26	1.15	1.52	0.98	1.25	2.85	1.14	2.44	2.00	
02/03/2025 23:00	8.98	1.09	3.11	0.86	1.96	1.67	1.26	1.15	1.51	0.98	1.25	2.85	1.14	2.45	2.00	
02/03/2025 23:15	8.97	1.09	3.11	0.87	1.95	1.66	1.26	1.15	1.51	0.99	1.24	2.85	1.14	2.45	2.00	
02/03/2025 23:30	8.97	1.09	3.11	0.88	1.95	1.67	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.45	2.00	
02/03/2025 23:45	8.97	1.09	3.11	0.89	1.95	1.66	1.27	1.15	1.51	0.98	1.24	2.85	1.13	2.46	2.00	
03/03/2025 00:00	8.97	1.09	3.11	0.90	1.96	1.66	1.26	1.15	1.52	0.98	1.25	2.85	1.14	2.46	2.00	
03/03/2025 00:15	8.97	1.09	3.12	0.91	1.96	1.67	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.46	2.00	
03/03/2025 00:30	8.97	1.09	3.12	0.91	1.96	1.66	1.27	1.15	1.52	0.98	1.24	2.85	1.14	2.46	2.00	
03/03/2025 00:45	8.97	1.09	3.12	0.91	1.96	1.66	1.27	1.15	1.52	0.99	1.25	2.85	1.14	2.47	2.00	
03/03/2025 01:00	8.97	1.09	3.11	0.91	1.96	1.67	1.27	1.15	1.52	0.99	1.25	2.85	1.14	2.47	2.00	
03/03/2025 01:15	8.97	1.09	3.12	0.90	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.47	2.00	
03/03/2025 01:30	8.97	1.09	3.11	0.90	1.96	1.66	1.27	1.15	1.52	0.99	1.25	2.85	1.14	2.47	2.00	
03/03/2025 01:45	8.97	1.09	3.12	0.90	1.96	1.67	1.27	1.16	1.52	0.99	1.25	2.85	1.14	2.48	2.00	
03/03/2025 02:00	8.97	1.09	3.11	0.90	1.96	1.66	1.26	1.15	1.51	0.99	1.25	2.85	1.14	2.48	2.00	
03/03/2025 02:15	8.96	1.09	3.11	0.89	1.96	1.66	1.27	1.15	1.50	0.98	1.25	2.85	1.14	2.48	2.00	
03/03/2025 02:30	8.97	1.09	3.12	0.88	1.96	1.66	1.27	1.15	1.50	0.98	1.25	2.85	1.14	2.49	2.00	
03/03/2025 02:45	8.97	1.09	3.11	0.86	1.96	1.66	1.27	1.15	1.52	0.99	1.25	2.85	1.14	2.49	2.00	
03/03/2025 03:00	8.97	1.09	3.12	0.84	1.96	1.66	1.27	1.15	1.51	0.98	1.24	2.85	1.14	2.49	2.00	
03/03/2025 03:15	8.97	1.09	3.11	0.82	1.95	1.67	1.27	1.15	1.51	0.98	1.24	2.85	1.14	2.49	2.00	
03/03/2025 03:30	8.97	1.09	3.12	0.80	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.49	2.00	
03/03/2025 03:45	8.97	1.09	3.12	0.78	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.49	2.00	
03/03/2025 04:00	8.97	1.09	3.11	0.76	1.96	1.66	1.26	1.15	1.50	0.98	1.25	2.85	1.14	2.48	2.00	
03/03/2025 04:15	8.97	1.09	3.11	0.74	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.48	2.00	
03/03/2025 04:30	8.97	1.09	3.12	0.71	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.48	2.00	
03/03/2025 04:45	8.97	1.08	3.12	0.69	1.95	1.66	1.27	1.15	1.51	0.97	1.25	2.85	1.13	2.46	2.00	
03/03/2025 05:00	8.97	1.08	3.11	0.67	1.96	1.66	1.27	1.15	1.51	0.97	1.25	2.85	1.14	2.46	2.00	
03/03/2025 05:15	8.97	1.08	3.12	0.65	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.46	1.99	
03/03/2025 05:30	8.97	1.09	3.11	0.63	1.96	1.66	1.27	1.15	1.50	0.97	1.25	2.85	1.14	2.45	2.00	
03/03/2025 05:45	8.97	1.09	3.11	0.61	1.96	1.66	1.27	1.15	1.50	0.98	1.24	2.85	1.13	2.45	2.00	
03/03/2025 06:00	8.97	1.09	3.12	0.60	1.96	1.66	1.27	1.15	1.50	0.97	1.24	2.85	1.14	2.44	2.00	
03/03/2025 06:15	8.97	1.08	3.11	0.58	1.96	1.66	1.26	1.15	1.52	0.98	1.24	2.85	1.13	2.44	2.00	
03/03/2025 06:30	8.97	1.09	3.11	0.56	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.43	2.00	
03/03/2025 06:45	8.97	1.09	3.12	0.55	1.96	1.66	1.27	1.15	1.50	0.98	1.25	2.85	1.13	2.43	2.00	
03/03/2025 07:00	8.97	1.09	3.12	0.55	1.96	1.66	1.26	1.15	1.51	0.98	1.24	2.85	1.14	2.43	2.00	
03/03/2025 07:15	8.97	1.09	3.12	0.54	1.96	1.66	1.26	1.15	1.49	0.98	1.25	2.85	1.14	2.42	2.00	
03/03/2025 07:30	8.97	1.08	3.11	0.54	1.96	1.66	1.26	1.15	1.51	0.97	1.24	2.85	1.13	2.42	1.99	
03/03/2025 07:45	8.97	1.08	3.11	0.55	1.95	1.65	1.26	1.15	1.50	0.98	1.24	2.85	1.13	2.41	1.99	
03/03/2025 08:00	8.97	1.08	3.11	0.56	1.96	1.66	1.27	1.15	1.49	0.98	1.24	2.85	1.14	2.41	1.99	
03/03/2025 08:15	8.97	1.08	3.12	0.58	1.95	1.66	1.27	1.15	1.49	0.98	1.24	2.85	1.13	2.41	1.99	
03/03/2025 08:30	8.97	1.08	3.11	0.59	1.95	1.66	1.26	1.15	1.50	0.98	1.24	2.85	1.14	2.40	1.99	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
03/03/2025 08:45	8.97	1.09	3.11	0.61	1.95	1.65	1.27	1.15	1.50	0.98	1.24	2.85	1.13	2.40	1.99	
03/03/2025 09:00	8.97	1.08	3.11	0.62	1.95	1.66	1.26	1.15	1.50	0.97	1.24	2.85	1.14	2.40	1.99	
03/03/2025 09:15	8.96	1.08	3.11	0.64	1.95	1.66	1.27	1.15	1.49	0.98	1.24	2.84	1.13	2.39	1.99	
03/03/2025 09:30	8.96	1.08	3.11	0.66	1.95	1.65	1.26	1.15	1.51	0.97	1.23	2.84	1.13	2.39	1.99	
03/03/2025 09:45	8.96	1.08	3.11	0.67	1.95	1.65	1.26	1.14	1.50	0.98	1.23	2.84	1.13	2.38	1.99	
03/03/2025 10:00	8.96	1.08	3.11	0.68	1.95	1.65	1.27	1.15	1.49	0.97	1.23	2.84	1.13	2.38	1.99	
03/03/2025 10:15	8.97	1.08	3.11	0.70	1.95	1.65	1.26	1.15	1.49	0.97	1.24	2.84	1.13	2.39	1.99	
03/03/2025 10:30	8.97	1.08	3.11	0.71	1.95	1.66	1.26	1.15	1.50	0.98	1.24	2.84	1.13	2.39	1.99	
03/03/2025 10:45	8.97	1.08	3.11	0.75	1.95	1.66	1.26	1.15	1.50	0.98	1.25	2.85	1.13	2.39	1.99	
03/03/2025 11:00	8.97	1.08	3.11	0.76	1.95	1.66	1.26	1.15	1.49	0.98	1.24	2.85	1.13	2.40	1.99	
03/03/2025 11:15	8.97	1.08	3.12	0.77	1.95	1.66	1.26	1.15	1.50	0.98	1.24	2.85	1.13	2.41	1.99	
03/03/2025 11:30	8.97	1.09	3.11	0.80	1.95	1.66	1.26	1.15	1.52	0.99	1.25	2.84	1.13	2.41	1.99	
03/03/2025 11:45	8.97	1.09	3.11	0.81	1.95	1.66	1.27	1.15	1.50	0.99	1.25	2.85	1.13	2.41	2.00	
03/03/2025 12:00	8.97	1.09	3.11	0.82	1.96	1.66	1.27	1.15	1.52	0.99	1.25	2.85	1.14	2.41	2.00	
03/03/2025 12:15	8.98	1.09	3.12	0.85	1.96	1.67	1.28	1.16	1.52	0.99	1.25	2.86	1.14	2.43	2.01	
03/03/2025 12:30	8.98	1.10	3.13	0.86	1.97	1.68	1.28	1.16	1.52	1.00	1.26	2.86	1.15	2.43	2.01	
03/03/2025 12:45	8.98	1.10	3.12	0.87	1.96	1.68	1.27	1.16	1.51	1.00	1.26	2.86	1.14	2.43	2.01	
03/03/2025 13:00	8.97	1.09	3.12	0.87	1.96	1.67	1.27	1.16	1.51	0.99	1.25	2.85	1.14	2.43	2.00	
03/03/2025 13:15	8.97	1.09	3.12	0.88	1.96	1.67	1.27	1.16	1.52	0.99	1.25	2.85	1.14	2.43	2.00	
03/03/2025 13:30	8.97	1.09	3.11	0.88	1.96	1.67	1.27	1.16	1.51	0.99	1.24	2.85	1.14	2.43	2.00	
03/03/2025 13:45	8.97	1.09	3.12	0.89	1.96	1.67	1.28	1.15	1.51	0.99	1.25	2.85	1.14	2.43	2.00	
03/03/2025 14:00	8.97	1.09	3.12	0.89	1.96	1.67	1.27	1.16	1.52	0.99	1.26	2.85	1.14	2.44	2.00	
03/03/2025 14:15	8.97	1.09	3.11	0.89	1.96	1.67	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.44	2.00	
03/03/2025 14:30	8.97	1.09	3.11	0.89	1.96	1.67	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.44	2.00	
03/03/2025 14:45	8.97	1.09	3.12	0.89	1.96	1.67	1.27	1.16	1.52	0.98	1.25	2.85	1.14	2.45	2.00	
03/03/2025 15:00	8.97	1.09	3.11	0.88	1.96	1.67	1.28	1.16	1.52	0.98	1.25	2.85	1.14	2.45	2.00	
03/03/2025 15:15	8.97	1.09	3.12	0.86	1.96	1.67	1.28	1.17	1.51	0.98	1.25	2.85	1.14	2.45	2.00	
03/03/2025 15:30	8.97	1.09	3.12	0.84	1.96	1.67	1.28	1.16	1.52	0.98	1.25	2.85	1.14	2.45	2.00	
03/03/2025 15:45	8.97	1.09	3.12	0.83	1.96	1.66	1.28	1.16	1.50	0.99	1.25	2.85	1.14	2.46	2.00	
03/03/2025 16:00	8.97	1.09	3.11	0.81	1.96	1.66	1.27	1.15	1.51	0.98	1.24	2.85	1.14	2.46	2.00	
03/03/2025 16:15	8.97	1.09	3.11	0.78	1.96	1.66	1.27	1.17	1.51	0.98	1.25	2.85	1.13	2.46	2.00	
03/03/2025 16:30	8.97	1.09	3.11	0.77	1.95	1.66	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.46	2.00	
03/03/2025 16:45	8.97	1.09	3.11	0.75	1.95	1.66	1.27	1.15	1.50	0.99	1.25	2.85	1.13	2.45	1.99	
03/03/2025 17:00	8.97	1.09	3.11	0.73	1.96	1.66	1.27	1.15	1.50	0.99	1.24	2.85	1.14	2.45	2.00	
03/03/2025 17:15	8.97	1.09	3.12	0.72	1.95	1.67	1.28	1.16	1.50	0.99	1.25	2.85	1.14	2.44	2.00	
03/03/2025 17:30	8.97	1.09	3.11	0.70	1.95	1.66	1.26	1.15	1.51	0.99	1.25	2.86	1.14	2.44	2.00	
03/03/2025 17:45	8.97	1.09	3.12	0.69	1.96	1.66	1.28	1.16	1.51	0.99	1.25	2.85	1.14	2.44	2.00	
03/03/2025 18:00	8.97	1.09	3.11	0.66	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.14	2.43	1.99	
03/03/2025 18:15	8.97	1.09	3.11	0.65	1.95	1.66	1.27	1.15	1.50	0.98	1.25	2.85	1.14	2.42	1.99	
03/03/2025 18:30	8.97	1.09	3.11	0.64	1.95	1.66	1.28	1.15	1.52	0.98	1.25	2.85	1.14	2.42	2.00	
03/03/2025 18:45	8.97	1.09	3.11	0.63	1.95	1.66	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.41	1.99	
03/03/2025 19:00	8.97	1.09	3.11	0.62	1.95	1.66	1.27	1.15	1.51	0.98	1.24	2.85	1.14	2.41	1.99	
03/03/2025 19:15	8.97	1.09	3.11	0.61	1.95	1.66	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.41	2.00	
03/03/2025 19:30	8.97	1.09	3.11	0.61	1.95	1.66	1.27	1.15	1.51	0.99	1.24	2.85	1.14	2.40	1.99	
03/03/2025 19:45	8.97	1.08	3.11	0.62	1.95	1.66	1.27	1.15	1.50	0.98	1.25	2.85	1.13	2.40	1.99	
03/03/2025 20:00	8.97	1.09	3.11	0.63	1.95	1.66	1.28	1.15	1.50	0.98	1.25	2.85	1.13	2.39	1.99	
03/03/2025 20:15	8.96	1.09	3.11	0.65	1.95	1.66	1.27	1.15	1.52	0.98	1.24	2.85	1.13	2.39	1.99	
03/03/2025 20:30	8.97	1.08	3.11	0.67	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.84	1.13	2.39	1.99	
03/03/2025 20:45	8.97	1.09	3.11	0.68	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.39	1.99	
03/03/2025 21:00	8.97	1.09	3.11	0.70	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.84	1.14	2.39	1.99	
03/03/2025 21:15	8.96	1.08	3.11	0.72	1.95	1.66	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.39	1.99	
03/03/2025 21:30	8.97	1.09	3.11	0.73	1.95	1.66	1.27	1.15	1.52	0.99	1.25	2.85	1.14	2.39	1.99	
03/03/2025 21:45	8.97	1.09	3.11	0.75	1.95	1.66	1.27	1.15	1.51	0.99	1.25	2.85	1.14	2.39	1.99	
03/03/2025 22:00	8.97	1.09	3.11	0.77	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.40	1.99	
03/03/2025 22:15	8.97	1.09	3.11	0.78	1.95	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.14	2.39	1.99	
03/03/2025 22:30	8.97	1.08	3.11	0.80	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.40	1.99	
03/03/2025 22:45	8.97	1.09	3.11	0.81	1.95	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.13	2.40	1.99	
03/03/2025 23:00	8.97	1.09	3.11	0.83	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.41	1.99	
03/03/2025 23:15	8.97	1.09	3.11	0.85	1.95	1.66	1.28	1.15	1.52	0.99	1.25	2.85	1.13	2.41	2.00	
03/03/2025 23:30	8.97	1.08	3.11	0.86	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.41	2.00	
03/03/2025 23:45	8.97	1.08	3.11	0.88	1.95	1.66	1.28	1.15	1.51	0.98	1.25	2.84	1.13	2.42	1.99	
04/03/2025 00:00	8.97	1.09	3.11	0.90	1.96	1.66	1.27	1.15	1.51	0.98	1.25	2.85	1.13	2.42	2.00	
04/03/2025 00:15	8.97	1.09	3.11	0.90	1.95	1.66	1.27	1.15	1.50	0.98	1.25	2.85	1.13	2.42	1.99	
04/03/2025 00:30	8.97	1.08	3.11	0.92	1.95	1.66	1.28	1.15	1.51	0.98	1.25	2.85	1.13	2.43	1.99	
04/03/2025 00:45	8.96	1.09	3.11	0.92	1.95	1.66	1.27	1.15	1.50	0.99	1.25	2.85	1.13	2.42	1.99	
04/03/2025 01:00	8.97	1.09	3.11	0.93	1.96	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.13	2.43	1.99	
04/03/2025 01:15	8.97	1.09	3.11	0.93	1.95	1.66	1.28	1.15	1.51	0.98	1.25	2.85	1.13	2.43	1.99	
04/03/2025 01:30	8.96	1.08	3.11	0.92	1.95	1.66	1.28	1.15	1.51	0.98	1.25	2.85	1.13	2.43	1.99	
04/03/2025 01:45	8.97	1.09	3.11	0.92	1.95	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.13	2.44	1.99	
04/03/2025 02:00	8.96	1.08	3.11	0.92	1.95	1.66	1.28	1.15	1.51	0.98	1.25	2.85	1.14	2.44	1.99	
04/03/2025 02:15	8.96	1.08	3.11	0.91	1.95	1.66	1.28	1.15	1.51	0.98	1.24	2.84	1.13	2.44	1.99	
04/03/2025 02:30	8.97	1.09	3.12	0.92	1.96	1.66	1.28	1.15	1.52	0.98	1.24	2.85	1.13	2.44	1.99	
04/03/2025 02:45	8.96	1.09	3.11	0.91	1.95	1.66	1.28	1.15	1.51	0.98	1.25	2.85	1.13	2.45	1.99	
04/03/2025 03:00	8.97	1.09	3.11	0.90	1.96	1.66	1.28	1.15	1.51	0.98	1.25	2.85	1.13	2.45	2.00	
04/03/2025 03:15	8.97	1.09	3.11	0.89	1.95	1.66	1.27	1.15	1.52	0.98	1.25	2.84	1.13	2.45	1.99	
04/03/2025 03:30	8.96	1.09	3.11	0.87	1.95	1.66	1.27	1.15	1.51	0.99	1.25	2.84	1.13	2.45	1.99	
04/03/2025 03:45	8.97	1.09	3.11	0.85	1.95	1.66	1.28	1.15	1.52	0.98	1.24	2.84	1.13	2.46	1.99	
04/03/2025 04:00	8.97	1.09	3.11	0.84	1.95	1.66	1.26	1.15	1.52	0.99	1.25	2.84	1.13	2.46	1.99	
04/03/2025 04:15	8.96	1.09	3.11	0.81	1.95	1.66	1.27	1.15	1.50	0.99	1.25	2.85	1.13	2.46	1.99	
04/03/2025 04:30	8.97	1.09	3.11	0.79	1.95	1.66	1.28	1.15	1.51	0.98	1.24	2.84	1.13	2.46	1.99	
04/03/2025 04:45	8.96	1.08	3.11	0.77	1.95	1.66	1.28	1.15	1.51	0.99	1.25	2.84	1.13	2.45	1.99	
04/03/2025 05:00	8.97	1.09	3.11	0.75	1.95	1.66	1.27	1.15	1.51	0.99	1.26	2.84	1.13	2.45	1.99	
04/03/2025 05:15	8.96	1.09	3.11	0.73	1.95	1.66	1.28	1.15	1.52	0.99	1.25	2.84	1.13	2.45	1.99	
04/03/2025 05:30	8.97	1.09	3.11	0.71	1.95	1.66	1.28	1.15	1.52	0.99	1.25	2.84	1.13	2.44	1.99	
04/03/2025 05:45	8.97	1.08	3.11	0.69	1.95	1.66	1.28	1.15	1.52	0.99	1.24	2.84	1.13	2.43	1.99	
04/03/2025 06:00	8.97	1.09	3.11	0.67	1.96	1.66	1.28	1.15	1.51	0.99	1.25	2.85	1.13	2.43	1.99	
04/03/2025 06:15	8.96	1.08	3.10	0.64	1.95	1.66	1.28	1.15	1.51	0.98	1.24	2.84	1.13	2.42	1.99	
04/03/2025 06:30	8.96	1.09	3.11	0.63	1.95	1.66	1.27	1.15	1.51	0.98	1.24	2.84	1.13	2.42	1.99	
04/03/2025 06:45	8.96	1.08	3.11	0.61	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.84	1.13	2.41	1.99	
04/03/2025 07:00	8.97	1.09	3.11	0.60	1.96	1.66	1.27	1.15	1.51	0.99	1.24	2.84	1.13	2.41	1.99	
04/03/2025 07:15	8.96	1.09	3.11	0.58	1.95	1.65	1.27	1.15	1.51	0.98	1.25	2.84	1.13	2.40	1.99	
04/03/2025 07:30	8.96	1.09	3.11	0.57	1.95	1.66	1.27	1.15	1.51	0.98	1.25	2.84	1.12	2.40	1.99	
04/03/2025 07:45	8.96	1.09	3.11	0.56	1.95	1.66	1.27	1.15	1.53	0.99	1.24	2.84	1.13	2.40	1.99	
04/03/2025 08:00	8.96	1.09	3.10	0.56	1.95	1.65	1.27	1.15	1.52	0.99	1.24	2.84	1.13	2.38	1.99	
04/03/2025 08:15	8.96	1.08	3.11	0.56	1.95	1.65	1.26	1.15	1.52	0.98	1.24	2.84	1.13	2.38	1.99	
04/03/2025 08:30	8.96	1.09	3.11	0.56	1.95	1.65	1.27	1.15	1.52	0.97	1.24	2.84	1.13	2.38	1.99	
04/03/2025 08:45	8.96	1.08	3.10	0.57	1.95	1.65	1.26	1.14	1.52	0.98	1.24	2.83	1.12	2.38	1.99	
04/03/2025 09:00	8.96	1.08	3.10	0.59	1.94	1.65	1.26	1.15	1.50	0.98	1.24	2.84	1.13	2.37	1.99	
04/03/2025 09:15	8.96	1.08	3.11	0.60	1.94	1.65	1.27	1.15	1.51	0.98	1.25	2.84	1.12	2.37	1.99	
04/03/2025 09:30	8.96	1.08	3.10	0.61	1.94	1.64	1.26	1.14	1.50	0.98	1.24	2.84	1.12	2.37	1.98	
04/03/2025 09:45	8.96	1.08	3.10	0.62	1.94	1.65	1.27	1.15	1.50	0.97	1.24	2.84	1.12	2.36	1.99	
04/03/2025 10:00	8.96	1.08	3.10	0.63	1.94	1.65	1.27	1.14	1.51	0.97	1.25	2.84	1.12	2.36	1.98	
04/03/2025 10:15	8.96	1.08	3.10	0.65	1.94	1.65	1.26	1.15	1.51	0.97	1.24	2.84	1.12	2.35	1.99	
04/03/2025 10:30	8.96	1.08	3.10	0.66	1.94	1.65	1.26	1.15	1.52	0.97	1.24	2.84	1.12	2.35	1.98	
04/03/2025 10:45	8.96	1.08	3.10	0.68	1.94	1.65	1.26	1.16	1.51	0.98	1.25	2.84	1.12	2.35	1.99	
04/03/2025 11:00	8.96	1.08	3.10	0.69	1.94	1.65	1.26	1.15	1.51	0.97	1.24	2.83	1.12	2.35	1.99	
04/03/2025 11:15	8.96	1.08	3.10	0.70	1.94	1.66	1.26	1.15	1.52	0.97	1.25	2.84	1.12	2.35	1.99	
04/03/2025 11:30	8.96	1.08	3.10	0.72	1.94	1.66	1.27	1.15	1.52	0.98	1.25	2.84	1.12	2.36	1.99	
04/03/2025 11:45	8.96	1.08	3.10	0.73	1.94	1.66	1.27	1.15	1.53	0.98	1.25	2.84	1.12	2.36	1.99	
04/03/2025 12:00	8.96	1.09	3.10	0.75	1.95	1.66	1.27	1.15	1.53	0.99	1.24	2.84	1.13	2.37	1.99	
04/03/2025 12:15	8.96	1.08	3.10	0.77	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.84	1.12	2.37	1.99	
04/03/2025 12:30	8.96	1.08	3.10	0.78	1.95	1.66	1.27	1.15	1.53	0.99	1.25	2.84	1.12	2.37	1.99	
04/03/2025 12:45	8.96	1.08	3.10	0.79	1.95	1.66	1.26	1.15	1.52	0.97	1.24	2.84	1.12	2.38	1.99	
04/03/2025 13:00	8.96	1.08	3.10	0.81	1.95	1.66	1.27	1.15	1.53	0.98	1.24	2.84	1.13	2.38	1.99	
04/03/2025 13:15	8.96	1.08	3.11	0.82	1.95	1.66	1.26	1.15	1.52	0.98	1.24	2.84	1.13	2.38	1.99	
04/03/2025 13:30	8.96	1.08	3.10	0.83	1.96	1.66	1.26	1.15	1.51	0.98	1.24	2.84	1.13	2.38	1.99	
04/03/2025 13:45	8.96	1.09	3.10	0.84	1.95	1.66	1.27	1.15	1.54	0.98	1.24	2.84	1.13	2.39	1.99	
04/03/2025 14:00	8.96	1.09	3.10	0.84	1.95	1.66	1.26	1.15	1.53	0.99	1.24	2.84	1.13	2.39	2.00	
04/03/2025 14:15	8.96	1.08	3.10	0.85	1.95	1.66	1.27	1.15	1.54	0.98	1.24	2.84	1.13	2.39	1.99	
04/03/2025 14:30	8.96	1.08	3.11	0.85	1.95	1.66	1.27	1.15	1.53	0.99	1.24	2.85	1.13	2.39	1.99	
04/03/2025 14:45	8.96	1.08	3.11	0.86	1.95	1.66	1.26	1.15	1.53	0.97	1.25	2.84	1.12	2.39	1.99	
04/03/2025 15:00	8.96	1.08	3.10	0.86	1.95	1.66	1.26	1.15	1.53	0.98	1.24	2.84	1.12	2.40	1.99	
04/03/2025 15:15	8.96	1.09	3.10	0.85	1.95	1.66	1.27	1.15	1.51	0.99	1.24	2.84	1.13	2.40	1.99	
04/03/2025 15:30	8.96	1.08	3.10	0.85	1.95	1.66	1.27	1.15	1.52	0.99	1.25	2.84	1.13	2.40	2.00	
04/03/2025 15:45	8.96	1.09	3.11	0.83	1.95	1.66	1.27	1.15	1.52	0.99	1.25	2.84	1.13	2.41	1.99	
04/03/2025 16:00	8.96	1.09	3.11	0.82	1.96	1.66	1.27	1.15	1.53	0.99	1.24	2.85	1.13	2.41	2.00	
04/03/2025 16:15	8.97	1.09	3.11	0.80	1.96	1.66	1.27	1.15	1.52	0.99	1.25	2.84	1.13	2.42	2.00	
04/03/2025 16:30	8.96	1.09	3.11	0.78	1.96	1.66	1.27	1.15	1.53	0.99	1.25	2.85	1.13	2.41	2.00	
04/03/2025 16:45	8.96	1.09	3.11	0.76	1.96	1.66	1.27	1.17	1.53	0.98	1.25	2.85	1.14	2.41	2.00	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
04/03/2025 17:00	8.96	1.09	3.11	0.74	1.96	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.13	2.41	2.00	
04/03/2025 17:15	8.96	1.09	3.11	0.72	1.95	1.66	1.27	1.16	1.52	0.99	1.25	2.85	1.13	2.40	2.00	
04/03/2025 17:30	8.96	1.09	3.11	0.71	1.95	1.66	1.27	1.16	1.52	0.99	1.25	2.85	1.14	2.40	2.00	
04/03/2025 17:45	8.97	1.09	3.11	0.69	1.95	1.66	1.27	1.16	1.53	0.99	1.24	2.85	1.14	2.40	2.00	
04/03/2025 18:00	8.96	1.09	3.11	0.67	1.95	1.66	1.28	1.16	1.52	0.99	1.25	2.85	1.13	2.39	1.99	
04/03/2025 18:15	8.96	1.09	3.11	0.65	1.95	1.66	1.27	1.15	1.53	0.98	1.24	2.85	1.13	2.39	1.99	
04/03/2025 18:30	8.96	1.09	3.11	0.64	1.95	1.65	1.27	1.15	1.52	0.99	1.24	2.85	1.13	2.38	1.99	
04/03/2025 18:45	8.96	1.09	3.11	0.62	1.95	1.65	1.27	1.16	1.52	0.98	1.25	2.85	1.13	2.38	1.99	
04/03/2025 19:00	8.97	1.09	3.11	0.61	1.95	1.65	1.27	1.16	1.53	0.98	1.25	2.85	1.13	2.38	1.99	
04/03/2025 19:15	8.97	1.09	3.11	0.60	1.95	1.66	1.27	1.15	1.53	0.99	1.25	2.85	1.13	2.37	2.00	
04/03/2025 19:30	8.97	1.09	3.11	0.59	1.95	1.66	1.27	1.15	1.52	0.99	1.24	2.85	1.13	2.36	2.00	
04/03/2025 19:45	8.97	1.09	3.11	0.58	1.95	1.66	1.28	1.16	1.52	0.99	1.25	2.85	1.13	2.36	1.99	
04/03/2025 20:00	8.97	1.09	3.11	0.57	1.95	1.66	1.27	1.16	1.52	0.99	1.24	2.85	1.14	2.35	1.99	
04/03/2025 20:15	8.96	1.08	3.11	0.58	1.95	1.65	1.27	1.15	1.51	0.97	1.24	2.84	1.13	2.35	1.99	
04/03/2025 20:30	8.97	1.09	3.11	0.58	1.95	1.65	1.27	1.15	1.52	0.99	1.24	2.85	1.13	2.35	1.99	
04/03/2025 20:45	8.96	1.08	3.10	0.60	1.95	1.65	1.28	1.15	1.53	0.99	1.24	2.85	1.13	2.35	1.99	
04/03/2025 21:00	8.97	1.09	3.11	0.62	1.95	1.66	1.27	1.15	1.52	0.98	1.24	2.85	1.14	2.34	2.00	
04/03/2025 21:15	8.97	1.09	3.11	0.63	1.95	1.66	1.27	1.15	1.54	0.98	1.25	2.85	1.13	2.34	1.99	
04/03/2025 21:30	8.96	1.09	3.11	0.65	1.95	1.66	1.27	1.16	1.52	0.99	1.25	2.85	1.14	2.34	2.00	
04/03/2025 21:45	8.97	1.09	3.11	0.67	1.95	1.66	1.27	1.15	1.52	0.98	1.24	2.85	1.14	2.34	1.99	
04/03/2025 22:00	8.96	1.09	3.11	0.68	1.95	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.14	2.33	1.99	
04/03/2025 22:15	8.96	1.09	3.11	0.70	1.95	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.13	2.34	1.99	
04/03/2025 22:30	8.96	1.09	3.11	0.72	1.95	1.66	1.27	1.15	1.51	0.99	1.24	2.85	1.13	2.34	1.99	
04/03/2025 22:45	8.96	1.09	3.11	0.73	1.95	1.66	1.27	1.15	1.53	0.98	1.24	2.85	1.13	2.34	2.00	
04/03/2025 23:00	8.97	1.09	3.10	0.74	1.95	1.66	1.27	1.15	1.53	0.98	1.24	2.85	1.13	2.34	2.00	
04/03/2025 23:15	8.97	1.09	3.11	0.76	1.95	1.66	1.28	1.16	1.52	0.98	1.24	2.85	1.14	2.34	2.00	
04/03/2025 23:30	8.96	1.09	3.10	0.77	1.95	1.66	1.28	1.16	1.53	0.98	1.24	2.85	1.14	2.35	2.00	
04/03/2025 23:45	8.96	1.09	3.11	0.79	1.95	1.66	1.28	1.16	1.53	0.99	1.24	2.85	1.14	2.35	2.00	
05/03/2025 00:00	8.97	1.09	3.11	0.81	1.95	1.66	1.28	1.15	1.52	0.99	1.24	2.85	1.14	2.35	1.99	
05/03/2025 00:15	8.96	1.09	3.11	0.82	1.95	1.66	1.28	1.16	1.53	0.99	1.24	2.85	1.13	2.35	1.99	
05/03/2025 00:30	8.96	1.08	3.11	0.84	1.95	1.66	1.28	1.15	1.51	0.98	1.24	2.85	1.13	2.36	1.99	
05/03/2025 00:45	8.96	1.09	3.11	0.85	1.95	1.66	1.27	1.16	1.51	0.98	1.24	2.85	1.14	2.36	1.99	
05/03/2025 01:00	8.96	1.09	3.11	0.87	1.95	1.66	1.27	1.15	1.53	0.98	1.25	2.85	1.14	2.36	1.99	
05/03/2025 01:15	8.96	1.09	3.11	0.88	1.95	1.66	1.29	1.16	1.53	0.98	1.24	2.85	1.14	2.36	1.99	
05/03/2025 01:30	8.96	1.09	3.11	0.89	1.95	1.66	1.27	1.16	1.53	0.99	1.24	2.85	1.14	2.37	2.00	
05/03/2025 01:45	8.96	1.09	3.11	0.90	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.85	1.14	2.37	2.00	
05/03/2025 02:00	8.96	1.09	3.11	0.89	1.96	1.66	1.27	1.15	1.52	0.98	1.24	2.85	1.14	2.37	1.99	
05/03/2025 02:15	8.96	1.09	3.11	0.90	1.96	1.66	1.27	1.16	1.53	0.99	1.25	2.85	1.14	2.37	1.99	
05/03/2025 02:30	8.96	1.09	3.11	0.90	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.85	1.14	2.37	2.00	
05/03/2025 02:45	8.96	1.09	3.11	0.90	1.95	1.66	1.27	1.15	1.53	0.99	1.25	2.85	1.14	2.37	1.99	
05/03/2025 03:00	8.96	1.08	3.11	0.90	1.95	1.65	1.27	1.15	1.52	0.98	1.25	2.85	1.14	2.38	1.99	
05/03/2025 03:15	8.96	1.08	3.11	0.90	1.95	1.65	1.26	1.15	1.52	0.98	1.25	2.85	1.13	2.38	1.99	
05/03/2025 03:30	8.96	1.09	3.11	0.90	1.95	1.66	1.27	1.16	1.52	0.99	1.25	2.85	1.14	2.39	1.99	
05/03/2025 03:45	8.96	1.09	3.11	0.89	1.95	1.66	1.28	1.16	1.52	0.99	1.25	2.85	1.14	2.39	1.99	
05/03/2025 04:00	8.96	1.09	3.11	0.88	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.85	1.14	2.39	2.00	
05/03/2025 04:15	8.96	1.09	3.11	0.86	1.95	1.66	1.27	1.16	1.51	0.98	1.25	2.85	1.14	2.39	1.99	
05/03/2025 04:30	8.96	1.09	3.11	0.85	1.95	1.66	1.27	1.16	1.53	0.99	1.25	2.85	1.14	2.39	1.99	
05/03/2025 04:45	8.96	1.08	3.11	0.82	1.95	1.65	1.27	1.15	1.52	0.98	1.24	2.85	1.14	2.39	1.99	
05/03/2025 05:00	8.96	1.09	3.11	0.81	1.95	1.65	1.27	1.15	1.52	0.98	1.25	2.85	1.14	2.39	1.99	
05/03/2025 05:15	8.96	1.09	3.11	0.79	1.95	1.65	1.27	1.15	1.52	0.97	1.24	2.85	1.14	2.40	1.99	
05/03/2025 05:30	8.96	1.08	3.11	0.77	1.95	1.65	1.27	1.15	1.52	0.98	1.25	2.84	1.14	2.40	1.99	
05/03/2025 05:45	8.96	1.09	3.11	0.75	1.95	1.66	1.27	1.15	1.53	0.98	1.25	2.85	1.14	2.39	1.99	
05/03/2025 06:00	8.96	1.09	3.11	0.73	1.95	1.66	1.27	1.15	1.53	0.98	1.24	2.85	1.14	2.39	1.99	
05/03/2025 06:15	8.96	1.09	3.11	0.71	1.95	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.14	2.38	1.99	
05/03/2025 06:30	8.96	1.09	3.11	0.69	1.95	1.66	1.27	1.15	1.52	0.98	1.24	2.85	1.14	2.38	1.99	
05/03/2025 06:45	8.96	1.09	3.11	0.67	1.95	1.66	1.27	1.15	1.53	0.99	1.25	2.85	1.14	2.37	1.99	
05/03/2025 07:00	8.96	1.09	3.10	0.66	1.95	1.65	1.27	1.15	1.52	0.98	1.24	2.85	1.14	2.37	1.99	
05/03/2025 07:15	8.96	1.08	3.10	0.64	1.95	1.66	1.27	1.16	1.54	0.98	1.24	2.85	1.14	2.36	1.99	
05/03/2025 07:30	8.96	1.08	3.11	0.63	1.95	1.66	1.27	1.15	1.54	0.98	1.25	2.85	1.14	2.36	1.99	
05/03/2025 07:45	8.96	1.09	3.11	0.61	1.95	1.66	1.27	1.15	1.52	0.98	1.24	2.85	1.14	2.36	1.99	
05/03/2025 08:00	8.96	1.09	3.10	0.60	1.95	1.65	1.26	1.15	1.52	0.97	1.25	2.85	1.14	2.35	1.99	
05/03/2025 08:15	8.96	1.08	3.11	0.59	1.95	1.65	1.27	1.15	1.52	0.97	1.25	2.85	1.14	2.35	1.99	
05/03/2025 08:30	8.95	1.08	3.10	0.59	1.94	1.65	1.26	1.15	1.53	0.98	1.24	2.84	1.13	2.34	1.99	
05/03/2025 08:45	8.96	1.08	3.10	0.58	1.94	1.65	1.26	1.15	1.51	0.97	1.24	2.84	1.13	2.34	1.98	
05/03/2025 09:00	8.96	1.09	3.10	0.59	1.95	1.65	1.26	1.15	1.52	0.98	1.24	2.85	1.14	2.33	1.99	
05/03/2025 09:15	8.96	1.08	3.10	0.59	1.95	1.65	1.27	1.15	1.51	0.97	1.25	2.85	1.13	2.33	1.99	
05/03/2025 09:30	8.96	1.08	3.10	0.60	1.94	1.65	1.27	1.15	1.52	0.98	1.24	2.84	1.14	2.33	1.99	
05/03/2025 09:45	8.96	1.08	3.10	0.61	1.94	1.65	1.27	1.15	1.52	0.98	1.24	2.84	1.14	2.32	1.99	
05/03/2025 10:00	8.96	1.08	3.10	0.62	1.94	1.65	1.28	1.15	1.51	0.98	1.24	2.85	1.14	2.32	1.99	
05/03/2025 10:15	8.96	1.08	3.10	0.63	1.94	1.65	1.27	1.15	1.52	0.97	1.24	2.84	1.13	2.31	1.99	
05/03/2025 10:30	8.96	1.08	3.10	0.64	1.94	1.65	1.27	1.15	1.52	0.98	1.24	2.84	1.13	2.31	1.98	
05/03/2025 10:45	8.96	1.08	3.10	0.65	1.94	1.65	1.28	1.15	1.52	0.98	1.24	2.84	1.14	2.31	1.99	
05/03/2025 11:00	8.96	1.08	3.10	0.66	1.95	1.66	1.27	1.15	1.52	0.97	1.24	2.85	1.13	2.31	1.99	
05/03/2025 11:15	8.96	1.08	3.10	0.68	1.94	1.66	1.27	1.15	1.52	0.97	1.24	2.84	1.13	2.31	1.99	
05/03/2025 11:30	8.96	1.08	3.11	0.69	1.95	1.66	1.28	1.15	1.53	0.98	1.24	2.85	1.14	2.31	1.99	
05/03/2025 11:45	8.96	1.08	3.10	0.70	1.95	1.66	1.27	1.15	1.53	0.97	1.25	2.85	1.13	2.31	1.99	
05/03/2025 12:00	8.96	1.08	3.10	0.72	1.95	1.66	1.27	1.15	1.53	0.97	1.24	2.84	1.14	2.31	1.99	
05/03/2025 12:15	8.96	1.08	3.10	0.73	1.94	1.66	1.27	1.15	1.54	0.98	1.24	2.85	1.13	2.32	1.99	
05/03/2025 12:30	8.96	1.09	3.10	0.75	1.95	1.66	1.27	1.15	1.53	0.97	1.24	2.85	1.13	2.32	1.99	
05/03/2025 12:45	8.96	1.08	3.11	0.76	1.95	1.66	1.27	1.15	1.54	0.98	1.25	2.85	1.14	2.32	1.99	
05/03/2025 13:00	8.96	1.08	3.10	0.78	1.95	1.66	1.27	1.15	1.54	0.97	1.24	2.85	1.14	2.33	1.99	
05/03/2025 13:15	8.96	1.09	3.11	0.78	1.95	1.66	1.27	1.15	1.53	0.98	1.24	2.85	1.14	2.33	1.99	
05/03/2025 13:30	8.96	1.08	3.10	0.79	1.95	1.66	1.27	1.16	1.54	0.98	1.24	2.85	1.13	2.33	1.99	
05/03/2025 13:45	8.96	1.09	3.11	0.81	1.95	1.66	1.27	1.15	1.53	0.98	1.25	2.85	1.14	2.34	1.99	
05/03/2025 14:00	8.96	1.08	3.10	0.82	1.95	1.66	1.27	1.16	1.52	0.97	1.24	2.85	1.14	2.33	1.99	
05/03/2025 14:15	8.95	1.08	3.11	0.82	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.85	1.14	2.34	1.99	
05/03/2025 14:30	8.96	1.09	3.11	0.83	1.95	1.66	1.27	1.15	1.53	0.98	1.24	2.85	1.14	2.34	1.99	
05/03/2025 14:45	8.96	1.08	3.11	0.83	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.85	1.14	2.34	1.99	
05/03/2025 15:00	8.96	1.08	3.11	0.84	1.95	1.66	1.27	1.15	1.53	0.97	1.25	2.85	1.14	2.34	1.99	
05/03/2025 15:15	8.96	1.08	3.11	0.84	1.95	1.66	1.27	1.15	1.52	0.98	1.25	2.85	1.14	2.34	1.99	
05/03/2025 15:30	8.96	1.09	3.11	0.84	1.95	1.66	1.26	1.16	1.53	0.98	1.24	2.85	1.14	2.35	1.99	
05/03/2025 15:45	8.96	1.08	3.11	0.84	1.95	1.66	1.27	1.15	1.53	0.97	1.24	2.85	1.13	2.35	1.99	
05/03/2025 16:00	8.96	1.09	3.10	0.84	1.95	1.66	1.26	1.15	1.52	0.98	1.25	2.85	1.14	2.36	1.99	
05/03/2025 16:15	8.96	1.09	3.11	0.83	1.95	1.66	1.27	1.15	1.53	0.98	1.25	2.85	1.14	2.36	1.99	
05/03/2025 16:30	8.96	1.09	3.11	0.82	1.95	1.65	1.27	1.16	1.52	0.98	1.24	2.85	1.14	2.36	1.99	
05/03/2025 16:45	8.96	1.09	3.11	0.80	1.95	1.66	1.27	1.16	1.53	0.97	1.24	2.85	1.15	2.37	1.99	
05/03/2025 17:00	8.96	1.09	3.10	0.79	1.95	1.65	1.27	1.15	1.53	0.97	1.24	2.85	1.14	2.37	1.99	
05/03/2025 17:15	8.96	1.08	3.10	0.77	1.95	1.65	1.27	1.16	1.53	0.97	1.24	2.85	1.14	2.37	1.99	
05/03/2025 17:30	8.96	1.09	3.11	0.76	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.85	1.14	2.37	1.99	
05/03/2025 17:45	8.96	1.09	3.11	0.74	1.95	1.66	1.27	1.16	1.51	0.97	1.25	2.85	1.14	2.37	1.99	
05/03/2025 18:00	8.96	1.09	3.11	0.73	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.85	1.14	2.37	1.99	
05/03/2025 18:15	8.96	1.09	3.11	0.71	1.95	1.66	1.28	1.16	1.52	0.97	1.25	2.86	1.14	2.37	2.00	
05/03/2025 18:30	8.96	1.09	3.11	0.70	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.85	1.14	2.36	1.99	
05/03/2025 18:45	8.97	1.09	3.11	0.69	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.36	1.99	
05/03/2025 19:00	8.97	1.09	3.11	0.67	1.95	1.66	1.27	1.16	1.53	0.97	1.25	2.86	1.15	2.35	2.00	
05/03/2025 19:15	8.97	1.09	3.11	0.66	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.34	2.00	
05/03/2025 19:30	8.96	1.09	3.11	0.65	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.34	1.99	
05/03/2025 19:45	8.96	1.09	3.11	0.63	1.95	1.66	1.28	1.16	1.52	0.98	1.24	2.86	1.14	2.34	1.99	
05/03/2025 20:00	8.97	1.09	3.11	0.62	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.33	1.99	
05/03/2025 20:15	8.97	1.09	3.11	0.61	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.34	2.00	
05/03/2025 20:30	8.96	1.09	3.11	0.61	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.85	1.14	2.33	1.99	
05/03/2025 20:45	8.97	1.09	3.11	0.61	1.95	1.66	1.28	1.16	1.53	0.97	1.24	2.86	1.14	2.32	1.99	
05/03/2025 21:00	8.96	1.09	3.11	0.61	1.95	1.66	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.32	1.99	
05/03/2025 21:15	8.96	1.09	3.11	0.62	1.95	1.66	1.27	1.16	1.53	0.97	1.24	2.86	1.14	2.31	1.99	
05/03/2025 21:30	8.97	1.09	3.11	0.63	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.14	2.31	2.00	
05/03/2025 21:45	8.96	1.09	3.11	0.64	1.95	1.66	1.28	1.16	1.52	0.97	1.24	2.85	1.14	2.31	1.99	
05/03/2025 22:00	8.96	1.08	3.11	0.66	1.96	1.66	1.28	1.16	1.52	0.97	1.24	2.85	1.15	2.30	2.00	
05/03/2025 22:15	8.96	1.09	3.11	0.67	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.30	1.99	
05/03/2025 22:30	8.96	1.09	3.11	0.69	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.31	2.00	
05/03/2025 22:45	8.96	1.09	3.11	0.70	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.31	1.99	
05/03/2025 23:00	8.96	1.09	3.11	0.72	1.96	1.66	1.27	1.16	1.52	0.99	1.24	2.86	1.15	2.31	1.99	
05/03/2025 23:15	8.96	1.09	3.11	0.73	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.31	2.00	
05/03/2025 23:30	8.96	1.09	3.11	0.74	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.31	1.99	
05/03/2025 23:45	8.96	1.09	3.11	0.76	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.86	1.14	2.31	1.99	
06/03/2025 00:00	8.96	1.09	3.11	0.77	1.96	1.66	1.28	1.15	1.52	0.98	1.24	2.86	1.15	2.32	2.00	
06/03/2025 00:15	8.96	1.09	3.11	0.79	1.95	1.66	1.28	1.16	1.52	0.97	1.24	2.86	1.15	2.31	1.99	
06/03/2025 00:30	8.96	1.09	3.11	0.80	1.95	1.66	1.28	1.16	1.52	0.98	1.24	2.86	1.15	2.32	1.99	
06/03/2025 00:45	8.97	1.09	3.11	0.82	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.32	2.00	
06/03/2025 01:00	8.96	1.08	3.11	0.84	1.95	1.66	1.27	1.16	1.53	0.97	1.25	2.86	1.15	2.32	1.99	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
06/03/2025 01:15	8.96	1.09	3.11	0.85	1.95	1.66	1.27	1.16	1.51	0.97	1.24	2.86	1.15	2.33	1.99	
06/03/2025 01:30	8.96	1.09	3.11	0.87	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.33	2.00	
06/03/2025 01:45	8.96	1.09	3.11	0.88	1.95	1.66	1.27	1.16	1.54	0.98	1.25	2.86	1.15	2.33	2.00	
06/03/2025 02:00	8.96	1.09	3.11	0.89	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.86	1.15	2.33	1.99	
06/03/2025 02:15	8.96	1.09	3.11	0.90	1.95	1.66	1.27	1.16	1.53	0.97	1.24	2.86	1.15	2.33	1.99	
06/03/2025 02:30	8.96	1.09	3.11	0.91	1.95	1.66	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.34	1.99	
06/03/2025 02:45	8.96	1.09	3.11	0.92	1.96	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.34	2.00	
06/03/2025 03:00	8.96	1.09	3.11	0.92	1.96	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.35	2.00	
06/03/2025 03:15	8.96	1.09	3.11	0.92	1.96	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.35	2.00	
06/03/2025 03:30	8.96	1.09	3.11	0.92	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.35	2.00	
06/03/2025 03:45	8.96	1.09	3.11	0.92	1.95	1.66	1.28	1.16	1.53	0.98	1.24	2.86	1.15	2.35	2.00	
06/03/2025 04:00	8.96	1.09	3.11	0.93	1.96	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.35	2.00	
06/03/2025 04:15	8.96	1.09	3.11	0.92	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.35	1.99	
06/03/2025 04:30	8.96	1.09	3.11	0.92	1.95	1.66	1.28	1.16	1.53	0.98	1.24	2.86	1.15	2.36	2.00	
06/03/2025 04:45	8.96	1.09	3.11	0.91	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.85	1.15	2.36	1.99	
06/03/2025 05:00	8.96	1.09	3.11	0.90	1.96	1.66	1.28	1.16	1.53	0.97	1.24	2.86	1.15	2.36	2.00	
06/03/2025 05:15	8.96	1.09	3.11	0.89	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.36	1.99	
06/03/2025 05:30	8.96	1.09	3.11	0.87	1.95	1.66	1.28	1.16	1.53	0.98	1.24	2.86	1.15	2.37	1.99	
06/03/2025 05:45	8.96	1.09	3.11	0.85	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.37	2.00	
06/03/2025 06:00	8.96	1.09	3.11	0.84	1.95	1.66	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.37	2.00	
06/03/2025 06:15	8.96	1.09	3.11	0.82	1.95	1.66	1.28	1.16	1.53	0.97	1.24	2.86	1.15	2.38	2.00	
06/03/2025 06:30	8.96	1.09	3.11	0.80	1.95	1.66	1.27	1.16	1.53	0.97	1.25	2.86	1.15	2.38	1.99	
06/03/2025 06:45	8.96	1.09	3.11	0.79	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.86	1.15	2.38	1.99	
06/03/2025 07:00	8.96	1.09	3.11	0.77	1.95	1.65	1.28	1.16	1.52	0.97	1.25	2.86	1.15	2.38	1.99	
06/03/2025 07:15	8.96	1.09	3.12	0.76	1.95	1.66	1.28	1.16	1.54	0.97	1.25	2.86	1.15	2.37	2.00	
06/03/2025 07:30	8.96	1.09	3.11	0.74	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.37	1.99	
06/03/2025 07:45	8.96	1.09	3.11	0.72	1.95	1.66	1.28	1.16	1.51	0.97	1.25	2.85	1.15	2.37	1.99	
06/03/2025 08:00	8.96	1.09	3.11	0.71	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.36	1.99	
06/03/2025 08:15	8.96	1.09	3.11	0.69	1.95	1.65	1.27	1.16	1.53	0.97	1.24	2.86	1.15	2.35	1.99	
06/03/2025 08:30	8.96	1.09	3.11	0.69	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.85	1.15	2.35	1.99	
06/03/2025 08:45	8.96	1.09	3.11	0.68	1.95	1.66	1.27	1.16	1.52	0.98	1.23	2.85	1.15	2.34	1.99	
06/03/2025 09:00	8.96	1.09	3.11	0.68	1.95	1.66	1.26	1.16	1.52	0.98	1.24	2.85	1.15	2.34	1.99	
06/03/2025 09:15	8.96	1.09	3.11	0.67	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.34	1.99	
06/03/2025 09:30	8.96	1.09	3.11	0.67	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.85	1.15	2.33	1.99	
06/03/2025 09:45	8.96	1.08	3.11	0.68	1.95	1.66	1.28	1.16	1.53	0.98	1.24	2.85	1.14	2.33	1.99	
06/03/2025 10:00	8.96	1.08	3.10	0.69	1.95	1.66	1.27	1.15	1.52	0.97	1.24	2.85	1.15	2.32	1.99	
06/03/2025 10:15	8.96	1.09	3.11	0.69	1.95	1.66	1.27	1.16	1.52	0.97	1.24	2.86	1.15	2.32	1.99	
06/03/2025 10:30	8.96	1.08	3.10	0.70	1.94	1.66	1.26	1.15	1.51	0.98	1.25	2.85	1.15	2.31	1.99	
06/03/2025 10:45	8.95	1.09	3.11	0.70	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.85	1.14	2.31	1.99	
06/03/2025 11:00	8.96	1.08	3.10	0.72	1.95	1.66	1.27	1.16	1.52	0.97	1.24	2.85	1.14	2.31	1.99	
06/03/2025 11:15	8.95	1.09	3.10	0.73	1.95	1.65	1.26	1.15	1.51	0.97	1.25	2.85	1.14	2.32	1.99	
06/03/2025 11:30	8.96	1.09	3.11	0.74	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.86	1.14	2.32	1.99	
06/03/2025 11:45	8.96	1.09	3.10	0.75	1.95	1.65	1.26	1.16	1.52	0.97	1.25	2.86	1.15	2.33	1.99	
06/03/2025 12:00	8.96	1.09	3.11	0.77	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.33	2.00	
06/03/2025 12:15	8.96	1.09	3.11	0.78	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.85	1.15	2.33	1.99	
06/03/2025 12:30	8.96	1.09	3.11	0.79	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.33	2.00	
06/03/2025 12:45	8.96	1.09	3.11	0.80	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.34	1.99	
06/03/2025 13:00	8.96	1.09	3.11	0.82	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.86	1.15	2.34	2.00	
06/03/2025 13:15	8.96	1.09	3.11	0.82	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.34	1.99	
06/03/2025 13:30	8.96	1.09	3.11	0.83	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.35	1.99	
06/03/2025 13:45	8.96	1.09	3.11	0.85	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.35	1.99	
06/03/2025 14:00	8.96	1.09	3.11	0.86	1.95	1.66	1.27	1.16	1.53	0.97	1.25	2.86	1.15	2.35	1.99	
06/03/2025 14:15	8.96	1.09	3.11	0.87	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.35	2.00	
06/03/2025 14:30	8.96	1.09	3.11	0.87	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.14	2.36	1.99	
06/03/2025 14:45	8.96	1.09	3.11	0.88	1.95	1.66	1.28	1.16	1.54	0.97	1.25	2.86	1.15	2.36	2.00	
06/03/2025 15:00	8.96	1.09	3.11	0.88	1.95	1.66	1.26	1.17	1.53	0.98	1.25	2.86	1.15	2.36	2.00	
06/03/2025 15:15	8.96	1.09	3.11	0.89	1.96	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.37	2.00	
06/03/2025 15:30	8.96	1.09	3.11	0.89	1.96	1.66	1.26	1.16	1.53	0.99	1.25	2.86	1.15	2.37	2.00	
06/03/2025 15:45	8.96	1.09	3.11	0.89	1.95	1.66	1.27	1.16	1.52	0.97	1.24	2.86	1.15	2.37	2.00	
06/03/2025 16:00	8.96	1.09	3.11	0.89	1.96	1.66	1.26	1.16	1.52	0.98	1.25	2.86	1.15	2.37	1.99	
06/03/2025 16:15	8.96	1.09	3.11	0.89	1.95	1.66	1.28	1.16	1.52	0.99	1.26	2.86	1.15	2.38	2.00	
06/03/2025 16:30	8.96	1.09	3.11	0.89	1.95	1.66	1.28	1.16	1.54	0.99	1.25	2.86	1.15	2.38	1.99	
06/03/2025 16:45	8.97	1.09	3.11	0.88	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.86	1.15	2.38	2.00	
06/03/2025 17:00	8.96	1.09	3.11	0.88	1.95	1.66	1.27	1.16	1.52	0.99	1.25	2.86	1.15	2.39	2.00	
06/03/2025 17:15	8.96	1.09	3.11	0.87	1.95	1.66	1.27	1.16	1.52	0.99	1.25	2.86	1.15	2.39	1.99	
06/03/2025 17:30	8.96	1.09	3.11	0.85	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.87	1.16	2.39	2.00	
06/03/2025 17:45	8.96	1.09	3.11	0.83	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.40	1.99	
06/03/2025 18:00	8.96	1.09	3.11	0.82	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.87	1.16	2.40	1.99	
06/03/2025 18:15	8.96	1.09	3.11	0.80	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.16	2.40	1.99	
06/03/2025 18:30	8.97	1.09	3.12	0.79	1.95	1.66	1.27	1.16	1.51	0.98	1.25	2.86	1.16	2.40	2.00	
06/03/2025 18:45	8.96	1.09	3.11	0.77	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.86	1.15	2.40	2.00	
06/03/2025 19:00	8.96	1.09	3.11	0.76	1.96	1.66	1.28	1.17	1.52	0.99	1.25	2.86	1.15	2.40	2.00	
06/03/2025 19:15	8.96	1.09	3.11	0.74	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.39	2.00	
06/03/2025 19:30	8.97	1.09	3.11	0.72	1.95	1.66	1.27	1.16	1.53	0.99	1.25	2.86	1.15	2.39	2.00	
06/03/2025 19:45	8.96	1.09	3.11	0.71	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.87	1.16	2.38	2.00	
06/03/2025 20:00	8.97	1.09	3.11	0.70	1.96	1.66	1.27	1.17	1.52	0.99	1.25	2.87	1.16	2.37	2.00	
06/03/2025 20:15	8.97	1.09	3.11	0.68	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.16	2.37	2.00	
06/03/2025 20:30	8.97	1.09	3.12	0.67	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.16	2.36	2.00	
06/03/2025 20:45	8.97	1.09	3.11	0.65	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.87	1.15	2.37	2.00	
06/03/2025 21:00	8.97	1.09	3.11	0.64	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.87	1.16	2.36	2.00	
06/03/2025 21:15	8.96	1.09	3.11	0.64	1.95	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.16	2.35	2.00	
06/03/2025 21:30	8.96	1.09	3.11	0.63	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.35	1.99	
06/03/2025 21:45	8.96	1.09	3.11	0.63	1.95	1.66	1.27	1.16	1.53	0.97	1.25	2.87	1.15	2.34	2.00	
06/03/2025 22:00	8.97	1.09	3.11	0.62	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.86	1.15	2.34	1.99	
06/03/2025 22:15	8.96	1.09	3.11	0.62	1.95	1.66	1.27	1.17	1.53	0.97	1.25	2.86	1.15	2.33	1.99	
06/03/2025 22:30	8.96	1.09	3.11	0.62	1.95	1.66	1.27	1.16	1.52	0.97	1.24	2.86	1.15	2.33	1.99	
06/03/2025 22:45	8.96	1.09	3.11	0.63	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.33	1.99	
06/03/2025 23:00	8.97	1.09	3.11	0.64	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.16	2.33	2.00	
06/03/2025 23:15	8.96	1.09	3.11	0.65	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.16	2.32	1.99	
06/03/2025 23:30	8.97	1.09	3.11	0.65	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.87	1.16	2.32	2.00	
06/03/2025 23:45	8.96	1.09	3.11	0.66	1.95	1.66	1.28	1.17	1.52	0.98	1.25	2.86	1.16	2.31	2.00	
07/03/2025 00:00	8.96	1.09	3.11	0.67	1.95	1.66	1.28	1.16	1.53	0.97	1.25	2.86	1.16	2.31	2.00	
07/03/2025 00:15	8.96	1.09	3.11	0.68	1.94	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.31	1.99	
07/03/2025 00:30	8.96	1.09	3.11	0.69	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.16	2.31	1.99	
07/03/2025 00:45	8.96	1.09	3.11	0.71	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.31	1.99	
07/03/2025 01:00	8.96	1.09	3.11	0.72	1.95	1.66	1.29	1.16	1.52	0.98	1.25	2.86	1.15	2.31	2.00	
07/03/2025 01:15	8.97	1.09	3.11	0.73	1.95	1.66	1.28	1.17	1.52	0.98	1.25	2.86	1.16	2.32	2.00	
07/03/2025 01:30	8.96	1.09	3.11	0.74	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.16	2.32	1.99	
07/03/2025 01:45	8.96	1.09	3.11	0.76	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.16	2.32	1.99	
07/03/2025 02:00	8.96	1.09	3.11	0.77	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.16	2.32	1.99	
07/03/2025 02:15	8.96	1.09	3.11	0.78	1.95	1.66	1.27	1.16	1.51	0.98	1.25	2.86	1.15	2.33	1.99	
07/03/2025 02:30	8.96	1.09	3.11	0.80	1.95	1.66	1.27	1.16	1.51	0.97	1.25	2.87	1.15	2.33	1.99	
07/03/2025 02:45	8.97	1.09	3.11	0.81	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.87	1.15	2.33	1.99	
07/03/2025 03:00	8.97	1.09	3.11	0.82	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.16	2.34	2.00	
07/03/2025 03:15	8.97	1.09	3.11	0.83	1.95	1.67	1.28	1.16	1.53	0.97	1.25	2.86	1.16	2.34	2.00	
07/03/2025 03:30	8.96	1.09	3.11	0.84	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.16	2.35	2.00	
07/03/2025 03:45	8.96	1.09	3.11	0.85	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.87	1.16	2.35	2.00	
07/03/2025 04:00	8.96	1.09	3.11	0.86	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.87	1.15	2.35	1.99	
07/03/2025 04:15	8.96	1.09	3.11	0.86	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.36	1.99	
07/03/2025 04:30	8.97	1.09	3.11	0.87	1.95	1.66	1.28	1.16	1.52	0.99	1.24	2.86	1.16	2.36	1.99	
07/03/2025 04:45	8.96	1.09	3.11	0.87	1.94	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.36	1.99	
07/03/2025 05:00	8.96	1.09	3.11	0.87	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.36	1.99	
07/03/2025 05:15	8.96	1.09	3.11	0.86	1.94	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.37	1.99	
07/03/2025 05:30	8.96	1.09	3.11	0.86	1.95	1.66	1.26	1.16	1.51	0.99	1.25	2.86	1.16	2.37	1.99	
07/03/2025 05:45	8.96	1.09	3.11	0.85	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.16	2.37	1.99	
07/03/2025 06:00	8.96	1.09	3.11	0.84	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.87	1.16	2.38	1.99	
07/03/2025 06:15	8.96	1.09	3.11	0.82	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.38	1.99	
07/03/2025 06:30	8.96	1.09	3.11	0.81	1.94	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.38	1.99	
07/03/2025 06:45	8.96	1.09	3.11	0.80	1.94	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.38	1.99	
07/03/2025 07:00	8.96	1.09	3.11	0.78	1.94	1.65	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.38	1.99	
07/03/2025 07:15	8.96	1.09	3.11	0.77	1.95	1.65	1.27	1.16	1.52	0.99	1.24	2.87	1.15	2.38	1.99	
07/03/2025 07:30	8.96	1.09	3.11	0.76	1.94	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.16	2.38	1.99	
07/03/2025 07:45	8.96	1.09	3.11	0.75	1.94	1.66	1.27	1.16	1.51	0.98	1.24	2.86	1.15	2.38	1.99	
07/03/2025 08:00	8.96	1.09	3.11	0.74	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.38	1.99	
07/03/2025 08:15	8.96	1.09	3.11	0.72	1.95	1.65	1.27	1.16	1.51	0.99	1.24	2.86	1.15	2.37	1.99	
07/03/2025 08:30	8.96	1.09	3.11	0.71	1.94	1.66	1.27	1.16	1.51	0.99	1.24	2.86	1.15	2.37	1.99	
07/03/2025 08:45	8.96	1.09	3.11	0.70	1.94	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.36	1.99	
07/03/2025 09:00	8.96	1.09	3.11	0.70	1.95	1.65	1.26	1.16	1.50	0.98	1.24	2.86	1.15	2.35	1.99	
07/03/2025 09:15	8.96	1.09	3.11	0.69	1.94	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.35	1.99	

Appendix C: Diver Water Level Data

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
07/03/2025 09:30	8.96	1.09	3.11	0.68	1.94	1.66	1.28	1.16	1.51	0.98	1.25	2.86	1.15	2.35	1.99	
07/03/2025 09:45	8.96	1.09	3.11	0.67	1.94	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.34	1.98	
07/03/2025 10:00	8.96	1.09	3.11	0.67	1.94	1.65	1.26	1.16	1.50	0.98	1.24	2.86	1.15	2.34	1.99	
07/03/2025 10:15	8.96	1.09	3.11	0.66	1.94	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.33	1.99	
07/03/2025 10:30	8.96	1.09	3.11	0.66	1.94	1.65	1.26	1.16	1.51	0.99	1.24	2.86	1.15	2.33	1.99	
07/03/2025 10:45	8.96	1.09	3.11	0.66	1.94	1.66	1.26	1.16	1.52	0.98	1.24	2.86	1.15	2.32	1.99	
07/03/2025 11:00	8.96	1.09	3.11	0.66	1.94	1.65	1.27	1.15	1.52	0.98	1.24	2.86	1.15	2.32	1.99	
07/03/2025 11:15	8.96	1.09	3.11	0.67	1.94	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.32	1.99	
07/03/2025 11:30	8.96	1.08	3.11	0.68	1.94	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.31	1.99	
07/03/2025 11:45	8.96	1.09	3.11	0.69	1.94	1.66	1.27	1.16	1.51	0.98	1.24	2.86	1.15	2.31	1.99	
07/03/2025 12:00	8.96	1.09	3.11	0.70	1.95	1.66	1.28	1.16	1.53	0.97	1.24	2.86	1.15	2.31	1.99	
07/03/2025 12:15	8.96	1.09	3.11	0.70	1.95	1.66	1.27	1.16	1.51	0.98	1.24	2.86	1.15	2.31	1.99	
07/03/2025 12:30	8.96	1.09	3.11	0.71	1.94	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.30	1.99	
07/03/2025 12:45	8.96	1.09	3.11	0.72	1.95	1.66	1.27	1.16	1.54	0.98	1.24	2.86	1.15	2.31	1.99	
07/03/2025 13:00	8.96	1.09	3.11	0.73	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.31	1.99	
07/03/2025 13:15	8.96	1.09	3.11	0.74	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.32	1.99	
07/03/2025 13:30	8.96	1.09	3.11	0.75	1.94	1.66	1.27	1.17	1.51	0.99	1.25	2.86	1.15	2.33	1.99	
07/03/2025 13:45	8.96	1.09	3.11	0.76	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.33	1.99	
07/03/2025 14:00	8.96	1.09	3.11	0.78	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.33	1.99	
07/03/2025 14:15	8.96	1.09	3.11	0.79	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.33	1.99	
07/03/2025 14:30	8.96	1.09	3.11	0.80	1.95	1.66	1.28	1.16	1.53	0.98	1.24	2.86	1.15	2.34	1.99	
07/03/2025 14:45	8.96	1.09	3.11	0.82	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.34	1.99	
07/03/2025 15:00	8.96	1.09	3.11	0.83	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.34	1.99	
07/03/2025 15:15	8.96	1.09	3.11	0.84	1.95	1.66	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.35	1.99	
07/03/2025 15:30	8.96	1.09	3.11	0.85	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.35	1.99	
07/03/2025 15:45	8.95	1.09	3.11	0.86	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.35	1.99	
07/03/2025 16:00	8.96	1.09	3.11	0.87	1.95	1.66	1.27	1.16	1.51	0.98	1.24	2.86	1.15	2.36	1.99	
07/03/2025 16:15	8.96	1.09	3.11	0.88	1.94	1.65	1.27	1.16	1.52	0.97	1.24	2.86	1.15	2.36	1.99	
07/03/2025 16:30	8.96	1.09	3.11	0.89	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.36	1.99	
07/03/2025 16:45	8.96	1.09	3.11	0.89	1.95	1.66	1.27	1.16	1.51	0.99	1.24	2.86	1.15	2.37	1.99	
07/03/2025 17:00	8.96	1.09	3.11	0.90	1.95	1.66	1.27	1.16	1.51	0.98	1.25	2.87	1.15	2.37	1.99	
07/03/2025 17:15	8.96	1.09	3.11	0.90	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.38	1.99	
07/03/2025 17:30	8.96	1.09	3.12	0.90	1.95	1.66	1.27	1.16	1.51	0.98	1.25	2.86	1.15	2.38	1.99	
07/03/2025 17:45	8.96	1.09	3.11	0.90	1.95	1.66	1.27	1.16	1.53	0.99	1.24	2.86	1.15	2.38	1.99	
07/03/2025 18:00	8.97	1.09	3.11	0.90	1.95	1.66	1.27	1.16	1.51	0.97	1.24	2.86	1.16	2.38	1.99	
07/03/2025 18:15	8.96	1.09	3.11	0.89	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.39	1.99	
07/03/2025 18:30	8.96	1.09	3.11	0.88	1.95	1.66	1.28	1.16	1.51	0.97	1.25	2.86	1.15	2.39	1.99	
07/03/2025 18:45	8.96	1.09	3.11	0.87	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.39	1.99	
07/03/2025 19:00	8.96	1.09	3.11	0.86	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.40	1.99	
07/03/2025 19:15	8.97	1.09	3.11	0.86	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.16	2.40	1.99	
07/03/2025 19:30	8.96	1.09	3.11	0.84	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.87	1.15	2.40	1.99	
07/03/2025 19:45	8.96	1.09	3.11	0.83	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.41	1.99	
07/03/2025 20:00	8.97	1.10	3.11	0.82	1.95	1.66	1.27	1.17	1.52	0.98	1.24	2.86	1.16	2.41	1.99	
07/03/2025 20:15	8.96	1.09	3.11	0.81	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.16	2.41	1.99	
07/03/2025 20:30	8.96	1.09	3.11	0.79	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.41	1.99	
07/03/2025 20:45	8.96	1.09	3.11	0.78	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.41	1.99	
07/03/2025 21:00	8.97	1.09	3.11	0.77	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.87	1.16	2.41	1.99	
07/03/2025 21:15	8.96	1.09	3.11	0.76	1.95	1.66	1.27	1.16	1.53	0.99	1.24	2.86	1.15	2.40	1.99	
07/03/2025 21:30	8.96	1.09	3.11	0.75	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.87	1.15	2.40	1.99	
07/03/2025 21:45	8.96	1.09	3.11	0.74	1.95	1.66	1.27	1.17	1.52	0.98	1.25	2.86	1.15	2.39	1.99	
07/03/2025 22:00	8.97	1.09	3.11	0.73	1.95	1.66	1.28	1.16	1.53	0.98	1.24	2.87	1.16	2.39	1.99	
07/03/2025 22:15	8.96	1.09	3.11	0.72	1.95	1.66	1.28	1.16	1.52	0.98	1.24	2.86	1.16	2.39	1.99	
07/03/2025 22:30	8.96	1.10	3.11	0.72	1.95	1.66	1.28	1.17	1.52	0.97	1.25	2.87	1.16	2.38	1.99	
07/03/2025 22:45	8.96	1.09	3.11	0.71	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.16	2.37	1.99	
07/03/2025 23:00	8.97	1.10	3.11	0.71	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.16	2.38	1.99	
07/03/2025 23:15	8.97	1.09	3.11	0.71	1.95	1.66	1.27	1.16	1.51	0.98	1.24	2.86	1.16	2.37	1.99	
07/03/2025 23:30	8.96	1.09	3.11	0.70	1.95	1.66	1.27	1.17	1.52	0.98	1.25	2.86	1.16	2.36	1.99	
07/03/2025 23:45	8.96	1.09	3.11	0.70	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.15	2.36	1.99	
08/03/2025 00:00	8.97	1.10	3.11	0.71	1.95	1.66	1.27	1.17	1.53	0.98	1.25	2.87	1.16	2.36	1.99	
08/03/2025 00:15	8.96	1.09	3.11	0.71	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.16	2.35	1.99	
08/03/2025 00:30	8.97	1.09	3.11	0.72	1.95	1.66	1.28	1.17	1.52	0.98	1.24	2.87	1.15	2.35	1.99	
08/03/2025 00:45	8.96	1.09	3.11	0.72	1.95	1.66	1.27	1.17	1.53	0.98	1.24	2.86	1.16	2.34	1.99	
08/03/2025 01:00	8.96	1.09	3.11	0.73	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.16	2.34	1.99	
08/03/2025 01:15	8.97	1.10	3.12	0.74	1.95	1.66	1.28	1.17	1.52	0.98	1.25	2.87	1.16	2.35	1.99	
08/03/2025 01:30	8.96	1.09	3.12	0.75	1.96	1.66	1.28	1.16	1.54	0.97	1.25	2.87	1.16	2.36	1.99	
08/03/2025 01:45	8.96	1.10	3.12	0.76	1.95	1.66	1.27	1.17	1.52	0.98	1.24	2.86	1.16	2.36	1.99	
08/03/2025 02:00	8.96	1.09	3.11	0.77	1.95	1.66	1.28	1.17	1.52	0.97	1.24	2.86	1.16	2.36	1.99	
08/03/2025 02:15	8.97	1.09	3.12	0.78	1.95	1.66	1.27	1.17	1.52	0.98	1.25	2.87	1.16	2.37	1.99	
08/03/2025 02:30	8.96	1.09	3.11	0.79	1.95	1.66	1.28	1.17	1.52	0.98	1.24	2.86	1.16	2.37	1.99	
08/03/2025 02:45	8.97	1.10	3.11	0.80	1.95	1.66	1.28	1.17	1.53	0.98	1.25	2.87	1.16	2.37	2.00	
08/03/2025 03:00	8.97	1.10	3.11	0.81	1.95	1.67	1.28	1.17	1.53	0.97	1.25	2.87	1.16	2.38	2.00	
08/03/2025 03:15	8.96	1.09	3.11	0.82	1.95	1.66	1.27	1.17	1.52	0.97	1.25	2.86	1.16	2.38	2.00	
08/03/2025 03:30	8.96	1.09	3.11	0.82	1.95	1.66	1.28	1.17	1.52	0.98	1.24	2.86	1.16	2.38	1.99	
08/03/2025 03:45	8.96	1.09	3.11	0.84	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.16	2.39	1.99	
08/03/2025 04:00	8.96	1.09	3.11	0.84	1.95	1.66	1.27	1.17	1.52	0.98	1.25	2.86	1.16	2.39	1.99	
08/03/2025 04:15	8.96	1.09	3.12	0.85	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.16	2.39	1.99	
08/03/2025 04:30	8.97	1.10	3.11	0.86	1.96	1.66	1.27	1.17	1.53	0.98	1.25	2.87	1.16	2.40	2.00	
08/03/2025 04:45	8.97	1.10	3.11	0.86	1.95	1.67	1.28	1.17	1.53	0.98	1.26	2.87	1.16	2.40	2.00	
08/03/2025 05:00	8.97	1.10	3.11	0.87	1.95	1.66	1.27	1.17	1.53	0.98	1.25	2.86	1.16	2.40	1.99	
08/03/2025 05:15	8.96	1.09	3.11	0.87	1.95	1.66	1.29	1.16	1.53	0.98	1.25	2.86	1.16	2.40	1.99	
08/03/2025 05:30	8.96	1.10	3.11	0.87	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.87	1.15	2.40	1.99	
08/03/2025 05:45	8.97	1.10	3.11	0.88	1.95	1.66	1.28	1.17	1.52	0.98	1.25	2.86	1.16	2.41	1.99	
08/03/2025 06:00	8.97	1.10	3.11	0.87	1.95	1.66	1.27	1.16	1.53	0.97	1.25	2.86	1.16	2.41	2.00	
08/03/2025 06:15	8.96	1.10	3.11	0.87	1.95	1.66	1.28	1.17	1.52	0.98	1.24	2.87	1.16	2.41	1.99	
08/03/2025 06:30	8.96	1.09	3.11	0.86	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.87	1.15	2.42	1.99	
08/03/2025 06:45	8.96	1.09	3.11	0.85	1.95	1.66	1.27	1.16	1.53	0.99	1.25	2.86	1.16	2.42	1.99	
08/03/2025 07:00	8.97	1.10	3.11	0.85	1.95	1.66	1.28	1.17	1.53	0.99	1.25	2.87	1.16	2.42	1.99	
08/03/2025 07:15	8.96	1.09	3.11	0.84	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.16	2.42	1.99	
08/03/2025 07:30	8.97	1.10	3.11	0.82	1.95	1.66	1.28	1.16	1.53	0.99	1.25	2.86	1.16	2.43	1.99	
08/03/2025 07:45	8.96	1.09	3.11	0.81	1.95	1.66	1.27	1.17	1.51	0.98	1.25	2.86	1.15	2.43	1.99	
08/03/2025 08:00	8.96	1.09	3.11	0.80	1.95	1.66	1.28	1.16	1.51	0.98	1.25	2.86	1.16	2.43	1.99	
08/03/2025 08:15	8.96	1.09	3.11	0.79	1.94	1.65	1.27	1.16	1.51	0.99	1.25	2.86	1.15	2.42	1.99	
08/03/2025 08:30	8.96	1.09	3.11	0.77	1.94	1.65	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.42	1.99	
08/03/2025 08:45	8.96	1.09	3.11	0.76	1.94	1.65	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.42	1.99	
08/03/2025 09:00	8.97	1.09	3.11	0.75	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.41	1.99	
08/03/2025 09:15	8.96	1.09	3.11	0.74	1.94	1.65	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.41	1.99	
08/03/2025 09:30	8.96	1.09	3.11	0.73	1.94	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.40	1.99	
08/03/2025 09:45	8.96	1.09	3.11	0.71	1.94	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.40	1.99	
08/03/2025 10:00	8.96	1.09	3.11	0.70	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.39	1.99	
08/03/2025 10:15	8.96	1.09	3.11	0.69	1.94	1.66	1.27	1.16	1.53	0.99	1.24	2.86	1.15	2.39	1.99	
08/03/2025 10:30	8.96	1.09	3.11	0.68	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.39	1.99	
08/03/2025 10:45	8.96	1.09	3.11	0.67	1.95	1.66	1.27	1.17	1.53	0.98	1.25	2.86	1.15	2.38	1.99	
08/03/2025 11:00	8.96	1.09	3.11	0.67	1.94	1.65	1.28	1.16	1.52	0.98	1.24	2.86	1.15	2.37	1.99	
08/03/2025 11:15	8.96	1.09	3.11	0.66	1.94	1.66	1.27	1.16	1.52	0.97	1.25	2.86	1.15	2.37	1.99	
08/03/2025 11:30	8.96	1.09	3.11	0.66	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.37	1.99	
08/03/2025 11:45	8.96	1.09	3.11	0.65	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.36	1.99	
08/03/2025 12:00	8.96	1.09	3.11	0.65	1.95	1.66	1.28	1.16	1.51	0.98	1.24	2.86	1.15	2.36	1.99	
08/03/2025 12:15	8.96	1.09	3.11	0.65	1.95	1.66	1.27	1.17	1.53	0.98	1.26	2.86	1.15	2.35	1.99	
08/03/2025 12:30	8.96	1.09	3.11	0.65	1.95	1.66	1.27	1.16	1.54	0.99	1.25	2.86	1.15	2.35	1.99	
08/03/2025 12:45	8.96	1.09	3.11	0.65	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.34	1.99	
08/03/2025 13:00	8.96	1.09	3.11	0.66	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.34	1.99	
08/03/2025 13:15	8.96	1.09	3.11	0.66	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.33	1.99	
08/03/2025 13:30	8.96	1.09	3.11	0.66	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.33	1.99	
08/03/2025 13:45	8.96	1.09	3.11	0.67	1.95	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.32	1.99	
08/03/2025 14:00	8.96	1.09	3.11	0.68	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.32	1.99	
08/03/2025 14:15	8.96	1.09	3.11	0.69	1.95	1.66	1.27	1.17	1.53	0.98	1.25	2.86	1.15	2.32	1.99	
08/03/2025 14:30	8.96	1.10	3.11	0.70	1.95	1.66	1.27	1.17	1.54	0.99	1.25	2.86	1.15	2.31	1.99	
08/03/2025 14:45	8.96	1.09	3.11	0.71	1.95	1.66	1.28	1.17	1.53	0.98	1.24	2.86	1.15	2.31	1.99	
08/03/2025 15:00	8.96	1.09	3.11	0.72	1.95	1.66	1.27	1.16	1.54	0.97	1.24	2.86	1.15	2.31	1.99	
08/03/2025 15:15	8.96	1.09	3.11	0.72	1.95	1.66	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.31	1.99	
08/03/2025 15:30	8.96	1.09	3.11	0.74	1.95	1.66	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.33	1.99	
08/03/2025 15:45	8.96	1.09	3.11	0.75	1.95	1.66	1.27	1.16	1.52	0.98	1.26	2.86	1.15	2.33	1.99	
08/03/2025 16:00	8.96	1.09	3.11	0.76	1.95	1.66	1.28	1.16	1.52	0.97	1.24	2.86	1.15	2.33	1.99	
08/03/2025 16:15	8.96	1.09	3.11	0.77	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.34	1.99	
08/03/2025 16:30	8.96	1.09	3.11	0.78	1.95	1.66	1.27	1.16	1.54	0.98	1.25	2.86	1.15	2.34	1.99	
08/03/2025 16:45	8.96	1.09	3.11	0.79	1.95	1.66	1.27	1.16	1.54	0.98	1.25	2.86	1.15	2.34	1.99	
08/03/2025 17:00	8.96	1.09	3.10	0.80	1.95	1.66	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.35	1.99	
08/03/2025 17:15	8.96	1.09	3.11	0.81	1.95	1.66	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.35	1.99	
08/03/2025 17:30	8.96	1.09	3.11	0.81	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.35	1.99	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
08/03/2025 17:45	8.96	1.09	3.11	0.82	1.95	1.66	1.27	1.16	1.54	0.98	1.26	2.86	1.15	2.36	1.99	
08/03/2025 18:00	8.96	1.09	3.11	0.83	1.95	1.65	1.26	1.16	1.53	0.98	1.25	2.86	1.16	2.36	1.99	
08/03/2025 18:15	8.96	1.09	3.11	0.83	1.95	1.66	1.28	1.16	1.55	0.98	1.25	2.86	1.16	2.36	1.99	
08/03/2025 18:30	8.96	1.09	3.11	0.84	1.95	1.66	1.28	1.16	1.54	0.98	1.26	2.86	1.16	2.37	1.99	
08/03/2025 18:45	8.97	1.09	3.11	0.84	1.95	1.66	1.27	1.17	1.53	0.98	1.24	2.86	1.16	2.37	1.99	
08/03/2025 19:00	8.96	1.09	3.11	0.84	1.95	1.66	1.28	1.17	1.54	0.98	1.24	2.86	1.16	2.37	1.99	
08/03/2025 19:15	8.97	1.09	3.11	0.83	1.95	1.66	1.27	1.16	1.55	0.98	1.25	2.86	1.16	2.38	1.99	
08/03/2025 19:30	8.97	1.09	3.11	0.82	1.95	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.16	2.39	1.99	
08/03/2025 19:45	8.96	1.09	3.11	0.82	1.95	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.38	1.99	
08/03/2025 20:00	8.96	1.09	3.11	0.81	1.95	1.66	1.27	1.16	1.54	0.97	1.25	2.86	1.16	2.39	1.99	
08/03/2025 20:15	8.96	1.09	3.11	0.80	1.95	1.66	1.27	1.16	1.53	0.98	1.24	2.86	1.15	2.39	1.99	
08/03/2025 20:30	8.96	1.09	3.11	0.79	1.95	1.66	1.27	1.16	1.54	0.98	1.25	2.86	1.16	2.39	1.99	
08/03/2025 20:45	8.96	1.09	3.11	0.78	1.95	1.66	1.27	1.16	1.52	0.97	1.25	2.86	1.15	2.40	1.99	
08/03/2025 21:00	8.96	1.09	3.11	0.77	1.95	1.66	1.27	1.16	1.52	0.98	1.24	2.86	1.16	2.39	1.99	
08/03/2025 21:15	8.96	1.09	3.11	0.75	1.95	1.66	1.28	1.16	1.53	0.98	1.26	2.86	1.15	2.39	1.99	
08/03/2025 21:30	8.96	1.09	3.11	0.74	1.94	1.65	1.28	1.16	1.52	0.98	1.26	2.86	1.15	2.39	1.99	
08/03/2025 21:45	8.96	1.09	3.11	0.73	1.95	1.66	1.28	1.17	1.53	0.98	1.26	2.86	1.16	2.39	1.99	
08/03/2025 22:00	8.97	1.09	3.11	0.72	1.95	1.66	1.28	1.16	1.53	0.97	1.26	2.87	1.16	2.38	1.99	
08/03/2025 22:15	8.97	1.09	3.11	0.71	1.95	1.66	1.27	1.16	1.54	0.99	1.26	2.86	1.16	2.38	1.99	
08/03/2025 22:30	8.97	1.10	3.11	0.70	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.87	1.16	2.37	2.00	
08/03/2025 22:45	8.96	1.09	3.11	0.69	1.95	1.66	1.28	1.17	1.54	0.97	1.26	2.87	1.16	2.37	1.99	
08/03/2025 23:00	8.96	1.09	3.11	0.68	1.95	1.66	1.28	1.17	1.53	0.97	1.25	2.87	1.16	2.36	1.99	
08/03/2025 23:15	8.96	1.09	3.11	0.67	1.95	1.66	1.29	1.17	1.53	0.98	1.25	2.86	1.15	2.36	1.99	
08/03/2025 23:30	8.96	1.09	3.11	0.66	1.95	1.66	1.28	1.17	1.53	0.98	1.26	2.86	1.16	2.35	1.99	
08/03/2025 23:45	8.96	1.09	3.11	0.65	1.95	1.66	1.28	1.17	1.53	0.99	1.25	2.86	1.16	2.34	1.99	
09/03/2025 00:00	8.96	1.09	3.11	0.64	1.95	1.66	1.28	1.17	1.52	0.98	1.25	2.87	1.16	2.34	2.00	
09/03/2025 00:15	8.97	1.09	3.11	0.64	1.95	1.66	1.28	1.17	1.52	0.98	1.25	2.87	1.16	2.34	2.00	
09/03/2025 00:30	8.96	1.09	3.11	0.64	1.95	1.66	1.29	1.17	1.53	0.97	1.25	2.87	1.16	2.33	1.99	
09/03/2025 00:45	8.96	1.10	3.11	0.63	1.95	1.66	1.28	1.17	1.53	0.99	1.26	2.86	1.16	2.32	2.00	
09/03/2025 01:00	8.97	1.10	3.11	0.63	1.95	1.66	1.28	1.17	1.53	0.98	1.26	2.87	1.16	2.32	2.00	
09/03/2025 01:15	8.96	1.09	3.11	0.63	1.95	1.66	1.28	1.17	1.52	0.98	1.26	2.86	1.16	2.31	1.99	
09/03/2025 01:30	8.97	1.10	3.11	0.63	1.95	1.67	1.28	1.17	1.53	0.98	1.25	2.87	1.16	2.31	2.00	
09/03/2025 01:45	8.97	1.10	3.12	0.63	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.87	1.16	2.31	2.00	
09/03/2025 02:00	8.96	1.10	3.11	0.64	1.95	1.66	1.29	1.17	1.54	0.97	1.25	2.87	1.16	2.30	2.00	
09/03/2025 02:15	8.96	1.10	3.12	0.64	1.95	1.66	1.28	1.17	1.53	0.97	1.26	2.87	1.16	2.30	2.00	
09/03/2025 02:30	8.97	1.10	3.11	0.66	1.95	1.67	1.29	1.17	1.53	0.98	1.26	2.87	1.16	2.29	2.00	
09/03/2025 02:45	8.96	1.10	3.11	0.67	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.87	1.16	2.29	2.00	
09/03/2025 03:00	8.96	1.10	3.11	0.67	1.95	1.66	1.28	1.17	1.52	0.98	1.25	2.86	1.16	2.29	2.00	
09/03/2025 03:15	8.96	1.09	3.11	0.69	1.95	1.66	1.28	1.17	1.53	0.99	1.25	2.87	1.15	2.29	1.99	
09/03/2025 03:30	8.96	1.10	3.11	0.70	1.95	1.66	1.28	1.17	1.52	0.98	1.25	2.86	1.15	2.29	1.99	
09/03/2025 03:45	8.97	1.09	3.11	0.71	1.95	1.66	1.29	1.17	1.54	0.98	1.25	2.86	1.16	2.29	2.00	
09/03/2025 04:00	8.97	1.10	3.11	0.72	1.95	1.66	1.29	1.17	1.53	0.97	1.25	2.87	1.16	2.29	1.99	
09/03/2025 04:15	8.96	1.10	3.11	0.74	1.95	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.30	1.99	
09/03/2025 04:30	8.97	1.09	3.11	0.75	1.95	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.31	1.99	
09/03/2025 04:45	8.96	1.09	3.11	0.76	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.31	1.99	
09/03/2025 05:00	8.97	1.10	3.11	0.78	1.95	1.66	1.28	1.17	1.54	0.97	1.26	2.86	1.16	2.32	2.00	
09/03/2025 05:15	8.96	1.10	3.11	0.79	1.95	1.66	1.27	1.16	1.54	0.98	1.25	2.86	1.16	2.32	1.99	
09/03/2025 05:30	8.96	1.10	3.11	0.81	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.16	2.33	2.00	
09/03/2025 05:45	8.97	1.09	3.11	0.82	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.16	2.33	1.99	
09/03/2025 06:00	8.97	1.09	3.11	0.83	1.96	1.66	1.28	1.17	1.55	0.97	1.26	2.86	1.16	2.34	2.00	
09/03/2025 06:15	8.96	1.09	3.11	0.84	1.95	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.34	1.99	
09/03/2025 06:30	8.96	1.09	3.11	0.85	1.95	1.66	1.28	1.17	1.55	0.97	1.26	2.86	1.15	2.34	1.99	
09/03/2025 06:45	8.96	1.09	3.11	0.86	1.95	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.34	1.99	
09/03/2025 07:00	8.96	1.10	3.11	0.87	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.16	2.35	2.00	
09/03/2025 07:15	8.97	1.10	3.11	0.88	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.86	1.16	2.35	1.99	
09/03/2025 07:30	8.96	1.09	3.11	0.88	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.36	1.99	
09/03/2025 07:45	8.96	1.10	3.11	0.88	1.95	1.66	1.28	1.17	1.53	0.99	1.25	2.86	1.15	2.37	1.99	
09/03/2025 08:00	8.96	1.10	3.11	0.88	1.95	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.16	2.37	1.99	
09/03/2025 08:15	8.96	1.09	3.11	0.88	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.86	1.15	2.37	1.99	
09/03/2025 08:30	8.96	1.10	3.11	0.87	1.95	1.66	1.28	1.17	1.55	0.98	1.26	2.86	1.15	2.37	1.99	
09/03/2025 08:45	8.96	1.09	3.11	0.86	1.95	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.37	1.99	
09/03/2025 09:00	8.97	1.10	3.11	0.86	1.95	1.66	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.38	1.99	
09/03/2025 09:15	8.96	1.10	3.11	0.85	1.95	1.66	1.29	1.17	1.54	0.97	1.25	2.86	1.15	2.38	1.99	
09/03/2025 09:30	8.96	1.09	3.11	0.84	1.95	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.39	1.99	
09/03/2025 09:45	8.96	1.09	3.11	0.83	1.95	1.66	1.29	1.17	1.53	0.97	1.25	2.86	1.15	2.38	1.99	
09/03/2025 10:00	8.96	1.09	3.11	0.82	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.39	1.99	
09/03/2025 10:15	8.96	1.09	3.11	0.81	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.39	1.99	
09/03/2025 10:30	8.96	1.09	3.11	0.80	1.95	1.66	1.28	1.17	1.53	0.98	1.24	2.86	1.15	2.39	1.99	
09/03/2025 10:45	8.96	1.09	3.11	0.79	1.94	1.66	1.28	1.17	1.53	0.97	1.24	2.86	1.15	2.40	1.99	
09/03/2025 11:00	8.96	1.09	3.11	0.78	1.95	1.66	1.29	1.17	1.53	0.97	1.25	2.86	1.15	2.39	1.99	
09/03/2025 11:15	8.96	1.09	3.11	0.77	1.95	1.66	1.28	1.16	1.52	0.97	1.24	2.86	1.15	2.39	1.99	
09/03/2025 11:30	8.96	1.09	3.11	0.75	1.95	1.66	1.28	1.17	1.53	0.98	1.26	2.86	1.15	2.39	1.99	
09/03/2025 11:45	8.96	1.10	3.11	0.75	1.95	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.39	1.99	
09/03/2025 12:00	8.96	1.10	3.11	0.74	1.95	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.39	1.99	
09/03/2025 12:15	8.96	1.09	3.11	0.73	1.94	1.66	1.27	1.17	1.53	0.96	1.25	2.86	1.15	2.38	1.99	
09/03/2025 12:30	8.96	1.09	3.11	0.72	1.95	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.38	1.99	
09/03/2025 12:45	8.96	1.09	3.11	0.71	1.95	1.66	1.27	1.17	1.54	0.98	1.25	2.86	1.15	2.37	1.99	
09/03/2025 13:00	8.96	1.09	3.11	0.70	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.37	1.99	
09/03/2025 13:15	8.96	1.09	3.11	0.70	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.37	2.00	
09/03/2025 13:30	8.96	1.09	3.11	0.70	1.95	1.66	1.28	1.17	1.55	0.97	1.25	2.86	1.14	2.36	1.99	
09/03/2025 13:45	8.96	1.09	3.11	0.69	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.35	2.00	
09/03/2025 14:00	8.96	1.09	3.11	0.69	1.95	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.35	1.99	
09/03/2025 14:15	8.96	1.09	3.11	0.69	1.95	1.66	1.27	1.17	1.53	0.97	1.25	2.86	1.15	2.35	1.99	
09/03/2025 14:30	8.96	1.09	3.11	0.69	1.95	1.66	1.27	1.17	1.54	0.98	1.25	2.86	1.15	2.34	1.99	
09/03/2025 14:45	8.96	1.09	3.11	0.70	1.94	1.66	1.28	1.17	1.52	0.98	1.25	2.86	1.15	2.33	1.99	
09/03/2025 15:00	8.96	1.09	3.11	0.70	1.95	1.66	1.27	1.16	1.54	0.97	1.25	2.86	1.15	2.33	1.99	
09/03/2025 15:15	8.96	1.09	3.11	0.71	1.94	1.65	1.28	1.17	1.53	0.98	1.24	2.85	1.15	2.33	1.99	
09/03/2025 15:30	8.96	1.09	3.11	0.72	1.95	1.66	1.28	1.17	1.52	0.98	1.25	2.86	1.15	2.33	1.99	
09/03/2025 15:45	8.97	1.09	3.11	0.73	1.95	1.66	1.27	1.17	1.53	0.98	1.25	2.86	1.15	2.33	1.99	
09/03/2025 16:00	8.96	1.09	3.11	0.74	1.95	1.66	1.27	1.17	1.53	0.97	1.25	2.86	1.15	2.34	1.99	
09/03/2025 16:15	8.96	1.09	3.11	0.75	1.95	1.66	1.27	1.17	1.53	0.98	1.25	2.86	1.15	2.35	1.99	
09/03/2025 16:30	8.96	1.09	3.11	0.75	1.95	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.34	1.99	
09/03/2025 16:45	8.96	1.10	3.11	0.76	1.95	1.66	1.29	1.17	1.53	0.98	1.25	2.86	1.15	2.36	1.99	
09/03/2025 17:00	8.96	1.09	3.11	0.78	1.95	1.66	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.36	1.99	
09/03/2025 17:15	8.96	1.09	3.11	0.78	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.36	1.99	
09/03/2025 17:30	8.96	1.09	3.11	0.79	1.94	1.66	1.28	1.16	1.52	0.98	1.25	2.86	1.15	2.37	1.99	
09/03/2025 17:45	8.96	1.09	3.11	0.81	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.37	1.99	
09/03/2025 18:00	8.96	1.09	3.11	0.81	1.95	1.66	1.28	1.17	1.54	0.98	1.24	2.87	1.15	2.37	1.99	
09/03/2025 18:15	8.96	1.10	3.11	0.82	1.95	1.66	1.28	1.17	1.53	0.99	1.25	2.86	1.15	2.38	1.99	
09/03/2025 18:30	8.96	1.10	3.11	0.83	1.95	1.66	1.27	1.17	1.54	0.99	1.25	2.86	1.15	2.38	1.99	
09/03/2025 18:45	8.96	1.10	3.11	0.83	1.95	1.66	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.38	1.99	
09/03/2025 19:00	8.97	1.09	3.11	0.84	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.39	1.99	
09/03/2025 19:15	8.96	1.09	3.11	0.85	1.95	1.66	1.28	1.16	1.53	0.98	1.26	2.87	1.15	2.39	1.99	
09/03/2025 19:30	8.96	1.10	3.11	0.85	1.95	1.66	1.28	1.17	1.52	0.98	1.26	2.87	1.16	2.39	1.99	
09/03/2025 19:45	8.96	1.10	3.12	0.85	1.95	1.66	1.29	1.17	1.53	0.98	1.26	2.87	1.16	2.40	1.99	
09/03/2025 20:00	8.97	1.09	3.11	0.85	1.95	1.66	1.28	1.17	1.53	0.98	1.26	2.87	1.15	2.40	1.99	
09/03/2025 20:15	8.96	1.10	3.12	0.85	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.86	1.15	2.40	1.99	
09/03/2025 20:30	8.96	1.09	3.11	0.85	1.95	1.66	1.28	1.17	1.54	0.99	1.26	2.86	1.15	2.40	1.99	
09/03/2025 20:45	8.96	1.10	3.11	0.85	1.95	1.66	1.28	1.17	1.53	0.98	1.26	2.86	1.15	2.41	1.99	
09/03/2025 21:00	8.97	1.09	3.11	0.85	1.95	1.66	1.28	1.17	1.54	0.99	1.25	2.86	1.16	2.41	1.99	
09/03/2025 21:15	8.96	1.10	3.11	0.84	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.87	1.16	2.41	1.99	
09/03/2025 21:30	8.96	1.10	3.11	0.83	1.95	1.66	1.28	1.17	1.53	0.99	1.25	2.86	1.15	2.42	1.99	
09/03/2025 21:45	8.96	1.10	3.11	0.82	1.95	1.65	1.29	1.17	1.53	0.99	1.25	2.86	1.15	2.42	1.99	
09/03/2025 22:00	8.97	1.09	3.11	0.81	1.95	1.66	1.28	1.17	1.53	0.97	1.26	2.87	1.16	2.42	1.99	
09/03/2025 22:15	8.96	1.09	3.11	0.80	1.95	1.66	1.28	1.17	1.54	0.99	1.26	2.86	1.15	2.43	1.99	
09/03/2025 22:30	8.96	1.10	3.11	0.79	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.87	1.16	2.43	1.99	
09/03/2025 22:45	8.97	1.10	3.11	0.78	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.87	1.16	2.42	1.99	
09/03/2025 23:00	8.97	1.09	3.11	0.76	1.95	1.66	1.28	1.17	1.53	0.98	1.26	2.86	1.16	2.42	1.99	
09/03/2025 23:15	8.96	1.10	3.11	0.75	1.94	1.66	1.28	1.17	1.54	0.98	1.26	2.87	1.15	2.42	1.99	
09/03/2025 23:30	8.97	1.10	3.12	0.74	1.95	1.66	1.28	1.17	1.54	0.99	1.26	2.87	1.16	2.41	1.99	
09/03/2025 23:45	8.96	1.10	3.11	0.73	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.16	2.40	1.99	
10/03/2025 00:00	8.96	1.10	3.11	0.71	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.87	1.15	2.40	1.99	
10/03/2025 00:15	8.97	1.10	3.11	0.70	1.95	1.66	1.28	1.17	1.55	0.98	1.25	2.86	1.16	2.39	2.00	
10/03/2025 00:30	8.96	1.09	3.11	0.69	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.16	2.39	1.99	
10/03/2025 00:45	8.97	1.09	3.11	0.68	1.95	1.66	1.28	1.17	1.54	0.99	1.26	2.86	1.15	2.38	1.99	
10/03/2025 01:00	8.96	1.10	3.11	0.67	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.37	2.00	
10/03/2025 01:15	8.97	1.10	3.11	0.66	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.87	1.15	2.37	2.00	
10/03/2025 01:30	8.96	1.10	3.11	0.65	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.36	2.00	
10/03/2025 01:45	8.97	1.10	3.11	0.64	1.95	1.66	1.28	1.17	1.54	0.99	1.26	2.87	1.16	2.36	2.00	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
10/03/2025 02:00	8.96	1.10	3.11	0.64	1.95	1.66	1.28	1.17	1.53	0.98	1.26	2.87	1.16	2.35	2.00	
10/03/2025 02:15	8.97	1.10	3.12	0.64	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.87	1.16	2.35	2.00	
10/03/2025 02:30	8.96	1.09	3.11	0.63	1.95	1.66	1.29	1.17	1.53	0.98	1.25	2.86	1.15	2.34	1.99	
10/03/2025 02:45	8.96	1.10	3.11	0.63	1.95	1.66	1.29	1.17	1.54	0.98	1.25	2.86	1.16	2.34	1.99	
10/03/2025 03:00	8.97	1.09	3.11	0.64	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.87	1.16	2.33	1.99	
10/03/2025 03:15	8.96	1.09	3.12	0.64	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.86	1.16	2.33	1.99	
10/03/2025 03:30	8.96	1.10	3.11	0.64	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.32	2.00	
10/03/2025 03:45	8.96	1.09	3.11	0.65	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.86	1.16	2.32	1.99	
10/03/2025 04:00	8.97	1.09	3.11	0.66	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.16	2.31	1.99	
10/03/2025 04:15	8.97	1.10	3.12	0.67	1.95	1.66	1.29	1.17	1.54	0.98	1.26	2.87	1.16	2.31	2.00	
10/03/2025 04:30	8.96	1.09	3.11	0.68	1.95	1.66	1.29	1.17	1.53	0.98	1.26	2.86	1.15	2.30	1.99	
10/03/2025 04:45	8.96	1.09	3.11	0.69	1.95	1.66	1.28	1.17	1.54	0.98	1.26	2.86	1.15	2.30	1.99	
10/03/2025 05:00	8.96	1.09	3.11	0.71	1.95	1.66	1.28	1.17	1.53	0.97	1.26	2.86	1.16	2.31	1.99	
10/03/2025 05:15	8.97	1.09	3.11	0.72	1.95	1.66	1.29	1.17	1.54	0.98	1.25	2.86	1.16	2.32	1.99	
10/03/2025 05:30	8.96	1.09	3.11	0.73	1.94	1.66	1.28	1.16	1.53	0.97	1.26	2.86	1.15	2.32	1.99	
10/03/2025 05:45	8.96	1.09	3.11	0.74	1.95	1.66	1.28	1.16	1.53	0.98	1.26	2.86	1.15	2.33	1.99	
10/03/2025 06:00	8.97	1.09	3.11	0.76	1.95	1.66	1.27	1.17	1.53	0.98	1.26	2.87	1.16	2.34	1.99	
10/03/2025 06:15	8.96	1.09	3.11	0.77	1.95	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.16	2.34	1.99	
10/03/2025 06:30	8.96	1.09	3.11	0.79	1.94	1.66	1.29	1.17	1.52	0.98	1.25	2.86	1.16	2.34	1.99	
10/03/2025 06:45	8.96	1.09	3.11	0.80	1.95	1.66	1.29	1.17	1.54	0.98	1.26	2.86	1.15	2.34	1.99	
10/03/2025 07:00	8.96	1.09	3.11	0.81	1.95	1.65	1.29	1.17	1.53	0.97	1.25	2.86	1.16	2.35	1.99	
10/03/2025 07:15	8.97	1.09	3.11	0.82	1.95	1.66	1.29	1.17	1.53	0.97	1.25	2.86	1.16	2.35	1.99	
10/03/2025 07:30	8.96	1.09	3.11	0.83	1.94	1.65	1.28	1.17	1.52	0.97	1.25	2.86	1.16	2.35	1.99	
10/03/2025 07:45	8.96	1.09	3.11	0.84	1.94	1.65	1.28	1.17	1.53	0.97	1.25	2.86	1.16	2.35	1.99	
10/03/2025 08:00	8.96	1.09	3.11	0.86	1.94	1.66	1.28	1.17	1.54	0.97	1.26	2.86	1.15	2.36	1.99	
10/03/2025 08:15	8.96	1.09	3.11	0.86	1.94	1.65	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.36	1.99	
10/03/2025 08:30	8.96	1.09	3.11	0.87	1.94	1.65	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.36	1.99	
10/03/2025 08:45	8.96	1.09	3.11	0.88	1.94	1.65	1.29	1.16	1.53	0.98	1.25	2.85	1.15	2.37	1.99	
10/03/2025 09:00	8.96	1.09	3.11	0.88	1.94	1.65	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.37	1.99	
10/03/2025 09:15	8.96	1.09	3.11	0.88	1.94	1.65	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.38	1.99	
10/03/2025 09:30	8.96	1.09	3.11	0.88	1.94	1.65	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.38	1.99	
10/03/2025 09:45	8.96	1.09	3.11	0.87	1.94	1.65	1.28	1.16	1.54	0.97	1.25	2.86	1.15	2.38	1.99	
10/03/2025 10:00	8.95	1.09	3.11	0.87	1.94	1.65	1.27	1.16	1.53	0.96	1.25	2.85	1.15	2.38	1.99	
10/03/2025 10:15	8.96	1.09	3.11	0.86	1.94	1.65	1.28	1.17	1.53	0.97	1.25	2.85	1.15	2.39	1.99	
10/03/2025 10:30	8.96	1.10	3.11	0.86	1.94	1.65	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.40	1.99	
10/03/2025 10:45	8.96	1.09	3.11	0.85	1.94	1.65	1.28	1.16	1.53	0.97	1.25	2.85	1.15	2.40	1.99	
10/03/2025 11:00	8.96	1.10	3.11	0.84	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.40	1.99	
10/03/2025 11:15	8.96	1.09	3.11	0.83	1.94	1.65	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.40	1.99	
10/03/2025 11:30	8.96	1.09	3.11	0.82	1.94	1.65	1.28	1.16	1.52	0.98	1.25	2.85	1.15	2.41	1.99	
10/03/2025 11:45	8.96	1.10	3.11	0.81	1.93	1.66	1.28	1.17	1.52	0.97	1.25	2.86	1.15	2.41	1.99	
10/03/2025 12:00	8.96	1.10	3.11	0.80	1.94	1.65	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.41	1.99	
10/03/2025 12:15	8.96	1.09	3.11	0.79	1.94	1.65	1.28	1.17	1.52	0.98	1.25	2.86	1.15	2.41	1.99	
10/03/2025 12:30	8.96	1.09	3.11	0.78	1.93	1.66	1.28	1.17	1.53	0.98	1.25	2.85	1.15	2.41	1.99	
10/03/2025 12:45	8.96	1.09	3.11	0.76	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.40	1.99	
10/03/2025 13:00	8.96	1.09	3.10	0.75	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.40	1.99	
10/03/2025 13:15	8.96	1.09	3.11	0.74	1.94	1.65	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.39	1.99	
10/03/2025 13:30	8.96	1.09	3.11	0.73	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.39	1.99	
10/03/2025 13:45	8.96	1.09	3.11	0.71	1.94	1.65	1.28	1.17	1.53	0.97	1.24	2.86	1.15	2.39	1.99	
10/03/2025 14:00	8.96	1.09	3.11	0.71	1.94	1.65	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.38	1.99	
10/03/2025 14:15	8.96	1.09	3.11	0.70	1.94	1.66	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.38	1.99	
10/03/2025 14:30	8.96	1.09	3.11	0.70	1.94	1.66	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.37	1.99	
10/03/2025 14:45	8.96	1.09	3.11	0.70	1.94	1.66	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.37	1.99	
10/03/2025 15:00	8.96	1.09	3.11	0.70	1.94	1.66	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.36	1.99	
10/03/2025 15:15	8.96	1.09	3.11	0.70	1.94	1.65	1.27	1.16	1.53	0.98	1.25	2.86	1.15	2.35	1.99	
10/03/2025 15:30	8.96	1.09	3.11	0.69	1.94	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.35	1.99	
10/03/2025 15:45	8.96	1.09	3.11	0.69	1.94	1.65	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.35	1.98	
10/03/2025 16:00	8.96	1.09	3.11	0.70	1.94	1.66	1.27	1.17	1.53	0.97	1.25	2.86	1.15	2.34	1.99	
10/03/2025 16:15	8.96	1.09	3.11	0.70	1.94	1.65	1.27	1.16	1.52	0.97	1.25	2.86	1.15	2.34	1.99	
10/03/2025 16:30	8.96	1.09	3.11	0.71	1.94	1.65	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.34	1.99	
10/03/2025 16:45	8.96	1.09	3.11	0.72	1.94	1.65	1.28	1.17	1.53	0.98	1.25	2.87	1.15	2.34	1.99	
10/03/2025 17:00	8.96	1.09	3.11	0.72	1.94	1.65	1.27	1.16	1.52	0.98	1.25	2.86	1.15	2.34	1.99	
10/03/2025 17:15	8.96	1.09	3.11	0.74	1.94	1.65	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.34	1.99	
10/03/2025 17:30	8.97	1.09	3.11	0.75	1.94	1.65	1.28	1.17	1.52	0.99	1.25	2.86	1.15	2.35	1.99	
10/03/2025 17:45	8.96	1.09	3.11	0.76	1.94	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.36	1.99	
10/03/2025 18:00	8.97	1.10	3.11	0.77	1.94	1.65	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.36	1.99	
10/03/2025 18:15	8.97	1.09	3.11	0.78	1.94	1.65	1.28	1.17	1.53	0.98	1.25	2.87	1.15	2.37	1.99	
10/03/2025 18:30	8.96	1.10	3.11	0.79	1.94	1.65	1.28	1.17	1.53	0.98	1.25	2.87	1.16	2.36	1.99	
10/03/2025 18:45	8.97	1.09	3.11	0.80	1.94	1.65	1.28	1.17	1.52	0.98	1.25	2.86	1.15	2.37	1.99	
10/03/2025 19:00	8.96	1.09	3.11	0.81	1.94	1.65	1.28	1.17	1.53	0.97	1.24	2.86	1.15	2.37	1.99	
10/03/2025 19:15	8.96	1.10	3.11	0.82	1.94	1.65	1.28	1.17	1.52	0.98	1.25	2.86	1.15	2.37	1.99	
10/03/2025 19:30	8.96	1.09	3.11	0.83	1.94	1.65	1.28	1.17	1.53	0.99	1.24	2.86	1.15	2.38	1.99	
10/03/2025 19:45	8.97	1.09	3.11	0.84	1.94	1.65	1.28	1.16	1.53	0.98	1.25	2.86	1.15	2.38	1.99	
10/03/2025 20:00	8.96	1.09	3.11	0.85	1.94	1.65	1.27	1.17	1.53	0.97	1.24	2.86	1.15	2.38	1.99	
10/03/2025 20:15	8.96	1.09	3.11	0.85	1.94	1.66	1.28	1.17	1.52	0.98	1.24	2.86	1.15	2.38	1.99	
10/03/2025 20:30	8.97	1.10	3.11	0.86	1.94	1.66	1.29	1.17	1.54	0.98	1.25	2.86	1.15	2.39	1.99	
10/03/2025 20:45	8.96	1.09	3.11	0.86	1.94	1.66	1.28	1.17	1.53	0.98	1.24	2.86	1.15	2.39	1.99	
10/03/2025 21:00	8.97	1.10	3.11	0.87	1.94	1.66	1.27	1.17	1.53	0.98	1.24	2.87	1.15	2.39	1.99	
10/03/2025 21:15	8.97	1.10	3.11	0.87	1.94	1.66	1.28	1.17	1.52	0.98	1.25	2.86	1.16	2.39	1.99	
10/03/2025 21:30	8.96	1.09	3.11	0.87	1.94	1.65	1.27	1.17	1.53	0.99	1.25	2.87	1.15	2.40	1.99	
10/03/2025 21:45	8.97	1.09	3.11	0.87	1.94	1.66	1.28	1.17	1.52	0.98	1.25	2.87	1.16	2.40	1.99	
10/03/2025 22:00	8.97	1.10	3.11	0.87	1.94	1.65	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.41	1.99	
10/03/2025 22:15	8.97	1.09	3.11	0.86	1.94	1.66	1.28	1.17	1.52	0.98	1.25	2.87	1.15	2.41	1.99	
10/03/2025 22:30	8.96	1.09	3.11	0.86	1.94	1.65	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.41	1.99	
10/03/2025 22:45	8.97	1.10	3.11	0.85	1.94	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.41	1.99	
10/03/2025 23:00	8.96	1.09	3.10	0.84	1.94	1.65	1.27	1.17	1.53	0.98	1.24	2.86	1.15	2.41	1.99	
10/03/2025 23:15	8.97	1.10	3.11	0.83	1.94	1.65	1.27	1.17	1.54	0.97	1.24	2.86	1.15	2.42	1.99	
10/03/2025 23:30	8.96	1.09	3.10	0.81	1.94	1.65	1.27	1.17	1.54	0.98	1.24	2.86	1.15	2.42	1.99	
10/03/2025 23:45	8.96	1.09	3.11	0.80	1.94	1.65	1.28	1.17	1.53	0.98	1.24	2.86	1.15	2.42	1.99	
11/03/2025 00:00	8.97	1.09	3.10	0.79	1.94	1.65	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.42	1.99	
11/03/2025 00:15	8.97	1.10	3.11	0.78	1.94	1.65	1.28	1.17	1.53	0.98	1.24	2.86	1.15	2.42	1.99	
11/03/2025 00:30	8.97	1.10	3.11	0.76	1.94	1.65	1.27	1.17	1.52	0.98	1.25	2.86	1.15	2.42	1.99	
11/03/2025 00:45	8.97	1.10	3.11	0.75	1.94	1.65	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.41	1.99	
11/03/2025 01:00	8.97	1.10	3.11	0.74	1.94	1.66	1.28	1.16	1.53	0.97	1.25	2.86	1.16	2.41	1.99	
11/03/2025 01:15	8.97	1.09	3.11	0.73	1.94	1.66	1.28	1.17	1.52	0.98	1.24	2.86	1.15	2.40	1.99	
11/03/2025 01:30	8.96	1.10	3.11	0.72	1.94	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.40	1.99	
11/03/2025 01:45	8.96	1.10	3.11	0.70	1.94	1.65	1.27	1.17	1.53	0.98	1.25	2.86	1.15	2.39	1.99	
11/03/2025 02:00	8.96	1.10	3.10	0.69	1.94	1.66	1.28	1.17	1.53	0.98	1.24	2.86	1.15	2.38	1.99	
11/03/2025 02:15	8.96	1.10	3.10	0.69	1.94	1.66	1.27	1.17	1.53	0.98	1.25	2.86	1.15	2.37	1.99	
11/03/2025 02:30	8.96	1.10	3.11	0.68	1.94	1.66	1.28	1.17	1.55	0.98	1.24	2.86	1.15	2.37	1.99	
11/03/2025 02:45	8.97	1.09	3.11	0.67	1.94	1.65	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.36	1.99	
11/03/2025 03:00	8.97	1.10	3.11	0.66	1.94	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.16	2.36	1.99	
11/03/2025 03:15	8.97	1.10	3.11	0.66	1.94	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.36	1.99	
11/03/2025 03:30	8.96	1.10	3.11	0.66	1.94	1.66	1.28	1.17	1.54	0.98	1.24	2.86	1.15	2.35	1.99	
11/03/2025 03:45	8.96	1.10	3.11	0.65	1.94	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.35	1.99	
11/03/2025 04:00	8.96	1.09	3.11	0.66	1.94	1.65	1.27	1.17	1.54	0.98	1.24	2.86	1.15	2.34	1.99	
11/03/2025 04:15	8.96	1.09	3.11	0.66	1.94	1.65	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.33	1.99	
11/03/2025 04:30	8.96	1.10	3.11	0.67	1.94	1.65	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.33	1.99	
11/03/2025 04:45	8.96	1.09	3.11	0.68	1.94	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.33	1.99	
11/03/2025 05:00	8.96	1.10	3.11	0.69	1.94	1.66	1.28	1.17	1.54	0.97	1.24	2.86	1.15	2.32	1.99	
11/03/2025 05:15	8.96	1.09	3.11	0.70	1.94	1.65	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.32	1.99	
11/03/2025 05:30	8.96	1.09	3.11	0.71	1.94	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.32	1.99	
11/03/2025 05:45	8.97	1.09	3.11	0.73	1.94	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.32	1.99	
11/03/2025 06:00	8.96	1.10	3.11	0.74	1.94	1.65	1.27	1.17	1.54	0.98	1.24	2.86	1.15	2.33	1.99	
11/03/2025 06:15	8.97	1.09	3.11	0.75	1.94	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.33	1.99	
11/03/2025 06:30	8.96	1.09	3.11	0.76	1.94	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.33	1.99	
11/03/2025 06:45	8.97	1.09	3.11	0.78	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.16	2.34	1.99	
11/03/2025 07:00	8.96	1.09	3.11	0.79	1.95	1.66	1.28	1.17	1.55	0.97	1.25	2.86	1.15	2.34	1.99	
11/03/2025 07:15	8.97	1.09	3.11	0.81	1.94	1.65	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.34	1.99	
11/03/2025 07:30	8.97	1.09	3.11	0.82	1.94	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.35	1.99	
11/03/2025 07:45	8.96	1.09	3.11	0.83	1.94	1.66	1.28	1.17	1.53	0.98	1.25	2.86	1.15	2.35	1.99	
11/03/2025 08:00	8.96	1.09	3.11	0.84	1.94	1.65	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.35	1.99	
11/03/2025 08:15	8.96	1.09	3.11	0.85	1.94	1.66	1.29	1.17	1.54	0.98	1.25	2.86	1.15	2.35	1.99	
11/03/2025 08:30	8.96	1.09	3.11	0.87	1.94	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.36	1.99	
11/03/2025 08:45	8.96	1.10	3.11	0.87	1.94	1.66	1.28	1.16	1.54	0.97	1.25	2.86	1.15	2.36	1.99	
11/03/2025 09:00	8.96	1.09	3.10	0.88	1.94	1.65	1.27	1.15	1.54	0.98	1.25	2.85	1.15	2.36	1.98	
11/03/2025 09:15	8.96	1.09	3.11	0.88	1.94	1.65	1.27	1.16	1.54	0.97	1.25	2.86	1.15	2.36	1.99	
11/03/2025 09:30	8.96	1.09	3.11	0.90	1.94	1.65	1.28	1.16	1.54	0.98	1.25	2.86	1.15	2.37	1.99	
11/03/2025 09:45	8.96	1.10	3.11	0.91	1.94	1.65	1.28	1.16	1.54	0.97	1.24	2.85	1.15	2.37	1.99	
11/03/2025 10:00	8.96	1.10	3.11	0.91	1.94	1.65	1.27	1.16	1.54	0.98	1.24	2.85	1.15	2.37	1.99	

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
11/03/2025 10:15	8.96	1.09	3.11	0.91	1.94	1.65	1.28	1.18	1.55	0.97	1.25	2.85	1.14	2.37	1.99	
11/03/2025 10:30	8.97	1.10	3.11	0.91	1.94	1.65	1.29	1.17	1.55	0.98	1.25	2.86	1.15	2.38	1.99	
11/03/2025 10:45	8.96	1.09	3.11	0.91	1.94	1.65	1.28	1.17	1.54	0.97	1.25	2.85	1.15	2.38	1.99	
11/03/2025 11:00	8.96	1.09	3.10	0.90	1.94	1.65	1.28	1.16	1.54	0.97	1.24	2.85	1.15	2.38	1.99	
11/03/2025 11:15	8.96	1.09	3.11	0.90	1.94	1.66	1.28	1.16	1.55	0.98	1.25	2.86	1.15	2.39	1.99	
11/03/2025 11:30	8.96	1.09	3.11	0.89	1.94	1.65	1.28	1.16	1.54	0.97	1.25	2.85	1.15	2.39	1.99	
11/03/2025 11:45	8.96	1.09	3.11	0.88	1.94	1.65	1.28	1.17	1.54	0.97	1.26	2.85	1.15	2.39	1.99	
11/03/2025 12:00	8.96	1.09	3.11	0.87	1.94	1.65	1.28	1.16	1.55	0.97	1.25	2.85	1.14	2.39	1.99	
11/03/2025 12:15	8.96	1.10	3.11	0.86	1.94	1.66	1.29	1.17	1.55	0.97	1.25	2.86	1.15	2.40	1.99	
11/03/2025 12:30	8.96	1.09	3.10	0.84	1.94	1.65	1.28	1.17	1.54	0.97	1.24	2.86	1.15	2.40	1.99	
11/03/2025 12:45	8.96	1.09	3.10	0.83	1.94	1.66	1.29	1.17	1.54	0.97	1.24	2.85	1.15	2.40	1.99	
11/03/2025 13:00	8.96	1.10	3.11	0.82	1.94	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.41	1.99	
11/03/2025 13:15	8.96	1.09	3.11	0.81	1.94	1.65	1.28	1.17	1.55	0.98	1.25	2.86	1.15	2.41	1.99	
11/03/2025 13:30	8.96	1.09	3.11	0.79	1.94	1.65	1.29	1.16	1.53	0.97	1.25	2.86	1.15	2.40	1.99	
11/03/2025 13:45	8.96	1.09	3.11	0.78	1.94	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.40	1.99	
11/03/2025 14:00	8.96	1.09	3.11	0.77	1.94	1.66	1.29	1.17	1.54	0.97	1.26	2.86	1.15	2.40	1.99	
11/03/2025 14:15	8.96	1.09	3.11	0.76	1.94	1.66	1.28	1.17	1.55	0.97	1.25	2.86	1.15	2.39	1.99	
11/03/2025 14:30	8.96	1.10	3.11	0.75	1.94	1.66	1.29	1.17	1.54	0.97	1.25	2.86	1.15	2.39	1.99	
11/03/2025 14:45	8.96	1.09	3.10	0.74	1.94	1.66	1.29	1.17	1.54	0.97	1.25	2.86	1.14	2.38	1.99	
11/03/2025 15:00	8.96	1.09	3.11	0.73	1.94	1.66	1.28	1.17	1.55	0.97	1.25	2.86	1.15	2.37	1.99	
11/03/2025 15:15	8.96	1.09	3.11	0.72	1.94	1.65	1.28	1.16	1.54	0.97	1.25	2.86	1.14	2.37	1.99	
11/03/2025 15:30	8.96	1.09	3.11	0.72	1.94	1.66	1.28	1.16	1.54	0.97	1.25	2.86	1.15	2.37	1.99	
11/03/2025 15:45	8.96	1.09	3.11	0.72	1.94	1.65	1.29	1.17	1.54	0.96	1.24	2.85	1.14	2.36	1.99	
11/03/2025 16:00	8.96	1.09	3.11	0.72	1.94	1.65	1.29	1.17	1.54	0.96	1.24	2.85	1.15	2.35	1.98	
11/03/2025 16:15	8.96	1.09	3.11	0.72	1.94	1.65	1.29	1.18	1.53	0.97	1.24	2.86	1.15	2.35	1.99	
11/03/2025 16:30	8.96	1.10	3.11	0.73	1.94	1.65	1.29	1.17	1.54	0.97	1.24	2.86	1.15	2.35	1.99	
11/03/2025 16:45	8.96	1.09	3.11	0.74	1.94	1.65	1.29	1.16	1.53	0.97	1.24	2.86	1.14	2.35	1.99	
11/03/2025 17:00	8.96	1.09	3.10	0.75	1.94	1.65	1.28	1.16	1.54	0.96	1.24	2.86	1.15	2.35	1.99	
11/03/2025 17:15	8.96	1.09	3.11	0.75	1.94	1.66	1.29	1.16	1.53	0.97	1.24	2.86	1.15	2.35	1.99	
11/03/2025 17:30	8.96	1.09	3.11	0.77	1.94	1.65	1.29	1.17	1.53	0.96	1.25	2.86	1.15	2.36	1.99	
11/03/2025 17:45	8.96	1.09	3.11	0.77	1.94	1.65	1.29	1.17	1.53	0.96	1.25	2.86	1.15	2.36	1.99	
11/03/2025 18:00	8.96	1.09	3.11	0.79	1.94	1.65	1.29	1.17	1.54	0.95	1.25	2.86	1.15	2.36	1.99	
11/03/2025 18:15	8.96	1.09	3.11	0.80	1.94	1.65	1.29	1.17	1.52	0.97	1.25	2.86	1.15	2.36	1.99	
11/03/2025 18:30	8.96	1.09	3.11	0.81	1.94	1.65	1.29	1.17	1.53	0.97	1.25	2.86	1.15	2.37	1.99	
11/03/2025 18:45	8.96	1.09	3.11	0.82	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.37	1.99	
11/03/2025 19:00	8.96	1.09	3.11	0.84	1.94	1.66	1.28	1.17	1.54	0.96	1.25	2.86	1.15	2.37	1.99	
11/03/2025 19:15	8.96	1.09	3.11	0.85	1.94	1.65	1.29	1.17	1.54	0.97	1.25	2.86	1.15	2.37	1.99	
11/03/2025 19:30	8.96	1.09	3.11	0.86	1.94	1.65	1.29	1.16	1.55	0.96	1.25	2.86	1.15	2.37	1.98	
11/03/2025 19:45	8.96	1.09	3.11	0.87	1.94	1.65	1.29	1.17	1.54	0.97	1.25	2.86	1.15	2.38	1.99	
11/03/2025 20:00	8.96	1.09	3.10	0.88	1.94	1.65	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.38	1.98	
11/03/2025 20:15	8.96	1.09	3.11	0.90	1.94	1.66	1.29	1.17	1.54	0.97	1.25	2.86	1.15	2.39	1.99	
11/03/2025 20:30	8.96	1.09	3.11	0.90	1.94	1.66	1.29	1.17	1.53	0.98	1.25	2.86	1.15	2.39	1.99	
11/03/2025 20:45	8.96	1.10	3.11	0.91	1.94	1.66	1.29	1.17	1.54	0.98	1.25	2.86	1.15	2.39	1.99	
11/03/2025 21:00	8.96	1.09	3.11	0.91	1.94	1.66	1.28	1.17	1.55	0.97	1.25	2.86	1.15	2.39	1.99	
11/03/2025 21:15	8.96	1.09	3.11	0.91	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.39	1.99	
11/03/2025 21:30	8.96	1.09	3.11	0.92	1.94	1.66	1.29	1.17	1.53	0.97	1.24	2.86	1.15	2.40	1.99	
11/03/2025 21:45	8.96	1.09	3.11	0.92	1.94	1.66	1.29	1.17	1.54	0.97	1.25	2.86	1.15	2.40	1.99	
11/03/2025 22:00	8.96	1.09	3.11	0.92	1.94	1.66	1.28	1.17	1.55	0.97	1.24	2.86	1.15	2.40	1.99	
11/03/2025 22:15	8.96	1.09	3.11	0.92	1.94	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.41	1.99	
11/03/2025 22:30	8.96	1.09	3.11	0.92	1.94	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.41	1.99	
11/03/2025 22:45	8.96	1.09	3.11	0.91	1.94	1.65	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.41	1.99	
11/03/2025 23:00	8.97	1.10	3.11	0.91	1.94	1.66	1.29	1.17	1.54	0.97	1.25	2.86	1.15	2.41	1.99	
11/03/2025 23:15	8.96	1.09	3.11	0.90	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.42	1.99	
11/03/2025 23:30	8.96	1.10	3.11	0.89	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.42	1.99	
11/03/2025 23:45	8.96	1.10	3.11	0.88	1.95	1.66	1.29	1.17	1.54	0.97	1.25	2.86	1.15	2.42	1.99	
12/03/2025 00:00	8.96	1.10	3.11	0.87	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.42	1.99	
12/03/2025 00:15	8.96	1.09	3.11	0.85	1.94	1.66	1.28	1.16	1.53	0.97	1.25	2.86	1.15	2.42	1.99	
12/03/2025 00:30	8.96	1.10	3.11	0.83	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.43	1.99	
12/03/2025 00:45	8.96	1.10	3.11	0.81	1.94	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.43	1.99	
12/03/2025 01:00	8.96	1.10	3.11	0.80	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.42	1.99	
12/03/2025 01:15	8.96	1.10	3.11	0.78	1.94	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.42	1.99	
12/03/2025 01:30	8.96	1.10	3.11	0.77	1.95	1.66	1.27	1.17	1.53	0.97	1.25	2.86	1.15	2.42	1.99	
12/03/2025 01:45	8.96	1.10	3.11	0.75	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.41	1.99	
12/03/2025 02:00	8.97	1.10	3.11	0.73	1.95	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.40	1.99	
12/03/2025 02:15	8.96	1.09	3.11	0.72	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.40	1.99	
12/03/2025 02:30	8.96	1.09	3.11	0.70	1.95	1.66	1.29	1.17	1.54	0.97	1.25	2.86	1.16	2.39	1.99	
12/03/2025 02:45	8.96	1.10	3.11	0.69	1.95	1.66	1.29	1.17	1.54	0.98	1.26	2.86	1.15	2.38	1.99	
12/03/2025 03:00	8.96	1.10	3.11	0.68	1.95	1.66	1.29	1.17	1.55	0.97	1.25	2.86	1.15	2.38	1.99	
12/03/2025 03:15	8.96	1.10	3.11	0.66	1.94	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.37	1.99	
12/03/2025 03:30	8.96	1.09	3.11	0.65	1.95	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.37	1.99	
12/03/2025 03:45	8.96	1.09	3.11	0.65	1.95	1.66	1.28	1.17	1.54	0.96	1.25	2.86	1.15	2.36	1.99	
12/03/2025 04:00	8.96	1.10	3.11	0.64	1.95	1.66	1.29	1.17	1.53	0.97	1.25	2.86	1.15	2.36	1.99	
12/03/2025 04:15	8.96	1.09	3.11	0.64	1.95	1.66	1.28	1.17	1.53	0.97	1.26	2.86	1.15	2.35	1.99	
12/03/2025 04:30	8.96	1.10	3.11	0.65	1.95	1.66	1.28	1.17	1.55	0.97	1.25	2.86	1.15	2.35	1.99	
12/03/2025 04:45	8.96	1.10	3.11	0.65	1.95	1.65	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.34	1.99	
12/03/2025 05:00	8.96	1.09	3.11	0.66	1.95	1.65	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.33	1.99	
12/03/2025 05:15	8.96	1.09	3.11	0.66	1.94	1.65	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.33	1.99	
12/03/2025 05:30	8.96	1.09	3.11	0.67	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.85	1.15	2.32	1.99	
12/03/2025 05:45	8.96	1.09	3.11	0.69	1.94	1.65	1.28	1.17	1.53	0.96	1.25	2.86	1.15	2.32	1.99	
12/03/2025 06:00	8.96	1.09	3.11	0.70	1.94	1.65	1.27	1.17	1.53	0.97	1.25	2.86	1.15	2.31	1.99	
12/03/2025 06:15	8.96	1.09	3.11	0.71	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.31	1.99	
12/03/2025 06:30	8.96	1.09	3.10	0.72	1.94	1.65	1.27	1.17	1.54	0.97	1.26	2.85	1.15	2.31	1.99	
12/03/2025 06:45	8.96	1.09	3.11	0.74	1.94	1.66	1.28	1.17	1.54	0.97	1.25	2.85	1.15	2.32	1.99	
12/03/2025 07:00	8.96	1.10	3.11	0.75	1.94	1.65	1.27	1.17	1.53	0.97	1.25	2.86	1.15	2.32	1.99	
12/03/2025 07:15	8.96	1.09	3.11	0.76	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.32	1.99	
12/03/2025 07:30	8.96	1.09	3.11	0.78	1.94	1.66	1.28	1.17	1.54	0.98	1.25	2.86	1.15	2.32	1.99	
12/03/2025 07:45	8.96	1.09	3.11	0.79	1.94	1.66	1.28	1.17	1.53	0.96	1.25	2.86	1.15	2.33	1.99	
12/03/2025 08:00	8.96	1.10	3.11	0.80	1.94	1.66	1.28	1.17	1.53	0.96	1.25	2.86	1.15	2.34	1.99	
12/03/2025 08:15	8.97	1.10	3.11	0.82	1.94	1.65	1.28	1.17	1.53	0.96	1.25	2.86	1.15	2.34	1.99	
12/03/2025 08:30	8.97	1.10	3.11	0.83	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.86	1.15	2.34	1.99	
12/03/2025 08:45	8.96	1.10	3.11	0.84	1.94	1.66	1.29	1.17	1.54	0.97	1.25	2.86	1.15	2.34	1.99	
12/03/2025 09:00	8.96	1.10	3.11	0.86	1.95	1.66	1.28	1.17	1.53	0.97	1.24	2.86	1.16	2.35	1.99	
12/03/2025 09:15	8.96	1.09	3.11	0.87	1.94	1.65	1.28	1.16	1.53	0.97	1.25	2.85	1.15	2.35	1.99	
12/03/2025 09:30	8.96	1.10	3.11	0.88	1.94	1.66	1.28	1.17	1.54	0.97	1.25	2.86	1.15	2.35	1.99	
12/03/2025 09:45	8.96	1.10	3.11	0.89	1.94	1.66	1.28	1.17	1.54	0.97	1.25	2.85	1.15	2.36	1.99	
12/03/2025 10:00	8.96	1.09	3.11	0.90	1.94	1.65	1.28	1.16	1.54	0.97	1.25	2.86	1.15	2.36	1.99	
12/03/2025 10:15	8.96	1.09	3.11	0.90	1.94	1.65	1.28	1.16	1.54	0.97	1.25	2.85	1.15	2.36	1.99	
12/03/2025 10:30	8.96	1.09	3.11	0.91	1.94	1.65	1.28	1.16	1.52	0.97	1.25	2.86	1.15	2.37	1.99	
12/03/2025 10:45	8.96	1.09	3.11	0.92	1.94	1.65	1.27	1.16	1.54	0.97	1.25	2.85	1.14	2.36	1.99	
12/03/2025 11:00	8.96	1.09	3.10	0.92	1.94	1.65	1.27	1.17	1.53	0.97	1.24	2.85	1.15	2.37	1.98	
12/03/2025 11:15	8.96	1.09	3.11	0.92	1.94	1.65	1.27	1.17	1.54	0.97	1.25	2.85	1.15	2.37	1.99	
12/03/2025 11:30	8.96	1.09	3.10	0.92	1.94	1.65	1.28	1.17	1.54	0.97	1.25	2.85	1.15	2.37	1.99	
12/03/2025 11:45	8.96	1.09	3.11	0.91	1.94	1.66	1.28	1.16	1.52	0.96	1.25	2.85	1.14	2.38	1.99	
12/03/2025 12:00	8.96	1.09	3.10	0.90	1.94	1.65	1.28	1.16	1.53	0.97	1.24	2.85	1.15	2.38	1.98	
12/03/2025 12:15	8.96	1.09	3.10	0.89	1.94	1.66	1.28	1.17	1.53	0.97	1.24	2.85	1.15	2.39	1.98	
12/03/2025 12:30	8.96	1.09	3.10	0.88	1.94	1.65	1.28	1.17	1.53	0.97	1.24	2.85	1.14	2.39	1.98	
12/03/2025 12:45	8.96	1.09	3.10	0.87	1.94	1.66	1.28	1.17	1.53	0.97	1.25	2.85	1.15	2.39	1.99	
12/03/2025 13:00	8.96	1.10	3.10	0.85	1.94	1.66	1.28	1.17	1.51	0.97	1.24	2.86	1.15	2.39	1.99	
12/03/2025 13:15	8.96	1.09	3.10	0.84	1.94	1.66	1.28	1.18	1.50	0.97	1.25	2.86	1.15	2.39	1.99	
12/03/2025 13:30	8.96	1.09	3.11	0.82	1.94	1.66	1.28	1.16	1.51	0.96	1.25	2.86	1.15	2.40	1.99	
12/03/2025 13:45	8.96	1.09	3.11	0.81	1.94	1.66	1.28	1.17	1.51	0.97	1.25	2.86	1.15	2.40	1.99	
12/03/2025 14:00	8.96	1.09	3.10	0.80	1.94	1.66	1.28	1.17	1.50	0.97	1.24	2.86	1.15	2.40	1.99	
12/03/2025 14:15	8.96	1.09	3.10	0.78	1.94	1.65	1.28	1.17	1.50	0.97	1.24	2.85	1.14	2.40	1.98	
12/03/2025 14:30	8.96	1.10	3.11	0.77	1.94	1.65	1.27	1.16	1.49	0.97	1.24	2.86	1.14	2.39	1.99	
12/03/2025 14:45	8.96	1.10	3.11	0.76	1.94	1.66	1.28	1.16	1.50	0.97	1.25	2.86	1.15	2.39	1.99	
12/03/2025 15:00	8.96	1.09	3.10	0.74	1.94	1.65	1.27	1.17	1.50	0.97	1.24	2.86	1.14	2.38	1.98	
12/03/2025 15:15	8.96	1.09	3.11	0.73	1.94	1.65	1.28	1.16	1.50	0.97	1.25	2.85	1.15	2.37	1.99	
12/03/2025 15:30	8.96	1.09	3.10	0.72	1.94	1.65	1.28	1.16	1.50	0.97	1.25	2.86	1.15	2.37	1.98	
12/03/2025 15:45	8.95	1.09	3.10	0.71	1.94	1.65	1.28	1.16	1.50	0.97	1.25	2.86	1.14	2.36	1.98	
12/03/2025 16:00	8.96	1.09	3.10	0.71	1.94	1.65	1.28	1.16	1.50	0.97	1.24	2.86	1.15	2.36	1.99	
12/03/2025 16:15	8.96	1.09	3.10	0.71	1.94	1.65	1.28	1.17	1.50	0.97	1.24	2.86	1.15	2.36	1.99	
12/03/2025 16:30	8.96	1.09	3.10	0.71	1.94	1.65	1.29	1.16	1.50	0.97	1.24	2.85	1.14	2.35	1.98	
12/03/2025 16:45	8.96	1.09	3.10	0.71	1.94	1.65	1.28	1.16	1.49	0.97	1.25	2.86	1.14	2.35	1.98	
12/03/2025 17:00	8.96	1.09	3.10	0.72	1.94	1.65	1.28	1.17	1.50	0.97	1.25	2.86	1.15	2.35	1.98	
12/03/2025 17:15	8.96	1.09	3.10	0.73	1.94	1.65	1.28	1.17	1.48	0.96	1.25	2.86	1.14	2.34	1.98	
12/03/2025 17:30	8.96	1.09	3.10	0.74	1.94	1.65	1.28	1.17	1.50	0.97	1.25	2.86	1.15	2.34	1.98	
12/03/2025 17:45	8.96	1.09	3.10	0.75	1.94	1.65	1.28	1.17	1.50	0.98	1.25	2.86	1.15	2.34	1.98	
12/03/2025 18:00	8.95	1.09	3.10	0.76	1.94	1.65	1.28	1.17	1.50	0.97	1.24	2.86	1.15	2.34	1.98	
12/03/2025 18:15	8.96	1.09	3.11	0.77	1.93	1.65	1.28	1.17	1.50	0.97	1.24	2.86	1.15	2.34	1.98	

Appendix C: Diver Water Level Data

	ACC-BH05-EW	BP23	C2D	C3D	C7	CPB_BP_11	CPB_BP_13	GRR-BH15-EW	PT02	PT05	PZ2009_20	PS01	PS02	PS03	RR7	COMMENTS
Top of well Level (mOD)	19.11	8.95	4.46	3.24	15.47	17.46	12.26	7.67	11.91	4.66	8.08	3.32	1.72	3.05	9.34	
12/03/2025 18:30	8.96	1.09	3.11	0.78	1.93	1.64	1.28	1.17	1.51	0.97	1.25	2.86	1.15	2.34	1.98	
12/03/2025 18:45	8.96	1.09	3.11	0.79	1.93	1.65	1.28	1.17	1.50	0.97	1.25	2.86	1.15	2.35	1.98	
12/03/2025 19:00	8.96	1.09	3.10	0.80	1.94	1.65	1.28	1.17	1.50	0.97	1.25	2.86	1.15	2.35	1.98	
12/03/2025 19:15	8.96	1.09	3.11	0.82	1.94	1.65	1.28	1.16	1.50	0.97	1.25	2.86	1.15	2.36	1.98	
12/03/2025 19:30	8.96	1.09	3.10	0.82	1.93	1.65	1.29	1.16	1.50	0.97	1.25	2.86	1.15	2.36	1.98	
12/03/2025 19:45	8.96	1.09	3.11	0.84	1.94	1.65	1.27	1.17	1.50	0.97	1.25	2.85	1.15	2.36	1.98	
12/03/2025 20:00	8.96	1.09	3.11	0.85	1.94	1.65	1.28	1.17	1.49	0.97	1.25	2.86	1.15	2.36	1.99	
12/03/2025 20:15	8.96	1.09	3.11	0.86	1.94	1.65	1.29	1.17	1.52	0.98	1.25	2.86	1.15	2.36	1.99	
12/03/2025 20:30	8.96	1.09	3.11	0.87	1.94	1.65	1.28	1.17	1.51	0.97	1.25	2.86	1.15	2.36	1.98	
12/03/2025 20:45	8.96	1.09	3.10	0.88	1.94	1.65	1.28	1.17	1.51	0.97	1.25	2.86	1.15	2.36	1.98	
12/03/2025 21:00	8.96	1.10	3.11	0.90	1.94	1.66	1.28	1.17	1.51	0.97	1.25	2.86	1.16	2.37	1.99	
12/03/2025 21:15	8.96	1.10	3.11	0.90	1.94	1.65	1.27	1.17	1.53	0.97	1.25	2.86	1.15	2.37	1.99	
12/03/2025 21:30	8.96	1.10	3.11	0.91	1.93	1.65	1.28	1.17	1.52	0.98	1.25	2.86	1.15	2.37	1.99	
12/03/2025 21:45	8.96	1.09	3.11	0.91	1.93	1.65	1.28	1.17	1.51	0.96	1.25	2.86	1.15	2.37	1.98	
12/03/2025 22:00	8.96	1.09	3.11	0.92	1.94	1.65	1.28	1.17	1.52	0.97	1.25	2.86	1.15	2.37	1.98	
12/03/2025 22:15	8.96	1.10	3.11	0.92	1.94	1.65	1.27	1.17	1.51	0.97	1.25	2.86	1.15	2.37	1.98	
12/03/2025 22:30	8.96	1.10	3.11	0.92	1.94	1.66	1.29	1.17	1.50	0.98	1.25	2.86	1.15	2.38	1.99	
12/03/2025 22:45	8.96	1.10	3.11	0.93	1.94	1.66	1.27	1.17	1.50	0.97	1.24	2.86	1.15	2.38	1.99	
12/03/2025 23:00	8.96	1.10	3.10	0.92	1.94	1.65	1.28	1.17	1.50	0.97	1.24	2.86	1.15	2.38	1.99	
12/03/2025 23:15	8.96	1.10	3.11	0.92	1.94	1.65	1.28	1.17	1.50	0.98	1.25	2.86	1.15	2.38	1.99	
12/03/2025 23:30	8.96	1.10	3.11	0.93	1.94	1.65	1.28	1.17	1.50	0.97	1.26	2.86	1.15	2.39	1.99	
12/03/2025 23:45	8.96	1.10	3.11	0.91	1.94	1.65	1.28	1.17	1.51	0.97	1.25	2.86	1.15	2.38	1.99	
13/03/2025 00:00	8.96	1.10	3.11	0.91	1.94	1.65	1.28	1.17	1.50	0.97	1.25	2.86	1.16	2.39	1.98	
13/03/2025 00:15	8.96	1.10	3.11	0.90	1.94	1.66	1.28	1.17	1.51	0.98	1.25	2.86	1.15	2.39	1.99	
13/03/2025 00:30	8.96	1.10	3.11	0.88	1.94	1.65	1.28	1.17	1.52	0.98	1.26	2.86	1.16	2.39	1.99	
13/03/2025 00:45	8.96	1.10	3.11	0.86	1.94	1.65	1.28	1.17	1.50	0.97	1.25	2.86	1.15	2.39	1.98	
13/03/2025 01:00	8.96	1.10	3.11	0.85	1.94	1.65	1.28	1.17	1.51	0.97	1.25	2.86	1.15	2.40	1.99	
13/03/2025 01:15	8.96	1.10	3.11	0.83	1.94	1.66	1.29	1.17	1.50	0.97	1.25	2.86	1.15	2.40	1.99	
13/03/2025 01:30	8.96	1.10	3.11	0.81	1.94	1.65	1.28	1.17	1.50	0.98	1.25	2.86	1.15	2.40	1.98	
13/03/2025 01:45	8.96	1.10	3.11	0.79	1.94	1.65	1.28	1.17	1.50	0.98	1.24	2.86	1.15	2.39	1.98	
13/03/2025 02:00	8.96	1.09	3.11	0.77	1.94	1.65	1.29	1.17	1.51	0.97	1.24	2.86	1.16	2.39	1.98	
13/03/2025 02:15	8.96	1.10	3.11	0.76	1.94	1.65	1.28	1.17	1.49	0.97	1.24	2.86	1.16	2.38	1.99	
13/03/2025 02:30	8.96	1.09	3.10	0.74	1.94	1.65	1.28	1.17	1.50	0.97	1.24	2.86	1.15	2.38	1.98	
13/03/2025 02:45	8.96	1.10	3.11	0.73	1.94	1.66	1.29	1.17	1.50	0.98	1.25	2.86	1.15	2.37	1.99	
13/03/2025 03:00	8.96	1.09	3.11	0.71	1.94	1.65	1.27	1.17	1.51	0.98	1.24	2.86	1.15	2.36	1.99	
13/03/2025 03:15	8.96	1.10	3.10	0.70	1.94	1.65	1.28	1.17	1.49	0.97	1.25	2.86	1.16	2.36	1.98	
13/03/2025 03:30	8.96	1.10	3.10	0.68	1.94	1.65	1.29	1.17	1.50	0.97	1.25	2.86	1.15	2.35	1.99	
13/03/2025 03:45	8.96	1.10	3.11	0.67	1.94	1.65	1.27	1.17	1.50	0.97	1.25	2.86	1.15	2.35	1.99	
13/03/2025 04:00	8.96	1.10	3.11	0.66	1.94	1.65	1.28	1.17	1.49	0.97	1.25	2.86	1.16	2.34	1.99	
13/03/2025 04:15	8.96	1.10	3.11	0.65	1.94	1.65	1.28	1.17	1.51	0.97	1.26	2.86	1.15	2.34	1.99	
13/03/2025 04:30	8.96	1.09	3.11	0.64	1.94	1.66	1.29	1.17	1.50	0.97	1.25	2.86	1.16	2.33	1.99	
13/03/2025 04:45	8.96	1.10	3.11	0.64	1.94	1.65	1.28	1.17	1.50	0.97	1.25	2.86	1.15	2.33	1.99	
13/03/2025 05:00	8.96	1.09	3.11	0.64	1.94	1.65	1.28	1.17	1.50	0.97	1.25	2.86	1.16	2.32	1.99	
13/03/2025 05:15	8.96	1.09	3.11	0.65	1.94	1.65	1.27	1.17	1.50	0.96	1.25	2.86	1.16	2.32	1.98	
13/03/2025 05:30	8.96	1.09	3.11	0.65	1.94	1.65	1.29	1.17	1.49	0.97	1.24	2.86	1.16	2.31	1.98	
13/03/2025 05:45	8.96	1.09	3.10	0.66	1.93	1.65	1.28	1.17	1.49	0.97	1.24	2.86	1.16	2.31	1.98	
13/03/2025 06:00	8.96	1.09	3.10	0.67	1.94	1.65	1.28	1.17	1.50	0.97	1.25	2.86	1.16	2.30	1.98	
13/03/2025 06:15	8.96	1.09	3.11	0.68	1.93	1.65	1.28	1.17	1.51	0.97	1.25	2.86	1.15	2.30	1.98	
13/03/2025 06:30	8.96	1.10	3.11	0.70	1.94	1.65	1.27	1.17	1.50	0.97	1.25	2.86	1.15	2.29	1.98	
13/03/2025 06:45	8.96	1.09	3.10	0.71	1.94	1.65	1.28	1.17	1.49	0.97	1.25	2.86	1.16	2.29	1.98	
13/03/2025 07:00	8.96	1.10	3.11	0.72	1.94	1.65	1.28	1.17	1.49	0.96	1.25	2.86	1.15	2.29	1.98	
13/03/2025 07:15	8.96	1.09	3.11	0.73	1.93	1.65	1.29	1.17	1.49	0.97	1.25	2.86	1.15	2.29	1.98	
13/03/2025 07:30	8.96	1.09	3.11	0.75	1.93	1.65	1.28	1.17	1.50	0.97	1.25	2.86	1.15	2.29	1.98	
13/03/2025 07:45	8.96	1.10	3.11	0.76	1.94	1.65	1.28	1.17	1.49	0.97	1.25	2.86	1.15	2.30	1.98	
13/03/2025 08:00	8.96	1.09	3.10	0.78	1.93	1.65	1.27	1.17	1.49	0.97	1.24	2.86	1.15	2.30	1.98	
13/03/2025 08:15	8.96	1.09	3.10	0.79	1.93	1.65	1.27	1.16	1.49	0.97	1.25	2.86	1.15	2.30	1.98	
13/03/2025 08:30	8.96	1.09	3.11	0.80	1.93	1.65	1.27	1.16	1.49	0.97	1.25	2.86	1.15	2.30	1.98	
13/03/2025 08:45	8.96	1.10	3.10		1.93	1.65	1.28	1.17	1.49	0.97	1.26	2.86	1.15	2.31	1.98	
13/03/2025 09:00	8.96	1.09	3.10		1.93	1.65	1.28	1.17	1.50	0.96		2.86	1.15	2.31	1.98	
13/03/2025 09:15	8.96		3.10		1.93	1.65	1.27	1.17	1.51	0.97		2.86	1.15	2.31	1.98	
13/03/2025 09:30	8.96		3.10		1.93	1.65	1.27	1.17	1.51	0.97		2.86	1.15	2.31		
13/03/2025 09:45	8.96		3.10		1.93	1.65	1.28	1.17	1.50	0.97		2.86	1.15	2.32		
13/03/2025 10:00	8.96		3.10		1.94	1.65	1.28	1.17	1.49	0.97		2.86	1.15	2.32		
13/03/2025 10:15	8.96				1.93	1.65	1.28	1.16	1.50	0.97		2.86		2.32		
13/03/2025 10:30	8.96				1.93	1.65	1.28	1.16	1.49	0.97				2.33		
13/03/2025 10:45	8.96				1.94	1.65	1.27	1.16	1.49	0.97				2.33		
13/03/2025 11:00	8.98				1.95	1.67	1.29		1.51	0.99				2.35		
13/03/2025 11:15	8.97					1.66	1.30		1.51	0.99				2.35		
13/03/2025 11:30						1.67	1.30		1.51	1.00				2.36		
13/03/2025 11:45						1.65	1.29		1.51	0.98				2.35		
13/03/2025 12:00						1.70	1.34		1.56	1.02				2.40		
13/03/2025 12:15						1.71	1.33		1.57	1.03				2.41		
13/03/2025 12:30						1.65	1.27		1.50	0.98				2.35		
13/03/2025 12:45										0.97				2.35		
13/03/2025 13:00										0.97				2.36		
13/03/2025 13:15														2.36		
13/03/2025 13:30														2.37		

APPENDIX D: MANUAL DIP DATA

	ACC-BH05-EW		BP23		C2D		C3D		C7		CPB_BP_11		CPB_BP_13		GRR-BH15-EW		PB01		PT01		PT02		PT05		PZ2009_20		RR7		PS01		PS02		PS03		Comments
Top of well Level (mOD)	19.11		8.95		4.46		3.24		15.47		17.46		12.26		7.67		13.47		13.94		11.91		4.66		8.08		9.34		3.32		1.72		3.05		
Date and Time	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	
03/02/2025 11:22	10.13	8.98																																
03/02/2025 11:38									13.53	1.94																								
03/02/2025 12:15																																	0.56	2.49	
03/02/2025 14:18																															0.55	1.17			
03/02/2025 14:26					1.33	3.13																												
03/02/2025 14:35																													0.46	2.87				
04/02/2025 09:32							2.68	0.56																										
04/02/2025 09:47			7.84	1.11																														
04/02/2025 10:07																									6.80	1.28								
04/02/2025 11:04																							3.64	1.02										
04/02/2025 11:47																					10.33	1.58												
04/02/2025 12:43															6.48	1.19																		
04/02/2025 13:10											15.79	1.67																						
04/02/2025 13:35													10.97	1.29																				
04/02/2025 13:55																											7.34	2.00						
11/02/2025 11:42																																		PB01 Dip Nulled
11/02/2025 11:46																			12.43	1.51														
15/02/2025 12:12																																	0.68	2.38
15/02/2025 13:15									13.52	1.95																								
15/02/2025 14:02																															0.58	1.14		
15/02/2025 14:12					1.39	3.07																												
15/02/2025 14:21																													0.47	2.85				
15/02/2025 16:19																							3.66	1.00										
16/02/2025 08:49			7.84	1.11																														
16/02/2025 09:04							2.67	0.57																										
16/02/2025 09:18															6.48	1.19																		
16/02/2025 09:26																									6.81	1.27								
16/02/2025 09:50													10.96	1.30																				
16/02/2025 10:09											15.80	1.66																						
16/02/2025 10:19																					10.34	1.57												
16/02/2025 10:39																											7.34	2.00						
16/02/2025 11:07	10.12	8.99																																
16/02/2025 11:50																															0.57	1.15		
16/02/2025 12:12																													0.46	2.87				
16/02/2025 13:07																																	0.70	2.36
17/02/2025 11:08																															0.57	1.15		
17/02/2025 11:20																													0.46	2.86				
17/02/2025 12:18																																	0.75	2.30
18/02/2025 07:42																	12.02	1.45																
18/02/2025 07:47																			12.44	1.50														
18/02/2025 08:01																	12.24	1.23																
18/02/2025 08:02																	12.25	1.22																
18/02/2025 08:04																	12.25	1.22																
18/02/2025 08:05																	12.26	1.21																
18/02/2025 08:06																	12.26	1.21																
18/02/2025 08:07																	12.27	1.20																
18/02/2025 08:08																	12.27	1.20																
18/02/2025 08:09																	12.27	1.20																
18/02/2025 08:10																	12.27	1.20																
18/02/2025 08:11																	12.27	1.20																
18/02/2025 08:12																	12.27	1.20																
18/02/2025 08:13																	12.27	1.20																
18/02/2025 08:14																	12.27	1.20																
18/02/2025 08:15																	12.27	1.20																
18/02/2025 08:16																	12.27	1.20																
18/02/2025 08:17																	12.27	1.20																
18/02/2025 08:18																	12.27	1.20																
18/02/2025 08:19																	12.27	1.20																
18/02/2025 08:20																	12.27	1.20																
18/02/2025 08:23																			12.44	1.50														
18/02/2025 08:25																	12.27	1.20																
18/02/2025 08:31																	12.27	1.20																
18/02/2025 08:33							2.71	0.53																										
18/02/2025 08:35																	12.27	1.20																
18/02/2025 08:40																	12.27	1.20																
18/02/2025 08:45																	12.27	1.20																
18/02/2025 08:51																	12.27	1.20																
18/02/2025 08:55																	12.27	1.20																
18/02/2025 09:01																	12.27	1.20							6.81	1.27								
18/02/2025 09:10																	12.27	1.20																
18/02/2025 09:22															6.49	1.18																		
18/02/2025 09:23																	12.27	1.20																
18/02/2025 09:31			7.85	1.10													12.27	1.20																
18/02/2025 09:34																			12.44	1.50														
18/02/2025 09:39																	12.27	1.20																
18/02/2025 09:45																	12.49	0.98																
18/02/2025 09:47																	12.49	0.98																
18/02/2025 09:49																	12.49	0.98																
18/02/2025 09:50																	12.49	0.98																
18/02/2025 09:51																	12.49	0.98																
18/02/2025 09:52																	12.49	0.98																
18/02/2025 09:54																	12.49	0.98																
18/02/2025 09:55																	12.49	0.98																
18/02/2025 09:56																	12.49	0.98																
18/02/2025 09:57																	12.49	0.98																
18/02/2025 09:59																	12.49	0.98																
18/02/2025 10:00																	12.49	0.98																
18/02/2025 10:06																	12.50	0.97																
18/02/2025 10:11																	12.50	0.97																
18/02/2025 10:12																			12.44	1.50														
18/02/2025 10:16																	12.50	0.97																
18/02/2025 10:18																															0.58	1.14		
18/02/2025 10:22																	12.50	0.97																
18/02/2025 10:25																	12.50	0.97																
18/02/2025 10:30																	12.50	0.97																
18/02/2025 10:33																													0.47	2.85				
18/02/2025 10:36																	12.50	0.97																
18/02/2025 10:41																	12.50	0.97																
18/02/2025 10:51																	12.50	0.97																
18/02/2025 10:53																			12.44	1.50														
18/02/2025 11:01																	12.50	0.97																
18/02/2025 11:03									13.51	1.96																								
18/02/2025 11:11																	12.50	0.97																
18/02/2025 11:17	10.12	8.99																																
18/02/2025 11:19																	12.50	0.97																
18/02/2025 11:23																	12.74	0.73																
18/02/2025 11:24					1.35	3.11											12.74	0.73																
18/02/2025 11:25																	12.74	0.73																
18/02/2025 11:26																	12.74	0.73																
18/02/2025 11:27																	12.74	0.73																
18/02/2025 11:29																	12.74	0.73																
18/02/2025 11:30																	12.74	0.73																

	ACC-BH05-EW		BP23		C2D		C3D		C7		CPB_BP_11		CPB_BP_13		GRR-BH15-EW		PB01		PT01		PT02		PT05		PZ2009_20		RR7		PS01		PS02		PS03		Comments
Top of well Level (mOD)	19.11		8.95		4.46		3.24		15.47		17.46		12.26		7.67		13.47		13.94		11.91		4.66		8.08		9.34		3.32		1.72		3.05		
Date and Time	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	
18/02/2025 11:32																	12.74	0.73																
18/02/2025 11:33																	12.74	0.73																
18/02/2025 11:34																	12.74	0.73																
18/02/2025 11:35																	12.74	0.73																
18/02/2025 11:36																	12.74	0.73																
18/02/2025 11:37																	12.74	0.73																
18/02/2025 11:38																	12.74	0.73																
18/02/2025 11:39																	12.74	0.73																
18/02/2025 11:40																	12.74	0.73																
18/02/2025 11:41																	12.74	0.73																
18/02/2025 11:46																	12.75	0.72																
18/02/2025 11:51																	12.75	0.72																
18/02/2025 11:57																	12.75	0.72																
18/02/2025 11:58																	12.75	0.72																
18/02/2025 12:01																	12.75	0.72																
18/02/2025 12:07																	12.75	0.72																
18/02/2025 12:12																	12.75	0.72																
18/02/2025 12:16																	12.75	0.72																
18/02/2025 12:19																			12.44	1.50														
18/02/2025 12:20																	12.75	0.72																
18/02/2025 12:31																	12.75	0.72																
18/02/2025 12:41																	12.75	0.72																
18/02/2025 12:42													10.97	1.29																				
18/02/2025 12:51																	12.75	0.72																
18/02/2025 12:52											15.78	1.68																						
18/02/2025 12:58																					10.32	1.59												
18/02/2025 13:00																	12.75	0.72																
18/02/2025 13:02																	12.98	0.49																
18/02/2025 13:03																	12.98	0.49																
18/02/2025 13:04																	12.98	0.49																
18/02/2025 13:05																	12.98	0.49																
18/02/2025 13:06																	12.98	0.49																
18/02/2025 13:07																	12.99	0.48									7.33	2.01						
18/02/2025 13:08																	12.99	0.48																
18/02/2025 13:09																	12.99	0.48																
18/02/2025 13:10																	12.99	0.48																
18/02/2025 13:11																	12.99	0.48																
18/02/2025 13:12																	12.99	0.48																
18/02/2025 13:13																	12.99	0.48																
18/02/2025 13:14																	12.99	0.48																
18/02/2025 13:15																	12.99	0.48																
18/02/2025 13:16																	12.99	0.48																
18/02/2025 13:17																	12.99	0.48																
18/02/2025 13:18																	13.00	0.47																
18/02/2025 13:19																	13.00	0.47																
18/02/2025 13:20																	13.00	0.47																
18/02/2025 13:21																	13.00	0.47																
18/02/2025 13:26																	13.00	0.47																
18/02/2025 13:31																	13.00	0.47																
18/02/2025 13:36																	13.00	0.47																
18/02/2025 13:40																																	0.75	2.30
18/02/2025 13:41																	13.00	0.47																
18/02/2025 13:46																	13.00	0.47																
18/02/2025 13:53																	13.00	0.47																
18/02/2025 13:56																	13.00	0.47																
18/02/2025 13:57																							3.68	0.98										
18/02/2025 14:01																	13.00	0.47																
18/02/2025 14:05																			12.44	1.50														
18/02/2025 14:12																	13.00	0.47																
18/02/2025 14:21																	13.00	0.47																
18/02/2025 14:31																	13.00	0.47																
18/02/2025 14:39																	13.00	0.47																
18/02/2025 14:42																	13.25	0.22																
18/02/2025 14:43																	13.25	0.22																
18/02/2025 14:44																	13.26	0.21																
18/02/2025 14:45																	13.26	0.21																
18/02/2025 14:46																	13.27	0.20																
18/02/2025 14:47																																		
18/02/2025 14:49																	13.27	0.20																
18/02/2025 14:50																	13.27	0.20																
18/02/2025 14:51																	13.27	0.20																
18/02/2025 14:52																	13.27	0.20																
18/02/2025 14:53																	13.27	0.20																
18/02/2025 14:54																	13.27	0.20																
18/02/2025 14:55																	13.27	0.20																
18/02/2025 14:56																	13.27	0.20																
18/02/2025 14:57																	13.27	0.20																
18/02/2025 14:58																	13.27	0.20																
18/02/2025 14:59																	13.27	0.20																
18/02/2025 15:00																	13.27	0.20																
18/02/2025 15:01																	13.27	0.20																
18/02/2025 15:06																	13.27	0.20																
18/02/2025 15:11																	13.27	0.20																
18/02/2025 15:17																	13.27	0.20																
18/02/2025 15:21																	13.27	0.20																
18/02/2025 15:28																	13.27	0.20																
18/02/2025 15:31																	13.27	0.20																
18/02/2025 15:36																	13.27	0.20																
18/02/2025 15:41																	13.27	0.20																
18/02/2025 15:51																	13.27	0.20																
18/02/2025 16:01																	13.27	0.20																
18/02/2025 16:12																	13.27	0.20																
18/02/2025 16:19																	13.27	0.20																
19/02/2025 07:41																			12.45	1.49														
19/02/2025 08:32							2.72	0.52																										
19/02/2025 08:54																									6.81	1.27								
19/02/2025 09:08			7.85	1.10																														
19/02/2025 09:37																											7.33	2.01						
19/02/2025 10:09																															0.58	1.14		
19/02/2025 10:16					1.35	3.11																												
19/02/2025 10:22																													0.48	2.85				
19/02/2025 10:50									13.50	1.97																								
19/02/2025 11:02	10.12	8.99																																
19/02/2025 11:10																	12.02	1.45																
19/02/2025 11:12																			12.44	1.50														
19/02/2025 12:56													10.97	1.29																				
19/02/2025 13:07											15.79	1.67																						
19/02/2025 13:17																					10.33	1.58												
19/02/2025 13:24															6.49	1.18																		
19/02/2025 13:54																																	0.83	2.22
19/02/2025 14:11																							3.67	0.99										
20/02/2025 07:51																	12.02	1.45																

	ACC-BH05-EW		BP23		C2D		C3D		C7		CPB_BP_11		CPB_BP_13		GRR-BH15-EW		PB01		PT01		PT02		PT05		PZ2009_20		RR7		PS01		PS02		PS03		Comments
Top of well Level (mOD)	19.11		8.95		4.46		3.24		15.47		17.46		12.26		7.67		13.47		13.94		11.91		4.66		8.08		9.34		3.32		1.72		3.05		
Date and Time	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	
20/02/2025 08:01																	12.52	0.95																	
20/02/2025 08:02																	12.56	0.91																	
20/02/2025 08:03																	12.57	0.90																	
20/02/2025 08:04																	12.58	0.89																	
20/02/2025 08:05																	12.59	0.88																	
20/02/2025 08:06																	12.59	0.88																	
20/02/2025 08:07																	12.60	0.87																	
20/02/2025 08:08																	12.60	0.87																	
20/02/2025 08:09																	12.60	0.87																	
20/02/2025 08:10																	12.60	0.87																	
20/02/2025 08:16																	12.61	0.86																	
20/02/2025 08:19																			12.44	1.50															
20/02/2025 08:23																	12.60	0.87																	
20/02/2025 08:28																	12.61	0.86																	
20/02/2025 08:31																	12.62	0.85																	
20/02/2025 08:32							2.71	0.53																											
20/02/2025 08:47																	12.63	0.84																	
20/02/2025 08:50																									6.81	1.27									
20/02/2025 09:00																	12.63	0.84																	
20/02/2025 09:04			7.85	1.10																															
20/02/2025 09:25																											7.33	2.01							
20/02/2025 10:02																	12.63	0.84													0.58	1.14			
20/02/2025 10:10					1.35	3.11																													
20/02/2025 10:17																													0.48	2.85					
20/02/2025 10:50									13.50	1.97																									
20/02/2025 11:00																	12.63	0.84																	
20/02/2025 11:02	10.12	8.99																																	
20/02/2025 12:02																	12.63	0.84																	
20/02/2025 12:31													10.97	1.29																					
20/02/2025 12:41											15.78	1.68																							
20/02/2025 12:46																					10.33	1.59													
20/02/2025 12:54															6.49	1.18																			
20/02/2025 13:27																	12.64	0.83	12.44	1.50															
20/02/2025 13:32																																	0.85	2.20	
20/02/2025 13:56																							3.68	0.98											
20/02/2025 14:05																	12.65	0.82																	
20/02/2025 15:00																	12.65	0.82																	
20/02/2025 15:02																			12.45	1.49															
20/02/2025 16:05																			12.45	1.49															
20/02/2025 16:06																	12.65	0.82																	
20/02/2025 17:00																			12.45	1.49															
20/02/2025 17:01																	12.65	0.82																	
21/02/2025 08:02																			12.45	1.49															
21/02/2025 08:03																	12.65	0.82																	
21/02/2025 08:46							2.58	0.66																											
21/02/2025 09:02																	12.66	0.81	12.45	1.49					6.81	1.27									
21/02/2025 09:16			7.87	1.08																															
21/02/2025 09:53																											7.33	2.01							
21/02/2025 10:07																	12.65	0.82																	
21/02/2025 10:25																															0.58	1.14			
21/02/2025 10:32					1.35	3.11																													
21/02/2025 10:39																													0.48	2.85					
21/02/2025 11:02																	12.65	0.82																	
21/02/2025 11:11									13.50	1.97																									
21/02/2025 11:23	10.12	8.99																																	
21/02/2025 12:02																	12.65	0.82	12.45	1.49															
21/02/2025 12:38																					10.33	1.59													
21/02/2025 12:45											15.78	1.68																							
21/02/2025 12:53													10.97	1.29																					
21/02/2025 13:02																	12.65	0.82	12.45	1.49															
21/02/2025 13:06															6.49	1.18																			
21/02/2025 14:04																																	0.74	2.31	
21/02/2025 14:21																							3.68	0.98											
21/02/2025 15:00																			12.45	1.49															
21/02/2025 15:02																	12.66	0.81																	
21/02/2025 16:02																			12.46	1.48															
21/02/2025 16:03																	12.66	0.81																	
21/02/2025 17:00																	12.66	0.81																	
22/02/2025 08:04																	12.68	0.79																	
22/02/2025 08:06																			12.47	1.47															
22/02/2025 08:25							2.48	0.76																											
22/02/2025 08:40			7.87	1.08																															
22/02/2025 09:05																	12.67	0.80																	
22/02/2025 09:08															6.50	1.17																			
22/02/2025 09:17																									6.82	1.26									
22/02/2025 09:35																											7.34	2.00							
22/02/2025 10:00																	12.67	0.80	12.46	1.48															
22/02/2025 10:08																															0.54	1.18			
22/02/2025 10:16					1.35	3.11																													
22/02/2025 10:23																													0.43	2.89					
22/02/2025 11:04																	12.67	0.80	12.46	1.48															
22/02/2025 11:16									13.50	1.97																									
22/02/2025 11:38	10.12	8.99																																	
22/02/2025 12:03																	12.67	0.80	12.46	1.48															
22/02/2025 12:18											15.79	1.67																							
22/02/2025 12:31													10.99	1.27																					
22/02/2025 12:52																					10.35	1.56													
22/02/2025 13:03																	12.67	0.80																	
22/02/2025 13:48																																	0.64	2.41	
22/02/2025 14:01																	12.67	0.80					3.68	0.98											
22/02/2025 15:09																	12.68	0.79																	
22/02/2025 15:15																			12.47	1.47															
22/02/2025 16:16																	12.68	0.79	12.47	1.47															
22/02/2025 16:45																	12.68	0.79	12.48	1.46															
23/02/2025 08:02																	12.69	0.78																	
23/02/2025 08:04																			12.48	1.46															
23/02/2025 08:16							2.44	0.80																											
23/02/2025 08:31			7.87	1.08																															
23/02/2025 08:48															6.50	1.17																			
23/02/2025 08:54																									6.82	1.26									
23/02/2025 09:01																	12.69	0.78																	
23/02/2025 09:03																			12.48	1.46															
23/02/2025 09:08																											7.33	2.01							
23/02/2025 10:01																	12.68	0.79	12.47	1.47															
23/02/2025 10:04																															0.54	1.18			
23/02/2025 10:16					1.34	3.12																													
23/02/2025 10:24																													0.45	2.88					
23/02/2025 11:03																	12.68	0.79	12.48	1.46															
23/02/2025 11:08									13.51	1.96																									
23/02/2025 12:00																	12.69	0.78																	
23/02/2025 12:01																			12.48	1.46															
23/02/2025 12:31											15.79	1.67																							

	ACC-BH05-EW		BP23		C2D		C3D		C7		CPB_BP_11		CPB_BP_13		GRR-BH15-EW		PB01		PT01		PT02		PT05		PZ2009_20		RR7		PS01		PS02		PS03		Comments
Top of well Level (mOD)	19.11		8.95		4.46		3.24		15.47		17.46		12.26		7.67		13.47		13.94		11.91		4.66		8.08		9.34		3.32		1.72		3.05		
Date and Time	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	
23/02/2025 12:46													10.99	1.27																				
23/02/2025 13:01																	12.68	0.79	12.48	1.46														
23/02/2025 13:07																					10.35	1.57												
23/02/2025 13:31																																	0.57	2.48
23/02/2025 13:46																							3.67	0.99										
23/02/2025 14:18	10.12	8.99																																
23/02/2025 15:03																	12.68	0.79																
23/02/2025 16:02																	12.68	0.79	12.48	1.46														
23/02/2025 16:57																	12.68	0.79	12.48	1.46														
24/02/2025 08:02																	12.70	0.77	12.48	1.46														
24/02/2025 08:25							2.44	0.80																										
24/02/2025 08:56																									6.82	1.26								
24/02/2025 09:08			7.86	1.09																														
24/02/2025 09:31																											7.33	2.01						
24/02/2025 10:02																															0.56	1.16		
24/02/2025 10:10					1.34	3.12																												
24/02/2025 10:17																													0.45	2.87				
24/02/2025 10:48									13.50	1.97																								
24/02/2025 11:01	10.12	8.99																																
24/02/2025 12:33													10.98	1.28																				
24/02/2025 12:46											15.79	1.67																						
24/02/2025 13:06																					10.35	1.56												
24/02/2025 13:34																																	0.57	2.49
24/02/2025 13:51																							3.67	0.99										
24/02/2025 14:12															6.50	1.17																		
24/02/2025 16:35																	12.70	0.77																
24/02/2025 16:38																			12.50	1.44														
25/02/2025 08:14																			12.50	1.44														
25/02/2025 08:18																	12.70	0.77																
25/02/2025 08:23							2.36	0.88																										
25/02/2025 08:36			7.86	1.09																														
25/02/2025 08:52																									6.82	1.26								
25/02/2025 09:21																											7.34	2.00						
25/02/2025 10:03																															0.56	1.16		
25/02/2025 10:09					1.34	3.12																												
25/02/2025 10:17																													0.45	2.88				
25/02/2025 10:18																	12.70	0.77																
25/02/2025 10:48									13.51	1.96																								
25/02/2025 11:01	10.12	8.99																																
25/02/2025 12:33															6.50	1.17																		
25/02/2025 12:42													10.99	1.27																				
25/02/2025 12:52											15.79	1.67																						
25/02/2025 13:02																					10.36	1.55												
25/02/2025 13:31																																	0.40	2.66
25/02/2025 13:49																							3.66	1.00										
25/02/2025 14:07																			12.50	1.44														
25/02/2025 14:08																	12.71	0.76																
25/02/2025 15:03																	12.72	0.75	12.50	1.44														
26/02/2025 08:25							2.43	0.81																										
26/02/2025 08:41																									6.82	1.26								
26/02/2025 08:54			7.86	1.09																														
26/02/2025 09:00																	12.71	0.76	12.50	1.44														
26/02/2025 09:17																											7.33	2.01						
26/02/2025 10:02																															0.57	1.15		
26/02/2025 10:08					1.33	3.13																												
26/02/2025 10:17																													0.46	2.86				
26/02/2025 10:46									13.51	1.96																								
26/02/2025 10:55	10.12	8.99																																
26/02/2025 11:02																	12.73	0.74																
26/02/2025 11:04																			12.51	1.43														
26/02/2025 12:03																	12.72	0.75	12.51	1.43														
26/02/2025 12:41															6.50	1.17																		
26/02/2025 12:51													10.99	1.27																				
26/02/2025 13:06											15.79	1.67																						
26/02/2025 13:11																					10.34	1.57												
26/02/2025 13:53																																	0.41	2.64
26/02/2025 14:08																							3.67	0.99										
26/02/2025 15:07																	12.72	0.75																
26/02/2025 16:06																	12.73	0.74	12.51	1.43														
26/02/2025 16:44																			12.51	1.43														
26/02/2025 16:59																	12.70	0.77	12.51	1.43														
27/02/2025 08:32							2.46	0.78																										
27/02/2025 08:52																									6.82	1.26								
27/02/2025 09:01																			12.52	1.42														
27/02/2025 09:03																	12.70	0.77																
27/02/2025 09:08			7.86	1.09																														
27/02/2025 09:27																											7.34	2.00						
27/02/2025 10:03																															0.56	1.16		
27/02/2025 10:08					1.34	3.12																												
27/02/2025 10:16																													0.46	2.87				
27/02/2025 11:01									13.52	1.95																								
27/02/2025 11:19	10.12	8.99																																
27/02/2025 12:37															6.51	1.16																		
27/02/2025 12:49													10.99	1.27																				
27/02/2025 13:03											15.80	1.66																						
27/02/2025 13:09																					10.37	1.54												
27/02/2025 13:31																																	0.43	2.62
27/02/2025 13:48																							3.66	1.00										
27/02/2025 16:01																	12.73	0.74	12.53	1.41														
27/02/2025 17:00																	12.70	0.77	12.53	1.41														
28/02/2025 08:20							2.57	0.67																										
28/02/2025 08:37																									6.83	1.25								
28/02/2025 08:48			7.86	1.09																														
28/02/2025 09:03																	12.70	0.77	12.53	1.41														
28/02/2025 09:08																											7.34	2.00						
28/02/2025 10:03																															0.57	1.15		
28/02/2025 10:08					1.34	3.12																												
28/02/2025 10:18																													0.46	2.86				
28/02/2025 10:48									13.52	1.95																								
28/02/2025 10:56	10.12	8.99																																
28/02/2025 12:10																	12.70	0.77	12.53	1.41														
28/02/2025 12:34															6.51	1.16																		
28/02/2025 12:47													10.99	1.27																				
28/02/2025 12:55											15.80	1.66																						
28/02/2025 13:02																					10.37	1.54												
28/02/2025 13:32																																	0.47	2.59
28/02/2025 13:48																							3.67	0.99										
28/02/2025 16:02																	12.70	0.77	12.53	1.41														
28/02/2025 17:11																	12.70	0.77	12.53	1.41														
01/03/2025 08:13							2.63	0.61																										
01/03/2025 08:24			7.87	1.08																														
01/03/2025 08:39																									6.83	1.25								

	ACC-BH05-EW		BP23		C2D		C3D		C7		CPB_BP_11		CPB_BP_13		GRR-BH15-EW		PB01		PT01		PT02		PT05		PZ2009_20		RR7		PS01		PS02		PS03		Comments
Top of well Level (mOD)	19.11		8.95		4.46		3.24		15.47		17.46		12.26		7.67		13.47		13.94		11.91		4.66		8.08		9.34		3.32		1.72		3.05		
Date and Time	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	Dip (m)	WL (mOD)	
01/03/2025 08:46															6.52	1.15																		
01/03/2025 08:56																					10.38	1.53												
01/03/2025 09:12																											7.34	2.00						
01/03/2025 10:02																															0.58	1.14		
01/03/2025 10:03																			12.54	1.40														
01/03/2025 10:04																	12.70	0.77																
01/03/2025 10:08					1.35	3.11																												
01/03/2025 10:17																													0.47	2.85				
01/03/2025 10:47									13.53	1.94																								
01/03/2025 11:05	10.12	8.99																																
01/03/2025 11:41											15.81	1.65																						
01/03/2025 13:10																							3.67	0.99										
03/03/2025 08:56																	12.70	0.77	12.55	1.39														
03/03/2025 09:00																	12.21	1.26																
03/03/2025 09:01																	12.20	1.27																
03/03/2025 09:02																	12.18	1.29																
03/03/2025 09:03																																		
03/03/2025 09:04																	12.16	1.31																
03/03/2025 09:05																	12.16	1.31																
03/03/2025 09:07																	12.15	1.32																
03/03/2025 09:08																	12.15	1.32																
03/03/2025 09:09																	12.15	1.32																
03/03/2025 09:10																	12.14	1.33																
03/03/2025 09:11																	12.14	1.33																
03/03/2025 09:12																	12.14	1.33																
03/03/2025 09:13																	12.14	1.33																
03/03/2025 09:14																	12.13	1.34																
03/03/2025 09:15																	12.13	1.34																
03/03/2025 09:16																	12.13	1.34																
03/03/2025 09:17																	12.13	1.34																
03/03/2025 09:19																	12.13	1.34																
03/03/2025 09:20																	12.13	1.34																
03/03/2025 09:22																	12.13	1.34																
03/03/2025 09:25																	12.13	1.34																
03/03/2025 09:26																	12.13	1.34																
03/03/2025 09:28																	12.13	1.34																
03/03/2025 09:30																	12.13	1.34																
03/03/2025 09:36																	12.12	1.35	12.54	1.40														
03/03/2025 09:41																	12.14	1.33																
03/03/2025 09:47																	12.13	1.34																
03/03/2025 09:50																	12.14	1.33																
03/03/2025 09:51																			12.54	1.40														
03/03/2025 09:55																	12.12	1.35																
03/03/2025 10:00																	12.11	1.36																
03/03/2025 10:10																			12.54	1.40														
03/03/2025 10:16																	12.12	1.35																
03/03/2025 10:26																	12.12	1.35																
03/03/2025 10:31																	12.11	1.36																
03/03/2025 10:47																	12.10	1.37																
03/03/2025 10:52																			12.54	1.40														
03/03/2025 11:01																	12.11	1.36																
03/03/2025 11:32													11.00	1.26																				
03/03/2025 12:02																	12.10	1.37	12.54	1.40														
03/03/2025 13:04																	12.10	1.37	12.54	1.40														
03/03/2025 13:20																																	0.54	2.51
03/03/2025 13:59																	12.09	1.38	12.54	1.40														
03/03/2025 16:14																			12.54	1.40														
04/03/2025 08:48																																		
04/03/2025 08:50																			12.53	1.41														
04/03/2025 11:02																	12.08	1.39	12.53	1.41														
04/03/2025 12:02																	12.08	1.39	12.52	1.42														
04/03/2025 13:00																	12.07	1.40	12.52	1.42														
04/03/2025 14:00																	12.07	1.40	12.52	1.42														
04/03/2025 15:03																	12.07	1.40	12.52	1.42														
04/03/2025 16:04																	12.07	1.40																
04/03/2025 16:06																			12.51	1.43														
05/03/2025 10:54																			12.50	1.44														
05/03/2025 10:55																	12.06	1.41																
05/03/2025 11:31																	12.06	1.41																
05/03/2025 12:35																	11.69	1.41																
05/03/2025 15:15																	11.69	1.41	12.50	1.44														
06/03/2025 11:07																	11.69	1.41																
06/03/2025 11:15																			12.49	1.45														
10/03/2025 10:06																	11.67	1.43																
10/03/2025 10:07																			12.47	1.47														
10/03/2025 16:54																	11.67	1.43																
10/03/2025 16:56																			12.47	1.47														
12/03/2025 08:43																			12.46	1.48														
12/03/2025 08:46																	11.67	1.43																
12/03/2025 13:05																	11.66	1.44																
12/03/2025 13:06																			12.46	1.48														
13/03/2025 08:38							2.47	0.77																										
13/03/2025 08:53																									6.84	1.24								
13/03/2025 09:05			7.87	1.08																														
13/03/2025 09:11																	11.67	1.43																
13/03/2025 09:13																			12.45	1.49														
13/03/2025 09:23																											7.36	1.98						
13/03/2025 10:02																															0.56	1.16		
13/03/2025 10:08					1.36	3.10																												
13/03/2025 10:16																													0.45	2.87				
13/03/2025 11:06									13.56	1.91																								
13/03/2025 11:14	10.15	8.96																																
13/03/2025 12:31													11.02	1.24																				
13/03/2025 12:38											15.84	1.62																						
13/03/2025 12:42																					10.37	1.54												
13/03/2025 12:48															6.51	1.16																		
13/03/2025 13:10																							7.38	-2.72										
13/03/2025 13:31																																	0.70	2.35

APPENDIX E: ATKINS SURFACE WATER MONITORING DATA

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
15/05/2024 09:45			-0.01	0.00										
15/05/2024 10:00			-0.01	0.00										
15/05/2024 10:15			-0.01	0.00										
15/05/2024 10:30			-0.01	0.00										
15/05/2024 10:45			-0.01	0.00										
15/05/2024 11:00			-0.02	0.00										
15/05/2024 11:15			-0.02	0.00										
15/05/2024 11:30			-0.02	0.00										
15/05/2024 11:45			-0.01	0.00										
15/05/2024 12:00			-0.01	0.00										
15/05/2024 12:15			-0.02	0.00										
15/05/2024 12:30			-0.02	0.00	0.16	0.15	0.10							
15/05/2024 12:45			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 13:00			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 13:15			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 13:30			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 13:45			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 14:00			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 14:15			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 14:30			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 14:45			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 15:00			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 15:15			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 15:30			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 15:45			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 16:00			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 16:15			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 16:30			-0.01	0.00	0.15	0.15	0.10							
15/05/2024 16:45			-0.01	0.00	0.15	0.15	0.10							
15/05/2024 17:00			-0.01	0.00	0.15	0.15	0.10							
15/05/2024 17:15			-0.01	0.00	0.15	0.15	0.10							
15/05/2024 17:30			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 17:45			-0.01	0.00	0.15	0.15	0.10							
15/05/2024 18:00			-0.01	0.00	0.15	0.15	0.10							
15/05/2024 18:15			-0.01	0.00	0.15	0.15	0.10							
15/05/2024 18:30			-0.01	0.00	0.15	0.15	0.10							
15/05/2024 18:45			-0.01	0.00	0.15	0.15	0.10							
15/05/2024 19:00			-0.01	0.00	0.15	0.15	0.10							
15/05/2024 19:15			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 19:30			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 19:45			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 20:00			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 20:15			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 20:30			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 20:45			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 21:00			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 21:15			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 21:30			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 21:45			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 22:00			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 22:15			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 22:30			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 22:45			-0.02	0.00	0.15	0.15	0.10							
15/05/2024 23:00			-0.02	0.00	0.15	0.15	0.09							
15/05/2024 23:15			-0.02	0.00	0.15	0.15	0.09							
15/05/2024 23:30			-0.02	0.00	0.15	0.15	0.09							
15/05/2024 23:45			-0.02	0.00	0.15	0.15	0.09							
16/05/2024 00:00			-0.02	0.00	0.15	0.15	0.09							
16/05/2024 00:15			-0.02	0.00	0.15	0.15	0.09							
16/05/2024 00:30			-0.02	0.00	0.15	0.14	0.09							
16/05/2024 00:45			-0.02	0.00	0.15	0.14	0.09							
16/05/2024 01:00			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 01:15			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 01:30			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 01:45			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 02:00			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 02:15			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 02:30			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 02:45			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 03:00			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 03:15			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 03:30			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 03:45			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 04:00			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 04:15			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 04:30			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 04:45			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 05:00			-0.02	0.00	0.14	0.14	0.08							
16/05/2024 05:15			-0.02	0.00	0.14	0.14	0.08							
16/05/2024 05:30			-0.02	0.00	0.14	0.14	0.08							
16/05/2024 05:45			-0.02	0.00	0.14	0.14	0.08							
16/05/2024 06:00			-0.02	0.00	0.14	0.14	0.08							
16/05/2024 06:15			-0.02	0.00	0.14	0.14	0.08							
16/05/2024 06:30			-0.02	0.00	0.14	0.14	0.08							
16/05/2024 06:45			-0.02	0.00	0.14	0.14	0.08							
16/05/2024 07:00			-0.02	0.00	0.14	0.14	0.08							
16/05/2024 07:15			-0.02	0.00	0.14	0.14	0.08							
16/05/2024 07:30			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 07:45			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 08:00			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 08:15			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 08:30			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 08:45			-0.02	0.00	0.14	0.14	0.09							
16/05/2024 09:00			-0.02	0.00	0.15	0.15	0.10							
16/05/2024 09:15			-0.02	0.00	0.15	0.15	0.10							
16/05/2024 09:30			-0.02	0.00	0.15	0.15	0.10							
16/05/2024 09:45			-0.02	0.00	0.16	0.15	0.10							
16/05/2024 10:00			-0.02	0.00	0.16	0.16	0.11							
16/05/2024 10:15			-0.02	0.00	0.16	0.16	0.11							
16/05/2024 10:30			-0.01	0.00	0.17	0.16	0.11							
16/05/2024 10:45			-0.01	0.00	0.17	0.17	0.12							
16/05/2024 11:00			-0.01	0.00	0.17	0.17	0.12							
16/05/2024 11:15			-0.01	0.00	0.18	0.17	0.12							
16/05/2024 11:30			-0.01	0.00	0.18	0.17	0.13							
16/05/2024 11:45			-0.01	0.00	0.18	0.18	0.13							
16/05/2024 12:00			-0.01	0.00	0.19	0.18	0.13							
16/05/2024 12:15			0.00	0.00	0.19	0.18	0.14							
16/05/2024 12:30			0.00	0.00	0.19	0.18	0.14							
16/05/2024 12:45			0.00	0.00	0.20	0.19	0.14							
16/05/2024 13:00			0.00	0.00	0.20	0.19	0.15							

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
16/05/2024 13:15			0.00	0.00	0.20	0.19	0.15							
16/05/2024 13:30			0.00	0.00	0.20	0.19	0.15							
16/05/2024 13:45			0.00	0.00	0.20	0.19	0.15	0.64	0.02					
16/05/2024 14:00			0.00	0.00	0.21	0.19	0.16	0.64	0.02					
16/05/2024 14:15			0.00	0.00	0.21	0.19	0.16	0.63	0.05					
16/05/2024 14:30			0.00	0.00	0.21	0.20	0.16	0.63	0.05					
16/05/2024 14:45			0.01	0.00	0.21	0.20	0.16	0.63	0.05					
16/05/2024 15:00			0.01	0.00	0.21	0.20	0.16	0.63	0.05					
16/05/2024 15:15			0.01	0.00	0.21	0.20	0.16	0.63	0.06					
16/05/2024 15:30			0.01	0.00	0.21	0.20	0.16	0.63	0.05					
16/05/2024 15:45			0.01	0.00	0.21	0.20	0.16	0.63	0.06					
16/05/2024 16:00			0.01	0.00	0.21	0.20	0.16	0.63	0.05					
16/05/2024 16:15			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 16:30			0.01	0.00	0.21	0.20	0.16	0.62	0.06					
16/05/2024 16:45			0.01	0.00	0.21	0.20	0.16	0.62	0.04					
16/05/2024 17:00			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 17:15			0.01	0.00	0.21	0.20	0.16	0.62	0.06					
16/05/2024 17:30			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 17:45			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 18:00			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 18:15			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 18:30			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 18:45			0.01	0.00	0.21	0.20	0.16	0.62	0.06					
16/05/2024 19:00			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 19:15			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 19:30			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 19:45			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 20:00			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 20:15			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 20:30			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 20:45			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 21:00			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 21:15			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 21:30			0.01	0.00	0.21	0.20	0.16	0.62	0.06					
16/05/2024 21:45			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 22:00			0.01	0.00	0.21	0.20	0.16	0.62	0.04					
16/05/2024 22:15			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 22:30			0.01	0.00	0.21	0.20	0.16	0.62	0.05					
16/05/2024 22:45			0.01	0.00	0.21	0.20	0.16	0.61	0.05					
16/05/2024 23:00			0.01	0.00	0.21	0.20	0.16	0.61	0.06					
16/05/2024 23:15			0.01	0.00	0.20	0.19	0.15	0.61	0.06					
16/05/2024 23:30			0.01	0.00	0.20	0.19	0.15	0.61	0.05					
16/05/2024 23:45			0.01	0.00	0.20	0.19	0.15	0.61	0.04					
17/05/2024 00:00			0.01	0.00	0.20	0.19	0.15	0.61	0.05					
17/05/2024 00:15			0.01	0.00	0.20	0.19	0.15	0.61	0.05					
17/05/2024 00:30			0.01	0.00	0.20	0.19	0.15	0.61	0.05					
17/05/2024 00:45			0.01	0.00	0.20	0.19	0.15	0.61	0.05					
17/05/2024 01:00			0.01	0.00	0.20	0.19	0.15	0.61	0.04					
17/05/2024 01:15			0.01	0.00	0.20	0.19	0.15	0.61	0.04					
17/05/2024 01:30			0.01	0.00	0.20	0.19	0.15	0.61	0.04					
17/05/2024 01:45			0.01	0.00	0.20	0.19	0.15	0.61	0.04					
17/05/2024 02:00			0.01	0.00	0.20	0.19	0.15	0.61	0.05					
17/05/2024 02:15			0.01	0.00	0.20	0.19	0.15	0.61	0.05					
17/05/2024 02:30			0.01	0.00	0.20	0.19	0.15	0.61						
17/05/2024 02:45			0.01	0.00	0.20	0.19	0.15	0.61	0.05					
17/05/2024 03:00			0.01	0.00	0.20	0.19	0.15	0.61	0.05					
17/05/2024 03:15			0.01	0.00	0.20	0.19	0.15	0.61						
17/05/2024 03:30			0.01	0.00	0.20	0.19	0.15	0.61						
17/05/2024 03:45			0.01	0.00	0.20	0.19	0.15	0.60	0.05					
17/05/2024 04:00			0.01	0.00	0.20	0.19	0.15	0.60	0.05					
17/05/2024 04:15			0.01	0.00	0.20	0.19	0.15	0.60						
17/05/2024 04:30			0.01	0.00	0.20	0.19	0.15	0.60	0.05					
17/05/2024 04:45			0.01	0.00	0.20	0.19	0.15	0.60	0.06					
17/05/2024 05:00			0.00	0.00	0.20	0.19	0.15	0.60	0.05					
17/05/2024 05:15			0.00	0.00	0.20	0.19	0.15	0.60	0.06					
17/05/2024 05:30			0.00	0.00	0.20	0.19	0.15	0.60	0.05					
17/05/2024 05:45			0.00	0.00	0.20	0.19	0.14	0.60	0.06					
17/05/2024 06:00			0.00	0.00	0.20	0.19	0.14	0.60	0.06					
17/05/2024 06:15			0.00	0.00	0.19	0.19	0.14	0.60	0.05					
17/05/2024 06:30			0.00	0.00	0.19	0.19	0.14	0.60	0.05					
17/05/2024 06:45			0.00	0.00	0.19	0.19	0.14	0.60	0.05					
17/05/2024 07:00			0.00	0.00	0.19	0.19	0.14	0.60	0.05					
17/05/2024 07:15			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 07:30			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 07:45			0.00	0.00	0.19	0.18	0.14	0.60						
17/05/2024 08:00			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 08:15			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 08:30			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 08:45			0.00	0.00	0.19	0.18	0.14	0.60						
17/05/2024 09:00			0.00	0.00	0.19	0.18	0.14	0.60	0.00					
17/05/2024 09:15			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 09:30			0.00	0.00	0.19	0.18	0.14	0.60						
17/05/2024 09:45			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 10:00			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 10:15			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 10:30			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 10:45			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 11:00			0.00	0.00	0.19	0.18	0.14	0.60	0.05					
17/05/2024 11:15			0.00	0.00	0.19	0.18	0.14	0.59	0.05					
17/05/2024 11:30			0.00	0.00	0.19	0.18	0.14	0.59	0.06					
17/05/2024 11:45			0.00	0.00	0.19	0.18	0.14	0.59	0.06					
17/05/2024 12:00			0.00	0.00	0.19	0.18	0.14	0.59	0.04					
17/05/2024 12:15			0.00	0.00	0.19	0.18	0.14	0.59	0.04					
17/05/2024 12:30			0.00	0.00	0.19	0.18	0.14	0.59	0.04					
17/05/2024 12:45			0.00	0.00	0.19	0.18	0.14	0.59	0.05					
17/05/2024 13:00			0.00	0.00	0.19	0.18	0.14	0.59	0.05					
17/05/2024 13:15			0.00	0.00	0.19	0.18	0.14	0.59	0.05					
17/05/2024 13:30			0.00	0.00	0.19	0.18	0.14	0.59	0.05					
17/05/2024 13:45			0.00	0.00	0.19	0.18	0.13	0.59	0.04					
17/05/2024 14:00			0.00	0.00	0.19	0.18	0.13	0.59	0.05					
17/05/2024 14:15			0.00	0.00	0.19	0.18	0.13	0.59	0.04					
17/05/2024 14:30			0.00	0.00	0.19	0.18	0.13	0.59	0.05					
17/05/2024 14:45			0.00	0.00	0.19	0.18	0.13	0.59	0.05					
17/05/2024 15:00			0.00	0.00	0.19	0.18	0.13	0.59	0.05					
17/05/2024 15:15			0.00	0.00	0.18	0.18	0.13	0.59	0.05					
17/05/2024 15:30			0.00	0.00	0.18	0.18	0.13	0.59						
17/05/2024 15:45			0.00	0.00	0.18	0.18	0.13	0.59						
17/05/2024 16:00			0.00	0.00	0.18	0.18	0.13	0.59	0.05					
17/05/2024 16:15			0.00	0.00	0.18	0.18	0.13	0.59	0.05					
17/05/2024 16:30			0.00	0.00	0.18	0.18	0.13	0.59						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
17/05/2024 16:45			0.00	0.00	0.18	0.18	0.13	0.59	0.05					
17/05/2024 17:00			0.00	0.00	0.18	0.18	0.13	0.59	0.05					
17/05/2024 17:15			0.00	0.00	0.18	0.18	0.13	0.59	0.04					
17/05/2024 17:30			0.00	0.00	0.18	0.18	0.13	0.59						
17/05/2024 17:45			0.00	0.00	0.18	0.18	0.13	0.59	0.05					
17/05/2024 18:00			0.00	0.00	0.18	0.18	0.13	0.58	0.05					
17/05/2024 18:15			0.00	0.00	0.18	0.18	0.13	0.58						
17/05/2024 18:30			0.00	0.00	0.18	0.18	0.13	0.58						
17/05/2024 18:45			0.00	0.00	0.18	0.18	0.13	0.58	0.05					
17/05/2024 19:00			0.00	0.00	0.18	0.18	0.13	0.58						
17/05/2024 19:15			0.00	0.00	0.18	0.18	0.13	0.58	0.06					
17/05/2024 19:30			0.00	0.00	0.18	0.18	0.13	0.58	0.06					
17/05/2024 19:45			0.00	0.00	0.18	0.17	0.13	0.59						
17/05/2024 20:00			0.00	0.00	0.18	0.17	0.12	0.59	0.05					
17/05/2024 20:15			0.00	0.00	0.18	0.17	0.12	0.58	0.04					
17/05/2024 20:30			0.00	0.00	0.18	0.17	0.12	0.58	0.04					
17/05/2024 20:45			-0.01	0.00	0.18	0.17	0.12	0.58	0.05					
17/05/2024 21:00			0.00	0.00	0.18	0.17	0.12	0.58	0.05					
17/05/2024 21:15			-0.01	0.00	0.18	0.17	0.12	0.58	0.05					
17/05/2024 21:30			-0.01	0.00	0.18	0.17	0.12	0.58						
17/05/2024 21:45			-0.01	0.00	0.18	0.17	0.12	0.58						
17/05/2024 22:00			-0.01	0.00	0.18	0.17	0.12	0.58						
17/05/2024 22:15			-0.01	0.00	0.18	0.17	0.12	0.58						
17/05/2024 22:30			-0.01	0.00	0.18	0.17	0.12	0.58	0.04					
17/05/2024 22:45			-0.01	0.00	0.17	0.17	0.12	0.58						
17/05/2024 23:00			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
17/05/2024 23:15			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
17/05/2024 23:30			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
17/05/2024 23:45			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
18/05/2024 00:00			-0.01	0.00	0.17	0.17	0.12	0.58						
18/05/2024 00:15			-0.01	0.00	0.17	0.17	0.12	0.58	0.04					
18/05/2024 00:30			-0.01	0.00	0.17	0.17	0.12	0.58	0.04					
18/05/2024 00:45			-0.01	0.00	0.17	0.17	0.12	0.57	0.04					
18/05/2024 01:00			-0.01	0.00	0.17	0.17	0.12	0.57						
18/05/2024 01:15			-0.01	0.00	0.17	0.17	0.12	0.58						
18/05/2024 01:30			-0.01	0.00	0.17	0.17	0.12	0.58						
18/05/2024 01:45			-0.01	0.00	0.17	0.17	0.12	0.58						
18/05/2024 02:00			-0.01	0.00	0.17	0.17	0.12	0.58						
18/05/2024 02:15			-0.01	0.00	0.17	0.17	0.12	0.57						
18/05/2024 02:30			-0.01	0.00	0.17	0.17	0.12	0.57	0.05					
18/05/2024 02:45			-0.01	0.00	0.17	0.17	0.12	0.57	0.05					
18/05/2024 03:00			-0.01	0.00	0.17	0.17	0.12	0.56						
18/05/2024 03:15			-0.01	0.00	0.17	0.17	0.12	0.56	0.05					
18/05/2024 03:30			-0.01	0.00	0.17	0.17	0.11	0.56						
18/05/2024 03:45			-0.01	0.00	0.17	0.16	0.11	0.56	0.05					
18/05/2024 04:00			-0.01	0.00	0.17	0.16	0.11	0.56	0.00					
18/05/2024 04:15			-0.01	0.00	0.17	0.16	0.11	0.56						
18/05/2024 04:30			-0.01	0.00	0.17	0.16	0.11	0.56						
18/05/2024 04:45			-0.01	0.00	0.17	0.16	0.11	0.56	0.00					
18/05/2024 05:00			-0.01	0.00	0.16	0.16	0.11	0.55	0.05					
18/05/2024 05:15			-0.01	0.00	0.16	0.16	0.11	0.55	0.04					
18/05/2024 05:30			-0.01	0.00	0.16	0.16	0.11	0.55						
18/05/2024 05:45			-0.01	0.00	0.16	0.16	0.11	0.55	0.05					
18/05/2024 06:00			-0.01	0.00	0.16	0.16	0.11	0.55	0.04					
18/05/2024 06:15			-0.01	0.00	0.16	0.16	0.11	0.55						
18/05/2024 06:30			-0.01	0.00	0.16	0.16	0.11	0.55						
18/05/2024 06:45			-0.01	0.00	0.16	0.16	0.11	0.55	0.04					
18/05/2024 07:00			-0.01	0.00	0.16	0.16	0.10	0.55	0.04					
18/05/2024 07:15			-0.01	0.00	0.16	0.16	0.10	0.55	0.05					
18/05/2024 07:30			-0.01	0.00	0.16	0.16	0.10	0.55	0.05					
18/05/2024 07:45			-0.02	0.00	0.16	0.15	0.10	0.55						
18/05/2024 08:00			-0.02	0.00	0.16	0.15	0.10	0.55						
18/05/2024 08:15			-0.02	0.00	0.16	0.15	0.10	0.55						
18/05/2024 08:30			-0.02	0.00	0.16	0.15	0.10	0.55						
18/05/2024 08:45			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 09:00			-0.02	0.00	0.15	0.15	0.10	0.56						
18/05/2024 09:15			-0.02	0.00	0.15	0.15	0.10	0.56						
18/05/2024 09:30			-0.02	0.00	0.15	0.15	0.10	0.56						
18/05/2024 09:45			-0.02	0.00	0.15	0.15	0.10	0.56	0.04					
18/05/2024 10:00			-0.02	0.00	0.15	0.15	0.10	0.56	0.04					
18/05/2024 10:15			-0.02	0.00	0.15	0.15	0.10	0.56						
18/05/2024 10:30			-0.02	0.00	0.15	0.15	0.10	0.56						
18/05/2024 10:45			-0.02	0.00	0.15	0.15	0.10	0.56						
18/05/2024 11:00			-0.02	0.00	0.16	0.15	0.10	0.56	0.04					
18/05/2024 11:15			-0.02	0.00	0.16	0.15	0.10	0.56	0.05					
18/05/2024 11:30			-0.02	0.00	0.16	0.15	0.10	0.56						
18/05/2024 11:45			-0.02	0.00	0.16	0.15	0.10	0.56	0.04					
18/05/2024 12:00			-0.02	0.00	0.16	0.15	0.10	0.56	0.04					
18/05/2024 12:15			-0.02	0.00	0.16	0.15	0.10	0.56						
18/05/2024 12:30			-0.02	0.00	0.16	0.15	0.10	0.56						
18/05/2024 12:45			-0.02	0.00	0.16	0.15	0.10	0.56						
18/05/2024 13:00			-0.02	0.00	0.16	0.15	0.10	0.56	0.05					
18/05/2024 13:15			-0.02	0.00	0.16	0.15	0.10	0.56	0.05					
18/05/2024 13:30			-0.02	0.00	0.16	0.15	0.10	0.56						
18/05/2024 13:45			-0.02	0.00	0.16	0.16	0.10	0.56						
18/05/2024 14:00			-0.02	0.00	0.16	0.16	0.10	0.55						
18/05/2024 14:15			-0.02	0.00	0.16	0.16	0.10	0.55						
18/05/2024 14:30			-0.02	0.00	0.16	0.16	0.10	0.55						
18/05/2024 14:45			-0.02	0.00	0.16	0.16	0.10	0.55						
18/05/2024 15:00			-0.02	0.00	0.16	0.16	0.10	0.55						
18/05/2024 15:15			-0.02	0.00	0.16	0.15	0.10	0.55						
18/05/2024 15:30			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 15:45			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 16:00			-0.02	0.00	0.15	0.15	0.10	0.55	0.03					
18/05/2024 16:15			-0.02	0.00	0.15	0.15	0.10	0.55	0.04					
18/05/2024 16:30			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 16:45			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 17:00			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 17:15			-0.02	0.00	0.15	0.15	0.10	0.55	0.05					
18/05/2024 17:30			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 17:45			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 18:00			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 18:15			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 18:30			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 18:45			-0.02	0.00	0.15	0.15	0.10	0.55	0.03					
18/05/2024 19:00			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 19:15			-0.02	0.00	0.15	0.15	0.10	0.55	0.03					
18/05/2024 19:30			-0.02	0.00	0.15	0.15	0.10	0.55						
18/05/2024 19:45			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 20:00			-0.02	0.00	0.15	0.15	0.09	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
18/05/2024 20:15			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 20:30			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 20:45			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 21:00			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 21:15			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 21:30			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 21:45			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 22:00			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 22:15			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 22:30			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 22:45			-0.02	0.00	0.15	0.15	0.09	0.55						
18/05/2024 23:00			-0.02	0.00	0.15	0.15	0.09	0.54						
18/05/2024 23:15			-0.02	0.00	0.15	0.15	0.09	0.54						
18/05/2024 23:30			-0.02	0.00	0.15	0.15	0.09	0.54						
18/05/2024 23:45			-0.02	0.00	0.15	0.15	0.09	0.54						
19/05/2024 00:00			-0.02	0.00	0.15	0.15	0.09	0.54						
19/05/2024 00:15			-0.02	0.00	0.15	0.15	0.09	0.54						
19/05/2024 00:30			-0.02	0.00	0.15	0.15	0.09	0.55						
19/05/2024 00:45			-0.02	0.00	0.15	0.15	0.09	0.54						
19/05/2024 01:00			-0.02	0.00	0.14	0.15	0.09	0.54						
19/05/2024 01:15			-0.02	0.00	0.14	0.15	0.09	0.54						
19/05/2024 01:30			-0.02	0.00	0.14	0.15	0.09	0.54						
19/05/2024 01:45			-0.02	0.00	0.14	0.15	0.09	0.54						
19/05/2024 02:00			-0.02	0.00	0.14	0.15	0.09	0.54						
19/05/2024 02:15			-0.02	0.00	0.14	0.15	0.09	0.54						
19/05/2024 02:30			-0.02	0.00	0.14	0.14	0.09	0.53						
19/05/2024 02:45			-0.02	0.00	0.14	0.14	0.09	0.53						
19/05/2024 03:00			-0.02	0.00	0.14	0.14	0.09	0.53						
19/05/2024 03:15			-0.02	0.00	0.14	0.14	0.09	0.53						
19/05/2024 03:30			-0.02	0.00	0.14	0.14	0.09	0.53						
19/05/2024 03:45			-0.02	0.00	0.14	0.14	0.09	0.53						
19/05/2024 04:00			-0.02	0.00	0.14	0.14	0.09	0.53						
19/05/2024 04:15			-0.02	0.00	0.14	0.14	0.09	0.53						
19/05/2024 04:30			-0.02	0.00	0.14	0.14	0.09	0.53						
19/05/2024 04:45			-0.02	0.00	0.14	0.14	0.09	0.53						
19/05/2024 05:00			-0.02	0.00	0.14	0.14	0.09	0.52						
19/05/2024 05:15			-0.02	0.00	0.14	0.14	0.09	0.52						
19/05/2024 05:30			-0.02	0.00	0.14	0.14	0.08	0.52						
19/05/2024 05:45			-0.02	0.00	0.14	0.14	0.08	0.52						
19/05/2024 06:00			-0.02	0.00	0.14	0.14	0.08	0.52						
19/05/2024 06:15			-0.03	0.00	0.14	0.14	0.08	0.52						
19/05/2024 06:30			-0.03	0.00	0.14	0.14	0.08	0.52						
19/05/2024 06:45			-0.03	0.00	0.14	0.14	0.08	0.52						
19/05/2024 07:00			-0.03	0.00	0.14	0.14	0.08	0.52						
19/05/2024 07:15			-0.03	0.00	0.13	0.14	0.08	0.52						
19/05/2024 07:30			-0.03	0.00	0.13	0.14	0.08	0.52						
19/05/2024 07:45			-0.03	0.00	0.13	0.14	0.08	0.52						
19/05/2024 08:00			-0.03	0.00	0.13	0.14	0.08	0.52	0.00					
19/05/2024 08:15			-0.03	0.00	0.13	0.14	0.08	0.53						
19/05/2024 08:30			-0.03	0.00	0.13	0.13	0.08	0.53						
19/05/2024 08:45			-0.03	0.00	0.13	0.13	0.08	0.53						
19/05/2024 09:00			-0.03	0.00	0.13	0.13	0.08	0.53						
19/05/2024 09:15			-0.03	0.00	0.13	0.13	0.08	0.53						
19/05/2024 09:30			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
19/05/2024 09:45			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
19/05/2024 10:00			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
19/05/2024 10:15			-0.03	0.00	0.13	0.13	0.08	0.55						
19/05/2024 10:30			-0.03	0.00	0.13	0.14	0.08	0.55	0.04					
19/05/2024 10:45			-0.03	0.00	0.13	0.14	0.08	0.55	0.03					
19/05/2024 11:00			-0.03	0.00	0.13	0.14	0.08	0.55	0.04					
19/05/2024 11:15			-0.03	0.00	0.14	0.14	0.08	0.55						
19/05/2024 11:30			-0.03	0.00	0.14	0.14	0.08	0.55						
19/05/2024 11:45			-0.03	0.00	0.14	0.14	0.08	0.55						
19/05/2024 12:00			-0.03	0.00	0.14	0.14	0.08	0.55	0.04					
19/05/2024 12:15			-0.03	0.00	0.14	0.14	0.08	0.55						
19/05/2024 12:30			-0.03	0.00	0.14	0.14	0.09	0.55						
19/05/2024 12:45			-0.03	0.00	0.14	0.14	0.09	0.55						
19/05/2024 13:00			-0.03	0.00	0.14	0.14	0.09	0.55						
19/05/2024 13:15			-0.03	0.00	0.14	0.14	0.09	0.54						
19/05/2024 13:30			-0.03	0.00	0.14	0.14	0.09	0.54						
19/05/2024 13:45			-0.03	0.00	0.14	0.14	0.09	0.54						
19/05/2024 14:00			-0.03	0.00	0.14	0.14	0.09	0.54						
19/05/2024 14:15			-0.03	0.00	0.14	0.14	0.09	0.54	0.04					
19/05/2024 14:30			-0.03	0.00	0.14	0.14	0.09	0.54	0.04					
19/05/2024 14:45			-0.03	0.00	0.14	0.14	0.09	0.54	0.03					
19/05/2024 15:00			-0.03	0.00	0.14	0.14	0.09	0.54	0.03					
19/05/2024 15:15			-0.03	0.00	0.14	0.14	0.09	0.54	0.03					
19/05/2024 15:30			-0.03	0.00	0.14	0.14	0.09	0.54	0.04					
19/05/2024 15:45			-0.03	0.00	0.14	0.14	0.09	0.54						
19/05/2024 16:00			-0.03	0.00	0.14	0.14	0.09	0.54						
19/05/2024 16:15			-0.03	0.00	0.14	0.14	0.09	0.54						
19/05/2024 16:30			-0.03	0.00	0.14	0.14	0.09	0.54	0.03					
19/05/2024 16:45			-0.03	0.00	0.14	0.14	0.08	0.54						
19/05/2024 17:00			-0.02	0.00	0.14	0.14	0.08	0.54	0.03					
19/05/2024 17:15			-0.02	0.00	0.14	0.14	0.08	0.54	0.03					
19/05/2024 17:30			-0.02	0.00	0.14	0.14	0.08	0.54						
19/05/2024 17:45			-0.02	0.00	0.14	0.14	0.08	0.54	0.03					
19/05/2024 18:00			-0.02	0.00	0.14	0.14	0.08	0.54						
19/05/2024 18:15			-0.02	0.00	0.14	0.14	0.08	0.54	0.04					
19/05/2024 18:30			-0.02	0.00	0.14	0.14	0.08	0.54	0.04					
19/05/2024 18:45			-0.02	0.00	0.14	0.14	0.08	0.54	0.04					
19/05/2024 19:00			-0.02	0.00	0.14	0.14	0.08	0.54						
19/05/2024 19:15			-0.02	0.00	0.14	0.14	0.08	0.54						
19/05/2024 19:30			-0.02	0.00	0.14	0.14	0.08	0.54						
19/05/2024 19:45			-0.02	0.00	0.14	0.14	0.08	0.54						
19/05/2024 20:00			-0.02	0.00	0.14	0.14	0.08	0.54						
19/05/2024 20:15			-0.02	0.00	0.14	0.14	0.08	0.55						
19/05/2024 20:30			-0.02	0.00	0.14	0.14	0.08	0.55						
19/05/2024 20:45			-0.02	0.00	0.14	0.14	0.08	0.54						
19/05/2024 21:00			-0.03	0.00	0.14	0.14	0.08	0.54						
19/05/2024 21:15			-0.03	0.00	0.14	0.14	0.08	0.54						
19/05/2024 21:30			-0.03	0.00	0.14	0.14	0.08	0.54						
19/05/2024 21:45			-0.03	0.00	0.14	0.14	0.08	0.54						
19/05/2024 22:00			-0.03	0.00	0.14	0.14	0.08	0.54						
19/05/2024 22:15			-0.03	0.00	0.14	0.14	0.08	0.54						
19/05/2024 22:30			-0.03	0.00	0.14	0.14	0.08	0.54						
19/05/2024 22:45			-0.03	0.00	0.14	0.14	0.08	0.55						
19/05/2024 23:00			-0.03	0.00	0.14	0.14	0.08	0.55						
19/05/2024 23:15			-0.03	0.00	0.14	0.14	0.08	0.55						
19/05/2024 23:30			-0.03	0.00	0.14	0.14	0.08	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
19/05/2024 23:45			-0.03	0.00	0.14	0.14	0.08	0.54	0.04					
20/05/2024 00:00			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 00:15			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 00:30			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 00:45			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 01:00			-0.03	0.00	0.14	0.14	0.08	0.53						
20/05/2024 01:15			-0.03	0.00	0.14	0.14	0.08	0.53						
20/05/2024 01:30			-0.03	0.00	0.14	0.14	0.08	0.53						
20/05/2024 01:45			-0.03	0.00	0.14	0.14	0.08	0.53	0.04					
20/05/2024 02:00			-0.03	0.00	0.13	0.14	0.08	0.53						
20/05/2024 02:15			-0.03	0.00	0.13	0.14	0.08	0.53						
20/05/2024 02:30			-0.03	0.00	0.13	0.14	0.08	0.52						
20/05/2024 02:45			-0.03	0.00	0.13	0.14	0.08	0.52						
20/05/2024 03:00			-0.03	0.00	0.13	0.13	0.08	0.52						
20/05/2024 03:15			-0.03	0.00	0.13	0.13	0.08	0.52						
20/05/2024 03:30			-0.03	0.00	0.13	0.13	0.08	0.52						
20/05/2024 03:45			-0.03	0.00	0.13	0.13	0.08	0.52						
20/05/2024 04:00			-0.03	0.00	0.13	0.13	0.08	0.52						
20/05/2024 04:15			-0.03	0.00	0.13	0.13	0.08	0.52						
20/05/2024 04:30			-0.03	0.00	0.13	0.13	0.08	0.52						
20/05/2024 04:45			-0.03	0.00	0.13	0.13	0.08	0.52						
20/05/2024 05:00			-0.03	0.00	0.13	0.13	0.08	0.52						
20/05/2024 05:15			-0.03	0.00	0.13	0.13	0.08	0.52	0.03					
20/05/2024 05:30			-0.03	0.00	0.13	0.13	0.08	0.52						
20/05/2024 05:45			-0.03	0.00	0.13	0.13	0.07	0.52						
20/05/2024 06:00			-0.03	0.00	0.13	0.13	0.07	0.52						
20/05/2024 06:15			-0.03	0.00	0.13	0.13	0.07	0.52						
20/05/2024 06:30			-0.03	0.00	0.13	0.13	0.07	0.52	0.03					
20/05/2024 06:45			-0.03	0.00	0.13	0.13	0.07	0.52						
20/05/2024 07:00			-0.03	0.00	0.12	0.13	0.07	0.52						
20/05/2024 07:15			-0.03	0.00	0.12	0.13	0.07	0.52						
20/05/2024 07:30			-0.03	0.00	0.12	0.13	0.07	0.52						
20/05/2024 07:45			-0.03	0.00	0.12	0.13	0.07	0.53						
20/05/2024 08:00			-0.03	0.00	0.12	0.13	0.07	0.53	0.05					
20/05/2024 08:15			-0.03	0.00	0.12	0.13	0.07	0.53						
20/05/2024 08:30			-0.03	0.00	0.12	0.13	0.07	0.54	0.04					
20/05/2024 08:45			-0.04	0.00	0.12	0.13	0.07	0.54	0.04					
20/05/2024 09:00			-0.04	0.00	0.12	0.13	0.07	0.54	0.04					
20/05/2024 09:15			-0.03	0.00	0.13	0.13	0.07	0.54						
20/05/2024 09:30			-0.03	0.00	0.13	0.13	0.07	0.54						
20/05/2024 09:45			-0.03	0.00	0.13	0.13	0.07	0.54						
20/05/2024 10:00			-0.03	0.00	0.13	0.13	0.07	0.54						
20/05/2024 10:15			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 10:30			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 10:45			-0.03	0.00	0.13	0.13	0.08	0.54	0.03					
20/05/2024 11:00			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
20/05/2024 11:15			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 11:30			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 11:45			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 12:00			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 12:15			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 12:30			-0.03	0.00	0.13	0.13	0.08	0.54	-0.01					
20/05/2024 12:45			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 13:00			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 13:15			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
20/05/2024 13:30			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 13:45			-0.03	0.00	0.13	0.13	0.08	0.54	0.05					
20/05/2024 14:00			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 14:15			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 14:30			-0.03	0.00	0.13	0.13	0.08	0.54	0.03					
20/05/2024 14:45			-0.03	0.00	0.13	0.13	0.08	0.54	0.02					
20/05/2024 15:00			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 15:15			-0.03	0.00	0.13	0.13	0.08	0.53						
20/05/2024 15:30			-0.03	0.00	0.13	0.13	0.08	0.53	0.04					
20/05/2024 15:45			-0.03	0.00	0.13	0.13	0.08	0.53						
20/05/2024 16:00			-0.03	0.00	0.13	0.13	0.08	0.53						
20/05/2024 16:15			-0.03	0.00	0.13	0.13	0.08	0.53						
20/05/2024 16:30			-0.03	0.00	0.13	0.13	0.08	0.53						
20/05/2024 16:45			-0.03	0.00	0.13	0.13	0.08	0.53						
20/05/2024 17:00			-0.03	0.00	0.13	0.13	0.08	0.53	-0.03					
20/05/2024 17:15			-0.03	0.00	0.13	0.13	0.08	0.53						
20/05/2024 17:30			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 17:45			-0.03	0.00	0.13	0.13	0.08	0.54	0.00					
20/05/2024 18:00			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 18:15			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
20/05/2024 18:30			-0.03	0.00	0.13	0.13	0.08	0.54	0.05					
20/05/2024 18:45			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
20/05/2024 19:00			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
20/05/2024 19:15			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 19:30			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 19:45			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 20:00			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 20:15			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 20:30			-0.03	0.00	0.13	0.13	0.08	0.54						
20/05/2024 20:45			-0.03	0.00	0.13	0.13	0.08	0.55						
20/05/2024 21:00			-0.03	0.00	0.13	0.14	0.08	0.54						
20/05/2024 21:15			-0.03	0.00	0.13	0.14	0.08	0.54						
20/05/2024 21:30			-0.03	0.00	0.13	0.14	0.08	0.54						
20/05/2024 21:45			-0.03	0.00	0.13	0.14	0.08	0.54						
20/05/2024 22:00			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 22:15			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 22:30			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 22:45			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 23:00			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 23:15			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 23:30			-0.03	0.00	0.14	0.14	0.08	0.54						
20/05/2024 23:45			-0.03	0.00	0.14	0.14	0.08	0.54						
21/05/2024 00:00			-0.03	0.00	0.14	0.14	0.08	0.54						
21/05/2024 00:15			-0.03	0.00	0.14	0.14	0.08	0.54						
21/05/2024 00:30			-0.03	0.00	0.14	0.14	0.08	0.54						
21/05/2024 00:45			-0.03	0.00	0.14	0.14	0.08	0.54						
21/05/2024 01:00			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 01:15			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 01:30			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 01:45			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 02:00			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 02:15			-0.03	0.00	0.13	0.14	0.08	0.53						
21/05/2024 02:30			-0.03	0.00	0.13	0.14	0.08	0.53						
21/05/2024 02:45			-0.03	0.00	0.13	0.14	0.08	0.53						
21/05/2024 03:00			-0.03	0.00	0.13	0.14	0.08	0.53						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
21/05/2024 03:15			-0.03	0.00	0.13	0.14	0.08	0.53						
21/05/2024 03:30			-0.03	0.00	0.13	0.14	0.08	0.53						
21/05/2024 03:45			-0.03	0.00	0.13	0.13	0.08	0.53						
21/05/2024 04:00			-0.03	0.00	0.13	0.13	0.08	0.53						
21/05/2024 04:15			-0.03	0.00	0.13	0.13	0.08	0.53						
21/05/2024 04:30			-0.03	0.00	0.13	0.13	0.08	0.53						
21/05/2024 04:45			-0.03	0.00	0.13	0.13	0.08	0.52						
21/05/2024 05:00			-0.03	0.00	0.13	0.13	0.08	0.52						
21/05/2024 05:15			-0.03	0.00	0.13	0.13	0.08	0.52						
21/05/2024 05:30			-0.03	0.00	0.13	0.13	0.08	0.52						
21/05/2024 05:45			-0.03	0.00	0.13	0.13	0.08	0.52						
21/05/2024 06:00			-0.03	0.00	0.13	0.13	0.08	0.52						
21/05/2024 06:15			-0.03	0.00	0.13	0.13	0.08	0.52						
21/05/2024 06:30			-0.03	0.00	0.13	0.13	0.07	0.52						
21/05/2024 06:45			-0.03	0.00	0.13	0.13	0.07	0.52						
21/05/2024 07:00			-0.03	0.00	0.13	0.13	0.07	0.52						
21/05/2024 07:15			-0.03	0.00	0.13	0.13	0.07	0.53						
21/05/2024 07:30			-0.03	0.00	0.13	0.13	0.07	0.53						
21/05/2024 07:45			-0.03	0.00	0.13	0.13	0.07	0.53						
21/05/2024 08:00			-0.03	0.00	0.13	0.13	0.07	0.54	0.03					
21/05/2024 08:15			-0.03	0.00	0.13	0.13	0.07	0.54	0.04					
21/05/2024 08:30			-0.03	0.00	0.13	0.13	0.07	0.54						
21/05/2024 08:45			-0.04	0.00	0.13	0.13	0.07	0.54	0.04					
21/05/2024 09:00			-0.04	0.00	0.13	0.13	0.07	0.54						
21/05/2024 09:15			-0.04	0.00	0.13	0.13	0.07	0.54						
21/05/2024 09:30			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
21/05/2024 09:45			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
21/05/2024 10:00			-0.03	0.00	0.13	0.13	0.08	0.54	0.04					
21/05/2024 10:15			-0.03	0.00	0.13	0.13	0.08	0.54	0.03					
21/05/2024 10:30			-0.04	0.00	0.13	0.13	0.08	0.54						
21/05/2024 10:45			-0.04	0.00	0.13	0.13	0.08	0.54						
21/05/2024 11:00			-0.03	0.00	0.13	0.13	0.08	0.54						
21/05/2024 11:15			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
21/05/2024 11:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
21/05/2024 11:45			-0.03	0.00	0.13	0.13	0.08	0.54						
21/05/2024 12:00			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
21/05/2024 12:15			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 12:30			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 12:45			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 13:00			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 13:15			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 13:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
21/05/2024 13:45			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 14:00			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 14:15			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 14:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
21/05/2024 14:45			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 15:00			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 15:15			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 15:30			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 15:45			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 16:00			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 16:15			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 16:30			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 16:45			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
21/05/2024 17:00			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
21/05/2024 17:15			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
21/05/2024 17:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
21/05/2024 17:45			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
21/05/2024 18:00			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 18:15			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 18:30			-0.03	0.00	0.13	0.14	0.08	0.54						
21/05/2024 18:45			-0.03	0.00	0.13	0.14	0.08	0.55						
21/05/2024 19:00			-0.03	0.00	0.13	0.14	0.08	0.55	0.04					
21/05/2024 19:15			-0.03	0.00	0.13	0.14	0.08	0.55						
21/05/2024 19:30			-0.03	0.00	0.13	0.14	0.08	0.55	0.04					
21/05/2024 19:45			-0.03	0.00	0.13	0.14	0.08	0.55						
21/05/2024 20:00			-0.03	0.00	0.13	0.14	0.08	0.55						
21/05/2024 20:15			-0.03	0.00	0.13	0.14	0.08	0.55						
21/05/2024 20:30			-0.03	0.00	0.13	0.14	0.08	0.55						
21/05/2024 20:45			-0.03	0.00	0.14	0.14	0.08	0.55						
21/05/2024 21:00			-0.03	0.00	0.14	0.14	0.08	0.55	0.04					
21/05/2024 21:15			-0.03	0.00	0.14	0.14	0.08	0.55	0.04					
21/05/2024 21:30			-0.03	0.00	0.14	0.14	0.08	0.55						
21/05/2024 21:45			-0.03	0.00	0.14	0.14	0.08	0.55	0.01					
21/05/2024 22:00			-0.03	0.00	0.14	0.14	0.08	0.55	0.04					
21/05/2024 22:15			-0.03	0.00	0.14	0.14	0.08	0.55	0.05					
21/05/2024 22:30			-0.03	0.00	0.14	0.14	0.08	0.55	0.04					
21/05/2024 22:45			-0.03	0.00	0.14	0.14	0.08	0.55	0.04					
21/05/2024 23:00			-0.03	0.00	0.14	0.14	0.08	0.55						
21/05/2024 23:15			-0.03	0.00	0.14	0.14	0.08	0.55	0.04					
21/05/2024 23:30			-0.03	0.00	0.14	0.14	0.08	0.55						
21/05/2024 23:45			-0.03	0.00	0.14	0.14	0.08	0.55	0.03					
22/05/2024 00:00			-0.03	0.00	0.14	0.14	0.08	0.54	0.03					
22/05/2024 00:15			-0.03	0.00	0.14	0.14	0.08	0.54	0.04					
22/05/2024 00:30			-0.03	0.00	0.14	0.14	0.08	0.54	0.03					
22/05/2024 00:45			-0.03	0.00	0.14	0.14	0.08	0.54	0.04					
22/05/2024 01:00			-0.03	0.00	0.14	0.14	0.09	0.54	0.03					
22/05/2024 01:15			-0.03	0.00	0.14	0.14	0.09	0.54	0.04					
22/05/2024 01:30			-0.03	0.00	0.14	0.14	0.09	0.54	0.04					
22/05/2024 01:45			-0.03	0.00	0.14	0.14	0.09	0.54	0.05					
22/05/2024 02:00			-0.03	0.00	0.14	0.14	0.09	0.55	0.04					
22/05/2024 02:15			-0.03	0.00	0.14	0.14	0.09	0.56	0.05					
22/05/2024 02:30			-0.03	0.00	0.14	0.14	0.09	0.56	0.04					
22/05/2024 02:45			-0.03	0.00	0.14	0.14	0.09	0.57	0.05					
22/05/2024 03:00			-0.03	0.00	0.14	0.14	0.09	0.57	0.05					
22/05/2024 03:15			-0.03	0.00	0.14	0.14	0.09	0.57	0.04					
22/05/2024 03:30			-0.03	0.00	0.14	0.14	0.09	0.56	0.04					
22/05/2024 03:45			-0.03	0.00	0.14	0.14	0.09	0.56	0.04					
22/05/2024 04:00			-0.03	0.00	0.14	0.15	0.09	0.56	0.05					
22/05/2024 04:15			-0.03	0.00	0.14	0.15	0.09	0.56	0.04					
22/05/2024 04:30			-0.03	0.00	0.15	0.15	0.09	0.56	0.04					
22/05/2024 04:45			-0.03	0.00	0.15	0.15	0.09	0.56	0.05					
22/05/2024 05:00			-0.02	0.00	0.15	0.15	0.09	0.56	0.05					
22/05/2024 05:15			-0.02	0.00	0.15	0.15	0.09	0.57	0.04					
22/05/2024 05:30			-0.03	0.00	0.15	0.15	0.10	0.57	0.04					
22/05/2024 05:45			-0.02	0.00	0.15	0.15	0.10	0.57	0.05					
22/05/2024 06:00			-0.02	0.00	0.15	0.15	0.10	0.57						
22/05/2024 06:15			-0.02	0.00	0.15	0.15	0.10	0.57						
22/05/2024 06:30			-0.02	0.00	0.15	0.15	0.10	0.57						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
22/05/2024 06:45			-0.02	0.00	0.15	0.15	0.10	0.57	0.05					
22/05/2024 07:00			-0.02	0.00	0.15	0.15	0.10	0.57	0.04					
22/05/2024 07:15			-0.02	0.00	0.15	0.15	0.10	0.57	0.06					
22/05/2024 07:30			-0.02	0.00	0.15	0.15	0.10	0.57	0.05					
22/05/2024 07:45			-0.02	0.00	0.15	0.15	0.10	0.57						
22/05/2024 08:00			-0.02	0.00	0.15	0.15	0.10	0.57	0.05					
22/05/2024 08:15			-0.02	0.00	0.15	0.16	0.10	0.57	0.05					
22/05/2024 08:30			-0.02	0.00	0.15	0.16	0.10	0.57	0.06					
22/05/2024 08:45			-0.02	0.00	0.15	0.16	0.10	0.57	0.06					
22/05/2024 09:00			-0.03	0.00	0.15	0.16	0.10	0.58						
22/05/2024 09:15			-0.03	0.00	0.15	0.16	0.10	0.58	0.06					
22/05/2024 09:30			-0.03	0.00	0.16	0.16	0.10	0.58	0.04					
22/05/2024 09:45			-0.02	0.00	0.16	0.16	0.10	0.57	0.04					
22/05/2024 10:00			-0.02	0.00	0.16	0.16	0.10	0.57	0.06					
22/05/2024 10:15			-0.02	0.00	0.16	0.16	0.10	0.57	0.05					
22/05/2024 10:30			-0.02	0.00	0.16	0.16	0.10	0.57	0.06					
22/05/2024 10:45			-0.02	0.00	0.16	0.16	0.10	0.57	0.05					
22/05/2024 11:00			-0.02	0.00	0.16	0.16	0.10	0.57						
22/05/2024 11:15			-0.02	0.00	0.16	0.16	0.10	0.57	0.06					
22/05/2024 11:30			-0.02	0.00	0.16	0.16	0.11	0.57	0.05					
22/05/2024 11:45			-0.02	0.00	0.16	0.16	0.10	0.57	0.06					
22/05/2024 12:00			-0.02	0.00	0.16	0.16	0.10	0.57	0.03					
22/05/2024 12:15			-0.02	0.00	0.16	0.16	0.10	0.57						
22/05/2024 12:30			-0.02	0.00	0.16	0.16	0.10	0.57	0.03					
22/05/2024 12:45			-0.02	0.00	0.16	0.16	0.10	0.57	0.04					
22/05/2024 13:00			-0.02	0.00	0.16	0.16	0.10	0.57						
22/05/2024 13:15			-0.02	0.00	0.16	0.16	0.10	0.57	0.03					
22/05/2024 13:30			-0.01	0.00	0.16	0.16	0.10	0.56	0.05					
22/05/2024 13:45			-0.01	0.00	0.16	0.16	0.10	0.56	0.04					
22/05/2024 14:00			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
22/05/2024 14:15			-0.02	0.00	0.16	0.16	0.10	0.56	0.02					
22/05/2024 14:30			-0.03	0.00	0.16	0.15	0.10	0.56	0.03					
22/05/2024 14:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.06					
22/05/2024 15:00			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
22/05/2024 15:15			-0.02	0.00	0.16	0.15	0.10	0.56	0.04					
22/05/2024 15:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
22/05/2024 15:45			-0.02	0.00	0.16	0.15	0.10	0.56						
22/05/2024 16:00			-0.01	0.00	0.15	0.15	0.10	0.56	0.02					
22/05/2024 16:15			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 16:30			-0.02	0.00	0.15	0.15	0.10	0.56	0.04					
22/05/2024 16:45			-0.02	0.00	0.15	0.15	0.10	0.56	0.04					
22/05/2024 17:00			-0.02	0.00	0.15	0.15	0.10	0.56	0.02					
22/05/2024 17:15			-0.02	0.00	0.15	0.15	0.10	0.56	0.03					
22/05/2024 17:30			-0.02	0.00	0.15	0.15	0.10	0.57	0.04					
22/05/2024 17:45			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 18:00			-0.02	0.00	0.15	0.15	0.10	0.56	0.03					
22/05/2024 18:15			-0.02	0.00	0.15	0.15	0.10	0.56	0.03					
22/05/2024 18:30			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 18:45			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 19:00			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 19:15			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 19:30			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 19:45			-0.02	0.00	0.15	0.15	0.10	0.56	0.04					
22/05/2024 20:00			-0.02	0.00	0.15	0.15	0.10	0.56	0.04					
22/05/2024 20:15			-0.02	0.00	0.15	0.15	0.10	0.56	0.04					
22/05/2024 20:30			-0.02	0.00	0.15	0.16	0.10	0.56						
22/05/2024 20:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
22/05/2024 21:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
22/05/2024 21:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
22/05/2024 21:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
22/05/2024 21:45			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 22:00			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 22:15			-0.02	0.00	0.15	0.15	0.10	0.56	0.04					
22/05/2024 22:30			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 22:45			-0.02	0.00	0.15	0.15	0.10	0.56	0.04					
22/05/2024 23:00			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 23:15			-0.02	0.00	0.15	0.15	0.10	0.56	0.04					
22/05/2024 23:30			-0.02	0.00	0.15	0.15	0.10	0.56						
22/05/2024 23:45			-0.02	0.00	0.15	0.15	0.10	0.56	0.03					
23/05/2024 00:00			-0.02	0.00	0.15	0.15	0.10	0.56						
23/05/2024 00:15			-0.02	0.00	0.15	0.15	0.10	0.56	0.05					
23/05/2024 00:30			-0.02	0.00	0.15	0.15	0.10	0.56						
23/05/2024 00:45			-0.02	0.00	0.15	0.15	0.10	0.56						
23/05/2024 01:00			-0.02	0.00	0.15	0.15	0.09	0.55						
23/05/2024 01:15			-0.02	0.00	0.15	0.15	0.09	0.54	0.05					
23/05/2024 01:30			-0.02	0.00	0.15	0.15	0.09	0.55	0.05					
23/05/2024 01:45			-0.02	0.00	0.15	0.15	0.09	0.55	0.04					
23/05/2024 02:00			-0.02	0.00	0.15	0.15	0.09	0.55	0.00					
23/05/2024 02:15			-0.02	0.00	0.15	0.15	0.09	0.55	0.05					
23/05/2024 02:30			-0.02	0.00	0.15	0.15	0.09	0.55	0.03					
23/05/2024 02:45			-0.02	0.00	0.15	0.15	0.09	0.55	0.04					
23/05/2024 03:00			-0.02	0.00	0.15	0.15	0.09	0.55	0.04					
23/05/2024 03:15			-0.02	0.00	0.15	0.15	0.09	0.55	0.03					
23/05/2024 03:30			-0.02	0.00	0.14	0.15	0.09	0.55						
23/05/2024 03:45			-0.02	0.00	0.14	0.15	0.09	0.55	0.04					
23/05/2024 04:00			-0.02	0.00	0.14	0.15	0.09	0.54	0.04					
23/05/2024 04:15			-0.02	0.00	0.14	0.15	0.09	0.54	0.04					
23/05/2024 04:30			-0.02	0.00	0.14	0.15	0.09	0.54	0.04					
23/05/2024 04:45			-0.02	0.00	0.14	0.15	0.09	0.54	0.04					
23/05/2024 05:00			-0.02	0.00	0.14	0.15	0.09	0.54	0.04					
23/05/2024 05:15			-0.02	0.00	0.14	0.15	0.09	0.54	0.05					
23/05/2024 05:30			-0.02	0.00	0.14	0.15	0.09	0.54						
23/05/2024 05:45			-0.02	0.00	0.14	0.15	0.09	0.54	0.03					
23/05/2024 06:00			-0.02	0.00	0.14	0.15	0.09	0.54	0.04					
23/05/2024 06:15			-0.02	0.00	0.14	0.15	0.09	0.54	0.03					
23/05/2024 06:30			-0.03	0.00	0.14	0.15	0.09	0.54	0.03					
23/05/2024 06:45			-0.02	0.00	0.14	0.15	0.09	0.54	0.03					
23/05/2024 07:00			-0.03	0.00	0.14	0.15	0.09	0.54	0.02					
23/05/2024 07:15			-0.02	0.00	0.14	0.14	0.09	0.54	0.04					
23/05/2024 07:30			-0.02	0.00	0.14	0.15	0.09	0.55						
23/05/2024 07:45			-0.02	0.00	0.14	0.14	0.09	0.55						
23/05/2024 08:00			-0.02	0.00	0.14	0.14	0.09	0.55						
23/05/2024 08:15			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 08:30			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 08:45			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 09:00			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 09:15			-0.03	0.00	0.14	0.14	0.09	0.55	0.03					
23/05/2024 09:30			-0.03	0.00	0.14	0.14	0.09	0.56	0.05					
23/05/2024 09:45			-0.03	0.00	0.14	0.14	0.09	0.55	0.02					
23/05/2024 10:00			-0.03	0.00	0.14	0.14	0.09	0.55	0.04					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
23/05/2024 10:15			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
23/05/2024 10:30			-0.02	0.00	0.14	0.14	0.09	0.55						
23/05/2024 10:45			-0.02	0.00	0.14	0.15	0.09	0.55	0.03					
23/05/2024 11:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.04					
23/05/2024 11:15			-0.02	0.00	0.14	0.15	0.09	0.55	0.03					
23/05/2024 11:30			-0.03	0.00	0.14	0.15	0.09	0.55						
23/05/2024 11:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.03					
23/05/2024 12:00			-0.03	0.00	0.14	0.15	0.09	0.55	0.03					
23/05/2024 12:15			-0.03	0.00	0.14	0.15	0.09	0.55	0.03					
23/05/2024 12:30			-0.03	0.00	0.14	0.15	0.09	0.55						
23/05/2024 12:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.03					
23/05/2024 13:00			-0.03	0.00	0.14	0.15	0.09	0.55						
23/05/2024 13:15			-0.02	0.00	0.14	0.15	0.09	0.55	0.03					
23/05/2024 13:30			-0.03	0.00	0.14	0.15	0.09	0.55						
23/05/2024 13:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
23/05/2024 14:00			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
23/05/2024 14:15			-0.03	0.00	0.14	0.15	0.09	0.55						
23/05/2024 14:30			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
23/05/2024 14:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
23/05/2024 15:00			-0.03	0.00	0.14	0.15	0.09	0.55						
23/05/2024 15:15			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
23/05/2024 15:30			-0.02	0.00	0.14	0.15	0.09	0.54	0.04					
23/05/2024 15:45			-0.02	0.00	0.14	0.14	0.09	0.54						
23/05/2024 16:00			-0.02	0.00	0.14	0.15	0.09	0.54						
23/05/2024 16:15			-0.02	0.00	0.14	0.15	0.09	0.54	0.04					
23/05/2024 16:30			-0.03	0.00	0.14	0.14	0.09	0.54						
23/05/2024 16:45			-0.03	0.00	0.14	0.14	0.09	0.54						
23/05/2024 17:00			-0.03	0.00	0.14	0.14	0.09	0.54						
23/05/2024 17:15			-0.02	0.00	0.14	0.14	0.09	0.55						
23/05/2024 17:30			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 17:45			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 18:00			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 18:15			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 18:30			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 18:45			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 19:00			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 19:15			-0.02	0.00	0.14	0.14	0.09	0.55	0.04					
23/05/2024 19:30			-0.02	0.00	0.14	0.14	0.09	0.55	0.04					
23/05/2024 19:45			-0.02	0.00	0.14	0.14	0.09	0.55						
23/05/2024 20:00			-0.02	0.00	0.14	0.14	0.09	0.55						
23/05/2024 20:15			-0.02	0.00	0.14	0.14	0.09	0.55	0.03					
23/05/2024 20:30			-0.02	0.00	0.14	0.14	0.08	0.55	0.00					
23/05/2024 20:45			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 21:00			-0.02	0.00	0.14	0.14	0.08	0.55	0.05					
23/05/2024 21:15			-0.02	0.00	0.14	0.14	0.08	0.55						
23/05/2024 21:30			-0.02	0.00	0.14	0.14	0.09	0.55						
23/05/2024 21:45			-0.03	0.00	0.14	0.14	0.09	0.55						
23/05/2024 22:00			-0.02	0.00	0.14	0.14	0.09	0.55						
23/05/2024 22:15			-0.03	0.00	0.14	0.14	0.09	0.55						
23/05/2024 22:30			-0.03	0.00	0.14	0.14	0.09	0.55						
23/05/2024 22:45			-0.02	0.00	0.14	0.14	0.09	0.55						
23/05/2024 23:00			-0.03	0.00	0.14	0.14	0.09	0.55						
23/05/2024 23:15			-0.03	0.00	0.14	0.14	0.09	0.55						
23/05/2024 23:30			-0.03	0.00	0.14	0.14	0.09	0.55						
23/05/2024 23:45			-0.03	0.00	0.14	0.14	0.09	0.55						
24/05/2024 00:00			-0.03	0.00	0.14	0.14	0.09	0.55						
24/05/2024 00:15			-0.03	0.00	0.14	0.14	0.09	0.54						
24/05/2024 00:30			-0.03	0.00	0.14	0.14	0.09	0.54						
24/05/2024 00:45			-0.03	0.00	0.14	0.14	0.08	0.54						
24/05/2024 01:00			-0.03	0.00	0.14	0.14	0.08	0.54						
24/05/2024 01:15			-0.03	0.00	0.14	0.14	0.08	0.54						
24/05/2024 01:30			-0.03	0.00	0.14	0.14	0.08	0.54						
24/05/2024 01:45			-0.03	0.00	0.14	0.14	0.08	0.54						
24/05/2024 02:00			-0.02	0.00	0.14	0.14	0.08	0.54	0.04					
24/05/2024 02:15			-0.02	0.00	0.14	0.14	0.08	0.54						
24/05/2024 02:30			-0.02	0.00	0.14	0.14	0.08	0.54						
24/05/2024 02:45			-0.03	0.00	0.14	0.14	0.08	0.53						
24/05/2024 03:00			-0.02	0.00	0.13	0.14	0.08	0.53						
24/05/2024 03:15			-0.03	0.00	0.13	0.14	0.08	0.53	0.03					
24/05/2024 03:30			-0.03	0.00	0.13	0.14	0.08	0.53						
24/05/2024 03:45			-0.03	0.00	0.13	0.14	0.08	0.53	0.03					
24/05/2024 04:00			-0.03	0.00	0.13	0.14	0.08	0.53						
24/05/2024 04:15			-0.03	0.00	0.13	0.14	0.08	0.53						
24/05/2024 04:30			-0.03	0.00	0.13	0.14	0.08	0.53	0.02					
24/05/2024 04:45			-0.03	0.00	0.13	0.14	0.08	0.53	0.02					
24/05/2024 05:00			-0.03	0.00	0.13	0.14	0.08	0.53						
24/05/2024 05:15			-0.03	0.00	0.13	0.14	0.08	0.53						
24/05/2024 05:30			-0.03	0.00	0.13	0.14	0.08	0.53						
24/05/2024 05:45			-0.03	0.00	0.13	0.14	0.08	0.53						
24/05/2024 06:00			-0.03	0.00	0.13	0.14	0.08	0.53						
24/05/2024 06:15			-0.03	0.00	0.13	0.14	0.08	0.53						
24/05/2024 06:30			-0.03	0.00	0.13	0.14	0.08	0.53	0.02					
24/05/2024 06:45			-0.03	0.00	0.13	0.14	0.08	0.53	0.02					
24/05/2024 07:00			-0.03	0.00	0.13	0.14	0.08	0.53	0.03					
24/05/2024 07:15			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 07:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
24/05/2024 07:45			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 08:00			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 08:15			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 08:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.05					
24/05/2024 08:45			-0.03	0.00	0.13	0.14	0.08	0.54	0.06					
24/05/2024 09:00			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 09:15			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 09:30			-0.03	0.00	0.13	0.14	0.08	0.55	0.05					
24/05/2024 09:45			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 10:00			-0.03	0.00	0.13	0.14	0.08	0.55	0.03					
24/05/2024 10:15			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 10:30			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 10:45			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 11:00			-0.03	0.00	0.13	0.14	0.08	0.55	0.04					
24/05/2024 11:15			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 11:30			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 11:45			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
24/05/2024 12:00			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 12:15			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
24/05/2024 12:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.06					
24/05/2024 12:45			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
24/05/2024 13:00			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 13:15			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
24/05/2024 13:30			-0.03	0.00	0.13	0.14	0.08	0.55	0.04					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
24/05/2024 13:45			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 14:00			-0.03	0.00	0.13	0.14	0.08	0.55	0.04					
24/05/2024 14:15			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 14:30			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 14:45			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
24/05/2024 15:00			-0.03	0.00	0.13	0.14	0.08	0.54	0.05					
24/05/2024 15:15			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 15:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
24/05/2024 15:45			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 16:00			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 16:15			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 16:30			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 16:45			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 17:00			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 17:15			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 17:30			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 17:45			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 18:00			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 18:15			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 18:30			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 18:45			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 19:00			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 19:15			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 19:30			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 19:45			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 20:00			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 20:15			-0.03	0.00	0.13	0.14	0.08	0.55						
24/05/2024 20:30			-0.03	0.00	0.13	0.14	0.08	0.55	0.05					
24/05/2024 20:45			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 21:00			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 21:15			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
24/05/2024 21:30			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 21:45			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 22:00			-0.03	0.00	0.13	0.14	0.08	0.54						
24/05/2024 22:15			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
24/05/2024 22:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
24/05/2024 22:45			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
24/05/2024 23:00			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
24/05/2024 23:15			-0.03	0.00	0.13	0.14	0.08	0.54	0.02					
24/05/2024 23:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
24/05/2024 23:45			-0.03	0.00	0.13	0.14	0.08	0.54						
25/05/2024 00:00			-0.03	0.00	0.13	0.14	0.08	0.54	0.02					
25/05/2024 00:15			-0.03	0.00	0.13	0.14	0.08	0.54	0.04					
25/05/2024 00:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.05					
25/05/2024 00:45			-0.03	0.00	0.13	0.14	0.08	0.54						
25/05/2024 01:00			-0.03	0.00	0.13	0.14	0.08	0.54						
25/05/2024 01:15			-0.03	0.00	0.13	0.14	0.08	0.54						
25/05/2024 01:30			-0.03	0.00	0.13	0.14	0.08	0.54						
25/05/2024 01:45			-0.03	0.00	0.13	0.14	0.08	0.54						
25/05/2024 02:00			-0.03	0.00	0.13	0.14	0.08	0.54						
25/05/2024 02:15			-0.03	0.00	0.13	0.14	0.08	0.54						
25/05/2024 02:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
25/05/2024 02:45			-0.03	0.00	0.13	0.14	0.08	0.54						
25/05/2024 03:00			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 03:15			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 03:30			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 03:45			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 04:00			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 04:15			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 04:30			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 04:45			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 05:00			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 05:15			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 05:30			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 05:45			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 06:00			-0.03	0.00	0.13	0.14	0.08	0.52						
25/05/2024 06:15			-0.03	0.00	0.13	0.14	0.08	0.52						
25/05/2024 06:30			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 06:45			-0.03	0.00	0.13	0.14	0.08	0.53						
25/05/2024 07:00			-0.03	0.00	0.13	0.13	0.08	0.53						
25/05/2024 07:15			-0.03	0.00	0.13	0.13	0.07	0.53						
25/05/2024 07:30			-0.03	0.00	0.13	0.13	0.07	0.53						
25/05/2024 07:45			-0.03	0.00	0.13	0.13	0.07	0.53						
25/05/2024 08:00			-0.03	0.00	0.13	0.13	0.07	0.53						
25/05/2024 08:15			-0.03	0.00	0.13	0.13	0.07	0.54	0.03					
25/05/2024 08:30			-0.03	0.00	0.13	0.13	0.07	0.54	0.02					
25/05/2024 08:45			-0.03	0.00	0.13	0.13	0.07	0.54	0.04					
25/05/2024 09:00			-0.03	0.00	0.13	0.13	0.07	0.54	0.04					
25/05/2024 09:15			-0.03	0.00	0.13	0.13	0.08	0.54	0.05					
25/05/2024 09:30			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
25/05/2024 09:45			-0.03	0.00	0.13	0.14	0.08	0.54	0.03					
25/05/2024 10:00			-0.03	0.00	0.13	0.14	0.08	0.55	0.02					
25/05/2024 10:15			-0.03	0.00	0.13	0.14	0.08	0.55	0.03					
25/05/2024 10:30			-0.03	0.00	0.13	0.14	0.08	0.55	0.03					
25/05/2024 10:45			-0.03	0.00	0.13	0.14	0.08	0.55	0.04					
25/05/2024 11:00			-0.03	0.00	0.13	0.14	0.08	0.55	0.03					
25/05/2024 11:15			-0.03	0.00	0.13	0.14	0.08	0.55	0.03					
25/05/2024 11:30			-0.03	0.00	0.13	0.14	0.08	0.55						
25/05/2024 11:45			-0.03	0.00	0.13	0.14	0.08	0.55						
25/05/2024 12:00			-0.03	0.00	0.13	0.14	0.08	0.55	0.04					
25/05/2024 12:15			-0.03	0.00	0.13	0.14	0.08	0.55	0.03					
25/05/2024 12:30			-0.03	0.00	0.13	0.14	0.08	0.55	0.04					
25/05/2024 12:45			-0.03	0.00	0.13	0.14	0.08	0.55	0.06					
25/05/2024 13:00			-0.03	0.00	0.14	0.14	0.08	0.55	0.05					
25/05/2024 13:15			-0.03	0.00	0.14	0.14	0.08	0.55	0.06					
25/05/2024 13:30			-0.03	0.00	0.14	0.14	0.08	0.55	0.05					
25/05/2024 13:45			-0.03	0.00	0.14	0.14	0.08	0.55	0.05					
25/05/2024 14:00			-0.03	0.00	0.14	0.14	0.08	0.55	0.05					
25/05/2024 14:15			-0.03	0.00	0.14	0.14	0.08	0.55						
25/05/2024 14:30			-0.03	0.00	0.14	0.14	0.09	0.55						
25/05/2024 14:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
25/05/2024 15:00			-0.04	0.00	0.14	0.15	0.09	0.55	0.03					
25/05/2024 15:15			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
25/05/2024 15:30			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 15:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
25/05/2024 16:00			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 16:15			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 16:30			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
25/05/2024 16:45			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 17:00			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
25/05/2024 17:15			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
25/05/2024 17:30			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
25/05/2024 17:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
25/05/2024 18:00			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 18:15			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 18:30			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 18:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
25/05/2024 19:00			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 19:15			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 19:30			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 19:45			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 20:00			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
25/05/2024 20:15			-0.02	0.00	0.14	0.15	0.09	0.56	0.04					
25/05/2024 20:30			-0.03	0.00	0.14	0.15	0.09	0.56	0.04					
25/05/2024 20:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
25/05/2024 21:00			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
25/05/2024 21:15			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 21:30			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 21:45			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 22:00			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
25/05/2024 22:15			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 22:30			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 22:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
25/05/2024 23:00			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 23:15			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 23:30			-0.03	0.00	0.14	0.15	0.09	0.55						
25/05/2024 23:45			-0.03	0.00	0.14	0.15	0.09	0.55						
26/05/2024 00:00			-0.03	0.00	0.14	0.15	0.09	0.55						
26/05/2024 00:15			-0.03	0.00	0.14	0.15	0.09	0.55						
26/05/2024 00:30			-0.03	0.00	0.14	0.15	0.09	0.55						
26/05/2024 00:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
26/05/2024 01:00			-0.03	0.00	0.14	0.15	0.09	0.55						
26/05/2024 01:15			-0.03	0.00	0.14	0.15	0.09	0.55						
26/05/2024 01:30			-0.02	0.00	0.14	0.15	0.09	0.55						
26/05/2024 01:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.02					
26/05/2024 02:00			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
26/05/2024 02:15			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
26/05/2024 02:30			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
26/05/2024 02:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
26/05/2024 03:00			-0.03	0.00	0.14	0.15	0.09	0.55	0.05					
26/05/2024 03:15			-0.03	0.00	0.14	0.15	0.09	0.55	0.06					
26/05/2024 03:30			-0.03	0.00	0.14	0.15	0.09	0.56	0.06					
26/05/2024 03:45			-0.03	0.00	0.14	0.15	0.09	0.57	0.06					
26/05/2024 04:00			-0.03	0.00	0.14	0.15	0.09	0.57	0.05					
26/05/2024 04:15			-0.03	0.00	0.14	0.15	0.09	0.57	0.05					
26/05/2024 04:30			-0.03	0.00	0.14	0.15	0.09	0.57	0.05					
26/05/2024 04:45			-0.03	0.00	0.15	0.15	0.09	0.57	0.05					
26/05/2024 05:00			-0.03	0.00	0.15	0.15	0.09	0.57	0.05					
26/05/2024 05:15			-0.03	0.00	0.15	0.15	0.09	0.57	0.05					
26/05/2024 05:30			-0.03	0.00	0.15	0.16	0.09	0.57	0.04					
26/05/2024 05:45			-0.03	0.00	0.15	0.16	0.10	0.57	0.04					
26/05/2024 06:00			-0.03	0.00	0.15	0.16	0.10	0.57	0.05					
26/05/2024 06:15			-0.03	0.00	0.15	0.16	0.10	0.57	0.05					
26/05/2024 06:30			-0.02	0.00	0.15	0.16	0.10	0.57	0.05					
26/05/2024 06:45			-0.02	0.00	0.15	0.16	0.10	0.57	0.06					
26/05/2024 07:00			-0.02	0.00	0.15	0.16	0.10	0.57	0.05					
26/05/2024 07:15			-0.02	0.00	0.15	0.16	0.10	0.58	0.05					
26/05/2024 07:30			-0.02	0.00	0.15	0.16	0.10	0.58	0.05					
26/05/2024 07:45			-0.03	0.00	0.16	0.16	0.10	0.58	0.05					
26/05/2024 08:00			-0.03	0.00	0.16	0.16	0.10	0.58	0.05					
26/05/2024 08:15			-0.02	0.00	0.16	0.16	0.10	0.59	0.05					
26/05/2024 08:30			-0.02	0.00	0.16	0.17	0.10	0.59	0.06					
26/05/2024 08:45			-0.02	0.00	0.16	0.17	0.11	0.59	0.05					
26/05/2024 09:00			-0.02	0.00	0.16	0.17	0.11	0.59	0.06					
26/05/2024 09:15			-0.02	0.00	0.16	0.17	0.11	0.60	0.05					
26/05/2024 09:30			-0.02	0.00	0.16	0.17	0.11	0.60	0.05					
26/05/2024 09:45			-0.02	0.00	0.16	0.17	0.11	0.60	0.06					
26/05/2024 10:00			-0.02	0.00	0.16	0.17	0.11	0.60	0.06					
26/05/2024 10:15			-0.02	0.00	0.17	0.17	0.11	0.59	0.06					
26/05/2024 10:30			-0.02	0.00	0.17	0.17	0.11	0.59	0.06					
26/05/2024 10:45			-0.02	0.00	0.17	0.17	0.11	0.59	0.06					
26/05/2024 11:00			-0.02	0.00	0.17	0.17	0.12	0.59	0.05					
26/05/2024 11:15			-0.02	0.00	0.17	0.17	0.12	0.59	0.07					
26/05/2024 11:30			-0.02	0.00	0.17	0.17	0.12	0.59	0.06					
26/05/2024 11:45			-0.02	0.00	0.17	0.17	0.12	0.59	0.06					
26/05/2024 12:00			-0.02	0.00	0.17	0.17	0.12	0.59	0.05					
26/05/2024 12:15			-0.02	0.00	0.17	0.17	0.12	0.59	0.05					
26/05/2024 12:30			-0.02	0.00	0.17	0.18	0.12	0.59	0.05					
26/05/2024 12:45			-0.02	0.00	0.17	0.18	0.12	0.59						
26/05/2024 13:00			-0.02	0.00	0.17	0.18	0.12	0.59	0.05					
26/05/2024 13:15			-0.02	0.00	0.17	0.18	0.12	0.59	0.05					
26/05/2024 13:30			-0.02	0.00	0.17	0.18	0.12	0.59	0.05					
26/05/2024 13:45			-0.02	0.00	0.17	0.18	0.12	0.59	0.05					
26/05/2024 14:00			-0.02	0.00	0.18	0.18	0.12	0.59	0.06					
26/05/2024 14:15			-0.02	0.00	0.18	0.18	0.12	0.59	0.06					
26/05/2024 14:30			-0.02	0.00	0.18	0.18	0.12	0.58	0.06					
26/05/2024 14:45			-0.02	0.00	0.18	0.18	0.12	0.59	0.05					
26/05/2024 15:00			-0.01	0.00	0.18	0.18	0.12	0.59	0.05					
26/05/2024 15:15			-0.01	0.00	0.18	0.18	0.12	0.59	0.05					
26/05/2024 15:30			-0.01	0.00	0.18	0.18	0.12	0.59	0.05					
26/05/2024 15:45			-0.01	0.00	0.18	0.18	0.12	0.59	0.05					
26/05/2024 16:00			-0.01	0.00	0.18	0.18	0.12	0.59	0.06					
26/05/2024 16:15			-0.01	0.00	0.18	0.18	0.12	0.59	0.05					
26/05/2024 16:30			-0.01	0.00	0.18	0.18	0.12	0.59	0.06					
26/05/2024 16:45			-0.01	0.00	0.18	0.18	0.12	0.58	0.05					
26/05/2024 17:00			-0.01	0.00	0.18	0.18	0.12	0.58						
26/05/2024 17:15			-0.01	0.00	0.18	0.18	0.12	0.58	0.07					
26/05/2024 17:30			-0.01	0.00	0.18	0.18	0.12	0.58	0.06					
26/05/2024 17:45			-0.01	0.00	0.18	0.18	0.12	0.58	0.05					
26/05/2024 18:00			-0.01	0.00	0.18	0.18	0.12	0.58	0.06					
26/05/2024 18:15			-0.01	0.00	0.18	0.18	0.12	0.58	0.06					
26/05/2024 18:30			-0.01	0.00	0.18	0.18	0.12	0.58	0.05					
26/05/2024 18:45			-0.01	0.00	0.17	0.18	0.12	0.58						
26/05/2024 19:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
26/05/2024 19:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
26/05/2024 19:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
26/05/2024 19:45			-0.01	0.00	0.17	0.17	0.12	0.58	0.06					
26/05/2024 20:00			-0.01	0.00	0.17	0.17	0.12	0.58	0.06					
26/05/2024 20:15			-0.01	0.00	0.17	0.17	0.12	0.58	0.06					
26/05/2024 20:30			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
26/05/2024 20:45			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
26/05/2024 21:00			-0.01	0.00	0.17	0.17	0.12	0.58	0.06					
26/05/2024 21:15			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
26/05/2024 21:30			-0.01	0.00	0.17	0.17	0.12	0.58	0.06					
26/05/2024 21:45			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
26/05/2024 22:00			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
26/05/2024 22:15			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
26/05/2024 22:30			-0.01	0.00	0.17	0.17	0.12	0.58						
26/05/2024 22:45			-0.01	0.00	0.17	0.17	0.12	0.58	0.06					
26/05/2024 23:00			-0.01	0.00	0.17	0.17	0.12	0.58	0.06					
26/05/2024 23:15			-0.01	0.00	0.17	0.17	0.12	0.58						
26/05/2024 23:30			-0.01	0.00	0.17	0.17	0.12	0.58	0.06					
26/05/2024 23:45			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
27/05/2024 00:00			-0.01	0.00	0.17	0.17	0.12	0.57	0.05					
27/05/2024 00:15			-0.01	0.00	0.17	0.17	0.12	0.57	0.06					
27/05/2024 00:30			-0.01	0.00	0.17	0.17	0.12	0.57	0.05					
27/05/2024 00:45			-0.02	0.00	0.17	0.17	0.11	0.57	0.04					
27/05/2024 01:00			-0.01	0.00	0.17	0.17	0.11	0.57	0.04					
27/05/2024 01:15			-0.01	0.00	0.17	0.17	0.11	0.57	0.05					
27/05/2024 01:30			-0.01	0.00	0.17	0.17	0.11	0.57	0.05					
27/05/2024 01:45			-0.01	0.00	0.17	0.17	0.11	0.57	0.05					
27/05/2024 02:00			-0.01	0.00	0.17	0.17	0.11	0.57	0.05					
27/05/2024 02:15			-0.01	0.00	0.17	0.17	0.11	0.57	0.05					
27/05/2024 02:30			-0.01	0.00	0.17	0.17	0.11	0.57	0.05					
27/05/2024 02:45			-0.01	0.00	0.17	0.17	0.11	0.56	0.05					
27/05/2024 03:00			-0.01	0.00	0.17	0.17	0.11	0.56	0.04					
27/05/2024 03:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
27/05/2024 03:30			-0.01	0.00	0.16	0.17	0.11	0.56	0.05					
27/05/2024 03:45			-0.01	0.00	0.16	0.17	0.11	0.56	0.04					
27/05/2024 04:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
27/05/2024 04:15			-0.02	0.00	0.16	0.17	0.11	0.56						
27/05/2024 04:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
27/05/2024 04:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
27/05/2024 05:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
27/05/2024 05:15			-0.02	0.00	0.16	0.16	0.11	0.56	0.05					
27/05/2024 05:30			-0.02	0.00	0.16	0.16	0.11	0.56						
27/05/2024 05:45			-0.02	0.00	0.16	0.16	0.11	0.56	0.04					
27/05/2024 06:00			-0.02	0.00	0.16	0.16	0.11	0.56						
27/05/2024 06:15			-0.02	0.00	0.16	0.16	0.11	0.56	0.05					
27/05/2024 06:30			-0.02	0.00	0.16	0.16	0.11	0.56	0.05					
27/05/2024 06:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 07:00			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
27/05/2024 07:15			-0.02	0.00	0.16	0.16	0.10	0.56	0.03					
27/05/2024 07:30			-0.02	0.00	0.16	0.16	0.10	0.56	0.02					
27/05/2024 07:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.03					
27/05/2024 08:00			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 08:15			-0.02	0.00	0.16	0.16	0.10	0.56	0.03					
27/05/2024 08:30			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
27/05/2024 08:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
27/05/2024 09:00			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 09:15			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
27/05/2024 09:30			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 09:45			-0.02	0.00	0.16	0.16	0.10	0.57	0.05					
27/05/2024 10:00			-0.02	0.00	0.16	0.16	0.10	0.57	0.05					
27/05/2024 10:15			-0.02	0.00	0.16	0.16	0.10	0.57	0.05					
27/05/2024 10:30			-0.02	0.00	0.15	0.16	0.10	0.57	0.04					
27/05/2024 10:45			-0.02	0.00	0.16	0.16	0.10	0.57	0.05					
27/05/2024 11:00			-0.02	0.00	0.16	0.16	0.10	0.57	0.03					
27/05/2024 11:15			-0.02	0.00	0.16	0.16	0.10	0.57	0.04					
27/05/2024 11:30			-0.02	0.00	0.16	0.16	0.10	0.57	0.04					
27/05/2024 11:45			-0.02	0.00	0.16	0.16	0.10	0.57	0.04					
27/05/2024 12:00			-0.02	0.00	0.16	0.16	0.10	0.57						
27/05/2024 12:15			-0.02	0.00	0.16	0.16	0.11	0.57	0.04					
27/05/2024 12:30			-0.02	0.00	0.16	0.16	0.10	0.57	0.05					
27/05/2024 12:45			-0.02	0.00	0.16	0.16	0.11	0.57	0.05					
27/05/2024 13:00			-0.02	0.00	0.16	0.16	0.11	0.57	0.04					
27/05/2024 13:15			-0.03	0.00	0.16	0.16	0.11	0.56	0.02					
27/05/2024 13:30			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
27/05/2024 13:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 14:00			-0.02	0.00	0.16	0.16	0.11	0.56	0.03					
27/05/2024 14:15			-0.02	0.00	0.16	0.16	0.11	0.56	0.03					
27/05/2024 14:30			-0.02	0.00	0.16	0.16	0.11	0.56	0.04					
27/05/2024 14:45			-0.02	0.00	0.16	0.16	0.11	0.56	0.04					
27/05/2024 15:00			-0.02	0.00	0.16	0.16	0.11	0.56	0.04					
27/05/2024 15:15			-0.02	0.00	0.16	0.16	0.11	0.56						
27/05/2024 15:30			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 15:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
27/05/2024 16:00			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
27/05/2024 16:15			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 16:30			-0.02	0.00	0.16	0.16	0.10	0.56						
27/05/2024 16:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.03					
27/05/2024 17:00			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 17:15			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 17:30			-0.02	0.00	0.16	0.16	0.10	0.56						
27/05/2024 17:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 18:00			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
27/05/2024 18:15			-0.02	0.00	0.16	0.16	0.10	0.56	0.06					
27/05/2024 18:30			-0.02	0.00	0.16	0.16	0.10	0.56						
27/05/2024 18:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 19:00			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 19:15			-0.02	0.00	0.16	0.16	0.10	0.56						
27/05/2024 19:30			-0.02	0.00	0.16	0.16	0.10	0.56						
27/05/2024 19:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 20:00			-0.02	0.00	0.16	0.16	0.10	0.56						
27/05/2024 20:15			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
27/05/2024 20:30			-0.02	0.00	0.16	0.16	0.10	0.56						
27/05/2024 20:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.05					
27/05/2024 21:00			-0.02	0.00	0.16	0.16	0.10	0.56						
27/05/2024 21:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
27/05/2024 21:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
27/05/2024 21:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
27/05/2024 22:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
27/05/2024 22:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
27/05/2024 22:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
27/05/2024 22:45			-0.02	0.00	0.15	0.16	0.10	0.56						
27/05/2024 23:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
27/05/2024 23:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
27/05/2024 23:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
27/05/2024 23:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
28/05/2024 00:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
28/05/2024 00:15			-0.02	0.00	0.15	0.16	0.10	0.56						
28/05/2024 00:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
28/05/2024 00:45			-0.02	0.00	0.15	0.16	0.10	0.55						
28/05/2024 01:00			-0.02	0.00	0.15	0.16	0.10	0.55						
28/05/2024 01:15			-0.02	0.00	0.15	0.16	0.10	0.55						
28/05/2024 01:30			-0.02	0.00	0.15	0.16	0.10	0.55						
28/05/2024 01:45			-0.02	0.00	0.15	0.16	0.10	0.55						
28/05/2024 02:00			-0.02	0.00	0.15	0.16	0.10	0.55						
28/05/2024 02:15			-0.02	0.00	0.15	0.16	0.10	0.55	0.03					
28/05/2024 02:30			-0.02	0.00	0.15	0.16	0.10	0.55	0.02					
28/05/2024 02:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.03					
28/05/2024 03:00			-0.02	0.00	0.15	0.16	0.10	0.55						
28/05/2024 03:15			-0.02	0.00	0.15	0.16	0.10	0.54	0.03					
28/05/2024 03:30			-0.02	0.00	0.15	0.16	0.10	0.54	0.03					
28/05/2024 03:45			-0.02	0.00	0.15	0.16	0.10	0.54	0.02					
28/05/2024 04:00			-0.02	0.00	0.15	0.15	0.10	0.54	0.03					
28/05/2024 04:15			-0.02	0.00	0.15	0.15	0.10	0.54	0.04					
28/05/2024 04:30			-0.02	0.00	0.15	0.15	0.09	0.54						
28/05/2024 04:45			-0.02	0.00	0.15	0.15	0.09	0.54						
28/05/2024 05:00			-0.02	0.00	0.15	0.15	0.09	0.54						
28/05/2024 05:15			-0.03	0.00	0.15	0.15	0.09	0.54						
28/05/2024 05:30			-0.03	0.00	0.15	0.15	0.09	0.55						
28/05/2024 05:45			-0.03	0.00	0.15	0.15	0.09	0.55						
28/05/2024 06:00			-0.03	0.00	0.15	0.15	0.09	0.55						
28/05/2024 06:15			-0.03	0.00	0.15	0.15	0.09	0.54						
28/05/2024 06:30			-0.03	0.00	0.15	0.15	0.09	0.54						
28/05/2024 06:45			-0.03	0.00	0.15	0.15	0.09	0.54	0.03					
28/05/2024 07:00			-0.03	0.00	0.15	0.15	0.09	0.54						
28/05/2024 07:15			-0.03	0.00	0.15	0.15	0.09	0.55						
28/05/2024 07:30			-0.03	0.00	0.15	0.15	0.09	0.55	0.04					
28/05/2024 07:45			-0.03	0.00	0.15	0.15	0.09	0.55	0.03					
28/05/2024 08:00			-0.02	0.00	0.15	0.15	0.09	0.55	0.03					
28/05/2024 08:15			-0.02	0.00	0.15	0.15	0.09	0.55	0.04					
28/05/2024 08:30			-0.03	0.00	0.15	0.15	0.09	0.55	0.04					
28/05/2024 08:45			-0.03	0.00	0.15	0.15	0.09	0.55						
28/05/2024 09:00			-0.03	0.00	0.15	0.15	0.09	0.55						
28/05/2024 09:15			-0.03	0.00	0.15	0.15	0.09	0.55	0.05					
28/05/2024 09:30			-0.03	0.00	0.15	0.15	0.09	0.55	0.03					
28/05/2024 09:45			-0.03	0.00	0.15	0.15	0.09	0.55	0.03					
28/05/2024 10:00			-0.03	0.00	0.15	0.15	0.09	0.55	0.04					
28/05/2024 10:15			-0.03	0.00	0.15	0.15	0.09	0.55	0.06					
28/05/2024 10:30			-0.03	0.00	0.15	0.15	0.09	0.55	0.06					
28/05/2024 10:45			-0.02	0.00	0.15	0.15	0.09	0.55	0.04					
28/05/2024 11:00			-0.02	0.00	0.15	0.15	0.09	0.56	0.04					
28/05/2024 11:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
28/05/2024 11:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
28/05/2024 11:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
28/05/2024 12:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
28/05/2024 12:15			-0.03	0.00	0.15	0.16	0.10	0.57	0.06					
28/05/2024 12:30			-0.03	0.00	0.15	0.16	0.10	0.57	0.05					
28/05/2024 12:45			-0.03	0.00	0.15	0.16	0.10	0.57	0.05					
28/05/2024 13:00			-0.03	0.00	0.15	0.16	0.10	0.57	0.06					
28/05/2024 13:15			-0.03	0.00	0.15	0.16	0.10	0.57	0.05					
28/05/2024 13:30			-0.03	0.00	0.15	0.16	0.10	0.58	0.06					
28/05/2024 13:45			-0.03	0.00	0.16	0.16	0.10	0.58	0.05					
28/05/2024 14:00			-0.02	0.00	0.16	0.16	0.10	0.57	0.05					
28/05/2024 14:15			-0.03	0.00	0.16	0.16	0.10	0.57	0.06					
28/05/2024 14:30			-0.03	0.00	0.16	0.17	0.10	0.57	0.06					
28/05/2024 14:45			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
28/05/2024 15:00			-0.02	0.00	0.16	0.17	0.11	0.58	0.05					
28/05/2024 15:15			-0.03	0.00	0.16	0.17	0.11	0.58	0.07					
28/05/2024 15:30			-0.03	0.00	0.16	0.17	0.11	0.58	0.05					
28/05/2024 15:45			-0.03	0.00	0.16	0.17	0.11	0.58	0.06					
28/05/2024 16:00			-0.02	0.00	0.16	0.17	0.11	0.58	0.06					
28/05/2024 16:15			-0.02	0.00	0.16	0.17	0.11	0.58	0.05					
28/05/2024 16:30			-0.02	0.00	0.16	0.17	0.11	0.58	0.00					
28/05/2024 16:45			-0.02	0.00	0.17	0.17	0.11	0.58	0.06					
28/05/2024 17:00			-0.02	0.00	0.17	0.17	0.11	0.58	0.05					
28/05/2024 17:15			-0.02	0.00	0.17	0.17	0.11	0.58	0.06					
28/05/2024 17:30			-0.02	0.00	0.17	0.17	0.11	0.58						
28/05/2024 17:45			-0.02	0.00	0.17	0.17	0.11	0.58						
28/05/2024 18:00			-0.02	0.00	0.17	0.17	0.12	0.58	0.06					
28/05/2024 18:15			-0.02	0.00	0.17	0.17	0.12	0.58	0.05					
28/05/2024 18:30			-0.02	0.00	0.17	0.17	0.12	0.58						
28/05/2024 18:45			-0.02	0.00	0.17	0.17	0.12	0.58	0.05					
28/05/2024 19:00			-0.02	0.00	0.17	0.17	0.12	0.58	0.06					
28/05/2024 19:15			-0.02	0.00	0.17	0.17	0.12	0.58	0.06					
28/05/2024 19:30			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
28/05/2024 19:45			-0.02	0.00	0.17	0.17	0.12	0.58	0.06					
28/05/2024 20:00			-0.02	0.00	0.17	0.17	0.12	0.58	0.06					
28/05/2024 20:15			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
28/05/2024 20:30			-0.01	0.00	0.17	0.17	0.12	0.58	0.05					
28/05/2024 20:45			-0.02	0.00	0.17	0.17	0.12	0.58	0.06					
28/05/2024 21:00			-0.02	0.00	0.17	0.17	0.12	0.58	0.05					
28/05/2024 21:15			-0.02	0.00	0.17	0.17	0.12	0.58						
28/05/2024 21:30			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
28/05/2024 21:45			-0.02	0.00	0.17	0.18	0.12	0.58	0.06					
28/05/2024 22:00			-0.02	0.00	0.17	0.18	0.12	0.58	0.06					
28/05/2024 22:15			-0.02	0.00	0.17	0.18	0.12	0.58	0.06					
28/05/2024 22:30			-0.02	0.00	0.17	0.18	0.12	0.58	0.06					
28/05/2024 22:45			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
28/05/2024 23:00			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
28/05/2024 23:15			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
28/05/2024 23:30			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
28/05/2024 23:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.04					
29/05/2024 00:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 00:15			-0.02	0.00	0.17	0.18	0.12	0.57	0.06					
29/05/2024 00:30			-0.02	0.00	0.17	0.17	0.12	0.57	0.05					
29/05/2024 00:45			-0.02	0.00	0.17	0.17	0.12	0.57	0.07					
29/05/2024 01:00			-0.02	0.00	0.17	0.17	0.12	0.57	0.06					
29/05/2024 01:15			-0.01	0.00	0.17	0.18	0.12	0.57	0.06					
29/05/2024 01:30			-0.01	0.00	0.17	0.18	0.12	0.57	0.08					
29/05/2024 01:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
29/05/2024 02:00			-0.02	0.00	0.17	0.18	0.12	0.58	0.06					
29/05/2024 02:15			-0.01	0.00	0.17	0.18	0.12	0.59	0.06					
29/05/2024 02:30			-0.01	0.00	0.17	0.18	0.12	0.59	0.06					
29/05/2024 02:45			-0.01	0.00	0.17	0.18	0.12	0.59						
29/05/2024 03:00			-0.01	0.00	0.17	0.18	0.12	0.59	0.05					
29/05/2024 03:15			-0.01	0.00	0.17	0.18	0.12	0.59	0.04					
29/05/2024 03:30			-0.01	0.00	0.17	0.18	0.12	0.59						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
29/05/2024 03:45			-0.01	0.00	0.17	0.18	0.12	0.59	0.06					
29/05/2024 04:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 04:15			-0.01	0.00	0.17	0.18	0.12	0.58						
29/05/2024 04:30			-0.01	0.00	0.17	0.18	0.12	0.58						
29/05/2024 04:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
29/05/2024 05:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 05:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 05:30			-0.01	0.00	0.17	0.18	0.12	0.58						
29/05/2024 05:45			-0.01	0.00	0.18	0.18	0.12	0.58	0.05					
29/05/2024 06:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.04					
29/05/2024 06:15			-0.02	0.00	0.18	0.18	0.12	0.58	0.05					
29/05/2024 06:30			-0.02	0.00	0.18	0.18	0.12	0.58						
29/05/2024 06:45			-0.01	0.00	0.18	0.18	0.12	0.58	0.05					
29/05/2024 07:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 07:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 07:30			-0.02	0.00	0.17	0.18	0.12	0.58	0.04					
29/05/2024 07:45			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 08:00			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 08:15			-0.02	0.00	0.17	0.18	0.12	0.58	0.04					
29/05/2024 08:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 08:45			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 09:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 09:15			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 09:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
29/05/2024 09:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 10:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
29/05/2024 10:15			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 10:30			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 10:45			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 11:00			-0.01	0.00	0.17	0.18	0.12	0.59	0.05					
29/05/2024 11:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 11:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 11:45			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 12:00			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 12:15			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 12:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 12:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
29/05/2024 13:00			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 13:15			-0.02	0.00	0.18	0.18	0.12	0.58	0.05					
29/05/2024 13:30			-0.02	0.00	0.18	0.18	0.12	0.58	0.05					
29/05/2024 13:45			-0.02	0.00	0.18	0.18	0.12	0.58	0.05					
29/05/2024 14:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.04					
29/05/2024 14:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 14:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 14:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 15:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 15:15			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 15:30			-0.02	0.00	0.17	0.18	0.12	0.57	0.06					
29/05/2024 15:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 16:00			-0.02	0.00	0.17	0.18	0.12	0.58						
29/05/2024 16:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 16:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.04					
29/05/2024 16:45			-0.01	0.00	0.17	0.18	0.12	0.57	0.06					
29/05/2024 17:00			-0.01	0.00	0.17	0.18	0.12	0.57	0.04					
29/05/2024 17:15			-0.01	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 17:30			-0.01	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 17:45			-0.01	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 18:00			-0.01	0.00	0.17	0.18	0.12	0.57	0.06					
29/05/2024 18:15			-0.01	0.00	0.17	0.18	0.12	0.57	0.06					
29/05/2024 18:30			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 18:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.06					
29/05/2024 19:00			-0.01	0.00	0.17	0.18	0.12	0.57	0.06					
29/05/2024 19:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
29/05/2024 19:30			-0.01	0.00	0.17	0.18	0.12	0.57						
29/05/2024 19:45			-0.01	0.00	0.17	0.18	0.12	0.57						
29/05/2024 20:00			-0.01	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 20:15			-0.01	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 20:30			-0.01	0.00	0.17	0.18	0.12	0.57	0.04					
29/05/2024 20:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 21:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 21:15			-0.02	0.00	0.17	0.18	0.12	0.57	0.04					
29/05/2024 21:30			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 21:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 22:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 22:15			-0.02	0.00	0.17	0.18	0.12	0.58						
29/05/2024 22:30			-0.02	0.00	0.17	0.18	0.12	0.58	0.07					
29/05/2024 22:45			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
29/05/2024 23:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
29/05/2024 23:15			-0.02	0.00	0.17	0.18	0.12	0.57						
29/05/2024 23:30			-0.02	0.00	0.17	0.17	0.12	0.57	0.06					
29/05/2024 23:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.00					
30/05/2024 00:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
30/05/2024 00:15			-0.02	0.00	0.17	0.18	0.12	0.57	0.04					
30/05/2024 00:30			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
30/05/2024 00:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.06					
30/05/2024 01:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.04					
30/05/2024 01:15			-0.02	0.00	0.17	0.17	0.11	0.57	0.03					
30/05/2024 01:30			-0.02	0.00	0.17	0.17	0.11	0.57	0.05					
30/05/2024 01:45			-0.02	0.00	0.17	0.17	0.11	0.56	0.05					
30/05/2024 02:00			-0.02	0.00	0.17	0.17	0.11	0.56	0.04					
30/05/2024 02:15			-0.02	0.00	0.17	0.17	0.11	0.56	0.05					
30/05/2024 02:30			-0.02	0.00	0.17	0.17	0.11	0.56	0.04					
30/05/2024 02:45			-0.02	0.00	0.17	0.17	0.11	0.56	0.05					
30/05/2024 03:00			-0.02	0.00	0.17	0.17	0.11	0.56	0.05					
30/05/2024 03:15			-0.02	0.00	0.17	0.17	0.11	0.56	0.05					
30/05/2024 03:30			-0.02	0.00	0.17	0.17	0.11	0.56	0.05					
30/05/2024 03:45			-0.02	0.00	0.17	0.17	0.11	0.56	0.04					
30/05/2024 04:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 04:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
30/05/2024 04:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
30/05/2024 04:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 05:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
30/05/2024 05:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 05:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 05:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 06:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 06:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 06:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 06:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 07:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
30/05/2024 07:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 07:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 07:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.00					
30/05/2024 08:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 08:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
30/05/2024 08:30			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 08:45			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 09:00			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 09:15			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 09:30			-0.02	0.00	0.16	0.17	0.11	0.57	0.04					
30/05/2024 09:45			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 10:00			-0.02	0.00	0.16	0.17	0.11	0.57	0.03					
30/05/2024 10:15			-0.02	0.00	0.16	0.17	0.11	0.57	0.04					
30/05/2024 10:30			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 10:45			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 11:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
30/05/2024 11:15			-0.03	0.00	0.16	0.17	0.11	0.56	0.06					
30/05/2024 11:30			-0.03	0.00	0.16	0.17	0.11	0.56						
30/05/2024 11:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 12:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 12:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 12:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
30/05/2024 12:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 13:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 13:15			-0.01	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 13:30			-0.01	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 13:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 14:00			-0.01	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 14:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 14:30			-0.02	0.00	0.16	0.17	0.11	0.56						
30/05/2024 14:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 15:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 15:15			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 15:30			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 15:45			-0.02	0.00	0.16	0.17	0.11	0.57	0.04					
30/05/2024 16:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 16:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
30/05/2024 16:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 16:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.02					
30/05/2024 17:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
30/05/2024 17:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 17:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
30/05/2024 17:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
30/05/2024 18:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 18:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 18:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
30/05/2024 18:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
30/05/2024 19:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 19:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
30/05/2024 19:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 19:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 20:00			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 20:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 20:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 20:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 21:00			-0.02	0.00	0.16	0.17	0.11	0.57	0.06					
30/05/2024 21:15			-0.02	0.00	0.16	0.17	0.11	0.57	0.06					
30/05/2024 21:30			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 21:45			-0.02	0.00	0.16	0.17	0.11	0.57	0.06					
30/05/2024 22:00			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 22:15			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
30/05/2024 22:30			-0.02	0.00	0.16	0.17	0.11	0.57	0.07					
30/05/2024 22:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 23:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
30/05/2024 23:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
30/05/2024 23:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
30/05/2024 23:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
31/05/2024 00:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
31/05/2024 00:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
31/05/2024 00:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
31/05/2024 00:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
31/05/2024 01:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
31/05/2024 01:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
31/05/2024 01:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
31/05/2024 01:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
31/05/2024 02:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
31/05/2024 02:15			-0.02	0.00	0.16	0.17	0.11	0.55	0.05					
31/05/2024 02:30			-0.02	0.00	0.16	0.17	0.11	0.55	0.04					
31/05/2024 02:45			-0.02	0.00	0.16	0.17	0.11	0.55	0.05					
31/05/2024 03:00			-0.02	0.00	0.16	0.17	0.11	0.55	0.04					
31/05/2024 03:15			-0.02	0.00	0.16	0.17	0.11	0.55	0.05					
31/05/2024 03:30			-0.02	0.00	0.16	0.17	0.11	0.55	0.04					
31/05/2024 03:45			-0.02	0.00	0.16	0.17	0.11	0.55	0.03					
31/05/2024 04:00			-0.02	0.00	0.16	0.17	0.11	0.55	0.05					
31/05/2024 04:15			-0.02	0.00	0.16	0.17	0.11	0.55	0.04					
31/05/2024 04:30			-0.02	0.00	0.16	0.17	0.11	0.55	0.05					
31/05/2024 04:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
31/05/2024 05:00			-0.02	0.00	0.16	0.17	0.11	0.57	0.06					
31/05/2024 05:15			-0.02	0.00	0.16	0.17	0.11	0.58	0.06					
31/05/2024 05:30			-0.02	0.00	0.16	0.17	0.11	0.58	0.07					
31/05/2024 05:45			-0.02	0.00	0.16	0.17	0.11	0.59	0.06					
31/05/2024 06:00			-0.02	0.00	0.16	0.17	0.11	0.59	0.06					
31/05/2024 06:15			-0.02	0.00	0.16	0.17	0.11	0.59	0.06					
31/05/2024 06:30			-0.02	0.00	0.16	0.17	0.11	0.58	0.05					
31/05/2024 06:45			-0.02	0.00	0.16	0.17	0.11	0.58	0.05					
31/05/2024 07:00			-0.02	0.00	0.17	0.17	0.11	0.58	0.06					
31/05/2024 07:15			-0.02	0.00	0.17	0.17	0.11	0.58	0.06					
31/05/2024 07:30			-0.02	0.00	0.17	0.17	0.11	0.58	0.06					
31/05/2024 07:45			-0.02	0.00	0.17	0.18	0.11	0.58	0.05					
31/05/2024 08:00			-0.02	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 08:15			-0.02	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 08:30			-0.02	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 08:45			-0.02	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 09:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 09:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 09:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 09:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 10:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 10:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 10:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
31/05/2024 10:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 11:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 11:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 11:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 11:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 12:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 12:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 12:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 12:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 13:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 13:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 13:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 13:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 14:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 14:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 14:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 14:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 15:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 15:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 15:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 15:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 16:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 16:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 16:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 16:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 17:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 17:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.04					
31/05/2024 17:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 17:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 18:00			-0.01	0.00	0.17	0.18	0.12	0.57	0.06					
31/05/2024 18:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 18:30			-0.01	0.00	0.17	0.18	0.12	0.57	0.07					
31/05/2024 18:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 19:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 19:15			-0.01	0.00	0.17	0.18	0.12	0.57	0.04					
31/05/2024 19:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 19:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.05					
31/05/2024 20:00			-0.01	0.00	0.17	0.18	0.12	0.57	0.07					
31/05/2024 20:15			-0.01	0.00	0.17	0.18	0.12	0.57	0.06					
31/05/2024 20:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 20:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 21:00			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 21:15			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 21:30			-0.01	0.00	0.17	0.18	0.12	0.58	0.07					
31/05/2024 21:45			-0.01	0.00	0.17	0.18	0.12	0.58	0.06					
31/05/2024 22:00			-0.01	0.00	0.17	0.18	0.12	0.57	0.05					
31/05/2024 22:15			-0.01	0.00	0.17	0.18	0.12	0.57						
31/05/2024 22:30			-0.01	0.00	0.17	0.18	0.12	0.57						
31/05/2024 22:45			-0.01	0.00	0.17	0.18	0.12	0.57						
31/05/2024 23:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.06					
31/05/2024 23:15			-0.01	0.00	0.17	0.18	0.12	0.57	0.05					
31/05/2024 23:30			-0.02	0.00	0.17	0.18	0.12	0.57	0.06					
31/05/2024 23:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.06					
01/06/2024 00:00			-0.02	0.00	0.17	0.18	0.12	0.57						
01/06/2024 00:15			-0.01	0.00	0.17	0.18	0.12	0.57	0.05					
01/06/2024 00:30			-0.01	0.00	0.17	0.18	0.12	0.57	0.06					
01/06/2024 00:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.06					
01/06/2024 01:00			-0.01	0.00	0.17	0.18	0.12	0.57						
01/06/2024 01:15			-0.02	0.00	0.17	0.18	0.12	0.57						
01/06/2024 01:30			-0.01	0.00	0.17	0.18	0.12	0.57						
01/06/2024 01:45			-0.01	0.00	0.17	0.18	0.11	0.57	0.05					
01/06/2024 02:00			-0.02	0.00	0.17	0.18	0.11	0.57	0.06					
01/06/2024 02:15			-0.02	0.00	0.17	0.18	0.11	0.56	0.06					
01/06/2024 02:30			-0.02	0.00	0.17	0.18	0.11	0.56	0.06					
01/06/2024 02:45			-0.02	0.00	0.17	0.18	0.11	0.56	0.05					
01/06/2024 03:00			-0.02	0.00	0.17	0.17	0.11	0.56	0.06					
01/06/2024 03:15			-0.02	0.00	0.17	0.17	0.11	0.56	0.05					
01/06/2024 03:30			-0.02	0.00	0.17	0.17	0.11	0.56	0.06					
01/06/2024 03:45			-0.02	0.00	0.17	0.17	0.11	0.56	0.05					
01/06/2024 04:00			-0.02	0.00	0.17	0.17	0.11	0.56	0.07					
01/06/2024 04:15			-0.02	0.00	0.17	0.17	0.11	0.56	0.05					
01/06/2024 04:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 04:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 05:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 05:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 05:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 05:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 06:00			-0.01	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 06:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
01/06/2024 06:30			-0.01	0.00	0.16	0.17	0.11	0.56						
01/06/2024 06:45			-0.02	0.00	0.16	0.17	0.11	0.56						
01/06/2024 07:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 07:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 07:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 07:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 08:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 08:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 08:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 08:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 09:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 09:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 09:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 09:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 10:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 10:15			-0.02	0.00	0.16	0.17	0.11	0.57	0.06					
01/06/2024 10:30			-0.02	0.00	0.16	0.17	0.11	0.57	0.07					
01/06/2024 10:45			-0.02	0.00	0.16	0.17	0.11	0.57	0.07					
01/06/2024 11:00			-0.02	0.00	0.16	0.17	0.11	0.57	0.06					
01/06/2024 11:15			-0.02	0.00	0.16	0.17	0.11	0.57	0.06					
01/06/2024 11:30			-0.02	0.00	0.16	0.17	0.11	0.57	0.06					
01/06/2024 11:45			-0.02	0.00	0.16	0.17	0.11	0.57	0.06					
01/06/2024 12:00			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
01/06/2024 12:15			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
01/06/2024 12:30			-0.02	0.00	0.16	0.17	0.11	0.57	0.05					
01/06/2024 12:45			-0.01	0.00	0.16	0.17	0.11	0.57	0.07					
01/06/2024 13:00			-0.02	0.00	0.16	0.17	0.11	0.57	0.07					
01/06/2024 13:15			-0.02	0.00	0.16	0.17	0.11	0.57	0.04					
01/06/2024 13:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 13:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 14:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
01/06/2024 14:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 14:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 14:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 15:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 15:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.07					
01/06/2024 15:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 15:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 16:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.03					
01/06/2024 16:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 16:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 16:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 17:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
01/06/2024 17:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 17:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
01/06/2024 17:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 18:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.07					
01/06/2024 18:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 18:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 18:45			-0.02	0.00	0.16	0.17	0.10	0.56	0.07					
01/06/2024 19:00			-0.02	0.00	0.16	0.17	0.11	0.57	0.06					
01/06/2024 19:15			-0.02	0.00	0.16	0.17	0.10	0.56	0.07					
01/06/2024 19:30			-0.02	0.00	0.16	0.17	0.10	0.56	0.06					
01/06/2024 19:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 20:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 20:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 20:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.07					
01/06/2024 20:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.06					
01/06/2024 21:00			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 21:15			-0.02	0.00	0.16	0.17	0.11	0.56	0.04					
01/06/2024 21:30			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 21:45			-0.02	0.00	0.16	0.17	0.11	0.56	0.05					
01/06/2024 22:00			-0.02	0.00	0.16	0.17	0.10	0.56	0.06					
01/06/2024 22:15			-0.02	0.00	0.16	0.17	0.10	0.56	0.07					
01/06/2024 22:30			-0.02	0.00	0.16	0.17	0.10	0.56	0.04					
01/06/2024 22:45			-0.02	0.00	0.16	0.17	0.10	0.56	0.06					
01/06/2024 23:00			-0.02	0.00	0.16	0.17	0.10	0.56	0.06					
01/06/2024 23:15			-0.02	0.00	0.16	0.17	0.10	0.56	0.05					
01/06/2024 23:30			-0.02	0.00	0.16	0.17	0.10	0.56						
01/06/2024 23:45			-0.02	0.00	0.16	0.17	0.10	0.56	0.06					
02/06/2024 00:00			-0.02	0.00	0.16	0.17	0.10	0.56						
02/06/2024 00:15			-0.02	0.00	0.16	0.17	0.10	0.56	0.05					
02/06/2024 00:30			-0.02	0.00	0.16	0.17	0.10	0.56	0.07					
02/06/2024 00:45			-0.02	0.00	0.16	0.17	0.10	0.56						
02/06/2024 01:00			-0.02	0.00	0.16	0.17	0.10	0.56	0.06					
02/06/2024 01:15			-0.02	0.00	0.16	0.17	0.10	0.56						
02/06/2024 01:30			-0.02	0.00	0.16	0.17	0.10	0.56						
02/06/2024 01:45			-0.02	0.00	0.16	0.17	0.10	0.56						
02/06/2024 02:00			-0.02	0.00	0.16	0.17	0.10	0.55						
02/06/2024 02:15			-0.02	0.00	0.16	0.17	0.10	0.55						
02/06/2024 02:30			-0.02	0.00	0.16	0.17	0.10	0.55						
02/06/2024 02:45			-0.02	0.00	0.16	0.17	0.10	0.55	0.05					
02/06/2024 03:00			-0.02	0.00	0.16	0.17	0.10	0.55						
02/06/2024 03:15			-0.02	0.00	0.16	0.17	0.10	0.55						
02/06/2024 03:30			-0.02	0.00	0.16	0.17	0.10	0.55	0.05					
02/06/2024 03:45			-0.02	0.00	0.15	0.16	0.10	0.55						
02/06/2024 04:00			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
02/06/2024 04:15			-0.02	0.00	0.15	0.16	0.10	0.55						
02/06/2024 04:30			-0.02	0.00	0.15	0.16	0.10	0.55						
02/06/2024 04:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
02/06/2024 05:00			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
02/06/2024 05:15			-0.02	0.00	0.15	0.16	0.10	0.55						
02/06/2024 05:30			-0.02	0.00	0.15	0.16	0.10	0.55						
02/06/2024 05:45			-0.02	0.00	0.15	0.16	0.10	0.54	0.06					
02/06/2024 06:00			-0.02	0.00	0.15	0.16	0.10	0.54						
02/06/2024 06:15			-0.02	0.00	0.15	0.16	0.10	0.54						
02/06/2024 06:30			-0.02	0.00	0.15	0.16	0.10	0.54						
02/06/2024 06:45			-0.02	0.00	0.15	0.16	0.10	0.54						
02/06/2024 07:00			-0.02	0.00	0.15	0.16	0.10	0.54						
02/06/2024 07:15			-0.02	0.00	0.15	0.16	0.10	0.54	0.05					
02/06/2024 07:30			-0.03	0.00	0.15	0.16	0.10	0.54	0.05					
02/06/2024 07:45			-0.03	0.00	0.15	0.16	0.10	0.54						
02/06/2024 08:00			-0.03	0.00	0.15	0.16	0.10	0.54						
02/06/2024 08:15			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
02/06/2024 08:30			-0.02	0.00	0.15	0.16	0.10	0.55	0.05					
02/06/2024 08:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
02/06/2024 09:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.05					
02/06/2024 09:15			-0.02	0.00	0.15	0.16	0.09	0.55	0.06					
02/06/2024 09:30			-0.02	0.00	0.15	0.16	0.09	0.55	0.06					
02/06/2024 09:45			-0.02	0.00	0.15	0.16	0.09	0.56	0.06					
02/06/2024 10:00			-0.03	0.00	0.15	0.16	0.09	0.56	0.06					
02/06/2024 10:15			-0.03	0.00	0.15	0.16	0.09	0.56	0.05					
02/06/2024 10:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
02/06/2024 10:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 11:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.07					
02/06/2024 11:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
02/06/2024 11:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 11:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.04					
02/06/2024 12:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
02/06/2024 12:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.07					
02/06/2024 12:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
02/06/2024 12:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
02/06/2024 13:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.04					
02/06/2024 13:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.04					
02/06/2024 13:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
02/06/2024 13:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 14:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
02/06/2024 14:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.04					
02/06/2024 14:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.04					
02/06/2024 14:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
02/06/2024 15:00			-0.02	0.00	0.15	0.16	0.10	0.55	0.05					
02/06/2024 15:15			-0.02	0.00	0.15	0.16	0.10	0.55	0.05					
02/06/2024 15:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.03					
02/06/2024 15:45			-0.03	0.00	0.15	0.16	0.10	0.55	0.04					
02/06/2024 16:00			-0.03	0.00	0.15	0.16	0.10	0.56						
02/06/2024 16:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 16:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 16:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 17:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 17:15			-0.02	0.00	0.15	0.16	0.10	0.56						
02/06/2024 17:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
02/06/2024 17:45			-0.02	0.00	0.15	0.16	0.10	0.56						
02/06/2024 18:00			-0.02	0.00	0.15	0.16	0.10	0.56						
02/06/2024 18:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
02/06/2024 18:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 18:45			-0.02	0.00	0.15	0.16	0.10	0.56						
02/06/2024 19:00			-0.02	0.00	0.15	0.16	0.10	0.56						
02/06/2024 19:15			-0.02	0.00	0.15	0.16	0.10	0.56						
02/06/2024 19:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 19:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
02/06/2024 20:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
02/06/2024 20:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.03					
02/06/2024 20:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
02/06/2024 20:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
02/06/2024 21:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 21:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
02/06/2024 21:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 21:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
02/06/2024 22:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 22:15			-0.02	0.00	0.15	0.16	0.10	0.56						
02/06/2024 22:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 22:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 23:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
02/06/2024 23:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
02/06/2024 23:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
02/06/2024 23:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
03/06/2024 00:00			-0.02	0.00	0.15	0.16	0.10	0.56						
03/06/2024 00:15			-0.02	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 00:30			-0.02	0.00	0.15	0.16	0.10	0.55						
03/06/2024 00:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 01:00			-0.02	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 01:15			-0.02	0.00	0.15	0.16	0.10	0.55						
03/06/2024 01:30			-0.02	0.00	0.15	0.16	0.10	0.55						
03/06/2024 01:45			-0.02	0.00	0.15	0.16	0.10	0.55						
03/06/2024 02:00			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
03/06/2024 02:15			-0.03	0.00	0.15	0.16	0.10	0.55						
03/06/2024 02:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 02:45			-0.02	0.00	0.15	0.16	0.10	0.55						
03/06/2024 03:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 03:15			-0.03	0.00	0.15	0.16	0.10	0.54	0.07					
03/06/2024 03:30			-0.02	0.00	0.15	0.16	0.10	0.54	0.00					
03/06/2024 03:45			-0.02	0.00	0.15	0.16	0.10	0.54						
03/06/2024 04:00			-0.02	0.00	0.15	0.16	0.10	0.54	0.06					
03/06/2024 04:15			-0.02	0.00	0.15	0.16	0.10	0.54						
03/06/2024 04:30			-0.02	0.00	0.15	0.16	0.10	0.54	0.06					
03/06/2024 04:45			-0.03	0.00	0.15	0.16	0.10	0.54						
03/06/2024 05:00			-0.03	0.00	0.15	0.16	0.10	0.54	0.05					
03/06/2024 05:15			-0.03	0.00	0.15	0.16	0.10	0.54	0.04					
03/06/2024 05:30			-0.03	0.00	0.15	0.16	0.10	0.54						
03/06/2024 05:45			-0.03	0.00	0.15	0.16	0.10	0.54	0.04					
03/06/2024 06:00			-0.03	0.00	0.15	0.16	0.09	0.54	0.04					
03/06/2024 06:15			-0.03	0.00	0.15	0.16	0.09	0.54	0.04					
03/06/2024 06:30			-0.03	0.00	0.15	0.16	0.09	0.54	0.06					
03/06/2024 06:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.06					
03/06/2024 07:00			-0.03	0.00	0.15	0.16	0.09	0.55						
03/06/2024 07:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.00					
03/06/2024 07:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
03/06/2024 07:45			-0.03	0.00	0.15	0.16	0.09	0.55						
03/06/2024 08:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
03/06/2024 08:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
03/06/2024 08:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
03/06/2024 08:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
03/06/2024 09:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
03/06/2024 09:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
03/06/2024 09:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.06					
03/06/2024 09:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
03/06/2024 10:00			-0.02	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 10:15			-0.02	0.00	0.15	0.16	0.10	0.55	0.05					
03/06/2024 10:30			-0.02	0.00	0.15	0.16	0.10	0.55	0.08					
03/06/2024 10:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.00					
03/06/2024 11:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
03/06/2024 11:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
03/06/2024 11:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
03/06/2024 11:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
03/06/2024 12:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.04					
03/06/2024 12:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.07					
03/06/2024 12:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
03/06/2024 12:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
03/06/2024 13:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.07					
03/06/2024 13:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.07					
03/06/2024 13:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 13:45			-0.03	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 14:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 14:15			-0.03	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 14:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 14:45			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
03/06/2024 15:00			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
03/06/2024 15:15			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
03/06/2024 15:30			-0.02	0.00	0.15	0.16	0.10	0.55						
03/06/2024 15:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.05					
03/06/2024 16:00			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
03/06/2024 16:15			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
03/06/2024 16:30			-0.02	0.00	0.15	0.16	0.10	0.55	0.05					
03/06/2024 16:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.04					
03/06/2024 17:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
03/06/2024 17:15			-0.03	0.00	0.15	0.16	0.10	0.55	0.05					
03/06/2024 17:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 17:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.04					
03/06/2024 18:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
03/06/2024 18:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.07					
03/06/2024 18:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
03/06/2024 18:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
03/06/2024 19:00			-0.02	0.00	0.15	0.16	0.10	0.56						
03/06/2024 19:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
03/06/2024 19:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
03/06/2024 19:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
03/06/2024 20:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
03/06/2024 20:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
03/06/2024 20:30			-0.02	0.00	0.15	0.16	0.10	0.56						
03/06/2024 20:45			-0.02	0.00	0.15	0.16	0.10	0.56						
03/06/2024 21:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
03/06/2024 21:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
03/06/2024 21:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
03/06/2024 21:45			-0.02	0.00	0.15	0.16	0.10	0.56						
03/06/2024 22:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
03/06/2024 22:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
03/06/2024 22:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
03/06/2024 22:45			-0.02	0.00	0.15	0.16	0.10	0.56						
03/06/2024 23:00			-0.02	0.00	0.15	0.16	0.10	0.56						
03/06/2024 23:15			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
03/06/2024 23:30			-0.02	0.00	0.15	0.16	0.10	0.55	0.07					
03/06/2024 23:45			-0.03	0.00	0.15	0.16	0.10	0.55						
04/06/2024 00:00			-0.03	0.00	0.15	0.16	0.10	0.55						
04/06/2024 00:15			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
04/06/2024 00:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
04/06/2024 00:45			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
04/06/2024 01:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.07					
04/06/2024 01:15			-0.03	0.00	0.15	0.16	0.10	0.55						
04/06/2024 01:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.05					
04/06/2024 01:45			-0.03	0.00	0.15	0.16	0.10	0.55						
04/06/2024 02:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
04/06/2024 02:15			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
04/06/2024 02:30			-0.03	0.00	0.15	0.16	0.10	0.55						
04/06/2024 02:45			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
04/06/2024 03:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.05					
04/06/2024 03:15			-0.03	0.00	0.15	0.16	0.10	0.55	0.05					
04/06/2024 03:30			-0.03	0.00	0.15	0.16	0.10	0.55						
04/06/2024 03:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.05					
04/06/2024 04:00			-0.02	0.00	0.15	0.16	0.10	0.55	0.06					
04/06/2024 04:15			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
04/06/2024 04:30			-0.02	0.00	0.15	0.16	0.10	0.54	0.04					
04/06/2024 04:45			-0.02	0.00	0.15	0.16	0.10	0.54	0.04					
04/06/2024 05:00			-0.02	0.00	0.15	0.16	0.10	0.54						
04/06/2024 05:15			-0.03	0.00	0.15	0.16	0.10	0.54	0.06					
04/06/2024 05:30			-0.03	0.00	0.15	0.16	0.10	0.54	0.07					
04/06/2024 05:45			-0.03	0.00	0.15	0.16	0.10	0.54	0.05					
04/06/2024 06:00			-0.03	0.00	0.15	0.16	0.10	0.54	0.04					
04/06/2024 06:15			-0.03	0.00	0.15	0.16	0.10	0.54	0.04					
04/06/2024 06:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.04					
04/06/2024 06:45			-0.03	0.00	0.15	0.16	0.10	0.55	0.04					
04/06/2024 07:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.07					
04/06/2024 07:15			-0.03	0.00	0.15	0.16	0.10	0.55	0.06					
04/06/2024 07:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.05					
04/06/2024 07:45			-0.03	0.00	0.15	0.16	0.10	0.55	0.04					
04/06/2024 08:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.05					
04/06/2024 08:15			-0.03	0.00	0.15	0.16	0.10	0.56						
04/06/2024 08:30			-0.03	0.00	0.15	0.16	0.10	0.56						
04/06/2024 08:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 09:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 09:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.08					
04/06/2024 09:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.08					
04/06/2024 09:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
04/06/2024 10:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 10:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 10:30			-0.03	0.00	0.15	0.17	0.10	0.56	0.06					
04/06/2024 10:45			-0.03	0.00	0.15	0.17	0.10	0.56	0.07					
04/06/2024 11:00			-0.03	0.00	0.15	0.17	0.10	0.56	0.04					
04/06/2024 11:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
04/06/2024 11:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.07					
04/06/2024 11:45			-0.03	0.00	0.15	0.17	0.10	0.56	0.05					
04/06/2024 12:00			-0.03	0.00	0.15	0.17	0.10	0.56	0.06					
04/06/2024 12:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 12:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
04/06/2024 12:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 13:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.04					
04/06/2024 13:15			-0.03	0.00	0.15	0.17	0.10	0.55	0.04					
04/06/2024 13:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.05					
04/06/2024 13:45			-0.03	0.00	0.15	0.16	0.10	0.55	0.03					
04/06/2024 14:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.05					
04/06/2024 14:15			-0.03	0.00	0.15	0.16	0.10	0.55	0.04					
04/06/2024 14:30			-0.03	0.00	0.15	0.16	0.10	0.55	0.05					
04/06/2024 14:45			-0.03	0.00	0.15	0.16	0.10	0.55	0.04					
04/06/2024 15:00			-0.03	0.00	0.15	0.16	0.10	0.55	0.04					
04/06/2024 15:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 15:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
04/06/2024 15:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 16:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
04/06/2024 16:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 16:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
04/06/2024 16:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
04/06/2024 17:00			-0.03	0.00	0.15	0.16	0.10	0.56						
04/06/2024 17:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.04					
04/06/2024 17:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.04					
04/06/2024 17:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
04/06/2024 18:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
04/06/2024 18:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 18:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 18:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
04/06/2024 19:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
04/06/2024 19:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 19:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.07					
04/06/2024 19:45			-0.02	0.00	0.15	0.16	0.10	0.56	0.05					
04/06/2024 20:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
04/06/2024 20:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.06					
04/06/2024 20:30			-0.02	0.00	0.16	0.16	0.10	0.56	0.06					
04/06/2024 20:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.03					
04/06/2024 21:00			-0.02	0.00	0.16	0.16	0.10	0.56	0.03					
04/06/2024 21:15			-0.02	0.00	0.16	0.16	0.10	0.56	0.03					
04/06/2024 21:30			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
04/06/2024 21:45			-0.02	0.00	0.16	0.16	0.10	0.56						
04/06/2024 22:00			-0.02	0.00	0.16	0.16	0.10	0.57						
04/06/2024 22:15			-0.02	0.00	0.16	0.16	0.10	0.56						
04/06/2024 22:30			-0.02	0.00	0.16	0.16	0.10	0.57						
04/06/2024 22:45			-0.03	0.00	0.16	0.17	0.10	0.57						
04/06/2024 23:00			-0.02	0.00	0.16	0.17	0.10	0.56						
04/06/2024 23:15			-0.02	0.00	0.16	0.17	0.10	0.56	0.03					
04/06/2024 23:30			-0.02	0.00	0.16	0.17	0.10	0.56						
04/06/2024 23:45			-0.02	0.00	0.16	0.17	0.10	0.56						
05/06/2024 00:00			-0.02	0.00	0.16	0.17	0.10	0.56						
05/06/2024 00:15			-0.02	0.00	0.16	0.17	0.10	0.56	0.03					
05/06/2024 00:30			-0.02	0.00	0.16	0.17	0.10	0.56						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
05/06/2024 00:45			-0.02	0.00	0.16	0.17	0.10	0.56						
05/06/2024 01:00			-0.02	0.00	0.16	0.17	0.10	0.56						
05/06/2024 01:15			-0.02	0.00	0.16	0.17	0.10	0.56						
05/06/2024 01:30			-0.02	0.00	0.16	0.17	0.10	0.56						
05/06/2024 01:45			-0.02	0.00	0.16	0.16	0.10	0.56	0.04					
05/06/2024 02:00			-0.02	0.00	0.16	0.16	0.10	0.55						
05/06/2024 02:15			-0.02	0.00	0.16	0.16	0.10	0.55	0.00					
05/06/2024 02:30			-0.02	0.00	0.16	0.16	0.10	0.55						
05/06/2024 02:45			-0.02	0.00	0.15	0.16	0.10	0.55	0.05					
05/06/2024 03:00			-0.02	0.00	0.15	0.16	0.10	0.55	0.05					
05/06/2024 03:15			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 03:30			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 03:45			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 04:00			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 04:15			-0.02	0.00	0.15	0.16	0.10	0.55	0.04					
05/06/2024 04:30			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 04:45			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 05:00			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 05:15			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 05:30			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 05:45			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 06:00			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 06:15			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 06:30			-0.03	0.00	0.15	0.16	0.10	0.55						
05/06/2024 06:45			-0.03	0.00	0.15	0.16	0.10	0.55	0.03					
05/06/2024 07:00			-0.03	0.00	0.15	0.16	0.10	0.55						
05/06/2024 07:15			-0.03	0.00	0.15	0.16	0.10	0.55						
05/06/2024 07:30			-0.03	0.00	0.15	0.16	0.10	0.55						
05/06/2024 07:45			-0.03	0.00	0.15	0.16	0.10	0.55						
05/06/2024 08:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
05/06/2024 08:15			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 08:30			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 08:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
05/06/2024 09:00			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 09:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
05/06/2024 09:30			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 09:45			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 10:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
05/06/2024 10:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
05/06/2024 10:30			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 10:45			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 11:00			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 11:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
05/06/2024 11:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.02					
05/06/2024 11:45			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 12:00			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 12:15			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 12:30			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 12:45			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 13:00			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 13:15			-0.02	0.00	0.15	0.16	0.10	0.56	0.03					
05/06/2024 13:30			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 13:45			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 14:00			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 14:15			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 14:30			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 14:45			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 15:00			-0.03	0.00	0.15	0.16	0.10	0.55						
05/06/2024 15:15			-0.03	0.00	0.15	0.16	0.10	0.55						
05/06/2024 15:30			-0.03	0.00	0.15	0.16	0.10	0.55						
05/06/2024 15:45			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 16:00			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 16:15			-0.02	0.00	0.15	0.16	0.10	0.55	0.03					
05/06/2024 16:30			-0.02	0.00	0.15	0.16	0.10	0.55	0.04					
05/06/2024 16:45			-0.03	0.00	0.15	0.16	0.10	0.55						
05/06/2024 17:00			-0.03	0.00	0.15	0.16	0.10	0.55						
05/06/2024 17:15			-0.03	0.00	0.15	0.16	0.10	0.55	0.03					
05/06/2024 17:30			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 17:45			-0.02	0.00	0.15	0.16	0.10	0.55						
05/06/2024 18:00			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 18:15			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 18:30			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 18:45			-0.02	0.00	0.15	0.16	0.09	0.56						
05/06/2024 19:00			-0.02	0.00	0.15	0.16	0.09	0.56						
05/06/2024 19:15			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 19:30			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 19:45			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 20:00			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 20:15			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 20:30			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 20:45			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 21:00			-0.02	0.00	0.15	0.16	0.10	0.56	0.03					
05/06/2024 21:15			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 21:30			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 21:45			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 22:00			-0.02	0.00	0.15	0.16	0.10	0.56						
05/06/2024 22:15			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 22:30			-0.02	0.00	0.15	0.16	0.10	0.56	0.04					
05/06/2024 22:45			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 23:00			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 23:15			-0.03	0.00	0.15	0.16	0.10	0.56						
05/06/2024 23:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.05					
05/06/2024 23:45			-0.03	0.00	0.15	0.16	0.10	0.56						
06/06/2024 00:00			-0.03	0.00	0.15	0.16	0.10	0.56						
06/06/2024 00:15			-0.03	0.00	0.15	0.16	0.10	0.56						
06/06/2024 00:30			-0.03	0.00	0.15	0.16	0.10	0.56						
06/06/2024 00:45			-0.03	0.00	0.15	0.16	0.10	0.55						
06/06/2024 01:00			-0.03	0.00	0.15	0.16	0.10	0.55						
06/06/2024 01:15			-0.03	0.00	0.15	0.16	0.10	0.55						
06/06/2024 01:30			-0.03	0.00	0.15	0.16	0.10	0.55						
06/06/2024 01:45			-0.02	0.00	0.15	0.16	0.10	0.55						
06/06/2024 02:00			-0.03	0.00	0.15	0.16	0.10	0.55						
06/06/2024 02:15			-0.03	0.00	0.15	0.16	0.10	0.55						
06/06/2024 02:30			-0.03	0.00	0.15	0.16	0.10	0.55						
06/06/2024 02:45			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 03:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
06/06/2024 03:15			-0.02	0.00	0.15	0.16	0.09	0.55	0.04					
06/06/2024 03:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.03					
06/06/2024 03:45			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 04:00			-0.03	0.00	0.15	0.16	0.09	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
06/06/2024 04:15			-0.03	0.00	0.15	0.16	0.09	0.54						
06/06/2024 04:30			-0.03	0.00	0.15	0.16	0.09	0.54						
06/06/2024 04:45			-0.03	0.00	0.15	0.16	0.09	0.54	0.04					
06/06/2024 05:00			-0.03	0.00	0.15	0.16	0.09	0.54	0.04					
06/06/2024 05:15			-0.03	0.00	0.15	0.16	0.09	0.54						
06/06/2024 05:30			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 05:45			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 06:00			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 06:15			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 06:30			-0.03	0.00	0.14	0.16	0.09	0.55						
06/06/2024 06:45			-0.03	0.00	0.14	0.16	0.09	0.55						
06/06/2024 07:00			-0.03	0.00	0.14	0.16	0.09	0.55						
06/06/2024 07:15			-0.03	0.00	0.14	0.16	0.09	0.55						
06/06/2024 07:30			-0.03	0.00	0.14	0.16	0.09	0.55	0.03					
06/06/2024 07:45			-0.03	0.00	0.14	0.16	0.09	0.55	0.03					
06/06/2024 08:00			-0.03	0.00	0.14	0.16	0.09	0.55						
06/06/2024 08:15			-0.03	0.00	0.14	0.16	0.09	0.55	0.03					
06/06/2024 08:30			-0.03	0.00	0.14	0.16	0.09	0.55	0.04					
06/06/2024 08:45			-0.03	0.00	0.14	0.16	0.09	0.55	0.04					
06/06/2024 09:00			-0.03	0.00	0.14	0.16	0.09	0.55						
06/06/2024 09:15			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 09:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.00					
06/06/2024 09:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
06/06/2024 10:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.05					
06/06/2024 10:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
06/06/2024 10:30			-0.02	0.00	0.15	0.16	0.09	0.55	0.05					
06/06/2024 10:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
06/06/2024 11:00			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 11:15			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 11:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.06					
06/06/2024 11:45			-0.02	0.00	0.15	0.16	0.09	0.55						
06/06/2024 12:00			-0.03	0.00	0.15	0.16	0.09	0.56	0.06					
06/06/2024 12:15			-0.03	0.00	0.15	0.16	0.09	0.56						
06/06/2024 12:30			-0.03	0.00	0.15	0.16	0.09	0.56	0.05					
06/06/2024 12:45			-0.02	0.00	0.15	0.16	0.09	0.56	0.05					
06/06/2024 13:00			-0.03	0.00	0.15	0.16	0.09	0.56						
06/06/2024 13:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.01					
06/06/2024 13:30			-0.02	0.00	0.15	0.16	0.09	0.55						
06/06/2024 13:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.08					
06/06/2024 14:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.06					
06/06/2024 14:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
06/06/2024 14:30			-0.02	0.00	0.15	0.16	0.09	0.55	0.04					
06/06/2024 14:45			-0.02	0.00	0.15	0.16	0.09	0.55	0.03					
06/06/2024 15:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
06/06/2024 15:15			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 15:30			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 15:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
06/06/2024 16:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
06/06/2024 16:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
06/06/2024 16:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
06/06/2024 16:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
06/06/2024 17:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.03					
06/06/2024 17:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
06/06/2024 17:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.03					
06/06/2024 17:45			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 18:00			-0.02	0.00	0.15	0.16	0.09	0.55						
06/06/2024 18:15			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 18:30			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 18:45			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 19:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.02					
06/06/2024 19:15			-0.03	0.00	0.15	0.16	0.09	0.56						
06/06/2024 19:30			-0.02	0.00	0.15	0.16	0.09	0.56	0.05					
06/06/2024 19:45			-0.02	0.00	0.15	0.16	0.09	0.56	0.05					
06/06/2024 20:00			-0.02	0.00	0.15	0.16	0.09	0.56						
06/06/2024 20:15			-0.02	0.00	0.15	0.16	0.09	0.56						
06/06/2024 20:30			-0.02	0.00	0.15	0.16	0.09	0.56						
06/06/2024 20:45			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 21:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.07					
06/06/2024 21:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
06/06/2024 21:30			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 21:45			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 22:00			-0.03	0.00	0.15	0.16	0.09	0.55						
06/06/2024 22:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
06/06/2024 22:30			-0.03	0.00	0.15	0.16	0.09	0.56						
06/06/2024 22:45			-0.03	0.00	0.15	0.16	0.09	0.56	0.07					
06/06/2024 23:00			-0.03	0.00	0.15	0.16	0.09	0.56						
06/06/2024 23:15			-0.03	0.00	0.15	0.16	0.09	0.56						
06/06/2024 23:30			-0.03	0.00	0.15	0.16	0.09	0.56						
06/06/2024 23:45			-0.03	0.00	0.15	0.16	0.09	0.56						
07/06/2024 00:00			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 00:15			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 00:30			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 00:45			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 01:00			-0.02	0.00	0.15	0.16	0.09	0.55						
07/06/2024 01:15			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 01:30			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 01:45			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 02:00			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 02:15			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 02:30			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 02:45			-0.03	0.00	0.15	0.16	0.09	0.54	0.04					
07/06/2024 03:00			-0.03	0.00	0.15	0.16	0.09	0.54						
07/06/2024 03:15			-0.03	0.00	0.15	0.16	0.09	0.54	0.05					
07/06/2024 03:30			-0.03	0.00	0.15	0.16	0.09	0.54						
07/06/2024 03:45			-0.03	0.00	0.15	0.16	0.09	0.54	0.03					
07/06/2024 04:00			-0.03	0.00	0.15	0.16	0.09	0.54						
07/06/2024 04:15			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 04:30			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 04:45			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 05:00			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 05:15			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 05:30			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 05:45			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 06:00			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 06:15			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 06:30			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 06:45			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 07:00			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 07:15			-0.03	0.00	0.14	0.16	0.09	0.54						
07/06/2024 07:30			-0.03	0.00	0.14	0.16	0.09	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
07/06/2024 07:45			-0.03	0.00	0.14	0.15	0.09	0.55						
07/06/2024 08:00			-0.03	0.00	0.14	0.15	0.09	0.55						
07/06/2024 08:15			-0.03	0.00	0.14	0.15	0.09	0.55	0.03					
07/06/2024 08:30			-0.03	0.00	0.14	0.15	0.09	0.55	0.04					
07/06/2024 08:45			-0.03	0.00	0.14	0.15	0.09	0.55	0.06					
07/06/2024 09:00			-0.03	0.00	0.14	0.15	0.09	0.56	0.04					
07/06/2024 09:15			-0.03	0.00	0.14	0.15	0.09	0.56	0.05					
07/06/2024 09:30			-0.03	0.00	0.14	0.16	0.09	0.56	0.07					
07/06/2024 09:45			-0.03	0.00	0.14	0.16	0.09	0.56	0.09					
07/06/2024 10:00			-0.03	0.00	0.14	0.16	0.09	0.55	0.00					
07/06/2024 10:15			-0.03	0.00	0.14	0.16	0.09	0.55	0.04					
07/06/2024 10:30			-0.03	0.00	0.14	0.16	0.09	0.55	0.05					
07/06/2024 10:45			-0.03	0.00	0.14	0.16	0.09	0.55	0.01					
07/06/2024 11:00			-0.03	0.00	0.14	0.16	0.09	0.55	0.01					
07/06/2024 11:15			-0.03	0.00	0.14	0.16	0.09	0.55	0.05					
07/06/2024 11:30			-0.03	0.00	0.14	0.16	0.09	0.55						
07/06/2024 11:45			-0.03	0.00	0.14	0.16	0.09	0.55	0.05					
07/06/2024 12:00			-0.03	0.00	0.14	0.16	0.09	0.55						
07/06/2024 12:15			-0.03	0.00	0.14	0.16	0.09	0.55	0.04					
07/06/2024 12:30			-0.03	0.00	0.14	0.16	0.09	0.55	0.08					
07/06/2024 12:45			-0.03	0.00	0.14	0.16	0.09	0.55						
07/06/2024 13:00			-0.03	0.00	0.14	0.16	0.09	0.55						
07/06/2024 13:15			-0.03	0.00	0.14	0.16	0.09	0.55	0.05					
07/06/2024 13:30			-0.03	0.00	0.14	0.16	0.09	0.55	0.05					
07/06/2024 13:45			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 14:00			-0.03	0.00	0.14	0.16	0.09	0.55	0.02					
07/06/2024 14:15			-0.03	0.00	0.14	0.16	0.09	0.55						
07/06/2024 14:30			-0.03	0.00	0.14	0.16	0.09	0.55	0.05					
07/06/2024 14:45			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 15:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.06					
07/06/2024 15:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.03					
07/06/2024 15:30			-0.03	0.00	0.14	0.16	0.09	0.55	0.04					
07/06/2024 15:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
07/06/2024 16:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.03					
07/06/2024 16:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
07/06/2024 16:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.03					
07/06/2024 16:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
07/06/2024 17:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.03					
07/06/2024 17:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.03					
07/06/2024 17:30			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 17:45			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 18:00			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 18:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
07/06/2024 18:30			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 18:45			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 19:00			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 19:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
07/06/2024 19:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.05					
07/06/2024 19:45			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 20:00			-0.03	0.00	0.15	0.16	0.09	0.56						
07/06/2024 20:15			-0.03	0.00	0.15	0.16	0.09	0.56						
07/06/2024 20:30			-0.03	0.00	0.15	0.16	0.09	0.56						
07/06/2024 20:45			-0.03	0.00	0.15	0.16	0.09	0.56						
07/06/2024 21:00			-0.03	0.00	0.15	0.16	0.09	0.56						
07/06/2024 21:15			-0.03	0.00	0.15	0.16	0.09	0.56						
07/06/2024 21:30			-0.03	0.00	0.15	0.16	0.09	0.56	0.04					
07/06/2024 21:45			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 22:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.04					
07/06/2024 22:15			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 22:30			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 22:45			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 23:00			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 23:15			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 23:30			-0.03	0.00	0.15	0.16	0.09	0.55						
07/06/2024 23:45			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 00:00			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 00:15			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 00:30			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 00:45			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 01:00			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 01:15			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 01:30			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 01:45			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 02:00			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 02:15			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 02:30			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 02:45			-0.03	0.00	0.15	0.16	0.09	0.54						
08/06/2024 03:00			-0.03	0.00	0.15	0.16	0.09	0.54						
08/06/2024 03:15			-0.03	0.00	0.15	0.16	0.09	0.54						
08/06/2024 03:30			-0.03	0.00	0.15	0.16	0.09	0.54						
08/06/2024 03:45			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 04:00			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 04:15			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 04:30			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 04:45			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 05:00			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 05:15			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 05:30			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 05:45			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 06:00			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 06:15			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 06:30			-0.04	0.00	0.14	0.16	0.09	0.55						
08/06/2024 06:45			-0.03	0.00	0.14	0.16	0.09	0.55						
08/06/2024 07:00			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 07:15			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 07:30			-0.03	0.00	0.14	0.16	0.09	0.54						
08/06/2024 07:45			-0.03	0.00	0.14	0.16	0.09	0.55						
08/06/2024 08:00			-0.03	0.00	0.14	0.16	0.09	0.55						
08/06/2024 08:15			-0.03	0.00	0.14	0.16	0.09	0.55						
08/06/2024 08:30			-0.03	0.00	0.14	0.16	0.09	0.55						
08/06/2024 08:45			-0.03	0.00	0.14	0.16	0.09	0.55						
08/06/2024 09:00			-0.03	0.00	0.14	0.16	0.09	0.55	0.14					
08/06/2024 09:15			-0.03	0.00	0.14	0.16	0.09	0.55	0.11					
08/06/2024 09:30			-0.03	0.00	0.14	0.16	0.09	0.55	0.07					
08/06/2024 09:45			-0.03	0.00	0.14	0.16	0.09	0.55	0.13					
08/06/2024 10:00			-0.03	0.00	0.14	0.16	0.09	0.55	0.12					
08/06/2024 10:15			-0.03	0.00	0.14	0.16	0.09	0.55						
08/06/2024 10:30			-0.03	0.00	0.14	0.16	0.09	0.55						
08/06/2024 10:45			-0.03	0.00	0.14	0.16	0.09	0.55						
08/06/2024 11:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
08/06/2024 11:15			-0.03	0.00	0.14	0.16	0.09	0.56	0.07					
08/06/2024 11:30			-0.03	0.00	0.14	0.16	0.09	0.56						
08/06/2024 11:45			-0.03	0.00	0.14	0.16	0.09	0.56	0.06					
08/06/2024 12:00			-0.03	0.00	0.14	0.16	0.09	0.56	0.01					
08/06/2024 12:15			-0.03	0.00	0.14	0.16	0.09	0.56	0.03					
08/06/2024 12:30			-0.02	0.00	0.14	0.16	0.09	0.56	0.02					
08/06/2024 12:45			-0.02	0.00	0.14	0.16	0.09	0.56						
08/06/2024 13:00			-0.03	0.00	0.14	0.16	0.09	0.56						
08/06/2024 13:15			-0.03	0.00	0.15	0.16	0.09	0.56						
08/06/2024 13:30			-0.03	0.00	0.15	0.16	0.09	0.56						
08/06/2024 13:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.09					
08/06/2024 14:00			-0.04	0.00	0.15	0.16	0.09	0.55	0.11					
08/06/2024 14:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.09					
08/06/2024 14:30			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 14:45			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 15:00			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 15:15			-0.03	0.00	0.15	0.16	0.09	0.55	0.20					
08/06/2024 15:30			-0.03	0.00	0.15	0.16	0.09	0.55	0.28					
08/06/2024 15:45			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 16:00			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 16:15			-0.02	0.00	0.15	0.16	0.09	0.55	0.00					
08/06/2024 16:30			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 16:45			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 17:00			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 17:15			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 17:30			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 17:45			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 18:00			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 18:15			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 18:30			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 18:45			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 19:00			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 19:15			-0.03	0.00	0.15	0.16	0.09	0.56						
08/06/2024 19:30			-0.03	0.00	0.15	0.16	0.09	0.56						
08/06/2024 19:45			-0.02	0.00	0.15	0.16	0.09	0.56						
08/06/2024 20:00			-0.02	0.00	0.15	0.16	0.09	0.56						
08/06/2024 20:15			-0.02	0.00	0.15	0.16	0.09	0.56						
08/06/2024 20:30			-0.02	0.00	0.15	0.16	0.09	0.56						
08/06/2024 20:45			-0.02	0.00	0.15	0.16	0.09	0.56						
08/06/2024 21:00			-0.02	0.00	0.15	0.16	0.09	0.55						
08/06/2024 21:15			-0.02	0.00	0.15	0.16	0.09	0.55						
08/06/2024 21:30			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 21:45			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 22:00			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 22:15			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 22:30			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 22:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.19					
08/06/2024 23:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.65					
08/06/2024 23:15			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 23:30			-0.03	0.00	0.15	0.16	0.09	0.55						
08/06/2024 23:45			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 00:00			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 00:15			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 00:30			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 00:45			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 01:00			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 01:15			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 01:30			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 01:45			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 02:00			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 02:15			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 02:30			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 02:45			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 03:00			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 03:15			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 03:30			-0.03	0.00	0.14	0.16	0.09	0.54						
09/06/2024 03:45			-0.03	0.00	0.14	0.16	0.09	0.54						
09/06/2024 04:00			-0.03	0.00	0.14	0.16	0.09	0.54						
09/06/2024 04:15			-0.03	0.00	0.14	0.16	0.09	0.54						
09/06/2024 04:30			-0.03	0.00	0.14	0.16	0.09	0.54						
09/06/2024 04:45			-0.03	0.00	0.14	0.16	0.09	0.54						
09/06/2024 05:00			-0.03	0.00	0.14	0.16	0.09	0.54						
09/06/2024 05:15			-0.03	0.00	0.14	0.16	0.09	0.54						
09/06/2024 05:30			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 05:45			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 06:00			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 06:15			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 06:30			-0.04	0.00	0.14	0.16	0.09	0.55						
09/06/2024 06:45			-0.04	0.00	0.14	0.16	0.09	0.54						
09/06/2024 07:00			-0.04	0.00	0.14	0.16	0.09	0.54	0.19					
09/06/2024 07:15			-0.04	0.00	0.14	0.16	0.09	0.54						
09/06/2024 07:30			-0.04	0.00	0.14	0.16	0.09	0.54						
09/06/2024 07:45			-0.03	0.00	0.14	0.16	0.09	0.54						
09/06/2024 08:00			-0.03	0.00	0.14	0.16	0.09	0.55	0.08					
09/06/2024 08:15			-0.03	0.00	0.14	0.16	0.09	0.55	0.09					
09/06/2024 08:30			-0.03	0.00	0.14	0.16	0.09	0.55	0.10					
09/06/2024 08:45			-0.03	0.00	0.14	0.16	0.09	0.55	0.12					
09/06/2024 09:00			-0.03	0.00	0.14	0.16	0.09	0.55	0.08					
09/06/2024 09:15			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 09:30			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 09:45			-0.03	0.00	0.14	0.16	0.09	0.55	0.07					
09/06/2024 10:00			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 10:15			-0.03	0.00	0.14	0.16	0.09	0.55	0.14					
09/06/2024 10:30			-0.03	0.00	0.14	0.16	0.09	0.55	0.01					
09/06/2024 10:45			-0.03	0.00	0.14	0.16	0.09	0.55	0.09					
09/06/2024 11:00			-0.03	0.00	0.14	0.16	0.09	0.56	0.11					
09/06/2024 11:15			-0.03	0.00	0.14	0.16	0.09	0.56	0.13					
09/06/2024 11:30			-0.04	0.00	0.14	0.16	0.09	0.56	0.05					
09/06/2024 11:45			-0.03	0.00	0.14	0.16	0.09	0.56						
09/06/2024 12:00			-0.03	0.00	0.14	0.16	0.09	0.56	0.00					
09/06/2024 12:15			-0.03	0.00	0.14	0.16	0.09	0.56						
09/06/2024 12:30			-0.03	0.00	0.14	0.16	0.09	0.56						
09/06/2024 12:45			-0.03	0.00	0.14	0.16	0.09	0.56						
09/06/2024 13:00			-0.03	0.00	0.14	0.16	0.09	0.56						
09/06/2024 13:15			-0.03	0.00	0.14	0.16	0.09	0.55						
09/06/2024 13:30			-0.03	0.00	0.14	0.16	0.09	0.56						
09/06/2024 13:45			-0.03	0.00	0.14	0.16	0.09	0.56	0.13					
09/06/2024 14:00			-0.03	0.00	0.14	0.16	0.09	0.56						
09/06/2024 14:15			-0.03	0.00	0.14	0.16	0.09	0.56						
09/06/2024 14:30			-0.03	0.00	0.14	0.16	0.09	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
09/06/2024 14:45			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 15:00			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 15:15			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 15:30			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 15:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.02					
09/06/2024 16:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.02					
09/06/2024 16:15			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 16:30			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 16:45			-0.03	0.00	0.15	0.16	0.09	0.55	0.03					
09/06/2024 17:00			-0.03	0.00	0.15	0.16	0.09	0.55	0.02					
09/06/2024 17:15			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 17:30			-0.03	0.00	0.15	0.16	0.09	0.55						
09/06/2024 17:45			-0.03	0.00	0.15	0.16	0.09	0.56						
09/06/2024 18:00			-0.03	0.00	0.15	0.16	0.09	0.56						
09/06/2024 18:15			-0.03	0.00	0.15	0.16	0.09	0.56	0.03					
09/06/2024 18:30			-0.03	0.00	0.15	0.16	0.09	0.56	0.03					
09/06/2024 18:45			-0.03	0.00	0.15	0.16	0.09	0.56	0.09					
09/06/2024 19:00			-0.03	0.00	0.15	0.16	0.09	0.56	0.00					
09/06/2024 19:15			-0.03	0.00	0.15	0.16	0.09	0.56						
09/06/2024 19:30			-0.03	0.00	0.15	0.16	0.09	0.56						
09/06/2024 19:45			-0.03	0.00	0.15	0.16	0.09	0.56						
09/06/2024 20:00			-0.03	0.00	0.15	0.16	0.09	0.56						
09/06/2024 20:15			-0.03	0.00	0.15	0.16	0.09	0.56	0.04					
09/06/2024 20:30			-0.03	0.00	0.15	0.16	0.09	0.56	0.03					
09/06/2024 20:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
09/06/2024 21:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
09/06/2024 21:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
09/06/2024 21:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
09/06/2024 21:45			-0.03	0.00	0.15	0.16	0.10	0.56						
09/06/2024 22:00			-0.03	0.00	0.15	0.16	0.10	0.56						
09/06/2024 22:15			-0.03	0.00	0.15	0.16	0.10	0.55						
09/06/2024 22:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
09/06/2024 22:45			-0.03	0.00	0.15	0.16	0.10	0.56						
09/06/2024 23:00			-0.03	0.00	0.15	0.16	0.10	0.56						
09/06/2024 23:15			-0.03	0.00	0.15	0.16	0.10	0.56						
09/06/2024 23:30			-0.03	0.00	0.15	0.16	0.10	0.56						
09/06/2024 23:45			-0.03	0.00	0.15	0.16	0.10	0.56	0.04					
10/06/2024 00:00			-0.03	0.00	0.15	0.16	0.10	0.56	0.03					
10/06/2024 00:15			-0.03	0.00	0.15	0.16	0.10	0.56	0.02					
10/06/2024 00:30			-0.03	0.00	0.15	0.16	0.10	0.56	0.02					
10/06/2024 00:45			-0.03	0.00	0.15	0.16	0.10	0.55						
10/06/2024 01:00			-0.03	0.00	0.15	0.16	0.10	0.55						
10/06/2024 01:15			-0.03	0.00	0.15	0.16	0.10	0.55						
10/06/2024 01:30			-0.03	0.00	0.15	0.17	0.10	0.55						
10/06/2024 01:45			-0.03	0.00	0.15	0.17	0.10	0.55						
10/06/2024 02:00			-0.03	0.00	0.15	0.17	0.10	0.55	0.03					
10/06/2024 02:15			-0.03	0.00	0.15	0.17	0.10	0.55	0.04					
10/06/2024 02:30			-0.03	0.00	0.15	0.17	0.10	0.55	0.07					
10/06/2024 02:45			-0.03	0.00	0.15	0.17	0.10	0.55						
10/06/2024 03:00			-0.03	0.00	0.15	0.17	0.10	0.55	0.04					
10/06/2024 03:15			-0.03	0.00	0.15	0.17	0.10	0.55	0.04					
10/06/2024 03:30			-0.03	0.00	0.15	0.17	0.10	0.56	0.04					
10/06/2024 03:45			-0.03	0.00	0.16	0.17	0.10	0.57	0.04					
10/06/2024 04:00			-0.03	0.00	0.16	0.17	0.10	0.58	0.06					
10/06/2024 04:15			-0.03	0.00	0.16	0.17	0.10	0.59	0.06					
10/06/2024 04:30			-0.03	0.00	0.16	0.17	0.10	0.59	0.06					
10/06/2024 04:45			-0.03	0.00	0.16	0.17	0.10	0.59	0.04					
10/06/2024 05:00			-0.03	0.00	0.16	0.17	0.11	0.59	0.05					
10/06/2024 05:15			-0.03	0.00	0.16	0.17	0.11	0.59	0.04					
10/06/2024 05:30			-0.02	0.00	0.16	0.18	0.11	0.59	0.05					
10/06/2024 05:45			-0.02	0.00	0.16	0.18	0.11	0.59	0.05					
10/06/2024 06:00			-0.02	0.00	0.17	0.18	0.11	0.59	0.05					
10/06/2024 06:15			-0.02	0.00	0.17	0.18	0.11	0.59	0.05					
10/06/2024 06:30			-0.02	0.00	0.17	0.18	0.11	0.60	0.06					
10/06/2024 06:45			-0.02	0.00	0.17	0.18	0.12	0.59	0.04					
10/06/2024 07:00			-0.02	0.00	0.17	0.18	0.12	0.59	0.04					
10/06/2024 07:15			-0.02	0.00	0.17	0.18	0.12	0.59	0.06					
10/06/2024 07:30			-0.02	0.00	0.17	0.18	0.12	0.59	0.05					
10/06/2024 07:45			-0.02	0.00	0.17	0.19	0.12	0.59	0.04					
10/06/2024 08:00			-0.01	0.00	0.17	0.19	0.12	0.59	0.04					
10/06/2024 08:15			-0.01	0.00	0.17	0.19	0.12	0.59	0.05					
10/06/2024 08:30			-0.01	0.00	0.18	0.19	0.12	0.59	0.05					
10/06/2024 08:45			-0.01	0.00	0.18	0.19	0.12	0.59	0.06					
10/06/2024 09:00			-0.01	0.00	0.18	0.19	0.12	0.59	0.05					
10/06/2024 09:15			-0.01	0.00	0.18	0.19	0.13	0.59	0.04					
10/06/2024 09:30			-0.01	0.00	0.18	0.19	0.13	0.59	0.05					
10/06/2024 09:45			-0.01	0.00	0.18	0.19	0.13	0.59	0.05					
10/06/2024 10:00			-0.01	0.00	0.18	0.19	0.13	0.60	0.06					
10/06/2024 10:15			-0.01	0.00	0.18	0.19	0.13	0.60	0.05					
10/06/2024 10:30			-0.01	0.00	0.18	0.19	0.13	0.61	0.05					
10/06/2024 10:45			-0.01	0.00	0.18	0.19	0.13	0.61	0.05					
10/06/2024 11:00			-0.01	0.00	0.18	0.19	0.13	0.61	0.04					
10/06/2024 11:15			-0.01	0.00	0.19	0.19	0.13	0.61	0.04					
10/06/2024 11:30			-0.01	0.00	0.19	0.20	0.13	0.61	0.04					
10/06/2024 11:45			-0.01	0.00	0.19	0.20	0.13	0.61	0.05					
10/06/2024 12:00			-0.01	0.00	0.19	0.20	0.14	0.61	0.05					
10/06/2024 12:15			0.00	0.00	0.19	0.20	0.14	0.61	0.04					
10/06/2024 12:30			-0.01	0.00	0.19	0.20	0.14	0.61	0.04					
10/06/2024 12:45			-0.01	0.00	0.20	0.20	0.14	0.61	0.05					
10/06/2024 13:00			0.00	0.00	0.20	0.20	0.15	0.61	0.05					
10/06/2024 13:15			0.00	0.00	0.20	0.21	0.15	0.61	0.05					
10/06/2024 13:30			-0.01	0.00	0.20	0.21	0.15	0.61	0.06					
10/06/2024 13:45			0.00	0.00	0.20	0.21	0.15	0.62	0.06					
10/06/2024 14:00			0.00	0.00	0.20	0.21	0.15	0.62	0.05					
10/06/2024 14:15			0.00	0.00	0.20	0.21	0.15	0.62	0.06					
10/06/2024 14:30			0.00	0.00	0.20	0.21	0.15	0.62	0.20					
10/06/2024 14:45			0.01	0.00	0.20	0.21	0.15	0.62	0.56					
10/06/2024 15:00			0.00	0.00	0.20	0.21	0.15	0.62	0.05					
10/06/2024 15:15			0.01	0.00	0.20	0.21	0.15	0.62						
10/06/2024 15:30			0.01	0.00	0.20	0.21	0.15	0.62	0.05					
10/06/2024 15:45			0.00	0.00	0.20	0.21	0.15	0.62	0.05					
10/06/2024 16:00			0.01	0.00	0.21	0.21	0.16	0.62	0.06					
10/06/2024 16:15			0.01	0.00	0.21	0.21	0.16	0.62	0.06					
10/06/2024 16:30			0.00	0.00	0.21	0.21	0.16	0.62	0.06					
10/06/2024 16:45			0.01	0.00	0.21	0.21	0.16	0.62	0.05					
10/06/2024 17:00			0.00	0.00	0.21	0.21	0.16	0.62	0.05					
10/06/2024 17:15			0.01	0.00	0.21	0.21	0.16	0.62	0.05					
10/06/2024 17:30			0.00	0.00	0.21	0.21	0.16	0.61	0.05					
10/06/2024 17:45			0.01	0.00	0.21	0.21	0.16	0.61						
10/06/2024 18:00			0.00	0.00	0.21	0.21	0.16	0.61	0.04					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
10/06/2024 18:15			0.01	0.00	0.21	0.21	0.16	0.61	0.04					
10/06/2024 18:30			0.01	0.00	0.21	0.21	0.16	0.61	0.05					
10/06/2024 18:45			0.01	0.00	0.21	0.21	0.16	0.61	0.06					
10/06/2024 19:00			0.01	0.00	0.21	0.21	0.16	0.62	0.05					
10/06/2024 19:15			0.01	0.00	0.21	0.21	0.16	0.62	0.05					
10/06/2024 19:30			0.01	0.00	0.21	0.21	0.16	0.62	0.00					
10/06/2024 19:45			0.01	0.00	0.21	0.21	0.16	0.62	0.05					
10/06/2024 20:00			0.01	0.00	0.21	0.21	0.16	0.62	0.06					
10/06/2024 20:15			0.01	0.00	0.21	0.21	0.16	0.61	0.05					
10/06/2024 20:30			0.01	0.00	0.21	0.21	0.16	0.61	0.04					
10/06/2024 20:45			0.01	0.00	0.21	0.21	0.16	0.61	0.06					
10/06/2024 21:00			0.01	0.00	0.21	0.21	0.16	0.61	0.05					
10/06/2024 21:15			0.01	0.00	0.21	0.21	0.16	0.61	0.05					
10/06/2024 21:30			0.01	0.00	0.21	0.21	0.16	0.61	0.06					
10/06/2024 21:45			0.01	0.00	0.21	0.21	0.16	0.61						
10/06/2024 22:00			0.01	0.00	0.21	0.21	0.16	0.61	0.06					
10/06/2024 22:15			0.01	0.00	0.21	0.21	0.16	0.61	0.05					
10/06/2024 22:30			0.01	0.00	0.21	0.21	0.16	0.61	0.06					
10/06/2024 22:45			0.01	0.00	0.21	0.21	0.15	0.61	0.05					
10/06/2024 23:00			0.01	0.00	0.21	0.21	0.15	0.61	0.00					
10/06/2024 23:15			0.01	0.00	0.21	0.21	0.15	0.61	0.06					
10/06/2024 23:30			0.01	0.00	0.21	0.21	0.15	0.61	0.06					
10/06/2024 23:45			0.01	0.00	0.21	0.21	0.15	0.61	0.05					
11/06/2024 00:00			0.01	0.00	0.21	0.21	0.15	0.61	0.06					
11/06/2024 00:15			0.00	0.00	0.21	0.21	0.15	0.61	0.05					
11/06/2024 00:30			0.00	0.00	0.21	0.21	0.15	0.61						
11/06/2024 00:45			0.00	0.00	0.21	0.21	0.15	0.61	0.06					
11/06/2024 01:00			0.00	0.00	0.21	0.21	0.15	0.61	0.05					
11/06/2024 01:15			0.00	0.00	0.20	0.21	0.15	0.61	0.06					
11/06/2024 01:30			0.00	0.00	0.20	0.21	0.15	0.61	0.06					
11/06/2024 01:45			0.00	0.00	0.20	0.21	0.15	0.61	0.06					
11/06/2024 02:00			0.00	0.00	0.20	0.21	0.15	0.61						
11/06/2024 02:15			0.00	0.00	0.20	0.21	0.15	0.61	0.05					
11/06/2024 02:30			0.00	0.00	0.20	0.21	0.15	0.61	0.05					
11/06/2024 02:45			0.00	0.00	0.20	0.21	0.15	0.61						
11/06/2024 03:00			0.00	0.00	0.20	0.21	0.15	0.61	0.03					
11/06/2024 03:15			0.00	0.00	0.20	0.21	0.15	0.60						
11/06/2024 03:30			0.00	0.00	0.20	0.21	0.15	0.60	0.03					
11/06/2024 03:45			0.01	0.00	0.20	0.21	0.15	0.60	0.04					
11/06/2024 04:00			0.00	0.00	0.20	0.21	0.15	0.60						
11/06/2024 04:15			0.00	0.00	0.20	0.21	0.15	0.60	0.04					
11/06/2024 04:30			0.00	0.00	0.20	0.21	0.15	0.60						
11/06/2024 04:45			0.00	0.00	0.20	0.21	0.15	0.60						
11/06/2024 05:00			0.00	0.00	0.20	0.21	0.15	0.60						
11/06/2024 05:15			0.00	0.00	0.20	0.21	0.15	0.60						
11/06/2024 05:30			0.00	0.00	0.20	0.21	0.15	0.59						
11/06/2024 05:45			0.00	0.00	0.20	0.21	0.15	0.59						
11/06/2024 06:00			0.00	0.00	0.20	0.21	0.15	0.59						
11/06/2024 06:15			0.00	0.00	0.20	0.21	0.15	0.59						
11/06/2024 06:30			0.00	0.00	0.20	0.21	0.15	0.59						
11/06/2024 06:45			0.00	0.00	0.20	0.21	0.15	0.59						
11/06/2024 07:00			0.00	0.00	0.20	0.21	0.15	0.59						
11/06/2024 07:15			0.00	0.00	0.20	0.21	0.15	0.59	0.04					
11/06/2024 07:30			0.00	0.00	0.20	0.20	0.14	0.59						
11/06/2024 07:45			0.00	0.00	0.20	0.20	0.14	0.60						
11/06/2024 08:00			0.00	0.00	0.20	0.20	0.14	0.60						
11/06/2024 08:15			0.00	0.00	0.20	0.20	0.14	0.60	0.05					
11/06/2024 08:30			0.00	0.00	0.20	0.20	0.14	0.60						
11/06/2024 08:45			0.00	0.00	0.20	0.20	0.14	0.60	0.05					
11/06/2024 09:00			0.00	0.00	0.20	0.20	0.14	0.60	0.04					
11/06/2024 09:15			0.00	0.00	0.20	0.20	0.14	0.60	0.03					
11/06/2024 09:30			0.00	0.00	0.20	0.20	0.14	0.60						
11/06/2024 09:45			0.00	0.00	0.20	0.20	0.14	0.60	0.03					
11/06/2024 10:00			0.00	0.00	0.20	0.20	0.14	0.60	0.02					
11/06/2024 10:15			0.00	0.00	0.20	0.20	0.14	0.60	0.02					
11/06/2024 10:30			-0.01	0.00	0.20	0.20	0.14	0.60	0.04					
11/06/2024 10:45			0.00	0.00	0.20	0.20	0.14	0.59	0.04					
11/06/2024 11:00			0.00	0.00	0.20	0.20	0.14	0.59	0.04					
11/06/2024 11:15			-0.01	0.00	0.20	0.20	0.14	0.59	0.05					
11/06/2024 11:30			0.00	0.00	0.20	0.20	0.14	0.59	0.04					
11/06/2024 11:45			-0.01	0.00	0.20	0.20	0.14	0.59	0.03					
11/06/2024 12:00			-0.01	0.00	0.19	0.20	0.14	0.59	0.04					
11/06/2024 12:15			0.00	0.00	0.19	0.20	0.14	0.59	0.04					
11/06/2024 12:30			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 12:45			0.00	0.00	0.19	0.20	0.14	0.59	0.02					
11/06/2024 13:00			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 13:15			0.00	0.00	0.19	0.20	0.14	0.59	0.02					
11/06/2024 13:30			-0.01	0.00	0.19	0.20	0.14	0.59						
11/06/2024 13:45			0.00	0.00	0.19	0.20	0.14	0.59	0.04					
11/06/2024 14:00			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 14:15			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 14:30			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 14:45			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 15:00			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 15:15			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 15:30			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 15:45			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 16:00			-0.01	0.00	0.19	0.20	0.14	0.59						
11/06/2024 16:15			-0.01	0.00	0.19	0.20	0.14	0.58						
11/06/2024 16:30			0.00	0.00	0.19	0.20	0.14	0.58						
11/06/2024 16:45			0.00	0.00	0.19	0.20	0.14	0.58						
11/06/2024 17:00			0.00	0.00	0.19	0.20	0.14	0.58						
11/06/2024 17:15			-0.01	0.00	0.19	0.20	0.14	0.59						
11/06/2024 17:30			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 17:45			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 18:00			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 18:15			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 18:30			0.00	0.00	0.19	0.20	0.14	0.59	0.03					
11/06/2024 18:45			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 19:00			-0.01	0.00	0.19	0.20	0.14	0.59						
11/06/2024 19:15			-0.01	0.00	0.19	0.20	0.14	0.59						
11/06/2024 19:30			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 19:45			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 20:00			0.00	0.00	0.19	0.20	0.14	0.59						
11/06/2024 20:15			0.00	0.00	0.19	0.20	0.14	0.59	0.04					
11/06/2024 20:30			0.00	0.00	0.19	0.20	0.13	0.59	0.04					
11/06/2024 20:45			0.00	0.00	0.19	0.20	0.13	0.59						
11/06/2024 21:00			0.00	0.00	0.19	0.20	0.13	0.59						
11/06/2024 21:15			0.00	0.00	0.19	0.20	0.13	0.59						
11/06/2024 21:30			0.00	0.00	0.19	0.20	0.13	0.58						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
11/06/2024 21:45			-0.01	0.00	0.19	0.20	0.13	0.58						
11/06/2024 22:00			-0.01	0.00	0.19	0.20	0.13	0.58						
11/06/2024 22:15			-0.01	0.00	0.19	0.20	0.13	0.58						
11/06/2024 22:30			-0.01	0.00	0.19	0.20	0.13	0.58						
11/06/2024 22:45			-0.01	0.00	0.19	0.20	0.13	0.58						
11/06/2024 23:00			-0.01	0.00	0.19	0.20	0.13	0.58						
11/06/2024 23:15			-0.01	0.00	0.19	0.20	0.13	0.58						
11/06/2024 23:30			-0.01	0.00	0.19	0.20	0.13	0.58						
11/06/2024 23:45			-0.01	0.00	0.19	0.20	0.13	0.58						
12/06/2024 00:00			-0.01	0.00	0.19	0.20	0.13	0.58	0.04					
12/06/2024 00:15			-0.01	0.00	0.19	0.20	0.13	0.58						
12/06/2024 00:30			-0.01	0.00	0.19	0.20	0.13	0.58						
12/06/2024 00:45			-0.01	0.00	0.18	0.20	0.13	0.58						
12/06/2024 01:00			-0.01	0.00	0.18	0.19	0.13	0.58						
12/06/2024 01:15			-0.01	0.00	0.18	0.19	0.13	0.58						
12/06/2024 01:30			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 01:45			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 02:00			-0.01	0.00	0.18	0.19	0.13	0.58						
12/06/2024 02:15			-0.01	0.00	0.18	0.19	0.13	0.58						
12/06/2024 02:30			-0.01	0.00	0.18	0.19	0.13	0.58						
12/06/2024 02:45			-0.01	0.00	0.18	0.19	0.13	0.58						
12/06/2024 03:00			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 03:15			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 03:30			-0.01	0.00	0.18	0.19	0.13	0.57	0.02					
12/06/2024 03:45			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 04:00			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 04:15			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 04:30			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 04:45			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 05:00			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 05:15			-0.01	0.00	0.18	0.19	0.13	0.57						
12/06/2024 05:30			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 05:45			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 06:00			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 06:15			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 06:30			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 06:45			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 07:00			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 07:15			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 07:30			-0.01	0.00	0.18	0.19	0.12	0.57	0.07					
12/06/2024 07:45			-0.02	0.00	0.18	0.19	0.12	0.57	0.06					
12/06/2024 08:00			-0.02	0.00	0.18	0.19	0.12	0.57	0.04					
12/06/2024 08:15			-0.02	0.00	0.18	0.19	0.12	0.57	0.04					
12/06/2024 08:30			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 08:45			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 09:00			-0.01	0.00	0.17	0.19	0.12	0.57	0.04					
12/06/2024 09:15			-0.01	0.00	0.17	0.19	0.12	0.57	0.04					
12/06/2024 09:30			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 09:45			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 10:00			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 10:15			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 10:30			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 10:45			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 11:00			-0.02	0.00	0.18	0.19	0.12	0.57	0.03					
12/06/2024 11:15			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 11:30			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 11:45			-0.02	0.00	0.17	0.19	0.12	0.57	0.04					
12/06/2024 12:00			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 12:15			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 12:30			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 12:45			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 13:00			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 13:15			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 13:30			-0.02	0.00	0.17	0.19	0.12	0.57	0.04					
12/06/2024 13:45			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 14:00			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 14:15			-0.01	0.00	0.17	0.19	0.12	0.57	0.05					
12/06/2024 14:30			-0.01	0.00	0.17	0.19	0.12	0.57	0.05					
12/06/2024 14:45			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 15:00			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 15:15			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 15:30			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 15:45			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 16:00			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 16:15			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 16:30			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 16:45			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 17:00			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 17:15			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 17:30			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 17:45			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 18:00			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 18:15			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 18:30			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 18:45			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 19:00			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 19:15			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 19:30			-0.02	0.00	0.17	0.19	0.12	0.57						
12/06/2024 19:45			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 20:00			-0.01	0.00	0.17	0.19	0.12	0.57						
12/06/2024 20:15			-0.01	0.00	0.18	0.19	0.12	0.57	0.06					
12/06/2024 20:30			-0.01	0.00	0.17	0.19	0.12	0.58	0.05					
12/06/2024 20:45			-0.02	0.00	0.18	0.19	0.12	0.58						
12/06/2024 21:00			-0.02	0.00	0.18	0.19	0.12	0.57	0.05					
12/06/2024 21:15			-0.02	0.00	0.18	0.19	0.12	0.57	0.05					
12/06/2024 21:30			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 21:45			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 22:00			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 22:15			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 22:30			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 22:45			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 23:00			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 23:15			-0.01	0.00	0.18	0.19	0.12	0.57						
12/06/2024 23:30			-0.02	0.00	0.18	0.19	0.12	0.57						
12/06/2024 23:45			-0.02	0.00	0.18	0.19	0.12	0.57						
13/06/2024 00:00			-0.02	0.00	0.18	0.19	0.12	0.57						
13/06/2024 00:15			-0.02	0.00	0.18	0.19	0.12	0.57						
13/06/2024 00:30			-0.02	0.00	0.18	0.19	0.12	0.57						
13/06/2024 00:45			-0.02	0.00	0.18	0.19	0.12	0.57						
13/06/2024 01:00			-0.02	0.00	0.18	0.19	0.12	0.56						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
13/06/2024 01:15			-0.02	0.00	0.18	0.19	0.12	0.56						
13/06/2024 01:30			-0.02	0.00	0.18	0.19	0.12	0.56						
13/06/2024 01:45			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 02:00			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 02:15			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 02:30			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 02:45			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 03:00			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 03:15			-0.02	0.00	0.17	0.19	0.12	0.56	0.04					
13/06/2024 03:30			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 03:45			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 04:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.05					
13/06/2024 04:15			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 04:30			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 04:45			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 05:00			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 05:15			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 05:30			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 05:45			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 06:00			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 06:15			-0.02	0.00	0.17	0.19	0.12	0.54						
13/06/2024 06:30			-0.02	0.00	0.17	0.19	0.12	0.55						
13/06/2024 06:45			-0.02	0.00	0.17	0.19	0.12	0.56						
13/06/2024 07:00			-0.02	0.00	0.17	0.19	0.11	0.56						
13/06/2024 07:15			-0.02	0.00	0.17	0.19	0.11	0.56						
13/06/2024 07:30			-0.02	0.00	0.17	0.18	0.11	0.56						
13/06/2024 07:45			-0.02	0.00	0.17	0.18	0.11	0.56	0.07					
13/06/2024 08:00			-0.02	0.00	0.17	0.18	0.11	0.56						
13/06/2024 08:15			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 08:30			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 08:45			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 09:00			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 09:15			-0.02	0.00	0.17	0.18	0.11	0.57	0.07					
13/06/2024 09:30			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 09:45			-0.02	0.00	0.17	0.18	0.11	0.57	0.00					
13/06/2024 10:00			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 10:15			-0.02	0.00	0.17	0.18	0.11	0.57	0.06					
13/06/2024 10:30			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 10:45			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 11:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.04					
13/06/2024 11:15			-0.02	0.00	0.17	0.18	0.12	0.57	0.04					
13/06/2024 11:30			-0.02	0.00	0.17	0.18	0.12	0.56	0.05					
13/06/2024 11:45			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 12:00			-0.02	0.00	0.17	0.18	0.12	0.56	0.05					
13/06/2024 12:15			-0.02	0.00	0.17	0.18	0.11	0.56	0.06					
13/06/2024 12:30			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 12:45			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 13:00			-0.02	0.00	0.17	0.18	0.12	0.56	0.04					
13/06/2024 13:15			-0.02	0.00	0.17	0.19	0.12	0.56	0.04					
13/06/2024 13:30			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 13:45			-0.02	0.00	0.17	0.18	0.12	0.56	0.05					
13/06/2024 14:00			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 14:15			-0.02	0.00	0.17	0.19	0.12	0.56	0.33					
13/06/2024 14:30			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 14:45			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 15:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.00					
13/06/2024 15:15			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 15:30			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 15:45			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 16:00			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 16:15			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 16:30			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 16:45			-0.02	0.00	0.17	0.18	0.12	0.56	0.03					
13/06/2024 17:00			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 17:15			-0.02	0.00	0.17	0.18	0.12	0.56						
13/06/2024 17:30			-0.02	0.00	0.17	0.18	0.11	0.56						
13/06/2024 17:45			-0.02	0.00	0.17	0.18	0.11	0.56						
13/06/2024 18:00			-0.02	0.00	0.17	0.18	0.11	0.56						
13/06/2024 18:15			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 18:30			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 18:45			-0.02	0.00	0.17	0.18	0.11	0.57						
13/06/2024 19:00			-0.02	0.00	0.17	0.18	0.11	0.57	0.03					
13/06/2024 19:15			-0.02	0.00	0.17	0.18	0.11	0.57	0.04					
13/06/2024 19:30			-0.02	0.00	0.17	0.18	0.12	0.57	0.04					
13/06/2024 19:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.04					
13/06/2024 20:00			-0.02	0.00	0.17	0.18	0.12	0.57						
13/06/2024 20:15			-0.02	0.00	0.17	0.18	0.12	0.57	0.06					
13/06/2024 20:30			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
13/06/2024 20:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
13/06/2024 21:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.07					
13/06/2024 21:15			-0.02	0.00	0.17	0.18	0.12	0.57						
13/06/2024 21:30			-0.02	0.00	0.17	0.19	0.12	0.57						
13/06/2024 21:45			-0.02	0.00	0.17	0.19	0.12	0.57						
13/06/2024 22:00			-0.02	0.00	0.17	0.19	0.12	0.57						
13/06/2024 22:15			-0.02	0.00	0.17	0.19	0.12	0.57						
13/06/2024 22:30			-0.02	0.00	0.17	0.19	0.12	0.57	0.05					
13/06/2024 22:45			-0.02	0.00	0.17	0.19	0.12	0.57						
13/06/2024 23:00			-0.02	0.00	0.17	0.19	0.12	0.57						
13/06/2024 23:15			-0.02	0.00	0.17	0.19	0.12	0.57						
13/06/2024 23:30			-0.02	0.00	0.17	0.19	0.12	0.57						
13/06/2024 23:45			-0.02	0.00	0.17	0.19	0.12	0.57						
14/06/2024 00:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
14/06/2024 00:15			-0.02	0.00	0.17	0.19	0.12	0.57	0.06					
14/06/2024 00:30			-0.02	0.00	0.17	0.19	0.12	0.57						
14/06/2024 00:45			-0.02	0.00	0.17	0.19	0.12	0.56						
14/06/2024 01:00			-0.02	0.00	0.17	0.19	0.12	0.56						
14/06/2024 01:15			-0.02	0.00	0.17	0.19	0.12	0.56						
14/06/2024 01:30			-0.02	0.00	0.17	0.19	0.12	0.56						
14/06/2024 01:45			-0.02	0.00	0.17	0.19	0.12	0.56						
14/06/2024 02:00			-0.02	0.00	0.17	0.19	0.12	0.56						
14/06/2024 02:15			-0.02	0.00	0.17	0.19	0.12	0.56						
14/06/2024 02:30			-0.02	0.00	0.17	0.19	0.12	0.56						
14/06/2024 02:45			-0.02	0.00	0.17	0.19	0.12	0.56						
14/06/2024 03:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.06					
14/06/2024 03:15			-0.02	0.00	0.17	0.19	0.12	0.56	0.08					
14/06/2024 03:30			-0.02	0.00	0.17	0.19	0.12	0.56	0.06					
14/06/2024 03:45			-0.02	0.00	0.17	0.19	0.12	0.56	0.04					
14/06/2024 04:00			-0.02	0.00	0.17	0.19	0.12	0.56						
14/06/2024 04:15			-0.02	0.00	0.17	0.19	0.12	0.57						
14/06/2024 04:30			-0.02	0.00	0.17	0.19	0.12	0.58						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
14/06/2024 04:45			-0.02	0.00	0.17	0.19	0.12	0.58						
14/06/2024 05:00			-0.02	0.00	0.17	0.19	0.12	0.58						
14/06/2024 05:15			-0.02	0.00	0.17	0.19	0.12	0.58						
14/06/2024 05:30			-0.02	0.00	0.17	0.19	0.12	0.58						
14/06/2024 05:45			-0.02	0.00	0.17	0.19	0.12	0.58						
14/06/2024 06:00			-0.02	0.00	0.18	0.19	0.12	0.58						
14/06/2024 06:15			-0.02	0.00	0.18	0.19	0.12	0.58						
14/06/2024 06:30			-0.02	0.00	0.18	0.19	0.12	0.58	0.05					
14/06/2024 06:45			-0.02	0.00	0.18	0.19	0.12	0.58						
14/06/2024 07:00			-0.02	0.00	0.18	0.19	0.12	0.58						
14/06/2024 07:15			-0.02	0.00	0.18	0.19	0.12	0.58						
14/06/2024 07:30			-0.02	0.00	0.18	0.19	0.13	0.58						
14/06/2024 07:45			-0.02	0.00	0.18	0.19	0.13	0.58						
14/06/2024 08:00			-0.02	0.00	0.18	0.19	0.13	0.58	0.07					
14/06/2024 08:15			-0.02	0.00	0.18	0.19	0.13	0.58						
14/06/2024 08:30			-0.02	0.00	0.18	0.19	0.13	0.58	0.04					
14/06/2024 08:45			-0.02	0.00	0.18	0.19	0.13	0.58						
14/06/2024 09:00			-0.02	0.00	0.18	0.19	0.13	0.58						
14/06/2024 09:15			-0.01	0.00	0.18	0.19	0.13	0.58						
14/06/2024 09:30			-0.01	0.00	0.18	0.19	0.13	0.58						
14/06/2024 09:45			-0.01	0.00	0.18	0.19	0.13	0.58	0.04					
14/06/2024 10:00			-0.02	0.00	0.18	0.19	0.13	0.58	0.04					
14/06/2024 10:15			-0.01	0.00	0.18	0.19	0.13	0.58	0.03					
14/06/2024 10:30			-0.02	0.00	0.18	0.19	0.13	0.58	0.04					
14/06/2024 10:45			-0.02	0.00	0.18	0.19	0.13	0.58						
14/06/2024 11:00			-0.02	0.00	0.18	0.19	0.13	0.57	0.04					
14/06/2024 11:15			-0.01	0.00	0.18	0.19	0.13	0.58	0.08					
14/06/2024 11:30			-0.01	0.00	0.18	0.19	0.13	0.58	0.06					
14/06/2024 11:45			-0.01	0.00	0.18	0.19	0.13	0.58	0.04					
14/06/2024 12:00			-0.01	0.00	0.18	0.19	0.13	0.58	0.05					
14/06/2024 12:15			-0.01	0.00	0.18	0.19	0.13	0.58	0.04					
14/06/2024 12:30			-0.02	0.00	0.18	0.19	0.13	0.58						
14/06/2024 12:45			-0.02	0.00	0.18	0.19	0.13	0.58	0.05					
14/06/2024 13:00			-0.02	0.00	0.18	0.19	0.13	0.57						
14/06/2024 13:15			-0.01	0.00	0.18	0.19	0.13	0.57	0.05					
14/06/2024 13:30			-0.01	0.00	0.18	0.19	0.13	0.57	0.04					
14/06/2024 13:45			-0.02	0.00	0.18	0.19	0.13	0.57	0.04					
14/06/2024 14:00			-0.01	0.00	0.18	0.19	0.13	0.57	0.04					
14/06/2024 14:15			-0.02	0.00	0.18	0.19	0.13	0.57						
14/06/2024 14:30			-0.01	0.00	0.18	0.19	0.13	0.57	0.05					
14/06/2024 14:45			-0.01	0.00	0.18	0.19	0.13	0.57						
14/06/2024 15:00			-0.02	0.00	0.18	0.19	0.13	0.57	0.05					
14/06/2024 15:15			-0.02	0.00	0.18	0.19	0.13	0.57	0.06					
14/06/2024 15:30			-0.02	0.00	0.18	0.19	0.13	0.57	0.04					
14/06/2024 15:45			-0.01	0.00	0.18	0.19	0.13	0.57						
14/06/2024 16:00			-0.01	0.00	0.18	0.19	0.13	0.57						
14/06/2024 16:15			-0.02	0.00	0.18	0.19	0.13	0.57	0.04					
14/06/2024 16:30			-0.01	0.00	0.18	0.19	0.13	0.57	0.04					
14/06/2024 16:45			-0.02	0.00	0.18	0.19	0.13	0.57	0.05					
14/06/2024 17:00			-0.02	0.00	0.18	0.19	0.13	0.57	0.05					
14/06/2024 17:15			-0.02	0.00	0.18	0.19	0.13	0.57	0.05					
14/06/2024 17:30			-0.02	0.00	0.18	0.19	0.12	0.57	0.05					
14/06/2024 17:45			-0.01	0.00	0.18	0.19	0.13	0.57	0.06					
14/06/2024 18:00			-0.01	0.00	0.18	0.19	0.12	0.57						
14/06/2024 18:15			-0.01	0.00	0.18	0.19	0.12	0.57						
14/06/2024 18:30			-0.01	0.00	0.18	0.19	0.12	0.57						
14/06/2024 18:45			-0.01	0.00	0.18	0.19	0.12	0.57						
14/06/2024 19:00			-0.01	0.00	0.18	0.19	0.12	0.57	0.05					
14/06/2024 19:15			-0.01	0.00	0.18	0.19	0.12	0.57	0.06					
14/06/2024 19:30			-0.01	0.00	0.18	0.19	0.12	0.57						
14/06/2024 19:45			-0.01	0.00	0.18	0.19	0.12	0.57						
14/06/2024 20:00			-0.01	0.00	0.18	0.19	0.12	0.57						
14/06/2024 20:15			-0.01	0.00	0.18	0.19	0.12	0.58	0.06					
14/06/2024 20:30			-0.02	0.00	0.18	0.19	0.12	0.58	0.59					
14/06/2024 20:45			-0.02	0.00	0.18	0.19	0.12	0.58	0.67					
14/06/2024 21:00			-0.02	0.00	0.18	0.19	0.12	0.58						
14/06/2024 21:15			-0.02	0.00	0.18	0.19	0.12	0.57						
14/06/2024 21:30			-0.02	0.00	0.18	0.19	0.12	0.57						
14/06/2024 21:45			-0.02	0.00	0.18	0.19	0.12	0.57						
14/06/2024 22:00			-0.02	0.00	0.18	0.19	0.12	0.57						
14/06/2024 22:15			-0.02	0.00	0.18	0.19	0.12	0.57						
14/06/2024 22:30			-0.02	0.00	0.18	0.19	0.12	0.57						
14/06/2024 22:45			-0.02	0.00	0.18	0.19	0.12	0.57						
14/06/2024 23:00			-0.02	0.00	0.18	0.19	0.12	0.57						
14/06/2024 23:15			-0.02	0.00	0.18	0.19	0.12	0.57						
14/06/2024 23:30			-0.02	0.00	0.18	0.19	0.12	0.57						
14/06/2024 23:45			-0.02	0.00	0.18	0.19	0.12	0.57						
15/06/2024 00:00			-0.02	0.00	0.18	0.19	0.12	0.57						
15/06/2024 00:15			-0.02	0.00	0.18	0.19	0.12	0.57	0.24					
15/06/2024 00:30			-0.02	0.00	0.18	0.19	0.12	0.57	0.65					
15/06/2024 00:45			-0.02	0.00	0.18	0.19	0.12	0.57	0.37					
15/06/2024 01:00			-0.02	0.00	0.18	0.19	0.12	0.57	0.27					
15/06/2024 01:15			-0.02	0.00	0.18	0.19	0.12	0.57	0.27					
15/06/2024 01:30			-0.02	0.00	0.18	0.19	0.12	0.57	0.66					
15/06/2024 01:45			-0.02	0.00	0.18	0.19	0.12	0.57						
15/06/2024 02:00			-0.02	0.00	0.18	0.19	0.12	0.56						
15/06/2024 02:15			-0.02	0.00	0.18	0.19	0.12	0.56						
15/06/2024 02:30			-0.02	0.00	0.17	0.19	0.12	0.56						
15/06/2024 02:45			-0.02	0.00	0.17	0.19	0.12	0.56	0.10					
15/06/2024 03:00			-0.02	0.00	0.17	0.19	0.12	0.56						
15/06/2024 03:15			-0.02	0.00	0.17	0.19	0.12	0.57	0.04					
15/06/2024 03:30			-0.02	0.00	0.17	0.19	0.12	0.57						
15/06/2024 03:45			-0.02	0.00	0.17	0.19	0.12	0.57						
15/06/2024 04:00			-0.02	0.00	0.17	0.19	0.12	0.56						
15/06/2024 04:15			-0.01	0.00	0.17	0.19	0.12	0.56						
15/06/2024 04:30			-0.01	0.00	0.17	0.18	0.12	0.56						
15/06/2024 04:45			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 05:00			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 05:15			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 05:30			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 05:45			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 06:00			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 06:15			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 06:30			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 06:45			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 07:00			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 07:15			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 07:30			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 07:45			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 08:00			-0.02	0.00	0.17	0.18	0.12	0.56						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
15/06/2024 08:15			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 08:30			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 08:45			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 09:00			-0.02	0.00	0.17	0.18	0.12	0.56						
15/06/2024 09:15			-0.02	0.00	0.17	0.18	0.12	0.57						
15/06/2024 09:30			-0.02	0.00	0.17	0.18	0.12	0.57						
15/06/2024 09:45			-0.02	0.00	0.17	0.18	0.12	0.57						
15/06/2024 10:00			-0.02	0.00	0.17	0.18	0.11	0.57						
15/06/2024 10:15			-0.02	0.00	0.17	0.18	0.11	0.57						
15/06/2024 10:30			-0.02	0.00	0.17	0.18	0.11	0.57						
15/06/2024 10:45			-0.02	0.00	0.17	0.18	0.12	0.57	0.03					
15/06/2024 11:00			-0.02	0.00	0.17	0.18	0.11	0.57	0.03					
15/06/2024 11:15			-0.02	0.00	0.17	0.18	0.12	0.57						
15/06/2024 11:30			-0.02	0.00	0.17	0.18	0.12	0.57						
15/06/2024 11:45			-0.02	0.00	0.17	0.18	0.12	0.57						
15/06/2024 12:00			-0.02	0.00	0.17	0.18	0.12	0.57						
15/06/2024 12:15			-0.02	0.00	0.17	0.18	0.12	0.57						
15/06/2024 12:30			-0.03	0.00	0.17	0.18	0.12	0.57						
15/06/2024 12:45			-0.02	0.00	0.17	0.18	0.12	0.57						
15/06/2024 13:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.02					
15/06/2024 13:15			-0.02	0.00	0.17	0.18	0.12	0.57	0.05					
15/06/2024 13:30			-0.01	0.00	0.17	0.18	0.12	0.57	0.05					
15/06/2024 13:45			-0.01	0.00	0.17	0.18	0.12	0.57	0.06					
15/06/2024 14:00			-0.02	0.00	0.17	0.18	0.12	0.57	0.06					
15/06/2024 14:15			-0.02	0.00	0.17	0.19	0.12	0.57	0.04					
15/06/2024 14:30			-0.02	0.00	0.17	0.19	0.12	0.58	0.04					
15/06/2024 14:45			-0.02	0.00	0.17	0.19	0.12	0.58	0.06					
15/06/2024 15:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.08					
15/06/2024 15:15			-0.02	0.00	0.17	0.18	0.12	0.58	0.05					
15/06/2024 15:30			-0.01	0.00	0.17	0.19	0.12	0.58	0.05					
15/06/2024 15:45			-0.01	0.00	0.17	0.19	0.12	0.58	0.06					
15/06/2024 16:00			-0.01	0.00	0.17	0.19	0.12	0.57						
15/06/2024 16:15			-0.01	0.00	0.17	0.19	0.12	0.58	0.05					
15/06/2024 16:30			-0.01	0.00	0.17	0.19	0.12	0.58	0.08					
15/06/2024 16:45			-0.01	0.00	0.17	0.19	0.12	0.58						
15/06/2024 17:00			-0.02	0.00	0.17	0.19	0.12	0.58						
15/06/2024 17:15			-0.02	0.00	0.18	0.19	0.12	0.58						
15/06/2024 17:30			-0.01	0.00	0.18	0.19	0.12	0.58						
15/06/2024 17:45			-0.01	0.00	0.18	0.19	0.12	0.58						
15/06/2024 18:00			-0.01	0.00	0.18	0.19	0.12	0.59	0.43					
15/06/2024 18:15			-0.01	0.00	0.18	0.19	0.12	0.59						
15/06/2024 18:30			-0.01	0.00	0.18	0.19	0.12	0.59						
15/06/2024 18:45			-0.01	0.00	0.18	0.19	0.12	0.58						
15/06/2024 19:00			-0.01	0.00	0.18	0.19	0.12	0.58	0.04					
15/06/2024 19:15			-0.01	0.00	0.18	0.19	0.12	0.58	0.05					
15/06/2024 19:30			-0.01	0.00	0.18	0.19	0.13	0.58						
15/06/2024 19:45			-0.01	0.00	0.18	0.19	0.13	0.58						
15/06/2024 20:00			-0.01	0.00	0.18	0.19	0.13	0.58						
15/06/2024 20:15			-0.01	0.00	0.18	0.19	0.13	0.59						
15/06/2024 20:30			-0.01	0.00	0.18	0.19	0.13	0.59						
15/06/2024 20:45			-0.01	0.00	0.18	0.19	0.13	0.59						
15/06/2024 21:00			-0.01	0.00	0.18	0.19	0.13	0.59						
15/06/2024 21:15			-0.01	0.00	0.18	0.19	0.13	0.59						
15/06/2024 21:30			-0.01	0.00	0.18	0.19	0.13	0.59						
15/06/2024 21:45			-0.01	0.00	0.18	0.19	0.13	0.59	0.26					
15/06/2024 22:00			-0.01	0.00	0.18	0.19	0.13	0.58	0.66					
15/06/2024 22:15			-0.01	0.00	0.18	0.19	0.13	0.58						
15/06/2024 22:30			-0.01	0.00	0.18	0.19	0.13	0.58	0.03					
15/06/2024 22:45			-0.01	0.00	0.18	0.19	0.13	0.58						
15/06/2024 23:00			-0.01	0.00	0.18	0.19	0.13	0.58						
15/06/2024 23:15			-0.01	0.00	0.18	0.19	0.13	0.58						
15/06/2024 23:30			-0.01	0.00	0.18	0.19	0.13	0.58						
15/06/2024 23:45			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 00:00			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 00:15			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 00:30			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 00:45			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 01:00			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 01:15			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 01:30:00			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 01:45:00			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 02:00:00			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 02:15:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 02:30:00			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 02:45:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 03:00:00			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 03:15:00			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 03:30:00			-0.01	0.00	0.18	0.19	0.13	0.58						
16/06/2024 03:45:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 04:00:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 04:15:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 04:30:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 04:45:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 05:00:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 05:15:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 05:30:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 05:45:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 06:00:00			-0.02	0.00	0.18	0.19	0.13	0.57						
16/06/2024 06:15:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 06:30:00			-0.01	0.00	0.18	0.19	0.13	0.57						
16/06/2024 06:45:00			-0.02	0.00	0.18	0.19	0.12	0.57						
16/06/2024 07:00:00			-0.02	0.00	0.18	0.19	0.12	0.57						
16/06/2024 07:15:00			-0.01	0.00	0.18	0.19	0.12	0.57						
16/06/2024 07:30:00			-0.02	0.00	0.18	0.19	0.12	0.57	0.03					
16/06/2024 07:45:00			-0.02	0.00	0.18	0.19	0.12	0.57	0.05					
16/06/2024 08:00:00			-0.02	0.00	0.18	0.19	0.12	0.57						
16/06/2024 08:15:00			-0.02	0.00	0.18	0.19	0.12	0.57	0.03					
16/06/2024 08:30:00			-0.02	0.00	0.18	0.19	0.12	0.57	0.04					
16/06/2024 08:45:00			-0.02	0.00	0.18	0.19	0.12	0.57						
16/06/2024 09:00:00			-0.01	0.00	0.18	0.19	0.12	0.57	0.06					
16/06/2024 09:15:00			-0.01	0.00	0.18	0.19	0.12	0.57	0.05					
16/06/2024 09:30:00			-0.01	0.00	0.18	0.19	0.12	0.58	0.07					
16/06/2024 09:45:00			-0.01	0.00	0.18	0.19	0.12	0.58	0.09					
16/06/2024 10:00:00			-0.02	0.00	0.18	0.19	0.12	0.58	0.07					
16/06/2024 10:15:00			-0.01	0.00	0.18	0.19	0.12	0.58	0.05					
16/06/2024 10:30:00			-0.01	0.00	0.18	0.19	0.12	0.59	0.14					
16/06/2024 10:45:00			-0.02	0.00	0.18	0.19	0.12	0.59	0.09					
16/06/2024 11:00:00			-0.01	0.00	0.18	0.19	0.12	0.59	0.07					
16/06/2024 11:15:00			-0.01	0.00	0.18	0.19	0.13	0.60	0.09					
16/06/2024 11:30:00			-0.02	0.00	0.18	0.19	0.13	0.63	0.08					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
16/06/2024 11:45:00			-0.01	0.00	0.18	0.19	0.13	0.64	0.03					
16/06/2024 12:00:00			-0.01	0.00	0.18	0.19	0.13	0.63	0.06					
16/06/2024 12:15:00			-0.01	0.00	0.18	0.19	0.13	0.62						
16/06/2024 12:30:00			-0.02	0.00	0.18	0.20	0.13	0.61	0.07					
16/06/2024 12:45:00			-0.01	0.00	0.19	0.20	0.13	0.61	0.07					
16/06/2024 13:00:00			-0.02	0.00	0.19	0.20	0.14	0.61	0.08					
16/06/2024 13:15:00			-0.01	0.00	0.19	0.20	0.14	0.61						
16/06/2024 13:30:00			-0.01	0.00	0.19	0.20	0.14	0.60	0.06					
16/06/2024 13:45:00			-0.01	0.00	0.19	0.20	0.14	0.60	0.05					
16/06/2024 14:00:00			-0.01	0.00	0.19	0.20	0.14	0.60	0.07					
16/06/2024 14:15:00			-0.01	0.00	0.19	0.20	0.14	0.60	0.07					
16/06/2024 14:30:00			0.00	0.00	0.19	0.20	0.14	0.60						
16/06/2024 14:45:00			0.00	0.00	0.19	0.21	0.14	0.60	0.04					
16/06/2024 15:00:00			-0.01	0.00	0.19	0.21	0.14	0.60	0.07					
16/06/2024 15:15:00			0.00	0.00	0.20	0.21	0.14	0.60	0.07					
16/06/2024 15:30:00			0.00	0.00	0.20	0.21	0.14	0.60						
16/06/2024 15:45:00			-0.01	0.00	0.20	0.21	0.14	0.60	0.07					
16/06/2024 16:00:00			0.00	0.00	0.20	0.20	0.14	0.60	0.06					
16/06/2024 16:15:00			-0.01	0.00	0.20	0.20	0.14	0.60	0.05					
16/06/2024 16:30:00			0.00	0.00	0.20	0.20	0.14	0.60	0.07					
16/06/2024 16:45:00			0.00	0.00	0.20	0.20	0.14	0.60	0.27					
16/06/2024 17:00:00			0.00	0.00	0.20	0.20	0.14	0.60	0.28					
16/06/2024 17:15:00			0.00	0.00	0.20	0.20	0.14	0.60	0.28					
16/06/2024 17:30:00			0.00	0.00	0.20	0.20	0.14	0.60	0.28					
16/06/2024 17:45:00			0.00	0.00	0.20	0.20	0.14	0.60	0.28					
16/06/2024 18:00:00			0.00	0.00	0.20	0.21	0.14	0.60	0.28					
16/06/2024 18:15:00			0.00	0.00	0.20	0.20	0.14	0.60	0.28					
16/06/2024 18:30:00			0.00	0.00	0.20	0.21	0.14	0.60	0.28					
16/06/2024 18:45:00			0.00	0.00	0.20	0.21	0.14	0.60	0.28					
16/06/2024 19:00:00			0.00	0.00	0.20	0.21	0.14	0.60	0.66					
16/06/2024 19:15:00			0.00	0.00	0.20	0.21	0.14	0.60						
16/06/2024 19:30:00			0.00	0.00	0.20	0.21	0.14	0.60						
16/06/2024 19:45:00			0.00	0.00	0.20	0.21	0.14	0.60						
16/06/2024 20:00:00			0.00	0.00	0.20	0.20	0.14	0.60						
16/06/2024 20:15:00			0.00	0.00	0.20	0.20	0.14	0.60						
16/06/2024 20:30:00			0.00	0.00	0.20	0.21	0.14	0.60	0.15					
16/06/2024 20:45:00			0.00	0.00	0.20	0.21	0.14	0.60						
16/06/2024 21:00:00			0.00	0.00	0.20	0.20	0.14	0.60						
16/06/2024 21:15:00			0.00	0.00	0.20	0.20	0.14	0.60						
16/06/2024 21:30:00			0.00	0.00	0.19	0.20	0.14	0.60						
16/06/2024 21:45:00			0.00	0.00	0.20	0.20	0.14	0.60						
16/06/2024 22:00:00			0.00	0.00	0.20	0.21	0.14	0.60						
16/06/2024 22:15:00			0.00	0.00	0.20	0.21	0.14	0.60						
16/06/2024 22:30:00			0.00	0.00	0.20	0.21	0.14	0.60						
16/06/2024 22:45:00			0.00	0.00	0.20	0.20	0.14	0.60						
16/06/2024 23:00:00			0.00	0.00	0.20	0.21	0.14	0.60						
16/06/2024 23:15:00			0.00	0.00	0.20	0.21	0.14	0.60						
16/06/2024 23:30:00			0.00	0.00	0.20	0.20	0.14	0.60						
16/06/2024 23:45:00			0.00	0.00	0.20	0.21	0.14	0.60						
17/06/2024 00:00:00			0.00	0.00	0.19	0.21	0.14	0.60						
17/06/2024 00:15:00			0.00	0.00	0.19	0.20	0.14	0.60						
17/06/2024 00:30:00			0.00	0.00	0.19	0.20	0.14	0.60						
17/06/2024 00:45:00			0.00	0.00	0.19	0.20	0.14	0.60						
17/06/2024 01:00:00			0.00	0.00	0.19	0.20	0.14	0.60	0.02					
17/06/2024 01:15:00			0.00	0.00	0.19	0.20	0.14	0.60						
17/06/2024 01:30:00			0.00	0.00	0.19	0.20	0.14	0.60						
17/06/2024 01:45:00			0.00	0.00	0.19	0.20	0.14	0.60						
17/06/2024 02:00:00			0.00	0.00	0.19	0.20	0.14	0.60						
17/06/2024 02:15:00			0.00	0.00	0.19	0.20	0.14	0.59						
17/06/2024 02:30:00			0.00	0.00	0.19	0.20	0.14	0.59						
17/06/2024 02:45:00			0.00	0.00	0.19	0.20	0.14	0.59						
17/06/2024 03:00:00			0.00	0.00	0.19	0.20	0.14	0.59						
17/06/2024 03:15:00			0.00	0.00	0.19	0.20	0.14	0.59						
17/06/2024 03:30:00			0.00	0.00	0.19	0.20	0.14	0.59						
17/06/2024 03:45:00			0.00	0.00	0.19	0.20	0.14	0.59						
17/06/2024 04:00:00			0.00	0.00	0.19	0.20	0.14	0.59						
17/06/2024 04:15:00			0.00	0.00	0.19	0.20	0.14	0.58						
17/06/2024 04:30:00			0.00	0.00	0.19	0.20	0.14	0.58						
17/06/2024 04:45:00			0.00	0.00	0.19	0.20	0.14	0.58						
17/06/2024 05:00:00			0.00	0.00	0.19	0.20	0.14	0.58						
17/06/2024 05:15:00			0.00	0.00	0.19	0.20	0.14	0.58						
17/06/2024 05:30:00			0.00	0.00	0.19	0.20	0.14	0.59						
17/06/2024 05:45:00			-0.01	0.00	0.19	0.20	0.14	0.59						
17/06/2024 06:00:00			-0.01	0.00	0.19	0.20	0.14	0.58						
17/06/2024 06:15:00			-0.01	0.00	0.19	0.20	0.14	0.58						
17/06/2024 06:30:00			-0.01	0.00	0.19	0.20	0.13	0.58						
17/06/2024 06:45:00			-0.01	0.00	0.19	0.20	0.13	0.58	0.06					
17/06/2024 07:00:00			-0.01	0.00	0.19	0.20	0.13	0.58	0.04					
17/06/2024 07:15:00			-0.01	0.00	0.19	0.20	0.13	0.58						
17/06/2024 07:30:00			-0.01	0.00	0.19	0.20	0.13	0.58	0.04					
17/06/2024 07:45:00			-0.01	0.00	0.19	0.20	0.13	0.58	0.06					
17/06/2024 08:00:00			-0.01	0.00	0.19	0.20	0.13	0.59	0.05					
17/06/2024 08:15:00			-0.01	0.00	0.19	0.20	0.13	0.58						
17/06/2024 08:30:00			-0.01	0.00	0.19	0.20	0.13	0.59						
17/06/2024 08:45:00			-0.01	0.00	0.19	0.20	0.13	0.59	0.06					
17/06/2024 09:00:00			-0.01	0.00	0.19	0.20	0.13	0.59	0.04					
17/06/2024 09:15:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.04					
17/06/2024 09:30:00			-0.01	0.00	0.19	0.20	0.13	0.59	0.05					
17/06/2024 09:45:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.05					
17/06/2024 10:00:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.05					
17/06/2024 10:15:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.05					
17/06/2024 10:30:00			-0.01	0.00	0.18	0.19	0.13	0.59						
17/06/2024 10:45:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.07					
17/06/2024 11:00:00			-0.01	0.00	0.18	0.20	0.13	0.59						
17/06/2024 11:15:00			-0.01	0.00	0.18	0.19	0.13	0.59						
17/06/2024 11:30:00			-0.01	0.00	0.18	0.20	0.13	0.59						
17/06/2024 11:45:00			-0.01	0.00	0.18	0.20	0.13	0.59						
17/06/2024 12:00:00			-0.01	0.00	0.18	0.20	0.13	0.59						
17/06/2024 12:15:00			-0.01	0.00	0.18	0.20	0.13	0.59						
17/06/2024 12:30:00			-0.01	0.00	0.18	0.20	0.13	0.59						
17/06/2024 12:45:00			-0.01	0.00	0.18	0.20	0.13	0.59						
17/06/2024 13:00:00			-0.01	0.00	0.18	0.20	0.13	0.58						
17/06/2024 13:15:00			-0.01	0.00	0.18	0.20	0.13	0.58						
17/06/2024 13:30:00			-0.01	0.00	0.18	0.20	0.13	0.58						
17/06/2024 13:45:00			-0.01	0.00	0.18	0.20	0.13	0.58						
17/06/2024 14:00:00			-0.01	0.00	0.18	0.20	0.13	0.58						
17/06/2024 14:15:00			-0.01	0.00	0.18	0.20	0.13	0.58						
17/06/2024 14:30:00			-0.01	0.00	0.18	0.20	0.13	0.58						
17/06/2024 14:45:00			-0.01	0.00	0.18	0.20	0.13	0.59						
17/06/2024 15:00:00			-0.01	0.00	0.18	0.20	0.13	0.58						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
17/06/2024 15:15:00			-0.01	0.00	0.18	0.20	0.13	0.60						
17/06/2024 15:30:00			-0.01	0.00	0.18	0.20	0.13	0.60						
17/06/2024 15:45:00			-0.01	0.00	0.18	0.20	0.13	0.60						
17/06/2024 16:00:00			-0.01	0.00	0.18	0.20	0.13	0.60						
17/06/2024 16:15:00			-0.01	0.00	0.18	0.20	0.13	0.60						
17/06/2024 16:30:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 16:45:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 17:00:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 17:15:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 17:30:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 17:45:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 18:00:00			-0.01	0.00	0.18	0.19	0.13	0.60	0.04					
17/06/2024 18:15:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 18:30:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 18:45:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 19:00:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 19:15:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 19:30:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 19:45:00			-0.01	0.00	0.18	0.19	0.13	0.60						
17/06/2024 20:00:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 20:15:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 20:30:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 20:45:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 21:00:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 21:15:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 21:30:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 21:45:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 22:00:00			-0.01	0.00	0.18	0.19	0.13	0.61						
17/06/2024 22:15:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 22:30:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 22:45:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 23:00:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 23:15:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 23:30:00			-0.01	0.00	0.18	0.19	0.13	0.62						
17/06/2024 23:45:00			-0.01	0.00	0.18	0.19	0.12	0.61						
18/06/2024 00:00:00			-0.01	0.00	0.18	0.19	0.12	0.61						
18/06/2024 00:15:00			-0.01	0.00	0.18	0.19	0.12	0.61						
18/06/2024 00:30:00			-0.01	0.00	0.18	0.19	0.12	0.61						
18/06/2024 00:45:00			-0.01	0.00	0.18	0.19	0.12	0.61						
18/06/2024 01:00:00			-0.01	0.00	0.18	0.19	0.12	0.61						
18/06/2024 01:15:00			-0.01	0.00	0.18	0.19	0.12	0.61						
18/06/2024 01:30:00			-0.01	0.00	0.18	0.19	0.12	0.61						
18/06/2024 01:45:00			-0.01	0.00	0.18	0.19	0.12	0.61						
18/06/2024 02:00:00			-0.01	0.00	0.18	0.19	0.12	0.61						
18/06/2024 02:15:00			-0.02	0.00	0.18	0.19	0.12	0.61						
18/06/2024 02:30:00			-0.02	0.00	0.18	0.19	0.12	0.61						
18/06/2024 02:45:00			-0.01	0.00	0.17	0.19	0.12	0.61						
18/06/2024 03:00:00			-0.01	0.00	0.17	0.19	0.12	0.61						
18/06/2024 03:15:00			-0.02	0.00	0.17	0.19	0.12	0.61						
18/06/2024 03:30:00			-0.02	0.00	0.17	0.19	0.12	0.61						
18/06/2024 03:45:00			-0.02	0.00	0.17	0.19	0.12	0.61						
18/06/2024 04:00:00			-0.02	0.00	0.17	0.19	0.12	0.60						
18/06/2024 04:15:00			-0.02	0.00	0.17	0.19	0.12	0.60						
18/06/2024 04:30:00			-0.02	0.00	0.17	0.19	0.12	0.60						
18/06/2024 04:45:00			-0.01	0.00	0.17	0.18	0.12	0.60						
18/06/2024 05:00:00			-0.01	0.00	0.17	0.18	0.12	0.60						
18/06/2024 05:15:00			-0.02	0.00	0.17	0.18	0.12	0.60	0.04					
18/06/2024 05:30:00			-0.02	0.00	0.17	0.18	0.12	0.60	0.04					
18/06/2024 05:45:00			-0.02	0.00	0.17	0.18	0.12	0.60	0.04					
18/06/2024 06:00:00			-0.02	0.00	0.17	0.18	0.12	0.60	0.04					
18/06/2024 06:15:00			-0.02	0.00	0.17	0.18	0.12	0.60	0.05					
18/06/2024 06:30:00			-0.02	0.00	0.17	0.18	0.12	0.60	0.06					
18/06/2024 06:45:00			-0.02	0.00	0.17	0.18	0.12	0.60	0.05					
18/06/2024 07:00:00			-0.02	0.00	0.17	0.18	0.12	0.60	0.04					
18/06/2024 07:15:00			-0.02	0.00	0.17	0.18	0.12	0.60						
18/06/2024 07:30:00			-0.02	0.00	0.17	0.18	0.12	0.60						
18/06/2024 07:45:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 08:00:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 08:15:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 08:30:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 08:45:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.04					
18/06/2024 09:00:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 09:15:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 09:30:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 09:45:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 10:00:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 10:15:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.06					
18/06/2024 10:30:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 10:45:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 11:00:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 11:15:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.06					
18/06/2024 11:30:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 11:45:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 12:00:00			-0.02	0.00	0.17	0.18	0.12	0.62						
18/06/2024 12:15:00			-0.02	0.00	0.17	0.18	0.12	0.62						
18/06/2024 12:30:00			-0.02	0.00	0.17	0.18	0.12	0.62						
18/06/2024 12:45:00			-0.02	0.00	0.17	0.18	0.12	0.62	0.07					
18/06/2024 13:00:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 13:15:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 13:30:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 13:45:00			-0.01	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 14:00:00			-0.01	0.00	0.17	0.18	0.12	0.61	0.03					
18/06/2024 14:15:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 14:30:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.04					
18/06/2024 14:45:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 15:00:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.04					
18/06/2024 15:15:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 15:30:00			-0.01	0.00	0.17	0.17	0.12	0.61	0.05					
18/06/2024 15:45:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 16:00:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 16:15:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 16:30:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.05					
18/06/2024 16:45:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.04					
18/06/2024 17:00:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.04					
18/06/2024 17:15:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.04					
18/06/2024 17:30:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.06					
18/06/2024 17:45:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.04					
18/06/2024 18:00:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.03					
18/06/2024 18:15:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 18:30:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.04					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
18/06/2024 18:45:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.05					
18/06/2024 19:00:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.03					
18/06/2024 19:15:00			-0.02	0.00	0.17	0.18	0.11	0.61						
18/06/2024 19:30:00			-0.02	0.00	0.17	0.18	0.11	0.62						
18/06/2024 19:45:00			-0.02	0.00	0.17	0.18	0.11	0.62						
18/06/2024 20:00:00			-0.02	0.00	0.17	0.18	0.11	0.62	0.05					
18/06/2024 20:15:00			-0.02	0.00	0.17	0.18	0.11	0.62	0.04					
18/06/2024 20:30:00			-0.02	0.00	0.17	0.18	0.11	0.62						
18/06/2024 20:45:00			-0.02	0.00	0.17	0.18	0.11	0.62						
18/06/2024 21:00:00			-0.02	0.00	0.17	0.18	0.11	0.62						
18/06/2024 21:15:00			-0.02	0.00	0.17	0.18	0.11	0.62	0.04					
18/06/2024 21:30:00			-0.02	0.00	0.17	0.18	0.11	0.62						
18/06/2024 21:45:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.04					
18/06/2024 22:00:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.03					
18/06/2024 22:15:00			-0.02	0.00	0.17	0.18	0.11	0.61						
18/06/2024 22:30:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.03					
18/06/2024 22:45:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.03					
18/06/2024 23:00:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 23:15:00			-0.02	0.00	0.17	0.18	0.12	0.61						
18/06/2024 23:30:00			-0.02	0.00	0.17	0.18	0.11	0.61						
18/06/2024 23:45:00			-0.02	0.00	0.17	0.18	0.12	0.61	0.03					
19/06/2024 00:00:00			-0.02	0.00	0.17	0.18	0.11	0.61						
19/06/2024 00:15:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.06					
19/06/2024 00:30:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.04					
19/06/2024 00:45:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.04					
19/06/2024 01:00:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.03					
19/06/2024 01:15:00			-0.02	0.00	0.17	0.18	0.11	0.61						
19/06/2024 01:30:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.04					
19/06/2024 01:45:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.03					
19/06/2024 02:00:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.03					
19/06/2024 02:15:00			-0.02	0.00	0.17	0.18	0.11	0.61	0.04					
19/06/2024 02:30:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.04					
19/06/2024 02:45:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.05					
19/06/2024 03:00:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.03					
19/06/2024 03:15:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.03					
19/06/2024 03:30:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.04					
19/06/2024 03:45:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.03					
19/06/2024 04:00:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.04					
19/06/2024 04:15:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.04					
19/06/2024 04:30:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.04					
19/06/2024 04:45:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.04					
19/06/2024 05:00:00			-0.02	0.00	0.17	0.18	0.11	0.60	0.05					
19/06/2024 05:15:00			-0.02	0.00	0.16	0.18	0.11	0.60	0.04					
19/06/2024 05:30:00			-0.02	0.00	0.16	0.18	0.11	0.60	0.06					
19/06/2024 05:45:00			-0.02	0.00	0.16	0.18	0.11	0.60	0.07					
19/06/2024 06:00:00			-0.02	0.00	0.16	0.18	0.11	0.60	0.06					
19/06/2024 06:15:00			-0.02	0.00	0.16	0.18	0.11	0.60						
19/06/2024 06:30:00			-0.02	0.00	0.16	0.18	0.11	0.60						
19/06/2024 06:45:00			-0.02	0.00	0.16	0.18	0.11	0.60						
19/06/2024 07:00:00			-0.02	0.00	0.16	0.18	0.11	0.60						
19/06/2024 07:15:00			-0.02	0.00	0.16	0.18	0.11	0.60						
19/06/2024 07:30:00			-0.02	0.00	0.16	0.18	0.11	0.60						
19/06/2024 07:45:00			-0.02	0.00	0.16	0.18	0.11	0.60	0.06					
19/06/2024 08:00:00			-0.02	0.00	0.16	0.18	0.11	0.60	0.05					
19/06/2024 08:15:00			-0.02	0.00	0.16	0.18	0.11	0.60	0.05					
19/06/2024 08:30:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.05					
19/06/2024 08:45:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.06					
19/06/2024 09:00:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 09:15:00			-0.03	0.00	0.16	0.17	0.11	0.61	0.07					
19/06/2024 09:30:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.04					
19/06/2024 09:45:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 10:00:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 10:15:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 10:30:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.05					
19/06/2024 10:45:00			-0.02	0.00	0.16	0.17	0.11	0.61						
19/06/2024 11:00:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.06					
19/06/2024 11:15:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.06					
19/06/2024 11:30:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.05					
19/06/2024 11:45:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.05					
19/06/2024 12:00:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.06					
19/06/2024 12:15:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.05					
19/06/2024 12:30:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 12:45:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.05					
19/06/2024 13:00:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.05					
19/06/2024 13:15:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.05					
19/06/2024 13:30:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.04					
19/06/2024 13:45:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.04					
19/06/2024 14:00:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.04					
19/06/2024 14:15:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.05					
19/06/2024 14:30:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.08					
19/06/2024 14:45:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.06					
19/06/2024 15:00:00			-0.02	0.00	0.16	0.18	0.11	0.61						
19/06/2024 15:15:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.08					
19/06/2024 15:30:00			-0.02	0.00	0.16	0.18	0.11	0.61						
19/06/2024 15:45:00			-0.02	0.00	0.16	0.18	0.11	0.61						
19/06/2024 16:00:00			-0.02	0.00	0.16	0.18	0.11	0.61						
19/06/2024 16:15:00			-0.02	0.00	0.16	0.17	0.11	0.61						
19/06/2024 16:30:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 16:45:00			-0.02	0.00	0.16	0.17	0.11	0.61						
19/06/2024 17:00:00			-0.02	0.00	0.16	0.17	0.11	0.61						
19/06/2024 17:15:00			-0.02	0.00	0.16	0.17	0.11	0.61						
19/06/2024 17:30:00			-0.02	0.00	0.16	0.17	0.11	0.61						
19/06/2024 17:45:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.07					
19/06/2024 18:00:00			-0.02	0.00	0.16	0.17	0.11	0.61						
19/06/2024 18:15:00			-0.02	0.00	0.16	0.17	0.11	0.61						
19/06/2024 18:30:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.08					
19/06/2024 18:45:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 19:00:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.02					
19/06/2024 19:15:00			-0.02	0.00	0.16	0.17	0.11	0.62						
19/06/2024 19:30:00			-0.02	0.00	0.16	0.17	0.11	0.62	0.05					
19/06/2024 19:45:00			-0.02	0.00	0.16	0.17	0.11	0.62						
19/06/2024 20:00:00			-0.02	0.00	0.16	0.17	0.11	0.62	0.05					
19/06/2024 20:15:00			-0.02	0.00	0.16	0.17	0.11	0.61						
19/06/2024 20:30:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 20:45:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.04					
19/06/2024 21:00:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 21:15:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.06					
19/06/2024 21:30:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.06					
19/06/2024 21:45:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 22:00:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.06					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
19/06/2024 22:15:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 22:30:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 22:45:00			-0.03	0.00	0.16	0.17	0.11	0.61	0.04					
19/06/2024 23:00:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 23:15:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.04					
19/06/2024 23:30:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
19/06/2024 23:45:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
20/06/2024 00:00:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.06					
20/06/2024 00:15:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.06					
20/06/2024 00:30:00			-0.02	0.00	0.16	0.17	0.11	0.61	0.05					
20/06/2024 00:45:00			-0.03	0.00	0.16	0.17	0.11	0.61	0.05					
20/06/2024 01:00:00			-0.03	0.00	0.16	0.17	0.11	0.60	0.05					
20/06/2024 01:15:00			-0.03	0.00	0.16	0.17	0.11	0.60	0.05					
20/06/2024 01:30:00			-0.03	0.00	0.16	0.17	0.11	0.60	0.05					
20/06/2024 01:45:00			-0.02	0.00	0.16	0.17	0.11	0.60	0.05					
20/06/2024 02:00:00			-0.02	0.00	0.16	0.17	0.11	0.60	0.05					
20/06/2024 02:15:00			-0.02	0.00	0.16	0.17	0.11	0.60	0.04					
20/06/2024 02:30:00			-0.02	0.00	0.16	0.17	0.11	0.60	0.05					
20/06/2024 02:45:00			-0.02	0.00	0.16	0.17	0.11	0.60	0.04					
20/06/2024 03:00:00			-0.02	0.00	0.16	0.17	0.11	0.60	0.04					
20/06/2024 03:15:00			-0.02	0.00	0.16	0.17	0.11	0.60	0.06					
20/06/2024 03:30:00			-0.02	0.00	0.16	0.17	0.10	0.60	0.05					
20/06/2024 03:45:00			-0.02	0.00	0.16	0.17	0.10	0.60	0.04					
20/06/2024 04:00:00			-0.02	0.00	0.16	0.17	0.10	0.60	0.06					
20/06/2024 04:15:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.06					
20/06/2024 04:30:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.07					
20/06/2024 04:45:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.07					
20/06/2024 05:00:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.07					
20/06/2024 05:15:00			-0.02	0.00	0.16	0.17	0.10	0.60	0.08					
20/06/2024 05:30:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.07					
20/06/2024 05:45:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.08					
20/06/2024 06:00:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.07					
20/06/2024 06:15:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.06					
20/06/2024 06:30:00			-0.03	0.00	0.16	0.17	0.10	0.60						
20/06/2024 06:45:00			-0.03	0.00	0.16	0.17	0.10	0.60						
20/06/2024 07:00:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.07					
20/06/2024 07:15:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.08					
20/06/2024 07:30:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.08					
20/06/2024 07:45:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.07					
20/06/2024 08:00:00			-0.03	0.00	0.16	0.17	0.10	0.60	0.07					
20/06/2024 08:15:00			-0.03	0.00	0.16	0.17	0.10	0.61	0.04					
20/06/2024 08:30:00			-0.03	0.00	0.16	0.17	0.10	0.61	0.06					
20/06/2024 08:45:00			-0.03	0.00	0.16	0.17	0.10	0.61	0.04					
20/06/2024 09:00:00			-0.02	0.00	0.16	0.17	0.10	0.61	0.06					
20/06/2024 09:15:00			-0.02	0.00	0.16	0.17	0.10	0.61	0.06					
20/06/2024 09:30:00			-0.02	0.00	0.16	0.17	0.10	0.62	0.06					
20/06/2024 09:45:00			-0.03	0.00	0.16	0.17	0.10	0.62	0.05					
20/06/2024 10:00:00			-0.03	0.00	0.16	0.17	0.10	0.61	0.05					
20/06/2024 10:15:00			-0.03	0.00	0.16	0.17	0.10	0.61	0.05					
20/06/2024 10:30:00			-0.03	0.00	0.16	0.17	0.10	0.61	0.04					
20/06/2024 10:45:00			-0.03	0.00	0.16	0.17	0.10	0.62	0.05					
20/06/2024 11:00:00			-0.03	0.00	0.16	0.17	0.10	0.62	0.06					
20/06/2024 11:15:00			-0.03	0.00	0.16	0.17	0.10	0.62	0.05					
20/06/2024 11:30:00			-0.03	0.00	0.16	0.17	0.11	0.62	0.06					
20/06/2024 11:45:00			-0.03	0.00	0.16	0.17	0.11	0.62	0.05					
20/06/2024 12:00:00			-0.03	0.00	0.16	0.17	0.11	0.62	0.05					
20/06/2024 12:15:00			-0.03	0.00	0.16	0.17	0.11	0.62	0.04					
20/06/2024 12:30:00			-0.03	0.00	0.16	0.17	0.11	0.62	0.04					
20/06/2024 12:45:00			-0.03	0.00	0.16	0.17	0.11	0.62	0.06					
20/06/2024 13:00:00			-0.03	0.00	0.16	0.17	0.11	0.62	0.05					
20/06/2024 13:15:00			-0.03	0.00	0.16	0.17	0.11	0.62	0.04					
20/06/2024 13:30:00			-0.03	0.00	0.16	0.17	0.11	0.62	0.05					
20/06/2024 13:45:00			-0.03	0.00	0.16	0.17	0.11	0.62	0.05					
20/06/2024 14:00:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.05					
20/06/2024 14:15:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.05					
20/06/2024 14:30:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 14:45:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.05					
20/06/2024 15:00:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.05					
20/06/2024 15:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 15:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.05					
20/06/2024 15:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.06					
20/06/2024 16:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.05					
20/06/2024 16:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.05					
20/06/2024 16:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.05					
20/06/2024 16:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.05					
20/06/2024 17:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 17:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 17:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 17:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 18:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 18:15:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.05					
20/06/2024 18:30:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 18:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.03					
20/06/2024 19:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 19:15:00			-0.02	0.00	0.16	0.18	0.11	0.62						
20/06/2024 19:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 19:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 20:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.03					
20/06/2024 20:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.03					
20/06/2024 20:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.03					
20/06/2024 20:45:00			-0.02	0.00	0.16	0.18	0.11	0.62						
20/06/2024 21:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.03					
20/06/2024 21:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.03					
20/06/2024 21:30:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.03					
20/06/2024 21:45:00			-0.03	0.00	0.16	0.18	0.11	0.63						
20/06/2024 22:00:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.03					
20/06/2024 22:15:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.03					
20/06/2024 22:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.03					
20/06/2024 22:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.03					
20/06/2024 23:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 23:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 23:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
20/06/2024 23:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
21/06/2024 00:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.03					
21/06/2024 00:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.03					
21/06/2024 00:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
21/06/2024 00:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
21/06/2024 01:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.05					
21/06/2024 01:15:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.05					
21/06/2024 01:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.05					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
21/06/2024 01:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.05					
21/06/2024 02:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
21/06/2024 02:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.04					
21/06/2024 02:30:00			-0.02	0.00	0.16	0.18	0.11	0.61						
21/06/2024 02:45:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.06					
21/06/2024 03:00:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.05					
21/06/2024 03:15:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.04					
21/06/2024 03:30:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.03					
21/06/2024 03:45:00			-0.02	0.00	0.16	0.18	0.11	0.61						
21/06/2024 04:00:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 04:15:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 04:30:00			-0.02	0.00	0.16	0.18	0.11	0.61						
21/06/2024 04:45:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 05:00:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 05:15:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 05:30:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 05:45:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 06:00:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.02					
21/06/2024 06:15:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 06:30:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.02					
21/06/2024 06:45:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.03					
21/06/2024 07:00:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 07:15:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 07:30:00			-0.03	0.00	0.16	0.18	0.11	0.61						
21/06/2024 07:45:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.03					
21/06/2024 08:00:00			-0.03	0.00	0.16	0.18	0.11	0.62						
21/06/2024 08:15:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.04					
21/06/2024 08:30:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.04					
21/06/2024 08:45:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.00					
21/06/2024 09:00:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.03					
21/06/2024 09:15:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.04					
21/06/2024 09:30:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.03					
21/06/2024 09:45:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.03					
21/06/2024 10:00:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.04					
21/06/2024 10:15:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.04					
21/06/2024 10:30:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.02					
21/06/2024 10:45:00			-0.03	0.00	0.16	0.18	0.11	0.63						
21/06/2024 11:00:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.23					
21/06/2024 11:15:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 11:30:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 11:45:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 12:00:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 12:15:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 12:30:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 12:45:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 13:00:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 13:15:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 13:30:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 13:45:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 14:00:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 14:15:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 14:30:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 14:45:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 15:00:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 15:15:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 15:30:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 15:45:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 16:00:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 16:15:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 16:30:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 16:45:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 17:00:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 17:15:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 17:30:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 17:45:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 18:00:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 18:15:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 18:30:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 18:45:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.24					
21/06/2024 19:00:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.25					
21/06/2024 19:15:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.25					
21/06/2024 19:30:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.00					
21/06/2024 19:45:00			-0.02	0.00	0.16	0.18	0.11	0.64						
21/06/2024 20:00:00			-0.02	0.00	0.16	0.18	0.11	0.64						
21/06/2024 20:15:00			-0.02	0.00	0.16	0.18	0.11	0.64						
21/06/2024 20:30:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.02					
21/06/2024 20:45:00			-0.02	0.00	0.16	0.18	0.11	0.64						
21/06/2024 21:00:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.03					
21/06/2024 21:15:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.04					
21/06/2024 21:30:00			-0.02	0.00	0.16	0.18	0.11	0.63						
21/06/2024 21:45:00			-0.02	0.00	0.16	0.18	0.11	0.63						
21/06/2024 22:00:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.03					
21/06/2024 22:15:00			-0.02	0.00	0.16	0.18	0.11	0.63						
21/06/2024 22:30:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.04					
21/06/2024 22:45:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.03					
21/06/2024 23:00:00			-0.02	0.00	0.16	0.18	0.11	0.63						
21/06/2024 23:15:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.02					
21/06/2024 23:30:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.03					
21/06/2024 23:45:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.01					
22/06/2024 00:00:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.01					
22/06/2024 00:15:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.00					
22/06/2024 00:30:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.01					
22/06/2024 00:45:00			-0.02	0.00	0.16	0.18	0.11	0.63						
22/06/2024 01:00:00			-0.02	0.00	0.16	0.18	0.11	0.63						
22/06/2024 01:15:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.00					
22/06/2024 01:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.00					
22/06/2024 01:45:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 02:00:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 02:15:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 02:30:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 02:45:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 03:00:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 03:15:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 03:30:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 03:45:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 04:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.00					
22/06/2024 04:15:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 04:30:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 04:45:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 05:00:00			-0.02	0.00	0.16	0.18	0.11	0.62						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
22/06/2024 05:15:00			-0.02	0.00	0.16	0.18	0.11	0.62						
22/06/2024 05:30:00			-0.02	0.00	0.16	0.18	0.10	0.62						
22/06/2024 05:45:00			-0.02	0.00	0.16	0.18	0.10	0.62						
22/06/2024 06:00:00			-0.02	0.00	0.16	0.18	0.10	0.62						
22/06/2024 06:15:00			-0.02	0.00	0.16	0.18	0.10	0.62						
22/06/2024 06:30:00			-0.03	0.00	0.16	0.18	0.10	0.62						
22/06/2024 06:45:00			-0.03	0.00	0.16	0.18	0.10	0.62						
22/06/2024 07:00:00			-0.03	0.00	0.16	0.18	0.10	0.62						
22/06/2024 07:15:00			-0.02	0.00	0.16	0.18	0.10	0.62						
22/06/2024 07:30:00			-0.03	0.00	0.16	0.18	0.10	0.62						
22/06/2024 07:45:00			-0.02	0.00	0.16	0.18	0.10	0.62						
22/06/2024 08:00:00			-0.03	0.00	0.16	0.17	0.10	0.62						
22/06/2024 08:15:00			-0.02	0.00	0.16	0.17	0.10	0.62						
22/06/2024 08:30:00			-0.02	0.00	0.16	0.17	0.10	0.63						
22/06/2024 08:45:00			-0.03	0.00	0.16	0.17	0.10	0.63						
22/06/2024 09:00:00			-0.03	0.00	0.16	0.17	0.10	0.63						
22/06/2024 09:15:00			-0.02	0.00	0.16	0.17	0.10	0.63						
22/06/2024 09:30:00			-0.02	0.00	0.16	0.17	0.10	0.63						
22/06/2024 09:45:00			-0.02	0.00	0.16	0.17	0.10	0.63						
22/06/2024 10:00:00			-0.02	0.00	0.16	0.17	0.10	0.63	0.06					
22/06/2024 10:15:00			-0.02	0.00	0.16	0.17	0.10	0.63						
22/06/2024 10:30:00			-0.03	0.00	0.16	0.17	0.10	0.64						
22/06/2024 10:45:00			-0.03	0.00	0.16	0.17	0.10	0.64						
22/06/2024 11:00:00			-0.02	0.00	0.16	0.17	0.10	0.64						
22/06/2024 11:15:00			-0.02	0.00	0.16	0.18	0.10	0.64						
22/06/2024 11:30:00			-0.03	0.00	0.16	0.18	0.10	0.64						
22/06/2024 11:45:00			-0.03	0.00	0.16	0.18	0.10	0.64						
22/06/2024 12:00:00			-0.03	0.00	0.16	0.18	0.10	0.64						
22/06/2024 12:15:00			-0.03	0.00	0.16	0.18	0.10	0.64						
22/06/2024 12:30:00			-0.02	0.00	0.16	0.18	0.10	0.64						
22/06/2024 12:45:00			-0.03	0.00	0.16	0.18	0.10	0.64						
22/06/2024 13:00:00			-0.03	0.00	0.16	0.18	0.10	0.64						
22/06/2024 13:15:00			-0.02	0.00	0.16	0.18	0.10	0.64						
22/06/2024 13:30:00			-0.02	0.00	0.16	0.18	0.10	0.64						
22/06/2024 13:45:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.00					
22/06/2024 14:00:00			-0.03	0.00	0.16	0.18	0.11	0.64	0.02					
22/06/2024 14:15:00			-0.02	0.00	0.16	0.18	0.11	0.64						
22/06/2024 14:30:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 14:45:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 15:00:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 15:15:00			-0.03	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 15:30:00			-0.03	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 15:45:00			-0.02	0.00	0.16	0.18	0.11	0.65	0.26					
22/06/2024 16:00:00			-0.02	0.00	0.16	0.18	0.11	0.65	0.26					
22/06/2024 16:15:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 16:30:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 16:45:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 17:00:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 17:15:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 17:30:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 17:45:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 18:00:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 18:15:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.26					
22/06/2024 18:30:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 18:45:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 19:00:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 19:15:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 19:30:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 19:45:00			-0.02	0.00	0.17	0.19	0.11	0.64	0.26					
22/06/2024 20:00:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 20:15:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 20:30:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 20:45:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 21:00:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 21:15:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 21:30:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 21:45:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 22:00:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 22:15:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 22:30:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 22:45:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.26					
22/06/2024 23:00:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.38					
22/06/2024 23:15:00			-0.02	0.00	0.17	0.18	0.11	0.64	0.65					
22/06/2024 23:30:00			-0.02	0.00	0.17	0.18	0.11	0.64						
22/06/2024 23:45:00			-0.02	0.00	0.17	0.18	0.11	0.64						
23/06/2024 00:00:00			-0.02	0.00	0.17	0.18	0.11	0.64						
23/06/2024 00:15:00			-0.02	0.00	0.17	0.18	0.11	0.64						
23/06/2024 00:30:00			-0.02	0.00	0.17	0.18	0.11	0.64						
23/06/2024 00:45:00			-0.02	0.00	0.17	0.18	0.11	0.64						
23/06/2024 01:00:00			-0.02	0.00	0.17	0.18	0.11	0.64						
23/06/2024 01:15:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 01:30:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 01:45:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 02:00:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 02:15:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 02:30:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 02:45:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 03:00:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 03:15:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 03:30:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 03:45:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 04:00:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 04:15:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 04:30:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 04:45:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 05:00:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 05:15:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 05:30:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 05:45:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 06:00:00			-0.02	0.00	0.16	0.18	0.11	0.62						
23/06/2024 06:15:00			-0.02	0.00	0.16	0.18	0.11	0.62						
23/06/2024 06:30:00			-0.02	0.00	0.16	0.18	0.11	0.62						
23/06/2024 06:45:00			-0.02	0.00	0.16	0.18	0.11	0.62						
23/06/2024 07:00:00			-0.03	0.00	0.16	0.18	0.11	0.62						
23/06/2024 07:15:00			-0.03	0.00	0.16	0.18	0.11	0.62						
23/06/2024 07:30:00			-0.03	0.00	0.16	0.18	0.11	0.63						
23/06/2024 07:45:00			-0.03	0.00	0.16	0.18	0.11	0.63						
23/06/2024 08:00:00			-0.03	0.00	0.16	0.18	0.11	0.63						
23/06/2024 08:15:00			-0.03	0.00	0.16	0.18	0.11	0.63						
23/06/2024 08:30:00			-0.03	0.00	0.16	0.18	0.11	0.63						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
23/06/2024 08:45:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 09:00:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 09:15:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 09:30:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.18					
23/06/2024 09:45:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.01					
23/06/2024 10:00:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.01					
23/06/2024 10:15:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.01					
23/06/2024 10:30:00			-0.02	0.00	0.16	0.18	0.11	0.64						
23/06/2024 10:45:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.00					
23/06/2024 11:00:00			-0.02	0.00	0.16	0.18	0.11	0.64						
23/06/2024 11:15:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.00					
23/06/2024 11:30:00			-0.02	0.00	0.16	0.18	0.11	0.64						
23/06/2024 11:45:00			-0.03	0.00	0.16	0.18	0.11	0.65						
23/06/2024 12:00:00			-0.03	0.00	0.16	0.18	0.11	0.65						
23/06/2024 12:15:00			-0.03	0.00	0.16	0.18	0.11	0.65						
23/06/2024 12:30:00			-0.02	0.00	0.16	0.18	0.11	0.65	0.24					
23/06/2024 12:45:00			-0.03	0.00	0.16	0.18	0.11	0.65	0.26					
23/06/2024 13:00:00			-0.02	0.00	0.16	0.18	0.11	0.65						
23/06/2024 13:15:00			-0.02	0.00	0.16	0.18	0.11	0.65						
23/06/2024 13:30:00			-0.02	0.00	0.16	0.18	0.11	0.65						
23/06/2024 13:45:00			-0.02	0.00	0.16	0.18	0.11	0.65	0.13					
23/06/2024 14:00:00			-0.02	0.00	0.16	0.18	0.11	0.65	0.01					
23/06/2024 14:15:00			-0.02	0.00	0.16	0.18	0.11	0.65	0.02					
23/06/2024 14:30:00			-0.02	0.00	0.16	0.18	0.11	0.65						
23/06/2024 14:45:00			-0.03	0.00	0.16	0.18	0.11	0.65						
23/06/2024 15:00:00			-0.03	0.00	0.16	0.18	0.11	0.65	0.30					
23/06/2024 15:15:00			-0.03	0.00	0.16	0.18	0.11	0.65	0.31					
23/06/2024 15:30:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.32					
23/06/2024 15:45:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.32					
23/06/2024 16:00:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.66					
23/06/2024 16:15:00			-0.02	0.00	0.16	0.18	0.11	0.65	0.34					
23/06/2024 16:30:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.32					
23/06/2024 16:45:00			-0.02	0.00	0.16	0.18	0.11	0.64						
23/06/2024 17:00:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.61					
23/06/2024 17:15:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.20					
23/06/2024 17:30:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.20					
23/06/2024 17:45:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.21					
23/06/2024 18:00:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.66					
23/06/2024 18:15:00			-0.02	0.00	0.16	0.18	0.11	0.64						
23/06/2024 18:30:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.29					
23/06/2024 18:45:00			-0.02	0.00	0.16	0.18	0.11	0.64	0.66					
23/06/2024 19:00:00			-0.02	0.00	0.16	0.18	0.11	0.64						
23/06/2024 19:15:00			-0.02	0.00	0.16	0.18	0.11	0.65	0.00					
23/06/2024 19:30:00			-0.02	0.00	0.16	0.18	0.11	0.64						
23/06/2024 19:45:00			-0.02	0.00	0.16	0.18	0.11	0.64						
23/06/2024 20:00:00			-0.02	0.00	0.16	0.18	0.11	0.64						
23/06/2024 20:15:00			-0.02	0.00	0.16	0.18	0.11	0.63						
23/06/2024 20:30:00			-0.02	0.00	0.16	0.18	0.11	0.62						
23/06/2024 20:45:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.01					
23/06/2024 21:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.02					
23/06/2024 21:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.01					
23/06/2024 21:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.00					
23/06/2024 21:45:00			-0.02	0.00	0.16	0.18	0.11	0.62						
23/06/2024 22:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.26					
23/06/2024 22:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.27					
23/06/2024 22:30:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.03					
23/06/2024 22:45:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.00					
23/06/2024 23:00:00			-0.02	0.00	0.16	0.18	0.11	0.63	0.02					
23/06/2024 23:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.01					
23/06/2024 23:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.01					
23/06/2024 23:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.00					
24/06/2024 00:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.01					
24/06/2024 00:15:00			-0.02	0.00	0.16	0.18	0.11	0.62						
24/06/2024 00:30:00			-0.02	0.00	0.16	0.18	0.11	0.62						
24/06/2024 00:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.00					
24/06/2024 01:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.00					
24/06/2024 01:15:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.01					
24/06/2024 01:30:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.01					
24/06/2024 01:45:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.00					
24/06/2024 02:00:00			-0.02	0.00	0.16	0.18	0.11	0.62	0.00					
24/06/2024 02:15:00			-0.02	0.00	0.16	0.18	0.11	0.61						
24/06/2024 02:30:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.00					
24/06/2024 02:45:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.00					
24/06/2024 03:00:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.00					
24/06/2024 03:15:00			-0.02	0.00	0.16	0.18	0.11	0.61	-0.01					
24/06/2024 03:30:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.01					
24/06/2024 03:45:00			-0.02	0.00	0.16	0.18	0.11	0.61						
24/06/2024 04:00:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.00					
24/06/2024 04:15:00			-0.02	0.00	0.16	0.18	0.11	0.61						
24/06/2024 04:30:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.01					
24/06/2024 04:45:00			-0.02	0.00	0.16	0.18	0.11	0.61						
24/06/2024 05:00:00			-0.02	0.00	0.16	0.18	0.11	0.61						
24/06/2024 05:15:00			-0.02	0.00	0.16	0.18	0.11	0.61						
24/06/2024 05:30:00			-0.02	0.00	0.16	0.18	0.11	0.61						
24/06/2024 05:45:00			-0.02	0.00	0.16	0.18	0.11	0.61	0.00					
24/06/2024 06:00:00			-0.02	0.00	0.16	0.18	0.11	0.61	-0.02					
24/06/2024 06:15:00			-0.02	0.00	0.16	0.18	0.11	0.61						
24/06/2024 06:30:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.00					
24/06/2024 06:45:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.00					
24/06/2024 07:00:00			-0.03	0.00	0.16	0.18	0.11	0.61						
24/06/2024 07:15:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.01					
24/06/2024 07:30:00			-0.03	0.00	0.16	0.18	0.11	0.61						
24/06/2024 07:45:00			-0.03	0.00	0.16	0.18	0.11	0.61						
24/06/2024 08:00:00			-0.03	0.00	0.16	0.18	0.11	0.61	-0.01					
24/06/2024 08:15:00			-0.03	0.00	0.16	0.18	0.11	0.62	-0.02					
24/06/2024 08:30:00			-0.03	0.00	0.16	0.18	0.11	0.62						
24/06/2024 08:45:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.02					
24/06/2024 09:00:00			-0.03	0.00	0.16	0.18	0.11	0.62						
24/06/2024 09:15:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.02					
24/06/2024 09:30:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.00					
24/06/2024 09:45:00			-0.03	0.00	0.16	0.18	0.10	0.62						
24/06/2024 10:00:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.00					
24/06/2024 10:15:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.00					
24/06/2024 10:30:00			-0.03	0.00	0.16	0.18	0.10	0.62						
24/06/2024 10:45:00			-0.03	0.00	0.16	0.18	0.10	0.62	-0.01					
24/06/2024 11:00:00			-0.03	0.00	0.16	0.18	0.10	0.62	-0.01					
24/06/2024 11:15:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.32					
24/06/2024 11:30:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.32					
24/06/2024 11:45:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.32					
24/06/2024 12:00:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.32					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
24/06/2024 12:15:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.32					
24/06/2024 12:30:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.30					
24/06/2024 12:45:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.28					
24/06/2024 13:00:00			-0.03	0.00	0.16	0.18	0.10	0.62	0.32					
24/06/2024 13:15:00			-0.03	0.00	0.16	0.17	0.10	0.62	0.32					
24/06/2024 13:30:00			-0.03	0.00	0.16	0.17	0.10	0.62	0.30					
24/06/2024 13:45:00			-0.03	0.00	0.16	0.17	0.10	0.62	0.28					
24/06/2024 14:00:00			-0.03	0.00	0.16	0.17	0.10	0.62	0.28					
24/06/2024 14:15:00			-0.03	0.00	0.16	0.17	0.10	0.62	0.28					
24/06/2024 14:30:00			-0.03	0.00	0.16	0.17	0.10	0.62	0.28					
24/06/2024 14:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
24/06/2024 15:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
24/06/2024 15:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
24/06/2024 15:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
24/06/2024 15:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
24/06/2024 16:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.20					
24/06/2024 16:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.19					
24/06/2024 16:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.26					
24/06/2024 16:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.21					
24/06/2024 17:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.20					
24/06/2024 17:15:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.19					
24/06/2024 17:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
24/06/2024 17:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
24/06/2024 18:00:00			-0.03	0.00	0.15	0.17	0.10	0.61						
24/06/2024 18:15:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.27					
24/06/2024 18:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
24/06/2024 18:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
24/06/2024 19:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.63					
24/06/2024 19:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
24/06/2024 19:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
24/06/2024 19:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 20:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
24/06/2024 20:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
24/06/2024 20:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 20:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.66					
24/06/2024 21:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.34					
24/06/2024 21:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 21:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 21:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 22:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 22:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 22:30:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 22:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 23:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 23:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 23:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
24/06/2024 23:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.32					
25/06/2024 00:00:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 00:15:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 00:30:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 00:45:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 01:00:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 01:15:00			-0.04	0.00	0.15	0.17	0.10	0.61						
25/06/2024 01:30:00			-0.04	0.00	0.15	0.17	0.10	0.61						
25/06/2024 01:45:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.05					
25/06/2024 02:00:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 02:15:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 02:30:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 02:45:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 03:00:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 03:15:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 03:30:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 03:45:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 04:00:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 04:15:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 04:30:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 04:45:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.00					
25/06/2024 05:00:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.25					
25/06/2024 05:15:00			-0.04	0.00	0.15	0.17	0.10	0.61						
25/06/2024 05:30:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 05:45:00			-0.04	0.00	0.15	0.17	0.10	0.60	0.32					
25/06/2024 06:00:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 06:15:00			-0.04	0.00	0.15	0.17	0.10	0.60	0.32					
25/06/2024 06:30:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 06:45:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 07:00:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 07:15:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 07:30:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 07:45:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 08:00:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 08:15:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.32					
25/06/2024 08:30:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.32					
25/06/2024 08:45:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.32					
25/06/2024 09:00:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.32					
25/06/2024 09:15:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.32					
25/06/2024 09:30:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.32					
25/06/2024 09:45:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.32					
25/06/2024 10:00:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.32					
25/06/2024 10:15:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.32					
25/06/2024 10:30:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.32					
25/06/2024 10:45:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.32					
25/06/2024 11:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 11:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 11:30:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.05					
25/06/2024 11:45:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.64					
25/06/2024 12:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 12:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 12:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 12:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 13:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 13:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 13:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 13:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 14:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 14:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 14:30:00			-0.04	0.00	0.15	0.17	0.10	0.63						
25/06/2024 14:45:00			-0.04	0.00	0.15	0.17	0.10	0.63						
25/06/2024 15:00:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.17					
25/06/2024 15:15:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.00					
25/06/2024 15:30:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
25/06/2024 15:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
25/06/2024 16:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.14					
25/06/2024 16:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 16:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 16:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 17:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 17:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 17:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 17:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 18:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 18:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 18:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.35					
25/06/2024 18:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
25/06/2024 19:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
25/06/2024 19:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.64					
25/06/2024 19:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
25/06/2024 19:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
25/06/2024 20:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
25/06/2024 20:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
25/06/2024 20:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
25/06/2024 20:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
25/06/2024 21:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
25/06/2024 21:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
25/06/2024 21:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
25/06/2024 21:45:00			-0.04	0.00	0.15	0.17	0.10	0.63						
25/06/2024 22:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
25/06/2024 22:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 22:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 22:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
25/06/2024 23:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
25/06/2024 23:15:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.00					
25/06/2024 23:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
25/06/2024 23:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 00:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 00:15:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 00:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 00:45:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 01:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 01:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 01:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 01:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 02:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 02:15:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 02:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 02:45:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 03:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 03:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 03:30:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
26/06/2024 03:45:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
26/06/2024 04:00:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
26/06/2024 04:15:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
26/06/2024 04:30:00			-0.04	0.00	0.15	0.17	0.10	0.61	0.00					
26/06/2024 04:45:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
26/06/2024 05:00:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
26/06/2024 05:15:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
26/06/2024 05:30:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
26/06/2024 05:45:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.00					
26/06/2024 06:00:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.66					
26/06/2024 06:15:00			-0.04	0.00	0.15	0.17	0.10	0.61						
26/06/2024 06:30:00			-0.04	0.00	0.15	0.17	0.10	0.61						
26/06/2024 06:45:00			-0.04	0.00	0.15	0.17	0.10	0.61						
26/06/2024 07:00:00			-0.04	0.00	0.15	0.17	0.10	0.61						
26/06/2024 07:15:00			-0.04	0.00	0.15	0.17	0.10	0.61						
26/06/2024 07:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 07:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 08:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 08:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 08:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 08:45:00			-0.04	0.00	0.15	0.17	0.10	0.60						
26/06/2024 09:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 09:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 09:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 09:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 10:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 10:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 10:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 10:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 11:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 11:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 11:30:00			-0.04	0.00	0.15	0.17	0.10	0.63						
26/06/2024 11:45:00			-0.04	0.00	0.15	0.17	0.10	0.63						
26/06/2024 12:00:00			-0.04	0.00	0.15	0.17	0.10	0.63						
26/06/2024 12:15:00			-0.04	0.00	0.15	0.17	0.10	0.63						
26/06/2024 12:30:00			-0.04	0.00	0.15	0.17	0.10	0.60						
26/06/2024 12:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 13:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 13:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 13:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 13:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 14:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 14:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
26/06/2024 14:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
26/06/2024 14:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 15:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 15:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
26/06/2024 15:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 15:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
26/06/2024 16:00:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 16:15:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 16:30:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.64					
26/06/2024 16:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
26/06/2024 17:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
26/06/2024 17:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
26/06/2024 17:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
26/06/2024 17:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
26/06/2024 18:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 18:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
26/06/2024 18:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.13					
26/06/2024 18:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.26					
26/06/2024 19:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
26/06/2024 19:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
26/06/2024 19:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
26/06/2024 19:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
26/06/2024 20:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
26/06/2024 20:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
26/06/2024 20:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
26/06/2024 20:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
26/06/2024 21:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
26/06/2024 21:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
26/06/2024 21:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
26/06/2024 21:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
26/06/2024 22:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
26/06/2024 22:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
26/06/2024 22:30:00			-0.04	0.00	0.15	0.18	0.10	0.63						
26/06/2024 22:45:00			-0.04	0.00	0.15	0.18	0.10	0.63						
26/06/2024 23:00:00			-0.04	0.00	0.15	0.18	0.10	0.63						
26/06/2024 23:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
26/06/2024 23:30:00			-0.03	0.00	0.15	0.18	0.10	0.63						
26/06/2024 23:45:00			-0.03	0.00	0.15	0.18	0.10	0.63						
27/06/2024 00:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
27/06/2024 00:15:00			-0.04	0.00	0.16	0.17	0.10	0.62						
27/06/2024 00:30:00			-0.03	0.00	0.16	0.17	0.10	0.62						
27/06/2024 00:45:00			-0.03	0.00	0.16	0.18	0.10	0.62						
27/06/2024 01:00:00			-0.04	0.00	0.16	0.18	0.10	0.62						
27/06/2024 01:15:00			-0.04	0.00	0.16	0.18	0.10	0.62						
27/06/2024 01:30:00			-0.04	0.00	0.16	0.18	0.10	0.62						
27/06/2024 01:45:00			-0.04	0.00	0.16	0.18	0.10	0.62						
27/06/2024 02:00:00			-0.04	0.00	0.16	0.18	0.10	0.62						
27/06/2024 02:15:00			-0.03	0.00	0.16	0.18	0.10	0.62						
27/06/2024 02:30:00			-0.03	0.00	0.16	0.18	0.10	0.62						
27/06/2024 02:45:00			-0.03	0.00	0.15	0.18	0.10	0.62						
27/06/2024 03:00:00			-0.03	0.00	0.15	0.18	0.10	0.62						
27/06/2024 03:15:00			-0.03	0.00	0.15	0.18	0.10	0.62						
27/06/2024 03:30:00			-0.03	0.00	0.15	0.18	0.10	0.62						
27/06/2024 03:45:00			-0.03	0.00	0.15	0.18	0.10	0.62						
27/06/2024 04:00:00			-0.03	0.00	0.15	0.18	0.10	0.62						
27/06/2024 04:15:00			-0.03	0.00	0.15	0.18	0.10	0.62						
27/06/2024 04:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
27/06/2024 04:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
27/06/2024 05:00:00			-0.03	0.00	0.15	0.17	0.10	0.61						
27/06/2024 05:15:00			-0.04	0.00	0.15	0.17	0.10	0.61						
27/06/2024 05:30:00			-0.04	0.00	0.15	0.17	0.10	0.61						
27/06/2024 05:45:00			-0.04	0.00	0.15	0.17	0.10	0.61						
27/06/2024 06:00:00			-0.04	0.00	0.15	0.17	0.10	0.61						
27/06/2024 06:15:00			-0.04	0.00	0.15	0.17	0.10	0.61						
27/06/2024 06:30:00			-0.04	0.00	0.15	0.17	0.10	0.61						
27/06/2024 06:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
27/06/2024 07:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
27/06/2024 07:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
27/06/2024 07:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
27/06/2024 07:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
27/06/2024 08:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
27/06/2024 08:15:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.28					
27/06/2024 08:30:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.66					
27/06/2024 08:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
27/06/2024 09:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
27/06/2024 09:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
27/06/2024 09:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.26					
27/06/2024 09:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.23					
27/06/2024 10:00:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.27					
27/06/2024 10:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.28					
27/06/2024 10:30:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.28					
27/06/2024 10:45:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.26					
27/06/2024 11:00:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.25					
27/06/2024 11:15:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.25					
27/06/2024 11:30:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.27					
27/06/2024 11:45:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.27					
27/06/2024 12:00:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 12:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.29					
27/06/2024 12:30:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.29					
27/06/2024 12:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.29					
27/06/2024 13:00:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 13:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 13:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 13:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 14:00:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 14:15:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 14:30:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 14:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 15:00:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 15:15:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.29					
27/06/2024 15:30:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.30					
27/06/2024 15:45:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.31					
27/06/2024 16:00:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.30					
27/06/2024 16:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.30					
27/06/2024 16:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.30					
27/06/2024 16:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
27/06/2024 17:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
27/06/2024 17:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
27/06/2024 17:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.07					
27/06/2024 17:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.25					
27/06/2024 18:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.27					
27/06/2024 18:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.27					
27/06/2024 18:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.27					
27/06/2024 18:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.27					
27/06/2024 19:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.27					
27/06/2024 19:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.27					
27/06/2024 19:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.27					
27/06/2024 19:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.29					
27/06/2024 20:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
27/06/2024 20:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
27/06/2024 20:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
27/06/2024 20:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
27/06/2024 21:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
27/06/2024 21:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
27/06/2024 21:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
27/06/2024 21:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.29					
27/06/2024 22:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.30					
27/06/2024 22:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.30					
27/06/2024 22:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.30					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
27/06/2024 22:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.31					
27/06/2024 23:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.31					
27/06/2024 23:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.31					
27/06/2024 23:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.31					
27/06/2024 23:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.27					
28/06/2024 00:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.31					
28/06/2024 00:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.31					
28/06/2024 00:30:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.26					
28/06/2024 00:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.65					
28/06/2024 01:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
28/06/2024 01:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.50					
28/06/2024 01:30:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.26					
28/06/2024 01:45:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.25					
28/06/2024 02:00:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.25					
28/06/2024 02:15:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.25					
28/06/2024 02:30:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.29					
28/06/2024 02:45:00			-0.03	0.00	0.15	0.17	0.10	0.61	0.32					
28/06/2024 03:00:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.32					
28/06/2024 03:15:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.32					
28/06/2024 03:30:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.29					
28/06/2024 03:45:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.32					
28/06/2024 04:00:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.66					
28/06/2024 04:15:00			-0.03	0.00	0.15	0.17	0.09	0.61						
28/06/2024 04:30:00			-0.03	0.00	0.15	0.17	0.09	0.61						
28/06/2024 04:45:00			-0.03	0.00	0.15	0.17	0.09	0.61						
28/06/2024 05:00:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.27					
28/06/2024 05:15:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 05:30:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 05:45:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 06:00:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 06:15:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 06:30:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 06:45:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 07:00:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 07:15:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 07:30:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 07:45:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 08:00:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.25					
28/06/2024 08:15:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 08:30:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 08:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 09:00:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 09:15:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 09:30:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.67					
28/06/2024 09:45:00			-0.03	0.00	0.15	0.17	0.09	0.62						
28/06/2024 10:00:00			-0.03	0.00	0.15	0.17	0.09	0.62						
28/06/2024 10:15:00			-0.04	0.00	0.15	0.17	0.09	0.62						
28/06/2024 10:30:00			-0.03	0.00	0.15	0.17	0.09	0.62						
28/06/2024 10:45:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 11:00:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 11:15:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 11:30:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 11:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 12:00:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 12:15:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 12:30:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 12:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 13:00:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 13:15:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 13:30:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 13:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 14:00:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 14:15:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 14:30:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 14:45:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 15:00:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 15:15:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 15:30:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 15:45:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 16:00:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 16:15:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 16:30:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 16:45:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 17:00:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 17:15:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 17:30:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 17:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 18:00:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 18:15:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 18:30:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 18:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 19:00:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 19:15:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 19:30:00			-0.03	0.00	0.15	0.17	0.09	0.62						
28/06/2024 19:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	-0.01					
28/06/2024 20:00:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.24					
28/06/2024 20:15:00			-0.03	0.00	0.15	0.17	0.09	0.62						
28/06/2024 20:30:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.55					
28/06/2024 20:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 21:00:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.67					
28/06/2024 21:15:00			-0.03	0.00	0.15	0.17	0.09	0.62						
28/06/2024 21:30:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 21:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 22:00:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 22:15:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 22:30:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 22:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 23:00:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 23:15:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 23:30:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.25					
28/06/2024 23:45:00			-0.03	0.00	0.15	0.17	0.09	0.62	0.25					
29/06/2024 00:00:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.04					
29/06/2024 00:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 00:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 00:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
29/06/2024 01:00:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.25					
29/06/2024 01:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 01:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.25					
29/06/2024 01:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.25					
29/06/2024 02:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
29/06/2024 02:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 02:30:00			-0.03	0.00	0.15	0.17	0.09	0.62						
29/06/2024 02:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 03:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 03:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 03:30:00			-0.03	0.00	0.15	0.17	0.09	0.62						
29/06/2024 03:45:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.03					
29/06/2024 04:00:00			-0.03	0.00	0.15	0.17	0.09	0.61						
29/06/2024 04:15:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.02					
29/06/2024 04:30:00			-0.03	0.00	0.15	0.17	0.09	0.61	0.01					
29/06/2024 04:45:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 05:00:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.00					
29/06/2024 05:15:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 05:30:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 05:45:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.01					
29/06/2024 06:00:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 06:15:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 06:30:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 06:45:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.00					
29/06/2024 07:00:00			-0.04	0.00	0.15	0.17	0.09	0.61	0.00					
29/06/2024 07:15:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 07:30:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 07:45:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 08:00:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 08:15:00			-0.04	0.00	0.15	0.17	0.09	0.61						
29/06/2024 08:30:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 08:45:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 09:00:00			-0.04	0.00	0.15	0.17	0.09	0.62	0.00					
29/06/2024 09:15:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 09:30:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 09:45:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 10:00:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 10:15:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 10:30:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 10:45:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 11:00:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 11:15:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 11:30:00			-0.04	0.00	0.15	0.17	0.09	0.63						
29/06/2024 11:45:00			-0.04	0.00	0.15	0.17	0.09	0.63						
29/06/2024 12:00:00			-0.04	0.00	0.15	0.17	0.09	0.63						
29/06/2024 12:15:00			-0.04	0.00	0.15	0.15	0.09	0.63						
29/06/2024 12:30:00			-0.04	0.00	0.15	0.17	0.09	0.63						
29/06/2024 12:45:00			-0.04	0.00	0.15	0.17	0.09	0.63	0.00					
29/06/2024 13:00:00			-0.04	0.00	0.15	0.17	0.09	0.63						
29/06/2024 13:15:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 13:30:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 13:45:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 14:00:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 14:15:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 14:30:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 14:45:00			-0.04	0.00	0.15	0.17	0.09	0.62						
29/06/2024 15:00:00			-0.03	0.00	0.15	0.17	0.09	0.62						
29/06/2024 15:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 15:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 15:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 16:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 16:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 16:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 16:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 17:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 17:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 17:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 17:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 18:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 18:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 18:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 18:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 19:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
29/06/2024 19:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.31					
29/06/2024 19:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.26					
29/06/2024 19:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.26					
29/06/2024 20:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 20:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
29/06/2024 20:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
29/06/2024 20:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
29/06/2024 21:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
29/06/2024 21:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
29/06/2024 21:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
29/06/2024 21:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
29/06/2024 22:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
29/06/2024 22:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 22:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
29/06/2024 22:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 23:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 23:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 23:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
29/06/2024 23:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 00:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
30/06/2024 00:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
30/06/2024 00:30:00			-0.04	0.00	0.15	0.17	0.10	0.62						
30/06/2024 00:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
30/06/2024 01:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
30/06/2024 01:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
30/06/2024 01:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 01:45:00			-0.04	0.00	0.15	0.17	0.10	0.62						
30/06/2024 02:00:00			-0.04	0.00	0.15	0.17	0.10	0.62						
30/06/2024 02:15:00			-0.04	0.00	0.15	0.17	0.10	0.62						
30/06/2024 02:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 02:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 03:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 03:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 03:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 03:45:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 04:00:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 04:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 04:30:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 04:45:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 05:00:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 05:15:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 05:30:00			-0.03	0.00	0.15	0.17	0.10	0.61						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
30/06/2024 05:45:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 06:00:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 06:15:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 06:30:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 06:45:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 07:00:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 07:15:00			-0.03	0.00	0.15	0.17	0.10	0.61						
30/06/2024 07:30:00			-0.04	0.00	0.15	0.17	0.10	0.61						
30/06/2024 07:45:00			-0.04	0.00	0.15	0.17	0.10	0.61						
30/06/2024 08:00:00			-0.04	0.00	0.15	0.17	0.09	0.61						
30/06/2024 08:15:00			-0.03	0.00	0.15	0.17	0.09	0.61						
30/06/2024 08:30:00			-0.03	0.00	0.15	0.17	0.09	0.62						
30/06/2024 08:45:00			-0.03	0.00	0.15	0.17	0.09	0.62						
30/06/2024 09:00:00			-0.04	0.00	0.15	0.17	0.09	0.62						
30/06/2024 09:15:00			-0.03	0.00	0.15	0.17	0.09	0.62						
30/06/2024 09:30:00			-0.03	0.00	0.15	0.17	0.09	0.62						
30/06/2024 09:45:00			-0.03	0.00	0.15	0.17	0.09	0.62						
30/06/2024 10:00:00			-0.03	0.00	0.15	0.17	0.09	0.62						
30/06/2024 10:15:00			-0.03	0.00	0.15	0.17	0.09	0.62						
30/06/2024 10:30:00			-0.03	0.00	0.15	0.17	0.09	0.62						
30/06/2024 10:45:00			-0.03	0.00	0.15	0.17	0.09	0.62						
30/06/2024 11:00:00			-0.03	0.00	0.15	0.17	0.09	0.62						
30/06/2024 11:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.00					
30/06/2024 11:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.61					
30/06/2024 11:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 12:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
30/06/2024 12:15:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.51					
30/06/2024 12:30:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.32					
30/06/2024 12:45:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.31					
30/06/2024 13:00:00			-0.04	0.00	0.15	0.17	0.10	0.63						
30/06/2024 13:15:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.29					
30/06/2024 13:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
30/06/2024 13:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
30/06/2024 14:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.29					
30/06/2024 14:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
30/06/2024 14:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.29					
30/06/2024 14:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 15:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 15:15:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 15:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.29					
30/06/2024 15:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.29					
30/06/2024 16:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
30/06/2024 16:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.29					
30/06/2024 16:30:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.29					
30/06/2024 16:45:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.28					
30/06/2024 17:00:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.36					
30/06/2024 17:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.28					
30/06/2024 17:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
30/06/2024 17:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
30/06/2024 18:00:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.27					
30/06/2024 18:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.27					
30/06/2024 18:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
30/06/2024 18:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
30/06/2024 19:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
30/06/2024 19:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.07					
30/06/2024 19:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.00					
30/06/2024 19:45:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.00					
30/06/2024 20:00:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.63					
30/06/2024 20:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
30/06/2024 20:30:00			-0.03	0.00	0.15	0.18	0.10	0.62						
30/06/2024 20:45:00			-0.03	0.00	0.15	0.18	0.10	0.63						
30/06/2024 21:00:00			-0.03	0.00	0.15	0.18	0.10	0.61						
30/06/2024 21:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
30/06/2024 21:30:00			-0.03	0.00	0.15	0.18	0.10	0.60	0.30					
30/06/2024 21:45:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.29					
30/06/2024 22:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
30/06/2024 22:15:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.20					
30/06/2024 22:30:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.66					
30/06/2024 22:45:00			-0.03	0.00	0.15	0.18	0.10	0.63						
30/06/2024 23:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
30/06/2024 23:15:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.32					
30/06/2024 23:30:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.30					
30/06/2024 23:45:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.30					
01/07/2024 00:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
01/07/2024 00:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
01/07/2024 00:30:00			-0.03	0.00	0.16	0.18	0.10	0.63						
01/07/2024 00:45:00			-0.03	0.00	0.16	0.18	0.10	0.63						
01/07/2024 01:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
01/07/2024 01:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
01/07/2024 01:30:00			-0.03	0.00	0.15	0.18	0.10	0.63						
01/07/2024 01:45:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 02:00:00			-0.03	0.00	0.16	0.18	0.10	0.62						
01/07/2024 02:15:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 02:30:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 02:45:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 03:00:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 03:15:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 03:30:00			-0.03	0.00	0.15	0.18	0.10	0.63						
01/07/2024 03:45:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 04:00:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 04:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 04:30:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 04:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
01/07/2024 05:00:00			-0.03	0.00	0.15	0.17	0.10	0.62						
01/07/2024 05:15:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 05:30:00			-0.03	0.00	0.15	0.17	0.10	0.62						
01/07/2024 05:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
01/07/2024 06:00:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 06:15:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 06:30:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 06:45:00			-0.03	0.00	0.15	0.18	0.10	0.62						
01/07/2024 07:00:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.30					
01/07/2024 07:15:00			-0.03	0.00	0.15	0.17	0.10	0.62	0.30					
01/07/2024 07:30:00			-0.04	0.00	0.15	0.17	0.10	0.62	0.30					
01/07/2024 07:45:00			-0.03	0.00	0.15	0.17	0.10	0.62						
01/07/2024 08:00:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.30					
01/07/2024 08:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.30					
01/07/2024 08:30:00			-0.04	0.00	0.15	0.17	0.10	0.63						
01/07/2024 08:45:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.30					
01/07/2024 09:00:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.30					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
01/07/2024 09:15:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.30					
01/07/2024 09:30:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.30					
01/07/2024 09:45:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.30					
01/07/2024 10:00:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.30					
01/07/2024 10:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 10:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 10:45:00			-0.03	0.00	0.15	0.17	0.10	0.64	0.28					
01/07/2024 11:00:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.29					
01/07/2024 11:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.66					
01/07/2024 11:30:00			-0.04	0.00	0.15	0.17	0.10	0.63						
01/07/2024 11:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 12:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 12:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 12:30:00			-0.04	0.00	0.15	0.17	0.10	0.63						
01/07/2024 12:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 13:00:00			-0.04	0.00	0.15	0.17	0.10	0.63						
01/07/2024 13:15:00			-0.04	0.00	0.15	0.17	0.10	0.63						
01/07/2024 13:30:00			-0.04	0.00	0.15	0.17	0.10	0.63						
01/07/2024 13:45:00			-0.04	0.00	0.15	0.17	0.10	0.63						
01/07/2024 14:00:00			-0.04	0.00	0.15	0.17	0.10	0.63						
01/07/2024 14:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 14:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 14:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 15:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 15:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 15:30:00			-0.04	0.00	0.15	0.17	0.10	0.63						
01/07/2024 15:45:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.34					
01/07/2024 16:00:00			-0.04	0.00	0.15	0.17	0.10	0.63	0.27					
01/07/2024 16:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.28					
01/07/2024 16:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
01/07/2024 16:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
01/07/2024 17:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 17:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 17:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 17:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 18:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 18:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 18:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.27					
01/07/2024 18:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.27					
01/07/2024 19:00:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.27					
01/07/2024 19:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.27					
01/07/2024 19:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
01/07/2024 19:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.28					
01/07/2024 20:00:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.27					
01/07/2024 20:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.26					
01/07/2024 20:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.28					
01/07/2024 20:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.30					
01/07/2024 21:00:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.67					
01/07/2024 21:15:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.28					
01/07/2024 21:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.26					
01/07/2024 21:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.26					
01/07/2024 22:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 22:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
01/07/2024 22:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.30					
01/07/2024 22:45:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.67					
01/07/2024 23:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
01/07/2024 23:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
01/07/2024 23:30:00			-0.04	0.00	0.15	0.18	0.10	0.63						
01/07/2024 23:45:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 00:00:00			-0.04	0.00	0.15	0.18	0.10	0.63						
02/07/2024 00:15:00			-0.04	0.00	0.15	0.18	0.10	0.63						
02/07/2024 00:30:00			-0.04	0.00	0.15	0.18	0.10	0.63						
02/07/2024 00:45:00			-0.04	0.00	0.15	0.18	0.10	0.63						
02/07/2024 01:00:00			-0.04	0.00	0.15	0.18	0.10	0.63						
02/07/2024 01:15:00			-0.04	0.00	0.15	0.18	0.10	0.63						
02/07/2024 01:30:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 01:45:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 02:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 02:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 02:30:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 02:45:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 03:00:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 03:15:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 03:30:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 03:45:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 04:00:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 04:15:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 04:30:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 04:45:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 05:00:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 05:15:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 05:30:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 05:45:00			-0.03	0.00	0.15	0.18	0.10	0.62	0.68					
02/07/2024 06:00:00			-0.03	0.00	0.15	0.18	0.10	0.62						
02/07/2024 06:15:00			-0.03	0.00	0.15	0.18	0.10	0.62	0.29					
02/07/2024 06:30:00			-0.03	0.00	0.15	0.18	0.10	0.62	0.29					
02/07/2024 06:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.29					
02/07/2024 07:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
02/07/2024 07:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
02/07/2024 07:30:00			-0.03	0.00	0.15	0.17	0.10	0.63						
02/07/2024 07:45:00			-0.03	0.00	0.15	0.17	0.10	0.63						
02/07/2024 08:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
02/07/2024 08:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
02/07/2024 08:30:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.31					
02/07/2024 08:45:00			-0.03	0.00	0.15	0.17	0.10	0.63	0.31					
02/07/2024 09:00:00			-0.03	0.00	0.15	0.17	0.10	0.63						
02/07/2024 09:15:00			-0.03	0.00	0.15	0.17	0.10	0.63						
02/07/2024 09:30:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 09:45:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 10:00:00			-0.04	0.00	0.15	0.18	0.10	0.63						
02/07/2024 10:15:00			-0.04	0.00	0.15	0.18	0.10	0.63	0.28					
02/07/2024 10:30:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.65					
02/07/2024 10:45:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 11:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 11:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 11:30:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 11:45:00			-0.04	0.00	0.15	0.18	0.10	0.63						
02/07/2024 12:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 12:15:00			-0.04	0.00	0.15	0.18	0.10	0.63						
02/07/2024 12:30:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.17					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
02/07/2024 12:45:00			-0.03	0.00	0.15	0.18	0.10	0.63	0.59					
02/07/2024 13:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 13:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 13:30:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 13:45:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 14:00:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 14:15:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 14:30:00			-0.03	0.00	0.15	0.18	0.10	0.63						
02/07/2024 14:45:00			-0.03	0.00	0.16	0.18	0.10	0.63						
02/07/2024 15:00:00			-0.03	0.00	0.16	0.18	0.10	0.63						
02/07/2024 15:15:00			-0.03	0.00	0.16	0.18	0.10	0.63						
02/07/2024 15:30:00			-0.04	0.00	0.16	0.18	0.10	0.63						
02/07/2024 15:45:00			-0.04	0.00	0.16	0.18	0.10	0.63						
02/07/2024 16:00:00			-0.04	0.00	0.16	0.18	0.10	0.63						
02/07/2024 16:15:00			-0.04	0.00	0.16	0.18	0.10	0.63						
02/07/2024 16:30:00			-0.03	0.00	0.16	0.18	0.10	0.63						
02/07/2024 16:45:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 17:00:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 17:15:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 17:30:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 17:45:00			-0.04	0.00	0.16	0.18	0.10	0.64						
02/07/2024 18:00:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 18:15:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 18:30:00			-0.03	0.00	0.16	0.18	0.10	0.64	0.51					
02/07/2024 18:45:00			-0.03	0.00	0.16	0.18	0.10	0.64	0.29					
02/07/2024 19:00:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 19:15:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 19:30:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 19:45:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 20:00:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 20:15:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 20:30:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 20:45:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 21:00:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 21:15:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 21:30:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 21:45:00			-0.03	0.00	0.16	0.18	0.10	0.64						
02/07/2024 22:00:00			-0.03	0.00	0.16	0.18	0.11	0.64						
02/07/2024 22:15:00			-0.03	0.00	0.16	0.18	0.11	0.64	0.30					
02/07/2024 22:30:00			-0.03	0.00	0.16	0.18	0.11	0.64	0.27					
02/07/2024 22:45:00			-0.03	0.00	0.16	0.18	0.11	0.64						
02/07/2024 23:00:00			-0.04	0.00	0.16	0.18	0.11	0.64	0.25					
02/07/2024 23:15:00			-0.04	0.00	0.16	0.18	0.11	0.64	0.25					
02/07/2024 23:30:00			-0.04	0.00	0.16	0.18	0.11	0.64	0.27					
02/07/2024 23:45:00			-0.04	0.00	0.16	0.18	0.11	0.64	0.27					
03/07/2024 00:00:00			-0.04	0.00	0.16	0.18	0.11	0.61	0.39					
03/07/2024 00:15:00			-0.04	0.00	0.16	0.18	0.11	0.62						
03/07/2024 00:30:00			-0.04	0.00	0.16	0.18	0.11	0.57	0.26					
03/07/2024 00:45:00			-0.03	0.00	0.16	0.18	0.11	0.60						
03/07/2024 01:00:00			-0.03	0.00	0.16	0.18	0.11	0.57						
03/07/2024 01:15:00			-0.03	0.00	0.16	0.18	0.11	0.58	0.13					
03/07/2024 01:30:00			-0.03	0.00	0.16	0.18	0.11	0.58	0.66					
03/07/2024 01:45:00			-0.03	0.00	0.16	0.18	0.11	0.58	0.27					
03/07/2024 02:00:00			-0.03	0.00	0.16	0.18	0.11	0.59	0.26					
03/07/2024 02:15:00			-0.03	0.00	0.16	0.18	0.11	0.58						
03/07/2024 02:30:00			-0.03	0.00	0.16	0.18	0.11	0.59						
03/07/2024 02:45:00			-0.03	0.00	0.16	0.18	0.11	0.60	0.28					
03/07/2024 03:00:00			-0.03	0.00	0.16	0.18	0.11	0.59						
03/07/2024 03:15:00			-0.03	0.00	0.16	0.18	0.11	0.59						
03/07/2024 03:30:00			-0.03	0.00	0.16	0.18	0.11	0.60	0.07					
03/07/2024 03:45:00			-0.03	0.00	0.16	0.18	0.11	0.60	0.00					
03/07/2024 04:00:00			-0.03	0.00	0.16	0.18	0.11	0.60	0.00					
03/07/2024 04:15:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.00					
03/07/2024 04:30:00			-0.03	0.00	0.16	0.18	0.11	0.61	0.39					
03/07/2024 04:45:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.27					
03/07/2024 05:00:00			-0.03	0.00	0.16	0.18	0.11	0.62	0.65					
03/07/2024 05:15:00			-0.03	0.00	0.16	0.18	0.11	0.63						
03/07/2024 05:30:00			-0.03	0.00	0.16	0.18	0.11	0.63	0.28					
03/07/2024 05:45:00			-0.03	0.00	0.16	0.19	0.11	0.63	0.27					
03/07/2024 06:00:00			-0.03	0.00	0.16	0.19	0.11	0.64	0.27					
03/07/2024 06:15:00			-0.03	0.00	0.17	0.19	0.11	0.64	0.27					
03/07/2024 06:30:00			-0.03	0.00	0.17	0.19	0.11	0.64	0.27					
03/07/2024 06:45:00			-0.03	0.00	0.17	0.19	0.11	0.65	0.66					
03/07/2024 07:00:00			-0.03	0.00	0.17	0.19	0.11	0.65						
03/07/2024 07:15:00			-0.03	0.00	0.17	0.19	0.12	0.65						
03/07/2024 07:30:00			-0.03	0.00	0.17	0.19	0.12	0.65	0.51					
03/07/2024 07:45:00			-0.03	0.00	0.17	0.19	0.12	0.65	0.28					
03/07/2024 08:00:00			-0.03	0.00	0.17	0.19	0.12	0.65						
03/07/2024 08:15:00			-0.03	0.00	0.17	0.20	0.12	0.65						
03/07/2024 08:30:00			-0.03	0.00	0.18	0.20	0.12	0.65						
03/07/2024 08:45:00			-0.03	0.00	0.18	0.20	0.12	0.66						
03/07/2024 09:00:00			-0.03	0.00	0.18	0.20	0.13	0.66						
03/07/2024 09:15:00			-0.03	0.00	0.18	0.20	0.13	0.66						
03/07/2024 09:30:00			-0.03	0.00	0.18	0.20	0.13	0.66						
03/07/2024 09:45:00			-0.03	0.00	0.18	0.20	0.13	0.66						
03/07/2024 10:00:00			-0.03	0.00	0.18	0.20	0.13	0.66						
03/07/2024 10:15:00			-0.03	0.00	0.18	0.20	0.13	0.66	0.31					
03/07/2024 10:30:00			-0.03	0.00	0.18	0.20	0.13	0.65						
03/07/2024 10:45:00			-0.03	0.00	0.19	0.21	0.13	0.65						
03/07/2024 11:00:00			-0.03	0.00	0.19	0.21	0.13	0.65						
03/07/2024 11:15:00			-0.02	0.00	0.19	0.21	0.13	0.65						
03/07/2024 11:30:00			-0.03	0.00	0.19	0.21	0.13	0.65						
03/07/2024 11:45:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 12:00:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 12:15:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 12:30:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 12:45:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 13:00:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 13:15:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 13:30:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 13:45:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 14:00:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 14:15:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 14:30:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 14:45:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 15:00:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 15:15:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 15:30:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 15:45:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 16:00:00			-0.02	0.00	0.19	0.21	0.14	0.65						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
03/07/2024 16:15:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 16:30:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 16:45:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 17:00:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 17:15:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 17:30:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 17:45:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 18:00:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 18:15:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 18:30:00			-0.02	0.00	0.19	0.21	0.14	0.65						
03/07/2024 18:45:00			-0.02	0.00	0.19	0.21	0.14	0.65	0.00					
03/07/2024 19:00:00			-0.02	0.00	0.19	0.21	0.14	0.65	0.00					
03/07/2024 19:15:00			-0.02	0.00	0.19	0.21	0.14	0.65	0.00					
03/07/2024 19:30:00			-0.02	0.00	0.19	0.21	0.14	0.66	0.00					
03/07/2024 19:45:00			-0.02	0.00	0.19	0.21	0.14	0.66	0.00					
03/07/2024 20:00:00			-0.02	0.00	0.19	0.21	0.14	0.66	0.00					
03/07/2024 20:15:00			-0.02	0.00	0.19	0.21	0.14	0.66	0.00					
03/07/2024 20:30:00			-0.02	0.00	0.19	0.21	0.14	0.66	0.00					
03/07/2024 20:45:00			-0.02	0.00	0.19	0.21	0.14	0.66	0.00					
03/07/2024 21:00:00			-0.02	0.00	0.19	0.21	0.14	0.66	0.00					
03/07/2024 21:15:00			-0.02	0.00	0.19	0.21	0.14	0.66	0.65					
03/07/2024 21:30:00			-0.02	0.00	0.19	0.21	0.14	0.66						
03/07/2024 21:45:00			-0.02	0.00	0.19	0.21	0.14	0.66						
03/07/2024 22:00:00			-0.02	0.00	0.19	0.21	0.14	0.66						
03/07/2024 22:15:00			-0.02	0.00	0.19	0.21	0.14	0.66						
03/07/2024 22:30:00			-0.02	0.00	0.19	0.21	0.14	0.66						
03/07/2024 22:45:00			-0.02	0.00	0.19	0.21	0.14	0.66						
03/07/2024 23:00:00			-0.02	0.00	0.19	0.21	0.14	0.65	0.00					
03/07/2024 23:15:00			-0.02	0.00	0.19	0.21	0.14	0.65	0.59					
03/07/2024 23:30:00			-0.01	0.00	0.19	0.21	0.14	0.65						
03/07/2024 23:45:00			-0.01	0.00	0.19	0.21	0.14	0.65	0.29					
04/07/2024 00:00:00			-0.01	0.00	0.19	0.21	0.14	0.65						
04/07/2024 00:15:00			-0.01	0.00	0.19	0.21	0.14	0.65						
04/07/2024 00:30:00			-0.01	0.00	0.19	0.21	0.14	0.65	0.00					
04/07/2024 00:45:00			-0.01	0.00	0.19	0.21	0.14	0.65	0.00					
04/07/2024 01:00:00			-0.01	0.00	0.19	0.21	0.14	0.65	0.00					
04/07/2024 01:15:00			-0.01	0.00	0.19	0.21	0.14	0.65	0.00					
04/07/2024 01:30:00			-0.01	0.00	0.19	0.21	0.14	0.65	0.00					
04/07/2024 01:45:00			-0.02	0.00	0.19	0.21	0.14	0.64	0.00					
04/07/2024 02:00:00			-0.01	0.00	0.19	0.21	0.14	0.64	0.00					
04/07/2024 02:15:00			-0.01	0.00	0.19	0.21	0.14	0.64	0.00					
04/07/2024 02:30:00			-0.01	0.00	0.19	0.21	0.14	0.64	0.00					
04/07/2024 02:45:00			-0.01	0.00	0.19	0.21	0.14	0.64	0.00					
04/07/2024 03:00:00			-0.01	0.00	0.19	0.21	0.13	0.64	0.31					
04/07/2024 03:15:00			-0.01	0.00	0.19	0.21	0.13	0.64	0.26					
04/07/2024 03:30:00			-0.01	0.00	0.19	0.21	0.13	0.64	0.26					
04/07/2024 03:45:00			-0.01	0.00	0.19	0.21	0.13	0.64	0.26					
04/07/2024 04:00:00			-0.01	0.00	0.19	0.21	0.13	0.64	0.26					
04/07/2024 04:15:00			-0.01	0.00	0.19	0.21	0.13	0.64						
04/07/2024 04:30:00			-0.01	0.00	0.18	0.21	0.13	0.64	0.26					
04/07/2024 04:45:00			-0.01	0.00	0.18	0.21	0.13	0.64	0.26					
04/07/2024 05:00:00			-0.01	0.00	0.18	0.21	0.13	0.63	0.26					
04/07/2024 05:15:00			-0.01	0.00	0.18	0.20	0.13	0.63	0.26					
04/07/2024 05:30:00			-0.02	0.00	0.18	0.20	0.13	0.63	0.26					
04/07/2024 05:45:00			-0.02	0.00	0.18	0.20	0.13	0.63						
04/07/2024 06:00:00			-0.02	0.00	0.18	0.20	0.13	0.63						
04/07/2024 06:15:00			-0.02	0.00	0.18	0.20	0.13	0.63	0.13					
04/07/2024 06:30:00			-0.02	0.00	0.18	0.20	0.13	0.63	0.00					
04/07/2024 06:45:00			-0.02	0.00	0.18	0.20	0.13	0.63	0.00					
04/07/2024 07:00:00			-0.02	0.00	0.18	0.20	0.13	0.63	0.00					
04/07/2024 07:15:00			-0.02	0.00	0.18	0.20	0.13	0.63	0.00					
04/07/2024 07:30:00			-0.02	0.00	0.18	0.20	0.13	0.63	0.00					
04/07/2024 07:45:00			-0.02	0.00	0.18	0.20	0.13	0.64	0.00					
04/07/2024 08:00:00			-0.02	0.00	0.18	0.20	0.13	0.64	0.00					
04/07/2024 08:15:00			-0.02	0.00	0.18	0.20	0.13	0.64	0.00					
04/07/2024 08:30:00			-0.02	0.00	0.18	0.20	0.13	0.64	0.00					
04/07/2024 08:45:00			-0.02	0.00	0.18	0.20	0.13	0.64	0.00					
04/07/2024 09:00:00			-0.02	0.00	0.18	0.20	0.13	0.64	0.00					
04/07/2024 09:15:00			-0.02	0.00	0.18	0.20	0.13	0.64	0.00					
04/07/2024 09:30:00			-0.02	0.00	0.18	0.20	0.13	0.64	0.66					
04/07/2024 09:45:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 10:00:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 10:15:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 10:30:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 10:45:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 11:00:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 11:15:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 11:30:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 11:45:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 12:00:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 12:15:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 12:30:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 12:45:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 13:00:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 13:15:00			-0.01	0.00	0.18	0.20	0.13	0.64						
04/07/2024 13:30:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 13:45:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 14:00:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 14:15:00			-0.03	0.00	0.18	0.20	0.13	0.64						
04/07/2024 14:30:00			-0.03	0.00	0.18	0.20	0.13	0.64						
04/07/2024 14:45:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 15:00:00			-0.02	0.00	0.18	0.20	0.13	0.64						
04/07/2024 15:15:00			-0.02	0.00	0.18	0.20	0.12	0.64						
04/07/2024 15:30:00			-0.02	0.00	0.18	0.20	0.12	0.64						
04/07/2024 15:45:00			-0.02	0.00	0.18	0.20	0.12	0.64						
04/07/2024 16:00:00			-0.03	0.00	0.18	0.20	0.12	0.64						
04/07/2024 16:15:00			-0.02	0.00	0.18	0.20	0.12	0.64	0.00					
04/07/2024 16:30:00			-0.02	0.00	0.18	0.20	0.12	0.64	0.00					
04/07/2024 16:45:00			-0.02	0.00	0.18	0.20	0.12	0.64	0.64					
04/07/2024 17:00:00			-0.02	0.00	0.18	0.20	0.12	0.64						
04/07/2024 17:15:00			-0.02	0.00	0.18	0.20	0.12	0.64						
04/07/2024 17:30:00			-0.02	0.00	0.18	0.20	0.12	0.64	0.00					
04/07/2024 17:45:00			-0.02	0.00	0.18	0.20	0.12	0.64	0.00					
04/07/2024 18:00:00			-0.02	0.00	0.18	0.20	0.12	0.64	0.00					
04/07/2024 18:15:00			-0.02	0.00	0.18	0.20	0.12	0.64	0.00					
04/07/2024 18:30:00			-0.02	0.00	0.17	0.19	0.12	0.64	0.66					
04/07/2024 18:45:00			-0.02	0.00	0.17	0.19	0.12	0.64						
04/07/2024 19:00:00			-0.02	0.00	0.17	0.19	0.12	0.64						
04/07/2024 19:15:00			-0.02	0.00	0.17	0.19	0.12	0.64	0.00					
04/07/2024 19:30:00			-0.02	0.00	0.17	0.19	0.12	0.64	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
04/07/2024 19:45:00			-0.02	0.00	0.17	0.19	0.12	0.64	0.00					
04/07/2024 20:00:00			-0.02	0.00	0.17	0.19	0.12	0.64	0.65					
04/07/2024 20:15:00			-0.02	0.00	0.17	0.19	0.12	0.64						
04/07/2024 20:30:00			-0.02	0.00	0.17	0.19	0.12	0.64						
04/07/2024 20:45:00			-0.02	0.00	0.17	0.19	0.12	0.64						
04/07/2024 21:00:00			-0.02	0.00	0.17	0.19	0.12	0.64						
04/07/2024 21:15:00			-0.02	0.00	0.17	0.20	0.12	0.64						
04/07/2024 21:30:00			-0.02	0.00	0.17	0.20	0.12	0.64						
04/07/2024 21:45:00			-0.02	0.00	0.17	0.20	0.12	0.64						
04/07/2024 22:00:00			-0.02	0.00	0.17	0.20	0.12	0.64						
04/07/2024 22:15:00			-0.02	0.00	0.17	0.20	0.12	0.64						
04/07/2024 22:30:00			-0.02	0.00	0.17	0.20	0.12	0.64						
04/07/2024 22:45:00			-0.02	0.00	0.17	0.20	0.12	0.64						
04/07/2024 23:00:00			-0.02	0.00	0.17	0.20	0.12	0.64						
04/07/2024 23:15:00			-0.02	0.00	0.17	0.20	0.12	0.64						
04/07/2024 23:30:00			-0.02	0.00	0.17	0.20	0.12	0.64						
04/07/2024 23:45:00			-0.02	0.00	0.17	0.20	0.12	0.63						
05/07/2024 00:00:00			-0.02	0.00	0.17	0.20	0.12	0.63						
05/07/2024 00:15:00			-0.02	0.00	0.17	0.20	0.12	0.63						
05/07/2024 00:30:00			-0.02	0.00	0.17	0.20	0.12	0.63						
05/07/2024 00:45:00			-0.02	0.00	0.17	0.20	0.12	0.63						
05/07/2024 01:00:00			-0.02	0.00	0.17	0.20	0.12	0.63						
05/07/2024 01:15:00			-0.02	0.00	0.17	0.20	0.12	0.63						
05/07/2024 01:30:00			-0.02	0.00	0.17	0.20	0.12	0.63						
05/07/2024 01:45:00			-0.02	0.00	0.17	0.20	0.12	0.63						
05/07/2024 02:00:00			-0.02	0.00	0.17	0.19	0.12	0.63						
05/07/2024 02:15:00			-0.02	0.00	0.17	0.19	0.12	0.63						
05/07/2024 02:30:00			-0.03	0.00	0.17	0.19	0.12	0.63	0.27					
05/07/2024 02:45:00			-0.03	0.00	0.17	0.19	0.12	0.63	0.25					
05/07/2024 03:00:00			-0.03	0.00	0.17	0.19	0.12	0.62	0.25					
05/07/2024 03:15:00			-0.02	0.00	0.17	0.19	0.12	0.62	0.65					
05/07/2024 03:30:00			-0.02	0.00	0.17	0.19	0.12	0.62						
05/07/2024 03:45:00			-0.02	0.00	0.17	0.19	0.12	0.62						
05/07/2024 04:00:00			-0.02	0.00	0.17	0.19	0.12	0.62						
05/07/2024 04:15:00			-0.03	0.00	0.17	0.19	0.12	0.62						
05/07/2024 04:30:00			-0.03	0.00	0.17	0.19	0.12	0.62						
05/07/2024 04:45:00			-0.03	0.00	0.17	0.19	0.12	0.62						
05/07/2024 05:00:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 05:15:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 05:30:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 05:45:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 06:00:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 06:15:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 06:30:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 06:45:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 07:00:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 07:15:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 07:30:00			-0.03	0.00	0.17	0.19	0.11	0.62						
05/07/2024 07:45:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 08:00:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 08:15:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 08:30:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 08:45:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 09:00:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 09:15:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 09:30:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 09:45:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 10:00:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 10:15:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 10:30:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 10:45:00			-0.03	0.00	0.17	0.19	0.11	0.63						
05/07/2024 11:00:00			-0.03	0.00	0.17	0.19	0.11	0.64						
05/07/2024 11:15:00			-0.03	0.00	0.17	0.19	0.11	0.64						
05/07/2024 11:30:00			-0.03	0.00	0.17	0.19	0.11	0.64						
05/07/2024 11:45:00			-0.03	0.00	0.17	0.19	0.11	0.64						
05/07/2024 12:00:00			-0.03	0.00	0.17	0.19	0.12	0.64						
05/07/2024 12:15:00			-0.03	0.00	0.17	0.19	0.12	0.64						
05/07/2024 12:30:00			-0.03	0.00	0.17	0.19	0.12	0.64						
05/07/2024 12:45:00			-0.03	0.00	0.17	0.19	0.12	0.65						
05/07/2024 13:00:00			-0.03	0.00	0.17	0.19	0.12	0.65						
05/07/2024 13:15:00			-0.03	0.00	0.17	0.19	0.12	0.65						
05/07/2024 13:30:00			-0.03	0.00	0.17	0.19	0.12	0.65						
05/07/2024 13:45:00			-0.03	0.00	0.17	0.19	0.12	0.65						
05/07/2024 14:00:00			-0.03	0.00	0.17	0.19	0.12	0.65						
05/07/2024 14:15:00			-0.03	0.00	0.17	0.19	0.12	0.65						
05/07/2024 14:30:00			-0.03	0.00	0.17	0.19	0.12	0.65						
05/07/2024 14:45:00			-0.03	0.00	0.17	0.19	0.12	0.65						
05/07/2024 15:00:00			-0.03	0.00	0.17	0.20	0.12	0.64						
05/07/2024 15:15:00			-0.03	0.00	0.17	0.20	0.12	0.64						
05/07/2024 15:30:00			-0.03	0.00	0.17	0.20	0.12	0.64						
05/07/2024 15:45:00			-0.03	0.00	0.17	0.19	0.12	0.64						
05/07/2024 16:00:00			-0.03	0.00	0.17	0.20	0.12	0.64						
05/07/2024 16:15:00			-0.03	0.00	0.17	0.20	0.12	0.64						
05/07/2024 16:30:00			-0.03	0.00	0.17	0.20	0.12	0.64						
05/07/2024 16:45:00			-0.02	0.00	0.17	0.20	0.12	0.64						
05/07/2024 17:00:00			-0.02	0.00	0.17	0.20	0.12	0.64						
05/07/2024 17:15:00			-0.02	0.00	0.17	0.20	0.12	0.64						
05/07/2024 17:30:00			-0.02	0.00	0.17	0.20	0.12	0.65						
05/07/2024 17:45:00			-0.03	0.00	0.17	0.19	0.12	0.65						
05/07/2024 18:00:00			-0.02	0.00	0.18	0.19	0.12	0.65						
05/07/2024 18:15:00			-0.03	0.00	0.18	0.19	0.12	0.65						
05/07/2024 18:30:00			-0.03	0.00	0.18	0.19	0.12	0.65						
05/07/2024 18:45:00			-0.02	0.00	0.18	0.20	0.12	0.66						
05/07/2024 19:00:00			-0.02	0.00	0.18	0.20	0.13	0.66						
05/07/2024 19:15:00			-0.02	0.00	0.18	0.20	0.13	0.68						
05/07/2024 19:30:00			-0.02	0.00	0.18	0.20	0.13	0.70						
05/07/2024 19:45:00			-0.02	0.00	0.18	0.20	0.13	0.71						
05/07/2024 20:00:00			-0.02	0.00	0.19	0.21	0.13	0.71						
05/07/2024 20:15:00			-0.02	0.00	0.19	0.21	0.14	0.71						
05/07/2024 20:30:00			-0.02	0.00	0.19	0.21	0.14	0.70						
05/07/2024 20:45:00			-0.02	0.00	0.19	0.21	0.14	0.70						
05/07/2024 21:00:00			-0.02	0.00	0.20	0.22	0.15	0.70						
05/07/2024 21:15:00			-0.02	0.00	0.20	0.22	0.15	0.70						
05/07/2024 21:30:00			-0.01	0.00	0.20	0.22	0.15	0.70						
05/07/2024 21:45:00			-0.01	0.00	0.20	0.22	0.15	0.70						
05/07/2024 22:00:00			-0.01	0.00	0.21	0.22	0.16	0.70						
05/07/2024 22:15:00			-0.01	0.00	0.21	0.23	0.16	0.70						
05/07/2024 22:30:00			-0.01	0.00	0.21	0.23	0.16	0.70						
05/07/2024 22:45:00			-0.01	0.00	0.21	0.23	0.16	0.70						
05/07/2024 23:00:00			-0.01	0.00	0.21	0.23	0.16	0.70						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
05/07/2024 23:15:00			-0.01	0.00	0.21	0.23	0.16	0.69						
05/07/2024 23:30:00			-0.01	0.00	0.21	0.23	0.16	0.70						
05/07/2024 23:45:00			0.00	0.00	0.22	0.23	0.17	0.70						
06/07/2024 00:00:00			0.00	0.00	0.22	0.23	0.17	0.70						
06/07/2024 00:15:00			0.00	0.00	0.22	0.23	0.17	0.70						
06/07/2024 00:30:00			0.00	0.00	0.22	0.24	0.17	0.70	0.00					
06/07/2024 00:45:00			0.00	0.00	0.22	0.24	0.17	0.70	0.00					
06/07/2024 01:00:00			0.00	0.00	0.22	0.24	0.17	0.70	0.00					
06/07/2024 01:15:00			0.00	0.00	0.22	0.24	0.17	0.70	0.63					
06/07/2024 01:30:00			0.00	0.00	0.22	0.24	0.17	0.70						
06/07/2024 01:45:00			0.00	0.00	0.22	0.24	0.17	0.69						
06/07/2024 02:00:00			0.00	0.00	0.22	0.24	0.18	0.69						
06/07/2024 02:15:00			0.00	0.00	0.22	0.24	0.18	0.69						
06/07/2024 02:30:00			0.00	0.00	0.22	0.24	0.18	0.69						
06/07/2024 02:45:00			0.01	0.00	0.23	0.24	0.18	0.69						
06/07/2024 03:00:00			0.01	0.00	0.23	0.24	0.18	0.69						
06/07/2024 03:15:00			0.01	0.00	0.23	0.25	0.18	0.70						
06/07/2024 03:30:00			0.01	0.00	0.23	0.25	0.18	0.71						
06/07/2024 03:45:00			0.01	0.00	0.23	0.24	0.18	0.71						
06/07/2024 04:00:00			0.01	0.00	0.23	0.24	0.18	0.71						
06/07/2024 04:15:00			0.01	0.00	0.23	0.24	0.18	0.71						
06/07/2024 04:30:00			0.01	0.00	0.23	0.25	0.19	0.71						
06/07/2024 04:45:00			0.01	0.00	0.23	0.25	0.19	0.71						
06/07/2024 05:00:00			0.01	0.00	0.23	0.25	0.19	0.71						
06/07/2024 05:15:00			0.01	0.00	0.23	0.25	0.19	0.71						
06/07/2024 05:30:00			0.01	0.00	0.23	0.25	0.19	0.71						
06/07/2024 05:45:00			0.01	0.00	0.23	0.25	0.19	0.71						
06/07/2024 06:00:00			0.01	0.00	0.23	0.25	0.19	0.71						
06/07/2024 06:15:00			0.01	0.00	0.24	0.25	0.19	0.70						
06/07/2024 06:30:00			0.01	0.00	0.24	0.25	0.19	0.70						
06/07/2024 06:45:00			0.01	0.00	0.24	0.25	0.19	0.70						
06/07/2024 07:00:00			0.01	0.00	0.24	0.25	0.19	0.70						
06/07/2024 07:15:00			0.01	0.00	0.24	0.25	0.19	0.70						
06/07/2024 07:30:00			0.02	0.01	0.24	0.25	0.19	0.70						
06/07/2024 07:45:00			0.02	0.01	0.24	0.25	0.19	0.71						
06/07/2024 08:00:00			0.02	0.00	0.24	0.25	0.19	0.71						
06/07/2024 08:15:00			0.02	0.01	0.24	0.25	0.19	0.71						
06/07/2024 08:30:00			0.02	0.01	0.24	0.25	0.19	0.71						
06/07/2024 08:45:00			0.02	0.01	0.24	0.25	0.19	0.71	0.00					
06/07/2024 09:00:00			0.02	0.01	0.24	0.25	0.19	0.71	0.00					
06/07/2024 09:15:00			0.02	0.01	0.24	0.25	0.19	0.71	0.00					
06/07/2024 09:30:00			0.02	0.01	0.25	0.26	0.20	0.71	0.00					
06/07/2024 09:45:00			0.04	0.01	0.25	0.27	0.21	0.78	0.00					
06/07/2024 10:00:00			0.04	0.01	0.26	0.27	0.22	0.92	0.00					
06/07/2024 10:15:00			0.04	0.02	0.26	0.27	0.22	0.89	0.00					
06/07/2024 10:30:00			0.04	0.01	0.27	0.28	0.23	0.84	0.00					
06/07/2024 10:45:00			0.05	0.02	0.28	0.29	0.25	0.81	0.00					
06/07/2024 11:00:00			0.06	0.03	0.30	0.30	0.27	0.79	0.00					
06/07/2024 11:15:00			0.07	0.03	0.30	0.31	0.28	0.79	0.00					
06/07/2024 11:30:00			0.07	0.04	0.31	0.32	0.29	0.79	0.00					
06/07/2024 11:45:00			0.08	0.04	0.31	0.32	0.29	0.78	0.00					
06/07/2024 12:00:00			0.09	0.05	0.32	0.32	0.30	0.78	0.00					
06/07/2024 12:15:00			0.10	0.06	0.32	0.33	0.30	0.76	0.00					
06/07/2024 12:30:00			0.10	0.06	0.32	0.33	0.30	0.76	0.00					
06/07/2024 12:45:00			0.10	0.06	0.32	0.33	0.30	0.76	0.00					
06/07/2024 13:00:00			0.10	0.06	0.32	0.33	0.30	0.76	0.00					
06/07/2024 13:15:00			0.10	0.06	0.32	0.33	0.30	0.76	0.00					
06/07/2024 13:30:00			0.10	0.06	0.32	0.33	0.30	0.75	0.00					
06/07/2024 13:45:00			0.10	0.06	0.32	0.33	0.31	0.75	0.00					
06/07/2024 14:00:00			0.10	0.06	0.32	0.33	0.31	0.75	0.00					
06/07/2024 14:15:00			0.11	0.07	0.32	0.33	0.31	0.75	0.00					
06/07/2024 14:30:00			0.11	0.07	0.32	0.33	0.31	0.74	0.00					
06/07/2024 14:45:00			0.11	0.07	0.32	0.33	0.31	0.74	0.00					
06/07/2024 15:00:00			0.11	0.07	0.32	0.33	0.31	0.74	0.00					
06/07/2024 15:15:00			0.11	0.07	0.32	0.33	0.31	0.74	0.00					
06/07/2024 15:30:00			0.10	0.06	0.32	0.33	0.31	0.74	0.00					
06/07/2024 15:45:00			0.10	0.06	0.32	0.33	0.30	0.73	0.00					
06/07/2024 16:00:00			0.10	0.06	0.32	0.33	0.30	0.73	0.00					
06/07/2024 16:15:00			0.10	0.06	0.32	0.33	0.30	0.73	0.00					
06/07/2024 16:30:00			0.10	0.06	0.32	0.33	0.30	0.73	0.00					
06/07/2024 16:45:00			0.10	0.06	0.32	0.33	0.30	0.73	0.00					
06/07/2024 17:00:00			0.10	0.06	0.32	0.33	0.30	0.73	0.00					
06/07/2024 17:15:00			0.10	0.06	0.32	0.33	0.30	0.73	0.00					
06/07/2024 17:30:00			0.10	0.06	0.32	0.33	0.29	0.72	0.00					
06/07/2024 17:45:00			0.10	0.06	0.31	0.32	0.29	0.72	0.00					
06/07/2024 18:00:00			0.10	0.06	0.31	0.32	0.29	0.72	0.00					
06/07/2024 18:15:00			0.10	0.06	0.31	0.32	0.29	0.72	0.00					
06/07/2024 18:30:00			0.10	0.06	0.31	0.32	0.29	0.72	0.00					
06/07/2024 18:45:00			0.10	0.06	0.31	0.32	0.29	0.72	0.00					
06/07/2024 19:00:00			0.09	0.05	0.31	0.32	0.29	0.72	0.00					
06/07/2024 19:15:00			0.09	0.05	0.31	0.32	0.29	0.72	0.00					
06/07/2024 19:30:00			0.09	0.05	0.31	0.32	0.28	0.72	0.00					
06/07/2024 19:45:00			0.09	0.05	0.31	0.32	0.28	0.72	0.00					
06/07/2024 20:00:00			0.09	0.05	0.31	0.32	0.28	0.71	0.00					
06/07/2024 20:15:00			0.09	0.05	0.30	0.31	0.28	0.71	0.00					
06/07/2024 20:30:00			0.09	0.05	0.30	0.31	0.28	0.71	0.00					
06/07/2024 20:45:00			0.09	0.05	0.30	0.31	0.28	0.71	0.00					
06/07/2024 21:00:00			0.09	0.05	0.30	0.31	0.28	0.71	0.00					
06/07/2024 21:15:00			0.09	0.05	0.30	0.31	0.28	0.71	0.00					
06/07/2024 21:30:00			0.09	0.05	0.30	0.31	0.27	0.71	0.00					
06/07/2024 21:45:00			0.09	0.05	0.30	0.31	0.27	0.71	0.00					
06/07/2024 22:00:00			0.08	0.05	0.30	0.31	0.27	0.71	0.00					
06/07/2024 22:15:00			0.08	0.04	0.30	0.31	0.27	0.70	0.00					
06/07/2024 22:30:00			0.08	0.04	0.30	0.31	0.27	0.70	0.00					
06/07/2024 22:45:00			0.08	0.04	0.30	0.31	0.27	0.70	0.00					
06/07/2024 23:00:00			0.08	0.04	0.30	0.31	0.27	0.70	0.00					
06/07/2024 23:15:00			0.08	0.04	0.29	0.30	0.27	0.70	0.00					
06/07/2024 23:30:00			0.08	0.04	0.29	0.30	0.26	0.70	0.00					
06/07/2024 23:45:00			0.08	0.04	0.29	0.30	0.26	0.70	0.00					
07/07/2024 00:00:00			0.08	0.04	0.29	0.30	0.26	0.70	0.00					
07/07/2024 00:15:00			0.08	0.04	0.29	0.30	0.26	0.70	0.00					
07/07/2024 00:30:00			0.08	0.04	0.29	0.30	0.26	0.70	0.00					
07/07/2024 00:45:00			0.07	0.04	0.29	0.30	0.26	0.70	0.00					
07/07/2024 01:00:00			0.07	0.04	0.29	0.30	0.26	0.70	0.00					
07/07/2024 01:15:00			0.07	0.04	0.29	0.30	0.26	0.69	0.00					
07/07/2024 01:30:00			0.07	0.04	0.29	0.30	0.26	0.69	0.00					
07/07/2024 01:45:00			0.07	0.04	0.28	0.30	0.25	0.69	0.00					
07/07/2024 02:00:00			0.07	0.03	0.28	0.30	0.25	0.69	0.00					
07/07/2024 02:15:00			0.07	0.03	0.28	0.30	0.25	0.69	0.00					
07/07/2024 02:30:00			0.07	0.03	0.28	0.29	0.25	0.69	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
07/07/2024 02:45:00			0.07	0.03	0.28	0.29	0.25	0.69	0.00					
07/07/2024 03:00:00			0.07	0.03	0.28	0.29	0.25	0.69	0.00					
07/07/2024 03:15:00			0.07	0.03	0.28	0.29	0.25	0.69	0.00					
07/07/2024 03:30:00			0.06	0.03	0.28	0.29	0.25	0.69	0.00					
07/07/2024 03:45:00			0.06	0.03	0.28	0.29	0.25	0.68	0.00					
07/07/2024 04:00:00			0.06	0.03	0.28	0.29	0.24	0.68	0.00					
07/07/2024 04:15:00			0.06	0.03	0.28	0.29	0.24	0.68	0.00					
07/07/2024 04:30:00			0.06	0.03	0.28	0.29	0.24	0.68	0.00					
07/07/2024 04:45:00			0.06	0.03	0.27	0.29	0.24	0.68	0.00					
07/07/2024 05:00:00			0.06	0.03	0.27	0.29	0.24	0.68	0.00					
07/07/2024 05:15:00			0.06	0.03	0.27	0.29	0.24	0.68	0.00					
07/07/2024 05:30:00			0.06	0.03	0.27	0.28	0.24	0.68	0.00					
07/07/2024 05:45:00			0.06	0.03	0.27	0.28	0.24	0.68	0.00					
07/07/2024 06:00:00			0.06	0.03	0.27	0.28	0.24	0.68	0.00					
07/07/2024 06:15:00			0.06	0.03	0.27	0.28	0.24	0.68	0.00					
07/07/2024 06:30:00			0.05	0.02	0.27	0.28	0.23	0.68	0.00					
07/07/2024 06:45:00			0.05	0.02	0.27	0.28	0.23	0.68	0.00					
07/07/2024 07:00:00			0.05	0.02	0.27	0.28	0.23	0.68	0.00					
07/07/2024 07:15:00			0.05	0.02	0.27	0.28	0.23	0.68	0.00					
07/07/2024 07:30:00			0.05	0.02	0.27	0.28	0.23	0.68	0.00					
07/07/2024 07:45:00			0.05	0.02	0.27	0.28	0.23	0.68	0.00					
07/07/2024 08:00:00			0.05	0.02	0.27	0.28	0.23	0.68	0.00					
07/07/2024 08:15:00			0.05	0.02	0.26	0.28	0.23	0.68	0.00					
07/07/2024 08:30:00			0.05	0.02	0.26	0.28	0.23	0.67	0.00					
07/07/2024 08:45:00			0.05	0.02	0.26	0.28	0.23	0.67	0.00					
07/07/2024 09:00:00			0.05	0.02	0.26	0.28	0.23	0.67	0.00					
07/07/2024 09:15:00			0.05	0.02	0.26	0.28	0.22	0.67	0.00					
07/07/2024 09:30:00			0.05	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 09:45:00			0.05	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 10:00:00			0.05	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 10:15:00			0.05	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 10:30:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 10:45:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 11:00:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 11:15:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 11:30:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 11:45:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 12:00:00			0.04	0.01	0.26	0.27	0.22	0.67	0.00					
07/07/2024 12:15:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 12:30:00			0.04	0.02	0.25	0.27	0.21	0.67	0.00					
07/07/2024 12:45:00			0.04	0.02	0.25	0.27	0.21	0.67	0.00					
07/07/2024 13:00:00			0.04	0.02	0.25	0.27	0.21	0.67	0.00					
07/07/2024 13:15:00			0.05	0.02	0.25	0.27	0.21	0.67	0.00					
07/07/2024 13:30:00			0.05	0.02	0.25	0.27	0.21	0.67	0.00					
07/07/2024 13:45:00			0.04	0.01	0.25	0.27	0.21	0.67	0.00					
07/07/2024 14:00:00			0.04	0.01	0.25	0.27	0.21	0.67	0.00					
07/07/2024 14:15:00			0.04	0.01	0.25	0.27	0.21	0.67	0.00					
07/07/2024 14:30:00			0.04	0.01	0.25	0.27	0.21	0.67	0.00					
07/07/2024 14:45:00			0.04	0.01	0.25	0.27	0.21	0.67	0.00					
07/07/2024 15:00:00			0.04	0.02	0.25	0.27	0.21	0.68	0.00					
07/07/2024 15:15:00			0.04	0.02	0.25	0.27	0.21	0.69	0.00					
07/07/2024 15:30:00			0.04	0.02	0.25	0.27	0.21	0.69	0.00					
07/07/2024 15:45:00			0.04	0.02	0.25	0.27	0.21	0.70	0.00					
07/07/2024 16:00:00			0.04	0.01	0.25	0.27	0.21	0.70	0.00					
07/07/2024 16:15:00			0.04	0.01	0.25	0.27	0.21	0.69	0.00					
07/07/2024 16:30:00			0.04	0.01	0.25	0.27	0.21	0.69	0.00					
07/07/2024 16:45:00			0.04	0.01	0.25	0.27	0.21	0.69	0.00					
07/07/2024 17:00:00			0.04	0.01	0.25	0.27	0.21	0.69	0.00					
07/07/2024 17:15:00			0.04	0.01	0.26	0.27	0.22	0.69	0.00					
07/07/2024 17:30:00			0.04	0.02	0.26	0.27	0.22	0.69	0.00					
07/07/2024 17:45:00			0.04	0.02	0.26	0.27	0.22	0.68	0.00					
07/07/2024 18:00:00			0.04	0.02	0.26	0.27	0.22	0.68	0.00					
07/07/2024 18:15:00			0.04	0.02	0.26	0.27	0.22	0.68	0.00					
07/07/2024 18:30:00			0.04	0.02	0.26	0.27	0.22	0.68	0.00					
07/07/2024 18:45:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 19:00:00			0.05	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 19:15:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 19:30:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 19:45:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 20:00:00			0.04	0.02	0.26	0.27	0.22	0.67	0.00					
07/07/2024 20:15:00			0.05	0.02	0.25	0.27	0.21	0.67	0.00					
07/07/2024 20:30:00			0.04	0.02	0.25	0.27	0.21	0.68	0.00					
07/07/2024 20:45:00			0.04	0.02	0.25	0.27	0.21	0.68	0.00					
07/07/2024 21:00:00			0.04	0.02	0.25	0.27	0.21	0.68	0.00					
07/07/2024 21:15:00			0.04	0.02	0.25	0.27	0.21	0.68	0.00					
07/07/2024 21:30:00			0.04	0.02	0.25	0.27	0.21	0.68	0.00					
07/07/2024 21:45:00			0.04	0.02	0.25	0.27	0.21	0.68	0.00					
07/07/2024 22:00:00			0.04	0.02	0.25	0.27	0.21	0.68	0.00					
07/07/2024 22:15:00			0.04	0.02	0.25	0.27	0.21	0.67	0.00					
07/07/2024 22:30:00			0.04	0.02	0.25	0.27	0.21	0.67	0.00					
07/07/2024 22:45:00			0.04	0.02	0.25	0.27	0.21	0.67	0.00					
07/07/2024 23:00:00			0.04	0.02	0.25	0.27	0.21	0.67	0.00					
07/07/2024 23:15:00			0.04	0.01	0.25	0.27	0.21	0.67	0.00					
07/07/2024 23:30:00			0.04	0.01	0.25	0.27	0.21	0.66	0.00					
07/07/2024 23:45:00			0.04	0.01	0.25	0.27	0.21	0.66	0.00					
08/07/2024 00:00:00			0.04	0.01	0.25	0.27	0.21	0.66	0.00					
08/07/2024 00:15:00			0.04	0.01	0.25	0.26	0.21	0.66	0.00					
08/07/2024 00:30:00			0.04	0.01	0.25	0.26	0.21	0.66	0.00					
08/07/2024 00:45:00			0.04	0.01	0.25	0.26	0.21	0.66	0.00					
08/07/2024 01:00:00			0.04	0.01	0.25	0.26	0.21	0.66	0.00					
08/07/2024 01:15:00			0.04	0.01	0.25	0.26	0.21	0.66	0.00					
08/07/2024 01:30:00			0.04	0.01	0.25	0.26	0.20	0.66	0.00					
08/07/2024 01:45:00			0.04	0.01	0.25	0.26	0.20	0.66	0.00					
08/07/2024 02:00:00			0.03	0.01	0.25	0.26	0.20	0.66	0.00					
08/07/2024 02:15:00			0.03	0.01	0.24	0.26	0.20	0.65	0.00					
08/07/2024 02:30:00			0.03	0.01	0.24	0.26	0.20	0.65	0.00					
08/07/2024 02:45:00			0.03	0.01	0.24	0.26	0.20	0.65	0.00					
08/07/2024 03:00:00			0.03	0.01	0.24	0.26	0.20	0.65	0.00					
08/07/2024 03:15:00			0.03	0.01	0.24	0.26	0.20	0.65	0.00					
08/07/2024 03:30:00			0.03	0.01	0.24	0.26	0.20	0.65	0.00					
08/07/2024 03:45:00			0.03	0.01	0.24	0.26	0.20	0.65	0.00					
08/07/2024 04:00:00			0.03	0.01	0.24	0.26	0.20	0.65	0.00					
08/07/2024 04:15:00			0.03	0.01	0.24	0.26	0.20	0.65	0.00					
08/07/2024 04:30:00			0.03	0.01	0.24	0.26	0.19	0.65	0.00					
08/07/2024 04:45:00			0.03	0.01	0.24	0.25	0.19	0.65	0.00					
08/07/2024 05:00:00			0.03	0.01	0.24	0.25	0.19	0.65	0.00					
08/07/2024 05:15:00			0.03	0.01	0.24	0.25	0.19	0.65	0.00					
08/07/2024 05:30:00			0.03	0.01	0.24	0.25	0.19	0.65	0.00					
08/07/2024 05:45:00			0.03	0.01	0.24	0.25	0.19	0.65	0.00					
08/07/2024 06:00:00			0.03	0.01	0.24	0.25	0.19	0.65	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
08/07/2024 06:15:00			0.03	0.01	0.24	0.25	0.19	0.64	0.00					
08/07/2024 06:30:00			0.02	0.01	0.24	0.25	0.19	0.65	0.00					
08/07/2024 06:45:00			0.02	0.01	0.23	0.25	0.19	0.65	0.00					
08/07/2024 07:00:00			0.02	0.01	0.23	0.25	0.19	0.65	0.00					
08/07/2024 07:15:00			0.02	0.01	0.23	0.25	0.19	0.65	0.00					
08/07/2024 07:30:00			0.02	0.01	0.23	0.25	0.19	0.65	0.00					
08/07/2024 07:45:00			0.02	0.01	0.23	0.25	0.19	0.65	0.00					
08/07/2024 08:00:00			0.02	0.01	0.23	0.25	0.19	0.65	0.00					
08/07/2024 08:15:00			0.02	0.01	0.23	0.25	0.19	0.65	0.00					
08/07/2024 08:30:00			0.02	0.01	0.23	0.25	0.19	0.65	0.00					
08/07/2024 08:45:00			0.02	0.00	0.23	0.25	0.19	0.65	0.00					
08/07/2024 09:00:00			0.02	0.00	0.23	0.25	0.19	0.65	0.00					
08/07/2024 09:15:00			0.02	0.01	0.23	0.25	0.18	0.65	0.00					
08/07/2024 09:30:00			0.02	0.01	0.23	0.25	0.18	0.65	0.00					
08/07/2024 09:45:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					
08/07/2024 10:00:00			0.02	0.01	0.23	0.25	0.18	0.65	0.00					
08/07/2024 10:15:00			0.02	0.01	0.23	0.25	0.18	0.65	0.00					
08/07/2024 10:30:00			0.02	0.01	0.23	0.25	0.18	0.65	0.00					
08/07/2024 10:45:00			0.02	0.01	0.23	0.25	0.18	0.65	0.00					
08/07/2024 11:00:00			0.02	0.01	0.23	0.25	0.18	0.65	0.00					
08/07/2024 11:15:00			0.02	0.01	0.23	0.25	0.18	0.65	0.00					
08/07/2024 11:30:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					
08/07/2024 11:45:00			0.02	0.00	0.23	0.25	0.18	0.64	0.00					
08/07/2024 12:00:00			0.02	0.00	0.23	0.25	0.18	0.64	0.00					
08/07/2024 12:15:00			0.02	0.00	0.23	0.24	0.18	0.64	0.00					
08/07/2024 12:30:00			0.02	0.00	0.23	0.24	0.18	0.64	0.00					
08/07/2024 12:45:00			0.02	0.00	0.23	0.24	0.18	0.64	0.00					
08/07/2024 13:00:00			0.02	0.00	0.23	0.24	0.18	0.64	0.00					
08/07/2024 13:15:00			0.02	0.00	0.23	0.24	0.18	0.64	0.00					
08/07/2024 13:30:00			0.02	0.00	0.23	0.24	0.18	0.64	0.00					
08/07/2024 13:45:00			0.02	0.00	0.22	0.24	0.18	0.64	0.00					
08/07/2024 14:00:00			0.02	0.00	0.22	0.24	0.18	0.63	0.00					
08/07/2024 14:15:00			0.01	0.00	0.22	0.24	0.18	0.63	0.00					
08/07/2024 14:30:00			0.01	0.00	0.22	0.24	0.18	0.63	0.00					
08/07/2024 14:45:00			0.01	0.00	0.22	0.24	0.18	0.64	0.00					
08/07/2024 15:00:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
08/07/2024 15:15:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
08/07/2024 15:30:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
08/07/2024 15:45:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
08/07/2024 16:00:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
08/07/2024 16:15:00			0.01	0.00	0.22	0.24	0.17	0.63	0.00					
08/07/2024 16:30:00			0.01	0.00	0.22	0.24	0.17	0.63	0.00					
08/07/2024 16:45:00			0.01	0.00	0.22	0.24	0.17	0.63	0.00					
08/07/2024 17:00:00			0.01	0.00	0.22	0.24	0.17	0.63	0.00					
08/07/2024 17:15:00			0.01	0.00	0.22	0.24	0.17	0.63	0.00					
08/07/2024 17:30:00			0.01	0.00	0.22	0.23	0.17	0.63	0.00					
08/07/2024 17:45:00			0.01	0.00	0.22	0.23	0.17	0.63	0.00					
08/07/2024 18:00:00			0.01	0.00	0.22	0.23	0.17	0.63	0.00					
08/07/2024 18:15:00			0.01	0.00	0.21	0.23	0.17	0.63	0.00					
08/07/2024 18:30:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 18:45:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 19:00:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 19:15:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 19:30:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 19:45:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 20:00:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 20:15:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 20:30:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 20:45:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 21:00:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 21:15:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 21:30:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 21:45:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 22:00:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 22:15:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 22:30:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
08/07/2024 22:45:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
08/07/2024 23:00:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
08/07/2024 23:15:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
08/07/2024 23:30:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
08/07/2024 23:45:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 00:00:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 00:15:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 00:30:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 00:45:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 01:00:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 01:15:00			0.00	0.00	0.21	0.23	0.16	0.65	0.00					
09/07/2024 01:30:00			0.00	0.00	0.21	0.23	0.16	0.65	0.00					
09/07/2024 01:45:00			0.00	0.00	0.21	0.23	0.17	0.66	0.00					
09/07/2024 02:00:00			0.00	0.00	0.21	0.24	0.17	0.66	0.00					
09/07/2024 02:15:00			0.00	0.00	0.22	0.24	0.17	0.66	0.00					
09/07/2024 02:30:00			0.00	0.00	0.22	0.23	0.17	0.66	0.00					
09/07/2024 02:45:00			0.00	0.00	0.22	0.23	0.17	0.66	0.00					
09/07/2024 03:00:00			0.00	0.00	0.22	0.24	0.17	0.67	0.00					
09/07/2024 03:15:00			0.00	0.00	0.22	0.24	0.17	0.67	0.00					
09/07/2024 03:30:00			0.01	0.00	0.22	0.24	0.17	0.66	0.00					
09/07/2024 03:45:00			0.01	0.00	0.22	0.24	0.17	0.66	0.00					
09/07/2024 04:00:00			0.01	0.00	0.22	0.24	0.17	0.66	0.00					
09/07/2024 04:15:00			0.01	0.00	0.22	0.24	0.18	0.66	0.00					
09/07/2024 04:30:00			0.01	0.00	0.22	0.24	0.18	0.65	0.00					
09/07/2024 04:45:00			0.01	0.00	0.22	0.24	0.18	0.66	0.00					
09/07/2024 05:00:00			0.01	0.00	0.23	0.24	0.18	0.66	0.00					
09/07/2024 05:15:00			0.01	0.00	0.23	0.24	0.18	0.67	0.00					
09/07/2024 05:30:00			0.01	0.00	0.23	0.24	0.18	0.67	0.00					
09/07/2024 05:45:00			0.01	0.00	0.23	0.25	0.18	0.67	0.00					
09/07/2024 06:00:00			0.01	0.00	0.23	0.25	0.18	0.66	0.00					
09/07/2024 06:15:00			0.01	0.00	0.23	0.25	0.18	0.66	0.00					
09/07/2024 06:30:00			0.01	0.00	0.23	0.24	0.18	0.66	0.00					
09/07/2024 06:45:00			0.02	0.00	0.23	0.24	0.18	0.66	0.00					
09/07/2024 07:00:00			0.02	0.00	0.23	0.24	0.18	0.66	0.00					
09/07/2024 07:15:00			0.01	0.00	0.23	0.24	0.18	0.66	0.00					
09/07/2024 07:30:00			0.01	0.00	0.23	0.24	0.18	0.66	0.00					
09/07/2024 07:45:00			0.02	0.00	0.23	0.24	0.18	0.66	0.00					
09/07/2024 08:00:00			0.02	0.00	0.23	0.25	0.18	0.66	0.00					
09/07/2024 08:15:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					
09/07/2024 08:30:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					
09/07/2024 08:45:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					
09/07/2024 09:00:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					
09/07/2024 09:15:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					
09/07/2024 09:30:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
09/07/2024 09:45:00			0.02	0.00	0.23	0.23	0.18	0.65	0.00					
09/07/2024 10:00:00			0.02	0.00	0.23	0.24	0.18	0.65	0.00					
09/07/2024 10:15:00			0.02	0.00	0.23	0.24	0.18	0.65	0.00					
09/07/2024 10:30:00			0.01	0.00	0.23	0.24	0.18	0.65	0.00					
09/07/2024 10:45:00			0.01	0.00	0.23	0.24	0.18	0.65	0.00					
09/07/2024 11:00:00			0.01	0.00	0.23	0.24	0.18	0.65	0.00					
09/07/2024 11:15:00			0.02	0.00	0.23	0.24	0.18	0.65	0.00					
09/07/2024 11:30:00			0.02	0.00	0.23	0.24	0.18	0.65	0.00					
09/07/2024 11:45:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					
09/07/2024 12:00:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					
09/07/2024 12:15:00			0.02	0.00	0.23	0.25	0.18	0.65	0.00					
09/07/2024 12:30:00			0.01	0.00	0.23	0.25	0.18	0.64	0.00					
09/07/2024 12:45:00			0.02	0.00	0.23	0.25	0.18	0.64	0.00					
09/07/2024 13:00:00			0.01	0.00	0.23	0.24	0.18	0.64	0.00					
09/07/2024 13:15:00			0.01	0.00	0.23	0.24	0.18	0.64	0.00					
09/07/2024 13:30:00			0.01	0.00	0.22	0.24	0.18	0.64	0.00					
09/07/2024 13:45:00			0.01	0.00	0.22	0.24	0.18	0.64	0.00					
09/07/2024 14:00:00			0.01	0.00	0.22	0.24	0.18	0.64	0.00					
09/07/2024 14:15:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 14:30:00			0.01	0.00	0.22	0.24	0.17	0.65	0.00					
09/07/2024 14:45:00			0.01	0.00	0.22	0.24	0.17	0.65	0.00					
09/07/2024 15:00:00			0.01	0.00	0.22	0.24	0.17	0.65	0.00					
09/07/2024 15:15:00			0.01	0.00	0.22	0.24	0.17	0.65	0.00					
09/07/2024 15:30:00			0.01	0.00	0.22	0.24	0.17	0.65	0.00					
09/07/2024 15:45:00			0.01	0.00	0.22	0.24	0.17	0.65	0.00					
09/07/2024 16:00:00			0.01	0.00	0.22	0.24	0.17	0.65	0.00					
09/07/2024 16:15:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 16:30:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 16:45:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 17:00:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 17:15:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 17:30:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 17:45:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 18:00:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 18:15:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 18:30:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 18:45:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 19:00:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 19:15:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 19:30:00			0.01	0.00	0.22	0.24	0.17	0.64	0.00					
09/07/2024 19:45:00			0.01	0.00	0.22	0.23	0.17	0.64	0.00					
09/07/2024 20:00:00			0.01	0.00	0.22	0.23	0.17	0.64	0.00					
09/07/2024 20:15:00			0.01	0.00	0.22	0.23	0.17	0.64	0.00					
09/07/2024 20:30:00			0.01	0.00	0.22	0.23	0.17	0.64	0.00					
09/07/2024 20:45:00			0.01	0.00	0.21	0.23	0.17	0.64	0.00					
09/07/2024 21:00:00			0.01	0.00	0.22	0.23	0.17	0.64	0.00					
09/07/2024 21:15:00			0.01	0.00	0.21	0.23	0.17	0.64	0.00					
09/07/2024 21:30:00			0.01	0.00	0.21	0.23	0.17	0.64	0.00					
09/07/2024 21:45:00			0.01	0.00	0.21	0.23	0.17	0.64	0.00					
09/07/2024 22:00:00			0.01	0.00	0.21	0.23	0.17	0.64	0.00					
09/07/2024 22:15:00			0.01	0.00	0.21	0.23	0.17	0.64	0.00					
09/07/2024 22:30:00			0.01	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 22:45:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 23:00:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 23:15:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 23:30:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
09/07/2024 23:45:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
10/07/2024 00:00:00			0.00	0.00	0.21	0.23	0.16	0.64	0.00					
10/07/2024 00:15:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
10/07/2024 00:30:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
10/07/2024 00:45:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
10/07/2024 01:00:00			0.00	0.00	0.21	0.23	0.16	0.63	0.00					
10/07/2024 01:15:00			0.01	0.00	0.21	0.23	0.16	0.63	0.00					
10/07/2024 01:30:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
10/07/2024 01:45:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
10/07/2024 02:00:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
10/07/2024 02:15:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
10/07/2024 02:30:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
10/07/2024 02:45:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
10/07/2024 03:00:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
10/07/2024 03:15:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
10/07/2024 03:30:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
10/07/2024 03:45:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
10/07/2024 04:00:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
10/07/2024 04:15:00			0.00	0.00	0.21	0.22	0.15	0.61	0.00					
10/07/2024 04:30:00			0.00	0.00	0.21	0.22	0.15	0.61	0.00					
10/07/2024 04:45:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 05:00:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 05:15:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 05:30:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 05:45:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 06:00:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 06:15:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 06:30:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 06:45:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 07:00:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 07:15:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 07:30:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 07:45:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 08:00:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 08:15:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 08:30:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 08:45:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 09:00:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 09:15:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 09:30:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 09:45:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 10:00:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 10:15:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 10:30:00			0.00	0.00	0.20	0.22	0.15	0.63	0.00					
10/07/2024 10:45:00			-0.01	0.00	0.20	0.22	0.15	0.63	0.00					
10/07/2024 11:00:00			-0.01	0.00	0.20	0.22	0.15	0.63	0.00					
10/07/2024 11:15:00			-0.01	0.00	0.20	0.22	0.15	0.63	0.00					
10/07/2024 11:30:00			-0.01	0.00	0.20	0.22	0.15	0.63	0.00					
10/07/2024 11:45:00			-0.01	0.00	0.20	0.22	0.15	0.63	0.00					
10/07/2024 12:00:00			-0.01	0.00	0.20	0.22	0.15	0.63	0.00					
10/07/2024 12:15:00			0.00	0.00	0.20	0.22	0.15	0.63	0.00					
10/07/2024 12:30:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 12:45:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 13:00:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
10/07/2024 13:15:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 13:30:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
10/07/2024 13:45:00			-0.01	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 14:00:00			-0.01	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 14:15:00			0.00	0.00	0.20	0.22	0.15	0.61	0.00					
10/07/2024 14:30:00			-0.01	0.00	0.20	0.22	0.14	0.61	0.00					
10/07/2024 14:45:00			-0.01	0.00	0.20	0.22	0.14	0.61	0.00					
10/07/2024 15:00:00			-0.01	0.00	0.20	0.22	0.14	0.61	0.00					
10/07/2024 15:15:00			-0.01	0.00	0.20	0.22	0.14	0.61	0.00					
10/07/2024 15:30:00			0.00	0.00	0.20	0.22	0.14	0.61	0.00					
10/07/2024 15:45:00			-0.01	0.00	0.20	0.22	0.14	0.61	0.00					
10/07/2024 16:00:00			-0.01	0.00	0.19	0.22	0.14	0.61	0.00					
10/07/2024 16:15:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 16:30:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 16:45:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 17:00:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 17:15:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 17:30:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 17:45:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 18:00:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 18:15:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 18:30:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 18:45:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 19:00:00			-0.01	0.00	0.19	0.21	0.14	0.62	0.00					
10/07/2024 19:15:00			-0.01	0.00	0.19	0.21	0.14	0.62	0.00					
10/07/2024 19:30:00			-0.01	0.00	0.19	0.21	0.14	0.62	0.00					
10/07/2024 19:45:00			-0.01	0.00	0.19	0.21	0.14	0.62	0.00					
10/07/2024 20:00:00			-0.01	0.00	0.19	0.21	0.14	0.62	0.00					
10/07/2024 20:15:00			-0.01	0.00	0.19	0.21	0.14	0.62	0.00					
10/07/2024 20:30:00			-0.01	0.00	0.19	0.21	0.14	0.62	0.00					
10/07/2024 20:45:00			-0.01	0.00	0.19	0.21	0.14	0.62	0.00					
10/07/2024 21:00:00			-0.01	0.00	0.19	0.21	0.14	0.62	0.00					
10/07/2024 21:15:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 21:30:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 21:45:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 22:00:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 22:15:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 22:30:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 22:45:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 23:00:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 23:15:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 23:30:00			-0.01	0.00	0.19	0.21	0.14	0.61	0.00					
10/07/2024 23:45:00			-0.01	0.00	0.19	0.21	0.14	0.60	0.00					
11/07/2024 00:00:00			-0.01	0.00	0.19	0.21	0.14	0.60	0.00					
11/07/2024 00:15:00			-0.01	0.00	0.19	0.21	0.14	0.60	0.00					
11/07/2024 00:30:00			-0.01	0.00	0.19	0.21	0.14	0.60	0.00					
11/07/2024 00:45:00			-0.01	0.00	0.19	0.21	0.14	0.60	0.00					
11/07/2024 01:00:00			-0.01	0.00	0.19	0.21	0.14	0.60	0.00					
11/07/2024 01:15:00			-0.01	0.00	0.19	0.21	0.14	0.60	0.00					
11/07/2024 01:30:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
11/07/2024 01:45:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
11/07/2024 02:00:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
11/07/2024 02:15:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
11/07/2024 02:30:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
11/07/2024 02:45:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
11/07/2024 03:00:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
11/07/2024 03:15:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
11/07/2024 03:30:00			-0.01	0.00	0.19	0.21	0.13	0.58	0.00					
11/07/2024 03:45:00			-0.01	0.00	0.19	0.21	0.13	0.58	0.00					
11/07/2024 04:00:00			-0.01	0.00	0.18	0.21	0.13	0.58	0.00					
11/07/2024 04:15:00			-0.01	0.00	0.18	0.21	0.13	0.58	0.00					
11/07/2024 04:30:00			-0.01	0.00	0.18	0.21	0.13	0.58	0.00					
11/07/2024 04:45:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 05:00:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 05:15:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 05:30:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 05:45:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 06:00:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 06:15:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 06:30:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 06:45:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 07:00:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 07:15:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 07:30:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
11/07/2024 07:45:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 08:00:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
11/07/2024 08:15:00			-0.02	0.00	0.18	0.20	0.12	0.60	0.00					
11/07/2024 08:30:00			-0.02	0.00	0.18	0.20	0.12	0.60	0.00					
11/07/2024 08:45:00			-0.02	0.00	0.18	0.20	0.12	0.60	0.00					
11/07/2024 09:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 09:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 09:30:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 09:45:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 10:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 10:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 10:30:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 10:45:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 11:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 11:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 11:30:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 11:45:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 12:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 12:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 12:30:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 12:45:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 13:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 13:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 13:30:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 13:45:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 14:00:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 14:15:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 14:30:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 14:45:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 15:00:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 15:15:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 15:30:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 15:45:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 16:00:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 16:15:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 16:30:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
11/07/2024 16:45:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 17:00:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 17:15:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 17:30:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 17:45:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 18:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 18:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 18:30:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 18:45:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 19:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 19:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 19:30:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 19:45:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 20:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 20:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 20:30:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 20:45:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 21:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 21:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 21:30:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 21:45:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 22:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 22:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 22:30:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 22:45:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
11/07/2024 23:00:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 23:15:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 23:30:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
11/07/2024 23:45:00			-0.02	0.00	0.18	0.21	0.13	0.59	0.00					
12/07/2024 00:00:00			-0.02	0.00	0.18	0.21	0.13	0.59	0.00					
12/07/2024 00:15:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
12/07/2024 00:30:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
12/07/2024 00:45:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
12/07/2024 01:00:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
12/07/2024 01:15:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
12/07/2024 01:30:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
12/07/2024 01:45:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
12/07/2024 02:00:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
12/07/2024 02:15:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
12/07/2024 02:30:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
12/07/2024 02:45:00			-0.02	0.00	0.18	0.20	0.12	0.58	0.00					
12/07/2024 03:00:00			-0.02	0.00	0.18	0.20	0.12	0.58	0.00					
12/07/2024 03:15:00			-0.02	0.00	0.18	0.20	0.12	0.58	0.00					
12/07/2024 03:30:00			-0.02	0.00	0.18	0.20	0.12	0.58	0.00					
12/07/2024 03:45:00			-0.02	0.00	0.18	0.20	0.12	0.58	0.00					
12/07/2024 04:00:00			-0.02	0.00	0.18	0.20	0.12	0.58	0.00					
12/07/2024 04:15:00			-0.02	0.00	0.18	0.20	0.12	0.58	0.00					
12/07/2024 04:30:00			-0.02	0.00	0.18	0.20	0.12	0.58	0.00					
12/07/2024 04:45:00			-0.02	0.00	0.18	0.20	0.12	0.58	0.00					
12/07/2024 05:00:00			-0.02	0.00	0.18	0.20	0.12	0.58	0.00					
12/07/2024 05:15:00			-0.02	0.00	0.17	0.20	0.12	0.58	0.00					
12/07/2024 05:30:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
12/07/2024 05:45:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
12/07/2024 06:00:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
12/07/2024 06:15:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
12/07/2024 06:30:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
12/07/2024 06:45:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
12/07/2024 07:00:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
12/07/2024 07:15:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
12/07/2024 07:30:00			-0.02	0.00	0.17	0.20	0.12	0.58	0.00					
12/07/2024 07:45:00			-0.02	0.00	0.17	0.20	0.12	0.58	0.00					
12/07/2024 08:00:00			-0.02	0.00	0.17	0.20	0.12	0.58	0.00					
12/07/2024 08:15:00			-0.02	0.00	0.17	0.20	0.12	0.58	0.00					
12/07/2024 08:30:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 08:45:00			-0.02	0.00	0.17	0.19	0.12	0.59	0.00					
12/07/2024 09:00:00			-0.02	0.00	0.17	0.19	0.12	0.59	0.00					
12/07/2024 09:15:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 09:30:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 09:45:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 10:00:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 10:15:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 10:30:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 10:45:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 11:00:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 11:15:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 11:30:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 11:45:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 12:00:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 12:15:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 12:30:00			-0.02	0.00	0.17	0.20	0.12	0.59	0.00					
12/07/2024 12:45:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 13:00:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 13:15:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 13:30:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 13:45:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 14:00:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 14:15:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 14:30:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 14:45:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 15:00:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 15:15:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 15:30:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 15:45:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 16:00:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 16:15:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 16:30:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 16:45:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 17:00:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 17:15:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 17:30:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 17:45:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 18:00:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 18:15:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 18:30:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 18:45:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 19:00:00			-0.02	0.00	0.18	0.20	0.12	0.59	0.00					
12/07/2024 19:15:00			-0.02	0.00	0.18	0.20	0.12	0.60	0.00					
12/07/2024 19:30:00			-0.02	0.00	0.18	0.20	0.12	0.61	0.00					
12/07/2024 19:45:00			-0.02	0.00	0.18	0.20	0.12	0.62	0.00					
12/07/2024 20:00:00			-0.02	0.00	0.18	0.20	0.12	0.63	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
12/07/2024 20:15:00			-0.02	0.00	0.18	0.20	0.13	0.63	0.00					
12/07/2024 20:30:00			-0.02	0.00	0.18	0.20	0.13	0.63	0.00					
12/07/2024 20:45:00			-0.02	0.00	0.18	0.21	0.13	0.63	0.00					
12/07/2024 21:00:00			-0.02	0.00	0.18	0.21	0.13	0.63	0.00					
12/07/2024 21:15:00			-0.02	0.00	0.19	0.21	0.13	0.63	0.00					
12/07/2024 21:30:00			-0.02	0.00	0.19	0.21	0.14	0.64	0.00					
12/07/2024 21:45:00			-0.01	0.00	0.19	0.21	0.14	0.64	0.00					
12/07/2024 22:00:00			-0.01	0.00	0.19	0.21	0.14	0.64	0.00					
12/07/2024 22:15:00			-0.01	0.00	0.19	0.22	0.14	0.64	0.00					
12/07/2024 22:30:00			-0.01	0.00	0.19	0.22	0.14	0.64	0.00					
12/07/2024 22:45:00			-0.01	0.00	0.20	0.22	0.15	0.64	0.00					
12/07/2024 23:00:00			-0.01	0.00	0.20	0.22	0.15	0.63	0.00					
12/07/2024 23:15:00			-0.01	0.00	0.20	0.22	0.15	0.61	0.00					
12/07/2024 23:30:00			-0.01	0.00	0.20	0.22	0.15	0.61	0.00					
12/07/2024 23:45:00			-0.01	0.00	0.20	0.22	0.15	0.61	0.00					
13/07/2024 00:00:00			-0.01	0.00	0.20	0.22	0.15	0.62	0.00					
13/07/2024 00:15:00			0.00	0.00	0.20	0.22	0.15	0.62	0.00					
13/07/2024 00:30:00			0.00	0.00	0.20	0.23	0.15	0.62	0.00					
13/07/2024 00:45:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
13/07/2024 01:00:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
13/07/2024 01:15:00			0.00	0.00	0.21	0.23	0.16	0.62	0.00					
13/07/2024 01:30:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 01:45:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 02:00:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 02:15:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 02:30:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 02:45:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 03:00:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 03:15:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 03:30:00			0.01	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 03:45:00			0.01	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 04:00:00			0.01	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 04:15:00			0.00	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 04:30:00			0.01	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 04:45:00			0.01	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 05:00:00			0.01	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 05:15:00			0.01	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 05:30:00			0.01	0.00	0.21	0.23	0.16	0.61	0.00					
13/07/2024 05:45:00			0.01	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 06:00:00			0.01	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 06:15:00			0.01	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 06:30:00			0.01	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 06:45:00			0.01	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 07:00:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 07:15:00			0.01	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 07:30:00			0.01	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 07:45:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 08:00:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 08:15:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 08:30:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 08:45:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 09:00:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 09:15:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 09:30:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 09:45:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 10:00:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 10:15:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 10:30:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 10:45:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 11:00:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 11:15:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 11:30:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 11:45:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 12:00:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 12:15:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 12:30:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 12:45:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 13:00:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 13:15:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 13:30:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 13:45:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 14:00:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 14:15:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 14:30:00			0.00	0.00	0.21	0.23	0.16	0.60	0.00					
13/07/2024 14:45:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 15:00:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 15:15:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 15:30:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 15:45:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 16:00:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 16:15:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 16:30:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 16:45:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 17:00:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 17:15:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 17:30:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 17:45:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 18:00:00			0.00	0.00	0.20	0.22	0.15	0.60	0.00					
13/07/2024 18:15:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 18:30:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 18:45:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 19:00:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 19:15:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 19:30:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 19:45:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 20:00:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 20:15:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 20:30:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 20:45:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 21:00:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 21:15:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 21:30:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 21:45:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 22:00:00			0.00	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 22:15:00			-0.01	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 22:30:00			-0.01	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 22:45:00			-0.01	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 23:00:00			-0.01	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 23:15:00			-0.01	0.00	0.20	0.22	0.15	0.59	0.00					
13/07/2024 23:30:00			-0.01	0.00	0.20	0.22	0.15	0.59	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
13/07/2024 23:45:00			-0.01	0.00	0.20	0.22	0.15	0.59	0.00					
14/07/2024 00:00:00			-0.01	0.00	0.20	0.22	0.15	0.59	0.00					
14/07/2024 00:15:00			-0.01	0.00	0.20	0.21	0.14	0.59	0.00					
14/07/2024 00:30:00			-0.01	0.00	0.20	0.21	0.14	0.59	0.00					
14/07/2024 00:45:00			-0.01	0.00	0.20	0.21	0.14	0.59	0.00					
14/07/2024 01:00:00			-0.01	0.00	0.20	0.21	0.14	0.59	0.00					
14/07/2024 01:15:00			-0.01	0.00	0.20	0.21	0.14	0.58	0.00					
14/07/2024 01:30:00			-0.01	0.00	0.20	0.21	0.14	0.58	0.00					
14/07/2024 01:45:00			-0.01	0.00	0.19	0.21	0.14	0.58	0.00					
14/07/2024 02:00:00			-0.01	0.00	0.19	0.21	0.14	0.58	0.00					
14/07/2024 02:15:00			-0.01	0.00	0.19	0.21	0.14	0.58	0.00					
14/07/2024 02:30:00			-0.01	0.00	0.19	0.21	0.14	0.58	0.00					
14/07/2024 02:45:00			-0.01	0.00	0.19	0.21	0.14	0.58	0.00					
14/07/2024 03:00:00			-0.01	0.00	0.19	0.21	0.14	0.58	0.00					
14/07/2024 03:15:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
14/07/2024 03:30:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
14/07/2024 03:45:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
14/07/2024 04:00:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
14/07/2024 04:15:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
14/07/2024 04:30:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
14/07/2024 04:45:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
14/07/2024 05:00:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
14/07/2024 05:15:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
14/07/2024 05:30:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
14/07/2024 05:45:00			-0.01	0.00	0.19	0.21	0.13	0.57	0.00					
14/07/2024 06:00:00			-0.01	0.00	0.19	0.21	0.13	0.57	0.00					
14/07/2024 06:15:00			-0.01	0.00	0.19	0.21	0.13	0.57	0.00					
14/07/2024 06:30:00			-0.01	0.00	0.19	0.21	0.13	0.57	0.00					
14/07/2024 06:45:00			-0.01	0.00	0.18	0.21	0.13	0.57	0.00					
14/07/2024 07:00:00			-0.01	0.00	0.18	0.21	0.13	0.57	0.00					
14/07/2024 07:15:00			-0.02	0.00	0.18	0.21	0.13	0.57	0.00					
14/07/2024 07:30:00			-0.02	0.00	0.18	0.20	0.13	0.57	0.00					
14/07/2024 07:45:00			-0.02	0.00	0.18	0.20	0.13	0.57	0.00					
14/07/2024 08:00:00			-0.02	0.00	0.18	0.20	0.13	0.57	0.00					
14/07/2024 08:15:00			-0.02	0.00	0.18	0.20	0.13	0.57	0.00					
14/07/2024 08:30:00			-0.02	0.00	0.18	0.20	0.13	0.57	0.00					
14/07/2024 08:45:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
14/07/2024 09:00:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
14/07/2024 09:15:00			-0.02	0.00	0.18	0.20	0.13	0.58	0.00					
14/07/2024 09:30:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
14/07/2024 09:45:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 10:00:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 10:15:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 10:30:00			-0.02	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 10:45:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 11:00:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 11:15:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 11:30:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 11:45:00			-0.02	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 12:00:00			-0.01	0.00	0.18	0.21	0.13	0.60	0.00					
14/07/2024 12:15:00			-0.01	0.00	0.19	0.21	0.13	0.60	0.00					
14/07/2024 12:30:00			-0.02	0.00	0.19	0.21	0.13	0.60	0.00					
14/07/2024 12:45:00			-0.02	0.00	0.19	0.21	0.13	0.60	0.00					
14/07/2024 13:00:00			-0.01	0.00	0.19	0.21	0.14	0.60	0.00					
14/07/2024 13:15:00			-0.02	0.00	0.19	0.21	0.14	0.60	0.00					
14/07/2024 13:30:00			-0.01	0.00	0.19	0.21	0.14	0.60	0.00					
14/07/2024 13:45:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
14/07/2024 14:00:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
14/07/2024 14:15:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
14/07/2024 14:30:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
14/07/2024 14:45:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
14/07/2024 15:00:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
14/07/2024 15:15:00			-0.02	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 15:30:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 15:45:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 16:00:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 16:15:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 16:30:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 16:45:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 17:00:00			-0.01	0.00	0.18	0.21	0.13	0.59	0.00					
14/07/2024 17:15:00			-0.01	0.00	0.18	0.21	0.13	0.59	0.00					
14/07/2024 17:30:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 17:45:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 18:00:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 18:15:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 18:30:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 18:45:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 19:00:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 19:15:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 19:30:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 19:45:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 20:00:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 20:15:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
14/07/2024 20:30:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 20:45:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
14/07/2024 21:00:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 21:15:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 21:30:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 21:45:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 22:00:00			-0.01	0.00	0.19	0.21	0.13	0.59	0.00					
14/07/2024 22:15:00			-0.01	0.00	0.19	0.21	0.13	0.58	0.00					
14/07/2024 22:30:00			-0.01	0.00	0.19	0.21	0.13	0.58	0.00					
14/07/2024 22:45:00			-0.01	0.00	0.18	0.21	0.13	0.58	0.00					
14/07/2024 23:00:00			-0.01	0.00	0.18	0.21	0.13	0.58	0.00					
14/07/2024 23:15:00			-0.01	0.00	0.18	0.21	0.13	0.58	0.00					
14/07/2024 23:30:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
14/07/2024 23:45:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
15/07/2024 00:00:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
15/07/2024 00:15:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
15/07/2024 00:30:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
15/07/2024 00:45:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
15/07/2024 01:00:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
15/07/2024 01:15:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
15/07/2024 01:30:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
15/07/2024 01:45:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
15/07/2024 02:00:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
15/07/2024 02:15:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
15/07/2024 02:30:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
15/07/2024 02:45:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
15/07/2024 03:00:00			-0.01	0.00	0.18	0.20	0.12	0.57	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
15/07/2024 03:15:00			-0.02	0.00	0.18	0.20	0.12	0.56	0.00					
15/07/2024 03:30:00			-0.02	0.00	0.18	0.20	0.12	0.56	0.00					
15/07/2024 03:45:00			-0.02	0.00	0.18	0.20	0.12	0.56	0.00					
15/07/2024 04:00:00			-0.02	0.00	0.18	0.20	0.12	0.56	0.00					
15/07/2024 04:15:00			-0.02	0.00	0.18	0.20	0.12	0.56	0.00					
15/07/2024 04:30:00			-0.02	0.00	0.17	0.20	0.12	0.56	0.00					
15/07/2024 04:45:00			-0.02	0.00	0.17	0.20	0.12	0.56	0.00					
15/07/2024 05:00:00			-0.02	0.00	0.17	0.20	0.12	0.56	0.00					
15/07/2024 05:15:00			-0.02	0.00	0.17	0.20	0.12	0.56	0.00					
15/07/2024 05:30:00			-0.02	0.00	0.17	0.20	0.12	0.56	0.00					
15/07/2024 05:45:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.00					
15/07/2024 06:00:00			0.00	0.00	0.17	0.19	0.12	0.56	0.00					
15/07/2024 06:15:00			0.00	0.00	0.17	0.19	0.12	0.56	0.00					
15/07/2024 06:30:00			0.00	0.00	0.17	0.19	0.12	0.56	0.00					
15/07/2024 06:45:00			0.00	0.00	0.17	0.19	0.12	0.56	0.00					
15/07/2024 07:00:00			-0.01	0.00	0.17	0.19	0.12	0.57	0.00					
15/07/2024 07:15:00			-0.01	0.00	0.17	0.19	0.12	0.57	0.00					
15/07/2024 07:30:00			-0.01	0.00	0.17	0.19	0.12	0.57	0.00					
15/07/2024 07:45:00			-0.01	0.00	0.17	0.19	0.12	0.57	0.00					
15/07/2024 08:00:00			-0.01	0.00	0.17	0.19	0.12	0.58	0.00					
15/07/2024 08:15:00			-0.01	0.00	0.17	0.19	0.12	0.58	0.00					
15/07/2024 08:30:00			-0.01	0.00	0.17	0.19	0.12	0.58	0.00					
15/07/2024 08:45:00			-0.01	0.00	0.17	0.19	0.12	0.58	0.00					
15/07/2024 09:00:00			-0.01	0.00	0.17	0.19	0.12	0.58	0.00					
15/07/2024 09:15:00			-0.01	0.00	0.17	0.19	0.12	0.58	0.00					
15/07/2024 09:30:00			-0.01	0.00	0.17	0.19	0.12	0.58	0.00					
15/07/2024 09:45:00			-0.01	0.00	0.17	0.20	0.12	0.58	0.00					
15/07/2024 10:00:00			-0.01	0.00	0.17	0.20	0.12	0.59	0.00					
15/07/2024 10:15:00			-0.01	0.00	0.17	0.20	0.12	0.59	0.00					
15/07/2024 10:30:00			-0.01	0.00	0.17	0.20	0.12	0.59	0.00					
15/07/2024 10:45:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 11:00:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 11:15:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 11:30:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 11:45:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 12:00:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 12:15:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 12:30:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 12:45:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 13:00:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 13:15:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 13:30:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 13:45:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 14:00:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 14:15:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 14:30:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 14:45:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 15:00:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 15:15:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 15:30:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 15:45:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 16:00:00			-0.01	0.00	0.18	0.20	0.12	0.58	0.00					
15/07/2024 16:15:00			-0.01	0.00	0.18	0.20	0.12	0.58	0.00					
15/07/2024 16:30:00			-0.01	0.00	0.18	0.20	0.12	0.58	0.00					
15/07/2024 16:45:00			-0.01	0.00	0.18	0.20	0.12	0.58	0.00					
15/07/2024 17:00:00			-0.01	0.00	0.18	0.20	0.12	0.58	0.00					
15/07/2024 17:15:00			-0.01	0.00	0.18	0.20	0.12	0.58	0.00					
15/07/2024 17:30:00			-0.01	0.00	0.18	0.20	0.12	0.58	0.00					
15/07/2024 17:45:00			-0.01	0.00	0.18	0.20	0.12	0.58	0.00					
15/07/2024 18:00:00			-0.01	0.00	0.18	0.20	0.12	0.58	0.00					
15/07/2024 18:15:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 18:30:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 18:45:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 19:00:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 19:15:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 19:30:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 19:45:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 20:00:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 20:15:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 20:30:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 20:45:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 21:00:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 21:15:00			-0.01	0.00	0.18	0.20	0.12	0.59	0.00					
15/07/2024 21:30:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
15/07/2024 21:45:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
15/07/2024 22:00:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
15/07/2024 22:15:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
15/07/2024 22:30:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
15/07/2024 22:45:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
15/07/2024 23:00:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
15/07/2024 23:15:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
15/07/2024 23:30:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
15/07/2024 23:45:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
16/07/2024 00:00:00			-0.01	0.00	0.18	0.20	0.13	0.59	0.00					
16/07/2024 00:15:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
16/07/2024 00:30:00			-0.01	0.00	0.18	0.20	0.13	0.62	0.00					
16/07/2024 00:45:00			-0.01	0.00	0.18	0.20	0.13	0.63	0.00					
16/07/2024 01:00:00			-0.01	0.00	0.18	0.20	0.13	0.63	0.00					
16/07/2024 01:15:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
16/07/2024 01:30:00			-0.01	0.00	0.18	0.20	0.13	0.60	0.00					
16/07/2024 01:45:00			-0.01	0.00	0.19	0.20	0.13	0.59	0.00					
16/07/2024 02:00:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 02:15:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 02:30:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 02:45:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 03:00:00			0.00	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 03:15:00			0.00	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 03:30:00			0.00	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 03:45:00			0.00	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 04:00:00			0.00	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 04:15:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 04:30:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 04:45:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 05:00:00			0.00	0.00	0.20	0.21	0.14	0.58	0.00					
16/07/2024 05:15:00			0.00	0.00	0.20	0.21	0.14	0.58	0.00					
16/07/2024 05:30:00			0.00	0.00	0.20	0.21	0.14	0.58	0.00					
16/07/2024 05:45:00			0.00	0.00	0.20	0.21	0.14	0.57	0.00					
16/07/2024 06:00:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 06:15:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 06:30:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
16/07/2024 06:45:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 07:00:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 07:15:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 07:30:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 07:45:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 08:00:00			-0.01	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 08:15:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 08:30:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 08:45:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 09:00:00			0.00	0.00	0.19	0.21	0.13	0.59	0.00					
16/07/2024 09:15:00			0.00	0.00	0.19	0.21	0.13	0.58	0.00					
16/07/2024 09:30:00			-0.01	0.00	0.19	0.21	0.13	0.58	0.00					
16/07/2024 09:45:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 10:00:00			-0.01	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 10:15:00			0.00	0.00	0.19	0.21	0.14	0.59	0.00					
16/07/2024 10:30:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 10:45:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 11:00:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 11:15:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 11:30:00			-0.01	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 11:45:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 12:00:00			0.00	0.00	0.19	0.21	0.14	0.58	0.00					
16/07/2024 12:15:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 12:30:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 12:45:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 13:00:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 13:15:00			0.00	0.00	0.19	0.21	0.14	0.57	0.00					
16/07/2024 13:30:00			0.00	0.00	0.19	0.21	0.13	0.57	0.00					
16/07/2024 13:45:00			0.00	0.00	0.19	0.21	0.13	0.57	0.00					
16/07/2024 14:00:00			0.00	0.00	0.19	0.21	0.13	0.57	0.00					
16/07/2024 14:15:00			-0.01	0.00	0.19	0.20	0.13	0.57	0.00					
16/07/2024 14:30:00			-0.01	0.00	0.19	0.20	0.13	0.57	0.00					
16/07/2024 14:45:00			-0.01	0.00	0.19	0.20	0.13	0.57	0.00					
16/07/2024 15:00:00			0.00	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 15:15:00			0.00	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 15:30:00			0.00	0.00	0.18	0.20	0.13	0.58	0.00					
16/07/2024 15:45:00			0.00	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 16:00:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 16:15:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 16:30:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 16:45:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 17:00:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 17:15:00			0.00	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 17:30:00			0.00	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 17:45:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 18:00:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 18:15:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 18:30:00			0.00	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 18:45:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 19:00:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 19:15:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 19:30:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 19:45:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 20:00:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 20:15:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
16/07/2024 20:30:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 20:45:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 21:00:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 21:15:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 21:30:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 21:45:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 22:00:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 22:15:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 22:30:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 22:45:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
16/07/2024 23:00:00			-0.01	0.00	0.18	0.20	0.13	0.58	0.00					
16/07/2024 23:15:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 23:30:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
16/07/2024 23:45:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
17/07/2024 00:00:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
17/07/2024 00:15:00			-0.01	0.00	0.18	0.20	0.13	0.57	0.00					
17/07/2024 00:30:00			-0.01	0.00	0.18	0.20	0.13	0.56	0.00					
17/07/2024 00:45:00			-0.01	0.00	0.18	0.20	0.13	0.56	0.00					
17/07/2024 01:00:00			-0.01	0.00	0.18	0.20	0.13	0.56	0.00					
17/07/2024 01:15:00			-0.01	0.00	0.18	0.20	0.13	0.56	0.00					
17/07/2024 01:30:00			-0.01	0.00	0.18	0.20	0.13	0.56	0.00					
17/07/2024 01:45:00			-0.01	0.00	0.18	0.20	0.13	0.55	0.00					
17/07/2024 02:00:00			-0.01	0.00	0.18	0.20	0.13	0.55	0.00					
17/07/2024 02:15:00			-0.01	0.00	0.18	0.20	0.13	0.55	0.00					
17/07/2024 02:30:00			-0.01	0.00	0.18	0.20	0.12	0.55	0.00					
17/07/2024 02:45:00			-0.01	0.00	0.18	0.20	0.12	0.55	0.00					
17/07/2024 03:00:00			-0.01	0.00	0.18	0.20	0.12	0.55	0.00					
17/07/2024 03:15:00			-0.01	0.00	0.18	0.20	0.12	0.55	0.00					
17/07/2024 03:30:00			-0.01	0.00	0.17	0.20	0.12	0.55	0.00					
17/07/2024 03:45:00			-0.01	0.00	0.17	0.20	0.12	0.55	0.00					
17/07/2024 04:00:00			-0.01	0.00	0.17	0.19	0.12	0.55	0.00					
17/07/2024 04:15:00			-0.01	0.00	0.17	0.19	0.12	0.55	0.00					
17/07/2024 04:30:00			-0.01	0.00	0.17	0.19	0.12	0.55	0.00					
17/07/2024 04:45:00			-0.01	0.00	0.17	0.19	0.12	0.55	0.00					
17/07/2024 05:00:00			-0.01	0.00	0.17	0.19	0.12	0.54	0.00					
17/07/2024 05:15:00			-0.01	0.00	0.17	0.19	0.12	0.54	0.00					
17/07/2024 05:30:00			-0.01	0.00	0.17	0.19	0.12	0.54	0.00					
17/07/2024 05:45:00			-0.01	0.00	0.17	0.19	0.11	0.54	0.00					
17/07/2024 06:00:00			-0.01	0.00	0.17	0.19	0.11	0.54	0.00					
17/07/2024 06:15:00			-0.01	0.00	0.17	0.19	0.11	0.54	0.00					
17/07/2024 06:30:00			-0.01	0.00	0.17	0.19	0.11	0.54	0.00					
17/07/2024 06:45:00			-0.01	0.00	0.17	0.19	0.11	0.55	0.00					
17/07/2024 07:00:00			-0.01	0.00	0.17	0.19	0.11	0.55	0.00					
17/07/2024 07:15:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
17/07/2024 07:30:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
17/07/2024 07:45:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
17/07/2024 08:00:00			-0.02	0.00	0.17	0.19	0.11	0.56	0.00					
17/07/2024 08:15:00			-0.02	0.00	0.17	0.19	0.11	0.56	0.00					
17/07/2024 08:30:00			-0.02	0.00	0.17	0.19	0.11	0.56	0.00					
17/07/2024 08:45:00			-0.02	0.00	0.17	0.19	0.11	0.56	0.00					
17/07/2024 09:00:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 09:15:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 09:30:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 09:45:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 10:00:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
17/07/2024 10:15:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 10:30:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 10:45:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 11:00:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 11:15:00			-0.01	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 11:30:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 11:45:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
17/07/2024 12:00:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
17/07/2024 12:15:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
17/07/2024 12:30:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
17/07/2024 12:45:00			-0.01	0.00	0.17	0.20	0.12	0.57	0.00					
17/07/2024 13:00:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
17/07/2024 13:15:00			-0.02	0.00	0.17	0.20	0.12	0.57	0.00					
17/07/2024 13:30:00			-0.01	0.00	0.17	0.20	0.12	0.57	0.00					
17/07/2024 13:45:00			-0.01	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 14:00:00			-0.01	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 14:15:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 14:30:00			-0.01	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 14:45:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 15:00:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 15:15:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.00					
17/07/2024 15:30:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.00					
17/07/2024 15:45:00			-0.01	0.00	0.17	0.19	0.12	0.56	0.00					
17/07/2024 16:00:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.00					
17/07/2024 16:15:00			-0.01	0.00	0.17	0.19	0.11	0.56	0.00					
17/07/2024 16:30:00			-0.01	0.00	0.17	0.19	0.11	0.56	0.00					
17/07/2024 16:45:00			-0.01	0.00	0.17	0.19	0.11	0.56	0.00					
17/07/2024 17:00:00			-0.01	0.00	0.17	0.19	0.11	0.56	0.00					
17/07/2024 17:15:00			-0.01	0.00	0.17	0.19	0.11	0.56	0.00					
17/07/2024 17:30:00			-0.01	0.00	0.17	0.19	0.11	0.56	0.00					
17/07/2024 17:45:00			-0.01	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 18:00:00			-0.01	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 18:15:00			-0.01	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 18:30:00			-0.01	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 18:45:00			-0.01	0.00	0.17	0.19	0.11	0.58	0.00					
17/07/2024 19:00:00			-0.01	0.00	0.17	0.19	0.11	0.58	0.00					
17/07/2024 19:15:00			-0.02	0.00	0.17	0.19	0.11	0.58	0.00					
17/07/2024 19:30:00			-0.01	0.00	0.17	0.19	0.11	0.58	0.00					
17/07/2024 19:45:00			-0.02	0.00	0.17	0.19	0.11	0.58	0.00					
17/07/2024 20:00:00			-0.02	0.00	0.17	0.19	0.11	0.58	0.00					
17/07/2024 20:15:00			-0.02	0.00	0.17	0.19	0.11	0.58	0.00					
17/07/2024 20:30:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 20:45:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
17/07/2024 21:00:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 21:15:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 21:30:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 21:45:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 22:00:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 22:15:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 22:30:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 22:45:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 23:00:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 23:15:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 23:30:00			-0.02	0.00	0.17	0.19	0.12	0.57	0.00					
17/07/2024 23:45:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.00					
18/07/2024 00:00:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.00					
18/07/2024 00:15:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.00					
18/07/2024 00:30:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.00					
18/07/2024 00:45:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.00					
18/07/2024 01:00:00			-0.01	0.00	0.17	0.19	0.12	0.56	0.00					
18/07/2024 01:15:00			-0.02	0.00	0.17	0.19	0.12	0.56	0.00					
18/07/2024 01:30:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
18/07/2024 01:45:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
18/07/2024 02:00:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
18/07/2024 02:15:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
18/07/2024 02:30:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
18/07/2024 02:45:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
18/07/2024 03:00:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
18/07/2024 03:15:00			-0.02	0.00	0.17	0.19	0.11	0.55	0.00					
18/07/2024 03:30:00			-0.02	0.00	0.16	0.19	0.11	0.55	0.00					
18/07/2024 03:45:00			-0.02	0.00	0.16	0.19	0.11	0.55	0.00					
18/07/2024 04:00:00			-0.02	0.00	0.16	0.19	0.11	0.55	0.00					
18/07/2024 04:15:00			-0.02	0.00	0.16	0.19	0.11	0.55	0.00					
18/07/2024 04:30:00			-0.02	0.00	0.16	0.19	0.11	0.55	0.00					
18/07/2024 04:45:00			-0.02	0.00	0.16	0.19	0.11	0.55	0.00					
18/07/2024 05:00:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
18/07/2024 05:15:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
18/07/2024 05:30:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
18/07/2024 05:45:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
18/07/2024 06:00:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
18/07/2024 06:15:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
18/07/2024 06:30:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
18/07/2024 06:45:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
18/07/2024 07:00:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
18/07/2024 07:15:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
18/07/2024 07:30:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
18/07/2024 07:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
18/07/2024 08:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
18/07/2024 08:15:00			-0.02	0.00	0.16	0.18	0.10	0.56	0.00					
18/07/2024 08:30:00			-0.03	0.00	0.16	0.18	0.10	0.56	0.00					
18/07/2024 08:45:00			-0.03	0.00	0.16	0.18	0.10	0.56	0.00					
18/07/2024 09:00:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
18/07/2024 09:15:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
18/07/2024 09:30:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 09:45:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 10:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 10:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 10:30:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 10:45:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 11:00:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 11:15:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 11:30:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 11:45:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 12:00:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 12:15:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 12:30:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 12:45:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 13:00:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 13:15:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 13:30:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
18/07/2024 13:45:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 14:00:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 14:15:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 14:30:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 14:45:00			-0.02	0.00	0.17	0.19	0.11	0.57	0.00					
18/07/2024 15:00:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 15:15:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 15:30:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 15:45:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 16:00:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 16:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 16:30:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 16:45:00			-0.02	0.00	0.16	0.18	0.11	0.58	0.00					
18/07/2024 17:00:00			-0.02	0.00	0.16	0.18	0.11	0.58	0.00					
18/07/2024 17:15:00			-0.02	0.00	0.16	0.18	0.11	0.58	0.00					
18/07/2024 17:30:00			-0.02	0.00	0.16	0.18	0.11	0.58	0.00					
18/07/2024 17:45:00			-0.02	0.00	0.16	0.18	0.11	0.58	0.00					
18/07/2024 18:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 18:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 18:30:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 18:45:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 19:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 19:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 19:30:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 19:45:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 20:00:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 20:15:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 20:30:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 20:45:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 21:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
18/07/2024 21:15:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 21:30:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 21:45:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 22:00:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.00					
18/07/2024 22:15:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.10					
18/07/2024 22:30:00			-0.02	0.00	0.16	0.19	0.11	0.57						
18/07/2024 22:45:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.20					
18/07/2024 23:00:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.22					
18/07/2024 23:15:00			-0.02	0.00	0.16	0.19	0.11	0.57						
18/07/2024 23:30:00			-0.02	0.00	0.16	0.19	0.11	0.57						
18/07/2024 23:45:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.21					
19/07/2024 00:00:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.20					
19/07/2024 00:15:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.20					
19/07/2024 00:30:00			-0.02	0.00	0.16	0.19	0.11	0.57	0.20					
19/07/2024 00:45:00			-0.02	0.00	0.16	0.19	0.11	0.57						
19/07/2024 01:00:00			-0.02	0.00	0.16	0.19	0.11	0.56						
19/07/2024 01:15:00			-0.02	0.00	0.16	0.19	0.11	0.56	0.10					
19/07/2024 01:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 01:45:00			-0.02	0.00	0.16	0.19	0.11	0.56	0.00					
19/07/2024 02:00:00			-0.02	0.00	0.16	0.19	0.11	0.55	0.00					
19/07/2024 02:15:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
19/07/2024 02:30:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
19/07/2024 02:45:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.10					
19/07/2024 03:00:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.19					
19/07/2024 03:15:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.19					
19/07/2024 03:30:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.19					
19/07/2024 03:45:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.19					
19/07/2024 04:00:00			-0.02	0.00	0.16	0.18	0.11	0.54						
19/07/2024 04:15:00			-0.02	0.00	0.16	0.18	0.11	0.54						
19/07/2024 04:30:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.10					
19/07/2024 04:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
19/07/2024 05:00:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
19/07/2024 05:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
19/07/2024 05:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
19/07/2024 05:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
19/07/2024 06:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
19/07/2024 06:15:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
19/07/2024 06:30:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
19/07/2024 06:45:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
19/07/2024 07:00:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
19/07/2024 07:15:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
19/07/2024 07:30:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
19/07/2024 07:45:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
19/07/2024 08:00:00			-0.03	0.00	0.15	0.18	0.10	0.56	0.00					
19/07/2024 08:15:00			-0.03	0.00	0.15	0.18	0.10	0.56	0.00					
19/07/2024 08:30:00			-0.03	0.00	0.15	0.18	0.10	0.56	0.00					
19/07/2024 08:45:00			-0.03	0.00	0.15	0.18	0.10	0.57	0.00					
19/07/2024 09:00:00			-0.03	0.00	0.15	0.18	0.10	0.57	0.00					
19/07/2024 09:15:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
19/07/2024 09:30:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
19/07/2024 09:45:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
19/07/2024 10:00:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
19/07/2024 10:15:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
19/07/2024 10:30:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
19/07/2024 10:45:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 11:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 11:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 11:30:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 11:45:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 12:00:00			-0.02	0.00	0.16	0.18	0.11	0.58	0.00					
19/07/2024 12:15:00			-0.02	0.00	0.16	0.18	0.11	0.58	0.00					
19/07/2024 12:30:00			-0.02	0.00	0.16	0.18	0.11	0.58	0.00					
19/07/2024 12:45:00			-0.02	0.00	0.16	0.18	0.11	0.58	0.00					
19/07/2024 13:00:00			-0.02	0.00	0.16	0.18	0.11	0.58	0.00					
19/07/2024 13:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 13:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 13:45:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 14:00:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 14:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 14:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 14:45:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 15:00:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 15:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 15:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 15:45:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 16:00:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 16:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 16:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 16:45:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 17:00:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
19/07/2024 17:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 17:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 17:45:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 18:00:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 18:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 18:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 18:45:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 19:00:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 19:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 19:30:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 19:45:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 20:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 20:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 20:30:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 20:45:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 21:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 21:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
19/07/2024 21:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 21:45:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 22:00:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
19/07/2024 22:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.10					
19/07/2024 22:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.20					
19/07/2024 22:45:00			-0.02	0.00	0.16	0.18	0.11	0.56						
19/07/2024 23:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.20					
19/07/2024 23:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.20					
19/07/2024 23:30:00			-0.02	0.00	0.16	0.18	0.11	0.57						
19/07/2024 23:45:00			-0.02	0.00	0.16	0.18	0.11	0.57						
20/07/2024 00:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.20					
20/07/2024 00:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.20					
20/07/2024 00:30:00			-0.02	0.00	0.16	0.18	0.11	0.56						
20/07/2024 00:45:00			-0.02	0.00	0.16	0.18	0.11	0.56						
20/07/2024 01:00:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.03					
20/07/2024 01:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
20/07/2024 01:30:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 01:45:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 02:00:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 02:15:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 02:30:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 02:45:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 03:00:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 03:15:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 03:30:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 03:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
20/07/2024 04:00:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
20/07/2024 04:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
20/07/2024 04:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
20/07/2024 04:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
20/07/2024 05:00:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
20/07/2024 05:15:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
20/07/2024 05:30:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
20/07/2024 05:45:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
20/07/2024 06:00:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
20/07/2024 06:15:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
20/07/2024 06:30:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
20/07/2024 06:45:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
20/07/2024 07:00:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
20/07/2024 07:15:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
20/07/2024 07:30:00			-0.03	0.00	0.15	0.17	0.10	0.55	0.00					
20/07/2024 07:45:00			-0.03	0.00	0.15	0.17	0.10	0.55	0.00					
20/07/2024 08:00:00			-0.03	0.00	0.15	0.17	0.10	0.55	0.00					
20/07/2024 08:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
20/07/2024 08:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.14					
20/07/2024 08:45:00			-0.03	0.00	0.15	0.17	0.10	0.56						
20/07/2024 09:00:00			-0.02	0.00	0.15	0.17	0.10	0.56						
20/07/2024 09:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.22					
20/07/2024 09:30:00			-0.03	0.00	0.15	0.17	0.10	0.57						
20/07/2024 09:45:00			-0.02	0.00	0.15	0.17	0.10	0.57						
20/07/2024 10:00:00			-0.03	0.00	0.15	0.18	0.10	0.58	0.04					
20/07/2024 10:15:00			-0.03	0.00	0.15	0.18	0.10	0.58	0.00					
20/07/2024 10:30:00			-0.02	0.00	0.15	0.18	0.10	0.58	0.00					
20/07/2024 10:45:00			-0.02	0.00	0.15	0.18	0.10	0.58	0.00					
20/07/2024 11:00:00			-0.03	0.00	0.15	0.18	0.10	0.58	0.00					
20/07/2024 11:15:00			-0.03	0.00	0.16	0.18	0.10	0.58	0.00					
20/07/2024 11:30:00			-0.03	0.00	0.16	0.18	0.10	0.58	0.00					
20/07/2024 11:45:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
20/07/2024 12:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
20/07/2024 12:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
20/07/2024 12:30:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
20/07/2024 12:45:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
20/07/2024 13:00:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
20/07/2024 13:15:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
20/07/2024 13:30:00			-0.02	0.00	0.16	0.18	0.11	0.57	0.00					
20/07/2024 13:45:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
20/07/2024 14:00:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
20/07/2024 14:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
20/07/2024 14:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
20/07/2024 14:45:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
20/07/2024 15:00:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
20/07/2024 15:15:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
20/07/2024 15:30:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
20/07/2024 15:45:00			-0.02	0.00	0.16	0.18	0.11	0.56	0.00					
20/07/2024 16:00:00			-0.02	0.00	0.16	0.18	0.11	0.52	0.00					
20/07/2024 16:15:00			-0.02	0.00	0.16	0.18	0.11	0.52	0.00					
20/07/2024 16:30:00			-0.02	0.00	0.16	0.18	0.11	0.53	0.00					
20/07/2024 16:45:00			-0.02	0.00	0.16	0.18	0.11	0.53	0.00					
20/07/2024 17:00:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
20/07/2024 17:15:00			-0.02	0.00	0.16	0.18	0.11	0.53	0.00					
20/07/2024 17:30:00			-0.02	0.00	0.16	0.18	0.11	0.53	0.00					
20/07/2024 17:45:00			-0.02	0.00	0.16	0.18	0.11	0.53	0.00					
20/07/2024 18:00:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 18:15:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 18:30:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 18:45:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 19:00:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 19:15:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 19:30:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 19:45:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 20:00:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 20:15:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 20:30:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
20/07/2024 20:45:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 21:00:00			-0.02	0.00	0.16	0.18	0.11	0.55	0.00					
20/07/2024 21:15:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
20/07/2024 21:30:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
20/07/2024 21:45:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
20/07/2024 22:00:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.07					
20/07/2024 22:15:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.19					
20/07/2024 22:30:00			-0.02	0.00	0.16	0.18	0.11	0.54						
20/07/2024 22:45:00			-0.02	0.00	0.16	0.18	0.11	0.55						
20/07/2024 23:00:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.02					
20/07/2024 23:15:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.00					
20/07/2024 23:30:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.10					
20/07/2024 23:45:00			-0.02	0.00	0.16	0.18	0.11	0.54						
21/07/2024 00:00:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.19					
21/07/2024 00:15:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.19					
21/07/2024 00:30:00			-0.02	0.00	0.16	0.18	0.11	0.54	0.19					
21/07/2024 00:45:00			-0.02	0.00	0.16	0.18	0.10	0.54						
21/07/2024 01:00:00			-0.02	0.00	0.16	0.18	0.10	0.53						
21/07/2024 01:15:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.10					
21/07/2024 01:30:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
21/07/2024 01:45:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
21/07/2024 02:00:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
21/07/2024 02:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 02:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 02:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 03:00:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
21/07/2024 03:15:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
21/07/2024 03:30:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
21/07/2024 03:45:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
21/07/2024 04:00:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
21/07/2024 04:15:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
21/07/2024 04:30:00			-0.02	0.00	0.15	0.18	0.10	0.52	0.00					
21/07/2024 04:45:00			-0.02	0.00	0.15	0.18	0.10	0.52	0.00					
21/07/2024 05:00:00			-0.02	0.00	0.15	0.18	0.10	0.52	0.00					
21/07/2024 05:15:00			-0.02	0.00	0.15	0.18	0.10	0.52	0.00					
21/07/2024 05:30:00			-0.02	0.00	0.15	0.18	0.10	0.52	0.00					
21/07/2024 05:45:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
21/07/2024 06:00:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
21/07/2024 06:15:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
21/07/2024 06:30:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
21/07/2024 06:45:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
21/07/2024 07:00:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
21/07/2024 07:15:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
21/07/2024 07:30:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
21/07/2024 07:45:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
21/07/2024 08:00:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
21/07/2024 08:15:00			-0.03	0.00	0.15	0.17	0.09	0.53	0.00					
21/07/2024 08:30:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
21/07/2024 08:45:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
21/07/2024 09:00:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
21/07/2024 09:15:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
21/07/2024 09:30:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
21/07/2024 09:45:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
21/07/2024 10:00:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
21/07/2024 10:15:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
21/07/2024 10:30:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
21/07/2024 10:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
21/07/2024 11:00:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
21/07/2024 11:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
21/07/2024 11:30:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
21/07/2024 11:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
21/07/2024 12:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
21/07/2024 12:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
21/07/2024 12:30:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
21/07/2024 12:45:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
21/07/2024 13:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 13:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 13:30:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 13:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 14:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 14:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 14:30:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 14:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 15:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 15:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 15:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 15:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 16:00:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 16:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 16:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 16:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 17:00:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 17:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 17:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 17:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 18:00:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
21/07/2024 18:15:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
21/07/2024 18:30:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
21/07/2024 18:45:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
21/07/2024 19:00:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
21/07/2024 19:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 19:30:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 19:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 20:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 20:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 20:30:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 20:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 21:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 21:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 21:30:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 21:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 22:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 22:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 22:30:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
21/07/2024 22:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 23:00:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 23:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 23:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
21/07/2024 23:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 00:00:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
22/07/2024 00:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 00:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 00:45:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
22/07/2024 01:00:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
22/07/2024 01:15:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
22/07/2024 01:30:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
22/07/2024 01:45:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
22/07/2024 02:00:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
22/07/2024 02:15:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
22/07/2024 02:30:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
22/07/2024 02:45:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
22/07/2024 03:00:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
22/07/2024 03:15:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
22/07/2024 03:30:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
22/07/2024 03:45:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
22/07/2024 04:00:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
22/07/2024 04:15:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
22/07/2024 04:30:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
22/07/2024 04:45:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
22/07/2024 05:00:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
22/07/2024 05:15:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
22/07/2024 05:30:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
22/07/2024 05:45:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
22/07/2024 06:00:00			-0.02	0.00	0.15	0.17	0.10	0.52	0.00					
22/07/2024 06:15:00			-0.02	0.00	0.15	0.17	0.09	0.52	0.00					
22/07/2024 06:30:00			-0.02	0.00	0.15	0.17	0.09	0.52	0.00					
22/07/2024 06:45:00			-0.02	0.00	0.15	0.17	0.09	0.52	0.00					
22/07/2024 07:00:00			-0.02	0.00	0.15	0.17	0.09	0.52	0.00					
22/07/2024 07:15:00			-0.02	0.00	0.15	0.17	0.09	0.52	0.00					
22/07/2024 07:30:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
22/07/2024 07:45:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
22/07/2024 08:00:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
22/07/2024 08:15:00			-0.03	0.00	0.15	0.17	0.09	0.53	0.00					
22/07/2024 08:30:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
22/07/2024 08:45:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
22/07/2024 09:00:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
22/07/2024 09:15:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
22/07/2024 09:30:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
22/07/2024 09:45:00			-0.03	0.00	0.15	0.17	0.09	0.54	0.00					
22/07/2024 10:00:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
22/07/2024 10:15:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
22/07/2024 10:30:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
22/07/2024 10:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
22/07/2024 11:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
22/07/2024 11:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
22/07/2024 11:30:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
22/07/2024 11:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
22/07/2024 12:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
22/07/2024 12:15:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
22/07/2024 12:30:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
22/07/2024 12:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 13:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 13:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 13:30:00			-0.03	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 13:45:00			-0.03	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 14:00:00			-0.03	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 14:15:00			-0.03	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 14:30:00			-0.03	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 14:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 15:00:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 15:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 15:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 15:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 16:00:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 16:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 16:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 16:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
22/07/2024 17:00:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
22/07/2024 17:15:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
22/07/2024 17:30:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
22/07/2024 17:45:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
22/07/2024 18:00:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
22/07/2024 18:15:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
22/07/2024 18:30:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
22/07/2024 18:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
22/07/2024 19:00:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
22/07/2024 19:15:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
22/07/2024 19:30:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
22/07/2024 19:45:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
22/07/2024 20:00:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
22/07/2024 20:15:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
22/07/2024 20:30:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
22/07/2024 20:45:00			-0.02	0.00	0.16	0.18	0.10	0.56	0.00					
22/07/2024 21:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 21:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 21:30:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 21:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 22:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 22:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 22:30:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 22:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 23:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 23:15:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 23:30:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
22/07/2024 23:45:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
23/07/2024 00:00:00			-0.02	0.00	0.16	0.18	0.10	0.55	0.00					
23/07/2024 00:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
23/07/2024 00:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
23/07/2024 00:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
23/07/2024 01:00:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
23/07/2024 01:15:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
23/07/2024 01:30:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
23/07/2024 01:45:00			-0.02	0.00	0.16	0.18	0.10	0.54	0.00					
23/07/2024 02:00:00			-0.02	0.00	0.16	0.18	0.10	0.53	0.00					
23/07/2024 02:15:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
23/07/2024 02:30:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
23/07/2024 02:45:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
23/07/2024 03:00:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
23/07/2024 03:15:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					
23/07/2024 03:30:00			-0.02	0.00	0.15	0.18	0.10	0.53	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
23/07/2024 03:45:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
23/07/2024 04:00:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
23/07/2024 04:15:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
23/07/2024 04:30:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
23/07/2024 04:45:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 05:00:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 05:15:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 05:30:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 05:45:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 06:00:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 06:15:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 06:30:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 06:45:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 07:00:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 07:15:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 07:30:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 07:45:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
23/07/2024 08:00:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
23/07/2024 08:15:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
23/07/2024 08:30:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
23/07/2024 08:45:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
23/07/2024 09:00:00			-0.03	0.00	0.15	0.17	0.09	0.54	0.00					
23/07/2024 09:15:00			-0.03	0.00	0.15	0.17	0.09	0.55	0.00					
23/07/2024 09:30:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
23/07/2024 09:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
23/07/2024 10:00:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
23/07/2024 10:15:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
23/07/2024 10:30:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
23/07/2024 10:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
23/07/2024 11:00:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
23/07/2024 11:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 11:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 11:45:00			-0.01	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 12:00:00			-0.01	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 12:15:00			-0.01	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 12:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 12:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 13:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 13:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 13:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 13:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 14:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 14:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 14:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 14:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 15:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 15:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 15:30:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
23/07/2024 15:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 16:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.17					
23/07/2024 16:15:00			-0.02	0.00	0.15	0.17	0.10	0.55						
23/07/2024 16:30:00			-0.02	0.00	0.15	0.17	0.10	0.55						
23/07/2024 16:45:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.10					
23/07/2024 17:00:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.17					
23/07/2024 17:15:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.19					
23/07/2024 17:30:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.19					
23/07/2024 17:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.19					
23/07/2024 18:00:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.19					
23/07/2024 18:15:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.19					
23/07/2024 18:30:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.19					
23/07/2024 18:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.19					
23/07/2024 19:00:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.20					
23/07/2024 19:15:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.20					
23/07/2024 19:30:00			-0.02	0.00	0.15	0.17	0.09	0.55						
23/07/2024 19:45:00			-0.02	0.00	0.15	0.17	0.09	0.55						
23/07/2024 20:00:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.05					
23/07/2024 20:15:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.00					
23/07/2024 20:30:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.00					
23/07/2024 20:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
23/07/2024 21:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
23/07/2024 21:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
23/07/2024 21:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 21:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 22:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 22:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 22:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 22:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
23/07/2024 23:00:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
23/07/2024 23:15:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
23/07/2024 23:30:00			-0.02	0.00	0.15	0.18	0.10	0.55	0.00					
23/07/2024 23:45:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
24/07/2024 00:00:00			-0.02	0.00	0.15	0.18	0.10	0.54	0.00					
24/07/2024 00:15:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
24/07/2024 00:30:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
24/07/2024 00:45:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.10					
24/07/2024 01:00:00			-0.02	0.00	0.15	0.17	0.10	0.53						
24/07/2024 01:15:00			-0.02	0.00	0.15	0.17	0.10	0.53						
24/07/2024 01:30:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.10					
24/07/2024 01:45:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
24/07/2024 02:00:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
24/07/2024 02:15:00			-0.02	0.00	0.15	0.17	0.10	0.53	0.00					
24/07/2024 02:30:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.13					
24/07/2024 02:45:00			-0.02	0.00	0.15	0.17	0.09	0.52	0.20					
24/07/2024 03:00:00			-0.02	0.00	0.15	0.17	0.09	0.52	0.19					
24/07/2024 03:15:00			-0.02	0.00	0.15	0.17	0.09	0.52	0.19					
24/07/2024 03:30:00			-0.02	0.00	0.15	0.17	0.09	0.52	0.20					
24/07/2024 03:45:00			-0.02	0.00	0.14	0.17	0.09	0.53	0.20					
24/07/2024 04:00:00			-0.02	0.00	0.14	0.17	0.09	0.53						
24/07/2024 04:15:00			-0.02	0.00	0.14	0.17	0.09	0.53	0.20					
24/07/2024 04:30:00			-0.02	0.00	0.14	0.17	0.09	0.53						
24/07/2024 04:45:00			-0.02	0.00	0.14	0.17	0.09	0.53						
24/07/2024 05:00:00			-0.02	0.00	0.14	0.17	0.09	0.53	0.20					
24/07/2024 05:15:00			-0.02	0.00	0.14	0.17	0.09	0.53	0.20					
24/07/2024 05:30:00			-0.02	0.00	0.14	0.17	0.09	0.52	0.19					
24/07/2024 05:45:00			-0.02	0.00	0.14	0.17	0.09	0.52	0.20					
24/07/2024 06:00:00			-0.02	0.00	0.14	0.17	0.09	0.52	0.20					
24/07/2024 06:15:00			-0.02	0.00	0.14	0.17	0.09	0.52	0.20					
24/07/2024 06:30:00			-0.02	0.00	0.14	0.16	0.09	0.52	0.20					
24/07/2024 06:45:00			-0.02	0.00	0.14	0.17	0.09	0.52	0.19					
24/07/2024 07:00:00			-0.03	0.00	0.14	0.16	0.09	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
24/07/2024 07:15:00			-0.03	0.00	0.14	0.16	0.09	0.53						
24/07/2024 07:30:00			-0.03	0.00	0.14	0.16	0.09	0.53	0.10					
24/07/2024 07:45:00			-0.03	0.00	0.14	0.16	0.09	0.53	0.00					
24/07/2024 08:00:00			-0.03	0.00	0.14	0.16	0.09	0.53	0.00					
24/07/2024 08:15:00			-0.03	0.00	0.14	0.16	0.09	0.53	0.00					
24/07/2024 08:30:00			-0.02	0.00	0.14	0.16	0.09	0.54	0.00					
24/07/2024 08:45:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
24/07/2024 09:00:00			-0.03	0.00	0.14	0.17	0.09	0.54	0.00					
24/07/2024 09:15:00			-0.03	0.00	0.14	0.17	0.09	0.54	0.00					
24/07/2024 09:30:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
24/07/2024 09:45:00			-0.03	0.00	0.14	0.17	0.09	0.55	0.00					
24/07/2024 10:00:00			-0.03	0.00	0.14	0.17	0.09	0.55	0.00					
24/07/2024 10:15:00			-0.03	0.00	0.14	0.17	0.09	0.55	0.00					
24/07/2024 10:30:00			-0.03	0.00	0.14	0.17	0.09	0.55	0.00					
24/07/2024 10:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
24/07/2024 11:00:00			-0.03	0.00	0.15	0.17	0.09	0.55	0.00					
24/07/2024 11:15:00			-0.03	0.00	0.15	0.17	0.09	0.55	0.00					
24/07/2024 11:30:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
24/07/2024 11:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.10					
24/07/2024 12:00:00			-0.02	0.00	0.15	0.17	0.09	0.55						
24/07/2024 12:15:00			-0.03	0.00	0.15	0.17	0.09	0.56						
24/07/2024 12:30:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.10					
24/07/2024 12:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.10					
24/07/2024 13:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.20					
24/07/2024 13:15:00			-0.02	0.00	0.15	0.17	0.10	0.56						
24/07/2024 13:30:00			-0.02	0.00	0.15	0.17	0.10	0.56						
24/07/2024 13:45:00			-0.03	0.00	0.15	0.17	0.10	0.55	0.10					
24/07/2024 14:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 14:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 14:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 14:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 15:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 15:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 15:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 15:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 16:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 16:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 16:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 16:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 17:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 17:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 17:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 17:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 18:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
24/07/2024 18:15:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
24/07/2024 18:30:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
24/07/2024 18:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
24/07/2024 19:00:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.00					
24/07/2024 19:15:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.00					
24/07/2024 19:30:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.00					
24/07/2024 19:45:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.00					
24/07/2024 20:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
24/07/2024 20:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
24/07/2024 20:30:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
24/07/2024 20:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
24/07/2024 21:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
24/07/2024 21:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
24/07/2024 21:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
24/07/2024 21:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
24/07/2024 22:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
24/07/2024 22:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
24/07/2024 22:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
24/07/2024 22:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
24/07/2024 23:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
24/07/2024 23:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
24/07/2024 23:30:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
24/07/2024 23:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
25/07/2024 00:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
25/07/2024 00:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
25/07/2024 00:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.10					
25/07/2024 00:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.20					
25/07/2024 01:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.19					
25/07/2024 01:15:00			-0.02	0.00	0.15	0.17	0.10	0.55						
25/07/2024 01:30:00			-0.02	0.00	0.15	0.17	0.10	0.54						
25/07/2024 01:45:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.10					
25/07/2024 02:00:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
25/07/2024 02:15:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
25/07/2024 02:30:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
25/07/2024 02:45:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
25/07/2024 03:00:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
25/07/2024 03:15:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
25/07/2024 03:30:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
25/07/2024 03:45:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
25/07/2024 04:00:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
25/07/2024 04:15:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
25/07/2024 04:30:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
25/07/2024 04:45:00			-0.02	0.00	0.15	0.17	0.09	0.53	0.00					
25/07/2024 05:00:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 05:15:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 05:30:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 05:45:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 06:00:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 06:15:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 06:30:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 06:45:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 07:00:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 07:15:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 07:30:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
25/07/2024 07:45:00			-0.02	0.00	0.14	0.17	0.09	0.55	0.10					
25/07/2024 08:00:00			-0.02	0.00	0.14	0.17	0.09	0.55	0.19					
25/07/2024 08:15:00			-0.02	0.00	0.14	0.17	0.09	0.55						
25/07/2024 08:30:00			-0.03	0.00	0.14	0.17	0.09	0.55						
25/07/2024 08:45:00			-0.03	0.00	0.14	0.17	0.09	0.55	0.10					
25/07/2024 09:00:00			-0.02	0.00	0.14	0.17	0.09	0.56	0.00					
25/07/2024 09:15:00			-0.02	0.00	0.14	0.17	0.09	0.56	0.00					
25/07/2024 09:30:00			-0.02	0.00	0.14	0.17	0.09	0.56	0.00					
25/07/2024 09:45:00			-0.02	0.00	0.14	0.17	0.09	0.57	0.00					
25/07/2024 10:00:00			-0.02	0.00	0.14	0.17	0.09	0.57	0.00					
25/07/2024 10:15:00			-0.02	0.00	0.15	0.17	0.09	0.57	0.00					
25/07/2024 10:30:00			-0.02	0.00	0.15	0.17	0.09	0.57	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
25/07/2024 10:45:00			-0.02	0.00	0.15	0.17	0.09	0.57	0.00					
25/07/2024 11:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 11:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 11:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 11:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 12:00:00			-0.02	0.00	0.15	0.18	0.10	0.57	0.00					
25/07/2024 12:15:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 12:30:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 12:45:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 13:00:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 13:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
25/07/2024 13:30:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 13:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
25/07/2024 14:00:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 14:15:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 14:30:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 14:45:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 15:00:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 15:15:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 15:30:00			-0.02	0.00	0.15	0.18	0.10	0.56	0.00					
25/07/2024 15:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
25/07/2024 16:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
25/07/2024 16:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
25/07/2024 16:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 16:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 17:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 17:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 17:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 17:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 18:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 18:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 18:30:00			-0.02	0.00	0.15	0.17	0.10	0.57						
25/07/2024 18:45:00			-0.02	0.00	0.15	0.17	0.10	0.57						
25/07/2024 19:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 19:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 19:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
25/07/2024 19:45:00			-0.02	0.00	0.15	0.18	0.10	0.57	0.00					
25/07/2024 20:00:00			-0.02	0.00	0.15	0.18	0.10	0.57	0.17					
25/07/2024 20:15:00			-0.02	0.00	0.15	0.18	0.10	0.57	0.20					
25/07/2024 20:30:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.20					
25/07/2024 20:45:00			-0.02	0.00	0.16	0.18	0.10	0.57						
25/07/2024 21:00:00			-0.02	0.00	0.16	0.18	0.10	0.57						
25/07/2024 21:15:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.10					
25/07/2024 21:30:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
25/07/2024 21:45:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.00					
25/07/2024 22:00:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.19					
25/07/2024 22:15:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.20					
25/07/2024 22:30:00			-0.02	0.00	0.16	0.18	0.10	0.57						
25/07/2024 22:45:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.20					
25/07/2024 23:00:00			-0.02	0.00	0.16	0.17	0.10	0.57	0.20					
25/07/2024 23:15:00			-0.02	0.00	0.16	0.17	0.10	0.57	0.20					
25/07/2024 23:30:00			-0.02	0.00	0.16	0.17	0.10	0.57	0.20					
25/07/2024 23:45:00			-0.02	0.00	0.16	0.18	0.10	0.56	0.20					
26/07/2024 00:00:00			-0.02	0.00	0.16	0.18	0.10	0.56						
26/07/2024 00:15:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.20					
26/07/2024 00:30:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.20					
26/07/2024 00:45:00			-0.02	0.00	0.16	0.18	0.10	0.57	0.20					
26/07/2024 01:00:00			-0.02	0.00	0.16	0.17	0.10	0.57	0.19					
26/07/2024 01:15:00			-0.01	0.00	0.16	0.17	0.10	0.56	0.19					
26/07/2024 01:30:00			-0.01	0.00	0.16	0.17	0.10	0.56						
26/07/2024 01:45:00			-0.01	0.00	0.16	0.17	0.10	0.56						
26/07/2024 02:00:00			-0.01	0.00	0.16	0.17	0.10	0.56	0.03					
26/07/2024 02:15:00			-0.01	0.00	0.16	0.17	0.10	0.56	0.00					
26/07/2024 02:30:00			-0.01	0.00	0.16	0.17	0.10	0.55	0.00					
26/07/2024 02:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
26/07/2024 03:00:00			-0.01	0.00	0.15	0.17	0.10	0.55	0.00					
26/07/2024 03:15:00			-0.01	0.00	0.15	0.17	0.10	0.55	0.00					
26/07/2024 03:30:00			-0.01	0.00	0.15	0.17	0.10	0.55	0.00					
26/07/2024 03:45:00			-0.01	0.00	0.15	0.17	0.10	0.55	0.00					
26/07/2024 04:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.00					
26/07/2024 04:15:00			-0.01	0.00	0.15	0.17	0.10	0.55	0.00					
26/07/2024 04:30:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
26/07/2024 04:45:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
26/07/2024 05:00:00			-0.02	0.00	0.15	0.17	0.10	0.54	0.00					
26/07/2024 05:15:00			-0.01	0.00	0.15	0.17	0.10	0.54	0.00					
26/07/2024 05:30:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
26/07/2024 05:45:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
26/07/2024 06:00:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
26/07/2024 06:15:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
26/07/2024 06:30:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
26/07/2024 06:45:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
26/07/2024 07:00:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
26/07/2024 07:15:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
26/07/2024 07:30:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.00					
26/07/2024 07:45:00			-0.02	0.00	0.14	0.17	0.09	0.55	0.00					
26/07/2024 08:00:00			-0.02	0.00	0.14	0.17	0.09	0.55	0.12					
26/07/2024 08:15:00			-0.02	0.00	0.14	0.17	0.09	0.55						
26/07/2024 08:30:00			-0.02	0.00	0.14	0.17	0.09	0.56						
26/07/2024 08:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.10					
26/07/2024 09:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
26/07/2024 09:15:00			-0.02	0.00	0.14	0.17	0.09	0.56	0.00					
26/07/2024 09:30:00			-0.02	0.00	0.14	0.17	0.09	0.56	0.00					
26/07/2024 09:45:00			-0.02	0.00	0.14	0.17	0.09	0.56	0.00					
26/07/2024 10:00:00			-0.02	0.00	0.15	0.17	0.09	0.57	0.00					
26/07/2024 10:15:00			-0.02	0.00	0.15	0.17	0.09	0.57	0.00					
26/07/2024 10:30:00			-0.02	0.00	0.15	0.17	0.09	0.57	0.00					
26/07/2024 10:45:00			-0.02	0.00	0.15	0.17	0.09	0.57	0.00					
26/07/2024 11:00:00			-0.02	0.00	0.15	0.17	0.10	0.58	0.00					
26/07/2024 11:15:00			-0.02	0.00	0.15	0.17	0.10	0.58	0.00					
26/07/2024 11:30:00			-0.02	0.00	0.15	0.17	0.10	0.58	0.00					
26/07/2024 11:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 12:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 12:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 12:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 12:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 13:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 13:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 13:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 13:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 14:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
26/07/2024 14:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 14:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 14:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.00					
26/07/2024 15:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
26/07/2024 15:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.00					
26/07/2024 15:30:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.10					
26/07/2024 15:45:00			-0.02	0.00	0.15	0.17	0.10	0.57						
26/07/2024 16:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.25					
26/07/2024 16:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.25					
26/07/2024 16:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.25					
26/07/2024 16:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.25					
26/07/2024 17:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 17:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 17:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 17:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 18:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 18:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 18:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 18:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 19:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 19:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 19:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 19:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 20:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 20:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 20:30:00			-0.01	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 20:45:00			-0.01	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 21:00:00			-0.01	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 21:15:00			-0.01	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 21:30:00			-0.01	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 21:45:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 22:00:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.24					
26/07/2024 22:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.24					
26/07/2024 22:30:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.24					
26/07/2024 22:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.24					
26/07/2024 23:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.24					
26/07/2024 23:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.23					
26/07/2024 23:30:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.23					
26/07/2024 23:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.23					
27/07/2024 00:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.22					
27/07/2024 00:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.22					
27/07/2024 00:30:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.22					
27/07/2024 00:45:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.22					
27/07/2024 01:00:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.22					
27/07/2024 01:15:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.22					
27/07/2024 01:30:00			-0.02	0.00	0.15	0.17	0.10	0.55	0.22					
27/07/2024 01:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.22					
27/07/2024 02:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.22					
27/07/2024 02:15:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.22					
27/07/2024 02:30:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.22					
27/07/2024 02:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.29					
27/07/2024 03:00:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.29					
27/07/2024 03:15:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.29					
27/07/2024 03:30:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.29					
27/07/2024 03:45:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.29					
27/07/2024 04:00:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.28					
27/07/2024 04:15:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.28					
27/07/2024 04:30:00			-0.02	0.00	0.14	0.17	0.09	0.54	0.66					
27/07/2024 04:45:00			-0.01	0.00	0.14	0.17	0.09	0.54						
27/07/2024 05:00:00			-0.02	0.00	0.14	0.16	0.09	0.54	0.28					
27/07/2024 05:15:00			-0.02	0.00	0.14	0.16	0.09	0.54	0.28					
27/07/2024 05:30:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.28					
27/07/2024 05:45:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.28					
27/07/2024 06:00:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.28					
27/07/2024 06:15:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.28					
27/07/2024 06:30:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.28					
27/07/2024 06:45:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.29					
27/07/2024 07:00:00			-0.02	0.00	0.14	0.16	0.09	0.53						
27/07/2024 07:15:00			-0.02	0.00	0.14	0.16	0.09	0.54						
27/07/2024 07:30:00			-0.02	0.00	0.14	0.16	0.09	0.54						
27/07/2024 07:45:00			-0.02	0.00	0.14	0.16	0.09	0.54						
27/07/2024 08:00:00			-0.02	0.00	0.14	0.16	0.09	0.54						
27/07/2024 08:15:00			-0.02	0.00	0.14	0.16	0.09	0.54	0.00					
27/07/2024 08:30:00			-0.02	0.00	0.14	0.16	0.09	0.54	0.24					
27/07/2024 08:45:00			-0.02	0.00	0.14	0.16	0.08	0.55	0.28					
27/07/2024 09:00:00			-0.02	0.00	0.14	0.16	0.08	0.55	0.28					
27/07/2024 09:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.29					
27/07/2024 09:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.29					
27/07/2024 09:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.30					
27/07/2024 10:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.29					
27/07/2024 10:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.28					
27/07/2024 10:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.23					
27/07/2024 10:45:00			-0.02	0.00	0.14	0.16	0.09	0.57						
27/07/2024 11:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.30					
27/07/2024 11:15:00			-0.01	0.00	0.14	0.16	0.09	0.57						
27/07/2024 11:30:00			-0.01	0.00	0.14	0.16	0.09	0.57	0.31					
27/07/2024 11:45:00			-0.01	0.00	0.14	0.16	0.09	0.57	0.30					
27/07/2024 12:00:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.30					
27/07/2024 12:15:00			-0.02	0.00	0.15	0.17	0.09	0.57	0.25					
27/07/2024 12:30:00			-0.02	0.00	0.15	0.17	0.09	0.57						
27/07/2024 12:45:00			-0.02	0.00	0.15	0.17	0.09	0.57	0.26					
27/07/2024 13:00:00			-0.02	0.00	0.15	0.17	0.09	0.58	0.30					
27/07/2024 13:15:00			-0.02	0.00	0.15	0.17	0.09	0.57	0.30					
27/07/2024 13:30:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.29					
27/07/2024 13:45:00			-0.02	0.00	0.15	0.17	0.10	0.57						
27/07/2024 14:00:00			-0.02	0.00	0.15	0.17	0.10	0.57						
27/07/2024 14:15:00			-0.02	0.00	0.15	0.17	0.10	0.57	0.28					
27/07/2024 14:30:00			-0.01	0.00	0.15	0.17	0.10	0.56	0.28					
27/07/2024 14:45:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.28					
27/07/2024 15:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.27					
27/07/2024 15:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.27					
27/07/2024 15:30:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.27					
27/07/2024 15:45:00			-0.01	0.00	0.15	0.17	0.10	0.56	0.27					
27/07/2024 16:00:00			-0.01	0.00	0.15	0.17	0.10	0.56	0.27					
27/07/2024 16:15:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.27					
27/07/2024 16:30:00			-0.02	0.00	0.15	0.17	0.10	0.56						
27/07/2024 16:45:00			-0.01	0.00	0.15	0.17	0.10	0.56						
27/07/2024 17:00:00			-0.02	0.00	0.15	0.17	0.10	0.56	0.04					
27/07/2024 17:15:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 17:30:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
27/07/2024 17:45:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 18:00:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 18:15:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 18:30:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 18:45:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 19:00:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 19:15:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 19:30:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 19:45:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 20:00:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 20:15:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 20:30:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 20:45:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 21:00:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 21:15:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 21:30:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 21:45:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 22:00:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 22:15:00			-0.02	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 22:30:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 22:45:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 23:00:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.00					
27/07/2024 23:15:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.13					
27/07/2024 23:30:00			-0.01	0.00	0.15	0.17	0.09	0.56	0.25					
27/07/2024 23:45:00			-0.01	0.00	0.15	0.17	0.09	0.55						
28/07/2024 00:00:00			-0.02	0.00	0.15	0.17	0.09	0.55						
28/07/2024 00:15:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.13					
28/07/2024 00:30:00			-0.01	0.00	0.15	0.17	0.09	0.55	0.00					
28/07/2024 00:45:00			-0.02	0.00	0.15	0.17	0.09	0.55	0.00					
28/07/2024 01:00:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
28/07/2024 01:15:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
28/07/2024 01:30:00			-0.02	0.00	0.15	0.17	0.09	0.54	0.00					
28/07/2024 01:45:00			-0.01	0.00	0.15	0.16	0.09	0.54	0.00					
28/07/2024 02:00:00			-0.01	0.00	0.15	0.16	0.09	0.54	0.18					
28/07/2024 02:15:00			-0.01	0.00	0.15	0.16	0.09	0.54						
28/07/2024 02:30:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.22					
28/07/2024 02:45:00			-0.02	0.00	0.14	0.16	0.09	0.53						
28/07/2024 03:00:00			-0.01	0.00	0.14	0.16	0.09	0.53						
28/07/2024 03:15:00			-0.01	0.00	0.14	0.16	0.09	0.53	0.22					
28/07/2024 03:30:00			-0.01	0.00	0.14	0.16	0.09	0.53						
28/07/2024 03:45:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.22					
28/07/2024 04:00:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.22					
28/07/2024 04:15:00			-0.02	0.00	0.14	0.16	0.09	0.53						
28/07/2024 04:30:00			-0.02	0.00	0.14	0.16	0.09	0.53						
28/07/2024 04:45:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.11					
28/07/2024 05:00:00			-0.02	0.00	0.14	0.16	0.09	0.52	0.00					
28/07/2024 05:15:00			-0.02	0.00	0.14	0.16	0.08	0.52	0.00					
28/07/2024 05:30:00			-0.02	0.00	0.14	0.16	0.08	0.52	0.00					
28/07/2024 05:45:00			-0.02	0.00	0.14	0.16	0.08	0.52	0.00					
28/07/2024 06:00:00			-0.02	0.00	0.14	0.16	0.08	0.52	0.00					
28/07/2024 06:15:00			-0.02	0.00	0.14	0.16	0.08	0.52	0.00					
28/07/2024 06:30:00			-0.02	0.00	0.14	0.16	0.08	0.52	0.00					
28/07/2024 06:45:00			-0.02	0.00	0.13	0.15	0.08	0.52	0.00					
28/07/2024 07:00:00			-0.02	0.00	0.13	0.15	0.08	0.52	0.00					
28/07/2024 07:15:00			-0.02	0.00	0.13	0.15	0.08	0.52	0.00					
28/07/2024 07:30:00			-0.03	0.00	0.13	0.15	0.08	0.52	0.00					
28/07/2024 07:45:00			-0.03	0.00	0.13	0.15	0.08	0.52	0.00					
28/07/2024 08:00:00			-0.03	0.00	0.13	0.15	0.08	0.53	0.19					
28/07/2024 08:15:00			-0.03	0.00	0.13	0.15	0.08	0.53	0.22					
28/07/2024 08:30:00			-0.03	0.00	0.13	0.15	0.08	0.53	0.23					
28/07/2024 08:45:00			-0.02	0.00	0.13	0.15	0.08	0.53	0.24					
28/07/2024 09:00:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.24					
28/07/2024 09:15:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.24					
28/07/2024 09:30:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.25					
28/07/2024 09:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.25					
28/07/2024 10:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.26					
28/07/2024 10:15:00			-0.02	0.00	0.13	0.15	0.08	0.55						
28/07/2024 10:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.28					
28/07/2024 10:45:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.29					
28/07/2024 11:00:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.25					
28/07/2024 11:15:00			-0.02	0.00	0.14	0.16	0.08	0.56	0.26					
28/07/2024 11:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.28					
28/07/2024 11:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.28					
28/07/2024 12:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.26					
28/07/2024 12:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.26					
28/07/2024 12:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.26					
28/07/2024 12:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.25					
28/07/2024 13:00:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.25					
28/07/2024 13:15:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.25					
28/07/2024 13:30:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.25					
28/07/2024 13:45:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.24					
28/07/2024 14:00:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.24					
28/07/2024 14:15:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.24					
28/07/2024 14:30:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.24					
28/07/2024 14:45:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.24					
28/07/2024 15:00:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.24					
28/07/2024 15:15:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.24					
28/07/2024 15:30:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.24					
28/07/2024 15:45:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.24					
28/07/2024 16:00:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.23					
28/07/2024 16:15:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.23					
28/07/2024 16:30:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.23					
28/07/2024 16:45:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.23					
28/07/2024 17:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.23					
28/07/2024 17:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.23					
28/07/2024 17:30:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.23					
28/07/2024 17:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.23					
28/07/2024 18:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.23					
28/07/2024 18:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.23					
28/07/2024 18:30:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.23					
28/07/2024 18:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.23					
28/07/2024 19:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.24					
28/07/2024 19:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.24					
28/07/2024 19:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.24					
28/07/2024 19:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.25					
28/07/2024 20:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.27					
28/07/2024 20:15:00			-0.02	0.00	0.14	0.16	0.09	0.56						
28/07/2024 20:30:00			-0.02	0.00	0.14	0.16	0.09	0.57						
28/07/2024 20:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.13					
28/07/2024 21:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
28/07/2024 21:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.12					
28/07/2024 21:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.23					
28/07/2024 21:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.23					
28/07/2024 22:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.22					
28/07/2024 22:15:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.22					
28/07/2024 22:30:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.22					
28/07/2024 22:45:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.22					
28/07/2024 23:00:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.22					
28/07/2024 23:15:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.22					
28/07/2024 23:30:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.22					
28/07/2024 23:45:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.22					
29/07/2024 00:00:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.22					
29/07/2024 00:15:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.22					
29/07/2024 00:30:00			-0.02	0.00	0.15	0.16	0.09	0.55	0.21					
29/07/2024 00:45:00			-0.02	0.00	0.15	0.16	0.09	0.54	0.21					
29/07/2024 01:00:00			-0.02	0.00	0.15	0.16	0.09	0.54	0.20					
29/07/2024 01:15:00			-0.02	0.00	0.15	0.16	0.09	0.54	0.20					
29/07/2024 01:30:00			-0.02	0.00	0.14	0.16	0.09	0.54	0.20					
29/07/2024 01:45:00			-0.02	0.00	0.14	0.16	0.09	0.54	0.20					
29/07/2024 02:00:00			-0.02	0.00	0.14	0.16	0.09	0.54	0.20					
29/07/2024 02:15:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.20					
29/07/2024 02:30:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.20					
29/07/2024 02:45:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.19					
29/07/2024 03:00:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.19					
29/07/2024 03:15:00			-0.02	0.00	0.14	0.16	0.09	0.53						
29/07/2024 03:30:00			-0.02	0.00	0.14	0.16	0.09	0.53						
29/07/2024 03:45:00			-0.02	0.00	0.14	0.16	0.09	0.53	0.10					
29/07/2024 04:00:00			-0.02	0.00	0.14	0.16	0.08	0.53	0.00					
29/07/2024 04:15:00			-0.02	0.00	0.14	0.16	0.08	0.53	0.00					
29/07/2024 04:30:00			-0.02	0.00	0.14	0.16	0.08	0.53	0.00					
29/07/2024 04:45:00			-0.02	0.00	0.14	0.16	0.08	0.53	0.00					
29/07/2024 05:00:00			-0.02	0.00	0.14	0.15	0.08	0.53	0.00					
29/07/2024 05:15:00			-0.02	0.00	0.13	0.15	0.08	0.53	0.00					
29/07/2024 05:30:00			-0.02	0.00	0.13	0.15	0.08	0.53	0.00					
29/07/2024 05:45:00			-0.02	0.00	0.13	0.15	0.08	0.52	0.00					
29/07/2024 06:00:00			-0.02	0.00	0.13	0.15	0.08	0.52	0.00					
29/07/2024 06:15:00			-0.02	0.00	0.13	0.15	0.08	0.52	0.00					
29/07/2024 06:30:00			-0.03	0.00	0.13	0.15	0.08	0.53	0.00					
29/07/2024 06:45:00			-0.03	0.00	0.13	0.15	0.08	0.53	0.00					
29/07/2024 07:00:00			-0.03	0.00	0.13	0.15	0.08	0.53	0.17					
29/07/2024 07:15:00			-0.03	0.00	0.13	0.15	0.08	0.53	0.19					
29/07/2024 07:30:00			-0.03	0.00	0.13	0.15	0.08	0.53	0.20					
29/07/2024 07:45:00			-0.03	0.00	0.13	0.15	0.08	0.53	0.20					
29/07/2024 08:00:00			-0.03	0.00	0.13	0.15	0.08	0.54	0.23					
29/07/2024 08:15:00			-0.03	0.00	0.13	0.15	0.08	0.55	0.23					
29/07/2024 08:30:00			-0.03	0.00	0.13	0.15	0.08	0.55	0.23					
29/07/2024 08:45:00			-0.03	0.00	0.13	0.15	0.08	0.55	0.24					
29/07/2024 09:00:00			-0.03	0.00	0.13	0.15	0.08	0.56	0.24					
29/07/2024 09:15:00			-0.03	0.00	0.13	0.15	0.08	0.56	0.24					
29/07/2024 09:30:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.24					
29/07/2024 09:45:00			-0.03	0.00	0.14	0.15	0.08	0.56	0.24					
29/07/2024 10:00:00			-0.02	0.00	0.14	0.16	0.08	0.56	0.24					
29/07/2024 10:15:00			-0.02	0.00	0.14	0.16	0.08	0.56	0.23					
29/07/2024 10:30:00			-0.03	0.00	0.14	0.16	0.09	0.56	0.23					
29/07/2024 10:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.24					
29/07/2024 11:00:00			-0.03	0.00	0.14	0.16	0.09	0.56	0.23					
29/07/2024 11:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.23					
29/07/2024 11:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.23					
29/07/2024 11:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.23					
29/07/2024 12:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.23					
29/07/2024 12:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.23					
29/07/2024 12:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.22					
29/07/2024 12:45:00			-0.03	0.00	0.14	0.16	0.09	0.56	0.22					
29/07/2024 13:00:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.22					
29/07/2024 13:15:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.22					
29/07/2024 13:30:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.22					
29/07/2024 13:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.22					
29/07/2024 14:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.22					
29/07/2024 14:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.22					
29/07/2024 14:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.21					
29/07/2024 14:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.21					
29/07/2024 15:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.21					
29/07/2024 15:15:00			-0.02	0.00	0.14	0.14	0.09	0.56	0.21					
29/07/2024 15:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.21					
29/07/2024 15:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.21					
29/07/2024 16:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.21					
29/07/2024 16:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.21					
29/07/2024 16:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.21					
29/07/2024 16:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.21					
29/07/2024 17:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.22					
29/07/2024 17:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.22					
29/07/2024 17:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.23					
29/07/2024 17:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.23					
29/07/2024 18:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.23					
29/07/2024 18:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.23					
29/07/2024 18:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.23					
29/07/2024 18:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.24					
29/07/2024 19:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.24					
29/07/2024 19:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.24					
29/07/2024 19:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.24					
29/07/2024 19:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.23					
29/07/2024 20:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.23					
29/07/2024 20:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.23					
29/07/2024 20:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.23					
29/07/2024 20:45:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.23					
29/07/2024 21:00:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.23					
29/07/2024 21:15:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.23					
29/07/2024 21:30:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.23					
29/07/2024 21:45:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.23					
29/07/2024 22:00:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.21					
29/07/2024 22:15:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.22					
29/07/2024 22:30:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.22					
29/07/2024 22:45:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.22					
29/07/2024 23:00:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.20					
29/07/2024 23:15:00			-0.02	0.00	0.15	0.15	0.09	0.57	0.20					
29/07/2024 23:30:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.21					
29/07/2024 23:45:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.21					
30/07/2024 00:00:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.20					
30/07/2024 00:15:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.20					
30/07/2024 00:30:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.20					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
30/07/2024 00:45:00			-0.02	0.00	0.15	0.16	0.09	0.56						
30/07/2024 01:00:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.19					
30/07/2024 01:15:00			-0.02	0.00	0.15	0.16	0.09	0.55						
30/07/2024 01:30:00			-0.02	0.00	0.14	0.16	0.09	0.55						
30/07/2024 01:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.10					
30/07/2024 02:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
30/07/2024 02:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
30/07/2024 02:30:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
30/07/2024 02:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
30/07/2024 03:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
30/07/2024 03:15:00			-0.02	0.00	0.14	0.16	0.09	0.54	0.00					
30/07/2024 03:30:00			-0.02	0.00	0.14	0.16	0.09	0.54	0.00					
30/07/2024 03:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
30/07/2024 04:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
30/07/2024 04:15:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.00					
30/07/2024 04:30:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
30/07/2024 04:45:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
30/07/2024 05:00:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
30/07/2024 05:15:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
30/07/2024 05:30:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.00					
30/07/2024 05:45:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.00					
30/07/2024 06:00:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.00					
30/07/2024 06:15:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.00					
30/07/2024 06:30:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.00					
30/07/2024 06:45:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.00					
30/07/2024 07:00:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.00					
30/07/2024 07:15:00			-0.03	0.00	0.14	0.15	0.08	0.55	0.00					
30/07/2024 07:30:00			-0.03	0.00	0.14	0.15	0.08	0.55	0.00					
30/07/2024 07:45:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.10					
30/07/2024 08:00:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.20					
30/07/2024 08:15:00			-0.03	0.00	0.14	0.15	0.08	0.55	0.20					
30/07/2024 08:30:00			-0.03	0.00	0.14	0.15	0.08	0.56	0.21					
30/07/2024 08:45:00			-0.03	0.00	0.14	0.15	0.08	0.56	0.25					
30/07/2024 09:00:00			-0.02	0.00	0.14	0.15	0.08	0.56						
30/07/2024 09:15:00			-0.02	0.00	0.14	0.15	0.08	0.56						
30/07/2024 09:30:00			-0.02	0.00	0.14	0.15	0.08	0.56						
30/07/2024 09:45:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.15					
30/07/2024 10:00:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.00					
30/07/2024 10:15:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.00					
30/07/2024 10:30:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.00					
30/07/2024 10:45:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
30/07/2024 11:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 11:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 11:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 11:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 12:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 12:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 12:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 12:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 13:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 13:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
30/07/2024 13:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
30/07/2024 13:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
30/07/2024 14:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
30/07/2024 14:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
30/07/2024 14:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 14:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 15:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 15:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 15:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 15:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 16:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 16:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
30/07/2024 16:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
30/07/2024 16:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
30/07/2024 17:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 17:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 17:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 17:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 18:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 18:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 18:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 18:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 19:00:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
30/07/2024 19:15:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
30/07/2024 19:30:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
30/07/2024 19:45:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
30/07/2024 20:00:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
30/07/2024 20:15:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
30/07/2024 20:30:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
30/07/2024 20:45:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
30/07/2024 21:00:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
30/07/2024 21:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 21:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 21:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
30/07/2024 22:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.17					
30/07/2024 22:15:00			-0.02	0.00	0.14	0.16	0.09	0.58						
30/07/2024 22:30:00			-0.02	0.00	0.14	0.16	0.09	0.58						
30/07/2024 22:45:00			-0.02	0.00	0.14	0.16	0.09	0.58						
30/07/2024 23:00:00			-0.02	0.00	0.14	0.16	0.09	0.58						
30/07/2024 23:15:00			-0.02	0.00	0.14	0.16	0.09	0.58						
30/07/2024 23:30:00			-0.02	0.00	0.14	0.16	0.09	0.57						
30/07/2024 23:45:00			-0.02	0.00	0.14	0.16	0.09	0.57						
31/07/2024 00:00:00			-0.02	0.00	0.14	0.16	0.09	0.57						
31/07/2024 00:15:00			-0.02	0.00	0.14	0.16	0.09	0.57						
31/07/2024 00:30:00			-0.02	0.00	0.14	0.16	0.09	0.56						
31/07/2024 00:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.32					
31/07/2024 01:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.32					
31/07/2024 01:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.32					
31/07/2024 01:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.32					
31/07/2024 01:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.32					
31/07/2024 02:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.31					
31/07/2024 02:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.31					
31/07/2024 02:30:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.31					
31/07/2024 02:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.31					
31/07/2024 03:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.31					
31/07/2024 03:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.31					
31/07/2024 03:30:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.31					
31/07/2024 03:45:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.31					
31/07/2024 04:00:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.31					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
31/07/2024 04:15:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.31					
31/07/2024 04:30:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.31					
31/07/2024 04:45:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.31					
31/07/2024 05:00:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.31					
31/07/2024 05:15:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.31					
31/07/2024 05:30:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.31					
31/07/2024 05:45:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.31					
31/07/2024 06:00:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.31					
31/07/2024 06:15:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.31					
31/07/2024 06:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.31					
31/07/2024 06:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.31					
31/07/2024 07:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.32					
31/07/2024 07:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.32					
31/07/2024 07:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.32					
31/07/2024 07:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.32					
31/07/2024 08:00:00			-0.02	0.00	0.13	0.15	0.08	0.55						
31/07/2024 08:15:00			-0.02	0.00	0.13	0.15	0.08	0.56						
31/07/2024 08:30:00			-0.02	0.00	0.13	0.15	0.08	0.56						
31/07/2024 08:45:00			-0.02	0.00	0.13	0.15	0.08	0.56						
31/07/2024 09:00:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.19					
31/07/2024 09:15:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.06					
31/07/2024 09:30:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.08					
31/07/2024 09:45:00			-0.02	0.00	0.13	0.15	0.08	0.57						
31/07/2024 10:00:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.08					
31/07/2024 10:15:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.09					
31/07/2024 10:30:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.09					
31/07/2024 10:45:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.08					
31/07/2024 11:00:00			-0.02	0.00	0.13	0.15	0.08	0.57						
31/07/2024 11:15:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.10					
31/07/2024 11:30:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.09					
31/07/2024 11:45:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.08					
31/07/2024 12:00:00			-0.02	0.00	0.14	0.15	0.09	0.57						
31/07/2024 12:15:00			-0.02	0.00	0.14	0.16	0.09	0.57						
31/07/2024 12:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.02					
31/07/2024 12:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 13:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 13:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 13:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 13:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 14:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 14:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 14:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 14:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 15:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 15:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
31/07/2024 15:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
31/07/2024 15:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
31/07/2024 16:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
31/07/2024 16:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
31/07/2024 16:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
31/07/2024 16:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
31/07/2024 17:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
31/07/2024 17:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
31/07/2024 17:30:00			-0.02	0.00	0.14	0.16	0.08	0.56	0.00					
31/07/2024 17:45:00			-0.02	0.00	0.14	0.16	0.08	0.56	0.00					
31/07/2024 18:00:00			-0.02	0.00	0.14	0.16	0.08	0.56	0.00					
31/07/2024 18:15:00			-0.02	0.00	0.14	0.16	0.08	0.56	0.00					
31/07/2024 18:30:00			-0.02	0.00	0.14	0.16	0.08	0.57	0.63					
31/07/2024 18:45:00			-0.02	0.00	0.14	0.15	0.08	0.57						
31/07/2024 19:00:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.10					
31/07/2024 19:15:00			-0.02	0.00	0.14	0.15	0.08	0.57						
31/07/2024 19:30:00			-0.02	0.00	0.14	0.15	0.08	0.58						
31/07/2024 19:45:00			-0.02	0.00	0.14	0.15	0.08	0.58						
31/07/2024 20:00:00			-0.02	0.00	0.14	0.15	0.08	0.58						
31/07/2024 20:15:00			-0.02	0.00	0.14	0.15	0.08	0.58						
31/07/2024 20:30:00			-0.02	0.00	0.14	0.15	0.08	0.58						
31/07/2024 20:45:00			-0.02	0.00	0.14	0.15	0.09	0.58						
31/07/2024 21:00:00			-0.02	0.00	0.14	0.15	0.09	0.57						
31/07/2024 21:15:00			-0.02	0.00	0.14	0.15	0.09	0.57						
31/07/2024 21:30:00			-0.02	0.00	0.14	0.15	0.09	0.57						
31/07/2024 21:45:00			-0.02	0.00	0.14	0.16	0.09	0.57						
31/07/2024 22:00:00			-0.02	0.00	0.14	0.16	0.09	0.57						
31/07/2024 22:15:00			-0.02	0.00	0.14	0.16	0.09	0.57						
31/07/2024 22:30:00			-0.02	0.00	0.14	0.16	0.09	0.57						
31/07/2024 22:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 23:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 23:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 23:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
31/07/2024 23:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 00:00:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 00:15:00			-0.02	0.00	0.14	0.16	0.09	0.56						
01/08/2024 00:30:00			-0.02	0.00	0.14	0.16	0.09	0.56						
01/08/2024 00:45:00			-0.02	0.00	0.14	0.16	0.09	0.56						
01/08/2024 01:00:00			-0.02	0.00	0.14	0.16	0.09	0.56						
01/08/2024 01:15:00			-0.02	0.00	0.14	0.16	0.09	0.56						
01/08/2024 01:30:00			-0.02	0.00	0.14	0.16	0.09	0.55						
01/08/2024 01:45:00			-0.02	0.00	0.14	0.16	0.09	0.55						
01/08/2024 02:00:00			-0.02	0.00	0.14	0.16	0.09	0.55						
01/08/2024 02:15:00			-0.02	0.00	0.14	0.16	0.09	0.55						
01/08/2024 02:30:00			-0.02	0.00	0.14	0.16	0.09	0.55						
01/08/2024 02:45:00			-0.02	0.00	0.14	0.16	0.09	0.55						
01/08/2024 03:00:00			-0.02	0.00	0.14	0.16	0.09	0.55						
01/08/2024 03:15:00			-0.02	0.00	0.14	0.16	0.08	0.55						
01/08/2024 03:30:00			-0.02	0.00	0.14	0.15	0.08	0.55						
01/08/2024 03:45:00			-0.02	0.00	0.14	0.15	0.08	0.55						
01/08/2024 04:00:00			-0.02	0.00	0.14	0.15	0.08	0.55						
01/08/2024 04:15:00			-0.02	0.00	0.13	0.15	0.08	0.55						
01/08/2024 04:30:00			-0.02	0.00	0.13	0.15	0.08	0.54						
01/08/2024 04:45:00			-0.02	0.00	0.13	0.15	0.08	0.55						
01/08/2024 05:00:00			-0.02	0.00	0.13	0.15	0.08	0.54						
01/08/2024 05:15:00			-0.02	0.00	0.13	0.15	0.08	0.54						
01/08/2024 05:30:00			-0.02	0.00	0.13	0.15	0.08	0.54						
01/08/2024 05:45:00			-0.02	0.00	0.13	0.15	0.08	0.54						
01/08/2024 06:00:00			-0.02	0.00	0.13	0.15	0.08	0.54						
01/08/2024 06:15:00			-0.02	0.00	0.13	0.15	0.08	0.55						
01/08/2024 06:30:00			-0.02	0.00	0.13	0.15	0.08	0.55						
01/08/2024 06:45:00			-0.02	0.00	0.13	0.15	0.08	0.55						
01/08/2024 07:00:00			-0.02	0.00	0.13	0.15	0.08	0.55						
01/08/2024 07:15:00			-0.02	0.00	0.13	0.15	0.08	0.56						
01/08/2024 07:30:00			-0.02	0.00	0.13	0.15	0.08	0.56						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
01/08/2024 07:45:00			-0.02	0.00	0.13	0.15	0.08	0.56						
01/08/2024 08:00:00			-0.02	0.00	0.13	0.15	0.08	0.56						
01/08/2024 08:15:00			-0.02	0.00	0.13	0.15	0.08	0.56						
01/08/2024 08:30:00			-0.02	0.00	0.13	0.15	0.08	0.56						
01/08/2024 08:45:00			-0.03	0.00	0.13	0.15	0.08	0.56						
01/08/2024 09:00:00			-0.02	0.00	0.13	0.15	0.08	0.56						
01/08/2024 09:15:00			-0.02	0.00	0.13	0.15	0.08	0.57						
01/08/2024 09:30:00			-0.02	0.00	0.13	0.15	0.08	0.57						
01/08/2024 09:45:00			-0.02	0.00	0.13	0.15	0.08	0.57						
01/08/2024 10:00:00			-0.02	0.00	0.13	0.15	0.08	0.57						
01/08/2024 10:15:00			-0.02	0.00	0.13	0.15	0.08	0.57						
01/08/2024 10:30:00			-0.02	0.00	0.14	0.15	0.08	0.57						
01/08/2024 10:45:00			-0.02	0.00	0.14	0.15	0.08	0.57						
01/08/2024 11:00:00			-0.02	0.00	0.14	0.15	0.08	0.57						
01/08/2024 11:15:00			-0.02	0.00	0.14	0.16	0.08	0.56	0.00					
01/08/2024 11:30:00			-0.02	0.00	0.14	0.16	0.08	0.57	0.65					
01/08/2024 11:45:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 12:00:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 12:15:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 12:30:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 12:45:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 13:00:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 13:15:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 13:30:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 13:45:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 14:00:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 14:15:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 14:30:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 14:45:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 15:00:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 15:15:00			-0.02	0.00	0.14	0.16	0.08	0.57						
01/08/2024 15:30:00			-0.02	0.00	0.14	0.16	0.08	0.57						
01/08/2024 15:45:00			-0.02	0.00	0.14	0.16	0.08	0.57						
01/08/2024 16:00:00			-0.02	0.00	0.14	0.16	0.08	0.57						
01/08/2024 16:15:00			-0.02	0.00	0.14	0.16	0.08	0.57						
01/08/2024 16:30:00			-0.02	0.00	0.14	0.16	0.08	0.58						
01/08/2024 16:45:00			-0.02	0.00	0.14	0.16	0.08	0.58						
01/08/2024 17:00:00			-0.02	0.00	0.14	0.16	0.08	0.58						
01/08/2024 17:15:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.35					
01/08/2024 17:30:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.10					
01/08/2024 17:45:00			-0.02	0.00	0.14	0.16	0.08	0.57	0.20					
01/08/2024 18:00:00			-0.02	0.00	0.14	0.16	0.08	0.57	0.20					
01/08/2024 18:15:00			-0.02	0.00	0.14	0.16	0.08	0.57						
01/08/2024 18:30:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 18:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.10					
01/08/2024 19:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
01/08/2024 19:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
01/08/2024 19:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.10					
01/08/2024 19:45:00			-0.02	0.00	0.14	0.16	0.09	0.57						
01/08/2024 20:00:00			-0.02	0.00	0.14	0.16	0.09	0.58						
01/08/2024 20:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.10					
01/08/2024 20:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
01/08/2024 20:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 21:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
01/08/2024 21:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 21:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 21:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 22:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 22:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 22:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 22:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 23:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 23:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 23:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
01/08/2024 23:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
02/08/2024 00:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
02/08/2024 00:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
02/08/2024 00:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
02/08/2024 00:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
02/08/2024 01:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
02/08/2024 01:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
02/08/2024 01:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
02/08/2024 01:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
02/08/2024 02:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
02/08/2024 02:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
02/08/2024 02:30:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
02/08/2024 02:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
02/08/2024 03:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
02/08/2024 03:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
02/08/2024 03:30:00			-0.02	0.00	0.14	0.16	0.08	0.55	0.00					
02/08/2024 03:45:00			-0.02	0.00	0.14	0.16	0.08	0.55	0.00					
02/08/2024 04:00:00			-0.02	0.00	0.14	0.16	0.08	0.55	0.00					
02/08/2024 04:15:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
02/08/2024 04:30:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
02/08/2024 04:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 05:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 05:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 05:30:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.00					
02/08/2024 05:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 06:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 06:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 06:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 06:45:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
02/08/2024 07:00:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
02/08/2024 07:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 07:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 07:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 08:00:00			-0.03	0.00	0.13	0.15	0.08	0.55	0.00					
02/08/2024 08:15:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
02/08/2024 08:30:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.11					
02/08/2024 08:45:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.21					
02/08/2024 09:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.23					
02/08/2024 09:15:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.23					
02/08/2024 09:30:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.23					
02/08/2024 09:45:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.22					
02/08/2024 10:00:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.21					
02/08/2024 10:15:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.21					
02/08/2024 10:30:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.21					
02/08/2024 10:45:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.21					
02/08/2024 11:00:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.21					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
02/08/2024 11:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.21					
02/08/2024 11:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.22					
02/08/2024 11:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.22					
02/08/2024 12:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.21					
02/08/2024 12:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.21					
02/08/2024 12:30:00			-0.02	0.00	0.14	0.16	0.09	0.58						
02/08/2024 12:45:00			-0.02	0.00	0.14	0.16	0.09	0.58						
02/08/2024 13:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
02/08/2024 13:15:00			-0.02	0.00	0.14	0.16	0.09	0.58						
02/08/2024 13:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
02/08/2024 13:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
02/08/2024 14:00:00			-0.02	0.00	0.14	0.16	0.09	0.58						
02/08/2024 14:15:00			-0.02	0.00	0.14	0.16	0.09	0.54						
02/08/2024 14:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.20					
02/08/2024 14:45:00			-0.02	0.00	0.14	0.16	0.09	0.56						
02/08/2024 15:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.21					
02/08/2024 15:15:00			-0.02	0.00	0.14	0.16	0.09	0.57						
02/08/2024 15:30:00			-0.02	0.00	0.14	0.16	0.09	0.57						
02/08/2024 15:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.10					
02/08/2024 16:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
02/08/2024 16:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
02/08/2024 16:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
02/08/2024 16:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
02/08/2024 17:00:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
02/08/2024 17:15:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
02/08/2024 17:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.10					
02/08/2024 17:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
02/08/2024 18:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
02/08/2024 18:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
02/08/2024 18:30:00			-0.02	0.00	0.14	0.16	0.09	0.58						
02/08/2024 18:45:00			-0.02	0.00	0.14	0.16	0.09	0.58						
02/08/2024 19:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.03					
02/08/2024 19:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
02/08/2024 19:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
02/08/2024 19:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.15					
02/08/2024 20:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
02/08/2024 20:15:00			-0.02	0.00	0.14	0.16	0.09	0.59	0.20					
02/08/2024 20:30:00			-0.02	0.00	0.14	0.16	0.09	0.59	0.20					
02/08/2024 20:45:00			-0.02	0.00	0.14	0.16	0.09	0.59						
02/08/2024 21:00:00			-0.02	0.00	0.14	0.16	0.09	0.58						
02/08/2024 21:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.10					
02/08/2024 21:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
02/08/2024 21:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
02/08/2024 22:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
02/08/2024 22:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
02/08/2024 22:30:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.00					
02/08/2024 22:45:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.00					
02/08/2024 23:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
02/08/2024 23:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
02/08/2024 23:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
02/08/2024 23:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 00:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 00:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
03/08/2024 00:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 00:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 01:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 01:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 01:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
03/08/2024 01:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
03/08/2024 02:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
03/08/2024 02:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
03/08/2024 02:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
03/08/2024 02:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
03/08/2024 03:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
03/08/2024 03:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
03/08/2024 03:30:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
03/08/2024 03:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
03/08/2024 04:00:00			-0.02	0.00	0.14	0.16	0.08	0.55	0.00					
03/08/2024 04:15:00			-0.02	0.00	0.14	0.16	0.08	0.55	0.00					
03/08/2024 04:30:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
03/08/2024 04:45:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
03/08/2024 05:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 05:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 05:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 05:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 06:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 06:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 06:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 06:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 07:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 07:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 07:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 07:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 08:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
03/08/2024 08:15:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
03/08/2024 08:30:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
03/08/2024 08:45:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
03/08/2024 09:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
03/08/2024 09:15:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
03/08/2024 09:30:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.10					
03/08/2024 09:45:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.20					
03/08/2024 10:00:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.22					
03/08/2024 10:15:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.22					
03/08/2024 10:30:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.23					
03/08/2024 10:45:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.24					
03/08/2024 11:00:00			-0.02	0.00	0.14	0.15	0.08	0.58						
03/08/2024 11:15:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.22					
03/08/2024 11:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.21					
03/08/2024 11:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.21					
03/08/2024 12:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.21					
03/08/2024 12:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.21					
03/08/2024 12:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 12:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 13:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 13:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 13:30:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.20					
03/08/2024 13:45:00			-0.03	0.00	0.15	0.16	0.09	0.58	0.20					
03/08/2024 14:00:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.20					
03/08/2024 14:15:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.21					
03/08/2024 14:30:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.21					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
03/08/2024 14:45:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.21					
03/08/2024 15:00:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.20					
03/08/2024 15:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 15:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 15:45:00			-0.02	0.00	0.14	0.16	0.09	0.58						
03/08/2024 16:00:00			-0.02	0.00	0.14	0.16	0.09	0.57						
03/08/2024 16:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.10					
03/08/2024 16:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 16:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 17:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 17:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 17:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 17:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
03/08/2024 18:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.17					
03/08/2024 18:15:00			-0.01	0.00	0.14	0.16	0.09	0.57	0.19					
03/08/2024 18:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.20					
03/08/2024 18:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 19:00:00			-0.01	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 19:15:00			-0.01	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 19:30:00			-0.01	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 19:45:00			-0.01	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 20:00:00			-0.01	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 20:15:00			-0.01	0.00	0.14	0.16	0.09	0.58	0.20					
03/08/2024 20:30:00			-0.01	0.00	0.14	0.16	0.09	0.58						
03/08/2024 20:45:00			-0.01	0.00	0.14	0.16	0.09	0.57						
03/08/2024 21:00:00			-0.01	0.00	0.14	0.16	0.09	0.57	0.05					
03/08/2024 21:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.10					
03/08/2024 21:30:00			-0.01	0.00	0.14	0.16	0.09	0.57	0.19					
03/08/2024 21:45:00			-0.01	0.00	0.14	0.16	0.09	0.57	0.20					
03/08/2024 22:00:00			-0.01	0.00	0.14	0.16	0.09	0.57	0.20					
03/08/2024 22:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.20					
03/08/2024 22:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.20					
03/08/2024 22:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.20					
03/08/2024 23:00:00			-0.02	0.00	0.14	0.16	0.09	0.57						
03/08/2024 23:15:00			-0.02	0.00	0.14	0.16	0.09	0.57						
03/08/2024 23:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.10					
03/08/2024 23:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
04/08/2024 00:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
04/08/2024 00:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
04/08/2024 00:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
04/08/2024 00:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
04/08/2024 01:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
04/08/2024 01:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
04/08/2024 01:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
04/08/2024 01:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
04/08/2024 02:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
04/08/2024 02:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
04/08/2024 02:30:00			-0.01	0.00	0.14	0.15	0.09	0.55	0.00					
04/08/2024 02:45:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.00					
04/08/2024 03:00:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.00					
04/08/2024 03:15:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.00					
04/08/2024 03:30:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
04/08/2024 03:45:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
04/08/2024 04:00:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.00					
04/08/2024 04:15:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.00					
04/08/2024 04:30:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.00					
04/08/2024 04:45:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.00					
04/08/2024 05:00:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.00					
04/08/2024 05:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
04/08/2024 05:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
04/08/2024 05:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
04/08/2024 06:00:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.00					
04/08/2024 06:15:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.00					
04/08/2024 06:30:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.00					
04/08/2024 06:45:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.00					
04/08/2024 07:00:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.00					
04/08/2024 07:15:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.00					
04/08/2024 07:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
04/08/2024 07:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
04/08/2024 08:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
04/08/2024 08:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
04/08/2024 08:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
04/08/2024 08:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
04/08/2024 09:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
04/08/2024 09:15:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
04/08/2024 09:30:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
04/08/2024 09:45:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
04/08/2024 10:00:00			-0.02	0.00	0.13	0.15	0.08	0.57						
04/08/2024 10:15:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.20					
04/08/2024 10:30:00			-0.02	0.00	0.13	0.15	0.08	0.57						
04/08/2024 10:45:00			-0.02	0.00	0.13	0.15	0.08	0.57						
04/08/2024 11:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.05					
04/08/2024 11:15:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.10					
04/08/2024 11:30:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.20					
04/08/2024 11:45:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.20					
04/08/2024 12:00:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.20					
04/08/2024 12:15:00			-0.02	0.00	0.14	0.15	0.09	0.58						
04/08/2024 12:30:00			-0.02	0.00	0.14	0.15	0.09	0.57						
04/08/2024 12:45:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.10					
04/08/2024 13:00:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
04/08/2024 13:15:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
04/08/2024 13:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 13:45:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
04/08/2024 14:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 14:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 14:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 14:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 15:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 15:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 15:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 15:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 16:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 16:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 16:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 16:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 17:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 17:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 17:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 17:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 18:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
04/08/2024 18:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 18:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
04/08/2024 18:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 19:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 19:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 19:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 19:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 20:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 20:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 20:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
04/08/2024 20:45:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.00					
04/08/2024 21:00:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.00					
04/08/2024 21:15:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.00					
04/08/2024 21:30:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.00					
04/08/2024 21:45:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.00					
04/08/2024 22:00:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.00					
04/08/2024 22:15:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.00					
04/08/2024 22:30:00			-0.02	0.00	0.15	0.16	0.09	0.58	0.00					
04/08/2024 22:45:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.00					
04/08/2024 23:00:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.00					
04/08/2024 23:15:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.00					
04/08/2024 23:30:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.00					
04/08/2024 23:45:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.00					
05/08/2024 00:00:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.00					
05/08/2024 00:15:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.00					
05/08/2024 00:30:00			-0.02	0.00	0.15	0.16	0.09	0.57	0.00					
05/08/2024 00:45:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.00					
05/08/2024 01:00:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.00					
05/08/2024 01:15:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.00					
05/08/2024 01:30:00			-0.02	0.00	0.15	0.16	0.09	0.56	0.00					
05/08/2024 01:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
05/08/2024 02:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
05/08/2024 02:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
05/08/2024 02:30:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
05/08/2024 02:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
05/08/2024 03:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
05/08/2024 03:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
05/08/2024 03:30:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
05/08/2024 03:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
05/08/2024 04:00:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.00					
05/08/2024 04:15:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.00					
05/08/2024 04:30:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
05/08/2024 04:45:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
05/08/2024 05:00:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
05/08/2024 05:15:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
05/08/2024 05:30:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
05/08/2024 05:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
05/08/2024 06:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
05/08/2024 06:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
05/08/2024 06:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
05/08/2024 06:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
05/08/2024 07:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
05/08/2024 07:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
05/08/2024 07:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
05/08/2024 07:45:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
05/08/2024 08:00:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
05/08/2024 08:15:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
05/08/2024 08:30:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
05/08/2024 08:45:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.10					
05/08/2024 09:00:00			-0.02	0.00	0.13	0.15	0.08	0.57						
05/08/2024 09:15:00			-0.02	0.00	0.13	0.15	0.08	0.57						
05/08/2024 09:30:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.10					
05/08/2024 09:45:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
05/08/2024 10:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
05/08/2024 10:15:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
05/08/2024 10:30:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.00					
05/08/2024 10:45:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.10					
05/08/2024 11:00:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.19					
05/08/2024 11:15:00			-0.02	0.00	0.14	0.15	0.08	0.58						
05/08/2024 11:30:00			-0.02	0.00	0.14	0.15	0.09	0.58						
05/08/2024 11:45:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.10					
05/08/2024 12:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
05/08/2024 12:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.10					
05/08/2024 12:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.19					
05/08/2024 12:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.19					
05/08/2024 13:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.19					
05/08/2024 13:15:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.19					
05/08/2024 13:30:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.19					
05/08/2024 13:45:00			-0.02	0.00	0.14	0.15	0.09	0.58						
05/08/2024 14:00:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.19					
05/08/2024 14:15:00			-0.01	0.00	0.14	0.15	0.09	0.58						
05/08/2024 14:30:00			-0.02	0.00	0.14	0.16	0.09	0.58						
05/08/2024 14:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.10					
05/08/2024 15:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
05/08/2024 15:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
05/08/2024 15:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.20					
05/08/2024 15:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.20					
05/08/2024 16:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.20					
05/08/2024 16:15:00			-0.02	0.00	0.14	0.16	0.09	0.57						
05/08/2024 16:30:00			-0.02	0.00	0.14	0.16	0.09	0.57						
05/08/2024 16:45:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.10					
05/08/2024 17:00:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.18					
05/08/2024 17:15:00			-0.02	0.00	0.14	0.15	0.09	0.57						
05/08/2024 17:30:00			-0.02	0.00	0.14	0.15	0.09	0.57						
05/08/2024 17:45:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.10					
05/08/2024 18:00:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.00					
05/08/2024 18:15:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
05/08/2024 18:30:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
05/08/2024 18:45:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
05/08/2024 19:00:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
05/08/2024 19:15:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
05/08/2024 19:30:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
05/08/2024 19:45:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
05/08/2024 20:00:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
05/08/2024 20:15:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
05/08/2024 20:30:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
05/08/2024 20:45:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
05/08/2024 21:00:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
05/08/2024 21:15:00			-0.02	0.00	0.14	0.15	0.09	0.59	0.00					
05/08/2024 21:30:00			-0.02	0.00	0.14	0.15	0.09	0.59	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
05/08/2024 21:45:00			-0.02	0.00	0.14	0.15	0.09	0.59	0.00					
05/08/2024 22:00:00			-0.02	0.00	0.14	0.15	0.09	0.59	0.00					
05/08/2024 22:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
05/08/2024 22:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
05/08/2024 22:45:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
05/08/2024 23:00:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
05/08/2024 23:15:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
05/08/2024 23:30:00			-0.02	0.00	0.14	0.16	0.09	0.58	0.00					
05/08/2024 23:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
06/08/2024 00:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
06/08/2024 00:15:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
06/08/2024 00:30:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
06/08/2024 00:45:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
06/08/2024 01:00:00			-0.02	0.00	0.14	0.16	0.09	0.57	0.00					
06/08/2024 01:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
06/08/2024 01:30:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
06/08/2024 01:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
06/08/2024 02:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.00					
06/08/2024 02:15:00			-0.02	0.00	0.14	0.15	0.09	0.56	0.00					
06/08/2024 02:30:00			-0.02	0.00	0.14	0.15	0.09	0.56	0.00					
06/08/2024 02:45:00			-0.02	0.00	0.14	0.15	0.09	0.56	0.00					
06/08/2024 03:00:00			-0.02	0.00	0.14	0.15	0.09	0.56	0.00					
06/08/2024 03:15:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.00					
06/08/2024 03:30:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.00					
06/08/2024 03:45:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
06/08/2024 04:00:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.00					
06/08/2024 04:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
06/08/2024 04:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
06/08/2024 04:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
06/08/2024 05:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
06/08/2024 05:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
06/08/2024 05:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
06/08/2024 05:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
06/08/2024 06:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
06/08/2024 06:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
06/08/2024 06:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.00					
06/08/2024 06:45:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
06/08/2024 07:00:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
06/08/2024 07:15:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
06/08/2024 07:30:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.00					
06/08/2024 07:45:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
06/08/2024 08:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
06/08/2024 08:15:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
06/08/2024 08:30:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
06/08/2024 08:45:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
06/08/2024 09:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
06/08/2024 09:15:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
06/08/2024 09:30:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.00					
06/08/2024 09:45:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.00					
06/08/2024 10:00:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.00					
06/08/2024 10:15:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.00					
06/08/2024 10:30:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.00					
06/08/2024 10:45:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
06/08/2024 11:00:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
06/08/2024 11:15:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
06/08/2024 11:30:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
06/08/2024 11:45:00			-0.02	0.00	0.14	0.15	0.08	0.58	0.00					
06/08/2024 12:00:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 12:15:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 12:30:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 12:45:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 13:00:00			-0.02	0.00	0.14	0.15	0.09	0.59	0.00					
06/08/2024 13:15:00			-0.02	0.00	0.14	0.15	0.09	0.59	0.00					
06/08/2024 13:30:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 13:45:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 14:00:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 14:15:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 14:30:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 14:45:00			-0.02	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 15:00:00			-0.01	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 15:15:00			-0.01	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 15:30:00			-0.01	0.00	0.14	0.15	0.09	0.57	0.00					
06/08/2024 15:45:00			-0.01	0.00	0.14	0.13	0.09	0.57	0.00					
06/08/2024 16:00:00			-0.01	0.00	0.14	0.15	0.09	0.57	0.00					
06/08/2024 16:15:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.00					
06/08/2024 16:30:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.00					
06/08/2024 16:45:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.00					
06/08/2024 17:00:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.00					
06/08/2024 17:15:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.00					
06/08/2024 17:30:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.00					
06/08/2024 17:45:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.00					
06/08/2024 18:00:00			-0.01	0.00	0.14	0.15	0.08	0.58	0.00					
06/08/2024 18:15:00			-0.01	0.00	0.14	0.15	0.08	0.58	0.00					
06/08/2024 18:30:00			-0.01	0.00	0.14	0.15	0.08	0.58	0.00					
06/08/2024 18:45:00			-0.01	0.00	0.13	0.15	0.08	0.58	0.00					
06/08/2024 19:00:00			-0.01	0.00	0.13	0.15	0.08	0.58	0.00					
06/08/2024 19:15:00			-0.01	0.00	0.13	0.15	0.08	0.58	0.00					
06/08/2024 19:30:00			-0.01	0.00	0.13	0.15	0.08	0.58	0.00					
06/08/2024 19:45:00			-0.01	0.00	0.14	0.15	0.08	0.58	0.00					
06/08/2024 20:00:00			-0.01	0.00	0.14	0.15	0.08	0.58	0.00					
06/08/2024 20:15:00			-0.01	0.00	0.14	0.15	0.08	0.58	0.10					
06/08/2024 20:30:00			-0.01	0.00	0.14	0.15	0.08	0.59	0.19					
06/08/2024 20:45:00			-0.01	0.00	0.14	0.15	0.08	0.59	0.19					
06/08/2024 21:00:00			-0.01	0.00	0.14	0.15	0.08	0.59						
06/08/2024 21:15:00			-0.01	0.00	0.14	0.15	0.08	0.59						
06/08/2024 21:30:00			-0.01	0.00	0.14	0.15	0.08	0.59	0.10					
06/08/2024 21:45:00			-0.01	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 22:00:00			-0.01	0.00	0.14	0.15	0.09	0.59	0.00					
06/08/2024 22:15:00			-0.01	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 22:30:00			-0.01	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 22:45:00			-0.01	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 23:00:00			-0.01	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 23:15:00			-0.01	0.00	0.14	0.15	0.09	0.58	0.00					
06/08/2024 23:30:00			-0.01	0.00	0.14	0.15	0.09	0.57	0.00					
06/08/2024 23:45:00			-0.01	0.00	0.14	0.15	0.09	0.57	0.00					
07/08/2024 00:00:00			-0.01	0.00	0.14	0.15	0.09	0.57	0.00					
07/08/2024 00:15:00			-0.01	0.00	0.14	0.15	0.09	0.57	0.00					
07/08/2024 00:30:00			-0.01	0.00	0.14	0.15	0.09	0.57	0.00					
07/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.09	0.57	0.00					
07/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.09	0.57	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
07/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.09	0.56	0.00					
07/08/2024 01:30:00			-0.01	0.00	0.14	0.15	0.09	0.56	0.00					
07/08/2024 01:45:00			-0.01	0.00	0.14	0.15	0.09	0.56	0.00					
07/08/2024 02:00:00			-0.01	0.00	0.14	0.15	0.09	0.56	0.00					
07/08/2024 02:15:00			-0.01	0.00	0.14	0.15	0.09	0.56	0.00					
07/08/2024 02:30:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.00					
07/08/2024 02:45:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.00					
07/08/2024 03:00:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.00					
07/08/2024 03:15:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.00					
07/08/2024 03:30:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.00					
07/08/2024 03:45:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.00					
07/08/2024 04:00:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.00					
07/08/2024 04:15:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.00					
07/08/2024 04:30:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.00					
07/08/2024 04:45:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.00					
07/08/2024 05:00:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.00					
07/08/2024 05:15:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.00					
07/08/2024 05:30:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.00					
07/08/2024 05:45:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.00					
07/08/2024 06:00:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.00					
07/08/2024 06:15:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.00					
07/08/2024 06:30:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.00					
07/08/2024 06:45:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.00					
07/08/2024 07:00:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.00					
07/08/2024 07:15:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.00					
07/08/2024 07:30:00			-0.02	0.00	0.13	0.14	0.08	0.56	0.00					
07/08/2024 07:45:00			-0.02	0.00	0.13	0.14	0.08	0.56	0.00					
07/08/2024 08:00:00			-0.02	0.00	0.13	0.14	0.08	0.56	0.00					
07/08/2024 08:15:00			-0.02	0.00	0.13	0.14	0.08	0.57	0.10					
07/08/2024 08:30:00			-0.02	0.00	0.13	0.14	0.08	0.57						
07/08/2024 08:45:00			-0.02	0.00	0.13	0.14	0.08	0.57	0.20					
07/08/2024 09:00:00			-0.02	0.00	0.13	0.14	0.08	0.57	0.20					
07/08/2024 09:15:00			-0.02	0.00	0.13	0.14	0.08	0.57	0.20					
07/08/2024 09:30:00			-0.02	0.00	0.13	0.14	0.08	0.57						
07/08/2024 09:45:00			-0.02	0.00	0.13	0.14	0.08	0.57						
07/08/2024 10:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.03					
07/08/2024 10:15:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
07/08/2024 10:30:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.00					
07/08/2024 10:45:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.15					
07/08/2024 11:00:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.21					
07/08/2024 11:15:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.21					
07/08/2024 11:30:00			-0.02	0.00	0.14	0.15	0.08	0.57						
07/08/2024 11:45:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.20					
07/08/2024 12:00:00			-0.02	0.00	0.14	0.15	0.08	0.57						
07/08/2024 12:15:00			-0.02	0.00	0.14	0.15	0.08	0.57						
07/08/2024 12:30:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.23					
07/08/2024 12:45:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.26					
07/08/2024 13:00:00			-0.02	0.00	0.14	0.15	0.09	0.57	0.60					
07/08/2024 13:15:00			-0.01	0.00	0.14	0.15	0.09	0.57						
07/08/2024 13:30:00			-0.01	0.00	0.14	0.15	0.08	0.57						
07/08/2024 13:45:00			-0.01	0.00	0.14	0.15	0.08	0.57						
07/08/2024 14:00:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.19					
07/08/2024 14:15:00			-0.01	0.00	0.14	0.15	0.08	0.57						
07/08/2024 14:30:00			-0.01	0.00	0.14	0.15	0.08	0.58						
07/08/2024 14:45:00			-0.01	0.00	0.14	0.15	0.08	0.58						
07/08/2024 15:00:00			-0.01	0.00	0.14	0.15	0.08	0.58						
07/08/2024 15:15:00			-0.01	0.00	0.14	0.15	0.08	0.57						
07/08/2024 15:30:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.17					
07/08/2024 15:45:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.30					
07/08/2024 16:00:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.67					
07/08/2024 16:15:00			-0.02	0.00	0.14	0.15	0.08	0.57						
07/08/2024 16:30:00			-0.02	0.00	0.14	0.15	0.08	0.57						
07/08/2024 16:45:00			-0.02	0.00	0.14	0.15	0.08	0.57						
07/08/2024 17:00:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.02					
07/08/2024 17:15:00			-0.01	0.00	0.14	0.15	0.08	0.57						
07/08/2024 17:30:00			-0.01	0.00	0.14	0.15	0.08	0.57						
07/08/2024 17:45:00			-0.01	0.00	0.13	0.15	0.08	0.57						
07/08/2024 18:00:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.25					
07/08/2024 18:15:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.25					
07/08/2024 18:30:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.25					
07/08/2024 18:45:00			-0.01	0.00	0.13	0.15	0.08	0.57						
07/08/2024 19:00:00			-0.01	0.00	0.13	0.15	0.08	0.57						
07/08/2024 19:15:00			-0.01	0.00	0.13	0.15	0.08	0.57						
07/08/2024 19:30:00			-0.01	0.00	0.13	0.15	0.08	0.57						
07/08/2024 19:45:00			-0.01	0.00	0.13	0.15	0.08	0.58						
07/08/2024 20:00:00			-0.01	0.00	0.13	0.15	0.08	0.58						
07/08/2024 20:15:00			-0.01	0.00	0.13	0.15	0.08	0.58						
07/08/2024 20:30:00			-0.01	0.00	0.13	0.15	0.08	0.58						
07/08/2024 20:45:00			-0.01	0.00	0.13	0.15	0.08	0.58						
07/08/2024 21:00:00			-0.01	0.00	0.13	0.15	0.08	0.58						
07/08/2024 21:15:00			-0.01	0.00	0.14	0.15	0.08	0.58						
07/08/2024 21:30:00			-0.01	0.00	0.14	0.15	0.08	0.58						
07/08/2024 21:45:00			-0.01	0.00	0.14	0.15	0.08	0.58						
07/08/2024 22:00:00			-0.01	0.00	0.14	0.15	0.08	0.58						
07/08/2024 22:15:00			-0.01	0.00	0.14	0.15	0.09	0.57						
07/08/2024 22:30:00			-0.01	0.00	0.14	0.15	0.09	0.57						
07/08/2024 22:45:00			-0.01	0.00	0.14	0.15	0.09	0.57						
07/08/2024 23:00:00			-0.01	0.00	0.14	0.15	0.09	0.57						
07/08/2024 23:15:00			-0.01	0.00	0.14	0.15	0.09	0.57						
07/08/2024 23:30:00			-0.01	0.00	0.14	0.15	0.09	0.57						
07/08/2024 23:45:00			-0.01	0.00	0.14	0.15	0.09	0.57						
08/08/2024 00:00:00			-0.01	0.00	0.14	0.15	0.09	0.57						
08/08/2024 00:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
08/08/2024 00:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
08/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.08	0.56						
08/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.08	0.56						
08/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.08	0.56						
08/08/2024 01:30:00			-0.01	0.00	0.14	0.15	0.08	0.56						
08/08/2024 01:45:00			-0.01	0.00	0.14	0.15	0.08	0.55						
08/08/2024 02:00:00			-0.01	0.00	0.14	0.15	0.08	0.55						
08/08/2024 02:15:00			-0.01	0.00	0.13	0.15	0.08	0.55						
08/08/2024 02:30:00			-0.01	0.00	0.13	0.15	0.08	0.55						
08/08/2024 02:45:00			-0.01	0.00	0.13	0.15	0.08	0.55						
08/08/2024 03:00:00			-0.01	0.00	0.13	0.15	0.08	0.55						
08/08/2024 03:15:00			-0.01	0.00	0.13	0.15	0.08	0.55						
08/08/2024 03:30:00			-0.01	0.00	0.13	0.15	0.08	0.55						
08/08/2024 03:45:00			-0.01	0.00	0.13	0.15	0.08	0.55						
08/08/2024 04:00:00			-0.01	0.00	0.13	0.15	0.08	0.54						
08/08/2024 04:15:00			-0.01	0.00	0.13	0.15	0.08	0.54						
08/08/2024 04:30:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.31					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
08/08/2024 04:45:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.66					
08/08/2024 05:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
08/08/2024 05:15:00			-0.01	0.00	0.13	0.14	0.07	0.55						
08/08/2024 05:30:00			-0.01	0.00	0.13	0.14	0.07	0.55						
08/08/2024 05:45:00			-0.01	0.00	0.13	0.14	0.07	0.55						
08/08/2024 06:00:00			-0.02	0.00	0.13	0.14	0.07	0.55						
08/08/2024 06:15:00			-0.02	0.00	0.13	0.14	0.07	0.55						
08/08/2024 06:30:00			-0.02	0.00	0.12	0.14	0.07	0.55						
08/08/2024 06:45:00			-0.01	0.00	0.12	0.14	0.07	0.55						
08/08/2024 07:00:00			-0.02	0.00	0.12	0.14	0.07	0.55						
08/08/2024 07:15:00			-0.02	0.00	0.12	0.14	0.07	0.55						
08/08/2024 07:30:00			-0.02	0.00	0.12	0.14	0.07	0.55						
08/08/2024 07:45:00			-0.02	0.00	0.12	0.14	0.07	0.55						
08/08/2024 08:00:00			-0.02	0.00	0.12	0.14	0.07	0.55						
08/08/2024 08:15:00			-0.02	0.00	0.12	0.14	0.07	0.56						
08/08/2024 08:30:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.51					
08/08/2024 08:45:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.31					
08/08/2024 09:00:00			-0.02	0.00	0.12	0.14	0.07	0.56						
08/08/2024 09:15:00			-0.02	0.00	0.12	0.14	0.07	0.56						
08/08/2024 09:30:00			-0.02	0.00	0.13	0.14	0.07	0.56						
08/08/2024 09:45:00			-0.02	0.00	0.13	0.14	0.07	0.57						
08/08/2024 10:00:00			-0.02	0.00	0.13	0.14	0.07	0.57						
08/08/2024 10:15:00			-0.02	0.00	0.13	0.14	0.07	0.57						
08/08/2024 10:30:00			-0.02	0.00	0.13	0.14	0.08	0.57						
08/08/2024 10:45:00			-0.02	0.00	0.13	0.14	0.08	0.57						
08/08/2024 11:00:00			-0.02	0.00	0.13	0.14	0.08	0.57						
08/08/2024 11:15:00			-0.02	0.00	0.13	0.14	0.08	0.57						
08/08/2024 11:30:00			-0.02	0.00	0.13	0.14	0.08	0.57						
08/08/2024 11:45:00			-0.02	0.00	0.13	0.15	0.08	0.57						
08/08/2024 12:00:00			-0.02	0.00	0.13	0.15	0.08	0.57						
08/08/2024 12:15:00			-0.02	0.00	0.13	0.15	0.08	0.58						
08/08/2024 12:30:00			-0.02	0.00	0.13	0.15	0.08	0.58						
08/08/2024 12:45:00			-0.02	0.00	0.13	0.15	0.08	0.58						
08/08/2024 13:00:00			-0.02	0.00	0.13	0.15	0.08	0.58						
08/08/2024 13:15:00			-0.02	0.00	0.13	0.15	0.08	0.58						
08/08/2024 13:30:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.32					
08/08/2024 13:45:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.32					
08/08/2024 14:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.36					
08/08/2024 14:15:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.30					
08/08/2024 14:30:00			-0.02	0.00	0.13	0.15	0.08	0.57						
08/08/2024 14:45:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.29					
08/08/2024 15:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.28					
08/08/2024 15:15:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.28					
08/08/2024 15:30:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.28					
08/08/2024 15:45:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.27					
08/08/2024 16:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.28					
08/08/2024 16:15:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.27					
08/08/2024 16:30:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.27					
08/08/2024 16:45:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.27					
08/08/2024 17:00:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.27					
08/08/2024 17:15:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.27					
08/08/2024 17:30:00			-0.02	0.00	0.13	0.14	0.08	0.57	0.27					
08/08/2024 17:45:00			-0.02	0.00	0.13	0.14	0.08	0.57	0.28					
08/08/2024 18:00:00			-0.02	0.00	0.13	0.15	0.08	0.58	0.58					
08/08/2024 18:15:00			-0.02	0.00	0.13	0.15	0.08	0.59						
08/08/2024 18:30:00			-0.02	0.00	0.13	0.15	0.08	0.59						
08/08/2024 18:45:00			-0.02	0.00	0.13	0.14	0.08	0.57						
08/08/2024 19:00:00			-0.02	0.00	0.13	0.14	0.08	0.57						
08/08/2024 19:15:00			-0.02	0.00	0.13	0.14	0.08	0.57						
08/08/2024 19:30:00			-0.02	0.00	0.13	0.15	0.08	0.57						
08/08/2024 19:45:00			-0.02	0.00	0.13	0.15	0.08	0.57						
08/08/2024 20:00:00			-0.02	0.00	0.13	0.15	0.08	0.56						
08/08/2024 20:15:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.32					
08/08/2024 20:30:00			-0.01	0.00	0.14	0.15	0.08	0.57	0.32					
08/08/2024 20:45:00			-0.01	0.00	0.14	0.15	0.09	0.57	0.32					
08/08/2024 21:00:00			-0.01	0.00	0.14	0.15	0.09	0.56	0.30					
08/08/2024 21:15:00			-0.01	0.00	0.14	0.15	0.09	0.56	0.31					
08/08/2024 21:30:00			-0.02	0.00	0.14	0.15	0.09	0.56						
08/08/2024 21:45:00			-0.02	0.00	0.14	0.15	0.09	0.56	0.30					
08/08/2024 22:00:00			-0.01	0.00	0.14	0.15	0.09	0.56	0.30					
08/08/2024 22:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.30					
08/08/2024 22:30:00			-0.01	0.00	0.14	0.16	0.09	0.55	0.29					
08/08/2024 22:45:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.28					
08/08/2024 23:00:00			-0.02	0.00	0.14	0.16	0.09	0.55						
08/08/2024 23:15:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.28					
08/08/2024 23:30:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.28					
08/08/2024 23:45:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.29					
09/08/2024 00:00:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.29					
09/08/2024 00:15:00			-0.02	0.00	0.14	0.16	0.09	0.56	0.29					
09/08/2024 00:30:00			-0.02	0.00	0.14	0.16	0.09	0.55	0.28					
09/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.09	0.55	0.27					
09/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.09	0.55	0.28					
09/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.09	0.55	0.27					
09/08/2024 01:30:00			-0.02	0.00	0.14	0.15	0.09	0.54	0.28					
09/08/2024 01:45:00			-0.01	0.00	0.14	0.15	0.09	0.54	0.30					
09/08/2024 02:00:00			-0.01	0.00	0.14	0.15	0.09	0.54	0.29					
09/08/2024 02:15:00			-0.01	0.00	0.14	0.15	0.09	0.54	0.29					
09/08/2024 02:30:00			-0.01	0.00	0.14	0.15	0.09	0.54	0.29					
09/08/2024 02:45:00			-0.01	0.00	0.14	0.15	0.09	0.54	0.29					
09/08/2024 03:00:00			-0.01	0.00	0.14	0.15	0.08	0.54	0.29					
09/08/2024 03:15:00			-0.01	0.00	0.14	0.15	0.08	0.54	0.28					
09/08/2024 03:30:00			-0.01	0.00	0.14	0.15	0.08	0.53	0.27					
09/08/2024 03:45:00			-0.01	0.00	0.13	0.15	0.08	0.53	0.29					
09/08/2024 04:00:00			-0.01	0.00	0.13	0.15	0.08	0.53	0.28					
09/08/2024 04:15:00			-0.01	0.00	0.13	0.15	0.08	0.53	0.29					
09/08/2024 04:30:00			-0.01	0.00	0.13	0.15	0.08	0.53	0.28					
09/08/2024 04:45:00			-0.01	0.00	0.13	0.15	0.08	0.53	0.28					
09/08/2024 05:00:00			-0.01	0.00	0.13	0.15	0.08	0.53	0.28					
09/08/2024 05:15:00			-0.01	0.00	0.13	0.15	0.08	0.53	0.28					
09/08/2024 05:30:00			-0.01	0.00	0.13	0.15	0.08	0.53	0.28					
09/08/2024 05:45:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.27					
09/08/2024 06:00:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.28					
09/08/2024 06:15:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.28					
09/08/2024 06:30:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.28					
09/08/2024 06:45:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.28					
09/08/2024 07:00:00			-0.01	0.00	0.13	0.14	0.07	0.53	0.29					
09/08/2024 07:15:00			-0.01	0.00	0.13	0.14	0.07	0.53	0.29					
09/08/2024 07:30:00			0.00	0.00	0.13	0.14	0.07	0.54	0.30					
09/08/2024 07:45:00			-0.01	0.00	0.13	0.14	0.07	0.54	0.31					
09/08/2024 08:00:00			-0.01	0.00	0.13	0.14	0.07	0.54	0.32					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
09/08/2024 08:15:00			-0.01	0.00	0.13	0.14	0.07	0.55	0.31					
09/08/2024 08:30:00			-0.01	0.00	0.13	0.14	0.07	0.55	0.32					
09/08/2024 08:45:00			-0.01	0.00	0.13	0.14	0.07	0.56						
09/08/2024 09:00:00			-0.01	0.00	0.13	0.14	0.07	0.56	0.01					
09/08/2024 09:15:00			-0.01	0.00	0.13	0.14	0.07	0.56						
09/08/2024 09:30:00			-0.01	0.00	0.13	0.14	0.07	0.56	0.00					
09/08/2024 09:45:00			-0.01	0.00	0.13	0.14	0.08	0.56	-0.01					
09/08/2024 10:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
09/08/2024 10:15:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.01					
09/08/2024 10:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
09/08/2024 10:45:00			-0.02	0.00	0.13	0.14	0.08	0.56						
09/08/2024 11:00:00			-0.01	0.00	0.13	0.15	0.08	0.55						
09/08/2024 11:15:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.01					
09/08/2024 11:30:00			-0.02	0.00	0.13	0.15	0.08	0.55						
09/08/2024 11:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 12:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.67					
09/08/2024 12:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 12:30:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 12:45:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 13:00:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 13:15:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 13:30:00			-0.02	0.00	0.13	0.15	0.08	0.55						
09/08/2024 13:45:00			-0.02	0.00	0.13	0.15	0.08	0.55						
09/08/2024 14:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	-0.01					
09/08/2024 14:15:00			-0.01	0.00	0.13	0.15	0.08	0.55						
09/08/2024 14:30:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 14:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 15:00:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 15:15:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 15:30:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.32					
09/08/2024 15:45:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.32					
09/08/2024 16:00:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.31					
09/08/2024 16:15:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.31					
09/08/2024 16:30:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.31					
09/08/2024 16:45:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.32					
09/08/2024 17:00:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.44					
09/08/2024 17:15:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.31					
09/08/2024 17:30:00			-0.01	0.00	0.13	0.14	0.08	0.48						
09/08/2024 17:45:00			-0.01	0.00	0.13	0.14	0.08	0.52						
09/08/2024 18:00:00			-0.01	0.00	0.13	0.14	0.08	0.52	0.32					
09/08/2024 18:15:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.32					
09/08/2024 18:30:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.32					
09/08/2024 18:45:00			-0.01	0.00	0.13	0.14	0.08	0.52	0.32					
09/08/2024 19:00:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.67					
09/08/2024 19:15:00			-0.01	0.00	0.13	0.14	0.08	0.52	0.32					
09/08/2024 19:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
09/08/2024 19:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
09/08/2024 20:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
09/08/2024 20:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
09/08/2024 20:30:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.03					
09/08/2024 20:45:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.01					
09/08/2024 21:00:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.01					
09/08/2024 21:15:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.17					
09/08/2024 21:30:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.32					
09/08/2024 21:45:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.32					
09/08/2024 22:00:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.65					
09/08/2024 22:15:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.51					
09/08/2024 22:30:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.32					
09/08/2024 22:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
09/08/2024 23:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
09/08/2024 23:15:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.32					
09/08/2024 23:30:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.32					
09/08/2024 23:45:00			-0.02	0.00	0.13	0.14	0.08	0.54	0.32					
10/08/2024 00:00:00			-0.02	0.00	0.13	0.14	0.08	0.54						
10/08/2024 00:15:00			-0.02	0.00	0.13	0.14	0.08	0.54						
10/08/2024 00:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 00:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 01:00:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.32					
10/08/2024 01:15:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.32					
10/08/2024 01:30:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.29					
10/08/2024 01:45:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.28					
10/08/2024 02:00:00			-0.01	0.00	0.13	0.14	0.08	0.53						
10/08/2024 02:15:00			-0.01	0.00	0.13	0.14	0.08	0.53						
10/08/2024 02:30:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.08					
10/08/2024 02:45:00			-0.01	0.00	0.13	0.14	0.08	0.52	0.00					
10/08/2024 03:00:00			-0.01	0.00	0.13	0.14	0.08	0.52	0.00					
10/08/2024 03:15:00			-0.01	0.00	0.13	0.14	0.08	0.52	0.00					
10/08/2024 03:30:00			-0.02	0.00	0.13	0.14	0.08	0.52	0.00					
10/08/2024 03:45:00			-0.02	0.00	0.13	0.14	0.08	0.52	0.00					
10/08/2024 04:00:00			-0.01	0.00	0.13	0.14	0.08	0.52	0.00					
10/08/2024 04:15:00			-0.02	0.00	0.13	0.14	0.07	0.52	0.00					
10/08/2024 04:30:00			-0.02	0.00	0.13	0.14	0.07	0.52	0.00					
10/08/2024 04:45:00			-0.01	0.00	0.13	0.14	0.07	0.52	0.00					
10/08/2024 05:00:00			-0.01	0.00	0.12	0.14	0.07	0.52	0.53					
10/08/2024 05:15:00			-0.01	0.00	0.12	0.14	0.07	0.52						
10/08/2024 05:30:00			-0.02	0.00	0.12	0.14	0.07	0.51						
10/08/2024 05:45:00			-0.01	0.00	0.12	0.14	0.07	0.51						
10/08/2024 06:00:00			-0.01	0.00	0.12	0.14	0.07	0.51						
10/08/2024 06:15:00			-0.01	0.00	0.12	0.14	0.07	0.51						
10/08/2024 06:30:00			-0.02	0.00	0.12	0.14	0.07	0.51						
10/08/2024 06:45:00			-0.02	0.00	0.12	0.14	0.07	0.51	0.50					
10/08/2024 07:00:00			-0.02	0.00	0.12	0.14	0.07	0.51	0.65					
10/08/2024 07:15:00			-0.02	0.00	0.12	0.14	0.07	0.52	0.26					
10/08/2024 07:30:00			-0.02	0.00	0.12	0.14	0.07	0.52	0.26					
10/08/2024 07:45:00			-0.02	0.00	0.12	0.14	0.07	0.52	0.27					
10/08/2024 08:00:00			-0.02	0.00	0.12	0.13	0.07	0.52	0.28					
10/08/2024 08:15:00			-0.02	0.00	0.12	0.13	0.07	0.52	0.28					
10/08/2024 08:30:00			-0.02	0.00	0.12	0.13	0.07	0.52	0.28					
10/08/2024 08:45:00			-0.02	0.00	0.12	0.13	0.07	0.53	0.29					
10/08/2024 09:00:00			-0.02	0.00	0.12	0.13	0.07	0.53	0.31					
10/08/2024 09:15:00			-0.02	0.00	0.12	0.13	0.07	0.53	0.31					
10/08/2024 09:30:00			-0.01	0.00	0.12	0.13	0.07	0.54	0.32					
10/08/2024 09:45:00			-0.02	0.00	0.12	0.13	0.07	0.54						
10/08/2024 10:00:00			-0.02	0.00	0.12	0.13	0.07	0.55						
10/08/2024 10:15:00			-0.02	0.00	0.12	0.13	0.07	0.55						
10/08/2024 10:30:00			-0.02	0.00	0.12	0.13	0.07	0.55						
10/08/2024 10:45:00			-0.02	0.00	0.12	0.14	0.07	0.55						
10/08/2024 11:00:00			-0.02	0.00	0.12	0.14	0.07	0.55						
10/08/2024 11:15:00			-0.02	0.00	0.12	0.14	0.07	0.55						
10/08/2024 11:30:00			-0.02	0.00	0.12	0.14	0.07	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
10/08/2024 11:45:00			-0.02	0.00	0.13	0.14	0.07	0.55						
10/08/2024 12:00:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.32					
10/08/2024 12:15:00			-0.02	0.00	0.13	0.14	0.08	0.55						
10/08/2024 12:30:00			-0.02	0.00	0.13	0.14	0.08	0.55						
10/08/2024 12:45:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.08					
10/08/2024 13:00:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.00					
10/08/2024 13:15:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.00					
10/08/2024 13:30:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.00					
10/08/2024 13:45:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.00					
10/08/2024 14:00:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.22					
10/08/2024 14:15:00			-0.02	0.00	0.13	0.14	0.08	0.54	0.31					
10/08/2024 14:30:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.31					
10/08/2024 14:45:00			-0.02	0.00	0.13	0.14	0.08	0.54	0.31					
10/08/2024 15:00:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.31					
10/08/2024 15:15:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.30					
10/08/2024 15:30:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.31					
10/08/2024 15:45:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.32					
10/08/2024 16:00:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.67					
10/08/2024 16:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
10/08/2024 16:30:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.32					
10/08/2024 16:45:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.32					
10/08/2024 17:00:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.32					
10/08/2024 17:15:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.32					
10/08/2024 17:30:00			-0.02	0.00	0.13	0.14	0.08	0.54	0.32					
10/08/2024 17:45:00			-0.02	0.00	0.13	0.14	0.08	0.54						
10/08/2024 18:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 18:15:00			-0.02	0.00	0.13	0.15	0.08	0.54						
10/08/2024 18:30:00			-0.02	0.00	0.13	0.15	0.08	0.54						
10/08/2024 18:45:00			-0.02	0.00	0.13	0.14	0.08	0.54						
10/08/2024 19:00:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.41					
10/08/2024 19:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 19:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 19:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 20:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 20:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 20:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 20:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 21:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 21:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 21:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 21:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 22:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 22:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 22:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 22:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 23:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
10/08/2024 23:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
10/08/2024 23:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
10/08/2024 23:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
11/08/2024 00:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
11/08/2024 00:15:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.32					
11/08/2024 00:30:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.32					
11/08/2024 00:45:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.27					
11/08/2024 01:00:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.21					
11/08/2024 01:15:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.21					
11/08/2024 01:30:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.21					
11/08/2024 01:45:00			-0.02	0.00	0.13	0.14	0.08	0.53						
11/08/2024 02:00:00			-0.01	0.00	0.13	0.14	0.08	0.53	0.20					
11/08/2024 02:15:00			-0.01	0.00	0.13	0.14	0.08	0.53						
11/08/2024 02:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
11/08/2024 02:45:00			-0.01	0.00	0.13	0.14	0.08	0.52	0.20					
11/08/2024 03:00:00			-0.01	0.00	0.13	0.14	0.08	0.52						
11/08/2024 03:15:00			-0.01	0.00	0.13	0.14	0.08	0.52						
11/08/2024 03:30:00			-0.01	0.00	0.13	0.14	0.08	0.52	0.10					
11/08/2024 03:45:00			-0.01	0.00	0.13	0.14	0.07	0.52	0.00					
11/08/2024 04:00:00			-0.01	0.00	0.13	0.14	0.07	0.52	0.00					
11/08/2024 04:15:00			-0.01	0.00	0.13	0.14	0.07	0.52	0.00					
11/08/2024 04:30:00			-0.01	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 04:45:00			-0.01	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 05:00:00			-0.01	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 05:15:00			-0.01	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 05:30:00			-0.01	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 05:45:00			-0.01	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 06:00:00			-0.01	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 06:15:00			-0.01	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 06:30:00			-0.01	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 06:45:00			-0.02	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 07:00:00			-0.02	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 07:15:00			-0.02	0.00	0.12	0.14	0.07	0.52	0.00					
11/08/2024 07:30:00			-0.02	0.00	0.12	0.13	0.07	0.52	0.00					
11/08/2024 07:45:00			-0.02	0.00	0.12	0.13	0.07	0.52	0.10					
11/08/2024 08:00:00			-0.02	0.00	0.12	0.13	0.07	0.52	0.20					
11/08/2024 08:15:00			-0.02	0.00	0.12	0.13	0.07	0.52	0.21					
11/08/2024 08:30:00			-0.02	0.00	0.12	0.13	0.07	0.53	0.21					
11/08/2024 08:45:00			-0.02	0.00	0.12	0.13	0.07	0.53	0.22					
11/08/2024 09:00:00			-0.02	0.00	0.12	0.13	0.07	0.53	0.24					
11/08/2024 09:15:00			-0.02	0.00	0.12	0.13	0.07	0.54	0.24					
11/08/2024 09:30:00			-0.02	0.00	0.12	0.13	0.07	0.54	0.25					
11/08/2024 09:45:00			-0.02	0.00	0.12	0.13	0.07	0.54	0.27					
11/08/2024 10:00:00			-0.02	0.00	0.12	0.13	0.07	0.55	0.31					
11/08/2024 10:15:00			-0.02	0.00	0.12	0.13	0.07	0.55	0.31					
11/08/2024 10:30:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.31					
11/08/2024 10:45:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.31					
11/08/2024 11:00:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.30					
11/08/2024 11:15:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.30					
11/08/2024 11:30:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.30					
11/08/2024 11:45:00			-0.02	0.00	0.13	0.14	0.07	0.56	0.30					
11/08/2024 12:00:00			-0.02	0.00	0.13	0.14	0.08	0.56	0.29					
11/08/2024 12:15:00			-0.02	0.00	0.13	0.14	0.08	0.56	0.29					
11/08/2024 12:30:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.29					
11/08/2024 12:45:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.28					
11/08/2024 13:00:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.27					
11/08/2024 13:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.27					
11/08/2024 13:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.27					
11/08/2024 13:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.27					
11/08/2024 14:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.26					
11/08/2024 14:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.26					
11/08/2024 14:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.26					
11/08/2024 14:45:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.26					
11/08/2024 15:00:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.25					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
11/08/2024 15:15:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.25					
11/08/2024 15:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.25					
11/08/2024 15:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.25					
11/08/2024 16:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.25					
11/08/2024 16:15:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.25					
11/08/2024 16:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.25					
11/08/2024 16:45:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.25					
11/08/2024 17:00:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.26					
11/08/2024 17:15:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.26					
11/08/2024 17:30:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.27					
11/08/2024 17:45:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.29					
11/08/2024 18:00:00			-0.02	0.00	0.13	0.14	0.08	0.56	0.28					
11/08/2024 18:15:00			-0.02	0.00	0.13	0.14	0.08	0.56	0.28					
11/08/2024 18:30:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.28					
11/08/2024 18:45:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.28					
11/08/2024 19:00:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.27					
11/08/2024 19:15:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.27					
11/08/2024 19:30:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.27					
11/08/2024 19:45:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.27					
11/08/2024 20:00:00			-0.02	0.00	0.13	0.15	0.08	0.55	0.29					
11/08/2024 20:15:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.30					
11/08/2024 20:30:00			-0.01	0.00	0.13	0.15	0.08	0.56	0.30					
11/08/2024 20:45:00			-0.02	0.00	0.13	0.14	0.08	0.57	0.31					
11/08/2024 21:00:00			-0.02	0.00	0.13	0.15	0.08	0.57	0.30					
11/08/2024 21:15:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.30					
11/08/2024 21:30:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.29					
11/08/2024 21:45:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.29					
11/08/2024 22:00:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.28					
11/08/2024 22:15:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.28					
11/08/2024 22:30:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.27					
11/08/2024 22:45:00			-0.02	0.00	0.14	0.15	0.09	0.56	0.27					
11/08/2024 23:00:00			-0.02	0.00	0.14	0.15	0.09	0.56	0.26					
11/08/2024 23:15:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.26					
11/08/2024 23:30:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.25					
11/08/2024 23:45:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.24					
12/08/2024 00:00:00			-0.02	0.00	0.14	0.15	0.09	0.55	0.23					
12/08/2024 00:15:00			-0.02	0.00	0.14	0.14	0.09	0.55	0.23					
12/08/2024 00:30:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.23					
12/08/2024 00:45:00			-0.02	0.00	0.14	0.15	0.08	0.55	0.22					
12/08/2024 01:00:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.26					
12/08/2024 01:15:00			-0.02	0.00	0.14	0.15	0.08	0.54	0.26					
12/08/2024 01:30:00			-0.02	0.00	0.14	0.13	0.08	0.54	0.27					
12/08/2024 01:45:00			-0.02	0.00	0.14	0.14	0.08	0.54	0.25					
12/08/2024 02:00:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.27					
12/08/2024 02:15:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.27					
12/08/2024 02:30:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.27					
12/08/2024 02:45:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.27					
12/08/2024 03:00:00			-0.02	0.00	0.13	0.15	0.08	0.54	0.26					
12/08/2024 03:15:00			-0.02	0.00	0.13	0.15	0.08	0.53	0.26					
12/08/2024 03:30:00			-0.02	0.00	0.13	0.15	0.08	0.53	0.26					
12/08/2024 03:45:00			-0.02	0.00	0.13	0.15	0.08	0.53	0.26					
12/08/2024 04:00:00			-0.02	0.00	0.13	0.15	0.08	0.53	0.26					
12/08/2024 04:15:00			-0.02	0.00	0.13	0.15	0.08	0.53	0.26					
12/08/2024 04:30:00			-0.02	0.00	0.13	0.15	0.08	0.53	0.26					
12/08/2024 04:45:00			-0.02	0.00	0.13	0.15	0.08	0.53	0.26					
12/08/2024 05:00:00			-0.01	0.00	0.13	0.15	0.08	0.53	0.26					
12/08/2024 05:15:00			-0.02	0.00	0.13	0.15	0.07	0.53	0.26					
12/08/2024 05:30:00			-0.01	0.00	0.13	0.15	0.07	0.53	0.26					
12/08/2024 05:45:00			-0.01	0.00	0.13	0.15	0.07	0.53	0.26					
12/08/2024 06:00:00			-0.01	0.00	0.12	0.14	0.07	0.53	0.26					
12/08/2024 06:15:00			-0.02	0.00	0.12	0.14	0.07	0.53	0.26					
12/08/2024 06:30:00			-0.02	0.00	0.12	0.14	0.07	0.53	0.26					
12/08/2024 06:45:00			-0.02	0.00	0.12	0.14	0.07	0.53	0.26					
12/08/2024 07:00:00			-0.02	0.00	0.12	0.14	0.07	0.53	0.26					
12/08/2024 07:15:00			-0.02	0.00	0.12	0.14	0.07	0.54	0.26					
12/08/2024 07:30:00			-0.02	0.00	0.12	0.14	0.07	0.54	0.26					
12/08/2024 07:45:00			-0.02	0.00	0.12	0.14	0.07	0.54	0.28					
12/08/2024 08:00:00			-0.02	0.00	0.12	0.14	0.07	0.55	0.29					
12/08/2024 08:15:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.30					
12/08/2024 08:30:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.30					
12/08/2024 08:45:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.30					
12/08/2024 09:00:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.30					
12/08/2024 09:15:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.30					
12/08/2024 09:30:00			-0.02	0.00	0.13	0.14	0.07	0.56	0.30					
12/08/2024 09:45:00			-0.02	0.00	0.13	0.14	0.07	0.56	0.30					
12/08/2024 10:00:00			-0.02	0.00	0.13	0.14	0.08	0.56	0.30					
12/08/2024 10:15:00			-0.02	0.00	0.13	0.14	0.08	0.56	0.30					
12/08/2024 10:30:00			-0.02	0.00	0.13	0.14	0.08	0.56	0.30					
12/08/2024 10:45:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.31					
12/08/2024 11:00:00			-0.01	0.00	0.13	0.15	0.08	0.56	0.31					
12/08/2024 11:15:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.31					
12/08/2024 11:30:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.30					
12/08/2024 11:45:00			-0.02	0.00	0.13	0.15	0.08	0.56	0.28					
12/08/2024 12:00:00			-0.01	0.00	0.13	0.15	0.08	0.56	0.27					
12/08/2024 12:15:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.27					
12/08/2024 12:30:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.28					
12/08/2024 12:45:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.29					
12/08/2024 13:00:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.29					
12/08/2024 13:15:00			-0.02	0.00	0.14	0.15	0.08	0.57	0.29					
12/08/2024 13:30:00			-0.02	0.00	0.14	0.14	0.08	0.56	0.28					
12/08/2024 13:45:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.28					
12/08/2024 14:00:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.27					
12/08/2024 14:15:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.27					
12/08/2024 14:30:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.27					
12/08/2024 14:45:00			-0.02	0.00	0.14	0.15	0.08	0.56	0.26					
12/08/2024 15:00:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.26					
12/08/2024 15:15:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.25					
12/08/2024 15:30:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.25					
12/08/2024 15:45:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.26					
12/08/2024 16:00:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.25					
12/08/2024 16:15:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.25					
12/08/2024 16:30:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.27					
12/08/2024 16:45:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.25					
12/08/2024 17:00:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.24					
12/08/2024 17:15:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.24					
12/08/2024 17:30:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.24					
12/08/2024 17:45:00			-0.01	0.00	0.13	0.15	0.08	0.55	0.24					
12/08/2024 18:00:00			-0.01	0.00	0.13	0.15	0.08	0.56	0.24					
12/08/2024 18:15:00			-0.01	0.00	0.13	0.15	0.08	0.56	0.24					
12/08/2024 18:30:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.24					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
12/08/2024 18:45:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.25					
12/08/2024 19:00:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.25					
12/08/2024 19:15:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.25					
12/08/2024 19:30:00			-0.01	0.00	0.13	0.15	0.08	0.56	0.25					
12/08/2024 19:45:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.26					
12/08/2024 20:00:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.26					
12/08/2024 20:15:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.26					
12/08/2024 20:30:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.26					
12/08/2024 20:45:00			-0.01	0.00	0.13	0.14	0.08	0.57	0.27					
12/08/2024 21:00:00			-0.01	0.00	0.13	0.14	0.08	0.57	0.30					
12/08/2024 21:15:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.30					
12/08/2024 21:30:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.29					
12/08/2024 21:45:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.29					
12/08/2024 22:00:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.27					
12/08/2024 22:15:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.26					
12/08/2024 22:30:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.26					
12/08/2024 22:45:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.25					
12/08/2024 23:00:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.24					
12/08/2024 23:15:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.24					
12/08/2024 23:30:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.24					
12/08/2024 23:45:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.23					
13/08/2024 00:00:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.23					
13/08/2024 00:15:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.23					
13/08/2024 00:30:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.22					
13/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.22					
13/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.21					
13/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.20					
13/08/2024 01:30:00			-0.01	0.00	0.14	0.15	0.08	0.54	0.20					
13/08/2024 01:45:00			-0.01	0.00	0.14	0.15	0.08	0.54	0.20					
13/08/2024 02:00:00			-0.01	0.00	0.14	0.15	0.08	0.54	0.21					
13/08/2024 02:15:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.21					
13/08/2024 02:30:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.21					
13/08/2024 02:45:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.21					
13/08/2024 03:00:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.20					
13/08/2024 03:15:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.20					
13/08/2024 03:30:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.20					
13/08/2024 03:45:00			-0.01	0.00	0.13	0.15	0.08	0.54	0.20					
13/08/2024 04:00:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.20					
13/08/2024 04:15:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.20					
13/08/2024 04:30:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.20					
13/08/2024 04:45:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.20					
13/08/2024 05:00:00			-0.01	0.00	0.13	0.14	0.08	0.54	0.20					
13/08/2024 05:15:00			-0.01	0.00	0.13	0.14	0.07	0.54	0.20					
13/08/2024 05:30:00			-0.01	0.00	0.13	0.14	0.07	0.53	0.20					
13/08/2024 05:45:00			-0.01	0.00	0.13	0.14	0.07	0.53	0.20					
13/08/2024 06:00:00			-0.01	0.00	0.13	0.14	0.07	0.53	0.20					
13/08/2024 06:15:00			-0.01	0.00	0.13	0.14	0.07	0.53	0.20					
13/08/2024 06:30:00			-0.01	0.00	0.13	0.14	0.07	0.53	0.20					
13/08/2024 06:45:00			-0.01	0.00	0.13	0.14	0.07	0.53	0.20					
13/08/2024 07:00:00			-0.01	0.00	0.12	0.14	0.07	0.53	0.20					
13/08/2024 07:15:00			-0.01	0.00	0.12	0.14	0.07	0.53	0.20					
13/08/2024 07:30:00			-0.02	0.00	0.12	0.14	0.07	0.54	0.20					
13/08/2024 07:45:00			-0.02	0.00	0.12	0.14	0.07	0.54	0.20					
13/08/2024 08:00:00			-0.02	0.00	0.12	0.14	0.07	0.54	0.25					
13/08/2024 08:15:00			-0.02	0.00	0.12	0.14	0.07	0.55	0.26					
13/08/2024 08:30:00			-0.02	0.00	0.12	0.14	0.07	0.55	0.28					
13/08/2024 08:45:00			-0.01	0.00	0.12	0.14	0.07	0.55	0.30					
13/08/2024 09:00:00			-0.01	0.00	0.12	0.14	0.07	0.56						
13/08/2024 09:15:00			-0.02	0.00	0.12	0.14	0.07	0.56	0.01					
13/08/2024 09:30:00			-0.01	0.00	0.12	0.14	0.07	0.57	0.01					
13/08/2024 09:45:00			-0.01	0.00	0.13	0.14	0.07	0.56	-0.01					
13/08/2024 10:00:00			-0.01	0.00	0.13	0.14	0.07	0.56	0.01					
13/08/2024 10:15:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.01					
13/08/2024 10:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
13/08/2024 10:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
13/08/2024 11:00:00			-0.01	0.00	0.13	0.15	0.08	0.56						
13/08/2024 11:15:00			-0.01	0.00	0.13	0.15	0.08	0.56	0.01					
13/08/2024 11:30:00			-0.01	0.00	0.13	0.15	0.08	0.56	0.01					
13/08/2024 11:45:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.01					
13/08/2024 12:00:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.01					
13/08/2024 12:15:00			-0.01	0.00	0.13	0.15	0.08	0.57	0.01					
13/08/2024 12:30:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 12:45:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 13:00:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 13:15:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 13:30:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 13:45:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 14:00:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 14:15:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 14:30:00			-0.01	0.00	0.14	0.14	0.08	0.55	0.01					
13/08/2024 14:45:00			-0.01	0.00	0.14	0.14	0.08	0.55	0.01					
13/08/2024 15:00:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.01					
13/08/2024 15:15:00			-0.02	0.00	0.13	0.14	0.08	0.55	0.01					
13/08/2024 15:30:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.01					
13/08/2024 15:45:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.01					
13/08/2024 16:00:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.01					
13/08/2024 16:15:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.01					
13/08/2024 16:30:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.01					
13/08/2024 16:45:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.44					
13/08/2024 17:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
13/08/2024 17:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
13/08/2024 17:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
13/08/2024 17:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
13/08/2024 18:00:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.05					
13/08/2024 18:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
13/08/2024 18:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
13/08/2024 18:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
13/08/2024 19:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
13/08/2024 19:15:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.03					
13/08/2024 19:30:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.02					
13/08/2024 19:45:00			-0.01	0.00	0.13	0.14	0.08	0.57	0.01					
13/08/2024 20:00:00			-0.01	0.00	0.13	0.14	0.08	0.57						
13/08/2024 20:15:00			-0.01	0.00	0.13	0.14	0.08	0.57						
13/08/2024 20:30:00			-0.01	0.00	0.13	0.14	0.08	0.57	0.01					
13/08/2024 20:45:00			-0.01	0.00	0.13	0.14	0.08	0.57	0.02					
13/08/2024 21:00:00			-0.01	0.00	0.13	0.14	0.08	0.57	0.00					
13/08/2024 21:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
13/08/2024 21:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
13/08/2024 21:45:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.01					
13/08/2024 22:00:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.02					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
13/08/2024 22:15:00			-0.01	0.00	0.14	0.14	0.08	0.56						
13/08/2024 22:30:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 22:45:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 23:00:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 23:15:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 23:30:00			-0.01	0.00	0.14	0.15	0.08	0.56	0.01					
13/08/2024 23:45:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.01					
14/08/2024 00:00:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.01					
14/08/2024 00:15:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.01					
14/08/2024 00:30:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.01					
14/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.01					
14/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.08	0.55	0.18					
14/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.08	0.54						
14/08/2024 01:30:00			-0.01	0.00	0.13	0.15	0.08	0.54						
14/08/2024 01:45:00			-0.01	0.00	0.13	0.15	0.08	0.54						
14/08/2024 02:00:00			-0.01	0.00	0.13	0.15	0.08	0.54						
14/08/2024 02:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
14/08/2024 02:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
14/08/2024 02:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
14/08/2024 03:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
14/08/2024 03:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
14/08/2024 03:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
14/08/2024 03:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
14/08/2024 04:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
14/08/2024 04:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
14/08/2024 04:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
14/08/2024 04:45:00			-0.01	0.00	0.13	0.14	0.08	0.53						
14/08/2024 05:00:00			-0.01	0.00	0.13	0.14	0.07	0.53						
14/08/2024 05:15:00			-0.01	0.00	0.13	0.14	0.07	0.53						
14/08/2024 05:30:00			-0.01	0.00	0.13	0.14	0.07	0.53						
14/08/2024 05:45:00			-0.01	0.00	0.13	0.14	0.07	0.53						
14/08/2024 06:00:00			-0.01	0.00	0.13	0.14	0.07	0.53						
14/08/2024 06:15:00			-0.01	0.00	0.13	0.14	0.07	0.53						
14/08/2024 06:30:00			-0.01	0.00	0.12	0.14	0.07	0.53						
14/08/2024 06:45:00			-0.01	0.00	0.12	0.14	0.07	0.53						
14/08/2024 07:00:00			-0.01	0.00	0.12	0.14	0.07	0.53						
14/08/2024 07:15:00			-0.01	0.00	0.12	0.14	0.07	0.53						
14/08/2024 07:30:00			-0.01	0.00	0.12	0.14	0.07	0.54						
14/08/2024 07:45:00			-0.01	0.00	0.12	0.14	0.07	0.54						
14/08/2024 08:00:00			-0.01	0.00	0.12	0.14	0.07	0.54						
14/08/2024 08:15:00			-0.01	0.00	0.12	0.14	0.07	0.54						
14/08/2024 08:30:00			-0.01	0.00	0.12	0.14	0.07	0.55						
14/08/2024 08:45:00			-0.01	0.00	0.12	0.14	0.07	0.55						
14/08/2024 09:00:00			-0.01	0.00	0.12	0.14	0.07	0.55						
14/08/2024 09:15:00			-0.02	0.00	0.12	0.14	0.07	0.55						
14/08/2024 09:30:00			-0.02	0.00	0.12	0.14	0.07	0.55						
14/08/2024 09:45:00			-0.02	0.00	0.12	0.14	0.07	0.55						
14/08/2024 10:00:00			-0.01	0.00	0.13	0.14	0.07	0.55						
14/08/2024 10:15:00			-0.02	0.00	0.13	0.14	0.07	0.55						
14/08/2024 10:30:00			-0.01	0.00	0.13	0.14	0.07	0.55						
14/08/2024 10:45:00			-0.01	0.00	0.13	0.14	0.07	0.55						
14/08/2024 11:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 11:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 11:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 11:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 12:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 12:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 12:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 12:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 13:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 13:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 13:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 13:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 14:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 14:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 14:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 14:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 15:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 15:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 15:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 15:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 16:00:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.02					
14/08/2024 16:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 16:30:00			-0.01	0.00	0.13	0.14	0.08	0.55	-0.01					
14/08/2024 16:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 17:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 17:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 17:30:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.02					
14/08/2024 17:45:00			-0.01	0.00	0.13	0.14	0.08	0.55	0.02					
14/08/2024 18:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 18:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 18:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 18:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
14/08/2024 19:00:00			-0.01	0.00	0.13	0.14	0.08	0.56	0.08					
14/08/2024 19:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 19:30:00			-0.01	0.00	0.13	0.14	0.08	0.57						
14/08/2024 19:45:00			-0.01	0.00	0.13	0.14	0.08	0.57						
14/08/2024 20:00:00			-0.01	0.00	0.13	0.14	0.08	0.57						
14/08/2024 20:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 20:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 20:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 21:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 21:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 21:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 21:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 22:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 22:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
14/08/2024 22:30:00			-0.01	0.00	0.14	0.14	0.08	0.56						
14/08/2024 22:45:00			-0.01	0.00	0.14	0.15	0.08	0.56						
14/08/2024 23:00:00			-0.01	0.00	0.14	0.15	0.08	0.56						
14/08/2024 23:15:00			-0.01	0.00	0.14	0.15	0.08	0.55						
14/08/2024 23:30:00			-0.01	0.00	0.14	0.15	0.08	0.55						
14/08/2024 23:45:00			-0.01	0.00	0.14	0.15	0.08	0.55						
15/08/2024 00:00:00			-0.01	0.00	0.14	0.15	0.08	0.55						
15/08/2024 00:15:00			-0.01	0.00	0.14	0.15	0.08	0.55						
15/08/2024 00:30:00			-0.01	0.00	0.14	0.15	0.08	0.55						
15/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.08	0.54						
15/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.08	0.54						
15/08/2024 01:15:00			-0.01	0.00	0.13	0.15	0.08	0.54						
15/08/2024 01:30:00			-0.01	0.00	0.13	0.15	0.08	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
15/08/2024 01:45:00			-0.01	0.00	0.13	0.15	0.08	0.54						
15/08/2024 02:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
15/08/2024 02:15:00			-0.01	0.00	0.13	0.14	0.08	0.53						
15/08/2024 02:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
15/08/2024 02:45:00			-0.01	0.00	0.13	0.14	0.08	0.53						
15/08/2024 03:00:00			-0.01	0.00	0.13	0.14	0.08	0.53						
15/08/2024 03:15:00			-0.01	0.00	0.13	0.14	0.08	0.53						
15/08/2024 03:30:00			-0.02	0.00	0.13	0.14	0.08	0.53						
15/08/2024 03:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
15/08/2024 04:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
15/08/2024 04:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
15/08/2024 04:30:00			-0.01	0.00	0.13	0.14	0.07	0.53						
15/08/2024 04:45:00			-0.01	0.00	0.13	0.14	0.07	0.53						
15/08/2024 05:00:00			-0.01	0.00	0.13	0.14	0.07	0.53						
15/08/2024 05:15:00			-0.01	0.00	0.13	0.14	0.07	0.53						
15/08/2024 05:30:00			-0.01	0.00	0.13	0.14	0.07	0.53						
15/08/2024 05:45:00			-0.01	0.00	0.12	0.14	0.07	0.53						
15/08/2024 06:00:00			-0.01	0.00	0.12	0.14	0.07	0.53						
15/08/2024 06:15:00			-0.01	0.00	0.12	0.14	0.07	0.53						
15/08/2024 06:30:00			-0.01	0.00	0.12	0.14	0.07	0.53						
15/08/2024 06:45:00			-0.01	0.00	0.12	0.14	0.07	0.53						
15/08/2024 07:00:00			-0.01	0.00	0.12	0.14	0.07	0.53						
15/08/2024 07:15:00			-0.01	0.00	0.12	0.14	0.07	0.53						
15/08/2024 07:30:00			-0.01	0.00	0.12	0.14	0.07	0.53						
15/08/2024 07:45:00			-0.02	0.00	0.12	0.14	0.07	0.54						
15/08/2024 08:00:00			-0.02	0.00	0.12	0.14	0.07	0.54						
15/08/2024 08:15:00			-0.02	0.00	0.12	0.14	0.07	0.54						
15/08/2024 08:30:00			-0.02	0.00	0.12	0.14	0.07	0.55						
15/08/2024 08:45:00			-0.02	0.00	0.12	0.14	0.07	0.55						
15/08/2024 09:00:00			-0.01	0.00	0.12	0.14	0.07	0.55						
15/08/2024 09:15:00			-0.01	0.00	0.12	0.14	0.07	0.55						
15/08/2024 09:30:00			-0.01	0.00	0.12	0.14	0.07	0.55						
15/08/2024 09:45:00			-0.02	0.00	0.12	0.14	0.07	0.56						
15/08/2024 10:00:00			-0.02	0.00	0.13	0.14	0.07	0.56						
15/08/2024 10:15:00			-0.02	0.00	0.13	0.14	0.07	0.56						
15/08/2024 10:30:00			-0.02	0.00	0.13	0.14	0.07	0.56						
15/08/2024 10:45:00			-0.02	0.00	0.13	0.14	0.08	0.56						
15/08/2024 11:00:00			-0.02	0.00	0.13	0.14	0.08	0.56						
15/08/2024 11:15:00			-0.02	0.00	0.13	0.14	0.08	0.56						
15/08/2024 11:30:00			-0.02	0.00	0.13	0.14	0.08	0.56						
15/08/2024 11:45:00			-0.02	0.00	0.13	0.14	0.08	0.56						
15/08/2024 12:00:00			-0.02	0.00	0.13	0.14	0.08	0.56						
15/08/2024 12:15:00			-0.02	0.00	0.13	0.14	0.08	0.56						
15/08/2024 12:30:00			-0.02	0.00	0.13	0.14	0.08	0.56						
15/08/2024 12:45:00			-0.02	0.00	0.13	0.14	0.08	0.55						
15/08/2024 13:00:00			-0.02	0.00	0.13	0.15	0.08	0.55						
15/08/2024 13:15:00			-0.02	0.00	0.13	0.15	0.08	0.55						
15/08/2024 13:30:00			-0.01	0.00	0.13	0.15	0.08	0.55						
15/08/2024 13:45:00			-0.01	0.00	0.13	0.15	0.08	0.55						
15/08/2024 14:00:00			-0.01	0.00	0.13	0.15	0.08	0.55						
15/08/2024 14:15:00			-0.01	0.00	0.13	0.15	0.08	0.55						
15/08/2024 14:30:00			-0.01	0.00	0.13	0.15	0.08	0.55						
15/08/2024 14:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 15:00:00			-0.02	0.00	0.13	0.14	0.08	0.55						
15/08/2024 15:15:00			-0.02	0.00	0.13	0.14	0.08	0.55						
15/08/2024 15:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 15:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 16:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 16:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 16:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 16:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 17:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 17:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 17:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 17:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 18:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 18:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
15/08/2024 18:30:00			-0.01	0.00	0.13	0.14	0.07	0.55						
15/08/2024 18:45:00			-0.01	0.00	0.13	0.14	0.07	0.55						
15/08/2024 19:00:00			-0.01	0.00	0.13	0.14	0.07	0.55						
15/08/2024 19:15:00			-0.01	0.00	0.13	0.14	0.07	0.56						
15/08/2024 19:30:00			-0.01	0.00	0.13	0.14	0.07	0.56						
15/08/2024 19:45:00			-0.01	0.00	0.13	0.14	0.07	0.56						
15/08/2024 20:00:00			-0.01	0.00	0.13	0.14	0.08	0.57						
15/08/2024 20:15:00			-0.01	0.00	0.13	0.14	0.08	0.57						
15/08/2024 20:30:00			-0.01	0.00	0.13	0.14	0.08	0.57						
15/08/2024 20:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
15/08/2024 21:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
15/08/2024 21:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
15/08/2024 21:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
15/08/2024 21:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
15/08/2024 22:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
15/08/2024 22:15:00			-0.01	0.00	0.13	0.14	0.08	0.57						
15/08/2024 22:30:00			-0.01	0.00	0.13	0.14	0.08	0.57						
15/08/2024 22:45:00			-0.01	0.00	0.14	0.14	0.08	0.57						
15/08/2024 23:00:00			-0.01	0.00	0.14	0.15	0.08	0.57						
15/08/2024 23:15:00			-0.01	0.00	0.14	0.15	0.08	0.57						
15/08/2024 23:30:00			-0.01	0.00	0.14	0.15	0.08	0.57						
15/08/2024 23:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
16/08/2024 00:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
16/08/2024 00:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
16/08/2024 00:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
16/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.09	0.55						
16/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.09	0.55						
16/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.09	0.55						
16/08/2024 01:30:00			-0.01	0.00	0.14	0.15	0.09	0.55						
16/08/2024 01:45:00			-0.01	0.00	0.14	0.15	0.09	0.55						
16/08/2024 02:00:00			-0.01	0.00	0.14	0.15	0.08	0.54						
16/08/2024 02:15:00			-0.01	0.00	0.14	0.15	0.08	0.54						
16/08/2024 02:30:00			-0.01	0.00	0.14	0.15	0.08	0.54						
16/08/2024 02:45:00			-0.01	0.00	0.14	0.15	0.08	0.54						
16/08/2024 03:00:00			-0.01	0.00	0.14	0.15	0.08	0.54						
16/08/2024 03:15:00			-0.01	0.00	0.13	0.15	0.08	0.54						
16/08/2024 03:30:00			-0.01	0.00	0.13	0.15	0.08	0.54						
16/08/2024 03:45:00			-0.01	0.00	0.13	0.15	0.08	0.54						
16/08/2024 04:00:00			-0.01	0.00	0.13	0.15	0.08	0.54						
16/08/2024 04:15:00			-0.01	0.00	0.13	0.15	0.08	0.55						
16/08/2024 04:30:00			-0.01	0.00	0.13	0.15	0.08	0.55						
16/08/2024 04:45:00			0.00	0.00	0.13	0.15	0.08	0.56						
16/08/2024 05:00:00			0.00	0.00	0.13	0.14	0.08	0.56						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
16/08/2024 05:15:00			0.00	0.00	0.13	0.14	0.08	0.57						
16/08/2024 05:30:00			0.00	0.00	0.13	0.14	0.08	0.58						
16/08/2024 05:45:00			0.00	0.00	0.13	0.15	0.08	0.58						
16/08/2024 06:00:00			0.00	0.00	0.13	0.15	0.08	0.59						
16/08/2024 06:15:00			0.00	0.00	0.13	0.15	0.08	0.59						
16/08/2024 06:30:00			0.00	0.00	0.13	0.15	0.08	0.59						
16/08/2024 06:45:00			0.00	0.00	0.14	0.15	0.08	0.59						
16/08/2024 07:00:00			-0.01	0.00	0.14	0.15	0.09	0.58						
16/08/2024 07:15:00			-0.01	0.00	0.14	0.15	0.09	0.58						
16/08/2024 07:30:00			-0.01	0.00	0.14	0.15	0.09	0.58						
16/08/2024 07:45:00			-0.01	0.00	0.15	0.15	0.09	0.58						
16/08/2024 08:00:00			-0.01	0.00	0.15	0.16	0.10	0.58						
16/08/2024 08:15:00			-0.01	0.00	0.15	0.16	0.10	0.58						
16/08/2024 08:30:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 08:45:00			0.00	0.00	0.15	0.16	0.10	0.57						
16/08/2024 09:00:00			0.00	0.00	0.15	0.16	0.10	0.57						
16/08/2024 09:15:00			0.00	0.00	0.15	0.16	0.10	0.57						
16/08/2024 09:30:00			0.00	0.00	0.15	0.16	0.10	0.57						
16/08/2024 09:45:00			0.00	0.00	0.15	0.16	0.10	0.57						
16/08/2024 10:00:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 10:15:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 10:30:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 10:45:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 11:00:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 11:15:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 11:30:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 11:45:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 12:00:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 12:15:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 12:30:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 12:45:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 13:00:00			-0.01	0.00	0.15	0.16	0.10	0.58						
16/08/2024 13:15:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 13:30:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 13:45:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 14:00:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 14:15:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 14:30:00			-0.01	0.00	0.15	0.16	0.10	0.57						
16/08/2024 14:45:00			-0.01	0.00	0.15	0.16	0.10	0.56						
16/08/2024 15:00:00			-0.01	0.00	0.15	0.16	0.10	0.56						
16/08/2024 15:15:00			0.00	0.00	0.15	0.16	0.10	0.56						
16/08/2024 15:30:00			0.00	0.00	0.15	0.16	0.10	0.56						
16/08/2024 15:45:00			0.00	0.00	0.15	0.16	0.10	0.56						
16/08/2024 16:00:00			0.00	0.00	0.15	0.16	0.09	0.56						
16/08/2024 16:15:00			0.00	0.00	0.15	0.16	0.09	0.56						
16/08/2024 16:30:00			-0.01	0.00	0.15	0.16	0.09	0.56						
16/08/2024 16:45:00			-0.01	0.00	0.15	0.16	0.09	0.56						
16/08/2024 17:00:00			-0.01	0.00	0.15	0.16	0.09	0.56						
16/08/2024 17:15:00			-0.01	0.00	0.15	0.16	0.09	0.56						
16/08/2024 17:30:00			-0.01	0.00	0.15	0.16	0.09	0.56						
16/08/2024 17:45:00			-0.01	0.00	0.15	0.16	0.09	0.56						
16/08/2024 18:00:00			-0.01	0.00	0.15	0.15	0.09	0.57						
16/08/2024 18:15:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 18:30:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 18:45:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 19:00:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 19:15:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 19:30:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 19:45:00			0.00	0.00	0.15	0.16	0.09	0.57						
16/08/2024 20:00:00			0.00	0.00	0.15	0.16	0.09	0.57						
16/08/2024 20:15:00			0.00	0.00	0.15	0.16	0.09	0.57						
16/08/2024 20:30:00			0.00	0.00	0.15	0.16	0.09	0.57						
16/08/2024 20:45:00			0.00	0.00	0.15	0.16	0.09	0.57						
16/08/2024 21:00:00			0.00	0.00	0.15	0.16	0.09	0.57						
16/08/2024 21:15:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 21:30:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 21:45:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 22:00:00			-0.01	0.00	0.15	0.16	0.09	0.56						
16/08/2024 22:15:00			-0.01	0.00	0.15	0.16	0.09	0.56						
16/08/2024 22:30:00			-0.01	0.00	0.15	0.16	0.09	0.56						
16/08/2024 22:45:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 23:00:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 23:15:00			-0.01	0.00	0.15	0.16	0.09	0.57						
16/08/2024 23:30:00			0.00	0.00	0.15	0.16	0.09	0.57						
16/08/2024 23:45:00			0.00	0.00	0.15	0.16	0.09	0.57						
17/08/2024 00:00:00			-0.01	0.00	0.15	0.16	0.09	0.57						
17/08/2024 00:15:00			-0.01	0.00	0.15	0.16	0.09	0.57						
17/08/2024 00:30:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 00:45:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 01:00:00			-0.01	0.00	0.15	0.16	0.10	0.56						
17/08/2024 01:15:00			-0.01	0.00	0.15	0.16	0.10	0.56						
17/08/2024 01:30:00			-0.01	0.00	0.15	0.16	0.10	0.55						
17/08/2024 01:45:00			-0.01	0.00	0.15	0.16	0.09	0.55						
17/08/2024 02:00:00			0.00	0.00	0.15	0.16	0.09	0.55						
17/08/2024 02:15:00			0.00	0.00	0.15	0.16	0.09	0.55						
17/08/2024 02:30:00			0.00	0.00	0.15	0.16	0.09	0.55						
17/08/2024 02:45:00			-0.01	0.00	0.15	0.16	0.09	0.55						
17/08/2024 03:00:00			0.00	0.00	0.14	0.16	0.09	0.55						
17/08/2024 03:15:00			0.00	0.00	0.14	0.16	0.09	0.54						
17/08/2024 03:30:00			0.00	0.00	0.14	0.16	0.09	0.54						
17/08/2024 03:45:00			0.00	0.00	0.14	0.15	0.09	0.54						
17/08/2024 04:00:00			0.00	0.00	0.14	0.15	0.09	0.54						
17/08/2024 04:15:00			0.00	0.00	0.14	0.15	0.09	0.54						
17/08/2024 04:30:00			0.00	0.00	0.14	0.15	0.09	0.54						
17/08/2024 04:45:00			0.00	0.00	0.14	0.15	0.09	0.54						
17/08/2024 05:00:00			-0.01	0.00	0.14	0.15	0.09	0.54						
17/08/2024 05:15:00			-0.01	0.00	0.14	0.15	0.08	0.54						
17/08/2024 05:30:00			-0.01	0.00	0.14	0.15	0.08	0.54						
17/08/2024 05:45:00			-0.01	0.00	0.14	0.15	0.08	0.54						
17/08/2024 06:00:00			-0.01	0.00	0.14	0.15	0.08	0.54						
17/08/2024 06:15:00			0.00	0.00	0.14	0.15	0.08	0.54						
17/08/2024 06:30:00			0.00	0.00	0.14	0.15	0.08	0.54						
17/08/2024 06:45:00			0.00	0.00	0.13	0.15	0.08	0.54						
17/08/2024 07:00:00			0.00	0.00	0.13	0.15	0.08	0.54						
17/08/2024 07:15:00			0.00	0.00	0.13	0.15	0.08	0.54						
17/08/2024 07:30:00			-0.01	0.00	0.13	0.15	0.08	0.54						
17/08/2024 07:45:00			-0.01	0.00	0.13	0.15	0.08	0.54						
17/08/2024 08:00:00			-0.01	0.00	0.13	0.15	0.08	0.54						
17/08/2024 08:15:00			-0.01	0.00	0.13	0.15	0.08	0.54						
17/08/2024 08:30:00			-0.01	0.00	0.13	0.15	0.08	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
17/08/2024 08:45:00			-0.01	0.00	0.13	0.15	0.08	0.55						
17/08/2024 09:00:00			-0.01	0.00	0.13	0.15	0.08	0.55						
17/08/2024 09:15:00			-0.01	0.00	0.13	0.15	0.08	0.56						
17/08/2024 09:30:00			-0.01	0.00	0.13	0.15	0.08	0.56						
17/08/2024 09:45:00			-0.01	0.00	0.13	0.15	0.08	0.56						
17/08/2024 10:00:00			-0.01	0.00	0.13	0.15	0.08	0.56						
17/08/2024 10:15:00			-0.01	0.00	0.13	0.15	0.08	0.56						
17/08/2024 10:30:00			-0.01	0.00	0.14	0.15	0.08	0.57						
17/08/2024 10:45:00			-0.01	0.00	0.14	0.15	0.08	0.57						
17/08/2024 11:00:00			-0.01	0.00	0.14	0.15	0.08	0.57						
17/08/2024 11:15:00			0.00	0.00	0.14	0.15	0.09	0.58						
17/08/2024 11:30:00			0.00	0.00	0.14	0.15	0.09	0.58						
17/08/2024 11:45:00			-0.01	0.00	0.14	0.15	0.09	0.57						
17/08/2024 12:00:00			-0.01	0.00	0.14	0.15	0.09	0.57						
17/08/2024 12:15:00			-0.01	0.00	0.14	0.15	0.09	0.57						
17/08/2024 12:30:00			-0.01	0.00	0.15	0.15	0.09	0.57						
17/08/2024 12:45:00			-0.01	0.00	0.15	0.16	0.09	0.57						
17/08/2024 13:00:00			-0.01	0.00	0.15	0.16	0.09	0.57						
17/08/2024 13:15:00			-0.01	0.00	0.15	0.16	0.09	0.57						
17/08/2024 13:30:00			-0.01	0.00	0.15	0.16	0.10	0.57						
17/08/2024 13:45:00			-0.01	0.00	0.15	0.16	0.10	0.57						
17/08/2024 14:00:00			-0.01	0.00	0.15	0.16	0.10	0.57						
17/08/2024 14:15:00			-0.01	0.00	0.15	0.16	0.10	0.57						
17/08/2024 14:30:00			-0.01	0.00	0.15	0.16	0.10	0.56						
17/08/2024 14:45:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 15:00:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 15:15:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 15:30:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 15:45:00			0.00	0.00	0.15	0.16	0.09	0.56						
17/08/2024 16:00:00			0.00	0.00	0.15	0.16	0.09	0.56						
17/08/2024 16:15:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 16:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
17/08/2024 16:45:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 17:00:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 17:15:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 17:30:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 17:45:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 18:00:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 18:15:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 18:30:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 18:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
17/08/2024 19:00:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 19:15:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 19:30:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 19:45:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 20:00:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 20:15:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 20:30:00			0.00	0.00	0.14	0.15	0.09	0.56						
17/08/2024 20:45:00			0.00	0.00	0.14	0.15	0.09	0.57						
17/08/2024 21:00:00			0.00	0.00	0.14	0.15	0.09	0.57						
17/08/2024 21:15:00			0.00	0.00	0.14	0.15	0.09	0.57						
17/08/2024 21:30:00			-0.01	0.00	0.14	0.15	0.09	0.57						
17/08/2024 21:45:00			-0.01	0.00	0.14	0.15	0.09	0.57						
17/08/2024 22:00:00			-0.01	0.00	0.14	0.15	0.09	0.57						
17/08/2024 22:15:00			-0.01	0.00	0.14	0.15	0.09	0.57						
17/08/2024 22:30:00			-0.01	0.00	0.15	0.16	0.09	0.57						
17/08/2024 22:45:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 23:00:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 23:15:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 23:30:00			-0.01	0.00	0.15	0.16	0.09	0.56						
17/08/2024 23:45:00			0.00	0.00	0.15	0.16	0.09	0.56						
18/08/2024 00:00:00			0.00	0.00	0.15	0.16	0.09	0.56						
18/08/2024 00:15:00			0.00	0.00	0.15	0.16	0.09	0.56						
18/08/2024 00:30:00			0.00	0.00	0.15	0.16	0.09	0.55						
18/08/2024 00:45:00			0.00	0.00	0.14	0.16	0.09	0.55						
18/08/2024 01:00:00			-0.01	0.00	0.14	0.16	0.09	0.55						
18/08/2024 01:15:00			-0.01	0.00	0.14	0.16	0.09	0.55						
18/08/2024 01:30:00			-0.01	0.00	0.14	0.16	0.09	0.55						
18/08/2024 01:45:00			-0.01	0.00	0.14	0.15	0.09	0.55						
18/08/2024 02:00:00			-0.01	0.00	0.14	0.15	0.09	0.55						
18/08/2024 02:15:00			-0.01	0.00	0.14	0.15	0.09	0.54						
18/08/2024 02:30:00			-0.01	0.00	0.14	0.15	0.09	0.54						
18/08/2024 02:45:00			0.00	0.00	0.14	0.15	0.09	0.54						
18/08/2024 03:00:00			0.00	0.00	0.14	0.15	0.09	0.54						
18/08/2024 03:15:00			-0.01	0.00	0.14	0.15	0.09	0.54						
18/08/2024 03:30:00			-0.01	0.00	0.14	0.15	0.09	0.54						
18/08/2024 03:45:00			-0.01	0.00	0.14	0.15	0.08	0.54						
18/08/2024 04:00:00			-0.01	0.00	0.14	0.15	0.08	0.54						
18/08/2024 04:15:00			-0.01	0.00	0.14	0.15	0.08	0.54						
18/08/2024 04:30:00			0.00	0.00	0.14	0.15	0.08	0.54						
18/08/2024 04:45:00			0.00	0.00	0.13	0.15	0.08	0.53						
18/08/2024 05:00:00			0.00	0.00	0.13	0.15	0.08	0.53						
18/08/2024 05:15:00			0.00	0.00	0.13	0.15	0.08	0.53						
18/08/2024 05:30:00			0.00	0.00	0.13	0.15	0.08	0.53						
18/08/2024 05:45:00			0.00	0.00	0.13	0.15	0.08	0.53						
18/08/2024 06:00:00			0.00	0.00	0.13	0.15	0.08	0.53						
18/08/2024 06:15:00			0.00	0.00	0.13	0.15	0.08	0.53						
18/08/2024 06:30:00			0.00	0.00	0.13	0.15	0.08	0.53						
18/08/2024 06:45:00			0.00	0.00	0.13	0.15	0.08	0.53						
18/08/2024 07:00:00			-0.01	0.00	0.13	0.15	0.08	0.53						
18/08/2024 07:15:00			-0.01	0.00	0.13	0.14	0.08	0.53						
18/08/2024 07:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
18/08/2024 07:45:00			-0.01	0.00	0.13	0.14	0.08	0.53						
18/08/2024 08:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
18/08/2024 08:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
18/08/2024 08:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
18/08/2024 08:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
18/08/2024 09:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
18/08/2024 09:15:00			0.00	0.00	0.13	0.14	0.08	0.55						
18/08/2024 09:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
18/08/2024 09:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
18/08/2024 10:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
18/08/2024 10:15:00			0.00	0.00	0.13	0.14	0.08	0.56						
18/08/2024 10:30:00			0.00	0.00	0.13	0.14	0.08	0.57						
18/08/2024 10:45:00			0.00	0.00	0.13	0.14	0.08	0.57						
18/08/2024 11:00:00			-0.01	0.00	0.13	0.14	0.08	0.57						
18/08/2024 11:15:00			-0.01	0.00	0.13	0.15	0.08	0.57						
18/08/2024 11:30:00			-0.01	0.00	0.13	0.15	0.08	0.57						
18/08/2024 11:45:00			-0.01	0.00	0.14	0.15	0.08	0.57						
18/08/2024 12:00:00			-0.01	0.00	0.14	0.15	0.09	0.57						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
18/08/2024 12:15:00			-0.01	0.00	0.14	0.15	0.09	0.57						
18/08/2024 12:30:00			-0.01	0.00	0.14	0.15	0.09	0.57						
18/08/2024 12:45:00			-0.01	0.00	0.14	0.15	0.09	0.57						
18/08/2024 13:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 13:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 13:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 13:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 14:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 14:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 14:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 14:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 15:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 15:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 15:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 15:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 16:00:00			0.00	0.00	0.14	0.15	0.09	0.56						
18/08/2024 16:15:00			0.00	0.00	0.14	0.15	0.09	0.55						
18/08/2024 16:30:00			0.00	0.00	0.14	0.15	0.09	0.55						
18/08/2024 16:45:00			0.00	0.00	0.14	0.15	0.09	0.55						
18/08/2024 17:00:00			0.00	0.00	0.14	0.15	0.09	0.55						
18/08/2024 17:15:00			0.00	0.00	0.14	0.15	0.09	0.55						
18/08/2024 17:30:00			0.00	0.00	0.14	0.15	0.09	0.55						
18/08/2024 17:45:00			0.00	0.00	0.14	0.15	0.09	0.55						
18/08/2024 18:00:00			0.00	0.00	0.14	0.15	0.09	0.55						
18/08/2024 18:15:00			0.00	0.00	0.14	0.15	0.08	0.55						
18/08/2024 18:30:00			0.00	0.00	0.14	0.15	0.08	0.55						
18/08/2024 18:45:00			0.00	0.00	0.14	0.15	0.08	0.55						
18/08/2024 19:00:00			0.00	0.00	0.14	0.15	0.08	0.55						
18/08/2024 19:15:00			0.00	0.00	0.14	0.15	0.08	0.56						
18/08/2024 19:30:00			0.00	0.00	0.14	0.15	0.08	0.56						
18/08/2024 19:45:00			0.00	0.00	0.14	0.15	0.08	0.56						
18/08/2024 20:00:00			0.00	0.00	0.14	0.15	0.08	0.56						
18/08/2024 20:15:00			0.00	0.00	0.14	0.15	0.08	0.56						
18/08/2024 20:30:00			0.00	0.00	0.14	0.15	0.08	0.57						
18/08/2024 20:45:00			0.00	0.00	0.14	0.15	0.08	0.57						
18/08/2024 21:00:00			0.00	0.00	0.14	0.15	0.08	0.57						
18/08/2024 21:15:00			0.00	0.00	0.14	0.15	0.08	0.57						
18/08/2024 21:30:00			0.00	0.00	0.14	0.15	0.09	0.57						
18/08/2024 21:45:00			0.00	0.00	0.14	0.15	0.09	0.56						
18/08/2024 22:00:00			0.00	0.00	0.14	0.15	0.09	0.56						
18/08/2024 22:15:00			0.00	0.00	0.14	0.15	0.09	0.56						
18/08/2024 22:30:00			0.00	0.00	0.14	0.15	0.09	0.56						
18/08/2024 22:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
18/08/2024 23:00:00			0.00	0.00	0.14	0.15	0.09	0.56						
18/08/2024 23:15:00			0.00	0.00	0.14	0.15	0.09	0.55						
18/08/2024 23:30:00			0.00	0.00	0.14	0.15	0.09	0.55						
18/08/2024 23:45:00			0.00	0.00	0.14	0.15	0.09	0.55						
19/08/2024 00:00:00			0.00	0.00	0.14	0.15	0.09	0.55						
19/08/2024 00:15:00			0.00	0.00	0.14	0.15	0.09	0.55						
19/08/2024 00:30:00			-0.01	0.00	0.14	0.15	0.09	0.55						
19/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.09	0.54						
19/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.09	0.54						
19/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.09	0.54						
19/08/2024 01:30:00			-0.01	0.00	0.14	0.15	0.09	0.54						
19/08/2024 01:45:00			-0.01	0.00	0.14	0.15	0.09	0.54						
19/08/2024 02:00:00			-0.01	0.00	0.14	0.15	0.08	0.54						
19/08/2024 02:15:00			-0.01	0.00	0.14	0.15	0.08	0.53						
19/08/2024 02:30:00			-0.01	0.00	0.14	0.15	0.08	0.53						
19/08/2024 02:45:00			-0.01	0.00	0.14	0.15	0.08	0.53						
19/08/2024 03:00:00			-0.01	0.00	0.13	0.15	0.08	0.53						
19/08/2024 03:15:00			-0.01	0.00	0.13	0.15	0.08	0.53						
19/08/2024 03:30:00			-0.01	0.00	0.13	0.15	0.08	0.53						
19/08/2024 03:45:00			-0.01	0.00	0.13	0.15	0.08	0.53						
19/08/2024 04:00:00			-0.01	0.00	0.13	0.15	0.08	0.53						
19/08/2024 04:15:00			-0.01	0.00	0.13	0.14	0.08	0.53						
19/08/2024 04:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
19/08/2024 04:45:00			-0.01	0.00	0.13	0.14	0.08	0.53						
19/08/2024 05:00:00			-0.01	0.00	0.13	0.14	0.08	0.52						
19/08/2024 05:15:00			-0.01	0.00	0.13	0.14	0.08	0.52						
19/08/2024 05:30:00			-0.01	0.00	0.13	0.14	0.08	0.52						
19/08/2024 05:45:00			-0.01	0.00	0.13	0.14	0.08	0.52						
19/08/2024 06:00:00			-0.01	0.00	0.13	0.14	0.07	0.52						
19/08/2024 06:15:00			-0.01	0.00	0.13	0.14	0.07	0.52						
19/08/2024 06:30:00			-0.01	0.00	0.13	0.14	0.07	0.52						
19/08/2024 06:45:00			-0.01	0.00	0.13	0.14	0.07	0.52						
19/08/2024 07:00:00			-0.01	0.00	0.13	0.14	0.07	0.53						
19/08/2024 07:15:00			-0.01	0.00	0.12	0.14	0.07	0.53						
19/08/2024 07:30:00			-0.01	0.00	0.12	0.14	0.07	0.53						
19/08/2024 07:45:00			-0.02	0.00	0.12	0.14	0.07	0.53						
19/08/2024 08:00:00			-0.01	0.00	0.12	0.14	0.07	0.54						
19/08/2024 08:15:00			-0.01	0.00	0.12	0.14	0.07	0.54						
19/08/2024 08:30:00			-0.01	0.00	0.12	0.14	0.07	0.54						
19/08/2024 08:45:00			-0.01	0.00	0.12	0.14	0.07	0.54						
19/08/2024 09:00:00			-0.01	0.00	0.13	0.14	0.07	0.55						
19/08/2024 09:15:00			-0.01	0.00	0.13	0.14	0.07	0.55						
19/08/2024 09:30:00			-0.01	0.00	0.13	0.14	0.07	0.56						
19/08/2024 09:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
19/08/2024 10:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
19/08/2024 10:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
19/08/2024 10:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
19/08/2024 10:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
19/08/2024 11:00:00			-0.01	0.00	0.13	0.15	0.08	0.56						
19/08/2024 11:15:00			-0.01	0.00	0.14	0.15	0.08	0.56						
19/08/2024 11:30:00			-0.01	0.00	0.14	0.15	0.08	0.56						
19/08/2024 11:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 12:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 12:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 12:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 12:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 13:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 13:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 13:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 13:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 14:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 14:15:00			-0.01	0.00	0.14	0.15	0.09	0.55						
19/08/2024 14:30:00			-0.01	0.00	0.14	0.15	0.09	0.55						
19/08/2024 14:45:00			-0.01	0.00	0.14	0.15	0.09	0.55						
19/08/2024 15:00:00			-0.01	0.00	0.14	0.15	0.09	0.55						
19/08/2024 15:15:00			-0.01	0.00	0.14	0.15	0.09	0.55						
19/08/2024 15:30:00			-0.01	0.00	0.14	0.15	0.09	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
19/08/2024 15:45:00			-0.01	0.00	0.14	0.15	0.09	0.55						
19/08/2024 16:00:00			-0.01	0.00	0.14	0.14	0.09	0.55						
19/08/2024 16:15:00			-0.01	0.00	0.14	0.14	0.09	0.55						
19/08/2024 16:30:00			-0.01	0.00	0.14	0.15	0.09	0.55						
19/08/2024 16:45:00			-0.01	0.00	0.14	0.14	0.09	0.55						
19/08/2024 17:00:00			-0.01	0.00	0.14	0.15	0.09	0.55						
19/08/2024 17:15:00			-0.01	0.00	0.14	0.14	0.09	0.55						
19/08/2024 17:30:00			-0.01	0.00	0.14	0.14	0.08	0.55						
19/08/2024 17:45:00			-0.01	0.00	0.14	0.14	0.08	0.55						
19/08/2024 18:00:00			-0.01	0.00	0.14	0.14	0.08	0.55						
19/08/2024 18:15:00			-0.01	0.00	0.14	0.14	0.08	0.55						
19/08/2024 18:30:00			-0.01	0.00	0.14	0.14	0.08	0.55						
19/08/2024 18:45:00			-0.01	0.00	0.14	0.14	0.08	0.55						
19/08/2024 19:00:00			-0.01	0.00	0.14	0.14	0.08	0.55						
19/08/2024 19:15:00			-0.01	0.00	0.14	0.14	0.08	0.55						
19/08/2024 19:30:00			-0.01	0.00	0.14	0.14	0.08	0.56						
19/08/2024 19:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
19/08/2024 20:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
19/08/2024 20:15:00			-0.01	0.00	0.14	0.14	0.08	0.56						
19/08/2024 20:30:00			-0.01	0.00	0.14	0.14	0.08	0.57						
19/08/2024 20:45:00			-0.01	0.00	0.14	0.14	0.08	0.57						
19/08/2024 21:00:00			-0.01	0.00	0.14	0.14	0.08	0.57						
19/08/2024 21:15:00			-0.01	0.00	0.14	0.14	0.08	0.56						
19/08/2024 21:30:00			-0.01	0.00	0.14	0.15	0.08	0.57						
19/08/2024 21:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 22:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 22:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 22:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 22:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 23:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 23:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 23:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
19/08/2024 23:45:00			-0.01	0.00	0.14	0.15	0.09	0.55						
20/08/2024 00:00:00			-0.01	0.00	0.14	0.15	0.09	0.51						
20/08/2024 00:15:00			-0.01	0.00	0.14	0.15	0.09	0.54						
20/08/2024 00:30:00			-0.01	0.00	0.14	0.15	0.09	0.55						
20/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.09	0.55						
20/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.09	0.55						
20/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.09	0.55						
20/08/2024 01:30:00			-0.01	0.00	0.14	0.15	0.09	0.54						
20/08/2024 01:45:00			-0.01	0.00	0.14	0.15	0.09	0.54						
20/08/2024 02:00:00			-0.01	0.00	0.14	0.15	0.09	0.54						
20/08/2024 02:15:00			-0.01	0.00	0.14	0.15	0.09	0.54						
20/08/2024 02:30:00			-0.01	0.00	0.14	0.15	0.08	0.54						
20/08/2024 02:45:00			-0.01	0.00	0.14	0.15	0.08	0.54						
20/08/2024 03:00:00			-0.01	0.00	0.14	0.15	0.08	0.54						
20/08/2024 03:15:00			-0.01	0.00	0.14	0.15	0.08	0.53						
20/08/2024 03:30:00			-0.01	0.00	0.14	0.15	0.08	0.53						
20/08/2024 03:45:00			-0.01	0.00	0.13	0.15	0.08	0.53						
20/08/2024 04:00:00			-0.01	0.00	0.13	0.15	0.08	0.53						
20/08/2024 04:15:00			-0.01	0.00	0.13	0.15	0.08	0.54						
20/08/2024 04:30:00			-0.01	0.00	0.13	0.15	0.08	0.54						
20/08/2024 04:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 05:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 05:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 05:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 05:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 06:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 06:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 06:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
20/08/2024 06:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 07:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 07:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 07:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 07:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 08:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 08:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
20/08/2024 08:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
20/08/2024 08:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
20/08/2024 09:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
20/08/2024 09:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
20/08/2024 09:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
20/08/2024 09:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
20/08/2024 10:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
20/08/2024 10:15:00			-0.02	0.00	0.13	0.14	0.08	0.56						
20/08/2024 10:30:00			-0.02	0.00	0.13	0.14	0.08	0.56						
20/08/2024 10:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
20/08/2024 11:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
20/08/2024 11:15:00			-0.02	0.00	0.13	0.14	0.08	0.56						
20/08/2024 11:30:00			-0.02	0.00	0.14	0.14	0.08	0.56						
20/08/2024 11:45:00			-0.02	0.00	0.14	0.15	0.08	0.56						
20/08/2024 12:00:00			-0.01	0.00	0.14	0.15	0.08	0.56						
20/08/2024 12:15:00			-0.01	0.00	0.14	0.15	0.08	0.56						
20/08/2024 12:30:00			-0.01	0.00	0.14	0.15	0.08	0.56						
20/08/2024 12:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
20/08/2024 13:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
20/08/2024 13:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
20/08/2024 13:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
20/08/2024 13:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
20/08/2024 14:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
20/08/2024 14:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
20/08/2024 14:30:00			-0.01	0.00	0.14	0.15	0.08	0.56						
20/08/2024 14:45:00			-0.01	0.00	0.14	0.15	0.08	0.56						
20/08/2024 15:00:00			-0.01	0.00	0.14	0.15	0.08	0.56						
20/08/2024 15:15:00			-0.01	0.00	0.14	0.15	0.08	0.55						
20/08/2024 15:30:00			-0.01	0.00	0.14	0.15	0.08	0.55						
20/08/2024 15:45:00			0.00	0.00	0.14	0.15	0.08	0.55						
20/08/2024 16:00:00			0.00	0.00	0.14	0.15	0.08	0.55						
20/08/2024 16:15:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 16:30:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 16:45:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 17:00:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 17:15:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 17:30:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 17:45:00			-0.01	0.00	0.13	0.15	0.08	0.56						
20/08/2024 18:00:00			-0.01	0.00	0.13	0.15	0.08	0.56						
20/08/2024 18:15:00			-0.01	0.00	0.13	0.15	0.08	0.56						
20/08/2024 18:30:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 18:45:00			-0.01	0.00	0.13	0.15	0.08	0.56						
20/08/2024 19:00:00			-0.01	0.00	0.13	0.15	0.08	0.56						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
20/08/2024 19:15:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 19:30:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 19:45:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 20:00:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 20:15:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 20:30:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 20:45:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 21:00:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 21:15:00			0.00	0.00	0.13	0.15	0.08	0.56						
20/08/2024 21:30:00			-0.01	0.00	0.14	0.15	0.08	0.56						
20/08/2024 21:45:00			-0.01	0.00	0.14	0.15	0.08	0.56						
20/08/2024 22:00:00			-0.01	0.00	0.14	0.15	0.08	0.56						
20/08/2024 22:15:00			-0.01	0.00	0.14	0.15	0.08	0.56						
20/08/2024 22:30:00			-0.01	0.00	0.14	0.15	0.08	0.55						
20/08/2024 22:45:00			-0.01	0.00	0.14	0.15	0.08	0.55						
20/08/2024 23:00:00			0.00	0.00	0.14	0.15	0.08	0.55						
20/08/2024 23:15:00			0.00	0.00	0.14	0.15	0.08	0.55						
20/08/2024 23:30:00			0.00	0.00	0.14	0.15	0.08	0.55						
20/08/2024 23:45:00			-0.01	0.00	0.14	0.15	0.08	0.55						
21/08/2024 00:00:00			-0.01	0.00	0.14	0.15	0.08	0.55						
21/08/2024 00:15:00			-0.01	0.00	0.14	0.15	0.08	0.54						
21/08/2024 00:30:00			-0.01	0.00	0.14	0.15	0.08	0.54						
21/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.08	0.54						
21/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.08	0.54						
21/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.08	0.53						
21/08/2024 01:30:00			-0.01	0.00	0.13	0.15	0.08	0.53						
21/08/2024 01:45:00			-0.01	0.00	0.13	0.15	0.08	0.53						
21/08/2024 02:00:00			-0.01	0.00	0.13	0.14	0.08	0.53						
21/08/2024 02:15:00			-0.01	0.00	0.13	0.14	0.08	0.53						
21/08/2024 02:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
21/08/2024 02:45:00			-0.01	0.00	0.13	0.14	0.08	0.53						
21/08/2024 03:00:00			-0.01	0.00	0.13	0.14	0.08	0.53						
21/08/2024 03:15:00			-0.01	0.00	0.13	0.14	0.08	0.52						
21/08/2024 03:30:00			-0.01	0.00	0.13	0.14	0.08	0.52						
21/08/2024 03:45:00			-0.01	0.00	0.13	0.14	0.08	0.52						
21/08/2024 04:00:00			-0.01	0.00	0.13	0.14	0.08	0.52						
21/08/2024 04:15:00			-0.01	0.00	0.13	0.14	0.08	0.52						
21/08/2024 04:30:00			-0.01	0.00	0.13	0.14	0.07	0.52						
21/08/2024 04:45:00			-0.01	0.00	0.13	0.14	0.07	0.52						
21/08/2024 05:00:00			-0.01	0.00	0.13	0.14	0.07	0.52						
21/08/2024 05:15:00			-0.01	0.00	0.12	0.14	0.07	0.52						
21/08/2024 05:30:00			-0.01	0.00	0.12	0.14	0.07	0.53						
21/08/2024 05:45:00			-0.01	0.00	0.12	0.14	0.07	0.52						
21/08/2024 06:00:00			-0.01	0.00	0.12	0.14	0.07	0.52						
21/08/2024 06:15:00			-0.01	0.00	0.12	0.14	0.07	0.52						
21/08/2024 06:30:00			-0.01	0.00	0.12	0.14	0.07	0.52						
21/08/2024 06:45:00			-0.01	0.00	0.12	0.14	0.07	0.52						
21/08/2024 07:00:00			-0.01	0.00	0.12	0.14	0.07	0.52						
21/08/2024 07:15:00			-0.01	0.00	0.12	0.14	0.07	0.52						
21/08/2024 07:30:00			-0.01	0.00	0.12	0.14	0.07	0.53						
21/08/2024 07:45:00			-0.01	0.00	0.12	0.14	0.07	0.53						
21/08/2024 08:00:00			-0.01	0.00	0.12	0.14	0.07	0.53						
21/08/2024 08:15:00			-0.01	0.00	0.12	0.14	0.07	0.53						
21/08/2024 08:30:00			-0.01	0.00	0.12	0.14	0.07	0.54						
21/08/2024 08:45:00			-0.01	0.00	0.12	0.14	0.07	0.54						
21/08/2024 09:00:00			-0.01	0.00	0.12	0.14	0.07	0.54						
21/08/2024 09:15:00			-0.01	0.00	0.12	0.14	0.07	0.54						
21/08/2024 09:30:00			-0.01	0.00	0.12	0.14	0.07	0.54						
21/08/2024 09:45:00			-0.01	0.00	0.12	0.14	0.07	0.54						
21/08/2024 10:00:00			-0.01	0.00	0.12	0.14	0.07	0.55						
21/08/2024 10:15:00			-0.01	0.00	0.13	0.14	0.07	0.55						
21/08/2024 10:30:00			-0.01	0.00	0.13	0.14	0.07	0.55						
21/08/2024 10:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 11:00:00			-0.02	0.00	0.13	0.14	0.08	0.55						
21/08/2024 11:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 11:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 11:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 12:00:00			-0.01	0.00	0.13	0.14	0.08	0.56						
21/08/2024 12:15:00			-0.01	0.00	0.13	0.14	0.08	0.56						
21/08/2024 12:30:00			-0.01	0.00	0.13	0.14	0.08	0.56						
21/08/2024 12:45:00			-0.01	0.00	0.13	0.14	0.08	0.56						
21/08/2024 13:00:00			-0.01	0.00	0.14	0.14	0.08	0.55						
21/08/2024 13:15:00			-0.01	0.00	0.14	0.14	0.08	0.55						
21/08/2024 13:30:00			-0.01	0.00	0.14	0.14	0.08	0.55						
21/08/2024 13:45:00			-0.01	0.00	0.14	0.14	0.08	0.55						
21/08/2024 14:00:00			-0.01	0.00	0.14	0.14	0.09	0.55						
21/08/2024 14:15:00			-0.01	0.00	0.14	0.15	0.09	0.55						
21/08/2024 14:30:00			-0.02	0.00	0.14	0.15	0.09	0.55						
21/08/2024 14:45:00			-0.01	0.00	0.14	0.15	0.09	0.55						
21/08/2024 15:00:00			-0.01	0.00	0.14	0.14	0.08	0.54						
21/08/2024 15:15:00			-0.01	0.00	0.14	0.15	0.08	0.54						
21/08/2024 15:30:00			-0.01	0.00	0.14	0.14	0.08	0.54						
21/08/2024 15:45:00			-0.01	0.00	0.14	0.14	0.08	0.54						
21/08/2024 16:00:00			-0.01	0.00	0.14	0.14	0.08	0.54						
21/08/2024 16:15:00			-0.01	0.00	0.14	0.14	0.08	0.54						
21/08/2024 16:30:00			-0.01	0.00	0.14	0.14	0.08	0.54						
21/08/2024 16:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
21/08/2024 17:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
21/08/2024 17:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
21/08/2024 17:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
21/08/2024 17:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
21/08/2024 18:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
21/08/2024 18:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
21/08/2024 18:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 18:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 19:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 19:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 19:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 19:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 20:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 20:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 20:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 20:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 21:00:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 21:15:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 21:30:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 21:45:00			-0.01	0.00	0.13	0.14	0.08	0.55						
21/08/2024 22:00:00			-0.01	0.00	0.13	0.15	0.08	0.55						
21/08/2024 22:15:00			-0.01	0.00	0.14	0.15	0.08	0.55						
21/08/2024 22:30:00			-0.01	0.00	0.14	0.15	0.08	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
21/08/2024 22:45:00			-0.01	0.00	0.14	0.14	0.08	0.55						
21/08/2024 23:00:00			-0.01	0.00	0.14	0.15	0.08	0.55						
21/08/2024 23:15:00			-0.01	0.00	0.14	0.15	0.08	0.56						
21/08/2024 23:30:00			-0.01	0.00	0.14	0.15	0.08	0.56						
21/08/2024 23:45:00			-0.02	0.00	0.14	0.15	0.08	0.56						
22/08/2024 00:00:00			-0.02	0.00	0.14	0.15	0.08	0.55						
22/08/2024 00:15:00			-0.02	0.00	0.14	0.15	0.08	0.55						
22/08/2024 00:30:00			-0.02	0.00	0.14	0.15	0.08	0.55						
22/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.09	0.55						
22/08/2024 01:00:00			-0.02	0.00	0.14	0.15	0.09	0.54						
22/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.09	0.54						
22/08/2024 01:30:00			-0.01	0.00	0.14	0.15	0.09	0.54						
22/08/2024 01:45:00			-0.02	0.00	0.14	0.15	0.08	0.54						
22/08/2024 02:00:00			-0.02	0.00	0.14	0.14	0.08	0.54						
22/08/2024 02:15:00			-0.01	0.00	0.14	0.14	0.08	0.53						
22/08/2024 02:30:00			-0.02	0.00	0.14	0.14	0.08	0.53						
22/08/2024 02:45:00			-0.01	0.00	0.14	0.14	0.08	0.53						
22/08/2024 03:00:00			-0.02	0.00	0.13	0.14	0.08	0.53						
22/08/2024 03:15:00			-0.02	0.00	0.13	0.14	0.08	0.53						
22/08/2024 03:30:00			-0.02	0.00	0.13	0.14	0.08	0.53						
22/08/2024 03:45:00			-0.02	0.00	0.13	0.14	0.08	0.53						
22/08/2024 04:00:00			-0.02	0.00	0.13	0.14	0.08	0.53						
22/08/2024 04:15:00			-0.02	0.00	0.13	0.14	0.08	0.53						
22/08/2024 04:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
22/08/2024 04:45:00			-0.01	0.00	0.13	0.14	0.08	0.53						
22/08/2024 05:00:00			-0.01	0.00	0.13	0.14	0.08	0.53						
22/08/2024 05:15:00			-0.01	0.00	0.13	0.14	0.08	0.53						
22/08/2024 05:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
22/08/2024 05:45:00			-0.02	0.00	0.13	0.14	0.07	0.53						
22/08/2024 06:00:00			-0.01	0.00	0.13	0.14	0.07	0.53						
22/08/2024 06:15:00			-0.01	0.00	0.13	0.14	0.07	0.53						
22/08/2024 06:30:00			-0.02	0.00	0.12	0.14	0.07	0.53						
22/08/2024 06:45:00			-0.01	0.00	0.12	0.14	0.07	0.53						
22/08/2024 07:00:00			-0.01	0.00	0.12	0.14	0.07	0.53						
22/08/2024 07:15:00			-0.01	0.00	0.12	0.14	0.07	0.53						
22/08/2024 07:30:00			-0.01	0.00	0.12	0.14	0.07	0.53						
22/08/2024 07:45:00			-0.01	0.00	0.12	0.14	0.07	0.54						
22/08/2024 08:00:00			-0.01	0.00	0.12	0.14	0.07	0.54						
22/08/2024 08:15:00			-0.01	0.00	0.12	0.14	0.07	0.54						
22/08/2024 08:30:00			-0.01	0.00	0.12	0.14	0.07	0.55						
22/08/2024 08:45:00			-0.01	0.00	0.12	0.14	0.07	0.55						
22/08/2024 09:00:00			-0.01	0.00	0.13	0.14	0.07	0.56						
22/08/2024 09:15:00			-0.01	0.00	0.13	0.14	0.07	0.57						
22/08/2024 09:30:00			-0.02	0.00	0.13	0.14	0.07	0.57						
22/08/2024 09:45:00			-0.02	0.00	0.13	0.14	0.08	0.57						
22/08/2024 10:00:00			-0.01	0.00	0.13	0.14	0.08	0.57						
22/08/2024 10:15:00			-0.02	0.00	0.13	0.14	0.08	0.57						
22/08/2024 10:30:00			-0.02	0.00	0.13	0.14	0.08	0.57						
22/08/2024 10:45:00			-0.02	0.00	0.14	0.14	0.08	0.57						
22/08/2024 11:00:00			-0.02	0.00	0.14	0.15	0.08	0.57						
22/08/2024 11:15:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 11:30:00			-0.02	0.00	0.14	0.15	0.09	0.57						
22/08/2024 11:45:00			-0.02	0.00	0.14	0.15	0.09	0.57						
22/08/2024 12:00:00			-0.02	0.00	0.14	0.15	0.09	0.57						
22/08/2024 12:15:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 12:30:00			-0.01	0.00	0.15	0.15	0.09	0.56						
22/08/2024 12:45:00			-0.01	0.00	0.15	0.15	0.09	0.56						
22/08/2024 13:00:00			-0.01	0.00	0.15	0.15	0.09	0.57						
22/08/2024 13:15:00			-0.01	0.00	0.15	0.15	0.09	0.57						
22/08/2024 13:30:00			-0.01	0.00	0.15	0.15	0.09	0.57						
22/08/2024 13:45:00			-0.01	0.00	0.15	0.15	0.09	0.57						
22/08/2024 14:00:00			-0.01	0.00	0.15	0.15	0.09	0.56						
22/08/2024 14:15:00			-0.01	0.00	0.15	0.15	0.09	0.56						
22/08/2024 14:30:00			-0.01	0.00	0.15	0.15	0.09	0.56						
22/08/2024 14:45:00			-0.01	0.00	0.15	0.15	0.09	0.56						
22/08/2024 15:00:00			-0.01	0.00	0.15	0.15	0.09	0.56						
22/08/2024 15:15:00			-0.01	0.00	0.15	0.15	0.09	0.56						
22/08/2024 15:30:00			-0.01	0.00	0.15	0.15	0.09	0.56						
22/08/2024 15:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 16:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 16:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 16:30:00			-0.01	0.00	0.14	0.13	0.09	0.56						
22/08/2024 16:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 17:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 17:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 17:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 17:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 18:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 18:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 18:30:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 18:45:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 19:00:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 19:15:00			-0.01	0.00	0.14	0.15	0.09	0.56						
22/08/2024 19:30:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 19:45:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 20:00:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 20:15:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 20:30:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 20:45:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 21:00:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 21:15:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 21:30:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 21:45:00			-0.01	0.00	0.14	0.15	0.09	0.57						
22/08/2024 22:00:00			-0.01	0.00	0.15	0.15	0.09	0.57						
22/08/2024 22:15:00			-0.01	0.00	0.15	0.15	0.09	0.57						
22/08/2024 22:30:00			-0.01	0.00	0.15	0.15	0.09	0.57						
22/08/2024 22:45:00			-0.01	0.00	0.15	0.15	0.10	0.57						
22/08/2024 23:00:00			-0.01	0.00	0.15	0.15	0.10	0.57						
22/08/2024 23:15:00			-0.01	0.00	0.15	0.15	0.10	0.56						
22/08/2024 23:30:00			-0.01	0.00	0.15	0.15	0.10	0.56						
22/08/2024 23:45:00			-0.01	0.00	0.15	0.15	0.10	0.56						
23/08/2024 00:00:00			-0.01	0.00	0.15	0.15	0.10	0.56						
23/08/2024 00:15:00			-0.01	0.00	0.15	0.15	0.10	0.56						
23/08/2024 00:30:00			-0.01	0.00	0.15	0.15	0.09	0.56						
23/08/2024 00:45:00			-0.01	0.00	0.15	0.15	0.09	0.56						
23/08/2024 01:00:00			-0.01	0.00	0.15	0.15	0.09	0.52						
23/08/2024 01:15:00			-0.01	0.00	0.15	0.15	0.09	0.52						
23/08/2024 01:30:00			-0.01	0.00	0.15	0.15	0.09	0.52						
23/08/2024 01:45:00			-0.01	0.00	0.15	0.15	0.09	0.52						
23/08/2024 02:00:00			-0.01	0.00	0.15	0.15	0.09	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
23/08/2024 02:15:00			-0.01	0.00	0.15	0.15	0.09	0.52						
23/08/2024 02:30:00			-0.01	0.00	0.14	0.15	0.09	0.52						
23/08/2024 02:45:00			-0.01	0.00	0.14	0.15	0.09	0.52						
23/08/2024 03:00:00			-0.01	0.00	0.14	0.15	0.09	0.51						
23/08/2024 03:15:00			-0.01	0.00	0.14	0.15	0.09	0.51						
23/08/2024 03:30:00			-0.01	0.00	0.14	0.15	0.09	0.50						
23/08/2024 03:45:00			-0.02	0.00	0.14	0.15	0.09	0.51						
23/08/2024 04:00:00			-0.01	0.00	0.14	0.15	0.09	0.49						
23/08/2024 04:15:00			-0.01	0.00	0.14	0.15	0.09	0.49						
23/08/2024 04:30:00			-0.01	0.00	0.14	0.15	0.09	0.47						
23/08/2024 04:45:00			-0.01	0.00	0.14	0.15	0.09	0.50						
23/08/2024 05:00:00			-0.01	0.00	0.14	0.15	0.08	0.51						
23/08/2024 05:15:00			-0.01	0.00	0.14	0.15	0.08	0.51						
23/08/2024 05:30:00			-0.01	0.00	0.14	0.15	0.08	0.51						
23/08/2024 05:45:00			-0.01	0.00	0.14	0.15	0.08	0.51						
23/08/2024 06:00:00			-0.01	0.00	0.13	0.15	0.08	0.51						
23/08/2024 06:15:00			-0.01	0.00	0.13	0.15	0.08	0.51						
23/08/2024 06:30:00			-0.01	0.00	0.13	0.15	0.08	0.51						
23/08/2024 06:45:00			-0.01	0.00	0.13	0.15	0.08	0.51						
23/08/2024 07:00:00			-0.01	0.00	0.13	0.15	0.08	0.52						
23/08/2024 07:15:00			-0.01	0.00	0.13	0.15	0.08	0.52						
23/08/2024 07:30:00			-0.01	0.00	0.13	0.15	0.08	0.52						
23/08/2024 07:45:00			-0.01	0.00	0.13	0.15	0.08	0.52						
23/08/2024 08:00:00			-0.01	0.00	0.13	0.15	0.08	0.52						
23/08/2024 08:15:00			-0.01	0.00	0.13	0.15	0.08	0.53						
23/08/2024 08:30:00			-0.01	0.00	0.13	0.15	0.08	0.53						
23/08/2024 08:45:00			-0.01	0.00	0.13	0.14	0.08	0.53						
23/08/2024 09:00:00			-0.01	0.00	0.13	0.14	0.08	0.53						
23/08/2024 09:15:00			0.00	0.00	0.13	0.14	0.08	0.54						
23/08/2024 09:30:00			-0.01	0.00	0.13	0.15	0.08	0.54						
23/08/2024 09:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
23/08/2024 10:00:00			0.00	0.00	0.13	0.15	0.08	0.54						
23/08/2024 10:15:00			0.00	0.00	0.13	0.15	0.08	0.54						
23/08/2024 10:30:00			0.00	0.00	0.13	0.15	0.08	0.55						
23/08/2024 10:45:00			0.00	0.00	0.13	0.15	0.08	0.55						
23/08/2024 11:00:00			-0.01	0.00	0.14	0.15	0.08	0.55						
23/08/2024 11:15:00			-0.01	0.00	0.14	0.15	0.08	0.54						
23/08/2024 11:30:00			-0.01	0.00	0.14	0.15	0.09	0.54						
23/08/2024 11:45:00			-0.01	0.00	0.14	0.15	0.09	0.54						
23/08/2024 12:00:00			-0.01	0.00	0.14	0.15	0.09	0.54						
23/08/2024 12:15:00			-0.01	0.00	0.14	0.15	0.09	0.54						
23/08/2024 12:30:00			-0.01	0.00	0.14	0.15	0.09	0.54						
23/08/2024 12:45:00			-0.01	0.00	0.14	0.15	0.09	0.54						
23/08/2024 13:00:00			-0.01	0.00	0.14	0.15	0.09	0.54						
23/08/2024 13:15:00			-0.01	0.00	0.14	0.15	0.09	0.53						
23/08/2024 13:30:00			-0.01	0.00	0.14	0.15	0.09	0.53						
23/08/2024 13:45:00			-0.01	0.00	0.14	0.15	0.09	0.53						
23/08/2024 14:00:00			-0.01	0.00	0.14	0.15	0.09	0.53						
23/08/2024 14:15:00			-0.01	0.00	0.14	0.15	0.09	0.53						
23/08/2024 14:30:00			-0.01	0.00	0.14	0.15	0.09	0.53						
23/08/2024 14:45:00			-0.01	0.00	0.14	0.15	0.09	0.52						
23/08/2024 15:00:00			-0.01	0.00	0.14	0.15	0.09	0.53						
23/08/2024 15:15:00			-0.01	0.00	0.14	0.15	0.09	0.53						
23/08/2024 15:30:00			-0.01	0.00	0.14	0.15	0.09	0.53						
23/08/2024 15:45:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 16:00:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 16:15:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 16:30:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 16:45:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 17:00:00			-0.01	0.00	0.14	0.15	0.08	0.52						
23/08/2024 17:15:00			-0.01	0.00	0.14	0.15	0.08	0.52						
23/08/2024 17:30:00			-0.01	0.00	0.13	0.15	0.08	0.52						
23/08/2024 17:45:00			-0.01	0.00	0.13	0.14	0.08	0.52						
23/08/2024 18:00:00			-0.01	0.00	0.13	0.14	0.08	0.52						
23/08/2024 18:15:00			-0.01	0.00	0.13	0.14	0.08	0.52						
23/08/2024 18:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
23/08/2024 18:45:00			-0.01	0.00	0.13	0.14	0.08	0.53						
23/08/2024 19:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
23/08/2024 19:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
23/08/2024 19:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
23/08/2024 19:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
23/08/2024 20:00:00			-0.01	0.00	0.13	0.14	0.08	0.53						
23/08/2024 20:15:00			-0.01	0.00	0.13	0.14	0.08	0.53						
23/08/2024 20:30:00			-0.01	0.00	0.13	0.14	0.08	0.53						
23/08/2024 20:45:00			-0.01	0.00	0.13	0.14	0.08	0.53						
23/08/2024 21:00:00			-0.01	0.00	0.14	0.14	0.08	0.53						
23/08/2024 21:15:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 21:30:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 21:45:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 22:00:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 22:15:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 22:30:00			-0.02	0.00	0.14	0.15	0.08	0.53						
23/08/2024 22:45:00			-0.02	0.00	0.14	0.15	0.08	0.53						
23/08/2024 23:00:00			-0.02	0.00	0.14	0.15	0.08	0.53						
23/08/2024 23:15:00			-0.01	0.00	0.14	0.15	0.08	0.53						
23/08/2024 23:30:00			-0.02	0.00	0.14	0.15	0.08	0.53						
23/08/2024 23:45:00			-0.02	0.00	0.14	0.15	0.08	0.53						
24/08/2024 00:00:00			-0.01	0.00	0.14	0.15	0.08	0.53						
24/08/2024 00:15:00			-0.02	0.00	0.14	0.15	0.08	0.52						
24/08/2024 00:30:00			-0.01	0.00	0.14	0.15	0.08	0.52						
24/08/2024 00:45:00			-0.01	0.00	0.14	0.15	0.08	0.52						
24/08/2024 01:00:00			-0.01	0.00	0.14	0.15	0.08	0.52						
24/08/2024 01:15:00			-0.01	0.00	0.14	0.15	0.08	0.52						
24/08/2024 01:30:00			-0.01	0.00	0.14	0.15	0.08	0.52						
24/08/2024 01:45:00			-0.02	0.00	0.14	0.15	0.08	0.52						
24/08/2024 02:00:00			-0.02	0.00	0.13	0.15	0.08	0.51						
24/08/2024 02:15:00			-0.01	0.00	0.13	0.15	0.08	0.51						
24/08/2024 02:30:00			-0.01	0.00	0.13	0.15	0.08	0.51						
24/08/2024 02:45:00			-0.01	0.00	0.13	0.15	0.08	0.51						
24/08/2024 03:00:00			-0.02	0.00	0.13	0.14	0.08	0.51						
24/08/2024 03:15:00			-0.02	0.00	0.13	0.14	0.08	0.51						
24/08/2024 03:30:00			-0.01	0.00	0.13	0.14	0.08	0.51						
24/08/2024 03:45:00			-0.01	0.00	0.13	0.14	0.08	0.50						
24/08/2024 04:00:00			-0.01	0.00	0.13	0.14	0.08	0.51						
24/08/2024 04:15:00			-0.02	0.00	0.13	0.14	0.08	0.51						
24/08/2024 04:30:00			-0.02	0.00	0.13	0.14	0.08	0.50						
24/08/2024 04:45:00			-0.02	0.00	0.13	0.14	0.08	0.51						
24/08/2024 05:00:00			-0.02	0.00	0.13	0.14	0.08	0.51						
24/08/2024 05:15:00			-0.02	0.00	0.13	0.14	0.08	0.51						
24/08/2024 05:30:00			-0.01	0.00	0.13	0.14	0.08	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
24/08/2024 05:45:00			-0.02	0.00	0.13	0.14	0.07	0.52						
24/08/2024 06:00:00			-0.01	0.00	0.13	0.14	0.07	0.53						
24/08/2024 06:15:00			-0.01	0.00	0.13	0.14	0.07	0.53						
24/08/2024 06:30:00			-0.02	0.00	0.13	0.14	0.07	0.54						
24/08/2024 06:45:00			-0.01	0.00	0.13	0.14	0.07	0.54						
24/08/2024 07:00:00			-0.01	0.00	0.13	0.14	0.07	0.54						
24/08/2024 07:15:00			-0.01	0.00	0.13	0.14	0.08	0.54						
24/08/2024 07:30:00			-0.01	0.00	0.13	0.14	0.08	0.54						
24/08/2024 07:45:00			-0.01	0.00	0.13	0.14	0.08	0.54						
24/08/2024 08:00:00			-0.01	0.00	0.13	0.14	0.08	0.54						
24/08/2024 08:15:00			-0.02	0.00	0.13	0.14	0.08	0.54						
24/08/2024 08:30:00			-0.01	0.00	0.13	0.15	0.08	0.54						
24/08/2024 08:45:00			-0.01	0.00	0.14	0.15	0.08	0.54						
24/08/2024 09:00:00			-0.02	0.00	0.14	0.15	0.08	0.54						
24/08/2024 09:15:00			-0.02	0.00	0.14	0.15	0.09	0.54						
24/08/2024 09:30:00			-0.02	0.00	0.14	0.15	0.09	0.54						
24/08/2024 09:45:00			-0.01	0.00	0.14	0.15	0.09	0.54						
24/08/2024 10:00:00			-0.02	0.00	0.14	0.15	0.09	0.55						
24/08/2024 10:15:00			-0.02	0.00	0.14	0.15	0.09	0.55						
24/08/2024 10:30:00			-0.02	0.00	0.14	0.15	0.09	0.55						
24/08/2024 10:45:00			-0.01	0.00	0.14	0.15	0.09	0.55						
24/08/2024 11:00:00			-0.02	0.00	0.15	0.15	0.09	0.55						
24/08/2024 11:15:00			-0.01	0.00	0.15	0.15	0.09	0.56						
24/08/2024 11:30:00			-0.02	0.00	0.15	0.16	0.09	0.56						
24/08/2024 11:45:00			-0.01	0.00	0.15	0.16	0.10	0.57						
24/08/2024 12:00:00			-0.01	0.00	0.15	0.16	0.10	0.58						
24/08/2024 12:15:00			-0.01	0.00	0.15	0.16	0.10	0.59						
24/08/2024 12:30:00			-0.01	0.00	0.15	0.16	0.10	0.59						
24/08/2024 12:45:00			-0.01	0.00	0.16	0.16	0.10	0.60						
24/08/2024 13:00:00			-0.01	0.00	0.16	0.16	0.11	0.60						
24/08/2024 13:15:00			-0.01	0.00	0.16	0.16	0.11	0.60						
24/08/2024 13:30:00			-0.01	0.00	0.17	0.17	0.11	0.60						
24/08/2024 13:45:00			0.00	0.00	0.17	0.17	0.12	0.60						
24/08/2024 14:00:00			0.00	0.00	0.17	0.17	0.12	0.61						
24/08/2024 14:15:00			0.00	0.00	0.18	0.17	0.13	0.61						
24/08/2024 14:30:00			0.00	0.00	0.18	0.17	0.13	0.61						
24/08/2024 14:45:00			0.00	0.00	0.18	0.18	0.13	0.61						
24/08/2024 15:00:00			0.01	0.00	0.19	0.17	0.14	0.61						
24/08/2024 15:15:00			0.00	0.00	0.19	0.18	0.14	0.61						
24/08/2024 15:30:00			0.01	0.00	0.19	0.18	0.14	0.61						
24/08/2024 15:45:00			0.01	0.00	0.20	0.18	0.14	0.61						
24/08/2024 16:00:00			0.01	0.00	0.20	0.18	0.15	0.59						
24/08/2024 16:15:00			0.01	0.00	0.20	0.18	0.15	0.59						
24/08/2024 16:30:00			0.01	0.00	0.20	0.18	0.15	0.59						
24/08/2024 16:45:00			0.01	0.00	0.20	0.18	0.15	0.59						
24/08/2024 17:00:00			0.01	0.00	0.20	0.19	0.15	0.58						
24/08/2024 17:15:00			0.02	0.00	0.20	0.19	0.15	0.58						
24/08/2024 17:30:00			0.02	0.00	0.20	0.19	0.15	0.58						
24/08/2024 17:45:00			0.02	0.00	0.21	0.19	0.16	0.58						
24/08/2024 18:00:00			0.02	0.01	0.21	0.19	0.16	0.59						
24/08/2024 18:15:00			0.02	0.01	0.21	0.19	0.16	0.59						
24/08/2024 18:30:00			0.02	0.00	0.21	0.19	0.16	0.58						
24/08/2024 18:45:00			0.02	0.01	0.21	0.19	0.16	0.59						
24/08/2024 19:00:00			0.02	0.01	0.21	0.19	0.16	0.59						
24/08/2024 19:15:00			0.02	0.00	0.21	0.19	0.16	0.59						
24/08/2024 19:30:00			0.02	0.01	0.21	0.19	0.16	0.59						
24/08/2024 19:45:00			0.02	0.01	0.21	0.19	0.16	0.59						
24/08/2024 20:00:00			0.02	0.01	0.21	0.19	0.16	0.59						
24/08/2024 20:15:00			0.02	0.01	0.21	0.19	0.16	0.58						
24/08/2024 20:30:00			0.02	0.01	0.21	0.19	0.16	0.58						
24/08/2024 20:45:00			0.02	0.01	0.21	0.19	0.16	0.58						
24/08/2024 21:00:00			0.02	0.01	0.21	0.19	0.16	0.58						
24/08/2024 21:15:00			0.02	0.01	0.21	0.19	0.16	0.58						
24/08/2024 21:30:00			0.02	0.01	0.21	0.19	0.16	0.58						
24/08/2024 21:45:00			0.02	0.01	0.21	0.19	0.16	0.58						
24/08/2024 22:00:00			0.02	0.01	0.21	0.19	0.16	0.58						
24/08/2024 22:15:00			0.03	0.01	0.20	0.19	0.15	0.58						
24/08/2024 22:30:00			0.02	0.01	0.20	0.19	0.15	0.58						
24/08/2024 22:45:00			0.02	0.01	0.20	0.19	0.15	0.57						
24/08/2024 23:00:00			0.02	0.01	0.20	0.19	0.15	0.57						
24/08/2024 23:15:00			0.02	0.01	0.20	0.19	0.15	0.57						
24/08/2024 23:30:00			0.02	0.01	0.20	0.19	0.15	0.57						
24/08/2024 23:45:00			0.02	0.01	0.20	0.19	0.15	0.57						
25/08/2024 00:00:00			0.02	0.01	0.20	0.18	0.15	0.57						
25/08/2024 00:15:00			0.02	0.01	0.20	0.18	0.15	0.57						
25/08/2024 00:30:00			0.02	0.01	0.20	0.18	0.15	0.57						
25/08/2024 00:45:00			0.02	0.01	0.20	0.18	0.15	0.57						
25/08/2024 01:00:00			0.02	0.01	0.20	0.18	0.15	0.57						
25/08/2024 01:15:00			0.02	0.00	0.20	0.18	0.15	0.57						
25/08/2024 01:30:00			0.02	0.00	0.20	0.18	0.15	0.57						
25/08/2024 01:45:00			0.02	0.00	0.20	0.18	0.15	0.57						
25/08/2024 02:00:00			0.02	0.00	0.20	0.18	0.15	0.56						
25/08/2024 02:15:00			0.02	0.00	0.20	0.18	0.15	0.56						
25/08/2024 02:30:00			0.02	0.00	0.20	0.18	0.15	0.56						
25/08/2024 02:45:00			0.02	0.00	0.20	0.18	0.15	0.55						
25/08/2024 03:00:00			0.02	0.00	0.20	0.18	0.14	0.55						
25/08/2024 03:15:00			0.02	0.00	0.20	0.18	0.14	0.55						
25/08/2024 03:30:00			0.02	0.00	0.19	0.18	0.14	0.55						
25/08/2024 03:45:00			0.02	0.00	0.19	0.18	0.14	0.55						
25/08/2024 04:00:00			0.02	0.00	0.19	0.18	0.14	0.55						
25/08/2024 04:15:00			0.01	0.00	0.19	0.18	0.14	0.55						
25/08/2024 04:30:00			0.01	0.00	0.19	0.18	0.14	0.55						
25/08/2024 04:45:00			0.01	0.00	0.19	0.18	0.14	0.55						
25/08/2024 05:00:00			0.01	0.00	0.19	0.17	0.14	0.54						
25/08/2024 05:15:00			0.01	0.00	0.19	0.17	0.13	0.54						
25/08/2024 05:30:00			0.01	0.00	0.19	0.17	0.13	0.54						
25/08/2024 05:45:00			0.01	0.00	0.18	0.17	0.13	0.54						
25/08/2024 06:00:00			0.01	0.00	0.18	0.17	0.13	0.54						
25/08/2024 06:15:00			0.01	0.00	0.18	0.17	0.13	0.54						
25/08/2024 06:30:00			0.01	0.00	0.18	0.17	0.13	0.54						
25/08/2024 06:45:00			0.01	0.00	0.18	0.17	0.13	0.54						
25/08/2024 07:00:00			0.01	0.00	0.18	0.17	0.13	0.54						
25/08/2024 07:15:00			0.00	0.00	0.18	0.17	0.13	0.54						
25/08/2024 07:30:00			0.00	0.00	0.18	0.17	0.12	0.54						
25/08/2024 07:45:00			0.00	0.00	0.18	0.17	0.12	0.54						
25/08/2024 08:00:00			0.00	0.00	0.18	0.17	0.12	0.54						
25/08/2024 08:15:00			0.00	0.00	0.18	0.17	0.12	0.54						
25/08/2024 08:30:00			0.00	0.00	0.17	0.17	0.12	0.54						
25/08/2024 08:45:00			0.00	0.00	0.17	0.17	0.12	0.55						
25/08/2024 09:00:00			0.00	0.00	0.17	0.17	0.12	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
25/08/2024 09:15:00			0.00	0.00	0.17	0.17	0.12	0.55						
25/08/2024 09:30:00			0.00	0.00	0.17	0.17	0.12	0.56						
25/08/2024 09:45:00			0.00	0.00	0.17	0.17	0.12	0.56						
25/08/2024 10:00:00			0.00	0.00	0.17	0.17	0.12	0.56						
25/08/2024 10:15:00			0.00	0.00	0.17	0.17	0.12	0.56						
25/08/2024 10:30:00			0.00	0.00	0.17	0.17	0.12	0.56						
25/08/2024 10:45:00			0.00	0.00	0.18	0.17	0.12	0.56						
25/08/2024 11:00:00			0.00	0.00	0.18	0.17	0.12	0.56						
25/08/2024 11:15:00			0.00	0.00	0.18	0.17	0.12	0.56						
25/08/2024 11:30:00			0.00	0.00	0.18	0.17	0.12	0.56						
25/08/2024 11:45:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 12:00:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 12:15:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 12:30:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 12:45:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 13:00:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 13:15:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 13:30:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 13:45:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 14:00:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 14:15:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 14:30:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 14:45:00			0.00	0.00	0.18	0.17	0.13	0.56						
25/08/2024 15:00:00			0.00	0.00	0.18	0.17	0.13	0.55						
25/08/2024 15:15:00			0.00	0.00	0.18	0.17	0.13	0.55						
25/08/2024 15:30:00			0.00	0.00	0.18	0.17	0.13	0.55						
25/08/2024 15:45:00			0.00	0.00	0.18	0.17	0.13	0.55						
25/08/2024 16:00:00			0.00	0.00	0.18	0.17	0.13	0.55						
25/08/2024 16:15:00			0.00	0.00	0.18	0.17	0.13	0.55						
25/08/2024 16:30:00			0.00	0.00	0.18	0.17	0.12	0.55						
25/08/2024 16:45:00			0.00	0.00	0.18	0.17	0.12	0.55						
25/08/2024 17:00:00			0.00	0.00	0.18	0.17	0.12	0.54						
25/08/2024 17:15:00			0.00	0.00	0.18	0.17	0.12	0.54						
25/08/2024 17:30:00			0.00	0.00	0.18	0.17	0.12	0.54						
25/08/2024 17:45:00			0.00	0.00	0.17	0.17	0.12	0.54						
25/08/2024 18:00:00			0.00	0.00	0.17	0.17	0.12	0.54						
25/08/2024 18:15:00			0.00	0.00	0.17	0.17	0.12	0.54						
25/08/2024 18:30:00			0.00	0.00	0.17	0.17	0.12	0.54						
25/08/2024 18:45:00			0.00	0.00	0.17	0.17	0.12	0.54						
25/08/2024 19:00:00			0.00	0.00	0.17	0.16	0.12	0.54						
25/08/2024 19:15:00			0.00	0.00	0.17	0.16	0.12	0.54						
25/08/2024 19:30:00			0.00	0.00	0.17	0.16	0.12	0.55						
25/08/2024 19:45:00			0.00	0.00	0.17	0.16	0.12	0.55						
25/08/2024 20:00:00			0.00	0.00	0.17	0.16	0.12	0.55						
25/08/2024 20:15:00			0.00	0.00	0.17	0.16	0.11	0.55						
25/08/2024 20:30:00			0.00	0.00	0.17	0.16	0.11	0.55						
25/08/2024 20:45:00			0.00	0.00	0.17	0.16	0.11	0.55						
25/08/2024 21:00:00			0.00	0.00	0.17	0.16	0.12	0.55						
25/08/2024 21:15:00			0.00	0.00	0.17	0.16	0.12	0.55						
25/08/2024 21:30:00			0.00	0.00	0.17	0.16	0.12	0.55						
25/08/2024 21:45:00			0.00	0.00	0.17	0.16	0.12	0.55						
25/08/2024 22:00:00			0.00	0.00	0.17	0.16	0.12	0.55						
25/08/2024 22:15:00			0.00	0.00	0.17	0.16	0.12	0.54						
25/08/2024 22:30:00			0.00	0.00	0.17	0.16	0.12	0.54						
25/08/2024 22:45:00			0.00	0.00	0.17	0.16	0.12	0.54						
25/08/2024 23:00:00			0.00	0.00	0.17	0.16	0.12	0.54						
25/08/2024 23:15:00			0.00	0.00	0.17	0.16	0.12	0.54						
25/08/2024 23:30:00			0.00	0.00	0.17	0.16	0.12	0.54						
25/08/2024 23:45:00			0.00	0.00	0.17	0.16	0.12	0.54						
26/08/2024 00:00:00			0.00	0.00	0.17	0.16	0.11	0.54						
26/08/2024 00:15:00			0.00	0.00	0.17	0.16	0.11	0.53						
26/08/2024 00:30:00			0.00	0.00	0.17	0.16	0.11	0.53						
26/08/2024 00:45:00			0.00	0.00	0.17	0.16	0.11	0.53						
26/08/2024 01:00:00			0.00	0.00	0.17	0.16	0.11	0.53						
26/08/2024 01:15:00			0.00	0.00	0.17	0.16	0.11	0.53						
26/08/2024 01:30:00			0.00	0.00	0.16	0.16	0.11	0.53						
26/08/2024 01:45:00			0.00	0.00	0.16	0.16	0.11	0.53						
26/08/2024 02:00:00			0.00	0.00	0.16	0.16	0.11	0.52						
26/08/2024 02:15:00			0.00	0.00	0.16	0.16	0.11	0.52						
26/08/2024 02:30:00			0.00	0.00	0.16	0.16	0.11	0.52						
26/08/2024 02:45:00			0.00	0.00	0.16	0.16	0.11	0.52						
26/08/2024 03:00:00			0.00	0.00	0.16	0.16	0.11	0.52						
26/08/2024 03:15:00			0.00	0.00	0.16	0.16	0.10	0.52						
26/08/2024 03:30:00			0.00	0.00	0.16	0.16	0.10	0.52						
26/08/2024 03:45:00			-0.01	0.00	0.16	0.16	0.10	0.52						
26/08/2024 04:00:00			-0.01	0.00	0.16	0.16	0.10	0.52						
26/08/2024 04:15:00			-0.01	0.00	0.15	0.16	0.10	0.52						
26/08/2024 04:30:00			-0.01	0.00	0.15	0.16	0.10	0.52						
26/08/2024 04:45:00			-0.01	0.00	0.15	0.15	0.10	0.51						
26/08/2024 05:00:00			0.00	0.00	0.15	0.15	0.10	0.51						
26/08/2024 05:15:00			-0.01	0.00	0.15	0.15	0.10	0.51						
26/08/2024 05:30:00			-0.01	0.00	0.15	0.15	0.10	0.51						
26/08/2024 05:45:00			-0.01	0.00	0.15	0.15	0.10	0.51						
26/08/2024 06:00:00			-0.01	0.00	0.15	0.15	0.10	0.51						
26/08/2024 06:15:00			-0.01	0.00	0.15	0.15	0.09	0.51						
26/08/2024 06:30:00			-0.01	0.00	0.15	0.15	0.09	0.51						
26/08/2024 06:45:00			-0.01	0.00	0.15	0.15	0.09	0.51						
26/08/2024 07:00:00			-0.01	0.00	0.15	0.15	0.09	0.51						
26/08/2024 07:15:00			-0.01	0.00	0.15	0.15	0.09	0.51						
26/08/2024 07:30:00			-0.01	0.00	0.15	0.15	0.09	0.51						
26/08/2024 07:45:00			-0.01	0.00	0.15	0.15	0.09	0.51						
26/08/2024 08:00:00			-0.01	0.00	0.15	0.15	0.09	0.52						
26/08/2024 08:15:00			-0.01	0.00	0.14	0.15	0.09	0.52						
26/08/2024 08:30:00			-0.01	0.00	0.14	0.15	0.09	0.52						
26/08/2024 08:45:00			-0.01	0.00	0.14	0.15	0.09	0.52						
26/08/2024 09:00:00			-0.01	0.00	0.14	0.15	0.09	0.53						
26/08/2024 09:15:00			-0.01	0.00	0.14	0.15	0.09	0.53						
26/08/2024 09:30:00			-0.01	0.00	0.14	0.15	0.09	0.53						
26/08/2024 09:45:00			-0.01	0.00	0.14	0.15	0.09	0.54						
26/08/2024 10:00:00			-0.02	0.00	0.14	0.15	0.09	0.54						
26/08/2024 10:15:00			-0.01	0.00	0.15	0.15	0.09	0.55						
26/08/2024 10:30:00			-0.01	0.00	0.15	0.15	0.09	0.55						
26/08/2024 10:45:00			-0.01	0.00	0.15	0.15	0.09	0.55						
26/08/2024 11:00:00			-0.01	0.00	0.15	0.15	0.09	0.55						
26/08/2024 11:15:00			-0.01	0.00	0.15	0.15	0.10	0.55						
26/08/2024 11:30:00			-0.01	0.00	0.15	0.15	0.10	0.55						
26/08/2024 11:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 12:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 12:15:00			-0.01	0.00	0.16	0.15	0.10	0.54						
26/08/2024 12:30:00			-0.01	0.00	0.16	0.15	0.10	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
26/08/2024 12:45:00			-0.01	0.00	0.16	0.15	0.10	0.54						
26/08/2024 13:00:00			-0.01	0.00	0.16	0.16	0.10	0.54						
26/08/2024 13:15:00			-0.01	0.00	0.16	0.15	0.11	0.54						
26/08/2024 13:30:00			-0.01	0.00	0.16	0.16	0.10	0.54						
26/08/2024 13:45:00			-0.01	0.00	0.16	0.16	0.11	0.54						
26/08/2024 14:00:00			-0.01	0.00	0.16	0.16	0.10	0.54						
26/08/2024 14:15:00			-0.01	0.00	0.16	0.16	0.10	0.53						
26/08/2024 14:30:00			-0.01	0.00	0.16	0.16	0.10	0.53						
26/08/2024 14:45:00			-0.01	0.00	0.16	0.16	0.10	0.53						
26/08/2024 15:00:00			-0.01	0.00	0.16	0.16	0.10	0.53						
26/08/2024 15:15:00			-0.01	0.00	0.16	0.15	0.10	0.53						
26/08/2024 15:30:00			-0.01	0.00	0.16	0.16	0.10	0.53						
26/08/2024 15:45:00			-0.01	0.00	0.16	0.16	0.10	0.54						
26/08/2024 16:00:00			-0.01	0.00	0.16	0.15	0.10	0.54						
26/08/2024 16:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 16:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 16:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 17:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 17:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 17:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 17:45:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 18:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 18:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 18:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 18:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 19:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 19:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 19:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 19:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 20:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 20:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 20:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 20:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 21:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 21:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 21:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 21:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 22:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 22:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
26/08/2024 22:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 22:45:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 23:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 23:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 23:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
26/08/2024 23:45:00			-0.01	0.00	0.15	0.15	0.10	0.53						
27/08/2024 00:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
27/08/2024 00:15:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 00:30:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 00:45:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 01:00:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 01:15:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 01:30:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 01:45:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 02:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
27/08/2024 02:15:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 02:30:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 02:45:00			-0.01	0.00	0.15	0.15	0.09	0.52						
27/08/2024 03:00:00			-0.01	0.00	0.15	0.15	0.09	0.52						
27/08/2024 03:15:00			-0.01	0.00	0.15	0.15	0.09	0.51						
27/08/2024 03:30:00			-0.01	0.00	0.15	0.15	0.09	0.51						
27/08/2024 03:45:00			-0.01	0.00	0.15	0.15	0.09	0.51						
27/08/2024 04:00:00			-0.01	0.00	0.15	0.15	0.09	0.51						
27/08/2024 04:15:00			-0.01	0.00	0.15	0.15	0.09	0.51						
27/08/2024 04:30:00			-0.01	0.00	0.15	0.15	0.09	0.51						
27/08/2024 04:45:00			-0.01	0.00	0.15	0.15	0.09	0.51						
27/08/2024 05:00:00			-0.01	0.00	0.14	0.15	0.09	0.51						
27/08/2024 05:15:00			-0.01	0.00	0.14	0.15	0.09	0.51						
27/08/2024 05:30:00			-0.01	0.00	0.14	0.15	0.09	0.51						
27/08/2024 05:45:00			-0.01	0.00	0.14	0.15	0.09	0.51						
27/08/2024 06:00:00			-0.01	0.00	0.14	0.15	0.09	0.51						
27/08/2024 06:15:00			-0.01	0.00	0.14	0.15	0.09	0.51						
27/08/2024 06:30:00			-0.01	0.00	0.14	0.15	0.09	0.51						
27/08/2024 06:45:00			-0.01	0.00	0.14	0.15	0.09	0.51						
27/08/2024 07:00:00			-0.01	0.00	0.14	0.15	0.09	0.51						
27/08/2024 07:15:00			-0.02	0.00	0.14	0.15	0.09	0.51						
27/08/2024 07:30:00			-0.02	0.00	0.14	0.15	0.09	0.51						
27/08/2024 07:45:00			-0.02	0.00	0.14	0.15	0.08	0.51						
27/08/2024 08:00:00			-0.02	0.00	0.14	0.14	0.08	0.52						
27/08/2024 08:15:00			-0.02	0.00	0.14	0.14	0.08	0.52						
27/08/2024 08:30:00			-0.02	0.00	0.14	0.14	0.08	0.53						
27/08/2024 08:45:00			-0.02	0.00	0.14	0.14	0.08	0.53						
27/08/2024 09:00:00			-0.02	0.00	0.14	0.14	0.08	0.53						
27/08/2024 09:15:00			-0.02	0.00	0.14	0.14	0.09	0.53						
27/08/2024 09:30:00			-0.01	0.00	0.14	0.14	0.09	0.53						
27/08/2024 09:45:00			-0.01	0.00	0.14	0.14	0.09	0.54						
27/08/2024 10:00:00			-0.02	0.00	0.14	0.14	0.09	0.54						
27/08/2024 10:15:00			-0.02	0.00	0.14	0.14	0.09	0.54						
27/08/2024 10:30:00			-0.02	0.00	0.14	0.15	0.09	0.54						
27/08/2024 10:45:00			-0.02	0.00	0.14	0.15	0.09	0.54						
27/08/2024 11:00:00			-0.02	0.00	0.15	0.15	0.09	0.54						
27/08/2024 11:15:00			-0.02	0.00	0.15	0.15	0.09	0.54						
27/08/2024 11:30:00			-0.02	0.00	0.15	0.15	0.09	0.54						
27/08/2024 11:45:00			-0.02	0.00	0.15	0.15	0.09	0.54						
27/08/2024 12:00:00			-0.02	0.00	0.15	0.15	0.10	0.54						
27/08/2024 12:15:00			-0.02	0.00	0.15	0.15	0.10	0.54						
27/08/2024 12:30:00			-0.02	0.00	0.15	0.15	0.10	0.54						
27/08/2024 12:45:00			-0.02	0.00	0.15	0.15	0.10	0.53						
27/08/2024 13:00:00			-0.02	0.00	0.15	0.15	0.10	0.54						
27/08/2024 13:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
27/08/2024 13:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
27/08/2024 13:45:00			-0.01	0.00	0.15	0.15	0.10	0.53						
27/08/2024 14:00:00			-0.02	0.00	0.15	0.15	0.10	0.53						
27/08/2024 14:15:00			-0.02	0.00	0.15	0.15	0.10	0.53						
27/08/2024 14:30:00			-0.02	0.00	0.15	0.15	0.10	0.54						
27/08/2024 14:45:00			-0.02	0.00	0.15	0.15	0.10	0.54						
27/08/2024 15:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
27/08/2024 15:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
27/08/2024 15:30:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 15:45:00			-0.01	0.00	0.15	0.15	0.10	0.52						
27/08/2024 16:00:00			-0.01	0.00	0.15	0.15	0.10	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
27/08/2024 16:15:00			-0.01	0.00	0.15	0.14	0.10	0.52						
27/08/2024 16:30:00			-0.01	0.00	0.15	0.14	0.10	0.52						
27/08/2024 16:45:00			-0.02	0.00	0.15	0.14	0.10	0.52						
27/08/2024 17:00:00			-0.01	0.00	0.15	0.14	0.10	0.52						
27/08/2024 17:15:00			-0.01	0.00	0.15	0.14	0.10	0.52						
27/08/2024 17:30:00			-0.01	0.00	0.15	0.14	0.10	0.52						
27/08/2024 17:45:00			-0.01	0.00	0.15	0.14	0.10	0.52						
27/08/2024 18:00:00			-0.01	0.00	0.15	0.14	0.09	0.52						
27/08/2024 18:15:00			-0.01	0.00	0.15	0.14	0.09	0.52						
27/08/2024 18:30:00			-0.01	0.00	0.15	0.14	0.09	0.52						
27/08/2024 18:45:00			-0.01	0.00	0.15	0.14	0.09	0.52						
27/08/2024 19:00:00			-0.01	0.00	0.15	0.14	0.09	0.52						
27/08/2024 19:15:00			-0.01	0.00	0.15	0.14	0.09	0.52						
27/08/2024 19:30:00			-0.01	0.00	0.15	0.14	0.09	0.52						
27/08/2024 19:45:00			-0.01	0.00	0.15	0.14	0.09	0.52						
27/08/2024 20:00:00			-0.01	0.00	0.15	0.14	0.09	0.53						
27/08/2024 20:15:00			-0.01	0.00	0.15	0.14	0.09	0.53						
27/08/2024 20:30:00			-0.01	0.00	0.15	0.14	0.09	0.53						
27/08/2024 20:45:00			-0.01	0.00	0.15	0.14	0.09	0.53						
27/08/2024 21:00:00			-0.01	0.00	0.15	0.14	0.09	0.53						
27/08/2024 21:15:00			-0.01	0.00	0.15	0.14	0.09	0.53						
27/08/2024 21:30:00			-0.01	0.00	0.15	0.14	0.09	0.53						
27/08/2024 21:45:00			-0.01	0.00	0.15	0.14	0.09	0.53						
27/08/2024 22:00:00			-0.01	0.00	0.15	0.14	0.10	0.53						
27/08/2024 22:15:00			-0.01	0.00	0.15	0.14	0.10	0.53						
27/08/2024 22:30:00			-0.01	0.00	0.15	0.14	0.10	0.53						
27/08/2024 22:45:00			-0.01	0.00	0.15	0.14	0.10	0.52						
27/08/2024 23:00:00			-0.01	0.00	0.15	0.14	0.10	0.52						
27/08/2024 23:15:00			-0.01	0.00	0.15	0.14	0.10	0.52						
27/08/2024 23:30:00			-0.01	0.00	0.15	0.14	0.10	0.52						
27/08/2024 23:45:00			-0.01	0.00	0.15	0.14	0.10	0.52						
28/08/2024 00:00:00			-0.01	0.00	0.15	0.14	0.10	0.52						
28/08/2024 00:15:00			-0.01	0.00	0.15	0.14	0.10	0.52						
28/08/2024 00:30:00			-0.01	0.00	0.15	0.14	0.10	0.52						
28/08/2024 00:45:00			-0.01	0.00	0.15	0.14	0.10	0.51						
28/08/2024 01:00:00			-0.01	0.00	0.15	0.14	0.10	0.51						
28/08/2024 01:15:00			-0.01	0.00	0.15	0.14	0.10	0.51						
28/08/2024 01:30:00			-0.01	0.00	0.15	0.14	0.10	0.51						
28/08/2024 01:45:00			-0.01	0.00	0.15	0.14	0.09	0.51						
28/08/2024 02:00:00			-0.01	0.00	0.15	0.14	0.09	0.50						
28/08/2024 02:15:00			-0.01	0.00	0.15	0.14	0.09	0.50						
28/08/2024 02:30:00			-0.01	0.00	0.15	0.14	0.09	0.50						
28/08/2024 02:45:00			-0.01	0.00	0.15	0.14	0.09	0.50						
28/08/2024 03:00:00			-0.01	0.00	0.14	0.14	0.09	0.50						
28/08/2024 03:15:00			-0.01	0.00	0.14	0.14	0.09	0.50						
28/08/2024 03:30:00			-0.01	0.00	0.14	0.14	0.09	0.50						
28/08/2024 03:45:00			-0.01	0.00	0.14	0.14	0.09	0.50						
28/08/2024 04:00:00			-0.01	0.00	0.14	0.14	0.09	0.50						
28/08/2024 04:15:00			-0.01	0.00	0.14	0.14	0.09	0.50						
28/08/2024 04:30:00			-0.01	0.00	0.14	0.14	0.09	0.50						
28/08/2024 04:45:00			-0.01	0.00	0.14	0.14	0.09	0.50						
28/08/2024 05:00:00			-0.01	0.00	0.14	0.14	0.09	0.50						
28/08/2024 05:15:00			-0.01	0.00	0.14	0.14	0.09	0.50						
28/08/2024 05:30:00			-0.01	0.00	0.14	0.14	0.08	0.50						
28/08/2024 05:45:00			-0.01	0.00	0.14	0.14	0.08	0.50						
28/08/2024 06:00:00			-0.01	0.00	0.14	0.14	0.08	0.50						
28/08/2024 06:15:00			-0.02	0.00	0.14	0.14	0.08	0.50						
28/08/2024 06:30:00			-0.02	0.00	0.14	0.13	0.08	0.50						
28/08/2024 06:45:00			-0.02	0.00	0.14	0.14	0.08	0.50						
28/08/2024 07:00:00			-0.02	0.00	0.14	0.13	0.08	0.50						
28/08/2024 07:15:00			-0.02	0.00	0.14	0.13	0.08	0.50						
28/08/2024 07:30:00			-0.02	0.00	0.14	0.13	0.08	0.51						
28/08/2024 07:45:00			-0.02	0.00	0.14	0.13	0.08	0.51						
28/08/2024 08:00:00			-0.02	0.00	0.14	0.13	0.08	0.52						
28/08/2024 08:15:00			-0.02	0.00	0.14	0.13	0.08	0.52						
28/08/2024 08:30:00			-0.02	0.00	0.14	0.13	0.08	0.52						
28/08/2024 08:45:00			-0.02	0.00	0.14	0.13	0.08	0.52						
28/08/2024 09:00:00			-0.02	0.00	0.14	0.13	0.08	0.52						
28/08/2024 09:15:00			-0.02	0.00	0.14	0.14	0.08	0.52						
28/08/2024 09:30:00			-0.02	0.00	0.14	0.14	0.09	0.53						
28/08/2024 09:45:00			-0.02	0.00	0.14	0.14	0.09	0.53						
28/08/2024 10:00:00			-0.02	0.00	0.14	0.14	0.09	0.53						
28/08/2024 10:15:00			-0.02	0.00	0.14	0.14	0.09	0.53						
28/08/2024 10:30:00			-0.02	0.00	0.14	0.14	0.09	0.53						
28/08/2024 10:45:00			-0.02	0.00	0.14	0.14	0.09	0.53						
28/08/2024 11:00:00			-0.02	0.00	0.14	0.14	0.09	0.53						
28/08/2024 11:15:00			-0.02	0.00	0.15	0.14	0.09	0.53						
28/08/2024 11:30:00			-0.02	0.00	0.15	0.14	0.09	0.53						
28/08/2024 11:45:00			-0.02	0.00	0.15	0.14	0.09	0.53						
28/08/2024 12:00:00			-0.02	0.00	0.15	0.14	0.09	0.53						
28/08/2024 12:15:00			-0.02	0.00	0.15	0.14	0.09	0.53						
28/08/2024 12:30:00			-0.02	0.00	0.15	0.14	0.09	0.53						
28/08/2024 12:45:00			-0.02	0.00	0.15	0.14	0.09	0.53						
28/08/2024 13:00:00			-0.02	0.00	0.15	0.14	0.10	0.53						
28/08/2024 13:15:00			-0.02	0.00	0.15	0.14	0.10	0.53						
28/08/2024 13:30:00			-0.02	0.00	0.15	0.14	0.10	0.53						
28/08/2024 13:45:00			-0.02	0.00	0.15	0.14	0.10	0.53						
28/08/2024 14:00:00			-0.02	0.00	0.15	0.14	0.10	0.53						
28/08/2024 14:15:00			-0.01	0.00	0.15	0.14	0.09	0.53						
28/08/2024 14:30:00			-0.01	0.00	0.15	0.14	0.09	0.52						
28/08/2024 14:45:00			-0.02	0.00	0.15	0.14	0.09	0.52						
28/08/2024 15:00:00			-0.02	0.00	0.15	0.14	0.09	0.52						
28/08/2024 15:15:00			-0.01	0.00	0.15	0.14	0.09	0.52						
28/08/2024 15:30:00			-0.01	0.00	0.15	0.14	0.09	0.52						
28/08/2024 15:45:00			-0.01	0.00	0.15	0.14	0.09	0.52						
28/08/2024 16:00:00			-0.01	0.00	0.15	0.14	0.09	0.52						
28/08/2024 16:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
28/08/2024 16:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
28/08/2024 16:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 17:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 17:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 17:30:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 17:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 18:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 18:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 18:30:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 18:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 19:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 19:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 19:30:00			-0.01	0.00	0.14	0.14	0.09	0.53						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
28/08/2024 19:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
28/08/2024 20:00:00			-0.01	0.00	0.15	0.14	0.09	0.53						
28/08/2024 20:15:00			-0.01	0.00	0.15	0.14	0.09	0.54						
28/08/2024 20:30:00			-0.01	0.00	0.15	0.14	0.09	0.54						
28/08/2024 20:45:00			-0.01	0.00	0.15	0.14	0.09	0.54						
28/08/2024 21:00:00			-0.01	0.00	0.15	0.14	0.09	0.54						
28/08/2024 21:15:00			-0.01	0.00	0.15	0.14	0.09	0.54						
28/08/2024 21:30:00			-0.01	0.00	0.15	0.14	0.09	0.54						
28/08/2024 21:45:00			-0.01	0.00	0.15	0.14	0.09	0.53						
28/08/2024 22:00:00			-0.01	0.00	0.15	0.14	0.10	0.53						
28/08/2024 22:15:00			-0.01	0.00	0.15	0.14	0.10	0.53						
28/08/2024 22:30:00			-0.01	0.00	0.15	0.14	0.10	0.53						
28/08/2024 22:45:00			-0.01	0.00	0.15	0.14	0.10	0.53						
28/08/2024 23:00:00			-0.01	0.00	0.15	0.14	0.10	0.53						
28/08/2024 23:15:00			-0.01	0.00	0.15	0.14	0.10	0.53						
28/08/2024 23:30:00			-0.01	0.00	0.15	0.14	0.10	0.53						
28/08/2024 23:45:00			-0.01	0.00	0.15	0.14	0.10	0.53						
29/08/2024 00:00:00			-0.01	0.00	0.15	0.14	0.10	0.52						
29/08/2024 00:15:00			-0.01	0.00	0.15	0.14	0.10	0.52						
29/08/2024 00:30:00			-0.01	0.00	0.15	0.14	0.10	0.52						
29/08/2024 00:45:00			-0.01	0.00	0.15	0.14	0.10	0.52						
29/08/2024 01:00:00			-0.01	0.00	0.15	0.14	0.10	0.52						
29/08/2024 01:15:00			-0.01	0.00	0.15	0.14	0.09	0.52						
29/08/2024 01:30:00			-0.01	0.00	0.15	0.14	0.09	0.51						
29/08/2024 01:45:00			-0.01	0.00	0.15	0.14	0.09	0.51						
29/08/2024 02:00:00			-0.01	0.00	0.15	0.14	0.09	0.51						
29/08/2024 02:15:00			-0.01	0.00	0.15	0.14	0.09	0.51						
29/08/2024 02:30:00			-0.01	0.00	0.14	0.14	0.09	0.51						
29/08/2024 02:45:00			-0.01	0.00	0.14	0.14	0.09	0.51						
29/08/2024 03:00:00			-0.01	0.00	0.14	0.14	0.09	0.51						
29/08/2024 03:15:00			-0.01	0.00	0.14	0.14	0.09	0.51						
29/08/2024 03:30:00			-0.01	0.00	0.14	0.14	0.09	0.50						
29/08/2024 03:45:00			-0.01	0.00	0.14	0.14	0.09	0.50						
29/08/2024 04:00:00			-0.01	0.00	0.14	0.14	0.09	0.50						
29/08/2024 04:15:00			-0.01	0.00	0.14	0.14	0.09	0.50						
29/08/2024 04:30:00			-0.01	0.00	0.14	0.14	0.08	0.50						
29/08/2024 04:45:00			-0.01	0.00	0.14	0.14	0.08	0.50						
29/08/2024 05:00:00			-0.01	0.00	0.14	0.14	0.08	0.50						
29/08/2024 05:15:00			-0.01	0.00	0.14	0.14	0.08	0.50						
29/08/2024 05:30:00			-0.01	0.00	0.13	0.14	0.08	0.50						
29/08/2024 05:45:00			-0.01	0.00	0.13	0.14	0.08	0.50						
29/08/2024 06:00:00			-0.01	0.00	0.13	0.13	0.08	0.50						
29/08/2024 06:15:00			-0.01	0.00	0.13	0.13	0.08	0.50						
29/08/2024 06:30:00			-0.01	0.00	0.13	0.13	0.08	0.50						
29/08/2024 06:45:00			-0.01	0.00	0.13	0.13	0.08	0.50						
29/08/2024 07:00:00			-0.01	0.00	0.13	0.13	0.08	0.51						
29/08/2024 07:15:00			-0.01	0.00	0.13	0.13	0.08	0.51						
29/08/2024 07:30:00			-0.02	0.00	0.13	0.13	0.08	0.52						
29/08/2024 07:45:00			-0.02	0.00	0.13	0.13	0.08	0.52						
29/08/2024 08:00:00			-0.02	0.00	0.13	0.13	0.08	0.52						
29/08/2024 08:15:00			-0.02	0.00	0.13	0.13	0.08	0.52						
29/08/2024 08:30:00			-0.02	0.00	0.13	0.13	0.08	0.52						
29/08/2024 08:45:00			-0.02	0.00	0.13	0.13	0.08	0.52						
29/08/2024 09:00:00			-0.02	0.00	0.13	0.13	0.08	0.52						
29/08/2024 09:15:00			-0.02	0.00	0.13	0.13	0.08	0.53						
29/08/2024 09:30:00			-0.01	0.00	0.13	0.13	0.08	0.53						
29/08/2024 09:45:00			-0.01	0.00	0.13	0.13	0.08	0.54						
29/08/2024 10:00:00			-0.01	0.00	0.14	0.13	0.08	0.55						
29/08/2024 10:15:00			-0.02	0.00	0.14	0.14	0.08	0.55						
29/08/2024 10:30:00			-0.02	0.00	0.14	0.14	0.09	0.55						
29/08/2024 10:45:00			-0.02	0.00	0.14	0.14	0.09	0.55						
29/08/2024 11:00:00			-0.02	0.00	0.14	0.14	0.09	0.54						
29/08/2024 11:15:00			-0.02	0.00	0.15	0.14	0.09	0.54						
29/08/2024 11:30:00			-0.02	0.00	0.15	0.14	0.09	0.54						
29/08/2024 11:45:00			-0.02	0.00	0.15	0.14	0.10	0.54						
29/08/2024 12:00:00			-0.02	0.00	0.15	0.14	0.10	0.53						
29/08/2024 12:15:00			-0.02	0.00	0.15	0.14	0.10	0.53						
29/08/2024 12:30:00			-0.02	0.00	0.15	0.14	0.10	0.53						
29/08/2024 12:45:00			-0.01	0.00	0.15	0.14	0.10	0.53						
29/08/2024 13:00:00			-0.01	0.00	0.15	0.14	0.10	0.54						
29/08/2024 13:15:00			-0.01	0.00	0.15	0.14	0.10	0.54						
29/08/2024 13:30:00			-0.01	0.00	0.15	0.14	0.10	0.54						
29/08/2024 13:45:00			-0.01	0.00	0.15	0.14	0.10	0.54						
29/08/2024 14:00:00			-0.01	0.00	0.15	0.14	0.10	0.53						
29/08/2024 14:15:00			-0.01	0.00	0.15	0.14	0.10	0.53						
29/08/2024 14:30:00			-0.01	0.00	0.15	0.14	0.10	0.53						
29/08/2024 14:45:00			-0.01	0.00	0.15	0.14	0.10	0.53						
29/08/2024 15:00:00			-0.01	0.00	0.15	0.14	0.10	0.53						
29/08/2024 15:15:00			-0.01	0.00	0.15	0.14	0.10	0.53						
29/08/2024 15:30:00			-0.01	0.00	0.15	0.14	0.10	0.53						
29/08/2024 15:45:00			-0.02	0.00	0.15	0.14	0.10	0.52						
29/08/2024 16:00:00			-0.01	0.00	0.15	0.14	0.10	0.52						
29/08/2024 16:15:00			-0.01	0.00	0.15	0.14	0.10	0.52						
29/08/2024 16:30:00			-0.01	0.00	0.15	0.14	0.09	0.52						
29/08/2024 16:45:00			-0.01	0.00	0.15	0.14	0.09	0.52						
29/08/2024 17:00:00			-0.01	0.00	0.15	0.14	0.09	0.52						
29/08/2024 17:15:00			-0.01	0.00	0.15	0.14	0.09	0.52						
29/08/2024 17:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 17:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 18:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 18:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 18:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 18:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 19:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 19:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 19:30:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 19:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 20:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 20:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 20:30:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 20:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 21:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 21:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 21:30:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 21:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 22:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
29/08/2024 22:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 22:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 22:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 23:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
29/08/2024 23:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 23:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
29/08/2024 23:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 00:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 00:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 00:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 00:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 01:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 01:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 01:30:00			-0.01	0.00	0.14	0.14	0.09	0.51						
30/08/2024 01:45:00			-0.01	0.00	0.14	0.14	0.09	0.51						
30/08/2024 02:00:00			-0.01	0.00	0.14	0.14	0.09	0.51						
30/08/2024 02:15:00			-0.01	0.00	0.14	0.14	0.09	0.51						
30/08/2024 02:30:00			-0.01	0.00	0.14	0.14	0.09	0.50						
30/08/2024 02:45:00			-0.01	0.00	0.14	0.14	0.09	0.50						
30/08/2024 03:00:00			-0.01	0.00	0.14	0.14	0.09	0.50						
30/08/2024 03:15:00			-0.01	0.00	0.14	0.14	0.09	0.50						
30/08/2024 03:30:00			-0.01	0.00	0.14	0.14	0.09	0.50						
30/08/2024 03:45:00			-0.01	0.00	0.14	0.14	0.09	0.50						
30/08/2024 04:00:00			-0.01	0.00	0.14	0.14	0.09	0.50						
30/08/2024 04:15:00			-0.01	0.00	0.14	0.14	0.08	0.49						
30/08/2024 04:30:00			-0.01	0.00	0.14	0.14	0.08	0.49						
30/08/2024 04:45:00			-0.01	0.00	0.14	0.14	0.08	0.49						
30/08/2024 05:00:00			-0.01	0.00	0.14	0.14	0.08	0.49						
30/08/2024 05:15:00			-0.01	0.00	0.13	0.13	0.08	0.49						
30/08/2024 05:30:00			-0.01	0.00	0.13	0.13	0.08	0.49						
30/08/2024 05:45:00			-0.01	0.00	0.13	0.13	0.08	0.49						
30/08/2024 06:00:00			-0.01	0.00	0.13	0.13	0.08	0.49						
30/08/2024 06:15:00			-0.01	0.00	0.13	0.13	0.08	0.49						
30/08/2024 06:30:00			-0.01	0.00	0.13	0.13	0.08	0.49						
30/08/2024 06:45:00			-0.01	0.00	0.13	0.13	0.08	0.49						
30/08/2024 07:00:00			-0.01	0.00	0.13	0.13	0.08	0.49						
30/08/2024 07:15:00			-0.01	0.00	0.13	0.13	0.08	0.49						
30/08/2024 07:30:00			-0.02	0.00	0.13	0.13	0.08	0.50						
30/08/2024 07:45:00			-0.02	0.00	0.13	0.13	0.08	0.50						
30/08/2024 08:00:00			-0.02	0.00	0.13	0.13	0.08	0.51						
30/08/2024 08:15:00			-0.02	0.00	0.13	0.13	0.08	0.52						
30/08/2024 08:30:00			-0.02	0.00	0.13	0.13	0.08	0.52						
30/08/2024 08:45:00			-0.02	0.00	0.13	0.13	0.08	0.52						
30/08/2024 09:00:00			-0.02	0.00	0.13	0.13	0.08	0.52						
30/08/2024 09:15:00			-0.02	0.00	0.13	0.13	0.08	0.52						
30/08/2024 09:30:00			-0.02	0.00	0.13	0.13	0.08	0.52						
30/08/2024 09:45:00			-0.02	0.00	0.13	0.13	0.08	0.52						
30/08/2024 10:00:00			-0.02	0.00	0.13	0.13	0.08	0.52						
30/08/2024 10:15:00			-0.02	0.00	0.13	0.13	0.08	0.53						
30/08/2024 10:30:00			-0.02	0.00	0.14	0.13	0.08	0.53						
30/08/2024 10:45:00			-0.02	0.00	0.14	0.13	0.08	0.53						
30/08/2024 11:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 11:15:00			-0.02	0.00	0.14	0.14	0.09	0.53						
30/08/2024 11:30:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 11:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 12:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 12:15:00			-0.02	0.00	0.14	0.14	0.09	0.52						
30/08/2024 12:30:00			-0.02	0.00	0.14	0.14	0.09	0.52						
30/08/2024 12:45:00			-0.02	0.00	0.14	0.14	0.09	0.52						
30/08/2024 13:00:00			-0.02	0.00	0.15	0.14	0.09	0.52						
30/08/2024 13:15:00			-0.01	0.00	0.15	0.14	0.09	0.52						
30/08/2024 13:30:00			-0.01	0.00	0.15	0.14	0.09	0.52						
30/08/2024 13:45:00			-0.02	0.00	0.15	0.14	0.09	0.52						
30/08/2024 14:00:00			-0.01	0.00	0.15	0.14	0.09	0.52						
30/08/2024 14:15:00			-0.01	0.00	0.15	0.14	0.09	0.52						
30/08/2024 14:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 14:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 15:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 15:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 15:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 15:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 16:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 16:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 16:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 16:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 17:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 17:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 17:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 17:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 18:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 18:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 18:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 18:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 19:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 19:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 19:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 19:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 20:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
30/08/2024 20:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 20:30:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 20:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 21:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 21:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 21:30:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 21:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 22:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
30/08/2024 22:15:00			-0.01	0.00	0.15	0.14	0.09	0.52						
30/08/2024 22:30:00			-0.01	0.00	0.15	0.14	0.09	0.52						
30/08/2024 22:45:00			-0.01	0.00	0.15	0.14	0.09	0.52						
30/08/2024 23:00:00			-0.01	0.00	0.15	0.14	0.09	0.52						
30/08/2024 23:15:00			-0.01	0.00	0.15	0.14	0.09	0.52						
30/08/2024 23:30:00			-0.01	0.00	0.15	0.14	0.09	0.52						
30/08/2024 23:45:00			-0.01	0.00	0.15	0.14	0.09	0.52						
31/08/2024 00:00:00			-0.01	0.00	0.15	0.14	0.09	0.52						
31/08/2024 00:15:00			-0.01	0.00	0.15	0.14	0.09	0.51						
31/08/2024 00:30:00			-0.01	0.00	0.15	0.14	0.09	0.51						
31/08/2024 00:45:00			-0.01	0.00	0.15	0.14	0.09	0.51						
31/08/2024 01:00:00			-0.01	0.00	0.15	0.14	0.09	0.51						
31/08/2024 01:15:00			-0.01	0.00	0.14	0.14	0.09	0.51						
31/08/2024 01:30:00			-0.01	0.00	0.14	0.14	0.09	0.51						
31/08/2024 01:45:00			-0.01	0.00	0.14	0.14	0.09	0.51						
31/08/2024 02:00:00			-0.01	0.00	0.14	0.14	0.09	0.50						
31/08/2024 02:15:00			-0.01	0.00	0.14	0.14	0.09	0.50						
31/08/2024 02:30:00			-0.01	0.00	0.14	0.14	0.09	0.50						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
31/08/2024 02:45:00			-0.01	0.00	0.14	0.14	0.09	0.50						
31/08/2024 03:00:00			-0.01	0.00	0.14	0.14	0.09	0.50						
31/08/2024 03:15:00			-0.01	0.00	0.14	0.14	0.09	0.50						
31/08/2024 03:30:00			-0.02	0.00	0.14	0.14	0.09	0.50						
31/08/2024 03:45:00			-0.02	0.00	0.14	0.14	0.09	0.50						
31/08/2024 04:00:00			-0.02	0.00	0.14	0.14	0.08	0.51						
31/08/2024 04:15:00			-0.02	0.00	0.14	0.14	0.08	0.51						
31/08/2024 04:30:00			-0.02	0.00	0.14	0.14	0.08	0.50						
31/08/2024 04:45:00			-0.02	0.00	0.14	0.14	0.08	0.50						
31/08/2024 05:00:00			-0.02	0.00	0.14	0.14	0.08	0.50						
31/08/2024 05:15:00			-0.01	0.00	0.14	0.14	0.08	0.50						
31/08/2024 05:30:00			-0.01	0.00	0.14	0.13	0.08	0.50						
31/08/2024 05:45:00			-0.01	0.00	0.14	0.13	0.08	0.50						
31/08/2024 06:00:00			-0.01	0.00	0.14	0.13	0.08	0.50						
31/08/2024 06:15:00			-0.02	0.00	0.13	0.13	0.08	0.50						
31/08/2024 06:30:00			-0.02	0.00	0.13	0.13	0.08	0.50						
31/08/2024 06:45:00			-0.02	0.00	0.13	0.13	0.08	0.50						
31/08/2024 07:00:00			-0.02	0.00	0.13	0.13	0.08	0.50						
31/08/2024 07:15:00			-0.02	0.00	0.13	0.13	0.08	0.50						
31/08/2024 07:30:00			-0.02	0.00	0.13	0.13	0.08	0.50						
31/08/2024 07:45:00			-0.02	0.00	0.13	0.13	0.08	0.50						
31/08/2024 08:00:00			-0.02	0.00	0.13	0.13	0.08	0.50						
31/08/2024 08:15:00			-0.02	0.00	0.13	0.13	0.08	0.50						
31/08/2024 08:30:00			-0.02	0.00	0.13	0.13	0.08	0.51						
31/08/2024 08:45:00			-0.02	0.00	0.13	0.13	0.08	0.51						
31/08/2024 09:00:00			-0.02	0.00	0.13	0.13	0.08	0.51						
31/08/2024 09:15:00			-0.02	0.00	0.13	0.13	0.08	0.52						
31/08/2024 09:30:00			-0.02	0.00	0.13	0.13	0.08	0.52						
31/08/2024 09:45:00			-0.02	0.00	0.13	0.13	0.08	0.52						
31/08/2024 10:00:00			-0.02	0.00	0.13	0.13	0.08	0.52						
31/08/2024 10:15:00			-0.02	0.00	0.13	0.13	0.08	0.53						
31/08/2024 10:30:00			-0.02	0.00	0.13	0.13	0.08	0.53						
31/08/2024 10:45:00			-0.02	0.00	0.13	0.13	0.08	0.53						
31/08/2024 11:00:00			-0.02	0.00	0.14	0.13	0.08	0.53						
31/08/2024 11:15:00			-0.02	0.00	0.14	0.13	0.08	0.53						
31/08/2024 11:30:00			-0.02	0.00	0.14	0.13	0.08	0.53						
31/08/2024 11:45:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 12:00:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 12:15:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 12:30:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 12:45:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 13:00:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 13:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
31/08/2024 13:30:00			-0.02	0.00	0.15	0.14	0.09	0.53						
31/08/2024 13:45:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 14:00:00			-0.02	0.00	0.15	0.14	0.09	0.52						
31/08/2024 14:15:00			-0.02	0.00	0.15	0.14	0.09	0.52						
31/08/2024 14:30:00			-0.02	0.00	0.15	0.14	0.09	0.52						
31/08/2024 14:45:00			-0.02	0.00	0.15	0.14	0.09	0.52						
31/08/2024 15:00:00			-0.02	0.00	0.15	0.14	0.09	0.52						
31/08/2024 15:15:00			-0.02	0.00	0.14	0.14	0.09	0.52						
31/08/2024 15:30:00			-0.02	0.00	0.15	0.14	0.09	0.52						
31/08/2024 15:45:00			-0.02	0.00	0.15	0.14	0.09	0.52						
31/08/2024 16:00:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 16:15:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 16:30:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 16:45:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 17:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
31/08/2024 17:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
31/08/2024 17:30:00			-0.02	0.00	0.14	0.14	0.09	0.53						
31/08/2024 17:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
31/08/2024 18:00:00			-0.01	0.00	0.15	0.14	0.09	0.52						
31/08/2024 18:15:00			-0.01	0.00	0.15	0.14	0.09	0.53						
31/08/2024 18:30:00			-0.02	0.00	0.15	0.14	0.09	0.53						
31/08/2024 18:45:00			-0.02	0.00	0.15	0.14	0.09	0.53						
31/08/2024 19:00:00			-0.02	0.00	0.15	0.14	0.09	0.53						
31/08/2024 19:15:00			-0.02	0.00	0.15	0.14	0.09	0.54						
31/08/2024 19:30:00			-0.01	0.00	0.15	0.14	0.09	0.55						
31/08/2024 19:45:00			-0.01	0.00	0.15	0.14	0.09	0.55						
31/08/2024 20:00:00			-0.01	0.00	0.15	0.14	0.09	0.55						
31/08/2024 20:15:00			-0.01	0.00	0.15	0.14	0.09	0.55						
31/08/2024 20:30:00			-0.01	0.00	0.15	0.15	0.09	0.55						
31/08/2024 20:45:00			-0.01	0.00	0.15	0.15	0.09	0.55						
31/08/2024 21:00:00			-0.01	0.00	0.15	0.15	0.10	0.55						
31/08/2024 21:15:00			-0.01	0.00	0.15	0.15	0.10	0.55						
31/08/2024 21:30:00			-0.01	0.00	0.15	0.15	0.10	0.55						
31/08/2024 21:45:00			-0.01	0.00	0.16	0.15	0.10	0.54						
31/08/2024 22:00:00			-0.01	0.00	0.16	0.15	0.10	0.54						
31/08/2024 22:15:00			-0.01	0.00	0.16	0.15	0.10	0.54						
31/08/2024 22:30:00			-0.01	0.00	0.16	0.15	0.10	0.54						
31/08/2024 22:45:00			-0.02	0.00	0.16	0.15	0.10	0.54						
31/08/2024 23:00:00			-0.01	0.00	0.16	0.15	0.10	0.54						
31/08/2024 23:15:00			-0.01	0.00	0.16	0.15	0.10	0.53						
31/08/2024 23:30:00			-0.01	0.00	0.16	0.15	0.10	0.53						
31/08/2024 23:45:00			-0.01	0.00	0.16	0.15	0.10	0.53						
01/09/2024 00:00:00			-0.01	0.00	0.16	0.15	0.10	0.53						
01/09/2024 00:15:00			-0.01	0.00	0.16	0.15	0.10	0.53						
01/09/2024 00:30:00			-0.01	0.00	0.16	0.15	0.10	0.53						
01/09/2024 00:45:00			-0.01	0.00	0.16	0.15	0.10	0.53						
01/09/2024 01:00:00			-0.01	0.00	0.15	0.15	0.10	0.52						
01/09/2024 01:15:00			-0.01	0.00	0.15	0.15	0.10	0.52						
01/09/2024 01:30:00			-0.01	0.00	0.15	0.15	0.10	0.52						
01/09/2024 01:45:00			-0.01	0.00	0.15	0.15	0.10	0.52						
01/09/2024 02:00:00			-0.01	0.00	0.15	0.15	0.10	0.52						
01/09/2024 02:15:00			-0.01	0.00	0.15	0.15	0.10	0.52						
01/09/2024 02:30:00			-0.01	0.00	0.15	0.15	0.10	0.52						
01/09/2024 02:45:00			-0.01	0.00	0.15	0.15	0.10	0.52						
01/09/2024 03:00:00			-0.01	0.00	0.15	0.15	0.10	0.52						
01/09/2024 03:15:00			-0.01	0.00	0.15	0.15	0.09	0.52						
01/09/2024 03:30:00			-0.01	0.00	0.15	0.15	0.09	0.52						
01/09/2024 03:45:00			-0.01	0.00	0.15	0.14	0.09	0.51						
01/09/2024 04:00:00			-0.01	0.00	0.15	0.14	0.09	0.51						
01/09/2024 04:15:00			-0.01	0.00	0.15	0.14	0.09	0.51						
01/09/2024 04:30:00			-0.01	0.00	0.14	0.14	0.09	0.51						
01/09/2024 04:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
01/09/2024 05:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
01/09/2024 05:15:00			-0.02	0.00	0.14	0.14	0.09	0.52						
01/09/2024 05:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
01/09/2024 05:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
01/09/2024 06:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
01/09/2024 06:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
01/09/2024 06:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
01/09/2024 06:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
01/09/2024 07:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
01/09/2024 07:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
01/09/2024 07:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
01/09/2024 07:45:00			-0.02	0.00	0.14	0.14	0.09	0.52						
01/09/2024 08:00:00			-0.02	0.00	0.14	0.14	0.09	0.52						
01/09/2024 08:15:00			-0.02	0.00	0.14	0.14	0.09	0.52						
01/09/2024 08:30:00			-0.02	0.00	0.14	0.14	0.09	0.52						
01/09/2024 08:45:00			-0.02	0.00	0.14	0.14	0.09	0.52						
01/09/2024 09:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
01/09/2024 09:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
01/09/2024 09:30:00			-0.02	0.00	0.14	0.14	0.09	0.53						
01/09/2024 09:45:00			-0.02	0.00	0.14	0.14	0.09	0.54						
01/09/2024 10:00:00			-0.02	0.00	0.14	0.14	0.09	0.54						
01/09/2024 10:15:00			-0.02	0.00	0.14	0.14	0.09	0.54						
01/09/2024 10:30:00			-0.02	0.00	0.14	0.14	0.09	0.54						
01/09/2024 10:45:00			-0.02	0.00	0.14	0.14	0.09	0.54						
01/09/2024 11:00:00			-0.02	0.00	0.14	0.14	0.09	0.54						
01/09/2024 11:15:00			-0.02	0.00	0.14	0.14	0.09	0.55						
01/09/2024 11:30:00			-0.02	0.00	0.15	0.15	0.09	0.55						
01/09/2024 11:45:00			-0.02	0.00	0.15	0.15	0.09	0.55						
01/09/2024 12:00:00			-0.02	0.00	0.15	0.15	0.09	0.55						
01/09/2024 12:15:00			-0.02	0.00	0.15	0.15	0.09	0.55						
01/09/2024 12:30:00			-0.02	0.00	0.15	0.15	0.10	0.54						
01/09/2024 12:45:00			-0.02	0.00	0.15	0.15	0.10	0.54						
01/09/2024 13:00:00			-0.02	0.00	0.15	0.15	0.10	0.54						
01/09/2024 13:15:00			-0.02	0.00	0.15	0.15	0.10	0.54						
01/09/2024 13:30:00			-0.02	0.00	0.15	0.15	0.10	0.54						
01/09/2024 13:45:00			-0.02	0.00	0.15	0.15	0.10	0.54						
01/09/2024 14:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 14:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 14:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 14:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 15:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 15:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 15:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 15:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 16:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
01/09/2024 16:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
01/09/2024 16:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
01/09/2024 16:45:00			-0.01	0.00	0.15		0.10	0.53						
01/09/2024 17:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
01/09/2024 17:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 17:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 17:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 18:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 18:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 18:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 18:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 19:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 19:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 19:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 19:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 20:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 20:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 20:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 20:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 21:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 21:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 21:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 21:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 22:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 22:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 22:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 22:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 23:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
01/09/2024 23:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
01/09/2024 23:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
01/09/2024 23:45:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 00:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 00:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 00:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 00:45:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 01:00:00			-0.01	0.00	0.15	0.15	0.10	0.52						
02/09/2024 01:15:00			-0.01	0.00	0.15	0.15	0.10	0.52						
02/09/2024 01:30:00			-0.01	0.00	0.15	0.15	0.10	0.52						
02/09/2024 01:45:00			-0.01	0.00	0.15	0.15	0.10	0.52						
02/09/2024 02:00:00			-0.01	0.00	0.15	0.15	0.10	0.52						
02/09/2024 02:15:00			-0.01	0.00	0.15	0.15	0.10	0.52						
02/09/2024 02:30:00			-0.01	0.00	0.15	0.15	0.10	0.52						
02/09/2024 02:45:00			-0.01	0.00	0.15	0.15	0.09	0.52						
02/09/2024 03:00:00			-0.01	0.00	0.15	0.15	0.09	0.52						
02/09/2024 03:15:00			-0.01	0.00	0.15	0.15	0.09	0.51						
02/09/2024 03:30:00			-0.01	0.00	0.15	0.15	0.09	0.51						
02/09/2024 03:45:00			-0.01	0.00	0.15	0.15	0.09	0.51						
02/09/2024 04:00:00			-0.01	0.00	0.15	0.15	0.09	0.51						
02/09/2024 04:15:00			-0.01	0.00	0.14	0.15	0.09	0.51						
02/09/2024 04:30:00			-0.01	0.00	0.14	0.15	0.09	0.51						
02/09/2024 04:45:00			-0.01	0.00	0.14	0.15	0.09	0.51						
02/09/2024 05:00:00			-0.01	0.00	0.14	0.14	0.09	0.51						
02/09/2024 05:15:00			-0.01	0.00	0.14	0.14	0.09	0.51						
02/09/2024 05:30:00			-0.01	0.00	0.14	0.14	0.09	0.51						
02/09/2024 05:45:00			-0.01	0.00	0.14	0.14	0.09	0.51						
02/09/2024 06:00:00			-0.01	0.00	0.14	0.14	0.09	0.51						
02/09/2024 06:15:00			-0.01	0.00	0.14	0.14	0.09	0.51						
02/09/2024 06:30:00			-0.01	0.00	0.14	0.14	0.09	0.51						
02/09/2024 06:45:00			-0.01	0.00	0.14	0.14	0.09	0.51						
02/09/2024 07:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
02/09/2024 07:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
02/09/2024 07:30:00			-0.02	0.00	0.14	0.14	0.09	0.53						
02/09/2024 07:45:00			-0.02	0.00	0.14	0.14	0.09	0.53						
02/09/2024 08:00:00			-0.02	0.00	0.14	0.14	0.09	0.53						
02/09/2024 08:15:00			-0.02	0.00	0.14	0.14	0.09	0.53						
02/09/2024 08:30:00			-0.02	0.00	0.14	0.14	0.09	0.53						
02/09/2024 08:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
02/09/2024 09:00:00			-0.01	0.00	0.14	0.14	0.09	0.54						
02/09/2024 09:15:00			-0.01	0.00	0.14	0.14	0.09	0.54						
02/09/2024 09:30:00			-0.02	0.00	0.14	0.14	0.09	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
02/09/2024 09:45:00			-0.01	0.00	0.14	0.14	0.09	0.54						
02/09/2024 10:00:00			-0.01	0.00	0.14	0.14	0.09	0.54						
02/09/2024 10:15:00			-0.01	0.00	0.14	0.15	0.09	0.55						
02/09/2024 10:30:00			-0.01	0.00	0.15	0.15	0.09	0.55						
02/09/2024 10:45:00			-0.01	0.00	0.15	0.15	0.09	0.55						
02/09/2024 11:00:00			-0.01	0.00	0.15	0.15	0.09	0.55						
02/09/2024 11:15:00			-0.01	0.00	0.15	0.15	0.10	0.55						
02/09/2024 11:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 11:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 12:00:00			-0.02	0.00	0.15	0.15	0.10	0.54						
02/09/2024 12:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 12:30:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 12:45:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 13:00:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 13:15:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 13:30:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 13:45:00			-0.01	0.00	0.16	0.15	0.10	0.53						
02/09/2024 14:00:00			-0.01	0.00	0.16	0.15	0.10	0.53						
02/09/2024 14:15:00			-0.01	0.00	0.16	0.15	0.10	0.53						
02/09/2024 14:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 14:45:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 15:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 15:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 15:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 15:45:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 16:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 16:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 16:30:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 16:45:00			-0.01	0.00	0.15	0.15	0.10	0.53						
02/09/2024 17:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 17:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 17:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 17:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 18:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 18:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 18:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 18:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 19:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 19:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 19:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 19:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 20:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 20:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 20:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 20:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 21:00:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 21:15:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 21:30:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 21:45:00			-0.01	0.00	0.15	0.15	0.10	0.54						
02/09/2024 22:00:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 22:15:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 22:30:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 22:45:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 23:00:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 23:15:00			-0.01	0.00	0.16	0.15	0.10	0.54						
02/09/2024 23:30:00			-0.01	0.00	0.16	0.15	0.10	0.53						
02/09/2024 23:45:00			-0.01	0.00	0.16	0.15	0.10	0.53						
03/09/2024 00:00:00			-0.01	0.00	0.16	0.15	0.10	0.53						
03/09/2024 00:15:00			-0.01	0.00	0.16	0.15	0.10	0.53						
03/09/2024 00:30:00			-0.01	0.00	0.16	0.15	0.10	0.53						
03/09/2024 00:45:00			-0.01	0.00	0.16	0.15	0.10	0.53						
03/09/2024 01:00:00			-0.01	0.00	0.15	0.15	0.10	0.53						
03/09/2024 01:15:00			-0.01	0.00	0.15	0.15	0.10	0.52						
03/09/2024 01:30:00			-0.01	0.00	0.15	0.15	0.10	0.52						
03/09/2024 01:45:00			-0.01	0.00	0.15	0.15	0.10	0.52						
03/09/2024 02:00:00			-0.01	0.00	0.15	0.15	0.10	0.52						
03/09/2024 02:15:00			-0.01	0.00	0.15	0.15	0.10	0.53						
03/09/2024 02:30:00			-0.01	0.00	0.15	0.15	0.10	0.55						
03/09/2024 02:45:00			-0.01	0.00	0.15	0.15	0.10	0.57						
03/09/2024 03:00:00			0.00	0.00	0.15	0.15	0.10	0.58						
03/09/2024 03:15:00			-0.01	0.00	0.15	0.15	0.10	0.58						
03/09/2024 03:30:00			-0.01	0.00	0.15	0.16	0.10	0.59						
03/09/2024 03:45:00			-0.01	0.00	0.16	0.16	0.10	0.58						
03/09/2024 04:00:00			-0.01	0.00	0.16	0.16	0.11	0.58						
03/09/2024 04:15:00			-0.01	0.00	0.16	0.16	0.11	0.58						
03/09/2024 04:30:00			-0.01	0.00	0.17	0.16	0.11	0.57						
03/09/2024 04:45:00			-0.01	0.00	0.17	0.16	0.12	0.57						
03/09/2024 05:00:00			-0.01	0.00	0.17	0.16	0.12	0.57						
03/09/2024 05:15:00			0.00	0.00	0.18	0.16	0.12	0.57						
03/09/2024 05:30:00			0.00	0.00	0.18	0.17	0.12	0.57						
03/09/2024 05:45:00			0.00	0.00	0.18	0.17	0.12	0.57						
03/09/2024 06:00:00			0.00	0.00	0.18	0.17	0.12	0.57						
03/09/2024 06:15:00			0.00	0.00	0.18	0.17	0.13	0.57						
03/09/2024 06:30:00			0.00	0.00	0.18	0.17	0.13	0.57						
03/09/2024 06:45:00			0.00	0.00	0.18	0.17	0.13	0.56						
03/09/2024 07:00:00			0.00	0.00	0.18	0.17	0.13	0.56						
03/09/2024 07:15:00			0.00	0.00	0.18	0.17	0.13	0.55						
03/09/2024 07:30:00			0.01	0.00	0.18	0.17	0.13	0.55						
03/09/2024 07:45:00			0.01	0.00	0.18	0.17	0.13	0.55						
03/09/2024 08:00:00			0.01	0.00	0.18	0.17	0.13	0.55						
03/09/2024 08:15:00			0.01	0.00	0.18	0.17	0.13	0.55						
03/09/2024 08:30:00			0.01	0.00	0.18	0.17	0.13	0.55						
03/09/2024 08:45:00			0.01	0.00	0.18	0.17	0.13	0.57						
03/09/2024 09:00:00			0.00	0.00	0.18	0.17	0.12	0.58						
03/09/2024 09:15:00			0.00	0.00	0.18	0.17	0.12	0.59						
03/09/2024 09:30:00			0.00	0.00	0.18	0.17	0.12	0.59						
03/09/2024 09:45:00			0.01	0.00	0.18	0.17	0.13	0.59						
03/09/2024 10:00:00			0.01	0.00	0.18	0.17	0.13	0.59						
03/09/2024 10:15:00			0.01	0.00	0.18	0.17	0.13	0.59						
03/09/2024 10:30:00			0.00	0.00	0.19	0.17	0.13	0.59						
03/09/2024 10:45:00			0.00	0.00	0.19	0.17	0.13	0.59						
03/09/2024 11:00:00			0.00	0.00	0.19	0.17	0.13	0.60						
03/09/2024 11:15:00			0.01	0.00	0.19	0.17	0.13	0.59						
03/09/2024 11:30:00			0.00	0.00	0.19	0.17	0.13	0.59						
03/09/2024 11:45:00			0.00	0.00	0.18	0.17	0.13	0.58						
03/09/2024 12:00:00			0.00	0.00	0.18	0.17	0.13	0.58						
03/09/2024 12:15:00			0.01	0.00	0.18	0.17	0.12	0.58						
03/09/2024 12:30:00			0.01	0.00	0.18	0.17	0.12	0.58						
03/09/2024 12:45:00			0.01	0.00	0.18	0.17	0.12	0.58						
03/09/2024 13:00:00			0.01	0.00	0.18	0.17	0.12	0.58						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
03/09/2024 13:15:00			0.01	0.00	0.18	0.17	0.12	0.58						
03/09/2024 13:30:00			0.01	0.00	0.18	0.17	0.12	0.58						
03/09/2024 13:45:00			0.01	0.00	0.18	0.17	0.12	0.58						
03/09/2024 14:00:00			0.01	0.00	0.17	0.17	0.12	0.58						
03/09/2024 14:15:00			0.01	0.00	0.17	0.17	0.12	0.57						
03/09/2024 14:30:00			0.01	0.00	0.17	0.17	0.12	0.57						
03/09/2024 14:45:00			0.01	0.00	0.17	0.17	0.12	0.56						
03/09/2024 15:00:00			0.01	0.00	0.17	0.17	0.12	0.56						
03/09/2024 15:15:00			0.01	0.00	0.17	0.17	0.12	0.55						
03/09/2024 15:30:00			0.01	0.00	0.17	0.17	0.12	0.55						
03/09/2024 15:45:00			0.01	0.00	0.17	0.17	0.12	0.54						
03/09/2024 16:00:00			0.01	0.00	0.17	0.17	0.11	0.54						
03/09/2024 16:15:00			0.01	0.00	0.17	0.17	0.11	0.54						
03/09/2024 16:30:00			0.01	0.00	0.17	0.16	0.11	0.53						
03/09/2024 16:45:00			0.01	0.00	0.16	0.16	0.11	0.53						
03/09/2024 17:00:00			0.01	0.00	0.16	0.16	0.11	0.53						
03/09/2024 17:15:00			0.01	0.00	0.16	0.16	0.11	0.53						
03/09/2024 17:30:00			0.01	0.00	0.16	0.16	0.11	0.53						
03/09/2024 17:45:00			0.01	0.00	0.16	0.16	0.10	0.53						
03/09/2024 18:00:00			0.01	0.00	0.16	0.16	0.10	0.53						
03/09/2024 18:15:00			0.01	0.00	0.16	0.16	0.10	0.52						
03/09/2024 18:30:00			0.01	0.00	0.16	0.16	0.10	0.52						
03/09/2024 18:45:00			0.01	0.00	0.15	0.15	0.10	0.52						
03/09/2024 19:00:00			0.01	0.00	0.15	0.15	0.10	0.52						
03/09/2024 19:15:00			0.01	0.00	0.15	0.15	0.10	0.52						
03/09/2024 19:30:00			0.01	0.00	0.15	0.15	0.10	0.52						
03/09/2024 19:45:00			0.00	0.00	0.15	0.15	0.10	0.52						
03/09/2024 20:00:00			0.00	0.00	0.15	0.15	0.10	0.52						
03/09/2024 20:15:00			0.00	0.00	0.15	0.15	0.09	0.52						
03/09/2024 20:30:00			0.00	0.00	0.15	0.15	0.09	0.52						
03/09/2024 20:45:00			0.00	0.00	0.15	0.15	0.09	0.53						
03/09/2024 21:00:00			0.00	0.00	0.15	0.15	0.09	0.53						
03/09/2024 21:15:00			0.00	0.00	0.15	0.15	0.09	0.53						
03/09/2024 21:30:00			0.00	0.00	0.14	0.15	0.09	0.53						
03/09/2024 21:45:00			0.00	0.00	0.14	0.15	0.09	0.53						
03/09/2024 22:00:00			0.00	0.00	0.14	0.15	0.09	0.53						
03/09/2024 22:15:00			0.00	0.00	0.14	0.15	0.09	0.53						
03/09/2024 22:30:00			0.00	0.00	0.14	0.15	0.09	0.53						
03/09/2024 22:45:00			0.00	0.00	0.14	0.15	0.09	0.53						
03/09/2024 23:00:00			0.00	0.00	0.14	0.15	0.09	0.53						
03/09/2024 23:15:00			0.00	0.00	0.14	0.15	0.09	0.53						
03/09/2024 23:30:00			0.00	0.00	0.14	0.15	0.09	0.53						
03/09/2024 23:45:00			0.00	0.00	0.14	0.15	0.09	0.54						
04/09/2024 00:00:00			0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 00:15:00			0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 00:30:00			0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 00:45:00			0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 01:00:00			0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 01:15:00			0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 01:30:00			0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 01:45:00			0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 02:00:00			0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 02:15:00			0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 02:30:00			0.00	0.00	0.15	0.15	0.09	0.52						
04/09/2024 02:45:00			0.00	0.00	0.15	0.15	0.09	0.52						
04/09/2024 03:00:00			0.00	0.00	0.15	0.15	0.09	0.52						
04/09/2024 03:15:00			0.00	0.00	0.15	0.15	0.09	0.52						
04/09/2024 03:30:00			0.00	0.00	0.15	0.15	0.09	0.52						
04/09/2024 03:45:00			0.00	0.00	0.14	0.15	0.09	0.52						
04/09/2024 04:00:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 04:15:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 04:30:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 04:45:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 05:00:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 05:15:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 05:30:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 05:45:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 06:00:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 06:15:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 06:30:00			0.00	0.00	0.14	0.14	0.09	0.52						
04/09/2024 06:45:00			-0.01	0.00	0.14	0.14	0.09	0.52						
04/09/2024 07:00:00			-0.01	0.00	0.14	0.14	0.09	0.52						
04/09/2024 07:15:00			-0.01	0.00	0.14	0.14	0.09	0.52						
04/09/2024 07:30:00			-0.01	0.00	0.14	0.14	0.09	0.52						
04/09/2024 07:45:00			-0.01	0.00	0.14	0.14	0.09	0.53						
04/09/2024 08:00:00			-0.01	0.00	0.14	0.14	0.09	0.53						
04/09/2024 08:15:00			-0.01	0.00	0.14	0.14	0.09	0.53						
04/09/2024 08:30:00			-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 08:45:00			-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 09:00:00			-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 09:15:00			-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 09:30:00			-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 09:45:00			-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 10:00:00			-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 10:15	0.55		-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 10:30	0.55		-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 10:45	0.56		-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 11:00	0.56		-0.01	0.00	0.14	0.14	0.09	0.54						
04/09/2024 11:15	0.56		0.00	0.00	0.14	0.14	0.09	0.54						
04/09/2024 11:30	0.56		0.00	0.00	0.14	0.14	0.09	0.54						
04/09/2024 11:45	0.56		0.00	0.00	0.15	0.14	0.09	0.54						
04/09/2024 12:00	0.56		0.00	0.00	0.15	0.14	0.09	0.54						
04/09/2024 12:15	0.56		0.00	0.00	0.15	0.14	0.09	0.54						
04/09/2024 12:30	0.56		0.00	0.00	0.15	0.14	0.09	0.54						
04/09/2024 12:45	0.56		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 13:00	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 13:15	0.57		-0.01	0.00	0.15	0.15	0.09	0.54						
04/09/2024 13:30	0.57		-0.01	0.00	0.15	0.15	0.09	0.54						
04/09/2024 13:45	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 14:00	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 14:15	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 14:30	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 14:45	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 15:00	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 15:15	0.57		-0.01	0.00	0.15	0.15	0.09	0.54						
04/09/2024 15:30	0.58		-0.01	0.00	0.15	0.15	0.09	0.53						
04/09/2024 15:45	0.58		0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 16:00	0.58		0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 16:15	0.58		0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 16:30	0.58		0.00	0.00	0.15	0.15	0.09	0.53						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
04/09/2024 16:45	0.57		0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 17:00	0.57		0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 17:15	0.57		0.00	0.00	0.15	0.15	0.09	0.53						
04/09/2024 17:30	0.57		-0.01	0.00	0.15	0.15	0.09	0.53						
04/09/2024 17:45	0.57		-0.01	0.00	0.15	0.15	0.09	0.54						
04/09/2024 18:00	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 18:15	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 18:30	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 18:45	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 19:00	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 19:15	0.57		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 19:30	0.56		0.00	0.00	0.15	0.15	0.09	0.54						
04/09/2024 19:45	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
04/09/2024 20:00	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
04/09/2024 20:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
04/09/2024 20:30	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
04/09/2024 20:45	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
04/09/2024 21:00	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
04/09/2024 21:15	0.56		-0.01	0.00	0.15	0.15	0.10	0.55						
04/09/2024 21:30	0.55		-0.01	0.00	0.15	0.15	0.10	0.55						
04/09/2024 21:45	0.55		0.00	0.00	0.15	0.15	0.10	0.55						
04/09/2024 22:00	0.55		0.00	0.00	0.15	0.15	0.10	0.54						
04/09/2024 22:15	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
04/09/2024 22:30	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
04/09/2024 22:45	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
04/09/2024 23:00	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
04/09/2024 23:15	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
04/09/2024 23:30	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
04/09/2024 23:45	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
05/09/2024 00:00	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
05/09/2024 00:15	0.55		0.00	0.00	0.15	0.15	0.10	0.53						
05/09/2024 00:30	0.55		0.00	0.00	0.15	0.15	0.10	0.53						
05/09/2024 00:45	0.55		-0.01	0.00	0.15	0.15	0.10	0.53						
05/09/2024 01:00	0.55		0.00	0.00	0.15	0.15	0.10	0.53						
05/09/2024 01:15	0.55		0.00	0.00	0.15	0.15	0.10	0.53						
05/09/2024 01:30	0.56		0.00	0.00	0.15	0.15	0.10	0.52						
05/09/2024 01:45	0.56		0.00	0.00	0.15	0.15	0.09	0.52						
05/09/2024 02:00	0.56		-0.01	0.00	0.15	0.15	0.09	0.52						
05/09/2024 02:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.52						
05/09/2024 02:30	0.56		-0.01	0.00	0.15	0.15	0.09	0.52						
05/09/2024 02:45	0.56		-0.01	0.00	0.15	0.15	0.09	0.52						
05/09/2024 03:00	0.56		-0.01	0.00	0.15	0.15	0.09	0.52						
05/09/2024 03:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.52						
05/09/2024 03:30	0.56		-0.01	0.00	0.14	0.15	0.09	0.52						
05/09/2024 03:45	0.56		-0.01	0.00	0.14	0.14	0.09	0.52						
05/09/2024 04:00	0.56		-0.01	0.00	0.14	0.14	0.09	0.52						
05/09/2024 04:15	0.56		-0.01	0.00	0.14	0.14	0.09	0.52						
05/09/2024 04:30	0.56		-0.01	0.00	0.14	0.14	0.09	0.52						
05/09/2024 04:45	0.56		-0.01	0.00	0.14	0.14	0.09	0.51						
05/09/2024 05:00	0.56		-0.01	0.00	0.14	0.14	0.09	0.51						
05/09/2024 05:15	0.57		-0.01	0.00	0.14	0.14	0.09	0.51						
05/09/2024 05:30	0.56		-0.01	0.00	0.14	0.14	0.09	0.51						
05/09/2024 05:45	0.57		-0.01	0.00	0.14	0.14	0.09	0.51						
05/09/2024 06:00	0.56		-0.01	0.00	0.14	0.14	0.09	0.51						
05/09/2024 06:15	0.56		-0.01	0.00	0.14	0.14	0.09	0.52						
05/09/2024 06:30	0.56		-0.01	0.00	0.14	0.14	0.09	0.52						
05/09/2024 06:45	0.56		-0.01	0.00	0.14	0.14	0.09	0.52						
05/09/2024 07:00	0.56		-0.01	0.00	0.14	0.14	0.09	0.52						
05/09/2024 07:15	0.56		-0.01	0.00	0.14	0.14	0.08	0.52						
05/09/2024 07:30	0.56		-0.01	0.00	0.14	0.14	0.08	0.52						
05/09/2024 07:45	0.56		-0.01	0.00	0.14	0.14	0.08	0.53						
05/09/2024 08:00	0.56		0.00	0.00	0.14	0.14	0.08	0.53						
05/09/2024 08:15	0.56		-0.01	0.00	0.14	0.14	0.08	0.53						
05/09/2024 08:30	0.56		-0.01	0.00	0.14	0.14	0.08	0.54						
05/09/2024 08:45	0.56		-0.01	0.00	0.14	0.14	0.08	0.54						
05/09/2024 09:00	0.56		-0.01	0.00	0.14	0.14	0.08	0.54						
05/09/2024 09:15	0.56		-0.01	0.00	0.14	0.14	0.09	0.55						
05/09/2024 09:30	0.56		-0.01	0.00	0.14	0.14	0.09	0.55						
05/09/2024 09:45	0.56		-0.01	0.00	0.14	0.14	0.09	0.55						
05/09/2024 10:00	0.56		-0.01	0.00	0.14	0.14	0.09	0.55						
05/09/2024 10:15	0.55		-0.01	0.00	0.14	0.14	0.09	0.55						
05/09/2024 10:30	0.55		-0.01	0.00	0.14	0.14	0.09	0.55						
05/09/2024 10:45	0.55		-0.01	0.00	0.14	0.15	0.09	0.55						
05/09/2024 11:00	0.55		-0.01	0.00	0.15	0.15	0.09	0.55						
05/09/2024 11:15	0.55		-0.01	0.00	0.15	0.15	0.09	0.55						
05/09/2024 11:30	0.55		-0.01	0.00	0.15	0.15	0.09	0.55						
05/09/2024 11:45	0.55		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 12:00	0.55		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 12:15	0.55		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 12:30	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
05/09/2024 12:45	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
05/09/2024 13:00	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
05/09/2024 13:15	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
05/09/2024 13:30	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
05/09/2024 13:45	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
05/09/2024 14:00	0.56		-0.01	0.00	0.15	0.15	0.10	0.54						
05/09/2024 14:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 14:30	0.56		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 14:45	0.56		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 15:00	0.56		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 15:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 15:30	0.56		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 15:45	0.56		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 16:00	0.56		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 16:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 16:30	0.56		-0.01	0.00	0.15	0.15	0.09	0.54						
05/09/2024 16:45	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 17:00	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 17:15	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 17:30	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 17:45	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 18:00	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 18:15	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 18:30	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 18:45	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 19:00	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 19:15	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 19:30	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
05/09/2024 19:45	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 20:00	0.56		0.00	0.00	0.15	0.15	0.10	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
05/09/2024 20:15	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 20:30	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 20:45	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 21:00	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 21:15	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 21:30	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 21:45	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 22:00	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 22:15	0.55		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 22:30	0.55		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 22:45	0.55		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 23:00	0.55		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 23:15	0.55		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 23:30	0.55		0.00	0.00	0.15	0.15	0.10	0.55						
05/09/2024 23:45	0.55		0.00	0.00	0.15	0.15	0.10	0.54						
06/09/2024 00:00	0.55		0.00	0.00	0.15	0.15	0.10	0.54						
06/09/2024 00:15	0.55		0.00	0.00	0.15	0.15	0.10	0.54						
06/09/2024 00:30	0.55		0.00	0.00	0.15	0.15	0.10	0.54						
06/09/2024 00:45	0.55		0.00	0.00	0.15	0.15	0.10	0.54						
06/09/2024 01:00	0.55		0.00	0.00	0.15	0.15	0.10	0.54						
06/09/2024 01:15	0.55		-0.01	0.00	0.15	0.15	0.10	0.54						
06/09/2024 01:30	0.55		-0.01	0.00	0.15	0.15	0.10	0.53						
06/09/2024 01:45	0.55		-0.01	0.00	0.15	0.15	0.10	0.53						
06/09/2024 02:00	0.56		-0.01	0.00	0.15	0.15	0.09	0.53						
06/09/2024 02:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.53						
06/09/2024 02:30	0.56		-0.01	0.00	0.15	0.15	0.09	0.53						
06/09/2024 02:45	0.56		0.00	0.00	0.15	0.15	0.09	0.53						
06/09/2024 03:00	0.56		0.00	0.00	0.15	0.15	0.09	0.53						
06/09/2024 03:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.53						
06/09/2024 03:30	0.56		0.00	0.00	0.15	0.15	0.09	0.53						
06/09/2024 03:45	0.56		0.00	0.00	0.15	0.15	0.09	0.53						
06/09/2024 04:00	0.56		-0.01	0.00	0.14	0.15	0.09	0.53						
06/09/2024 04:15	0.57		-0.01	0.00	0.14	0.15	0.09	0.52						
06/09/2024 04:30	0.57		-0.01	0.00	0.14	0.15	0.09	0.52						
06/09/2024 04:45	0.57		-0.01	0.00	0.14	0.15	0.09	0.52						
06/09/2024 05:00	0.57		0.00	0.00	0.14	0.15	0.09	0.52						
06/09/2024 05:15	0.57		0.00	0.00	0.14	0.15	0.09	0.52						
06/09/2024 05:30	0.57		0.00	0.00	0.14	0.15	0.09	0.52						
06/09/2024 05:45	0.57		0.00	0.00	0.14	0.14	0.09	0.52						
06/09/2024 06:00	0.57		0.00	0.00	0.14	0.15	0.09	0.53						
06/09/2024 06:15	0.57		-0.01	0.00	0.14	0.14	0.09	0.53						
06/09/2024 06:30	0.57		-0.01	0.00	0.14	0.14	0.09	0.53						
06/09/2024 06:45	0.57		-0.01	0.00	0.14	0.14	0.09	0.53						
06/09/2024 07:00	0.57		-0.01	0.00	0.14	0.14	0.09	0.53						
06/09/2024 07:15	0.57		-0.01	0.00	0.14	0.14	0.09	0.53						
06/09/2024 07:30	0.57		-0.01	0.00	0.14	0.14	0.09	0.54						
06/09/2024 07:45	0.56		-0.01	0.00	0.14	0.14	0.09	0.54						
06/09/2024 08:00	0.56		-0.01	0.00	0.14	0.14	0.09	0.54						
06/09/2024 08:15	0.56		-0.01	0.00	0.14	0.14	0.09	0.54						
06/09/2024 08:30	0.56		-0.01	0.00	0.14	0.14	0.09	0.55						
06/09/2024 08:45	0.56		-0.01	0.00	0.14	0.14	0.09	0.55						
06/09/2024 09:00	0.56		-0.01	0.00	0.14	0.15	0.09	0.55						
06/09/2024 09:15	0.56		-0.01	0.00	0.14	0.15	0.09	0.55						
06/09/2024 09:30	0.56		-0.01	0.00	0.14	0.15	0.09	0.55						
06/09/2024 09:45	0.56		-0.01	0.00	0.14	0.15	0.09	0.55						
06/09/2024 10:00	0.56		-0.01	0.00	0.14	0.15	0.09	0.55						
06/09/2024 10:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 10:30	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 10:45	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 11:00	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 11:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 11:30	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 11:45	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 12:00	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 12:15	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 12:30	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 12:45	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 13:00	0.56		-0.01	0.00	0.15	0.15	0.09	0.55						
06/09/2024 13:15	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 13:30	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 13:45	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 14:00	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 14:15	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 14:30	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
06/09/2024 14:45	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
06/09/2024 15:00	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
06/09/2024 15:15	0.56		0.00	0.00	0.15	0.15	0.10	0.55						
06/09/2024 15:30	0.57		0.00	0.00	0.15	0.15	0.10	0.55						
06/09/2024 15:45	0.57		0.00	0.00	0.15	0.15	0.10	0.55						
06/09/2024 16:00	0.57		0.00	0.00	0.15	0.15	0.10	0.55						
06/09/2024 16:15	0.57		0.00	0.00	0.15	0.15	0.10	0.55						
06/09/2024 16:30	0.57		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 16:45	0.57		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 17:00	0.57		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 17:15	0.57		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 17:30	0.57		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 17:45	0.57		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 18:00	0.57		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 18:15	0.57		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 18:30	0.57		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 18:45	0.57		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 19:00	0.57		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 19:15	0.57		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 19:30	0.57		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 19:45	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 20:00	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 20:15	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 20:30	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
06/09/2024 20:45	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 21:00	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 21:15	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 21:30	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 21:45	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 22:00	0.56		0.00	0.00	0.15	0.15	0.09	0.55						
06/09/2024 22:15	0.56		0.00	0.00	0.15	0.14	0.09	0.55						
06/09/2024 22:30	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
06/09/2024 22:45	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
06/09/2024 23:00	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
06/09/2024 23:15	0.55		0.00	0.00	0.15	0.16	0.09	0.55						
06/09/2024 23:30	0.55		0.00	0.00	0.15	0.16	0.09	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
06/09/2024 23:45	0.55		0.00	0.00	0.15	0.16	0.09	0.55						
07/09/2024 00:00	0.55		0.00	0.00	0.15	0.16	0.09	0.55						
07/09/2024 00:15	0.55		0.00	0.00	0.15	0.16	0.09	0.55						
07/09/2024 00:30	0.55		0.00	0.00	0.15	0.16	0.09	0.54						
07/09/2024 00:45	0.55		0.00	0.00	0.15	0.16	0.09	0.54						
07/09/2024 01:00	0.55		0.00	0.00	0.15	0.16	0.09	0.54						
07/09/2024 01:15	0.55		0.00	0.00	0.15	0.16	0.09	0.54						
07/09/2024 01:30	0.55		0.00	0.00	0.15	0.15	0.09	0.54						
07/09/2024 01:45	0.55		0.00	0.00	0.15	0.15	0.09	0.54						
07/09/2024 02:00	0.55		0.00	0.00	0.15	0.15	0.09	0.54						
07/09/2024 02:15	0.55		0.00	0.00	0.15	0.15	0.09	0.54						
07/09/2024 02:30	0.55		0.00	0.00	0.15	0.15	0.09	0.54						
07/09/2024 02:45	0.56		0.00	0.00	0.15	0.15	0.09	0.54						
07/09/2024 03:00	0.55		0.00	0.00	0.14	0.15	0.09	0.54						
07/09/2024 03:15	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
07/09/2024 03:30	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
07/09/2024 03:45	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 04:00	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 04:15	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 04:30	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 04:45	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 05:00	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 05:15	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 05:30	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 05:45	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 06:00	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 06:15	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 06:30	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 06:45	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 07:00	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 07:15	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 07:30	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
07/09/2024 07:45	0.56		0.00	0.00	0.14	0.15	0.08	0.53						
07/09/2024 08:00	0.56		0.00	0.00	0.14	0.15	0.08	0.53						
07/09/2024 08:15	0.56		0.00	0.00	0.14	0.15	0.08	0.54						
07/09/2024 08:30	0.56		0.00	0.00	0.14	0.15	0.08	0.54						
07/09/2024 08:45	0.56		0.00	0.00	0.14	0.15	0.08	0.55						
07/09/2024 09:00	0.56		-0.01	0.00	0.14	0.15	0.08	0.55						
07/09/2024 09:15	0.55		-0.01	0.00	0.14	0.15	0.08	0.55						
07/09/2024 09:30	0.55		-0.01	0.00	0.14	0.15	0.08	0.55						
07/09/2024 09:45	0.55		-0.01	0.00	0.14	0.15	0.09	0.56						
07/09/2024 10:00	0.55		-0.01	0.00	0.14	0.15	0.09	0.56						
07/09/2024 10:15	0.55		-0.01	0.00	0.14	0.15	0.09	0.56						
07/09/2024 10:30	0.55		-0.01	0.00	0.14	0.15	0.09	0.56						
07/09/2024 10:45	0.55		-0.01	0.00	0.14	0.15	0.09	0.56						
07/09/2024 11:00	0.55		-0.01	0.00	0.14	0.15	0.09	0.56						
07/09/2024 11:15	0.55		-0.01	0.00	0.14	0.15	0.09	0.56						
07/09/2024 11:30	0.55		-0.01	0.00	0.15	0.15	0.09	0.56						
07/09/2024 11:45	0.55		-0.01	0.00	0.15	0.15	0.09	0.56						
07/09/2024 12:00	0.55		-0.01	0.00	0.15	0.16	0.09	0.56						
07/09/2024 12:15	0.55		-0.01	0.00	0.15	0.16	0.09	0.56						
07/09/2024 12:30	0.55		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 12:45	0.55		-0.01	0.00	0.15	0.16	0.09	0.56						
07/09/2024 13:00	0.55		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 13:15	0.55		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 13:30	0.55		0.00	0.00	0.15	0.16	0.10	0.54						
07/09/2024 13:45	0.55		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 14:00	0.55		0.00	0.00	0.15	0.16	0.10	0.56						
07/09/2024 14:15	0.55		0.00	0.00	0.15	0.16	0.10	0.56						
07/09/2024 14:30	0.55		0.00	0.00	0.15	0.16	0.10	0.56						
07/09/2024 14:45	0.55		0.00	0.00	0.15	0.16	0.10	0.56						
07/09/2024 15:00	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 15:15	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 15:30	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 15:45	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 16:00	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 16:15	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
07/09/2024 16:30	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
07/09/2024 16:45	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
07/09/2024 17:00	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
07/09/2024 17:15	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
07/09/2024 17:30	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
07/09/2024 17:45	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
07/09/2024 18:00	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 18:15	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
07/09/2024 18:30	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
07/09/2024 18:45	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 19:00	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
07/09/2024 19:15	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
07/09/2024 19:30	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
07/09/2024 19:45	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
07/09/2024 20:00	0.56		0.00	0.00	0.15	0.15	0.09	0.56						
07/09/2024 20:15	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 20:30	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 20:45	0.56		0.00	0.00	0.15	0.15	0.09	0.57						
07/09/2024 21:00	0.56		0.00	0.00	0.15	0.16	0.09	0.57						
07/09/2024 21:15	0.56		0.00	0.00	0.15	0.16	0.09	0.57						
07/09/2024 21:30	0.56		0.00	0.00	0.15	0.16	0.09	0.57						
07/09/2024 21:45	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 22:00	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 22:15	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 22:30	0.56		0.00	0.00	0.15	0.16	0.09	0.56						
07/09/2024 22:45	0.56		-0.01	0.00	0.15	0.16	0.10	0.56						
07/09/2024 23:00	0.56		0.00	0.00	0.15	0.16	0.10	0.56						
07/09/2024 23:15	0.56		0.00	0.00	0.15	0.16	0.10	0.56						
07/09/2024 23:30	0.56		0.00	0.00	0.15	0.16	0.10	0.56						
07/09/2024 23:45	0.56		0.00	0.00	0.15	0.16	0.10	0.56						
08/09/2024 00:00	0.56		0.00	0.00	0.15	0.16	0.10	0.55						
08/09/2024 00:15	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
08/09/2024 00:30	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
08/09/2024 00:45	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
08/09/2024 01:00	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
08/09/2024 01:15	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
08/09/2024 01:30	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
08/09/2024 01:45	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
08/09/2024 02:00	0.56		0.00	0.00	0.15	0.16	0.09	0.55						
08/09/2024 02:15	0.56		0.00	0.00	0.15	0.16	0.09	0.54						
08/09/2024 02:30	0.56		0.00	0.00	0.15	0.16	0.09	0.54						
08/09/2024 02:45	0.56		0.00	0.00	0.15	0.16	0.09	0.54						
08/09/2024 03:00	0.56		0.00	0.00	0.15	0.16	0.09	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
08/09/2024 03:15	0.56		0.00	0.00	0.14	0.16	0.09	0.54						
08/09/2024 03:30	0.56		0.00	0.00	0.14	0.16	0.09	0.54						
08/09/2024 03:45	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 04:00	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 04:15	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 04:30	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 04:45	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 05:00	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 05:15	0.56		0.00	0.00	0.14	0.15	0.09	0.53						
08/09/2024 05:30	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 05:45	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 06:00	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 06:15	0.57		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 06:30	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 06:45	0.57		0.00	0.00	0.14	0.15	0.08	0.54						
08/09/2024 07:00	0.57		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 07:15	0.57		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 07:30	0.57		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 07:45	0.57		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 08:00	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 08:15	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 08:30	0.56		0.01	0.00	0.14	0.15	0.09	0.54						
08/09/2024 08:45	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 09:00	0.56		0.00	0.00	0.14	0.15	0.09	0.54						
08/09/2024 09:15	0.56		0.00	0.00	0.14	0.15	0.09	0.55						
08/09/2024 09:30	0.56		0.00	0.00	0.14	0.15	0.09	0.55						
08/09/2024 09:45	0.56		0.00	0.00	0.14	0.15	0.09	0.56						
08/09/2024 10:00	0.56		0.00	0.00	0.14	0.15	0.09	0.56						
08/09/2024 10:15	0.56		0.00	0.00	0.14	0.15	0.09	0.56						
08/09/2024 10:30	0.56		0.00	0.00	0.14	0.15	0.09	0.56						
08/09/2024 10:45	0.56		0.00	0.00	0.14	0.15	0.09	0.56						
08/09/2024 11:00	0.56		0.00	0.00	0.14	0.15	0.09	0.56						
08/09/2024 11:15	0.56		0.00	0.00	0.14	0.15	0.09	0.57						
08/09/2024 11:30	0.56		0.00	0.00	0.14	0.15	0.09	0.57						
08/09/2024 11:45	0.56		0.00	0.00	0.14	0.15	0.09	0.57						
08/09/2024 12:00	0.55		0.00	0.00	0.15	0.16	0.09	0.57						
08/09/2024 12:15	0.55		0.00	0.00	0.15	0.16	0.09	0.57						
08/09/2024 12:30	0.56		0.00	0.00	0.15	0.16	0.09	0.54						
08/09/2024 12:45	0.55		0.00	0.00	0.15	0.16	0.09	0.54						
08/09/2024 13:00	0.56		0.00	0.00	0.15	0.16	0.09	0.53						
08/09/2024 13:15	0.56		0.00	0.00	0.15	0.16	0.09	0.53						
08/09/2024 13:30	0.56		0.00	0.00	0.15	0.16	0.09	0.53						
08/09/2024 13:45	0.56		0.01	0.00	0.15	0.16	0.09	0.53						
08/09/2024 14:00	0.56		0.01	0.00	0.15	0.16	0.09	0.52						
08/09/2024 14:15	0.56		0.00	0.00	0.15	0.16	0.09	0.52						
08/09/2024 14:30	0.56		0.00	0.00	0.15	0.16	0.09	0.52						
08/09/2024 14:45	0.56		0.00	0.00	0.15	0.15	0.09	0.52						
08/09/2024 15:00	0.56		0.00	0.00	0.15	0.15	0.09	0.52						
08/09/2024 15:15	0.56		0.00	0.00	0.15	0.16	0.09	0.52						
08/09/2024 15:30	0.56		0.00	0.00	0.15	0.16	0.09	0.52						
08/09/2024 15:45	0.56		0.00	0.00	0.15	0.16	0.09	0.52						
08/09/2024 16:00	0.56		0.00	0.00	0.15	0.16	0.09	0.52						
08/09/2024 16:15	0.56		0.00	0.00	0.15	0.16	0.09	0.52						
08/09/2024 16:30	0.56		0.00	0.00	0.15	0.16	0.09	0.52						
08/09/2024 16:45	0.57		0.00	0.00	0.15	0.16	0.09	0.52						
08/09/2024 17:00	0.57		0.00	0.00	0.15	0.16	0.09	0.52						
08/09/2024 17:15	0.57		0.00	0.00	0.15	0.16	0.09	0.53						
08/09/2024 17:30	0.57		0.00	0.00	0.15	0.16	0.09	0.53						
08/09/2024 17:45	0.57		0.00	0.00	0.15	0.16	0.09	0.53						
08/09/2024 18:00	0.57		0.00	0.00	0.15	0.16	0.09	0.54						
08/09/2024 18:15	0.57		0.00	0.00	0.15	0.16	0.09	0.53						
08/09/2024 18:30	0.57		0.01	0.00	0.15	0.16	0.09	0.53						
08/09/2024 18:45	0.57		0.01	0.00	0.15	0.16	0.09	0.53						
08/09/2024 19:00	0.57		0.01	0.00	0.15	0.16	0.10	0.53						
08/09/2024 19:15	0.57		0.01	0.00	0.15	0.16	0.10	0.53						
08/09/2024 19:30	0.57		0.01	0.00	0.15	0.16	0.10	0.53						
08/09/2024 19:45	0.57		0.00	0.00	0.15	0.16	0.10	0.53						
08/09/2024 20:00	0.57		0.00	0.00	0.15	0.16	0.10	0.53						
08/09/2024 20:15	0.57		0.00	0.00	0.15	0.16	0.10	0.53						
08/09/2024 20:30	0.57		0.00	0.00	0.15	0.16	0.10	0.53						
08/09/2024 20:45	0.57		0.00	0.00	0.15	0.16	0.10	0.53						
08/09/2024 21:00	0.57		0.01	0.00	0.15	0.16	0.10	0.53						
08/09/2024 21:15	0.57		0.01	0.00	0.16	0.17	0.11	0.56						
08/09/2024 21:30	0.57		0.01	0.00	0.17	0.17	0.11	0.85						
08/09/2024 21:45	0.57		0.01	0.00	0.17	0.17	0.11	0.87						
08/09/2024 22:00	0.57		0.01	0.00	0.18	0.18	0.13	0.78						
08/09/2024 22:15	0.57		0.02	0.00	0.22	0.21	0.17	0.73						
08/09/2024 22:30	0.57		0.02	0.01	0.24	0.23	0.20	0.69						
08/09/2024 22:45	0.57		0.03	0.01	0.25	0.24	0.21	0.66						
08/09/2024 23:00	0.57		0.04	0.01	0.26	0.24	0.22	0.65						
08/09/2024 23:15	0.57		0.05	0.02	0.26	0.25	0.22	0.62						
08/09/2024 23:30	0.57		0.05	0.02	0.26	0.25	0.22	0.63						
08/09/2024 23:45	0.57		0.06	0.03	0.26	0.25	0.22	0.62						
09/09/2024 00:00	0.57		0.06	0.03	0.26	0.24	0.21	0.62						
09/09/2024 00:15	0.57		0.06	0.03	0.25	0.24	0.21	0.61						
09/09/2024 00:30	0.57		0.06	0.03	0.25	0.24	0.21	0.61						
09/09/2024 00:45	0.57		0.06	0.03	0.25	0.24	0.21	0.61						
09/09/2024 01:00	0.57		0.06	0.03	0.25	0.24	0.20	0.61						
09/09/2024 01:15	0.57		0.06	0.03	0.25	0.24	0.20	0.61						
09/09/2024 01:30	0.57		0.06	0.03	0.24	0.24	0.20	0.61						
09/09/2024 01:45	0.57		0.06	0.03	0.24	0.24	0.20	0.60						
09/09/2024 02:00	0.58		0.06	0.03	0.24	0.24	0.20	0.60						
09/09/2024 02:15	0.58		0.06	0.03	0.24	0.23	0.20	0.60						
09/09/2024 02:30	0.58		0.06	0.03	0.24	0.23	0.19	0.60						
09/09/2024 02:45	0.58		0.06	0.03	0.24	0.23	0.19	0.60						
09/09/2024 03:00	0.58		0.05	0.02	0.24	0.23	0.19	0.60						
09/09/2024 03:15	0.58		0.05	0.02	0.24	0.23	0.19	0.60						
09/09/2024 03:30	0.58		0.05	0.02	0.24	0.23	0.19	0.60						
09/09/2024 03:45	0.58		0.05	0.02	0.23	0.23	0.19	0.59						
09/09/2024 04:00	0.58		0.05	0.02	0.23	0.23	0.19	0.59						
09/09/2024 04:15	0.59		0.05	0.02	0.23	0.23	0.19	0.59						
09/09/2024 04:30	0.59		0.05	0.02	0.23	0.23	0.19	0.60						
09/09/2024 04:45	0.59		0.05	0.02	0.23	0.23	0.18	0.60						
09/09/2024 05:00	0.59		0.05	0.02	0.23	0.23	0.18	0.60						
09/09/2024 05:15	0.59		0.05	0.02	0.23	0.23	0.18	0.60						
09/09/2024 05:30	0.59		0.05	0.02	0.23	0.22	0.18	0.59						
09/09/2024 05:45	0.59		0.05	0.02	0.23	0.22	0.18	0.59						
09/09/2024 06:00	0.59		0.05	0.02	0.23	0.22	0.18	0.59						
09/09/2024 06:15	0.59		0.05	0.02	0.23	0.22	0.18	0.59						
09/09/2024 06:30	0.60		0.05	0.02	0.23	0.22	0.18	0.59						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
09/09/2024 06:45	0.60		0.05	0.02	0.23	0.22	0.18	0.59						
09/09/2024 07:00	0.60		0.05	0.02	0.23	0.22	0.18	0.59						
09/09/2024 07:15	0.60		0.05	0.02	0.23	0.22	0.18	0.59						
09/09/2024 07:30	0.60		0.05	0.02	0.23	0.22	0.18	0.59						
09/09/2024 07:45	0.60		0.05	0.02	0.23	0.22	0.18	0.59						
09/09/2024 08:00	0.60		0.05	0.02	0.23	0.22	0.18	0.59						
09/09/2024 08:15	0.60		0.05	0.02	0.22	0.22	0.18	0.59						
09/09/2024 08:30	0.60		0.05	0.02	0.22	0.22	0.18	0.59						
09/09/2024 08:45	0.60		0.05	0.02	0.22	0.22	0.18	0.59						
09/09/2024 09:00	0.60		0.04	0.02	0.22	0.22	0.18	0.59						
09/09/2024 09:15	0.60		0.04	0.02	0.22	0.22	0.17	0.59						
09/09/2024 09:30	0.60		0.04	0.02	0.22	0.22	0.17	0.59						
09/09/2024 09:45	0.60		0.04	0.02	0.22	0.22	0.17	0.59						
09/09/2024 10:00	0.60		0.04	0.02	0.22	0.22	0.17	0.58						
09/09/2024 10:15	0.60		0.05	0.02	0.22	0.22	0.17	0.58						
09/09/2024 10:30	0.60		0.04	0.02	0.22	0.22	0.17	0.58						
09/09/2024 10:45	0.60		0.04	0.02	0.22	0.22	0.17	0.58						
09/09/2024 11:00	0.60		0.05	0.02	0.22	0.22	0.17	0.58						
09/09/2024 11:15	0.60		0.04	0.02	0.22	0.22	0.17	0.58						
09/09/2024 11:30	0.60		0.04	0.02	0.22	0.22	0.17	0.58						
09/09/2024 11:45	0.60		0.04	0.02	0.22	0.22	0.17	0.58						
09/09/2024 12:00	0.60		0.04	0.02	0.22	0.21	0.17	0.58						
09/09/2024 12:15	0.61		0.04	0.02	0.22	0.21	0.17	0.58						
09/09/2024 12:30	0.61		0.05	0.02	0.22	0.21	0.17	0.58						
09/09/2024 12:45	0.61		0.04	0.02	0.22	0.21	0.17	0.58						
09/09/2024 13:00	0.61		0.04	0.01	0.22	0.21	0.17	0.58						
09/09/2024 13:15	0.61		0.04	0.01	0.22	0.21	0.17	0.57						
09/09/2024 13:30	0.61		0.04	0.01	0.22	0.21	0.17	0.57						
09/09/2024 13:45	0.61		0.04	0.01	0.22	0.21	0.17	0.57						
09/09/2024 14:00	0.61		0.04	0.01	0.22	0.21	0.17	0.57						
09/09/2024 14:15	0.61		0.04	0.01	0.22	0.21	0.17	0.57						
09/09/2024 14:30	0.61		0.04	0.01	0.22	0.21	0.17	0.57						
09/09/2024 14:45	0.61		0.04	0.01	0.21	0.21	0.16	0.57						
09/09/2024 15:00	0.61		0.04	0.01	0.21	0.21	0.16	0.57						
09/09/2024 15:15	0.61		0.04	0.02	0.21	0.21	0.16	0.57						
09/09/2024 15:30	0.61		0.04	0.01	0.21	0.21	0.16	0.57						
09/09/2024 15:45	0.61		0.04	0.01	0.21	0.21	0.16	0.57						
09/09/2024 16:00	0.61		0.04	0.01	0.21	0.21	0.16	0.57						
09/09/2024 16:15	0.61		0.04	0.01	0.21	0.21	0.16	0.57						
09/09/2024 16:30	0.62		0.04	0.01	0.21	0.21	0.16	0.57						
09/09/2024 16:45	0.62		0.04	0.01	0.21	0.21	0.16	0.57						
09/09/2024 17:00	0.62		0.04	0.01	0.21	0.21	0.16	0.57						
09/09/2024 17:15	0.62		0.03	0.01	0.21	0.21	0.16	0.57						
09/09/2024 17:30	0.62		0.03	0.01	0.21	0.21	0.16	0.57						
09/09/2024 17:45	0.62		0.03	0.01	0.21	0.21	0.16	0.57						
09/09/2024 18:00	0.62		0.03	0.01	0.21	0.21	0.16	0.56						
09/09/2024 18:15	0.62		0.03	0.01	0.21	0.21	0.16	0.56						
09/09/2024 18:30	0.62		0.03	0.01	0.21	0.21	0.16	0.56						
09/09/2024 18:45	0.62		0.03	0.01	0.21	0.20	0.16	0.56						
09/09/2024 19:00	0.62		0.03	0.01	0.21	0.20	0.15	0.56						
09/09/2024 19:15	0.62		0.03	0.01	0.21	0.20	0.15	0.56						
09/09/2024 19:30	0.62		0.03	0.01	0.21	0.20	0.15	0.56						
09/09/2024 19:45	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 20:00	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 20:15	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 20:30	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 20:45	0.62		0.03	0.01	0.20	0.20	0.15	0.57						
09/09/2024 21:00	0.62		0.03	0.01	0.20	0.20	0.15	0.57						
09/09/2024 21:15	0.62		0.03	0.01	0.20	0.20	0.15	0.57						
09/09/2024 21:30	0.62		0.03	0.01	0.20	0.20	0.15	0.57						
09/09/2024 21:45	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 22:00	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 22:15	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 22:30	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 22:45	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 23:00	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 23:15	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 23:30	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
09/09/2024 23:45	0.62		0.03	0.01	0.20	0.20	0.15	0.56						
10/09/2024 00:00	0.62		0.02	0.01	0.20	0.20	0.15	0.55						
10/09/2024 00:15	0.62		0.03	0.01	0.20	0.20	0.15	0.55						
10/09/2024 00:30	0.62		0.03	0.01	0.20	0.20	0.15	0.55						
10/09/2024 00:45	0.62		0.02	0.01	0.20	0.20	0.15	0.55						
10/09/2024 01:00	0.62		0.02	0.01	0.20	0.20	0.15	0.55						
10/09/2024 01:15	0.62		0.02	0.01	0.20	0.20	0.15	0.55						
10/09/2024 01:30	0.62		0.02	0.01	0.20	0.20	0.15	0.55						
10/09/2024 01:45	0.62		0.02	0.01	0.20	0.20	0.14	0.55						
10/09/2024 02:00	0.62		0.02	0.01	0.20	0.20	0.14	0.55						
10/09/2024 02:15	0.62		0.02	0.00	0.20	0.20	0.14	0.55						
10/09/2024 02:30	0.62		0.02	0.00	0.20	0.20	0.14	0.54						
10/09/2024 02:45	0.62		0.02	0.00	0.19	0.20	0.14	0.54						
10/09/2024 03:00	0.62		0.02	0.01	0.19	0.20	0.14	0.54						
10/09/2024 03:15	0.63		0.02	0.00	0.19	0.20	0.14	0.53						
10/09/2024 03:30	0.63		0.02	0.00	0.19	0.19	0.14	0.53						
10/09/2024 03:45	0.63		0.01	0.00	0.19	0.19	0.14	0.53						
10/09/2024 04:00	0.63		0.02	0.00	0.19	0.19	0.14	0.53						
10/09/2024 04:15	0.63		0.02	0.00	0.19	0.19	0.14	0.53						
10/09/2024 04:30	0.63		0.02	0.00	0.19	0.19	0.14	0.53						
10/09/2024 04:45	0.63		0.02	0.00	0.19	0.19	0.13	0.52						
10/09/2024 05:00	0.63		0.01	0.00	0.19	0.19	0.13	0.52						
10/09/2024 05:15	0.63		0.01	0.00	0.18	0.19	0.13	0.52						
10/09/2024 05:30	0.63		0.01	0.00	0.18	0.19	0.13	0.52						
10/09/2024 05:45	0.63		0.01	0.00	0.18	0.19	0.13	0.52						
10/09/2024 06:00	0.63		0.01	0.00	0.18	0.19	0.13	0.52						
10/09/2024 06:15	0.63		0.01	0.00	0.18	0.18	0.13	0.52						
10/09/2024 06:30	0.63		0.01	0.00	0.18	0.18	0.12	0.52						
10/09/2024 06:45	0.63		0.01	0.00	0.18	0.18	0.12	0.52						
10/09/2024 07:00	0.63		0.01	0.00	0.18	0.18	0.12	0.52						
10/09/2024 07:15	0.63		0.01	0.00	0.18	0.18	0.12	0.53						
10/09/2024 07:30	0.63		0.01	0.00	0.18	0.18	0.12	0.53						
10/09/2024 07:45	0.63		0.01	0.00	0.17	0.18	0.12	0.53						
10/09/2024 08:00	0.63		0.01	0.00	0.17	0.18	0.12	0.53						
10/09/2024 08:15	0.63		0.01	0.00	0.17	0.18	0.12	0.53						
10/09/2024 08:30	0.63		0.01	0.00	0.17	0.18	0.12	0.54						
10/09/2024 08:45	0.63		0.01	0.00	0.17	0.18	0.12	0.54						
10/09/2024 09:00	0.63		0.00	0.00	0.17	0.18	0.12	0.54						
10/09/2024 09:15	0.63		0.01	0.00	0.17	0.18	0.12	0.54						
10/09/2024 09:30	0.63		0.01	0.00	0.17	0.18	0.12	0.54						
10/09/2024 09:45	0.63		0.00	0.00	0.17	0.18	0.12	0.54						
10/09/2024 10:00	0.63		0.00	0.00	0.17	0.18	0.12	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
10/09/2024 10:15	0.63		0.00	0.00	0.18	0.18	0.12	0.54						
10/09/2024 10:30	0.63		0.01	0.00	0.18	0.18	0.12	0.54						
10/09/2024 10:45	0.63		0.00	0.00	0.18	0.18	0.12	0.54						
10/09/2024 11:00	0.63		0.00	0.00	0.18	0.18	0.12	0.53						
10/09/2024 11:15	0.63		0.01	0.00	0.18	0.18	0.12	0.53						
10/09/2024 11:30	0.63		0.00	0.00	0.18	0.18	0.12	0.54						
10/09/2024 11:45	0.62		0.01	0.00	0.18	0.18	0.12	0.54						
10/09/2024 12:00	0.62		0.01	0.00	0.18	0.18	0.12	0.54						
10/09/2024 12:15	0.62		0.01	0.00	0.18	0.18	0.12	0.54						
10/09/2024 12:30	0.62		0.01	0.00	0.18	0.18	0.12	0.54						
10/09/2024 12:45	0.62		0.01	0.00	0.18	0.18	0.12	0.53						
10/09/2024 13:00	0.62		0.01	0.00	0.18	0.18	0.12	0.53						
10/09/2024 13:15	0.62		0.00	0.00	0.18	0.18	0.12	0.53						
10/09/2024 13:30	0.62		0.01	0.00	0.18	0.18	0.12	0.53						
10/09/2024 13:45	0.62		0.01	0.00	0.18	0.18	0.12	0.53						
10/09/2024 14:00	0.62		0.01	0.00	0.18	0.18	0.12	0.53						
10/09/2024 14:15	0.62		0.01	0.00	0.17	0.18	0.12	0.53						
10/09/2024 14:30	0.62		0.01	0.00	0.17	0.18	0.12	0.53						
10/09/2024 14:45	0.62		0.01	0.00	0.17	0.18	0.12	0.53						
10/09/2024 15:00	0.62		0.01	0.00	0.17	0.18	0.12	0.53						
10/09/2024 15:15	0.62		0.01	0.00	0.17	0.18	0.12	0.53						
10/09/2024 15:30	0.62		0.01	0.00	0.17	0.18	0.12	0.53						
10/09/2024 15:45	0.62		0.01	0.00	0.17	0.18	0.12	0.52						
10/09/2024 16:00	0.62		0.01	0.00	0.17	0.18	0.12	0.52						
10/09/2024 16:15	0.62		0.01	0.00	0.17	0.18	0.12	0.52						
10/09/2024 16:30	0.62		0.01	0.00	0.17	0.18	0.12	0.52						
10/09/2024 16:45	0.62		0.01	0.00	0.17	0.18	0.12	0.52						
10/09/2024 17:00	0.62		0.01	0.00	0.17	0.18	0.11	0.52						
10/09/2024 17:15	0.63		0.01	0.00	0.17	0.17	0.11	0.52						
10/09/2024 17:30	0.63		0.01	0.00	0.17	0.17	0.11	0.52						
10/09/2024 17:45	0.63		0.01	0.00	0.17	0.17	0.11	0.52						
10/09/2024 18:00	0.63		0.01	0.00	0.17	0.17	0.11	0.53						
10/09/2024 18:15	0.63		0.01	0.00	0.17	0.17	0.11	0.53						
10/09/2024 18:30	0.63		0.01	0.00	0.17	0.17	0.11	0.53						
10/09/2024 18:45	0.63		0.01	0.00	0.17	0.17	0.11	0.53						
10/09/2024 19:00	0.63		0.01	0.00	0.17	0.17	0.11	0.53						
10/09/2024 19:15	0.63		0.01	0.00	0.17	0.17	0.11	0.55						
10/09/2024 19:30	0.63		0.01	0.00	0.17	0.17	0.11	0.56						
10/09/2024 19:45	0.63		0.01	0.00	0.17	0.17	0.11	0.57						
10/09/2024 20:00	0.63		0.01	0.00	0.17	0.18	0.12	0.58						
10/09/2024 20:15	0.63		0.00	0.00	0.17	0.18	0.12	0.58						
10/09/2024 20:30	0.63		0.01	0.00	0.17	0.18	0.12	0.59						
10/09/2024 20:45	0.63		0.01	0.00	0.18	0.18	0.12	0.59						
10/09/2024 21:00	0.63		0.01	0.00	0.18	0.18	0.12	0.59						
10/09/2024 21:15	0.63		0.01	0.00	0.18	0.19	0.13	0.59						
10/09/2024 21:30	0.63		0.02	0.00	0.18	0.19	0.13	0.58						
10/09/2024 21:45	0.63		0.02	0.00	0.19	0.19	0.13	0.57						
10/09/2024 22:00	0.63		0.02	0.00	0.19	0.19	0.14	0.57						
10/09/2024 22:15	0.63		0.02	0.01	0.19	0.19	0.14	0.57						
10/09/2024 22:30	0.63		0.02	0.01	0.19	0.19	0.14	0.56						
10/09/2024 22:45	0.63		0.02	0.01	0.19	0.19	0.14	0.56						
10/09/2024 23:00	0.63		0.02	0.01	0.19	0.20	0.14	0.56						
10/09/2024 23:15	0.63		0.02	0.01	0.19	0.20	0.14	0.56						
10/09/2024 23:30	0.63		0.02	0.01	0.19	0.20	0.14	0.56						
10/09/2024 23:45	0.63		0.02	0.01	0.19	0.20	0.14	0.56						
11/09/2024 00:00	0.63		0.02	0.01	0.19	0.20	0.14	0.55						
11/09/2024 00:15	0.63		0.02	0.01	0.19	0.20	0.14	0.55						
11/09/2024 00:30	0.63		0.02	0.01	0.19	0.19	0.14	0.55						
11/09/2024 00:45	0.63		0.02	0.01	0.19	0.19	0.14	0.55						
11/09/2024 01:00	0.63		0.02	0.01	0.19	0.19	0.14	0.55						
11/09/2024 01:15	0.63		0.02	0.01	0.19	0.19	0.14	0.55						
11/09/2024 01:30	0.63		0.02	0.01	0.19	0.19	0.14	0.55						
11/09/2024 01:45	0.64		0.02	0.01	0.19	0.19	0.14	0.55						
11/09/2024 02:00	0.64		0.02	0.01	0.19	0.19	0.14	0.55						
11/09/2024 02:15	0.64		0.02	0.01	0.19	0.19	0.14	0.55						
11/09/2024 02:30	0.64		0.02	0.01	0.19	0.19	0.13	0.55						
11/09/2024 02:45	0.64		0.02	0.01	0.19	0.19	0.13	0.54						
11/09/2024 03:00	0.64		0.02	0.01	0.19	0.19	0.13	0.54						
11/09/2024 03:15	0.64		0.02	0.01	0.19	0.19	0.13	0.53						
11/09/2024 03:30	0.64		0.02	0.01	0.19	0.19	0.13	0.53						
11/09/2024 03:45	0.64		0.02	0.01	0.18	0.19	0.13	0.53						
11/09/2024 04:00	0.64		0.02	0.01	0.18	0.19	0.13	0.53						
11/09/2024 04:15	0.64		0.02	0.00	0.18	0.19	0.13	0.53						
11/09/2024 04:30	0.64		0.02	0.00	0.18	0.19	0.13	0.53						
11/09/2024 04:45	0.64		0.02	0.00	0.18	0.19	0.13	0.53						
11/09/2024 05:00	0.64		0.02	0.00	0.18	0.19	0.13	0.53						
11/09/2024 05:15	0.64		0.02	0.00	0.18	0.18	0.12	0.53						
11/09/2024 05:30	0.64		0.02	0.00	0.18	0.18	0.12	0.52						
11/09/2024 05:45	0.64		0.02	0.00	0.18	0.18	0.12	0.52						
11/09/2024 06:00	0.64		0.01	0.00	0.18	0.18	0.12	0.52						
11/09/2024 06:15	0.64		0.01	0.00	0.18	0.18	0.12	0.52						
11/09/2024 06:30	0.64		0.01	0.00	0.17	0.18	0.12	0.52						
11/09/2024 06:45	0.64		0.01	0.00	0.17	0.18	0.12	0.52						
11/09/2024 07:00	0.64		0.01	0.00	0.17	0.18	0.12	0.52						
11/09/2024 07:15	0.65		0.01	0.00	0.17	0.18	0.12	0.52						
11/09/2024 07:30	0.65		0.01	0.00	0.17	0.18	0.12	0.53						
11/09/2024 07:45	0.65		0.01	0.00	0.17	0.18	0.12	0.53						
11/09/2024 08:00	0.65		0.01	0.00	0.17	0.18	0.12	0.53						
11/09/2024 08:15	0.65		0.01	0.00	0.17	0.18	0.12	0.53						
11/09/2024 08:30	0.65		0.01	0.00	0.17	0.18	0.12	0.53						
11/09/2024 08:45	0.65		0.01	0.00	0.17	0.18	0.12	0.54						
11/09/2024 09:00	0.65		0.01	0.00	0.17	0.18	0.12	0.54						
11/09/2024 09:15	0.65		0.01	0.00	0.17	0.18	0.12	0.54						
11/09/2024 09:30	0.65		0.01	0.00	0.17	0.18	0.12	0.54						
11/09/2024 09:45	0.65		0.01	0.00	0.17	0.18	0.12	0.54						
11/09/2024 10:00	0.65		0.01	0.00	0.17	0.18	0.12	0.54						
11/09/2024 10:15	0.65		0.00	0.00	0.17	0.18	0.12	0.53						
11/09/2024 10:30	0.65		0.01	0.00	0.17	0.18	0.12	0.53						
11/09/2024 10:45	0.65		0.00	0.00	0.17	0.18	0.12	0.53						
11/09/2024 11:00	0.65		0.00	0.00	0.17	0.18	0.12	0.53						
11/09/2024 11:15	0.65		0.01	0.00	0.17	0.18	0.12	0.53						
11/09/2024 11:30	0.65		0.01	0.00	0.17	0.18	0.12	0.53						
11/09/2024 11:45	0.65		0.01	0.00	0.17	0.18	0.12	0.53						
11/09/2024 12:00	0.65		0.01	0.00	0.17	0.18	0.12	0.53						
11/09/2024 12:15	0.65		0.00	0.00	0.17	0.18	0.12	0.53						
11/09/2024 12:30	0.65		0.00	0.00	0.17	0.18	0.12	0.53						
11/09/2024 12:45	0.65		0.00	0.00	0.17	0.17	0.12	0.53						
11/09/2024 13:00	0.65		0.01	0.00	0.17	0.17	0.12	0.53						
11/09/2024 13:15	0.65		0.01	0.00	0.17	0.17	0.12	0.53						
11/09/2024 13:30	0.65		0.02	0.01	0.17	0.17	0.11	0.53						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
11/09/2024 13:45	0.65		0.01	0.00	0.17	0.17	0.11	0.53						
11/09/2024 14:00	0.65		0.01	0.00	0.17	0.17	0.11	0.53						
11/09/2024 14:15	0.65		0.01	0.00	0.17	0.17	0.11	0.53						
11/09/2024 14:30	0.65		0.00	0.00	0.17	0.17	0.11	0.53						
11/09/2024 14:45	0.66		0.01	0.00	0.17	0.17	0.11	0.53						
11/09/2024 15:00	0.65		0.01	0.00	0.17	0.17	0.11	0.53						
11/09/2024 15:15	0.66		0.01	0.00	0.17	0.17	0.11	0.53						
11/09/2024 15:30	0.66		0.01	0.00	0.17	0.17	0.11	0.52						
11/09/2024 15:45	0.66		0.01	0.00	0.17	0.17	0.11	0.52						
11/09/2024 16:00	0.66		0.01	0.00	0.17	0.17	0.11	0.52						
11/09/2024 16:15	0.66		0.01	0.00	0.17	0.17	0.11	0.52						
11/09/2024 16:30	0.66		0.01	0.00	0.17	0.17	0.11	0.52						
11/09/2024 16:45	0.66		0.01	0.00	0.17	0.17	0.11	0.52						
11/09/2024 17:00	0.66		0.01	0.00	0.17	0.17	0.11	0.52						
11/09/2024 17:15	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
11/09/2024 17:30	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
11/09/2024 17:45	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
11/09/2024 18:00	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
11/09/2024 18:15	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 18:30	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 18:45	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 19:00	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 19:15	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 19:30	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 19:45	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 20:00	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 20:15	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 20:30	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 20:45	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 21:00	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 21:15	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 21:30	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 21:45	0.66		0.01	0.00	0.16	0.17	0.11	0.53						
11/09/2024 22:00	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
11/09/2024 22:15	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
11/09/2024 22:30	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
11/09/2024 22:45	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
11/09/2024 23:00	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
11/09/2024 23:15	0.66		0.00	0.00	0.16	0.17	0.11	0.52						
11/09/2024 23:30	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
11/09/2024 23:45	0.66		0.01	0.00	0.16	0.17	0.11	0.52						
12/09/2024 00:00	0.66		0.01	0.00	0.16	0.17	0.11	0.51						
12/09/2024 00:15	0.65		0.01	0.00	0.16	0.17	0.11	0.51						
12/09/2024 00:30	0.65		0.01	0.00	0.16	0.17	0.11	0.51						
12/09/2024 00:45	0.66		0.01	0.00	0.16	0.17	0.11	0.51						
12/09/2024 01:00	0.65		0.01	0.00	0.16	0.17	0.11	0.51						
12/09/2024 01:15	0.66		0.01	0.00	0.16	0.17	0.11	0.51						
12/09/2024 01:30	0.66		0.01	0.00	0.16	0.16	0.10	0.51						
12/09/2024 01:45	0.66		0.00	0.00	0.16	0.16	0.10	0.51						
12/09/2024 02:00	0.66		0.00	0.00	0.16	0.16	0.10	0.51						
12/09/2024 02:15	0.66		0.00	0.00	0.16	0.16	0.10	0.51						
12/09/2024 02:30	0.66		0.00	0.00	0.16	0.16	0.10	0.50						
12/09/2024 02:45	0.66		0.00	0.00	0.16	0.16	0.10	0.50						
12/09/2024 03:00	0.66		0.00	0.00	0.16	0.16	0.10	0.50						
12/09/2024 03:15	0.66		0.00	0.00	0.16	0.16	0.10	0.50						
12/09/2024 03:30	0.66		0.00	0.00	0.16	0.16	0.10	0.50						
12/09/2024 03:45	0.66		0.00	0.00	0.15	0.16	0.10	0.50						
12/09/2024 04:00	0.66		0.01	0.00	0.15	0.16	0.10	0.50						
12/09/2024 04:15	0.66		0.00	0.00	0.15	0.16	0.10	0.49						
12/09/2024 04:30	0.66		0.00	0.00	0.15	0.16	0.10	0.49						
12/09/2024 04:45	0.66		0.00	0.00	0.15	0.16	0.10	0.49						
12/09/2024 05:00	0.66		0.00	0.00	0.15	0.16	0.10	0.49						
12/09/2024 05:15	0.66		0.00	0.00	0.15	0.16	0.10	0.49						
12/09/2024 05:30	0.66		0.00	0.00	0.15	0.16	0.10	0.49						
12/09/2024 05:45	0.66		0.00	0.00	0.15	0.16	0.10	0.49						
12/09/2024 06:00	0.66		0.00	0.00	0.15	0.15	0.09	0.49						
12/09/2024 06:15	0.66		0.00	0.00	0.15	0.15	0.09	0.49						
12/09/2024 06:30	0.66		0.00	0.00	0.15	0.15	0.09	0.49						
12/09/2024 06:45	0.66		0.00	0.00	0.15	0.15	0.09	0.49						
12/09/2024 07:00	0.66		0.00	0.00	0.15	0.15	0.09	0.49						
12/09/2024 07:15	0.66		0.00	0.00	0.15	0.15	0.09	0.50						
12/09/2024 07:30	0.66		0.00	0.00	0.15	0.15	0.09	0.50						
12/09/2024 07:45	0.66		0.00	0.00	0.15	0.15	0.09	0.51						
12/09/2024 08:00	0.66		0.00	0.00	0.15	0.15	0.09	0.52						
12/09/2024 08:15	0.66		0.00	0.00	0.15	0.15	0.09	0.52						
12/09/2024 08:30	0.66		0.00	0.00	0.15	0.15	0.09	0.52						
12/09/2024 08:45	0.66		0.00	0.00	0.15	0.15	0.09	0.52						
12/09/2024 09:00	0.66		0.00	0.00	0.15	0.15	0.09	0.52						
12/09/2024 09:15	0.66		0.00	0.00	0.15	0.15	0.09	0.52						
12/09/2024 09:30	0.66		0.00	0.00	0.15	0.15	0.09	0.52						
12/09/2024 09:45	0.66		0.00	0.00	0.15	0.15	0.10	0.52						
12/09/2024 10:00	0.66		-0.01	0.00	0.15	0.15	0.10	0.52						
12/09/2024 10:15	0.66		-0.01	0.00	0.15	0.16	0.10	0.52						
12/09/2024 10:30	0.66		0.00	0.00	0.15	0.16	0.10	0.52						
12/09/2024 10:45	0.66		0.00	0.00	0.15	0.16	0.10	0.52						
12/09/2024 11:00	0.66		0.00	0.00	0.15	0.16	0.10	0.52						
12/09/2024 11:15	0.66		0.00	0.00	0.15	0.16	0.10	0.52						
12/09/2024 11:30	0.66		0.00	0.00	0.15	0.16	0.10	0.52						
12/09/2024 11:45	0.66		0.00	0.00	0.16	0.16	0.10	0.52						
12/09/2024 12:00	0.66		0.00	0.00	0.16	0.16	0.10	0.52						
12/09/2024 12:15	0.65		0.00	0.00	0.16	0.16	0.10	0.52						
12/09/2024 12:30	0.65		0.00	0.00	0.16	0.16	0.10	0.52						
12/09/2024 12:45	0.65		0.00	0.00	0.16	0.16	0.10	0.51						
12/09/2024 13:00	0.65		0.01	0.00	0.16	0.16	0.10	0.51						
12/09/2024 13:15	0.65		0.01	0.00	0.15	0.16	0.10	0.51						
12/09/2024 13:30	0.65		0.01	0.00	0.15	0.16	0.10	0.51						
12/09/2024 13:45	0.65		0.01	0.00	0.15	0.16	0.10	0.51						
12/09/2024 14:00	0.65		0.00	0.00	0.15	0.16	0.10	0.51						
12/09/2024 14:15	0.65		0.00	0.00	0.15	0.16	0.10	0.51						
12/09/2024 14:30	0.65		0.00	0.00	0.15	0.16	0.10	0.51						
12/09/2024 14:45	0.65		0.00	0.00	0.15	0.16	0.10	0.52						
12/09/2024 15:00	0.65		0.00	0.00	0.15	0.16	0.10	0.53						
12/09/2024 15:15	0.65		0.00	0.00	0.15	0.16	0.10	0.54						
12/09/2024 15:30	0.65		0.00	0.00	0.15	0.16	0.10	0.54						
12/09/2024 15:45	0.65		0.00	0.00	0.15	0.16	0.10	0.53						
12/09/2024 16:00	0.65		0.00	0.00	0.15	0.16	0.10	0.53						
12/09/2024 16:15	0.65		0.00	0.00	0.16	0.16	0.10	0.53						
12/09/2024 16:30	0.65		0.00	0.00	0.16	0.16	0.10	0.52						
12/09/2024 16:45	0.65		0.00	0.00	0.16	0.16	0.10	0.52						
12/09/2024 17:00	0.65		0.00	0.00	0.16	0.16	0.10	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
12/09/2024 17:15	0.65		0.00	0.00	0.16	0.16	0.10	0.52						
12/09/2024 17:30	0.65		0.00	0.00	0.16	0.16	0.11	0.52						
12/09/2024 17:45	0.66		0.00	0.00	0.16	0.16	0.11	0.52						
12/09/2024 18:00	0.66		0.00	0.00	0.16	0.16	0.11	0.52						
12/09/2024 18:15	0.66		0.00	0.00	0.16	0.16	0.11	0.53						
12/09/2024 18:30	0.66		0.00	0.00	0.16	0.16	0.11	0.53						
12/09/2024 18:45	0.66		0.01	0.00	0.16	0.16	0.10	0.53						
12/09/2024 19:00	0.66		0.01	0.00	0.16	0.16	0.11	0.53						
12/09/2024 19:15	0.66		0.00	0.00	0.16	0.16	0.11	0.53						
12/09/2024 19:30	0.66		0.01	0.00	0.16	0.16	0.11	0.53						
12/09/2024 19:45	0.66		0.00	0.00	0.16	0.16	0.11	0.53						
12/09/2024 20:00	0.66		0.00	0.00	0.16	0.16	0.11	0.53						
12/09/2024 20:15	0.66		0.01	0.00	0.16	0.16	0.11	0.53						
12/09/2024 20:30	0.66		0.00	0.00	0.16	0.16	0.11	0.52						
12/09/2024 20:45	0.66		0.01	0.00	0.16	0.16	0.11	0.52						
12/09/2024 21:00	0.66		0.01	0.00	0.16	0.16	0.11	0.52						
12/09/2024 21:15	0.66		0.01	0.00	0.16	0.16	0.11	0.52						
12/09/2024 21:30	0.66		0.01	0.00	0.16	0.16	0.11	0.52						
12/09/2024 21:45	0.66		0.01	0.00	0.16	0.16	0.11	0.52						
12/09/2024 22:00	0.66		0.01	0.00	0.16	0.16	0.11	0.52						
12/09/2024 22:15	0.66		0.01	0.00	0.16	0.16	0.11	0.52						
12/09/2024 22:30	0.66		0.01	0.00	0.16	0.16	0.11	0.52						
12/09/2024 22:45	0.66		0.00	0.00	0.16	0.16	0.11	0.52						
12/09/2024 23:00	0.66		0.00	0.00	0.16	0.16	0.11	0.51						
12/09/2024 23:15	0.66		0.01	0.00	0.16	0.16	0.11	0.51						
12/09/2024 23:30	0.66		0.01	0.00	0.16	0.16	0.11	0.51						
12/09/2024 23:45	0.66		0.00	0.00	0.16	0.16	0.11	0.51						
13/09/2024 00:00	0.66		0.01	0.00	0.16	0.16	0.10	0.51						
13/09/2024 00:15	0.66		0.01	0.00	0.16	0.16	0.10	0.51						
13/09/2024 00:30	0.66		0.00	0.00	0.16	0.16	0.10	0.51						
13/09/2024 00:45	0.66		0.00	0.00	0.16	0.16	0.10	0.50						
13/09/2024 01:00	0.65		0.00	0.00	0.16	0.16	0.10	0.50						
13/09/2024 01:15	0.65		0.01	0.00	0.16	0.16	0.10	0.50						
13/09/2024 01:30	0.65		0.00	0.00	0.16	0.16	0.10	0.50						
13/09/2024 01:45	0.65		0.00	0.00	0.16	0.16	0.10	0.50						
13/09/2024 02:00	0.65		0.00	0.00	0.15	0.16	0.10	0.50						
13/09/2024 02:15	0.65		0.00	0.00	0.15	0.16	0.10	0.50						
13/09/2024 02:30	0.65		0.00	0.00	0.15	0.16	0.10	0.50						
13/09/2024 02:45	0.65		0.00	0.00	0.15	0.16	0.10	0.50						
13/09/2024 03:00	0.65		0.00	0.00	0.15	0.16	0.10	0.50						
13/09/2024 03:15	0.65		0.00	0.00	0.15	0.15	0.10	0.50						
13/09/2024 03:30	0.65		0.00	0.00	0.15	0.15	0.10	0.50						
13/09/2024 03:45	0.65		0.00	0.00	0.15	0.15	0.10	0.49						
13/09/2024 04:00	0.65		0.00	0.00	0.15	0.15	0.10	0.49						
13/09/2024 04:15	0.65		0.00	0.00	0.15	0.15	0.10	0.49						
13/09/2024 04:30	0.65		0.00	0.00	0.15	0.15	0.10	0.49						
13/09/2024 04:45	0.65		0.00	0.00	0.15	0.15	0.09	0.49						
13/09/2024 05:00	0.65		0.00	0.00	0.15	0.15	0.09	0.49						
13/09/2024 05:15	0.65		0.00	0.00	0.15	0.15	0.09	0.49						
13/09/2024 05:30	0.65		0.00	0.00	0.15	0.15	0.09	0.49						
13/09/2024 05:45	0.65		0.00	0.00	0.15	0.15	0.09	0.49						
13/09/2024 06:00	0.65		0.00	0.00	0.15	0.15	0.09	0.49						
13/09/2024 06:15	0.65		0.00	0.00	0.15	0.15	0.09	0.49						
13/09/2024 06:30	0.65		0.00	0.00	0.14	0.15	0.09	0.49						
13/09/2024 06:45	0.65		0.00	0.00	0.14	0.15	0.09	0.49						
13/09/2024 07:00	0.65		0.00	0.00	0.14	0.15	0.09	0.49						
13/09/2024 07:15	0.65		-0.01	0.00	0.14	0.15	0.09	0.49						
13/09/2024 07:30	0.65		0.00	0.00	0.14	0.15	0.09	0.50						
13/09/2024 07:45	0.65		0.00	0.00	0.14	0.15	0.09	0.50						
13/09/2024 08:00	0.65		0.00	0.00	0.14	0.15	0.09	0.50						
13/09/2024 08:15	0.65		0.00	0.00	0.14	0.15	0.09	0.51						
13/09/2024 08:30	0.65		0.00	0.00	0.14	0.15	0.09	0.51						
13/09/2024 08:45	0.66		0.00	0.00	0.14	0.15	0.09	0.51						
13/09/2024 09:00	0.66		0.00	0.00	0.14	0.15	0.09	0.51						
13/09/2024 09:15	0.66		0.00	0.00	0.14	0.15	0.09	0.51						
13/09/2024 09:30	0.66		0.00	0.00	0.14	0.15	0.09	0.51						
13/09/2024 09:45	0.66		-0.01	0.00	0.14	0.15	0.09	0.51						
13/09/2024 10:00	0.66		-0.01	0.00	0.15	0.15	0.09	0.52						
13/09/2024 10:15	0.66		-0.01	0.00	0.15	0.15	0.09	0.52						
13/09/2024 10:30	0.66		0.00	0.00	0.15	0.15	0.09	0.52						
13/09/2024 10:45	0.66		-0.01	0.00	0.15	0.15	0.09	0.52						
13/09/2024 11:00	0.66		-0.01	0.00	0.15	0.15	0.09	0.52						
13/09/2024 11:15	0.66		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 11:30	0.65		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 11:45	0.65		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 12:00	0.65		-0.01	0.00	0.15	0.15	0.10	0.51						
13/09/2024 12:15	0.65		-0.01	0.00	0.15	0.15	0.10	0.51						
13/09/2024 12:30	0.65		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 12:45	0.64		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 13:00	0.64		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 13:15	0.64		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 13:30	0.64		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 13:45	0.63		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 14:00	0.63		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 14:15	0.63		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 14:30	0.63		0.00	0.00	0.15	0.15	0.10	0.52						
13/09/2024 14:45	0.63		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 15:00	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 15:15	0.62		-0.01	0.00	0.15	0.15	0.10	0.51						
13/09/2024 15:30	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 15:45	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 16:00	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 16:15	0.62		0.00	0.00	0.15	0.15	0.10	0.50						
13/09/2024 16:30	0.62		0.00	0.00	0.15	0.15	0.10	0.50						
13/09/2024 16:45	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 17:00	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 17:15	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 17:30	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 17:45	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 18:00	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 18:15	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 18:30	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 18:45	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 19:00	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 19:15	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 19:30	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 19:45	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 20:00	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 20:15	0.62		0.00	0.00	0.15	0.15	0.09	0.51						
13/09/2024 20:30	0.62		0.00	0.00	0.15	0.15	0.09	0.51						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
13/09/2024 20:45	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 21:00	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 21:15	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 21:30	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 21:45	0.62		0.00	0.00	0.15	0.15	0.10	0.52						
13/09/2024 22:00	0.62		0.00	0.00	0.15	0.15	0.10	0.52						
13/09/2024 22:15	0.62		0.00	0.00	0.15	0.15	0.10	0.52						
13/09/2024 22:30	0.62		0.00	0.00	0.15	0.15	0.10	0.52						
13/09/2024 22:45	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 23:00	0.62		0.00	0.00	0.15	0.15	0.10	0.51						
13/09/2024 23:15	0.62		0.00	0.00	0.15	0.16	0.10	0.51						
13/09/2024 23:30	0.62		0.00	0.00	0.15	0.16	0.10	0.51						
13/09/2024 23:45	0.62		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 00:00	0.62		0.00	0.00	0.15	0.16	0.10	0.50						
14/09/2024 00:15	0.62		0.00	0.00	0.15	0.16	0.10	0.50						
14/09/2024 00:30	0.62		0.00	0.00	0.15	0.16	0.10	0.50						
14/09/2024 00:45	0.62		0.00	0.00	0.15	0.16	0.10	0.50						
14/09/2024 01:00	0.62		0.00	0.00	0.15	0.16	0.10	0.50						
14/09/2024 01:15	0.62		0.00	0.00	0.15	0.16	0.10	0.49						
14/09/2024 01:30	0.62		0.00	0.00	0.15	0.15	0.10	0.49						
14/09/2024 01:45	0.61		0.00	0.00	0.15	0.15	0.10	0.49						
14/09/2024 02:00	0.61		0.00	0.00	0.15	0.15	0.09	0.49						
14/09/2024 02:15	0.61		0.00	0.00	0.15	0.15	0.09	0.49						
14/09/2024 02:30	0.61		0.00	0.00	0.15	0.15	0.09	0.49						
14/09/2024 02:45	0.61		0.00	0.00	0.15	0.15	0.09	0.49						
14/09/2024 03:00	0.60		0.00	0.00	0.15	0.15	0.09	0.49						
14/09/2024 03:15	0.60		0.00	0.00	0.15	0.15	0.09	0.49						
14/09/2024 03:30	0.60		0.00	0.00	0.14	0.15	0.09	0.49						
14/09/2024 03:45	0.60		0.00	0.00	0.14	0.15	0.09	0.49						
14/09/2024 04:00	0.60		0.00	0.00	0.14	0.15	0.09	0.49						
14/09/2024 04:15	0.60		0.00	0.00	0.14	0.15	0.09	0.49						
14/09/2024 04:30	0.60		0.00	0.00	0.14	0.15	0.09	0.48						
14/09/2024 04:45	0.60		0.00	0.00	0.14	0.15	0.09	0.48						
14/09/2024 05:00	0.59		0.00	0.00	0.14	0.15	0.09	0.48						
14/09/2024 05:15	0.59		0.00	0.00	0.14	0.15	0.09	0.48						
14/09/2024 05:30	0.59		0.00	0.00	0.14	0.15	0.09	0.48						
14/09/2024 05:45	0.59		0.00	0.00	0.14	0.15	0.09	0.48						
14/09/2024 06:00	0.59		0.00	0.00	0.14	0.14	0.09	0.48						
14/09/2024 06:15	0.59		0.00	0.00	0.14	0.14	0.09	0.48						
14/09/2024 06:30	0.59		0.00	0.00	0.14	0.14	0.08	0.48						
14/09/2024 06:45	0.60		-0.01	0.00	0.14	0.14	0.08	0.48						
14/09/2024 07:00	0.60		-0.01	0.00	0.14	0.14	0.08	0.48						
14/09/2024 07:15	0.60		-0.01	0.00	0.14	0.14	0.08	0.49						
14/09/2024 07:30	0.60		-0.01	0.00	0.14	0.14	0.08	0.49						
14/09/2024 07:45	0.60		-0.01	0.00	0.14	0.14	0.08	0.49						
14/09/2024 08:00	0.60		-0.01	0.00	0.14	0.14	0.08	0.49						
14/09/2024 08:15	0.60		-0.01	0.00	0.14	0.14	0.08	0.49						
14/09/2024 08:30	0.60		-0.01	0.00	0.14	0.14	0.08	0.50						
14/09/2024 08:45	0.60		-0.01	0.00	0.14	0.14	0.08	0.50						
14/09/2024 09:00	0.60		-0.01	0.00	0.14	0.14	0.08	0.51						
14/09/2024 09:15	0.60		-0.01	0.00	0.14	0.14	0.08	0.51						
14/09/2024 09:30	0.60		-0.01	0.00	0.14	0.14	0.08	0.51						
14/09/2024 09:45	0.60		-0.01	0.00	0.14	0.14	0.08	0.52						
14/09/2024 10:00	0.60		-0.01	0.00	0.14	0.14	0.08	0.53						
14/09/2024 10:15	0.60		-0.01	0.00	0.14	0.14	0.09	0.53						
14/09/2024 10:30	0.60		-0.01	0.00	0.14	0.14	0.09	0.53						
14/09/2024 10:45	0.60		-0.01	0.00	0.14	0.15	0.09	0.53						
14/09/2024 11:00	0.60		-0.01	0.00	0.14	0.15	0.09	0.53						
14/09/2024 11:15	0.60		-0.01	0.00	0.15	0.15	0.09	0.52						
14/09/2024 11:30	0.60		-0.01	0.00	0.15	0.15	0.09	0.52						
14/09/2024 11:45	0.60		-0.01	0.00	0.15	0.15	0.09	0.52						
14/09/2024 12:00	0.60		-0.01	0.00	0.15	0.15	0.10	0.52						
14/09/2024 12:15	0.60		-0.01	0.00	0.15	0.15	0.10	0.52						
14/09/2024 12:30	0.60		-0.01	0.00	0.15	0.15	0.10	0.52						
14/09/2024 12:45	0.60		-0.01	0.00	0.15	0.15	0.10	0.52						
14/09/2024 13:00	0.60		-0.01	0.00	0.15	0.15	0.10	0.52						
14/09/2024 13:15	0.59		-0.01	0.00	0.15	0.16	0.10	0.51						
14/09/2024 13:30	0.59		-0.01	0.00	0.15	0.16	0.10	0.51						
14/09/2024 13:45	0.59		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 14:00	0.59		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 14:15	0.59		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 14:30	0.59		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 14:45	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 15:00	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 15:15	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 15:30	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 15:45	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 16:00	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 16:15	0.57		0.00	0.00	0.15	0.15	0.10	0.51						
14/09/2024 16:30	0.57		0.00	0.00	0.15	0.15	0.10	0.51						
14/09/2024 16:45	0.57		0.00	0.00	0.15	0.15	0.10	0.51						
14/09/2024 17:00	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 17:15	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 17:30	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 17:45	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 18:00	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 18:15	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 18:30	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 18:45	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 19:00	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 19:15	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 19:30	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 19:45	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 20:00	0.57		0.00	0.00	0.15	0.15	0.09	0.52						
14/09/2024 20:15	0.57		0.00	0.00	0.15	0.15	0.09	0.52						
14/09/2024 20:30	0.57		0.00	0.00	0.15	0.15	0.09	0.52						
14/09/2024 20:45	0.57		0.00	0.00	0.15	0.15	0.09	0.52						
14/09/2024 21:00	0.57		0.00	0.00	0.15	0.15	0.09	0.52						
14/09/2024 21:15	0.57		0.00	0.00	0.15	0.15	0.09	0.52						
14/09/2024 21:30	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
14/09/2024 21:45	0.57		0.00	0.00	0.15	0.16	0.09	0.51						
14/09/2024 22:00	0.57		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 22:15	0.57		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 22:30	0.57		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 22:45	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 23:00	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 23:15	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
14/09/2024 23:30	0.58		0.00	0.00	0.15	0.16	0.10	0.50						
14/09/2024 23:45	0.58		0.00	0.00	0.15	0.16	0.09	0.50						
15/09/2024 00:00	0.58		0.00	0.00	0.15	0.16	0.09	0.50						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
15/09/2024 00:15	0.58		0.00	0.00	0.15	0.16	0.09	0.50						
15/09/2024 00:30	0.58		0.00	0.00	0.15	0.15	0.09	0.50						
15/09/2024 00:45	0.58		0.00	0.00	0.15	0.15	0.09	0.50						
15/09/2024 01:00	0.58		0.00	0.00	0.15	0.15	0.09	0.50						
15/09/2024 01:15	0.58		0.00	0.00	0.15	0.15	0.09	0.50						
15/09/2024 01:30	0.58		0.00	0.00	0.15	0.15	0.09	0.50						
15/09/2024 01:45	0.58		0.00	0.00	0.15	0.15	0.09	0.49						
15/09/2024 02:00	0.58		0.00	0.00	0.15	0.15	0.09	0.49						
15/09/2024 02:15	0.58		0.00	0.00	0.15	0.15	0.09	0.49						
15/09/2024 02:30	0.58		0.00	0.00	0.15	0.15	0.09	0.49						
15/09/2024 02:45	0.58		0.00	0.00	0.14	0.15	0.09	0.49						
15/09/2024 03:00	0.58		0.00	0.00	0.14	0.15	0.09	0.49						
15/09/2024 03:15	0.58		0.00	0.00	0.14	0.15	0.09	0.49						
15/09/2024 03:30	0.57		0.00	0.00	0.14	0.15	0.09	0.49						
15/09/2024 03:45	0.57		0.00	0.00	0.14	0.15	0.09	0.49						
15/09/2024 04:00	0.57		0.00	0.00	0.14	0.15	0.09	0.49						
15/09/2024 04:15	0.57		0.00	0.00	0.14	0.15	0.09	0.49						
15/09/2024 04:30	0.57		0.00	0.00	0.14	0.15	0.09	0.49						
15/09/2024 04:45	0.57		0.00	0.00	0.14	0.15	0.09	0.48						
15/09/2024 05:00	0.57		0.00	0.00	0.14	0.15	0.09	0.48						
15/09/2024 05:15	0.57		0.00	0.00	0.14	0.15	0.08	0.48						
15/09/2024 05:30	0.57		0.00	0.00	0.14	0.15	0.08	0.48						
15/09/2024 05:45	0.57		0.00	0.00	0.14	0.15	0.08	0.48						
15/09/2024 06:00	0.57		0.00	0.00	0.14	0.15	0.08	0.48						
15/09/2024 06:15	0.57		0.00	0.00	0.14	0.15	0.08	0.48						
15/09/2024 06:30	0.57		-0.01	0.00	0.14	0.15	0.08	0.48						
15/09/2024 06:45	0.57		-0.01	0.00	0.14	0.14	0.08	0.48						
15/09/2024 07:00	0.57		-0.01	0.00	0.14	0.14	0.08	0.49						
15/09/2024 07:15	0.57		-0.01	0.00	0.14	0.14	0.08	0.49						
15/09/2024 07:30	0.57		-0.01	0.00	0.14	0.14	0.08	0.50						
15/09/2024 07:45	0.57		-0.01	0.00	0.14	0.14	0.08	0.50						
15/09/2024 08:00	0.58		-0.01	0.00	0.14	0.14	0.08	0.50						
15/09/2024 08:15	0.58		-0.01	0.00	0.14	0.14	0.08	0.50						
15/09/2024 08:30	0.58		-0.01	0.00	0.14	0.14	0.08	0.50						
15/09/2024 08:45	0.58		-0.01	0.00	0.14	0.14	0.08	0.50						
15/09/2024 09:00	0.58		-0.01	0.00	0.14	0.14	0.08	0.51						
15/09/2024 09:15	0.58		-0.01	0.00	0.14	0.14	0.08	0.51						
15/09/2024 09:30	0.58		-0.01	0.00	0.14	0.15	0.08	0.51						
15/09/2024 09:45	0.58		-0.01	0.00	0.14	0.15	0.08	0.52						
15/09/2024 10:00	0.58		-0.01	0.00	0.14	0.15	0.08	0.52						
15/09/2024 10:15	0.58		-0.01	0.00	0.14	0.15	0.09	0.52						
15/09/2024 10:30	0.58		-0.01	0.00	0.14	0.15	0.09	0.52						
15/09/2024 10:45	0.58		-0.01	0.00	0.14	0.15	0.09	0.52						
15/09/2024 11:00	0.58		-0.01	0.00	0.14	0.15	0.09	0.52						
15/09/2024 11:15	0.59		-0.01	0.00	0.14	0.15	0.09	0.52						
15/09/2024 11:30	0.59		-0.01	0.00	0.14	0.15	0.09	0.52						
15/09/2024 11:45	0.59		-0.01	0.00	0.15	0.15	0.09	0.52						
15/09/2024 12:00	0.59		-0.01	0.00	0.15	0.15	0.09	0.52						
15/09/2024 12:15	0.59		-0.01	0.00	0.15	0.15	0.09	0.52						
15/09/2024 12:30	0.59		-0.01	0.00	0.15	0.15	0.09	0.52						
15/09/2024 12:45	0.59		-0.01	0.00	0.15	0.16	0.10	0.52						
15/09/2024 13:00	0.59		-0.01	0.00	0.15	0.16	0.10	0.52						
15/09/2024 13:15	0.59		-0.01	0.00	0.15	0.16	0.10	0.52						
15/09/2024 13:30	0.59		0.00	0.00	0.15	0.16	0.10	0.53						
15/09/2024 13:45	0.59		0.00	0.00	0.15	0.16	0.10	0.53						
15/09/2024 14:00	0.59		0.00	0.00	0.15	0.16	0.10	0.53						
15/09/2024 14:15	0.59		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 14:30	0.59		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 14:45	0.59		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 15:00	0.59		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 15:15	0.58		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 15:30	0.58		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 15:45	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
15/09/2024 16:00	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
15/09/2024 16:15	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
15/09/2024 16:30	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
15/09/2024 16:45	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
15/09/2024 17:00	0.57		0.00	0.00	0.15	0.16	0.10	0.51						
15/09/2024 17:15	0.57		0.00	0.00	0.15	0.16	0.10	0.51						
15/09/2024 17:30	0.57		0.00	0.00	0.15	0.16	0.10	0.51						
15/09/2024 17:45	0.57		0.00	0.00	0.15	0.16	0.10	0.51						
15/09/2024 18:00	0.57		0.00	0.00	0.15	0.16	0.10	0.51						
15/09/2024 18:15	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 18:30	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 18:45	0.57		0.00	0.00	0.15	0.15	0.09	0.52						
15/09/2024 19:00	0.57		0.00	0.00	0.15	0.15	0.10	0.52						
15/09/2024 19:15	0.57		0.00	0.00	0.15	0.15	0.09	0.52						
15/09/2024 19:30	0.57		0.00	0.00	0.15	0.16	0.09	0.52						
15/09/2024 19:45	0.57		0.00	0.00	0.15	0.16	0.09	0.52						
15/09/2024 20:00	0.57		0.00	0.00	0.15	0.16	0.09	0.52						
15/09/2024 20:15	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 20:30	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 20:45	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 21:00	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 21:15	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 21:30	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 21:45	0.57		0.00	0.00	0.15	0.16	0.10	0.53						
15/09/2024 22:00	0.57		0.00	0.00	0.15	0.16	0.10	0.53						
15/09/2024 22:15	0.57		0.00	0.00	0.15	0.16	0.10	0.53						
15/09/2024 22:30	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 22:45	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 23:00	0.57		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 23:15	0.58		0.00	0.00	0.15	0.16	0.10	0.52						
15/09/2024 23:30	0.58		4.148638330364E	0.00	0.15	0.16	0.10	0.52						
15/09/2024 23:45	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
16/09/2024 00:00	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
16/09/2024 00:15	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
16/09/2024 00:30	0.58		0.00	0.00	0.15	0.16	0.10	0.51						
16/09/2024 00:45	0.58		5.42122677526088	0.00	0.15	0.16	0.10	0.50						
16/09/2024 01:00	0.58		5.67574446424029	0.00	0.15	0.16	0.10	0.50						
16/09/2024 01:15	0.58		5.93026215321966	0.00	0.15	0.16	0.10	0.50						
16/09/2024 01:30	0.58		0.00	0.00	0.15	0.16	0.10	0.50						
16/09/2024 01:45	0.58		0.00	0.00	0.15	0.16	0.10	0.50						
16/09/2024 02:00	0.58		0.00	0.00	0.15	0.16	0.09	0.50						
16/09/2024 02:15	0.58		0.00	0.00	0.15	0.16	0.09	0.50						
16/09/2024 02:30	0.58		0.00	0.00	0.15	0.16	0.09	0.49						
16/09/2024 02:45	0.58		0.00	0.00	0.15	0.16	0.09	0.49						
16/09/2024 03:00	0.58		0.00	0.00	0.15	0.15	0.09	0.49						
16/09/2024 03:15	0.58		0.00	0.00	0.15	0.15	0.09	0.49						
16/09/2024 03:30	0.58		0.00	0.00	0.14	0.15	0.09	0.49						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
16/09/2024 03:45	0.58		0.00	0.00	0.14	0.15	0.09	0.49						
16/09/2024 04:00	0.58		0.00	0.00	0.14	0.15	0.09	0.49						
16/09/2024 04:15	0.58		0.00	0.00	0.14	0.15	0.09	0.49						
16/09/2024 04:30	0.58		0.00	0.00	0.14	0.15	0.09	0.49						
16/09/2024 04:45	0.58		0.00	0.00	0.14	0.15	0.09	0.49						
16/09/2024 05:00	0.57		0.00	0.00	0.14	0.15	0.09	0.49						
16/09/2024 05:15	0.57		0.00	0.00	0.14	0.15	0.09	0.49						
16/09/2024 05:30	0.57		0.00	0.00	0.14	0.15	0.09	0.49						
16/09/2024 05:45	0.57		0.00	0.00	0.14	0.15	0.08	0.49						
16/09/2024 06:00	0.57		0.00	0.00	0.14	0.15	0.08	0.49						
16/09/2024 06:15	0.57		0.00	0.00	0.14	0.15	0.08	0.49						
16/09/2024 06:30	0.57		0.00	0.00	0.14	0.15	0.08	0.49						
16/09/2024 06:45	0.57		0.00	0.00	0.14	0.15	0.08	0.49						
16/09/2024 07:00	0.57		-0.01	0.00	0.14	0.15	0.08	0.49						
16/09/2024 07:15	0.57		-0.01	0.00	0.14	0.15	0.08	0.49						
16/09/2024 07:30	0.57		0.00	0.00	0.14	0.15	0.08	0.50						
16/09/2024 07:45	0.57		0.00	0.00	0.14	0.14	0.08	0.50						
16/09/2024 08:00	0.57		-0.01	0.00	0.14	0.14	0.08	0.51						
16/09/2024 08:15	0.57		-0.01	0.00	0.14	0.14	0.08	0.51						
16/09/2024 08:30	0.57		-0.01	0.00	0.14	0.14	0.08	0.51						
16/09/2024 08:45	0.57		-0.01	0.00	0.14	0.14	0.08	0.51						
16/09/2024 09:00	0.57		-0.01	0.00	0.14	0.15	0.08	0.52						
16/09/2024 09:15	0.57		-0.01	0.00	0.14	0.15	0.08	0.52						
16/09/2024 09:30	0.57		-0.01	0.00	0.14	0.15	0.08	0.52						
16/09/2024 09:45	0.57		-0.01	0.00	0.14	0.15	0.08	0.52						
16/09/2024 10:00	0.57		-0.01	0.00	0.14	0.15	0.09	0.52						
16/09/2024 10:15	0.58		-0.01	0.00	0.14	0.15	0.09	0.52						
16/09/2024 10:30	0.58		-0.01	0.00	0.14	0.15	0.09	0.52						
16/09/2024 10:45	0.58		-0.01	0.00	0.14	0.15	0.09	0.53						
16/09/2024 11:00	0.58		-0.01	0.00	0.14	0.15	0.09	0.53						
16/09/2024 11:15	0.58		-0.01	0.00	0.14	0.15	0.09	0.52						
16/09/2024 11:30	0.58		0.00	0.00	0.14	0.15	0.09	0.52						
16/09/2024 11:45	0.58		-0.01	0.00	0.15	0.15	0.09	0.52						
16/09/2024 12:00	0.58		-0.01	0.00	0.15	0.15	0.09	0.52						
16/09/2024 12:15	0.58		0.00	0.00	0.15	0.15	0.09	0.52						
16/09/2024 12:30	0.58		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 12:45	0.58		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 13:00	0.58		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 13:15	0.58		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 13:30	0.58		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 13:45	0.58		-0.01	0.00	0.15	0.16	0.09	0.51						
16/09/2024 14:00	0.58		0.00	0.00	0.15	0.16	0.09	0.51						
16/09/2024 14:15	0.58		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 14:30	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 14:45	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 15:00	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 15:15	0.57		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 15:30	0.56		0.00	0.00	0.15	0.15	0.09	0.51						
16/09/2024 15:45	0.56		0.00	0.00	0.15	0.15	0.09	0.50						
16/09/2024 16:00	0.56		0.00	0.00	0.14	0.15	0.09	0.50						
16/09/2024 16:15	0.56		0.00	0.00	0.14	0.15	0.09	0.50						
16/09/2024 16:30	0.55		0.00	0.00	0.14	0.15	0.09	0.50						
16/09/2024 16:45	0.55		0.00	0.00	0.14	0.15	0.09	0.50						
16/09/2024 17:00	0.55		0.00	0.00	0.14	0.15	0.09	0.50						
16/09/2024 17:15	0.55		0.00	0.00	0.14	0.15	0.09	0.50						
16/09/2024 17:30	0.55		0.00	0.00	0.14	0.15	0.09	0.50						
16/09/2024 17:45	0.54		0.00	0.00	0.14	0.15	0.09	0.50						
16/09/2024 18:00	0.54		0.00	0.00	0.14	0.15	0.09	0.50						
16/09/2024 18:15	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
16/09/2024 18:30	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
16/09/2024 18:45	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
16/09/2024 19:00	0.53		0.00	0.00	0.14	0.15	0.09	0.51						
16/09/2024 19:15	0.53		0.00	0.00	0.14	0.15	0.09	0.51						
16/09/2024 19:30	0.53		0.00	0.00	0.14	0.15	0.09	0.51						
16/09/2024 19:45	0.53		0.00	0.00	0.14	0.15	0.09	0.52						
16/09/2024 20:00	0.53		0.00	0.00	0.14	0.15	0.09	0.52						
16/09/2024 20:15	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
16/09/2024 20:30	0.53		0.00	0.00	0.14	0.15	0.09	0.52						
16/09/2024 20:45	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
16/09/2024 21:00	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
16/09/2024 21:15	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
16/09/2024 21:30	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
16/09/2024 21:45	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
16/09/2024 22:00	0.54		0.00	0.00	0.14	0.15	0.09	0.52						
16/09/2024 22:15	0.54		0.00	0.00	0.15	0.15	0.09	0.52						
16/09/2024 22:30	0.54		0.00	0.00	0.15	0.15	0.09	0.52						
16/09/2024 22:45	0.54		-0.01	0.00	0.15	0.15	0.09	0.52						
16/09/2024 23:00	0.54		-0.01	0.00	0.15	0.16	0.09	0.51						
16/09/2024 23:15	0.54		0.00	0.00	0.15	0.16	0.09	0.51						
16/09/2024 23:30	0.54		0.00	0.00	0.15	0.16	0.09	0.51						
16/09/2024 23:45	0.54		0.00	0.00	0.15	0.16	0.09	0.51						
17/09/2024 00:00	0.54		0.00	0.00	0.15	0.16	0.09	0.51						
17/09/2024 00:15	0.55		0.00	0.00	0.15	0.16	0.09	0.50						
17/09/2024 00:30	0.55		0.00	0.00	0.15	0.16	0.09	0.50						
17/09/2024 00:45	0.55		0.00	0.00	0.15	0.16	0.09	0.50						
17/09/2024 01:00	0.55		0.00	0.00	0.15	0.16	0.09	0.50						
17/09/2024 01:15	0.55		0.00	0.00	0.15	0.16	0.09	0.50						
17/09/2024 01:30	0.55		0.00	0.00	0.15	0.15	0.09	0.50						
17/09/2024 01:45	0.55		0.00	0.00	0.15	0.15	0.09	0.49						
17/09/2024 02:00	0.55		0.00	0.00	0.15	0.15	0.09	0.49						
17/09/2024 02:15	0.55		0.00	0.00	0.14	0.15	0.09	0.49						
17/09/2024 02:30	0.55		0.00	0.00	0.14	0.15	0.09	0.49						
17/09/2024 02:45	0.55		0.00	0.00	0.14	0.15	0.09	0.49						
17/09/2024 03:00	0.55		0.00	0.00	0.14	0.15	0.09	0.49						
17/09/2024 03:15	0.55		0.00	0.00	0.14	0.15	0.09	0.49						
17/09/2024 03:30	0.55		0.00	0.00	0.14	0.15	0.09	0.49						
17/09/2024 03:45	0.55		0.00	0.00	0.14	0.15	0.09	0.49						
17/09/2024 04:00	0.55		0.00	0.00	0.14	0.15	0.09	0.49						
17/09/2024 04:15	0.55		0.00	0.00	0.14	0.15	0.09	0.49						
17/09/2024 04:30	0.55		0.00	0.00	0.14	0.15	0.08	0.48						
17/09/2024 04:45	0.55		0.00	0.00	0.14	0.15	0.08	0.48						
17/09/2024 05:00	0.54		0.00	0.00	0.14	0.15	0.08	0.48						
17/09/2024 05:15	0.54		0.00	0.00	0.14	0.15	0.08	0.48						
17/09/2024 05:30	0.54		0.00	0.00	0.14	0.15	0.08	0.48						
17/09/2024 05:45	0.54		0.00	0.00	0.14	0.15	0.08	0.48						
17/09/2024 06:00	0.54		0.00	0.00	0.14	0.15	0.08	0.48						
17/09/2024 06:15	0.53		-0.01	0.00	0.13	0.14	0.08	0.48						
17/09/2024 06:30	0.53		-0.01	0.00	0.13	0.14	0.08	0.49						
17/09/2024 06:45	0.53		-0.01	0.00	0.13	0.14	0.08	0.49						
17/09/2024 07:00	0.53		-0.01	0.00	0.13	0.14	0.08	0.49						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
17/09/2024 07:15	0.53		-0.01	0.00	0.13	0.14	0.08	0.49						
17/09/2024 07:30	0.53		-0.01	0.00	0.13	0.14	0.08	0.49						
17/09/2024 07:45	0.53		-0.01	0.00	0.13	0.14	0.08	0.50						
17/09/2024 08:00	0.53		-0.01	0.00	0.13	0.14	0.08	0.50						
17/09/2024 08:15	0.53		-0.01	0.00	0.13	0.14	0.08	0.51						
17/09/2024 08:30	0.54		-0.01	0.00	0.13	0.14	0.08	0.51						
17/09/2024 08:45	0.54		-0.01	0.00	0.13	0.14	0.08	0.51						
17/09/2024 09:00	0.54		-0.01	0.00	0.13	0.14	0.08	0.51						
17/09/2024 09:15	0.54		-0.01	0.00	0.13	0.14	0.08	0.51						
17/09/2024 09:30	0.54		-0.01	0.00	0.14	0.14	0.08	0.51						
17/09/2024 09:45	0.54		-0.01	0.00	0.14	0.15	0.08	0.51						
17/09/2024 10:00	0.54		-0.01	0.00	0.14	0.15	0.08	0.52						
17/09/2024 10:15	0.54		-0.01	0.00	0.14	0.15	0.08	0.52						
17/09/2024 10:30	0.55		-0.01	0.00	0.14	0.15	0.08	0.52						
17/09/2024 10:45	0.55		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 11:00	0.55		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 11:15	0.55		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 11:30	0.55		0.00	0.00	0.14	0.15	0.09	0.52						
17/09/2024 11:45	0.55		0.00	0.00	0.14	0.15	0.09	0.51						
17/09/2024 12:00	0.56		-0.01	0.00	0.14	0.15	0.09	0.51						
17/09/2024 12:15	0.56		-0.01	0.00	0.14	0.15	0.09	0.51						
17/09/2024 12:30	0.56		-0.01	0.00	0.15	0.15	0.09	0.51						
17/09/2024 12:45	0.56		-0.01	0.00	0.15	0.15	0.09	0.51						
17/09/2024 13:00	0.56		-0.01	0.00	0.15	0.15	0.09	0.51						
17/09/2024 13:15	0.56		-0.01	0.00	0.14	0.15	0.09	0.51						
17/09/2024 13:30	0.56		-0.01	0.00	0.14	0.15	0.09	0.51						
17/09/2024 13:45	0.56		0.00	0.00	0.14	0.15	0.09	0.51						
17/09/2024 14:00	0.56		0.00	0.00	0.14	0.15	0.09	0.51						
17/09/2024 14:15	0.56		0.00	0.00	0.14	0.15	0.09	0.51						
17/09/2024 14:30	0.56		-0.01	0.00	0.14	0.15	0.09	0.51						
17/09/2024 14:45	0.55		0.00	0.00	0.14	0.15	0.09	0.51						
17/09/2024 15:00	0.55		0.00	0.00	0.14	0.15	0.09	0.50						
17/09/2024 15:15	0.55		0.00	0.00	0.14	0.15	0.09	0.50						
17/09/2024 15:30	0.55		0.00	0.00	0.14	0.15	0.09	0.50						
17/09/2024 15:45	0.55		0.00	0.00	0.14	0.15	0.09	0.50						
17/09/2024 16:00	0.54		-0.01	0.00	0.14	0.15	0.09	0.50						
17/09/2024 16:15	0.54		-0.01	0.00	0.14	0.15	0.09	0.50						
17/09/2024 16:30	0.54		-0.01	0.00	0.14	0.15	0.09	0.50						
17/09/2024 16:45	0.54		-0.01	0.00	0.14	0.15	0.09	0.50						
17/09/2024 17:00	0.54		-0.01	0.00	0.14	0.15	0.09	0.50						
17/09/2024 17:15	0.53		-0.01	0.00	0.14	0.15	0.09	0.50						
17/09/2024 17:30	0.53		0.00	0.00	0.14	0.15	0.09	0.50						
17/09/2024 17:45	0.53		0.00	0.00	0.14	0.15	0.09	0.51						
17/09/2024 18:00	0.53		-0.01	0.00	0.14	0.15	0.09	0.51						
17/09/2024 18:15	0.52		-0.01	0.00	0.14	0.15	0.08	0.51						
17/09/2024 18:30	0.52		-0.01	0.00	0.14	0.15	0.09	0.51						
17/09/2024 18:45	0.52		-0.01	0.00	0.14	0.15	0.09	0.51						
17/09/2024 19:00	0.52		-0.01	0.00	0.14	0.15	0.09	0.51						
17/09/2024 19:15	0.52		-0.01	0.00	0.14	0.15	0.08	0.51						
17/09/2024 19:30	0.52		0.00	0.00	0.14	0.15	0.08	0.52						
17/09/2024 19:45	0.52		0.00	0.00	0.14	0.15	0.09	0.52						
17/09/2024 20:00	0.51		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 20:15	0.51		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 20:30	0.51		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 20:45	0.51		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 21:00	0.51		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 21:15	0.51		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 21:30	0.51		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 21:45	0.51		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 22:00	0.52		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 22:15	0.52		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 22:30	0.52		-0.01	0.00	0.14	0.15	0.09	0.52						
17/09/2024 22:45	0.52		0.00	0.00	0.15	0.15	0.09	0.52						
17/09/2024 23:00	0.52		-0.01	0.00	0.15	0.15	0.09	0.52						
17/09/2024 23:15	0.52		0.00	0.00	0.15	0.15	0.09	0.51						
17/09/2024 23:30	0.52		0.00	0.00	0.15	0.16	0.09	0.51						
17/09/2024 23:45	0.52		0.00	0.00	0.15	0.16	0.09	0.51						
18/09/2024 00:00	0.52		0.00	0.00	0.15	0.16	0.09	0.51						
18/09/2024 00:15	0.53		0.00	0.00	0.15	0.16	0.09	0.51						
18/09/2024 00:30	0.53		0.00	0.00	0.15	0.16	0.09	0.50						
18/09/2024 00:45	0.53		0.00	0.00	0.15	0.16	0.09	0.50						
18/09/2024 01:00	0.53		0.00	0.00	0.15	0.15	0.09	0.50						
18/09/2024 01:15	0.53		0.00	0.00	0.15	0.15	0.09	0.50						
18/09/2024 01:30	0.54		0.00	0.00	0.14	0.14	0.09	0.50						
18/09/2024 01:45	0.54		0.00	0.00	0.14	0.15	0.09	0.50						
18/09/2024 02:00	0.54		0.00	0.00	0.14	0.15	0.09	0.49						
18/09/2024 02:15	0.54		-0.01	0.00	0.14	0.15	0.09	0.49						
18/09/2024 02:30	0.54		0.00	0.00	0.14	0.15	0.09	0.49						
18/09/2024 02:45	0.54		0.00	0.00	0.14	0.15	0.09	0.49						
18/09/2024 03:00	0.54		-0.01	0.00	0.14	0.15	0.09	0.49						
18/09/2024 03:15	0.54		-0.01	0.00	0.14	0.15	0.09	0.49						
18/09/2024 03:30	0.54		-0.01	0.00	0.14	0.15	0.09	0.49						
18/09/2024 03:45	0.54		-0.01	0.00	0.14	0.15	0.08	0.49						
18/09/2024 04:00	0.54		0.00	0.00	0.14	0.15	0.08	0.49						
18/09/2024 04:15	0.54		-0.01	0.00	0.14	0.15	0.08	0.49						
18/09/2024 04:30	0.54		-0.01	0.00	0.14	0.15	0.08	0.49						
18/09/2024 04:45	0.54		-0.01	0.00	0.14	0.15	0.08	0.49						
18/09/2024 05:00	0.53		-0.01	0.00	0.14	0.15	0.08	0.49						
18/09/2024 05:15	0.53		-0.01	0.00	0.14	0.14	0.08	0.49						
18/09/2024 05:30	0.53		-0.01	0.00	0.13	0.14	0.08	0.49						
18/09/2024 05:45	0.53		-0.01	0.00	0.13	0.14	0.08	0.48						
18/09/2024 06:00	0.53		-0.01	0.00	0.13	0.14	0.08	0.48						
18/09/2024 06:15	0.53		-0.01	0.00	0.13	0.14	0.08	0.49						
18/09/2024 06:30	0.53		-0.01	0.00	0.13	0.14	0.08	0.49						
18/09/2024 06:45	0.52		-0.01	0.00	0.13	0.14	0.08	0.49						
18/09/2024 07:00	0.52		-0.01	0.00	0.13	0.14	0.08	0.49						
18/09/2024 07:15	0.52		-0.01	0.00	0.13	0.14	0.08	0.49						
18/09/2024 07:30	0.52		-0.01	0.00	0.13	0.14	0.08	0.49						
18/09/2024 07:45	0.52		-0.01	0.00	0.13	0.14	0.08	0.50						
18/09/2024 08:00	0.52		-0.01	0.00	0.13	0.14	0.08	0.50						
18/09/2024 08:15	0.52		-0.01	0.00	0.13	0.14	0.08	0.51						
18/09/2024 08:30	0.52		-0.01	0.00	0.13	0.14	0.08	0.52						
18/09/2024 08:45	0.52		-0.01	0.00	0.13	0.14	0.08	0.52						
18/09/2024 09:00	0.52		-0.01	0.00	0.13	0.14	0.08	0.52						
18/09/2024 09:15	0.52		-0.01	0.00	0.13	0.14	0.08	0.52						
18/09/2024 09:30	0.52		-0.01	0.00	0.13	0.14	0.08	0.52						
18/09/2024 09:45	0.52		-0.01	0.00	0.13	0.14	0.08	0.52						
18/09/2024 10:00	0.52		-0.01	0.00	0.14	0.15	0.08	0.52						
18/09/2024 10:15	0.53		-0.01	0.00	0.14	0.15	0.08	0.52						
18/09/2024 10:30	0.53		-0.01	0.00	0.14	0.15	0.08	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
18/09/2024 10:45	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 11:00	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 11:15	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 11:30	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 11:45	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 12:00	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 12:15	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 12:30	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 12:45	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 13:00	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 13:15	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 13:30	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 13:45	0.55		-0.01	0.00	0.14	0.15	0.09	0.51						
18/09/2024 14:00	0.55		-0.01	0.00	0.15	0.15	0.09	0.51						
18/09/2024 14:15	0.55		-0.01	0.00	0.15	0.15	0.09	0.51						
18/09/2024 14:30	0.55		-0.01	0.00	0.14	0.15	0.09	0.51						
18/09/2024 14:45	0.55		-0.01	0.00	0.14	0.15	0.09	0.51						
18/09/2024 15:00	0.55		-0.01	0.00	0.14	0.15	0.09	0.51						
18/09/2024 15:15	0.54		-0.01	0.00	0.14	0.15	0.09	0.51						
18/09/2024 15:30	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 15:45	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 16:00	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 16:15	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 16:30	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 16:45	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 17:00	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 17:15	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 17:30	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 17:45	0.54		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 18:00	0.53		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 18:15	0.53		0.00	0.00	0.14	0.15	0.09	0.51						
18/09/2024 18:30	0.53		0.00	0.00	0.14	0.15	0.09	0.52						
18/09/2024 18:45	0.53		0.00	0.00	0.14	0.15	0.09	0.52						
18/09/2024 19:00	0.53		0.00	0.00	0.14	0.15	0.09	0.52						
18/09/2024 19:15	0.53		0.00	0.00	0.14	0.15	0.09	0.52						
18/09/2024 19:30	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 19:45	0.53		0.00	0.00	0.14	0.15	0.09	0.52						
18/09/2024 20:00	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 20:15	0.53		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 20:30	0.52		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 20:45	0.52		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 21:00	0.52		-0.01	0.00	0.14	0.15	0.09	0.52						
18/09/2024 21:15	0.52		0.00	0.00	0.14	0.15	0.09	0.52						
18/09/2024 21:30	0.52		0.00	0.00	0.14	0.15	0.09	0.52						
18/09/2024 21:45	0.52		0.00	0.00	0.14	0.15	0.09	0.52						
18/09/2024 22:00	0.52		0.00	0.00	0.15	0.16	0.09	0.52						
18/09/2024 22:15	0.52		0.00	0.00	0.15	0.16	0.09	0.52						
18/09/2024 22:30	0.52		0.00	0.00	0.15	0.16	0.09	0.52						
18/09/2024 22:45	0.52		0.00	0.00	0.15	0.16	0.09	0.52						
18/09/2024 23:00	0.52		0.00	0.00	0.15	0.16	0.09	0.52						
18/09/2024 23:15	0.53		0.00	0.00	0.15	0.16	0.09	0.52						
18/09/2024 23:30	0.53		0.00	0.00	0.15	0.16	0.09	0.52						
18/09/2024 23:45	0.53		0.00	0.00	0.15	0.16	0.09	0.52						
19/09/2024 00:00	0.53		0.00	0.00	0.15	0.16	0.09	0.52						
19/09/2024 00:15	0.53		0.00	0.00	0.15	0.16	0.09	0.52						
19/09/2024 00:30	0.53		0.00	0.00	0.15	0.16	0.09	0.51						
19/09/2024 00:45	0.53		0.00	0.00	0.15	0.16	0.09	0.51						
19/09/2024 01:00	0.53		0.00	0.00	0.15	0.16	0.09	0.51						
19/09/2024 01:15	0.53		0.00	0.00	0.15	0.16	0.09	0.51						
19/09/2024 01:30	0.53		0.00	0.00	0.15	0.15	0.09	0.50						
19/09/2024 01:45	0.53		0.00	0.00	0.15	0.15	0.09	0.50						
19/09/2024 02:00	0.53		0.00	0.00	0.15	0.15	0.09	0.50						
19/09/2024 02:15	0.54		0.00	0.00	0.14	0.15	0.09	0.50						
19/09/2024 02:30	0.54		0.00	0.00	0.14	0.15	0.09	0.50						
19/09/2024 02:45	0.54		0.00	0.00	0.14	0.15	0.09	0.50						
19/09/2024 03:00	0.54		0.00	0.00	0.14	0.15	0.09	0.50						
19/09/2024 03:15	0.54		0.00	0.00	0.14	0.15	0.09	0.50						
19/09/2024 03:30	0.54		0.00	0.00	0.14	0.15	0.09	0.49						
19/09/2024 03:45	0.54		0.00	0.00	0.14	0.15	0.09	0.49						
19/09/2024 04:00	0.54		0.00	0.00	0.14	0.15	0.09	0.49						
19/09/2024 04:15	0.54		0.00	0.00	0.14	0.15	0.09	0.49						
19/09/2024 04:30	0.54		0.00	0.00	0.14	0.15	0.09	0.49						
19/09/2024 04:45	0.54		0.00	0.00	0.14	0.15	0.08	0.49						
19/09/2024 05:00	0.54		-0.01	0.00	0.14	0.15	0.08	0.49						
19/09/2024 05:15	0.54		0.00	0.00	0.14	0.15	0.08	0.49						
19/09/2024 05:30	0.54		0.00	0.00	0.14	0.15	0.08	0.49						
19/09/2024 05:45	0.54		0.00	0.00	0.14	0.15	0.08	0.49						
19/09/2024 06:00	0.54		-0.01	0.00	0.14	0.15	0.08	0.49						
19/09/2024 06:15	0.54		-0.01	0.00	0.14	0.15	0.08	0.49						
19/09/2024 06:30	0.54		-0.01	0.00	0.13	0.15	0.08	0.49						
19/09/2024 06:45	0.54		-0.01	0.00	0.13	0.15	0.08	0.49						
19/09/2024 07:00	0.54		-0.01	0.00	0.13	0.14	0.08	0.50						
19/09/2024 07:15	0.54		-0.01	0.00	0.13	0.14	0.08	0.50						
19/09/2024 07:30	0.54		-0.01	0.00	0.13	0.14	0.08	0.50						
19/09/2024 07:45	0.54		-0.01	0.00	0.13	0.14	0.08	0.51						
19/09/2024 08:00	0.54		-0.01	0.00	0.13	0.14	0.08	0.51						
19/09/2024 08:15	0.54		-0.01	0.00	0.13	0.14	0.08	0.52						
19/09/2024 08:30	0.53		-0.01	0.00	0.13	0.14	0.08	0.52						
19/09/2024 08:45	0.53		-0.01	0.00	0.13	0.14	0.08	0.53						
19/09/2024 09:00	0.53		-0.01	0.00	0.14	0.14	0.08	0.53						
19/09/2024 09:15	0.53		-0.01	0.00	0.14	0.15	0.08	0.53						
19/09/2024 09:30	0.53		-0.01	0.00	0.14	0.15	0.08	0.53						
19/09/2024 09:45	0.53		-0.01	0.00	0.14	0.15	0.08	0.53						
19/09/2024 10:00	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
19/09/2024 10:15	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
19/09/2024 10:30	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
19/09/2024 10:45	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
19/09/2024 11:00	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
19/09/2024 11:15	0.54		-0.01	0.00	0.14	0.15	0.09	0.52						
19/09/2024 11:30	0.54		-0.01	0.00	0.15	0.15	0.09	0.52						
19/09/2024 11:45	0.54		-0.01	0.00	0.15	0.15	0.09	0.52						
19/09/2024 12:00	0.54		-0.01	0.00	0.15	0.15	0.09	0.52						
19/09/2024 12:15	0.54		-0.01	0.00	0.15	0.15	0.09	0.52						
19/09/2024 12:30	0.54		-0.01	0.00	0.15	0.16	0.09	0.52						
19/09/2024 12:45	0.54		-0.01	0.00	0.15	0.16	0.09	0.52						
19/09/2024 13:00	0.54		-0.01	0.00	0.15	0.16	0.09	0.52						
19/09/2024 13:15	0.54		-0.01	0.00	0.15	0.16	0.09	0.52						
19/09/2024 13:30	0.55		-0.01	0.00	0.15	0.16	0.09	0.52						
19/09/2024 13:45	0.55		-0.01	0.00	0.15	0.16	0.09	0.52						
19/09/2024 14:00	0.55		-0.01	0.00	0.15	0.16	0.09	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
19/09/2024 14:15	0.55		-0.01	0.00	0.15	0.16	0.09	0.52						
19/09/2024 14:30	0.55		-0.01	0.00	0.15	0.15	0.09	0.52						
19/09/2024 14:45	0.55		-0.01	0.00	0.15	0.15	0.09	0.51						
19/09/2024 15:00	0.55		-0.01	0.00	0.15	0.15	0.09	0.51						
19/09/2024 15:15	0.55		-0.01	0.00	0.15	0.15	0.09	0.51						
19/09/2024 15:30	0.55		-0.01	0.00	0.15	0.12	0.09	0.51						
19/09/2024 15:45	0.55		-0.01	0.00	0.15	0.14	0.09	0.51						
19/09/2024 16:00	0.55		-0.01	0.00	0.14	0.14	0.09	0.51						
19/09/2024 16:15	0.55		0.00	0.00	0.14	0.14	0.09	0.52						
19/09/2024 16:30	0.55		0.00	0.00	0.14	0.14	0.09	0.52						
19/09/2024 16:45	0.55		0.00	0.00	0.14	0.13	0.09	0.52						
19/09/2024 17:00	0.55		0.00	0.00	0.14	0.14	0.09	0.52						
19/09/2024 17:15	0.55		0.00	0.00	0.14	0.14	0.09	0.52						
19/09/2024 17:30	0.55		0.00	0.00	0.14	0.14	0.09	0.52						
19/09/2024 17:45	0.55		0.00	0.00	0.14	0.14	0.09	0.52						
19/09/2024 18:00	0.55		0.00	0.00	0.14	0.14	0.09	0.52						
19/09/2024 18:15	0.54		-0.01	0.00	0.14	0.14	0.09	0.52						
19/09/2024 18:30			0.00	0.00	0.14	0.14	0.09	0.52						
19/09/2024 18:45			0.00	0.00	0.14	0.14	0.09	0.52						
19/09/2024 19:00			-0.01	0.00	0.14	0.14	0.09	0.52						
19/09/2024 19:15			-0.01	0.00	0.14	0.14	0.09	0.53						
19/09/2024 19:30			0.00	0.00	0.14	0.14	0.09	0.53						
19/09/2024 19:45			0.00	0.00	0.14	0.14	0.09	0.53						
19/09/2024 20:00			0.00	0.00	0.14	0.14	0.09	0.53						
19/09/2024 20:15			-0.01	0.00	0.14	0.14	0.09	0.54						
19/09/2024 20:30			-0.01	0.00	0.14	0.14	0.09	0.54						
19/09/2024 20:45			0.00	0.00	0.15	0.14	0.09	0.54						
19/09/2024 21:00			0.00	0.00	0.15	0.14	0.09	0.53						
19/09/2024 21:15			0.00	0.00	0.15	0.14	0.09	0.53						
19/09/2024 21:30			0.00	0.00	0.15	0.14	0.09	0.53						
19/09/2024 21:45			0.00	0.00	0.15	0.15	0.09	0.53						
19/09/2024 22:00			0.00	0.00	0.15	0.15	0.09	0.53						
19/09/2024 22:15			0.00	0.00	0.15	0.15	0.10	0.53						
19/09/2024 22:30			0.00	0.00	0.15	0.15	0.10	0.52						
19/09/2024 22:45			0.00	0.00	0.15	0.15	0.10	0.52						
19/09/2024 23:00			0.00	0.00	0.15	0.15	0.10	0.52						
19/09/2024 23:15			0.00	0.00	0.15	0.15	0.10	0.52						
19/09/2024 23:30			0.00	0.00	0.15	0.15	0.10	0.52						
19/09/2024 23:45			0.00	0.00	0.15	0.15	0.10	0.52						
20/09/2024 00:00			0.00	0.00	0.15	0.15	0.10	0.52						
20/09/2024 00:15			0.00	0.00	0.15	0.15	0.10	0.51						
20/09/2024 00:30			0.00	0.00	0.15	0.15	0.09	0.51						
20/09/2024 00:45			0.00	0.00	0.15	0.15	0.09	0.51						
20/09/2024 01:00			0.00	0.00	0.15	0.15	0.09	0.51						
20/09/2024 01:15			0.00	0.00	0.15	0.15	0.09	0.51						
20/09/2024 01:30			0.00	0.00	0.15	0.15	0.09	0.51						
20/09/2024 01:45			0.00	0.00	0.15	0.15	0.09	0.51						
20/09/2024 02:00			0.00	0.00	0.15	0.15	0.09	0.51						
20/09/2024 02:15			0.00	0.00	0.15	0.15	0.09	0.51						
20/09/2024 02:30			0.00	0.00	0.15	0.15	0.09	0.51						
20/09/2024 02:45			0.00	0.00	0.14	0.15	0.09	0.51						
20/09/2024 03:00			0.00	0.00	0.14	0.15	0.09	0.51						
20/09/2024 03:15			0.00	0.00	0.14	0.15	0.09	0.51						
20/09/2024 03:30			0.00	0.00	0.14	0.15	0.09	0.51						
20/09/2024 03:45			0.00	0.00	0.14	0.15	0.09	0.50						
20/09/2024 04:00			0.00	0.00	0.14	0.15	0.09	0.50						
20/09/2024 04:15			0.00	0.00	0.14	0.15	0.09	0.50						
20/09/2024 04:30			0.00	0.00	0.14	0.15	0.09	0.50						
20/09/2024 04:45			-0.01	0.00	0.14	0.15	0.09	0.50						
20/09/2024 05:00			0.00	0.00	0.14	0.15	0.09	0.50						
20/09/2024 05:15			0.00	0.00	0.14	0.15	0.09	0.50						
20/09/2024 05:30			-0.01	0.00	0.14	0.15	0.09	0.50						
20/09/2024 05:45			0.00	0.00	0.14	0.14	0.09	0.50						
20/09/2024 06:00			0.00	0.00	0.14	0.14	0.09	0.50						
20/09/2024 06:15			0.00	0.00	0.14	0.14	0.09	0.50						
20/09/2024 06:30			-0.01	0.00	0.14	0.14	0.09	0.50						
20/09/2024 06:45			-0.01	0.00	0.14	0.14	0.08	0.50						
20/09/2024 07:00			-0.01	0.00	0.14	0.14	0.08	0.50						
20/09/2024 07:15			-0.01	0.00	0.14	0.14	0.08	0.50						
20/09/2024 07:30			0.00	0.00	0.14	0.14	0.08	0.50						
20/09/2024 07:45			0.00	0.00	0.14	0.14	0.08	0.51						
20/09/2024 08:00			-0.01	0.00	0.14	0.14	0.08	0.51						
20/09/2024 08:15			-0.01	0.00	0.14	0.14	0.08	0.52						
20/09/2024 08:30			-0.01	0.00	0.14	0.14	0.08	0.52						
20/09/2024 08:45			-0.01	0.00	0.14	0.14	0.08	0.52						
20/09/2024 09:00			-0.01	0.00	0.14	0.14	0.08	0.52						
20/09/2024 09:15			-0.01	0.00	0.14	0.14	0.08	0.52						
20/09/2024 09:30			-0.01	0.00	0.14	0.14	0.08	0.52						
20/09/2024 09:45			-0.01	0.00	0.14	0.15	0.09	0.53						
20/09/2024 10:00			-0.01	0.00	0.14	0.15	0.09	0.53						
20/09/2024 10:15			-0.01	0.00	0.14	0.15	0.09	0.53						
20/09/2024 10:30			-0.01	0.00	0.14	0.15	0.09	0.53						
20/09/2024 10:45			-0.01	0.00	0.14	0.15	0.09	0.53						
20/09/2024 11:00			-0.01	0.00	0.14	0.15	0.09	0.53						
20/09/2024 11:15			-0.01	0.00	0.14	0.15	0.09	0.53						
20/09/2024 11:30			-0.01	0.00	0.14	0.15	0.09	0.53						
20/09/2024 11:45			-0.01	0.00	0.15	0.15	0.09	0.53						
20/09/2024 12:00			-0.01	0.00	0.15	0.15	0.09	0.53						
20/09/2024 12:15			0.00	0.00	0.15	0.15	0.09	0.53						
20/09/2024 12:30			0.00	0.00	0.15	0.15	0.09	0.53						
20/09/2024 12:45			-0.01	0.00	0.15	0.15	0.09	0.53						
20/09/2024 13:00			-0.01	0.00	0.15	0.15	0.09	0.53						
20/09/2024 13:15			-0.01	0.00	0.15	0.16	0.09	0.53						
20/09/2024 13:30			-0.01	0.00	0.15	0.16	0.09	0.52						
20/09/2024 13:45			-0.01	0.00	0.15	0.16	0.09	0.52						
20/09/2024 14:00			-0.01	0.00	0.15	0.16	0.09	0.52						
20/09/2024 14:15			-0.01	0.00	0.15	0.16	0.09	0.52						
20/09/2024 14:30			-0.01	0.00	0.15	0.16	0.09	0.52						
20/09/2024 14:45			-0.01	0.00	0.15	0.16	0.09	0.52						
20/09/2024 15:00			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 15:15			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 15:30			-0.01	0.00	0.15	0.16	0.09	0.52						
20/09/2024 15:45			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 16:00			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 16:15			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 16:30			0.00	0.00	0.15	0.15	0.09	0.52						
20/09/2024 16:45			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 17:00			0.00	0.00	0.15	0.15	0.09	0.52						
20/09/2024 17:15			0.00	0.00	0.15	0.15	0.09	0.52						
20/09/2024 17:30			0.00	0.00	0.15	0.15	0.09	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
20/09/2024 17:45			0.00	0.00	0.15	0.15	0.09	0.52						
20/09/2024 18:00			0.00	0.00	0.15	0.15	0.09	0.52						
20/09/2024 18:15			0.00	0.00	0.15	0.15	0.09	0.52						
20/09/2024 18:30			0.00	0.00	0.15	0.15	0.09	0.52						
20/09/2024 18:45			0.00	0.00	0.15	0.15	0.09	0.52						
20/09/2024 19:00			0.00	0.00	0.15	0.15	0.09	0.52						
20/09/2024 19:15			0.00	0.00	0.15	0.15	0.09	0.52						
20/09/2024 19:30			0.00	0.00	0.15	0.15	0.09	0.53						
20/09/2024 19:45			0.00	0.00	0.15	0.15	0.09	0.53						
20/09/2024 20:00			0.00	0.00	0.15	0.15	0.09	0.53						
20/09/2024 20:15			0.00	0.00	0.15	0.16	0.09	0.53						
20/09/2024 20:30			0.00	0.00	0.15	0.16	0.09	0.53						
20/09/2024 20:45			0.00	0.00	0.15	0.16	0.09	0.53						
20/09/2024 21:00			0.00	0.00	0.15	0.16	0.09	0.53						
20/09/2024 21:15			0.00	0.00	0.15	0.16	0.09	0.53						
20/09/2024 21:30			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 21:45			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 22:00			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 22:15			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 22:30			0.00	0.00	0.15	0.16	0.09	0.52						
20/09/2024 22:45			0.00	0.00	0.15	0.16	0.09	0.53						
20/09/2024 23:00			0.00	0.00	0.15	0.16	0.09	0.53						
20/09/2024 23:15			0.00	0.00	0.15	0.16	0.09	0.53						
20/09/2024 23:30			0.00	0.00	0.15	0.16	0.09	0.53						
20/09/2024 23:45			0.00	0.00	0.15	0.16	0.09	0.52						
21/09/2024 00:00			0.00	0.00	0.15	0.16	0.09	0.52						
21/09/2024 00:15			0.00	0.00	0.15	0.16	0.09	0.52						
21/09/2024 00:30			0.00	0.00	0.15	0.16	0.09	0.52						
21/09/2024 00:45			0.00	0.00	0.15	0.16	0.09	0.51						
21/09/2024 01:00			0.00	0.00	0.15	0.16	0.09	0.51						
21/09/2024 01:15			0.00	0.00	0.15	0.16	0.09	0.51						
21/09/2024 01:30			0.00	0.00	0.15	0.16	0.09	0.51						
21/09/2024 01:45			0.00	0.00	0.15	0.16	0.09	0.51						
21/09/2024 02:00			0.00	0.00	0.15	0.16	0.09	0.51						
21/09/2024 02:15			0.00	0.00	0.15	0.16	0.09	0.50						
21/09/2024 02:30			0.00	0.00	0.15	0.16	0.09	0.50						
21/09/2024 02:45			0.00	0.00	0.15	0.16	0.09	0.50						
21/09/2024 03:00			0.00	0.00	0.15	0.16	0.09	0.50						
21/09/2024 03:15			0.00	0.00	0.14	0.16	0.09	0.50						
21/09/2024 03:30			0.00	0.00	0.14	0.15	0.09	0.50						
21/09/2024 03:45			0.00	0.00	0.14	0.15	0.09	0.50						
21/09/2024 04:00			0.00	0.00	0.14	0.15	0.09	0.50						
21/09/2024 04:15			0.00	0.00	0.14	0.15	0.09	0.50						
21/09/2024 04:30			0.00	0.00	0.14	0.15	0.09	0.50						
21/09/2024 04:45			0.00	0.00	0.14	0.15	0.09	0.50						
21/09/2024 05:00			0.00	0.00	0.14	0.15	0.09	0.49						
21/09/2024 05:15			0.00	0.00	0.14	0.15	0.09	0.49						
21/09/2024 05:30			0.00	0.00	0.14	0.15	0.09	0.49						
21/09/2024 05:45			0.00	0.00	0.14	0.15	0.09	0.49						
21/09/2024 06:00			-0.01	0.00	0.14	0.15	0.08	0.49						
21/09/2024 06:15			0.00	0.00	0.14	0.15	0.08	0.49						
21/09/2024 06:30			-0.01	0.00	0.14	0.15	0.08	0.49						
21/09/2024 06:45			-0.01	0.00	0.14	0.15	0.08	0.49						
21/09/2024 07:00			-0.01	0.00	0.14	0.15	0.08	0.50						
21/09/2024 07:15			-0.01	0.00	0.14	0.15	0.08	0.50						
21/09/2024 07:30			-0.01	0.00	0.14	0.15	0.08	0.50						
21/09/2024 07:45			-0.01	0.00	0.14	0.15	0.08	0.50						
21/09/2024 08:00			-0.01	0.00	0.14	0.15	0.08	0.50						
21/09/2024 08:15			-0.01	0.00	0.14	0.15	0.08	0.50						
21/09/2024 08:30			-0.01	0.00	0.14	0.15	0.08	0.51						
21/09/2024 08:45			-0.01	0.00	0.14	0.15	0.08	0.52						
21/09/2024 09:00			-0.01	0.00	0.14	0.15	0.08	0.53						
21/09/2024 09:15			-0.01	0.00	0.14	0.15	0.08	0.53						
21/09/2024 09:30			-0.01	0.00	0.14	0.15	0.08	0.53						
21/09/2024 09:45			-0.01	0.00	0.14	0.15	0.08	0.53						
21/09/2024 10:00			-0.01	0.00	0.14	0.15	0.08	0.53						
21/09/2024 10:15			-0.01	0.00	0.14	0.15	0.08	0.54						
21/09/2024 10:30			-0.02	0.00	0.14	0.15	0.09	0.54						
21/09/2024 10:45			-0.01	0.00	0.14	0.15	0.09	0.54						
21/09/2024 11:00			-0.01	0.00	0.14	0.15	0.09	0.54						
21/09/2024 11:15			-0.01	0.00	0.14	0.15	0.09	0.54						
21/09/2024 11:30			-0.01	0.00	0.15	0.15	0.09	0.54						
21/09/2024 11:45			-0.01	0.00	0.15	0.15	0.09	0.54						
21/09/2024 12:00			-0.01	0.00	0.15	0.16	0.09	0.54						
21/09/2024 12:15			-0.01	0.00	0.15	0.16	0.09	0.53						
21/09/2024 12:30			0.00	0.00	0.15	0.16	0.10	0.53						
21/09/2024 12:45			-0.01	0.00	0.15	0.16	0.10	0.53						
21/09/2024 13:00			-0.01	0.00	0.15	0.16	0.10	0.53						
21/09/2024 13:15			0.00	0.00	0.15	0.16	0.10	0.53						
21/09/2024 13:30			0.00	0.00	0.15	0.16	0.10	0.53						
21/09/2024 13:45			-0.01	0.00	0.15	0.16	0.10	0.53						
21/09/2024 14:00			-0.01	0.00	0.15	0.16	0.10	0.53						
21/09/2024 14:15			-0.01	0.00	0.15	0.16	0.10	0.52						
21/09/2024 14:30			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 14:45			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 15:00			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 15:15			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 15:30			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 15:45			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 16:00			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 16:15			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 16:30			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 16:45			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 17:00			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 17:15			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 17:30			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 17:45			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 18:00			0.00	0.00	0.15	0.16	0.09	0.52						
21/09/2024 18:15			0.00	0.00	0.15	0.16	0.09	0.52						
21/09/2024 18:30			0.00	0.00	0.15	0.16	0.09	0.52						
21/09/2024 18:45			0.00	0.00	0.15	0.16	0.09	0.52						
21/09/2024 19:00			0.00	0.00	0.15	0.16	0.09	0.53						
21/09/2024 19:15			0.00	0.00	0.15	0.16	0.09	0.53						
21/09/2024 19:30			0.00	0.00	0.15	0.16	0.09	0.53						
21/09/2024 19:45			0.00	0.00	0.15	0.16	0.09	0.53						
21/09/2024 20:00			0.00	0.00	0.15	0.16	0.09	0.53						
21/09/2024 20:15			0.00	0.00	0.15	0.16	0.09	0.53						
21/09/2024 20:30			0.00	0.00	0.15	0.16	0.10	0.53						
21/09/2024 20:45			0.00	0.00	0.15	0.16	0.10	0.53						
21/09/2024 21:00			0.00	0.00	0.15	0.16	0.10	0.53						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
21/09/2024 21:15			0.00	0.00	0.15	0.16	0.10	0.53						
21/09/2024 21:30			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 21:45			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 22:00			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 22:15			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 22:30			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 22:45			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 23:00			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 23:15			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 23:30			0.00	0.00	0.15	0.16	0.10	0.52						
21/09/2024 23:45			0.00	0.00	0.15	0.16	0.10	0.52						
22/09/2024 00:00			0.00	0.00	0.15	0.16	0.10	0.52						
22/09/2024 00:15			0.00	0.00	0.15	0.16	0.10	0.51						
22/09/2024 00:30			0.00	0.00	0.15	0.14	0.10	0.51						
22/09/2024 00:45			-0.01	0.00	0.15	0.14	0.10	0.51						
22/09/2024 01:00			-0.01	0.00	0.15	0.14	0.10	0.51						
22/09/2024 01:15			0.00	0.00	0.15	0.14	0.09	0.51						
22/09/2024 01:30			0.00	0.00	0.15	0.14	0.09	0.51						
22/09/2024 01:45			0.00	0.00	0.15	0.14	0.09	0.51						
22/09/2024 02:00			0.00	0.00	0.15	0.14	0.09	0.51						
22/09/2024 02:15			0.00	0.00	0.15	0.14	0.09	0.51						
22/09/2024 02:30			0.00	0.00	0.15	0.14	0.09	0.51						
22/09/2024 02:45			-0.01	0.00	0.15	0.14	0.09	0.50						
22/09/2024 03:00			-0.01	0.00	0.15	0.14	0.09	0.50						
22/09/2024 03:15			-0.01	0.00	0.15	0.14	0.09	0.50						
22/09/2024 03:30			-0.01	0.00	0.15	0.14	0.09	0.50						
22/09/2024 03:45			-0.01	0.00	0.14	0.14	0.09	0.50						
22/09/2024 04:00			-0.01	0.00	0.14	0.14	0.09	0.50						
22/09/2024 04:15			-0.01	0.00	0.14	0.14	0.09	0.50						
22/09/2024 04:30			-0.01	0.00	0.14	0.14	0.09	0.50						
22/09/2024 04:45			-0.01	0.00	0.14	0.14	0.09	0.50						
22/09/2024 05:00			-0.01	0.00	0.14	0.14	0.09	0.50						
22/09/2024 05:15			-0.01	0.00	0.14	0.14	0.09	0.50						
22/09/2024 05:30			-0.01	0.00	0.14	0.14	0.09	0.50						
22/09/2024 05:45			-0.01	0.00	0.14	0.13	0.09	0.51						
22/09/2024 06:00			-0.01	0.00	0.14	0.13	0.09	0.51						
22/09/2024 06:15			-0.01	0.00	0.14	0.13	0.09	0.51						
22/09/2024 06:30			-0.01	0.00	0.14	0.13	0.09	0.50						
22/09/2024 06:45			-0.01	0.00	0.14	0.13	0.09	0.50						
22/09/2024 07:00			-0.01	0.00	0.14	0.13	0.09	0.50						
22/09/2024 07:15			-0.01	0.00	0.14	0.13	0.09	0.50						
22/09/2024 07:30			-0.01	0.00	0.14	0.13	0.09	0.50						
22/09/2024 07:45			-0.01	0.00	0.14	0.13	0.09	0.50						
22/09/2024 08:00			-0.01	0.00	0.14	0.13	0.09	0.50						
22/09/2024 08:15			-0.01	0.00	0.14	0.13	0.09	0.51						
22/09/2024 08:30			-0.01	0.00	0.14	0.13	0.09	0.51						
22/09/2024 08:45			-0.01	0.00	0.14	0.13	0.09	0.51						
22/09/2024 09:00			-0.01	0.00	0.14	0.13	0.09	0.51						
22/09/2024 09:15			-0.01	0.00	0.14	0.13	0.09	0.52						
22/09/2024 09:30			-0.01	0.00	0.14	0.13	0.09	0.52						
22/09/2024 09:45			-0.01	0.00	0.14	0.13	0.09	0.52						
22/09/2024 10:00			-0.01	0.00	0.14	0.13	0.09	0.53						
22/09/2024 10:15			-0.01	0.00	0.14	0.13	0.09	0.53						
22/09/2024 10:30			-0.01	0.00	0.14	0.14	0.09	0.53						
22/09/2024 10:45			-0.01	0.00	0.14	0.14	0.09	0.53						
22/09/2024 11:00			-0.01	0.00	0.14	0.14	0.09	0.53						
22/09/2024 11:15			-0.01	0.00	0.14	0.14	0.09	0.53						
22/09/2024 11:30			-0.01	0.00	0.15	0.14	0.09	0.53						
22/09/2024 11:45			-0.01	0.00	0.15	0.14	0.09	0.53						
22/09/2024 12:00			-0.01	0.00	0.15	0.14	0.09	0.53						
22/09/2024 12:15			-0.01	0.00	0.15	0.14	0.09	0.53						
22/09/2024 12:30			-0.01	0.00	0.15	0.13	0.10	0.53						
22/09/2024 12:45			-0.01	0.00	0.15	0.14	0.10	0.53						
22/09/2024 13:00			-0.01	0.00	0.15	0.14	0.10	0.53						
22/09/2024 13:15			-0.01	0.00	0.15	0.14	0.10	0.53						
22/09/2024 13:30			-0.01	0.00	0.15	0.14	0.10	0.53						
22/09/2024 13:45			-0.01	0.00	0.15	0.14	0.10	0.53						
22/09/2024 14:00			-0.01	0.00	0.15	0.14	0.10	0.53						
22/09/2024 14:15			-0.01	0.00	0.15	0.14	0.10	0.53						
22/09/2024 14:30			0.00	0.00	0.15	0.14	0.10	0.53						
22/09/2024 14:45			0.00	0.00	0.15	0.14	0.10	0.53						
22/09/2024 15:00			0.00	0.00	0.15	0.14	0.10	0.53						
22/09/2024 15:15			0.00	0.00	0.15	0.14	0.10	0.53						
22/09/2024 15:30			0.00	0.00	0.15	0.14	0.10	0.53						
22/09/2024 15:45			0.00	0.00	0.15	0.14	0.10	0.53						
22/09/2024 16:00			0.00	0.00	0.15	0.14	0.10	0.54						
22/09/2024 16:15			0.00	0.00	0.15	0.14	0.10	0.54						
22/09/2024 16:30			0.00	0.00	0.15	0.14	0.10	0.54						
22/09/2024 16:45			0.00	0.00	0.15	0.14	0.10	0.54						
22/09/2024 17:00			0.00	0.00	0.15	0.15	0.10	0.54						
22/09/2024 17:15			0.00	0.00	0.15	0.15	0.10	0.53						
22/09/2024 17:30			0.00	0.00	0.15	0.15	0.10	0.53						
22/09/2024 17:45			0.00	0.00	0.15	0.15	0.10	0.53						
22/09/2024 18:00			0.00	0.00	0.16	0.15	0.10	0.53						
22/09/2024 18:15			0.00	0.00	0.16	0.15	0.10	0.53						
22/09/2024 18:30			0.00	0.00	0.16	0.15	0.10	0.53						
22/09/2024 18:45			0.00	0.00	0.16	0.15	0.10	0.53						
22/09/2024 19:00			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 19:15			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 19:30			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 19:45			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 20:00			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 20:15			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 20:30			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 20:45			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 21:00			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 21:15			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 21:30			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 21:45			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 22:00			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 22:15			0.00	0.00	0.16	0.15	0.10	0.54						
22/09/2024 22:30			0.00	0.00	0.16	0.15	0.10	0.53						
22/09/2024 22:45			0.00	0.00	0.16	0.15	0.10	0.53						
22/09/2024 23:00			0.00	0.00	0.16	0.15	0.10	0.53						
22/09/2024 23:15			0.00	0.00	0.16	0.15	0.10	0.52						
22/09/2024 23:30			0.00	0.00	0.16	0.15	0.10	0.53						
22/09/2024 23:45			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 00:00			0.00	0.00	0.16	0.15	0.10	0.52						
23/09/2024 00:15			0.00	0.00	0.16	0.15	0.10	0.52						
23/09/2024 00:30			0.00	0.00	0.16	0.15	0.10	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
23/09/2024 00:45			0.00	0.00	0.16	0.15	0.10	0.52						
23/09/2024 01:00			0.00	0.00	0.16	0.15	0.10	0.52						
23/09/2024 01:15			0.00	0.00	0.16	0.15	0.10	0.52						
23/09/2024 01:30			0.00	0.00	0.16	0.15	0.10	0.51						
23/09/2024 01:45			0.00	0.00	0.16	0.15	0.10	0.51						
23/09/2024 02:00			0.00	0.00	0.15	0.15	0.10	0.52						
23/09/2024 02:15			0.00	0.00	0.15	0.15	0.10	0.52						
23/09/2024 02:30			0.00	0.00	0.15	0.15	0.10	0.52						
23/09/2024 02:45			0.00	0.00	0.15	0.15	0.10	0.52						
23/09/2024 03:00			0.00	0.00	0.15	0.15	0.10	0.52						
23/09/2024 03:15			0.00	0.00	0.15	0.15	0.10	0.52						
23/09/2024 03:30			0.00	0.00	0.15	0.15	0.10	0.51						
23/09/2024 03:45			0.00	0.00	0.15	0.15	0.10	0.51						
23/09/2024 04:00			0.00	0.00	0.15	0.15	0.10	0.51						
23/09/2024 04:15			0.00	0.00	0.15	0.15	0.10	0.51						
23/09/2024 04:30			0.00	0.00	0.15	0.15	0.10	0.51						
23/09/2024 04:45			0.00	0.00	0.15	0.15	0.10	0.51						
23/09/2024 05:00			0.00	0.00	0.15	0.15	0.10	0.51						
23/09/2024 05:15			0.00	0.00	0.15	0.13	0.09	0.51						
23/09/2024 05:30			0.00	0.00	0.15	0.14	0.09	0.51						
23/09/2024 05:45			0.00	0.00	0.15	0.14	0.09	0.51						
23/09/2024 06:00			0.00	0.00	0.15	0.14	0.09	0.51						
23/09/2024 06:15			0.00	0.00	0.15	0.14	0.09	0.51						
23/09/2024 06:30			0.00	0.00	0.15	0.14	0.09	0.51						
23/09/2024 06:45			-0.01	0.00	0.15	0.14	0.09	0.52						
23/09/2024 07:00			-0.01	0.00	0.15	0.14	0.09	0.53						
23/09/2024 07:15			0.00	0.00	0.15	0.14	0.09	0.54						
23/09/2024 07:30			0.00	0.00	0.15	0.14	0.09	0.54						
23/09/2024 07:45			0.00	0.00	0.15	0.14	0.09	0.55						
23/09/2024 08:00			0.00	0.00	0.15	0.14	0.09	0.55						
23/09/2024 08:15			0.00	0.00	0.15	0.14	0.09	0.55						
23/09/2024 08:30			0.00	0.00	0.15	0.14	0.10	0.55						
23/09/2024 08:45			0.00	0.00	0.15	0.14	0.10	0.55						
23/09/2024 09:00			0.00	0.00	0.15	0.14	0.10	0.55						
23/09/2024 09:15			0.00	0.00	0.15	0.14	0.10	0.55						
23/09/2024 09:30			0.00	0.00	0.15	0.14	0.10	0.55						
23/09/2024 09:45			0.00	0.00	0.16	0.14	0.10	0.55						
23/09/2024 10:00			0.00	0.00	0.16	0.14	0.10	0.55						
23/09/2024 10:15			0.00	0.00	0.16	0.15	0.10	0.55						
23/09/2024 10:30			0.00	0.00	0.16	0.15	0.10	0.56						
23/09/2024 10:45			0.00	0.00	0.16	0.15	0.10	0.56						
23/09/2024 11:00			0.00	0.00	0.16	0.15	0.11	0.55						
23/09/2024 11:15			0.00	0.00	0.16	0.15	0.11	0.55						
23/09/2024 11:30			0.00	0.00	0.16	0.15	0.11	0.55						
23/09/2024 11:45			0.00	0.00	0.16	0.15	0.11	0.55						
23/09/2024 12:00			0.00	0.00	0.16	0.15	0.11	0.54						
23/09/2024 12:15			0.00	0.00	0.16	0.15	0.11	0.54						
23/09/2024 12:30			0.00	0.00	0.16	0.15	0.11	0.54						
23/09/2024 12:45			0.00	0.00	0.16	0.15	0.11	0.54						
23/09/2024 13:00			0.00	0.00	0.16	0.15	0.11	0.54						
23/09/2024 13:15			0.00	0.00	0.16	0.15	0.11	0.54						
23/09/2024 13:30			0.00	0.00	0.16	0.15	0.11	0.54						
23/09/2024 13:45			0.00	0.00	0.16	0.15	0.11	0.54						
23/09/2024 14:00			0.00	0.00	0.16	0.15	0.11	0.54						
23/09/2024 14:15			0.01	0.00	0.16	0.15	0.11	0.54						
23/09/2024 14:30			0.01	0.00	0.16	0.15	0.11	0.54						
23/09/2024 14:45			0.01	0.00	0.16	0.15	0.11	0.53						
23/09/2024 15:00			0.01	0.00	0.16	0.15	0.11	0.53						
23/09/2024 15:15			0.00	0.00	0.16	0.15	0.11	0.53						
23/09/2024 15:30			0.00	0.00	0.16	0.15	0.11	0.53						
23/09/2024 15:45			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 16:00			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 16:15			0.01	0.00	0.16	0.15	0.10	0.53						
23/09/2024 16:30			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 16:45			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 17:00			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 17:15			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 17:30			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 17:45			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 18:00			0.00	0.00	0.15	0.15	0.10	0.53						
23/09/2024 18:15			0.00	0.00	0.15	0.15	0.10	0.53						
23/09/2024 18:30			0.00	0.00	0.15	0.15	0.10	0.54						
23/09/2024 18:45			0.00	0.00	0.15	0.15	0.10	0.54						
23/09/2024 19:00			0.00	0.00	0.15	0.15	0.10	0.54						
23/09/2024 19:15			0.00	0.00	0.15	0.15	0.10	0.54						
23/09/2024 19:30			0.00	0.00	0.15	0.15	0.10	0.54						
23/09/2024 19:45			0.00	0.00	0.15	0.15	0.10	0.54						
23/09/2024 20:00			0.00	0.00	0.15	0.15	0.10	0.54						
23/09/2024 20:15			0.00	0.00	0.15	0.15	0.10	0.54						
23/09/2024 20:30			0.00	0.00	0.15	0.15	0.10	0.54						
23/09/2024 20:45			0.00	0.00	0.15	0.15	0.10	0.54						
23/09/2024 21:00			0.00	0.00	0.16	0.15	0.10	0.55						
23/09/2024 21:15			0.00	0.00	0.16	0.15	0.10	0.55						
23/09/2024 21:30			0.00	0.00	0.16	0.15	0.10	0.55						
23/09/2024 21:45			0.00	0.00	0.16	0.15	0.10	0.55						
23/09/2024 22:00			0.00	0.00	0.16	0.15	0.10	0.54						
23/09/2024 22:15			0.00	0.00	0.16	0.15	0.10	0.54						
23/09/2024 22:30			0.00	0.00	0.16	0.15	0.10	0.54						
23/09/2024 22:45			0.00	0.00	0.16	0.15	0.10	0.54						
23/09/2024 23:00			0.00	0.00	0.16	0.15	0.10	0.54						
23/09/2024 23:15			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 23:30			0.00	0.00	0.16	0.15	0.10	0.53						
23/09/2024 23:45			0.00	0.00	0.16	0.15	0.10	0.53						
24/09/2024 00:00			0.00	0.00	0.16	0.15	0.10	0.53						
24/09/2024 00:15			0.00	0.00	0.16	0.15	0.10	0.53						
24/09/2024 00:30			0.00	0.00	0.16	0.15	0.10	0.52						
24/09/2024 00:45			0.00	0.00	0.16	0.15	0.10	0.51						
24/09/2024 01:00			0.00	0.00	0.16	0.15	0.10	0.52						
24/09/2024 01:15			0.00	0.00	0.16	0.15	0.10	0.52						
24/09/2024 01:30			0.00	0.00	0.16	0.15	0.10	0.50						
24/09/2024 01:45			0.00	0.00	0.16	0.15	0.10	0.51						
24/09/2024 02:00			0.00	0.00	0.16	0.15	0.10	0.51						
24/09/2024 02:15			0.00	0.00	0.15	0.15	0.10	0.51						
24/09/2024 02:30			0.00	0.00	0.15	0.15	0.10	0.51						
24/09/2024 02:45			0.00	0.00	0.15	0.15	0.10	0.51						
24/09/2024 03:00			0.00	0.00	0.15	0.15	0.10	0.51						
24/09/2024 03:15			0.00	0.00	0.15	0.15	0.10	0.52						
24/09/2024 03:30			0.00	0.00	0.15	0.15	0.10	0.53						
24/09/2024 03:45			0.00	0.00	0.15	0.14	0.10	0.54						
24/09/2024 04:00			0.00	0.00	0.15	0.14	0.10	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
24/09/2024 04:15			0.00	0.00	0.15	0.14	0.10	0.55						
24/09/2024 04:30			0.00	0.00	0.15	0.14	0.10	0.55						
24/09/2024 04:45			0.00	0.00	0.15	0.14	0.10	0.55						
24/09/2024 05:00			0.00	0.00	0.15	0.15	0.10	0.55						
24/09/2024 05:15			0.00	0.00	0.15	0.15	0.10	0.55						
24/09/2024 05:30			0.00	0.00	0.16	0.15	0.10	0.54						
24/09/2024 05:45			0.00	0.00	0.16	0.15	0.10	0.54						
24/09/2024 06:00			0.00	0.00	0.16	0.15	0.10	0.53						
24/09/2024 06:15			0.00	0.00	0.16	0.15	0.10	0.53						
24/09/2024 06:30			0.00	0.00	0.16	0.15	0.10	0.53						
24/09/2024 06:45			0.00	0.00	0.16	0.15	0.10	0.53						
24/09/2024 07:00			0.01	0.00	0.16	0.15	0.11	0.53						
24/09/2024 07:15			0.00	0.00	0.16	0.15	0.11	0.53						
24/09/2024 07:30			0.00	0.00	0.16	0.15	0.10	0.54						
24/09/2024 07:45			0.01	0.00	0.16	0.15	0.10	0.55						
24/09/2024 08:00			0.01	0.00	0.16	0.15	0.10	0.56						
24/09/2024 08:15			0.01	0.00	0.16	0.15	0.10	0.57						
24/09/2024 08:30			0.01	0.00	0.16	0.15	0.11	0.57						
24/09/2024 08:45			0.01	0.00	0.16	0.15	0.11	0.56						
24/09/2024 09:00			0.01	0.00	0.16	0.15	0.11	0.56						
24/09/2024 09:15			0.01	0.00	0.16	0.15	0.11	0.56						
24/09/2024 09:30			0.01	0.00	0.16	0.15	0.11	0.56						
24/09/2024 09:45			0.01	0.00	0.16	0.16	0.11	0.56						
24/09/2024 10:00			0.01	0.00	0.17	0.16	0.11	0.56						
24/09/2024 10:15			0.01	0.00	0.17	0.16	0.11	0.56						
24/09/2024 10:30			0.01	0.00	0.17	0.16	0.11	0.56						
24/09/2024 10:45			0.01	0.00	0.17	0.16	0.11	0.56						
24/09/2024 11:00			0.01	0.00	0.17	0.16	0.11	0.56						
24/09/2024 11:15			0.01	0.00	0.17	0.16	0.12	0.56						
24/09/2024 11:30			0.01	0.00	0.17	0.16	0.12	0.55						
24/09/2024 11:45			0.01	0.00	0.17	0.16	0.12	0.55						
24/09/2024 12:00			0.01	0.00	0.17	0.16	0.12	0.55						
24/09/2024 12:15			0.01	0.00	0.17	0.16	0.12	0.55						
24/09/2024 12:30			0.01	0.00	0.17	0.16	0.12	0.54						
24/09/2024 12:45			0.01	0.00	0.17	0.16	0.12	0.54						
24/09/2024 13:00			0.01	0.00	0.17	0.16	0.12	0.54						
24/09/2024 13:15			0.01	0.00	0.17	0.16	0.12	0.54						
24/09/2024 13:30			0.01	0.00	0.17	0.16	0.12	0.54						
24/09/2024 13:45			0.01	0.00	0.17	0.16	0.11	0.54						
24/09/2024 14:00			0.01	0.00	0.17	0.16	0.11	0.54						
24/09/2024 14:15			0.01	0.00	0.17	0.16	0.11	0.54						
24/09/2024 14:30			0.01	0.00	0.17	0.16	0.11	0.54						
24/09/2024 14:45			0.01	0.00	0.17	0.16	0.11	0.54						
24/09/2024 15:00			0.01	0.00	0.17	0.16	0.11	0.54						
24/09/2024 15:15			0.01	0.00	0.17	0.16	0.11	0.53						
24/09/2024 15:30			0.01	0.00	0.16	0.16	0.11	0.53						
24/09/2024 15:45			0.01	0.00	0.16	0.16	0.11	0.53						
24/09/2024 16:00			0.01	0.00	0.16	0.16	0.11	0.53						
24/09/2024 16:15			0.01	0.00	0.16	0.15	0.11	0.53						
24/09/2024 16:30			0.01	0.00	0.16	0.15	0.11	0.53						
24/09/2024 16:45			0.01	0.00	0.16	0.15	0.11	0.53						
24/09/2024 17:00			0.01	0.00	0.16	0.15	0.11	0.53						
24/09/2024 17:15			0.01	0.00	0.16	0.15	0.11	0.53						
24/09/2024 17:30			0.01	0.00	0.16	0.15	0.11	0.53						
24/09/2024 17:45			0.01	0.00	0.16	0.15	0.11	0.53						
24/09/2024 18:00			0.01	0.00	0.16	0.15	0.11	0.53						
24/09/2024 18:15			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 18:30			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 18:45			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 19:00			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 19:15			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 19:30			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 19:45			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 20:00			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 20:15			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 20:30			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 20:45			0.00	0.00	0.16	0.15	0.11	0.54						
24/09/2024 21:00			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 21:15			0.01	0.00	0.16	0.15	0.11	0.55						
24/09/2024 21:30			0.01	0.00	0.16	0.15	0.11	0.55						
24/09/2024 21:45			0.00	0.00	0.16	0.15	0.11	0.55						
24/09/2024 22:00			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 22:15			0.00	0.00	0.16	0.15	0.11	0.54						
24/09/2024 22:30			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 22:45			0.00	0.00	0.16	0.15	0.11	0.54						
24/09/2024 23:00			0.01	0.00	0.16	0.15	0.11	0.54						
24/09/2024 23:15			0.01	0.00	0.16	0.15	0.11	0.53						
24/09/2024 23:30			0.01	0.00	0.16	0.17	0.11	0.53						
24/09/2024 23:45			0.01	0.00	0.16	0.17	0.11	0.53						
25/09/2024 00:00			0.01	0.00	0.16	0.17	0.11	0.53						
25/09/2024 00:15			0.01	0.00	0.16	0.17	0.11	0.53						
25/09/2024 00:30			0.01	0.00	0.16	0.17	0.11	0.52						
25/09/2024 00:45			0.01	0.00	0.16	0.17	0.11	0.52						
25/09/2024 01:00			0.01	0.00	0.16	0.17	0.11	0.52						
25/09/2024 01:15			0.01	0.00	0.16	0.17	0.11	0.52						
25/09/2024 01:30			0.01	0.00	0.16	0.17	0.11	0.52						
25/09/2024 01:45			0.01	0.00	0.16	0.17	0.11	0.52						
25/09/2024 02:00			0.01	0.00	0.16	0.17	0.11	0.51						
25/09/2024 02:15			0.00	0.00	0.16	0.17	0.10	0.51						
25/09/2024 02:30			0.00	0.00	0.16	0.17	0.10	0.51						
25/09/2024 02:45			0.00	0.00	0.16	0.17	0.10	0.51						
25/09/2024 03:00			0.00	0.00	0.16	0.17	0.10	0.51						
25/09/2024 03:15			0.00	0.00	0.16	0.17	0.10	0.51						
25/09/2024 03:30			0.00	0.00	0.16	0.17	0.10	0.51						
25/09/2024 03:45			0.00	0.00	0.15	0.16	0.10	0.51						
25/09/2024 04:00			0.00	0.00	0.15	0.16	0.10	0.51						
25/09/2024 04:15			0.00	0.00	0.15	0.16	0.10	0.51						
25/09/2024 04:30			0.00	0.00	0.15	0.16	0.10	0.50						
25/09/2024 04:45			0.00	0.00	0.15	0.16	0.10	0.50						
25/09/2024 05:00			0.00	0.00	0.15	0.16	0.10	0.50						
25/09/2024 05:15			0.00	0.00	0.15	0.16	0.10	0.50						
25/09/2024 05:30			0.00	0.00	0.15	0.16	0.10	0.50						
25/09/2024 05:45			0.00	0.00	0.15	0.16	0.10	0.50						
25/09/2024 06:00			0.00	0.00	0.15	0.16	0.10	0.50						
25/09/2024 06:15			0.00	0.00	0.15	0.16	0.10	0.50						
25/09/2024 06:30			0.00	0.00	0.15	0.16	0.09	0.50						
25/09/2024 06:45			0.00	0.00	0.15	0.16	0.09	0.50						
25/09/2024 07:00			0.00	0.00	0.15	0.16	0.09	0.51						
25/09/2024 07:15			0.00	0.00	0.15	0.16	0.09	0.51						
25/09/2024 07:30			0.00	0.00	0.15	0.16	0.09	0.51						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
25/09/2024 07:45			0.00	0.00	0.15	0.16	0.09	0.52						
25/09/2024 08:00			0.00	0.00	0.15	0.16	0.09	0.52						
25/09/2024 08:15			0.00	0.00	0.15	0.16	0.09	0.52						
25/09/2024 08:30			0.00	0.00	0.15	0.16	0.09	0.53						
25/09/2024 08:45			0.00	0.00	0.15	0.16	0.09	0.53						
25/09/2024 09:00			0.00	0.00	0.15	0.16	0.09	0.53						
25/09/2024 09:15			0.00	0.00	0.15	0.16	0.09	0.53						
25/09/2024 09:30			0.00	0.00	0.15	0.16	0.09	0.53						
25/09/2024 09:45			0.00	0.00	0.15	0.16	0.10	0.54						
25/09/2024 10:00			0.00	0.00	0.15	0.16	0.10	0.54						
25/09/2024 10:15			0.00	0.00	0.15	0.16	0.10	0.54						
25/09/2024 10:30			0.00	0.00	0.15	0.16	0.10	0.54						
25/09/2024 10:45			0.00	0.00	0.15	0.16	0.10	0.54						
25/09/2024 11:00			0.00	0.00	0.15	0.17	0.10	0.54						
25/09/2024 11:15			0.00	0.00	0.15	0.17	0.10	0.53						
25/09/2024 11:30			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 11:45			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 12:00			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 12:15			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 12:30			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 12:45			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 13:00			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 13:15			-0.01	0.00	0.16	0.16	0.10	0.53						
25/09/2024 13:30			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 13:45			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 14:00			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 14:15			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 14:30			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 14:45			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 15:00			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 15:15			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 15:30			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 15:45			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 16:00			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 16:15			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 16:30			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 16:45			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 17:00			0.00	0.00	0.16	0.16	0.10	0.53						
25/09/2024 17:15			0.00	0.00	0.16	0.16	0.10	0.54						
25/09/2024 17:30			0.00	0.00	0.16	0.16	0.10	0.54						
25/09/2024 17:45			0.00	0.00	0.16	0.16	0.10	0.54						
25/09/2024 18:00			0.00	0.00	0.16	0.16	0.10	0.54						
25/09/2024 18:15			0.00	0.00	0.16	0.16	0.10	0.54						
25/09/2024 18:30			0.00	0.00	0.16	0.17	0.10	0.54						
25/09/2024 18:45			0.00	0.00	0.16	0.17	0.10	0.54						
25/09/2024 19:00			0.00	0.00	0.16	0.17	0.10	0.54						
25/09/2024 19:15			0.00	0.00	0.16	0.17	0.10	0.55						
25/09/2024 19:30			0.00	0.00	0.16	0.17	0.10	0.55						
25/09/2024 19:45			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 20:00			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 20:15			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 20:30			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 20:45			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 21:00			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 21:15			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 21:30			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 21:45			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 22:00			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 22:15			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 22:30			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 22:45			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 23:00			0.00	0.00	0.16	0.16	0.11	0.55						
25/09/2024 23:15			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 23:30			0.00	0.00	0.16	0.17	0.11	0.55						
25/09/2024 23:45			0.00	0.00	0.17	0.17	0.11	0.56						
26/09/2024 00:00			0.00	0.00	0.17	0.18	0.11	0.59						
26/09/2024 00:15			0.01	0.00	0.17	0.18	0.11	0.65						
26/09/2024 00:30			0.01	0.00	0.17	0.18	0.12	0.69						
26/09/2024 00:45			0.01	0.00	0.17	0.18	0.12	0.67						
26/09/2024 01:00			0.01	0.00	0.18	0.18	0.13	0.65						
26/09/2024 01:15			0.01	0.00	0.19	0.19	0.14	0.64						
26/09/2024 01:30			0.01	0.00	0.20	0.20	0.15	0.63						
26/09/2024 01:45			0.02	0.00	0.20	0.20	0.15	0.62						
26/09/2024 02:00			0.02	0.01	0.21	0.21	0.16	0.62						
26/09/2024 02:15			0.03	0.01	0.21	0.21	0.16	0.61						
26/09/2024 02:30			0.03	0.01	0.21	0.21	0.16	0.61						
26/09/2024 02:45			0.03	0.01	0.21	0.21	0.16	0.60						
26/09/2024 03:00			0.03	0.01	0.21	0.21	0.16	0.60						
26/09/2024 03:15			0.04	0.01	0.21	0.21	0.16	0.59						
26/09/2024 03:30			0.04	0.01	0.21	0.21	0.16	0.59						
26/09/2024 03:45			0.04	0.01	0.21	0.21	0.16	0.59						
26/09/2024 04:00			0.04	0.01	0.21	0.21	0.16	0.59						
26/09/2024 04:15			0.04	0.01	0.21	0.21	0.16	0.59						
26/09/2024 04:30			0.04	0.01	0.21	0.21	0.16	0.59						
26/09/2024 04:45			0.04	0.01	0.21	0.21	0.15	0.58						
26/09/2024 05:00			0.04	0.01	0.20	0.21	0.15	0.58						
26/09/2024 05:15			0.03	0.01	0.20	0.21	0.15	0.57						
26/09/2024 05:30			0.03	0.01	0.20	0.20	0.15	0.57						
26/09/2024 05:45			0.03	0.01	0.20	0.20	0.15	0.57						
26/09/2024 06:00			0.03	0.01	0.20	0.20	0.15	0.57						
26/09/2024 06:15			0.03	0.01	0.20	0.20	0.15	0.57						
26/09/2024 06:30			0.03	0.01	0.20	0.20	0.15	0.58						
26/09/2024 06:45			0.03	0.01	0.20	0.20	0.15	0.59						
26/09/2024 07:00			0.03	0.01	0.20	0.20	0.15	0.60						
26/09/2024 07:15			0.03	0.01	0.20	0.20	0.14	0.61						
26/09/2024 07:30			0.03	0.01	0.20	0.20	0.14	0.61						
26/09/2024 07:45			0.03	0.01	0.20	0.20	0.15	0.61						
26/09/2024 08:00			0.03	0.01	0.20	0.20	0.15	0.61						
26/09/2024 08:15			0.03	0.01	0.20	0.20	0.15	0.61						
26/09/2024 08:30			0.03	0.01	0.20	0.20	0.15	0.60						
26/09/2024 08:45			0.03	0.01	0.20	0.21	0.15	0.60						
26/09/2024 09:00			0.03	0.01	0.20	0.21	0.15	0.60						
26/09/2024 09:15			0.03	0.01	0.20	0.21	0.15	0.60						
26/09/2024 09:30			0.03	0.01	0.20	0.21	0.15	0.60						
26/09/2024 09:45			0.04	0.01	0.20	0.21	0.15	0.60						
26/09/2024 10:00			0.03	0.01	0.20	0.21	0.15	0.60						
26/09/2024 10:15			0.03	0.01	0.21	0.21	0.15	0.60						
26/09/2024 10:30			0.04	0.01	0.21	0.21	0.15	0.60						
26/09/2024 10:45			0.03	0.01	0.21	0.21	0.15	0.60						
26/09/2024 11:00			0.03	0.01	0.21	0.21	0.16	0.60						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
26/09/2024 11:15			0.03	0.01	0.21	0.21	0.16	0.60						
26/09/2024 11:30			0.04	0.01	0.21	0.21	0.16	0.59						
26/09/2024 11:45			0.04	0.01	0.21	0.21	0.16	0.59						
26/09/2024 12:00			0.03	0.01	0.21	0.21	0.16	0.59						
26/09/2024 12:15			0.03	0.01	0.21	0.21	0.16	0.59						
26/09/2024 12:30			0.03	0.01	0.21	0.21	0.15	0.59						
26/09/2024 12:45			0.03	0.01	0.21	0.21	0.15	0.59						
26/09/2024 13:00			0.03	0.01	0.20	0.21	0.15	0.59						
26/09/2024 13:15			0.03	0.01	0.20	0.21	0.15	0.59						
26/09/2024 13:30			0.03	0.01	0.20	0.21	0.15	0.59						
26/09/2024 13:45			0.03	0.01	0.20	0.21	0.15	0.58						
26/09/2024 14:00			0.03	0.01	0.20	0.21	0.15	0.58						
26/09/2024 14:15			0.03	0.01	0.20	0.21	0.15	0.58						
26/09/2024 14:30			0.03	0.01	0.20	0.21	0.15	0.57						
26/09/2024 14:45			0.03	0.01	0.20	0.20	0.15	0.57						
26/09/2024 15:00			0.03	0.01	0.20	0.21	0.15	0.57						
26/09/2024 15:15			0.03	0.01	0.20	0.20	0.15	0.57						
26/09/2024 15:30			0.03	0.01	0.20	0.20	0.14	0.57						
26/09/2024 15:45			0.02	0.01	0.20	0.20	0.14	0.57						
26/09/2024 16:00			0.03	0.01	0.19	0.20	0.14	0.57						
26/09/2024 16:15			0.02	0.01	0.19	0.19	0.14	0.57						
26/09/2024 16:30			0.02	0.01	0.19	0.20	0.14	0.57						
26/09/2024 16:45			0.02	0.01	0.19	0.20	0.14	0.57						
26/09/2024 17:00			0.02	0.01	0.19	0.20	0.14	0.57						
26/09/2024 17:15			0.02	0.01	0.19	0.20	0.14	0.57						
26/09/2024 17:30			0.02	0.01	0.19	0.20	0.14	0.57						
26/09/2024 17:45			0.03	0.01	0.19	0.20	0.14	0.57						
26/09/2024 18:00			0.03	0.01	0.19	0.19	0.14	0.57						
26/09/2024 18:15			0.03	0.01	0.19	0.20	0.13	0.57						
26/09/2024 18:30			0.03	0.01	0.19	0.20	0.14	0.57						
26/09/2024 18:45			0.03	0.01	0.19	0.20	0.14	0.58						
26/09/2024 19:00			0.03	0.01	0.19	0.20	0.14	0.64						
26/09/2024 19:15			0.03	0.01	0.19	0.20	0.14	0.65						
26/09/2024 19:30			0.03	0.01	0.19	0.20	0.14	0.65						
26/09/2024 19:45			0.03	0.01	0.19	0.20	0.14	0.64						
26/09/2024 20:00			0.03	0.01	0.20	0.20	0.15	0.63						
26/09/2024 20:15			0.04	0.01	0.20	0.20	0.15	0.62						
26/09/2024 20:30			0.04	0.01	0.21	0.21	0.16	0.62						
26/09/2024 20:45			0.04	0.02	0.21	0.21	0.16	0.61						
26/09/2024 21:00			0.04	0.02	0.21	0.21	0.16	0.61						
26/09/2024 21:15			0.04	0.02	0.21	0.21	0.16	0.60						
26/09/2024 21:30			0.04	0.02	0.21	0.21	0.16	0.60						
26/09/2024 21:45			0.05	0.02	0.21	0.21	0.16	0.60						
26/09/2024 22:00			0.05	0.02	0.21	0.21	0.16	0.60						
26/09/2024 22:15			0.05	0.02	0.21	0.21	0.16	0.60						
26/09/2024 22:30			0.04	0.02	0.21	0.21	0.16	0.60						
26/09/2024 22:45			0.04	0.02	0.21	0.21	0.16	0.60						
26/09/2024 23:00			0.04	0.02	0.21	0.21	0.16	0.59						
26/09/2024 23:15			0.04	0.02	0.21	0.21	0.16	0.59						
26/09/2024 23:30			0.04	0.02	0.21	0.21	0.16	0.59						
26/09/2024 23:45			0.04	0.02	0.21	0.21	0.16	0.59						
27/09/2024 00:00			0.04	0.02	0.21	0.21	0.16	0.59						
27/09/2024 00:15			0.04	0.02	0.21	0.21	0.16	0.59						
27/09/2024 00:30			0.04	0.02	0.21	0.21	0.16	0.60						
27/09/2024 00:45			0.04	0.02	0.21	0.21	0.16	0.60						
27/09/2024 01:00			0.04	0.02	0.21	0.21	0.16	0.60						
27/09/2024 01:15			0.04	0.02	0.21	0.21	0.16	0.59						
27/09/2024 01:30			0.04	0.02	0.21	0.21	0.16	0.59						
27/09/2024 01:45			0.04	0.02	0.21	0.21	0.16	0.59						
27/09/2024 02:00			0.04	0.02	0.21	0.21	0.16	0.59						
27/09/2024 02:15			0.04	0.02	0.21	0.21	0.16	0.59						
27/09/2024 02:30			0.04	0.02	0.21	0.21	0.16	0.58						
27/09/2024 02:45			0.04	0.02	0.21	0.21	0.16	0.58						
27/09/2024 03:00			0.04	0.02	0.21	0.21	0.16	0.58						
27/09/2024 03:15			0.04	0.02	0.21	0.21	0.16	0.58						
27/09/2024 03:30			0.04	0.02	0.21	0.21	0.16	0.58						
27/09/2024 03:45			0.04	0.02	0.21	0.21	0.16	0.58						
27/09/2024 04:00			0.04	0.02	0.21	0.21	0.15	0.58						
27/09/2024 04:15			0.04	0.02	0.21	0.21	0.15	0.58						
27/09/2024 04:30			0.04	0.01	0.21	0.21	0.15	0.58						
27/09/2024 04:45			0.04	0.01	0.20	0.21	0.15	0.58						
27/09/2024 05:00			0.04	0.01	0.20	0.21	0.15	0.58						
27/09/2024 05:15			0.04	0.01	0.20	0.21	0.15	0.58						
27/09/2024 05:30			0.04	0.01	0.20	0.21	0.15	0.58						
27/09/2024 05:45			0.04	0.01	0.20	0.20	0.15	0.58						
27/09/2024 06:00			0.04	0.01	0.20	0.20	0.15	0.58						
27/09/2024 06:15			0.04	0.01	0.20	0.20	0.15	0.57						
27/09/2024 06:30			0.04	0.01	0.20	0.20	0.15	0.57						
27/09/2024 06:45			0.04	0.01	0.20	0.20	0.15	0.57						
27/09/2024 07:00			0.04	0.01	0.20	0.20	0.15	0.57						
27/09/2024 07:15			0.04	0.02	0.20	0.20	0.15	0.58						
27/09/2024 07:30			0.04	0.01	0.20	0.20	0.15	0.58						
27/09/2024 07:45			0.04	0.01	0.20	0.20	0.15	0.58						
27/09/2024 08:00			0.04	0.01	0.20	0.20	0.15	0.58						
27/09/2024 08:15			0.04	0.02	0.20	0.20	0.15	0.58						
27/09/2024 08:30			0.04	0.02	0.20	0.20	0.15	0.58						
27/09/2024 08:45			0.04	0.02	0.20	0.20	0.15	0.58						
27/09/2024 09:00			0.04	0.02	0.20	0.20	0.15	0.58						
27/09/2024 09:15			0.04	0.02	0.20	0.20	0.15	0.59						
27/09/2024 09:30			0.04	0.02	0.20	0.20	0.15	0.59						
27/09/2024 09:45			0.04	0.02	0.20	0.20	0.15	0.59						
27/09/2024 10:00			0.04	0.02	0.20	0.20	0.15	0.59						
27/09/2024 10:15			0.04	0.02	0.20	0.20	0.15	0.58						
27/09/2024 10:30			0.04	0.02	0.20	0.20	0.15	0.58						
27/09/2024 10:45			0.04	0.02	0.20	0.20	0.15	0.58						
27/09/2024 11:00			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 11:15			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 11:30			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 11:45			0.05	0.02	0.20	0.20	0.15	0.57						
27/09/2024 12:00			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 12:15			0.04	0.02	0.20	0.20	0.15	0.58						
27/09/2024 12:30			0.04	0.02	0.20	0.20	0.15	0.58						
27/09/2024 12:45			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 13:00			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 13:15			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 13:30			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 13:45			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 14:00			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 14:15			0.04	0.02	0.20	0.20	0.15	0.57						
27/09/2024 14:30			0.04	0.02	0.20	0.20	0.15	0.56						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
27/09/2024 14:45			0.04	0.02	0.20	0.20	0.15	0.56						
27/09/2024 15:00			0.04	0.02	0.20	0.20	0.15	0.56						
27/09/2024 15:15			0.05	0.02	0.20	0.20	0.15	0.56						
27/09/2024 15:30			0.04	0.02	0.20	0.20	0.15	0.56						
27/09/2024 15:45			0.04	0.02	0.20	0.20	0.15	0.56						
27/09/2024 16:00			0.04	0.02	0.20	0.20	0.15	0.56						
27/09/2024 16:15			0.04	0.02	0.20	0.20	0.15	0.56						
27/09/2024 16:30			0.04	0.02	0.20	0.20	0.14	0.56						
27/09/2024 16:45			0.04	0.02	0.20	0.20	0.14	0.56						
27/09/2024 17:00			0.04	0.02	0.20	0.20	0.14	0.56						
27/09/2024 17:15			0.04	0.02	0.20	0.19	0.14	0.56						
27/09/2024 17:30			0.04	0.01	0.19	0.19	0.14	0.56						
27/09/2024 17:45			0.04	0.02	0.19	0.19	0.14	0.56						
27/09/2024 18:00			0.04	0.02	0.19	0.19	0.14	0.56						
27/09/2024 18:15			0.04	0.01	0.19	0.19	0.14	0.56						
27/09/2024 18:30			0.04	0.01	0.19	0.19	0.14	0.55						
27/09/2024 18:45			0.04	0.01	0.19	0.19	0.14	0.55						
27/09/2024 19:00			0.04	0.01	0.19	0.19	0.14	0.55						
27/09/2024 19:15			0.04	0.01	0.19	0.19	0.14	0.56						
27/09/2024 19:30			0.04	0.01	0.19	0.19	0.14	0.56						
27/09/2024 19:45			0.04	0.01	0.19	0.19	0.14	0.56						
27/09/2024 20:00			0.04	0.01	0.19	0.19	0.14	0.56						
27/09/2024 20:15			0.04	0.01	0.19	0.19	0.14	0.56						
27/09/2024 20:30			0.04	0.01	0.19	0.19	0.14	0.55						
27/09/2024 20:45			0.04	0.01	0.19	0.19	0.14	0.55						
27/09/2024 21:00			0.04	0.01	0.19	0.19	0.14	0.55						
27/09/2024 21:15			0.04	0.01	0.19	0.19	0.14	0.55						
27/09/2024 21:30			0.03	0.01	0.19	0.19	0.14	0.55						
27/09/2024 21:45			0.03	0.01	0.19	0.19	0.14	0.55						
27/09/2024 22:00			0.03	0.01	0.19	0.19	0.14	0.55						
27/09/2024 22:15			0.03	0.01	0.19	0.19	0.14	0.55						
27/09/2024 22:30			0.03	0.01	0.19	0.19	0.14	0.55						
27/09/2024 22:45			0.03	0.01	0.19	0.19	0.14	0.55						
27/09/2024 23:00			0.03	0.01	0.19	0.19	0.14	0.54						
27/09/2024 23:15			0.03	0.01	0.19	0.19	0.14	0.54						
27/09/2024 23:30			0.03	0.01	0.19	0.19	0.14	0.54						
27/09/2024 23:45			0.03	0.01	0.19	0.19	0.14	0.54						
28/09/2024 00:00			0.03	0.01	0.19	0.19	0.14	0.53						
28/09/2024 00:15			0.03	0.01	0.19	0.19	0.13	0.53						
28/09/2024 00:30			0.03	0.01	0.19	0.19	0.13	0.53						
28/09/2024 00:45			0.03	0.01	0.19	0.19	0.13	0.53						
28/09/2024 01:00			0.03	0.01	0.19	0.19	0.13	0.53						
28/09/2024 01:15			0.03	0.01	0.19	0.19	0.13	0.53						
28/09/2024 01:30			0.03	0.01	0.18	0.18	0.13	0.52						
28/09/2024 01:45			0.03	0.01	0.18	0.18	0.13	0.52						
28/09/2024 02:00			0.03	0.01	0.18	0.18	0.13	0.52						
28/09/2024 02:15			0.03	0.01	0.18	0.18	0.13	0.52						
28/09/2024 02:30			0.03	0.01	0.18	0.18	0.13	0.52						
28/09/2024 02:45			0.03	0.01	0.18	0.18	0.13	0.52						
28/09/2024 03:00			0.03	0.01	0.18	0.18	0.12	0.51						
28/09/2024 03:15			0.03	0.01	0.18	0.18	0.12	0.51						
28/09/2024 03:30			0.02	0.01	0.18	0.18	0.12	0.51						
28/09/2024 03:45			0.02	0.01	0.18	0.18	0.12	0.51						
28/09/2024 04:00			0.02	0.01	0.18	0.18	0.12	0.51						
28/09/2024 04:15			0.02	0.01	0.17	0.18	0.12	0.51						
28/09/2024 04:30			0.02	0.01	0.17	0.18	0.12	0.51						
28/09/2024 04:45			0.02	0.01	0.17	0.18	0.12	0.51						
28/09/2024 05:00			0.02	0.01	0.17	0.17	0.12	0.51						
28/09/2024 05:15			0.02	0.01	0.17	0.17	0.12	0.51						
28/09/2024 05:30			0.02	0.01	0.17	0.17	0.12	0.51						
28/09/2024 05:45			0.02	0.01	0.17	0.17	0.12	0.51						
28/09/2024 06:00			0.02	0.01	0.17	0.17	0.11	0.51						
28/09/2024 06:15			0.02	0.01	0.17	0.17	0.11	0.51						
28/09/2024 06:30			0.02	0.00	0.17	0.17	0.11	0.51						
28/09/2024 06:45			0.02	0.00	0.17	0.17	0.11	0.51						
28/09/2024 07:00			0.02	0.00	0.17	0.17	0.11	0.51						
28/09/2024 07:15			0.02	0.00	0.17	0.17	0.11	0.51						
28/09/2024 07:30			0.02	0.00	0.17	0.17	0.11	0.51						
28/09/2024 07:45			0.02	0.00	0.17	0.17	0.11	0.51						
28/09/2024 08:00			0.01	0.00	0.17	0.17	0.11	0.51						
28/09/2024 08:15			0.01	0.00	0.17	0.17	0.11	0.51						
28/09/2024 08:30			0.02	0.00	0.17	0.17	0.11	0.51						
28/09/2024 08:45			0.01	0.00	0.17	0.17	0.11	0.52						
28/09/2024 09:00			0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 09:15			0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 09:30			0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 09:45			0.01	0.00	0.16	0.17	0.11	0.53						
28/09/2024 10:00			0.01	0.00	0.17	0.17	0.11	0.53						
28/09/2024 10:15			0.01	0.00	0.17	0.17	0.11	0.53						
28/09/2024 10:30			0.01	0.00	0.17	0.17	0.11	0.53						
28/09/2024 10:45			0.01	0.00	0.17	0.17	0.11	0.53						
28/09/2024 11:00			0.01	0.00	0.17	0.17	0.11	0.53						
28/09/2024 11:15			0.01	0.00	0.17	0.17	0.11	0.53						
28/09/2024 11:30			0.01	0.00	0.17	0.17	0.11	0.53						
28/09/2024 11:45			0.01	0.00	0.17	0.17	0.11	0.53						
28/09/2024 12:00			0.01	0.00	0.17	0.17	0.11	0.53						
28/09/2024 12:15			0.01	0.00	0.17	0.17	0.12	0.53						
28/09/2024 12:30			0.01	0.00	0.17	0.17	0.12	0.53						
28/09/2024 12:45			0.01	0.00	0.17	0.17	0.12	0.53						
28/09/2024 13:00			0.02	0.00	0.17	0.17	0.12	0.53						
28/09/2024 13:15			0.02	0.00	0.17	0.17	0.12	0.53						
28/09/2024 13:30			0.02	0.00	0.17	0.17	0.12	0.53						
28/09/2024 13:45			0.02	0.00	0.17	0.17	0.12	0.52						
28/09/2024 14:00			0.01	0.00	0.17	0.17	0.12	0.52						
28/09/2024 14:15			0.01	0.00	0.17	0.17	0.12	0.52						
28/09/2024 14:30			0.02	0.00	0.17	0.17	0.12	0.52						
28/09/2024 14:45			0.01	0.00	0.17	0.17	0.12	0.52						
28/09/2024 15:00			0.01	0.00	0.17	0.17	0.12	0.52						
28/09/2024 15:15	0.72		0.02	0.00	0.17	0.17	0.12	0.52						
28/09/2024 15:30	0.71		0.01	0.00	0.17	0.17	0.12	0.52						
28/09/2024 15:45	0.71		0.01	0.00	0.17	0.17	0.11	0.52						
28/09/2024 16:00	0.71		0.02	0.00	0.17	0.17	0.11	0.53						
28/09/2024 16:15	0.71		0.02	0.00	0.17	0.17	0.11	0.52						
28/09/2024 16:30	0.70		0.02	0.00	0.17	0.17	0.11	0.52						
28/09/2024 16:45	0.70		0.02	0.00	0.17	0.17	0.11	0.52						
28/09/2024 17:00	0.70		0.02	0.00	0.17	0.17	0.11	0.52						
28/09/2024 17:15	0.70		0.02	0.00	0.17	0.17	0.11	0.52						
28/09/2024 17:30	0.70		0.02	0.00	0.17	0.17	0.11	0.52						
28/09/2024 17:45	0.70		0.02	0.00	0.17	0.17	0.11	0.52						
28/09/2024 18:00	0.70		0.02	0.00	0.17	0.17	0.11	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
28/09/2024 18:15	0.70		0.02	0.00	0.17	0.17	0.11	0.52						
28/09/2024 18:30	0.70		0.02	0.00	0.17	0.17	0.11	0.52						
28/09/2024 18:45	0.69		0.01	0.00	0.17	0.17	0.11	0.52						
28/09/2024 19:00	0.69		0.01	0.00	0.17	0.17	0.11	0.52						
28/09/2024 19:15	0.70		0.01	0.00	0.17	0.17	0.11	0.52						
28/09/2024 19:30	0.70		0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 19:45	0.70		0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 20:00	0.70		0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 20:15	0.70		0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 20:30	0.70		0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 20:45	0.70		0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 21:00	0.70		0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 21:15			0.01	0.00	0.16	0.17	0.11	0.52						
28/09/2024 21:30			0.01	0.00	0.16	0.17	0.11	0.51						
28/09/2024 21:45			0.01	0.00	0.16	0.17	0.11	0.51						
28/09/2024 22:00	0.70		0.01	0.00	0.16	0.17	0.11	0.51						
28/09/2024 22:15			0.01	0.00	0.16	0.17	0.11	0.51						
28/09/2024 22:30			0.01	0.00	0.16	0.17	0.11	0.51						
28/09/2024 22:45			0.01	0.00	0.16	0.16	0.11	0.51						
28/09/2024 23:00			0.01	0.00	0.16	0.16	0.11	0.51						
28/09/2024 23:15			0.01	0.00	0.16	0.16	0.11	0.51						
28/09/2024 23:30			0.01	0.00	0.16	0.16	0.11	0.51						
28/09/2024 23:45			0.01	0.00	0.16	0.16	0.11	0.51						
29/09/2024 00:00			0.01	0.00	0.16	0.16	0.11	0.51						
29/09/2024 00:15			0.01	0.00	0.16	0.16	0.11	0.50						
29/09/2024 00:30			0.01	0.00	0.16	0.16	0.11	0.50						
29/09/2024 00:45			0.01	0.00	0.16	0.16	0.11	0.50						
29/09/2024 01:00			0.01	0.00	0.16	0.16	0.11	0.50						
29/09/2024 01:15			0.01	0.00	0.16	0.16	0.11	0.50						
29/09/2024 01:30			0.01	0.00	0.16	0.16	0.11	0.50						
29/09/2024 01:45			0.01	0.00	0.16	0.16	0.11	0.50						
29/09/2024 02:00			0.01	0.00	0.16	0.16	0.11	0.50						
29/09/2024 02:15			0.01	0.00	0.16	0.16	0.10	0.49						
29/09/2024 02:30			0.01	0.00	0.16	0.16	0.10	0.49						
29/09/2024 02:45			0.01	0.00	0.16	0.16	0.10	0.49						
29/09/2024 03:00			0.01	0.00	0.16	0.16	0.10	0.49						
29/09/2024 03:15			0.01	0.00	0.16	0.16	0.10	0.49						
29/09/2024 03:30			0.01	0.00	0.16	0.16	0.10	0.49						
29/09/2024 03:45			0.01	0.00	0.16	0.16	0.10	0.49						
29/09/2024 04:00			0.01	0.00	0.15	0.16	0.10	0.49						
29/09/2024 04:15			0.01	0.00	0.15	0.16	0.10	0.49						
29/09/2024 04:30			0.01	0.00	0.15	0.16	0.10	0.50						
29/09/2024 04:45			0.01	0.00	0.15	0.16	0.10	0.50						
29/09/2024 05:00			0.01	0.00	0.15	0.16	0.10	0.50						
29/09/2024 05:15			0.00	0.00	0.15	0.16	0.10	0.49						
29/09/2024 05:30			0.00	0.00	0.15	0.16	0.10	0.49						
29/09/2024 05:45			0.01	0.00	0.15	0.16	0.10	0.49						
29/09/2024 06:00			0.01	0.00	0.15	0.16	0.10	0.49						
29/09/2024 06:15			0.01	0.00	0.15	0.15	0.10	0.49						
29/09/2024 06:30			0.00	0.00	0.15	0.15	0.10	0.49						
29/09/2024 06:45			0.00	0.00	0.15	0.15	0.10	0.49						
29/09/2024 07:00			0.00	0.00	0.15	0.15	0.10	0.49						
29/09/2024 07:15			0.00	0.00	0.15	0.15	0.10	0.49						
29/09/2024 07:30			0.00	0.00	0.15	0.15	0.10	0.49						
29/09/2024 07:45			0.00	0.00	0.15	0.15	0.10	0.49						
29/09/2024 08:00			0.00	0.00	0.15	0.15	0.10	0.49						
29/09/2024 08:15			0.00	0.00	0.15	0.15	0.10	0.49						
29/09/2024 08:30			0.00	0.00	0.15	0.15	0.10	0.49						
29/09/2024 08:45			0.00	0.00	0.15	0.15	0.10	0.50						
29/09/2024 09:00			0.00	0.00	0.15	0.15	0.10	0.50						
29/09/2024 09:15			0.00	0.00	0.15	0.15	0.10	0.50						
29/09/2024 09:30			0.00	0.00	0.15	0.15	0.10	0.50						
29/09/2024 09:45			0.00	0.00	0.15	0.15	0.10	0.51						
29/09/2024 10:00			0.00	0.00	0.15	0.15	0.10	0.51						
29/09/2024 10:15			0.00	0.00	0.15	0.15	0.10	0.51						
29/09/2024 10:30			0.00	0.00	0.15	0.15	0.10	0.52						
29/09/2024 10:45			0.00	0.00	0.15	0.15	0.10	0.52						
29/09/2024 11:00			0.00	0.00	0.15	0.15	0.10	0.52						
29/09/2024 11:15			0.00	0.00	0.15	0.16	0.10	0.52						
29/09/2024 11:30			0.00	0.00	0.15	0.16	0.10	0.52						
29/09/2024 11:45			0.00	0.00	0.16	0.16	0.10	0.52						
29/09/2024 12:00			0.00	0.00	0.16	0.16	0.10	0.52						
29/09/2024 12:15			0.00	0.00	0.16	0.16	0.10	0.52						
29/09/2024 12:30			0.00	0.00	0.16	0.16	0.10	0.52						
29/09/2024 12:45			0.00	0.00	0.16	0.16	0.10	0.52						
29/09/2024 13:00			0.00	0.00	0.16	0.16	0.10	0.52						
29/09/2024 13:15			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 13:30			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 13:45			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 14:00			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 14:15			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 14:30			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 14:45			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 15:00			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 15:15			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 15:30			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 15:45			0.00	0.00	0.16	0.16	0.11	0.53						
29/09/2024 16:00			0.00	0.00	0.16	0.16	0.11	0.53						
29/09/2024 16:15			0.01	0.00	0.16	0.16	0.11	0.53						
29/09/2024 16:30			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 16:45			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 17:00			0.00	0.00	0.16	0.16	0.11	0.52						
29/09/2024 17:15			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 17:30			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 17:45			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 18:00			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 18:15			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 18:30			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 18:45			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 19:00			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 19:15			0.01	0.00	0.16	0.16	0.11	0.53						
29/09/2024 19:30			0.01	0.00	0.16	0.16	0.11	0.53						
29/09/2024 19:45			0.01	0.00	0.16	0.16	0.11	0.53						
29/09/2024 20:00			0.01	0.00	0.16	0.16	0.11	0.53						
29/09/2024 20:15			0.01	0.00	0.16	0.16	0.11	0.53						
29/09/2024 20:30			0.00	0.00	0.16	0.16	0.11	0.53						
29/09/2024 20:45			0.00	0.00	0.16	0.16	0.11	0.53						
29/09/2024 21:00			0.01	0.00	0.16	0.16	0.11	0.53						
29/09/2024 21:15			0.01	0.00	0.16	0.16	0.11	0.53						
29/09/2024 21:30			0.01	0.00	0.16	0.16	0.11	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
29/09/2024 21:45			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 22:00			0.01	0.00	0.16	0.17	0.11	0.52						
29/09/2024 22:15			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 22:30			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 22:45			0.01	0.00	0.16	0.17	0.11	0.52						
29/09/2024 23:00			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 23:15			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 23:30			0.01	0.00	0.16	0.16	0.11	0.52						
29/09/2024 23:45			0.01	0.00	0.16	0.16	0.11	0.52						
30/09/2024 00:00			0.01	0.00	0.16	0.17	0.11	0.52						
30/09/2024 00:15			0.01	0.00	0.16	0.16	0.11	0.51						
30/09/2024 00:30			0.01	0.00	0.16	0.16	0.11	0.51						
30/09/2024 00:45			0.01	0.00	0.16	0.16	0.11	0.51						
30/09/2024 01:00			0.01	0.00	0.16	0.16	0.11	0.51						
30/09/2024 01:15			0.01	0.00	0.16	0.16	0.11	0.51						
30/09/2024 01:30			0.01	0.00	0.16	0.16	0.11	0.51						
30/09/2024 01:45			0.01	0.00	0.16	0.16	0.11	0.51						
30/09/2024 02:00			0.01	0.00	0.16	0.16	0.11	0.50						
30/09/2024 02:15			0.01	0.00	0.16	0.16	0.11	0.50						
30/09/2024 02:30			0.00	0.00	0.16	0.16	0.11	0.51						
30/09/2024 02:45			0.00	0.00	0.16	0.16	0.10	0.51						
30/09/2024 03:00			0.01	0.00	0.16	0.16	0.10	0.51						
30/09/2024 03:15			0.01	0.00	0.16	0.16	0.10	0.51						
30/09/2024 03:30			0.00	0.00	0.16	0.16	0.10	0.51						
30/09/2024 03:45			0.00	0.00	0.16	0.16	0.10	0.51						
30/09/2024 04:00			0.00	0.00	0.16	0.16	0.10	0.50						
30/09/2024 04:15			0.00	0.00	0.16	0.16	0.10	0.50						
30/09/2024 04:30			0.00	0.00	0.16	0.16	0.10	0.50						
30/09/2024 04:45			0.00	0.00	0.16	0.16	0.10	0.50						
30/09/2024 05:00			0.00	0.00	0.15	0.16	0.10	0.50						
30/09/2024 05:15			0.00	0.00	0.15	0.16	0.10	0.50						
30/09/2024 05:30			0.00	0.00	0.15	0.16	0.10	0.50						
30/09/2024 05:45			0.00	0.00	0.15	0.16	0.10	0.50						
30/09/2024 06:00			0.00	0.00	0.15	0.16	0.10	0.50						
30/09/2024 06:15			0.00	0.00	0.15	0.16	0.10	0.50						
30/09/2024 06:30			0.00	0.00	0.15	0.16	0.10	0.50						
30/09/2024 06:45			0.00	0.00	0.15	0.16	0.10	0.50						
30/09/2024 07:00			0.00	0.00	0.15	0.16	0.10	0.51						
30/09/2024 07:15			0.00	0.00	0.15	0.16	0.10	0.51						
30/09/2024 07:30			0.00	0.00	0.15	0.16	0.10	0.51						
30/09/2024 07:45			0.00	0.00	0.15	0.16	0.10	0.53						
30/09/2024 08:00			0.00	0.00	0.15	0.16	0.10	0.55						
30/09/2024 08:15			0.00	0.00	0.15	0.16	0.10	0.56						
30/09/2024 08:30			0.00	0.00	0.16	0.16	0.10	0.56						
30/09/2024 08:45			0.00	0.00	0.16	0.16	0.10	0.60						
30/09/2024 09:00			0.00	0.00	0.16	0.16	0.11	0.62						
30/09/2024 09:15			0.00	0.00	0.16	0.17	0.11	0.62						
30/09/2024 09:30			0.00	0.00	0.17	0.17	0.11	0.61						
30/09/2024 09:45			0.01	0.00	0.17	0.17	0.12	0.61						
30/09/2024 10:00			0.01	0.00	0.18	0.18	0.12	0.61						
30/09/2024 10:15			0.01	0.00	0.18	0.18	0.13	0.61						
30/09/2024 10:30			0.02	0.00	0.19	0.19	0.14	0.61						
30/09/2024 10:45			0.02	0.00	0.19	0.19	0.14	0.60						
30/09/2024 11:00			0.02	0.01	0.20	0.19	0.14	0.60						
30/09/2024 11:15			0.02	0.01	0.20	0.20	0.15	0.61						
30/09/2024 11:30			0.03	0.01	0.20	0.20	0.15	0.61						
30/09/2024 11:45			0.03	0.01	0.20	0.20	0.15	0.60						
30/09/2024 12:00			0.03	0.01	0.21	0.20	0.15	0.61						
30/09/2024 12:15			0.03	0.01	0.21	0.20	0.16	0.61						
30/09/2024 12:30			0.04	0.01	0.21	0.20	0.16	0.61						
30/09/2024 12:45			0.04	0.01	0.21	0.21	0.16	0.61						
30/09/2024 13:00			0.04	0.01	0.21	0.21	0.16	0.61						
30/09/2024 13:15			0.04	0.02	0.21	0.21	0.16	0.61						
30/09/2024 13:30			0.04	0.02	0.21	0.21	0.16	0.61						
30/09/2024 13:45			0.04	0.02	0.22	0.21	0.17	0.60						
30/09/2024 14:00			0.04	0.02	0.22	0.21	0.17	0.60						
30/09/2024 14:15			0.04	0.02	0.22	0.21	0.17	0.59						
30/09/2024 14:30			0.04	0.02	0.22	0.21	0.17	0.59						
30/09/2024 14:45			0.04	0.02	0.22	0.21	0.17	0.59						
30/09/2024 15:00			0.04	0.02	0.22	0.21	0.17	0.59						
30/09/2024 15:15			0.04	0.02	0.22	0.21	0.17	0.59						
30/09/2024 15:30			0.05	0.02	0.22	0.21	0.17	0.59						
30/09/2024 15:45			0.05	0.02	0.21	0.21	0.16	0.59						
30/09/2024 16:00			0.05	0.02	0.21	0.21	0.16	0.58						
30/09/2024 16:15			0.05	0.02	0.21	0.21	0.16	0.58						
30/09/2024 16:30			0.04	0.02	0.21	0.21	0.16	0.58						
30/09/2024 16:45			0.04	0.02	0.21	0.21	0.16	0.58						
30/09/2024 17:00			0.04	0.02	0.21	0.21	0.16	0.58						
30/09/2024 17:15			0.04	0.02	0.21	0.21	0.16	0.58						
30/09/2024 17:30			0.04	0.02	0.21	0.21	0.16	0.58						
30/09/2024 17:45			0.04	0.02	0.21	0.21	0.16	0.58						
30/09/2024 18:00			0.04	0.02	0.21	0.21	0.16	0.58						
30/09/2024 18:15			0.04	0.02	0.21	0.21	0.16	0.58						
30/09/2024 18:30			0.04	0.02	0.21	0.21	0.16	0.58						
30/09/2024 18:45			0.04	0.01	0.21	0.21	0.16	0.58						
30/09/2024 19:00			0.04	0.01	0.21	0.21	0.15	0.58						
30/09/2024 19:15			0.04	0.01	0.20	0.21	0.15	0.58						
30/09/2024 19:30			0.04	0.01	0.20	0.21	0.15	0.58						
30/09/2024 19:45			0.04	0.01	0.20	0.21	0.15	0.58						
30/09/2024 20:00			0.04	0.01	0.20	0.21	0.15	0.58						
30/09/2024 20:15			0.04	0.01	0.20	0.20	0.15	0.58						
30/09/2024 20:30			0.04	0.01	0.20	0.20	0.15	0.58						
30/09/2024 20:45			0.04	0.01	0.20	0.20	0.15	0.58						
30/09/2024 21:00			0.04	0.01	0.20	0.20	0.15	0.58						
30/09/2024 21:15			0.04	0.01	0.20	0.21	0.15	0.58						
30/09/2024 21:30			0.04	0.01	0.20	0.20	0.15	0.58						
30/09/2024 21:45			0.04	0.01	0.20	0.20	0.15	0.58						
30/09/2024 22:00			0.04	0.01	0.20	0.20	0.15	0.58						
30/09/2024 22:15			0.04	0.01	0.20	0.20	0.15	0.57						
30/09/2024 22:30			0.04	0.01	0.20	0.20	0.15	0.57						
30/09/2024 22:45			0.04	0.01	0.20	0.20	0.15	0.57						
30/09/2024 23:00			0.04	0.01	0.20	0.20	0.15	0.57						
30/09/2024 23:15			0.04	0.01	0.20	0.20	0.15	0.57						
30/09/2024 23:30			0.04	0.01	0.20	0.20	0.15	0.57						
30/09/2024 23:45			0.04	0.01	0.20	0.20	0.15	0.57						
01/10/2024 00:00			0.04	0.01	0.20	0.20	0.15	0.57						
01/10/2024 00:15			0.04	0.01	0.20	0.20	0.15	0.57						
01/10/2024 00:30			0.04	0.01	0.20	0.20	0.15	0.57						
01/10/2024 00:45			0.04	0.01	0.20	0.20	0.15	0.57						
01/10/2024 01:00			0.04	0.01	0.20	0.20	0.15	0.57						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
01/10/2024 01:15			0.04	0.01	0.20	0.20	0.15	0.57						
01/10/2024 01:30			0.03	0.01	0.20	0.20	0.15	0.57						
01/10/2024 01:45			0.03	0.01	0.20	0.20	0.15	0.57						
01/10/2024 02:00			0.03	0.01	0.20	0.20	0.15	0.56						
01/10/2024 02:15			0.03	0.01	0.20	0.20	0.15	0.57						
01/10/2024 02:30			0.03	0.01	0.20	0.20	0.15	0.56						
01/10/2024 02:45			0.03	0.01	0.20	0.20	0.15	0.56						
01/10/2024 03:00			0.03	0.01	0.20	0.20	0.14	0.56						
01/10/2024 03:15			0.03	0.01	0.20	0.20	0.14	0.56						
01/10/2024 03:30			0.03	0.01	0.20	0.20	0.14	0.56						
01/10/2024 03:45			0.03	0.01	0.20	0.20	0.14	0.57						
01/10/2024 04:00			0.03	0.01	0.20	0.20	0.14	0.57						
01/10/2024 04:15			0.03	0.01	0.20	0.20	0.14	0.57						
01/10/2024 04:30			0.03	0.01	0.19	0.20	0.14	0.57						
01/10/2024 04:45			0.03	0.01	0.19	0.20	0.14	0.57						
01/10/2024 05:00			0.03	0.01	0.20	0.20	0.14	0.56						
01/10/2024 05:15			0.03	0.01	0.19	0.20	0.14	0.56						
01/10/2024 05:30			0.03	0.01	0.19	0.20	0.14	0.56						
01/10/2024 05:45			0.03	0.01	0.19	0.20	0.14	0.55						
01/10/2024 06:00			0.03	0.01	0.19	0.20	0.14	0.55						
01/10/2024 06:15			0.03	0.01	0.19	0.20	0.14	0.55						
01/10/2024 06:30			0.03	0.01	0.19	0.20	0.14	0.54						
01/10/2024 06:45			0.03	0.01	0.19	0.19	0.14	0.54						
01/10/2024 07:00			0.03	0.01	0.19	0.19	0.14	0.54						
01/10/2024 07:15			0.03	0.01	0.19	0.19	0.14	0.54						
01/10/2024 07:30			0.03	0.01	0.19	0.19	0.14	0.54						
01/10/2024 07:45			0.03	0.01	0.19	0.19	0.14	0.55						
01/10/2024 08:00			0.03	0.01	0.19	0.19	0.13	0.55						
01/10/2024 08:15			0.03	0.01	0.19	0.19	0.13	0.55						
01/10/2024 08:30			0.03	0.01	0.19	0.19	0.13	0.55						
01/10/2024 08:45			0.03	0.01	0.19	0.19	0.13	0.55						
01/10/2024 09:00			0.02	0.01	0.19	0.19	0.13	0.55						
01/10/2024 09:15			0.02	0.01	0.19	0.19	0.13	0.55						
01/10/2024 09:30			0.02	0.01	0.19	0.19	0.13	0.55						
01/10/2024 09:45			0.03	0.01	0.19	0.19	0.13	0.55						
01/10/2024 10:00			0.02	0.01	0.19	0.19	0.13	0.55						
01/10/2024 10:15			0.02	0.01	0.19	0.19	0.13	0.55						
01/10/2024 10:30			0.02	0.01	0.19	0.19	0.13	0.55						
01/10/2024 10:45			0.02	0.01	0.19	0.19	0.13	0.55						
01/10/2024 11:00			0.02	0.01	0.19	0.19	0.13	0.55						
01/10/2024 11:15			0.02	0.01	0.19	0.19	0.13	0.55						
01/10/2024 11:30			0.02	0.01	0.19	0.19	0.13	0.55						
01/10/2024 11:45			0.02	0.01	0.19	0.19	0.13	0.56						
01/10/2024 12:00			0.02	0.01	0.19	0.19	0.13	0.57						
01/10/2024 12:15			0.02	0.01	0.19	0.19	0.13	0.58						
01/10/2024 12:30			0.02	0.01	0.19	0.19	0.13	0.58						
01/10/2024 12:45			0.02	0.01	0.19	0.19	0.13	0.58						
01/10/2024 13:00			0.02	0.01	0.19	0.19	0.14	0.58						
01/10/2024 13:15			0.03	0.01	0.19	0.19	0.14	0.58						
01/10/2024 13:30			0.03	0.01	0.19	0.19	0.14	0.57						
01/10/2024 13:45			0.03	0.01	0.19	0.20	0.14	0.57						
01/10/2024 14:00			0.03	0.01	0.19	0.20	0.14	0.58						
01/10/2024 14:15			0.03	0.01	0.20	0.20	0.14	0.59						
01/10/2024 14:30			0.03	0.01	0.20	0.20	0.14	0.60						
01/10/2024 14:45			0.03	0.01	0.20	0.20	0.15	0.60						
01/10/2024 15:00			0.03	0.01	0.20	0.20	0.15	0.60						
01/10/2024 15:15			0.03	0.01	0.20	0.20	0.15	0.59						
01/10/2024 15:30			0.03	0.01	0.20	0.20	0.15	0.59						
01/10/2024 15:45			0.03	0.01	0.20	0.20	0.15	0.59						
01/10/2024 16:00			0.04	0.01	0.21	0.21	0.16	0.60						
01/10/2024 16:15			0.04	0.02	0.21	0.21	0.16	0.62						
01/10/2024 16:30			0.04	0.02	0.22	0.22	0.17	0.67						
01/10/2024 16:45			0.05	0.02	0.23	0.22	0.18	0.79						
01/10/2024 17:00			0.05	0.02	0.23	0.23	0.19	0.78						
01/10/2024 17:15			0.05	0.02	0.25	0.24	0.20	0.74						
01/10/2024 17:30			0.06	0.03	0.26	0.25	0.22	0.73						
01/10/2024 17:45			0.07	0.03	0.27	0.26	0.24	0.74						
01/10/2024 18:00			0.07	0.04	0.28	0.27	0.25	0.77						
01/10/2024 18:15			0.08	0.04	0.29	0.28	0.26	0.78						
01/10/2024 18:30			0.09	0.05	0.30	0.29	0.27	0.76						
01/10/2024 18:45			0.10	0.06	0.30	0.29	0.28	0.75						
01/10/2024 19:00			0.10	0.06	0.31	0.30	0.29	0.73						
01/10/2024 19:15			0.11	0.07	0.31	0.30	0.29	0.72						
01/10/2024 19:30			0.11	0.07	0.31	0.30	0.29	0.72						
01/10/2024 19:45			0.12	0.08	0.31	0.30	0.29	0.73						
01/10/2024 20:00			0.12	0.08	0.32	0.30	0.29	0.72						
01/10/2024 20:15			0.12	0.08	0.32	0.30	0.29	0.72						
01/10/2024 20:30			0.12	0.08	0.32	0.31	0.29	0.71						
01/10/2024 20:45			0.12	0.08	0.32	0.31	0.29	0.71						
01/10/2024 21:00			0.12	0.08	0.31	0.30	0.29	0.70						
01/10/2024 21:15			0.13	0.09	0.31	0.30	0.29	0.70						
01/10/2024 21:30			0.13	0.09	0.31	0.30	0.29	0.69						
01/10/2024 21:45			0.12	0.08	0.31	0.30	0.29	0.68						
01/10/2024 22:00			0.12	0.08	0.31	0.30	0.29	0.68						
01/10/2024 22:15			0.12	0.08	0.31	0.30	0.28	0.68						
01/10/2024 22:30			0.12	0.08	0.31	0.30	0.28	0.67						
01/10/2024 22:45	0.69		0.12	0.08	0.30	0.30	0.28	0.67						
01/10/2024 23:00	0.69		0.11	0.07	0.30	0.29	0.28	0.67						
01/10/2024 23:15	0.70		0.11	0.07	0.30	0.29	0.27	0.67						
01/10/2024 23:30	0.70		0.11	0.07	0.30	0.29	0.27	0.66						
01/10/2024 23:45	0.70		0.11	0.07	0.30	0.29	0.27	0.66						
02/10/2024 00:00	0.70		0.11	0.07	0.29	0.29	0.27	0.66						
02/10/2024 00:15	0.70		0.11	0.07	0.29	0.29	0.26	0.66						
02/10/2024 00:30	0.70		0.10	0.06	0.29	0.28	0.26	0.66						
02/10/2024 00:45			0.10	0.06	0.29	0.28	0.26	0.66						
02/10/2024 01:00			0.10	0.06	0.29	0.28	0.26	0.66						
02/10/2024 01:15			0.10	0.06	0.29	0.28	0.26	0.66						
02/10/2024 01:30			0.10	0.06	0.29	0.28	0.25	0.66						
02/10/2024 01:45			0.10	0.06	0.28	0.28	0.25	0.65						
02/10/2024 02:00			0.09	0.06	0.28	0.28	0.25	0.65						
02/10/2024 02:15			0.09	0.05	0.28	0.28	0.25	0.65						
02/10/2024 02:30			0.09	0.05	0.28	0.28	0.25	0.65						
02/10/2024 02:45			0.09	0.05	0.28	0.27	0.25	0.65						
02/10/2024 03:00			0.09	0.05	0.28	0.27	0.25	0.64						
02/10/2024 03:15			0.09	0.05	0.28	0.27	0.24	0.64						
02/10/2024 03:30			0.09	0.05	0.28	0.27	0.24	0.64						
02/10/2024 03:45			0.09	0.05	0.28	0.27	0.24	0.64						
02/10/2024 04:00			0.09	0.05	0.28	0.27	0.24	0.64						
02/10/2024 04:15			0.09	0.05	0.27	0.27	0.24	0.64						
02/10/2024 04:30			0.09	0.05	0.27	0.27	0.24	0.64						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
02/10/2024 04:45			0.09	0.05	0.27	0.27	0.24	0.64						
02/10/2024 05:00			0.09	0.05	0.27	0.26	0.24	0.63						
02/10/2024 05:15			0.09	0.05	0.27	0.26	0.23	0.63						
02/10/2024 05:30			0.09	0.05	0.27	0.26	0.23	0.63						
02/10/2024 05:45			0.09	0.05	0.27	0.26	0.23	0.64						
02/10/2024 06:00			0.09	0.05	0.27	0.26	0.23	0.64						
02/10/2024 06:15			0.09	0.05	0.27	0.26	0.23	0.65						
02/10/2024 06:30			0.08	0.05	0.27	0.26	0.23	0.64						
02/10/2024 06:45			0.08	0.05	0.27	0.26	0.23	0.64						
02/10/2024 07:00			0.08	0.05	0.27	0.26	0.23	0.64						
02/10/2024 07:15			0.08	0.05	0.27	0.26	0.23	0.64						
02/10/2024 07:30			0.08	0.05	0.27	0.26	0.23	0.64						
02/10/2024 07:45			0.08	0.05	0.27	0.26	0.23	0.64						
02/10/2024 08:00			0.08	0.05	0.26	0.26	0.23	0.64						
02/10/2024 08:15			0.08	0.05	0.26	0.26	0.23	0.63						
02/10/2024 08:30			0.08	0.05	0.26	0.26	0.23	0.63						
02/10/2024 08:45			0.08	0.05	0.26	0.26	0.22	0.63						
02/10/2024 09:00			0.08	0.05	0.26	0.26	0.22	0.63						
02/10/2024 09:15			0.08	0.05	0.26	0.26	0.22	0.63						
02/10/2024 09:30			0.08	0.04	0.26	0.25	0.22	0.63						
02/10/2024 09:45			0.08	0.04	0.26	0.25	0.22	0.63						
02/10/2024 10:00	0.72		0.08	0.04	0.26	0.25	0.22	0.62						
02/10/2024 10:15			0.08	0.04	0.26	0.25	0.22	0.62						
02/10/2024 10:30			0.08	0.04	0.26	0.25	0.22	0.62						
02/10/2024 10:45	0.72		0.08	0.04	0.26	0.25	0.22	0.62						
02/10/2024 11:00	0.72		0.08	0.04	0.26	0.25	0.22	0.62						
02/10/2024 11:15			0.08	0.04	0.26	0.25	0.22	0.62						
02/10/2024 11:30			0.08	0.04	0.26	0.25	0.21	0.62						
02/10/2024 11:45			0.08	0.04	0.26	0.25	0.21	0.62						
02/10/2024 12:00			0.07	0.04	0.25	0.25	0.21	0.62						
02/10/2024 12:15			0.07	0.04	0.25	0.25	0.21	0.62						
02/10/2024 12:30			0.07	0.04	0.25	0.25	0.21	0.62						
02/10/2024 12:45			0.08	0.04	0.25	0.25	0.21	0.61						
02/10/2024 13:00			0.07	0.04	0.25	0.25	0.21	0.61						
02/10/2024 13:15			0.07	0.04	0.25	0.24	0.21	0.61						
02/10/2024 13:30			0.07	0.04	0.25	0.24	0.21	0.61						
02/10/2024 13:45			0.07	0.04	0.25	0.24	0.21	0.61						
02/10/2024 14:00			0.07	0.04	0.25	0.24	0.21	0.62						
02/10/2024 14:15			0.07	0.04	0.25	0.24	0.21	0.62						
02/10/2024 14:30			0.07	0.04	0.25	0.24	0.20	0.63						
02/10/2024 14:45			0.07	0.03	0.25	0.24	0.20	0.63						
02/10/2024 15:00			0.07	0.04	0.25	0.24	0.20	0.63						
02/10/2024 15:15			0.07	0.04	0.25	0.24	0.20	0.63						
02/10/2024 15:30			0.07	0.04	0.25	0.24	0.21	0.63						
02/10/2024 15:45			0.07	0.04	0.25	0.24	0.21	0.62						
02/10/2024 16:00			0.07	0.04	0.25	0.24	0.21	0.64						
02/10/2024 16:15			0.07	0.04	0.25	0.24	0.21	0.64						
02/10/2024 16:30			0.07	0.04	0.25	0.24	0.21	0.64						
02/10/2024 16:45			0.07	0.04	0.25	0.24	0.21	0.64						
02/10/2024 17:00			0.07	0.04	0.25	0.24	0.21	0.63						
02/10/2024 17:15			0.08	0.04	0.25	0.24	0.21	0.63						
02/10/2024 17:30			0.08	0.04	0.25	0.24	0.21	0.62						
02/10/2024 17:45			0.08	0.04	0.25	0.24	0.21	0.62						
02/10/2024 18:00			0.08	0.04	0.25	0.24	0.21	0.62						
02/10/2024 18:15			0.07	0.04	0.25	0.24	0.21	0.61						
02/10/2024 18:30			0.07	0.04	0.25	0.24	0.21	0.61						
02/10/2024 18:45			0.07	0.04	0.25	0.24	0.21	0.61						
02/10/2024 19:00			0.07	0.04	0.25	0.24	0.21	0.61						
02/10/2024 19:15			0.07	0.04	0.25	0.24	0.21	0.61						
02/10/2024 19:30			0.07	0.04	0.25	0.24	0.21	0.61						
02/10/2024 19:45			0.07	0.04	0.25	0.24	0.20	0.62						
02/10/2024 20:00			0.07	0.04	0.25	0.24	0.20	0.62						
02/10/2024 20:15			0.07	0.04	0.25	0.24	0.20	0.62						
02/10/2024 20:30			0.07	0.04	0.25	0.24	0.20	0.62						
02/10/2024 20:45			0.07	0.04	0.25	0.24	0.20	0.61						
02/10/2024 21:00			0.07	0.04	0.25	0.24	0.20	0.61						
02/10/2024 21:15			0.07	0.04	0.25	0.24	0.20	0.61						
02/10/2024 21:30			0.07	0.04	0.25	0.24	0.20	0.62						
02/10/2024 21:45			0.07	0.04	0.25	0.24	0.20	0.62						
02/10/2024 22:00			0.07	0.04	0.25	0.24	0.20	0.62						
02/10/2024 22:15			0.07	0.04	0.25	0.24	0.20	0.65						
02/10/2024 22:30			0.07	0.04	0.25	0.24	0.20	0.65						
02/10/2024 22:45			0.07	0.04	0.25	0.24	0.20	0.65						
02/10/2024 23:00			0.07	0.04	0.25	0.24	0.21	0.64						
02/10/2024 23:15			0.07	0.04	0.25	0.24	0.21	0.64						
02/10/2024 23:30			0.07	0.04	0.25	0.24	0.21	0.63						
02/10/2024 23:45			0.08	0.04	0.25	0.24	0.21	0.62						
03/10/2024 00:00			0.08	0.04	0.25	0.25	0.21	0.62						
03/10/2024 00:15			0.08	0.04	0.25	0.25	0.21	0.62						
03/10/2024 00:30			0.08	0.04	0.25	0.25	0.21	0.61						
03/10/2024 00:45			0.08	0.04	0.25	0.25	0.21	0.61						
03/10/2024 01:00			0.08	0.04	0.25	0.25	0.21	0.61						
03/10/2024 01:15			0.08	0.04	0.25	0.25	0.21	0.61						
03/10/2024 01:30			0.07	0.04	0.25	0.24	0.21	0.61						
03/10/2024 01:45			0.07	0.04	0.25	0.24	0.21	0.61						
03/10/2024 02:00	0.76		0.07	0.04	0.25	0.24	0.21	0.61						
03/10/2024 02:15	0.76		0.07	0.04	0.25	0.24	0.21	0.61						
03/10/2024 02:30	0.76		0.07	0.04	0.25	0.24	0.21	0.61						
03/10/2024 02:45	0.76		0.07	0.04	0.25	0.24	0.21	0.61						
03/10/2024 03:00	0.76		0.07	0.04	0.25	0.24	0.21	0.61						
03/10/2024 03:15	0.76		0.07	0.04	0.25	0.24	0.20	0.61						
03/10/2024 03:30	0.76		0.07	0.04	0.25	0.24	0.20	0.61						
03/10/2024 03:45	0.76		0.07	0.04	0.25	0.24	0.20	0.60						
03/10/2024 04:00	0.76		0.07	0.04	0.24	0.24	0.20	0.60						
03/10/2024 04:15	0.76		0.07	0.04	0.24	0.24	0.20	0.60						
03/10/2024 04:30	0.76		0.07	0.03	0.24	0.24	0.20	0.60						
03/10/2024 04:45			0.07	0.03	0.24	0.24	0.20	0.60						
03/10/2024 05:00			0.07	0.03	0.24	0.24	0.20	0.60						
03/10/2024 05:15	0.76		0.07	0.03	0.24	0.24	0.20	0.60						
03/10/2024 05:30	0.76		0.07	0.03	0.24	0.23	0.20	0.60						
03/10/2024 05:45	0.76		0.07	0.03	0.24	0.23	0.19	0.60						
03/10/2024 06:00	0.76		0.06	0.03	0.24	0.23	0.19	0.60						
03/10/2024 06:15	0.76		0.07	0.03	0.24	0.23	0.19	0.60						
03/10/2024 06:30	0.76		0.06	0.03	0.24	0.23	0.19	0.59						
03/10/2024 06:45	0.76		0.06	0.03	0.24	0.23	0.19	0.59						
03/10/2024 07:00	0.76		0.06	0.03	0.24	0.23	0.19	0.59						
03/10/2024 07:15			0.06	0.03	0.24	0.23	0.19	0.59						
03/10/2024 07:30			0.06	0.03	0.24	0.23	0.19	0.59						
03/10/2024 07:45	0.76		0.06	0.03	0.24	0.23	0.19	0.59						
03/10/2024 08:00			0.06	0.03	0.23	0.23	0.19	0.59						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
03/10/2024 08:15	0.76		0.06	0.03	0.23	0.23	0.19	0.59						
03/10/2024 08:30			0.06	0.03	0.23	0.23	0.19	0.59						
03/10/2024 08:45			0.06	0.03	0.23	0.23	0.19	0.59						
03/10/2024 09:00			0.06	0.03	0.23	0.23	0.19	0.60						
03/10/2024 09:15			0.06	0.03	0.23	0.23	0.19	0.60						
03/10/2024 09:30			0.06	0.03	0.23	0.23	0.19	0.60						
03/10/2024 09:45			0.06	0.03	0.23	0.23	0.19	0.60						
03/10/2024 10:00			0.06	0.03	0.23	0.23	0.19	0.60						
03/10/2024 10:15			0.06	0.03	0.23	0.23	0.19	0.59						
03/10/2024 10:30			0.06	0.03	0.23	0.23	0.19	0.59						
03/10/2024 10:45			0.06	0.03	0.23	0.23	0.19	0.59						
03/10/2024 11:00			0.06	0.03	0.23	0.23	0.19	0.59						
03/10/2024 11:15			0.05	0.02	0.23	0.23	0.19	0.59						
03/10/2024 11:30			0.05	0.02	0.23	0.23	0.18	0.59						
03/10/2024 11:45			0.05	0.02	0.23	0.23	0.18	0.59						
03/10/2024 12:00			0.05	0.02	0.23	0.23	0.18	0.59						
03/10/2024 12:15			0.05	0.02	0.23	0.23	0.18	0.59						
03/10/2024 12:30			0.05	0.02	0.23	0.22	0.18	0.59						
03/10/2024 12:45			0.05	0.02	0.23	0.22	0.18	0.59						
03/10/2024 13:00			0.05	0.02	0.23	0.22	0.18	0.60						
03/10/2024 13:15			0.05	0.02	0.23	0.22	0.18	0.60						
03/10/2024 13:30			0.05	0.02	0.23	0.22	0.18	0.59						
03/10/2024 13:45	0.78		0.06	0.03	0.23	0.22	0.18	0.59						
03/10/2024 14:00			0.06	0.03	0.23	0.22	0.18	0.59						
03/10/2024 14:15	0.78		0.05	0.02	0.23	0.22	0.18	0.59						
03/10/2024 14:30			0.06	0.03	0.23	0.22	0.18	0.59						
03/10/2024 14:45			0.05	0.02	0.23	0.22	0.18	0.59						
03/10/2024 15:00	0.78		0.05	0.02	0.23	0.22	0.18	0.59						
03/10/2024 15:15			0.05	0.02	0.23	0.22	0.18	0.59						
03/10/2024 15:30			0.05	0.02	0.23	0.22	0.18	0.59						
03/10/2024 15:45			0.05	0.02	0.23	0.22	0.18	0.59						
03/10/2024 16:00			0.05	0.02	0.22	0.22	0.18	0.58						
03/10/2024 16:15			0.05	0.02	0.22	0.22	0.18	0.58						
03/10/2024 16:30			0.05	0.02	0.22	0.22	0.18	0.58						
03/10/2024 16:45			0.05	0.02	0.22	0.22	0.18	0.58						
03/10/2024 17:00			0.05	0.02	0.22	0.22	0.17	0.58						
03/10/2024 17:15			0.05	0.02	0.22	0.22	0.17	0.58						
03/10/2024 17:30			0.05	0.02	0.22	0.22	0.17	0.58						
03/10/2024 17:45			0.05	0.02	0.22	0.22	0.17	0.58						
03/10/2024 18:00			0.05	0.02	0.22	0.22	0.17	0.58						
03/10/2024 18:15			0.05	0.02	0.22	0.22	0.17	0.58						
03/10/2024 18:30			0.05	0.02	0.22	0.22	0.17	0.58						
03/10/2024 18:45			0.05	0.02	0.22	0.22	0.17	0.58						
03/10/2024 19:00			0.05	0.02	0.22	0.21	0.17	0.58						
03/10/2024 19:15	0.78		0.05	0.02	0.22	0.21	0.17	0.58						
03/10/2024 19:30			0.05	0.02	0.22	0.21	0.17	0.58						
03/10/2024 19:45	0.78		0.05	0.02	0.22	0.21	0.17	0.58						
03/10/2024 20:00	0.78		0.05	0.02	0.22	0.21	0.17	0.58						
03/10/2024 20:15			0.05	0.02	0.22	0.21	0.17	0.58						
03/10/2024 20:30			0.05	0.02	0.22	0.21	0.17	0.58						
03/10/2024 20:45			0.05	0.02	0.22	0.21	0.17	0.59						
03/10/2024 21:00			0.05	0.02	0.22	0.21	0.17	0.59						
03/10/2024 21:15			0.05	0.02	0.22	0.21	0.17	0.59						
03/10/2024 21:30			0.04	0.02	0.22	0.21	0.17	0.58						
03/10/2024 21:45			0.04	0.02	0.22	0.21	0.17	0.58						
03/10/2024 22:00			0.04	0.02	0.22	0.21	0.17	0.58						
03/10/2024 22:15			0.04	0.02	0.22	0.21	0.17	0.58						
03/10/2024 22:30	0.78		0.04	0.02	0.22	0.21	0.17	0.58						
03/10/2024 22:45	0.78		0.04	0.02	0.22	0.21	0.17	0.58						
03/10/2024 23:00	0.78		0.04	0.02	0.22	0.21	0.17	0.58						
03/10/2024 23:15	0.78		0.04	0.02	0.22	0.21	0.17	0.57						
03/10/2024 23:30	0.78		0.04	0.02	0.22	0.21	0.17	0.57						
03/10/2024 23:45	0.78		0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 00:00	0.78		0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 00:15			0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 00:30			0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 00:45			0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 01:00			0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 01:15			0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 01:30			0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 01:45			0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 02:00			0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 02:15			0.04	0.02	0.21	0.21	0.16	0.57						
04/10/2024 02:30			0.04	0.01	0.21	0.21	0.16	0.57						
04/10/2024 02:45			0.04	0.01	0.21	0.21	0.16	0.57						
04/10/2024 03:00			0.04	0.01	0.21	0.21	0.16	0.57						
04/10/2024 03:15	0.79		0.04	0.01	0.21	0.21	0.16	0.56						
04/10/2024 03:30	0.79		0.04	0.01	0.21	0.21	0.16	0.56						
04/10/2024 03:45	0.79		0.04	0.01	0.21	0.21	0.16	0.56						
04/10/2024 04:00			0.04	0.01	0.21	0.21	0.16	0.55						
04/10/2024 04:15	0.79		0.04	0.02	0.21	0.21	0.15	0.55						
04/10/2024 04:30			0.04	0.01	0.21	0.21	0.15	0.55						
04/10/2024 04:45	0.79		0.04	0.01	0.20	0.20	0.15	0.55						
04/10/2024 05:00			0.04	0.01	0.20	0.20	0.15	0.55						
04/10/2024 05:15			0.04	0.01	0.20	0.20	0.15	0.55						
04/10/2024 05:30			0.04	0.01	0.20	0.20	0.15	0.55						
04/10/2024 05:45			0.04	0.01	0.20	0.20	0.15	0.55						
04/10/2024 06:00			0.04	0.01	0.20	0.20	0.15	0.54						
04/10/2024 06:15			0.03	0.01	0.20	0.20	0.15	0.54						
04/10/2024 06:30			0.03	0.01	0.20	0.20	0.15	0.54						
04/10/2024 06:45			0.03	0.01	0.20	0.20	0.15	0.54						
04/10/2024 07:00			0.03	0.01	0.20	0.20	0.14	0.54						
04/10/2024 07:15			0.03	0.01	0.20	0.20	0.14	0.54						
04/10/2024 07:30			0.03	0.01	0.19	0.20	0.14	0.54						
04/10/2024 07:45	0.78		0.03	0.01	0.19	0.20	0.14	0.55						
04/10/2024 08:00	0.78		0.03	0.01	0.19	0.20	0.14	0.55						
04/10/2024 08:15			0.03	0.01	0.19	0.20	0.14	0.55						
04/10/2024 08:30	0.78		0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 08:45			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 09:00	0.78		0.03	0.01	0.19	0.19	0.14	0.56						
04/10/2024 09:15	0.78		0.03	0.01	0.19	0.19	0.14	0.56						
04/10/2024 09:30			0.03	0.01	0.19	0.19	0.14	0.56						
04/10/2024 09:45			0.03	0.01	0.19	0.19	0.14	0.56						
04/10/2024 10:00			0.02	0.01	0.19	0.19	0.14	0.56						
04/10/2024 10:15			0.02	0.01	0.19	0.19	0.14	0.56						
04/10/2024 10:30			0.02	0.01	0.19	0.19	0.14	0.56						
04/10/2024 10:45			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 11:00			0.02	0.01	0.19	0.19	0.14	0.55						
04/10/2024 11:15			0.02	0.01	0.19	0.19	0.14	0.55						
04/10/2024 11:30			0.02	0.01	0.19	0.19	0.14	0.55						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
04/10/2024 11:45			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 12:00			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 12:15			0.02	0.01	0.19	0.19	0.14	0.55						
04/10/2024 12:30			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 12:45			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 13:00			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 13:15			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 13:30			0.02	0.01	0.19	0.19	0.14	0.55						
04/10/2024 13:45			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 14:00			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 14:15			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 14:30			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 14:45			0.02	0.01	0.19	0.19	0.14	0.55						
04/10/2024 15:00			0.02	0.01	0.19	0.19	0.14	0.55						
04/10/2024 15:15			0.02	0.01	0.19	0.19	0.14	0.55						
04/10/2024 15:30			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 15:45			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 16:00			0.03	0.01	0.19	0.19	0.14	0.55						
04/10/2024 16:15			0.03	0.01	0.19	0.19	0.13	0.55						
04/10/2024 16:30			0.03	0.01	0.19	0.19	0.13	0.55						
04/10/2024 16:45			0.03	0.01	0.19	0.19	0.13	0.55						
04/10/2024 17:00			0.03	0.01	0.19	0.19	0.13	0.55						
04/10/2024 17:15			0.03	0.01	0.19	0.19	0.13	0.55						
04/10/2024 17:30			0.03	0.01	0.19	0.19	0.13	0.55						
04/10/2024 17:45			0.02	0.01	0.19	0.19	0.13	0.55						
04/10/2024 18:00	0.79		0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 18:15			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 18:30	0.79		0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 18:45			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 19:00			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 19:15			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 19:30	0.78		0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 19:45			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 20:00			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 20:15	0.78		0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 20:30			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 20:45			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 21:00			0.02	0.01	0.18	0.19	0.13	0.56						
04/10/2024 21:15			0.02	0.01	0.18	0.19	0.13	0.56						
04/10/2024 21:30			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 21:45			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 22:00			0.02	0.01	0.18	0.19	0.13	0.55						
04/10/2024 22:15			0.02	0.01	0.18	0.19	0.13	0.54						
04/10/2024 22:30			0.02	0.01	0.18	0.19	0.13	0.54						
04/10/2024 22:45			0.02	0.01	0.18	0.19	0.13	0.54						
04/10/2024 23:00			0.02	0.01	0.18	0.19	0.13	0.54						
04/10/2024 23:15			0.02	0.01	0.18	0.19	0.13	0.54						
04/10/2024 23:30			0.02	0.01	0.18	0.19	0.13	0.54						
04/10/2024 23:45			0.02	0.01	0.18	0.19	0.13	0.54						
05/10/2024 00:00			0.02	0.01	0.18	0.19	0.13	0.54						
05/10/2024 00:15			0.02	0.01	0.18	0.19	0.13	0.54						
05/10/2024 00:30			0.02	0.01	0.18	0.19	0.13	0.53						
05/10/2024 00:45			0.02	0.01	0.18	0.18	0.13	0.53						
05/10/2024 01:00			0.02	0.01	0.18	0.18	0.13	0.53						
05/10/2024 01:15	0.78		0.02	0.01	0.18	0.18	0.13	0.53						
05/10/2024 01:30	0.78		0.02	0.01	0.18	0.18	0.13	0.53						
05/10/2024 01:45	0.78		0.02	0.01	0.18	0.18	0.13	0.53						
05/10/2024 02:00			0.02	0.01	0.18	0.18	0.13	0.53						
05/10/2024 02:15			0.02	0.00	0.18	0.18	0.12	0.52						
05/10/2024 02:30			0.02	0.00	0.18	0.18	0.12	0.52						
05/10/2024 02:45	0.78		0.02	0.00	0.18	0.18	0.12	0.52						
05/10/2024 03:00	0.78		0.02	0.00	0.18	0.18	0.12	0.52						
05/10/2024 03:15			0.02	0.00	0.18	0.18	0.12	0.52						
05/10/2024 03:30			0.02	0.00	0.18	0.18	0.12	0.52						
05/10/2024 03:45	0.78		0.02	0.00	0.18	0.18	0.12	0.52						
05/10/2024 04:00	0.78		0.02	0.00	0.17	0.18	0.12	0.52						
05/10/2024 04:15			0.02	0.01	0.17	0.18	0.12	0.52						
05/10/2024 04:30			0.02	0.01	0.17	0.18	0.12	0.52						
05/10/2024 04:45			0.02	0.01	0.17	0.18	0.12	0.52						
05/10/2024 05:00			0.02	0.01	0.17	0.18	0.12	0.51						
05/10/2024 05:15			0.02	0.01	0.17	0.18	0.12	0.51						
05/10/2024 05:30			0.02	0.01	0.17	0.18	0.12	0.51						
05/10/2024 05:45			0.02	0.01	0.17	0.18	0.12	0.51						
05/10/2024 06:00			0.02	0.01	0.17	0.18	0.12	0.51						
05/10/2024 06:15			0.02	0.01	0.17	0.18	0.12	0.51						
05/10/2024 06:30			0.02	0.01	0.17	0.17	0.12	0.51						
05/10/2024 06:45			0.02	0.01	0.17	0.17	0.12	0.51						
05/10/2024 07:00			0.02	0.00	0.17	0.17	0.11	0.51						
05/10/2024 07:15			0.02	0.00	0.17	0.17	0.11	0.51						
05/10/2024 07:30			0.02	0.00	0.17	0.17	0.11	0.52						
05/10/2024 07:45			0.02	0.00	0.17	0.17	0.11	0.52						
05/10/2024 08:00			0.02	0.00	0.17	0.17	0.11	0.52						
05/10/2024 08:15			0.02	0.00	0.17	0.17	0.11	0.52						
05/10/2024 08:30			0.02	0.00	0.17	0.17	0.11	0.52						
05/10/2024 08:45			0.02	0.00	0.17	0.17	0.11	0.53						
05/10/2024 09:00			0.02	0.00	0.17	0.17	0.11	0.53						
05/10/2024 09:15			0.01	0.00	0.17	0.17	0.11	0.53						
05/10/2024 09:30			0.02	0.00	0.17	0.17	0.11	0.54						
05/10/2024 09:45			0.01	0.00	0.17	0.17	0.11	0.54						
05/10/2024 10:00			0.01	0.00	0.17	0.17	0.12	0.54						
05/10/2024 10:15			0.01	0.00	0.17	0.17	0.12	0.55						
05/10/2024 10:30			0.01	0.00	0.17	0.17	0.12	0.55						
05/10/2024 10:45			0.01	0.00	0.17	0.17	0.12	0.55						
05/10/2024 11:00	0.77		0.01	0.00	0.17	0.18	0.12	0.55						
05/10/2024 11:15	0.77		0.01	0.00	0.17	0.18	0.12	0.55						
05/10/2024 11:30			0.01	0.00	0.17	0.18	0.12	0.55						
05/10/2024 11:45	0.77		0.01	0.00	0.17	0.18	0.12	0.55						
05/10/2024 12:00	0.77		0.01	0.00	0.18	0.18	0.12	0.55						
05/10/2024 12:15	0.77		0.01	0.00	0.18	0.18	0.12	0.55						
05/10/2024 12:30	0.77		0.02	0.00	0.18	0.18	0.12	0.55						
05/10/2024 12:45	0.77		0.02	0.00	0.18	0.18	0.12	0.55						
05/10/2024 13:00	0.77		0.02	0.00	0.18	0.18	0.12	0.55						
05/10/2024 13:15	0.77		0.02	0.01	0.18	0.18	0.12	0.55						
05/10/2024 13:30	0.77		0.02	0.00	0.18	0.18	0.12	0.55						
05/10/2024 13:45	0.78		0.02	0.00	0.18	0.18	0.12	0.55						
05/10/2024 14:00			0.02	0.01	0.18	0.18	0.12	0.55						
05/10/2024 14:15			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 14:30			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 14:45			0.02	0.00	0.18	0.18	0.12	0.54						
05/10/2024 15:00			0.02	0.01	0.18	0.18	0.12	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
05/10/2024 15:15			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 15:30			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 15:45			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 16:00			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 16:15			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 16:30			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 16:45			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 17:00			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 17:15			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 17:30			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 17:45			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 18:00			0.02	0.01	0.18	0.18	0.12	0.54						
05/10/2024 18:15			0.02	0.01	0.18	0.18	0.12	0.55						
05/10/2024 18:30			0.02	0.01	0.18	0.18	0.12	0.55						
05/10/2024 18:45			0.02	0.01	0.17	0.18	0.12	0.55						
05/10/2024 19:00			0.02	0.01	0.17	0.18	0.12	0.55						
05/10/2024 19:15			0.02	0.01	0.17	0.18	0.12	0.55						
05/10/2024 19:30			0.02	0.01	0.17	0.18	0.12	0.55						
05/10/2024 19:45			0.02	0.01	0.17	0.18	0.12	0.55						
05/10/2024 20:00			0.02	0.01	0.17	0.18	0.12	0.55						
05/10/2024 20:15			0.02	0.01	0.17	0.18	0.12	0.55						
05/10/2024 20:30			0.02	0.00	0.17	0.18	0.12	0.55						
05/10/2024 20:45			0.02	0.00	0.17	0.18	0.12	0.55						
05/10/2024 21:00			0.02	0.00	0.17	0.18	0.12	0.55						
05/10/2024 21:15			0.02	0.00	0.17	0.18	0.12	0.55						
05/10/2024 21:30			0.02	0.00	0.17	0.18	0.12	0.55						
05/10/2024 21:45			0.02	0.00	0.17	0.18	0.12	0.55						
05/10/2024 22:00			0.02	0.00	0.17	0.18	0.12	0.55						
05/10/2024 22:15			0.02	0.00	0.17	0.18	0.12	0.55						
05/10/2024 22:30			0.02	0.00	0.17	0.18	0.12	0.55						
05/10/2024 22:45			0.02	0.00	0.18	0.18	0.12	0.55						
05/10/2024 23:00			0.02	0.00	0.17	0.18	0.12	0.55						
05/10/2024 23:15			0.02	0.01	0.17	0.18	0.12	0.55						
05/10/2024 23:30			0.02	0.01	0.18	0.18	0.12	0.55						
05/10/2024 23:45			0.02	0.00	0.18	0.18	0.12	0.54						
06/10/2024 00:00			0.02	0.00	0.18	0.18	0.12	0.54						
06/10/2024 00:15			0.02	0.00	0.17	0.18	0.12	0.54						
06/10/2024 00:30			0.02	0.01	0.17	0.18	0.12	0.54						
06/10/2024 00:45			0.02	0.00	0.17	0.18	0.12	0.54						
06/10/2024 01:00			0.02	0.00	0.17	0.18	0.12	0.54						
06/10/2024 01:15			0.02	0.00	0.17	0.18	0.12	0.54						
06/10/2024 01:30			0.02	0.00	0.17	0.18	0.12	0.54						
06/10/2024 01:45			0.02	0.00	0.17	0.18	0.12	0.53						
06/10/2024 02:00:00			0.02	0.00	0.17	0.18	0.12	0.53						
06/10/2024 02:15:00			0.02	0.00	0.17	0.18	0.12	0.53						
06/10/2024 02:30:00			0.02	0.00	0.17	0.18	0.12	0.53						
06/10/2024 02:45:00			0.02	0.00	0.17	0.18	0.12	0.53						
06/10/2024 03:00:00			0.02	0.00	0.17	0.18	0.12	0.53						
06/10/2024 03:15:00			0.02	0.00	0.17	0.18	0.12	0.53						
06/10/2024 03:30:00			0.02	0.00	0.17	0.18	0.12	0.53						
06/10/2024 03:45:00			0.02	0.00	0.17	0.18	0.11	0.53						
06/10/2024 04:00:00			0.02	0.00	0.17	0.18	0.11	0.53						
06/10/2024 04:15:00			0.02	0.00	0.17	0.18	0.11	0.53						
06/10/2024 04:30:00			0.02	0.00	0.17	0.17	0.11	0.53						
06/10/2024 04:45:00			0.02	0.00	0.17	0.17	0.11	0.53						
06/10/2024 05:00:00			0.02	0.00	0.17	0.17	0.11	0.53						
06/10/2024 05:15:00			0.02	0.00	0.16	0.17	0.11	0.53						
06/10/2024 05:30:00			0.02	0.00	0.16	0.17	0.11	0.53						
06/10/2024 05:45:00			0.02	0.00	0.16	0.17	0.11	0.53						
06/10/2024 06:00:00			0.01	0.00	0.16	0.17	0.11	0.53						
06/10/2024 06:15:00			0.01	0.00	0.16	0.17	0.11	0.52						
06/10/2024 06:30:00			0.01	0.00	0.16	0.17	0.11	0.52						
06/10/2024 06:45:00			0.01	0.00	0.16	0.17	0.11	0.53						
06/10/2024 07:00:00			0.01	0.00	0.16	0.17	0.11	0.52						
06/10/2024 07:15:00			0.01	0.00	0.16	0.17	0.11	0.53						
06/10/2024 07:30:00			0.01	0.00	0.16	0.17	0.11	0.53						
06/10/2024 07:45:00			0.01	0.00	0.16	0.17	0.11	0.53						
06/10/2024 08:00:00			0.01	0.00	0.16	0.17	0.11	0.53						
06/10/2024 08:15:00			0.01	0.00	0.16	0.17	0.11	0.53						
06/10/2024 08:30:00			0.01	0.00	0.16	0.17	0.11	0.53						
06/10/2024 08:45:00			0.01	0.00	0.16	0.17	0.11	0.54						
06/10/2024 09:00:00			0.01	0.00	0.16	0.17	0.11	0.54						
06/10/2024 09:15:00			0.01	0.00	0.16	0.17	0.11	0.54						
06/10/2024 09:30:00			0.01	0.00	0.16	0.17	0.11	0.55						
06/10/2024 09:45:00			0.01	0.00	0.16	0.17	0.11	0.55						
06/10/2024 10:00:00			0.01	0.00	0.16	0.17	0.11	0.55						
06/10/2024 10:15:00			0.01	0.00	0.16	0.17	0.11	0.55						
06/10/2024 10:30:00			0.01	0.00	0.16	0.17	0.11	0.56						
06/10/2024 10:45:00			0.00	0.00	0.16	0.17	0.11	0.56						
06/10/2024 11:00:00			0.01	0.00	0.16	0.17	0.11	0.56						
06/10/2024 11:15:00			0.01	0.00	0.16	0.17	0.11	0.56						
06/10/2024 11:30:00			0.01	0.00	0.16	0.17	0.11	0.57						
06/10/2024 11:45:00			0.01	0.00	0.17	0.17	0.11	0.57						
06/10/2024 12:00:00			0.01	0.00	0.17	0.17	0.11	0.57						
06/10/2024 12:15:00			0.01	0.00	0.17	0.18	0.11	0.57						
06/10/2024 12:30:00			0.01	0.00	0.17	0.18	0.11	0.57						
06/10/2024 12:45:00			0.01	0.00	0.17	0.18	0.11	0.57						
06/10/2024 13:00:00			0.02	0.00	0.17	0.18	0.12	0.57						
06/10/2024 13:15:00			0.02	0.00	0.17	0.18	0.12	0.57						
06/10/2024 13:30:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 13:45:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 14:00:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 14:15:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 14:30:00			0.02	0.01	0.17	0.18	0.12	0.56						
06/10/2024 14:45:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 15:00:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 15:15:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 15:30:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 15:45:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 16:00:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 16:15:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 16:30:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 16:45:00			0.02	0.01	0.17	0.18	0.12	0.56						
06/10/2024 17:00:00			0.02	0.01	0.17	0.18	0.12	0.56						
06/10/2024 17:15:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 17:30:00			0.02	0.01	0.17	0.18	0.12	0.56						
06/10/2024 17:45:00			0.02	0.01	0.17	0.18	0.12	0.56						
06/10/2024 18:00:00			0.02	0.01	0.17	0.18	0.12	0.56						
06/10/2024 18:15:00			0.02	0.00	0.17	0.18	0.12	0.56						
06/10/2024 18:30:00			0.02	0.00	0.17	0.18	0.12	0.56						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
06/10/2024 18:45:00			0.02	0.00	0.17	0.18	0.12	0.57						
06/10/2024 19:00:00			0.02	0.00	0.17	0.18	0.12	0.57						
06/10/2024 19:15:00			0.02	0.00	0.17	0.18	0.12	0.57						
06/10/2024 19:30:00			0.02	0.00	0.17	0.18	0.12	0.57						
06/10/2024 19:45:00			0.02	0.00	0.17	0.18	0.12	0.57						
06/10/2024 20:00:00			0.02	0.00	0.17	0.18	0.12	0.57						
06/10/2024 20:15:00			0.02	0.00	0.17	0.18	0.12	0.58						
06/10/2024 20:30:00			0.02	0.00	0.17	0.18	0.12	0.57						
06/10/2024 20:45:00			0.02	0.00	0.17	0.18	0.12	0.58						
06/10/2024 21:00:00			0.02	0.00	0.17	0.18	0.12	0.58						
06/10/2024 21:15:00			0.02	0.00	0.17	0.18	0.12	0.58						
06/10/2024 21:30:00			0.02	0.00	0.18	0.18	0.12	0.58						
06/10/2024 21:45:00			0.02	0.00	0.18	0.18	0.12	0.58						
06/10/2024 22:00:00			0.02	0.01	0.18	0.19	0.12	0.58						
06/10/2024 22:15:00			0.02	0.01	0.18	0.19	0.12	0.58						
06/10/2024 22:30:00			0.02	0.01	0.18	0.19	0.12	0.58						
06/10/2024 22:45:00			0.02	0.01	0.18	0.19	0.12	0.58						
06/10/2024 23:00:00			0.02	0.01	0.18	0.19	0.12	0.58						
06/10/2024 23:15:00			0.02	0.01	0.18	0.19	0.12	0.58						
06/10/2024 23:30:00			0.02	0.01	0.18	0.19	0.12	0.58						
06/10/2024 23:45:00			0.02	0.01	0.18	0.19	0.12	0.57						
07/10/2024 00:00:00			0.02	0.01	0.18	0.18	0.13	0.57						
07/10/2024 00:15:00			0.03	0.01	0.18	0.18	0.13	0.57						
07/10/2024 00:30:00			0.03	0.01	0.18	0.18	0.12	0.56						
07/10/2024 00:45:00			0.03	0.01	0.18	0.18	0.12	0.56						
07/10/2024 01:00:00			0.03	0.01	0.18	0.18	0.12	0.56						
07/10/2024 01:15:00			0.03	0.01	0.18	0.18	0.12	0.56						
07/10/2024 01:30:00			0.03	0.01	0.18	0.18	0.12	0.56						
07/10/2024 01:45:00			0.03	0.01	0.18	0.18	0.12	0.55						
07/10/2024 02:00:00			0.03	0.01	0.18	0.18	0.12	0.55						
07/10/2024 02:15:00			0.03	0.01	0.18	0.18	0.12	0.55						
07/10/2024 02:30:00			0.03	0.01	0.17	0.18	0.12	0.55						
07/10/2024 02:45:00			0.03	0.01	0.17	0.18	0.12	0.55						
07/10/2024 03:00:00			0.03	0.01	0.17	0.18	0.12	0.55						
07/10/2024 03:15:00			0.03	0.01	0.17	0.18	0.12	0.55						
07/10/2024 03:30:00			0.03	0.01	0.17	0.18	0.12	0.54						
07/10/2024 03:45:00			0.03	0.01	0.17	0.18	0.12	0.54						
07/10/2024 04:00:00			0.03	0.01	0.17	0.18	0.12	0.54						
07/10/2024 04:15:00			0.03	0.01	0.17	0.18	0.12	0.54						
07/10/2024 04:30:00			0.02	0.01	0.17	0.18	0.12	0.54						
07/10/2024 04:45:00			0.02	0.01	0.17	0.18	0.11	0.54						
07/10/2024 05:00:00			0.02	0.01	0.17	0.18	0.11	0.54						
07/10/2024 05:15:00			0.02	0.01	0.17	0.18	0.11	0.54						
07/10/2024 05:30:00			0.02	0.01	0.17	0.18	0.11	0.54						
07/10/2024 05:45:00			0.02	0.01	0.17	0.18	0.11	0.54						
07/10/2024 06:00:00			0.02	0.01	0.17	0.18	0.11	0.54						
07/10/2024 06:15:00			0.02	0.01	0.17	0.17	0.11	0.54						
07/10/2024 06:30:00			0.02	0.01	0.17	0.17	0.11	0.54						
07/10/2024 06:45:00			0.02	0.01	0.17	0.17	0.11	0.54						
07/10/2024 07:00:00			0.02	0.01	0.16	0.17	0.11	0.54						
07/10/2024 07:15:00			0.02	0.01	0.16	0.17	0.11	0.54						
07/10/2024 07:30:00			0.02	0.00	0.16	0.17	0.11	0.54						
07/10/2024 07:45:00			0.02	0.00	0.16	0.17	0.11	0.55						
07/10/2024 08:00:00			0.02	0.00	0.16	0.17	0.11	0.55						
07/10/2024 08:15:00			0.02	0.00	0.16	0.17	0.11	0.55						
07/10/2024 08:30:00			0.02	0.00	0.16	0.17	0.11	0.55						
07/10/2024 08:45:00			0.02	0.00	0.16	0.17	0.11	0.56						
07/10/2024 09:00:00			0.02	0.00	0.16	0.17	0.11	0.56						
07/10/2024 09:15:00			0.02	0.00	0.17	0.17	0.11	0.56						
07/10/2024 09:30:00			0.02	0.00	0.17	0.17	0.11	0.56						
07/10/2024 09:45:00			0.02	0.00	0.17	0.17	0.11	0.56						
07/10/2024 10:00:00			0.01	0.00	0.17	0.17	0.11	0.56						
07/10/2024 10:15:00			0.02	0.00	0.17	0.17	0.11	0.56						
07/10/2024 10:30:00			0.01	0.00	0.17	0.17	0.11	0.56						
07/10/2024 10:45:00			0.02	0.00	0.17	0.18	0.11	0.56						
07/10/2024 11:00:00			0.02	0.00	0.17	0.18	0.12	0.56						
07/10/2024 11:15:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 11:30:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 11:45:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 12:00:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 12:15:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 12:30:00			0.02	0.00	0.17	0.18	0.12	0.56						
07/10/2024 12:45:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 13:00:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 13:15:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 13:30:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 13:45:00			0.02	0.00	0.17	0.18	0.12	0.56						
07/10/2024 14:00:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 14:15:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 14:30:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 14:45:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 15:00:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 15:15:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 15:30:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 15:45:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 16:00:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 16:15:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 16:30:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 16:45:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 17:00:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 17:15:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 17:30:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 17:45:00			0.02	0.01	0.17	0.18	0.12	0.56						
07/10/2024 18:00:00			0.02	0.01	0.17	0.18	0.11	0.56						
07/10/2024 18:15:00			0.02	0.01	0.17	0.18	0.11	0.57						
07/10/2024 18:30:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 18:45:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 19:00:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 19:15:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 19:30:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 19:45:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 20:00:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 20:15:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 20:30:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 20:45:00			0.02	0.00	0.17	0.18	0.12	0.57						
07/10/2024 21:00:00			0.02	0.01	0.17	0.18	0.12	0.57						
07/10/2024 21:15:00			0.02	0.01	0.17	0.18	0.12	0.57						
07/10/2024 21:30:00			0.02	0.01	0.17	0.18	0.12	0.57						
07/10/2024 21:45:00			0.02	0.01	0.17	0.18	0.12	0.57						
07/10/2024 22:00:00			0.02	0.00	0.17	0.18	0.12	0.57						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
07/10/2024 22:15:00			0.02	0.01	0.17	0.18	0.12	0.57						
07/10/2024 22:30:00			0.02	0.01	0.17	0.18	0.12	0.59						
07/10/2024 22:45:00			0.02	0.01	0.17	0.18	0.12	0.60						
07/10/2024 23:00:00			0.02	0.01	0.17	0.18	0.12	0.60						
07/10/2024 23:15:00			0.02	0.01	0.17	0.18	0.12	0.60						
07/10/2024 23:30:00			0.02	0.01	0.18	0.19	0.12	0.60						
07/10/2024 23:45:00			0.03	0.01	0.18	0.19	0.13	0.59						
08/10/2024 00:00:00			0.03	0.01	0.19	0.19	0.13	0.63						
08/10/2024 00:15:00			0.03	0.01	0.19	0.19	0.14	0.67						
08/10/2024 00:30:00			0.03	0.01	0.19	0.20	0.14	0.67						
08/10/2024 00:45:00			0.03	0.01	0.19	0.20	0.14	0.66						
08/10/2024 01:00:00			0.04	0.01	0.20	0.20	0.15	0.65						
08/10/2024 01:15:00			0.04	0.01	0.21	0.21	0.15	0.64						
08/10/2024 01:30:00			0.04	0.02	0.21	0.21	0.16	0.63						
08/10/2024 01:45:00			0.04	0.02	0.21	0.21	0.16	0.63						
08/10/2024 02:00:00			0.05	0.02	0.22	0.21	0.17	0.62						
08/10/2024 02:15:00			0.05	0.02	0.22	0.22	0.17	0.62						
08/10/2024 02:30:00			0.05	0.02	0.22	0.22	0.17	0.61						
08/10/2024 02:45:00			0.05	0.02	0.22	0.22	0.17	0.61						
08/10/2024 03:00:00			0.05	0.02	0.22	0.22	0.17	0.60						
08/10/2024 03:15:00			0.05	0.02	0.22	0.22	0.17	0.60						
08/10/2024 03:30:00			0.05	0.02	0.22	0.22	0.17	0.60						
08/10/2024 03:45:00			0.06	0.03	0.22	0.21	0.17	0.60						
08/10/2024 04:00:00			0.06	0.03	0.22	0.21	0.17	0.61						
08/10/2024 04:15:00			0.06	0.03	0.21	0.21	0.16	0.61						
08/10/2024 04:30:00			0.06	0.03	0.21	0.21	0.16	0.61						
08/10/2024 04:45:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 05:00:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 05:15:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 05:30:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 05:45:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 06:00:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 06:15:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 06:30:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 06:45:00			0.05	0.02	0.21	0.21	0.16	0.59						
08/10/2024 07:00:00			0.05	0.02	0.21	0.21	0.16	0.59						
08/10/2024 07:15:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 07:30:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 07:45:00			0.05	0.02	0.21	0.21	0.15	0.60						
08/10/2024 08:00:00			0.04	0.02	0.21	0.21	0.15	0.60						
08/10/2024 08:15:00			0.04	0.02	0.21	0.21	0.15	0.60						
08/10/2024 08:30:00			0.04	0.02	0.21	0.21	0.15	0.60						
08/10/2024 08:45:00			0.04	0.02	0.21	0.21	0.15	0.60						
08/10/2024 09:00:00			0.04	0.02	0.21	0.21	0.15	0.60						
08/10/2024 09:15:00			0.05	0.02	0.21	0.21	0.15	0.60						
08/10/2024 09:30:00			0.04	0.02	0.21	0.21	0.15	0.60						
08/10/2024 09:45:00			0.04	0.02	0.21	0.21	0.15	0.61						
08/10/2024 10:00:00			0.04	0.02	0.21	0.21	0.15	0.61						
08/10/2024 10:15:00			0.04	0.02	0.21	0.21	0.15	0.61						
08/10/2024 10:30:00			0.05	0.02	0.21	0.21	0.15	0.61						
08/10/2024 10:45:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 11:00:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 11:15:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 11:30:00			0.04	0.02	0.21	0.21	0.16	0.60						
08/10/2024 11:45:00			0.05	0.02	0.21	0.21	0.16	0.60						
08/10/2024 12:00:00			0.04	0.02	0.21	0.21	0.16	0.60						
08/10/2024 12:15:00			0.04	0.02	0.21	0.21	0.16	0.60						
08/10/2024 12:30:00			0.04	0.02	0.21	0.21	0.16	0.60						
08/10/2024 12:45:00			0.04	0.02	0.21	0.21	0.16	0.60						
08/10/2024 13:00:00			0.05	0.02	0.21	0.21	0.15	0.60						
08/10/2024 13:15:00			0.04	0.02	0.21	0.21	0.15	0.60						
08/10/2024 13:30:00			0.05	0.02	0.21	0.21	0.15	0.59						
08/10/2024 13:45:00			0.04	0.02	0.21	0.21	0.15	0.59						
08/10/2024 14:00:00			0.05	0.02	0.20	0.21	0.15	0.59						
08/10/2024 14:15:00			0.04	0.02	0.20	0.21	0.15	0.59						
08/10/2024 14:30:00			0.05	0.02	0.20	0.21	0.15	0.59						
08/10/2024 14:45:00			0.05	0.02	0.20	0.20	0.15	0.58						
08/10/2024 15:00:00			0.04	0.02	0.20	0.20	0.15	0.58						
08/10/2024 15:15:00			0.04	0.02	0.20	0.20	0.15	0.58						
08/10/2024 15:30:00			0.04	0.02	0.20	0.20	0.15	0.58						
08/10/2024 15:45:00			0.04	0.02	0.20	0.20	0.15	0.58						
08/10/2024 16:00:00			0.04	0.02	0.20	0.20	0.15	0.58						
08/10/2024 16:15:00	0.73		0.04	0.02	0.20	0.20	0.15	0.58						
08/10/2024 16:30:00			0.04	0.02	0.20	0.20	0.15	0.58						
08/10/2024 16:45:00			0.04	0.02	0.20	0.20	0.14	0.58						
08/10/2024 17:00:00			0.04	0.02	0.20	0.20	0.14	0.58						
08/10/2024 17:15:00	0.73		0.04	0.02	0.20	0.20	0.14	0.58						
08/10/2024 17:30:00	0.73		0.04	0.01	0.19	0.20	0.14	0.59						
08/10/2024 17:45:00	0.73		0.04	0.01	0.19	0.20	0.14	0.59						
08/10/2024 18:00:00	0.73		0.04	0.01	0.19	0.20	0.14	0.59						
08/10/2024 18:15:00	0.73		0.04	0.01	0.19	0.20	0.14	0.59						
08/10/2024 18:30:00	0.73		0.03	0.01	0.19	0.20	0.14	0.59						
08/10/2024 18:45:00	0.73		0.03	0.01	0.19	0.20	0.14	0.59						
08/10/2024 19:00:00	0.73		0.04	0.01	0.19	0.20	0.14	0.59						
08/10/2024 19:15:00	0.73		0.03	0.01	0.19	0.20	0.14	0.59						
08/10/2024 19:30:00	0.73		0.03	0.01	0.19	0.20	0.14	0.59						
08/10/2024 19:45:00	0.73		0.03	0.01	0.19	0.20	0.14	0.59						
08/10/2024 20:00:00	0.73		0.03	0.01	0.19	0.20	0.14	0.59						
08/10/2024 20:15:00	0.73		0.03	0.01	0.19	0.20	0.14	0.59						
08/10/2024 20:30:00	0.72		0.04	0.02	0.20	0.20	0.14	0.59						
08/10/2024 20:45:00			0.04	0.01	0.20	0.20	0.14	0.59						
08/10/2024 21:00:00			0.04	0.01	0.20	0.19	0.14	0.61						
08/10/2024 21:15:00			0.04	0.01	0.20	0.20	0.14	0.62						
08/10/2024 21:30:00			0.04	0.01	0.20	0.20	0.15	0.63						
08/10/2024 21:45:00			0.04	0.01	0.20	0.20	0.15	0.63						
08/10/2024 22:00:00			0.04	0.01	0.20	0.20	0.15	0.63						
08/10/2024 22:15:00			0.04	0.02	0.20	0.20	0.15	0.63						
08/10/2024 22:30:00			0.04	0.02	0.20	0.20	0.15	0.63						
08/10/2024 22:45:00			0.04	0.02	0.21	0.21	0.15	0.62						
08/10/2024 23:00:00			0.04	0.02	0.21	0.21	0.16	0.62						
08/10/2024 23:15:00			0.04	0.02	0.21	0.21	0.16	0.62						
08/10/2024 23:30:00			0.05	0.02	0.21	0.21	0.16	0.62						
08/10/2024 23:45:00			0.05	0.02	0.21	0.21	0.16	0.62						
09/10/2024 00:00:00			0.05	0.02	0.21	0.21	0.16	0.63						
09/10/2024 00:15:00			0.05	0.02	0.22	0.21	0.17	0.63						
09/10/2024 00:30:00			0.05	0.02	0.22	0.22	0.17	0.64						
09/10/2024 00:45:00			0.05	0.02	0.22	0.22	0.17	0.67						
09/10/2024 01:00:00			0.05	0.02	0.22	0.22	0.17	0.69						
09/10/2024 01:15:00			0.06	0.03	0.23	0.22	0.18	0.68						
09/10/2024 01:30:00			0.06	0.03	0.23	0.23	0.18	0.67						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
09/10/2024 01:45:00			0.06	0.03	0.23	0.23	0.19	0.66						
09/10/2024 02:00:00			0.06	0.03	0.24	0.23	0.19	0.65						
09/10/2024 02:15:00			0.06	0.03	0.24	0.23	0.20	0.65						
09/10/2024 02:30:00			0.07	0.03	0.24	0.24	0.20	0.64						
09/10/2024 02:45:00			0.07	0.04	0.24	0.24	0.20	0.64						
09/10/2024 03:00:00			0.07	0.04	0.24	0.24	0.20	0.64						
09/10/2024 03:15:00			0.07	0.04	0.24	0.24	0.20	0.64						
09/10/2024 03:30:00			0.07	0.04	0.24	0.24	0.20	0.64						
09/10/2024 03:45:00			0.07	0.04	0.24	0.24	0.20	0.64						
09/10/2024 04:00:00			0.07	0.04	0.24	0.24	0.20	0.64						
09/10/2024 04:15:00			0.07	0.04	0.24	0.24	0.20	0.63						
09/10/2024 04:30:00			0.07	0.04	0.24	0.24	0.20	0.63						
09/10/2024 04:45:00			0.07	0.04	0.24	0.24	0.20	0.64						
09/10/2024 05:00:00			0.07	0.04	0.24	0.24	0.20	0.64						
09/10/2024 05:15:00			0.07	0.04	0.24	0.24	0.19	0.63						
09/10/2024 05:30:00			0.07	0.03	0.24	0.24	0.19	0.63						
09/10/2024 05:45:00			0.07	0.04	0.24	0.24	0.19	0.63						
09/10/2024 06:00:00			0.07	0.03	0.24	0.24	0.19	0.63						
09/10/2024 06:15:00			0.07	0.03	0.24	0.24	0.19	0.63						
09/10/2024 06:30:00			0.07	0.03	0.24	0.24	0.19	0.63						
09/10/2024 06:45:00			0.07	0.03	0.24	0.23	0.19	0.63						
09/10/2024 07:00:00			0.07	0.03	0.23	0.23	0.19	0.63						
09/10/2024 07:15:00			0.06	0.03	0.23	0.23	0.19	0.63						
09/10/2024 07:30:00			0.06	0.03	0.23	0.23	0.19	0.63						
09/10/2024 07:45:00			0.06	0.03	0.23	0.23	0.19	0.63						
09/10/2024 08:00:00			0.06	0.03	0.23	0.23	0.19	0.63						
09/10/2024 08:15:00			0.06	0.03	0.23	0.23	0.19	0.62						
09/10/2024 08:30:00			0.06	0.03	0.23	0.23	0.18	0.63						
09/10/2024 08:45:00			0.06	0.03	0.23	0.23	0.18	0.63						
09/10/2024 09:00:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 09:15:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 09:30:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 09:45:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 10:00:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 10:15:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 10:30:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 10:45:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 11:00:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 11:15:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 11:30:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 11:45:00			0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 12:00:00			0.06	0.03	0.23	0.23	0.18	0.63						
09/10/2024 12:15:00			0.06	0.03	0.23	0.23	0.18	0.63						
09/10/2024 12:30:00			0.06	0.03	0.23	0.23	0.18	0.63						
09/10/2024 12:45:00			0.06	0.03	0.23	0.23	0.18	0.63						
09/10/2024 13:00:00			0.06	0.03	0.23	0.23	0.18	0.63						
09/10/2024 13:15:00	0.75		0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 13:30:00	0.75		0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 13:45:00	0.75		0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 14:00:00	0.75		0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 14:15:00	0.75		0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 14:30:00	0.75		0.06	0.03	0.23	0.23	0.18	0.62						
09/10/2024 14:45:00	0.75		0.06	0.03	0.22	0.23	0.18	0.62						
09/10/2024 15:00:00	0.75		0.06	0.03	0.22	0.23	0.18	0.62						
09/10/2024 15:15:00			0.06	0.03	0.22	0.22	0.18	0.62						
09/10/2024 15:30:00	0.75		0.06	0.03	0.22	0.22	0.18	0.62						
09/10/2024 15:45:00	0.75		0.06	0.03	0.22	0.22	0.18	0.62						
09/10/2024 16:00:00	0.75		0.06	0.03	0.22	0.22	0.18	0.62						
09/10/2024 16:15:00	0.75		0.06	0.03	0.22	0.22	0.17	0.62						
09/10/2024 16:30:00	0.75		0.06	0.03	0.22	0.22	0.17	0.62						
09/10/2024 16:45:00	0.75		0.06	0.03	0.22	0.22	0.17	0.62						
09/10/2024 17:00:00	0.75		0.06	0.03	0.22	0.22	0.17	0.62						
09/10/2024 17:15:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 17:30:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 17:45:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 18:00:00			0.06	0.03	0.22	0.22	0.17	0.62						
09/10/2024 18:15:00			0.06	0.03	0.22	0.22	0.17	0.62						
09/10/2024 18:30:00			0.06	0.03	0.22	0.22	0.17	0.62						
09/10/2024 18:45:00			0.06	0.03	0.22	0.22	0.17	0.62						
09/10/2024 19:00:00			0.06	0.03	0.22	0.22	0.17	0.62						
09/10/2024 19:15:00			0.06	0.03	0.22	0.22	0.17	0.62						
09/10/2024 19:30:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 19:45:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 20:00:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 20:15:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 20:30:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 20:45:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 21:00:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 21:15:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 21:30:00			0.06	0.03	0.22	0.22	0.17	0.61						
09/10/2024 21:45:00			0.06	0.03	0.22	0.22	0.17	0.60						
09/10/2024 22:00:00			0.06	0.03	0.22	0.22	0.17	0.60						
09/10/2024 22:15:00			0.06	0.03	0.22	0.22	0.17	0.60						
09/10/2024 22:30:00			0.06	0.03	0.22	0.22	0.17	0.60						
09/10/2024 22:45:00			0.06	0.03	0.22	0.22	0.17	0.60						
09/10/2024 23:00:00			0.06	0.03	0.22	0.22	0.17	0.60						
09/10/2024 23:15:00			0.06	0.03	0.22	0.22	0.17	0.60						
09/10/2024 23:30:00			0.06	0.03	0.22	0.21	0.17	0.60						
09/10/2024 23:45:00			0.06	0.03	0.22	0.21	0.17	0.60						
10/10/2024 00:00:00			0.06	0.03	0.22	0.21	0.17	0.59						
10/10/2024 00:15:00			0.06	0.03	0.22	0.22	0.17	0.59						
10/10/2024 00:30:00			0.06	0.03	0.22	0.21	0.17	0.59						
10/10/2024 00:45:00			0.06	0.03	0.21	0.21	0.16	0.59						
10/10/2024 01:00:00			0.06	0.03	0.21	0.21	0.16	0.59						
10/10/2024 01:15:00			0.06	0.03	0.21	0.21	0.16	0.59						
10/10/2024 01:30:00			0.06	0.03	0.21	0.21	0.16	0.59						
10/10/2024 01:45:00			0.06	0.03	0.21	0.21	0.16	0.59						
10/10/2024 02:00:00			0.06	0.03	0.21	0.21	0.16	0.59						
10/10/2024 02:15:00			0.06	0.03	0.21	0.21	0.16	0.58						
10/10/2024 02:30:00			0.06	0.03	0.21	0.21	0.16	0.59						
10/10/2024 02:45:00			0.06	0.03	0.21	0.21	0.16	0.59						
10/10/2024 03:00:00			0.06	0.03	0.21	0.21	0.16	0.59						
10/10/2024 03:15:00			0.06	0.03	0.21	0.21	0.16	0.59						
10/10/2024 03:30:00			0.05	0.02	0.21	0.21	0.16	0.59						
10/10/2024 03:45:00			0.05	0.02	0.21	0.21	0.16	0.59						
10/10/2024 04:00:00			0.05	0.02	0.21	0.21	0.16	0.58						
10/10/2024 04:15:00			0.05	0.02	0.21	0.21	0.16	0.58						
10/10/2024 04:30:00			0.05	0.02	0.21	0.21	0.16	0.57						
10/10/2024 04:45:00			0.05	0.02	0.21	0.21	0.16	0.57						
10/10/2024 05:00:00			0.05	0.02	0.21	0.21	0.16	0.57						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
10/10/2024 05:15:00			0.05	0.02	0.21	0.21	0.16	0.56						
10/10/2024 05:30:00			0.05	0.02	0.21	0.21	0.16	0.56						
10/10/2024 05:45:00			0.05	0.02	0.21	0.21	0.16	0.56						
10/10/2024 06:00:00			0.05	0.02	0.21	0.21	0.15	0.56						
10/10/2024 06:15:00			0.05	0.02	0.21	0.21	0.15	0.56						
10/10/2024 06:30:00			0.05	0.02	0.20	0.20	0.15	0.55						
10/10/2024 06:45:00			0.05	0.02	0.20	0.20	0.15	0.55						
10/10/2024 07:00:00			0.05	0.02	0.20	0.20	0.15	0.55						
10/10/2024 07:15:00			0.05	0.02	0.20	0.20	0.15	0.56						
10/10/2024 07:30:00			0.05	0.02	0.20	0.20	0.15	0.56						
10/10/2024 07:45:00			0.05	0.02	0.20	0.20	0.15	0.56						
10/10/2024 08:00:00			0.05	0.02	0.20	0.20	0.15	0.56						
10/10/2024 08:15:00			0.04	0.02	0.20	0.20	0.15	0.56						
10/10/2024 08:30:00			0.04	0.02	0.20	0.20	0.15	0.56						
10/10/2024 08:45:00			0.04	0.02	0.20	0.20	0.15	0.56						
10/10/2024 09:00:00			0.05	0.02	0.20	0.20	0.15	0.56						
10/10/2024 09:15:00			0.04	0.02	0.20	0.20	0.15	0.56						
10/10/2024 09:30:00			0.04	0.02	0.20	0.20	0.15	0.56						
10/10/2024 09:45:00			0.04	0.02	0.20	0.20	0.15	0.56						
10/10/2024 10:00:00			0.04	0.02	0.20	0.20	0.14	0.56						
10/10/2024 10:15:00			0.04	0.02	0.20	0.20	0.15	0.56						
10/10/2024 10:30:00			0.04	0.02	0.20	0.20	0.15	0.56						
10/10/2024 10:45:00			0.04	0.02	0.20	0.20	0.15	0.56						
10/10/2024 11:00:00			0.05	0.02	0.20	0.20	0.15	0.56						
10/10/2024 11:15:00			0.05	0.02	0.20	0.20	0.14	0.56						
10/10/2024 11:30:00			0.04	0.02	0.20	0.20	0.14	0.56						
10/10/2024 11:45:00			0.04	0.02	0.20	0.20	0.14	0.56						
10/10/2024 12:00:00			0.04	0.02	0.20	0.20	0.14	0.56						
10/10/2024 12:15:00	0.77		0.04	0.02	0.20	0.20	0.14	0.56						
10/10/2024 12:30:00	0.77		0.04	0.02	0.20	0.20	0.14	0.56						
10/10/2024 12:45:00	0.77		0.04	0.01	0.20	0.20	0.14	0.56						
10/10/2024 13:00:00	0.77		0.04	0.02	0.20	0.20	0.14	0.56						
10/10/2024 13:15:00	0.77		0.04	0.02	0.20	0.20	0.14	0.55						
10/10/2024 13:30:00	0.77		0.04	0.02	0.20	0.20	0.14	0.55						
10/10/2024 13:45:00	0.77		0.04	0.02	0.20	0.20	0.14	0.55						
10/10/2024 14:00:00	0.77		0.04	0.02	0.20	0.19	0.14	0.55						
10/10/2024 14:15:00	0.77		0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 14:30:00	0.77		0.04	0.02	0.19	0.19	0.14	0.56						
10/10/2024 14:45:00	0.77		0.04	0.02	0.19	0.19	0.14	0.56						
10/10/2024 15:00:00			0.04	0.01	0.19	0.19	0.14	0.56						
10/10/2024 15:15:00	0.78		0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 15:30:00	0.78		0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 15:45:00	0.78		0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 16:00:00			0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 16:15:00			0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 16:30:00			0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 16:45:00			0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 17:00:00			0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 17:15:00			0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 17:30:00			0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 17:45:00			0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 18:00:00			0.04	0.02	0.19	0.19	0.14	0.55						
10/10/2024 18:15:00	0.78		0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 18:30:00			0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 18:45:00			0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 19:00:00			0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 19:15:00	0.78		0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 19:30:00			0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 19:45:00			0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 20:00:00	0.78		0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 20:15:00			0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 20:30:00	0.78		0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 20:45:00	0.78		0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 21:00:00			0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 21:15:00			0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 21:30:00	0.78		0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 21:45:00	0.78		0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 22:00:00	0.78		0.04	0.01	0.19	0.19	0.14	0.55						
10/10/2024 22:15:00	0.78		0.04	0.01	0.19	0.19	0.14	0.54						
10/10/2024 22:30:00	0.78		0.04	0.01	0.19	0.19	0.14	0.54						
10/10/2024 22:45:00	0.78		0.04	0.01	0.19	0.19	0.14	0.54						
10/10/2024 23:00:00	0.77		0.04	0.01	0.19	0.19	0.14	0.54						
10/10/2024 23:15:00	0.77		0.04	0.01	0.19	0.19	0.14	0.54						
10/10/2024 23:30:00	0.77		0.04	0.01	0.19	0.19	0.14	0.54						
10/10/2024 23:45:00	0.77		0.04	0.01	0.19	0.19	0.14	0.54						
11/10/2024 00:00:00	0.77		0.04	0.01	0.19	0.19	0.14	0.53						
11/10/2024 00:15:00	0.77		0.04	0.01	0.19	0.19	0.14	0.53						
11/10/2024 00:30:00	0.77		0.04	0.01	0.19	0.19	0.14	0.53						
11/10/2024 00:45:00	0.78		0.04	0.01	0.19	0.19	0.13	0.53						
11/10/2024 01:00:00	0.78		0.04	0.01	0.19	0.19	0.13	0.53						
11/10/2024 01:15:00	0.78		0.04	0.01	0.19	0.19	0.13	0.53						
11/10/2024 01:30:00	0.78		0.04	0.01	0.19	0.19	0.13	0.53						
11/10/2024 01:45:00	0.78		0.04	0.01	0.19	0.19	0.13	0.53						
11/10/2024 02:00:00	0.78		0.04	0.01	0.18	0.19	0.13	0.53						
11/10/2024 02:15:00	0.78		0.03	0.01	0.18	0.19	0.13	0.53						
11/10/2024 02:30:00			0.03	0.01	0.18	0.19	0.13	0.53						
11/10/2024 02:45:00			0.03	0.01	0.18	0.18	0.13	0.52						
11/10/2024 03:00:00			0.03	0.01	0.18	0.18	0.13	0.52						
11/10/2024 03:15:00			0.03	0.01	0.18	0.18	0.13	0.52						
11/10/2024 03:30:00			0.03	0.01	0.18	0.18	0.13	0.52						
11/10/2024 03:45:00			0.03	0.01	0.18	0.18	0.13	0.52						
11/10/2024 04:00:00			0.03	0.01	0.18	0.18	0.13	0.52						
11/10/2024 04:15:00			0.03	0.01	0.18	0.18	0.13	0.52						
11/10/2024 04:30:00			0.03	0.01	0.18	0.18	0.13	0.51						
11/10/2024 04:45:00			0.03	0.01	0.18	0.18	0.13	0.51						
11/10/2024 05:00:00			0.03	0.01	0.18	0.18	0.13	0.51						
11/10/2024 05:15:00			0.03	0.01	0.18	0.18	0.12	0.51						
11/10/2024 05:30:00			0.03	0.01	0.18	0.18	0.12	0.51						
11/10/2024 05:45:00			0.03	0.01	0.18	0.18	0.12	0.51						
11/10/2024 06:00:00			0.03	0.01	0.18	0.18	0.12	0.51						
11/10/2024 06:15:00			0.03	0.01	0.18	0.18	0.12	0.51						
11/10/2024 06:30:00			0.03	0.01	0.18	0.18	0.12	0.51						
11/10/2024 06:45:00			0.03	0.01	0.18	0.18	0.12	0.51						
11/10/2024 07:00:00			0.03	0.01	0.18	0.18	0.12	0.51						
11/10/2024 07:15:00			0.03	0.01	0.17	0.18	0.12	0.52						
11/10/2024 07:30:00			0.03	0.01	0.17	0.18	0.12	0.52						
11/10/2024 07:45:00			0.03	0.01	0.17	0.18	0.12	0.52						
11/10/2024 08:00:00			0.02	0.01	0.17	0.18	0.12	0.52						
11/10/2024 08:15:00			0.02	0.01	0.17	0.18	0.12	0.53						
11/10/2024 08:30:00			0.02	0.01	0.17	0.18	0.12	0.53						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
11/10/2024 08:45:00			0.02	0.01	0.17	0.18	0.12	0.53						
11/10/2024 09:00:00			0.02	0.01	0.17	0.18	0.12	0.53						
11/10/2024 09:15:00			0.02	0.01	0.18	0.18	0.12	0.53						
11/10/2024 09:30:00			0.02	0.01	0.18	0.18	0.12	0.53						
11/10/2024 09:45:00			0.02	0.01	0.18	0.18	0.12	0.53						
11/10/2024 10:00:00			0.02	0.01	0.18	0.18	0.12	0.53						
11/10/2024 10:15:00			0.02	0.01	0.18	0.18	0.12	0.53						
11/10/2024 10:30:00			0.02	0.00	0.18	0.18	0.12	0.53						
11/10/2024 10:45:00			0.02	0.00	0.18	0.18	0.12	0.53						
11/10/2024 11:00:00			0.02	0.01	0.18	0.18	0.12	0.53						
11/10/2024 11:15:00			0.02	0.01	0.18	0.18	0.12	0.53						
11/10/2024 11:30:00			0.02	0.01	0.18	0.18	0.12	0.53						
11/10/2024 11:45:00			0.02	0.01	0.18	0.18	0.12	0.53						
11/10/2024 12:00:00			0.02	0.01	0.18	0.18	0.13	0.53						
11/10/2024 12:15:00			0.02	0.01	0.18	0.18	0.13	0.53						
11/10/2024 12:30:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 12:45:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 13:00:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 13:15:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 13:30:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 13:45:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 14:00:00			0.02	0.01	0.18	0.18	0.13	0.54						
11/10/2024 14:15:00			0.02	0.01	0.18	0.18	0.13	0.54						
11/10/2024 14:30:00			0.02	0.01	0.18	0.18	0.13	0.54						
11/10/2024 14:45:00			0.03	0.01	0.18	0.18	0.13	0.54						
11/10/2024 15:00:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 15:15:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 15:30:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 15:45:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 16:00:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 16:15:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 16:30:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 16:45:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 17:00:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 17:15:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 17:30:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 17:45:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 18:00:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 18:15:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 18:30:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 18:45:00			0.03	0.01	0.18	0.18	0.12	0.53						
11/10/2024 19:00:00			0.03	0.01	0.18	0.18	0.12	0.53						
11/10/2024 19:15:00			0.03	0.01	0.18	0.18	0.12	0.53						
11/10/2024 19:30:00			0.03	0.01	0.18	0.18	0.12	0.54						
11/10/2024 19:45:00			0.03	0.01	0.18	0.18	0.12	0.54						
11/10/2024 20:00:00			0.03	0.01	0.18	0.18	0.12	0.54						
11/10/2024 20:15:00			0.03	0.01	0.18	0.18	0.12	0.54						
11/10/2024 20:30:00			0.03	0.01	0.18	0.18	0.12	0.53						
11/10/2024 20:45:00	0.77		0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 21:00:00	0.77		0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 21:15:00	0.77		0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 21:30:00			0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 21:45:00	0.77		0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 22:00:00	0.77		0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 22:15:00	0.77		0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 22:30:00	0.76		0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 22:45:00	0.76		0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 23:00:00	0.76		0.03	0.01	0.18	0.18	0.13	0.53						
11/10/2024 23:15:00	0.76		0.03	0.01	0.18	0.18	0.12	0.53						
11/10/2024 23:30:00	0.76		0.03	0.01	0.18	0.18	0.12	0.52						
11/10/2024 23:45:00	0.76		0.03	0.01	0.18	0.18	0.12	0.52						
12/10/2024 00:00:00	0.75		0.03	0.01	0.18	0.18	0.12	0.52						
12/10/2024 00:15:00	0.75		0.03	0.01	0.18	0.18	0.12	0.52						
12/10/2024 00:30:00			0.03	0.01	0.18	0.18	0.12	0.52						
12/10/2024 00:45:00	0.75		0.03	0.01	0.18	0.18	0.12	0.52						
12/10/2024 01:00:00	0.75		0.03	0.01	0.18	0.18	0.12	0.52						
12/10/2024 01:15:00	0.75		0.02	0.01	0.18	0.18	0.12	0.52						
12/10/2024 01:30:00	0.75		0.02	0.01	0.18	0.18	0.12	0.52						
12/10/2024 01:45:00			0.02	0.01	0.18	0.18	0.12	0.52						
12/10/2024 02:00:00			0.02	0.01	0.18	0.18	0.12	0.52						
12/10/2024 02:15:00			0.02	0.01	0.18	0.18	0.12	0.52						
12/10/2024 02:30:00			0.02	0.01	0.18	0.18	0.12	0.52						
12/10/2024 02:45:00			0.02	0.01	0.18	0.18	0.12	0.52						
12/10/2024 03:00:00			0.02	0.01	0.18	0.18	0.12	0.52						
12/10/2024 03:15:00			0.02	0.01	0.18	0.18	0.12	0.51						
12/10/2024 03:30:00			0.02	0.01	0.18	0.18	0.12	0.51						
12/10/2024 03:45:00			0.02	0.01	0.18	0.18	0.12	0.51						
12/10/2024 04:00:00			0.02	0.01	0.17	0.18	0.12	0.51						
12/10/2024 04:15:00			0.02	0.01	0.17	0.18	0.12	0.51						
12/10/2024 04:30:00			0.02	0.01	0.17	0.18	0.12	0.51						
12/10/2024 04:45:00			0.02	0.01	0.17	0.18	0.12	0.51						
12/10/2024 05:00:00			0.02	0.01	0.17	0.18	0.12	0.51						
12/10/2024 05:15:00			0.02	0.01	0.17	0.17	0.12	0.51						
12/10/2024 05:30:00			0.02	0.01	0.17	0.17	0.12	0.51						
12/10/2024 05:45:00			0.02	0.01	0.17	0.17	0.12	0.51						
12/10/2024 06:00:00			0.02	0.01	0.17	0.17	0.12	0.51						
12/10/2024 06:15:00			0.02	0.00	0.17	0.17	0.12	0.51						
12/10/2024 06:30:00			0.02	0.00	0.17	0.17	0.12	0.51						
12/10/2024 06:45:00			0.02	0.00	0.17	0.17	0.12	0.51						
12/10/2024 07:00:00			0.02	0.01	0.17	0.17	0.12	0.51						
12/10/2024 07:15:00			0.02	0.00	0.17	0.17	0.12	0.51						
12/10/2024 07:30:00			0.02	0.00	0.17	0.17	0.12	0.51						
12/10/2024 07:45:00			0.02	0.00	0.17	0.17	0.12	0.51						
12/10/2024 08:00:00			0.02	0.00	0.17	0.17	0.12	0.51						
12/10/2024 08:15:00			0.02	0.00	0.17	0.17	0.12	0.51						
12/10/2024 08:30:00			0.02	0.00	0.17	0.17	0.12	0.52						
12/10/2024 08:45:00			0.02	0.00	0.17	0.17	0.12	0.52						
12/10/2024 09:00:00			0.02	0.00	0.17	0.17	0.12	0.52						
12/10/2024 09:15:00			0.02	0.00	0.17	0.17	0.12	0.53						
12/10/2024 09:30:00			0.01	0.00	0.17	0.17	0.12	0.54						
12/10/2024 09:45:00			0.02	0.00	0.17	0.17	0.12	0.54						
12/10/2024 10:00:00			0.01	0.00	0.17	0.17	0.12	0.54						
12/10/2024 10:15:00			0.02	0.00	0.17	0.17	0.12	0.54						
12/10/2024 10:30:00			0.02	0.00	0.17	0.17	0.12	0.54						
12/10/2024 10:45:00			0.02	0.00	0.17	0.17	0.12	0.54						
12/10/2024 11:00:00			0.02	0.00	0.17	0.17	0.12	0.54						
12/10/2024 11:15:00			0.02	0.00	0.17	0.17	0.12	0.54						
12/10/2024 11:30:00			0.02	0.00	0.17	0.18	0.12	0.54						
12/10/2024 11:45:00			0.02	0.00	0.18	0.18	0.12	0.54						
12/10/2024 12:00:00			0.02	0.00	0.18	0.18	0.12	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
12/10/2024 12:15:00			0.02	0.00	0.18	0.18	0.12	0.54						
12/10/2024 12:30:00			0.02	0.00	0.18	0.18	0.12	0.54						
12/10/2024 12:45:00			0.02	0.01	0.18	0.18	0.12	0.54						
12/10/2024 13:00:00			0.02	0.01	0.18	0.18	0.12	0.54						
12/10/2024 13:15:00			0.02	0.01	0.18	0.18	0.12	0.54						
12/10/2024 13:30:00			0.02	0.01	0.18	0.18	0.12	0.54						
12/10/2024 13:45:00			0.02	0.01	0.18	0.18	0.12	0.54						
12/10/2024 14:00:00			0.02	0.01	0.18	0.18	0.12	0.54						
12/10/2024 14:15:00			0.02	0.01	0.18	0.18	0.12	0.54						
12/10/2024 14:30:00			0.02	0.01	0.18	0.18	0.12	0.55						
12/10/2024 14:45:00			0.02	0.01	0.18	0.18	0.12	0.55						
12/10/2024 15:00:00			0.02	0.01	0.18	0.18	0.12	0.55						
12/10/2024 15:15:00			0.02	0.01	0.18	0.18	0.12	0.54						
12/10/2024 15:30:00			0.02	0.01	0.18	0.18	0.13	0.54						
12/10/2024 15:45:00			0.02	0.01	0.18	0.18	0.13	0.54						
12/10/2024 16:00:00			0.03	0.01	0.18	0.18	0.13	0.54						
12/10/2024 16:15:00			0.03	0.01	0.18	0.18	0.13	0.54						
12/10/2024 16:30:00			0.03	0.01	0.18	0.18	0.13	0.55						
12/10/2024 16:45:00	0.72		0.03	0.01	0.18	0.18	0.13	0.57						
12/10/2024 17:00:00	0.72		0.03	0.01	0.18	0.18	0.13	0.61						
12/10/2024 17:15:00			0.03	0.01	0.19	0.19	0.13	0.61						
12/10/2024 17:30:00	0.73		0.03	0.01	0.19	0.19	0.13	0.60						
12/10/2024 17:45:00	0.73		0.03	0.01	0.19	0.19	0.14	0.60						
12/10/2024 18:00:00	0.73		0.03	0.01	0.19	0.19	0.14	0.59						
12/10/2024 18:15:00	0.73		0.04	0.01	0.19	0.19	0.14	0.59						
12/10/2024 18:30:00	0.73		0.04	0.01	0.20	0.19	0.14	0.59						
12/10/2024 18:45:00	0.73		0.04	0.02	0.20	0.20	0.15	0.59						
12/10/2024 19:00:00	0.74		0.04	0.02	0.20	0.20	0.15	0.58						
12/10/2024 19:15:00	0.74		0.04	0.02	0.20	0.20	0.15	0.58						
12/10/2024 19:30:00	0.74		0.05	0.02	0.20	0.20	0.15	0.58						
12/10/2024 19:45:00	0.74		0.05	0.02	0.20	0.20	0.15	0.57						
12/10/2024 20:00:00	0.74		0.05	0.02	0.20	0.20	0.15	0.57						
12/10/2024 20:15:00	0.74		0.05	0.02	0.20	0.20	0.15	0.57						
12/10/2024 20:30:00	0.74		0.05	0.02	0.20	0.20	0.15	0.57						
12/10/2024 20:45:00	0.74		0.05	0.02	0.20	0.20	0.15	0.57						
12/10/2024 21:00:00	0.75		0.05	0.02	0.20	0.20	0.15	0.57						
12/10/2024 21:15:00	0.75		0.05	0.02	0.20	0.20	0.15	0.56						
12/10/2024 21:30:00	0.75		0.05	0.02	0.20	0.20	0.15	0.56						
12/10/2024 21:45:00	0.75		0.05	0.02	0.20	0.20	0.15	0.56						
12/10/2024 22:00:00	0.75		0.05	0.02	0.20	0.20	0.15	0.56						
12/10/2024 22:15:00	0.75		0.05	0.02	0.20	0.20	0.15	0.56						
12/10/2024 22:30:00	0.75		0.05	0.02	0.20	0.20	0.15	0.56						
12/10/2024 22:45:00	0.74		0.05	0.02	0.20	0.20	0.15	0.56						
12/10/2024 23:00:00	0.74		0.05	0.02	0.20	0.20	0.15	0.56						
12/10/2024 23:15:00	0.74		0.05	0.02	0.20	0.20	0.15	0.56						
12/10/2024 23:30:00	0.74		0.05	0.02	0.20	0.20	0.15	0.56						
12/10/2024 23:45:00	0.74		0.05	0.02	0.20	0.20	0.15	0.56						
13/10/2024 00:00:00	0.74		0.05	0.02	0.20	0.20	0.15	0.56						
13/10/2024 00:15:00	0.74		0.05	0.02	0.20	0.20	0.15	0.56						
13/10/2024 00:30:00			0.05	0.02	0.20	0.20	0.15	0.55						
13/10/2024 00:45:00	0.74		0.05	0.02	0.20	0.20	0.15	0.55						
13/10/2024 01:00:00	0.74		0.04	0.02	0.20	0.20	0.15	0.55						
13/10/2024 01:15:00	0.74		0.05	0.02	0.20	0.20	0.15	0.55						
13/10/2024 01:30:00	0.74		0.05	0.02	0.20	0.20	0.14	0.55						
13/10/2024 01:45:00	0.73		0.05	0.02	0.20	0.20	0.14	0.55						
13/10/2024 02:00:00	0.73		0.05	0.02	0.20	0.20	0.14	0.55						
13/10/2024 02:15:00			0.05	0.02	0.20	0.20	0.14	0.55						
13/10/2024 02:30:00			0.04	0.02	0.20	0.19	0.14	0.55						
13/10/2024 02:45:00			0.05	0.02	0.20	0.19	0.14	0.55						
13/10/2024 03:00:00			0.05	0.02	0.20	0.19	0.14	0.55						
13/10/2024 03:15:00			0.05	0.02	0.20	0.19	0.14	0.55						
13/10/2024 03:30:00			0.05	0.02	0.19	0.19	0.14	0.55						
13/10/2024 03:45:00			0.05	0.02	0.19	0.19	0.14	0.55						
13/10/2024 04:00:00			0.05	0.02	0.19	0.19	0.14	0.54						
13/10/2024 04:15:00			0.05	0.02	0.19	0.19	0.14	0.54						
13/10/2024 04:30:00			0.04	0.02	0.19	0.19	0.14	0.54						
13/10/2024 04:45:00			0.05	0.02	0.19	0.19	0.14	0.54						
13/10/2024 05:00:00			0.04	0.02	0.19	0.19	0.14	0.54						
13/10/2024 05:15:00			0.04	0.02	0.19	0.19	0.14	0.53						
13/10/2024 05:30:00			0.04	0.02	0.19	0.19	0.14	0.53						
13/10/2024 05:45:00			0.04	0.02	0.19	0.19	0.14	0.53						
13/10/2024 06:00:00			0.04	0.02	0.19	0.19	0.14	0.53						
13/10/2024 06:15:00			0.04	0.02	0.19	0.19	0.14	0.52						
13/10/2024 06:30:00			0.04	0.02	0.19	0.19	0.14	0.52						
13/10/2024 06:45:00			0.04	0.02	0.19	0.19	0.14	0.52						
13/10/2024 07:00:00			0.04	0.02	0.19	0.19	0.13	0.52						
13/10/2024 07:15:00			0.04	0.02	0.19	0.19	0.13	0.52						
13/10/2024 07:30:00			0.04	0.02	0.19	0.19	0.13	0.52						
13/10/2024 07:45:00			0.04	0.02	0.19	0.19	0.13	0.52						
13/10/2024 08:00:00			0.04	0.01	0.19	0.19	0.13	0.52						
13/10/2024 08:15:00			0.04	0.02	0.18	0.19	0.13	0.52						
13/10/2024 08:30:00			0.04	0.01	0.18	0.19	0.13	0.52						
13/10/2024 08:45:00			0.04	0.01	0.18	0.18	0.13	0.52						
13/10/2024 09:00:00			0.03	0.01	0.18	0.18	0.13	0.52						
13/10/2024 09:15:00			0.03	0.01	0.18	0.18	0.13	0.53						
13/10/2024 09:30:00			0.04	0.01	0.18	0.18	0.13	0.53						
13/10/2024 09:45:00			0.03	0.01	0.18	0.18	0.13	0.53						
13/10/2024 10:00:00			0.03	0.01	0.18	0.18	0.13	0.53						
13/10/2024 10:15:00			0.03	0.01	0.18	0.18	0.13	0.53						
13/10/2024 10:30:00			0.03	0.01	0.18	0.18	0.13	0.53						
13/10/2024 10:45:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 11:00:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 11:15:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 11:30:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 11:45:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 12:00:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 12:15:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 12:30:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 12:45:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 13:00:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 13:15:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 13:30:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 13:45:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 14:00:00			0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 14:15:00			0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 14:30:00			0.03	0.01	0.19	0.18	0.13	0.53						
13/10/2024 14:45:00			0.03	0.01	0.19	0.18	0.13	0.53						
13/10/2024 15:00:00			0.03	0.01	0.19	0.18	0.13	0.53						
13/10/2024 15:15:00			0.04	0.01	0.19	0.18	0.13	0.53						
13/10/2024 15:30:00			0.04	0.01	0.19	0.18	0.13	0.53						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
13/10/2024 15:45:00			0.04	0.01	0.19	0.18	0.13	0.53						
13/10/2024 16:00:00			0.04	0.01	0.19	0.18	0.13	0.53						
13/10/2024 16:15:00			0.04	0.01	0.18	0.18	0.13	0.53						
13/10/2024 16:30:00			0.04	0.01	0.18	0.18	0.13	0.54						
13/10/2024 16:45:00			0.04	0.01	0.18	0.18	0.13	0.54						
13/10/2024 17:00:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 17:15:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 17:30:00			0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 17:45:00	0.75		0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 18:00:00	0.75		0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 18:15:00	0.75		0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 18:30:00	0.76		0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 18:45:00	0.76		0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 19:00:00	0.76		0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 19:15:00	0.76		0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 19:30:00	0.76		0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 19:45:00	0.76		0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 20:00:00	0.76		0.03	0.01	0.18	0.18	0.13	0.54						
13/10/2024 20:15:00	0.76		0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 20:30:00	0.76		0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 20:45:00			0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 21:00:00			0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 21:15:00	0.76		0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 21:30:00	0.77		0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 21:45:00	0.77		0.03	0.01	0.19	0.18	0.13	0.54						
13/10/2024 22:00:00	0.77		0.03	0.01	0.19	0.18	0.13	0.53						
13/10/2024 22:15:00	0.77		0.03	0.01	0.19	0.18	0.13	0.53						
13/10/2024 22:30:00	0.77		0.04	0.01	0.19	0.18	0.13	0.53						
13/10/2024 22:45:00	0.77		0.04	0.01	0.19	0.18	0.13	0.53						
13/10/2024 23:00:00	0.77		0.03	0.01	0.18	0.18	0.13	0.53						
13/10/2024 23:15:00	0.77		0.03	0.01	0.18	0.18	0.13	0.53						
13/10/2024 23:30:00	0.77		0.03	0.01	0.18	0.18	0.13	0.53						
13/10/2024 23:45:00	0.77		0.03	0.01	0.18	0.18	0.13	0.53						
14/10/2024 00:00:00	0.77		0.03	0.01	0.18	0.18	0.13	0.52						
14/10/2024 00:15:00	0.77		0.03	0.01	0.18	0.18	0.13	0.52						
14/10/2024 00:30:00	0.77		0.03	0.01	0.18	0.18	0.13	0.52						
14/10/2024 00:45:00	0.77		0.03	0.01	0.18	0.18	0.13	0.52						
14/10/2024 01:00:00	0.76		0.03	0.01	0.18	0.18	0.13	0.52						
14/10/2024 01:15:00	0.76		0.03	0.01	0.18	0.18	0.13	0.52						
14/10/2024 01:30:00	0.76		0.03	0.01	0.18	0.18	0.13	0.52						
14/10/2024 01:45:00	0.76		0.03	0.01	0.18	0.18	0.13	0.52						
14/10/2024 02:00:00	0.76		0.03	0.01	0.18	0.18	0.13	0.51						
14/10/2024 02:15:00	0.75		0.03	0.01	0.18	0.18	0.13	0.51						
14/10/2024 02:30:00	0.75		0.03	0.01	0.18	0.18	0.13	0.51						
14/10/2024 02:45:00	0.75		0.03	0.01	0.18	0.18	0.13	0.51						
14/10/2024 03:00:00	0.75		0.03	0.01	0.18	0.18	0.12	0.51						
14/10/2024 03:15:00	0.74		0.03	0.01	0.18	0.18	0.12	0.51						
14/10/2024 03:30:00	0.74		0.03	0.01	0.18	0.18	0.12	0.51						
14/10/2024 03:45:00	0.74		0.03	0.01	0.18	0.18	0.12	0.51						
14/10/2024 04:00:00	0.74		0.03	0.01	0.18	0.18	0.12	0.51						
14/10/2024 04:15:00	0.74		0.03	0.01	0.18	0.18	0.12	0.51						
14/10/2024 04:30:00	0.74		0.03	0.01	0.18	0.18	0.12	0.51						
14/10/2024 04:45:00	0.74		0.03	0.01	0.17	0.18	0.12	0.51						
14/10/2024 05:00:00	0.74		0.02	0.01	0.17	0.18	0.12	0.51						
14/10/2024 05:15:00	0.74		0.02	0.01	0.17	0.18	0.12	0.51						
14/10/2024 05:30:00	0.74		0.02	0.01	0.17	0.17	0.12	0.52						
14/10/2024 05:45:00	0.74		0.02	0.01	0.17	0.17	0.12	0.52						
14/10/2024 06:00:00	0.75		0.02	0.01	0.17	0.17	0.12	0.52						
14/10/2024 06:15:00	0.75		0.02	0.01	0.17	0.17	0.12	0.52						
14/10/2024 06:30:00	0.75		0.02	0.01	0.17	0.17	0.12	0.52						
14/10/2024 06:45:00	0.75		0.02	0.01	0.17	0.17	0.12	0.51						
14/10/2024 07:00:00	0.75		0.02	0.01	0.17	0.17	0.12	0.52						
14/10/2024 07:15:00	0.75		0.02	0.01	0.17	0.17	0.12	0.52						
14/10/2024 07:30:00	0.75		0.02	0.01	0.17	0.17	0.12	0.52						
14/10/2024 07:45:00	0.75		0.02	0.01	0.17	0.17	0.12	0.52						
14/10/2024 08:00:00	0.76		0.02	0.01	0.17	0.17	0.12	0.52						
14/10/2024 08:15:00	0.76		0.02	0.01	0.17	0.17	0.12	0.53						
14/10/2024 08:30:00	0.76		0.02	0.01	0.17	0.17	0.12	0.53						
14/10/2024 08:45:00	0.76		0.02	0.01	0.17	0.17	0.12	0.53						
14/10/2024 09:00:00	0.76		0.02	0.01	0.17	0.17	0.12	0.53						
14/10/2024 09:15:00	0.76		0.02	0.01	0.17	0.17	0.12	0.53						
14/10/2024 09:30:00	0.76		0.02	0.01	0.17	0.17	0.12	0.53						
14/10/2024 09:45:00	0.76		0.02	0.01	0.17	0.17	0.12	0.54						
14/10/2024 10:00:00	0.77		0.02	0.01	0.17	0.17	0.12	0.54						
14/10/2024 10:15:00	0.77		0.02	0.01	0.17	0.17	0.12	0.54						
14/10/2024 10:30:00			0.02	0.00	0.17	0.17	0.12	0.54						
14/10/2024 10:45:00			0.02	0.00	0.17	0.17	0.12	0.54						
14/10/2024 11:00:00			0.02	0.00	0.18	0.17	0.12	0.54						
14/10/2024 11:15:00	0.76		0.02	0.00	0.18	0.17	0.12	0.54						
14/10/2024 11:30:00			0.02	0.00	0.18	0.17	0.12	0.54						
14/10/2024 11:45:00			0.02	0.00	0.18	0.17	0.12	0.53						
14/10/2024 12:00:00			0.02	0.00	0.18	0.17	0.12	0.53						
14/10/2024 12:15:00			0.02	0.00	0.18	0.17	0.12	0.53						
14/10/2024 12:30:00			0.02	0.00	0.18	0.17	0.12	0.53						
14/10/2024 12:45:00			0.02	0.01	0.18	0.17	0.12	0.53						
14/10/2024 13:00:00			0.02	0.01	0.18	0.17	0.12	0.53						
14/10/2024 13:15:00			0.02	0.01	0.18	0.17	0.12	0.53	0.00					
14/10/2024 13:30:00			0.02	0.00	0.18	0.17	0.12	0.53	0.00					
14/10/2024 13:45:00	0.74		0.02	0.00	0.18	0.17	0.12	0.53	0.00					
14/10/2024 14:00:00	0.74		0.02	0.00	0.18	0.17	0.12	0.53	0.00					
14/10/2024 14:15:00			0.02	0.00	0.18	0.17	0.12	0.53	-0.01					
14/10/2024 14:30:00			0.02	0.01	0.18	0.17	0.12	0.53	-0.01					
14/10/2024 14:45:00	0.73		0.02	0.00	0.18	0.17	0.12	0.53						
14/10/2024 15:00:00	0.73		0.02	0.01	0.18	0.17	0.12	0.53						
14/10/2024 15:15:00	0.72		0.02	0.01	0.18	0.17	0.12	0.53						
14/10/2024 15:30:00	0.73		0.03	0.01	0.18	0.17	0.12	0.53						
14/10/2024 15:45:00	0.73		0.02	0.01	0.18	0.17	0.12	0.53						
14/10/2024 16:00:00	0.72		0.02	0.01	0.18	0.17	0.12	0.53						
14/10/2024 16:15:00	0.72		0.02	0.01	0.18	0.17	0.12	0.53						
14/10/2024 16:30:00	0.72		0.02	0.01	0.18	0.17	0.12	0.53						
14/10/2024 16:45:00	0.71		0.02	0.00	0.17	0.17	0.12	0.53						
14/10/2024 17:00:00	0.71		0.02	0.00	0.17	0.17	0.12	0.53						
14/10/2024 17:15:00	0.71		0.02	0.01	0.17	0.17	0.12	0.54						
14/10/2024 17:30:00	0.71		0.02	0.01	0.17	0.17	0.12	0.54						
14/10/2024 17:45:00	0.71		0.02	0.01	0.17	0.17	0.12	0.54						
14/10/2024 18:00:00	0.70		0.02	0.00	0.17	0.17	0.12	0.54						
14/10/2024 18:15:00	0.70		0.02	0.00	0.17	0.17	0.12	0.54						
14/10/2024 18:30:00	0.70		0.02	0.00	0.17	0.17	0.12	0.54						
14/10/2024 18:45:00	0.71		0.02	0.00	0.17	0.17	0.12	0.54						
14/10/2024 19:00:00	0.71		0.02	0.00	0.18	0.17	0.12	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
14/10/2024 19:15:00	0.71		0.02	0.00	0.18	0.17	0.12	0.54						
14/10/2024 19:30:00	0.71		0.02	0.01	0.18	0.17	0.12	0.54						
14/10/2024 19:45:00	0.71		0.02	0.01	0.18	0.17	0.12	0.54						
14/10/2024 20:00:00	0.71		0.02	0.01	0.18	0.17	0.12	0.54						
14/10/2024 20:15:00	0.71		0.02	0.01	0.18	0.17	0.12	0.54						
14/10/2024 20:30:00	0.71		0.02	0.01	0.18	0.17	0.12	0.54						
14/10/2024 20:45:00	0.72		0.02	0.01	0.18	0.17	0.12	0.54						
14/10/2024 21:00:00	0.72		0.02	0.01	0.18	0.17	0.12	0.54						
14/10/2024 21:15:00	0.72		0.02	0.01	0.18	0.17	0.12	0.54						
14/10/2024 21:30:00	0.73		0.02	0.01	0.18	0.17	0.12	0.54						
14/10/2024 21:45:00	0.73		0.02	0.01	0.18	0.17	0.12	0.54						
14/10/2024 22:00:00	0.73		0.02	0.01	0.18	0.17	0.12	0.53						
14/10/2024 22:15:00	0.73		0.02	0.00	0.18	0.17	0.12	0.53						
14/10/2024 22:30:00	0.74		0.02	0.00	0.18	0.17	0.12	0.53						
14/10/2024 22:45:00	0.74		0.02	0.00	0.18	0.17	0.12	0.53						
14/10/2024 23:00:00	0.74		0.02	0.00	0.18	0.17	0.12	0.53						
14/10/2024 23:15:00	0.74		0.02	0.00	0.18	0.17	0.12	0.53						
14/10/2024 23:30:00	0.74		0.02	0.01	0.18	0.17	0.12	0.53						
14/10/2024 23:45:00	0.75		0.02	0.01	0.18	0.17	0.12	0.53						
15/10/2024 00:00:00	0.75		0.02	0.01	0.18	0.17	0.12	0.52						
15/10/2024 00:15:00	0.75		0.02	0.01	0.18	0.17	0.12	0.52						
15/10/2024 00:30:00	0.75		0.02	0.01	0.18	0.17	0.12	0.52						
15/10/2024 00:45:00	0.74		0.02	0.01	0.18	0.17	0.12	0.52						
15/10/2024 01:00:00	0.74		0.02	0.01	0.18	0.17	0.12	0.52						
15/10/2024 01:15:00	0.74		0.02	0.00	0.18	0.17	0.12	0.52						
15/10/2024 01:30:00	0.74		0.02	0.00	0.17	0.17	0.12	0.52						
15/10/2024 01:45:00	0.74		0.02	0.00	0.17	0.17	0.12	0.52						
15/10/2024 02:00:00	0.73		0.02	0.00	0.17	0.17	0.12	0.51						
15/10/2024 02:15:00	0.73		0.02	0.00	0.17	0.17	0.12	0.51						
15/10/2024 02:30:00	0.73		0.02	0.00	0.17	0.17	0.12	0.51						
15/10/2024 02:45:00	0.72		0.02	0.00	0.17	0.17	0.12	0.51						
15/10/2024 03:00:00	0.72		0.02	0.00	0.17	0.17	0.12	0.51						
15/10/2024 03:15:00	0.72		0.02	0.00	0.17	0.17	0.12	0.51						
15/10/2024 03:30:00	0.71		0.02	0.00	0.17	0.17	0.12	0.51						
15/10/2024 03:45:00	0.71		0.02	0.00	0.17	0.17	0.12	0.51						
15/10/2024 04:00:00	0.71		0.02	0.00	0.17	0.17	0.12	0.51						
15/10/2024 04:15:00	0.71		0.02	0.00	0.17	0.17	0.12	0.51						
15/10/2024 04:30:00	0.70		0.01	0.00	0.17	0.17	0.12	0.51						
15/10/2024 04:45:00	0.70		0.01	0.00	0.17	0.17	0.12	0.51						
15/10/2024 05:00:00	0.70		0.01	0.00	0.17	0.17	0.11	0.51						
15/10/2024 05:15:00	0.70		0.01	0.00	0.17	0.17	0.11	0.51						
15/10/2024 05:30:00	0.70		0.01	0.00	0.17	0.17	0.11	0.51						
15/10/2024 05:45:00	0.70		0.01	0.00	0.17	0.17	0.11	0.51						
15/10/2024 06:00:00	0.70		0.01	0.00	0.17	0.17	0.11	0.51						
15/10/2024 06:15:00	0.71		0.01	0.00	0.17	0.16	0.11	0.51						
15/10/2024 06:30:00	0.71		0.01	0.00	0.17	0.16	0.11	0.52						
15/10/2024 06:45:00	0.71		0.01	0.00	0.17	0.16	0.11	0.52						
15/10/2024 07:00:00	0.72		0.01	0.00	0.17	0.16	0.11	0.52						
15/10/2024 07:15:00	0.72		0.01	0.00	0.17	0.16	0.11	0.52						
15/10/2024 07:30:00	0.72		0.01	0.00	0.17	0.16	0.11	0.52						
15/10/2024 07:45:00	0.73		0.01	0.00	0.17	0.16	0.11	0.53						
15/10/2024 08:00:00	0.73		0.01	0.00	0.17	0.16	0.11	0.53						
15/10/2024 08:15:00	0.73		0.01	0.00	0.17	0.16	0.11	0.53						
15/10/2024 08:30:00	0.73		0.01	0.00	0.17	0.16	0.11	0.53						
15/10/2024 08:45:00	0.74		0.01	0.00	0.17	0.16	0.11	0.53						
15/10/2024 09:00:00	0.74		0.01	0.00	0.17	0.16	0.11	0.53						
15/10/2024 09:15:00	0.74		0.01	0.00	0.17	0.17	0.11	0.53						
15/10/2024 09:30:00	0.74		0.01	0.00	0.17	0.17	0.11	0.53						
15/10/2024 09:45:00			0.01	0.00	0.17	0.17	0.11	0.53						
15/10/2024 10:00:00			0.01	0.00	0.17	0.17	0.11	0.53						
15/10/2024 10:15:00			0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 10:30:00			0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 10:45:00			0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 11:00:00			0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 11:15:00	0.75	0.00	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 11:30:00	0.74	0.00	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 11:45:00	0.74	0.00	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 12:00:00	0.73	0.00	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 12:15:00	0.73	0.00	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 12:30:00	0.72	0.00	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 12:45:00	0.72	0.01	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 13:00:00	0.71	0.01	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 13:15:00	0.71	0.00	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 13:30:00	0.70	0.00	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 13:45:00	0.70	0.01	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 14:00:00	0.69	0.01	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 14:15:00	0.69	0.00	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 14:30:00	0.68	-0.01	0.02	0.00	0.17	0.17	0.12	0.53						
15/10/2024 14:45:00	0.67	0.00	0.02	0.00	0.17	0.17	0.12	0.53						
15/10/2024 15:00:00	0.67	-0.01	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 15:15:00	0.66	0.00	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 15:30:00	0.66	0.02	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 15:45:00	0.66	0.01	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 16:00:00	0.65	0.02	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 16:15:00	0.65	0.03	0.01	0.00	0.17	0.17	0.12	0.53						
15/10/2024 16:30:00	0.64	0.01	0.01	0.00	0.17	0.17	0.12	0.54						
15/10/2024 16:45:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.54						
15/10/2024 17:00:00	0.64	0.02	0.01	0.00	0.17	0.17	0.12	0.54						
15/10/2024 17:15:00	0.63	-0.01	0.02	0.00	0.17	0.17	0.12	0.54						
15/10/2024 17:30:00	0.63	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
15/10/2024 17:45:00	0.63	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
15/10/2024 18:00:00	0.62	0.00	0.02	0.00	0.17	0.17	0.12	0.54						
15/10/2024 18:15:00	0.62	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
15/10/2024 18:30:00	0.62	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
15/10/2024 18:45:00	0.62	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
15/10/2024 19:00:00	0.62	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
15/10/2024 19:15:00	0.62	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
15/10/2024 19:30:00	0.63	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
15/10/2024 19:45:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.54						
15/10/2024 20:00:00	0.64	0.01	0.02	0.00	0.17	0.17	0.12	0.54						
15/10/2024 20:15:00	0.64	0.00	0.02	0.00	0.18	0.17	0.12	0.54						
15/10/2024 20:30:00	0.65		0.02	0.00	0.18	0.17	0.12	0.54						
15/10/2024 20:45:00	0.65	0.00	0.02	0.00	0.18	0.17	0.12	0.54						
15/10/2024 21:00:00	0.66	0.00	0.02	0.00	0.18	0.17	0.12	0.54						
15/10/2024 21:15:00	0.66	0.00	0.02	0.00	0.18	0.17	0.12	0.54						
15/10/2024 21:30:00	0.67	0.00	0.02	0.00	0.18	0.17	0.12	0.54						
15/10/2024 21:45:00	0.68	0.00	0.02	0.00	0.18	0.17	0.12	0.54						
15/10/2024 22:00:00	0.68	0.00	0.02	0.00	0.18	0.17	0.12	0.54						
15/10/2024 22:15:00		0.00	0.02	0.00	0.18	0.17	0.12	0.54						
15/10/2024 22:30:00		0.00	0.02	0.00	0.18	0.17	0.12	0.54						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
15/10/2024 22:45:00		0.00	0.02	0.00	0.18	0.18	0.12	0.54						
15/10/2024 23:00:00	0.70	0.00	0.02	0.00	0.18	0.18	0.12	0.54						
15/10/2024 23:15:00	0.70	0.00	0.02	0.00	0.18	0.18	0.12	0.54						
15/10/2024 23:30:00	0.71	0.00	0.02	0.00	0.18	0.18	0.12	0.54						
15/10/2024 23:45:00	0.71	0.00	0.02	0.00	0.18	0.18	0.12	0.53						
16/10/2024 00:00:00	0.71	0.00	0.02	0.00	0.18	0.18	0.12	0.53						
16/10/2024 00:15:00	0.71	0.00	0.02	0.00	0.18	0.18	0.12	0.53						
16/10/2024 00:30:00	0.70	0.00	0.02	0.00	0.18	0.18	0.12	0.53						
16/10/2024 00:45:00	0.70	0.00	0.02	0.00	0.18	0.18	0.12	0.53						
16/10/2024 01:00:00	0.70	0.00	0.02	0.00	0.18	0.18	0.12	0.53						
16/10/2024 01:15:00	0.69	0.01	0.02	0.00	0.18	0.18	0.12	0.53						
16/10/2024 01:30:00	0.69	0.00	0.02	0.00	0.18	0.17	0.12	0.52						
16/10/2024 01:45:00	0.68	0.00	0.02	0.00	0.18	0.17	0.12	0.52						
16/10/2024 02:00:00	0.68	0.00	0.02	0.00	0.17	0.17	0.12	0.52						
16/10/2024 02:15:00	0.67	0.01	0.02	0.00	0.17	0.17	0.12	0.52						
16/10/2024 02:30:00		0.00	0.02	0.00	0.17	0.17	0.12	0.52						
16/10/2024 02:45:00		0.00	0.02	0.00	0.17	0.17	0.12	0.52						
16/10/2024 03:00:00		0.00	0.02	0.00	0.17	0.17	0.12	0.52						
16/10/2024 03:15:00		0.00	0.02	0.00	0.17	0.17	0.12	0.52						
16/10/2024 03:30:00		0.00	0.02	0.00	0.17	0.17	0.12	0.52						
16/10/2024 03:45:00		0.00	0.02	0.00	0.17	0.17	0.12	0.52						
16/10/2024 04:00:00		0.00	0.02	0.00	0.17	0.17	0.12	0.52						
16/10/2024 04:15:00		0.00	0.01	0.00	0.17	0.17	0.12	0.52						
16/10/2024 04:30:00		0.00	0.02	0.00	0.17	0.17	0.12	0.52						
16/10/2024 04:45:00	0.63	0.02	0.01	0.00	0.17	0.17	0.12	0.52						
16/10/2024 05:00:00	0.63	0.00	0.01	0.00	0.17	0.17	0.12	0.52						
16/10/2024 05:15:00	0.62	0.00	0.01	0.00	0.17	0.17	0.12	0.52						
16/10/2024 05:30:00	0.62	0.00	0.01	0.00	0.17	0.17	0.11	0.52						
16/10/2024 05:45:00	0.62	0.00	0.01	0.00	0.17	0.17	0.11	0.52						
16/10/2024 06:00:00	0.62	-0.01	0.01	0.00	0.17	0.17	0.11	0.52						
16/10/2024 06:15:00	0.62	0.00	0.01	0.00	0.17	0.17	0.11	0.52						
16/10/2024 06:30:00	0.62	0.00	0.01	0.00	0.17	0.17	0.11	0.52						
16/10/2024 06:45:00	0.63	0.00	0.01	0.00	0.17	0.17	0.11	0.53						
16/10/2024 07:00:00	0.63	0.00	0.01	0.00	0.17	0.17	0.11	0.53						
16/10/2024 07:15:00	0.63	0.00	0.01	0.00	0.17	0.17	0.11	0.53						
16/10/2024 07:30:00	0.64	0.00	0.01	0.00	0.17	0.17	0.11	0.53						
16/10/2024 07:45:00	0.64	0.00	0.01	0.00	0.17	0.17	0.11	0.53						
16/10/2024 08:00:00	0.65	0.00	0.01	0.00	0.17	0.17	0.11	0.53						
16/10/2024 08:15:00	0.65	0.01	0.01	0.00	0.17	0.17	0.11	0.54						
16/10/2024 08:30:00	0.66	0.00	0.01	0.00	0.17	0.17	0.11	0.54						
16/10/2024 08:45:00	0.66	0.00	0.01	0.00	0.17	0.17	0.11	0.54						
16/10/2024 09:00:00	0.67	0.00	0.01	0.00	0.17	0.17	0.11	0.54						
16/10/2024 09:15:00		0.00	0.01	0.00	0.17	0.17	0.11	0.54						
16/10/2024 09:30:00		0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 09:45:00	0.68	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 10:00:00	0.69	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 10:15:00	0.69	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 10:30:00	0.70	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 10:45:00	0.70		0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 11:00:00	0.70	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 11:15:00	0.70	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 11:30:00	0.71	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 11:45:00	0.71	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 12:00:00	0.71	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 12:15:00	0.70	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 12:30:00	0.70	0.00	0.02	0.00	0.17	0.17	0.12	0.54						
16/10/2024 12:45:00	0.69	-0.01	0.02	0.00	0.17	0.17	0.12	0.54						
16/10/2024 13:00:00	0.69	0.00	0.02	0.00	0.17	0.17	0.12	0.54						
16/10/2024 13:15:00	0.68	-0.01	0.02	0.00	0.17	0.17	0.12	0.54						
16/10/2024 13:30:00	0.68	0.01	0.02	0.00	0.17	0.17	0.12	0.54						
16/10/2024 13:45:00	0.67		0.02	0.00	0.17	0.17	0.12	0.54						
16/10/2024 14:00:00	0.67	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 14:15:00	0.66	-0.01	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 14:30:00	0.66	0.00	0.01	0.00	0.17	0.17	0.12	0.54						
16/10/2024 14:45:00	0.65	0.02	0.02	0.00	0.18	0.18	0.12	0.54						
16/10/2024 15:00:00	0.65	0.00	0.02	0.00	0.18	0.18	0.12	0.54						
16/10/2024 15:15:00	0.64	0.01	0.02	0.01	0.18	0.18	0.12	0.54						
16/10/2024 15:30:00	0.64	0.00	0.02	0.01	0.18	0.18	0.12	0.54						
16/10/2024 15:45:00	0.63	0.00	0.02	0.00	0.17	0.18	0.12	0.54						
16/10/2024 16:00:00		0.00	0.02	0.00	0.17	0.18	0.12	0.54						
16/10/2024 16:15:00	0.62	0.00	0.02	0.00	0.17	0.18	0.12	0.54						
16/10/2024 16:30:00		0.00	0.02	0.00	0.17	0.18	0.12	0.55						
16/10/2024 16:45:00		0.00	0.02	0.00	0.17	0.18	0.12	0.54						
16/10/2024 17:00:00		0.00	0.02	0.00	0.17	0.18	0.12	0.54						
16/10/2024 17:15:00	0.61	0.01	0.02	0.00	0.17	0.18	0.12	0.54						
16/10/2024 17:30:00	0.61	0.00	0.02	0.00	0.18	0.18	0.12	0.54						
16/10/2024 17:45:00	0.60	0.01	0.02	0.00	0.18	0.18	0.12	0.54						
16/10/2024 18:00:00	0.60	0.00	0.02	0.00	0.18	0.18	0.12	0.54						
16/10/2024 18:15:00	0.60	0.00	0.02	0.00	0.18	0.18	0.12	0.54						
16/10/2024 18:30:00	0.60	0.00	0.02	0.00	0.18	0.18	0.12	0.54						
16/10/2024 18:45:00	0.59	0.03	0.02	0.00	0.18	0.18	0.12	0.55						
16/10/2024 19:00:00	0.59	0.00	0.02	0.00	0.18	0.18	0.12	0.55						
16/10/2024 19:15:00	0.59	0.00	0.02	0.00	0.18	0.18	0.12	0.55						
16/10/2024 19:30:00	0.59	0.00	0.02	0.00	0.18	0.18	0.12	0.55						
16/10/2024 19:45:00	0.59	0.00	0.02	0.00	0.18	0.18	0.12	0.55						
16/10/2024 20:00:00	0.59	0.00	0.02	0.00	0.18	0.18	0.12	0.55						
16/10/2024 20:15:00	0.59	0.00	0.02	0.00	0.18	0.18	0.12	0.55	0.06					
16/10/2024 20:30:00	0.60	0.00	0.02	0.00	0.18	0.18	0.12	0.55	0.06					
16/10/2024 20:45:00	0.60	0.00	0.02	0.00	0.18	0.18	0.12	0.55	0.06					
16/10/2024 21:00:00	0.61	0.00	0.02	0.01	0.18	0.18	0.12	0.55	0.05					
16/10/2024 21:15:00	0.61	0.00	0.02	0.01	0.18	0.18	0.12	0.55	0.05					
16/10/2024 21:30:00	0.62	0.00	0.02	0.01	0.18	0.18	0.12	0.55	0.01					
16/10/2024 21:45:00	0.62	0.02	0.02	0.01	0.18	0.18	0.12	0.55	0.01					
16/10/2024 22:00:00	0.63	0.00	0.02	0.01	0.18	0.18	0.13	0.55	0.02					
16/10/2024 22:15:00	0.63	0.00	0.02	0.01	0.18	0.18	0.13	0.55	0.04					
16/10/2024 22:30:00	0.64	0.04	0.02	0.01	0.18	0.18	0.13	0.55	0.02					
16/10/2024 22:45:00	0.64	0.05	0.02	0.01	0.18	0.18	0.13	0.56	0.06					
16/10/2024 23:00:00	0.65	0.05	0.02	0.01	0.18	0.18	0.13	0.57	0.05					
16/10/2024 23:15:00	0.65	0.00	0.02	0.01	0.18	0.18	0.13	0.58	0.05					
16/10/2024 23:30:00	0.66	0.04	0.02	0.01	0.18	0.18	0.13	0.58	0.04					
16/10/2024 23:45:00	0.66	0.04	0.02	0.01	0.18	0.18	0.13	0.58	0.07					
17/10/2024 00:00:00	0.67	0.04	0.03	0.01	0.18	0.18	0.13	0.58	0.06					
17/10/2024 00:15:00	0.67	-0.02	0.03	0.01	0.19	0.19	0.13	0.59	0.05					
17/10/2024 00:30:00		0.00	0.03	0.01	0.19	0.19	0.14	0.59	0.05					
17/10/2024 00:45:00		0.02	0.03	0.01	0.19	0.19	0.14	0.58	0.05					
17/10/2024 01:00:00	0.69	0.02	0.03	0.01	0.19	0.19	0.14	0.59	0.05					
17/10/2024 01:15:00	0.69	0.04	0.03	0.01	0.20	0.19	0.14	0.59	0.07					
17/10/2024 01:30:00	0.68	0.04	0.03	0.01	0.20	0.20	0.15	0.60	0.07					
17/10/2024 01:45:00	0.68	0.04	0.04	0.01	0.20	0.20	0.15	0.60	0.07					
17/10/2024 02:00:00	0.68	0.07	0.04	0.02	0.20	0.20	0.15	0.60	0.05					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
17/10/2024 02:15:00	0.67	0.01	0.04	0.02	0.21	0.20	0.15	0.60	0.04					
17/10/2024 02:30:00	0.67	0.00	0.05	0.02	0.21	0.20	0.16	0.59	0.06					
17/10/2024 02:45:00	0.67	0.00	0.05	0.02	0.21	0.21	0.16	0.60	0.09					
17/10/2024 03:00:00	0.66	0.00	0.05	0.02	0.21	0.21	0.16	0.61	0.08					
17/10/2024 03:15:00	0.66	0.00	0.05	0.02	0.22	0.21	0.17	0.61	0.09					
17/10/2024 03:30:00	0.66	0.00	0.05	0.02	0.22	0.21	0.17	0.61	0.07					
17/10/2024 03:45:00	0.65	0.00	0.05	0.02	0.22	0.21	0.17	0.61	0.07					
17/10/2024 04:00:00	0.65	0.00	0.05	0.02	0.22	0.21	0.17	0.60	0.07					
17/10/2024 04:15:00	0.64	0.00	0.05	0.02	0.22	0.21	0.17	0.60	0.07					
17/10/2024 04:30:00	0.64	0.00	0.05	0.02	0.22	0.21	0.17	0.59	0.07					
17/10/2024 04:45:00	0.64	0.00	0.06	0.03	0.22	0.21	0.18	0.59	0.06					
17/10/2024 05:00:00	0.63		0.06	0.03	0.22	0.22	0.18	0.58	0.07					
17/10/2024 05:15:00	0.63	0.00	0.06	0.03	0.22	0.22	0.18	0.58	0.07					
17/10/2024 05:30:00	0.63	0.00	0.06	0.03	0.22	0.22	0.18	0.58	0.06					
17/10/2024 05:45:00	0.63	0.00	0.06	0.03	0.22	0.21	0.18	0.58	0.08					
17/10/2024 06:00:00	0.63	0.00	0.06	0.03	0.22	0.21	0.18	0.58	0.06					
17/10/2024 06:15:00	0.63	0.00	0.06	0.03	0.22	0.21	0.17	0.58	0.05					
17/10/2024 06:30:00	0.63	0.00	0.06	0.03	0.22	0.21	0.17	0.58	0.07					
17/10/2024 06:45:00	0.63	0.00	0.06	0.03	0.22	0.21	0.17	0.58	0.07					
17/10/2024 07:00:00	0.63	0.00	0.06	0.03	0.22	0.21	0.17	0.58	0.06					
17/10/2024 07:15:00	0.64	0.00	0.05	0.02	0.22	0.21	0.17	0.58	0.07					
17/10/2024 07:30:00	0.64	0.00	0.05	0.02	0.22	0.21	0.17	0.58	0.06					
17/10/2024 07:45:00	0.65	0.00	0.05	0.02	0.22	0.21	0.17	0.58	0.07					
17/10/2024 08:00:00	0.65	0.00	0.05	0.02	0.22	0.21	0.17	0.58	0.07					
17/10/2024 08:15:00	0.66	0.00	0.05	0.02	0.22	0.21	0.17	0.58	0.06					
17/10/2024 08:30:00	0.66	0.00	0.05	0.02	0.22	0.21	0.17	0.57	0.07					
17/10/2024 08:45:00	0.67	0.00	0.05	0.02	0.22	0.21	0.17	0.57	0.06					
17/10/2024 09:00:00	0.67	0.00	0.05	0.02	0.22	0.21	0.17	0.57	0.06					
17/10/2024 09:15:00	0.67	0.03	0.05	0.02	0.22	0.21	0.17	0.57	0.05					
17/10/2024 09:30:00	0.68	0.00	0.05	0.02	0.22	0.21	0.17	0.57	0.05					
17/10/2024 09:45:00	0.68	0.00	0.05	0.02	0.22	0.21	0.17	0.57	0.06					
17/10/2024 10:00:00	0.69	0.00	0.05	0.02	0.22	0.21	0.17	0.57	0.06					
17/10/2024 10:15:00	0.69	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.07					
17/10/2024 10:30:00	0.70	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.06					
17/10/2024 10:45:00	0.70	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.07					
17/10/2024 11:00:00	0.70	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.07					
17/10/2024 11:15:00	0.71	0.00	0.04	0.02	0.21	0.21	0.16	0.57	0.07					
17/10/2024 11:30:00	0.71	0.00	0.04	0.02	0.21	0.21	0.16	0.57	0.06					
17/10/2024 11:45:00	0.71	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.07					
17/10/2024 12:00:00	0.72	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.07					
17/10/2024 12:15:00	0.72	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.05					
17/10/2024 12:30:00	0.72	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.07					
17/10/2024 12:45:00	0.72	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.07					
17/10/2024 13:00:00	0.72	0.00	0.05	0.02	0.21	0.21	0.16	0.58	0.06					
17/10/2024 13:15:00	0.72	0.00	0.04	0.02	0.21	0.21	0.16	0.58	0.06					
17/10/2024 13:30:00	0.72	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.06					
17/10/2024 13:45:00	0.72	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.06					
17/10/2024 14:00:00	0.71	0.00	0.04	0.02	0.21	0.21	0.16	0.57	0.05					
17/10/2024 14:15:00	0.71	0.00	0.04	0.02	0.21	0.21	0.16	0.57	0.06					
17/10/2024 14:30:00	0.70	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.07					
17/10/2024 14:45:00	0.70	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.06					
17/10/2024 15:00:00	0.69	0.00	0.05	0.02	0.21	0.21	0.16	0.57	0.05					
17/10/2024 15:15:00	0.69	0.00	0.05	0.02	0.21	0.21	0.16	0.56	0.05					
17/10/2024 15:30:00	0.68	0.00	0.05	0.02	0.21	0.21	0.16	0.56	0.05					
17/10/2024 15:45:00	0.68	0.00	0.05	0.02	0.21	0.20	0.16	0.56	0.04					
17/10/2024 16:00:00	0.67	0.00	0.05	0.02	0.21	0.20	0.16	0.56	0.05					
17/10/2024 16:15:00	0.67	0.00	0.05	0.02	0.21	0.20	0.16	0.56	0.04					
17/10/2024 16:30:00	0.67	0.00	0.05	0.02	0.21	0.20	0.16	0.55	0.03					
17/10/2024 16:45:00	0.66	0.00	0.05	0.02	0.21	0.20	0.16	0.55	0.06					
17/10/2024 17:00:00	0.66	0.00	0.05	0.02	0.21	0.20	0.16	0.55	0.05					
17/10/2024 17:15:00	0.65	0.00	0.05	0.02	0.21	0.20	0.16	0.55	0.05					
17/10/2024 17:30:00	0.65	0.00	0.05	0.02	0.21	0.20	0.16	0.55	0.05					
17/10/2024 17:45:00		0.00	0.05	0.02	0.21	0.20	0.16	0.55	0.07					
17/10/2024 18:00:00	0.64	0.00	0.04	0.02	0.21	0.20	0.16	0.55	0.08					
17/10/2024 18:15:00	0.64	0.00	0.04	0.02	0.21	0.20	0.15	0.55	0.05					
17/10/2024 18:30:00		0.00	0.04	0.02	0.21	0.20	0.15	0.55	0.05					
17/10/2024 18:45:00	0.63	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.06					
17/10/2024 19:00:00	0.63	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.06					
17/10/2024 19:15:00	0.63	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.04					
17/10/2024 19:30:00	0.62	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.05					
17/10/2024 19:45:00		0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.06					
17/10/2024 20:00:00	0.62	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.07					
17/10/2024 20:15:00	0.63	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.06					
17/10/2024 20:30:00	0.63	0.00	0.04	0.01	0.20	0.20	0.15	0.55	0.05					
17/10/2024 20:45:00	0.63	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.06					
17/10/2024 21:00:00	0.64	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.05					
17/10/2024 21:15:00	0.64	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.05					
17/10/2024 21:30:00	0.64	0.00	0.04	0.02	0.20	0.20	0.15	0.56	0.07					
17/10/2024 21:45:00	0.65	0.00	0.04	0.02	0.20	0.20	0.15	0.56	0.04					
17/10/2024 22:00:00	0.65	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.04					
17/10/2024 22:15:00	0.66	0.00	0.04	0.02	0.20	0.20	0.15	0.55	0.05					
17/10/2024 22:30:00	0.66	0.00	0.04	0.01	0.20	0.20	0.15	0.55	0.05					
17/10/2024 22:45:00	0.67	0.00	0.04	0.01	0.20	0.20	0.15	0.55	0.04					
17/10/2024 23:00:00	0.67	0.00	0.04	0.01	0.20	0.20	0.15	0.55	0.03					
17/10/2024 23:15:00	0.68	0.00	0.04	0.01	0.20	0.20	0.15	0.54	0.04					
17/10/2024 23:30:00	0.68	0.00	0.04	0.02	0.20	0.19	0.15	0.54	0.05					
17/10/2024 23:45:00	0.68	0.00	0.04	0.01	0.20	0.19	0.15	0.54	0.04					
18/10/2024 00:00:00	0.69	0.00	0.04	0.01	0.20	0.19	0.15	0.54	0.04					
18/10/2024 00:15:00	0.69	0.00	0.04	0.01	0.20	0.19	0.15	0.54	0.03					
18/10/2024 00:30:00	0.70	0.00	0.04	0.01	0.20	0.19	0.15	0.53	0.03					
18/10/2024 00:45:00	0.70	0.00	0.04	0.01	0.20	0.19	0.15	0.53	0.03					
18/10/2024 01:00:00	0.70	0.00	0.04	0.01	0.20	0.19	0.15	0.53	0.03					
18/10/2024 01:15:00	0.71	0.00	0.04	0.01	0.20	0.19	0.15	0.53	0.03					
18/10/2024 01:30:00	0.71	0.00	0.04	0.01	0.20	0.19	0.15	0.53	0.04					
18/10/2024 01:45:00	0.71	0.00	0.04	0.01	0.20	0.19	0.14	0.53	0.04					
18/10/2024 02:00:00		0.00	0.03	0.01	0.20	0.19	0.14	0.53	0.04					
18/10/2024 02:15:00	0.71	0.00	0.03	0.01	0.20	0.19	0.14	0.53	0.04					
18/10/2024 02:30:00	0.71	0.00	0.03	0.01	0.19	0.19	0.14	0.52	0.04					
18/10/2024 02:45:00		0.00	0.04	0.01	0.19	0.19	0.14	0.52	0.05					
18/10/2024 03:00:00	0.70	0.00	0.03	0.01	0.19	0.19	0.14	0.52						
18/10/2024 03:15:00	0.69	0.00	0.03	0.01	0.19	0.19	0.14	0.52						
18/10/2024 03:30:00	0.69	0.00	0.03	0.01	0.19	0.19	0.14	0.52						
18/10/2024 03:45:00	0.68	0.00	0.03	0.01	0.19	0.19	0.14	0.52						
18/10/2024 04:00:00	0.68	0.00	0.03	0.01	0.19	0.19	0.14	0.52						
18/10/2024 04:15:00	0.68	0.00	0.03	0.01	0.19	0.19	0.14	0.52						
18/10/2024 04:30:00	0.67	0.00	0.03	0.01	0.19	0.18	0.14	0.52						
18/10/2024 04:45:00	0.67	0.00	0.03	0.01	0.19	0.18	0.13	0.52						
18/10/2024 05:00:00	0.66	0.00	0.03	0.01	0.19	0.18	0.13	0.52						
18/10/2024 05:15:00	0.66	0.00	0.03	0.01	0.19	0.18	0.13	0.52						
18/10/2024 05:30:00	0.65	0.00	0.03	0.01	0.19	0.18	0.13	0.52						

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
18/10/2024 05:45:00	0.65	0.00	0.03	0.01	0.19	0.18	0.13	0.52						
18/10/2024 06:00:00	0.65	0.00	0.03	0.01	0.19	0.18	0.13	0.52						
18/10/2024 06:15:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.04					
18/10/2024 06:30:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.04					
18/10/2024 06:45:00	0.64	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.04					
18/10/2024 07:00:00	0.64	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.04					
18/10/2024 07:15:00	0.64	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.04					
18/10/2024 07:30:00	0.64	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.04					
18/10/2024 07:45:00	0.65	0.00	0.02	0.01	0.18	0.18	0.13	0.53	0.04					
18/10/2024 08:00:00	0.65	0.00	0.02	0.01	0.18	0.18	0.13	0.53	0.04					
18/10/2024 08:15:00	0.65	0.00	0.02	0.01	0.18	0.18	0.13	0.53	0.04					
18/10/2024 08:30:00	0.66	0.00	0.02	0.01	0.18	0.18	0.13	0.53	0.04					
18/10/2024 08:45:00	0.66	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.04					
18/10/2024 09:00:00	0.67	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.05					
18/10/2024 09:15:00	0.67	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.05					
18/10/2024 09:30:00	0.67	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.04					
18/10/2024 09:45:00		0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.04					
18/10/2024 10:00:00		0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.04					
18/10/2024 10:15:00	0.69	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.04					
18/10/2024 10:30:00	0.69	0.00	0.02	0.00	0.18	0.18	0.13	0.54	0.04					
18/10/2024 10:45:00		0.00	0.02	0.00	0.18	0.18	0.13	0.54	0.04					
18/10/2024 11:00:00		0.00	0.02	0.00	0.19	0.18	0.13	0.54	0.05					
18/10/2024 11:15:00	0.70	0.00	0.02	0.01	0.19	0.18	0.13	0.54	0.04					
18/10/2024 11:30:00	0.70	0.00	0.02	0.01	0.19	0.18	0.13	0.54	0.04					
18/10/2024 11:45:00		0.00	0.02	0.01	0.19	0.18	0.13	0.54	0.05					
18/10/2024 12:00:00		0.00	0.02	0.01	0.19	0.18	0.13	0.54	0.04					
18/10/2024 12:15:00	0.71	0.00	0.02	0.01	0.19	0.18	0.13	0.54	0.04					
18/10/2024 12:30:00	0.71	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.04					
18/10/2024 12:45:00	0.71	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.04					
18/10/2024 13:00:00	0.71	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.04					
18/10/2024 13:15:00	0.71	0.00	0.02	0.01	0.19	0.18	0.13	0.53	0.04					
18/10/2024 13:30:00	0.71	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.04					
18/10/2024 13:45:00	0.71	0.00	0.02	0.01	0.19	0.18	0.13	0.53	0.04					
18/10/2024 14:00:00	0.71	0.00	0.02	0.01	0.19	0.18	0.13	0.53	0.05					
18/10/2024 14:15:00	0.71	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.04					
18/10/2024 14:30:00	0.71	0.00	0.03	0.01	0.19	0.18	0.13	0.52	0.04					
18/10/2024 14:45:00	0.71	0.00	0.03	0.01	0.19	0.18	0.13	0.52	0.04					
18/10/2024 15:00:00		0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.04					
18/10/2024 15:15:00	0.70	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.03					
18/10/2024 15:30:00		0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.02					
18/10/2024 15:45:00	0.69	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.03					
18/10/2024 16:00:00	0.69	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.04					
18/10/2024 16:15:00	0.68	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.04					
18/10/2024 16:30:00	0.67	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.06					
18/10/2024 16:45:00	0.67	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.06					
18/10/2024 17:00:00	0.67	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.05					
18/10/2024 17:15:00	0.66	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.06					
18/10/2024 17:30:00	0.66	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.06					
18/10/2024 17:45:00	0.65	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.05					
18/10/2024 18:00:00	0.65	0.00	0.02	0.01	0.18	0.18	0.13	0.53	0.06					
18/10/2024 18:15:00	0.64	0.00	0.02	0.01	0.18	0.18	0.13	0.53	0.06					
18/10/2024 18:30:00	0.64	0.00	0.02	0.01	0.18	0.18	0.13	0.53	0.05					
18/10/2024 18:45:00	0.64		0.02	0.01	0.18	0.18	0.13	0.53	0.05					
18/10/2024 19:00:00	0.63		0.02	0.01	0.18	0.18	0.13	0.53	0.06					
18/10/2024 19:15:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.54	0.05					
18/10/2024 19:30:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.54	0.05					
18/10/2024 19:45:00	0.62	0.00	0.02	0.01	0.18	0.18	0.13	0.53	0.06					
18/10/2024 20:00:00	0.62	0.05	0.03	0.01	0.18	0.18	0.13	0.54	0.05					
18/10/2024 20:15:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.54	0.05					
18/10/2024 20:30:00	0.62		0.03	0.01	0.18	0.18	0.13	0.53	0.05					
18/10/2024 20:45:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.05					
18/10/2024 21:00:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.04					
18/10/2024 21:15:00	0.62	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
18/10/2024 21:30:00	0.62		0.03	0.01	0.19	0.18	0.13	0.53	0.05					
18/10/2024 21:45:00	0.63		0.03	0.01	0.19	0.18	0.13	0.53	0.05					
18/10/2024 22:00:00	0.63	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
18/10/2024 22:15:00	0.64	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.05					
18/10/2024 22:30:00	0.64	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.06					
18/10/2024 22:45:00	0.64	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
18/10/2024 23:00:00	0.65	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
18/10/2024 23:15:00	0.65	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
18/10/2024 23:30:00	0.66	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
18/10/2024 23:45:00	0.66	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 00:00:00	0.67	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.04					
19/10/2024 00:15:00	0.67	0.00	0.03	0.01	0.19	0.18	0.13	0.52	0.05					
19/10/2024 00:30:00	0.67	0.00	0.03	0.01	0.19	0.18	0.13	0.52	0.06					
19/10/2024 00:45:00	0.68	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.06					
19/10/2024 01:00:00	0.68	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.05					
19/10/2024 01:15:00	0.68	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.04					
19/10/2024 01:30:00	0.69	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.04					
19/10/2024 01:45:00	0.69	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.04					
19/10/2024 02:00:00	0.69	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.03					
19/10/2024 02:15:00	0.69	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.04					
19/10/2024 02:30:00	0.69	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.04					
19/10/2024 02:45:00	0.69	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.05					
19/10/2024 03:00:00	0.69	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.05					
19/10/2024 03:15:00	0.68	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.05					
19/10/2024 03:30:00	0.68		0.02	0.01	0.18	0.18	0.13	0.51						
19/10/2024 03:45:00	0.68	0.00	0.02	0.01	0.18	0.18	0.13	0.51						
19/10/2024 04:00:00	0.67	0.00	0.02	0.01	0.18	0.18	0.13	0.51						
19/10/2024 04:15:00	0.67	0.00	0.02	0.01	0.18	0.18	0.13	0.51						
19/10/2024 04:30:00	0.66	0.00	0.02	0.01	0.18	0.18	0.12	0.51						
19/10/2024 04:45:00	0.66	0.00	0.02	0.01	0.18	0.18	0.12	0.51						
19/10/2024 05:00:00	0.65	0.00	0.02	0.00	0.18	0.18	0.12	0.50						
19/10/2024 05:15:00	0.65	0.03	0.02	0.01	0.18	0.18	0.12	0.50						
19/10/2024 05:30:00	0.65	0.00	0.02	0.01	0.18	0.18	0.12	0.50						
19/10/2024 05:45:00	0.64	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.05					
19/10/2024 06:00:00	0.64	0.00	0.02	0.01	0.18	0.17	0.12	0.50	0.03					
19/10/2024 06:15:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.50	0.04					
19/10/2024 06:30:00	0.63	0.05	0.02	0.00	0.17	0.17	0.12	0.50	0.06					
19/10/2024 06:45:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.50	0.05					
19/10/2024 07:00:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.50	0.04					
19/10/2024 07:15:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.05					
19/10/2024 07:30:00	0.62	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.06					
19/10/2024 07:45:00	0.62	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.05					
19/10/2024 08:00:00	0.62	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.04					
19/10/2024 08:15:00	0.62	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.05					
19/10/2024 08:30:00	0.62	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.05					
19/10/2024 08:45:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.05					
19/10/2024 09:00:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.05					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
19/10/2024 09:15:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.04					
19/10/2024 09:30:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.53	0.04					
19/10/2024 09:45:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.53	0.05					
19/10/2024 10:00:00	0.65	0.02	0.02	0.00	0.17	0.17	0.12	0.53	0.05					
19/10/2024 10:15:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.06					
19/10/2024 10:30:00	0.65	0.03	0.02	0.00	0.17	0.17	0.12	0.53	0.05					
19/10/2024 10:45:00	0.66	0.00	0.02	0.00	0.18	0.17	0.12	0.54	0.05					
19/10/2024 11:00:00	0.66	0.00	0.02	0.00	0.18	0.17	0.12	0.54	0.05					
19/10/2024 11:15:00	0.67	0.00	0.02	0.00	0.18	0.18	0.12	0.55	0.07					
19/10/2024 11:30:00	0.67	0.00	0.02	0.00	0.18	0.18	0.12	0.55	0.06					
19/10/2024 11:45:00	0.67	0.00	0.02	0.00	0.18	0.18	0.12	0.55	0.07					
19/10/2024 12:00:00	0.68	0.00	0.02	0.00	0.18	0.18	0.12	0.55	0.06					
19/10/2024 12:15:00	0.68	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.07					
19/10/2024 12:30:00	0.68	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.06					
19/10/2024 12:45:00	0.69	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.06					
19/10/2024 13:00:00	0.69	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.04					
19/10/2024 13:15:00	0.69	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.06					
19/10/2024 13:30:00	0.70	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.06					
19/10/2024 13:45:00	0.70	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.05					
19/10/2024 14:00:00	0.70	0.00	0.03	0.01	0.18	0.18	0.13	0.54	0.06					
19/10/2024 14:15:00	0.70	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.06					
19/10/2024 14:30:00	0.70	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.06					
19/10/2024 14:45:00	0.71	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.06					
19/10/2024 15:00:00	0.70	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.06					
19/10/2024 15:15:00	0.70	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.06					
19/10/2024 15:30:00	0.70	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.05					
19/10/2024 15:45:00	0.69	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.05					
19/10/2024 16:00:00	0.69	0.00	0.03	0.01	0.19	0.18	0.13	0.54	0.06					
19/10/2024 16:15:00	0.68	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
19/10/2024 16:30:00	0.68	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 16:45:00	0.67	0.00	0.04	0.01	0.19	0.18	0.13	0.53	0.06					
19/10/2024 17:00:00	0.67	0.00	0.04	0.01	0.19	0.18	0.13	0.53	0.06					
19/10/2024 17:15:00	0.66	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 17:30:00	0.66	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 17:45:00	0.66	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 18:00:00	0.65	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 18:15:00	0.65	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 18:30:00	0.64	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
19/10/2024 18:45:00	0.64	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
19/10/2024 19:00:00	0.63	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 19:15:00	0.63	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
19/10/2024 19:30:00	0.63	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 19:45:00	0.62	0.06	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
19/10/2024 20:00:00	0.62	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 20:15:00	0.62	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.05					
19/10/2024 20:30:00	0.62	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
19/10/2024 20:45:00	0.62	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
19/10/2024 21:00:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.05					
19/10/2024 21:15:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.05					
19/10/2024 21:30:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.07					
19/10/2024 21:45:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.05					
19/10/2024 22:00:00	0.63	0.03	0.03	0.01	0.18	0.18	0.13	0.52	0.06					
19/10/2024 22:15:00		0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.06					
19/10/2024 22:30:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.06					
19/10/2024 22:45:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.06					
19/10/2024 23:00:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.06					
19/10/2024 23:15:00	0.65	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.06					
19/10/2024 23:30:00	0.65	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.06					
19/10/2024 23:45:00	0.66	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.05					
20/10/2024 00:00:00	0.66	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.06					
20/10/2024 00:15:00	0.66	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.06					
20/10/2024 00:30:00	0.67	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.05					
20/10/2024 00:45:00	0.67	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.05					
20/10/2024 01:00:00	0.67	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.05					
20/10/2024 01:15:00	0.68	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.05					
20/10/2024 01:30:00	0.68	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.05					
20/10/2024 01:45:00	0.68	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.05					
20/10/2024 02:00:00	0.68	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.05					
20/10/2024 02:15:00	0.69	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.05					
20/10/2024 02:30:00	0.69	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.06					
20/10/2024 02:45:00	0.69	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.04					
20/10/2024 03:00:00	0.70	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.05					
20/10/2024 03:15:00	0.70	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.05					
20/10/2024 03:30:00	0.70	0.00	0.02	0.01	0.18	0.18	0.13	0.50	0.05					
20/10/2024 03:45:00	0.69	0.05	0.02	0.01	0.18	0.18	0.13	0.50	0.05					
20/10/2024 04:00:00	0.69	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.05					
20/10/2024 04:15:00	0.69	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.05					
20/10/2024 04:30:00	0.68	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.05					
20/10/2024 04:45:00	0.68	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.05					
20/10/2024 05:00:00	0.67	0.04	0.02	0.00	0.18	0.18	0.12	0.50	0.05					
20/10/2024 05:15:00	0.67	0.00	0.02	0.00	0.18	0.18	0.12	0.50	0.04					
20/10/2024 05:30:00	0.66	0.03	0.02	0.00	0.18	0.18	0.12	0.50	0.04					
20/10/2024 05:45:00	0.66	0.00	0.02	0.00	0.18	0.17	0.12	0.50	0.04					
20/10/2024 06:00:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.04					
20/10/2024 06:15:00	0.65	0.04	0.02	0.01	0.17	0.17	0.12	0.50	0.04					
20/10/2024 06:30:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.04					
20/10/2024 06:45:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.04					
20/10/2024 07:00:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.04					
20/10/2024 07:15:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.05					
20/10/2024 07:30:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.04					
20/10/2024 07:45:00	0.63	0.03	0.02	0.00	0.17	0.17	0.12	0.50	0.05					
20/10/2024 08:00:00	0.62	0.00	0.01	0.00	0.17	0.17	0.12	0.51	0.05					
20/10/2024 08:15:00	0.62	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.05					
20/10/2024 08:30:00	0.62	-0.01	0.01	0.00	0.17	0.17	0.12	0.51	0.05					
20/10/2024 08:45:00	0.62	0.00	0.01	0.00	0.17	0.17	0.12	0.51	0.05					
20/10/2024 09:00:00	0.62	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.05					
20/10/2024 09:15:00	0.63	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.07					
20/10/2024 09:30:00	0.63	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.06					
20/10/2024 09:45:00	0.63	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.06					
20/10/2024 10:00:00	0.64	0.00	0.01	0.00	0.17	0.17	0.12	0.53	0.07					
20/10/2024 10:15:00	0.64	0.00	0.01	0.00	0.17	0.17	0.12	0.53	0.07					
20/10/2024 10:30:00	0.64	0.00	0.01	0.00	0.17	0.17	0.12	0.53	0.06					
20/10/2024 10:45:00	0.65	0.00	0.01	0.00	0.17	0.17	0.12	0.53	0.07					
20/10/2024 11:00:00	0.65	0.00	0.01	0.00	0.17	0.17	0.12	0.53	0.06					
20/10/2024 11:15:00	0.66	0.01	0.02	0.00	0.17	0.17	0.12	0.53	0.06					
20/10/2024 11:30:00	0.66	0.00	0.02	0.00	0.18	0.17	0.12	0.53	0.08					
20/10/2024 11:45:00	0.66	0.00	0.02	0.00	0.18	0.18	0.12	0.54	0.07					
20/10/2024 12:00:00	0.67	0.00	0.02	0.00	0.18	0.18	0.12	0.54	0.07					
20/10/2024 12:15:00	0.67		0.02	0.00	0.18	0.18	0.12	0.54	0.06					
20/10/2024 12:30:00	0.67	0.00	0.02	0.00	0.18	0.18	0.12	0.54	0.03					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
20/10/2024 12:45:00	0.68	0.02	0.02	0.00	0.18	0.18	0.12	0.54	0.06					
20/10/2024 13:00:00	0.68	0.00	0.02	0.00	0.18	0.18	0.13	0.54	0.07					
20/10/2024 13:15:00	0.68	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.07					
20/10/2024 13:30:00	0.69	0.01	0.02	0.01	0.18	0.18	0.13	0.54	0.08					
20/10/2024 13:45:00	0.69	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.09					
20/10/2024 14:00:00	0.69	0.01	0.02	0.01	0.18	0.18	0.13	0.54	0.07					
20/10/2024 14:15:00	0.70	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.07					
20/10/2024 14:30:00	0.70	-0.01	0.03	0.01	0.18	0.18	0.13	0.54	0.07					
20/10/2024 14:45:00	0.70	0.01	0.03	0.01	0.18	0.18	0.13	0.54	0.07					
20/10/2024 15:00:00	0.70	0.01	0.03	0.01	0.18	0.18	0.13	0.54	0.06					
20/10/2024 15:15:00	0.70	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.07					
20/10/2024 15:30:00	0.69	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.05					
20/10/2024 15:45:00	0.69	0.01	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
20/10/2024 16:00:00	0.69	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
20/10/2024 16:15:00	0.68	0.00	0.03	0.01	0.19	0.18	0.13	0.53	0.06					
20/10/2024 16:30:00	0.68	-0.02	0.03	0.01	0.19	0.18	0.13	0.53	0.07					
20/10/2024 16:45:00	0.67	0.00	0.03	0.01	0.19	0.18	0.13	0.55	0.08					
20/10/2024 17:00:00	0.67	0.00	0.03	0.01	0.19	0.18	0.13	0.55	0.07					
20/10/2024 17:15:00	0.66	0.00	0.03	0.01	0.19	0.18	0.13	0.56	0.08					
20/10/2024 17:30:00	0.66	0.00	0.04	0.01	0.19	0.18	0.13	0.55	0.09					
20/10/2024 17:45:00	0.65	0.00	0.04	0.01	0.19	0.18	0.13	0.55	0.07					
20/10/2024 18:00:00	0.65	-0.02	0.03	0.01	0.19	0.19	0.13	0.55	0.07					
20/10/2024 18:15:00	0.64	0.00	0.04	0.01	0.19	0.19	0.14	0.55	0.08					
20/10/2024 18:30:00	0.64	0.00	0.03	0.01	0.19	0.19	0.14	0.55	0.08					
20/10/2024 18:45:00	0.63	0.00	0.04	0.01	0.19	0.19	0.14	0.55	0.08					
20/10/2024 19:00:00	0.63	-0.02	0.04	0.01	0.19	0.19	0.14	0.55	0.07					
20/10/2024 19:15:00	0.63	0.00	0.04	0.01	0.19	0.19	0.14	0.55	0.07					
20/10/2024 19:30:00	0.62	0.00	0.04	0.01	0.19	0.19	0.14	0.55	0.07					
20/10/2024 19:45:00	0.62	0.01	0.04	0.01	0.19	0.19	0.14	0.55	0.07					
20/10/2024 20:00:00	0.61	0.00	0.04	0.02	0.19	0.19	0.14	0.55	0.08					
20/10/2024 20:15:00	0.61	0.00	0.04	0.02	0.19	0.19	0.14	0.54	0.08					
20/10/2024 20:30:00	0.61	0.00	0.04	0.02	0.19	0.19	0.14	0.54	0.07					
20/10/2024 20:45:00	0.60	-0.01	0.04	0.02	0.19	0.19	0.14	0.54	0.07					
20/10/2024 21:00:00	0.60	0.00	0.04	0.02	0.19	0.19	0.14	0.55	0.07					
20/10/2024 21:15:00	0.60	0.00	0.04	0.02	0.19	0.19	0.14	0.55	0.07					
20/10/2024 21:30:00	0.60	0.00	0.04	0.02	0.19	0.19	0.14	0.54	0.07					
20/10/2024 21:45:00	0.59	-0.01	0.04	0.02	0.19	0.19	0.14	0.54	0.07					
20/10/2024 22:00:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.54	0.07					
20/10/2024 22:15:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.54	0.07					
20/10/2024 22:30:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.07					
20/10/2024 22:45:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.06					
20/10/2024 23:00:00	0.59	-0.01	0.04	0.02	0.19	0.19	0.14	0.53	0.06					
20/10/2024 23:15:00	0.58	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.07					
20/10/2024 23:30:00	0.59	-0.01	0.04	0.02	0.19	0.19	0.14	0.53	0.06					
20/10/2024 23:45:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.52	0.07					
21/10/2024 00:00:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.52	0.06					
21/10/2024 00:15:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.52	0.06					
21/10/2024 00:30:00	0.60	0.00	0.04	0.01	0.19	0.19	0.14	0.52	0.07					
21/10/2024 00:45:00	0.60	0.00	0.04	0.01	0.19	0.19	0.14	0.52	0.06					
21/10/2024 01:00:00	0.60	0.00	0.04	0.01	0.19	0.19	0.14	0.52	0.06					
21/10/2024 01:15:00	0.61	0.00	0.04	0.01	0.19	0.19	0.14	0.51	0.07					
21/10/2024 01:30:00	0.61	0.00	0.04	0.01	0.19	0.19	0.14	0.51	0.06					
21/10/2024 01:45:00	0.62	0.00	0.04	0.01	0.19	0.19	0.13	0.51	0.06					
21/10/2024 02:00:00	0.62	0.00	0.03	0.01	0.19	0.18	0.13	0.51	0.06					
21/10/2024 02:15:00	0.62	0.00	0.04	0.01	0.19	0.18	0.13	0.51	0.05					
21/10/2024 02:30:00	0.63	0.00	0.03	0.01	0.19	0.18	0.13	0.51	0.05					
21/10/2024 02:45:00	0.63	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.06					
21/10/2024 03:00:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.06					
21/10/2024 03:15:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.07					
21/10/2024 03:30:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.05					
21/10/2024 03:45:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.04					
21/10/2024 04:00:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.05					
21/10/2024 04:15:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.05					
21/10/2024 04:30:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.06					
21/10/2024 04:45:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.05					
21/10/2024 05:00:00	0.61	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.04					
21/10/2024 05:15:00	0.61	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.05					
21/10/2024 05:30:00	0.61	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.05					
21/10/2024 05:45:00	0.60	-0.02	0.03	0.01	0.18	0.18	0.12	0.50	0.06					
21/10/2024 06:00:00	0.60	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.06					
21/10/2024 06:15:00	0.60	-0.01	0.03	0.01	0.18	0.17	0.12	0.50	0.06					
21/10/2024 06:30:00	0.59	0.00	0.02	0.01	0.18	0.17	0.12	0.50	0.05					
21/10/2024 06:45:00	0.59	-0.02	0.03	0.01	0.18	0.17	0.12	0.50	0.06					
21/10/2024 07:00:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
21/10/2024 07:15:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
21/10/2024 07:30:00	0.58	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.06					
21/10/2024 07:45:00	0.58	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.05					
21/10/2024 08:00:00	0.58	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.06					
21/10/2024 08:15:00	0.57	-0.01	0.02	0.01	0.17	0.17	0.12	0.51	0.07					
21/10/2024 08:30:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.06					
21/10/2024 08:45:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.06					
21/10/2024 09:00:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.06					
21/10/2024 09:15:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.06					
21/10/2024 09:30:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.08					
21/10/2024 09:45:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.08					
21/10/2024 10:00:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.07					
21/10/2024 10:15:00	0.57	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.07					
21/10/2024 10:30:00	0.57	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.08					
21/10/2024 10:45:00	0.57	0.00	0.02	0.01	0.18	0.17	0.12	0.53	0.07					
21/10/2024 11:00:00	0.57	0.00	0.02	0.01	0.18	0.17	0.12	0.53	0.08					
21/10/2024 11:15:00	0.58	0.00	0.02	0.01	0.18	0.17	0.12	0.53	0.06					
21/10/2024 11:30:00	0.58	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.07					
21/10/2024 11:45:00	0.58	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.07					
21/10/2024 12:00:00	0.59	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.06					
21/10/2024 12:15:00	0.59	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.06					
21/10/2024 12:30:00	0.59	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.06					
21/10/2024 12:45:00	0.60	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.07					
21/10/2024 13:00:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.06					
21/10/2024 13:15:00	0.61	0.00	0.03	0.01	0.18	0.17	0.13	0.52	0.07					
21/10/2024 13:30:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.06					
21/10/2024 13:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.06					
21/10/2024 14:00:00	0.62	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.06					
21/10/2024 14:15:00	0.62	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.06					
21/10/2024 14:30:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.06					
21/10/2024 14:45:00	0.63	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.05					
21/10/2024 15:00:00	0.63		0.02	0.01	0.18	0.18	0.13	0.51	0.07					
21/10/2024 15:15:00	0.63	0.00	0.02	0.01	0.18	0.18	0.12	0.51	0.07					
21/10/2024 15:30:00	0.64	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.06					
21/10/2024 15:45:00	0.64	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.06					
21/10/2024 16:00:00	0.64	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.05					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
21/10/2024 16:15:00	0.65	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.06					
21/10/2024 16:30:00	0.65	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.05					
21/10/2024 16:45:00	0.65	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.07					
21/10/2024 17:00:00	0.65	0.00	0.02	0.01	0.18	0.18	0.12	0.51	0.06					
21/10/2024 17:15:00	0.66	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
21/10/2024 17:30:00	0.66	0.00	0.02	0.01	0.18	0.18	0.12	0.51	0.08					
21/10/2024 17:45:00	0.65	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.07					
21/10/2024 18:00:00	0.65	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.08					
21/10/2024 18:15:00	0.65	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.09					
21/10/2024 18:30:00	0.64	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.09					
21/10/2024 18:45:00	0.64	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.08					
21/10/2024 19:00:00	0.63	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.08					
21/10/2024 19:15:00	0.63	0.00	0.02	0.01	0.18	0.17	0.12	0.53	0.08					
21/10/2024 19:30:00	0.63	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.08					
21/10/2024 19:45:00	0.62	-0.01	0.02	0.01	0.18	0.18	0.12	0.53	0.08					
21/10/2024 20:00:00	0.62	0.00	0.03	0.01	0.18	0.18	0.12	0.53	0.08					
21/10/2024 20:15:00	0.61	0.00	0.02	0.01	0.18	0.18	0.12	0.53	0.08					
21/10/2024 20:30:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.07					
21/10/2024 20:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
21/10/2024 21:00:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
21/10/2024 21:15:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
21/10/2024 21:30:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
21/10/2024 21:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.09					
21/10/2024 22:00:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
21/10/2024 22:15:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
21/10/2024 22:30:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
21/10/2024 22:45:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
21/10/2024 23:00:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
21/10/2024 23:15:00	0.63		0.03	0.01	0.18	0.18	0.13	0.52	0.08					
21/10/2024 23:30:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
21/10/2024 23:45:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
22/10/2024 00:00:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
22/10/2024 00:15:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
22/10/2024 00:30:00	0.65	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
22/10/2024 00:45:00	0.65	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
22/10/2024 01:00:00	0.65	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.08					
22/10/2024 01:15:00	0.65	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.07					
22/10/2024 01:30:00	0.66	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.07					
22/10/2024 01:45:00	0.66	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.06					
22/10/2024 02:00:00	0.66	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.06					
22/10/2024 02:15:00	0.66	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.07					
22/10/2024 02:30:00	0.67	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.06					
22/10/2024 02:45:00	0.67	0.00	0.03	0.01	0.18	0.17	0.12	0.49	0.06					
22/10/2024 03:00:00	0.67	0.00	0.03	0.01	0.18	0.17	0.12	0.49	0.05					
22/10/2024 03:15:00	0.67	0.00	0.03	0.01	0.18	0.17	0.12	0.49	0.08					
22/10/2024 03:30:00	0.67	0.00	0.03	0.01	0.18	0.17	0.12	0.49	0.08					
22/10/2024 03:45:00	0.68	0.00	0.03	0.01	0.18	0.17	0.12	0.49	0.07					
22/10/2024 04:00:00	0.68	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
22/10/2024 04:15:00	0.68	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
22/10/2024 04:30:00	0.68	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
22/10/2024 04:45:00	0.68	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
22/10/2024 05:00:00	0.67	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
22/10/2024 05:15:00	0.67	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.06					
22/10/2024 05:30:00	0.67	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
22/10/2024 05:45:00	0.66	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
22/10/2024 06:00:00	0.66	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.06					
22/10/2024 06:15:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
22/10/2024 06:30:00	0.65	-0.02	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
22/10/2024 06:45:00	0.64	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
22/10/2024 07:00:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
22/10/2024 07:15:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
22/10/2024 07:30:00	0.62	-0.02	0.02	0.00	0.17	0.17	0.11	0.50	0.09					
22/10/2024 07:45:00	0.62	0.00	0.02	0.00	0.17	0.17	0.11	0.50	0.07					
22/10/2024 08:00:00	0.61	0.00	0.02	0.00	0.17	0.17	0.11	0.50	0.08					
22/10/2024 08:15:00	0.61	0.00	0.02	0.00	0.17	0.17	0.11	0.51	0.08					
22/10/2024 08:30:00	0.61	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.08					
22/10/2024 08:45:00	0.60	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.08					
22/10/2024 09:00:00	0.60	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.09					
22/10/2024 09:15:00	0.59	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.09					
22/10/2024 09:30:00	0.59	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.09					
22/10/2024 09:45:00	0.59	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.08					
22/10/2024 10:00:00	0.58	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.09					
22/10/2024 10:15:00	0.58	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.08					
22/10/2024 10:30:00	0.58	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.09					
22/10/2024 10:45:00	0.58	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.07					
22/10/2024 11:00:00	0.58	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.08					
22/10/2024 11:15:00	0.58	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.08					
22/10/2024 11:30:00	0.59	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.08					
22/10/2024 11:45:00	0.59	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.08					
22/10/2024 12:00:00	0.59	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.08					
22/10/2024 12:15:00	0.60	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.08					
22/10/2024 12:30:00	0.60	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.07					
22/10/2024 12:45:00	0.60	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.08					
22/10/2024 13:00:00	0.61	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.08					
22/10/2024 13:15:00	0.61	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.08					
22/10/2024 13:30:00	0.62	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.08					
22/10/2024 13:45:00	0.62	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.08					
22/10/2024 14:00:00	0.62	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.09					
22/10/2024 14:15:00	0.63	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.07					
22/10/2024 14:30:00	0.63	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.07					
22/10/2024 14:45:00	0.63	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.09					
22/10/2024 15:00:00	0.64	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.09					
22/10/2024 15:15:00	0.64	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.08					
22/10/2024 15:30:00	0.64	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.09					
22/10/2024 15:45:00	0.65	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.08					
22/10/2024 16:00:00	0.65	0.00	0.02	0.01	0.18	0.17	0.12	0.50	0.08					
22/10/2024 16:15:00	0.65	0.00	0.02	0.01	0.18	0.17	0.12	0.50	0.08					
22/10/2024 16:30:00	0.65	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.08					
22/10/2024 16:45:00	0.66	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.08					
22/10/2024 17:00:00	0.66	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.08					
22/10/2024 17:15:00	0.66	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
22/10/2024 17:30:00	0.66	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.08					
22/10/2024 17:45:00	0.66	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.09					
22/10/2024 18:00:00	0.66	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.09					
22/10/2024 18:15:00	0.65	0.01	0.02	0.01	0.17	0.17	0.12	0.51	0.10					
22/10/2024 18:30:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.09					
22/10/2024 18:45:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.09					
22/10/2024 19:00:00	0.64	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.09					
22/10/2024 19:15:00	0.64	-0.02	0.02	0.01	0.17	0.17	0.12	0.52	0.08					
22/10/2024 19:30:00	0.63	-0.02	0.02	0.01	0.17	0.17	0.12	0.52	0.08					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
22/10/2024 19:45:00	0.63	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.09					
22/10/2024 20:00:00	0.62	-0.02	0.02	0.01	0.18	0.17	0.12	0.52	0.08					
22/10/2024 20:15:00	0.62	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.08					
22/10/2024 20:30:00	0.61	-0.02	0.02	0.01	0.18	0.17	0.12	0.52	0.09					
22/10/2024 20:45:00	0.61	-0.03	0.03	0.01	0.18	0.17	0.12	0.52	0.09					
22/10/2024 21:00:00	0.60	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
22/10/2024 21:15:00	0.60	-0.02	0.03	0.01	0.18	0.17	0.12	0.52	0.09					
22/10/2024 21:30:00	0.59	-0.01	0.02	0.01	0.18	0.17	0.12	0.52	0.09					
22/10/2024 21:45:00	0.59	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.08					
22/10/2024 22:00:00	0.59	0.00	0.03	0.01	0.18	0.17	0.13	0.51	0.07					
22/10/2024 22:15:00	0.59	0.00	0.03	0.01	0.18	0.17	0.13	0.51	0.08					
22/10/2024 22:30:00	0.59	0.00	0.03	0.01	0.18	0.17	0.13	0.51	0.09					
22/10/2024 22:45:00	0.59	0.00	0.03	0.01	0.18	0.17	0.13	0.51	0.09					
22/10/2024 23:00:00	0.59	0.00	0.03	0.01	0.18	0.17	0.13	0.51	0.08					
22/10/2024 23:15:00	0.59	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.08					
22/10/2024 23:30:00	0.60	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.08					
22/10/2024 23:45:00	0.60	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.08					
23/10/2024 00:00:00	0.60	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.08					
23/10/2024 00:15:00	0.61	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.07					
23/10/2024 00:30:00	0.61	0.00	0.02	0.01	0.18	0.17	0.12	0.50	0.08					
23/10/2024 00:45:00	0.61	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.07					
23/10/2024 01:00:00	0.62	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.08					
23/10/2024 01:15:00	0.62	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.09					
23/10/2024 01:30:00	0.62	0.00	0.03	0.01	0.18	0.17	0.12	0.49	0.07					
23/10/2024 01:45:00	0.63	0.00	0.02	0.01	0.18	0.17	0.12	0.49	0.08					
23/10/2024 02:00:00	0.63	0.00	0.02	0.01	0.18	0.17	0.12	0.49	0.07					
23/10/2024 02:15:00	0.63	0.00	0.02	0.01	0.18	0.17	0.12	0.49	0.07					
23/10/2024 02:30:00	0.64	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
23/10/2024 02:45:00	0.64	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
23/10/2024 03:00:00	0.64	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
23/10/2024 03:15:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
23/10/2024 03:30:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
23/10/2024 03:45:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
23/10/2024 04:00:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
23/10/2024 04:15:00	0.66	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
23/10/2024 04:30:00	0.66	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.08					
23/10/2024 04:45:00	0.66	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.08					
23/10/2024 05:00:00	0.66	0.00	0.02	0.00	0.17	0.17	0.12	0.48	0.06					
23/10/2024 05:15:00	0.66	0.00	0.02	0.00	0.17	0.17	0.12	0.48	0.07					
23/10/2024 05:30:00	0.66	0.00	0.02	0.00	0.17	0.17	0.12	0.48	0.08					
23/10/2024 05:45:00	0.66	0.00	0.02	0.00	0.17	0.17	0.12	0.48	0.08					
23/10/2024 06:00:00	0.66	0.00	0.02	0.00	0.17	0.17	0.12	0.48	0.07					
23/10/2024 06:15:00	0.66	0.00	0.02	0.00	0.17	0.16	0.12	0.48	0.07					
23/10/2024 06:30:00	0.65	0.00	0.02	0.00	0.17	0.16	0.11	0.48	0.07					
23/10/2024 06:45:00	0.65	0.00	0.02	0.00	0.17	0.16	0.11	0.49	0.07					
23/10/2024 07:00:00	0.64	-0.02	0.02	0.00	0.17	0.16	0.11	0.49	0.07					
23/10/2024 07:15:00	0.64	0.00	0.02	0.00	0.17	0.16	0.11	0.49	0.09					
23/10/2024 07:30:00	0.63	0.00	0.02	0.00	0.17	0.16	0.11	0.49	0.09					
23/10/2024 07:45:00	0.63	0.00	0.02	0.00	0.17	0.16	0.11	0.50	0.09					
23/10/2024 08:00:00	0.62	-0.01	0.02	0.00	0.17	0.16	0.11	0.50	0.09					
23/10/2024 08:15:00	0.62	-0.02	0.02	0.00	0.17	0.16	0.11	0.51	0.09					
23/10/2024 08:30:00	0.61	-0.02	0.02	0.00	0.17	0.16	0.11	0.52	0.10					
23/10/2024 08:45:00	0.61	-0.01	0.02	0.00	0.17	0.16	0.11	0.52	0.09					
23/10/2024 09:00:00	0.60	-0.01	0.01	0.00	0.17	0.16	0.11	0.52	0.08					
23/10/2024 09:15:00	0.60	0.00	0.01	0.00	0.17	0.16	0.11	0.52	0.09					
23/10/2024 09:30:00	0.60	-0.01	0.01	0.00	0.17	0.16	0.11	0.51	0.09					
23/10/2024 09:45:00	0.59	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.08					
23/10/2024 10:00:00	0.59	-0.02	0.01	0.00	0.17	0.17	0.12	0.51	0.08					
23/10/2024 10:15:00	0.58	-0.02	0.01	0.00	0.17	0.17	0.12	0.51	0.08					
23/10/2024 10:30:00	0.58	0.00	0.01	0.00	0.17	0.17	0.12	0.51	0.08					
23/10/2024 10:45:00	0.58	-0.02	0.01	0.00	0.17	0.17	0.12	0.51	0.09					
23/10/2024 11:00:00	0.57	0.00	0.01	0.00	0.17	0.17	0.12	0.51	0.09					
23/10/2024 11:15:00	0.57	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.09					
23/10/2024 11:30:00	0.57	-0.01	0.02	0.00	0.17	0.17	0.12	0.51	0.08					
23/10/2024 11:45:00	0.56	0.02	0.02	0.00	0.17	0.17	0.12	0.51	0.09					
23/10/2024 12:00:00	0.56	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.08					
23/10/2024 12:15:00	0.56	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.09					
23/10/2024 12:30:00	0.56	0.00	0.02	0.00	0.18	0.17	0.12	0.51	0.08					
23/10/2024 12:45:00	0.56	0.00	0.02	0.00	0.18	0.17	0.12	0.51	0.09					
23/10/2024 13:00:00	0.57	0.00	0.02	0.00	0.18	0.17	0.12	0.51	0.08					
23/10/2024 13:15:00	0.57	0.00	0.02	0.00	0.18	0.17	0.12	0.51	0.08					
23/10/2024 13:30:00	0.57	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.08					
23/10/2024 13:45:00	0.57	0.00	0.02	0.00	0.18	0.17	0.12	0.51	0.09					
23/10/2024 14:00:00	0.58	0.00	0.02	0.00	0.18	0.17	0.12	0.51	0.09					
23/10/2024 14:15:00	0.58	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.09					
23/10/2024 14:30:00	0.58	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.09					
23/10/2024 14:45:00	0.59	0.00	0.02	0.00	0.18	0.17	0.12	0.51	0.09					
23/10/2024 15:00:00	0.59	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.09					
23/10/2024 15:15:00	0.60	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.09					
23/10/2024 15:30:00	0.60	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.09					
23/10/2024 15:45:00	0.60	0.00	0.02	0.01	0.18	0.17	0.12	0.51	0.08					
23/10/2024 16:00:00	0.61	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.09					
23/10/2024 16:15:00	0.61	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.07					
23/10/2024 16:30:00	0.61	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.09					
23/10/2024 16:45:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.09					
23/10/2024 17:00:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.09					
23/10/2024 17:15:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.07					
23/10/2024 17:30:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.10					
23/10/2024 17:45:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.10					
23/10/2024 18:00:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.09					
23/10/2024 18:15:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.09					
23/10/2024 18:30:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.09					
23/10/2024 18:45:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.09					
23/10/2024 19:00:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.10					
23/10/2024 19:15:00	0.62	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.10					
23/10/2024 19:30:00	0.62	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.11					
23/10/2024 19:45:00	0.62	0.00	0.02	0.01	0.18	0.17	0.12	0.53	0.09					
23/10/2024 20:00:00	0.61	0.00	0.02	0.01	0.18	0.17	0.12	0.53	0.10					
23/10/2024 20:15:00	0.61	0.00	0.02	0.01	0.18	0.17	0.12	0.53	0.10					
23/10/2024 20:30:00	0.61	0.00	0.02	0.01	0.18	0.17	0.12	0.53	0.09					
23/10/2024 20:45:00	0.60	0.00	0.02	0.01	0.18	0.17	0.12	0.53	0.10					
23/10/2024 21:00:00	0.60	0.00	0.02	0.01	0.18	0.17	0.12	0.53	0.09					
23/10/2024 21:15:00	0.59	0.00	0.02	0.01	0.18	0.17	0.13	0.53	0.10					
23/10/2024 21:30:00	0.59	0.02	0.02	0.01	0.18	0.17	0.13	0.52	0.09					
23/10/2024 21:45:00	0.59	0.00	0.02	0.01	0.18	0.17	0.13	0.52	0.09					
23/10/2024 22:00:00	0.58	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.09					
23/10/2024 22:15:00	0.58	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.10					
23/10/2024 22:30:00	0.58	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.09					
23/10/2024 22:45:00	0.58	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.08					
23/10/2024 23:00:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
23/10/2024 23:15:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
23/10/2024 23:30:00	0.58	-0.02	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
23/10/2024 23:45:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
24/10/2024 00:00:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
24/10/2024 00:15:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.10					
24/10/2024 00:30:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
24/10/2024 00:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
24/10/2024 01:00:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.09					
24/10/2024 01:15:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.09					
24/10/2024 01:30:00	0.60	0.00	0.03	0.01	0.18	0.17	0.13	0.50	0.08					
24/10/2024 01:45:00	0.60	0.00	0.02	0.01	0.18	0.17	0.13	0.50	0.09					
24/10/2024 02:00:00	0.60		0.02	0.01	0.18	0.17	0.12	0.50	0.08					
24/10/2024 02:15:00	0.61	0.00	0.02	0.01	0.18	0.17	0.12	0.50	0.08					
24/10/2024 02:30:00	0.61	0.00	0.02	0.01	0.18	0.17	0.12	0.50	0.09					
24/10/2024 02:45:00	0.62	0.00	0.02	0.01	0.18	0.17	0.12	0.50	0.07					
24/10/2024 03:00:00	0.62	0.00	0.02	0.01	0.18	0.17	0.12	0.50	0.08					
24/10/2024 03:15:00	0.62	0.00	0.02	0.01	0.18	0.17	0.12	0.49	0.08					
24/10/2024 03:30:00	0.62	0.00	0.02	0.01	0.18	0.17	0.12	0.49	0.08					
24/10/2024 03:45:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
24/10/2024 04:00:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
24/10/2024 04:15:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
24/10/2024 04:30:00	0.64	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
24/10/2024 04:45:00	0.64	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
24/10/2024 05:00:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.49	0.08					
24/10/2024 05:15:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.49	0.09					
24/10/2024 05:30:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
24/10/2024 05:45:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.49	0.08					
24/10/2024 06:00:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.49	0.09					
24/10/2024 06:15:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.49	0.09					
24/10/2024 06:30:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.49	0.08					
24/10/2024 06:45:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.49	0.08					
24/10/2024 07:00:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.09					
24/10/2024 07:15:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.08					
24/10/2024 07:30:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.09					
24/10/2024 07:45:00	0.63	0.00	0.02	0.00	0.17	0.17	0.11	0.50	0.09					
24/10/2024 08:00:00	0.62	0.00	0.02	0.00	0.17	0.17	0.11	0.51	0.08					
24/10/2024 08:15:00	0.62	0.00	0.02	0.00	0.17	0.17	0.11	0.51	0.09					
24/10/2024 08:30:00	0.61	0.00	0.02	0.00	0.17	0.17	0.11	0.51	0.09					
24/10/2024 08:45:00	0.61	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.09					
24/10/2024 09:00:00	0.61	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.09					
24/10/2024 09:15:00	0.60	0.00	0.02	0.00	0.17	0.17	0.12	0.53	0.10					
24/10/2024 09:30:00	0.60	0.00	0.01	0.00	0.17	0.17	0.12	0.53	0.08					
24/10/2024 09:45:00	0.59		0.01	0.00	0.17	0.17	0.12	0.52	0.09					
24/10/2024 10:00:00	0.59	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.08					
24/10/2024 10:15:00	0.59	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.09					
24/10/2024 10:30:00	0.58	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.08					
24/10/2024 10:45:00	0.58	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.07					
24/10/2024 11:00:00	0.57	0.00	0.02	0.00	0.18	0.17	0.12	0.52	0.08					
24/10/2024 11:15:00	0.57	0.00	0.02	0.00	0.18	0.17	0.12	0.52	0.09					
24/10/2024 11:30:00	0.57	0.00	0.02	0.00	0.18	0.17	0.12	0.52	0.09					
24/10/2024 11:45:00	0.57	0.00	0.02	0.00	0.18	0.17	0.12	0.52	0.09					
24/10/2024 12:00:00	0.56	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.08					
24/10/2024 12:15:00	0.56	0.00	0.02	0.00	0.18	0.17	0.12	0.52	0.08					
24/10/2024 12:30:00	0.56	0.00	0.02	0.01	0.18	0.15	0.12	0.52	0.08					
24/10/2024 12:45:00	0.55	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.07					
24/10/2024 13:00:00	0.55	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.08					
24/10/2024 13:15:00	0.55	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.07					
24/10/2024 13:30:00	0.55	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.08					
24/10/2024 13:45:00	0.55	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.08					
24/10/2024 14:00:00	0.55	0.00	0.02	0.00	0.18	0.18	0.13	0.52	0.08					
24/10/2024 14:15:00	0.55	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.08					
24/10/2024 14:30:00	0.55	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.08					
24/10/2024 14:45:00	0.55	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.09					
24/10/2024 15:00:00	0.55	0.00	0.02	0.01	0.18	0.18	0.12	0.51	0.07					
24/10/2024 15:15:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
24/10/2024 15:30:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
24/10/2024 15:45:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
24/10/2024 16:00:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
24/10/2024 16:15:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.07					
24/10/2024 16:30:00	0.57	0.00	0.02	0.01	0.18	0.18	0.12	0.51	0.08					
24/10/2024 16:45:00	0.58	0.00	0.02	0.01	0.18	0.18	0.12	0.51	0.07					
24/10/2024 17:00:00	0.58	0.00	0.02	0.01	0.18	0.18	0.12	0.51	0.07					
24/10/2024 17:15:00	0.58	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.07					
24/10/2024 17:30:00	0.59	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.08					
24/10/2024 17:45:00	0.59	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.09					
24/10/2024 18:00:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.07					
24/10/2024 18:15:00	0.60	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.07					
24/10/2024 18:30:00	0.60	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.07					
24/10/2024 18:45:00	0.61	-0.01	0.02	0.01	0.18	0.18	0.12	0.52	0.09					
24/10/2024 19:00:00	0.61	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.08					
24/10/2024 19:15:00	0.61	0.00	0.02	0.01	0.18	0.18	0.12	0.53	0.09					
24/10/2024 19:30:00	0.62	0.00	0.02	0.01	0.18	0.18	0.12	0.53	0.08					
24/10/2024 19:45:00	0.62	0.00	0.02	0.01	0.18	0.18	0.12	0.53	0.07					
24/10/2024 20:00:00	0.62	0.00	0.02	0.01	0.18	0.18	0.12	0.53	0.09					
24/10/2024 20:15:00	0.62	0.00	0.02	0.01	0.18	0.18	0.12	0.53	0.07					
24/10/2024 20:30:00	0.62	0.00	0.02	0.01	0.18	0.18	0.13	0.54	0.09					
24/10/2024 20:45:00	0.62	0.00	0.02	0.01	0.18	0.18	0.13	0.53	0.09					
24/10/2024 21:00:00	0.62	0.00	0.02	0.01	0.18	0.18	0.13	0.53	0.08					
24/10/2024 21:15:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
24/10/2024 21:30:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
24/10/2024 21:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
24/10/2024 22:00:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
24/10/2024 22:15:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.09					
24/10/2024 22:30:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.09					
24/10/2024 22:45:00	0.60	0.00	0.03	0.01	0.18	0.19	0.13	0.52	0.09					
24/10/2024 23:00:00	0.59	0.00	0.03	0.01	0.18	0.19	0.13	0.52	0.07					
24/10/2024 23:15:00	0.59	0.00	0.03	0.01	0.18	0.19	0.13	0.52	0.10					
24/10/2024 23:30:00	0.59	0.00	0.03	0.01	0.18	0.19	0.13	0.52	0.09					
24/10/2024 23:45:00	0.59	0.00	0.03	0.01	0.18	0.19	0.13	0.52	0.08					
25/10/2024 00:00:00	0.59	0.00	0.03	0.01	0.18	0.19	0.13	0.52	0.07					
25/10/2024 00:15:00	0.59	0.00	0.03	0.01	0.18	0.19	0.13	0.52	0.07					
25/10/2024 00:30:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 00:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 01:00:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
25/10/2024 01:15:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
25/10/2024 01:30:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 01:45:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
25/10/2024 02:00:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 02:15:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.07					
25/10/2024 02:30:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.08					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
25/10/2024 02:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.09					
25/10/2024 03:00:00	0.61	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.07					
25/10/2024 03:15:00	0.62	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.09					
25/10/2024 03:30:00	0.62	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.07					
25/10/2024 03:45:00	0.62	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.08					
25/10/2024 04:00:00	0.63	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.08					
25/10/2024 04:15:00	0.63	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.07					
25/10/2024 04:30:00	0.63	0.00	0.02	0.01	0.18	0.18	0.12	0.50	0.07					
25/10/2024 04:45:00	0.63	0.00	0.02	0.01	0.17	0.18	0.12	0.50	0.06					
25/10/2024 05:00:00	0.64	0.00	0.02	0.01	0.17	0.18	0.12	0.50	0.07					
25/10/2024 05:15:00	0.64	0.00	0.02	0.01	0.17	0.18	0.12	0.50	0.07					
25/10/2024 05:30:00	0.64	0.00	0.02	0.01	0.17	0.18	0.12	0.50	0.08					
25/10/2024 05:45:00	0.64		0.02	0.01	0.17	0.18	0.12	0.50	0.08					
25/10/2024 06:00:00	0.64	0.00	0.02	0.01	0.17	0.18	0.12	0.50	0.08					
25/10/2024 06:15:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.50	0.09					
25/10/2024 06:30:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.50	0.07					
25/10/2024 06:45:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.50	0.07					
25/10/2024 07:00:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.50	0.08					
25/10/2024 07:15:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.50	0.08					
25/10/2024 07:30:00	0.66	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.07					
25/10/2024 07:45:00	0.66	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.08					
25/10/2024 08:00:00	0.66	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.08					
25/10/2024 08:15:00	0.66	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.09					
25/10/2024 08:30:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.08					
25/10/2024 08:45:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.09					
25/10/2024 09:00:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.08					
25/10/2024 09:15:00	0.64		0.02	0.01	0.17	0.17	0.12	0.53	0.09					
25/10/2024 09:30:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.53	0.09					
25/10/2024 09:45:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.53	0.09					
25/10/2024 10:00:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.53	0.08					
25/10/2024 10:15:00	0.62	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.08					
25/10/2024 10:30:00	0.62	0.00	0.01	0.00	0.17	0.18	0.12	0.52	0.09					
25/10/2024 10:45:00	0.61	0.00	0.02	0.00	0.18	0.18	0.12	0.52	0.09					
25/10/2024 11:00:00	0.61	0.00	0.02	0.00	0.18	0.18	0.12	0.52	0.08					
25/10/2024 11:15:00	0.61	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.08					
25/10/2024 11:30:00	0.60	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.08					
25/10/2024 11:45:00	0.60	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.08					
25/10/2024 12:00:00	0.59	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 12:15:00	0.59	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.09					
25/10/2024 12:30:00	0.58	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.08					
25/10/2024 12:45:00	0.58	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.08					
25/10/2024 13:00:00	0.58	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.08					
25/10/2024 13:15:00	0.57	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 13:30:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
25/10/2024 13:45:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
25/10/2024 14:00:00	0.57	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.08					
25/10/2024 14:15:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 14:30:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 14:45:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
25/10/2024 15:00:00	0.56	0.00	0.02	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 15:15:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
25/10/2024 15:30:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 15:45:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
25/10/2024 16:00:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 16:15:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 16:30:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.06					
25/10/2024 16:45:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 17:00:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
25/10/2024 17:15:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 17:30:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 17:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
25/10/2024 18:00:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 18:15:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
25/10/2024 18:30:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 18:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
25/10/2024 19:00:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 19:15:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
25/10/2024 19:30:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
25/10/2024 19:45:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
25/10/2024 20:00:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 20:15:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
25/10/2024 20:30:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
25/10/2024 20:45:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
25/10/2024 21:00:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
25/10/2024 21:15:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
25/10/2024 21:30:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.07					
25/10/2024 21:45:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
25/10/2024 22:00:00	0.64		0.03	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 22:15:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 22:30:00	0.64	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 22:45:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
25/10/2024 23:00:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
25/10/2024 23:15:00	0.63	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
25/10/2024 23:30:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
25/10/2024 23:45:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
26/10/2024 00:00:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
26/10/2024 00:15:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
26/10/2024 00:30:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
26/10/2024 00:45:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
26/10/2024 01:00:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.07					
26/10/2024 01:15:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.07					
26/10/2024 01:30:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.08					
26/10/2024 01:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.06					
26/10/2024 02:00:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.06					
26/10/2024 02:15:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.08					
26/10/2024 02:30:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.06					
26/10/2024 02:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
26/10/2024 03:00:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.06					
26/10/2024 03:15:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
26/10/2024 03:30:00	0.59	0.00	0.02	0.01	0.18	0.18	0.12	0.49	0.06					
26/10/2024 03:45:00	0.59	0.00	0.02	0.01	0.18	0.18	0.12	0.49	0.07					
26/10/2024 04:00:00	0.60	0.00	0.02	0.01	0.18	0.18	0.12	0.49	0.06					
26/10/2024 04:15:00	0.60	0.00	0.02	0.01	0.18	0.18	0.12	0.49	0.07					
26/10/2024 04:30:00	0.60	0.00	0.02	0.01	0.18	0.18	0.12	0.49	0.06					
26/10/2024 04:45:00	0.60	0.00	0.02	0.01	0.17	0.18	0.12	0.49	0.06					
26/10/2024 05:00:00	0.61	0.00	0.02	0.01	0.17	0.18	0.12	0.49	0.06					
26/10/2024 05:15:00	0.61	0.00	0.02	0.01	0.17	0.18	0.12	0.49	0.06					
26/10/2024 05:30:00	0.61		0.02	0.01	0.17	0.18	0.12	0.49	0.07					
26/10/2024 05:45:00	0.62	0.00	0.02	0.01	0.17	0.18	0.12	0.49	0.06					
26/10/2024 06:00:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.06					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
26/10/2024 06:15:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.06					
26/10/2024 06:30:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
26/10/2024 06:45:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
26/10/2024 07:00:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
26/10/2024 07:15:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
26/10/2024 07:30:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
26/10/2024 07:45:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.49	0.07					
26/10/2024 08:00:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.49	0.07					
26/10/2024 08:15:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.08					
26/10/2024 08:30:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.08					
26/10/2024 08:45:00	0.64	0.00	0.02	0.00	0.17	0.17	0.12	0.50	0.08					
26/10/2024 09:00:00	0.63	0.00	0.01	0.00	0.17	0.17	0.12	0.51	0.07					
26/10/2024 09:15:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.08					
26/10/2024 09:30:00	0.63	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.09					
26/10/2024 09:45:00	0.62	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.08					
26/10/2024 10:00:00	0.62	-0.01	0.02	0.00	0.17	0.17	0.12	0.52	0.09					
26/10/2024 10:15:00	0.62	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.10					
26/10/2024 10:30:00	0.61	0.00	0.02	0.00	0.17	0.17	0.12	0.53	0.10					
26/10/2024 10:45:00	0.61	0.00	0.01	0.00	0.17	0.17	0.12	0.52	0.08					
26/10/2024 11:00:00	0.60	0.00	0.01	0.00	0.17	0.17	0.12	0.53	0.08					
26/10/2024 11:15:00	0.60	0.00	0.01	0.00	0.17	0.17	0.12	0.53	0.08					
26/10/2024 11:30:00	0.59	0.00	0.02	0.00	0.17	0.18	0.12	0.53	0.09					
26/10/2024 11:45:00	0.59	0.00	0.02	0.00	0.18	0.18	0.12	0.52	0.08					
26/10/2024 12:00:00	0.59	0.00	0.02	0.00	0.18	0.18	0.12	0.52	0.08					
26/10/2024 12:15:00	0.58	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.09					
26/10/2024 12:30:00	0.58	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.07					
26/10/2024 12:45:00	0.57	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.07					
26/10/2024 13:00:00	0.57	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 13:15:00	0.57	0.00	0.02	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 13:30:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 13:45:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 14:00:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 14:15:00	0.55	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
26/10/2024 14:30:00	0.55	-0.02	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 14:45:00	0.55	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 15:00:00	0.55	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
26/10/2024 15:15:00	0.54	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.06					
26/10/2024 15:30:00	0.54	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
26/10/2024 15:45:00		0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
26/10/2024 16:00:00	0.54	0.01	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
26/10/2024 16:15:00	0.54	-0.01	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
26/10/2024 16:30:00	0.54	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
26/10/2024 16:45:00	0.54	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
26/10/2024 17:00:00	0.54		0.03	0.01	0.18	0.18	0.13	0.51	0.07					
26/10/2024 17:15:00	0.54	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 17:30:00	0.54	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 17:45:00	0.54	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 18:00:00	0.55	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 18:15:00	0.55	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
26/10/2024 18:30:00	0.55	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 18:45:00	0.55	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 19:00:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
26/10/2024 19:15:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 19:30:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 19:45:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 20:00:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 20:15:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 20:30:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 20:45:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 21:00:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 21:15:00		0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 21:30:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 21:45:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 22:00:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 22:15:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 22:30:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 22:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
26/10/2024 23:00:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
26/10/2024 23:15:00	0.61		0.03	0.01	0.18	0.18	0.13	0.52	0.08					
26/10/2024 23:30:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
26/10/2024 23:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
27/10/2024 00:00:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
27/10/2024 00:15:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
27/10/2024 00:30:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
27/10/2024 00:45:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
27/10/2024 01:00:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 01:15:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.09					
27/10/2024 01:30:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.08					
27/10/2024 01:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.08					
27/10/2024 02:00:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.08					
27/10/2024 02:15:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.08					
27/10/2024 02:30:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.07					
27/10/2024 02:45:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.07					
27/10/2024 03:00:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
27/10/2024 03:15:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.05					
27/10/2024 03:30:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.09					
27/10/2024 03:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.08					
27/10/2024 04:00:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.06					
27/10/2024 04:15:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
27/10/2024 04:30:00	0.59	0.00	0.03	0.01	0.17	0.18	0.12	0.49	0.07					
27/10/2024 04:45:00	0.60	0.00	0.03	0.01	0.17	0.18	0.12	0.49	0.07					
27/10/2024 05:00:00	0.60	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
27/10/2024 05:15:00	0.60	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
27/10/2024 05:30:00	0.60	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
27/10/2024 05:45:00	0.61	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
27/10/2024 06:00:00	0.61	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
27/10/2024 06:15:00	0.61	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
27/10/2024 06:30:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.08					
27/10/2024 06:45:00	0.62	0.00	0.03	0.01	0.17	0.17	0.12	0.48	0.07					
27/10/2024 07:00:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
27/10/2024 07:15:00	0.62	0.03	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
27/10/2024 07:30:00	0.63	-0.02	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
27/10/2024 07:45:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
27/10/2024 08:00:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.08					
27/10/2024 08:15:00	0.63	0.00	0.02	0.01	0.17	0.17	0.11	0.49	0.07					
27/10/2024 08:30:00	0.64	0.00	0.02	0.01	0.17	0.17	0.11	0.49	0.07					
27/10/2024 08:45:00	0.64	0.00	0.02	0.01	0.17	0.17	0.11	0.49	0.08					
27/10/2024 09:00:00	0.64	0.00	0.02	0.00	0.17	0.17	0.11	0.49	0.08					
27/10/2024 09:15:00	0.64	0.00	0.02	0.00	0.17	0.17	0.11	0.49	0.08					
27/10/2024 09:30:00	0.64	0.00	0.02	0.01	0.17	0.17	0.11	0.50	0.07					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
27/10/2024 09:45:00	0.65	0.00	0.02	0.00	0.17	0.17	0.11	0.50	0.08					
27/10/2024 10:00:00	0.65	0.00	0.02	0.00	0.17	0.17	0.11	0.50	0.08					
27/10/2024 10:15:00	0.65	0.00	0.01	0.00	0.17	0.17	0.11	0.51	0.10					
27/10/2024 10:30:00	0.65		0.01	0.00	0.17	0.17	0.11	0.51	0.08					
27/10/2024 10:45:00	0.65	0.00	0.01	0.00	0.17	0.17	0.11	0.51	0.09					
27/10/2024 11:00:00	0.65	0.00	0.01	0.00	0.17	0.17	0.11	0.51	0.09					
27/10/2024 11:15:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.09					
27/10/2024 11:30:00	0.65	0.00	0.02	0.00	0.17	0.17	0.12	0.52	0.10					
27/10/2024 11:45:00	0.65	0.00	0.02	0.01	0.17	0.17	0.12	0.53	0.08					
27/10/2024 12:00:00	0.64	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.09					
27/10/2024 12:15:00	0.64	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.09					
27/10/2024 12:30:00	0.63	0.01	0.02	0.01	0.17	0.17	0.12	0.52	0.09					
27/10/2024 12:45:00	0.63	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.08					
27/10/2024 13:00:00	0.62	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.09					
27/10/2024 13:15:00	0.62	0.00	0.02	0.01	0.18	0.17	0.12	0.52	0.09					
27/10/2024 13:30:00	0.61	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.09					
27/10/2024 13:45:00	0.61	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.09					
27/10/2024 14:00:00	0.60	0.00	0.02	0.01	0.18	0.18	0.12	0.52	0.09					
27/10/2024 14:15:00	0.60	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.08					
27/10/2024 14:30:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.08					
27/10/2024 14:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
27/10/2024 15:00:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 15:15:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 15:30:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 15:45:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 16:00:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 16:15:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 16:30:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 16:45:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 17:00:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
27/10/2024 17:15:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 17:30:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
27/10/2024 17:45:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
27/10/2024 18:00:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
27/10/2024 18:15:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.09					
27/10/2024 18:30:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
27/10/2024 18:45:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
27/10/2024 19:00:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.07					
27/10/2024 19:15:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
27/10/2024 19:30:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.09					
27/10/2024 19:45:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
27/10/2024 20:00:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.07					
27/10/2024 20:15:00	0.59	-0.02	0.03	0.01	0.18	0.18	0.12	0.51	0.10					
27/10/2024 20:30:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.09					
27/10/2024 20:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.09					
27/10/2024 21:00:00	0.60	-0.01	0.03	0.01	0.18	0.18	0.12	0.51	0.09					
27/10/2024 21:15:00	0.60	0.00	0.02	0.01	0.18	0.18	0.12	0.51	0.08					
27/10/2024 21:30:00	0.60	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.09					
27/10/2024 21:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.09					
27/10/2024 22:00:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
27/10/2024 22:15:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
27/10/2024 22:30:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.10					
27/10/2024 22:45:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
27/10/2024 23:00:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
27/10/2024 23:15:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
27/10/2024 23:30:00	0.62	-0.01	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
27/10/2024 23:45:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.09					
28/10/2024 00:00:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
28/10/2024 00:15:00	0.62	-0.01	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
28/10/2024 00:30:00	0.62	-0.02	0.03	0.01	0.18	0.18	0.13	0.51	0.08					
28/10/2024 00:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.51	0.07					
28/10/2024 01:00:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.08					
28/10/2024 01:15:00	0.60	-0.01	0.03	0.01	0.18	0.18	0.13	0.50	0.07					
28/10/2024 01:30:00	0.60	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.08					
28/10/2024 01:45:00	0.60		0.03	0.01	0.18	0.18	0.13	0.50	0.08					
28/10/2024 02:00:00	0.59	0.00	0.03	0.01	0.18	0.18	0.13	0.50	0.07					
28/10/2024 02:15:00	0.59	-0.01	0.03	0.01	0.18	0.18	0.13	0.50	0.07					
28/10/2024 02:30:00	0.58	-0.02	0.03	0.01	0.18	0.18	0.13	0.49	0.08					
28/10/2024 02:45:00	0.58	-0.02	0.03	0.01	0.18	0.18	0.13	0.49	0.07					
28/10/2024 03:00:00	0.58	0.00	0.03	0.01	0.18	0.18	0.13	0.49	0.07					
28/10/2024 03:15:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
28/10/2024 03:30:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.08					
28/10/2024 03:45:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
28/10/2024 04:00:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
28/10/2024 04:15:00	0.56	-0.01	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
28/10/2024 04:30:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
28/10/2024 04:45:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
28/10/2024 05:00:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
28/10/2024 05:15:00	0.56	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
28/10/2024 05:30:00	0.56	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.08					
28/10/2024 05:45:00	0.56	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
28/10/2024 06:00:00	0.56	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.06					
28/10/2024 06:15:00	0.56	-0.02	0.02	0.01	0.17	0.17	0.12	0.48	0.06					
28/10/2024 06:30:00	0.56	-0.01	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
28/10/2024 06:45:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
28/10/2024 07:00:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.48	0.07					
28/10/2024 07:15:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
28/10/2024 07:30:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
28/10/2024 07:45:00	0.58	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
28/10/2024 08:00:00	0.58	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
28/10/2024 08:15:00	0.58	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.08					
28/10/2024 08:30:00	0.59	0.00	0.02	0.01	0.17	0.17	0.12	0.49	0.07					
28/10/2024 08:45:00	0.59	0.00	0.02	0.01	0.17	0.17	0.11	0.50	0.07					
28/10/2024 09:00:00	0.59	-0.02	0.02	0.01	0.17	0.17	0.11	0.50	0.08					
28/10/2024 09:15:00	0.60	-0.02	0.02	0.01	0.17	0.17	0.11	0.50	0.08					
28/10/2024 09:30:00	0.60	0.00	0.02	0.00	0.17	0.17	0.11	0.51	0.08					
28/10/2024 09:45:00	0.60	0.00	0.02	0.00	0.17	0.17	0.11	0.51	0.09					
28/10/2024 10:00:00	0.60	0.00	0.02	0.00	0.17	0.17	0.11	0.51	0.08					
28/10/2024 10:15:00	0.61	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.10					
28/10/2024 10:30:00	0.61	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.09					
28/10/2024 10:45:00	0.61	0.00	0.02	0.00	0.17	0.17	0.12	0.51	0.08					
28/10/2024 11:00:00	0.61	0.00	0.02	0.01	0.17	0.17	0.12	0.52	0.08					
28/10/2024 11:15:00	0.61	-0.01	0.02	0.01	0.17	0.17	0.12	0.52	0.10					
28/10/2024 11:30:00	0.61	-0.01	0.02	0.01	0.17	0.17	0.12	0.52	0.10					
28/10/2024 11:45:00	0.60	-0.02	0.02	0.01	0.17	0.17	0.12	0.52	0.10					
28/10/2024 12:00:00	0.60	-0.01	0.02	0.01	0.17	0.17	0.12	0.53	0.08					
28/10/2024 12:15:00	0.60	-0.01	0.02	0.01	0.17	0.17	0.12	0.53	0.09					
28/10/2024 12:30:00	0.59	-0.02	0.02	0.01	0.17	0.18	0.12	0.53	0.10					
28/10/2024 12:45:00	0.59	-0.01	0.02	0.01	0.17	0.18	0.12	0.53	0.11					
28/10/2024 13:00:00	0.59	-0.02	0.02	0.01	0.18	0.18	0.12	0.53	0.09					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
28/10/2024 13:15:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.53	0.09					
28/10/2024 13:30:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.53	0.10					
28/10/2024 13:45:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.53	0.08					
28/10/2024 14:00:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.09					
28/10/2024 14:15:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.07					
28/10/2024 14:30:00	0.57	-0.01	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
28/10/2024 14:45:00	0.56	-0.02	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
28/10/2024 15:00:00	0.56	-0.02	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
28/10/2024 15:15:00	0.56	-0.02	0.03	0.01	0.18	0.18	0.13	0.54	0.09					
28/10/2024 15:30:00	0.56	-0.03	0.04	0.01	0.18	0.18	0.13	0.54	0.10					
28/10/2024 15:45:00	0.55	-0.01	0.04	0.01	0.18	0.18	0.13	0.55	0.11					
28/10/2024 16:00:00	0.55	0.00	0.04	0.01	0.18	0.18	0.13	0.54	0.09					
28/10/2024 16:15:00	0.55	0.00	0.04	0.01	0.19	0.18	0.13	0.54	0.10					
28/10/2024 16:30:00	0.55	-0.02	0.04	0.01	0.19	0.18	0.13	0.54	0.07					
28/10/2024 16:45:00	0.54	-0.02	0.04	0.01	0.19	0.19	0.13	0.54	0.07					
28/10/2024 17:00:00	0.54	-0.01	0.04	0.02	0.19	0.19	0.14	0.54	0.08					
28/10/2024 17:15:00	0.54	0.00	0.04	0.02	0.19	0.19	0.14	0.54	0.09					
28/10/2024 17:30:00	0.54	0.00	0.04	0.02	0.19	0.19	0.14	0.54	0.08					
28/10/2024 17:45:00	0.54	-0.01	0.04	0.02	0.19	0.19	0.14	0.54	0.09					
28/10/2024 18:00:00	0.54	0.00	0.04	0.02	0.19	0.19	0.14	0.54	0.09					
28/10/2024 18:15:00	0.54	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.09					
28/10/2024 18:30:00	0.54	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.09					
28/10/2024 18:45:00	0.54	-0.02	0.04	0.02	0.19	0.19	0.14	0.53	0.08					
28/10/2024 19:00:00	0.54	-0.02	0.04	0.02	0.19	0.19	0.14	0.53	0.08					
28/10/2024 19:15:00	0.55	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.07					
28/10/2024 19:30:00	0.55	-0.02	0.04	0.02	0.19	0.19	0.14	0.53	0.08					
28/10/2024 19:45:00	0.55	-0.02	0.04	0.02	0.19	0.19	0.14	0.53	0.08					
28/10/2024 20:00:00	0.55	-0.02	0.04	0.02	0.19	0.19	0.14	0.53	0.08					
28/10/2024 20:15:00	0.56	-0.02	0.04	0.02	0.19	0.19	0.14	0.53	0.09					
28/10/2024 20:30:00	0.56	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.09					
28/10/2024 20:45:00	0.56	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.09					
28/10/2024 21:00:00	0.57	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.09					
28/10/2024 21:15:00	0.57	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.09					
28/10/2024 21:30:00	0.57	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.09					
28/10/2024 21:45:00	0.58	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.08					
28/10/2024 22:00:00	0.58	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.08					
28/10/2024 22:15:00	0.58	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.09					
28/10/2024 22:30:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.10					
28/10/2024 22:45:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.09					
28/10/2024 23:00:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.08					
28/10/2024 23:15:00	0.59	0.00	0.04	0.02	0.19	0.19	0.14	0.53	0.08					
28/10/2024 23:30:00	0.60	0.00	0.04	0.02	0.19	0.19	0.14	0.52	0.07					
28/10/2024 23:45:00	0.60	0.00	0.04	0.02	0.19	0.19	0.14	0.52	0.09					
29/10/2024 00:00:00	0.60	0.00	0.04	0.02	0.19	0.19	0.14	0.52	0.08					
29/10/2024 00:15:00	0.61	0.00	0.04	0.02	0.19	0.19	0.14	0.52	0.06					
29/10/2024 00:30:00	0.61	0.00	0.04	0.02	0.19	0.19	0.14	0.51	0.08					
29/10/2024 00:45:00	0.61	0.00	0.04	0.02	0.19	0.19	0.14	0.51	0.08					
29/10/2024 01:00:00	0.61	0.00	0.04	0.02	0.19	0.19	0.14	0.51	0.07					
29/10/2024 01:15:00	0.61	0.00	0.04	0.02	0.19	0.19	0.14	0.51	0.07					
29/10/2024 01:30:00	0.60	0.00	0.04	0.02	0.19	0.19	0.14	0.51	0.08					
29/10/2024 01:45:00	0.60	0.00	0.04	0.02	0.19	0.19	0.14	0.51	0.06					
29/10/2024 02:00:00	0.60	0.00	0.04	0.02	0.19	0.19	0.13	0.51	0.07					
29/10/2024 02:15:00	0.60	0.00	0.04	0.01	0.19	0.19	0.13	0.51	0.07					
29/10/2024 02:30:00	0.59	-0.01	0.04	0.01	0.19	0.19	0.13	0.50	0.07					
29/10/2024 02:45:00	0.59	-0.01	0.04	0.01	0.19	0.19	0.13	0.50	0.07					
29/10/2024 03:00:00	0.59	0.00	0.04	0.01	0.19	0.19	0.13	0.50	0.07					
29/10/2024 03:15:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.07					
29/10/2024 03:30:00	0.58	-0.01	0.04	0.01	0.18	0.18	0.13	0.50	0.07					
29/10/2024 03:45:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.06					
29/10/2024 04:00:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.08					
29/10/2024 04:15:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.07					
29/10/2024 04:30:00	0.57	-0.02	0.04	0.01	0.18	0.18	0.13	0.50	0.07					
29/10/2024 04:45:00	0.56	0.00	0.04	0.01	0.18	0.18	0.13	0.49	0.08					
29/10/2024 05:00:00	0.56	-0.01	0.03	0.01	0.18	0.18	0.13	0.49	0.06					
29/10/2024 05:15:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
29/10/2024 05:30:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.06					
29/10/2024 05:45:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.08					
29/10/2024 06:00:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
29/10/2024 06:15:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
29/10/2024 06:30:00	0.57	-0.02	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
29/10/2024 06:45:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
29/10/2024 07:00:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
29/10/2024 07:15:00	0.57	0.00	0.03	0.01	0.17	0.18	0.12	0.49	0.07					
29/10/2024 07:30:00	0.58	0.00	0.03	0.01	0.17	0.18	0.12	0.49	0.07					
29/10/2024 07:45:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
29/10/2024 08:00:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
29/10/2024 08:15:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
29/10/2024 08:30:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
29/10/2024 08:45:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
29/10/2024 09:00:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
29/10/2024 09:15:00	0.60	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.08					
29/10/2024 09:30:00	0.60	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.09					
29/10/2024 09:45:00	0.60	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.09					
29/10/2024 10:00:00	0.61	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.09					
29/10/2024 10:15:00	0.61	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.10					
29/10/2024 10:30:00	0.61	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.09					
29/10/2024 10:45:00	0.61	0.00	0.02	0.01	0.17	0.17	0.12	0.53	0.08					
29/10/2024 11:00:00	0.62	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.09					
29/10/2024 11:15:00	0.62	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.10					
29/10/2024 11:30:00	0.62	0.00	0.03	0.01	0.18	0.18	0.12	0.53	0.08					
29/10/2024 11:45:00	0.62	0.00	0.03	0.01	0.18	0.18	0.12	0.53	0.09					
29/10/2024 12:00:00	0.62	0.00	0.03	0.01	0.18	0.18	0.12	0.53	0.07					
29/10/2024 12:15:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.08					
29/10/2024 12:30:00	0.62	0.00	0.03	0.01	0.18	0.18	0.13	0.53	0.09					
29/10/2024 12:45:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 13:00:00	0.61	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
29/10/2024 13:15:00	0.61	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.09					
29/10/2024 13:30:00	0.60	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.07					
29/10/2024 13:45:00	0.60	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 14:00:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.07					
29/10/2024 14:15:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 14:30:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.09					
29/10/2024 14:45:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.07					
29/10/2024 15:00:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.08					
29/10/2024 15:15:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 15:30:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 15:45:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 16:00:00	0.56	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 16:15:00	0.56	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 16:30:00	0.56	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.08					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
29/10/2024 16:45:00	0.55	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 17:00:00	0.55	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 17:15:00	0.55	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 17:30:00	0.54	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 17:45:00	0.54	-0.01	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 18:00:00	0.54	-0.02	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 18:15:00	0.54	-0.02	0.04	0.01	0.18	0.18	0.13	0.51	0.08					
29/10/2024 18:30:00	0.54	-0.01	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 18:45:00	0.54	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.08					
29/10/2024 19:00:00	0.54	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
29/10/2024 19:15:00	0.54	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 19:30:00	0.54	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 19:45:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
29/10/2024 20:00:00	0.55	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 20:15:00	0.55	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.09					
29/10/2024 20:30:00	0.55	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.09					
29/10/2024 20:45:00	0.55	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 21:00:00	0.56	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 21:15:00	0.56	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 21:30:00	0.56	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 21:45:00	0.56	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 22:00:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 22:15:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.07					
29/10/2024 22:30:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
29/10/2024 22:45:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.07					
29/10/2024 23:00:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.07					
29/10/2024 23:15:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.08					
29/10/2024 23:30:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.08					
29/10/2024 23:45:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
30/10/2024 00:00:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.08					
30/10/2024 00:15:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.08					
30/10/2024 00:30:00	0.60	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
30/10/2024 00:45:00	0.60	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.07					
30/10/2024 01:00:00	0.60	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.07					
30/10/2024 01:15:00	0.60	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.08					
30/10/2024 01:30:00	0.60	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
30/10/2024 01:45:00	0.60	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
30/10/2024 02:00:00	0.60	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
30/10/2024 02:15:00	0.60	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.06					
30/10/2024 02:30:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.08					
30/10/2024 02:45:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.07					
30/10/2024 03:00:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.06					
30/10/2024 03:15:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.06					
30/10/2024 03:30:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.06					
30/10/2024 03:45:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.06					
30/10/2024 04:00:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.49	0.07					
30/10/2024 04:15:00	0.57	0.00	0.04	0.01	0.18	0.18	0.12	0.49	0.06					
30/10/2024 04:30:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.06					
30/10/2024 04:45:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.08					
30/10/2024 05:00:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
30/10/2024 05:15:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.06					
30/10/2024 05:30:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.07					
30/10/2024 05:45:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.06					
30/10/2024 06:00:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
30/10/2024 06:15:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
30/10/2024 06:30:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
30/10/2024 06:45:00	0.56		0.03	0.01	0.17	0.17	0.12	0.49	0.07					
30/10/2024 07:00:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
30/10/2024 07:15:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
30/10/2024 07:30:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
30/10/2024 07:45:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.08					
30/10/2024 08:00:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
30/10/2024 08:15:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.08					
30/10/2024 08:30:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.08					
30/10/2024 08:45:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
30/10/2024 09:00:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
30/10/2024 09:15:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
30/10/2024 09:30:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
30/10/2024 09:45:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.08					
30/10/2024 10:00:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
30/10/2024 10:15:00	0.59	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.08					
30/10/2024 10:30:00	0.60	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.07					
30/10/2024 10:45:00	0.60	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.07					
30/10/2024 11:00:00	0.60	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.08					
30/10/2024 11:15:00	0.61	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.09					
30/10/2024 11:30:00	0.61	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.09					
30/10/2024 11:45:00	0.61	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
30/10/2024 12:00:00	0.61	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
30/10/2024 12:15:00	0.61	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
30/10/2024 12:30:00	0.62	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.09					
30/10/2024 12:45:00	0.61	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.08					
30/10/2024 13:00:00	0.61	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
30/10/2024 13:15:00	0.61	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.08					
30/10/2024 13:30:00	0.61	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.08					
30/10/2024 13:45:00	0.60	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.08					
30/10/2024 14:00:00	0.60	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					
30/10/2024 14:15:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.07					
30/10/2024 14:30:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.09					
30/10/2024 14:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.09					
30/10/2024 15:00:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.07					
30/10/2024 15:15:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.08					
30/10/2024 15:30:00	0.57	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
30/10/2024 15:45:00	0.57	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
30/10/2024 16:00:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.07					
30/10/2024 16:15:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
30/10/2024 16:30:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
30/10/2024 16:45:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
30/10/2024 17:00:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.06					
30/10/2024 17:15:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
30/10/2024 17:30:00	0.55		0.04	0.01	0.18	0.18	0.12	0.51	0.07					
30/10/2024 17:45:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.06					
30/10/2024 18:00:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
30/10/2024 18:15:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
30/10/2024 18:30:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
30/10/2024 18:45:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
30/10/2024 19:00:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
30/10/2024 19:15:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
30/10/2024 19:30:00	0.54	-0.01	0.04	0.01	0.18	0.18	0.12	0.51	0.09					
30/10/2024 19:45:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
30/10/2024 20:00:00	0.54	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.08					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
30/10/2024 20:15:00	0.54	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.08					
30/10/2024 20:30:00	0.54	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.08					
30/10/2024 20:45:00	0.54	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.08					
30/10/2024 21:00:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
30/10/2024 21:15:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
30/10/2024 21:30:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
30/10/2024 21:45:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.09					
30/10/2024 22:00:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
30/10/2024 22:15:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
30/10/2024 22:30:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.09					
30/10/2024 22:45:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.07					
30/10/2024 23:00:00	0.57		0.04	0.01	0.18	0.18	0.13	0.52	0.07					
30/10/2024 23:15:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
30/10/2024 23:30:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.06					
30/10/2024 23:45:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
31/10/2024 00:00:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
31/10/2024 00:15:00	0.58	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.08					
31/10/2024 00:30:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.08					
31/10/2024 00:45:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.07					
31/10/2024 01:00:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.51	0.06					
31/10/2024 01:15:00	0.59	-0.02	0.04	0.01	0.18	0.18	0.13	0.50	0.06					
31/10/2024 01:30:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.07					
31/10/2024 01:45:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.06					
31/10/2024 02:00:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.06					
31/10/2024 02:15:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.06					
31/10/2024 02:30:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.06					
31/10/2024 02:45:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.06					
31/10/2024 03:00:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.06					
31/10/2024 03:15:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.05					
31/10/2024 03:30:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.05					
31/10/2024 03:45:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.06					
31/10/2024 04:00:00	0.56	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.06					
31/10/2024 04:15:00	0.56	0.00	0.03	0.01	0.17	0.18	0.12	0.50	0.07					
31/10/2024 04:30:00	0.55	0.00	0.03	0.01	0.17	0.18	0.12	0.50	0.06					
31/10/2024 04:45:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.05					
31/10/2024 05:00:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.06					
31/10/2024 05:15:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
31/10/2024 05:30:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
31/10/2024 05:45:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.05					
31/10/2024 06:00:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.05					
31/10/2024 06:15:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.05					
31/10/2024 06:30:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
31/10/2024 06:45:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
31/10/2024 07:00:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
31/10/2024 07:15:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.05					
31/10/2024 07:30:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
31/10/2024 07:45:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
31/10/2024 08:00:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
31/10/2024 08:15:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
31/10/2024 08:30:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
31/10/2024 08:45:00	0.54	0.00	0.03	0.01	0.17	0.17	0.11	0.50	0.08					
31/10/2024 09:00:00	0.54	0.00	0.03	0.01	0.17	0.17	0.11	0.50	0.06					
31/10/2024 09:15:00	0.55	0.00	0.03	0.01	0.17	0.17	0.11	0.50	0.07					
31/10/2024 09:30:00	0.55	0.00	0.03	0.01	0.17	0.17	0.11	0.50	0.07					
31/10/2024 09:45:00	0.55	0.00	0.02	0.01	0.17	0.17	0.11	0.50	0.07					
31/10/2024 10:00:00	0.56	0.00	0.02	0.01	0.17	0.17	0.11	0.50	0.07					
31/10/2024 10:15:00	0.56	0.00	0.02	0.01	0.17	0.17	0.11	0.50	0.07					
31/10/2024 10:30:00	0.56	0.00	0.02	0.01	0.17	0.17	0.11	0.51	0.08					
31/10/2024 10:45:00	0.56	0.00	0.03	0.01	0.17	0.17	0.11	0.51	0.06					
31/10/2024 11:00:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.08					
31/10/2024 11:15:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.08					
31/10/2024 11:30:00	0.57	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.06					
31/10/2024 11:45:00	0.58		0.02	0.01	0.17	0.17	0.12	0.51	0.08					
31/10/2024 12:00:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.07					
31/10/2024 12:15:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.07					
31/10/2024 12:30:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
31/10/2024 12:45:00	0.59	-0.01	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
31/10/2024 13:00:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.07					
31/10/2024 13:15:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
31/10/2024 13:30:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.07					
31/10/2024 13:45:00	0.59	-0.01	0.03	0.01	0.17	0.17	0.12	0.52	0.07					
31/10/2024 14:00:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
31/10/2024 14:15:00	0.58	0.00	0.03	0.01	0.17	0.18	0.12	0.51	0.08					
31/10/2024 14:30:00	0.58	0.00	0.03	0.01	0.17	0.18	0.12	0.51	0.07					
31/10/2024 14:45:00	0.57	0.00	0.03	0.01	0.17	0.18	0.12	0.51	0.08					
31/10/2024 15:00:00	0.57	0.01	0.03	0.01	0.17	0.18	0.12	0.51	0.07					
31/10/2024 15:15:00	0.57	0.00	0.03	0.01	0.17	0.18	0.12	0.51	0.07					
31/10/2024 15:30:00	0.56	0.00	0.04	0.01	0.17	0.18	0.12	0.51	0.07					
31/10/2024 15:45:00	0.56	-0.02	0.04	0.01	0.17	0.18	0.12	0.51	0.07					
31/10/2024 16:00:00	0.56	-0.03	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
31/10/2024 16:15:00	0.55	0.00	0.03	0.01	0.18	0.18	0.12	0.51	0.06					
31/10/2024 16:30:00	0.55	-0.02	0.04	0.01	0.18	0.18	0.12	0.51	0.06					
31/10/2024 16:45:00	0.55	-0.01	0.03	0.01	0.18	0.18	0.12	0.51	0.07					
31/10/2024 17:00:00	0.55	-0.02	0.03	0.01	0.18	0.18	0.12	0.51	0.05					
31/10/2024 17:15:00	0.54	-0.01	0.03	0.01	0.18	0.18	0.12	0.51	0.07					
31/10/2024 17:30:00	0.54	-0.02	0.03	0.01	0.18	0.18	0.12	0.51	0.07					
31/10/2024 17:45:00	0.54	-0.01	0.03	0.01	0.18	0.18	0.12	0.52	0.08					
31/10/2024 18:00:00	0.54	-0.01	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
31/10/2024 18:15:00	0.53	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 18:30:00	0.53	-0.01	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
31/10/2024 18:45:00	0.53	-0.02	0.03	0.01	0.18	0.18	0.12	0.52	0.08					
31/10/2024 19:00:00	0.53	-0.02	0.03	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 19:15:00	0.53	-0.01	0.03	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 19:30:00	0.53	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 19:45:00	0.53	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
31/10/2024 20:00:00	0.53	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
31/10/2024 20:15:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 20:30:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 20:45:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 21:00:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 21:15:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 21:30:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
31/10/2024 21:45:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 22:00:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 22:15:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 22:30:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 22:45:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 23:00:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
31/10/2024 23:15:00	0.57	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
31/10/2024 23:30:00	0.57	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
31/10/2024 23:45:00	0.57	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
01/11/2024 00:00:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
01/11/2024 00:15:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.06					
01/11/2024 00:30:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
01/11/2024 00:45:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.06					
01/11/2024 01:00:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.06					
01/11/2024 01:15:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.06					
01/11/2024 01:30:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.06					
01/11/2024 01:45:00	0.59		0.04	0.01	0.18	0.18	0.12	0.50	0.06					
01/11/2024 02:00:00	0.60	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.05					
01/11/2024 02:15:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.07					
01/11/2024 02:30:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.06					
01/11/2024 02:45:00	0.59	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.06					
01/11/2024 03:00:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.06					
01/11/2024 03:15:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.07					
01/11/2024 03:30:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.50	0.06					
01/11/2024 03:45:00	0.58	0.00	0.03	0.01	0.18	0.18	0.12	0.49	0.05					
01/11/2024 04:00:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
01/11/2024 04:15:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
01/11/2024 04:30:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
01/11/2024 04:45:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.04					
01/11/2024 05:00:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.05					
01/11/2024 05:15:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
01/11/2024 05:30:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.05					
01/11/2024 05:45:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
01/11/2024 06:00:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
01/11/2024 06:15:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
01/11/2024 06:30:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.05					
01/11/2024 06:45:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
01/11/2024 07:00:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
01/11/2024 07:15:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
01/11/2024 07:30:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
01/11/2024 07:45:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
01/11/2024 08:00:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
01/11/2024 08:15:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
01/11/2024 08:30:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
01/11/2024 08:45:00	0.56		0.03	0.01	0.17	0.17	0.12	0.51	0.06					
01/11/2024 09:00:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.06					
01/11/2024 09:15:00	0.56	0.00	0.03	0.01	0.17	0.17	0.11	0.51	0.07					
01/11/2024 09:30:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
01/11/2024 09:45:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
01/11/2024 10:00:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.08					
01/11/2024 10:15:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.08					
01/11/2024 10:30:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
01/11/2024 10:45:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
01/11/2024 11:00:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
01/11/2024 11:15:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
01/11/2024 11:30:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
01/11/2024 11:45:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.09					
01/11/2024 12:00:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
01/11/2024 12:15:00	0.59	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.07					
01/11/2024 12:30:00	0.60	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.07					
01/11/2024 12:45:00	0.60	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.09					
01/11/2024 13:00:00	0.60	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
01/11/2024 13:15:00	0.60	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.08					
01/11/2024 13:30:00	0.61	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.08					
01/11/2024 13:45:00	0.61	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.08					
01/11/2024 14:00:00	0.61	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
01/11/2024 14:15:00	0.61	0.00	0.04	0.01	0.18	0.17	0.12	0.52	0.07					
01/11/2024 14:30:00	0.61	0.00	0.04	0.01	0.18	0.17	0.12	0.52	0.08					
01/11/2024 14:45:00	0.60	0.00	0.04	0.01	0.18	0.17	0.12	0.51	0.08					
01/11/2024 15:00:00	0.60	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
01/11/2024 15:15:00	0.60	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
01/11/2024 15:30:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
01/11/2024 15:45:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
01/11/2024 16:00:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
01/11/2024 16:15:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
01/11/2024 16:30:00	0.57	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
01/11/2024 16:45:00	0.57	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
01/11/2024 17:00:00	0.57	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.07					
01/11/2024 17:15:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.06					
01/11/2024 17:30:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.51	0.08					
01/11/2024 17:45:00	0.55	0.00	0.04	0.02	0.18	0.18	0.12	0.51	0.08					
01/11/2024 18:00:00	0.55	0.00	0.04	0.02	0.18	0.18	0.12	0.51	0.08					
01/11/2024 18:15:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
01/11/2024 18:30:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
01/11/2024 18:45:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
01/11/2024 19:00:00	0.54	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
01/11/2024 19:15:00	0.54	0.00	0.04	0.02	0.18	0.18	0.12	0.52	0.07					
01/11/2024 19:30:00	0.54	0.00	0.04	0.02	0.18	0.18	0.12	0.52	0.08					
01/11/2024 19:45:00	0.54		0.04	0.02	0.18	0.18	0.12	0.52	0.08					
01/11/2024 20:00:00	0.54	0.00	0.04	0.02	0.18	0.18	0.12	0.52	0.08					
01/11/2024 20:15:00	0.54	0.00	0.04	0.02	0.18	0.18	0.12	0.52	0.08					
01/11/2024 20:30:00	0.54	0.00	0.04	0.02	0.18	0.18	0.12	0.52	0.10					
01/11/2024 20:45:00	0.55	0.00	0.04	0.02	0.18	0.17	0.12	0.52	0.09					
01/11/2024 21:00:00	0.55	0.00	0.04	0.02	0.18	0.18	0.12	0.52	0.08					
01/11/2024 21:15:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.09					
01/11/2024 21:30:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.53	0.09					
01/11/2024 21:45:00	0.56	0.00	0.04	0.02	0.18	0.18	0.13	0.53	0.09					
01/11/2024 22:00:00	0.56	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
01/11/2024 22:15:00	0.56	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
01/11/2024 22:30:00	0.56	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
01/11/2024 22:45:00	0.57	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.06					
01/11/2024 23:00:00	0.57	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
01/11/2024 23:15:00	0.57	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
01/11/2024 23:30:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
01/11/2024 23:45:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
02/11/2024 00:00:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.08					
02/11/2024 00:15:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.07					
02/11/2024 00:30:00	0.59	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.07					
02/11/2024 00:45:00	0.59	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.08					
02/11/2024 01:00:00	0.59	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.08					
02/11/2024 01:15:00	0.59	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.06					
02/11/2024 01:30:00	0.60	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.08					
02/11/2024 01:45:00	0.60	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.08					
02/11/2024 02:00:00	0.60	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.07					
02/11/2024 02:15:00	0.60	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.08					
02/11/2024 02:30:00	0.60	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.08					
02/11/2024 02:45:00	0.60	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.07					
02/11/2024 03:00:00	0.60	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.07					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
02/11/2024 03:15:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.08					
02/11/2024 03:30:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.06					
02/11/2024 03:45:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.49	0.07					
02/11/2024 04:00:00	0.58	0.00	0.04	0.01	0.18	0.17	0.12	0.49	0.06					
02/11/2024 04:15:00	0.58	0.00	0.04	0.01	0.18	0.17	0.12	0.49	0.07					
02/11/2024 04:30:00	0.57	0.00	0.04	0.01	0.18	0.17	0.12	0.49	0.07					
02/11/2024 04:45:00	0.57	0.00	0.04	0.01	0.18	0.17	0.12	0.49	0.07					
02/11/2024 05:00:00	0.57	0.00	0.04	0.01	0.18	0.17	0.12	0.49	0.05					
02/11/2024 05:15:00	0.56	0.00	0.04	0.01	0.17	0.17	0.12	0.49	0.06					
02/11/2024 05:30:00	0.56		0.04	0.01	0.17	0.17	0.12	0.49	0.07					
02/11/2024 05:45:00	0.56		0.04	0.01	0.17	0.17	0.12	0.49	0.07					
02/11/2024 06:00:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
02/11/2024 06:15:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.08					
02/11/2024 06:30:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
02/11/2024 06:45:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
02/11/2024 07:00:00	0.54	-0.02	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
02/11/2024 07:15:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
02/11/2024 07:30:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
02/11/2024 07:45:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.08					
02/11/2024 08:00:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
02/11/2024 08:15:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
02/11/2024 08:30:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.08					
02/11/2024 08:45:00	0.54	0.00	0.03	0.01	0.17	0.17	0.11	0.49	0.08					
02/11/2024 09:00:00	0.54	0.00	0.03	0.01	0.17	0.17	0.11	0.50	0.09					
02/11/2024 09:15:00	0.54	0.00	0.03	0.01	0.17	0.17	0.11	0.50	0.08					
02/11/2024 09:30:00	0.54	0.00	0.03	0.01	0.17	0.17	0.11	0.50	0.09					
02/11/2024 09:45:00	0.54	0.00	0.03	0.01	0.17	0.17	0.11	0.51	0.08					
02/11/2024 10:00:00	0.55	0.00	0.03	0.01	0.17	0.17	0.11	0.51	0.08					
02/11/2024 10:15:00	0.55	0.00	0.03	0.01	0.17	0.17	0.11	0.51	0.08					
02/11/2024 10:30:00	0.55	0.00	0.03	0.01	0.17	0.17	0.11	0.52	0.08					
02/11/2024 10:45:00	0.55	0.00	0.03	0.01	0.17	0.17	0.11	0.52	0.09					
02/11/2024 11:00:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.09					
02/11/2024 11:15:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
02/11/2024 11:30:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.07					
02/11/2024 11:45:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
02/11/2024 12:00:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
02/11/2024 12:15:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.08					
02/11/2024 12:30:00	0.57	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.08					
02/11/2024 12:45:00	0.58	0.00	0.03	0.01	0.17	0.17	0.12	0.54	0.09					
02/11/2024 13:00:00	0.58	0.00	0.03	0.01	0.18	0.17	0.12	0.54	0.09					
02/11/2024 13:15:00	0.58	0.00	0.03	0.01	0.18	0.17	0.12	0.54	0.09					
02/11/2024 13:30:00	0.58	0.00	0.04	0.01	0.18	0.17	0.12	0.54	0.10					
02/11/2024 13:45:00	0.59	0.00	0.04	0.01	0.18	0.18	0.12	0.54	0.08					
02/11/2024 14:00:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.54	0.08					
02/11/2024 14:15:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.54	0.10					
02/11/2024 14:30:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.54	0.11					
02/11/2024 14:45:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.54	0.09					
02/11/2024 15:00:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.54	0.09					
02/11/2024 15:15:00	0.57	0.00	0.05	0.02	0.19	0.18	0.13	0.54	0.08					
02/11/2024 15:30:00	0.57	0.00	0.05	0.02	0.19	0.18	0.13	0.54	0.09					
02/11/2024 15:45:00	0.57	0.00	0.05	0.02	0.19	0.18	0.13	0.53	0.09					
02/11/2024 16:00:00	0.56	0.00	0.05	0.02	0.19	0.18	0.14	0.53	0.08					
02/11/2024 16:15:00	0.56	0.00	0.05	0.02	0.19	0.18	0.14	0.53	0.09					
02/11/2024 16:30:00	0.56	0.00	0.05	0.02	0.19	0.18	0.14	0.53	0.07					
02/11/2024 16:45:00	0.55	0.00	0.05	0.02	0.19	0.18	0.14	0.53	0.09					
02/11/2024 17:00:00	0.55	0.00	0.05	0.02	0.19	0.18	0.14	0.53	0.08					
02/11/2024 17:15:00	0.55	0.00	0.05	0.02	0.19	0.18	0.14	0.53	0.08					
02/11/2024 17:30:00	0.54	0.00	0.05	0.02	0.19	0.18	0.14	0.53	0.09					
02/11/2024 17:45:00	0.54	0.00	0.05	0.02	0.19	0.18	0.14	0.53	0.09					
02/11/2024 18:00:00	0.54	0.00	0.05	0.02	0.19	0.19	0.14	0.53	0.09					
02/11/2024 18:15:00	0.54	0.00	0.05	0.02	0.19	0.19	0.14	0.53	0.09					
02/11/2024 18:30:00	0.53	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.09					
02/11/2024 18:45:00	0.53	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.09					
02/11/2024 19:00:00	0.53	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.09					
02/11/2024 19:15:00	0.53	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.10					
02/11/2024 19:30:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.09					
02/11/2024 19:45:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.10					
02/11/2024 20:00:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.08					
02/11/2024 20:15:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.09					
02/11/2024 20:30:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.09					
02/11/2024 20:45:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.10					
02/11/2024 21:00:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.08					
02/11/2024 21:15:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.09					
02/11/2024 21:30:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.10					
02/11/2024 21:45:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.10					
02/11/2024 22:00:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.09					
02/11/2024 22:15:00	0.52	0.00	0.05	0.02	0.19	0.19	0.14	0.54	0.10					
02/11/2024 22:30:00	0.52	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.10					
02/11/2024 22:45:00	0.53	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.09					
02/11/2024 23:00:00	0.53	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.09					
02/11/2024 23:15:00	0.53	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.09					
02/11/2024 23:30:00	0.53	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.07					
02/11/2024 23:45:00	0.54	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.10					
03/11/2024 00:00:00	0.54	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.08					
03/11/2024 00:15:00	0.54	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.09					
03/11/2024 00:30:00	0.55	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.09					
03/11/2024 00:45:00	0.55	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.09					
03/11/2024 01:00:00	0.55	0.00	0.05	0.02	0.20	0.19	0.14	0.54	0.08					
03/11/2024 01:15:00	0.55	0.00	0.05	0.02	0.20	0.19	0.14	0.53	0.08					
03/11/2024 01:30:00	0.56	0.00	0.05	0.02	0.20	0.19	0.14	0.53	0.08					
03/11/2024 01:45:00	0.56	0.00	0.05	0.02	0.19	0.19	0.14	0.53	0.08					
03/11/2024 02:00:00	0.56	0.00	0.05	0.02	0.19	0.19	0.14	0.52	0.07					
03/11/2024 02:15:00	0.57	0.00	0.05	0.02	0.19	0.19	0.14	0.52	0.07					
03/11/2024 02:30:00	0.57	0.00	0.05	0.02	0.19	0.19	0.14	0.52	0.08					
03/11/2024 02:45:00	0.57	0.00	0.05	0.02	0.19	0.19	0.14	0.51	0.07					
03/11/2024 03:00:00	0.57	0.00	0.05	0.02	0.19	0.19	0.14	0.51	0.07					
03/11/2024 03:15:00	0.57	0.00	0.05	0.02	0.19	0.19	0.14	0.51	0.07					
03/11/2024 03:30:00	0.56	0.00	0.05	0.02	0.19	0.19	0.14	0.51	0.06					
03/11/2024 03:45:00	0.56	0.00	0.05	0.02	0.19	0.19	0.14	0.51	0.06					
03/11/2024 04:00:00	0.56	0.00	0.05	0.02	0.19	0.19	0.14	0.51	0.06					
03/11/2024 04:15:00	0.56	0.00	0.05	0.02	0.19	0.19	0.14	0.50	0.05					
03/11/2024 04:30:00	0.55	0.00	0.05	0.02	0.19	0.18	0.13	0.50	0.08					
03/11/2024 04:45:00	0.55	0.00	0.05	0.02	0.19	0.18	0.13	0.50	0.08					
03/11/2024 05:00:00	0.55	0.00	0.05	0.02	0.19	0.18	0.13	0.50	0.05					
03/11/2024 05:15:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.06					
03/11/2024 05:30:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.08					
03/11/2024 05:45:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.07					
03/11/2024 06:00:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.06					
03/11/2024 06:15:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.06					
03/11/2024 06:30:00	0.53	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.07					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
03/11/2024 06:45:00	0.53	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.05					
03/11/2024 07:00:00	0.53	-0.02	0.04	0.02	0.18	0.18	0.12	0.50	0.06					
03/11/2024 07:15:00	0.53	-0.01	0.04	0.02	0.18	0.18	0.12	0.49	0.07					
03/11/2024 07:30:00	0.53	-0.01	0.04	0.01	0.18	0.18	0.12	0.49	0.06					
03/11/2024 07:45:00	0.52	0.00	0.04	0.01	0.18	0.18	0.12	0.49	0.07					
03/11/2024 08:00:00	0.52	0.00	0.04	0.01	0.18	0.18	0.12	0.49	0.07					
03/11/2024 08:15:00	0.52	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.07					
03/11/2024 08:30:00	0.52	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.06					
03/11/2024 08:45:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
03/11/2024 09:00:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
03/11/2024 09:15:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.06					
03/11/2024 09:30:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
03/11/2024 09:45:00	0.53		0.03	0.01	0.17	0.17	0.12	0.50	0.08					
03/11/2024 10:00:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.06					
03/11/2024 10:15:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
03/11/2024 10:30:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07					
03/11/2024 10:45:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.07					
03/11/2024 11:00:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.09					
03/11/2024 11:15:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
03/11/2024 11:30:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.52	0.08					
03/11/2024 11:45:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.09					
03/11/2024 12:00:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.08					
03/11/2024 12:15:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.08					
03/11/2024 12:30:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.09					
03/11/2024 12:45:00	0.56	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.09					
03/11/2024 13:00:00	0.57	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.08					
03/11/2024 13:15:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.53	0.07					
03/11/2024 13:30:00	0.57	0.00	0.03	0.01	0.18	0.18	0.12	0.53	0.09					
03/11/2024 13:45:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.53	0.09					
03/11/2024 14:00:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.53	0.07					
03/11/2024 14:15:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.53	0.07					
03/11/2024 14:30:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.53	0.09					
03/11/2024 14:45:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.53	0.08					
03/11/2024 15:00:00	0.59	0.00	0.04	0.02	0.18	0.18	0.13	0.53	0.07					
03/11/2024 15:15:00	0.59	0.00	0.04	0.02	0.18	0.18	0.13	0.53	0.07					
03/11/2024 15:30:00	0.59	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 15:45:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 16:00:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.08					
03/11/2024 16:15:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 16:30:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
03/11/2024 16:45:00	0.57	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.07					
03/11/2024 17:00:00	0.57	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
03/11/2024 17:15:00	0.57	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
03/11/2024 17:30:00	0.56	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
03/11/2024 17:45:00	0.56	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 18:00:00	0.56	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 18:15:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 18:30:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
03/11/2024 18:45:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
03/11/2024 19:00:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 19:15:00	0.54		0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 19:30:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 19:45:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.09					
03/11/2024 20:00:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.53	0.07					
03/11/2024 20:15:00	0.53	0.00	0.04	0.02	0.18	0.18	0.13	0.53	0.09					
03/11/2024 20:30:00	0.53	0.00	0.04	0.02	0.18	0.18	0.13	0.53	0.08					
03/11/2024 20:45:00	0.53	0.00	0.04	0.02	0.18	0.18	0.13	0.53	0.09					
03/11/2024 21:00:00	0.53		0.04	0.02	0.18	0.18	0.13	0.53	0.08					
03/11/2024 21:15:00	0.53	0.00	0.04	0.02	0.18	0.18	0.13	0.53	0.08					
03/11/2024 21:30:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.53	0.08					
03/11/2024 21:45:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.09					
03/11/2024 22:00:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 22:15:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.09					
03/11/2024 22:30:00	0.54	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 22:45:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 23:00:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 23:15:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 23:30:00	0.55	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.08					
03/11/2024 23:45:00	0.56		0.04	0.02	0.18	0.18	0.13	0.52	0.08					
04/11/2024 00:00:00	0.56	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
04/11/2024 00:15:00	0.56	0.00	0.04	0.02	0.18	0.18	0.13	0.52	0.07					
04/11/2024 00:30:00	0.56	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.07					
04/11/2024 00:45:00	0.57	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.07					
04/11/2024 01:00:00	0.57	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.07					
04/11/2024 01:15:00	0.57	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.07					
04/11/2024 01:30:00	0.57	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.08					
04/11/2024 01:45:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.06					
04/11/2024 02:00:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.51	0.07					
04/11/2024 02:15:00	0.58	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.07					
04/11/2024 02:30:00	0.59	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.07					
04/11/2024 02:45:00	0.59	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.06					
04/11/2024 03:00:00	0.59	0.00	0.04	0.01	0.18	0.18	0.13	0.50	0.06					
04/11/2024 03:15:00	0.59	0.00	0.04	0.02	0.18	0.18	0.13	0.50	0.07					
04/11/2024 03:30:00	0.59	0.00	0.04	0.02	0.18	0.18	0.12	0.50	0.06					
04/11/2024 03:45:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.07					
04/11/2024 04:00:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.06					
04/11/2024 04:15:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.07					
04/11/2024 04:30:00	0.58	0.00	0.04	0.01	0.18	0.18	0.12	0.50	0.06					
04/11/2024 04:45:00	0.57		0.04	0.01	0.18	0.18	0.12	0.49	0.08					
04/11/2024 05:00:00	0.57	0.00	0.04	0.01	0.18	0.17	0.12	0.49	0.06					
04/11/2024 05:15:00	0.57	0.00	0.04	0.01	0.17	0.17	0.12	0.49	0.06					
04/11/2024 05:30:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06					
04/11/2024 05:45:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
04/11/2024 06:00:00	0.56	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
04/11/2024 06:15:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
04/11/2024 06:30:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
04/11/2024 06:45:00	0.55	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
04/11/2024 07:00:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
04/11/2024 07:15:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
04/11/2024 07:30:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
04/11/2024 07:45:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07					
04/11/2024 08:00:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
04/11/2024 08:15:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
04/11/2024 08:30:00	0.53	0.00	0.03	0.01	0.17	0.17	0.11	0.50	0.08					
04/11/2024 08:45:00	0.53	0.00	0.03	0.01	0.17	0.17	0.11	0.51	0.08					
04/11/2024 09:00:00	0.53	0.00	0.03	0.01	0.17	0.17	0.11	0.52	0.08					
04/11/2024 09:15:00	0.53	0.00	0.03	0.01	0.17	0.17	0.11	0.52	0.08					
04/11/2024 09:30:00	0.53	0.00	0.03	0.01	0.17	0.17	0.11	0.53	0.08					
04/11/2024 09:45:00	0.53	0.00	0.03	0.01	0.17	0.17	0.11	0.53	0.08					
04/11/2024 10:00:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.08					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
04/11/2024 10:15:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.09					
04/11/2024 10:30:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.08					
04/11/2024 10:45:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.07					
04/11/2024 11:00:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.09					
04/11/2024 11:15:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.07					
04/11/2024 11:30:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.07					
04/11/2024 11:45:00	0.54	0.00	0.03	0.01	0.17	0.17	0.12	0.53	0.08					
04/11/2024 12:00:00	0.55	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.09					
04/11/2024 12:15:00	0.55	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.07					
04/11/2024 12:30:00	0.55	0.00	0.03	0.01	0.18	0.18	0.12	0.52	0.08					
04/11/2024 12:45:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.06					
04/11/2024 13:00:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
04/11/2024 13:15:00	0.55	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.07					
04/11/2024 13:30:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.09					
04/11/2024 13:45:00	0.56	0.00	0.04	0.01	0.18	0.18	0.12	0.52	0.08					
04/11/2024 14:00:00	0.56	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.07					
04/11/2024 14:15:00	0.56		0.03	0.01	0.18	0.18	0.13	0.52	0.08					
04/11/2024 14:30:00	0.56	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.06					
04/11/2024 14:45:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.07					
04/11/2024 15:00:00	0.57	0.00	0.04	0.01	0.18	0.18	0.13	0.52	0.06					
04/11/2024 15:15:00	0.57	0.00	0.03	0.01	0.18	0.18	0.13	0.52	0.06					
04/11/2024 15:30:00	0.57	0.00	0.03	0.01	0.18	0.16	0.13	0.51	0.07					
04/11/2024 15:45:00	0.56	0.00	0.03	0.01	0.18	0.17	0.13	0.51	0.05					
04/11/2024 16:00:00	0.56	0.00	0.03	0.01	0.18	0.17	0.13	0.51	0.06					
04/11/2024 16:15:00	0.55	0.00	0.04	0.01	0.18	0.17	0.13	0.51	0.07					
04/11/2024 16:30:00	0.55	0.00	0.04	0.01	0.18	0.17	0.12	0.51	0.07					
04/11/2024 16:45:00	0.55	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.07					
04/11/2024 17:00:00	0.54	0.00	0.04	0.01	0.18	0.17	0.12	0.51	0.07					
04/11/2024 17:15:00	0.54	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.08					
04/11/2024 17:30:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.07					
04/11/2024 17:45:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
04/11/2024 18:00:00	0.52	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
04/11/2024 18:15:00	0.52	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
04/11/2024 18:30:00	0.51	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
04/11/2024 18:45:00	0.51	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
04/11/2024 19:00:00	0.50	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.08					
04/11/2024 19:15:00	0.50	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
04/11/2024 19:30:00	0.50	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
04/11/2024 19:45:00	0.49	0.00	0.03	0.01	0.18	0.17	0.12	0.52	0.07					
04/11/2024 20:00:00	0.49	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.06					
04/11/2024 20:15:00	0.48	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.08					
04/11/2024 20:30:00	0.48	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.08					
04/11/2024 20:45:00	0.48	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.07					
04/11/2024 21:00:00	0.48	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.07					
04/11/2024 21:15:00	0.48	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.08					
04/11/2024 21:30:00	0.48	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.08					
04/11/2024 21:45:00	0.48	0.00	0.03	0.01	0.18	0.17	0.12	0.53	0.08					
04/11/2024 22:00:00	0.48	0.00	0.03	0.01	0.18	0.17	0.13	0.53	0.08					
04/11/2024 22:15:00	0.48	0.00	0.03	0.01	0.18	0.17	0.13	0.53	0.07					
04/11/2024 22:30:00	0.48	0.00	0.04	0.01	0.18	0.17	0.13	0.53	0.07					
04/11/2024 22:45:00	0.48	0.00	0.04	0.01	0.18	0.17	0.13	0.53	0.10					
04/11/2024 23:00:00	0.48	0.00	0.04	0.01	0.18	0.17	0.13	0.53	0.08					
04/11/2024 23:15:00	0.48	0.00	0.04	0.01	0.18	0.17	0.13	0.53	0.08					
04/11/2024 23:30:00	0.49	0.00	0.04	0.01	0.18	0.17	0.13	0.53	0.08					
04/11/2024 23:45:00	0.49	0.00	0.04	0.01	0.18	0.17	0.13	0.52	0.07					
05/11/2024 00:00:00	0.49	0.00	0.04	0.01	0.18	0.17	0.13	0.52	0.07					
05/11/2024 00:15:00	0.50	0.00	0.04	0.01	0.18	0.17	0.13	0.52	0.06					
05/11/2024 00:30:00	0.50	0.00	0.04	0.01	0.18	0.17	0.13	0.52	0.07					
05/11/2024 00:45:00	0.50	0.00	0.04	0.01	0.18	0.17	0.13	0.52	0.07					
05/11/2024 01:00:00	0.50	0.00	0.04	0.01	0.18	0.17	0.13	0.52	0.07					
05/11/2024 01:15:00	0.51	0.00	0.04	0.01	0.18	0.17	0.13	0.52	0.08					
05/11/2024 01:30:00	0.51	0.00	0.04	0.01	0.18	0.17	0.13	0.51	0.06					
05/11/2024 01:45:00	0.51	0.00	0.04	0.01	0.18	0.17	0.13	0.51	0.07					
05/11/2024 02:00:00	0.52	0.00	0.04	0.01	0.18	0.17	0.13	0.51	0.07					
05/11/2024 02:15:00	0.52	0.00	0.04	0.01	0.18	0.17	0.13	0.51	0.08					
05/11/2024 02:30:00	0.52	0.00	0.04	0.01	0.18	0.17	0.13	0.51	0.06					
05/11/2024 02:45:00	0.53	0.00	0.04	0.01	0.18	0.17	0.13	0.51	0.06					
05/11/2024 03:00:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.08					
05/11/2024 03:15:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.07					
05/11/2024 03:30:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.06					
05/11/2024 03:45:00	0.53		0.03	0.01	0.18	0.17	0.12	0.50	0.06					
05/11/2024 04:00:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.07					
05/11/2024 04:15:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.06					
05/11/2024 04:30:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.07					
05/11/2024 04:45:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
05/11/2024 05:00:00	0.52	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
05/11/2024 05:15:00	0.52	0.00	0.03	0.01	0.17	0.17	0.12	0.48	0.08					
05/11/2024 05:30:00	0.52	0.00	0.03	0.01	0.17	0.17	0.12	0.48	0.07					
05/11/2024 05:45:00	0.51	0.00	0.03	0.01	0.17	0.17	0.12	0.48	0.07					
05/11/2024 06:00:00	0.51	0.00	0.03	0.01	0.17	0.17	0.12	0.48	0.07					
05/11/2024 06:15:00	0.51	0.00	0.03	0.01	0.17	0.17	0.12	0.48	0.06					
05/11/2024 06:30:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.48	0.07					
05/11/2024 06:45:00	0.50	0.00	0.03	0.01	0.17	0.16	0.12	0.48	0.07					
05/11/2024 07:00:00	0.50	0.00	0.03	0.01	0.17	0.16	0.12	0.48	0.07					
05/11/2024 07:15:00	0.50	0.00	0.03	0.01	0.17	0.16	0.12	0.48	0.06					
05/11/2024 07:30:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.49	0.05					
05/11/2024 07:45:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.49	0.07					
05/11/2024 08:00:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.49	0.08					
05/11/2024 08:15:00	0.49	0.00	0.03	0.01	0.17	0.16	0.11	0.49	0.09					
05/11/2024 08:30:00	0.48	0.00	0.03	0.01	0.17	0.16	0.11	0.48	0.08					
05/11/2024 08:45:00	0.48	0.00	0.03	0.01	0.17	0.16	0.11	0.49	0.08					
05/11/2024 09:00:00	0.48		0.02	0.01	0.17	0.16	0.11	0.49	0.08					
05/11/2024 09:15:00	0.48	0.08	0.02	0.01	0.17	0.16	0.11	0.50	0.08					
05/11/2024 09:30:00	0.48	0.10	0.02	0.01	0.17	0.16	0.11	0.50	0.08					
05/11/2024 09:45:00	0.48	0.08	0.02	0.01	0.17	0.16	0.11	0.50	0.10					
05/11/2024 10:00:00	0.48	0.07	0.02	0.01	0.17	0.16	0.12	0.50	0.08					
05/11/2024 10:15:00	0.48	0.09	0.02	0.01	0.17	0.16	0.12	0.50	0.08					
05/11/2024 10:30:00	0.48	0.10	0.03	0.01	0.17	0.16	0.12	0.50	0.08					
05/11/2024 10:45:00	0.49	0.00	0.02	0.01	0.17	0.16	0.12	0.50	0.08					
05/11/2024 11:00:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.50	0.09					
05/11/2024 11:15:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.50	0.09					
05/11/2024 11:30:00	0.49	0.08	0.03	0.01	0.17	0.16	0.12	0.50	0.08					
05/11/2024 11:45:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
05/11/2024 12:00:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
05/11/2024 12:15:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08					
05/11/2024 12:30:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.09					
05/11/2024 12:45:00	0.51	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07					
05/11/2024 13:00:00	0.51	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.06					
05/11/2024 13:15:00	0.51	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.08					
05/11/2024 13:30:00	0.51	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.08					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
05/11/2024 13:45:00	0.52	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.08					
05/11/2024 14:00:00	0.52	0.05	0.03	0.01	0.18	0.17	0.12	0.50	0.08					
05/11/2024 14:15:00	0.52	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.09					
05/11/2024 14:30:00	0.52	0.05	0.03	0.01	0.18	0.17	0.12	0.50	0.08					
05/11/2024 14:45:00	0.53	0.06	0.03	0.01	0.18	0.17	0.12	0.50	0.07	0.51	0.08			
05/11/2024 15:00:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.08	0.51	0.08			
05/11/2024 15:15:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.50	0.07	0.51	0.08			
05/11/2024 15:30:00	0.53	0.00	0.03	0.01	0.18	0.17	0.12	0.49	0.07	0.51	0.09			
05/11/2024 15:45:00	0.54	0.05	0.03	0.01	0.18	0.17	0.12	0.49	0.07	0.51	0.08			
05/11/2024 16:00:00	0.54	0.08	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.51	0.08			
05/11/2024 16:15:00	0.54	0.08	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.51	0.09			
05/11/2024 16:30:00	0.53	0.06	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.51	0.08			
05/11/2024 16:45:00	0.53	0.07	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.51	0.08			
05/11/2024 17:00:00	0.53	0.09	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.51	0.08			
05/11/2024 17:15:00	0.53	0.06	0.03	0.01	0.18	0.17	0.12	0.49	0.07	0.51	0.08			
05/11/2024 17:30:00	0.52	0.08	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.51	0.08			
05/11/2024 17:45:00	0.52	0.08	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.51	0.08			
05/11/2024 18:00:00	0.52	0.08	0.03	0.01	0.18	0.17	0.12	0.49	0.07	0.51	0.08			
05/11/2024 18:15:00	0.51	0.08	0.03	0.01	0.18	0.17	0.12	0.50	0.07	0.51	0.08			
05/11/2024 18:30:00	0.51	0.09	0.03	0.01	0.18	0.17	0.12	0.50	0.06	0.51	0.08			
05/11/2024 18:45:00	0.50	0.08	0.03	0.01	0.18	0.17	0.12	0.50	0.06	0.51	0.08			
05/11/2024 19:00:00	0.50	0.08	0.03	0.01	0.18	0.17	0.12	0.50	0.05	0.51	0.08			
05/11/2024 19:15:00	0.50	0.04	0.03	0.01	0.18	0.17	0.12	0.50	0.07	0.51	0.08			
05/11/2024 19:30:00	0.49	0.07	0.03	0.01	0.18	0.17	0.12	0.50	0.08	0.51	0.08			
05/11/2024 19:45:00	0.49	0.09	0.03	0.01	0.18	0.17	0.12	0.50	0.07	0.51	0.07			
05/11/2024 20:00:00	0.49	0.08	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.51	0.08			
05/11/2024 20:15:00	0.49	0.06	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.51	0.07			
05/11/2024 20:30:00	0.48	0.09	0.03	0.01	0.18	0.17	0.12	0.51	0.08	0.51	0.07			
05/11/2024 20:45:00	0.48	0.07	0.04	0.01	0.18	0.17	0.12	0.51	0.07	0.51	0.08			
05/11/2024 21:00:00	0.48	0.04	0.04	0.01	0.18	0.17	0.12	0.51	0.07	0.51	0.08			
05/11/2024 21:15:00	0.48	0.08	0.04	0.01	0.18	0.17	0.12	0.51	0.07	0.51	0.07			
05/11/2024 21:30:00	0.48	0.07	0.04	0.01	0.18	0.17	0.12	0.51	0.07	0.51	0.08			
05/11/2024 21:45:00	0.48	0.08	0.04	0.01	0.18	0.17	0.12	0.51	0.08	0.51	0.08			
05/11/2024 22:00:00	0.48	0.08	0.04	0.01	0.18	0.17	0.12	0.51	0.06	0.51	0.08			
05/11/2024 22:15:00	0.48	0.07	0.04	0.01	0.18	0.17	0.12	0.51	0.06	0.51	0.08			
05/11/2024 22:30:00	0.48	0.08	0.04	0.01	0.18	0.17	0.13	0.50	0.07	0.51	0.09			
05/11/2024 22:45:00	0.48	0.09	0.04	0.01	0.18	0.17	0.13	0.50	0.07	0.51	0.08			
05/11/2024 23:00:00	0.48	0.06	0.04	0.01	0.18	0.17	0.13	0.51	0.06	0.51	0.08			
05/11/2024 23:15:00	0.49	0.08	0.04	0.01	0.18	0.17	0.13	0.51	0.07	0.51	0.08			
05/11/2024 23:30:00	0.49	0.08	0.04	0.01	0.18	0.17	0.13	0.51	0.07	0.51	0.08			
05/11/2024 23:45:00	0.49	0.07	0.04	0.01	0.18	0.17	0.13	0.51	0.08	0.51	0.08			
06/11/2024 00:00:00	0.50	0.07	0.04	0.01	0.18	0.17	0.13	0.51	0.07	0.51	0.08			
06/11/2024 00:15:00	0.50	0.06	0.04	0.01	0.18	0.17	0.13	0.51	0.07	0.51	0.08			
06/11/2024 00:30:00	0.50	0.05	0.04	0.01	0.18	0.17	0.13	0.51	0.07	0.51	0.08			
06/11/2024 00:45:00	0.50	0.05	0.04	0.01	0.18	0.17	0.13	0.51	0.07	0.51	0.08			
06/11/2024 01:00:00	0.51	0.06	0.04	0.01	0.18	0.17	0.13	0.51	0.06	0.51	0.08			
06/11/2024 01:15:00	0.51	0.06	0.04	0.01	0.18	0.17	0.13	0.51	0.05	0.51	0.09			
06/11/2024 01:30:00	0.51	0.06	0.04	0.02	0.18	0.17	0.13	0.50	0.07	0.51	0.08			
06/11/2024 01:45:00	0.52	0.04	0.04	0.02	0.18	0.17	0.13	0.50	0.06	0.51	0.08			
06/11/2024 02:00:00	0.52	0.03	0.04	0.02	0.18	0.17	0.13	0.50	0.05	0.51	0.09			
06/11/2024 02:15:00	0.52	0.06	0.04	0.02	0.18	0.17	0.13	0.49	0.07	0.51	0.07			
06/11/2024 02:30:00	0.53	0.06	0.04	0.02	0.18	0.17	0.13	0.49	0.05	0.51	0.08			
06/11/2024 02:45:00	0.53	0.05	0.04	0.02	0.18	0.17	0.13	0.49	0.05	0.51	0.09			
06/11/2024 03:00:00	0.53	0.04	0.04	0.01	0.18	0.17	0.13	0.49	0.05	0.51	0.07			
06/11/2024 03:15:00	0.53	0.05	0.04	0.01	0.18	0.17	0.13	0.48	0.05	0.51	0.08			
06/11/2024 03:30:00	0.54	0.05	0.04	0.01	0.18	0.17	0.13	0.48	0.06	0.51	0.08			
06/11/2024 03:45:00	0.54	0.03	0.04	0.01	0.18	0.17	0.13	0.48	0.04	0.51	0.08			
06/11/2024 04:00:00	0.54	0.04	0.04	0.01	0.18	0.17	0.13	0.48	0.05	0.51	0.08			
06/11/2024 04:15:00	0.54	0.04	0.04	0.01	0.18	0.17	0.12	0.48	0.04	0.51	0.08			
06/11/2024 04:30:00	0.54	0.03	0.04	0.01	0.18	0.17	0.12	0.48	0.02	0.51	0.08			
06/11/2024 04:45:00	0.54	0.06	0.04	0.01	0.18	0.17	0.12	0.48	0.00	0.52	0.09			
06/11/2024 05:00:00	0.54	0.08	0.04	0.01	0.18	0.17	0.12	0.48	0.02	0.52	0.08			
06/11/2024 05:15:00	0.54	0.07	0.03	0.01	0.18	0.17	0.12	0.47	0.03	0.52	0.09			
06/11/2024 05:30:00	0.53	0.06	0.03	0.01	0.18	0.17	0.12	0.47	0.05	0.52	0.09			
06/11/2024 05:45:00	0.53	0.08	0.03	0.01	0.18	0.17	0.12	0.47	0.06	0.52	0.08			
06/11/2024 06:00:00	0.53	0.05	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.09			
06/11/2024 06:15:00	0.52	0.05	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.09			
06/11/2024 06:30:00	0.52	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.09			
06/11/2024 06:45:00	0.52	0.05	0.03	0.01	0.17	0.16	0.12	0.47	0.05	0.52	0.08			
06/11/2024 07:00:00	0.52	0.08	0.03	0.01	0.17	0.16	0.12	0.47	0.05	0.52	0.09			
06/11/2024 07:15:00	0.51	0.05	0.03	0.01	0.17	0.16	0.12	0.47	0.06	0.52	0.09			
06/11/2024 07:30:00	0.51	0.04	0.03	0.01	0.17	0.16	0.12	0.47	0.06	0.52	0.09			
06/11/2024 07:45:00	0.50	0.07	0.03	0.01	0.17	0.16	0.12	0.47	0.06	0.51	0.09			
06/11/2024 08:00:00	0.50	0.03	0.03	0.01	0.17	0.16	0.12	0.48	0.07	0.51	0.08			
06/11/2024 08:15:00	0.50	0.08	0.03	0.01	0.17	0.16	0.12	0.48	0.06	0.51	0.08			
06/11/2024 08:30:00	0.50	0.07	0.03	0.01	0.17	0.16	0.12	0.49	0.06	0.51	0.08			
06/11/2024 08:45:00	0.49	0.06	0.03	0.01	0.17	0.16	0.11	0.49	0.07	0.51	0.09			
06/11/2024 09:00:00	0.49	0.05	0.03	0.01	0.17	0.16	0.11	0.49	0.07	0.51	0.09			
06/11/2024 09:15:00	0.49	0.08	0.03	0.01	0.17	0.16	0.11	0.49	0.07	0.51	0.09			
06/11/2024 09:30:00	0.49	0.08	0.03	0.01	0.17	0.16	0.11	0.49	0.07	0.51	0.08			
06/11/2024 09:45:00	0.49	0.00	0.03	0.01	0.17	0.16	0.11	0.50	0.06	0.51	0.08			
06/11/2024 10:00:00	0.48	0.00	0.03	0.01	0.17	0.16	0.11	0.50	0.06	0.51	0.08	0.34	0.04	
06/11/2024 10:15:00	0.48	0.00	0.03	0.01	0.17	0.16	0.11	0.50	0.07	0.51	0.08	0.35	0.03	
06/11/2024 10:30:00	0.48	0.06	0.03	0.01	0.17	0.16	0.12	0.50	0.06	0.51	0.08	0.36	0.03	
06/11/2024 10:45:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.50	0.06	0.51	0.08	0.37	0.03	
06/11/2024 11:00:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.50	0.06	0.51	0.08	0.38	0.03	
06/11/2024 11:15:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.50	0.06	0.51	0.08	0.39	0.03	
06/11/2024 11:30:00	0.49	0.04	0.02	0.01	0.17	0.16	0.12	0.50	0.07	0.51	0.09	0.39	0.02	
06/11/2024 11:45:00	0.49	0.04	0.03	0.01	0.17	0.16	0.12	0.50	0.07	0.51	0.09	0.40	0.03	
06/11/2024 12:00:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.50	0.07	0.51	0.09	0.41	0.03	
06/11/2024 12:15:00	0.50	0.00	0.03	0.01	0.17	0.16	0.12	0.50	0.06	0.51	0.09	0.41	0.02	
06/11/2024 12:30:00	0.50	0.03	0.03	0.01	0.17	0.16	0.12	0.50	0.07	0.51	0.08	0.42	0.03	
06/11/2024 12:45:00	0.50	0.00	0.03	0.01	0.17	0.16	0.12	0.50	0.06	0.51	0.08	0.43	0.02	
06/11/2024 13:00:00	0.50	0.06	0.03	0.01	0.17	0.16	0.12	0.50	0.06	0.51	0.09	0.43	0.03	
06/11/2024 13:15:00	0.51	0.07	0.03	0.01	0.17	0.16	0.12	0.50	0.07	0.51	0.09	0.44	0.02	
06/11/2024 13:30:00	0.51	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.51	0.08	0.44	0.03	
06/11/2024 13:45:00	0.51	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.51	0.08	0.45	0.03	
06/11/2024 14:00:00	0.51	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.05	0.51	0.09	0.45	0.03	
06/11/2024 14:15:00	0.52	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.05	0.51	0.08	0.45	0.03	
06/11/2024 14:30:00	0.52	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.04	0.51	0.08	0.46	0.03	
06/11/2024 14:45:00	0.52	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.04	0.51	0.09	0.46	0.03	
06/11/2024 15:00:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.05	0.51	0.08	0.47	0.00	
06/11/2024 15:15:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.51	0.09	0.47	0.03	
06/11/2024 15:30:00	0.53	0.06	0.03	0.01	0.17	0.17	0.12	0.49	0.05	0.52	0.08	0.47	0.03	
06/11/2024 15:45:00	0.53	0.05	0.03	0.01	0.17	0.17	0.12	0.49	0.05	0.52	0.08	0.48	0.03	
06/11/2024 16:00:00	0.54	0.04	0.03	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.08	0.48	0.03	
06/11/2024 16:15:00	0.54	0.05	0.04	0.01	0.17	0.17	0.12	0.49	0.05	0.52	0.09	0.46	0.05	
06/11/2024 16:30:00	0.54	0.05	0.04	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.09	0.44	0.06	
06/11/2024 16:45:00	0.54	0.07	0.03	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.08	0.42	0.06	
06/11/2024 17:00:00	0.54	0.07	0.03	0.01	0.17	0.17	0.12	0.49	0.05	0.52	0.09	0.39	0.07	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
06/11/2024 17:15:00	0.54	0.05	0.03	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.08	0.37	0.06	
06/11/2024 17:30:00	0.54	0.06	0.03	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.08	0.35	0.07	
06/11/2024 17:45:00	0.53	0.05	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.08	0.34	0.08	
06/11/2024 18:00:00	0.53	0.05	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.08	0.32	0.07	
06/11/2024 18:15:00	0.53	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.09	0.31	0.08	
06/11/2024 18:30:00	0.52	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.08	0.29	0.09	
06/11/2024 18:45:00	0.52	0.08	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.09	0.28	0.08	
06/11/2024 19:00:00	0.52	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.09	0.28	0.09	
06/11/2024 19:15:00	0.51	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.52	0.08	0.27	0.11	
06/11/2024 19:30:00	0.51	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.09	0.26	0.08	
06/11/2024 19:45:00	0.51	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.09	0.25	0.11	
06/11/2024 20:00:00	0.50	0.07	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.09	0.25	0.09	
06/11/2024 20:15:00	0.50	0.06	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.08	0.24	0.07	
06/11/2024 20:30:00	0.50	0.06	0.03	0.01	0.18	0.17	0.12	0.51	0.08	0.52	0.08	0.24	0.08	
06/11/2024 20:45:00	0.50	0.06	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.09	0.25	0.06	
06/11/2024 21:00:00	0.49	0.07	0.03	0.01	0.18	0.17	0.12	0.51	0.05	0.52	0.09	0.27	0.06	
06/11/2024 21:15:00	0.49	0.06	0.04	0.01	0.18	0.17	0.12	0.51	0.06	0.52	0.08	0.32	0.05	
06/11/2024 21:30:00	0.49	0.05	0.04	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.09	0.33	0.04	
06/11/2024 21:45:00	0.49	0.07	0.04	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.08	0.35	0.03	
06/11/2024 22:00:00	0.49	0.07	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.09	0.36	0.03	
06/11/2024 22:15:00	0.49	0.08	0.04	0.01	0.18	0.17	0.12	0.51	0.06	0.52	0.09	0.37	0.04	
06/11/2024 22:30:00	0.49	0.06	0.04	0.01	0.18	0.17	0.13	0.51	0.07	0.52	0.08	0.38	0.02	
06/11/2024 22:45:00	0.49	0.06	0.04	0.01	0.18	0.17	0.13	0.51	0.07	0.52	0.08	0.39	0.03	
06/11/2024 23:00:00	0.49	0.06	0.04	0.01	0.18	0.17	0.13	0.50	0.07	0.52	0.08	0.40	0.03	
06/11/2024 23:15:00	0.49	0.00	0.04	0.01	0.18	0.17	0.13	0.50	0.06	0.52	0.08	0.40	0.03	
06/11/2024 23:30:00	0.49	0.07	0.04	0.01	0.18	0.17	0.13	0.51	0.07	0.52	0.08	0.41	0.04	
06/11/2024 23:45:00	0.50	0.06	0.04	0.01	0.18	0.17	0.13	0.51	0.06	0.52	0.08	0.42	0.03	
07/11/2024 00:00:00	0.50	0.07	0.04	0.01	0.18	0.17	0.13	0.51	0.07	0.52	0.08	0.42	0.03	
07/11/2024 00:15:00	0.50	0.06	0.04	0.01	0.18	0.17	0.13	0.51	0.08	0.52	0.08	0.43	0.03	
07/11/2024 00:30:00	0.50	0.05	0.04	0.01	0.18	0.17	0.13	0.50	0.07	0.52	0.08	0.43	0.03	
07/11/2024 00:45:00	0.51	0.00	0.04	0.01	0.18	0.17	0.13	0.50	0.04	0.52	0.08	0.44	0.02	
07/11/2024 01:00:00	0.51	0.05	0.04	0.01	0.18	0.17	0.13	0.50	0.07	0.52	0.09	0.44	0.02	
07/11/2024 01:15:00	0.51	0.00	0.04	0.01	0.18	0.17	0.13	0.50	0.06	0.52	0.09	0.44	0.02	
07/11/2024 01:30:00	0.52	0.05	0.04	0.01	0.18	0.17	0.13	0.49	0.06	0.52	0.08	0.45	0.03	
07/11/2024 01:45:00	0.52	0.06	0.04	0.01	0.18	0.17	0.13	0.49	0.07	0.52	0.09	0.45	-0.04	
07/11/2024 02:00:00	0.52	0.05	0.04	0.01	0.18	0.17	0.13	0.49	0.06	0.52	0.08	0.46	0.04	
07/11/2024 02:15:00	0.52	0.05	0.04	0.01	0.18	0.17	0.13	0.49	0.06	0.52	0.08	0.46	0.03	
07/11/2024 02:30:00	0.53	0.05	0.04	0.01	0.18	0.17	0.13	0.49	0.06	0.52	0.08	0.47	0.03	
07/11/2024 02:45:00	0.53	0.06	0.04	0.01	0.18	0.17	0.13	0.49	0.07	0.52	0.09	0.47	0.03	
07/11/2024 03:00:00	0.53	0.05	0.04	0.01	0.18	0.17	0.13	0.48	0.06	0.52	0.08	0.47	0.02	
07/11/2024 03:15:00	0.54	0.05	0.04	0.01	0.18	0.17	0.13	0.48	0.07	0.52	0.08	0.48	0.02	
07/11/2024 03:30:00	0.54	0.06	0.04	0.01	0.18	0.17	0.12	0.48	0.05	0.52	0.08	0.48	0.02	
07/11/2024 03:45:00	0.54	0.06	0.04	0.01	0.18	0.17	0.12	0.48	0.05	0.52	0.08	0.48	0.03	
07/11/2024 04:00:00	0.54	0.05	0.04	0.01	0.18	0.17	0.12	0.48	0.06	0.52	0.09	0.49	0.03	
07/11/2024 04:15:00	0.55	0.06	0.03	0.01	0.18	0.17	0.12	0.48	0.07	0.52	0.08	0.47	0.04	
07/11/2024 04:30:00	0.55	0.07	0.03	0.01	0.18	0.17	0.12	0.48	0.05	0.52	0.08	0.45	0.06	
07/11/2024 04:45:00	0.55	0.06	0.03	0.01	0.18	0.17	0.12	0.48	0.06	0.52	0.08	0.42	0.06	
07/11/2024 05:00:00	0.55	0.06	0.03	0.01	0.18	0.17	0.12	0.48	0.06	0.52	0.09	0.40	0.08	
07/11/2024 05:15:00	0.55	0.08	0.03	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.09	0.38	0.09	
07/11/2024 05:30:00	0.54	0.07	0.03	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.09	0.36	0.08	
07/11/2024 05:45:00	0.54	0.07	0.03	0.01	0.17	0.17	0.12	0.48	0.00	0.52	0.08	0.34	0.07	
07/11/2024 06:00:00	0.54	0.05	0.03	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.09	0.33	0.08	
07/11/2024 06:15:00	0.54	0.06	0.03	0.01	0.17	0.17	0.12	0.48	0.00	0.52	0.08	0.31	0.08	
07/11/2024 06:30:00	0.53	0.07	0.03	0.01	0.17	0.17	0.12	0.47	0.07	0.52	0.09	0.30	0.10	
07/11/2024 06:45:00	0.53	0.05	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.09	0.29	0.08	
07/11/2024 07:00:00	0.53	0.05	0.03	0.01	0.17	0.16	0.12	0.47	0.07	0.52	0.08	0.28	0.07	
07/11/2024 07:15:00	0.52	0.07	0.03	0.01	0.17	0.16	0.12	0.47	0.06	0.52	0.09	0.28	0.06	
07/11/2024 07:30:00	0.52	0.09	0.03	0.01	0.17	0.16	0.12	0.48	0.05	0.52	0.08	0.27	0.07	
07/11/2024 07:45:00	0.52	0.08	0.03	0.01	0.17	0.16	0.12	0.48	0.06	0.52	0.09	0.26	0.09	
07/11/2024 08:00:00	0.51	0.08	0.03	0.01	0.17	0.16	0.12	0.48	0.05	0.52	0.09	0.25	0.08	
07/11/2024 08:15:00	0.51	0.06	0.03	0.01	0.17	0.16	0.12	0.48	0.06	0.52	0.08	0.24	0.06	
07/11/2024 08:30:00	0.51	0.07	0.03	0.01	0.17	0.16	0.12	0.48	0.05	0.52	0.08	0.24	0.08	
07/11/2024 08:45:00	0.50	0.00	0.03	0.01	0.17	0.16	0.12	0.49	0.07	0.52	0.07	0.23	0.08	
07/11/2024 09:00:00	0.50	0.08	0.03	0.01	0.17	0.16	0.12	0.49	0.06	0.52	0.08	0.23	0.07	
07/11/2024 09:15:00	0.50	0.08	0.03	0.01	0.17	0.16	0.11	0.49	0.05	0.52	0.07	0.22	0.08	
07/11/2024 09:30:00	0.50	0.09	0.03	0.01	0.17	0.16	0.12	0.49	0.06	0.52	0.09	0.22	0.11	
07/11/2024 09:45:00	0.49	0.07	0.03	0.01	0.17	0.16	0.12	0.49	0.06	0.52	0.09	0.23	0.09	
07/11/2024 10:00:00	0.49	0.08	0.03	0.01	0.17	0.16	0.12	0.49	0.07	0.52	0.08	0.24	0.04	
07/11/2024 10:15:00	0.49	0.08	0.03	0.01	0.17	0.16	0.12	0.49	0.06	0.52	0.09	0.28	0.05	
07/11/2024 10:30:00	0.49	0.09	0.03	0.01	0.17	0.16	0.12	0.49	0.06	0.52	0.08	0.30	0.03	
07/11/2024 10:45:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.49	0.05	0.52	0.09	0.32	0.04	
07/11/2024 11:00:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.49	0.07	0.52	0.08	0.33	0.03	
07/11/2024 11:15:00	0.49	0.09	0.03	0.01	0.17	0.16	0.12	0.50	0.07	0.52	0.08	0.34	0.03	
07/11/2024 11:30:00	0.49	0.08	0.03	0.01	0.17	0.16	0.12	0.50	0.06	0.52	0.07	0.35	0.04	
07/11/2024 11:45:00	0.49	0.05	0.03	0.01	0.17	0.16	0.12	0.50	0.05	0.52	0.07	0.36	0.03	
07/11/2024 12:00:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.50	0.07	0.52	0.08	0.37	0.02	
07/11/2024 12:15:00	0.49	0.00	0.03	0.01	0.17	0.16	0.12	0.50	0.07	0.52	0.07	0.38	0.01	
07/11/2024 12:30:00	0.49	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.05	0.52	0.06	0.39	0.03	
07/11/2024 12:45:00	0.49	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.05	0.52	0.06	0.40	0.02	
07/11/2024 13:00:00	0.49	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.06	0.40	0.03	
07/11/2024 13:15:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.06	0.41	0.03	
07/11/2024 13:30:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.07	0.42	0.03	
07/11/2024 13:45:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.07	0.42	0.03	
07/11/2024 14:00:00	0.51	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.06	0.43	0.02	
07/11/2024 14:15:00	0.51	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.07	0.43	0.04	
07/11/2024 14:30:00	0.51	0.07	0.03	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.07	0.44	0.03	
07/11/2024 14:45:00	0.51	0.07	0.03	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.07	0.44	0.03	
07/11/2024 15:00:00	0.52	0.05	0.03	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.08	0.45	0.02	
07/11/2024 15:15:00	0.52	0.00	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.08	0.45	0.03	
07/11/2024 15:30:00	0.52	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.07	0.46	0.03	
07/11/2024 15:45:00	0.53	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.52	0.07	0.46	0.03	
07/11/2024 16:00:00	0.53	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.08	0.46	0.04	
07/11/2024 16:15:00	0.53	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.07	0.47	0.03	
07/11/2024 16:30:00	0.54	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.08	0.47	0.04	
07/11/2024 16:45:00	0.54	0.05	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.08	0.47	0.03	
07/11/2024 17:00:00	0.54	0.05	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.07	0.46	0.04	
07/11/2024 17:15:00	0.54	0.05	0.03	0.01	0.17	0.17	0.12	0.49	0.06	0.52	0.08	0.44	0.05	
07/11/2024 17:30:00	0.54	0.05	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.08	0.42	0.07	
07/11/2024 17:45:00	0.54	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.08	0.40	0.07	
07/11/2024 18:00:00	0.54	0.05	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.07	0.38	0.07	
07/11/2024 18:15:00	0.54	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.07	0.36	0.07	
07/11/2024 18:30:00	0.54	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.08	0.34	0.09	
07/11/2024 18:45:00	0.54	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.09	0.33	0.09	
07/11/2024 19:00:00	0.53	0.04	0.03	0.01	0.17	0.17	0.12	0.50	0.09	0.52	0.09	0.31	0.11	
07/11/2024 19:15:00	0.53	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.08	0.30	0.09	
07/11/2024 19:30:00	0.53	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.52	0.09	0.29	0.10	
07/11/2024 19:45:00	0.52	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.09	0.28	0.10	
07/11/2024 20:00:00	0.52	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.52	0.08	0.27	0.10	
07/11/2024 20:15:00	0.52	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.08	0.26	0.08	
07/11/2024 20:30:00	0.52	0.08	0.03	0.01	0.17	0.17	0.12	0.51	0.07	0.52	0.07	0.26	0.05	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
07/11/2024 20:45:00	0.51	0.06	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.08	0.25	0.10	
07/11/2024 21:00:00	0.51	0.05	0.03	0.01	0.18	0.17	0.12	0.51	0.08	0.52	0.07	0.25	0.09	
07/11/2024 21:15:00	0.51	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.07	0.24	0.09	
07/11/2024 21:30:00	0.50	0.07	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.07	0.24	0.08	
07/11/2024 21:45:00	0.50	0.09	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.08	0.26	0.05	
07/11/2024 22:00:00	0.50	0.09	0.04	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.07	0.28	0.05	
07/11/2024 22:15:00	0.50	0.07	0.03	0.01	0.18	0.17	0.12	0.51	0.07	0.52	0.08	0.30	0.04	
07/11/2024 22:30:00	0.50	0.09	0.03	0.01	0.18	0.17	0.12	0.51	0.06	0.52	0.07	0.32	0.04	
07/11/2024 22:45:00	0.50	0.07	0.04	0.01	0.18	0.17	0.12	0.50	0.07	0.52	0.07	0.34	0.04	
07/11/2024 23:00:00	0.50	0.07	0.04	0.01	0.18	0.17	0.12	0.50	0.07	0.52	0.08	0.35	0.03	
07/11/2024 23:15:00	0.50	0.07	0.04	0.01	0.18	0.17	0.12	0.50	0.06	0.52	0.07	0.36	0.04	
07/11/2024 23:30:00	0.50	0.06	0.03	0.01	0.18	0.17	0.12	0.50	0.07	0.52	0.07	0.37	0.04	
07/11/2024 23:45:00	0.50	0.08	0.03	0.01	0.18	0.17	0.12	0.50	0.05	0.52	0.08	0.38	0.04	
08/11/2024 00:00:00	0.50	0.00	0.04	0.01	0.18	0.17	0.12	0.50	0.05	0.52	0.08	0.39	0.04	
08/11/2024 00:15:00	0.50	0.07	0.04	0.01	0.18	0.17	0.12	0.50	0.07	0.52	0.08	0.40	0.03	
08/11/2024 00:30:00	0.50	0.06	0.03	0.01	0.18	0.17	0.12	0.50	0.06	0.52	0.08	0.41	0.04	
08/11/2024 00:45:00	0.51	0.08	0.04	0.01	0.18	0.17	0.12	0.50	0.07	0.52	0.08	0.41	0.03	
08/11/2024 01:00:00	0.51	0.05	0.03	0.01	0.18	0.17	0.12	0.50	0.05	0.52	0.08	0.42	0.03	
08/11/2024 01:15:00	0.51	0.04	0.04	0.01	0.18	0.17	0.12	0.49	0.06	0.52	0.06	0.43	0.03	
08/11/2024 01:30:00	0.51	0.08	0.04	0.01	0.18	0.17	0.12	0.49	0.07	0.52	0.06	0.43	0.03	
08/11/2024 01:45:00	0.52	0.06	0.03	0.01	0.18	0.17	0.12	0.49	0.07	0.52	0.07	0.43	0.03	
08/11/2024 02:00:00	0.52	0.05	0.04	0.01	0.18	0.17	0.12	0.49	0.07	0.52	0.08	0.44	0.00	
08/11/2024 02:15:00	0.52	0.06	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.52	0.07	0.45	0.02	
08/11/2024 02:30:00	0.52	0.07	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.52	0.07	0.45	0.03	
08/11/2024 02:45:00	0.53	0.07	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.52	0.08	0.45	0.03	
08/11/2024 03:00:00	0.53	0.06	0.03	0.01	0.18	0.17	0.12	0.48	0.06	0.52	0.07	0.46	0.03	
08/11/2024 03:15:00	0.53	0.06	0.03	0.01	0.18	0.17	0.12	0.48	0.06	0.52	0.07	0.46	0.03	
08/11/2024 03:30:00	0.53	0.04	0.03	0.01	0.18	0.17	0.12	0.48	0.05	0.52	0.07	0.47	0.04	
08/11/2024 03:45:00	0.54	0.06	0.03	0.01	0.18	0.17	0.12	0.48	0.06	0.52	0.05	0.47	0.03	
08/11/2024 04:00:00	0.54	0.07	0.03	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.06	0.47	0.03	
08/11/2024 04:15:00	0.54	0.06	0.03	0.01	0.17	0.17	0.12	0.48	0.05	0.52	0.07	0.48	0.03	
08/11/2024 04:30:00	0.55	0.06	0.03	0.01	0.17	0.17	0.12	0.48	0.04	0.52	0.08	0.48	0.03	
08/11/2024 04:45:00	0.55	0.07	0.03	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.08	0.47	0.05	
08/11/2024 05:00:00	0.55	0.07	0.03	0.01	0.17	0.17	0.12	0.48	0.05	0.52	0.07	0.45	0.07	
08/11/2024 05:15:00	0.55	0.08	0.03	0.01	0.17	0.17	0.12	0.48	0.05	0.52	0.07	0.43	0.07	
08/11/2024 05:30:00	0.55	0.06	0.03	0.01	0.17	0.17	0.12	0.48	0.05	0.52	0.08	0.41	0.06	
08/11/2024 05:45:00	0.55	0.07	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.07	0.38	0.06	
08/11/2024 06:00:00	0.55	0.08	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.07	0.36	0.07	
08/11/2024 06:15:00	0.55	0.07	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.08	0.35	0.09	
08/11/2024 06:30:00	0.54	0.04	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.53	0.09	0.33	0.10	
08/11/2024 06:45:00	0.54	0.08	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.09	0.32	0.09	
08/11/2024 07:00:00	0.54	0.08	0.03	0.01	0.17	0.17	0.11	0.47	0.06	0.53	0.08	0.31	0.10	
08/11/2024 07:15:00	0.53	0.06	0.03	0.01	0.17	0.17	0.11	0.47	0.06	0.53	0.07	0.30	0.10	
08/11/2024 07:30:00	0.53	0.05	0.03	0.01	0.17	0.17	0.11	0.47	0.05	0.52	0.07	0.29	0.09	
08/11/2024 07:45:00	0.53	0.05	0.03	0.01	0.17	0.17	0.11	0.48	0.05	0.52	0.07	0.27	0.09	
08/11/2024 08:00:00	0.52	0.07	0.03	0.01	0.17	0.17	0.11	0.48	0.00	0.52	0.08	0.27	0.11	
08/11/2024 08:15:00	0.52	0.07	0.03	0.01	0.17	0.17	0.11	0.48	0.05	0.52	0.07	0.26	0.08	
08/11/2024 08:30:00	0.52	0.08	0.03	0.01	0.17	0.17	0.11	0.48	0.06	0.52	0.07	0.25	0.11	
08/11/2024 08:45:00	0.51	0.08	0.02	0.01	0.17	0.17	0.11	0.48	0.07	0.52	0.06	0.25	0.09	
08/11/2024 09:00:00	0.51	0.05	0.02	0.01	0.17	0.17	0.11	0.49	0.06	0.52	0.07	0.24	0.08	
08/11/2024 09:15:00	0.51	0.05	0.02	0.01	0.17	0.17	0.11	0.49	0.07	0.52	0.07	0.24	0.08	
08/11/2024 09:30:00	0.51	0.08	0.02	0.01	0.17	0.16	0.11	0.49	0.07	0.52	0.07	0.23	0.11	
08/11/2024 09:45:00	0.50	0.07	0.02	0.01	0.17	0.16	0.11	0.50	0.07	0.52	0.07	0.23	0.11	
08/11/2024 10:00:00	0.50	0.08	0.02	0.01	0.17	0.16	0.11	0.50	0.07	0.52	0.07	0.22	0.07	
08/11/2024 10:15:00	0.50	0.07	0.02	0.01	0.17	0.16	0.11	0.50	0.07	0.52	0.08	0.22	0.07	
08/11/2024 10:30:00	0.50	0.09	0.02	0.01	0.17	0.17	0.11	0.50	0.07	0.52	0.06	0.22	0.09	
08/11/2024 10:45:00	0.49	0.09	0.02	0.01	0.17	0.17	0.11	0.50	0.06	0.52	0.07	0.22	0.06	
08/11/2024 11:00:00	0.49	0.05	0.02	0.01	0.17	0.17	0.11	0.50	0.07	0.52	0.07	0.24	0.06	
08/11/2024 11:15:00	0.49	0.07	0.02	0.01	0.17	0.17	0.11	0.50	0.08	0.52	0.08	0.25	0.06	
08/11/2024 11:30:00	0.49	0.08	0.02	0.01	0.17	0.17	0.11	0.50	0.07	0.52	0.09	0.27	0.04	
08/11/2024 11:45:00	0.49	0.06	0.02	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.07	0.29	0.05	
08/11/2024 12:00:00	0.49	0.08	0.02	0.01	0.17	0.17	0.12	0.51	0.08	0.52	0.08	0.31	0.05	
08/11/2024 12:15:00	0.49	0.00	0.02	0.01	0.17	0.17	0.12	0.51	0.08	0.52	0.08	0.32	0.05	
08/11/2024 12:30:00	0.49	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.08	0.52	0.08	0.34	0.04	
08/11/2024 12:45:00	0.49	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.08	0.52	0.08	0.35	0.03	
08/11/2024 13:00:00	0.49	0.00	0.03	0.01	0.17	0.17	0.12	0.51	0.07	0.52	0.08	0.36	0.04	
08/11/2024 13:15:00	0.49	0.06	0.03	0.01	0.17	0.17	0.12	0.51	0.07	0.52	0.07	0.37	0.04	
08/11/2024 13:30:00	0.49	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.52	0.08	0.38	0.02	
08/11/2024 13:45:00	0.49	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.52	0.09	0.39	0.03	
08/11/2024 14:00:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.08	0.39	0.04	
08/11/2024 14:15:00	0.50	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.08	0.40	0.03	
08/11/2024 14:30:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.08	0.41	0.03	
08/11/2024 14:45:00	0.50	0.00	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.08	0.41	0.03	
08/11/2024 15:00:00	0.51	0.06	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.52	0.08	0.42	0.03	
08/11/2024 15:15:00	0.51	0.05	0.03	0.01	0.18	0.17	0.12	0.49	0.07	0.52	0.08	0.42	0.03	
08/11/2024 15:30:00	0.51	0.07	0.03	0.01	0.18	0.17	0.12	0.49	0.05	0.52	0.08	0.43	0.03	
08/11/2024 15:45:00	0.52	0.07	0.03	0.01	0.18	0.17	0.12	0.49	0.06	0.52	0.08	0.43	0.03	
08/11/2024 16:00:00	0.52	0.06	0.03	0.01	0.18	0.17	0.12	0.48	0.06	0.52	0.08	0.44	0.03	
08/11/2024 16:15:00	0.52	0.00	0.03	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.08	0.44	0.03	
08/11/2024 16:30:00	0.52	0.07	0.03	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.08	0.45	0.03	
08/11/2024 16:45:00	0.53	0.06	0.03	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.08	0.45	0.03	
08/11/2024 17:00:00	0.53	0.05	0.03	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.08	0.46	0.03	
08/11/2024 17:15:00	0.53	0.07	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.08	0.46	0.03	
08/11/2024 17:30:00	0.54	0.05	0.03	0.01	0.17	0.17	0.12	0.47	0.04	0.52	0.07	0.47	0.03	
08/11/2024 17:45:00	0.54	0.07	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.07	0.47	0.02	
08/11/2024 18:00:00	0.54	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.08	0.47	0.03	
08/11/2024 18:15:00	0.55	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.07	0.47	0.03	
08/11/2024 18:30:00	0.55	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.08	0.46	0.05	
08/11/2024 18:45:00	0.55	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.04	0.52	0.08	0.44	0.05	
08/11/2024 19:00:00	0.55	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.07	0.42	0.08	
08/11/2024 19:15:00	0.55	0.07	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.08	0.41	0.07	
08/11/2024 19:30:00	0.55	0.05	0.03	0.01	0.17	0.17	0.11	0.47	0.05	0.52	0.07	0.39	0.07	
08/11/2024 19:45:00	0.55	0.09	0.03	0.01	0.17	0.17	0.11	0.47	0.07	0.52	0.08	0.37	0.06	
08/11/2024 20:00:00	0.55	0.07	0.03	0.01	0.17	0.17	0.11	0.47	0.06	0.52	0.06	0.35	0.08	
08/11/2024 20:15:00	0.54	0.08	0.02	0.01	0.17	0.17	0.11	0.47	0.05	0.52	0.07	0.34	0.08	
08/11/2024 20:30:00	0.54	0.06	0.02	0.01	0.17	0.17	0.11	0.47	0.06	0.52	0.07	0.33	0.09	
08/11/2024 20:45:00	0.54	0.08	0.02	0.01	0.17	0.17	0.11	0.47	0.06	0.52	0.07	0.31	0.09	
08/11/2024 21:00:00	0.54	0.08	0.02	0.01	0.17	0.17	0.11	0.47	0.05	0.52	0.06	0.30	0.08	
08/11/2024 21:15:00	0.53	0.08	0.02	0.01	0.17	0.16	0.11	0.47	0.05	0.52	0.08	0.30	0.08	
08/11/2024 21:30:00	0.53	0.06	0.02	0.01	0.17	0.16	0.11	0.47	0.06	0.52	0.09	0.29	0.09	
08/11/2024 21:45:00	0.53	0.05	0.02	0.01	0.17	0.16	0.11	0.47	0.06	0.52	0.08	0.29	0.10	
08/11/2024 22:00:00	0.53	0.08	0.02	0.01	0.16	0.16	0.11	0.48	0.07	0.52	0.08	0.29	0.08	
08/11/2024 22:15:00	0.52	0.06	0.02	0.01	0.16	0.16	0.11	0.48	0.07	0.52	0.07	0.30	0.09	
08/11/2024 22:30:00	0.52	0.08	0.02	0.01	0.16	0.16	0.11	0.48	0.07	0.52	0.08	0.32	0.06	
08/11/2024 22:45:00	0.52	0.06	0.02	0.01	0.16	0.16	0.11	0.49	0.07	0.52	0.08	0.35	0.04	
08/11/2024 23:00:00	0.52	0.08	0.02	0.01	0.16	0.16	0.11	0.49	0.08	0.52	0.08	0.37	0.05	
08/11/2024 23:15:00	0.52	0.09	0.02	0.01	0.16	0.16	0.11	0.49	0.07	0.52	0.09	0.38	0.04	
08/11/2024 23:30:00	0.52	0.08	0.02	0.01	0.16	0.16	0.11	0.49	0.07	0.52	0.08	0.39	0.04	
08/11/2024 23:45:00	0.52	0.08	0.02	0.01	0.16	0.16	0.11	0.49	0.08	0.52	0.08	0.40	0.04	
09/11/2024 00:00:00	0.52	0.08	0.02	0.01	0.16	0.16	0.11	0.49	0.07	0.52	0.07	0.41	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
09/11/2024 00:15:00	0.52	0.07	0.02	0.01	0.16	0.16	0.11	0.49	0.07	0.52	0.08	0.42	0.03	
09/11/2024 00:30:00	0.52	0.06	0.02	0.01	0.16	0.16	0.11	0.49	0.08	0.52	0.08	0.42	0.03	
09/11/2024 00:45:00	0.53	0.06	0.02	0.01	0.17	0.16	0.11	0.49	0.08	0.52	0.07	0.43	0.03	
09/11/2024 01:00:00	0.53	0.05	0.02	0.01	0.17	0.16	0.11	0.49	0.07	0.52	0.09	0.43	0.04	
09/11/2024 01:15:00	0.53	0.07	0.02	0.01	0.17	0.16	0.11	0.49	0.07	0.52	0.07	0.44	0.03	
09/11/2024 01:30:00	0.53	0.09	0.02	0.01	0.17	0.16	0.11	0.49	0.07	0.52	0.08	0.45	0.03	
09/11/2024 01:45:00	0.53	0.06	0.02	0.01	0.17	0.16	0.11	0.49	0.07	0.52	0.08	0.45	0.04	
09/11/2024 02:00:00	0.54	0.06	0.02	0.01	0.17	0.16	0.11	0.49	0.03	0.52	0.08	0.46	0.03	
09/11/2024 02:15:00	0.54	0.05	0.02	0.01	0.17	0.17	0.11	0.49	0.00	0.52	0.08	0.46	0.03	
09/11/2024 02:30:00	0.54	0.07	0.02	0.01	0.17	0.17	0.11	0.49	0.05	0.52	0.08	0.46	0.03	
09/11/2024 02:45:00	0.54	0.07	0.03	0.01	0.17	0.17	0.11	0.48	0.07	0.52	0.09	0.47	0.03	
09/11/2024 03:00:00	0.55	0.06	0.03	0.01	0.17	0.17	0.11	0.48	0.05	0.52	0.09	0.47	0.03	
09/11/2024 03:15:00	0.55	0.07	0.03	0.01	0.17	0.17	0.11	0.48	0.07	0.52	0.09	0.48	0.03	
09/11/2024 03:30:00	0.55	0.08	0.03	0.01	0.17	0.17	0.11	0.48	0.05	0.52	0.08	0.48	0.03	
09/11/2024 03:45:00	0.55	0.07	0.03	0.01	0.17	0.17	0.11	0.48	0.05	0.52	0.08	0.49	0.04	
09/11/2024 04:00:00	0.56	0.05	0.03	0.01	0.17	0.17	0.11	0.48	0.06	0.52	0.09	0.49	0.03	
09/11/2024 04:15:00	0.56	0.05	0.03	0.01	0.17	0.17	0.11	0.48	0.06	0.52	0.09	0.49	0.03	
09/11/2024 04:30:00	0.56	0.06	0.03	0.01	0.17	0.17	0.11	0.48	0.07	0.52	0.09	0.50	0.03	
09/11/2024 04:45:00	0.56	0.07	0.03	0.01	0.17	0.17	0.11	0.48	0.00	0.52	0.09	0.50	0.03	
09/11/2024 05:00:00	0.57	0.07	0.03	0.01	0.17	0.17	0.11	0.48	0.06	0.52	0.09	0.50	0.03	
09/11/2024 05:15:00	0.57	0.05	0.03	0.01	0.17	0.17	0.11	0.48	0.00	0.52	0.08	0.51	0.03	
09/11/2024 05:30:00	0.57	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.03	0.52	0.08	0.51	0.03	
09/11/2024 05:45:00	0.57	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.05	0.52	0.08	0.51	0.05	
09/11/2024 06:00:00	0.58	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.06	0.52	0.08	0.49	0.05	
09/11/2024 06:15:00	0.58	0.07	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.08	0.47	0.07	
09/11/2024 06:30:00	0.58	0.09	0.03	0.01	0.17	0.16	0.11	0.48	0.06	0.52	0.08	0.44	0.08	
09/11/2024 06:45:00	0.58	0.08	0.03	0.01	0.17	0.16	0.11	0.48	0.06	0.52	0.08	0.42	0.07	
09/11/2024 07:00:00	0.57	0.07	0.03	0.01	0.17	0.16	0.11	0.48	0.06	0.52	0.08	0.40	0.09	
09/11/2024 07:15:00	0.57	0.08	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.08	0.39	0.09	
09/11/2024 07:30:00	0.57	0.07	0.03	0.01	0.17	0.16	0.11	0.48	0.06	0.52	0.09	0.37	0.10	
09/11/2024 07:45:00	0.57	0.05	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.08	0.35	0.09	
09/11/2024 08:00:00	0.56	0.08	0.03	0.01	0.17	0.16	0.11	0.48	0.06	0.52	0.08	0.34	0.10	
09/11/2024 08:15:00	0.56	0.04	0.03	0.01	0.17	0.16	0.11	0.48	0.06	0.52	0.09	0.33	0.08	
09/11/2024 08:30:00	0.55	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.06	0.52	0.08	0.32	0.08	
09/11/2024 08:45:00	0.55	0.07	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.08	0.31	0.09	
09/11/2024 09:00:00	0.55	0.03	0.02	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.08	0.30	0.08	
09/11/2024 09:15:00	0.54	0.06	0.02	0.01	0.17	0.16	0.11	0.48	0.08	0.52	0.08	0.29	0.10	
09/11/2024 09:30:00	0.54	0.08	0.02	0.01	0.17	0.16	0.11	0.48	0.08	0.52	0.09	0.28	0.07	
09/11/2024 09:45:00	0.54	0.08	0.02	0.01	0.17	0.16	0.11	0.49	0.06	0.52	0.08	0.27	0.07	
09/11/2024 10:00:00	0.53	0.08	0.03	0.01	0.17	0.16	0.11	0.49	0.08	0.52	0.09	0.27	0.08	
09/11/2024 10:15:00	0.53	0.08	0.03	0.01	0.17	0.16	0.11	0.49	0.09	0.52	0.09	0.26	0.10	
09/11/2024 10:30:00	0.53	0.09	0.02	0.01	0.17	0.16	0.11	0.50	0.10	0.52	0.08	0.25	0.09	
09/11/2024 10:45:00	0.52	0.09	0.02	0.01	0.17	0.16	0.11	0.50	0.08	0.52	0.09	0.25	0.09	
09/11/2024 11:00:00	0.52	0.07	0.02	0.01	0.17	0.16	0.11	0.51	0.10	0.52	0.08	0.24	0.08	
09/11/2024 11:15:00	0.52	0.08	0.02	0.01	0.17	0.16	0.11	0.51	0.09	0.52	0.09	0.24	0.08	
09/11/2024 11:30:00	0.51	0.09	0.03	0.01	0.17	0.17	0.11	0.52	0.10	0.52	0.08	0.24	0.05	
09/11/2024 11:45:00	0.51	0.07	0.03	0.01	0.17	0.17	0.11	0.52	0.09	0.52	0.08	0.23	0.09	
09/11/2024 12:00:00	0.51	0.07	0.03	0.01	0.17	0.17	0.11	0.52	0.09	0.52	0.09	0.24	0.06	
09/11/2024 12:15:00	0.51	0.09	0.03	0.01	0.17	0.17	0.12	0.51	0.08	0.52	0.09	0.25	0.07	
09/11/2024 12:30:00	0.50	0.07	0.03	0.01	0.17	0.17	0.12	0.51	0.09	0.52	0.08	0.28	0.02	
09/11/2024 12:45:00	0.50	0.08	0.03	0.01	0.17	0.17	0.12	0.51	0.10	0.52	0.09	0.30	0.04	
09/11/2024 13:00:00	0.50	0.09	0.03	0.01	0.17	0.17	0.12	0.51	0.08	0.52	0.09	0.32	0.04	
09/11/2024 13:15:00	0.50	0.08	0.03	0.01	0.17	0.17	0.12	0.51	0.09	0.52	0.09	0.33	0.05	
09/11/2024 13:30:00	0.50	0.08	0.03	0.01	0.17	0.17	0.12	0.51	0.09	0.52	0.08	0.35	0.03	
09/11/2024 13:45:00	0.50	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.10	0.52	0.08	0.36	0.03	
09/11/2024 14:00:00	0.50	0.00	0.03	0.01	0.18	0.17	0.12	0.51	0.09	0.52	0.08	0.37	0.04	
09/11/2024 14:15:00	0.50	0.00	0.04	0.01	0.18	0.17	0.12	0.51	0.08	0.52	0.08	0.38	0.04	
09/11/2024 14:30:00	0.50	0.08	0.04	0.01	0.18	0.17	0.12	0.51	0.09	0.52	0.09	0.39	0.03	
09/11/2024 14:45:00	0.50	0.08	0.04	0.01	0.18	0.17	0.12	0.51	0.09	0.52	0.08	0.40	0.03	
09/11/2024 15:00:00	0.51	0.00	0.04	0.01	0.18	0.17	0.12	0.51	0.08	0.52	0.08	0.40	0.04	
09/11/2024 15:15:00	0.51	0.08	0.04	0.01	0.18	0.17	0.12	0.51	0.09	0.52	0.08	0.41	0.04	
09/11/2024 15:30:00	0.51	0.00	0.04	0.01	0.18	0.17	0.12	0.51	0.08	0.52	0.08	0.42	0.04	
09/11/2024 15:45:00	0.51	0.08	0.04	0.01	0.18	0.17	0.12	0.50	0.09	0.52	0.08	0.42	0.03	
09/11/2024 16:00:00	0.51	0.00	0.04	0.01	0.18	0.17	0.12	0.50	0.08	0.52	0.08	0.43	0.03	
09/11/2024 16:15:00	0.52	0.03	0.04	0.01	0.18	0.17	0.12	0.50	0.08	0.52	0.08	0.43	0.03	
09/11/2024 16:30:00	0.52	0.07	0.04	0.02	0.18	0.17	0.12	0.50	0.09	0.52	0.08	0.44	0.03	
09/11/2024 16:45:00	0.52	0.05	0.04	0.01	0.18	0.17	0.13	0.50	0.09	0.52	0.08	0.44	0.03	
09/11/2024 17:00:00	0.52	0.08	0.04	0.01	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.45	0.03	
09/11/2024 17:15:00	0.53	0.07	0.04	0.02	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.45	0.03	
09/11/2024 17:30:00	0.53	0.06	0.04	0.02	0.18	0.17	0.12	0.50	0.09	0.52	0.08	0.46	0.04	
09/11/2024 17:45:00	0.53	0.06	0.04	0.02	0.18	0.17	0.13	0.50	0.09	0.52	0.08	0.46	0.03	
09/11/2024 18:00:00	0.54	0.07	0.04	0.01	0.18	0.17	0.12	0.50	0.07	0.52	0.08	0.47	0.03	
09/11/2024 18:15:00	0.54	0.06	0.04	0.01	0.18	0.17	0.12	0.50	0.07	0.52	0.08	0.47	0.04	
09/11/2024 18:30:00	0.54	0.07	0.04	0.01	0.18	0.17	0.12	0.50	0.09	0.52	0.08	0.47	0.03	
09/11/2024 18:45:00	0.54	0.05	0.04	0.01	0.18	0.17	0.12	0.50	0.08	0.52	0.08	0.48	0.03	
09/11/2024 19:00:00	0.55	0.06	0.04	0.01	0.18	0.17	0.12	0.50	0.08	0.52	0.08	0.48	0.03	
09/11/2024 19:15:00	0.55	0.07	0.04	0.01	0.18	0.17	0.12	0.50	0.09	0.52	0.09	0.48	0.03	
09/11/2024 19:30:00	0.55	0.07	0.04	0.01	0.18	0.17	0.12	0.50	0.08	0.52	0.08	0.49	0.04	
09/11/2024 19:45:00	0.55	0.06	0.04	0.01	0.18	0.17	0.12	0.51	0.08	0.52	0.08	0.47	0.04	
09/11/2024 20:00:00	0.56	0.06	0.04	0.01	0.18	0.17	0.12	0.51	0.08	0.52	0.08	0.45	0.06	
09/11/2024 20:15:00	0.56	0.06	0.04	0.01	0.18	0.17	0.12	0.51	0.08	0.52	0.08	0.44	0.06	
09/11/2024 20:30:00	0.56	0.07	0.04	0.01	0.18	0.17	0.12	0.51	0.08	0.52	0.08	0.42	0.06	
09/11/2024 20:45:00	0.55	0.06	0.04	0.01	0.18	0.17	0.13	0.51	0.09	0.52	0.08	0.40	0.08	
09/11/2024 21:00:00	0.55	0.07	0.04	0.01	0.18	0.17	0.13	0.51	0.09	0.52	0.07	0.38	0.08	
09/11/2024 21:15:00	0.55	0.08	0.04	0.02	0.18	0.17	0.13	0.51	0.08	0.52	0.08	0.37	0.07	
09/11/2024 21:30:00	0.55	0.09	0.04	0.01	0.18	0.17	0.13	0.50	0.07	0.52	0.07	0.35	0.07	
09/11/2024 21:45:00	0.55	0.08	0.04	0.01	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.34	0.05	
09/11/2024 22:00:00	0.54	0.06	0.04	0.01	0.18	0.17	0.13	0.50	0.07	0.52	0.08	0.33	0.08	
09/11/2024 22:15:00	0.54	0.07	0.04	0.02	0.18	0.17	0.13	0.50	0.07	0.52	0.08	0.32	0.07	
09/11/2024 22:30:00	0.54	0.06	0.04	0.01	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.31	0.08	
09/11/2024 22:45:00	0.53	0.09	0.04	0.01	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.30	0.07	
09/11/2024 23:00:00	0.53	0.07	0.04	0.01	0.18	0.17	0.13	0.50	0.09	0.52	0.08	0.30	0.05	
09/11/2024 23:15:00	0.53	0.08	0.04	0.02	0.18	0.17	0.13	0.50	0.07	0.52	0.09	0.30	0.08	
09/11/2024 23:30:00	0.53	0.07	0.04	0.01	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.30	0.06	
09/11/2024 23:45:00	0.52	0.07	0.04	0.01	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.32	0.05	
10/11/2024 00:00:00	0.52	0.08	0.04	0.01	0.18	0.17	0.13	0.50	0.07	0.52	0.08	0.35	0.03	
10/11/2024 00:15:00	0.52	0.06	0.04	0.01	0.18	0.17	0.13	0.50	0.09	0.52	0.08	0.37	0.04	
10/11/2024 00:30:00	0.52	0.08	0.04	0.02	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.39	0.04	
10/11/2024 00:45:00	0.52	0.07	0.04	0.01	0.18	0.17	0.13	0.51	0.08	0.52	0.08	0.40	0.04	
10/11/2024 01:00:00	0.52	0.06	0.04	0.01	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.41	0.04	
10/11/2024 01:15:00	0.52	0.06	0.04	0.01	0.18	0.17	0.12	0.50	0.07	0.52	0.08	0.41	0.04	
10/11/2024 01:30:00	0.52	0.07	0.04	0.01	0.18	0.17	0.12	0.50	0.08	0.52	0.08	0.42	0.02	
10/11/2024 01:45:00	0.52	0.08	0.04	0.01	0.18	0.17	0.12	0.50	0.07	0.52	0.08	0.43	0.07	
10/11/2024 02:00:00	0.52	0.07	0.04	0.01	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.43	0.03	
10/11/2024 02:15:00	0.53	0.08	0.04	0.01	0.18	0.17	0.13	0.49	0.07	0.52	0.08	0.44	0.04	
10/11/2024 02:30:00	0.53	0.08	0.04	0.01	0.18	0.17	0.12	0.49	0.08	0.52	0.08	0.44	0.02	
10/11/2024 02:45:00	0.53	0.09	0.04	0.01	0.18	0.17	0.12	0.49	0.07	0.52	0.08	0.45	0.03	
10/11/2024 03:00:00	0.53	0.07	0.04	0.01	0.18	0.17	0.12	0.49	0.07	0.52	0.08	0.46	0.03	
10/11/2024 03:15:00	0.53	0.10	0.04	0.01	0.18	0.17	0.12	0.49	0.06	0.52	0.08	0.46	0.03	
10/11/2024 03:30:00	0.54	0.06	0.04	0.01	0.18	0.17	0.12	0.48	0.07	0.52	0.08	0.46	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
10/11/2024 03:45:00	0.54	0.05	0.04	0.01	0.18	0.17	0.12	0.48	0.07	0.52	0.08	0.47	0.04	
10/11/2024 04:00:00	0.54	0.06	0.04	0.01	0.18	0.17	0.12	0.48	0.07	0.52	0.08	0.47	0.04	
10/11/2024 04:15:00	0.55	0.05	0.04	0.01	0.18	0.17	0.12	0.48	0.06	0.52	0.08	0.48	0.03	
10/11/2024 04:30:00	0.55	0.08	0.04	0.01	0.18	0.17	0.12	0.48	0.07	0.52	0.08	0.48	0.03	
10/11/2024 04:45:00	0.55	0.06	0.04	0.01	0.18	0.17	0.12	0.48	0.07	0.52	0.09	0.48	0.04	
10/11/2024 05:00:00	0.55	0.06	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.52	0.08	0.49	0.03	
10/11/2024 05:15:00	0.56	0.06	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.52	0.09	0.49	0.02	
10/11/2024 05:30:00	0.56	0.06	0.04	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.08	0.50	0.03	
10/11/2024 05:45:00	0.56	0.07	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.52	0.08	0.50	0.03	
10/11/2024 06:00:00	0.56	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.09	0.50	0.03	
10/11/2024 06:15:00	0.57	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.08	0.51	0.03	
10/11/2024 06:30:00	0.57	0.05	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.08	0.51	0.03	
10/11/2024 06:45:00	0.57	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.07	0.52	0.08	0.51	0.06	
10/11/2024 07:00:00	0.57	0.07	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.08	0.51	0.04	
10/11/2024 07:15:00	0.57	0.07	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.08	0.50	0.04	
10/11/2024 07:30:00	0.57	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.07	0.52	0.08	0.48	0.06	
10/11/2024 07:45:00	0.58	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.08	0.45	0.05	
10/11/2024 08:00:00	0.57	0.05	0.03	0.01	0.17	0.17	0.11	0.47	0.07	0.52	0.08	0.43	0.05	
10/11/2024 08:15:00	0.57	0.05	0.03	0.01	0.17	0.17	0.11	0.47	0.07	0.52	0.08	0.41	0.08	
10/11/2024 08:30:00	0.57	0.06	0.03	0.01	0.17	0.17	0.11	0.47	0.07	0.52	0.08	0.39	0.06	
10/11/2024 08:45:00	0.57	0.06	0.03	0.01	0.17	0.16	0.11	0.47	0.07	0.52	0.08	0.37	0.08	
10/11/2024 09:00:00	0.56	0.08	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.09	0.35	0.08	
10/11/2024 09:15:00	0.56	0.05	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.09	0.34	0.07	
10/11/2024 09:30:00	0.56	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.09	0.33	0.09	
10/11/2024 09:45:00	0.55	0.07	0.03	0.01	0.17	0.16	0.11	0.48	0.08	0.52	0.08	0.32	0.06	
10/11/2024 10:00:00	0.55	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.08	0.52	0.08	0.31	0.08	
10/11/2024 10:15:00	0.55	0.09	0.03	0.01	0.17	0.16	0.11	0.49	0.09	0.52	0.09	0.30	0.09	
10/11/2024 10:30:00	0.54	0.09	0.02	0.01	0.17	0.16	0.11	0.49	0.09	0.52	0.09	0.29	0.08	
10/11/2024 10:45:00	0.54	0.09	0.02	0.01	0.17	0.16	0.11	0.49	0.08	0.52	0.09	0.28	0.06	
10/11/2024 11:00:00	0.53	0.09	0.03	0.01	0.17	0.16	0.11	0.50	0.08	0.52	0.09	0.27	0.09	
10/11/2024 11:15:00	0.53	0.08	0.03	0.01	0.17	0.16	0.11	0.50	0.09	0.52	0.08	0.27	0.07	
10/11/2024 11:30:00	0.53	0.10	0.03	0.01	0.17	0.16	0.11	0.50	0.09	0.52	0.09	0.26	0.07	
10/11/2024 11:45:00	0.52	0.09	0.03	0.01	0.17	0.16	0.11	0.50	0.09	0.52	0.08	0.26	0.08	
10/11/2024 12:00:00	0.52	0.08	0.03	0.01	0.17	0.16	0.11	0.49	0.10	0.51	0.09	0.25	0.11	
10/11/2024 12:15:00	0.52	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.09	0.51	0.09	0.24	0.09	
10/11/2024 12:30:00	0.51	0.09	0.03	0.01	0.17	0.17	0.12	0.51	0.10	0.51	0.08	0.24	0.09	
10/11/2024 12:45:00	0.51	0.07	0.03	0.01	0.17	0.17	0.12	0.51	0.09	0.51	0.09	0.23	0.08	
10/11/2024 13:00:00	0.51	0.08	0.03	0.01	0.17	0.17	0.12	0.51	0.09	0.51	0.09	0.23	0.07	
10/11/2024 13:15:00	0.51	0.07	0.03	0.01	0.17	0.17	0.12	0.51	0.09	0.51	0.09	0.23	0.07	
10/11/2024 13:30:00	0.50	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.51	0.09	0.23	0.06	
10/11/2024 13:45:00	0.50	0.05	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.51	0.09	0.25	0.04	
10/11/2024 14:00:00	0.50	0.05	0.03	0.01	0.17	0.17	0.12	0.50	0.09	0.51	0.09	0.30	0.03	
10/11/2024 14:15:00	0.50	0.07	0.04	0.01	0.17	0.17	0.12	0.50	0.08	0.51	0.09	0.36	0.00	
10/11/2024 14:30:00	0.50	0.07	0.03	0.01	0.18	0.17	0.12	0.50	0.08	0.51	0.09	0.39	0.03	
10/11/2024 14:45:00	0.50	0.08	0.03	0.01	0.18	0.17	0.12	0.50	0.08	0.51	0.09	0.39	0.03	
10/11/2024 15:00:00	0.50	0.10	0.04	0.01	0.18	0.17	0.12	0.50	0.08	0.51	0.09	0.39	0.04	
10/11/2024 15:15:00	0.50	0.08	0.04	0.01	0.18	0.17	0.12	0.50	0.07	0.51	0.09	0.40	0.03	
10/11/2024 15:30:00	0.50	0.00	0.04	0.01	0.18	0.17	0.12	0.51	0.09	0.51	0.09	0.41	0.02	
10/11/2024 15:45:00	0.51	0.07	0.04	0.01	0.18	0.17	0.12	0.51	0.10	0.51	0.09	0.42	0.03	
10/11/2024 16:00:00	0.51	0.09	0.04	0.01	0.18	0.17	0.12	0.51	0.08	0.51	0.09	0.42	0.02	
10/11/2024 16:15:00	0.51	0.08	0.04	0.01	0.18	0.17	0.12	0.51	0.08	0.51	0.09	0.43	0.03	
10/11/2024 16:30:00	0.51	0.08	0.04	0.01	0.18	0.17	0.12	0.51	0.09	0.51	0.08	0.43	0.03	
10/11/2024 16:45:00	0.52	0.06	0.04	0.01	0.18	0.17	0.12	0.51	0.09	0.51	0.09	0.44	0.03	
10/11/2024 17:00:00	0.52	0.06	0.04	0.02	0.18	0.17	0.12	0.51	0.08	0.51	0.09	0.44	0.03	
10/11/2024 17:15:00	0.52	0.08	0.04	0.02	0.18	0.17	0.13	0.50	0.08	0.51	0.09	0.45	0.03	
10/11/2024 17:30:00	0.52	0.05	0.04	0.02	0.18	0.17	0.13	0.50	0.08	0.51	0.09	0.45	0.03	
10/11/2024 17:45:00	0.53	0.07	0.04	0.02	0.18	0.17	0.13	0.50	0.08	0.51	0.09	0.45	0.03	
10/11/2024 18:00:00	0.53	0.05	0.04	0.02	0.18	0.17	0.13	0.50	0.08	0.51	0.09	0.46	0.03	
10/11/2024 18:15:00	0.53	0.07	0.04	0.02	0.18	0.17	0.13	0.50	0.08	0.51	0.09	0.46	0.03	
10/11/2024 18:30:00	0.54	0.07	0.04	0.02	0.18	0.17	0.13	0.50	0.09	0.51	0.09	0.47	0.04	
10/11/2024 18:45:00	0.54	0.05	0.04	0.02	0.18	0.17	0.13	0.50	0.08	0.51	0.09	0.47	0.03	
10/11/2024 19:00:00	0.54	0.06	0.04	0.02	0.18	0.17	0.13	0.50	0.08	0.51	0.08	0.47	0.03	
10/11/2024 19:15:00	0.54	0.06	0.04	0.02	0.18	0.17	0.13	0.51	0.08	0.51	0.08	0.48	0.04	
10/11/2024 19:30:00	0.55	0.06	0.04	0.02	0.18	0.17	0.13	0.51	0.08	0.51	0.09	0.48	0.03	
10/11/2024 19:45:00	0.55	0.08	0.04	0.01	0.18	0.17	0.13	0.51	0.09	0.51	0.09	0.48	0.03	
10/11/2024 20:00:00	0.55	0.07	0.04	0.02	0.18	0.17	0.13	0.51	0.08	0.51	0.08	0.49	0.02	
10/11/2024 20:15:00	0.55	0.07	0.04	0.02	0.18	0.17	0.13	0.51	0.08	0.51	0.09	0.49	0.03	
10/11/2024 20:30:00	0.56	0.05	0.04	0.02	0.18	0.17	0.13	0.51	0.09	0.52	0.09	0.49	0.02	
10/11/2024 20:45:00	0.56	0.07	0.04	0.02	0.18	0.17	0.13	0.51	0.09	0.52	0.09	0.50	0.03	
10/11/2024 21:00:00	0.56	0.07	0.04	0.02	0.18	0.18	0.13	0.51	0.08	0.52	0.09	0.50	0.04	
10/11/2024 21:15:00	0.56	0.05	0.04	0.02	0.18	0.18	0.13	0.51	0.08	0.52	0.08	0.49	0.05	
10/11/2024 21:30:00	0.57	0.06	0.04	0.02	0.18	0.18	0.13	0.51	0.07	0.52	0.09	0.47	0.05	
10/11/2024 21:45:00	0.57	0.07	0.04	0.02	0.18	0.18	0.13	0.51	0.09	0.52	0.08	0.45	0.05	
10/11/2024 22:00:00	0.57	0.07	0.04	0.02	0.18	0.18	0.13	0.51	0.09	0.52	0.09	0.43	0.08	
10/11/2024 22:15:00	0.56	0.08	0.04	0.02	0.18	0.18	0.13	0.51	0.08	0.52	0.09	0.41	0.07	
10/11/2024 22:30:00	0.56	0.08	0.04	0.02	0.18	0.18	0.13	0.51	0.08	0.52	0.09	0.39	0.08	
10/11/2024 22:45:00	0.56	0.06	0.04	0.02	0.18	0.18	0.13	0.51	0.08	0.52	0.08	0.38	0.07	
10/11/2024 23:00:00	0.56	0.06	0.04	0.02	0.18	0.18	0.13	0.50	0.08	0.52	0.08	0.36	0.07	
10/11/2024 23:15:00	0.55	0.08	0.04	0.02	0.18	0.18	0.13	0.50	0.09	0.52	0.09	0.35	0.07	
10/11/2024 23:30:00	0.55	0.09	0.04	0.02	0.18	0.18	0.13	0.50	0.07	0.52	0.09	0.34	0.08	
10/11/2024 23:45:00	0.55	0.06	0.04	0.02	0.18	0.18	0.13	0.50	0.08	0.52	0.09	0.33	0.08	
11/11/2024 00:00:00	0.55	0.07	0.04	0.02	0.18	0.18	0.13	0.50	0.08	0.52	0.09	0.32	0.07	
11/11/2024 00:15:00	0.54	0.05	0.04	0.02	0.18	0.18	0.13	0.50	0.09	0.52	0.09	0.32	0.06	
11/11/2024 00:30:00	0.54	0.09	0.04	0.02	0.18	0.18	0.13	0.50	0.08	0.52	0.08	0.33	0.06	
11/11/2024 00:45:00	0.54	0.07	0.04	0.02	0.18	0.18	0.13	0.49	0.08	0.52	0.09	0.34	0.06	
11/11/2024 01:00:00	0.53	0.05	0.04	0.02	0.18	0.18	0.13	0.49	0.07	0.52	0.09	0.37	0.03	
11/11/2024 01:15:00	0.53	0.07	0.04	0.02	0.18	0.18	0.13	0.49	0.07	0.52	0.08	0.42	0.01	
11/11/2024 01:30:00	0.53	0.05	0.04	0.02	0.18	0.18	0.13	0.49	0.07	0.52	0.09	0.45	0.02	
11/11/2024 01:45:00	0.53	0.09	0.04	0.01	0.18	0.18	0.13	0.49	0.07	0.52	0.09	0.45	0.03	
11/11/2024 02:00:00	0.53	0.09	0.04	0.02	0.18	0.18	0.13	0.49	0.07	0.52	0.09	0.45	0.03	
11/11/2024 02:15:00	0.53	0.06	0.04	0.02	0.18	0.17	0.13	0.49	0.07	0.52	0.09	0.45	0.02	
11/11/2024 02:30:00	0.54	0.08	0.04	0.02	0.18	0.17	0.13	0.48	0.07	0.52	0.10	0.46	0.02	
11/11/2024 02:45:00	0.54	0.08	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.52	0.10	0.47	0.02	
11/11/2024 03:00:00	0.54	0.06	0.04	0.02	0.18	0.17	0.12	0.48	0.07	0.52	0.09	0.47	0.03	
11/11/2024 03:15:00	0.54	0.07	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.52	0.09	0.48	0.03	
11/11/2024 03:30:00	0.55	0.07	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.52	0.09	0.48	0.02	
11/11/2024 03:45:00	0.55	0.07	0.04	0.02	0.18	0.17	0.12	0.48	0.07	0.52	0.10	0.49	0.03	
11/11/2024 04:00:00	0.55	0.04	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.52	0.09	0.49	0.03	
11/11/2024 04:15:00	0.55	0.08	0.04	0.02	0.17	0.17	0.12	0.48	0.06	0.52	0.09	0.49	0.03	
11/11/2024 04:30:00	0.56	0.08	0.04	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.09	0.50	0.03	
11/11/2024 04:45:00	0.56	0.04	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.52	0.09	0.50	0.02	
11/11/2024 05:00:00	0.56	0.06	0.04	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.09	0.50	0.02	
11/11/2024 05:15:00	0.56	0.00	0.04	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.10	0.51	0.03	
11/11/2024 05:30:00	0.57	0.05	0.04	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.09	0.51	0.03	
11/11/2024 05:45:00	0.57	0.07	0.03	0.01	0.17	0.17	0.12	0.47	0.00	0.52	0.09	0.51	0.04	
11/11/2024 06:00:00	0.57	0.05	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.09	0.52	0.03	
11/11/2024 06:15:00	0.57	0.05	0.03	0.01	0.17	0.17	0.12	0.47	0.07	0.52	0.09	0.52	0.02	
11/11/2024 06:30:00	0.58	0.06	0.03	0.01	0.17	0.17	0.12	0.47	0.06	0.52	0.09	0.52	0.02	
11/11/2024 06:45:00	0.58	0.05	0.03	0.01	0.17	0.17	0.12	0.47	0.05	0.52	0.09	0.52	0.02	
11/11/2024 07:00:00	0.58	0.06	0.03	0.01	0.17	0.17	0.11	0.48	0.07	0.52	0.09	0.53	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
11/11/2024 07:15:00	0.58	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.09	0.53	0.03	
11/11/2024 07:30:00	0.59	0.05	0.03	0.01	0.17	0.16	0.11	0.48	0.06	0.52	0.08	0.53	0.03	
11/11/2024 07:45:00	0.59	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.08	0.52	0.08	0.53	0.03	
11/11/2024 08:00:00	0.59	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.06	0.52	0.09	0.54	0.03	
11/11/2024 08:15:00	0.59	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.09	0.54	0.03	
11/11/2024 08:30:00	0.59	0.06	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.08	0.54	0.02	
11/11/2024 08:45:00	0.60	0.00	0.03	0.01	0.17	0.16	0.11	0.48	0.07	0.52	0.09	0.54	0.02	
11/11/2024 09:00:00	0.60	0.04	0.03	0.01	0.17	0.16	0.11	0.49	0.07	0.52	0.09	0.54	0.03	
11/11/2024 09:15:00	0.60	0.05	0.03	0.01	0.17	0.16	0.11	0.49	0.07	0.52	0.08	0.54	0.03	
11/11/2024 09:30:00	0.60	0.06	0.03	0.01	0.17	0.16	0.11	0.49	0.07	0.52	0.08	0.53	0.04	
11/11/2024 09:45:00	0.60	0.06	0.03	0.01	0.17	0.16	0.11	0.49	0.09	0.52	0.08	0.50	0.05	
11/11/2024 10:00:00	0.60	0.05	0.03	0.01	0.17	0.16	0.11	0.49	0.08	0.52	0.09	0.48	0.07	
11/11/2024 10:15:00	0.60	0.07	0.03	0.01	0.17	0.16	0.11	0.49	0.07	0.52	0.08	0.46	0.07	
11/11/2024 10:30:00	0.60	0.06	0.03	0.01	0.17	0.16	0.11	0.49	0.08	0.52	0.08	0.44	0.07	
11/11/2024 10:45:00	0.59	0.06	0.03	0.01	0.17	0.16	0.11	0.50	0.08	0.52	0.09	0.42	0.07	
11/11/2024 11:00:00	0.59	0.07	0.03	0.01	0.17	0.16	0.11	0.49	0.08	0.52	0.09	0.41	0.08	
11/11/2024 11:15:00	0.58	0.07	0.03	0.01	0.17	0.16	0.12	0.49	0.08	0.52	0.09	0.39	0.08	
11/11/2024 11:30:00	0.58	0.06	0.03	0.01	0.17	0.17	0.12	0.49	0.08	0.52	0.10	0.37	0.08	
11/11/2024 11:45:00	0.58	0.09	0.03	0.01	0.17	0.17	0.12	0.49	0.08	0.52	0.10	0.36	0.08	
11/11/2024 12:00:00	0.57	0.08	0.03	0.01	0.17	0.17	0.12	0.49	0.08	0.52	0.08	0.35	0.07	
11/11/2024 12:15:00	0.57	0.09	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.10	0.34	0.06	
11/11/2024 12:30:00	0.56	0.05	0.03	0.01	0.17	0.17	0.12	0.49	0.08	0.52	0.08	0.33	0.08	
11/11/2024 12:45:00	0.56	0.06	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.08	0.31	0.09	
11/11/2024 13:00:00	0.55	0.08	0.03	0.01	0.17	0.17	0.12	0.49	0.08	0.52	0.08	0.32	0.08	
11/11/2024 13:15:00	0.55	0.09	0.03	0.01	0.17	0.17	0.12	0.49	0.08	0.52	0.09	0.31	0.09	
11/11/2024 13:30:00	0.54	0.07	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.08	0.31	0.10	
11/11/2024 13:45:00	0.54	0.06	0.04	0.01	0.17	0.17	0.12	0.50	0.09	0.52	0.09	0.31	0.06	
11/11/2024 14:00:00	0.54	0.08	0.04	0.01	0.17	0.17	0.12	0.50	0.08	0.52	0.08	0.32	0.05	
11/11/2024 14:15:00	0.53	0.09	0.04	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.09	0.34	0.03	
11/11/2024 14:30:00	0.53	0.06	0.04	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.09	0.36	0.05	
11/11/2024 14:45:00	0.52	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.09	0.38	0.03	
11/11/2024 15:00:00	0.52	0.07	0.04	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.09	0.40	0.05	
11/11/2024 15:15:00	0.52	0.09	0.04	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.10	0.41	0.04	
11/11/2024 15:30:00	0.52	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.08	0.52	0.09	0.42	0.03	
11/11/2024 15:45:00	0.52	0.03	0.04	0.01	0.17	0.17	0.12	0.49	0.08	0.52	0.09	0.43	0.03	
11/11/2024 16:00:00	0.52	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.10	0.44	0.03	
11/11/2024 16:15:00	0.52	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.09	0.44	0.03	
11/11/2024 16:30:00	0.52	0.06	0.04	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.09	0.45	0.03	
11/11/2024 16:45:00	0.52	0.05	0.04	0.02	0.17	0.17	0.12	0.49	0.06	0.52	0.09	0.46	0.03	
11/11/2024 17:00:00	0.53	0.06	0.04	0.02	0.17	0.17	0.12	0.49	0.08	0.52	0.09	0.46	0.03	
11/11/2024 17:15:00	0.53	0.06	0.04	0.02	0.17	0.17	0.12	0.49	0.07	0.52	0.09	0.46	0.03	
11/11/2024 17:30:00	0.53	0.03	0.04	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.09	0.47	0.03	
11/11/2024 17:45:00	0.53	0.05	0.04	0.02	0.17	0.17	0.12	0.49	0.08	0.52	0.09	0.47	0.02	
11/11/2024 18:00:00	0.53	0.05	0.04	0.02	0.17	0.17	0.12	0.49	0.08	0.52	0.09	0.48	0.03	
11/11/2024 18:15:00	0.54	0.07	0.04	0.02	0.17	0.17	0.12	0.49	0.07	0.52	0.09	0.48	0.03	
11/11/2024 18:30:00	0.54	0.05	0.04	0.02	0.17	0.17	0.12	0.50	0.08	0.52	0.09	0.49	0.02	
11/11/2024 18:45:00	0.54	0.06	0.04	0.02	0.17	0.17	0.12	0.50	0.08	0.52	0.09	0.49	0.03	
11/11/2024 19:00:00	0.54	0.05	0.04	0.01	0.17	0.17	0.12	0.50	0.08	0.52	0.09	0.49	0.02	
11/11/2024 19:15:00	0.55	0.06	0.04	0.01	0.17	0.17	0.12	0.50	0.08	0.52	0.09	0.49	0.03	
11/11/2024 19:30:00	0.55	0.06	0.04	0.01	0.17	0.17	0.12	0.50	0.08	0.52	0.09	0.50	0.02	
11/11/2024 19:45:00	0.55	0.05	0.04	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.09	0.50	0.02	
11/11/2024 20:00:00	0.55	0.05	0.04	0.01	0.18	0.17	0.12	0.50	0.08	0.52	0.09	0.50	0.03	
11/11/2024 20:15:00	0.55	0.07	0.04	0.02	0.18	0.17	0.12	0.50	0.07	0.52	0.08	0.51	0.03	
11/11/2024 20:30:00	0.56	0.07	0.04	0.02	0.18	0.17	0.12	0.50	0.06	0.52	0.09	0.51	0.03	
11/11/2024 20:45:00	0.56	0.04	0.04	0.02	0.18	0.17	0.12	0.51	0.09	0.52	0.09	0.51	0.03	
11/11/2024 21:00:00	0.56	0.07	0.04	0.02	0.18	0.17	0.12	0.51	0.07	0.52	0.09	0.52	0.02	
11/11/2024 21:15:00	0.56	0.07	0.04	0.02	0.18	0.17	0.12	0.51	0.07	0.52	0.09	0.52	0.03	
11/11/2024 21:30:00	0.57	0.04	0.04	0.02	0.18	0.17	0.12	0.51	0.07	0.52	0.09	0.52	0.03	
11/11/2024 21:45:00	0.57	0.05	0.04	0.02	0.18	0.17	0.12	0.51	0.08	0.52	0.09	0.52	0.01	
11/11/2024 22:00:00	0.57	0.06	0.04	0.02	0.18	0.17	0.12	0.51	0.07	0.52	0.09	0.53	0.02	
11/11/2024 22:15:00	0.57	0.06	0.04	0.02	0.18	0.17	0.13	0.51	0.08	0.52	0.08	0.53	0.01	
11/11/2024 22:30:00	0.57	0.06	0.04	0.02	0.18	0.17	0.13	0.51	0.09	0.52	0.08	0.53	0.03	
11/11/2024 22:45:00	0.58	0.05	0.04	0.02	0.18	0.17	0.13	0.51	0.08	0.52	0.08	0.53	0.03	
11/11/2024 23:00:00	0.58	0.07	0.04	0.02	0.18	0.17	0.13	0.51	0.08	0.52	0.08	0.52	0.04	
11/11/2024 23:15:00	0.58	0.05	0.04	0.02	0.18	0.17	0.13	0.51	0.08	0.52	0.09	0.50	0.05	
11/11/2024 23:30:00	0.58	0.06	0.05	0.02	0.18	0.17	0.13	0.50	0.06	0.52	0.08	0.48	0.05	
11/11/2024 23:45:00	0.58	0.03	0.04	0.02	0.18	0.17	0.13	0.50	0.07	0.52	0.09	0.46	0.06	
12/11/2024 00:00:00	0.58	0.04	0.04	0.02	0.18	0.17	0.13	0.50	0.06	0.52	0.08	0.44	0.08	
12/11/2024 00:15:00	0.57	0.05	0.05	0.02	0.18	0.17	0.13	0.50	0.06	0.52	0.08	0.43	0.08	
12/11/2024 00:30:00	0.57	0.06	0.05	0.02	0.18	0.17	0.13	0.50	0.07	0.52	0.08	0.41	0.07	
12/11/2024 00:45:00	0.56	0.04	0.04	0.02	0.18	0.17	0.13	0.50	0.08	0.52	0.09	0.40	0.08	
12/11/2024 01:00:00	0.56	0.06	0.05	0.02	0.18	0.17	0.13	0.50	0.07	0.52	0.09	0.39	0.08	
12/11/2024 01:15:00	0.56	0.05	0.05	0.02	0.18	0.17	0.13	0.50	0.08	0.52	0.08	0.39	0.07	
12/11/2024 01:30:00	0.55	0.06	0.05	0.02	0.18	0.17	0.13	0.50	0.07	0.52	0.09	0.39	0.06	
12/11/2024 01:45:00	0.55	0.06	0.05	0.02	0.18	0.17	0.13	0.49	0.06	0.52	0.09	0.40	0.06	
12/11/2024 02:00:00	0.55	0.08	0.05	0.02	0.18	0.17	0.13	0.49	0.06	0.52	0.08	0.42	0.03	
12/11/2024 02:15:00	0.54	0.09	0.04	0.02	0.18	0.17	0.13	0.49	0.06	0.52	0.09	0.43	0.04	
12/11/2024 02:30:00	0.54	0.08	0.04	0.02	0.18	0.17	0.13	0.49	0.06	0.52	0.08	0.45	0.04	
12/11/2024 02:45:00	0.54	0.07	0.04	0.02	0.18	0.17	0.13	0.49	0.06	0.52	0.08	0.46	0.03	
12/11/2024 03:00:00	0.54	0.04	0.04	0.02	0.18	0.17	0.13	0.49	0.07	0.52	0.08	0.47	0.03	
12/11/2024 03:15:00	0.54	0.07	0.04	0.02	0.18	0.17	0.13	0.49	0.06	0.52	0.09	0.47	0.03	
12/11/2024 03:30:00	0.54	0.05	0.04	0.02	0.18	0.17	0.13	0.49	0.06	0.52	0.08	0.48	0.03	
12/11/2024 03:45:00	0.54	0.07	0.04	0.02	0.18	0.17	0.13	0.49	0.06	0.52	0.10	0.48	0.03	
12/11/2024 04:00:00	0.55	0.06	0.04	0.02	0.18	0.17	0.12	0.48	0.05	0.52	0.08	0.49	0.03	
12/11/2024 04:15:00	0.55	0.04	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.52	0.09	0.49	0.03	
12/11/2024 04:30:00	0.55	0.02	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.52	0.09	0.50	0.03	
12/11/2024 04:45:00	0.55	0.04	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.52	0.09	0.50	0.03	
12/11/2024 05:00:00	0.55	0.03	0.04	0.02	0.18	0.17	0.12	0.48	0.07	0.52	0.10	0.50	0.03	
12/11/2024 05:15:00	0.56	0.04	0.04	0.02	0.18	0.17	0.12	0.48	0.07	0.52	0.10	0.51	0.03	
12/11/2024 05:30:00	0.56	0.07	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.52	0.09	0.51	0.02	
12/11/2024 05:45:00	0.56	0.03	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.52	0.10	0.52	0.02	
12/11/2024 06:00:00	0.56	0.03	0.04	0.02	0.18	0.17	0.12	0.48	0.07	0.52	0.09	0.52	0.02	
12/11/2024 06:15:00	0.57	0.03	0.04	0.02	0.17	0.17	0.12	0.48	0.06	0.52	0.09	0.52	0.03	
12/11/2024 06:30:00	0.57	0.06	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.52	0.10	0.52	0.02	
12/11/2024 06:45:00	0.57	0.05	0.04	0.01	0.17	0.17	0.12	0.48	0.08	0.52	0.09	0.53	0.03	
12/11/2024 07:00:00	0.57	0.06	0.04	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.09	0.53	0.03	
12/11/2024 07:15:00	0.58	0.04	0.04	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.10	0.53	0.02	
12/11/2024 07:30:00	0.58	0.04	0.04	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.10	0.53	0.03	
12/11/2024 07:45:00	0.58	0.04	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.52	0.10	0.54	0.03	
12/11/2024 08:00:00	0.58	0.04	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.52	0.09	0.53	0.03	
12/11/2024 08:15:00	0.58	0.04	0.03	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.10	0.54	0.03	
12/11/2024 08:30:00	0.59	0.05	0.04	0.01	0.17	0.17	0.12	0.48	0.06	0.52	0.10	0.54	0.03	
12/11/2024 08:45:00	0.59	0.04	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.10	0.54	0.03	
12/11/2024 09:00:00	0.59	0.05	0.03	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.10	0.54	0.03	
12/11/2024 09:15:00	0.59	0.03	0.03	0.01	0.17	0.17	0.12	0.49	0.08	0.52	0.10	0.54	0.02	
12/11/2024 09:30:00	0.59	0.04	0.03	0.01	0.17	0.17	0.12	0.49	0.08	0.53	0.10	0.55	0.03	
12/11/2024 09:45:00	0.60	0.03	0.03	0.01	0.17	0.17	0.12	0.49	0.08	0.53	0.09	0.53	0.05	
12/11/2024 10:00:00	0.60	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.53	0.10	0.50	0.06	
12/11/2024 10:15:00	0.60	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.53	0.11	0.48	0.07	
12/11/2024 10:30:00	0.59	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.53	0.10	0.46	0.10	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
12/11/2024 10:45:00	0.59	0.03	0.04	0.01	0.17	0.17	0.12	0.50	0.07	0.53	0.11	0.44	0.09	
12/11/2024 11:00:00	0.59	0.07	0.04	0.01	0.17	0.17	0.12	0.50	0.07	0.53	0.11	0.42	0.08	
12/11/2024 11:15:00	0.58	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.53	0.11	0.39	0.08	
12/11/2024 11:30:00	0.58	0.08	0.03	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.10	0.38	0.10	
12/11/2024 11:45:00	0.57	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.07	0.52	0.10	0.36	0.10	
12/11/2024 12:00:00	0.57	0.09	0.04	0.01	0.17	0.17	0.12	0.50	0.07	0.52	0.11	0.35	0.09	
12/11/2024 12:15:00	0.56	0.03	0.04	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.10	0.34	0.09	
12/11/2024 12:30:00	0.55	0.04	0.04	0.01	0.17	0.17	0.12	0.50	0.06	0.52	0.10	0.33	0.09	
12/11/2024 12:45:00	0.55	0.03	0.04	0.02	0.17	0.17	0.12	0.50	0.07	0.52	0.10	0.33	0.08	
12/11/2024 13:00:00	0.54	0.07	0.04	0.02	0.17	0.17	0.12	0.50	0.07	0.52	0.08	0.32	0.10	
12/11/2024 13:15:00	0.54	0.09	0.04	0.02	0.18	0.17	0.12	0.50	0.06	0.52	0.09	0.31	0.09	
12/11/2024 13:30:00	0.53	0.08	0.04	0.02	0.18	0.17	0.12	0.50	0.08	0.52	0.09	0.30	0.09	
12/11/2024 13:45:00	0.53	0.08	0.04	0.02	0.18	0.17	0.12	0.50	0.07	0.52	0.10	0.29	0.08	
12/11/2024 14:00:00	0.53	0.07	0.04	0.02	0.18	0.17	0.12	0.50	0.06	0.52	0.09	0.28	0.07	
12/11/2024 14:15:00	0.52	0.05	0.04	0.02	0.18	0.17	0.12	0.50	0.08	0.52	0.09	0.28	0.08	
12/11/2024 14:30:00	0.52	0.06	0.04	0.02	0.18	0.17	0.12	0.51	0.08	0.52	0.09	0.27	0.07	
12/11/2024 14:45:00	0.51	0.03	0.04	0.02	0.18	0.17	0.12	0.51	0.08	0.52	0.09	0.26	0.08	
12/11/2024 15:00:00	0.51	0.07	0.04	0.02	0.18	0.17	0.12	0.52	0.08	0.52	0.09	0.26	0.08	
12/11/2024 15:15:00	0.51	0.07	0.04	0.02	0.18	0.17	0.12	0.53	0.08	0.52	0.09	0.25	0.07	
12/11/2024 15:30:00	0.50	0.10	0.04	0.02	0.18	0.17	0.13	0.53	0.08	0.52	0.09	0.25	0.07	
12/11/2024 15:45:00	0.50	0.08	0.04	0.02	0.18	0.17	0.13	0.53	0.09	0.52	0.09	0.25	0.07	
12/11/2024 16:00:00	0.50	0.08	0.04	0.02	0.18	0.17	0.13	0.53	0.08	0.52	0.09	0.25	0.06	
12/11/2024 16:15:00	0.49	0.08	0.04	0.02	0.18	0.17	0.13	0.53	0.08	0.52	0.10	0.26	0.06	
12/11/2024 16:30:00	0.49	0.09	0.05	0.02	0.18	0.17	0.13	0.53	0.07	0.52	0.10	0.28	0.05	
12/11/2024 16:45:00	0.49	0.06	0.05	0.02	0.18	0.18	0.13	0.53	0.07	0.52	0.09	0.30	0.04	
12/11/2024 17:00:00	0.49	0.08	0.05	0.02	0.19	0.18	0.13	0.52	0.08	0.52	0.09	0.32	0.04	
12/11/2024 17:15:00	0.49	0.10	0.05	0.02	0.19	0.18	0.13	0.52	0.07	0.52	0.09	0.34	0.04	
12/11/2024 17:30:00	0.49	0.08	0.05	0.02	0.19	0.18	0.14	0.52	0.08	0.52	0.09	0.35	0.03	
12/11/2024 17:45:00	0.49	0.08	0.05	0.02	0.19	0.18	0.14	0.52	0.07	0.52	0.09	0.36	0.02	
12/11/2024 18:00:00	0.49	0.10	0.05	0.02	0.19	0.18	0.14	0.51	0.08	0.52	0.10	0.37	0.04	
12/11/2024 18:15:00	0.49	0.09	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.52	0.09	0.38	0.03	
12/11/2024 18:30:00	0.49	0.09	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.52	0.09	0.39	0.03	
12/11/2024 18:45:00	0.49	0.09	0.05	0.02	0.19	0.18	0.14	0.51	0.08	0.52	0.10	0.40	0.02	
12/11/2024 19:00:00	0.49	0.09	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.52	0.10	0.41	0.03	
12/11/2024 19:15:00	0.50	0.09	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.52	0.10	0.42	0.03	
12/11/2024 19:30:00	0.50	0.08	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.52	0.09	0.42	0.04	
12/11/2024 19:45:00	0.50	0.08	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.52	0.10	0.42	0.03	
12/11/2024 20:00:00	0.50	0.07	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.52	0.11	0.43	0.02	
12/11/2024 20:15:00	0.51	0.05	0.05	0.02	0.19	0.18	0.14	0.51	0.08	0.52	0.11	0.44	0.03	
12/11/2024 20:30:00	0.51	0.06	0.05	0.02	0.19	0.18	0.14	0.51	0.08	0.52	0.10	0.44	0.03	
12/11/2024 20:45:00	0.51	0.07	0.05	0.02	0.19	0.18	0.14	0.51	0.08	0.53	0.10	0.45	0.03	
12/11/2024 21:00:00	0.52	0.07	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.53	0.11	0.45	0.03	
12/11/2024 21:15:00	0.52	0.07	0.05	0.02	0.19	0.18	0.14	0.51	0.06	0.53	0.11	0.46	0.02	
12/11/2024 21:30:00	0.52	0.08	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.53	0.11	0.46	0.03	
12/11/2024 21:45:00	0.52	0.07	0.05	0.02	0.19	0.18	0.14	0.51	0.06	0.53	0.10	0.46	0.03	
12/11/2024 22:00:00	0.53	0.06	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.53	0.11	0.47	0.03	
12/11/2024 22:15:00	0.53	0.08	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.53	0.10	0.47	0.03	
12/11/2024 22:30:00	0.53	0.06	0.05	0.02	0.19	0.18	0.14	0.51	0.08	0.53	0.10	0.48	0.03	
12/11/2024 22:45:00	0.54	0.08	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.53	0.10	0.48	0.03	
12/11/2024 23:00:00	0.54	0.06	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.53	0.10	0.47	0.05	
12/11/2024 23:15:00	0.54	0.08	0.05	0.02	0.19	0.18	0.14	0.51	0.06	0.53	0.11	0.45	0.06	
12/11/2024 23:30:00	0.54	0.07	0.05	0.02	0.19	0.18	0.14	0.51	0.08	0.53	0.10	0.42	0.07	
12/11/2024 23:45:00	0.54	0.08	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.53	0.10	0.40	0.09	
13/11/2024 00:00:00	0.54	0.09	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.53	0.11	0.38	0.07	
13/11/2024 00:15:00	0.54	0.08	0.05	0.02	0.19	0.18	0.14	0.51	0.07	0.53	0.11	0.36	0.08	
13/11/2024 00:30:00	0.54	0.10	0.05	0.02	0.19	0.18	0.14	0.50	0.08	0.53	0.10	0.35	0.08	
13/11/2024 00:45:00	0.54	0.08	0.05	0.02	0.19	0.18	0.14	0.50	0.06	0.53	0.11	0.33	0.08	
13/11/2024 01:00:00	0.53	0.10	0.05	0.02	0.19	0.18	0.14	0.50	0.07	0.53	0.10	0.32	0.09	
13/11/2024 01:15:00	0.53	0.09	0.05	0.02	0.19	0.18	0.13	0.50	0.07	0.53	0.10	0.30	0.08	
13/11/2024 01:30:00	0.53	0.09	0.05	0.02	0.19	0.18	0.13	0.50	0.06	0.53	0.10	0.29	0.08	
13/11/2024 01:45:00	0.52	0.08	0.05	0.02	0.19	0.18	0.13	0.50	0.07	0.53	0.10	0.28	0.10	
13/11/2024 02:00:00	0.52	0.07	0.05	0.02	0.19	0.18	0.13	0.50	0.06	0.53	0.11	0.27	0.08	
13/11/2024 02:15:00	0.52	0.10	0.05	0.02	0.19	0.18	0.13	0.50	0.07	0.53	0.11	0.27	0.07	
13/11/2024 02:30:00	0.51	0.09	0.05	0.02	0.19	0.18	0.13	0.49	0.06	0.53	0.10	0.26	0.08	
13/11/2024 02:45:00	0.51	0.10	0.05	0.02	0.19	0.18	0.13	0.49	0.06	0.53	0.10	0.26	0.08	
13/11/2024 03:00:00	0.51	0.09	0.05	0.02	0.19	0.18	0.13	0.49	0.06	0.53	0.10	0.26	0.07	
13/11/2024 03:15:00	0.51	0.11	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.53	0.11	0.28	0.06	
13/11/2024 03:30:00	0.50	0.09	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.53	0.11	0.30	0.05	
13/11/2024 03:45:00	0.50	0.10	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.53	0.10	0.33	0.05	
13/11/2024 04:00:00	0.50	0.10	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.53	0.11	0.34	0.04	
13/11/2024 04:15:00	0.50	0.10	0.05	0.02	0.18	0.18	0.13	0.48	0.05	0.53	0.10	0.36	0.04	
13/11/2024 04:30:00	0.50	0.09	0.05	0.02	0.18	0.18	0.13	0.48	0.06	0.53	0.10	0.37	0.04	
13/11/2024 04:45:00	0.50	0.11	0.05	0.02	0.18	0.18	0.13	0.48	0.04	0.53	0.11	0.38	0.04	
13/11/2024 05:00:00	0.50	0.10	0.05	0.02	0.18	0.18	0.13	0.48	0.05	0.53	0.10	0.39	0.04	
13/11/2024 05:15:00	0.50	0.10	0.05	0.02	0.18	0.17	0.13	0.48	0.06	0.53	0.10	0.40	0.04	
13/11/2024 05:30:00	0.50	0.08	0.04	0.02	0.18	0.17	0.13	0.48	0.05	0.53	0.11	0.41	0.03	
13/11/2024 05:45:00	0.51	0.10	0.04	0.02	0.18	0.17	0.13	0.48	0.05	0.53	0.11	0.41	0.03	
13/11/2024 06:00:00	0.51	0.09	0.04	0.02	0.18	0.17	0.12	0.48	0.05	0.53	0.11	0.42	0.03	
13/11/2024 06:15:00	0.51	0.09	0.04	0.02	0.18	0.17	0.12	0.48	0.05	0.53	0.10	0.43	0.04	
13/11/2024 06:30:00	0.51	0.09	0.04	0.02	0.18	0.17	0.12	0.47	0.05	0.53	0.10	0.43	0.04	
13/11/2024 06:45:00	0.52	0.09	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.53	0.11	0.44	0.04	
13/11/2024 07:00:00	0.52	0.09	0.04	0.02	0.18	0.17	0.12	0.47	0.06	0.53	0.10	0.44	0.03	
13/11/2024 07:15:00	0.52	0.09	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.53	0.11	0.45	0.03	
13/11/2024 07:30:00	0.52	0.07	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.53	0.11	0.45	0.04	
13/11/2024 07:45:00	0.53	0.09	0.04	0.02	0.18	0.17	0.12	0.48	0.06	0.53	0.11	0.46	0.04	
13/11/2024 08:00:00	0.53	0.08	0.04	0.02	0.17	0.17	0.12	0.48	0.07	0.53	0.11	0.46	0.03	
13/11/2024 08:15:00	0.53	0.08	0.04	0.02	0.17	0.17	0.12	0.49	0.06	0.53	0.10	0.46	0.03	
13/11/2024 08:30:00	0.54	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.06	0.53	0.10	0.47	0.03	
13/11/2024 08:45:00	0.54	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.06	0.53	0.11	0.47	0.02	
13/11/2024 09:00:00	0.54	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.06	0.53	0.10	0.47	0.03	
13/11/2024 09:15:00	0.55	0.00	0.04	0.01	0.17	0.17	0.12	0.50	0.07	0.53	0.10	0.48	0.02	
13/11/2024 09:30:00	0.55	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.04	0.53	0.10	0.48	0.03	
13/11/2024 09:45:00	0.55	0.08	0.03	0.01	0.17	0.17	0.12	0.50	0.02	0.53	0.11	0.48	0.04	
13/11/2024 10:00:00	0.55	0.08	0.04	0.01	0.17	0.17	0.12	0.51	0.00	0.53	0.10	0.49	0.03	
13/11/2024 10:15:00	0.56	0.08	0.04	0.01	0.17	0.17	0.12	0.51	0.00	0.54	0.11	0.49	0.03	
13/11/2024 10:30:00	0.56	0.07	0.04	0.01	0.18	0.17	0.12	0.51	0.00	0.53	0.10	0.49	0.04	
13/11/2024 10:45:00	0.56	0.07	0.04	0.01	0.18	0.17	0.12	0.51	0.00	0.54	0.11	0.48	0.03	
13/11/2024 11:00:00	0.56	0.06	0.04	0.01	0.18	0.17	0.12	0.51	0.00	0.54	0.11	0.46	0.07	
13/11/2024 11:15:00	0.56	0.07	0.04	0.01	0.18	0.17	0.12	0.51	0.00	0.54	0.11	0.43	0.07	
13/11/2024 11:30:00	0.56	0.07	0.04	0.02	0.18	0.17	0.12	0.51	0.00	0.54	0.11	0.41	0.08	
13/11/2024 11:45:00	0.56	0.08	0.04	0.02	0.18	0.17	0.12	0.51	0.00	0.54	0.11	0.39	0.08	
13/11/2024 12:00:00	0.56	0.09	0.04	0.02	0.18	0.17	0.12	0.50	0.00	0.54	0.11	0.36	0.09	
13/11/2024 12:15:00	0.56	0.10	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.54	0.11	0.34	0.08	
13/11/2024 12:30:00	0.55	0.06	0.04	0.02	0.18	0.17	0.13	0.50	0.15	0.54	0.11	0.33	0.09	
13/11/2024 12:45:00	0.55	0.07	0.04	0.02	0.18	0.17	0.13	0.50	0.07	0.54	0.11	0.32	0.08	
13/11/2024 13:00:00	0.55	0.07	0.04	0.02	0.18	0.17	0.13	0.50	0.07	0.53	0.11	0.31	0.03	
13/11/2024 13:15:00	0.54	0.08	0.04	0.02	0.18	0.17	0.13	0.50	0.07	0.53	0.11	0.30	0.08	
13/11/2024 13:30:00	0.54	0.09	0.04	0.02	0.18	0.17	0.13	0.50	0.07	0.53	0.11	0.30	0.09	
13/11/2024 13:45:00	0.54	0.08	0.04	0.02	0.18	0.18	0.13	0.50	0.07	0.53	0.11	0.29	0.09	
13/11/2024 14:00:00	0.53	0.10	0.04	0.02	0.18	0.18	0.13	0.50	0.06	0.53	0.11	0.28	0.11	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
13/11/2024 14:15:00	0.53	0.04	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.53	0.11	0.27	0.10	
13/11/2024 14:30:00	0.53	0.06	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.53	0.11	0.27	0.09	
13/11/2024 14:45:00	0.52	0.09	0.05	0.02	0.18	0.18	0.13	0.50	0.05	0.53	0.11	0.26	0.09	
13/11/2024 15:00:00	0.52	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.53	0.11	0.25	0.09	
13/11/2024 15:15:00	0.52	0.11	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.53	0.11	0.25	0.07	
13/11/2024 15:30:00	0.51	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.53	0.11	0.25	0.12	
13/11/2024 15:45:00	0.51	0.12	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.53	0.11	0.26	0.09	
13/11/2024 16:00:00	0.51	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.53	0.11	0.25	0.10	
13/11/2024 16:15:00	0.51	0.12	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.53	0.10	0.25	0.08	
13/11/2024 16:30:00	0.50	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.53	0.10	0.25	0.07	
13/11/2024 16:45:00	0.50	0.11	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.53	0.11	0.26	0.06	
13/11/2024 17:00:00	0.50	0.11	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.53	0.10	0.27	0.06	
13/11/2024 17:15:00	0.50	0.11	0.05	0.02	0.18	0.18	0.13	0.49	0.05	0.53	0.10	0.29	0.05	
13/11/2024 17:30:00	0.50	0.11	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.53	0.10	0.31	0.05	
13/11/2024 17:45:00	0.50	0.11	0.05	0.02	0.18	0.18	0.13	0.49	0.07	0.53	0.11	0.32	0.04	
13/11/2024 18:00:00	0.50	0.11	0.05	0.02	0.18	0.18	0.13	0.50	0.05	0.53	0.11	0.34	0.04	
13/11/2024 18:15:00	0.50	0.11	0.05	0.02	0.18	0.18	0.13	0.50	0.02	0.53	0.11	0.35	0.06	
13/11/2024 18:30:00	0.50	0.09	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.53	0.11	0.36	0.04	
13/11/2024 18:45:00	0.50	0.10	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.53	0.11	0.37	0.05	
13/11/2024 19:00:00	0.50	0.07	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.53	0.11	0.38	0.04	
13/11/2024 19:15:00	0.50	0.10	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.53	0.11	0.39	0.03	
13/11/2024 19:30:00	0.50	0.07	0.04	0.02	0.18	0.17	0.12	0.50	0.00	0.53	0.11	0.40	0.05	
13/11/2024 19:45:00	0.51	0.06	0.04	0.02	0.18	0.17	0.12	0.50	0.00	0.53	0.11	0.40	0.03	
13/11/2024 20:00:00	0.51	0.09	0.04	0.02	0.18	0.17	0.12	0.50	0.00	0.53	0.11	0.41	0.04	
13/11/2024 20:15:00	0.51	0.09	0.04	0.02	0.18	0.17	0.13	0.51	0.00	0.53	0.11	0.42	0.03	
13/11/2024 20:30:00	0.51	0.07	0.04	0.02	0.18	0.17	0.13	0.51	0.00	0.53	0.11	0.42	0.05	
13/11/2024 20:45:00	0.52	0.09	0.04	0.02	0.18	0.17	0.13	0.51	0.00	0.53	0.11	0.42	0.03	
13/11/2024 21:00:00	0.52	0.09	0.04	0.02	0.18	0.17	0.13	0.51	0.00	0.53	0.11	0.43	0.04	
13/11/2024 21:15:00	0.52	0.10	0.04	0.02	0.18	0.17	0.13	0.51	0.00	0.53	0.11	0.44	0.02	
13/11/2024 21:30:00	0.53	0.10	0.04	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.11	0.44	0.04	
13/11/2024 21:45:00	0.53	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.11	0.45	0.03	
13/11/2024 22:00:00	0.53	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.11	0.45	0.03	
13/11/2024 22:15:00	0.53	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.11	0.46	0.03	
13/11/2024 22:30:00	0.54	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.11	0.46	0.04	
13/11/2024 22:45:00	0.54	0.07	0.05	0.02	0.18	0.18	0.13	0.52	0.00	0.53	0.10	0.46	0.04	
13/11/2024 23:00:00	0.54	0.09	0.05	0.02	0.18	0.18	0.13	0.52	0.00	0.53	0.11	0.47	0.03	
13/11/2024 23:15:00	0.55	0.08	0.05	0.02	0.18	0.18	0.13	0.52	0.00	0.53	0.11	0.47	0.03	
13/11/2024 23:30:00	0.55	0.07	0.05	0.02	0.18	0.18	0.13	0.52	0.00	0.53	0.11	0.48	0.04	
13/11/2024 23:45:00	0.55	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.10	0.48	0.04	
14/11/2024 00:00:00	0.55	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.10	0.48	0.03	
14/11/2024 00:15:00	0.56	0.05	0.05	0.02	0.19	0.18	0.13	0.51	0.00	0.53	0.11	0.46	0.04	
14/11/2024 00:30:00	0.56	0.08	0.05	0.02	0.19	0.18	0.13	0.51	0.00	0.53	0.10	0.44	0.04	
14/11/2024 00:45:00	0.56	0.06	0.05	0.02	0.19	0.18	0.13	0.51	0.00	0.53	0.11	0.42	0.06	
14/11/2024 01:00:00	0.56	0.10	0.05	0.02	0.19	0.18	0.13	0.50	0.00	0.53	0.10	0.40	0.06	
14/11/2024 01:15:00	0.56	0.10	0.05	0.02	0.19	0.18	0.13	0.50	0.00	0.53	0.10	0.38	0.08	
14/11/2024 01:30:00	0.55	0.08	0.05	0.02	0.19	0.18	0.13	0.50	0.00	0.53	0.10	0.36	0.07	
14/11/2024 01:45:00	0.55	0.10	0.05	0.02	0.19	0.18	0.13	0.50	0.00	0.53	0.10	0.34	0.08	
14/11/2024 02:00:00	0.55	0.11	0.05	0.02	0.19	0.18	0.13	0.49	0.00	0.53	0.10	0.33	0.09	
14/11/2024 02:15:00	0.55	0.08	0.05	0.02	0.19	0.18	0.13	0.49	0.00	0.53	0.10	0.32	0.08	
14/11/2024 02:30:00	0.54	0.08	0.05	0.02	0.19	0.18	0.13	0.49	0.00	0.53	0.10	0.31	0.10	
14/11/2024 02:45:00	0.54	0.07	0.05	0.02	0.19	0.18	0.13	0.49	0.00	0.53	0.10	0.30	0.08	
14/11/2024 03:00:00	0.54	0.09	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.53	0.10	0.29	0.07	
14/11/2024 03:15:00	0.53	0.09	0.05	0.02	0.18	0.18	0.13	0.48	0.00	0.53	0.11	0.28	0.11	
14/11/2024 03:30:00	0.53	0.10	0.05	0.02	0.18	0.18	0.13	0.48	0.00	0.53	0.11	0.29	0.08	
14/11/2024 03:45:00	0.53	0.10	0.05	0.02	0.18	0.18	0.13	0.48	0.00	0.53	0.11	0.32	0.05	
14/11/2024 04:00:00	0.53	0.11	0.05	0.02	0.18	0.18	0.13	0.48	0.00	0.53	0.11	0.35	0.06	
14/11/2024 04:15:00	0.52	0.10	0.05	0.02	0.18	0.18	0.13	0.48	0.00	0.53	0.12	0.37	0.03	
14/11/2024 04:30:00	0.52	0.09	0.05	0.02	0.18	0.17	0.13	0.48	0.00	0.53	0.11	0.39	0.04	
14/11/2024 04:45:00	0.52	0.10	0.05	0.02	0.18	0.18	0.13	0.48	0.00	0.53	0.12	0.40	0.04	
14/11/2024 05:00:00	0.52	0.10	0.04	0.02	0.18	0.17	0.13	0.48	0.00	0.53	0.11	0.41	0.04	
14/11/2024 05:15:00	0.52	0.09	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.53	0.11	0.42	0.04	
14/11/2024 05:30:00	0.53	0.09	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.53	0.12	0.42	0.04	
14/11/2024 05:45:00	0.53	0.08	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.53	0.11	0.43	0.04	
14/11/2024 06:00:00	0.53	0.09	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.53	0.11	0.44	0.04	
14/11/2024 06:15:00	0.53	0.11	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.53	0.11	0.44	0.04	
14/11/2024 06:30:00	0.53	0.10	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.53	0.11	0.45	0.04	
14/11/2024 06:45:00	0.54	0.06	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.53	0.11	0.46	0.04	
14/11/2024 07:00:00	0.54	0.08	0.04	0.01	0.17	0.17	0.12	0.48	0.00	0.53	0.12	0.46	0.03	
14/11/2024 07:15:00	0.54	0.09	0.04	0.02	0.17	0.17	0.12	0.48	0.00	0.53	0.11	0.47	0.05	
14/11/2024 07:30:00	0.54	0.08	0.04	0.02	0.17	0.17	0.12	0.48	0.00	0.53	0.12	0.47	0.04	
14/11/2024 07:45:00	0.55	0.08	0.04	0.02	0.17	0.17	0.12	0.48	0.00	0.53	0.11	0.47	0.03	
14/11/2024 08:00:00	0.55	0.10	0.04	0.01	0.17	0.17	0.12	0.48	0.00	0.53	0.11	0.48	0.04	
14/11/2024 08:15:00	0.55	0.07	0.04	0.01	0.17	0.17	0.12	0.48	0.00	0.53	0.11	0.48	0.04	
14/11/2024 08:30:00	0.55	0.05	0.04	0.01	0.17	0.17	0.12	0.49	0.00	0.53	0.11	0.48	0.03	
14/11/2024 08:45:00	0.56	0.07	0.04	0.01	0.17	0.17	0.12	0.49	0.00	0.53	0.11	0.49	0.04	
14/11/2024 09:00:00	0.56	0.06	0.04	0.01	0.17	0.17	0.12	0.49	0.00	0.53	0.11	0.49	0.04	
14/11/2024 09:15:00	0.56	0.07	0.04	0.01	0.17	0.17	0.12	0.50	0.00	0.53	0.11	0.49	0.05	
14/11/2024 09:30:00	0.56	0.07	0.04	0.01	0.17	0.17	0.12	0.50	0.00	0.53	0.11	0.50	0.04	
14/11/2024 09:45:00	0.57	0.08	0.04	0.01	0.17	0.17	0.12	0.50	0.00	0.53	0.11	0.50	0.00	
14/11/2024 10:00:00	0.57	0.08	0.04	0.01	0.17	0.17	0.12	0.50	0.00	0.53	0.11	0.51		
14/11/2024 10:15:00	0.57	0.08	0.04	0.01	0.17	0.17	0.12	0.51	0.00	0.53	0.11	0.51	0.03	
14/11/2024 10:30:00	0.57	0.06	0.04	0.01	0.17	0.17	0.12	0.51	0.00	0.53	0.11	0.51	0.04	
14/11/2024 10:45:00	0.58	0.05	0.04	0.01	0.17	0.17	0.12	0.51	0.00	0.53	0.11	0.52	0.03	
14/11/2024 11:00:00	0.58	0.05	0.04	0.01	0.17	0.17	0.12	0.51	0.00	0.53	0.11	0.52	0.02	
14/11/2024 11:15:00	0.58	0.06	0.04	0.01	0.18	0.17	0.12	0.51	0.00	0.53	0.11	0.52	0.02	
14/11/2024 11:30:00	0.58	0.07	0.04	0.01	0.18	0.17	0.12	0.51	0.00	0.53	0.11	0.52	0.02	
14/11/2024 11:45:00	0.58	0.06	0.04	0.02	0.18	0.17	0.12	0.51	0.00	0.53	0.10	0.52	0.02	
14/11/2024 12:00:00	0.59	0.04	0.04	0.02	0.18	0.17	0.12	0.51	0.00	0.53	0.11	0.50	0.05	
14/11/2024 12:15:00	0.59	0.06	0.04	0.02	0.18	0.17	0.12	0.51	0.00	0.53	0.11	0.47	0.06	
14/11/2024 12:30:00	0.59	0.08	0.04	0.02	0.18	0.17	0.12	0.50	0.00	0.53	0.10	0.44	0.08	
14/11/2024 12:45:00	0.58	0.07	0.04	0.02	0.18	0.18	0.12	0.50	0.00	0.53	0.11	0.42	0.09	
14/11/2024 13:00:00	0.58	0.07	0.04	0.02	0.18	0.18	0.13	0.50	0.00	0.53	0.12	0.40	0.07	
14/11/2024 13:15:00	0.58	0.09	0.04	0.02	0.18	0.18	0.13	0.50	0.00	0.53	0.11	0.38	0.09	
14/11/2024 13:30:00	0.57	0.07	0.04	0.02	0.18	0.18	0.13	0.50	0.00	0.53	0.11	0.36	0.07	
14/11/2024 13:45:00	0.57	0.07	0.04	0.02	0.18	0.18	0.13	0.50	0.00	0.53	0.11	0.35	0.09	
14/11/2024 14:00:00	0.56	0.06	0.04	0.02	0.18	0.18	0.13	0.50	0.00	0.53	0.11	0.34	0.08	
14/11/2024 14:15:00	0.56	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.11	0.33	0.07	
14/11/2024 14:30:00	0.56	0.10	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.11	0.32	0.07	
14/11/2024 14:45:00	0.56	0.10	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.10	0.31	0.09	
14/11/2024 15:00:00	0.55	0.10	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.11	0.30	0.10	
14/11/2024 15:15:00	0.56	0.11	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.53	0.11	0.30	0.07	
14/11/2024 15:30:00	0.56	0.11	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.53	0.11	0.29	0.10	
14/11/2024 15:45:00	0.56	0.12	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.53	0.10	0.28	0.09	
14/11/2024 16:00:00	0.56	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.53	0.11	0.28	0.10	
14/11/2024 16:15:00	0.56	0.11	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.11	0.27	0.09	
14/11/2024 16:30:00	0.56	0.11	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.10	0.27	0.09	
14/11/2024 16:45:00	0.56	0.12	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.10	0.27	0.10	
14/11/2024 17:00:00	0.57	0.12	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.11	0.26	0.11	
14/11/2024 17:15:00	0.57	0.12	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.11	0.27	0.09	
14/11/2024 17:30:00	0.57	0.11	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.11	0.28	0.07	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
14/11/2024 17:45:00	0.57	0.12	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.11	0.30	0.06	
14/11/2024 18:00:00	0.57	0.13	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.11	0.32	0.06	
14/11/2024 18:15:00	0.57	0.11	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.11	0.34	0.06	
14/11/2024 18:30:00	0.57	0.12	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.11	0.36	0.07	
14/11/2024 18:45:00	0.57	0.11	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.11	0.38	0.07	
14/11/2024 19:00:00	0.57	0.12	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.11	0.39	0.06	
14/11/2024 19:15:00	0.58	0.12	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.10	0.41	0.04	
14/11/2024 19:30:00	0.58	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.11	0.42	0.04	
14/11/2024 19:45:00	0.58	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.10	0.43	0.05	
14/11/2024 20:00:00	0.58	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.10	0.44	0.06	
14/11/2024 20:15:00	0.59	0.12	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.09	0.45	0.05	
14/11/2024 20:30:00	0.59	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.52	0.11	0.45	0.04	
14/11/2024 20:45:00	0.59	0.10	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.52	0.10	0.46	0.04	
14/11/2024 21:00:00	0.59	0.10	0.05	0.02	0.18	0.18	0.13	0.52	0.00	0.52	0.11	0.47	0.05	
14/11/2024 21:15:00	0.60	0.07	0.05	0.02	0.18	0.18	0.13	0.52	0.00	0.52	0.10	0.47	0.04	
14/11/2024 21:30:00	0.60	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.52	0.10	0.48	0.04	
14/11/2024 21:45:00	0.60	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.52	0.10	0.49	0.05	
14/11/2024 22:00:00	0.61	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.52	0.10	0.49	0.05	
14/11/2024 22:15:00	0.61	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.52	0.10	0.50	0.04	
14/11/2024 22:30:00	0.61	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.52	0.11	0.50	0.04	
14/11/2024 22:45:00	0.61	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.52	0.10	0.51	0.05	
14/11/2024 23:00:00	0.62	0.06	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.10	0.51	0.05	
14/11/2024 23:15:00	0.62	0.09	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.11	0.52	0.05	
14/11/2024 23:30:00	0.62	0.08	0.05	0.02	0.19	0.18	0.13	0.50	0.00	0.52	0.11	0.52	0.05	
14/11/2024 23:45:00	0.62	0.09	0.05	0.02	0.19	0.18	0.13	0.50	0.00	0.52	0.11	0.53	0.05	
15/11/2024 00:00:00	0.63	0.09	0.05	0.02	0.19	0.18	0.13	0.50	0.00	0.52	0.10	0.53	0.04	
15/11/2024 00:15:00	0.63	0.08	0.05	0.02	0.19	0.18	0.13	0.50	0.00	0.52	0.11	0.53	0.06	
15/11/2024 00:30:00	0.63	0.07	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.10	0.51	0.06	
15/11/2024 00:45:00	0.63	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.10	0.48	0.07	
15/11/2024 01:00:00	0.63	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.52	0.10	0.46	0.08	
15/11/2024 01:15:00	0.63	0.08	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.10	0.44	0.09	
15/11/2024 01:30:00	0.63	0.09	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.10	0.42	0.07	
15/11/2024 01:45:00	0.63	0.10	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.09	0.40	0.09	
15/11/2024 02:00:00	0.63	0.09	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.10	0.39	0.12	
15/11/2024 02:15:00	0.62	0.11	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.10	0.38	0.10	
15/11/2024 02:30:00	0.62	0.11	0.05	0.02	0.18	0.18	0.13	0.49	0.00	0.52	0.10	0.37	0.12	
15/11/2024 02:45:00	0.62	0.09	0.05	0.02	0.18	0.18	0.13	0.48	0.00	0.51	0.10	0.36	0.12	
15/11/2024 03:00:00	0.61	0.10	0.05	0.02	0.18	0.18	0.13	0.48	0.00	0.51	0.09	0.35	0.08	
15/11/2024 03:15:00	0.61	0.10	0.05	0.02	0.18	0.18	0.13	0.48	0.00	0.51	0.10	0.34	0.08	
15/11/2024 03:30:00	0.61	0.11	0.04	0.02	0.18	0.18	0.13	0.48	0.00	0.51	0.10	0.33	0.10	
15/11/2024 03:45:00	0.61	0.09	0.04	0.02	0.18	0.18	0.13	0.48	0.00	0.51	0.10	0.33	0.08	
15/11/2024 04:00:00	0.60	0.11	0.04	0.02	0.18	0.18	0.12	0.48	0.00	0.51	0.09	0.32	0.10	
15/11/2024 04:15:00	0.60	0.11	0.04	0.02	0.18	0.18	0.12	0.48	0.00	0.51	0.10	0.32	0.10	
15/11/2024 04:30:00	0.60	0.10	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.51	0.10	0.31	0.11	
15/11/2024 04:45:00	0.60	0.09	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.51	0.10	0.32	0.11	
15/11/2024 05:00:00	0.59	0.10	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.51	0.09	0.34	0.08	
15/11/2024 05:15:00	0.59	0.12	0.04	0.02	0.18	0.17	0.12	0.48	0.00	0.51	0.08	0.36	0.07	
15/11/2024 05:30:00	0.59	0.12	0.04	0.02	0.18	0.17	0.12	0.47	0.00	0.51	0.09	0.38	0.06	
15/11/2024 05:45:00	0.59	0.10	0.04	0.02	0.17	0.17	0.12	0.47	0.00	0.51	0.09	0.40	0.06	
15/11/2024 06:00:00	0.59	0.12	0.04	0.02	0.17	0.17	0.12	0.47	0.00	0.50	0.09	0.41	0.07	
15/11/2024 06:15:00	0.59	0.10	0.04	0.02	0.17	0.17	0.12	0.47	0.00	0.50	0.09	0.43	0.06	
15/11/2024 06:30:00	0.59	0.11	0.04	0.01	0.17	0.17	0.12	0.47	0.00	0.50	0.10	0.44	0.06	
15/11/2024 06:45:00	0.59	0.11	0.04	0.01	0.17	0.17	0.12	0.47	0.00	0.50	0.09	0.45	0.04	
15/11/2024 07:00:00	0.59	0.10	0.04	0.01	0.17	0.17	0.12	0.47	0.00	0.50	0.09	0.46	0.05	
15/11/2024 07:15:00	0.59	0.09	0.04	0.01	0.17	0.17	0.12	0.47	0.00	0.50	0.10	0.46	0.05	
15/11/2024 07:30:00	0.59	0.08	0.04	0.01	0.17	0.17	0.12	0.47	0.00	0.50	0.10	0.47	0.04	
15/11/2024 07:45:00	0.59	0.09	0.04	0.01	0.17	0.17	0.12	0.48	0.00	0.50	0.10	0.48	0.05	
15/11/2024 08:00:00	0.59	0.08	0.03	0.01	0.17	0.17	0.12	0.48	0.00	0.50	0.09	0.48	0.04	
15/11/2024 08:15:00	0.60	0.08	0.03	0.01	0.17	0.17	0.12	0.48	0.00	0.50	0.09	0.49	0.05	
15/11/2024 08:30:00	0.60	0.09	0.03	0.01	0.17	0.17	0.12	0.48	0.00	0.50	0.10	0.49	0.05	
15/11/2024 08:45:00	0.60	0.10	0.03	0.01	0.17	0.17	0.12	0.48	0.00	0.50	0.10	0.50	0.05	
15/11/2024 09:00:00	0.60	0.06	0.03	0.01	0.17	0.17	0.12	0.49	0.00	0.50	0.09	0.50	0.04	
15/11/2024 09:15:00	0.60	0.08	0.03	0.01	0.17	0.17	0.12	0.49	0.00	0.50	0.09	0.51	0.03	
15/11/2024 09:30:00	0.61	0.10	0.03	0.01	0.17	0.17	0.12	0.49	0.00	0.50	0.09	0.51	0.03	
15/11/2024 09:45:00	0.61	0.09	0.03	0.01	0.17	0.17	0.12	0.49	0.00	0.50	0.10	0.52	0.03	
15/11/2024 10:00:00	0.61	0.08	0.03	0.01	0.17	0.17	0.12	0.50	0.00	0.50	0.10	0.52	0.03	
15/11/2024 10:15:00	0.61	0.08	0.03	0.01	0.17	0.17	0.12	0.50	0.00	0.50	0.10	0.53	0.01	
15/11/2024 10:30:00	0.62	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.00	0.50	0.09	0.53	0.02	
15/11/2024 10:45:00	0.62	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.00	0.50	0.10	0.53	0.01	
15/11/2024 11:00:00	0.62	0.04	0.03	0.01	0.17	0.17	0.12	0.50	0.00	0.50	0.10	0.54	0.03	
15/11/2024 11:15:00	0.62	0.07	0.03	0.01	0.17	0.17	0.12	0.50	0.00	0.50	0.09	0.54	0.02	
15/11/2024 11:30:00	0.63	0.06	0.03	0.01	0.17	0.17	0.12	0.50	0.00	0.50	0.10	0.54	0.01	
15/11/2024 11:45:00	0.63	0.06	0.04	0.01	0.17	0.17	0.12	0.50	0.00	0.50	0.12	0.55	0.04	
15/11/2024 12:00:00	0.63	0.07	0.04	0.01	0.17	0.17	0.12	0.50	0.00	0.50	0.09	0.55	0.03	
15/11/2024 12:15:00	0.63	0.07	0.04	0.01	0.17	0.17	0.12	0.51	0.00	0.50	0.11	0.54	0.04	
15/11/2024 12:30:00	0.63	0.07	0.04	0.01	0.17	0.17	0.12	0.51	0.00	0.50	0.12	0.52	0.08	
15/11/2024 12:45:00	0.63	0.07	0.04	0.01	0.17	0.17	0.12	0.51	0.00	0.50	0.10	0.49	0.08	
15/11/2024 13:00:00	0.63	0.08	0.04	0.02	0.17	0.17	0.12	0.51	0.00	0.50	0.08	0.46	0.07	
15/11/2024 13:15:00	0.63	0.07	0.04	0.02	0.17	0.17	0.12	0.50	0.00	0.50	0.08	0.44	0.08	
15/11/2024 13:30:00	0.63	0.07	0.04	0.02	0.18	0.17	0.12	0.50	0.00	0.50	0.08	0.42	0.09	
15/11/2024 13:45:00	0.62	0.06	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.50	0.09	0.40	0.08	
15/11/2024 14:00:00	0.62	0.09	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.50	0.10	0.39	0.07	
15/11/2024 14:15:00	0.62	0.10	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.50	0.09	0.38	0.09	
15/11/2024 14:30:00	0.61	0.10	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.50	0.09	0.37	0.11	
15/11/2024 14:45:00	0.61	0.10	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.49	0.09	0.36	0.09	
15/11/2024 15:00:00	0.61	0.10	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.49	0.09	0.35	0.08	
15/11/2024 15:15:00	0.60	0.09	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.49	0.10	0.34	0.09	
15/11/2024 15:30:00	0.60	0.10	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.49	0.09	0.34	0.07	
15/11/2024 15:45:00	0.60	0.10	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.49	0.09	0.33	0.08	
15/11/2024 16:00:00	0.59	0.10	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.49	0.09	0.33	0.08	
15/11/2024 16:15:00	0.59	0.11	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.49	0.09	0.32	0.07	
15/11/2024 16:30:00	0.59	0.10	0.04	0.02	0.18	0.17	0.13	0.50	0.00	0.49	0.10	0.31	0.09	
15/11/2024 16:45:00	0.58	0.11	0.04	0.02	0.18	0.17	0.13	0.51	0.00	0.49	0.09	0.31	0.09	
15/11/2024 17:00:00	0.58	0.09	0.04	0.02	0.18	0.17	0.13	0.51	0.00	0.49	0.09	0.30	0.07	
15/11/2024 17:15:00	0.58	0.10	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.49	0.09	0.30	0.09	
15/11/2024 17:30:00	0.57	0.10	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.49	0.08	0.30	0.13	
15/11/2024 17:45:00	0.57	0.11	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.48	0.09	0.29	0.09	
15/11/2024 18:00:00	0.57	0.11	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.48	0.09	0.29	0.07	
15/11/2024 18:15:00	0.57	0.11	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.48	0.09	0.29	0.10	
15/11/2024 18:30:00	0.56	0.11	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.48	0.09	0.31	0.08	
15/11/2024 18:45:00	0.56	0.11	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.48	0.10	0.34	0.05	
15/11/2024 19:00:00	0.56	0.11	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.48	0.10	0.36	0.07	
15/11/2024 19:15:00	0.56	0.10	0.05	0.02	0.18	0.17	0.13	0.50	0.00	0.48	0.09	0.38	0.05	
15/11/2024 19:30:00	0.56	0.12	0.04	0.02	0.18	0.18	0.13	0.51	0.00	0.48	0.08	0.39	0.03	
15/11/2024 19:45:00	0.56	0.11	0.04	0.02	0.18	0.18	0.13	0.51	0.00	0.48	0.09	0.41	0.03	
15/11/2024 20:00:00	0.56	0.10	0.04	0.02	0.18	0.17	0.13	0.51	0.00	0.48	0.09	0.42	0.04	
15/11/2024 20:15:00	0.56	0.09	0.05	0.02	0.18	0.17	0.13	0.51	0.00	0.48	0.09	0.43	0.06	
15/11/2024 20:30:00	0.56	0.09	0.04	0.02	0.18	0.18	0.13	0.51	0.00	0.48	0.09	0.43	0.05	
15/11/2024 20:45:00	0.56	0.11	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.48	0.09	0.44	0.04	
15/11/2024 21:00:00	0.56	0.06	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.48	0.10	0.45	0.05	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
15/11/2024 21:15:00	0.57	0.06	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.48	0.09	0.46	0.03	
15/11/2024 21:30:00	0.57	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.48	0.09	0.46	0.03	
15/11/2024 21:45:00	0.57	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.48	0.09	0.47	0.03	
15/11/2024 22:00:00	0.57	0.06	0.05	0.02	0.18	0.18	0.13	0.51	0.00	0.48	0.08	0.47	0.03	
15/11/2024 22:15:00	0.57	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.08	0.48	0.03	
15/11/2024 22:30:00	0.58	0.11	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.08	0.48	0.03	
15/11/2024 22:45:00	0.58	0.03	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.08	0.49	0.03	
15/11/2024 23:00:00	0.58	0.07	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.09	0.49	0.04	
15/11/2024 23:15:00	0.58	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.09	0.50	0.03	
15/11/2024 23:30:00	0.59	0.07	0.04	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.08	0.50	0.04	
15/11/2024 23:45:00	0.59	0.06	0.04	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.09	0.51	0.04	
16/11/2024 00:00:00	0.59	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.09	0.51	0.04	
16/11/2024 00:15:00	0.59	0.07	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.08	0.51	0.03	
16/11/2024 00:30:00	0.60	0.07	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.09	0.52	0.04	
16/11/2024 00:45:00	0.60	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.09	0.52	0.04	
16/11/2024 01:00:00	0.60	0.07	0.04	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.08	0.52	0.04	
16/11/2024 01:15:00	0.60	0.09	0.04	0.02	0.18	0.18	0.13	0.50	0.00	0.48	0.09	0.50	0.06	
16/11/2024 01:30:00	0.60	0.08	0.04	0.02	0.18	0.18	0.13	0.49	0.00	0.48	0.08	0.48	0.07	
16/11/2024 01:45:00	0.60	0.09	0.04	0.02	0.18	0.18	0.13	0.49	0.56	0.48	0.08	0.45	0.08	
16/11/2024 02:00:00	0.60	0.10	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.48	0.08	0.43	0.08	
16/11/2024 02:15:00	0.60	0.09	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.48	0.08	0.41	0.08	
16/11/2024 02:30:00	0.60	0.09	0.04	0.02	0.18	0.18	0.13	0.49	0.06	0.48	0.08	0.39	0.08	
16/11/2024 02:45:00	0.59	0.10	0.04	0.02	0.18	0.18	0.13	0.49	0.06	0.48	0.08	0.38	0.06	
16/11/2024 03:00:00	0.59	0.09	0.04	0.02	0.18	0.17	0.13	0.49	0.05	0.48	0.09	0.37	0.07	
16/11/2024 03:15:00	0.59	0.11	0.04	0.02	0.18	0.17	0.13	0.49	0.05	0.47	0.09	0.35	0.07	
16/11/2024 03:30:00	0.59	0.10	0.04	0.02	0.18	0.17	0.12	0.49	0.05	0.47	0.09	0.34	0.08	
16/11/2024 03:45:00	0.58	0.08	0.04	0.02	0.18	0.17	0.12	0.49	0.06	0.47	0.09	0.33	0.07	
16/11/2024 04:00:00	0.58	0.09	0.04	0.02	0.18	0.17	0.12	0.49	0.05	0.47	0.08	0.33	0.09	
16/11/2024 04:15:00	0.58	0.12	0.04	0.02	0.18	0.17	0.12	0.49	0.07	0.47	0.09	0.32	0.08	
16/11/2024 04:30:00	0.57	0.12	0.04	0.02	0.18	0.17	0.12	0.49	0.05	0.47	0.09	0.31	0.08	
16/11/2024 04:45:00	0.57	0.11	0.04	0.02	0.18	0.17	0.12	0.49	0.05	0.47	0.09	0.30	0.10	
16/11/2024 05:00:00	0.57	0.11	0.04	0.02	0.18	0.17	0.12	0.49	0.06	0.47	0.09	0.30	0.07	
16/11/2024 05:15:00	0.56	0.10	0.04	0.02	0.18	0.17	0.12	0.49	0.06	0.47	0.09	0.32	0.06	
16/11/2024 05:30:00	0.56	0.11	0.04	0.02	0.18	0.17	0.12	0.49	0.05	0.47	0.09	0.35	0.03	
16/11/2024 05:45:00	0.56	0.10	0.04	0.02	0.18	0.17	0.12	0.48	0.04	0.47	0.09	0.37	0.03	
16/11/2024 06:00:00	0.56	0.11	0.04	0.01	0.18	0.17	0.12	0.48	0.06	0.47	0.09	0.39	0.04	
16/11/2024 06:15:00	0.56	0.11	0.04	0.01	0.17	0.17	0.12	0.48	0.06	0.47	0.10	0.41	0.04	
16/11/2024 06:30:00	0.56	0.10	0.04	0.01	0.17	0.17	0.12	0.48	0.03	0.47	0.09	0.42	0.04	
16/11/2024 06:45:00	0.56	0.08	0.04	0.01	0.17	0.17	0.12	0.48	0.05	0.47	0.09	0.43	0.04	
16/11/2024 07:00:00	0.56	0.12	0.04	0.02	0.17	0.17	0.12	0.48	0.05	0.47	0.09	0.44	0.04	
16/11/2024 07:15:00	0.56	0.08	0.04	0.01	0.17	0.17	0.12	0.48	0.06	0.47	0.09	0.44	0.03	
16/11/2024 07:30:00	0.56	0.04	0.04	0.01	0.17	0.17	0.12	0.48	0.06	0.47	0.09	0.45	0.04	
16/11/2024 07:45:00	0.56	0.08	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.46	0.08	0.46	0.03	
16/11/2024 08:00:00	0.56	0.08	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.46	0.10	0.46	0.04	
16/11/2024 08:15:00	0.57	0.09	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.46	0.09	0.47	0.02	
16/11/2024 08:30:00	0.57	0.07	0.04	0.01	0.17	0.17	0.12	0.48	0.07	0.46	0.08	0.47	0.01	
16/11/2024 08:45:00	0.57	0.05	0.04	0.01	0.17	0.17	0.12	0.48	0.08	0.46	0.09	0.48	0.01	
16/11/2024 09:00:00	0.57	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.08	0.46	0.09	0.48	0.02	
16/11/2024 09:15:00	0.57	0.07	0.04	0.01	0.17	0.17	0.12	0.49	0.07	0.46	0.08	0.49	-0.01	
16/11/2024 09:30:00	0.58	0.06	0.04	0.01	0.17	0.17	0.12	0.49	0.08	0.46	0.08	0.49	0.03	
16/11/2024 09:45:00	0.58	0.09	0.04	0.01	0.17	0.17	0.12	0.49	0.08	0.46	0.09	0.50	0.03	
16/11/2024 10:00:00	0.58	0.08	0.04	0.01	0.17	0.17	0.12	0.50	0.08	0.46	0.09	0.50	0.00	
16/11/2024 10:15:00	0.58	0.09	0.04	0.01	0.17	0.17	0.12	0.50	0.09	0.46	0.09	0.51	0.01	
16/11/2024 10:30:00	0.59	0.08	0.04	0.01	0.17	0.17	0.12	0.51	0.09	0.46	0.09	0.51	0.02	
16/11/2024 10:45:00	0.59	0.05	0.04	0.01	0.17	0.17	0.12	0.51	0.08	0.46	0.09	0.52	0.01	
16/11/2024 11:00:00	0.59	0.07	0.04	0.01	0.17	0.17	0.12	0.51	0.08	0.46	0.08	0.52	0.04	
16/11/2024 11:15:00	0.59	0.05	0.04	0.01	0.17	0.17	0.12	0.51	0.09	0.46	0.08	0.52	0.02	
16/11/2024 11:30:00	0.60	0.07	0.04	0.01	0.17	0.17	0.12	0.51	0.08	0.46	0.09	0.53	0.01	
16/11/2024 11:45:00	0.60	0.08	0.04	0.01	0.17	0.17	0.12	0.51	0.09	0.46	0.09	0.53	0.02	
16/11/2024 12:00:00	0.60	0.06	0.04	0.01	0.17	0.17	0.12	0.51	0.08	0.46	0.09	0.53	0.02	
16/11/2024 12:15:00	0.60	0.07	0.04	0.01	0.17	0.17	0.12	0.51	0.09	0.47	0.08	0.54	0.02	
16/11/2024 12:30:00	0.61	0.07	0.04	0.02	0.18	0.17	0.12	0.51	0.08	0.47	0.08	0.54	0.02	
16/11/2024 12:45:00	0.61	0.07	0.04	0.02	0.18	0.17	0.12	0.51	0.08	0.47	0.09	0.54	0.02	
16/11/2024 13:00:00	0.61	0.07	0.04	0.02	0.18	0.17	0.12	0.51	0.08	0.47	0.08	0.55	0.01	
16/11/2024 13:15:00	0.61	0.06	0.04	0.02	0.18	0.17	0.12	0.51	0.07	0.47	0.08	0.55	0.01	
16/11/2024 13:30:00	0.61	0.05	0.04	0.02	0.18	0.17	0.12	0.51	0.08	0.47	0.08	0.55	0.02	
16/11/2024 13:45:00	0.62	0.07	0.05	0.02	0.18	0.17	0.12	0.51	0.09	0.47	0.08	0.56	0.03	
16/11/2024 14:00:00	0.62	0.06	0.04	0.02	0.18	0.18	0.13	0.51	0.08	0.47	0.08	0.55	0.01	
16/11/2024 14:15:00	0.62	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.07	0.47	0.09	0.53	0.06	
16/11/2024 14:30:00	0.62	0.05	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.47	0.08	0.50	0.08	
16/11/2024 14:45:00	0.62	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.47	0.08	0.48	0.05	
16/11/2024 15:00:00	0.62	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.47	0.07	0.46	0.05	
16/11/2024 15:15:00	0.61	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.47	0.09	0.43	0.07	
16/11/2024 15:30:00	0.61	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.47	0.08	0.42	0.09	
16/11/2024 15:45:00	0.61	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.47	0.09	0.40	0.08	
16/11/2024 16:00:00	0.60	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.07	0.47	0.09	0.38	0.08	
16/11/2024 16:15:00	0.60	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.47	0.09	0.37	0.07	
16/11/2024 16:30:00	0.59	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.47	0.08	0.36	0.07	
16/11/2024 16:45:00	0.59	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.47	0.09	0.35	0.08	
16/11/2024 17:00:00	0.59	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.47	0.08	0.34	0.06	
16/11/2024 17:15:00	0.58	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.01	0.47	0.10	0.34	0.09	
16/11/2024 17:30:00	0.58	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.17	0.47	0.09	0.33	0.09	
16/11/2024 17:45:00	0.57	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.09	0.47	0.09	0.33	0.09	
16/11/2024 18:00:00	0.57	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.47	0.09	0.37	0.04	
16/11/2024 18:15:00	0.57	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.47	0.10	0.41	0.04	
16/11/2024 18:30:00	0.57	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.47	0.09	0.43	0.04	
16/11/2024 18:45:00	0.56	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.47	0.09	0.44	0.03	
16/11/2024 19:00:00	0.56	0.11	0.05	0.02	0.18	0.18	0.13	0.52	0.07	0.47	0.10	0.45	0.02	
16/11/2024 19:15:00	0.56	0.09	0.05	0.02	0.18	0.18	0.13	0.52	0.06	0.47	0.09	0.46	0.02	
16/11/2024 19:30:00	0.57	0.09	0.05	0.02	0.18	0.18	0.13	0.52	0.08	0.47	0.10	0.47	0.04	
16/11/2024 19:45:00	0.57	0.06	0.05	0.02	0.18	0.18	0.13	0.52	0.07	0.47	0.09	0.47	0.03	
16/11/2024 20:00:00	0.57	0.09	0.05	0.02	0.18	0.18	0.13	0.52	0.07	0.46	0.10	0.48	0.02	
16/11/2024 20:15:00	0.57	0.05	0.05	0.02	0.18	0.18	0.13	0.52	0.07	0.46	0.10	0.49	0.02	
16/11/2024 20:30:00	0.57	0.09	0.05	0.02	0.18	0.18	0.13	0.52	0.06	0.46	0.09	0.49	0.03	
16/11/2024 20:45:00	0.57	0.09	0.05	0.02	0.18	0.18	0.13	0.52	0.07	0.46	0.08	0.50	0.04	
16/11/2024 21:00:00	0.58	0.08	0.05	0.02	0.18	0.18	0.13	0.52	0.06	0.46	0.09	0.50	0.03	
16/11/2024 21:15:00	0.58	0.06	0.05	0.02	0.18	0.18	0.13	0.52	0.06	0.46	0.09	0.51	0.03	
16/11/2024 21:30:00	0.58	0.07	0.05	0.02	0.19	0.18	0.13	0.52	0.07	0.46	0.09	0.51	0.03	
16/11/2024 21:45:00	0.58	0.09	0.05	0.02	0.19	0.18	0.13	0.52	0.07	0.46	0.09	0.52	0.03	
16/11/2024 22:00:00	0.59	0.07	0.05	0.02	0.19	0.18	0.13	0.52	0.06	0.46	0.08	0.52	0.03	
16/11/2024 22:15:00	0.59	0.08	0.05	0.02	0.19	0.18	0.13	0.51	0.07	0.46	0.09	0.53	0.04	
16/11/2024 22:30:00	0.59	0.05	0.05	0.02	0.19	0.18	0.13	0.51	0.07	0.46	0.09	0.53	0.03	
16/11/2024 22:45:00	0.59	0.06	0.05	0.02	0.19	0.18	0.13	0.51	0.07	0.46	0.09	0.53	0.02	
16/11/2024 23:00:00	0.60	0.07	0.05	0.02	0.19	0.18	0.13	0.51	0.07	0.46	0.10	0.54	0.03	
16/11/2024 23:15:00	0.60	0.08	0.05	0.02	0.19	0.18	0.13	0.51	0.07	0.46	0.08	0.54	0.03	
16/11/2024 23:30:00	0.60	0.08	0.05	0.02	0.19	0.18	0.13	0.51	0.07	0.46	0.09	0.54	0.04	
16/11/2024 23:45:00	0.60	0.07	0.05	0.02	0.19	0.18	0.13	0.51	0.07	0.46	0.09	0.55	0.02	
17/11/2024 00:00:00	0.61	0.06	0.05	0.02	0.19	0.18	0.13	0.51	0.07	0.46	0.09	0.55	0.03	
17/11/2024 00:15:00	0.61	0.06	0.05	0.02	0.19	0.18	0.13	0.51	0.07	0.46	0.09	0.55	0.03	
17/11/2024 00:30:00	0.61	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.07	0.46	0.10	0.56	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
17/11/2024 00:45:00	0.62	0.07	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.47	0.09	0.56	0.02	
17/11/2024 01:00:00	0.62	0.07	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.47	0.09	0.56	0.02	
17/11/2024 01:15:00	0.62	0.07	0.05	0.02	0.18	0.18	0.13	0.50	0.05	0.47	0.09	0.56	0.01	
17/11/2024 01:30:00	0.62	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.47	0.09	0.57	0.04	
17/11/2024 01:45:00	0.62	0.06	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.47	0.08	0.57	0.03	
17/11/2024 02:00:00	0.63	0.07	0.05	0.02	0.18	0.18	0.13	0.50	0.05	0.47	0.09	0.57	0.03	
17/11/2024 02:15:00	0.63	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.05	0.47	0.09	0.57	0.03	
17/11/2024 02:30:00	0.63	0.07	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.47	0.09	0.56	0.06	
17/11/2024 02:45:00	0.63	0.06	0.05	0.02	0.18	0.18	0.13	0.49	0.04	0.47	0.09	0.53	0.07	
17/11/2024 03:00:00	0.63	0.08	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.47	0.09	0.51	0.06	
17/11/2024 03:15:00	0.63	0.08	0.05	0.02	0.18	0.18	0.13	0.49	0.07	0.47	0.09	0.49	0.07	
17/11/2024 03:30:00	0.63	0.09	0.05	0.02	0.18	0.18	0.13	0.49	0.05	0.47	0.09	0.47	0.07	
17/11/2024 03:45:00	0.62	0.07	0.05	0.02	0.18	0.18	0.13	0.49	0.04	0.47	0.09	0.45	0.07	
17/11/2024 04:00:00	0.62	0.07	0.05	0.02	0.18	0.18	0.13	0.49	0.04	0.47	0.09	0.43	0.08	
17/11/2024 04:15:00	0.61	0.10	0.04	0.02	0.18	0.18	0.12	0.49	0.04	0.47	0.09	0.41	0.08	
17/11/2024 04:30:00	0.61	0.07	0.05	0.02	0.18	0.18	0.12	0.49	0.06	0.47	0.09	0.40	0.08	
17/11/2024 04:45:00	0.60	0.09	0.04	0.02	0.18	0.18	0.12	0.49	0.06	0.46	0.08	0.39	0.08	
17/11/2024 05:00:00	0.60	0.10	0.04	0.02	0.18	0.18	0.12	0.49	0.06	0.46	0.09	0.38	0.09	
17/11/2024 05:15:00	0.60	0.09	0.04	0.02	0.18	0.18	0.12	0.48	0.06	0.46	0.09	0.37	0.07	
17/11/2024 05:30:00	0.59	0.07	0.04	0.02	0.18	0.18	0.12	0.48	0.06	0.46	0.09	0.36	0.05	
17/11/2024 05:45:00	0.59	0.09	0.04	0.02	0.18	0.18	0.12	0.48	0.06	0.46	0.09	0.36	0.08	
17/11/2024 06:00:00	0.58	0.09	0.04	0.02	0.18	0.18	0.12	0.48	0.03	0.46	0.09	0.39	0.05	
17/11/2024 06:15:00	0.58	0.08	0.04	0.02	0.17	0.17	0.12	0.48	0.00	0.46	0.09	0.41	0.05	
17/11/2024 06:30:00	0.58	0.07	0.04	0.02	0.17	0.17	0.12	0.48	0.06	0.46	0.09	0.44	0.03	
17/11/2024 06:45:00	0.57	0.09	0.04	0.02	0.17	0.17	0.12	0.48	0.05	0.46	0.09	0.45	0.03	
17/11/2024 07:00:00	0.57	0.09	0.04	0.02	0.17	0.17	0.12	0.48	0.06	0.46	0.10	0.47	0.03	
17/11/2024 07:15:00	0.57	0.07	0.04	0.02	0.17	0.17	0.12	0.48	0.07	0.46	0.09	0.48	0.04	
17/11/2024 07:30:00	0.57	0.07	0.04	0.02	0.17	0.17	0.12	0.48	0.07	0.46	0.10	0.49	0.04	
17/11/2024 07:45:00	0.57	0.09	0.04	0.02	0.17	0.17	0.12	0.48	0.06	0.46	0.09	0.49	0.03	
17/11/2024 08:00:00	0.58	0.10	0.04	0.01	0.17	0.17	0.12	0.49	0.05	0.45	0.08	0.50	0.01	
17/11/2024 08:15:00	0.58	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.06	0.45	0.09	0.50	0.01	
17/11/2024 08:30:00	0.58	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.06	0.45	0.09	0.51	0.02	
17/11/2024 08:45:00	0.58	0.09	0.04	0.01	0.17	0.17	0.12	0.49	0.06	0.45	0.09	0.51	0.02	
17/11/2024 09:00:00	0.58	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.06	0.45	0.09	0.51	0.02	
17/11/2024 09:15:00	0.59	0.08	0.04	0.01	0.17	0.17	0.12	0.49	0.06	0.45	0.09	0.52	0.02	
17/11/2024 09:30:00	0.59	0.05	0.04	0.01	0.17	0.17	0.12	0.49	0.06	0.45	0.09	0.52	0.03	
17/11/2024 09:45:00	0.59	0.07	0.04	0.01	0.17	0.17	0.12	0.49	0.05	0.45	0.10	0.53	0.01	
17/11/2024 10:00:00	0.59	0.07	0.04	0.01	0.17	0.17	0.12	0.50	0.07	0.45	0.09	0.53	0.03	
17/11/2024 10:15:00	0.59	0.05	0.03	0.01	0.17	0.17	0.12	0.50	0.08	0.45	0.09	0.54	0.02	
17/11/2024 10:30:00	0.60	0.07	0.03	0.01	0.17	0.17	0.12	0.51	0.06	0.45	0.09	0.54	0.03	
17/11/2024 10:45:00	0.60	0.06	0.04	0.01	0.17	0.17	0.12	0.51	0.06	0.45	0.09	0.55	0.04	
17/11/2024 11:00:00	0.60	0.05	0.04	0.01	0.17	0.17	0.12	0.51	0.08	0.45	0.08	0.55	0.02	
17/11/2024 11:15:00	0.61	0.07	0.04	0.01	0.17	0.17	0.12	0.51	0.08	0.45	0.08	0.55	0.03	
17/11/2024 11:30:00	0.61	0.08	0.04	0.01	0.17	0.17	0.12	0.51	0.08	0.45	0.08	0.55	0.02	
17/11/2024 11:45:00	0.61	0.05	0.04	0.01	0.17	0.17	0.12	0.51	0.08	0.46	0.09	0.56	0.02	
17/11/2024 12:00:00	0.61	0.05	0.04	0.01	0.17	0.17	0.12	0.51	0.06	0.46	0.09	0.56	0.02	
17/11/2024 12:15:00	0.61	0.06	0.04	0.01	0.17	0.17	0.12	0.51	0.08	0.46	0.08	0.56	0.03	
17/11/2024 12:30:00	0.62	0.07	0.04	0.01	0.17	0.17	0.12	0.52	0.07	0.46	0.09	0.57	0.03	
17/11/2024 12:45:00	0.62	0.04	0.04	0.02	0.18	0.17	0.12	0.51	0.06	0.46	0.08	0.57	0.02	
17/11/2024 13:00:00	0.62	0.05	0.04	0.02	0.18	0.17	0.12	0.51	0.06	0.46	0.08	0.57	0.04	
17/11/2024 13:15:00	0.62	0.07	0.04	0.02	0.18	0.17	0.12	0.51	0.07	0.46	0.07	0.57	0.04	
17/11/2024 13:30:00	0.62	0.06	0.04	0.02	0.18	0.18	0.12	0.51	0.05	0.46	0.08	0.57	0.03	
17/11/2024 13:45:00	0.63	0.05	0.05	0.02	0.18	0.18	0.12	0.51	0.07	0.46	0.08	0.58	0.03	
17/11/2024 14:00:00	0.63	0.05	0.05	0.02	0.18	0.18	0.12	0.51	0.05	0.46	0.08	0.58	0.01	
17/11/2024 14:15:00	0.63	0.06	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.46	0.08	0.58	0.02	
17/11/2024 14:30:00	0.63	0.06	0.05	0.02	0.18	0.18	0.13	0.51	0.04	0.46	0.08	0.58	0.03	
17/11/2024 14:45:00	0.63	0.06	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.46	0.08	0.57	0.05	
17/11/2024 15:00:00	0.63	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.07	0.46	0.08	0.55	0.05	
17/11/2024 15:15:00	0.63	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.04	0.46	0.08	0.53	0.05	
17/11/2024 15:30:00	0.63	0.02	0.05	0.02	0.18	0.18	0.13	0.51	0.05	0.46	0.08	0.50	0.07	
17/11/2024 15:45:00	0.63	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.46	0.09	0.48	0.07	
17/11/2024 16:00:00	0.62	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.46	0.09	0.46	0.07	
17/11/2024 16:15:00	0.62	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.46	0.09	0.44	0.10	
17/11/2024 16:30:00	0.62	0.10	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.46	0.08	0.42	0.09	
17/11/2024 16:45:00	0.61	0.10	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.46	0.09	0.41	0.08	
17/11/2024 17:00:00	0.61	0.11	0.05	0.02	0.18	0.18	0.13	0.51	0.07	0.46	0.08	0.39	0.10	
17/11/2024 17:15:00	0.60	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.07	0.46	0.08	0.38	0.09	
17/11/2024 17:30:00	0.60	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.07	0.46	0.07	0.37	0.10	
17/11/2024 17:45:00	0.59	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.46	0.08	0.36	0.09	
17/11/2024 18:00:00	0.59	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.46	0.07	0.36	0.11	
17/11/2024 18:15:00	0.58	0.09	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.46	0.07	0.35	0.09	
17/11/2024 18:30:00	0.58	0.11	0.05	0.02	0.18	0.18	0.13	0.52	0.05	0.46	0.08	0.35	0.08	
17/11/2024 18:45:00	0.58	0.09	0.05	0.02	0.18	0.18	0.13	0.55	0.07	0.46	0.06	0.35	0.06	
17/11/2024 19:00:00	0.57	0.10	0.05	0.02	0.19	0.18	0.13	0.56	0.09	0.46	0.07	0.38	0.06	
17/11/2024 19:15:00	0.57	0.10	0.06	0.03	0.19	0.18	0.13	0.57	0.09	0.46	0.08	0.41	0.04	
17/11/2024 19:30:00	0.57	0.10	0.05	0.02	0.19	0.18	0.13	0.57	0.08	0.46	0.08	0.44	0.06	
17/11/2024 19:45:00	0.57	0.09	0.06	0.03	0.19	0.19	0.14	0.58	0.10	0.46	0.07	0.45	0.04	
17/11/2024 20:00:00	0.57	0.08	0.06	0.03	0.19	0.19	0.14	0.58	0.09	0.46	0.07	0.46	0.04	
17/11/2024 20:15:00	0.57	0.09	0.06	0.03	0.20	0.19	0.15	0.58	0.10	0.46	0.07	0.47	0.03	
17/11/2024 20:30:00	0.57	0.09	0.06	0.03	0.20	0.19	0.15	0.58	0.11	0.46	0.08	0.49	0.04	
17/11/2024 20:45:00	0.57	0.09	0.06	0.03	0.20	0.20	0.15	0.58	0.10	0.46	0.07	0.49	0.04	
17/11/2024 21:00:00	0.58	0.08	0.07	0.03	0.21	0.20	0.16	0.58	0.09	0.46	0.08	0.50	0.02	
17/11/2024 21:15:00	0.58	0.09	0.07	0.04	0.21	0.20	0.16	0.58	0.09	0.46	0.08	0.51	0.03	
17/11/2024 21:30:00	0.58	0.06	0.07	0.04	0.22	0.20	0.17	0.57	0.09	0.46	0.07	0.51	0.03	
17/11/2024 21:45:00	0.58	0.11	0.08	0.04	0.22	0.21	0.17	0.57	0.08	0.46	0.07	0.52	0.03	
17/11/2024 22:00:00	0.59	0.09	0.08	0.04	0.22	0.21	0.17	0.56	0.09	0.46	0.08	0.52	0.02	
17/11/2024 22:15:00	0.59	0.08	0.08	0.04	0.22	0.21	0.17	0.56	0.09	0.46	0.08	0.53	0.03	
17/11/2024 22:30:00	0.59	0.09	0.08	0.04	0.22	0.21	0.17	0.56	0.09	0.46	0.08	0.53	0.03	
17/11/2024 22:45:00	0.60	0.08	0.08	0.04	0.22	0.21	0.17	0.56	0.09	0.46	0.08	0.54	0.02	
17/11/2024 23:00:00	0.60	0.08	0.08	0.04	0.22	0.21	0.17	0.55	0.08	0.46	0.07	0.54	0.03	
17/11/2024 23:15:00	0.60	0.07	0.08	0.04	0.22	0.21	0.17	0.55	0.09	0.46	0.08	0.55	0.01	
17/11/2024 23:30:00	0.61	0.07	0.08	0.04	0.22	0.21	0.17	0.55	0.08	0.46	0.07	0.55	0.03	
17/11/2024 23:45:00	0.61	0.07	0.08	0.04	0.22	0.21	0.17	0.55	0.09	0.46	0.07	0.56	0.02	
18/11/2024 00:00:00	0.61	0.08	0.08	0.04	0.22	0.21	0.17	0.55	0.08	0.46	0.08	0.56	0.02	
18/11/2024 00:15:00	0.62	0.05	0.08	0.04	0.22	0.21	0.17	0.55	0.08	0.46	0.07	0.56	0.03	
18/11/2024 00:30:00	0.62	0.08	0.08	0.04	0.22	0.21	0.17	0.55	0.08	0.46	0.07	0.56	0.04	
18/11/2024 00:45:00	0.62	0.08	0.08	0.04	0.22	0.21	0.17	0.54	0.09	0.47	0.08	0.57	0.02	
18/11/2024 01:00:00	0.62	0.08	0.07	0.04	0.22	0.21	0.17	0.54	0.08	0.47	0.08	0.57	0.03	
18/11/2024 01:15:00	0.63	0.08	0.07	0.04	0.22	0.21	0.17	0.54	0.09	0.47	0.07	0.57	0.03	
18/11/2024 01:30:00	0.63	0.08	0.07	0.04	0.22	0.21	0.17	0.54	0.09	0.47	0.07	0.58	0.04	
18/11/2024 01:45:00	0.63	0.07	0.07	0.04	0.22	0.21	0.17	0.54	0.08	0.47	0.08	0.58	0.04	
18/11/2024 02:00:00	0.64	0.05	0.07	0.04	0.21	0.21	0.16	0.54	0.08	0.47	0.07	0.58	0.02	
18/11/2024 02:15:00	0.64	0.07	0.07	0.04	0.21	0.21	0.16	0.54	0.09	0.47	0.07	0.58	0.04	
18/11/2024 02:30:00	0.64	0.08	0.07	0.04	0.21	0.21	0.16	0.54	0.08	0.47	0.08	0.59	0.03	
18/11/2024 02:45:00	0.64	0.05	0.07	0.04	0.21	0.20	0.16	0.54	0.08	0.47	0.08	0.59	0.01	
18/11/2024 03:00:00	0.64	0.05	0.07	0.04	0.21	0.20	0.16	0.54	0.08	0.47	0.08	0.58	0.03	
18/11/2024 03:15:00	0.65	0.07	0.07	0.04	0.21	0.20	0.16	0.54	0.08	0.47	0.08	0.55	0.05	
18/11/2024 03:30:00	0.65	0.06	0.07	0.04	0.21	0.20	0.16	0.54	0.08	0.47	0.08	0.53	0.07	
18/11/2024 03:45:00	0.64	0.07	0.07	0.04	0.21	0.20	0.16	0.54	0.08	0.47	0.07	0.51	0.08	
18/11/2024 04:00:00	0.64	0.06	0.07	0.03	0.21	0.20	0.16	0.53	0.07	0.47	0.07	0.48	0.06	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
18/11/2024 04:15:00	0.64	0.06	0.07	0.03	0.21	0.20	0.16	0.53	0.08	0.47	0.07	0.47	0.09	
18/11/2024 04:30:00	0.63	0.07	0.07	0.03	0.21	0.20	0.16	0.53	0.08	0.47	0.08	0.45	0.07	
18/11/2024 04:45:00	0.63	0.08	0.07	0.03	0.21	0.20	0.16	0.53	0.08	0.47	0.08	0.43	0.09	
18/11/2024 05:00:00	0.63	0.08	0.07	0.03	0.21	0.20	0.16	0.53	0.08	0.47	0.07	0.42	0.09	
18/11/2024 05:15:00	0.62	0.08	0.07	0.03	0.21	0.20	0.16	0.53	0.08	0.47	0.08	0.41	0.07	
18/11/2024 05:30:00	0.62	0.09	0.07	0.03	0.21	0.20	0.16	0.53	0.08	0.47	0.07	0.40	0.09	
18/11/2024 05:45:00	0.61	0.10	0.07	0.03	0.21	0.20	0.15	0.53	0.07	0.47	0.07	0.39	0.09	
18/11/2024 06:00:00	0.61	0.10	0.07	0.03	0.21	0.20	0.15	0.53	0.08	0.47	0.07	0.38	0.08	
18/11/2024 06:15:00	0.60	0.10	0.07	0.03	0.20	0.20	0.15	0.53	0.08	0.47	0.08	0.37	0.08	
18/11/2024 06:30:00	0.60	0.09	0.07	0.03	0.20	0.20	0.15	0.53	0.08	0.47	0.08	0.36	0.10	
18/11/2024 06:45:00	0.60	0.09	0.07	0.03	0.20	0.20	0.15	0.52	0.07	0.47	0.08	0.37	0.07	
18/11/2024 07:00:00	0.59	0.11	0.07	0.03	0.20	0.20	0.15	0.52	0.08	0.47	0.08	0.40	0.04	
18/11/2024 07:15:00	0.59	0.10	0.07	0.03	0.20	0.20	0.15	0.52	0.08	0.47	0.08	0.43	0.04	
18/11/2024 07:30:00	0.59	0.08	0.07	0.03	0.20	0.20	0.15	0.51	0.07	0.47	0.07	0.45	0.03	
18/11/2024 07:45:00	0.58	0.08	0.07	0.03	0.20	0.20	0.15	0.51	0.08	0.47	0.08	0.47	0.04	
18/11/2024 08:00:00	0.58	0.09	0.06	0.03	0.20	0.20	0.15	0.51	0.07	0.47	0.08	0.48	0.03	
18/11/2024 08:15:00	0.59	0.08	0.06	0.03	0.20	0.20	0.15	0.51	0.08	0.47	0.08	0.49	0.03	
18/11/2024 08:30:00	0.59	0.08	0.06	0.03	0.20	0.19	0.15	0.51	0.08	0.47	0.07	0.50	0.01	
18/11/2024 08:45:00	0.59	0.07	0.06	0.03	0.20	0.19	0.15	0.51	0.08	0.47	0.07	0.50	0.02	
18/11/2024 09:00:00	0.59	0.07	0.06	0.03	0.20	0.19	0.15	0.52	0.08	0.47	0.08	0.51	0.01	
18/11/2024 09:15:00	0.59	0.05	0.06	0.03	0.20	0.19	0.14	0.52	0.09	0.47	0.07	0.52	0.01	
18/11/2024 09:30:00	0.60	0.06	0.06	0.03	0.20	0.19	0.14	0.52	0.08	0.47	0.08	0.52	0.02	
18/11/2024 09:45:00	0.60	0.09	0.06	0.03	0.20	0.19	0.14	0.52	0.07	0.47	0.08	0.53	0.02	
18/11/2024 10:00:00	0.60	0.07	0.06	0.03	0.20	0.19	0.14	0.52	0.08	0.47	0.08	0.53	0.02	
18/11/2024 10:15:00	0.60	0.08	0.06	0.03	0.19	0.19	0.14	0.52	0.08	0.47	0.07	0.54	0.02	
18/11/2024 10:30:00	0.61	0.08	0.06	0.03	0.19	0.19	0.14	0.52	0.08	0.47	0.08	0.54	0.00	
18/11/2024 10:45:00	0.61	0.08	0.06	0.03	0.19	0.19	0.14	0.52	0.08	0.47	0.08	0.55	-0.01	
18/11/2024 11:00:00	0.61	0.08	0.06	0.03	0.19	0.19	0.14	0.52	0.08	0.47	0.08	0.55	0.02	
18/11/2024 11:15:00	0.62	0.05	0.06	0.03	0.19	0.19	0.14	0.53	0.08	0.47	0.08	0.56	0.02	
18/11/2024 11:30:00	0.62	0.06	0.06	0.03	0.19	0.19	0.14	0.53	0.10	0.47	0.08	0.56	-0.05	
18/11/2024 11:45:00	0.62	0.05	0.06	0.03	0.19	0.19	0.14	0.53	0.09	0.47	0.08	0.56	0.01	
18/11/2024 12:00:00	0.63	0.04	0.06	0.03	0.19	0.19	0.14	0.53	0.08	0.47	0.09	0.57	0.01	
18/11/2024 12:15:00	0.63	0.06	0.06	0.03	0.19	0.19	0.14	0.53	0.08	0.47	0.07	0.57	0.03	
18/11/2024 12:30:00	0.63	0.05	0.06	0.03	0.19	0.19	0.14	0.52	0.08	0.47	0.07	0.58	0.01	
18/11/2024 12:45:00	0.63	0.05	0.06	0.03	0.19	0.19	0.14	0.52	0.09	0.47	0.07	0.58	0.03	
18/11/2024 13:00:00	0.64	0.08	0.06	0.03	0.19	0.19	0.14	0.52	0.08	0.47	0.08	0.58	0.02	
18/11/2024 13:15:00	0.64	0.06	0.06	0.03	0.20	0.19	0.14	0.52	0.09	0.47	0.08	0.58	0.03	
18/11/2024 13:30:00	0.64	0.07	0.06	0.03	0.20	0.19	0.14	0.52	0.08	0.47	0.07	0.59	0.00	
18/11/2024 13:45:00	0.64	0.06	0.06	0.03	0.20	0.19	0.14	0.52	0.09	0.47	0.07	0.59	0.04	
18/11/2024 14:00:00	0.64	0.05	0.06	0.03	0.20	0.19	0.14	0.52	0.08	0.47	0.08	0.59	0.02	
18/11/2024 14:15:00	0.65	0.06	0.06	0.03	0.20	0.19	0.14	0.51	0.08	0.47	0.08	0.59	0.02	
18/11/2024 14:30:00	0.65	0.06	0.06	0.03	0.20	0.19	0.14	0.51	0.08	0.47	0.08	0.60	0.02	
18/11/2024 14:45:00	0.65	0.06	0.06	0.03	0.19	0.19	0.14	0.51	0.08	0.47	0.08	0.60	0.01	
18/11/2024 15:00:00	0.65	0.05	0.06	0.03	0.19	0.19	0.14	0.51	0.07	0.47	0.07	0.60	0.02	
18/11/2024 15:15:00	0.66	0.06	0.06	0.03	0.19	0.19	0.14	0.51	0.08	0.47	0.07	0.60	0.04	
18/11/2024 15:30:00	0.66	0.07	0.06	0.03	0.19	0.19	0.14	0.51	0.07	0.47	0.07	0.59	0.01	
18/11/2024 15:45:00	0.66	0.07	0.06	0.03	0.19	0.19	0.14	0.51	0.08	0.47	0.08	0.56	0.06	
18/11/2024 16:00:00	0.66	0.07	0.06	0.03	0.19	0.19	0.14	0.51	0.08	0.47	0.07	0.54	0.07	
18/11/2024 16:15:00	0.65	0.07	0.06	0.03	0.19	0.19	0.14	0.51	0.08	0.48	0.07	0.51	0.07	
18/11/2024 16:30:00	0.65	0.07	0.06	0.03	0.19	0.19	0.14	0.51	0.07	0.47	0.08	0.49	0.06	
18/11/2024 16:45:00	0.65	0.08	0.06	0.03	0.19	0.19	0.14	0.51	0.08	0.47	0.08	0.47	0.08	
18/11/2024 17:00:00	0.64	0.07	0.05	0.02	0.19	0.19	0.14	0.51	0.08	0.47	0.07	0.45	0.07	
18/11/2024 17:15:00	0.64	0.07	0.05	0.02	0.19	0.19	0.14	0.51	0.07	0.47	0.08	0.43	0.08	
18/11/2024 17:30:00	0.63	0.09	0.05	0.02	0.19	0.19	0.14	0.51	0.08	0.47	0.07	0.42	0.07	
18/11/2024 17:45:00	0.63	0.08	0.05	0.02	0.19	0.19	0.14	0.51	0.08	0.47	0.07	0.41	0.08	
18/11/2024 18:00:00	0.62	0.09	0.05	0.02	0.19	0.19	0.14	0.51	0.07	0.47	0.08	0.40	0.09	
18/11/2024 18:15:00	0.62	0.09	0.05	0.02	0.19	0.19	0.14	0.51	0.08	0.47	0.07	0.39	0.08	
18/11/2024 18:30:00	0.61	0.11	0.05	0.02	0.19	0.19	0.14	0.51	0.08	0.47	0.07	0.38	0.08	
18/11/2024 18:45:00	0.61	0.09	0.05	0.02	0.19	0.19	0.13	0.51	0.08	0.47	0.08	0.37	0.09	
18/11/2024 19:00:00	0.61	0.09	0.05	0.02	0.19	0.19	0.13	0.51	0.08	0.47	0.08	0.36	0.09	
18/11/2024 19:15:00	0.60	0.10	0.05	0.02	0.19	0.19	0.13	0.51	0.08	0.47	0.08	0.36	0.06	
18/11/2024 19:30:00	0.60	0.09	0.05	0.02	0.19	0.19	0.13	0.52	0.08	0.47	0.08	0.37	0.07	
18/11/2024 19:45:00	0.59	0.10	0.05	0.02	0.19	0.19	0.13	0.52	0.09	0.47	0.08	0.39	0.05	
18/11/2024 20:00:00	0.59	0.10	0.05	0.02	0.19	0.19	0.13	0.52	0.08	0.47	0.07	0.42	0.04	
18/11/2024 20:15:00	0.59	0.10	0.05	0.02	0.19	0.19	0.13	0.52	0.09	0.47	0.07	0.44	0.03	
18/11/2024 20:30:00	0.59	0.10	0.05	0.02	0.19	0.19	0.13	0.52	0.08	0.47	0.07	0.46	0.04	
18/11/2024 20:45:00	0.59	0.10	0.05	0.02	0.19	0.19	0.14	0.52	0.08	0.47	0.09	0.48	0.03	
18/11/2024 21:00:00	0.59	0.10	0.05	0.02	0.19	0.19	0.14	0.53	0.08	0.47	0.07	0.49	0.04	
18/11/2024 21:15:00	0.59	0.08	0.05	0.02	0.19	0.19	0.14	0.54	0.09	0.47	0.07	0.50	0.03	
18/11/2024 21:30:00	0.59	0.08	0.05	0.02	0.19	0.19	0.14	0.55	0.09	0.47	0.06	0.51	0.03	
18/11/2024 21:45:00	0.59	0.08	0.05	0.02	0.19	0.19	0.14	0.56	0.10	0.47	0.07	0.52	0.03	
18/11/2024 22:00:00	0.60	0.08	0.05	0.02	0.19	0.19	0.14	0.57	0.09	0.47	0.08	0.52	0.03	
18/11/2024 22:15:00	0.60	0.07	0.05	0.02	0.19	0.19	0.14	0.58	0.08	0.47	0.06	0.53	0.03	
18/11/2024 22:30:00	0.60	0.09	0.05	0.02	0.20	0.20	0.14	0.58	0.07	0.47	0.07	0.54	0.02	
18/11/2024 22:45:00	0.61	0.07	0.06	0.03	0.20	0.20	0.15	0.59	0.07	0.47	0.06	0.54	0.03	
18/11/2024 23:00:00	0.61	0.07	0.06	0.03	0.20	0.20	0.15	0.59	0.08	0.47	0.06	0.55	0.04	
18/11/2024 23:15:00	0.62	0.07	0.06	0.03	0.21	0.21	0.16	0.60	0.10	0.48	0.08	0.55	0.04	
18/11/2024 23:30:00	0.62	0.08	0.06	0.03	0.21	0.21	0.16	0.61	0.10	0.48	0.06	0.56	0.04	
18/11/2024 23:45:00	0.63	0.08	0.07	0.03	0.22	0.22	0.17	0.61	0.10	0.48	0.06	0.56	0.03	
19/11/2024 00:00:00	0.63	0.09	0.07	0.04	0.23	0.22	0.18	0.62	0.09	0.48	0.06	0.57	0.03	
19/11/2024 00:15:00	0.64	0.07	0.07	0.04	0.23	0.23	0.18	0.61	0.10	0.48	0.07	0.57	0.03	
19/11/2024 00:30:00	0.64	0.07	0.08	0.04	0.23	0.23	0.19	0.61	0.10	0.49	0.06	0.58	0.04	
19/11/2024 00:45:00	0.65	0.08	0.08	0.04	0.24	0.23	0.19	0.62	0.10	0.49	0.06	0.58	0.04	
19/11/2024 01:00:00	0.65	0.08	0.08	0.04	0.24	0.23	0.20	0.62	0.09	0.49	0.06	0.59	0.03	
19/11/2024 01:15:00	0.66	0.06	0.08	0.05	0.25	0.24	0.20	0.61	0.10	0.50	0.07	0.59	0.02	
19/11/2024 01:30:00	0.66	0.08	0.09	0.05	0.25	0.24	0.21	0.61	0.09	0.50	0.07	0.59	0.03	
19/11/2024 01:45:00	0.67	0.08	0.09	0.05	0.25	0.24	0.21	0.62	0.12	0.50	0.07	0.60	0.05	
19/11/2024 02:00:00	0.67	0.08	0.09	0.05	0.26	0.25	0.21	0.63	0.10	0.50	0.04	0.60	0.04	
19/11/2024 02:15:00	0.68	0.06	0.09	0.05	0.26	0.25	0.22	0.63	0.11	0.51	0.07	0.61	0.03	
19/11/2024 02:30:00	0.68	0.08	0.10	0.06	0.26	0.25	0.22	0.63	0.10	0.51	0.09	0.62	0.04	
19/11/2024 02:45:00	0.68	0.05	0.10	0.06	0.26	0.25	0.22	0.62	0.11	0.51	0.10	0.62	0.03	
19/11/2024 03:00:00	0.69	0.06	0.10	0.06	0.26	0.25	0.23	0.62	0.10	0.52	0.11	0.63	0.04	
19/11/2024 03:15:00	0.69	0.08	0.11	0.07	0.27	0.25	0.23	0.61	0.10	0.52	0.10	0.63	0.07	
19/11/2024 03:30:00	0.70	0.07	0.11	0.07	0.27	0.25	0.23	0.61	0.10	0.52	0.09	0.60	0.09	
19/11/2024 03:45:00	0.70	0.08	0.11	0.07	0.27	0.25	0.23	0.61	0.10	0.52	0.09	0.58	0.09	
19/11/2024 04:00:00	0.70	0.07	0.11	0.07	0.27	0.25	0.23	0.61	0.09	0.53	0.10	0.56	0.10	
19/11/2024 04:15:00	0.70	0.08	0.11	0.07	0.27	0.25	0.23	0.61	0.09	0.53	0.10	0.54	0.07	
19/11/2024 04:30:00	0.70	0.07	0.11	0.07	0.27	0.25	0.23	0.60	0.09	0.53	0.10	0.51	0.10	
19/11/2024 04:45:00	0.70	0.09	0.11	0.07	0.27	0.25	0.23	0.60	0.08	0.53	0.10	0.50	0.10	
19/11/2024 05:00:00	0.69	0.08	0.11	0.07	0.27	0.25	0.23	0.60	0.09	0.53	0.10	0.48	0.10	
19/11/2024 05:15:00	0.69	0.09	0.11	0.07	0.26	0.25	0.23	0.59	0.08	0.53	0.10	0.47	0.09	
19/11/2024 05:30:00	0.69	0.08	0.11	0.07	0.26	0.25	0.23	0.59	0.09	0.53	0.10	0.46	0.09	
19/11/2024 05:45:00	0.68	0.09	0.11	0.07	0.26	0.25	0.22	0.59	0.09	0.53	0.09	0.45	0.07	
19/11/2024 06:00:00	0.68	0.09	0.11	0.07	0.26	0.25	0.22	0.59	0.09	0.53	0.10	0.44	0.07	
19/11/2024 06:15:00	0.68	0.09	0.10	0.06	0.26	0.25	0.22	0.59	0.09	0.53	0.10	0.43	0.08	
19/11/2024 06:30:00	0.67	0.08	0.10	0.06	0.26	0.25	0.22	0.59	0.09	0.53	0.10	0.42	0.11	
19/11/2024 06:45:00	0.67	0.10	0.10	0.06	0.26	0.25	0.22	0.59	0.09	0.53	0.10	0.42	0.12	
19/11/2024 07:00:00	0.67	0.09	0.10	0.06	0.26	0.25	0.22	0.59	0.08	0.53	0.10	0.41	0.09	
19/11/2024 07:15:00	0.67	0.11	0.10	0.06	0.26	0.25	0.22	0.59	0.08	0.53	0.10	0.41	0.10	
19/11/2024 07:30:00	0.67	0.10	0.10	0.06	0.26	0.25	0.22	0.58	0.09	0.54	0.10	0.40	0.09	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
19/11/2024 07:45:00	0.66	0.11	0.10	0.06	0.26	0.25	0.21	0.59	0.09	0.54	0.10	0.41	0.10	
19/11/2024 08:00:00	0.66	0.11	0.10	0.06	0.25	0.24	0.21	0.59	0.10	0.54	0.10	0.42	0.08	
19/11/2024 08:15:00	0.66	0.10	0.10	0.06	0.25	0.24	0.21	0.60	0.10	0.54	0.10	0.44	0.05	
19/11/2024 08:30:00	0.66	0.11	0.10	0.06	0.25	0.24	0.21	0.60	0.07	0.54	0.10	0.47	0.05	
19/11/2024 08:45:00	0.66	0.10	0.10	0.06	0.25	0.24	0.21	0.60	0.07	0.54	0.10	0.50	0.07	
19/11/2024 09:00:00	0.66	0.10	0.10	0.06	0.25	0.25	0.21	0.61	0.09	0.54	0.10	0.52	0.05	
19/11/2024 09:15:00	0.66	0.11	0.10	0.06	0.26	0.25	0.21	0.61	0.10	0.54	0.10	0.53	0.02	
19/11/2024 09:30:00	0.67	0.08	0.10	0.06	0.26	0.25	0.22	0.61	0.10	0.54	0.10	0.55	0.03	
19/11/2024 09:45:00	0.67	0.09	0.10	0.06	0.26	0.25	0.22	0.61	0.09	0.54	0.10	0.56	0.05	
19/11/2024 10:00:00	0.68	0.09	0.10	0.06	0.26	0.25	0.22	0.61	0.10	0.55	0.10	0.57	0.03	
19/11/2024 10:15:00	0.68	0.07	0.10	0.06	0.26	0.25	0.22	0.61	0.10	0.55	0.10	0.58	0.04	
19/11/2024 10:30:00	0.69	0.08	0.10	0.06	0.26	0.25	0.22	0.61	0.09	0.55	0.10	0.59	0.03	
19/11/2024 10:45:00	0.69	0.08	0.10	0.06	0.26	0.25	0.22	0.61	0.09	0.55	0.10	0.60	0.04	
19/11/2024 11:00:00	0.70	0.08	0.11	0.07	0.26	0.25	0.22	0.60	0.08	0.55	0.10	0.61	0.04	
19/11/2024 11:15:00	0.70	0.07	0.11	0.07	0.26	0.25	0.22	0.60	0.09	0.55	0.10	0.61	0.03	
19/11/2024 11:30:00	0.71	0.08	0.11	0.07	0.26	0.25	0.22	0.60	0.10	0.55	0.10	0.62	0.04	
19/11/2024 11:45:00	0.71	0.08	0.11	0.07	0.26	0.25	0.22	0.59	0.10	0.56	0.10	0.62	0.01	
19/11/2024 12:00:00	0.72	0.07	0.11	0.07	0.26	0.25	0.22	0.59	0.10	0.56	0.10	0.63	0.04	
19/11/2024 12:15:00	0.72	0.07	0.11	0.07	0.26	0.25	0.22	0.59	0.10	0.56	0.10	0.64	-0.01	
19/11/2024 12:30:00	0.72	0.07	0.11	0.07	0.26	0.25	0.22	0.59	0.10	0.56	0.10	0.64	0.03	
19/11/2024 12:45:00	0.73	0.08	0.11	0.07	0.26	0.25	0.22	0.59	0.10	0.56	0.11	0.65	0.00	
19/11/2024 13:00:00	0.73	0.08	0.10	0.06	0.26	0.25	0.22	0.59	0.10	0.56	0.11	0.65	0.03	
19/11/2024 13:15:00	0.74	0.08	0.10	0.06	0.26	0.25	0.22	0.59	0.09	0.56	0.13	0.65	0.02	
19/11/2024 13:30:00	0.74	0.07	0.10	0.06	0.26	0.25	0.22	0.58	0.10	0.56	0.11	0.66	0.03	
19/11/2024 13:45:00	0.74	0.06	0.10	0.06	0.26	0.25	0.21	0.58	0.10	0.56	0.11	0.66	0.02	
19/11/2024 14:00:00	0.75	0.06	0.10	0.06	0.25	0.24	0.21	0.58	0.10	0.57	0.12	0.66	0.05	
19/11/2024 14:15:00	0.75	0.07	0.10	0.06	0.25	0.24	0.21	0.58	0.09	0.57	0.11	0.67	0.04	
19/11/2024 14:30:00	0.75	0.09	0.10	0.06	0.25	0.24	0.21	0.58	0.09	0.57	0.13	0.67	0.04	
19/11/2024 14:45:00	0.75	0.06	0.10	0.06	0.25	0.24	0.21	0.58	0.10	0.57	0.13	0.68	-0.01	
19/11/2024 15:00:00	0.76	0.06	0.10	0.06	0.25	0.24	0.21	0.58	0.10	0.57	0.12	0.68	0.03	
19/11/2024 15:15:00	0.76	0.05	0.10	0.06	0.25	0.24	0.21	0.58	0.09	0.57	0.11	0.68	0.04	
19/11/2024 15:30:00	0.76	0.07	0.10	0.06	0.25	0.24	0.21	0.58	0.10	0.57	0.11	0.68	0.02	
19/11/2024 15:45:00	0.77	0.05	0.10	0.06	0.25	0.24	0.20	0.58	0.10	0.57	0.12	0.69	0.04	
19/11/2024 16:00:00	0.77	0.05	0.10	0.06	0.25	0.24	0.20	0.58	0.09	0.57	0.11	0.69	0.05	
19/11/2024 16:15:00	0.77	0.06	0.10	0.06	0.25	0.24	0.20	0.57	0.10	0.57	0.11	0.69	0.04	
19/11/2024 16:30:00	0.77	0.05	0.10	0.06	0.25	0.24	0.20	0.57	0.10	0.58	0.11	0.68	0.10	
19/11/2024 16:45:00	0.77	0.05	0.10	0.06	0.24	0.24	0.20	0.57	0.09	0.58	0.12	0.65	0.08	
19/11/2024 17:00:00	0.77	0.06	0.10	0.06	0.24	0.24	0.20	0.57	0.09	0.58	0.11	0.63	0.06	
19/11/2024 17:15:00	0.77	0.06	0.10	0.06	0.24	0.23	0.20	0.57	0.09	0.58	0.11	0.61	0.08	
19/11/2024 17:30:00	0.77	0.06	0.10	0.06	0.24	0.23	0.20	0.57	0.10	0.58	0.11	0.58	0.10	
19/11/2024 17:45:00	0.76	0.10	0.10	0.06	0.24	0.23	0.20	0.57	0.09	0.58	0.11	0.57	0.09	
19/11/2024 18:00:00	0.76	0.09	0.10	0.06	0.24	0.23	0.20	0.57	0.09	0.58	0.11	0.55	0.09	
19/11/2024 18:15:00	0.76	0.08	0.10	0.06	0.24	0.23	0.20	0.57	0.09	0.57	0.11	0.54	0.10	
19/11/2024 18:30:00	0.75	0.10	0.09	0.05	0.24	0.23	0.20	0.57	0.10	0.57	0.12	0.53	0.09	
19/11/2024 18:45:00	0.75	0.08	0.09	0.05	0.24	0.23	0.19	0.57	0.10	0.57	0.12	0.52	0.10	
19/11/2024 19:00:00	0.75	0.09	0.09	0.05	0.24	0.23	0.19	0.57	0.10	0.57	0.11	0.51	0.08	
19/11/2024 19:15:00	0.74	0.09	0.09	0.05	0.24	0.23	0.19	0.57	0.09	0.57	0.11	0.50	0.08	
19/11/2024 19:30:00	0.74	0.10	0.09	0.05	0.24	0.23	0.19	0.58	0.09	0.57	0.11	0.50	0.10	
19/11/2024 19:45:00	0.73	0.09	0.09	0.05	0.24	0.23	0.19	0.57	0.09	0.57	0.11	0.51	0.07	
19/11/2024 20:00:00	0.73	0.09	0.09	0.05	0.24	0.23	0.19	0.57	0.09	0.57	0.11	0.54	0.07	
19/11/2024 20:15:00	0.73	0.11	0.09	0.05	0.24	0.23	0.19	0.57	0.10	0.57	0.11	0.55	0.03	
19/11/2024 20:30:00	0.73	0.07	0.09	0.05	0.24	0.23	0.19	0.57	0.09	0.57	0.11	0.58	0.03	
19/11/2024 20:45:00	0.73	0.07	0.09	0.05	0.24	0.23	0.19	0.57	0.10	0.57	0.11	0.60	0.02	
19/11/2024 21:00:00	0.73	0.07	0.09	0.05	0.24	0.23	0.19	0.57	0.09	0.57	0.11	0.62	0.04	
19/11/2024 21:15:00	0.73	0.09	0.09	0.05	0.24	0.23	0.19	0.57	0.09	0.57	0.12	0.63	0.04	
19/11/2024 21:30:00	0.73	0.07	0.09	0.05	0.24	0.23	0.19	0.57	0.09	0.57	0.11	0.64	0.05	
19/11/2024 21:45:00	0.74	0.07	0.09	0.05	0.24	0.23	0.19	0.56	0.10	0.57	0.12	0.65	0.04	
19/11/2024 22:00:00	0.74	0.09	0.09	0.05	0.24	0.23	0.19	0.56	0.09	0.57	0.11	0.65	0.04	
19/11/2024 22:15:00	0.74	0.07	0.09	0.05	0.24	0.23	0.19	0.56	0.09	0.57	0.11	0.66	0.05	
19/11/2024 22:30:00	0.75	0.05	0.09	0.05	0.23	0.23	0.19	0.56	0.08	0.57	0.11	0.67	0.04	
19/11/2024 22:45:00	0.75	0.05	0.09	0.05	0.23	0.23	0.19	0.56	0.10	0.57	0.11	0.67	0.03	
19/11/2024 23:00:00	0.75	0.07	0.09	0.05	0.23	0.23	0.19	0.56	0.09	0.57	0.11	0.67	0.04	
19/11/2024 23:15:00	0.76	0.05	0.09	0.05	0.23	0.22	0.19	0.56	0.08	0.57	0.12	0.68	0.02	
19/11/2024 23:30:00	0.76	0.09	0.09	0.05	0.23	0.22	0.19	0.56	0.08	0.57	0.11	0.68	0.06	
19/11/2024 23:45:00	0.76	0.05	0.09	0.05	0.23	0.22	0.19	0.56	0.09	0.57	0.12	0.68	0.02	
20/11/2024 00:00:00	0.76	0.06	0.09	0.05	0.23	0.22	0.18	0.56	0.08	0.57	0.11	0.69	0.02	
20/11/2024 00:15:00	0.76	0.06	0.09	0.05	0.23	0.22	0.18	0.56	0.07	0.57	0.11	0.69	0.03	
20/11/2024 00:30:00	0.77	0.07	0.09	0.05	0.23	0.22	0.18	0.56	0.07	0.57	0.12	0.69	0.04	
20/11/2024 00:45:00	0.77	0.07	0.09	0.05	0.23	0.22	0.18	0.56	0.09	0.57	0.11	0.70	0.04	
20/11/2024 01:00:00	0.77	0.05	0.09	0.05	0.23	0.22	0.18	0.55	0.09	0.57	0.12	0.70	0.03	
20/11/2024 01:15:00	0.77	0.07	0.09	0.05	0.23	0.22	0.18	0.55	0.09	0.57	0.11	0.70	0.05	
20/11/2024 01:30:00	0.78	0.03	0.09	0.05	0.23	0.22	0.18	0.55	0.09	0.58	0.11	0.70	0.05	
20/11/2024 01:45:00	0.78	0.06	0.09	0.05	0.23	0.22	0.18	0.55	0.08	0.58	0.11	0.71	0.04	
20/11/2024 02:00:00	0.78	0.06	0.09	0.05	0.23	0.22	0.18	0.55	0.08	0.58	0.11	0.71	0.06	
20/11/2024 02:15:00	0.78	0.06	0.09	0.05	0.23	0.22	0.18	0.55	0.09	0.58	0.11	0.71	0.04	
20/11/2024 02:30:00	0.78	0.07	0.09	0.05	0.23	0.22	0.18	0.55	0.08	0.58	0.12	0.71	0.05	
20/11/2024 02:45:00	0.78	0.03	0.08	0.05	0.23	0.22	0.18	0.55	0.08	0.58	0.11	0.71	0.05	
20/11/2024 03:00:00	0.79	0.05	0.08	0.05	0.23	0.22	0.18	0.55	0.08	0.58	0.11	0.72	0.05	
20/11/2024 03:15:00	0.79	0.05	0.09	0.05	0.22	0.22	0.18	0.55	0.08	0.58	0.11	0.72	0.04	
20/11/2024 03:30:00	0.79	0.02	0.08	0.05	0.22	0.22	0.18	0.55	0.09	0.58	0.11	0.72	0.05	
20/11/2024 03:45:00	0.79	0.04	0.09	0.05	0.22	0.22	0.18	0.54	0.07	0.58	0.12	0.72	0.03	
20/11/2024 04:00:00	0.79	0.05	0.09	0.05	0.22	0.22	0.18	0.54	0.08	0.58	0.11	0.72	0.04	
20/11/2024 04:15:00	0.79	0.08	0.08	0.05	0.22	0.22	0.17	0.54	0.08	0.58	0.11	0.72	0.07	
20/11/2024 04:30:00	0.79	0.07	0.08	0.05	0.22	0.22	0.17	0.54	0.08	0.58	0.11	0.70	0.06	
20/11/2024 04:45:00	0.79	0.07	0.08	0.04	0.22	0.21	0.17	0.54	0.07	0.58	0.11	0.67	0.08	
20/11/2024 05:00:00	0.79	0.04	0.08	0.04	0.22	0.21	0.17	0.54	0.09	0.58	0.11	0.65	0.11	
20/11/2024 05:15:00	0.79	0.04	0.08	0.04	0.22	0.21	0.17	0.54	0.09	0.58	0.11	0.63	0.09	
20/11/2024 05:30:00	0.78	0.06	0.08	0.04	0.22	0.21	0.17	0.54	0.09	0.58	0.11	0.61	0.13	
20/11/2024 05:45:00	0.78	-0.02	0.08	0.04	0.22	0.21	0.17	0.54	0.08	0.58	0.11	0.59	0.11	
20/11/2024 06:00:00	0.77	0.08	0.08	0.04	0.22	0.21	0.17	0.54	0.08	0.58	0.11	0.57	0.09	
20/11/2024 06:15:00	0.77	0.08	0.08	0.04	0.22	0.21	0.17	0.54	0.09	0.57	0.11	0.56	0.08	
20/11/2024 06:30:00	0.76	0.05	0.08	0.04	0.22	0.21	0.17	0.54	0.09	0.57	0.11	0.55	0.06	
20/11/2024 06:45:00	0.76	0.10	0.08	0.04	0.22	0.21	0.17	0.54	0.09	0.57	0.11	0.54	0.12	
20/11/2024 07:00:00	0.75	0.09	0.08	0.04	0.22	0.21	0.17	0.54	0.09	0.57	0.11	0.53	0.09	
20/11/2024 07:15:00	0.75	0.09	0.08	0.04	0.22	0.21	0.17	0.54	0.09	0.57	0.10	0.52	0.10	
20/11/2024 07:30:00	0.75	0.09	0.08	0.04	0.22	0.21	0.17	0.54	0.08	0.57	0.11	0.51	0.12	
20/11/2024 07:45:00	0.74	0.08	0.08	0.04	0.22	0.21	0.17	0.54	0.05	0.57	0.11	0.50	0.08	
20/11/2024 08:00:00	0.74	0.08	0.08	0.04	0.22	0.21	0.17	0.54	0.08	0.56	0.10	0.50	0.09	
20/11/2024 08:15:00	0.73	0.10	0.08	0.04	0.22	0.21	0.17	0.54	0.08	0.56	0.11	0.49	0.09	
20/11/2024 08:30:00	0.73	0.10	0.08	0.04	0.21	0.21	0.16	0.54	0.08	0.56	0.12	0.49	0.09	
20/11/2024 08:45:00	0.73	0.09	0.08	0.04	0.21	0.21	0.16	0.54	0.09	0.56	0.10	0.51	0.07	
20/11/2024 09:00:00	0.72	0.08	0.08	0.04	0.21	0.21	0.16	0.55	0.07	0.56	0.11	0.53	0.06	
20/11/2024 09:15:00	0.72	0.08	0.08	0.04	0.21	0.21	0.16	0.54	0.08	0.56	0.11	0.55	0.02	
20/11/2024 09:30:00	0.72	0.09	0.08	0.04	0.21	0.21	0.16	0.54	0.09	0.56	0.11	0.58	0.02	
20/11/2024 09:45:00	0.72	0.10	0.08	0.04	0.21	0.21	0.16	0.54	0.09	0.55	0.10	0.60	0.04	
20/11/2024 10:00:00	0.72	0.08	0.08	0.04	0.21	0.21	0.16	0.54	0.09	0.55	0.10	0.62	0.03	
20/11/2024 10:15:00	0.73	0.06	0.08	0.04	0.21	0.21	0.16	0.54	0.08	0.55	0.11	0.64	0.03	
20/11/2024 10:30:00	0.73	0.06	0.08	0.04	0.21	0.21	0.16	0.54	0.07	0.55	0.12	0.65	0.03	
20/11/2024 10:45:00	0.73	0.06	0.08	0.04	0.21	0.21	0.16	0.54	0.08	0.55	0.11	0.66	0.03	
20/11/2024 11:00:00	0.73	0.09	0.08	0.04	0.21	0.21	0.16	0.54	0.07	0.55	0.11	0.66	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
20/11/2024 11:15:00	0.74	0.05	0.08	0.04	0.21	0.21	0.16	0.54	0.07	0.55	0.11	0.66	0.02	
20/11/2024 11:30:00	0.74	0.08	0.08	0.04	0.21	0.21	0.16	0.54	0.07	0.55	0.11	0.67	0.00	
20/11/2024 11:45:00	0.74	0.08	0.08	0.04	0.21	0.21	0.16	0.54	0.07	0.55	0.12	0.67	0.02	
20/11/2024 12:00:00	0.75	0.04	0.08	0.04	0.21	0.21	0.16	0.54	0.09	0.55	0.11	0.68	0.05	
20/11/2024 12:15:00	0.75	0.05	0.08	0.04	0.21	0.21	0.16	0.54	0.05	0.56	0.11	0.68	0.04	
20/11/2024 12:30:00	0.75	0.07	0.08	0.04	0.21	0.21	0.16	0.54	0.07	0.56	0.11	0.69	0.04	
20/11/2024 12:45:00	0.75	0.03	0.08	0.04	0.21	0.21	0.16	0.53	0.08	0.56	0.12	0.69	0.06	
20/11/2024 13:00:00	0.76	0.07	0.08	0.04	0.21	0.21	0.16	0.53	0.08	0.56	0.11	0.69	0.02	
20/11/2024 13:15:00	0.76	0.04	0.08	0.04	0.21	0.20	0.16	0.53	0.08	0.56	0.10	0.70	0.06	
20/11/2024 13:30:00	0.76	0.06	0.08	0.04	0.21	0.21	0.16	0.53	0.06	0.56	0.11	0.70	0.02	
20/11/2024 13:45:00	0.76	0.07	0.08	0.04	0.21	0.20	0.16	0.53	0.09	0.56	0.11	0.71	0.03	
20/11/2024 14:00:00	0.76	0.03	0.08	0.04	0.21	0.20	0.16	0.53	0.07	0.56	0.12	0.71	0.04	
20/11/2024 14:15:00	0.76	0.04	0.08	0.04	0.21	0.20	0.16	0.53	0.08	0.56	0.10	0.71	0.03	
20/11/2024 14:30:00	0.77	0.04	0.08	0.04	0.21	0.20	0.16	0.53	0.06	0.56	0.12	0.71	0.04	
20/11/2024 14:45:00	0.77	0.03	0.08	0.04	0.21	0.20	0.16	0.53	0.07	0.56	0.12	0.71	0.04	
20/11/2024 15:00:00	0.77	0.05	0.07	0.04	0.21	0.20	0.16	0.53	0.07	0.56	0.11	0.71	0.04	
20/11/2024 15:15:00	0.78	0.05	0.08	0.04	0.21	0.20	0.16	0.53	0.07	0.56	0.10	0.71	0.04	
20/11/2024 15:30:00	0.78	0.02	0.08	0.04	0.21	0.20	0.16	0.53	0.07	0.56	0.10	0.72	0.04	
20/11/2024 15:45:00	0.78	-0.02	0.08	0.04	0.21	0.20	0.16	0.53	0.08	0.56	0.09	0.72	0.06	
20/11/2024 16:00:00	0.78	0.04	0.07	0.04	0.21	0.20	0.16	0.53	0.07	0.56	0.11	0.72	0.04	
20/11/2024 16:15:00	0.78	0.04	0.07	0.04	0.21	0.20	0.16	0.53	0.08	0.56	0.12	0.72	0.05	
20/11/2024 16:30:00	0.78	0.04	0.07	0.04	0.21	0.20	0.16	0.52	0.06	0.56	0.11	0.72	0.04	
20/11/2024 16:45:00	0.78	0.06	0.07	0.04	0.21	0.20	0.16	0.52	0.06	0.56	0.11	0.73	0.05	
20/11/2024 17:00:00	0.79	0.03	0.08	0.04	0.21	0.20	0.15	0.52	0.07	0.56	0.11	0.73	0.08	
20/11/2024 17:15:00	0.79	0.06	0.07	0.04	0.21	0.20	0.15	0.52	0.07	0.57	0.11	0.73	0.04	
20/11/2024 17:30:00	0.79	0.05	0.07	0.04	0.21	0.20	0.15	0.53	0.08	0.57	0.09	0.73	0.04	
20/11/2024 17:45:00	0.79	0.05	0.07	0.04	0.21	0.20	0.15	0.53	0.08	0.57	0.10	0.71	0.07	
20/11/2024 18:00:00	0.79	0.05	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.57	0.10	0.70	0.07	
20/11/2024 18:15:00	0.78	0.05	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.57	0.10	0.68	0.06	
20/11/2024 18:30:00	0.78	0.06	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.57	0.10	0.66	0.08	
20/11/2024 18:45:00	0.78	0.05	0.07	0.04	0.20	0.20	0.15	0.53	0.07	0.56	0.10	0.65	0.09	
20/11/2024 19:00:00	0.77	0.04	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.56	0.10	0.63	0.08	
20/11/2024 19:15:00	0.77	0.04	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.56	0.10	0.62	0.09	
20/11/2024 19:30:00	0.77	0.07	0.07	0.04	0.20	0.20	0.15	0.53	0.07	0.56	0.11	0.61	0.08	
20/11/2024 19:45:00	0.76	0.05	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.56	0.11	0.62	0.05	
20/11/2024 20:00:00	0.76	0.07	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.56	0.10	0.62	0.08	
20/11/2024 20:15:00	0.76	0.05	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.56	0.10	0.62	0.05	
20/11/2024 20:30:00	0.75	0.04	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.55	0.10	0.63	0.03	
20/11/2024 20:45:00	0.75	0.08	0.07	0.04	0.20	0.20	0.15	0.53	0.07	0.55	0.11	0.66	0.03	
20/11/2024 21:00:00	0.75	0.06	0.07	0.04	0.20	0.20	0.15	0.53	0.07	0.55	0.11	0.67	0.04	
20/11/2024 21:15:00	0.75	0.08	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.55	0.10	0.68	0.01	
20/11/2024 21:30:00	0.75	0.07	0.07	0.04	0.20	0.20	0.15	0.53	0.08	0.55	0.11	0.69	0.02	
20/11/2024 21:45:00	0.75	0.06	0.07	0.04	0.20	0.20	0.15	0.52	0.08	0.55	0.10	0.70	0.03	
20/11/2024 22:00:00	0.76	0.05	0.07	0.04	0.20	0.20	0.15	0.52	0.07	0.55	0.10	0.70	0.04	
20/11/2024 22:15:00	0.76	0.07	0.07	0.04	0.20	0.20	0.15	0.52	0.08	0.55	0.11	0.70	0.05	
20/11/2024 22:30:00	0.76	0.06	0.07	0.04	0.20	0.20	0.15	0.52	0.08	0.55	0.11	0.71	0.03	
20/11/2024 22:45:00	0.76	0.07	0.07	0.04	0.20	0.20	0.15	0.52	0.08	0.55	0.10	0.71	0.04	
20/11/2024 23:00:00	0.77	0.06	0.07	0.04	0.20	0.20	0.15	0.52	0.07	0.55	0.10	0.71	0.04	
20/11/2024 23:15:00	0.77	0.06	0.07	0.04	0.20	0.20	0.15	0.51	0.07	0.55	0.10	0.71	0.02	
20/11/2024 23:30:00	0.77	0.08	0.07	0.04	0.20	0.20	0.15	0.51	0.05	0.55	0.10	0.72	0.03	
20/11/2024 23:45:00	0.77	0.07	0.07	0.04	0.20	0.20	0.15	0.51	0.07	0.55	0.10	0.72	0.04	
21/11/2024 00:00:00	0.77	0.07	0.07	0.04	0.20	0.20	0.15	0.51	0.06	0.55	0.10	0.72	0.03	
21/11/2024 00:15:00	0.77	0.06	0.07	0.03	0.20	0.20	0.15	0.51	0.07	0.55	0.10	0.72	0.04	
21/11/2024 00:30:00	0.77	0.05	0.07	0.03	0.20	0.19	0.15	0.51	0.07	0.55	0.10	0.72	0.01	
21/11/2024 00:45:00	0.78	0.06	0.07	0.03	0.20	0.19	0.15	0.50	0.06	0.55	0.10	0.72	0.02	
21/11/2024 01:00:00	0.78	0.07	0.07	0.03	0.20	0.19	0.15	0.50	0.07	0.55	0.09	0.73	0.03	
21/11/2024 01:15:00	0.78	0.06	0.07	0.03	0.20	0.19	0.15	0.50	0.07	0.56	0.10	0.73	0.03	
21/11/2024 01:30:00	0.78	0.05	0.07	0.03	0.20	0.19	0.14	0.50	0.05	0.56	0.10	0.73	0.02	
21/11/2024 01:45:00	0.78	0.05	0.06	0.03	0.20	0.19	0.14	0.50	0.07	0.56	0.09	0.73	0.03	
21/11/2024 02:00:00	0.78	0.04	0.06	0.03	0.20	0.19	0.14	0.49	0.06	0.56	0.10	0.73	0.02	
21/11/2024 02:15:00	0.78	0.04	0.06	0.03	0.19	0.19	0.14	0.49	0.06	0.56	0.10	0.73	0.02	
21/11/2024 02:30:00	0.78	0.00	0.06	0.03	0.19	0.19	0.14	0.49	0.05	0.56	0.10	0.73	0.03	
21/11/2024 02:45:00	0.79	0.05	0.06	0.03	0.19	0.19	0.14	0.49	0.05	0.56	0.10	0.73	0.02	
21/11/2024 03:00:00	0.79	0.07	0.06	0.03	0.19	0.19	0.14	0.49	0.06	0.56	0.10	0.73	0.02	
21/11/2024 03:15:00	0.79	0.06	0.06	0.03	0.19	0.19	0.14	0.49	0.06	0.56	0.09	0.74	0.03	
21/11/2024 03:30:00	0.79	0.06	0.06	0.03	0.19	0.19	0.14	0.49	0.06	0.56	0.10	0.74	0.04	
21/11/2024 03:45:00	0.79	0.05	0.06	0.03	0.19	0.19	0.14	0.48	0.05	0.56	0.10	0.74	0.03	
21/11/2024 04:00:00	0.79	0.06	0.06	0.03	0.19	0.19	0.14	0.48	0.05	0.56	0.09	0.74	0.02	
21/11/2024 04:15:00	0.79	0.05	0.06	0.03	0.19	0.19	0.13	0.48	0.05	0.56	0.11	0.74	0.03	
21/11/2024 04:30:00	0.79	0.06	0.06	0.03	0.19	0.19	0.13	0.48	0.06	0.56	0.10	0.74	0.01	
21/11/2024 04:45:00	0.79	0.07	0.05	0.02	0.19	0.18	0.13	0.48	0.06	0.56	0.10	0.73	0.04	
21/11/2024 05:00:00	0.79	0.06	0.05	0.02	0.18	0.18	0.13	0.48	0.05	0.56	0.10	0.70	0.03	
21/11/2024 05:15:00	0.79	0.06	0.05	0.02	0.18	0.18	0.13	0.48	0.05	0.56	0.10	0.68	0.07	
21/11/2024 05:30:00	0.78	0.07	0.05	0.02	0.18	0.18	0.13	0.48	0.04	0.56	0.10	0.66	0.09	
21/11/2024 05:45:00	0.78	0.06	0.05	0.02	0.18	0.18	0.13	0.48	0.05	0.56	0.09	0.63	0.05	
21/11/2024 06:00:00	0.77	0.10	0.05	0.02	0.18	0.18	0.13	0.48	0.06	0.56	0.09	0.61	0.06	
21/11/2024 06:15:00	0.77	0.07	0.05	0.02	0.18	0.18	0.13	0.48	0.07	0.55	0.09	0.60	0.11	
21/11/2024 06:30:00	0.76	0.07	0.05	0.02	0.18	0.18	0.13	0.48	0.06	0.55	0.09	0.59	0.09	
21/11/2024 06:45:00	0.76	0.06	0.05	0.02	0.18	0.18	0.13	0.48	0.06	0.55	0.09	0.57	0.08	
21/11/2024 07:00:00	0.75	0.07	0.05	0.02	0.18	0.18	0.13	0.48	0.07	0.55	0.09	0.56	0.09	
21/11/2024 07:15:00	0.75	0.07	0.05	0.02	0.18	0.18	0.12	0.48	0.06	0.55	0.09	0.55	0.09	
21/11/2024 07:30:00	0.74	0.08	0.05	0.02	0.18	0.18	0.12	0.48	0.07	0.54	0.09	0.54	0.11	
21/11/2024 07:45:00	0.73	0.08	0.05	0.02	0.18	0.18	0.12	0.48	0.06	0.54	0.09	0.53	0.08	
21/11/2024 08:00:00	0.73	0.08	0.04	0.02	0.18	0.18	0.12	0.48	0.06	0.54	0.10	0.52	0.10	
21/11/2024 08:15:00	0.72	0.09	0.05	0.02	0.18	0.18	0.12	0.48	0.07	0.54	0.09	0.51	0.09	
21/11/2024 08:30:00	0.72	0.09	0.04	0.02	0.18	0.18	0.12	0.49	0.07	0.53	0.09	0.50	0.07	
21/11/2024 08:45:00	0.71	0.08	0.04	0.02	0.18	0.18	0.12	0.49	0.08	0.53	0.10	0.50	0.10	
21/11/2024 09:00:00	0.71	0.09	0.04	0.02	0.18	0.18	0.12	0.50	0.07	0.53	0.10	0.49	0.08	
21/11/2024 09:15:00	0.70	0.07	0.04	0.02	0.18	0.18	0.12	0.50	0.07	0.53	0.10	0.48	0.08	
21/11/2024 09:30:00	0.70	0.08	0.04	0.02	0.18	0.18	0.12	0.50	0.08	0.53	0.10	0.48	0.05	
21/11/2024 09:45:00	0.70	0.08	0.04	0.02	0.18	0.18	0.12	0.50	0.07	0.53	0.10	0.48	0.05	
21/11/2024 10:00:00	0.69	0.08	0.04	0.02	0.18	0.18	0.12	0.50	0.07	0.52	0.10	0.48	0.05	
21/11/2024 10:15:00	0.69	0.08	0.04	0.02	0.18	0.18	0.12	0.50	0.05	0.52	0.10	0.48	0.07	
21/11/2024 10:30:00	0.68	0.09	0.04	0.02	0.18	0.18	0.12	0.50	0.07	0.52	0.10	0.49	0.03	
21/11/2024 10:45:00	0.68	0.10	0.04	0.02	0.18	0.18	0.12	0.50	0.08	0.52	0.10	0.50	0.04	
21/11/2024 11:00:00	0.67	0.08	0.04	0.02	0.18	0.18	0.12	0.50	0.07	0.52	0.10	0.54	0.00	
21/11/2024 11:15:00	0.67	0.09	0.04	0.02	0.18	0.18	0.12	0.51	0.08	0.52	0.10	0.57	0.02	
21/11/2024 11:30:00	0.67	0.07	0.04	0.02	0.18	0.18	0.12	0.51	0.09	0.51	0.10	0.60	-0.01	
21/11/2024 11:45:00	0.67	0.06	0.04	0.02	0.18	0.18	0.13	0.51	0.07	0.51	0.10	0.62	0.01	
21/11/2024 12:00:00	0.67	0.06	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.51	0.10	0.63	0.00	
21/11/2024 12:15:00	0.67	0.04	0.05	0.02	0.18	0.18	0.13	0.50	0.08	0.51	0.10	0.64	0.00	
21/11/2024 12:30:00	0.68	0.05	0.05	0.02	0.18	0.18	0.13	0.51	0.07	0.51	0.10	0.65	0.02	
21/11/2024 12:45:00	0.68	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.51	0.10	0.66	0.02	
21/11/2024 13:00:00	0.69	0.05	0.05	0.02	0.18	0.18	0.13	0.51	0.07	0.51	0.11	0.66	0.00	
21/11/2024 13:15:00	0.69	0.04	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.51	0.11	0.67	0.02	
21/11/2024 13:30:00	0.70	0.04	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.51	0.11	0.68	0.00	
21/11/2024 13:45:00	0.70	0.04	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.51	0.11	0.68	0.02	
21/11/2024 14:00:00	0.70	0.04	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.51	0.10	0.68	0.02	
21/11/2024 14:15:00	0.71	0.04	0.05	0.02	0.18	0.18	0.13	0.50	0.08	0.51	0.11	0.68	0.02	
21/11/2024 14:30:00	0.71	0.00	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.52	0.10	0.69	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
21/11/2024 14:45:00	0.71	0.03	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.52	0.10	0.69	0.00	
21/11/2024 15:00:00	0.72	0.03	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.52	0.10	0.69	0.03	
21/11/2024 15:15:00	0.72	0.06	0.05	0.02	0.18	0.18	0.13	0.50	0.08	0.52	0.10	0.69	0.02	
21/11/2024 15:30:00	0.72	0.04	0.05	0.02	0.18	0.18	0.13	0.50	0.08	0.52	0.10	0.69	0.02	
21/11/2024 15:45:00	0.72	0.00	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.52	0.09	0.70	0.00	
21/11/2024 16:00:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.52	0.09	0.70	0.02	
21/11/2024 16:15:00	0.73	0.04	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.52	0.10	0.70	0.02	
21/11/2024 16:30:00	0.73	0.00	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.52	0.10	0.70	0.03	
21/11/2024 16:45:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.52	0.10	0.71	0.02	
21/11/2024 17:00:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.52	0.10	0.71	0.03	
21/11/2024 17:15:00	0.74	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.53	0.10	0.71	0.02	
21/11/2024 17:30:00	0.74	0.00	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.53	0.10	0.70	0.03	
21/11/2024 17:45:00	0.74	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.53	0.10	0.68	0.04	
21/11/2024 18:00:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.53	0.10	0.66	0.08	
21/11/2024 18:15:00	0.73	0.07	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.53	0.10	0.64	0.07	
21/11/2024 18:30:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.53	0.10	0.62	0.07	
21/11/2024 18:45:00	0.72	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.08	0.53	0.10	0.59	0.04	
21/11/2024 19:00:00	0.72	0.06	0.05	0.02	0.18	0.18	0.13	0.50	0.08	0.52	0.09	0.58	0.07	
21/11/2024 19:15:00	0.71	0.06	0.05	0.02	0.18	0.18	0.13	0.50	0.07	0.52	0.09	0.56	0.08	
21/11/2024 19:30:00	0.71	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.08	0.52	0.09	0.55	0.08	
21/11/2024 19:45:00	0.70	0.06	0.05	0.02	0.18	0.18	0.13	0.51	0.06	0.52	0.09	0.53	0.07	
21/11/2024 20:00:00	0.69	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.52	0.10	0.52	0.06	
21/11/2024 20:15:00	0.69	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.09	0.52	0.10	0.51	0.07	
21/11/2024 20:30:00	0.68	0.06	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.52	0.10	0.50	0.10	
21/11/2024 20:45:00	0.68	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.51	0.10	0.49	0.06	
21/11/2024 21:00:00	0.67	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.51	0.10	0.49	0.05	
21/11/2024 21:15:00	0.66	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.07	0.51	0.11	0.49	0.05	
21/11/2024 21:30:00	0.66	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.51	0.11	0.50	0.02	
21/11/2024 21:45:00	0.65	0.08	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.51	0.11	0.53	0.01	
21/11/2024 22:00:00	0.65	0.07	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.51	0.11	0.56	0.02	
21/11/2024 22:15:00	0.65	0.06	0.05	0.02	0.18	0.18	0.13	0.51	0.08	0.51	0.11	0.59	0.02	
21/11/2024 22:30:00	0.65	0.08	0.06	0.03	0.18	0.18	0.13	0.51	0.08	0.51	0.11	0.61	-0.01	
21/11/2024 22:45:00	0.65	0.05	0.05	0.02	0.18	0.18	0.13	0.51	0.09	0.51	0.11	0.62	0.02	
21/11/2024 23:00:00	0.66	0.07	0.06	0.03	0.18	0.18	0.13	0.51	0.07	0.50	0.11	0.63	0.01	
21/11/2024 23:15:00	0.66	0.05	0.06	0.03	0.18	0.18	0.13	0.51	0.08	0.50	0.11	0.64	0.02	
21/11/2024 23:30:00	0.67	0.04	0.06	0.03	0.18	0.18	0.13	0.50	0.08	0.50	0.11	0.65	0.00	
21/11/2024 23:45:00	0.67	0.04	0.06	0.03	0.18	0.18	0.13	0.50	0.09	0.51	0.11	0.65	0.01	
22/11/2024 00:00:00	0.68	0.04	0.06	0.03	0.18	0.18	0.13	0.50	0.08	0.51	0.11	0.66	0.01	
22/11/2024 00:15:00	0.68	0.05	0.06	0.03	0.18	0.18	0.13	0.50	0.08	0.51	0.11	0.67	0.01	
22/11/2024 00:30:00	0.69	0.04	0.06	0.03	0.18	0.18	0.13	0.50	0.08	0.51	0.11	0.67	0.02	
22/11/2024 00:45:00	0.69	0.05	0.06	0.03	0.18	0.18	0.13	0.51	0.07	0.51	0.11	0.67	0.01	
22/11/2024 01:00:00	0.70	0.06	0.06	0.03	0.18	0.18	0.13	0.51	0.08	0.51	0.10	0.68	0.03	
22/11/2024 01:15:00	0.70	0.05	0.06	0.03	0.18	0.18	0.13	0.50	0.07	0.51	0.11	0.68	0.02	
22/11/2024 01:30:00	0.70	0.05	0.06	0.03	0.18	0.18	0.13	0.50	0.07	0.51	0.10	0.68	0.02	
22/11/2024 01:45:00	0.71	0.05	0.06	0.03	0.18	0.18	0.13	0.50	0.08	0.51	0.10	0.69	0.03	
22/11/2024 02:00:00	0.71	0.06	0.06	0.03	0.18	0.18	0.13	0.49	0.07	0.51	0.10	0.69	0.02	
22/11/2024 02:15:00	0.71	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.08	0.51	0.10	0.69	0.04	
22/11/2024 02:30:00	0.72	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.08	0.51	0.10	0.69	0.03	
22/11/2024 02:45:00	0.72	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.06	0.52	0.10	0.69	0.02	
22/11/2024 03:00:00	0.72	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.06	0.52	0.10	0.69	0.03	
22/11/2024 03:15:00	0.72	0.05	0.05	0.02	0.18	0.18	0.13	0.49	0.05	0.52	0.10	0.69	0.00	
22/11/2024 03:30:00	0.72	0.04	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.52	0.10	0.69	0.02	
22/11/2024 03:45:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.48	0.06	0.52	0.10	0.70	0.01	
22/11/2024 04:00:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.48	0.06	0.52	0.10	0.70	0.02	
22/11/2024 04:15:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.48	0.07	0.52	0.10	0.70	0.02	
22/11/2024 04:30:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.48	0.06	0.52	0.10	0.70	0.01	
22/11/2024 04:45:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.48	0.06	0.52	0.09	0.70	0.02	
22/11/2024 05:00:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.48	0.06	0.52	0.10	0.70	0.02	
22/11/2024 05:15:00	0.73	0.04	0.05	0.02	0.18	0.18	0.12	0.48	0.06	0.52	0.10	0.71	0.02	
22/11/2024 05:30:00	0.74	0.05	0.05	0.02	0.18	0.18	0.12	0.48	0.04	0.52	0.10	0.70	0.03	
22/11/2024 05:45:00	0.74	0.05	0.05	0.02	0.18	0.18	0.12	0.48	0.06	0.52	0.10	0.67	0.05	
22/11/2024 06:00:00	0.73	0.04	0.05	0.02	0.18	0.18	0.12	0.48	0.06	0.52	0.10	0.65	0.06	
22/11/2024 06:15:00	0.73	0.07	0.05	0.02	0.18	0.18	0.12	0.48	0.07	0.52	0.10	0.63	0.07	
22/11/2024 06:30:00	0.72	0.06	0.05	0.02	0.18	0.18	0.12	0.48	0.06	0.52	0.10	0.60	0.07	
22/11/2024 06:45:00	0.72	0.06	0.05	0.02	0.18	0.18	0.12	0.48	0.05	0.52	0.10	0.58	0.09	
22/11/2024 07:00:00	0.71	0.08	0.05	0.02	0.18	0.17	0.12	0.48	0.05	0.52	0.09	0.56	0.09	
22/11/2024 07:15:00	0.71	0.08	0.05	0.02	0.17	0.17	0.12	0.48	0.06	0.52	0.10	0.54	0.09	
22/11/2024 07:30:00	0.70	0.07	0.05	0.02	0.17	0.17	0.12	0.48	0.06	0.52	0.10	0.53	0.06	
22/11/2024 07:45:00	0.69	0.07	0.05	0.02	0.17	0.17	0.12	0.48	0.06	0.52	0.10	0.51	0.06	
22/11/2024 08:00:00	0.69	0.07	0.05	0.02	0.17	0.17	0.12	0.48	0.07	0.51	0.10	0.50	0.07	
22/11/2024 08:15:00	0.68	0.08	0.05	0.02	0.17	0.17	0.12	0.48	0.06	0.51	0.10	0.49	0.09	
22/11/2024 08:30:00	0.67	0.08	0.05	0.02	0.17	0.17	0.12	0.48	0.06	0.51	0.09	0.48	0.08	
22/11/2024 08:45:00	0.67	0.09	0.05	0.02	0.17	0.17	0.12	0.48	0.07	0.51	0.10	0.47	0.07	
22/11/2024 09:00:00	0.66	0.08	0.05	0.02	0.17	0.17	0.12	0.49	0.08	0.51	0.10	0.46	0.13	
22/11/2024 09:15:00	0.66	0.08	0.04	0.02	0.17	0.17	0.12	0.49	0.07	0.51	0.10	0.45	0.10	
22/11/2024 09:30:00	0.65	0.08	0.05	0.02	0.17	0.17	0.12	0.49	0.07	0.51	0.10	0.44	0.12	
22/11/2024 09:45:00	0.64	0.06	0.05	0.02	0.17	0.17	0.12	0.49	0.06	0.51	0.10	0.44	0.11	
22/11/2024 10:00:00	0.64	0.08	0.04	0.02	0.17	0.17	0.12	0.50	0.08	0.50	0.10	0.43	0.12	
22/11/2024 10:15:00	0.63	0.07	0.04	0.02	0.17	0.17	0.12	0.50	0.08	0.50	0.10	0.44	0.12	
22/11/2024 10:30:00	0.63	0.09	0.04	0.02	0.17	0.17	0.12	0.50	0.07	0.50	0.10	0.44	0.07	
22/11/2024 10:45:00	0.62	0.09	0.04	0.02	0.17	0.17	0.12	0.50	0.06	0.50	0.11	0.45	0.04	
22/11/2024 11:00:00	0.62	0.07	0.05	0.02	0.17	0.17	0.12	0.50	0.07	0.50	0.10	0.47	0.05	
22/11/2024 11:15:00	0.62	0.10	0.05	0.02	0.17	0.17	0.12	0.50	0.09	0.50	0.10	0.51	0.04	
22/11/2024 11:30:00	0.61	0.09	0.05	0.02	0.17	0.17	0.12	0.50	0.07	0.50	0.11	0.54	0.02	
22/11/2024 11:45:00	0.61	0.07	0.05	0.02	0.17	0.17	0.12	0.50	0.07	0.50	0.10	0.56	0.02	
22/11/2024 12:00:00	0.62	0.07	0.05	0.02	0.17	0.17	0.12	0.50	0.07	0.50	0.10	0.58	0.01	
22/11/2024 12:15:00	0.62	0.04	0.05	0.02	0.17	0.17	0.12	0.50	0.08	0.50	0.10	0.60	0.01	
22/11/2024 12:30:00	0.63	0.05	0.05	0.02	0.17	0.17	0.12	0.50	0.08	0.50	0.10	0.61	0.01	
22/11/2024 12:45:00	0.63	0.02	0.05	0.02	0.17	0.17	0.12	0.50	0.07	0.50	0.11	0.62	0.02	
22/11/2024 13:00:00	0.64	0.05	0.05	0.02	0.17	0.17	0.12	0.50	0.07	0.50	0.10	0.62	0.01	
22/11/2024 13:15:00	0.65	0.03	0.05	0.02	0.18	0.17	0.12	0.50	0.07	0.50	0.10	0.63	0.01	
22/11/2024 13:30:00	0.65	0.05	0.05	0.02	0.18	0.17	0.12	0.50	0.07	0.50	0.10	0.64	0.01	
22/11/2024 13:45:00	0.66	0.02	0.05	0.02	0.18	0.17	0.12	0.50	0.07	0.50	0.10	0.64	0.01	
22/11/2024 14:00:00	0.67	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.06	0.50	0.10	0.65	-0.01	
22/11/2024 14:15:00	0.67	0.04	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.50	0.10	0.66	0.00	
22/11/2024 14:30:00	0.68	0.03	0.06	0.03	0.18	0.17	0.12	0.49	0.07	0.50	0.10	0.66	0.02	
22/11/2024 14:45:00	0.68	0.04	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.50	0.10	0.66	0.02	
22/11/2024 15:00:00	0.69	0.03	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.50	0.10	0.67	0.02	
22/11/2024 15:15:00	0.69	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.50	0.10	0.67	0.01	
22/11/2024 15:30:00	0.69	0.04	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.50	0.10	0.68	0.01	
22/11/2024 15:45:00	0.70	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.09	0.51	0.10	0.68	0.02	
22/11/2024 16:00:00	0.70	0.04	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.51	0.09	0.68	0.02	
22/11/2024 16:15:00	0.70	0.05	0.06	0.03	0.18	0.17	0.12	0.49	0.07	0.51	0.09	0.68	0.02	
22/11/2024 16:30:00	0.70	0.04	0.06	0.03	0.18	0.17	0.12	0.49	0.08	0.51	0.09	0.68	0.00	
22/11/2024 16:45:00	0.71	0.04	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.51	0.10	0.68	0.03	
22/11/2024 17:00:00	0.71	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.51	0.09	0.69	0.02	
22/11/2024 17:15:00	0.71	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.51	0.09	0.69	0.02	
22/11/2024 17:30:00	0.71	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.51	0.10	0.69	0.03	
22/11/2024 17:45:00	0.72	0.04	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.51	0.09	0.69	0.00	
22/11/2024 18:00:00	0.72	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.51	0.09	0.69	0.00	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
22/11/2024 18:15:00	0.72	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.51	0.09	0.69	-0.01	
22/11/2024 18:30:00	0.72	0.06	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.51	0.09	0.69	0.01	
22/11/2024 18:45:00	0.72	0.04	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.51	0.09	0.69	0.00	
22/11/2024 19:00:00	0.72	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.51	0.09	0.69	0.01	
22/11/2024 19:15:00	0.72	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.51	0.09	0.68	0.01	
22/11/2024 19:30:00	0.72	0.00	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.51	0.09	0.66	0.07	
22/11/2024 19:45:00	0.72	0.03	0.05	0.02	0.18	0.17	0.12	0.50	0.08	0.51	0.10	0.64	0.08	
22/11/2024 20:00:00	0.72	0.05	0.05	0.02	0.18	0.17	0.12	0.50	0.07	0.51	0.09	0.63	0.08	
22/11/2024 20:15:00	0.71	0.04	0.05	0.02	0.18	0.17	0.12	0.50	0.08	0.51	0.09	0.61	0.05	
22/11/2024 20:30:00	0.71	0.05	0.05	0.02	0.18	0.17	0.12	0.50	0.09	0.51	0.09	0.59	0.06	
22/11/2024 20:45:00	0.70	0.07	0.05	0.02	0.18	0.17	0.12	0.50	0.08	0.51	0.10	0.57	0.08	
22/11/2024 21:00:00	0.70	0.07	0.05	0.02	0.18	0.17	0.12	0.50	0.07	0.51	0.09	0.55	0.13	
22/11/2024 21:15:00	0.69	0.07	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.51	0.09	0.54	0.07	
22/11/2024 21:30:00	0.69	0.07	0.05	0.02	0.18	0.17	0.12	0.49	0.06	0.51	0.09	0.53	0.07	
22/11/2024 21:45:00	0.68	0.09	0.05	0.02	0.18	0.17	0.12	0.50	0.07	0.51	0.09	0.52	0.11	
22/11/2024 22:00:00	0.67	0.06	0.05	0.02	0.18	0.17	0.12	0.50	0.07	0.51	0.10	0.51	0.05	
22/11/2024 22:15:00	0.67	0.08	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.50	0.10	0.51	0.04	
22/11/2024 22:30:00	0.66	0.08	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.50	0.10	0.51	0.04	
22/11/2024 22:45:00	0.66	0.06	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.50	0.09	0.52	0.03	
22/11/2024 23:00:00	0.65	0.08	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.50	0.10	0.54	0.04	
22/11/2024 23:15:00	0.65	0.07	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.50	0.10	0.57	0.04	
22/11/2024 23:30:00	0.65	0.09	0.05	0.02	0.18	0.17	0.12	0.49	0.08	0.50	0.10	0.59	0.02	
22/11/2024 23:45:00	0.65	0.07	0.05	0.02	0.18	0.17	0.12	0.49	0.06	0.50	0.10	0.61	0.03	
23/11/2024 00:00:00	0.65	0.06	0.05	0.02	0.18	0.17	0.12	0.49	0.06	0.50	0.10	0.62	0.02	
23/11/2024 00:15:00	0.66	0.06	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.50	0.10	0.63	0.02	
23/11/2024 00:30:00	0.66	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.07	0.50	0.10	0.64	0.01	
23/11/2024 00:45:00	0.66	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.06	0.50	0.10	0.65	0.00	
23/11/2024 01:00:00	0.67	0.05	0.05	0.02	0.18	0.17	0.12	0.49	0.06	0.50	0.10	0.65	0.02	
23/11/2024 01:15:00	0.67	0.05	0.05	0.02	0.18	0.17	0.12	0.48	0.07	0.50	0.10	0.66	0.02	
23/11/2024 01:30:00	0.68	0.05	0.05	0.02	0.18	0.17	0.12	0.48	0.06	0.50	0.10	0.66	0.02	
23/11/2024 01:45:00	0.68	0.04	0.05	0.02	0.18	0.17	0.12	0.48	0.07	0.50	0.10	0.66	0.01	
23/11/2024 02:00:00	0.69	0.05	0.05	0.02	0.18	0.17	0.12	0.48	0.06	0.50	0.10	0.67	0.00	
23/11/2024 02:15:00	0.69	0.05	0.05	0.02	0.18	0.17	0.12	0.48	0.07	0.50	0.10	0.67	0.01	
23/11/2024 02:30:00	0.69	0.04	0.05	0.02	0.18	0.17	0.12	0.48	0.06	0.50	0.10	0.67	0.01	
23/11/2024 02:45:00	0.70	0.06	0.05	0.02	0.18	0.17	0.12	0.48	0.06	0.50	0.10	0.67	0.01	
23/11/2024 03:00:00	0.70	0.06	0.05	0.02	0.18	0.17	0.12	0.48	0.07	0.50	0.09	0.68	0.01	
23/11/2024 03:15:00	0.70	0.04	0.05	0.02	0.18	0.17	0.12	0.47	0.06	0.50	0.09	0.68	-0.01	
23/11/2024 03:30:00	0.70	0.04	0.05	0.02	0.17	0.17	0.12	0.47	0.06	0.50	0.09	0.68	0.00	
23/11/2024 03:45:00	0.71	0.06	0.05	0.02	0.17	0.17	0.12	0.47	0.06	0.50	0.10	0.68	0.01	
23/11/2024 04:00:00	0.71	0.05	0.05	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.10	0.68	0.03	
23/11/2024 04:15:00	0.71	0.05	0.05	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.09	0.68	0.02	
23/11/2024 04:30:00	0.71	0.05	0.05	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.09	0.68	0.04	
23/11/2024 04:45:00	0.71	0.04	0.05	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.09	0.69	0.00	
23/11/2024 05:00:00	0.71	0.05	0.04	0.02	0.17	0.17	0.12	0.47	0.07	0.51	0.09	0.69	0.00	
23/11/2024 05:15:00	0.72	0.05	0.04	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.09	0.69	0.01	
23/11/2024 05:30:00	0.72	0.04	0.04	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.09	0.69	0.01	
23/11/2024 05:45:00	0.72	0.06	0.04	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.09	0.69	0.01	
23/11/2024 06:00:00	0.72	0.04	0.04	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.09	0.68	0.04	
23/11/2024 06:15:00	0.72	0.05	0.04	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.08	0.65	0.04	
23/11/2024 06:30:00	0.72	0.06	0.04	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.08	0.63	0.07	
23/11/2024 06:45:00	0.71	0.06	0.04	0.02	0.17	0.17	0.12	0.47	0.07	0.51	0.08	0.60	0.08	
23/11/2024 07:00:00	0.71	0.06	0.04	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.08	0.58	0.08	
23/11/2024 07:15:00	0.70	0.07	0.04	0.02	0.17	0.17	0.12	0.47	0.06	0.51	0.08	0.56	0.09	
23/11/2024 07:30:00	0.70	0.08	0.04	0.02	0.17	0.17	0.12	0.47	0.07	0.51	0.07	0.54	0.08	
23/11/2024 07:45:00	0.69	0.07	0.04	0.02	0.17	0.17	0.12	0.47	0.07	0.51	0.08	0.52	0.08	
23/11/2024 08:00:00	0.69	0.07	0.04	0.02	0.17	0.17	0.12	0.48	0.06	0.51	0.08	0.51	0.08	
23/11/2024 08:15:00	0.68	0.06	0.04	0.02	0.17	0.17	0.12	0.50	0.10	0.51	0.07	0.50	0.12	
23/11/2024 08:30:00	0.67	0.07	0.04	0.02	0.17	0.17	0.12	0.52	0.10	0.51	0.05	0.48	0.11	
23/11/2024 08:45:00	0.67	0.09	0.04	0.01	0.17	0.17	0.12	0.53	0.08	0.51	0.05	0.47	0.10	
23/11/2024 09:00:00	0.66	0.08	0.04	0.01	0.17	0.17	0.12	0.54	0.07	0.51	0.03	0.46	0.10	
23/11/2024 09:15:00	0.66	0.07	0.04	0.02	0.17	0.17	0.12	0.54	0.08	0.51	0.04	0.45	0.14	
23/11/2024 09:30:00	0.65	0.09	0.04	0.02	0.17	0.17	0.12	0.54	0.06	0.51	0.06	0.44	0.08	
23/11/2024 09:45:00	0.65	0.09	0.04	0.02	0.18	0.17	0.12	0.54	0.07	0.51	0.06	0.44	0.08	
23/11/2024 10:00:00	0.64	0.08	0.04	0.02	0.18	0.17	0.12	0.54	0.06	0.51	0.06	0.43	0.09	
23/11/2024 10:15:00	0.64	0.09	0.05	0.02	0.18	0.18	0.13	0.54	0.07	0.51	0.05	0.42	0.10	
23/11/2024 10:30:00	0.63	0.09	0.05	0.02	0.18	0.18	0.13	0.54	0.06	0.51	0.05	0.41	0.08	
23/11/2024 10:45:00	0.62	0.07	0.05	0.02	0.18	0.18	0.13	0.54	0.06	0.51	0.05	0.41	0.07	
23/11/2024 11:00:00	0.62	0.08	0.05	0.02	0.18	0.18	0.13	0.54	0.07	0.51	0.06	0.40	0.07	
23/11/2024 11:15:00	0.62	0.08	0.06	0.03	0.19	0.18	0.14	0.54	0.06	0.51	0.06	0.40	0.10	
23/11/2024 11:30:00	0.61	0.08	0.06	0.03	0.19	0.18	0.13	0.54	0.06	0.51	0.09	0.40	0.07	
23/11/2024 11:45:00	0.61	0.10	0.06	0.03	0.19	0.18	0.14	0.54	0.05	0.51	0.06	0.39	0.10	
23/11/2024 12:00:00	0.61	0.09	0.07	0.03	0.19	0.19	0.14	0.54	0.06	0.51	0.07	0.39	0.07	
23/11/2024 12:15:00	0.60	0.09	0.06	0.03	0.19	0.19	0.14	0.53	0.05	0.51	0.03	0.38	0.08	
23/11/2024 12:30:00	0.60	0.09	0.07	0.03	0.19	0.19	0.14	0.54	0.06	0.51	0.08	0.38	0.10	
23/11/2024 12:45:00	0.60	0.09	0.07	0.03	0.20	0.19	0.14	0.54	0.05	0.51	0.02	0.37	0.09	
23/11/2024 13:00:00	0.60	0.08	0.07	0.03	0.20	0.19	0.14	0.54	0.05	0.51	0.04	0.37	0.09	
23/11/2024 13:15:00	0.59	0.09	0.07	0.04	0.20	0.19	0.14	0.54	0.06	0.51	0.06	0.37	0.10	
23/11/2024 13:30:00	0.59	0.08	0.07	0.04	0.20	0.19	0.15	0.54	0.06	0.51	0.05	0.37	0.09	
23/11/2024 13:45:00	0.59	0.09	0.07	0.04	0.20	0.19	0.15	0.54	0.04	0.52	0.06	0.36	0.08	
23/11/2024 14:00:00	0.59	0.08	0.07	0.04	0.20	0.19	0.15	0.54	0.06	0.52	0.07	0.36	0.08	
23/11/2024 14:15:00	0.59	0.11	0.07	0.04	0.20	0.19	0.15	0.54	0.06	0.52	0.07	0.37	0.11	
23/11/2024 14:30:00	0.59	0.10	0.07	0.04	0.20	0.19	0.15	0.53	0.06	0.52	0.05	0.37	0.07	
23/11/2024 14:45:00	0.58	0.08	0.07	0.04	0.20	0.19	0.15	0.53	0.07	0.52	0.07	0.37	0.07	
23/11/2024 15:00:00	0.58	0.09	0.07	0.04	0.20	0.19	0.15	0.53	0.05	0.52	0.07	0.38	0.07	
23/11/2024 15:15:00	0.58	0.09	0.07	0.04	0.20	0.19	0.15	0.53	0.06	0.52	0.08	0.39	0.06	
23/11/2024 15:30:00	0.58	0.09	0.07	0.04	0.20	0.19	0.15	0.53	0.07	0.52	0.07	0.40	0.07	
23/11/2024 15:45:00	0.58	0.10	0.08	0.04	0.20	0.19	0.15	0.53	0.05	0.52	0.08	0.41	0.06	
23/11/2024 16:00:00	0.58	0.09	0.07	0.04	0.20	0.19	0.15	0.52	0.06	0.52	0.11	0.42	0.06	
23/11/2024 16:15:00	0.59	0.09	0.07	0.04	0.20	0.19	0.15	0.52	0.06	0.52	0.08	0.43	0.05	
23/11/2024 16:30:00	0.59	0.09	0.07	0.04	0.20	0.19	0.15	0.52	0.05	0.52	0.10	0.43	0.06	
23/11/2024 16:45:00	0.59	0.09	0.07	0.04	0.20	0.19	0.15	0.52	0.05	0.52	0.11	0.44	0.08	
23/11/2024 17:00:00	0.59	0.09	0.07	0.04	0.20	0.19	0.15	0.52	0.06	0.53	0.10	0.43	0.08	
23/11/2024 17:15:00	0.59	0.09	0.07	0.04	0.20	0.19	0.15	0.52	0.07	0.53	0.10	0.43	0.07	
23/11/2024 17:30:00	0.59	0.08	0.07	0.04	0.20	0.20	0.15	0.54	0.07	0.53	0.11	0.42	0.08	
23/11/2024 17:45:00	0.60	0.08	0.07	0.04	0.20	0.19	0.15	0.55	0.08	0.53	0.10	0.41	0.10	
23/11/2024 18:00:00	0.60	0.09	0.07	0.04	0.20	0.19	0.15	0.56	0.09	0.53	0.10	0.40	0.08	
23/11/2024 18:15:00	0.60	0.08	0.07	0.04	0.20	0.20	0.15	0.56	0.08	0.53	0.11	0.39	0.08	
23/11/2024 18:30:00	0.60	0.09	0.07	0.04	0.20	0.19	0.15	0.56	0.08	0.53	0.10	0.38	0.08	
23/11/2024 18:45:00	0.60	0.09	0.07	0.04	0.20	0.20	0.15	0.56	0.07	0.53	0.10	0.37	0.08	
23/11/2024 19:00:00	0.60	0.08	0.07	0.04	0.20	0.20	0.15	0.55	0.07	0.53	0.10	0.37	0.10	
23/11/2024 19:15:00	0.60	0.10	0.08	0.04	0.20	0.20	0.15	0.55	0.07	0.53	0.12	0.36	0.10	
23/11/2024 19:30:00	0.60	0.09	0.08	0.04	0.20	0.20	0.15	0.55	0.07	0.53	0.11	0.35	0.09	
23/11/2024 19:45:00	0.60	0.10	0.08	0.04	0.20	0.20	0.15	0.55	0.07	0.53	0.13	0.35	0.10	
23/11/2024 20:00:00	0.60	0.10	0.08	0.04	0.21	0.20	0.16	0.54	0.07	0.53	0.11	0.34	0.12	
23/11/2024 20:15:00	0.59	0.10	0.08	0.04	0.21	0.20	0.16	0.54	0.07	0.53	0.12	0.34	0.11	
23/11/2024 20:30:00	0.59	0.09	0.08	0.04	0.21	0.20	0.16	0.54	0.06	0.53	0.13	0.34	0.11	
23/11/2024 20:45:00	0.59	0.09	0.08	0.04	0.21	0.20	0.16	0.54	0.03	0.53	0.12	0.34	0.11	
23/11/2024 21:00:00	0.59	0.10	0.08	0.04	0.21	0.20	0.16	0.53	0.07	0.53	0.11	0.33	0.11	
23/11/2024 21:15:00	0.59	0.08	0.08	0.04	0.21	0.20	0.16	0.53	0.07	0.53	0.11	0.33	0.11	
23/11/2024 21:30:00	0.59	0.11	0.08	0.04	0.21	0.20	0.16	0.53	0.06	0.53	0.11	0.33	0.11	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
23/11/2024 21:45:00	0.59	0.10	0.08	0.04	0.21	0.20	0.16	0.53	0.06	0.53	0.13	0.33	0.10	
23/11/2024 22:00:00	0.58	0.10	0.08	0.04	0.21	0.20	0.16	0.53	0.07	0.53	0.11	0.32	0.10	
23/11/2024 22:15:00	0.58	0.12	0.08	0.04	0.21	0.20	0.16	0.52	0.06	0.53	0.11	0.32	0.10	
23/11/2024 22:30:00	0.58	0.08	0.08	0.04	0.21	0.20	0.16	0.52	0.06	0.53	0.11	0.32	0.13	
23/11/2024 22:45:00	0.58	0.08	0.08	0.04	0.21	0.20	0.15	0.52	0.06	0.53	0.11	0.32	0.09	
23/11/2024 23:00:00	0.58	0.11	0.08	0.04	0.20	0.20	0.15	0.52	0.07	0.53	0.10	0.31	0.11	
23/11/2024 23:15:00	0.58	0.10	0.08	0.04	0.20	0.20	0.15	0.52	0.06	0.53	0.10	0.31	0.12	
23/11/2024 23:30:00	0.58	0.10	0.08	0.04	0.20	0.20	0.15	0.52	0.06	0.53	0.12	0.31	0.11	
23/11/2024 23:45:00	0.58	0.10	0.08	0.04	0.20	0.20	0.15	0.52	0.06	0.53	0.12	0.31	0.11	
24/11/2024 00:00:00	0.58	0.10	0.08	0.04	0.20	0.20	0.15	0.51	0.07	0.53	0.11	0.31	0.09	
24/11/2024 00:15:00	0.58	0.11	0.07	0.04	0.20	0.20	0.15	0.51	0.06	0.53	0.10	0.31	0.10	
24/11/2024 00:30:00	0.57	0.10	0.07	0.04	0.20	0.20	0.15	0.51	0.06	0.53	0.11	0.31	0.12	
24/11/2024 00:45:00	0.57	0.11	0.07	0.04	0.20	0.20	0.15	0.51	0.07	0.53	0.11	0.31	0.12	
24/11/2024 01:00:00	0.57	0.11	0.07	0.04	0.20	0.19	0.15	0.51	0.06	0.53	0.09	0.32	0.10	
24/11/2024 01:15:00	0.57	0.10	0.07	0.04	0.20	0.19	0.15	0.51	0.06	0.53	0.10	0.33	0.08	
24/11/2024 01:30:00	0.57	0.11	0.07	0.04	0.20	0.19	0.14	0.51	0.06	0.53	0.10	0.35	0.07	
24/11/2024 01:45:00	0.57	0.09	0.07	0.04	0.20	0.19	0.14	0.51	0.06	0.53	0.11	0.37	0.07	
24/11/2024 02:00:00	0.57	0.10	0.07	0.03	0.20	0.19	0.14	0.50	0.06	0.53	0.11	0.39	0.04	
24/11/2024 02:15:00	0.57	0.10	0.07	0.03	0.20	0.19	0.14	0.50	0.05	0.53	0.10	0.42	0.04	
24/11/2024 02:30:00	0.57	0.09	0.07	0.03	0.19	0.19	0.14	0.50	0.06	0.53	0.09	0.44	0.05	
24/11/2024 02:45:00	0.57	0.09	0.07	0.03	0.19	0.19	0.14	0.50	0.06	0.53	0.09	0.46	0.04	
24/11/2024 03:00:00	0.58	0.11	0.07	0.03	0.19	0.19	0.14	0.50	0.06	0.53	0.09	0.48	0.03	
24/11/2024 03:15:00	0.58	0.09	0.07	0.03	0.19	0.19	0.14	0.50	0.05	0.53	0.09	0.49	0.02	
24/11/2024 03:30:00	0.58	0.09	0.06	0.03	0.19	0.18	0.14	0.50	0.06	0.53	0.10	0.50	0.03	
24/11/2024 03:45:00	0.59	0.08	0.07	0.03	0.19	0.19	0.14	0.50	0.06	0.53	0.10	0.52	0.03	
24/11/2024 04:00:00	0.59	0.06	0.06	0.03	0.19	0.19	0.14	0.50	0.07	0.53	0.07	0.53	0.03	
24/11/2024 04:15:00	0.60	0.09	0.06	0.03	0.19	0.18	0.14	0.50	0.06	0.53	0.10	0.54	0.04	
24/11/2024 04:30:00	0.60	0.08	0.06	0.03	0.19	0.18	0.14	0.50	0.06	0.53	0.06	0.55	0.01	
24/11/2024 04:45:00	0.61	0.08	0.06	0.03	0.19	0.18	0.13	0.50	0.05	0.53	0.05	0.55	0.02	
24/11/2024 05:00:00	0.62	0.08	0.06	0.03	0.19	0.18	0.13	0.50	0.06	0.53	0.11	0.57	0.03	
24/11/2024 05:15:00	0.62	0.06	0.06	0.03	0.19	0.18	0.13	0.50	0.06	0.53	0.08	0.57	0.03	
24/11/2024 05:30:00	0.63	0.06	0.06	0.03	0.19	0.18	0.13	0.49	0.06	0.53	0.09	0.58	0.02	
24/11/2024 05:45:00	0.63	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.05	0.53	0.08	0.59	0.04	
24/11/2024 06:00:00	0.64	0.07	0.06	0.03	0.19	0.18	0.13	0.49	0.06	0.53	0.09	0.58	0.04	
24/11/2024 06:15:00	0.64	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.06	0.53	0.07	0.56	0.06	
24/11/2024 06:30:00	0.64	0.08	0.05	0.02	0.18	0.18	0.13	0.49	0.05	0.54	0.04	0.54	0.06	
24/11/2024 06:45:00	0.65	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.06	0.53	0.12	0.52	0.06	
24/11/2024 07:00:00	0.64	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.06	0.54	0.11	0.50	0.09	
24/11/2024 07:15:00	0.64	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.06	0.54	0.03	0.48	0.09	
24/11/2024 07:30:00	0.64	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.06	0.54	0.09	0.46	0.11	
24/11/2024 07:45:00	0.64	0.07	0.05	0.02	0.18	0.18	0.13	0.49	0.05	0.54	0.08	0.45	0.10	
24/11/2024 08:00:00	0.64	0.09	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.54	0.09	0.43	0.08	
24/11/2024 08:15:00	0.63	0.08	0.05	0.02	0.18	0.18	0.13	0.49	0.06	0.54	0.07	0.42	0.09	
24/11/2024 08:30:00	0.63	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.54	0.08	0.41	0.12	
24/11/2024 08:45:00	0.63	0.09	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.54	0.08	0.40	0.10	
24/11/2024 09:00:00	0.62	0.09	0.05	0.02	0.18	0.18	0.13	0.50	0.06	0.54	0.04	0.39	0.10	
24/11/2024 09:15:00	0.62	0.10	0.05	0.02	0.18	0.18	0.12	0.50	0.05	0.54	0.06	0.39	0.09	
24/11/2024 09:30:00	0.62	0.09	0.05	0.02	0.18	0.18	0.12	0.50	0.06	0.54	0.03	0.38	0.10	
24/11/2024 09:45:00	0.61	0.07	0.05	0.02	0.18	0.18	0.12	0.50	0.06	0.54	0.06	0.37	0.09	
24/11/2024 10:00:00	0.61	0.10	0.05	0.02	0.18	0.18	0.12	0.50	0.06	0.54	0.09	0.36	0.10	
24/11/2024 10:15:00	0.61	0.11	0.05	0.02	0.18	0.18	0.12	0.51	0.06	0.54	0.09	0.36	0.10	
24/11/2024 10:30:00	0.61	0.10	0.05	0.02	0.18	0.18	0.12	0.51	0.07	0.54	0.08	0.36	0.10	
24/11/2024 10:45:00	0.60	0.10	0.05	0.02	0.18	0.18	0.12	0.51	0.07	0.54	0.06	0.35	0.13	
24/11/2024 11:00:00	0.60	0.10	0.05	0.02	0.18	0.18	0.12	0.51	0.06	0.54	0.11	0.35	0.12	
24/11/2024 11:15:00	0.60	0.11	0.05	0.02	0.18	0.18	0.12	0.52	0.06	0.54	0.06	0.35	0.12	
24/11/2024 11:30:00	0.60	0.09	0.05	0.02	0.18	0.18	0.12	0.52	0.07	0.54	0.09	0.34	0.14	
24/11/2024 11:45:00	0.60	0.12	0.05	0.02	0.18	0.18	0.12	0.52	0.07	0.54	0.10	0.33	0.11	
24/11/2024 12:00:00	0.59	0.10	0.05	0.02	0.18	0.18	0.13	0.52	0.07	0.54	0.09	0.33	0.16	
24/11/2024 12:15:00	0.59	0.10	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.09	0.33	0.11	
24/11/2024 12:30:00	0.59	0.10	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.07	0.33	0.13	
24/11/2024 12:45:00	0.59	0.10	0.06	0.03	0.18	0.18	0.13	0.52	0.06	0.53	0.11	0.33	0.07	
24/11/2024 13:00:00	0.59	0.09	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.10	0.32	0.13	
24/11/2024 13:15:00	0.58	0.10	0.06	0.03	0.18	0.18	0.13	0.52	0.06	0.54	0.10	0.32	0.11	
24/11/2024 13:30:00	0.58	0.10	0.06	0.03	0.18	0.18	0.13	0.52	0.08	0.54	0.09	0.31	0.13	
24/11/2024 13:45:00	0.58	0.10	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.54	0.04	0.31	0.09	
24/11/2024 14:00:00	0.58	0.09	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.09	0.31	0.11	
24/11/2024 14:15:00	0.58	0.09	0.06	0.03	0.18	0.18	0.13	0.52	0.06	0.53	0.09	0.31	0.07	
24/11/2024 14:30:00	0.58	0.09	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.09	0.32	0.10	
24/11/2024 14:45:00	0.58	0.11	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.03	0.32	0.11	
24/11/2024 15:00:00	0.57	0.10	0.06	0.03	0.19	0.18	0.13	0.52	0.06	0.53	0.10	0.34	0.09	
24/11/2024 15:15:00	0.57	0.12	0.06	0.03	0.18	0.18	0.13	0.51	0.05	0.53	0.09	0.36	0.07	
24/11/2024 15:30:00	0.57	0.08	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.53	0.08	0.39	0.07	
24/11/2024 15:45:00	0.57	0.09	0.06	0.03	0.18	0.18	0.13	0.51	0.06	0.53	0.05	0.41	0.05	
24/11/2024 16:00:00	0.57	0.11	0.06	0.03	0.18	0.18	0.13	0.51	0.06	0.53	0.06	0.43	0.05	
24/11/2024 16:15:00	0.57	0.09	0.06	0.03	0.18	0.18	0.13	0.51	0.06	0.53	0.05	0.45	0.04	
24/11/2024 16:30:00	0.58	0.10	0.06	0.03	0.19	0.18	0.13	0.51	0.06	0.53	0.11	0.47	0.04	
24/11/2024 16:45:00	0.58	0.10	0.06	0.03	0.18	0.18	0.13	0.51	0.07	0.53	0.02	0.48	0.03	
24/11/2024 17:00:00	0.58	0.08	0.06	0.03	0.18	0.18	0.13	0.51	0.06	0.53	0.09	0.49	0.04	
24/11/2024 17:15:00	0.59	0.08	0.06	0.03	0.18	0.18	0.13	0.51	0.07	0.53	0.07	0.51	0.03	
24/11/2024 17:30:00	0.59	0.09	0.06	0.03	0.18	0.18	0.13	0.51	0.07	0.53	0.07	0.52	0.02	
24/11/2024 17:45:00	0.59	0.10	0.06	0.03	0.19	0.18	0.13	0.51	0.07	0.53	0.11	0.52	0.03	
24/11/2024 18:00:00	0.60	0.07	0.06	0.03	0.18	0.18	0.13	0.51	0.06	0.53	0.14	0.53	0.03	
24/11/2024 18:15:00	0.60	0.06	0.06	0.03	0.18	0.18	0.13	0.51	0.07	0.53	0.06	0.54	0.03	
24/11/2024 18:30:00	0.61	0.08	0.06	0.03	0.18	0.18	0.13	0.51	0.07	0.53	0.02	0.55	0.04	
24/11/2024 18:45:00	0.61	0.08	0.06	0.03	0.18	0.18	0.13	0.51	0.06	0.53	0.00	0.56	0.04	
24/11/2024 19:00:00	0.62	0.07	0.06	0.03	0.18	0.18	0.13	0.51	0.07	0.53	0.09	0.56	0.04	
24/11/2024 19:15:00	0.62	0.09	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.09	0.57	0.03	
24/11/2024 19:30:00	0.63	0.08	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.03	0.58	0.04	
24/11/2024 19:45:00	0.63	0.07	0.06	0.03	0.18	0.18	0.13	0.52	0.06	0.53	0.10	0.58	0.04	
24/11/2024 20:00:00	0.64	0.10	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.02	0.59	0.04	
24/11/2024 20:15:00	0.64	0.07	0.06	0.03	0.18	0.18	0.13	0.52	0.06	0.53	0.07	0.59	0.03	
24/11/2024 20:30:00	0.64	0.06	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.08	0.60	0.04	
24/11/2024 20:45:00	0.65	0.06	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.08	0.61	0.04	
24/11/2024 21:00:00	0.65	0.07	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.53	0.10	0.61	0.03	
24/11/2024 21:15:00	0.66	0.08	0.06	0.03	0.18	0.18	0.13	0.53	0.06	0.53	0.07	0.61	0.04	
24/11/2024 21:30:00	0.66	0.06	0.06	0.03	0.18	0.18	0.13	0.53	0.06	0.53	0.07	0.62	0.04	
24/11/2024 21:45:00	0.66	0.08	0.06	0.03	0.18	0.18	0.13	0.53	0.06	0.53	0.11	0.62	0.04	
24/11/2024 22:00:00	0.67	0.06	0.06	0.03	0.18	0.18	0.13	0.53	0.06	0.54	0.06	0.62	0.04	
24/11/2024 22:15:00	0.67	0.06	0.06	0.03	0.18	0.18	0.13	0.53	0.06	0.54	0.10	0.63	0.04	
24/11/2024 22:30:00	0.68	0.06	0.06	0.03	0.18	0.18	0.13	0.53	0.06	0.54	0.09	0.63	0.03	
24/11/2024 22:45:00	0.68	0.07	0.06	0.03	0.18	0.18	0.13	0.52	0.06	0.54	0.11	0.64	0.04	
24/11/2024 23:00:00	0.68	0.07	0.06	0.03	0.18	0.18	0.13	0.52	0.06	0.54	0.10	0.64	0.05	
24/11/2024 23:15:00	0.68	0.05	0.07	0.03	0.18	0.18	0.13	0.52	0.06	0.54	0.10	0.64	0.03	
24/11/2024 23:30:00	0.68	0.07	0.07	0.03	0.18	0.18	0.13	0.52	0.06	0.54	0.03	0.64	0.04	
24/11/2024 23:45:00	0.69	0.07	0.07	0.04	0.19	0.18	0.13	0.51	0.04	0.54	0.08	0.65	0.04	
25/11/2024 00:00:00	0.69	0.06	0.07	0.04	0.19	0.18	0.13	0.51	0.06	0.54	0.07	0.66	0.04	
25/11/2024 00:15:00	0.69	0.06	0.07	0.03	0.19	0.18	0.13	0.51	0.07	0.54	0.07	0.66	0.04	
25/11/2024 00:30:00	0.69	0.07	0.07	0.03	0.19	0.18	0.13	0.51	0.07	0.54	0.10	0.66	0.04	
25/11/2024 00:45:00	0.70	0.06	0.07	0.03	0.19	0.18	0.13	0.51	0.06	0.54	0.12	0.66	0.02	
25/11/2024 01:00:00	0.70	0.05	0.07	0.03	0.19	0.18	0.13	0.52	0.06	0.54	0.11	0.66	0.04	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
25/11/2024 01:15:00	0.70	0.04	0.07	0.03	0.19	0.18	0.13	0.52	0.07	0.54	0.10	0.66	0.01	
25/11/2024 01:30:00	0.70	0.05	0.07	0.03	0.19	0.18	0.13	0.52	0.07	0.54	0.11	0.67	0.05	
25/11/2024 01:45:00	0.70	0.07	0.07	0.03	0.19	0.18	0.13	0.53	0.07	0.54	0.12	0.67	0.04	
25/11/2024 02:00:00	0.71	0.05	0.07	0.03	0.19	0.18	0.13	0.54	0.06	0.54	0.11	0.67	0.03	
25/11/2024 02:15:00	0.71	0.06	0.07	0.03	0.19	0.18	0.13	0.55	0.09	0.54	0.11	0.67	0.04	
25/11/2024 02:30:00	0.71	0.07	0.07	0.03	0.19	0.18	0.13	0.56	0.08	0.55	0.10	0.67	0.03	
25/11/2024 02:45:00	0.71	0.05	0.07	0.03	0.19	0.18	0.14	0.57	0.08	0.55	0.11	0.67	0.04	
25/11/2024 03:00:00	0.71	0.05	0.07	0.03	0.19	0.18	0.14	0.58	0.09	0.55	0.11	0.68	0.03	
25/11/2024 03:15:00	0.72	0.05	0.07	0.04	0.19	0.18	0.14	0.58	0.08	0.55	0.11	0.68	0.03	
25/11/2024 03:30:00	0.72	0.05	0.07	0.04	0.19	0.19	0.14	0.58	0.08	0.55	0.10	0.68	0.03	
25/11/2024 03:45:00	0.72	0.04	0.07	0.04	0.20	0.19	0.14	0.57	0.07	0.55	0.10	0.68	0.01	
25/11/2024 04:00:00	0.72	0.04	0.08	0.04	0.20	0.19	0.15	0.57	0.07	0.55	0.11	0.68	0.04	
25/11/2024 04:15:00	0.72	0.05	0.08	0.04	0.20	0.19	0.15	0.56	0.07	0.55	0.10	0.69	0.04	
25/11/2024 04:30:00	0.72	0.05	0.08	0.04	0.20	0.19	0.15	0.56	0.07	0.55	0.10	0.69	0.04	
25/11/2024 04:45:00	0.72	0.05	0.08	0.05	0.21	0.20	0.16	0.56	0.07	0.55	0.11	0.69	0.04	
25/11/2024 05:00:00	0.73	0.05	0.08	0.05	0.21	0.20	0.16	0.56	0.07	0.55	0.11	0.69	0.04	
25/11/2024 05:15:00	0.73	0.05	0.08	0.05	0.21	0.20	0.16	0.55	0.06	0.55	0.09	0.69	0.02	
25/11/2024 05:30:00	0.73	0.06	0.08	0.05	0.21	0.20	0.16	0.55	0.08	0.55	0.10	0.69	0.03	
25/11/2024 05:45:00	0.73	0.06	0.09	0.05	0.21	0.20	0.16	0.55	0.08	0.55	0.11	0.69	0.02	
25/11/2024 06:00:00	0.73	0.04	0.08	0.05	0.21	0.20	0.16	0.55	0.08	0.55	0.09	0.69	0.03	
25/11/2024 06:15:00	0.73	0.06	0.09	0.05	0.21	0.20	0.16	0.55	0.08	0.55	0.10	0.70	0.04	
25/11/2024 06:30:00	0.73	0.06	0.09	0.05	0.21	0.20	0.16	0.55	0.08	0.55	0.11	0.70	0.03	
25/11/2024 06:45:00	0.73	0.06	0.08	0.05	0.21	0.20	0.16	0.55	0.08	0.55	0.11	0.70	0.04	
25/11/2024 07:00:00	0.73	0.05	0.08	0.05	0.21	0.20	0.16	0.55	0.08	0.55	0.10	0.70	0.04	
25/11/2024 07:15:00	0.73	0.04	0.09	0.05	0.21	0.20	0.16	0.55	0.07	0.55	0.10	0.70	0.03	
25/11/2024 07:30:00	0.74	0.04	0.09	0.05	0.21	0.20	0.16	0.55	0.08	0.55	0.11	0.70	0.04	
25/11/2024 07:45:00	0.74	0.06	0.09	0.05	0.21	0.20	0.16	0.54	0.08	0.55	0.10	0.70	0.03	
25/11/2024 08:00:00	0.74	0.04	0.09	0.05	0.21	0.20	0.16	0.54	0.07	0.55	0.10	0.70	0.03	
25/11/2024 08:15:00	0.74	0.05	0.09	0.05	0.21	0.20	0.16	0.54	0.07	0.55	0.11	0.69	0.03	
25/11/2024 08:30:00	0.74	0.05	0.09	0.05	0.21	0.20	0.16	0.54	0.08	0.55	0.11	0.67	0.06	
25/11/2024 08:45:00	0.73	0.07	0.08	0.05	0.21	0.20	0.16	0.54	0.07	0.55	0.10	0.64	0.08	
25/11/2024 09:00:00	0.73	0.06	0.08	0.05	0.21	0.20	0.16	0.54	0.07	0.55	0.11	0.62	0.04	
25/11/2024 09:15:00	0.72	0.04	0.08	0.04	0.21	0.20	0.16	0.54	0.07	0.55	0.10	0.59	0.06	
25/11/2024 09:30:00	0.72	0.04	0.08	0.04	0.21	0.20	0.16	0.54	0.08	0.55	0.11	0.57	0.07	
25/11/2024 09:45:00	0.71	0.09	0.08	0.04	0.21	0.20	0.16	0.54	0.07	0.55	0.11	0.55	0.07	
25/11/2024 10:00:00	0.71	0.06	0.08	0.04	0.21	0.20	0.15	0.54	0.08	0.55	0.11	0.53	0.05	
25/11/2024 10:15:00	0.70	0.06	0.08	0.04	0.21	0.20	0.15	0.54	0.08	0.55	0.11	0.51	0.09	
25/11/2024 10:30:00	0.69	0.09	0.08	0.04	0.21	0.20	0.15	0.55	0.08	0.55	0.12	0.50	0.06	
25/11/2024 10:45:00	0.69	0.08	0.08	0.04	0.20	0.20	0.15	0.54	0.08	0.55	0.12	0.49	0.07	
25/11/2024 11:00:00	0.68	0.09	0.08	0.04	0.20	0.20	0.15	0.54	0.08	0.55	0.12	0.48	0.09	
25/11/2024 11:15:00	0.67	0.07	0.08	0.04	0.20	0.20	0.15	0.54	0.07	0.55	0.12	0.47	0.08	
25/11/2024 11:30:00	0.67	0.07	0.08	0.04	0.20	0.19	0.15	0.54	0.07	0.54	0.12	0.46	0.08	
25/11/2024 11:45:00	0.66	0.08	0.08	0.04	0.20	0.20	0.15	0.53	0.06	0.54	0.12	0.45	0.07	
25/11/2024 12:00:00	0.66	0.09	0.08	0.04	0.20	0.19	0.15	0.53	0.07	0.54	0.12	0.45	0.10	
25/11/2024 12:15:00	0.65	0.10	0.08	0.04	0.20	0.20	0.15	0.53	0.08	0.54	0.12	0.44	0.11	
25/11/2024 12:30:00	0.65	0.10	0.08	0.04	0.20	0.19	0.15	0.53	0.08	0.54	0.12	0.43	0.12	
25/11/2024 12:45:00	0.64	0.06	0.08	0.04	0.20	0.19	0.15	0.53	0.06	0.54	0.12	0.43	0.11	
25/11/2024 13:00:00	0.64	0.08	0.08	0.04	0.20	0.19	0.15	0.53	0.08	0.54	0.12	0.42	0.12	
25/11/2024 13:15:00	0.63	0.07	0.08	0.04	0.20	0.19	0.15	0.52	0.08	0.53	0.12	0.42	0.12	
25/11/2024 13:30:00	0.63	0.10	0.08	0.04	0.20	0.19	0.15	0.52	0.08	0.53	0.12	0.41	0.11	
25/11/2024 13:45:00	0.62	0.09	0.08	0.04	0.20	0.19	0.15	0.52	0.08	0.53	0.12	0.41	0.10	
25/11/2024 14:00:00	0.62	0.08	0.08	0.04	0.20	0.19	0.15	0.52	0.08	0.53	0.13	0.40	0.11	
25/11/2024 14:15:00	0.61	0.08	0.08	0.04	0.20	0.19	0.15	0.52	0.07	0.53	0.12	0.40	0.12	
25/11/2024 14:30:00	0.61	0.08	0.08	0.04	0.20	0.19	0.15	0.52	0.07	0.53	0.12	0.40	0.11	
25/11/2024 14:45:00	0.61	0.08	0.08	0.04	0.20	0.19	0.15	0.52	0.07	0.53	0.13	0.41	0.09	
25/11/2024 15:00:00	0.60	0.07	0.08	0.04	0.20	0.19	0.15	0.52	0.06	0.53	0.12	0.43	0.06	
25/11/2024 15:15:00	0.60	0.09	0.08	0.04	0.20	0.19	0.14	0.51	0.07	0.53	0.12	0.46	0.00	
25/11/2024 15:30:00	0.60	0.10	0.08	0.04	0.20	0.19	0.14	0.51	0.07	0.53	0.12	0.49	0.00	
25/11/2024 15:45:00	0.60	0.09	0.07	0.04	0.19	0.19	0.14	0.51	0.06	0.53	0.13	0.52	0.02	
25/11/2024 16:00:00	0.60	0.08	0.07	0.04	0.19	0.19	0.14	0.51	0.06	0.53	0.12	0.54	0.00	
25/11/2024 16:15:00	0.60	0.07	0.07	0.04	0.19	0.19	0.14	0.51	0.07	0.53	0.13	0.55	0.01	
25/11/2024 16:30:00	0.61	0.06	0.07	0.04	0.19	0.19	0.14	0.51	0.07	0.53	0.13	0.56	0.00	
25/11/2024 16:45:00	0.61	0.06	0.07	0.04	0.19	0.19	0.14	0.51	0.07	0.53	0.13	0.57	0.01	
25/11/2024 17:00:00	0.62	0.05	0.07	0.04	0.19	0.18	0.14	0.51	0.07	0.53	0.12	0.58	0.02	
25/11/2024 17:15:00	0.62	0.07	0.07	0.04	0.19	0.18	0.14	0.51	0.07	0.53	0.13	0.59	0.00	
25/11/2024 17:30:00	0.63	0.06	0.07	0.04	0.19	0.18	0.14	0.51	0.08	0.53	0.13	0.60	0.00	
25/11/2024 17:45:00	0.63	0.07	0.07	0.04	0.19	0.18	0.14	0.51	0.07	0.53	0.12	0.61	-0.02	
25/11/2024 18:00:00	0.64	0.05	0.07	0.04	0.19	0.18	0.14	0.51	0.07	0.53	0.13	0.61	0.02	
25/11/2024 18:15:00	0.65	0.06	0.07	0.03	0.19	0.18	0.13	0.51	0.07	0.53	0.13	0.62	0.01	
25/11/2024 18:30:00	0.65	0.06	0.07	0.03	0.19	0.18	0.13	0.51	0.07	0.53	0.13	0.62	0.00	
25/11/2024 18:45:00	0.66	0.05	0.07	0.04	0.19	0.18	0.13	0.51	0.07	0.53	0.13	0.63	0.03	
25/11/2024 19:00:00	0.66	0.06	0.07	0.03	0.19	0.18	0.13	0.51	0.07	0.53	0.13	0.63	0.01	
25/11/2024 19:15:00	0.66	0.06	0.07	0.03	0.19	0.18	0.13	0.51	0.08	0.53	0.12	0.64	0.03	
25/11/2024 19:30:00	0.67	0.06	0.07	0.03	0.19	0.18	0.13	0.51	0.08	0.53	0.12	0.64	0.02	
25/11/2024 19:45:00	0.67	0.05	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.54	0.12	0.64	0.02	
25/11/2024 20:00:00	0.68	0.06	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.54	0.12	0.65	0.01	
25/11/2024 20:15:00	0.68	0.04	0.07	0.03	0.18	0.18	0.13	0.51	0.08	0.54	0.12	0.65	0.00	
25/11/2024 20:30:00	0.68	0.06	0.06	0.03	0.18	0.18	0.13	0.52	0.07	0.54	0.12	0.66	0.03	
25/11/2024 20:45:00	0.69	0.05	0.06	0.03	0.18	0.18	0.13	0.52	0.08	0.54	0.12	0.65	0.01	
25/11/2024 21:00:00	0.69	0.05	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.54	0.12	0.66	0.01	
25/11/2024 21:15:00	0.69	0.07	0.07	0.03	0.18	0.18	0.13	0.51	0.08	0.54	0.12	0.66	0.01	
25/11/2024 21:30:00	0.69	0.05	0.07	0.03	0.18	0.18	0.13	0.51	0.08	0.54	0.12	0.66	0.01	
25/11/2024 21:45:00	0.70	0.06	0.07	0.03	0.18	0.18	0.13	0.51	0.08	0.54	0.12	0.67	0.02	
25/11/2024 22:00:00	0.70	0.04	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.54	0.12	0.67	0.01	
25/11/2024 22:15:00	0.70	0.06	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.54	0.12	0.65	0.03	
25/11/2024 22:30:00	0.70	0.06	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.54	0.12	0.63	0.06	
25/11/2024 22:45:00	0.70	0.06	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.54	0.11	0.61	0.07	
25/11/2024 23:00:00	0.70	0.05	0.07	0.03	0.18	0.18	0.13	0.51	0.08	0.54	0.12	0.60	0.05	
25/11/2024 23:15:00	0.69	0.08	0.07	0.03	0.18	0.18	0.13	0.51	0.08	0.54	0.12	0.58	0.05	
25/11/2024 23:30:00	0.69	0.09	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.54	0.11	0.56	0.05	
25/11/2024 23:45:00	0.69	0.06	0.07	0.03	0.18	0.18	0.13	0.51	0.06	0.54	0.12	0.55	0.07	
26/11/2024 00:00:00	0.68	0.08	0.07	0.03	0.18	0.18	0.13	0.50	0.07	0.54	0.12	0.53	0.07	
26/11/2024 00:15:00	0.68	0.10	0.07	0.03	0.18	0.18	0.13	0.50	0.08	0.54	0.11	0.52	0.07	
26/11/2024 00:30:00	0.67	0.09	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.54	0.12	0.51	0.08	
26/11/2024 00:45:00	0.67	0.07	0.07	0.03	0.18	0.18	0.13	0.51	0.07	0.54	0.11	0.50	0.06	
26/11/2024 01:00:00	0.66	0.08	0.07	0.03	0.18	0.18	0.13	0.51	0.06	0.54	0.12	0.49	0.07	
26/11/2024 01:15:00	0.66	0.08	0.07	0.03	0.18	0.18	0.13	0.50	0.07	0.54	0.11	0.49	0.07	
26/11/2024 01:30:00	0.65	0.07	0.06	0.03	0.18	0.18	0.13	0.50	0.07	0.54	0.12	0.48	0.04	
26/11/2024 01:45:00	0.65	0.09	0.06	0.03	0.18	0.18	0.13	0.50	0.07	0.54	0.11	0.48	0.01	
26/11/2024 02:00:00	0.64	0.10	0.06	0.03	0.18	0.18	0.13	0.50	0.07	0.53	0.11	0.49	0.04	
26/11/2024 02:15:00	0.64	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.07	0.53	0.12	0.51	0.04	
26/11/2024 02:30:00	0.63	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.07	0.53	0.12	0.53	0.05	
26/11/2024 02:45:00	0.63	0.10	0.06	0.03	0.18	0.18	0.13	0.49	0.06	0.53	0.12	0.56	0.01	
26/11/2024 03:00:00	0.63	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.06	0.53	0.12	0.57	0.03	
26/11/2024 03:15:00	0.64	0.08	0.06	0.03	0.18	0.17	0.13	0.48	0.07	0.53	0.12	0.59	0.01	
26/11/2024 03:30:00	0.64	0.06	0.06	0.03	0.18	0.17	0.13	0.48	0.07	0.53	0.12	0.60	-0.02	
26/11/2024 03:45:00	0.64	0.07	0.06	0.03	0.18	0.17	0.13	0.48	0.07	0.53	0.12	0.61	0.00	
26/11/2024 04:00:00	0.65	0.06	0.06	0.03	0.18	0.17	0.12	0.48	0.07	0.53	0.12	0.61	0.00	
26/11/2024 04:15:00	0.65	0.07	0.06	0.03	0.18	0.17	0.12	0.48	0.07	0.53	0.13	0.62	0.01	
26/11/2024 04:30:00	0.66	0.05	0.06	0.03	0.18	0.17	0.12	0.48	0.07	0.53	0.12	0.63	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
26/11/2024 04:45:00	0.66	0.06	0.06	0.03	0.18	0.17	0.12	0.48	0.06	0.53	0.12	0.63	0.02	
26/11/2024 05:00:00	0.66	0.06	0.06	0.03	0.18	0.17	0.12	0.48	0.06	0.53	0.12	0.64	-0.01	
26/11/2024 05:15:00	0.67	0.06	0.06	0.03	0.18	0.17	0.12	0.48	0.06	0.53	0.12	0.64	0.00	
26/11/2024 05:30:00	0.67	0.05	0.06	0.03	0.17	0.17	0.12	0.47	0.07	0.53	0.12	0.64	0.00	
26/11/2024 05:45:00	0.67	0.04	0.06	0.03	0.17	0.17	0.12	0.47	0.06	0.53	0.12	0.65	0.02	
26/11/2024 06:00:00	0.68	0.04	0.06	0.03	0.17	0.17	0.12	0.47	0.07	0.53	0.12	0.65	-0.01	
26/11/2024 06:15:00	0.68	0.04	0.05	0.02	0.17	0.17	0.12	0.47	0.07	0.54	0.12	0.65	0.01	
26/11/2024 06:30:00	0.68	0.04	0.05	0.02	0.17	0.17	0.12	0.47	0.07	0.54	0.12	0.66	0.02	
26/11/2024 06:45:00	0.69	0.04	0.05	0.02	0.17	0.17	0.12	0.47	0.07	0.54	0.12	0.66	0.03	
26/11/2024 07:00:00	0.69	0.04	0.06	0.03	0.17	0.17	0.12	0.47	0.07	0.54	0.12	0.66	0.02	
26/11/2024 07:15:00	0.69	0.05	0.05	0.02	0.17	0.17	0.12	0.47	0.05	0.54	0.12	0.66	0.00	
26/11/2024 07:30:00	0.70	0.05	0.05	0.02	0.17	0.17	0.12	0.47	0.06	0.54	0.12	0.67	0.02	
26/11/2024 07:45:00	0.70	0.05	0.05	0.02	0.17	0.17	0.12	0.47	0.07	0.54	0.12	0.67	0.00	
26/11/2024 08:00:00	0.70	0.05	0.05	0.02	0.17	0.17	0.12	0.48	0.06	0.54	0.12	0.67	0.01	
26/11/2024 08:15:00	0.70	0.05	0.05	0.02	0.17	0.16	0.11	0.48	0.07	0.54	0.11	0.67	0.01	
26/11/2024 08:30:00	0.70	0.05	0.05	0.02	0.17	0.16	0.11	0.48	0.07	0.54	0.11	0.67	0.02	
26/11/2024 08:45:00	0.70	0.06	0.05	0.02	0.17	0.16	0.11	0.48	0.07	0.54	0.11	0.67	0.04	
26/11/2024 09:00:00	0.71	0.05	0.05	0.02	0.17	0.16	0.11	0.48	0.07	0.54	0.11	0.67	0.02	
26/11/2024 09:15:00	0.71	0.06	0.05	0.02	0.17	0.16	0.11	0.49	0.07	0.54	0.12	0.67	0.02	
26/11/2024 09:30:00	0.71	0.04	0.05	0.02	0.17	0.16	0.11	0.49	0.07	0.54	0.12	0.67	0.02	
26/11/2024 09:45:00	0.71	0.04	0.05	0.02	0.17	0.16	0.11	0.49	0.07	0.54	0.12	0.66	0.02	
26/11/2024 10:00:00	0.71	0.05	0.05	0.02	0.17	0.16	0.11	0.49	0.06	0.54	0.11	0.64	0.03	
26/11/2024 10:15:00	0.71	0.05	0.05	0.02	0.17	0.16	0.11	0.49	0.06	0.54	0.11	0.61	0.04	
26/11/2024 10:30:00	0.70	0.07	0.04	0.02	0.17	0.16	0.11	0.50	0.08	0.54	0.11	0.59	0.06	
26/11/2024 10:45:00	0.70	0.05	0.05	0.02	0.17	0.16	0.11	0.50	0.08	0.54	0.12	0.57	0.05	
26/11/2024 11:00:00	0.69	0.06	0.05	0.02	0.17	0.16	0.11	0.50	0.06	0.54	0.11	0.55	0.02	
26/11/2024 11:15:00	0.69	0.05	0.05	0.02	0.17	0.16	0.11	0.50	0.07	0.54	0.11	0.53	0.08	
26/11/2024 11:30:00	0.68	0.07	0.05	0.02	0.17	0.16	0.11	0.50	0.07	0.54	0.11	0.51	0.04	
26/11/2024 11:45:00	0.68	0.07	0.05	0.02	0.17	0.16	0.12	0.50	0.06	0.54	0.12	0.49	0.08	
26/11/2024 12:00:00	0.67	0.08	0.05	0.02	0.17	0.16	0.12	0.50	0.06	0.54	0.11	0.48	0.05	
26/11/2024 12:15:00	0.66	0.06	0.05	0.02	0.17	0.17	0.12	0.50	0.07	0.54	0.11	0.47	0.06	
26/11/2024 12:30:00	0.66	0.07	0.05	0.02	0.17	0.17	0.12	0.50	0.06	0.53	0.11	0.46	0.09	
26/11/2024 12:45:00	0.65	0.09	0.05	0.02	0.17	0.17	0.12	0.50	0.06	0.53	0.12	0.45	0.06	
26/11/2024 13:00:00	0.65	0.08	0.05	0.02	0.17	0.17	0.12	0.50	0.06	0.53	0.12	0.44	0.11	
26/11/2024 13:15:00	0.64	0.06	0.05	0.02	0.17	0.17	0.12	0.49	0.06	0.53	0.12	0.44	0.09	
26/11/2024 13:30:00	0.63	0.10	0.05	0.02	0.17	0.17	0.12	0.49	0.06	0.53	0.11	0.43	0.09	
26/11/2024 13:45:00	0.63	0.09	0.05	0.02	0.17	0.17	0.12	0.49	0.06	0.53	0.12	0.42	0.09	
26/11/2024 14:00:00	0.62	0.08	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.53	0.12	0.41	0.10	
26/11/2024 14:15:00	0.62	0.09	0.06	0.03	0.17	0.17	0.12	0.49	0.06	0.53	0.12	0.41	0.11	
26/11/2024 14:30:00	0.61	0.08	0.06	0.03	0.17	0.17	0.12	0.49	0.08	0.52	0.11	0.40	0.10	
26/11/2024 14:45:00	0.61	0.07	0.06	0.03	0.17	0.17	0.12	0.50	0.06	0.52	0.12	0.40	0.11	
26/11/2024 15:00:00	0.60	0.06	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.52	0.12	0.40	0.11	
26/11/2024 15:15:00	0.60	0.09	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.52	0.12	0.40	0.10	
26/11/2024 15:30:00	0.60	0.06	0.06	0.03	0.17	0.17	0.12	0.50	0.08	0.52	0.12	0.40	0.09	
26/11/2024 15:45:00	0.59	0.08	0.06	0.03	0.17	0.17	0.12	0.49	0.06	0.52	0.12	0.42	0.00	
26/11/2024 16:00:00	0.59	0.08	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.12	0.45	0.00	
26/11/2024 16:15:00	0.59	0.08	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.11	0.48	0.00	
26/11/2024 16:30:00	0.58	0.07	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.13	0.50	0.00	
26/11/2024 16:45:00	0.59	0.08	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.12	0.52	0.00	
26/11/2024 17:00:00	0.59	0.06	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.12	0.54	0.00	
26/11/2024 17:15:00	0.59	0.07	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.12	0.55	0.02	
26/11/2024 17:30:00	0.60	0.07	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.12	0.56	0.00	
26/11/2024 17:45:00	0.60	0.07	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.12	0.57	0.00	
26/11/2024 18:00:00	0.61	0.06	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.12	0.58	0.01	
26/11/2024 18:15:00	0.61	0.08	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.13	0.58	0.00	
26/11/2024 18:30:00	0.62	0.06	0.05	0.02	0.17	0.17	0.12	0.49	0.07	0.52	0.13	0.59	0.02	
26/11/2024 18:45:00	0.62	0.07	0.06	0.03	0.17	0.17	0.12	0.49	0.06	0.52	0.12	0.60	0.02	
26/11/2024 19:00:00	0.63	0.05	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.12	0.60	0.02	
26/11/2024 19:15:00	0.63	0.07	0.06	0.03	0.17	0.17	0.12	0.49	0.07	0.52	0.12	0.61	0.00	
26/11/2024 19:30:00	0.64	0.05	0.05	0.02	0.17	0.17	0.12	0.50	0.07	0.52	0.12	0.61	0.01	
26/11/2024 19:45:00	0.64	0.06	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.52	0.12	0.62	0.03	
26/11/2024 20:00:00	0.64	0.06	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.52	0.12	0.62	0.02	
26/11/2024 20:15:00	0.65	0.05	0.05	0.02	0.17	0.17	0.12	0.50	0.07	0.52	0.12	0.62	0.01	
26/11/2024 20:30:00	0.65	0.06	0.05	0.02	0.17	0.17	0.12	0.50	0.07	0.52	0.12	0.63	0.00	
26/11/2024 20:45:00	0.66	0.05	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.52	0.12	0.63	0.03	
26/11/2024 21:00:00	0.66	0.05	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.52	0.12	0.64	0.03	
26/11/2024 21:15:00	0.66	0.05	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.53	0.12	0.64	0.01	
26/11/2024 21:30:00	0.67	0.04	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.53	0.12	0.64	0.03	
26/11/2024 21:45:00	0.67	0.06	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.53	0.11	0.64	0.03	
26/11/2024 22:00:00	0.67	0.06	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.53	0.11	0.64	0.03	
26/11/2024 22:15:00	0.68	0.06	0.06	0.03	0.17	0.17	0.12	0.50	0.08	0.53	0.12	0.65	0.02	
26/11/2024 22:30:00	0.68	0.05	0.06	0.03	0.17	0.17	0.12	0.50	0.08	0.53	0.12	0.65	0.01	
26/11/2024 22:45:00	0.68	0.06	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.53	0.11	0.65	0.02	
26/11/2024 23:00:00	0.68	0.05	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.53	0.11	0.65	0.01	
26/11/2024 23:15:00	0.69	0.04	0.06	0.03	0.17	0.17	0.12	0.50	0.07	0.53	0.11	0.63	0.04	
26/11/2024 23:30:00	0.69	0.06	0.06	0.03	0.18	0.17	0.12	0.50	0.07	0.53	0.12	0.61	0.06	
26/11/2024 23:45:00	0.68	0.05	0.06	0.03	0.18	0.17	0.12	0.50	0.06	0.53	0.11	0.59	0.06	
27/11/2024 00:00:00	0.68	0.06	0.06	0.03	0.18	0.17	0.12	0.50	0.07	0.53	0.12	0.57	0.05	
27/11/2024 00:15:00	0.68	0.06	0.06	0.03	0.18	0.17	0.12	0.50	0.07	0.53	0.12	0.55	0.08	
27/11/2024 00:30:00	0.67	0.07	0.06	0.03	0.18	0.17	0.12	0.49	0.07	0.53	0.11	0.53	0.04	
27/11/2024 00:45:00	0.67	0.07	0.06	0.03	0.18	0.17	0.12	0.49	0.07	0.53	0.12	0.51	0.06	
27/11/2024 01:00:00	0.66	0.06	0.06	0.03	0.18	0.17	0.12	0.49	0.07	0.53	0.11	0.50	0.06	
27/11/2024 01:15:00	0.66	0.06	0.06	0.03	0.18	0.17	0.12	0.49	0.07	0.53	0.11	0.48	0.06	
27/11/2024 01:30:00	0.65	0.07	0.06	0.03	0.18	0.17	0.12	0.49	0.07	0.53	0.11	0.47	0.07	
27/11/2024 01:45:00	0.64	0.09	0.06	0.03	0.18	0.17	0.12	0.49	0.06	0.53	0.11	0.46	0.07	
27/11/2024 02:00:00	0.64	0.06	0.06	0.03	0.18	0.17	0.12	0.48	0.05	0.53	0.12	0.45	0.09	
27/11/2024 02:15:00	0.63	0.08	0.06	0.03	0.18	0.17	0.12	0.48	0.07	0.53	0.11	0.44	0.06	
27/11/2024 02:30:00	0.63	0.07	0.06	0.03	0.18	0.17	0.12	0.48	0.07	0.52	0.11	0.44	0.06	
27/11/2024 02:45:00	0.62	0.06	0.06	0.03	0.18	0.17	0.12	0.47	0.06	0.52	0.11	0.44	0.09	
27/11/2024 03:00:00	0.62	0.07	0.06	0.03	0.18	0.17	0.12	0.48	0.06	0.52	0.07	0.44	0.00	
27/11/2024 03:15:00	0.61	0.08	0.05	0.02	0.18	0.17	0.12	0.48	0.07	0.52	0.10	0.45	0.00	
27/11/2024 03:30:00	0.61	0.05	0.05	0.02	0.18	0.17	0.12	0.48	0.06	0.52	0.08	0.48	0.02	
27/11/2024 03:45:00	0.61	0.08	0.05	0.02	0.18	0.17	0.12	0.49	0.06	0.52	0.07	0.51	0.02	
27/11/2024 04:00:00	0.61	0.07	0.05	0.02	0.18	0.17	0.12	0.49	0.05	0.52	0.11	0.53	0.03	
27/11/2024 04:15:00	0.61	0.06	0.05	0.02	0.18	0.17	0.12	0.49	0.06	0.52	0.09	0.55	0.04	
27/11/2024 04:30:00	0.61	0.05	0.05	0.02	0.18	0.17	0.12	0.50	0.08	0.52	0.09	0.56	0.01	
27/11/2024 04:45:00	0.61	0.07	0.05	0.02	0.18	0.17	0.12	0.51	0.05	0.52	0.09	0.57	0.03	
27/11/2024 05:00:00	0.62	0.06	0.05	0.02	0.18	0.17	0.12	0.52	0.06	0.52	0.08	0.58	0.02	
27/11/2024 05:15:00	0.62	0.06	0.05	0.02	0.18	0.17	0.12	0.54	0.09	0.53	0.09	0.59	0.03	
27/11/2024 05:30:00	0.63	0.06	0.05	0.02	0.18	0.17	0.12	0.56	0.05	0.53	0.10	0.60	0.02	
27/11/2024 05:45:00	0.63	0.06	0.05	0.02	0.18	0.17	0.13	0.57	0.08	0.53	0.09	0.60	0.05	
27/11/2024 06:00:00	0.64	0.05	0.05	0.02	0.18	0.18	0.13	0.58	0.09	0.53	0.08	0.61	0.02	
27/11/2024 06:15:00	0.65	0.05	0.06	0.03	0.19	0.18	0.13	0.60	0.10	0.54	0.10	0.62	0.03	
27/11/2024 06:30:00	0.66	0.06	0.06	0.03	0.20	0.19	0.14	0.61	0.12	0.54	0.10	0.62	0.00	
27/11/2024 06:45:00	0.66	0.05	0.06	0.03	0.20	0.19	0.15	0.64	0.15	0.54	0.10	0.63	0.02	
27/11/2024 07:00:00	0.67	0.06	0.07	0.04	0.22	0.20	0.17	0.66	0.14	0.55	0.09	0.64	0.03	
27/11/2024 07:15:00	0.68	0.05	0.08	0.04	0.23	0.21	0.18	0.69	0.19	0.56	0.10	0.64	0.02	
27/11/2024 07:30:00	0.69	0.05	0.09	0.05	0.25	0.23	0.20	0.79	0.16	0.57	0.11	0.65	0.02	
27/11/2024 07:45:00	0.71	0.07	0.09	0.06	0.26	0.24	0.22	0.84	0.13	0.58	0.11	0.66	0.03	
27/11/2024 08:00:00	0.72	0.07	0.10	0.06	0.28	0.26	0.25	0.86	0.11	0.59	0.13	0.67	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
27/11/2024 08:15:00	0.73	0.07	0.11	0.07	0.34	0.25	0.34	0.85	0.10	0.59	0.13	0.68	0.04	
27/11/2024 08:30:00	0.74	0.08	0.13	0.09	0.37	0.27	0.37	0.80	0.09	0.60	0.13	0.68	0.04	
27/11/2024 08:45:00	0.75	0.06	0.14	0.10	0.38	0.29	0.38	0.77	0.09	0.60	0.13	0.69	0.04	
27/11/2024 09:00:00	0.76	0.07	0.14	0.10	0.38	0.29	0.39	0.76	0.07	0.61	0.13	0.70	0.05	
27/11/2024 09:15:00	0.77	0.09	0.15	0.11	0.38	0.30	0.40	0.75	0.08	0.62	0.14	0.70	0.04	
27/11/2024 09:30:00	0.77	0.09	0.15	0.12	0.38	0.30	0.40	0.77	0.12	0.62	0.15	0.71	0.04	
27/11/2024 09:45:00	0.78	0.07	0.15	0.12	0.38	0.31	0.40	0.79	0.11	0.63	0.15	0.71	0.04	
27/11/2024 10:00:00	0.79	0.07	0.16	0.12	0.38	0.31	0.40	0.78	0.10	0.63	0.13	0.72	0.01	
27/11/2024 10:15:00	0.79	0.08	0.16	0.12	0.39	0.31	0.40	0.76	0.08	0.63	0.16	0.72	0.05	
27/11/2024 10:30:00	0.80	0.07	0.16	0.13	0.39	0.31	0.40	0.74	0.07	0.64	0.13	0.71	0.08	
27/11/2024 10:45:00	0.80	0.09	0.16	0.13	0.39	0.31	0.40	0.72	0.09	0.64	0.14	0.68	0.07	
27/11/2024 11:00:00	0.80	0.07	0.17	0.13	0.39	0.31	0.40	0.71	0.08	0.64	0.12	0.66	0.07	
27/11/2024 11:15:00	0.80	0.08	0.17	0.13	0.39	0.31	0.40	0.71	0.07	0.64	0.14	0.64	0.11	
27/11/2024 11:30:00	0.80	0.08	0.17	0.13	0.38	0.31	0.40	0.70	0.07	0.65	0.12	0.62	0.07	
27/11/2024 11:45:00	0.80	0.08	0.17	0.13	0.38	0.31	0.40	0.70	0.07	0.65	0.12	0.61	0.11	
27/11/2024 12:00:00	0.80	0.10	0.17	0.13	0.38	0.31	0.39	0.69	0.07	0.65	0.14	0.60	0.11	
27/11/2024 12:15:00	0.80	0.08	0.17	0.13	0.38	0.31	0.39	0.69	0.06	0.65	0.12	0.58	0.08	
27/11/2024 12:30:00	0.79	0.11	0.17	0.13	0.38	0.31	0.39	0.68	0.08	0.65	0.12	0.57	0.11	
27/11/2024 12:45:00	0.79	0.11	0.17	0.13	0.38	0.30	0.38	0.68	0.07	0.65	0.13	0.56	0.11	
27/11/2024 13:00:00	0.79	0.08	0.16	0.13	0.37	0.30	0.38	0.68	0.08	0.65	0.12	0.55	0.12	
27/11/2024 13:15:00	0.79	0.08	0.16	0.13	0.37	0.30	0.38	0.68	0.07	0.65	0.15	0.54	0.09	
27/11/2024 13:30:00	0.78	0.09	0.16	0.13	0.37	0.30	0.38	0.67	0.06	0.65	0.15	0.54	0.14	
27/11/2024 13:45:00	0.78	0.09	0.16	0.13	0.37	0.30	0.38	0.67	0.06	0.64	0.11	0.53	0.10	
27/11/2024 14:00:00	0.78	0.09	0.16	0.13	0.37	0.30	0.37	0.67	0.08	0.64	0.13	0.53	0.15	
27/11/2024 14:15:00	0.78	0.12	0.16	0.13	0.37	0.29	0.37	0.67	0.08	0.64	0.12	0.52	0.12	
27/11/2024 14:30:00	0.77	0.09	0.16	0.13	0.37	0.29	0.37	0.67	0.08	0.64	0.13	0.52	0.10	
27/11/2024 14:45:00	0.77	0.09	0.16	0.13	0.37	0.29	0.37	0.67	0.09	0.64	0.13	0.52	0.10	
27/11/2024 15:00:00	0.77	0.08	0.16	0.13	0.37	0.29	0.37	0.67	0.08	0.64	0.12	0.51	0.10	
27/11/2024 15:15:00	0.77	0.10	0.16	0.12	0.36	0.29	0.37	0.67	0.08	0.64	0.13	0.51	0.09	
27/11/2024 15:30:00	0.77	0.11	0.16	0.12	0.36	0.29	0.37	0.67	0.09	0.64	0.12	0.51	0.13	
27/11/2024 15:45:00	0.77	0.12	0.16	0.12	0.36	0.29	0.37	0.67	0.09	0.64	0.13	0.51	0.13	
27/11/2024 16:00:00	0.77	0.08	0.16	0.12	0.36	0.29	0.36	0.67	0.08	0.64	0.12	0.52	0.13	
27/11/2024 16:15:00	0.76	0.10	0.16	0.12	0.36	0.29	0.36	0.67	0.08	0.64	0.13	0.53	0.09	
27/11/2024 16:30:00	0.76	0.11	0.16	0.12	0.36	0.29	0.36	0.67	0.08	0.64	0.16	0.55	0.09	
27/11/2024 16:45:00	0.76	0.10	0.16	0.12	0.36	0.29	0.36	0.68	0.08	0.64	0.13	0.58	0.09	
27/11/2024 17:00:00	0.77	0.09	0.16	0.12	0.36	0.28	0.36	0.68	0.08	0.64	0.13	0.61	0.06	
27/11/2024 17:15:00	0.77	0.08	0.16	0.12	0.36	0.28	0.36	0.68	0.09	0.64	0.13	0.64	0.06	
27/11/2024 17:30:00	0.77	0.11	0.16	0.12	0.36	0.28	0.36	0.68	0.09	0.65	0.13	0.66	0.07	
27/11/2024 17:45:00	0.78	0.09	0.16	0.12	0.36	0.28	0.36	0.68	0.09	0.65	0.12	0.68	0.04	
27/11/2024 18:00:00	0.78	0.07	0.16	0.12	0.36	0.28	0.36	0.68	0.08	0.65	0.13	0.69	0.05	
27/11/2024 18:15:00	0.79	0.09	0.16	0.12	0.36	0.28	0.36	0.68	0.08	0.65	0.15	0.70	0.06	
27/11/2024 18:30:00	0.79	0.08	0.16	0.12	0.36	0.28	0.36	0.68	0.09	0.65	0.13	0.71	0.05	
27/11/2024 18:45:00	0.80	0.07	0.16	0.12	0.36	0.28	0.36	0.68	0.08	0.65	0.13	0.72	0.06	
27/11/2024 19:00:00	0.80	0.08	0.16	0.12	0.36	0.28	0.36	0.68	0.07	0.65	0.14	0.73	0.05	
27/11/2024 19:15:00	0.81	0.07	0.16	0.12	0.36	0.28	0.36	0.68	0.09	0.65	0.13	0.73	0.07	
27/11/2024 19:30:00	0.81	0.07	0.16	0.12	0.36	0.28	0.36	0.68	0.09	0.66	0.13	0.74	0.06	
27/11/2024 19:45:00	0.82	0.08	0.16	0.12	0.36	0.28	0.36	0.68	0.09	0.66	0.13	0.74	0.05	
27/11/2024 20:00:00	0.82	0.08	0.16	0.12	0.36	0.28	0.36	0.68	0.08	0.66	0.14	0.75	0.06	
27/11/2024 20:15:00	0.82	0.05	0.16	0.12	0.36	0.28	0.36	0.68	0.09	0.66	0.12	0.75	0.07	
27/11/2024 20:30:00	0.83	0.07	0.16	0.12	0.36	0.28	0.36	0.68	0.07	0.66	0.12	0.75	0.06	
27/11/2024 20:45:00	0.83	0.07	0.16	0.12	0.36	0.28	0.36	0.68	0.07	0.66	0.13	0.76	0.07	
27/11/2024 21:00:00	0.83	0.07	0.16	0.12	0.36	0.28	0.36	0.68	0.08	0.67	0.13	0.76	0.07	
27/11/2024 21:15:00	0.84	0.09	0.16	0.12	0.36	0.28	0.36	0.68	0.09	0.67	0.12	0.76	0.07	
27/11/2024 21:30:00	0.84	0.07	0.16	0.12	0.36	0.28	0.36	0.68	0.08	0.67	0.12	0.76	0.08	
27/11/2024 21:45:00	0.84	0.06	0.16	0.12	0.36	0.28	0.36	0.68	0.07	0.67	0.12	0.77	0.05	
27/11/2024 22:00:00	0.84	0.05	0.16	0.12	0.36	0.28	0.36	0.68	0.08	0.67	0.12	0.77	0.09	
27/11/2024 22:15:00	0.85	0.08	0.16	0.12	0.36	0.27	0.36	0.67	0.09	0.67	0.12	0.77	0.07	
27/11/2024 22:30:00	0.85	0.09	0.16	0.12	0.36	0.27	0.36	0.67	0.08	0.67	0.12	0.77	0.05	
27/11/2024 22:45:00	0.85	0.09	0.16	0.12	0.36	0.27	0.36	0.67	0.09	0.67	0.11	0.78	0.06	
27/11/2024 23:00:00	0.85	0.07	0.16	0.12	0.36	0.27	0.35	0.67	0.08	0.67	0.12	0.78	0.05	
27/11/2024 23:15:00	0.85	0.08	0.16	0.12	0.36	0.27	0.35	0.67	0.07	0.67	0.12	0.78	0.04	
27/11/2024 23:30:00	0.85	0.08	0.16	0.12	0.36	0.27	0.35	0.67	0.07	0.67	0.13	0.78	0.05	
27/11/2024 23:45:00	0.86	0.06	0.16	0.12	0.35	0.27	0.35	0.67	0.08	0.68	0.12	0.78	0.06	
28/11/2024 00:00:00	0.86	0.07	0.16	0.12	0.35	0.27	0.35	0.67	0.07	0.68	0.12	0.78	0.08	
28/11/2024 00:15:00	0.86	0.07	0.16	0.12	0.35	0.27	0.35	0.67	0.08	0.68	0.12	0.76	0.09	
28/11/2024 00:30:00	0.86	0.07	0.16	0.12	0.35	0.27	0.35	0.67	0.09	0.68	0.12	0.74	0.10	
28/11/2024 00:45:00	0.86	0.08	0.16	0.12	0.35	0.27	0.35	0.67	0.08	0.68	0.12	0.72	0.13	
28/11/2024 01:00:00	0.86	0.07	0.15	0.12	0.35	0.27	0.35	0.66	0.07	0.68	0.12	0.70	0.14	
28/11/2024 01:15:00	0.85	0.07	0.16	0.12	0.35	0.27	0.35	0.66	0.09	0.68	0.12	0.69	0.14	
28/11/2024 01:30:00	0.85	0.09	0.15	0.12	0.35	0.27	0.35	0.66	0.09	0.68	0.11	0.67	0.12	
28/11/2024 01:45:00	0.85	0.07	0.15	0.12	0.35	0.27	0.35	0.66	0.10	0.68	0.12	0.66	0.13	
28/11/2024 02:00:00	0.84	0.09	0.15	0.12	0.35	0.27	0.35	0.67	0.08	0.68	0.11	0.65	0.12	
28/11/2024 02:15:00	0.84	0.07	0.15	0.12	0.35	0.27	0.35	0.66	0.07	0.67	0.11	0.64	0.13	
28/11/2024 02:30:00	0.84	0.09	0.15	0.12	0.35	0.27	0.35	0.66	0.08	0.67	0.13	0.63	0.12	
28/11/2024 02:45:00	0.83	0.10	0.16	0.12	0.35	0.27	0.34	0.66	0.08	0.67	0.12	0.62	0.13	
28/11/2024 03:00:00	0.83	0.10	0.16	0.12	0.35	0.27	0.34	0.66	0.07	0.67	0.11	0.62	0.16	
28/11/2024 03:15:00	0.83	0.11	0.15	0.12	0.34	0.27	0.34	0.65	0.07	0.67	0.12	0.62	0.13	
28/11/2024 03:30:00	0.83	0.09	0.15	0.11	0.34	0.27	0.34	0.65	0.07	0.67	0.13	0.62	0.11	
28/11/2024 03:45:00	0.82	0.11	0.15	0.11	0.34	0.27	0.33	0.65	0.07	0.67	0.12	0.62	0.07	
28/11/2024 04:00:00	0.82	0.11	0.15	0.11	0.34	0.27	0.33	0.65	0.07	0.67	0.13	0.62	0.08	
28/11/2024 04:15:00	0.82	0.09	0.15	0.11	0.34	0.27	0.33	0.65	0.07	0.67	0.13	0.64	0.07	
28/11/2024 04:30:00	0.82	0.10	0.15	0.11	0.34	0.26	0.33	0.65	0.08	0.67	0.13	0.67	0.09	
28/11/2024 04:45:00	0.82	0.09	0.15	0.11	0.34	0.26	0.33	0.65	0.08	0.67	0.12	0.70	0.05	
28/11/2024 05:00:00	0.82	0.09	0.15	0.11	0.34	0.26	0.33	0.64	0.07	0.67	0.13	0.72	0.07	
28/11/2024 05:15:00	0.83	0.05	0.15	0.11	0.34	0.26	0.33	0.64	0.07	0.66	0.13	0.74	0.07	
28/11/2024 05:30:00	0.83	0.08	0.15	0.11	0.34	0.26	0.33	0.64	0.07	0.67	0.12	0.75	0.06	
28/11/2024 05:45:00	0.83	0.08	0.15	0.11	0.34	0.26	0.32	0.64	0.09	0.67	0.13	0.76	0.05	
28/11/2024 06:00:00	0.84	0.08	0.15	0.11	0.34	0.26	0.32	0.64	0.07	0.67	0.13	0.76	0.04	
28/11/2024 06:15:00	0.84	0.06	0.15	0.11	0.33	0.26	0.32	0.64	0.07	0.67	0.12	0.77	0.07	
28/11/2024 06:30:00	0.84	0.10	0.15	0.11	0.33	0.26	0.32	0.63	0.07	0.67	0.13	0.77	0.06	
28/11/2024 06:45:00	0.85	0.05	0.15	0.11	0.33	0.26	0.32	0.63	0.07	0.67	0.13	0.78	0.07	
28/11/2024 07:00:00	0.85	0.10	0.15	0.11	0.33	0.26	0.32	0.63	0.07	0.67	0.12	0.78	0.06	
28/11/2024 07:15:00	0.85	0.06	0.14	0.11	0.33	0.26	0.32	0.63	0.06	0.67	0.11	0.78	0.07	
28/11/2024 07:30:00	0.85	0.07	0.14	0.10	0.33	0.25	0.32	0.63	0.07	0.67	0.12	0.78	0.08	
28/11/2024 07:45:00	0.85	0.05	0.14	0.10	0.33	0.26	0.32	0.63	0.07	0.67	0.12	0.79	0.07	
28/11/2024 08:00:00	0.86	0.08	0.14	0.10	0.33	0.25	0.32	0.63	0.06	0.67	0.12	0.79	0.06	
28/11/2024 08:15:00	0.86	0.06	0.14	0.10	0.33	0.25	0.31	0.63	0.09	0.67	0.12	0.79	0.07	
28/11/2024 08:30:00	0.86	0.09	0.14	0.10	0.33	0.25	0.31	0.62	0.05	0.68	0.12	0.79	0.05	
28/11/2024 08:45:00	0.86	0.09	0.14	0.10	0.33	0.25	0.31	0.62	0.07	0.68	0.12	0.79	0.03	
28/11/2024 09:00:00	0.86	0.05	0.14	0.10	0.33	0.25	0.31	0.62	0.09	0.68	0.12	0.79	0.05	
28/11/2024 09:15:00	0.86	0.06	0.14	0.10	0.33	0.25	0.31	0.62	0.07	0.68	0.12	0.79	0.05	
28/11/2024 09:30:00	0.86	0.09	0.14	0.10	0.32	0.25	0.31	0.62	0.06	0.68	0.12	0.79	0.04	
28/11/2024 09:45:00	0.87	0.08	0.14	0.10	0.32	0.25	0.31	0.62	0.08	0.68	0.11	0.80	0.04	
28/11/2024 10:00:00	0.87	0.06	0.14	0.10	0.32	0.25	0.31	0.62	0.07	0.68	0.11	0.80	0.06	
28/11/2024 10:15:00	0.87	0.07	0.14	0.10	0.32	0.25	0.31	0.62	0.08	0.68	0.11	0.80	0.03	
28/11/2024 10:30:00	0.87	0.07	0.13	0.09	0.32	0.25	0.30	0.62	0.08	0.68	0.11	0.80	0.00	
28/11/2024 10:45:00	0.87	0.08	0.14	0.10	0.32	0.25	0.30	0.61	0.08	0.68	0.11	0.80	0.02	
28/11/2024 11:00:00	0.87	0.08	0.13	0.09	0.32	0.25	0.30	0.61	0.07	0.68	0.11	0.80	0.04	
28/11/2024 11:15:00	0.87	0.05	0.13	0.09	0.32	0.25	0.30	0.61	0.08	0.68	0.12	0.79	0.09	
28/11/2024 11:30:00	0.87	0.05	0.13	0.09	0.32	0.25	0.30	0.61	0.07	0.68	0.12	0.77	0.11	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
28/11/2024 11:45:00	0.87	0.07	0.13	0.09	0.32	0.24	0.30	0.61	0.07	0.68	0.12	0.74	0.14	
28/11/2024 12:00:00	0.87	0.07	0.13	0.09	0.32	0.24	0.30	0.61	0.07	0.68	0.10	0.72	0.09	
28/11/2024 12:15:00	0.86	0.07	0.13	0.09	0.32	0.24	0.30	0.61	0.08	0.68	0.11	0.70	0.14	
28/11/2024 12:30:00	0.86	0.07	0.13	0.09	0.32	0.24	0.29	0.61	0.08	0.68	0.11	0.69	0.13	
28/11/2024 12:45:00	0.86	0.09	0.13	0.09	0.31	0.24	0.29	0.61	0.09	0.68	0.11	0.67	0.14	
28/11/2024 13:00:00	0.85	0.09	0.13	0.09	0.31	0.24	0.29	0.60	0.09	0.68	0.11	0.66	0.15	
28/11/2024 13:15:00	0.85	0.08	0.13	0.09	0.31	0.24	0.29	0.60	0.09	0.68	0.11	0.65	0.10	
28/11/2024 13:30:00	0.84	0.09	0.13	0.09	0.31	0.24	0.29	0.60	0.08	0.67	0.10	0.64	0.16	
28/11/2024 13:45:00	0.84	0.10	0.13	0.09	0.31	0.24	0.29	0.60	0.09	0.67	0.11	0.63	0.16	
28/11/2024 14:00:00	0.84	0.08	0.13	0.09	0.31	0.24	0.29	0.60	0.09	0.67	0.12	0.62	0.11	
28/11/2024 14:15:00	0.84	0.10	0.13	0.09	0.31	0.24	0.29	0.60	0.08	0.67	0.11	0.62	0.17	
28/11/2024 14:30:00	0.83	0.11	0.13	0.09	0.31	0.24	0.29	0.60	0.10	0.67	0.12	0.62	0.17	
28/11/2024 14:45:00	0.83	0.09	0.13	0.09	0.31	0.24	0.29	0.60	0.07	0.67	0.12	0.61	0.14	
28/11/2024 15:00:00	0.83	0.09	0.13	0.09	0.31	0.24	0.28	0.60	0.08	0.67	0.12	0.61	0.10	
28/11/2024 15:15:00	0.82	0.10	0.13	0.09	0.31	0.24	0.28	0.59	0.07	0.66	0.12	0.60	0.15	
28/11/2024 15:30:00	0.82	0.11	0.13	0.09	0.31	0.24	0.28	0.59	0.08	0.66	0.13	0.60	0.13	
28/11/2024 15:45:00	0.82	0.09	0.13	0.08	0.31	0.24	0.28	0.59	0.08	0.66	0.12	0.60	0.07	
28/11/2024 16:00:00	0.81	0.09	0.13	0.08	0.30	0.24	0.28	0.59	0.06	0.66	0.11	0.60	0.14	
28/11/2024 16:15:00	0.81	0.10	0.13	0.09	0.30	0.24	0.28	0.59	0.08	0.66	0.11	0.59	0.12	
28/11/2024 16:30:00	0.81	0.12	0.13	0.08	0.30	0.23	0.28	0.59	0.07	0.66	0.12	0.59	0.13	
28/11/2024 16:45:00	0.81	0.12	0.12	0.08	0.30	0.23	0.28	0.60	0.08	0.66	0.14	0.59	0.15	
28/11/2024 17:00:00	0.80	0.11	0.12	0.08	0.30	0.23	0.28	0.60	0.06	0.66	0.12	0.59	0.11	
28/11/2024 17:15:00	0.80	0.10	0.12	0.08	0.30	0.23	0.28	0.59	0.07	0.65	0.12	0.59	0.10	
28/11/2024 17:30:00	0.80	0.09	0.12	0.08	0.30	0.23	0.27	0.59	0.05	0.65	0.13	0.60	0.11	
28/11/2024 17:45:00	0.80	0.09	0.12	0.08	0.30	0.23	0.27	0.59	0.07	0.65	0.13	0.61	0.10	
28/11/2024 18:00:00	0.80	0.10	0.12	0.08	0.30	0.23	0.27	0.59	0.06	0.65	0.13	0.63	0.06	
28/11/2024 18:15:00	0.80	0.10	0.12	0.08	0.30	0.23	0.27	0.59	0.05	0.65	0.12	0.67	0.06	
28/11/2024 18:30:00	0.80	0.09	0.12	0.08	0.30	0.23	0.27	0.59	0.07	0.65	0.12	0.70	0.06	
28/11/2024 18:45:00	0.80	0.09	0.12	0.08	0.30	0.23	0.27	0.58	0.06	0.65	0.13	0.73	0.05	
28/11/2024 19:00:00	0.81	0.04	0.12	0.08	0.30	0.23	0.27	0.58	0.05	0.65	0.14	0.74	0.02	
28/11/2024 19:15:00	0.81	0.07	0.12	0.08	0.30	0.23	0.27	0.58	0.08	0.65	0.13	0.75	0.03	
28/11/2024 19:30:00	0.82	0.07	0.12	0.08	0.30	0.23	0.27	0.58	0.06	0.65	0.13	0.76	0.03	
28/11/2024 19:45:00	0.82	0.06	0.12	0.08	0.30	0.23	0.27	0.58	0.06	0.65	0.14	0.77	0.03	
28/11/2024 20:00:00	0.83	0.06	0.12	0.08	0.30	0.23	0.27	0.58	0.05	0.66	0.12	0.77	0.04	
28/11/2024 20:15:00	0.83	0.06	0.12	0.08	0.29	0.23	0.27	0.58	0.06	0.66	0.12	0.78	0.05	
28/11/2024 20:30:00	0.83	0.06	0.12	0.08	0.29	0.23	0.27	0.58	0.05	0.66	0.13	0.78	0.03	
28/11/2024 20:45:00	0.84	0.06	0.12	0.07	0.29	0.23	0.27	0.58	0.05	0.66	0.13	0.78	0.06	
28/11/2024 21:00:00	0.84	0.08	0.12	0.08	0.29	0.23	0.26	0.58	0.06	0.66	0.13	0.79	0.05	
28/11/2024 21:15:00	0.84	0.09	0.12	0.07	0.29	0.23	0.26	0.58	0.07	0.66	0.13	0.79	0.04	
28/11/2024 21:30:00	0.84	0.06	0.12	0.07	0.29	0.22	0.26	0.58	0.06	0.66	0.12	0.79	0.04	
28/11/2024 21:45:00	0.85	0.04	0.12	0.07	0.29	0.22	0.26	0.58	0.05	0.66	0.11	0.79	0.06	
28/11/2024 22:00:00	0.85	0.05	0.11	0.07	0.29	0.22	0.26	0.57	0.06	0.66	0.13	0.79	0.05	
28/11/2024 22:15:00	0.85	0.08	0.11	0.07	0.29	0.22	0.26	0.57	0.05	0.67	0.12	0.80	0.01	
28/11/2024 22:30:00	0.85	0.09	0.11	0.07	0.29	0.22	0.26	0.57	0.05	0.67	0.13	0.80	0.04	
28/11/2024 22:45:00	0.85	0.09	0.11	0.07	0.29	0.22	0.26	0.57	0.06	0.67	0.12	0.80	0.05	
28/11/2024 23:00:00	0.86	0.07	0.11	0.07	0.29	0.22	0.26	0.57	0.05	0.67	0.12	0.80	0.06	
28/11/2024 23:15:00	0.86	0.06	0.11	0.07	0.29	0.22	0.26	0.57	0.04	0.67	0.12	0.80	0.03	
28/11/2024 23:30:00	0.86	0.07	0.11	0.07	0.29	0.22	0.26	0.57	0.04	0.67	0.12	0.79	0.06	
28/11/2024 23:45:00	0.86	0.05	0.11	0.07	0.29	0.22	0.25	0.57	0.05	0.67	0.12	0.77	0.11	
29/11/2024 00:00:00	0.86	0.07	0.11	0.07	0.28	0.22	0.25	0.57	0.05	0.67	0.12	0.74	0.11	
29/11/2024 00:15:00	0.85	0.07	0.11	0.07	0.28	0.22	0.25	0.57	0.04	0.67	0.10	0.72	0.12	
29/11/2024 00:30:00	0.85	0.06	0.11	0.07	0.28	0.22	0.25	0.56	0.05	0.67	0.12	0.70	0.13	
29/11/2024 00:45:00	0.85	0.06	0.11	0.07	0.28	0.22	0.25	0.56	0.05	0.67	0.12	0.69	0.11	
29/11/2024 01:00:00	0.84	0.06	0.11	0.07	0.28	0.22	0.25	0.56	0.05	0.67	0.12	0.67	0.11	
29/11/2024 01:15:00	0.84	0.07	0.11	0.07	0.28	0.22	0.25	0.56	0.06	0.66	0.12	0.66	0.12	
29/11/2024 01:30:00	0.84	0.09	0.11	0.07	0.28	0.22	0.25	0.56	0.06	0.66	0.11	0.65	0.12	
29/11/2024 01:45:00	0.83	0.10	0.11	0.07	0.28	0.22	0.25	0.56	0.05	0.66	0.12	0.64	0.11	
29/11/2024 02:00:00	0.83	0.07	0.11	0.07	0.28	0.22	0.24	0.56	0.06	0.66	0.12	0.63	0.13	
29/11/2024 02:15:00	0.82	0.07	0.11	0.07	0.28	0.22	0.24	0.56	0.05	0.66	0.12	0.62	0.13	
29/11/2024 02:30:00	0.82	0.09	0.10	0.06	0.28	0.22	0.24	0.56	0.04	0.66	0.12	0.62	0.08	
29/11/2024 02:45:00	0.82	0.09	0.10	0.06	0.28	0.22	0.24	0.56	0.05	0.66	0.12	0.61	0.13	
29/11/2024 03:00:00	0.81	0.10	0.10	0.06	0.28	0.22	0.24	0.55	0.04	0.65	0.10	0.60	0.15	
29/11/2024 03:15:00	0.81	0.09	0.10	0.06	0.27	0.22	0.24	0.55	0.04	0.65	0.12	0.60	0.13	
29/11/2024 03:30:00	0.81	0.11	0.10	0.06	0.27	0.21	0.24	0.55	0.03	0.65	0.13	0.59	0.11	
29/11/2024 03:45:00	0.80	0.09	0.10	0.06	0.27	0.21	0.24	0.54	0.05	0.65	0.13	0.59	0.11	
29/11/2024 04:00:00	0.80	0.10	0.10	0.06	0.27	0.21	0.24	0.54	0.03	0.65	0.12	0.59	0.09	
29/11/2024 04:15:00	0.80	0.10	0.10	0.06	0.27	0.21	0.23	0.54	0.04	0.65	0.13	0.58	0.10	
29/11/2024 04:30:00	0.79	0.09	0.10	0.06	0.27	0.21	0.23	0.53	0.03	0.65	0.13	0.58	0.15	
29/11/2024 04:45:00	0.79	0.10	0.10	0.06	0.27	0.21	0.23	0.53	0.05	0.64	0.09	0.58	0.10	
29/11/2024 05:00:00	0.79	0.10	0.10	0.06	0.27	0.21	0.23	0.53	0.05	0.64	0.11	0.57	0.13	
29/11/2024 05:15:00	0.79	0.11	0.10	0.06	0.27	0.21	0.23	0.53	0.04	0.64	0.12	0.57	0.09	
29/11/2024 05:30:00	0.78	0.09	0.10	0.06	0.26	0.21	0.23	0.53	0.07	0.64	0.12	0.57	0.13	
29/11/2024 05:45:00	0.78	0.09	0.10	0.06	0.26	0.21	0.22	0.53	0.04	0.64	0.12	0.57	0.08	
29/11/2024 06:00:00	0.78	0.09	0.09	0.05	0.26	0.21	0.22	0.52	0.03	0.64	0.13	0.58	0.13	
29/11/2024 06:15:00	0.78	0.09	0.09	0.05	0.26	0.21	0.22	0.52	0.03	0.64	0.13	0.59	0.08	
29/11/2024 06:30:00	0.77	0.08	0.09	0.05	0.26	0.21	0.22	0.52	0.03	0.64	0.11	0.60	0.10	
29/11/2024 06:45:00	0.77	0.10	0.09	0.05	0.26	0.21	0.22	0.52	0.03	0.64	0.11	0.62	0.04	
29/11/2024 07:00:00	0.77	0.09	0.09	0.05	0.26	0.21	0.22	0.52	0.03	0.64	0.12	0.64	0.05	
29/11/2024 07:15:00	0.77	0.09	0.09	0.05	0.25	0.20	0.21	0.52	0.04	0.64	0.13	0.67	0.04	
29/11/2024 07:30:00	0.78	0.10	0.09	0.05	0.25	0.20	0.21	0.52	0.06	0.64	0.13	0.70	0.05	
29/11/2024 07:45:00	0.78	0.08	0.09	0.05	0.25	0.20	0.21	0.52	0.06	0.64	0.12	0.72	0.04	
29/11/2024 08:00:00	0.79	0.08	0.09	0.05	0.25	0.20	0.21	0.52	0.05	0.64	0.12	0.74	0.02	
29/11/2024 08:15:00	0.79	0.05	0.09	0.05	0.25	0.20	0.21	0.52	0.04	0.64	0.10	0.75	0.03	
29/11/2024 08:30:00	0.80	0.07	0.08	0.05	0.25	0.20	0.21	0.53	0.04	0.64	0.12	0.76	0.04	
29/11/2024 08:45:00	0.81	0.07	0.08	0.05	0.25	0.20	0.20	0.53	0.05	0.64	0.10	0.77	0.04	
29/11/2024 09:00:00	0.81	0.06	0.08	0.05	0.25	0.20	0.20	0.53	0.04	0.64	0.11	0.77	0.01	
29/11/2024 09:15:00	0.82	0.05	0.08	0.05	0.25	0.20	0.20	0.53	0.04	0.64	0.10	0.77	0.02	
29/11/2024 09:30:00	0.82	0.07	0.08	0.05	0.25	0.20	0.20	0.53	0.03	0.65	0.11	0.78	0.04	
29/11/2024 09:45:00	0.82	0.05	0.08	0.05	0.24	0.20	0.20	0.53	0.02	0.65	0.12	0.78	0.04	
29/11/2024 10:00:00	0.83	0.09	0.08	0.05	0.24	0.20	0.20	0.53	0.03	0.65	0.12	0.78	0.06	
29/11/2024 10:15:00	0.83	0.07	0.08	0.04	0.25	0.20	0.20	0.53	0.03	0.65	0.11	0.79	0.05	
29/11/2024 10:30:00	0.83	0.07	0.08	0.04	0.25	0.20	0.20	0.53	0.04	0.65	0.10	0.79	0.06	
29/11/2024 10:45:00	0.83	0.06	0.08	0.05	0.24	0.20	0.20	0.53	0.04	0.65	0.12	0.78	0.11	
29/11/2024 11:00:00	0.83	0.08	0.08	0.04	0.25	0.20	0.20	0.53	0.03	0.65	0.09	0.75	0.09	
29/11/2024 11:15:00	0.83	0.08	0.08	0.04	0.25	0.20	0.20	0.53	0.03	0.66	0.10	0.73	0.12	
29/11/2024 11:30:00	0.83	0.09	0.08	0.04	0.25	0.20	0.20	0.53	0.04	0.66	0.09	0.71	0.13	
29/11/2024 11:45:00	0.83	0.07	0.08	0.05	0.25	0.20	0.20	0.53	0.03	0.65	0.08	0.68	0.13	
29/11/2024 12:00:00	0.82	0.07	0.08	0.05	0.25	0.20	0.20	0.53	0.03	0.65	0.09	0.66	0.14	
29/11/2024 12:15:00	0.82	0.09	0.08	0.05	0.25	0.20	0.20	0.53	0.04	0.65	0.09	0.65	0.14	
29/11/2024 12:30:00	0.81	0.09	0.08	0.04	0.24	0.20	0.20	0.53	0.05	0.65	0.09	0.63	0.11	
29/11/2024 12:45:00	0.81	0.10	0.08	0.04	0.24	0.20	0.20	0.53	0.05	0.65	0.09	0.62	0.12	
29/11/2024 13:00:00	0.80	0.09	0.08	0.04	0.24	0.20	0.20	0.52	0.04	0.65	0.08	0.61	0.13	
29/11/2024 13:15:00	0.80	0.08	0.08	0.04	0.24	0.20	0.20	0.52	0.05	0.65	0.10	0.60	0.11	
29/11/2024 13:30:00	0.80	0.09	0.08	0.04	0.24	0.20	0.20	0.52	0.05	0.65	0.09	0.60	0.10	
29/11/2024 13:45:00	0.79	0.07	0.08	0.04	0.24	0.20	0.20	0.52	0.05	0.64	0.10	0.59	0.14	
29/11/2024 14:00:00	0.79	0.08	0.08	0.04	0.24	0.20	0.20	0.52	0.05	0.64	0.10	0.59	0.13	
29/11/2024 14:15:00	0.78	0.09	0.08	0.04	0.24	0.20	0.20	0.52	0.03	0.64	0.11	0.58	0.10	
29/11/2024 14:30:00	0.78	0.10	0.08	0.04	0.24	0.20	0.20	0.52	0.05	0.64	0.12	0.58	0.16	
29/11/2024 14:45:00	0.78	0.10	0.08	0.04	0.24	0.20	0.20	0.52	0.03	0.64	0.10	0.58	0.09	
29/11/2024 15:00:00	0.77	0.09	0.08	0.04	0.24	0.20	0.20	0.52	0.03	0.64	0.11	0.57	0.14	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
29/11/2024 15:15:00	0.77	0.11	0.08	0.04	0.24	0.20	0.20	0.52	0.05	0.64	0.10	0.57	0.04	
29/11/2024 15:30:00	0.77	0.09	0.08	0.04	0.24	0.20	0.19	0.52	0.05	0.63	0.11	0.57	0.07	
29/11/2024 15:45:00	0.76	0.10	0.08	0.04	0.24	0.20	0.19	0.52	0.04	0.63	0.10	0.56	0.06	
29/11/2024 16:00:00	0.76	0.09	0.08	0.04	0.24	0.20	0.19	0.51	0.05	0.63	0.12	0.56	0.04	
29/11/2024 16:15:00	0.76	0.10	0.08	0.04	0.24	0.20	0.19	0.51	0.06	0.63	0.12	0.55	0.11	
29/11/2024 16:30:00	0.76	0.08	0.08	0.04	0.24	0.19	0.19	0.51	0.04	0.63	0.12	0.55	0.08	
29/11/2024 16:45:00	0.75	0.10	0.08	0.04	0.23	0.19	0.19	0.51	0.06	0.63	0.11	0.55	0.11	
29/11/2024 17:00:00	0.75	0.11	0.08	0.04	0.23	0.19	0.19	0.51	0.04	0.63	0.12	0.55	0.09	
29/11/2024 17:15:00	0.75	0.10	0.08	0.04	0.23	0.19	0.19	0.51	0.05	0.63	0.11	0.55	0.10	
29/11/2024 17:30:00	0.75	0.09	0.08	0.04	0.23	0.19	0.19	0.51	0.04	0.62	0.09	0.54	0.06	
29/11/2024 17:45:00	0.74	0.08	0.07	0.04	0.23	0.19	0.19	0.51	0.05	0.62	0.11	0.55	0.08	
29/11/2024 18:00:00	0.74	0.09	0.07	0.04	0.23	0.19	0.18	0.51	0.05	0.62	0.10	0.55	0.09	
29/11/2024 18:15:00	0.74	0.11	0.07	0.04	0.23	0.19	0.18	0.51	0.05	0.62	0.11	0.56	0.06	
29/11/2024 18:30:00	0.74	0.08	0.07	0.04	0.23	0.19	0.18	0.51	0.05	0.62	0.13	0.57	0.08	
29/11/2024 18:45:00	0.74	0.10	0.07	0.04	0.23	0.19	0.18	0.51	0.05	0.62	0.11	0.60	0.06	
29/11/2024 19:00:00	0.74	0.10	0.07	0.04	0.23	0.19	0.18	0.52	0.05	0.62	0.12	0.64	0.04	
29/11/2024 19:15:00	0.74	0.08	0.07	0.04	0.23	0.19	0.18	0.52	0.05	0.62	0.12	0.68	0.05	
29/11/2024 19:30:00	0.75	0.07	0.07	0.04	0.23	0.19	0.18	0.52	0.05	0.62	0.12	0.70	0.02	
29/11/2024 19:45:00	0.76	0.08	0.07	0.04	0.23	0.19	0.18	0.52	0.03	0.62	0.11	0.72	0.03	
29/11/2024 20:00:00	0.76	0.07	0.07	0.04	0.23	0.19	0.18	0.52	0.03	0.62	0.13	0.73	0.02	
29/11/2024 20:15:00	0.77	0.05	0.07	0.04	0.23	0.19	0.18	0.52	0.04	0.62	0.13	0.74	0.02	
29/11/2024 20:30:00	0.78	0.06	0.07	0.04	0.23	0.19	0.18	0.52	0.07	0.62	0.11	0.75	0.03	
29/11/2024 20:45:00	0.78	0.07	0.07	0.04	0.23	0.19	0.18	0.52	0.09	0.63	0.11	0.76	0.04	
29/11/2024 21:00:00	0.79	0.06	0.07	0.04	0.23	0.19	0.18	0.52	0.06	0.63	0.12	0.76	0.03	
29/11/2024 21:15:00	0.80	0.06	0.07	0.04	0.23	0.19	0.18	0.52	0.06	0.63	0.10	0.77	0.03	
29/11/2024 21:30:00	0.80	0.06	0.07	0.04	0.23	0.19	0.18	0.52	0.09	0.63	0.09	0.77	0.03	
29/11/2024 21:45:00	0.80	0.06	0.07	0.04	0.23	0.19	0.18	0.52	0.07	0.63	0.11	0.77	0.02	
29/11/2024 22:00:00	0.81	0.06	0.07	0.04	0.23	0.19	0.18	0.51	0.06	0.64	0.11	0.78	0.04	
29/11/2024 22:15:00	0.81	0.05	0.07	0.04	0.23	0.19	0.18	0.51	0.05	0.64	0.09	0.78	0.04	
29/11/2024 22:30:00	0.81	0.05	0.07	0.04	0.23	0.19	0.18	0.51	0.06	0.64	0.10	0.78	0.04	
29/11/2024 22:45:00	0.82	0.07	0.07	0.04	0.23	0.19	0.18	0.51	0.08	0.64	0.12	0.78	0.04	
29/11/2024 23:00:00	0.82	0.07	0.07	0.04	0.23	0.19	0.18	0.51	0.08	0.64	0.11	0.79	0.04	
29/11/2024 23:15:00	0.82	0.05	0.07	0.04	0.22	0.19	0.18	0.51	0.07	0.64	0.12	0.79	0.05	
29/11/2024 23:30:00	0.82	0.06	0.07	0.04	0.22	0.19	0.18	0.51	0.04	0.64	0.11	0.79	0.05	
29/11/2024 23:45:00	0.82	0.07	0.07	0.04	0.22	0.19	0.18	0.51	0.08	0.64	0.12	0.78	0.06	
30/11/2024 00:00:00	0.82	0.05	0.07	0.04	0.22	0.19	0.18	0.51	0.07	0.64	0.12	0.75	0.06	
30/11/2024 00:15:00	0.82	0.07	0.07	0.04	0.22	0.19	0.18	0.51	0.10	0.64	0.12	0.73	0.11	
30/11/2024 00:30:00	0.82	0.08	0.07	0.04	0.22	0.19	0.17	0.51	0.08	0.64	0.12	0.71	0.11	
30/11/2024 00:45:00	0.82	0.08	0.07	0.03	0.22	0.19	0.17	0.51	0.08	0.64	0.12	0.68	0.14	
30/11/2024 01:00:00	0.81	0.08	0.07	0.04	0.22	0.19	0.17	0.51	0.07	0.64	0.11	0.67	0.12	
30/11/2024 01:15:00	0.81	0.08	0.07	0.04	0.22	0.19	0.17	0.51	0.07	0.64	0.11	0.65	0.11	
30/11/2024 01:30:00	0.80	0.07	0.07	0.04	0.22	0.19	0.17	0.51	0.06	0.64	0.11	0.64	0.10	
30/11/2024 01:45:00	0.80	0.09	0.07	0.04	0.22	0.19	0.17	0.50	0.05	0.64	0.12	0.63	0.15	
30/11/2024 02:00:00	0.79	0.08	0.07	0.04	0.22	0.19	0.17	0.50	0.04	0.63	0.12	0.62	0.13	
30/11/2024 02:15:00	0.79	0.08	0.07	0.04	0.22	0.19	0.17	0.50	0.03	0.63	0.12	0.61	0.10	
30/11/2024 02:30:00	0.78	0.10	0.07	0.04	0.22	0.19	0.17	0.50	0.03	0.63	0.13	0.60	0.10	
30/11/2024 02:45:00	0.78	0.10	0.07	0.03	0.22	0.19	0.17	0.50	0.04	0.63	0.13	0.59	0.11	
30/11/2024 03:00:00	0.77	0.10	0.07	0.03	0.22	0.19	0.17	0.50	0.04	0.63	0.13	0.58	0.10	
30/11/2024 03:15:00	0.77	0.10	0.07	0.03	0.22	0.19	0.17	0.49	0.05	0.62	0.13	0.58	0.09	
30/11/2024 03:30:00	0.76	0.10	0.07	0.03	0.22	0.19	0.17	0.49		0.62	0.13	0.57	0.08	
30/11/2024 03:45:00	0.76	0.07	0.07	0.03	0.22	0.19	0.17	0.49		0.62	0.13	0.57	0.12	
30/11/2024 04:00:00	0.76	0.08	0.07	0.03	0.22	0.19	0.17	0.49		0.62	0.13	0.57	0.08	
30/11/2024 04:15:00	0.75	0.09	0.07	0.03	0.22	0.19	0.17	0.49		0.62	0.12	0.56	0.11	
30/11/2024 04:30:00	0.75	0.09	0.06	0.03	0.21	0.19	0.16	0.49		0.62	0.13	0.56	0.09	
30/11/2024 04:45:00	0.74	0.10	0.06	0.03	0.21	0.19	0.16	0.49		0.61	0.12	0.55	0.08	
30/11/2024 05:00:00	0.74	0.10	0.06	0.03	0.21	0.19	0.16	0.49		0.61	0.13	0.55	0.10	
30/11/2024 05:15:00	0.74	0.10	0.06	0.03	0.21	0.18	0.16	0.49		0.61	0.14	0.55	0.11	
30/11/2024 05:30:00	0.73	0.08	0.06	0.03	0.21	0.18	0.16	0.48		0.61	0.13	0.54	0.05	
30/11/2024 05:45:00	0.73	0.09	0.06	0.03	0.21	0.18	0.16	0.48		0.61	0.13	0.55	0.08	
30/11/2024 06:00:00	0.73	0.10	0.06	0.03	0.21	0.18	0.16	0.48		0.61	0.13	0.55	0.06	
30/11/2024 06:15:00	0.72	0.09	0.06	0.03	0.21	0.18	0.16	0.48		0.61	0.13	0.56	0.03	
30/11/2024 06:30:00	0.72	0.10	0.06	0.03	0.21	0.18	0.16	0.48		0.60	0.13	0.57	0.01	
30/11/2024 06:45:00	0.72	0.09	0.06	0.03	0.20	0.18	0.15	0.48		0.60	0.14	0.60	0.05	
30/11/2024 07:00:00	0.72	0.08	0.06	0.03	0.20	0.18	0.15	0.48		0.60	0.12	0.63	0.02	
30/11/2024 07:15:00	0.72	0.09	0.06	0.03	0.20	0.18	0.15	0.48	0.04	0.60	0.14	0.67	0.02	
30/11/2024 07:30:00	0.73	0.08	0.06	0.03	0.20	0.18	0.15	0.48	0.05	0.60	0.12	0.70	0.02	
30/11/2024 07:45:00	0.74	0.04	0.06	0.03	0.20	0.18	0.15	0.48	0.04	0.60	0.14	0.71	0.02	
30/11/2024 08:00:00	0.74	0.05	0.06	0.03	0.20	0.18	0.15	0.48	0.05	0.60	0.13	0.73	0.02	
30/11/2024 08:15:00	0.75	0.04	0.05	0.02	0.20	0.18	0.15	0.48	0.05	0.60	0.12	0.73	0.01	
30/11/2024 08:30:00	0.76	0.05	0.05	0.02	0.20	0.18	0.15	0.48	0.05	0.61	0.12	0.74	0.01	
30/11/2024 08:45:00	0.77	0.04	0.05	0.02	0.20	0.18	0.15	0.48	0.05	0.61	0.14	0.75	0.02	
30/11/2024 09:00:00	0.77	0.04	0.05	0.02	0.20	0.18	0.15	0.49	0.05	0.61	0.12	0.75	0.02	
30/11/2024 09:15:00	0.78	0.05	0.05	0.02	0.20	0.18	0.15	0.49	0.05	0.61	0.13	0.76	0.02	
30/11/2024 09:30:00	0.78	0.05	0.05	0.02	0.20	0.18	0.15	0.49	0.05	0.61	0.14	0.76	0.02	
30/11/2024 09:45:00	0.79	0.05	0.05	0.02	0.20	0.18	0.15	0.49	0.05	0.62	0.12	0.76	0.03	
30/11/2024 10:00:00	0.79	0.05	0.05	0.02	0.20	0.18	0.15	0.50	0.05	0.62	0.13	0.77	0.03	
30/11/2024 10:15:00	0.79	0.05	0.05	0.02	0.20	0.18	0.15	0.50	0.05	0.62	0.13	0.77	0.02	
30/11/2024 10:30:00	0.80	0.04	0.05	0.02	0.20	0.18	0.15	0.50	0.05	0.62	0.14	0.77	0.03	
30/11/2024 10:45:00	0.80	0.06	0.05	0.02	0.20	0.18	0.15	0.50	0.05	0.62	0.14	0.77	0.02	
30/11/2024 11:00:00	0.80	0.07	0.05	0.02	0.20	0.18	0.15	0.51	0.05	0.62	0.13	0.78	0.00	
30/11/2024 11:15:00	0.81	0.05	0.05	0.02	0.20	0.18	0.15	0.51	0.05	0.62	0.12	0.78	0.01	
30/11/2024 11:30:00	0.81	0.06	0.05	0.02	0.20	0.18	0.15	0.51	0.05	0.63	0.12	0.78	0.01	
30/11/2024 11:45:00	0.81	0.06	0.05	0.02	0.20	0.18	0.15	0.51	0.05	0.63	0.12	0.78	-0.01	
30/11/2024 12:00:00	0.81	0.07	0.05	0.02	0.20	0.18	0.15	0.51	0.04	0.63	0.12	0.77	0.01	
30/11/2024 12:15:00	0.81	0.06	0.05	0.02	0.20	0.18	0.15	0.51	0.04	0.63	0.12	0.74	0.07	
30/11/2024 12:30:00	0.81	0.05	0.05	0.02	0.20	0.18	0.15	0.51	0.04	0.63	0.12	0.71	0.10	
30/11/2024 12:45:00	0.80	0.06	0.06	0.03	0.20	0.18	0.15	0.51	0.05	0.63	0.12	0.69	0.11	
30/11/2024 13:00:00	0.80	0.06	0.06	0.03	0.20	0.18	0.15	0.51	0.04	0.63	0.12	0.67	0.08	
30/11/2024 13:15:00	0.79	0.05	0.06	0.03	0.20	0.18	0.15	0.51	0.00	0.63	0.12	0.65	0.11	
30/11/2024 13:30:00	0.79	0.08	0.06	0.03	0.20	0.18	0.15	0.51	0.04	0.62	0.12	0.63	0.09	
30/11/2024 13:45:00	0.78	0.06	0.06	0.03	0.21	0.18	0.15	0.51	0.06	0.62	0.12	0.62	0.12	
30/11/2024 14:00:00	0.78	0.06	0.06	0.03	0.21	0.18	0.15	0.51	0.05	0.62	0.12	0.61	0.13	
30/11/2024 14:15:00	0.77	0.06	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.62	0.12	0.60	0.14	
30/11/2024 14:30:00	0.77	0.08	0.06	0.03	0.21	0.19	0.16	0.51	0.05	0.61	0.12	0.59	0.04	
30/11/2024 14:45:00	0.76	0.08	0.06	0.03	0.21	0.19	0.16	0.51	0.04	0.61	0.12	0.58	0.16	
30/11/2024 15:00:00	0.76	0.08	0.06	0.03	0.21	0.19	0.16	0.51	0.05	0.61	0.12	0.58	0.05	
30/11/2024 15:15:00	0.75	0.06	0.06	0.03	0.21	0.19	0.16	0.51	0.05	0.61	0.13	0.57	0.08	
30/11/2024 15:30:00	0.75	0.09	0.06	0.03	0.21	0.19	0.16	0.51	0.04	0.61	0.13	0.57	0.05	
30/11/2024 15:45:00	0.74	0.09	0.06	0.03	0.21	0.19	0.16	0.51	0.05	0.60	0.13	0.56	0.10	
30/11/2024 16:00:00	0.74	0.09	0.06	0.03	0.21	0.19	0.16	0.51	0.07	0.60	0.14	0.56	0.00	
30/11/2024 16:15:00	0.73	0.09	0.06	0.03	0.21	0.19	0.16	0.51	0.08	0.60	0.14	0.55	0.07	
30/11/2024 16:30:00	0.73	0.09	0.06	0.03	0.21	0.19	0.16	0.51	0.07	0.60	0.11	0.55	0.09	
30/11/2024 16:45:00	0.72	0.09	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.60	0.14	0.54	0.10	
30/11/2024 17:00:00	0.72	0.07	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.60	0.12	0.54	0.11	
30/11/2024 17:15:00	0.72	0.09	0.06	0.03	0.21	0.19	0.16	0.51	0.07	0.60	0.14	0.54	0.11	
30/11/2024 17:30:00	0.71	0.10	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.59	0.13	0.54	0.08	
30/11/2024 17:45:00	0.71	0.09	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.59	0.11	0.54	0.06	
30/11/2024 18:00:00	0.71	0.10	0.07	0.03	0.21	0.19	0.16	0.51	0.07	0.59	0.11	0.55	0.10	
30/11/2024 18:15:00	0.70	0.08	0.06	0.03	0.21	0.19	0.16	0.51	0.05	0.59	0.13	0.57	0.07	
30/11/2024 18:30:00	0.70	0.08	0.06	0.03	0.21	0.19	0.16	0.51	0.08	0.59	0.12	0.61	0.04	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
30/11/2024 18:45:00	0.70	0.07	0.06	0.03	0.21	0.19	0.16	0.51	0.05	0.59	0.12	0.65	0.01	
30/11/2024 19:00:00	0.71	0.06	0.06	0.03	0.21	0.19	0.16	0.51	0.04	0.59	0.13	0.68	0.01	
30/11/2024 19:15:00	0.72	0.04	0.06	0.03	0.21	0.19	0.16	0.51	0.07	0.59	0.13	0.70	0.00	
30/11/2024 19:30:00	0.73	0.05	0.06	0.03	0.21	0.19	0.16	0.51	0.07	0.59	0.12	0.71	0.00	
30/11/2024 19:45:00	0.73	0.05	0.06	0.03	0.21	0.19	0.16	0.51	0.05	0.59	0.12	0.73	-0.01	
30/11/2024 20:00:00	0.74	0.06	0.06	0.03	0.21	0.19	0.16	0.51	0.04	0.59	0.11	0.74	0.00	
30/11/2024 20:15:00	0.75	0.06	0.06	0.03	0.21	0.19	0.16	0.51	0.04	0.59	0.11	0.74	0.00	
30/11/2024 20:30:00	0.76	0.05	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.60	0.12	0.75	0.02	
30/11/2024 20:45:00	0.76	0.05	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.60	0.11	0.75	0.02	
30/11/2024 21:00:00	0.77	0.04	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.60	0.12	0.75	0.02	
30/11/2024 21:15:00	0.77	0.04	0.06	0.03	0.21	0.19	0.16	0.51	0.05	0.60	0.13	0.76	0.02	
30/11/2024 21:30:00	0.78	0.07	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.60	0.12	0.76	0.02	
30/11/2024 21:45:00	0.78	0.05	0.06	0.03	0.21	0.19	0.16	0.51	0.08	0.61	0.12	0.76	0.02	
30/11/2024 22:00:00	0.78	0.05	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.61	0.11	0.77	0.02	
30/11/2024 22:15:00	0.79	0.06	0.06	0.03	0.21	0.19	0.16	0.51	0.05	0.61	0.12	0.77	0.04	
30/11/2024 22:30:00	0.79	0.06	0.06	0.03	0.21	0.19	0.16	0.51	0.04	0.61	0.12	0.77	0.03	
30/11/2024 22:45:00	0.79	0.05	0.06	0.03	0.21	0.19	0.16	0.51	0.04	0.61	0.12	0.77	0.03	
30/11/2024 23:00:00	0.80	0.05	0.06	0.03	0.21	0.19	0.16	0.51	0.04	0.61	0.12	0.77	0.03	
30/11/2024 23:15:00	0.80	0.04	0.06	0.03	0.21	0.19	0.16	0.51	0.06	0.61	0.12	0.78	0.03	
30/11/2024 23:30:00	0.80	0.05	0.06	0.03	0.21	0.19	0.16	0.51	0.07	0.62	0.11	0.78	0.03	
30/11/2024 23:45:00	0.80	0.04	0.06	0.03	0.21	0.19	0.16	0.51	0.07	0.62	0.11	0.78	0.03	
01/12/2024 00:00:00	0.80	0.04	0.06	0.03	0.21	0.19	0.16	0.50	0.04	0.62	0.10	0.78	0.02	
01/12/2024 00:15:00	0.80	0.05	0.06	0.03	0.21	0.19	0.16	0.50	0.05	0.62	0.11	0.78	0.02	
01/12/2024 00:30:00	0.81	0.04	0.06	0.03	0.21	0.19	0.16	0.50	0.06	0.62	0.11	0.78	0.03	
01/12/2024 00:45:00	0.81	0.06	0.06	0.03	0.21	0.19	0.16	0.50	0.07	0.62	0.11	0.78	0.02	
01/12/2024 01:00:00	0.81	0.05	0.06	0.03	0.21	0.19	0.16	0.50	0.04	0.62	0.11	0.76	0.07	
01/12/2024 01:15:00	0.81	0.07	0.06	0.03	0.21	0.19	0.16	0.50	0.06	0.62	0.10	0.73	0.09	
01/12/2024 01:30:00	0.80	0.07	0.06	0.03	0.21	0.19	0.16	0.50	0.04	0.62	0.08	0.71	0.10	
01/12/2024 01:45:00	0.80	0.07	0.06	0.03	0.21	0.19	0.16	0.50	0.04	0.62	0.11	0.68	0.12	
01/12/2024 02:00:00	0.79	0.06	0.06	0.03	0.21	0.19	0.16	0.50	0.04	0.62	0.10	0.67	0.11	
01/12/2024 02:15:00	0.78	0.08	0.06	0.03	0.21	0.19	0.16	0.50	0.04	0.62	0.11	0.65	0.11	
01/12/2024 02:30:00	0.78	0.08	0.06	0.03	0.20	0.19	0.15	0.49	0.04	0.61	0.11	0.63	0.13	
01/12/2024 02:45:00	0.77	0.07	0.06	0.03	0.20	0.19	0.15	0.49	0.05	0.61	0.04	0.62	0.11	
01/12/2024 03:00:00	0.77	0.09	0.06	0.03	0.20	0.19	0.15	0.49	0.05	0.61	0.11	0.61	0.10	
01/12/2024 03:15:00	0.76	0.09	0.06	0.03	0.20	0.19	0.15	0.49	0.06	0.61	0.10	0.60	0.12	
01/12/2024 03:30:00	0.75	0.09	0.06	0.03	0.20	0.19	0.15	0.49	0.06	0.61	0.11	0.59	0.14	
01/12/2024 03:45:00	0.75	0.07	0.06	0.03	0.20	0.19	0.15	0.49	0.06	0.60	0.06	0.58	0.10	
01/12/2024 04:00:00	0.74	0.09	0.06	0.03	0.20	0.19	0.15	0.49	0.05	0.60	0.10	0.57	0.09	
01/12/2024 04:15:00	0.74	0.07	0.06	0.03	0.20	0.19	0.15	0.49	0.04	0.60	0.11	0.57	0.11	
01/12/2024 04:30:00	0.73	0.08	0.06	0.03	0.20	0.19	0.15	0.49	0.04	0.60	0.12	0.56	0.10	
01/12/2024 04:45:00	0.73	0.08	0.05	0.02	0.20	0.20	0.15	0.48	0.03	0.60	0.10	0.55	0.07	
01/12/2024 05:00:00	0.72	0.08	0.05	0.02	0.20	0.19	0.15	0.48	0.02	0.59	0.11	0.55	0.07	
01/12/2024 05:15:00	0.72	0.09	0.05	0.02	0.20	0.20	0.15	0.48	0.02	0.59	0.13	0.54	0.10	
01/12/2024 05:30:00	0.71	0.07	0.05	0.02	0.20	0.19	0.14	0.48	0.01	0.59	0.13	0.54	0.08	
01/12/2024 05:45:00	0.71	0.09	0.05	0.02	0.20	0.19	0.14	0.48	0.01	0.59	0.11	0.54	0.08	
01/12/2024 06:00:00	0.71	0.09	0.05	0.02	0.20	0.19	0.14	0.48	0.00	0.59	0.10	0.53	0.07	
01/12/2024 06:15:00	0.70	0.09	0.05	0.02	0.20	0.19	0.14	0.48	0.01	0.59	0.09	0.53	0.07	
01/12/2024 06:30:00	0.70	0.09	0.05	0.02	0.20	0.19	0.14	0.48	0.02	0.58	0.02	0.53	0.06	
01/12/2024 06:45:00	0.70	0.08	0.05	0.02	0.19	0.19	0.14	0.48	0.03	0.58	0.02	0.54	0.08	
01/12/2024 07:00:00	0.69	0.09	0.05	0.02	0.19	0.19	0.14	0.48	0.04	0.58	0.08	0.55	0.07	
01/12/2024 07:15:00	0.69	0.08	0.05	0.02	0.19	0.19	0.14	0.48	0.05	0.58	0.08	0.56	0.03	
01/12/2024 07:30:00	0.69	0.08	0.05	0.02	0.19	0.19	0.14	0.48	0.05	0.58	0.08	0.60	0.04	
01/12/2024 07:45:00	0.69	0.08	0.05	0.02	0.19	0.19	0.14	0.48	0.05	0.58	0.10	0.64	0.02	
01/12/2024 08:00:00	0.69	0.08	0.05	0.02	0.19	0.19	0.14	0.48	0.05	0.58	0.13	0.67	0.00	
01/12/2024 08:15:00	0.70	0.06	0.05	0.02	0.19	0.19	0.14	0.49	0.05	0.58	0.10	0.69	0.07	
01/12/2024 08:30:00	0.71	0.04	0.05	0.02	0.19	0.18	0.14	0.49	0.04	0.58	0.05	0.71	-0.01	
01/12/2024 08:45:00	0.72	0.05	0.05	0.02	0.19	0.18	0.14	0.49	0.06	0.58	0.01	0.72	0.02	
01/12/2024 09:00:00	0.73	0.05	0.05	0.02	0.19	0.18	0.14	0.49	0.05	0.58	0.03	0.73	0.02	
01/12/2024 09:15:00	0.74	0.04	0.05	0.02	0.19	0.18	0.14	0.49	0.05	0.58	0.04	0.73	0.02	
01/12/2024 09:30:00	0.75	0.04	0.05	0.02	0.19	0.18	0.14	0.49	0.03	0.59	0.01	0.74	0.02	
01/12/2024 09:45:00	0.75	0.05	0.05	0.02	0.19	0.18	0.14	0.49	0.03	0.59	0.02	0.74	0.01	
01/12/2024 10:00:00	0.76	0.03	0.05	0.02	0.19	0.18	0.14	0.50	0.04	0.59	0.02	0.75	0.02	
01/12/2024 10:15:00	0.76	0.05	0.05	0.02	0.19	0.18	0.14	0.50	0.05	0.59	0.08	0.75	0.02	
01/12/2024 10:30:00	0.77	0.04	0.05	0.02	0.19	0.18	0.14	0.50	0.07	0.59	0.06	0.76	0.02	
01/12/2024 10:45:00	0.77	0.04	0.05	0.02	0.19	0.18	0.14	0.50	0.07	0.60	0.04	0.76	0.01	
01/12/2024 11:00:00	0.78	0.05	0.05	0.02	0.19	0.18	0.14	0.51	0.06	0.60	0.06	0.76	0.03	
01/12/2024 11:15:00	0.78	0.05	0.05	0.02	0.19	0.18	0.14	0.51	0.05	0.60	0.08	0.76	0.01	
01/12/2024 11:30:00	0.78	0.05	0.05	0.02	0.19	0.19	0.14	0.51	0.06	0.60	0.12	0.77	0.02	
01/12/2024 11:45:00	0.78	0.06	0.05	0.02	0.19	0.19	0.14	0.51	0.05	0.60	0.12	0.77	0.03	
01/12/2024 12:00:00	0.79	0.05	0.05	0.02	0.19	0.19	0.14	0.51	0.06	0.60	0.11	0.77	0.03	
01/12/2024 12:15:00	0.79	0.05	0.05	0.02	0.19	0.19	0.14	0.51	0.09	0.60	0.11	0.76	0.05	
01/12/2024 12:30:00	0.79	0.05	0.05	0.02	0.19	0.19	0.14	0.51	0.07	0.60	0.09	0.73	0.08	
01/12/2024 12:45:00	0.78	0.06	0.05	0.02	0.20	0.19	0.14	0.51	0.06	0.61	0.12	0.70	0.12	
01/12/2024 13:00:00	0.78	0.07	0.05	0.02	0.20	0.19	0.15	0.52	0.06	0.60	0.10	0.68	0.13	
01/12/2024 13:15:00	0.77	0.08	0.06	0.03	0.20	0.19	0.15	0.52	0.08	0.60	0.11	0.65	0.12	
01/12/2024 13:30:00	0.77	0.07	0.06	0.03	0.20	0.19	0.15	0.52	0.07	0.60	0.11	0.63	0.12	
01/12/2024 13:45:00	0.76	0.07	0.06	0.03	0.20	0.19	0.15	0.51	0.08	0.60	0.11	0.62	0.04	
01/12/2024 14:00:00	0.76	0.08	0.06	0.03	0.20	0.19	0.15	0.52	0.07	0.60	0.11	0.60	0.14	
01/12/2024 14:15:00	0.75	0.07	0.06	0.03	0.20	0.19	0.15	0.52	0.08	0.60	0.11	0.59	0.11	
01/12/2024 14:30:00	0.74	0.08	0.06	0.03	0.20	0.19	0.15	0.52	0.08	0.59	0.09	0.58	0.11	
01/12/2024 14:45:00	0.74	0.09	0.06	0.03	0.20	0.19	0.15	0.52	0.05	0.59	0.12	0.57	0.11	
01/12/2024 15:00:00	0.73	0.09	0.06	0.03	0.20	0.19	0.15	0.52	0.04	0.59	0.12	0.56	0.10	
01/12/2024 15:15:00	0.73	0.09	0.06	0.03	0.21	0.20	0.16	0.52	0.05	0.59	0.10	0.56	0.10	
01/12/2024 15:30:00	0.72	0.10	0.06	0.03	0.21	0.20	0.16	0.53	0.04	0.59	0.11	0.55	0.05	
01/12/2024 15:45:00	0.72	0.09	0.06	0.03	0.21	0.20	0.16	0.54	0.05	0.59	0.10	0.55	0.11	
01/12/2024 16:00:00	0.71	0.08	0.06	0.03	0.21	0.20	0.16	0.55	0.04	0.58	0.11	0.54	0.08	
01/12/2024 16:15:00	0.71	0.09	0.06	0.03	0.21	0.20	0.16	0.55	0.02	0.58	0.10	0.53	0.05	
01/12/2024 16:30:00	0.70	0.09	0.06	0.03	0.21	0.20	0.16	0.55	0.01	0.58	0.11	0.53	0.09	
01/12/2024 16:45:00	0.70	0.09	0.06	0.03	0.21	0.20	0.16	0.55	0.01	0.58	0.11	0.52	0.09	
01/12/2024 17:00:00	0.69	0.09	0.07	0.03	0.22	0.20	0.17	0.55	0.00	0.58	0.12	0.52	0.09	
01/12/2024 17:15:00	0.69	0.08	0.07	0.04	0.22	0.20	0.17	0.54	0.00	0.58	0.12	0.52	0.05	
01/12/2024 17:30:00	0.68	0.09	0.07	0.04	0.22	0.20	0.17	0.54	0.00	0.58	0.13	0.51	0.07	
01/12/2024 17:45:00	0.68	0.07	0.07	0.04	0.22	0.20	0.18	0.54	0.02	0.57	0.11	0.51	0.09	
01/12/2024 18:00:00	0.68	0.08	0.07	0.04	0.22	0.21	0.18	0.54	0.00	0.57	0.12	0.51	0.09	
01/12/2024 18:15:00	0.67	0.08	0.07	0.04	0.23	0.21	0.18	0.54	0.04	0.57	0.12	0.52	0.12	
01/12/2024 18:30:00	0.67	0.09	0.08	0.04	0.23	0.21	0.18	0.54	0.02	0.57	0.13	0.54	0.02	
01/12/2024 18:45:00	0.67	0.09	0.08	0.04	0.23	0.21	0.18	0.54	0.00	0.57	0.13	0.57	0.04	
01/12/2024 19:00:00	0.67	0.08	0.08	0.04	0.23	0.21	0.18	0.54	0.02	0.57	0.13	0.61	0.03	
01/12/2024 19:15:00	0.67	0.07	0.08	0.04	0.23	0.21	0.18	0.53	0.02	0.57	0.13	0.65		
01/12/2024 19:30:00	0.68	0.06	0.08	0.04	0.23	0.21	0.18	0.53	-0.02	0.57	0.14	0.67	0.01	
01/12/2024 19:45:00	0.69	0.05	0.08	0.04	0.23	0.21	0.18	0.53	0.03	0.57	0.14	0.69	0.00	
01/12/2024 20:00:00	0.70	0.05	0.08	0.04	0.23	0.21	0.18	0.53	0.04	0.57	0.13	0.70	0.00	
01/12/2024 20:15:00	0.71	0.04	0.08	0.04	0.23	0.21	0.18	0.53	0.03	0.57	0.13	0.71	-0.01	
01/12/2024 20:30:00	0.72	0.04	0.08	0.04	0.23	0.21	0.18	0.53	0.00	0.57	0.12	0.72	0.01	
01/12/2024 20:45:00	0.73	0.06	0.08	0.04	0.23	0.21	0.18	0.53	0.01	0.57	0.12	0.73	0.01	
01/12/2024 21:00:00	0.73	0.04	0.08	0.04	0.23	0.21	0.18	0.53	0.03	0.58	0.13	0.73	0.01	
01/12/2024 21:15:00	0.74	0.03	0.08	0.04	0.23	0.21	0.18	0.53	0.02	0.58	0.13	0.74	0.00	
01/12/2024 21:30:00	0.75	0.05	0.08	0.04	0.23	0.21	0.18	0.53	0.00	0.58	0.13	0.74	0.03	
01/12/2024 21:45:00	0.75	0.05	0.08	0.04	0.23	0.21	0.18	0.52	0.04	0.58	0.12	0.75	0.02	
01/12/2024 22:00:00	0.76	0.05	0.08	0.04	0.23	0.21	0.18	0.52	0.03	0.58	0.12	0.75	0.00	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
01/12/2024 22:15:00	0.76	0.05	0.07	0.04	0.23	0.21	0.18	0.52	0.02	0.59	0.12	0.75	0.02	
01/12/2024 22:30:00	0.76	0.05	0.07	0.04	0.23	0.20	0.18	0.52	0.03	0.59	0.12	0.76	0.04	
01/12/2024 22:45:00	0.77	0.05	0.07	0.04	0.23	0.20	0.18	0.52	0.04	0.59	0.12	0.76	0.02	
01/12/2024 23:00:00	0.77	0.04	0.07	0.04	0.23	0.20	0.18	0.53	0.05	0.59	0.12	0.76	0.00	
01/12/2024 23:15:00	0.77	0.05	0.07	0.04	0.23	0.20	0.18	0.53	0.03	0.59	0.11	0.76	0.01	
01/12/2024 23:30:00	0.78	0.05	0.07	0.04	0.22	0.20	0.18	0.53		0.59	0.11	0.76	0.02	
01/12/2024 23:45:00	0.78	0.05	0.07	0.04	0.22	0.20	0.18	0.52		0.60	0.11	0.77	0.03	
02/12/2024 00:00:00	0.78	0.05	0.07	0.04	0.22	0.20	0.18	0.52		0.60	0.12	0.77	0.02	
02/12/2024 00:15:00	0.78	0.05	0.07	0.04	0.22	0.20	0.18	0.52		0.60	0.12	0.77	0.01	
02/12/2024 00:30:00	0.78	0.04	0.07	0.04	0.22	0.20	0.18	0.52		0.60	0.12	0.77	0.01	
02/12/2024 00:45:00	0.79	0.04	0.07	0.04	0.22	0.20	0.17	0.52		0.60	0.12	0.77	0.03	
02/12/2024 01:00:00	0.79	0.06	0.07	0.04	0.22	0.20	0.17	0.51		0.60	0.12	0.77	0.02	
02/12/2024 01:15:00	0.79	0.06	0.07	0.04	0.22	0.20	0.17	0.51		0.60	0.12	0.77	0.03	
02/12/2024 01:30:00	0.79	0.06	0.07	0.04	0.22	0.20	0.17	0.51	0.03	0.60	0.11	0.78	0.02	
02/12/2024 01:45:00	0.79	0.05	0.07	0.04	0.22	0.20	0.17	0.51	0.00	0.60	0.11	0.78	0.01	
02/12/2024 02:00:00	0.79	0.05	0.07	0.04	0.22	0.20	0.17	0.51		0.60	0.11	0.75	0.02	
02/12/2024 02:15:00	0.79	0.05	0.07	0.04	0.22	0.20	0.17	0.50		0.61	0.11	0.73	0.12	
02/12/2024 02:30:00	0.78	0.07	0.07	0.04	0.22	0.20	0.17	0.50		0.60	0.11	0.71	0.11	
02/12/2024 02:45:00	0.78	0.07	0.07	0.03	0.21	0.20	0.17	0.50		0.60	0.11	0.68	0.09	
02/12/2024 03:00:00	0.77	0.07	0.07	0.03	0.21	0.20	0.16	0.50		0.60	0.11	0.66	0.10	
02/12/2024 03:15:00	0.77	0.07	0.07	0.03	0.21	0.20	0.16	0.50		0.60	0.11	0.65	0.10	
02/12/2024 03:30:00	0.76	0.07	0.07	0.03	0.21	0.20	0.16	0.50		0.60	0.11	0.63	0.14	
02/12/2024 03:45:00	0.76	0.07	0.06	0.03	0.21	0.20	0.16	0.50		0.60	0.11	0.62	0.12	
02/12/2024 04:00:00	0.75	0.07	0.06	0.03	0.21	0.20	0.16	0.49		0.59	0.11	0.60	0.14	
02/12/2024 04:15:00	0.74	0.07	0.06	0.03	0.21	0.20	0.16	0.49		0.59	0.12	0.59	0.09	
02/12/2024 04:30:00	0.74	0.08	0.06	0.03	0.21	0.20	0.16	0.49		0.59	0.11	0.58	0.10	
02/12/2024 04:45:00	0.73	0.05	0.06	0.03	0.21	0.20	0.16	0.49		0.59	0.11	0.57	0.05	
02/12/2024 05:00:00	0.72	0.06	0.06	0.03	0.21	0.20	0.16	0.49		0.58	0.10	0.56	0.07	
02/12/2024 05:15:00	0.72	0.08	0.06	0.03	0.20	0.20	0.15	0.49		0.58	0.11	0.56	0.04	
02/12/2024 05:30:00	0.71	0.06	0.06	0.03	0.20	0.20	0.15	0.49		0.58	0.12	0.55	0.05	
02/12/2024 05:45:00	0.71	0.09	0.06	0.03	0.20	0.20	0.15	0.49		0.58	0.11	0.54	0.11	
02/12/2024 06:00:00	0.70	0.07	0.06	0.03	0.20	0.20	0.15	0.49		0.58	0.11	0.55	0.05	
02/12/2024 06:15:00	0.70	0.06	0.06	0.03	0.20	0.20	0.15	0.49		0.57	0.12	0.55	0.05	
02/12/2024 06:30:00	0.69	0.09	0.06	0.03	0.20	0.20	0.15	0.49	0.05	0.57	0.13	0.57	0.04	
02/12/2024 06:45:00	0.69	0.06	0.06	0.03	0.20	0.20	0.15	0.49	0.05	0.57	0.11	0.60	0.03	
02/12/2024 07:00:00	0.69	0.07	0.06	0.03	0.20	0.20	0.15	0.49	0.05	0.57	0.12	0.65	0.01	
02/12/2024 07:15:00	0.69	0.08	0.06	0.03	0.20	0.19	0.14	0.49	0.03	0.57	0.14	0.68	0.01	
02/12/2024 07:30:00	0.70	0.05	0.06	0.03	0.20	0.19	0.14	0.49	0.04	0.57	0.13	0.70	-0.01	
02/12/2024 07:45:00	0.71	0.04	0.06	0.03	0.20	0.19	0.14	0.49	0.03	0.57	0.12	0.71	0.00	
02/12/2024 08:00:00	0.72	0.05	0.05	0.02	0.19	0.19	0.14	0.49	0.02	0.57	0.12	0.72	0.01	
02/12/2024 08:15:00	0.73	0.04	0.06	0.03	0.19	0.19	0.14	0.49	0.02	0.57	0.13	0.73	0.01	
02/12/2024 08:30:00	0.73	0.04	0.05	0.02	0.19	0.19	0.14	0.49	0.03	0.57	0.13	0.74	0.02	
02/12/2024 08:45:00	0.74	0.04	0.05	0.02	0.19	0.19	0.14	0.50	0.04	0.57	0.11	0.74	0.01	
02/12/2024 09:00:00	0.75	0.04	0.05	0.02	0.19	0.19	0.14	0.50	0.04	0.58	0.12	0.74	0.01	
02/12/2024 09:15:00	0.75	0.05	0.05	0.02	0.19	0.19	0.14	0.50	0.04	0.58	0.12	0.75	0.02	
02/12/2024 09:30:00	0.76	0.04	0.05	0.02	0.19	0.19	0.14	0.50	0.04	0.58	0.12	0.75	0.01	
02/12/2024 09:45:00	0.76	0.04	0.05	0.02	0.19	0.19	0.14	0.51	0.04	0.58	0.11	0.75	0.00	
02/12/2024 10:00:00	0.76	0.03	0.05	0.02	0.19	0.19	0.14	0.51	0.03	0.58	0.12	0.76	0.00	
02/12/2024 10:15:00	0.77	0.00	0.05	0.02	0.19	0.19	0.14	0.51	0.03	0.59	0.12	0.76	0.00	
02/12/2024 10:30:00	0.77	0.05	0.05	0.02	0.19	0.19	0.14	0.51	0.02	0.59	0.11	0.76	0.03	
02/12/2024 10:45:00	0.77	0.04	0.05	0.02	0.19	0.19	0.14	0.51	0.02	0.59	0.11	0.76	0.03	
02/12/2024 11:00:00	0.77	0.05	0.05	0.02	0.19	0.19	0.14	0.51	0.03	0.59	0.11	0.77	0.01	
02/12/2024 11:15:00	0.78	0.03	0.05	0.02	0.19	0.19	0.14	0.51	0.02	0.59	0.11	0.77	0.03	
02/12/2024 11:30:00	0.78	0.05	0.05	0.02	0.19	0.19	0.14	0.51	0.01	0.59	0.10	0.77	0.02	
02/12/2024 11:45:00	0.78	0.05	0.05	0.02	0.20	0.19	0.14	0.51	0.02	0.60	0.10	0.77	-0.01	
02/12/2024 12:00:00	0.79	0.06	0.06	0.03	0.20	0.19	0.14	0.51	0.03	0.60	0.10	0.77	0.02	
02/12/2024 12:15:00	0.79	0.06	0.06	0.03	0.20	0.19	0.14	0.51	0.01	0.60	0.11	0.77	0.01	
02/12/2024 12:30:00	0.80	0.04	0.06	0.03	0.20	0.19	0.15	0.51	0.01	0.60	0.10	0.78	0.01	
02/12/2024 12:45:00	0.80	0.04	0.06	0.03	0.20	0.19	0.15	0.51	0.03	0.60	0.10	0.78	0.03	
02/12/2024 13:00:00	0.80	0.03	0.06	0.03	0.20	0.19	0.15	0.51	0.00	0.61	0.10	0.78	0.03	
02/12/2024 13:15:00	0.80	0.04	0.06	0.03	0.20	0.19	0.15	0.51	0.02	0.61	0.10	0.78	0.03	
02/12/2024 13:30:00	0.81	0.05	0.06	0.03	0.20	0.19	0.15	0.51	0.02	0.61	0.10	0.78	0.02	
02/12/2024 13:45:00	0.81	0.06	0.06	0.03	0.20	0.19	0.15	0.51	0.03	0.61	0.10	0.78	0.03	
02/12/2024 14:00:00	0.81	0.05	0.06	0.03	0.20	0.19	0.15	0.51	0.01	0.61	0.10	0.77	0.05	
02/12/2024 14:15:00	0.81	0.07	0.06	0.03	0.20	0.19	0.15	0.51	0.02	0.61	0.10	0.75	0.09	
02/12/2024 14:30:00	0.81	0.05	0.06	0.03	0.20	0.19	0.15	0.51	0.02	0.61	0.09	0.73	0.11	
02/12/2024 14:45:00	0.80	0.05	0.06	0.03	0.20	0.19	0.15	0.51	0.01	0.61	0.09	0.70	0.08	
02/12/2024 15:00:00	0.80	0.05	0.06	0.03	0.20	0.19	0.15	0.52	0.02	0.61	0.09	0.69	0.11	
02/12/2024 15:15:00	0.79	0.06	0.06	0.03	0.20	0.19	0.15	0.52	0.03	0.61	0.09	0.67	0.11	
02/12/2024 15:30:00	0.79	0.07	0.06	0.03	0.20	0.19	0.15	0.52	0.02	0.61	0.09	0.65	0.11	
02/12/2024 15:45:00	0.78	0.09	0.06	0.03	0.20	0.19	0.15	0.52	0.02	0.61	0.10	0.64	0.13	
02/12/2024 16:00:00	0.78	0.07	0.06	0.03	0.20	0.19	0.15	0.52	0.02	0.60	0.10	0.63	0.13	
02/12/2024 16:15:00	0.77	0.10	0.06	0.03	0.20	0.19	0.15	0.52	0.03	0.60	0.10	0.61	0.11	
02/12/2024 16:30:00	0.77	0.06	0.06	0.03	0.20	0.19	0.15	0.52	0.03	0.60	0.09	0.60	0.12	
02/12/2024 16:45:00	0.76	0.10	0.06	0.03	0.20	0.19	0.15	0.52	0.01	0.60	0.11	0.59	0.10	
02/12/2024 17:00:00	0.76	0.08	0.06	0.03	0.20	0.20	0.15	0.52	0.03	0.59	0.11	0.59	0.10	
02/12/2024 17:15:00	0.75	0.09	0.06	0.03	0.21	0.20	0.16	0.53	0.03	0.59	0.09	0.58	0.10	
02/12/2024 17:30:00	0.75	0.07	0.06	0.03	0.21	0.20	0.16	0.54	0.04	0.59	0.10	0.57	0.14	
02/12/2024 17:45:00	0.74	0.07	0.07	0.03	0.21	0.20	0.16	0.55	0.01	0.59	0.10	0.57	0.09	
02/12/2024 18:00:00	0.74	0.09	0.07	0.03	0.21	0.19	0.16	0.55	0.04	0.59	0.09	0.56	0.09	
02/12/2024 18:15:00	0.74	0.09	0.07	0.03	0.21	0.19	0.16	0.55	0.02	0.58	0.10	0.57	0.08	
02/12/2024 18:30:00	0.73	0.09	0.07	0.03	0.21	0.20	0.16	0.54	-0.03	0.58	0.09	0.59	0.08	
02/12/2024 18:45:00	0.73	0.09	0.07	0.04	0.21	0.20	0.16	0.54	-0.02	0.58	0.11	0.63	0.05	
02/12/2024 19:00:00	0.73	0.06	0.07	0.04	0.21	0.20	0.17	0.54	0.01	0.58	0.11	0.68	0.03	
02/12/2024 19:15:00	0.73	0.06	0.07	0.04	0.22	0.20	0.17	0.54	0.01	0.58	0.11	0.71	0.02	
02/12/2024 19:30:00	0.74	0.05	0.07	0.04	0.22	0.20	0.17	0.54	0.02	0.58	0.10	0.72	0.03	
02/12/2024 19:45:00	0.75	0.05	0.08	0.04	0.22	0.20	0.17	0.54	-0.01	0.58	0.10	0.74	0.02	
02/12/2024 20:00:00	0.76	0.06	0.08	0.04	0.22	0.20	0.17	0.54	0.00	0.58	0.10	0.74	0.00	
02/12/2024 20:15:00	0.76	0.04	0.08	0.04	0.22	0.20	0.17	0.54	-0.03	0.58	0.10	0.75	0.02	
02/12/2024 20:30:00	0.77	0.07	0.08	0.04	0.22	0.20	0.18	0.54	-0.02	0.58	0.10	0.76	0.03	
02/12/2024 20:45:00	0.77	0.07	0.08	0.04	0.23	0.20	0.18	0.54	-0.01	0.58	0.10	0.76	0.02	
02/12/2024 21:00:00	0.78	0.05	0.08	0.04	0.23	0.20	0.18	0.54	0.01	0.59	0.09	0.76	0.03	
02/12/2024 21:15:00	0.78	0.05	0.08	0.04	0.23	0.20	0.18	0.54	0.00	0.59	0.09	0.77	0.03	
02/12/2024 21:30:00	0.79	0.06	0.08	0.04	0.23	0.20	0.18	0.54	0.01	0.59	0.10	0.77	0.03	
02/12/2024 21:45:00	0.79	0.06	0.08	0.04	0.23	0.20	0.18	0.53	0.02	0.59	0.10	0.77	0.03	
02/12/2024 22:00:00	0.79	0.06	0.08	0.04	0.23	0.20	0.18	0.53	0.01	0.59	0.09	0.77	0.02	
02/12/2024 22:15:00	0.79	0.05	0.08	0.04	0.23	0.20	0.18	0.53	0.01	0.60	0.09	0.77	0.01	
02/12/2024 22:30:00	0.80	0.03	0.08	0.04	0.23	0.20	0.18	0.53	0.03	0.60	0.10	0.77	0.03	
02/12/2024 22:45:00	0.80	0.05	0.08	0.05	0.23	0.20	0.18	0.52	0.02	0.60	0.10	0.78	0.03	
02/12/2024 23:00:00	0.80	0.05	0.08	0.04	0.23	0.20	0.18	0.52	0.02	0.60	0.10	0.78	0.02	
02/12/2024 23:15:00	0.80	0.07	0.08	0.04	0.23	0.20	0.18	0.52	0.01	0.60	0.10	0.78	0.00	
02/12/2024 23:30:00	0.80	0.06	0.08	0.04	0.23	0.20	0.18	0.52	0.01	0.60	0.09	0.78	0.01	
02/12/2024 23:45:00	0.81	0.05	0.08	0.04	0.23	0.20	0.18	0.52	0.02	0.60	0.09	0.78	0.02	
03/12/2024 00:00:00	0.81	0.03	0.08	0.04	0.23	0.20	0.18	0.52	0.02	0.60	0.09	0.78	0.03	
03/12/2024 00:15:00	0.81	0.07	0.08	0.04	0.23	0.20	0.18	0.52	0.04	0.61	0.09	0.78	0.03	
03/12/2024 00:30:00	0.81	0.05	0.08	0.04	0.23	0.20	0.18	0.52	0.06	0.61	0.09	0.79	0.04	
03/12/2024 00:45:00	0.81	0.06	0.08	0.04	0.23	0.20	0.18	0.52	0.04	0.61	0.10	0.79	0.02	
03/12/2024 01:00:00	0.81	0.06	0.08	0.04	0.23	0.20	0.18	0.52		0.61	0.09	0.79	0.04	
03/12/2024 01:15:00	0.81	0.05	0.08	0.04	0.22	0.20	0.18	0.52		0.61	0.09	0.79	0.03	
03/12/2024 01:30:00	0.81	0.06	0.08	0.04	0.22	0.20	0.18	0.52		0.61	0.09	0.79	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
03/12/2024 01:45:00	0.81	0.05	0.08	0.04	0.22	0.20	0.18	0.52		0.61	0.09	0.79	0.02	
03/12/2024 02:00:00	0.82	0.06	0.08	0.04	0.22	0.20	0.17	0.52		0.61	0.09	0.79	0.02	
03/12/2024 02:15:00	0.82	0.06	0.08	0.04	0.22	0.20	0.17	0.52		0.61	0.09	0.79	0.04	
03/12/2024 02:30:00	0.82	0.06	0.08	0.04	0.22	0.20	0.17	0.51		0.61	0.09	0.79	0.02	
03/12/2024 02:45:00	0.82	0.06	0.08	0.04	0.22	0.20	0.17	0.51		0.61	0.09	0.78	0.03	
03/12/2024 03:00:00	0.82	0.05	0.08	0.04	0.22	0.20	0.17	0.51		0.61	0.09	0.76	0.07	
03/12/2024 03:15:00	0.81	0.07	0.08	0.04	0.22	0.20	0.17	0.51		0.61	0.09	0.74	0.08	
03/12/2024 03:30:00	0.81	0.08	0.08	0.04	0.22	0.20	0.17	0.50		0.61	0.09	0.72	0.09	
03/12/2024 03:45:00	0.80	0.09	0.07	0.04	0.22	0.20	0.17	0.50		0.61	0.09	0.70	0.09	
03/12/2024 04:00:00	0.80	0.08	0.07	0.04	0.22	0.20	0.17	0.50		0.61	0.09	0.68	0.14	
03/12/2024 04:15:00	0.79	0.07	0.07	0.04	0.22	0.20	0.17	0.50		0.61	0.09	0.66	0.13	
03/12/2024 04:30:00	0.79	0.10	0.07	0.04	0.22	0.20	0.17	0.50		0.60	0.09	0.65	0.11	
03/12/2024 04:45:00	0.78	0.08	0.07	0.04	0.21	0.20	0.16	0.50		0.60	0.09	0.63	0.09	
03/12/2024 05:00:00	0.78	0.06	0.07	0.04	0.21	0.20	0.16	0.50		0.60	0.09	0.62	0.11	
03/12/2024 05:15:00	0.77	0.08	0.07	0.04	0.21	0.19	0.16	0.50		0.59	0.09	0.61	0.08	
03/12/2024 05:30:00	0.76	0.08	0.07	0.04	0.21	0.19	0.16	0.50		0.59	0.09	0.60	0.07	
03/12/2024 05:45:00	0.76	0.06	0.07	0.03	0.21	0.19	0.16	0.50		0.59	0.10	0.59	0.03	
03/12/2024 06:00:00	0.75	0.08	0.07	0.03	0.21	0.19	0.16	0.49		0.59	0.08	0.59	0.07	
03/12/2024 06:15:00	0.75	0.05	0.07	0.03	0.21	0.19	0.16	0.49		0.58	0.09	0.58	0.09	
03/12/2024 06:30:00	0.74	0.08	0.07	0.03	0.21	0.19	0.16	0.49		0.58	0.09	0.57	0.09	
03/12/2024 06:45:00	0.74	0.08	0.07	0.03	0.20	0.19	0.15	0.49		0.58	0.09	0.57	0.08	
03/12/2024 07:00:00	0.74	0.10	0.07	0.03	0.20	0.19	0.15	0.49	0.03	0.58	0.10	0.57	0.08	
03/12/2024 07:15:00	0.73	0.07	0.07	0.03	0.20	0.19	0.15	0.49	0.03	0.57	0.09	0.57	0.06	
03/12/2024 07:30:00	0.73	0.08	0.06	0.03	0.20	0.19	0.15	0.49	0.02	0.57	0.09	0.58	0.06	
03/12/2024 07:45:00	0.72	0.06	0.07	0.03	0.20	0.19	0.15	0.49	0.03	0.57	0.10	0.60	0.05	
03/12/2024 08:00:00	0.72	0.07	0.06	0.03	0.20	0.19	0.15	0.49	0.03	0.57	0.10	0.63	0.03	
03/12/2024 08:15:00	0.72	0.05	0.06	0.03	0.20	0.19	0.15	0.49	0.02	0.56	0.10	0.67	-0.05	
03/12/2024 08:30:00	0.73	0.05	0.06	0.03	0.20	0.19	0.15	0.49	0.02	0.56	0.09	0.70	0.01	
03/12/2024 08:45:00	0.73	0.05	0.06	0.03	0.20	0.19	0.15	0.49	0.03	0.56	0.10	0.71	0.02	
03/12/2024 09:00:00	0.74	0.04	0.06	0.03	0.20	0.19	0.15	0.49	0.02	0.56	0.10	0.73	0.01	
03/12/2024 09:15:00	0.75	0.06	0.06	0.03	0.20	0.19	0.15	0.50	0.02	0.56	0.11	0.73	0.02	
03/12/2024 09:30:00	0.75	0.05	0.06	0.03	0.20	0.19	0.14	0.50	0.01	0.57	0.10	0.74	0.02	
03/12/2024 09:45:00	0.76	0.03	0.06	0.03	0.20	0.19	0.14	0.50	0.02	0.57	0.10	0.75	0.01	
03/12/2024 10:00:00	0.77	0.00	0.06	0.03	0.20	0.19	0.14	0.50	0.00	0.57	0.10	0.75		
03/12/2024 10:15:00	0.77	0.05	0.06	0.03	0.20	0.19	0.14	0.50	0.00	0.57	0.10	0.76	0.02	
03/12/2024 10:30:00	0.77	0.00	0.06	0.03	0.20	0.19	0.14	0.50	0.01	0.58	0.10	0.76	0.01	
03/12/2024 10:45:00	0.78	0.05	0.06	0.03	0.20	0.19	0.14	0.50	0.01	0.58	0.09	0.76	0.01	
03/12/2024 11:00:00	0.78	0.00	0.06	0.03	0.20	0.19	0.14	0.50	0.02	0.58	0.10	0.76	0.00	
03/12/2024 11:15:00	0.78	0.05	0.06	0.03	0.20	0.19	0.14	0.50	0.01	0.58	0.09	0.76	0.02	
03/12/2024 11:30:00	0.79	0.00	0.06	0.03	0.20	0.19	0.14	0.50	0.00	0.58	0.09	0.76	0.03	
03/12/2024 11:45:00	0.79	0.11	0.06	0.03	0.20	0.19	0.14	0.50	0.01	0.59	0.08	0.76	0.02	
03/12/2024 12:00:00	0.79	0.00	0.06	0.03	0.20	0.19	0.14	0.50	0.01	0.59	0.09	0.77	0.02	
03/12/2024 12:15:00	0.79	0.04	0.06	0.03	0.20	0.19	0.14	0.50	0.01	0.59	0.09	0.77	0.02	
03/12/2024 12:30:00	0.79	0.07	0.06	0.03	0.20	0.19	0.14	0.50	0.01	0.59	0.09	0.77	0.01	
03/12/2024 12:45:00	0.80	0.06	0.06	0.03	0.20	0.18	0.14	0.50	0.01	0.59	0.09	0.77	-0.08	
03/12/2024 13:00:00	0.80	0.00	0.06	0.03	0.20	0.18	0.14	0.50	0.01	0.59	0.08	0.78	0.00	
03/12/2024 13:15:00	0.80	0.00	0.06	0.03	0.20	0.18	0.14	0.50	0.01	0.59	0.08	0.77	0.00	
03/12/2024 13:30:00	0.80	0.05	0.06	0.03	0.20	0.18	0.14	0.51	0.01	0.59	0.08	0.78	0.00	
03/12/2024 13:45:00	0.80	0.05	0.06	0.03	0.20	0.18	0.14	0.51	0.02	0.59	0.08	0.79	0.05	
03/12/2024 14:00:00	0.80	0.06	0.06	0.03	0.20	0.18	0.14	0.51	0.02	0.59	0.08	0.78	0.02	
03/12/2024 14:15:00	0.80	0.06	0.06	0.03	0.20	0.18	0.14	0.50	0.03	0.60	0.08	0.77	0.02	
03/12/2024 14:30:00	0.80	0.05	0.06	0.03	0.20	0.19	0.14	0.50	0.01	0.60	0.08	0.73	0.08	
03/12/2024 14:45:00	0.80	0.06	0.06	0.03	0.20	0.19	0.15	0.50	0.01	0.60	0.08	0.71	0.07	
03/12/2024 15:00:00	0.79	0.05	0.06	0.03	0.20	0.19	0.15	0.50	0.01	0.59	0.08	0.69	0.05	
03/12/2024 15:15:00	0.79	0.06	0.06	0.03	0.20	0.19	0.15	0.50	0.02	0.59	0.08	0.67	0.06	
03/12/2024 15:30:00	0.78	0.06	0.06	0.03	0.20	0.19	0.15	0.50	0.02	0.59	0.08	0.66	0.11	
03/12/2024 15:45:00	0.77	0.07	0.06	0.03	0.20	0.19	0.15	0.50	0.02	0.59	0.08	0.64	0.11	
03/12/2024 16:00:00	0.77	0.07	0.06	0.03	0.20	0.19	0.15	0.50	0.02	0.58	0.08	0.62	0.11	
03/12/2024 16:15:00	0.76	0.08	0.06	0.03	0.20	0.19	0.15	0.50	0.02	0.58	0.07	0.61	0.14	
03/12/2024 16:30:00	0.76	0.07	0.06	0.03	0.20	0.19	0.14	0.49	0.02	0.58	0.10	0.60	0.09	
03/12/2024 16:45:00	0.75	0.06	0.06	0.03	0.20	0.19	0.14	0.49	0.03	0.58	0.09	0.59	0.14	
03/12/2024 17:00:00	0.74	0.07	0.06	0.03	0.20	0.19	0.14	0.49	0.03	0.57	0.09	0.58	0.12	
03/12/2024 17:15:00	0.74	0.07	0.06	0.03	0.20	0.18	0.14	0.49	0.02	0.57	0.08	0.57	0.09	
03/12/2024 17:30:00	0.73	0.05	0.06	0.03	0.19	0.18	0.14	0.49	0.03	0.57	0.09	0.56	0.11	
03/12/2024 17:45:00	0.73	0.07	0.06	0.03	0.19	0.18	0.14	0.49	0.02	0.56	0.09	0.56	0.08	
03/12/2024 18:00:00	0.72	0.06	0.06	0.03	0.19	0.18	0.14	0.49	0.02	0.56	0.10	0.55	0.07	
03/12/2024 18:15:00	0.72	0.08	0.06	0.03	0.19	0.18	0.14	0.50	0.03	0.56	0.10	0.54	0.11	
03/12/2024 18:30:00	0.71	0.09	0.06	0.03	0.19	0.18	0.14	0.50	0.02	0.56	0.09	0.53	0.07	
03/12/2024 18:45:00	0.71	0.07	0.06	0.03	0.19	0.18	0.14	0.50	0.02	0.55	0.09	0.53	0.07	
03/12/2024 19:00:00	0.70	0.07	0.06	0.03	0.19	0.18	0.14	0.50	0.02	0.55	0.09	0.53	0.06	
03/12/2024 19:15:00	0.70	0.08	0.06	0.03	0.19	0.18	0.14	0.50	0.02	0.55	0.10	0.52	0.10	
03/12/2024 19:30:00	0.70	0.08	0.06	0.03	0.19	0.18	0.14	0.50	0.02	0.55	0.09	0.52	0.05	
03/12/2024 19:45:00	0.69	0.09	0.06	0.03	0.19	0.18	0.14	0.50	0.00	0.54	0.09	0.53	0.05	
03/12/2024 20:00:00	0.69	0.07	0.06	0.03	0.19	0.18	0.14	0.50	0.01	0.54	0.08	0.54	0.02	
03/12/2024 20:15:00	0.69	0.07	0.06	0.03	0.19	0.18	0.14	0.50	0.01	0.54	0.10	0.56	0.05	
03/12/2024 20:30:00	0.68	0.07	0.06	0.03	0.19	0.18	0.14	0.51	0.00	0.54	0.09	0.60	0.04	
03/12/2024 20:45:00	0.69	0.07	0.06	0.03	0.19	0.18	0.14	0.51	0.02	0.54	0.10	0.64	0.02	
03/12/2024 21:00:00	0.69	0.07	0.06	0.03	0.19	0.18	0.14	0.51	0.01	0.53	0.10	0.67	-0.01	
03/12/2024 21:15:00	0.70	0.05	0.06	0.03	0.19	0.18	0.14	0.51	0.01	0.53	0.10	0.69	0.01	
03/12/2024 21:30:00	0.71	0.06	0.06	0.03	0.19	0.18	0.14	0.51	0.01	0.53	0.10	0.70	0.00	
03/12/2024 21:45:00	0.72	0.03	0.06	0.03	0.19	0.18	0.14	0.51	0.01	0.54	0.09	0.71		
03/12/2024 22:00:00	0.72	0.05	0.06	0.03	0.19	0.18	0.14	0.50	0.01	0.54	0.10	0.72	0.01	
03/12/2024 22:15:00	0.73	0.05	0.06	0.03	0.19	0.19	0.14	0.50	0.01	0.54	0.10	0.73	0.04	
03/12/2024 22:30:00	0.74	0.04	0.06	0.03	0.19	0.19	0.14	0.50	0.01	0.54	0.08	0.73	0.01	
03/12/2024 22:45:00	0.74	0.00	0.06	0.03	0.19	0.18	0.14	0.50	0.01	0.55	0.09	0.74	-0.01	
03/12/2024 23:00:00	0.75	0.05	0.06	0.03	0.19	0.18	0.14	0.50	0.00	0.55	0.08	0.74	0.01	
03/12/2024 23:15:00	0.75	0.00	0.06	0.03	0.19	0.18	0.14	0.50	0.00	0.55	0.08	0.75	0.01	
03/12/2024 23:30:00	0.76	0.05	0.07	0.03	0.19	0.18	0.14	0.50		0.56	0.08	0.75	0.03	
03/12/2024 23:45:00	0.76	0.04	0.06	0.03	0.19	0.18	0.14	0.50		0.56	0.07	0.75	0.01	
04/12/2024 00:00:00	0.77	0.00	0.06	0.03	0.19	0.18	0.14	0.50		0.56	0.08	0.75	0.02	
04/12/2024 00:15:00	0.77	0.00	0.06	0.03	0.19	0.18	0.14	0.49		0.56	0.08	0.76	0.00	
04/12/2024 00:30:00	0.77	0.05	0.06	0.03	0.19	0.18	0.14	0.49		0.57	0.08	0.76	0.01	
04/12/2024 00:45:00	0.77	0.05	0.06	0.03	0.19	0.18	0.14	0.49		0.57	0.08	0.76	-0.01	
04/12/2024 01:00:00	0.78	0.04	0.06	0.03	0.19	0.18	0.14	0.49		0.57	0.08	0.76	0.01	
04/12/2024 01:15:00	0.78	0.00	0.06	0.03	0.19	0.18	0.14	0.49		0.57	0.08	0.76	0.02	
04/12/2024 01:30:00	0.78	0.05	0.06	0.03	0.19	0.18	0.14	0.49		0.57	0.08	0.76	0.00	
04/12/2024 01:45:00	0.78	0.00	0.06	0.03	0.19	0.18	0.14	0.49	0.03	0.57	0.08	0.76	0.00	
04/12/2024 02:00:00	0.78	0.05	0.06	0.03	0.19	0.18	0.14	0.48		0.57	0.08	0.76	0.03	
04/12/2024 02:15:00	0.78	0.00	0.06	0.03	0.19	0.18	0.14	0.48		0.58	0.08	0.74	0.05	
04/12/2024 02:30:00	0.78	0.06	0.06	0.03	0.19	0.18	0.14	0.48		0.58	0.08	0.71	0.07	
04/12/2024 02:45:00	0.77	0.06	0.06	0.03	0.19	0.18	0.14	0.48		0.58	0.08	0.69	0.08	
04/12/2024 03:00:00	0.77	0.07	0.06	0.03	0.19	0.18	0.14	0.48		0.57	0.08	0.66	0.09	
04/12/2024 03:15:00	0.76	0.05	0.06	0.03	0.19	0.18	0.14	0.48		0.57	0.08	0.64	0.11	
04/12/2024 03:30:00	0.76	0.07	0.06	0.03	0.19	0.18	0.14	0.48		0.57	0.08	0.62	0.11	
04/12/2024 03:45:00	0.75	0.09	0.06	0.03	0.19	0.18	0.13	0.48		0.57	0.08	0.60	0.08	
04/12/2024 04:00:00	0.74	0.08	0.06	0.03	0.19	0.18	0.13	0.48	0.02	0.56	0.07	0.59	0.09	
04/12/2024 04:15:00	0.74	0.08	0.06	0.03	0.19	0.18	0.13	0.47	0.02	0.56	0.08	0.58	0.13	
04/12/2024 04:30:00	0.73	0.07	0.06	0.03	0.19	0.18	0.13	0.47	0.02	0.56	0.08	0.57	0.07	
04/12/2024 04:45:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.47	0.03	0.55	0.07	0.56	0.04	
04/12/2024 05:00:00	0.72	0.10	0.05	0.02	0.18	0.18	0.13	0.47		0.55	0.08	0.55	0.06	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
04/12/2024 05:15:00	0.71	0.06	0.06	0.03	0.18	0.18	0.13	0.48		0.55	0.08	0.54	0.09	
04/12/2024 05:30:00	0.71	0.09	0.05	0.02	0.18	0.18	0.13	0.48		0.54	0.07	0.53	0.14	
04/12/2024 05:45:00	0.70	0.09	0.05	0.02	0.18	0.18	0.13	0.48		0.54	0.08	0.53	0.09	
04/12/2024 06:00:00	0.70	0.07	0.05	0.02	0.18	0.18	0.13	0.48		0.54	0.08	0.52	0.07	
04/12/2024 06:15:00	0.69	0.08	0.05	0.02	0.18	0.18	0.13	0.48		0.54	0.08	0.52	0.11	
04/12/2024 06:30:00	0.69	0.10	0.05	0.02	0.18	0.18	0.13	0.48		0.53	0.08	0.51	0.05	
04/12/2024 06:45:00	0.68	0.06	0.05	0.02	0.18	0.18	0.13	0.48		0.53	0.07	0.51	0.10	
04/12/2024 07:00:00	0.68	0.07	0.05	0.02	0.18	0.18	0.12	0.47		0.53	0.07	0.50	0.11	
04/12/2024 07:15:00	0.67	0.06	0.05	0.02	0.18	0.18	0.12	0.48		0.53	0.08	0.49	0.07	
04/12/2024 07:30:00	0.67	0.08	0.05	0.02	0.18	0.18	0.12	0.48	0.03	0.52	0.07	0.49	0.08	
04/12/2024 07:45:00	0.67	0.08	0.05	0.02	0.18	0.18	0.12	0.48	0.02	0.52	0.08	0.49	0.07	
04/12/2024 08:00:00	0.66	0.09	0.05	0.02	0.18	0.18	0.12	0.48	0.02	0.52	0.08	0.49	0.07	
04/12/2024 08:15:00	0.66	0.09	0.05	0.02	0.18	0.18	0.12	0.48	0.02	0.52	0.07	0.49	0.04	
04/12/2024 08:30:00	0.65	0.08	0.05	0.02	0.18	0.18	0.12	0.48	0.01	0.51	0.10	0.49	0.03	
04/12/2024 08:45:00	0.65	0.08	0.05	0.02	0.18	0.18	0.12	0.48	0.03	0.51	0.09	0.50	0.03	
04/12/2024 09:00:00	0.65	0.08	0.05	0.02	0.18	0.18	0.12	0.49	0.02	0.51	0.09	0.52	0.07	
04/12/2024 09:15:00	0.65	0.06	0.05	0.02	0.17	0.18	0.12	0.49	0.01	0.51	0.08	0.56	0.02	
04/12/2024 09:30:00	0.65	0.06	0.05	0.02	0.17	0.18	0.12	0.49	0.01	0.51	0.09	0.60	-0.07	
04/12/2024 09:45:00	0.65	0.06	0.05	0.02	0.17	0.18	0.12	0.49	0.00	0.51	0.10	0.63	0.00	
04/12/2024 10:00:00	0.66	0.04	0.05	0.02	0.18	0.18	0.12	0.49	0.03	0.51	0.09	0.65	0.01	
04/12/2024 10:15:00	0.67	0.06	0.05	0.02	0.18	0.18	0.12	0.50	0.03	0.51	0.09	0.66	0.00	
04/12/2024 10:30:00	0.68	0.04	0.04	0.02	0.18	0.18	0.12	0.50	0.03	0.51	0.09	0.68	-0.01	
04/12/2024 10:45:00	0.69	0.05	0.05	0.02	0.18	0.18	0.12	0.50	0.03	0.51	0.09	0.69	0.01	
04/12/2024 11:00:00	0.70	0.04	0.05	0.02	0.18	0.18	0.12	0.50	0.03	0.51	0.09	0.70	0.01	
04/12/2024 11:15:00	0.71	0.04	0.05	0.02	0.18	0.18	0.12	0.50	0.03	0.52	0.08	0.71	0.00	
04/12/2024 11:30:00	0.71	0.04	0.05	0.02	0.18	0.18	0.13	0.50	0.04	0.52	0.08	0.71	0.02	
04/12/2024 11:45:00	0.72	0.03	0.05	0.02	0.18	0.18	0.13	0.50	0.04	0.52	0.08	0.72	0.02	
04/12/2024 12:00:00	0.72	0.04	0.05	0.02	0.18	0.18	0.13	0.50	0.03	0.53	0.07	0.72	-0.01	
04/12/2024 12:15:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.03	0.53	0.07	0.73	-0.02	
04/12/2024 12:30:00	0.73	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.04	0.53	0.03	0.73	0.01	
04/12/2024 12:45:00	0.74	0.05	0.05	0.02	0.18	0.18	0.13	0.50	0.03	0.54	0.00	0.73	-0.01	
04/12/2024 13:00:00	0.74	0.05	0.05	0.02	0.18	0.18	0.13	0.49	0.03	0.54	0.03	0.74	0.01	
04/12/2024 13:15:00	0.75	0.04	0.05	0.02	0.18	0.18	0.13	0.49	0.03	0.54	0.06	0.74	0.04	
04/12/2024 13:30:00	0.75	0.04	0.05	0.02	0.18	0.18	0.13	0.49	0.03	0.54	0.06	0.74	0.00	
04/12/2024 13:45:00	0.75	0.04	0.05	0.02	0.18	0.18	0.13	0.49	0.04	0.55	0.06	0.74	0.02	
04/12/2024 14:00:00	0.76	0.00	0.06	0.03	0.18	0.18	0.13	0.49	0.02	0.55	0.06	0.74	0.01	
04/12/2024 14:15:00	0.76	0.00	0.05	0.02	0.18	0.18	0.13	0.49	0.01	0.55	0.06	0.75	0.00	
04/12/2024 14:30:00	0.76	0.03	0.05	0.02	0.18	0.18	0.13	0.49	0.04	0.55	0.06	0.75	0.01	
04/12/2024 14:45:00	0.76	0.00	0.05	0.02	0.18	0.18	0.13	0.49	0.03	0.55	0.06	0.75	0.02	
04/12/2024 15:00:00	0.76	0.00	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.55	0.07	0.74	0.01	
04/12/2024 15:15:00	0.76	0.00	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.55	0.07	0.71	0.03	
04/12/2024 15:30:00	0.76	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.56	0.07	0.68	0.09	
04/12/2024 15:45:00	0.75	0.10	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.55	0.06	0.66	0.11	
04/12/2024 16:00:00	0.75	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.55	0.07	0.64	0.06	
04/12/2024 16:15:00	0.74	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.55	0.07	0.62	0.12	
04/12/2024 16:30:00	0.73	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.04	0.55	0.07	0.60	0.10	
04/12/2024 16:45:00	0.73	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.04	0.54	0.06	0.58	0.06	
04/12/2024 17:00:00	0.72	0.06	0.05	0.02	0.18	0.18	0.13	0.49	0.04	0.54	0.06	0.57	0.09	
04/12/2024 17:15:00	0.72	0.09	0.05	0.02	0.18	0.18	0.13	0.49	0.04	0.54	0.06	0.55	0.11	
04/12/2024 17:30:00	0.71	0.07	0.05	0.02	0.18	0.18	0.13	0.49	0.03	0.53	0.06	0.54	0.07	
04/12/2024 17:45:00	0.70	0.08	0.05	0.02	0.18	0.18	0.13	0.49	0.03	0.53	0.07	0.53	0.08	
04/12/2024 18:00:00	0.70	0.07	0.05	0.02	0.18	0.18	0.13	0.49	0.03	0.53	0.08	0.52	0.06	
04/12/2024 18:15:00	0.69	0.06	0.05	0.02	0.18	0.18	0.13	0.50	0.03	0.52	0.08	0.51	0.03	
04/12/2024 18:30:00	0.68	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.03	0.52	0.07	0.50	0.08	
04/12/2024 18:45:00	0.68	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.05	0.52	0.07	0.49	0.07	
04/12/2024 19:00:00	0.67	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.04	0.52	0.07	0.48	0.04	
04/12/2024 19:15:00	0.67	0.08	0.05	0.02	0.18	0.18	0.13	0.50	0.04	0.51	0.08	0.47	0.09	
04/12/2024 19:30:00	0.66	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.04	0.51	0.08	0.47	0.07	
04/12/2024 19:45:00	0.66	0.10	0.05	0.02	0.18	0.18	0.13	0.50	0.04	0.51	0.10	0.47	0.05	
04/12/2024 20:00:00	0.65	0.09	0.05	0.02	0.19	0.18	0.13	0.51	0.04	0.51	0.09	0.47	0.06	
04/12/2024 20:15:00	0.65	0.08	0.05	0.02	0.19	0.18	0.13	0.51	0.04	0.50	0.08	0.48	0.08	
04/12/2024 20:30:00	0.64	0.08	0.05	0.02	0.19	0.18	0.13	0.51	0.04	0.50	0.08	0.50	0.03	
04/12/2024 20:45:00	0.64	0.08	0.05	0.02	0.19	0.18	0.13	0.51	0.00	0.50	0.08	0.54	0.04	
04/12/2024 21:00:00	0.64	0.09	0.06	0.03	0.19	0.19	0.13	0.51	0.01	0.50	0.07	0.57	0.03	
04/12/2024 21:15:00	0.64	0.07	0.06	0.03	0.19	0.18	0.13	0.51	0.02	0.50	0.10	0.60	0.02	
04/12/2024 21:30:00	0.65	0.08	0.06	0.03	0.19	0.19	0.14	0.52	0.03	0.50	0.08	0.62	0.00	
04/12/2024 21:45:00	0.65	0.06	0.06	0.03	0.19	0.19	0.14	0.52	0.04	0.50	0.07	0.63	0.02	
04/12/2024 22:00:00	0.66	0.05	0.06	0.03	0.19	0.19	0.14	0.52	0.04	0.50	0.09	0.64	0.02	
04/12/2024 22:15:00	0.66	0.06	0.06	0.03	0.19	0.19	0.14	0.51	0.03	0.50	0.08	0.65	-0.01	
04/12/2024 22:30:00	0.67	0.04	0.06	0.03	0.19	0.19	0.14	0.51	0.04	0.50	0.08	0.66	0.00	
04/12/2024 22:45:00	0.68	0.05	0.06	0.03	0.19	0.19	0.14	0.51	0.04	0.50	0.08	0.67	0.02	
04/12/2024 23:00:00	0.69	0.05	0.06	0.03	0.19	0.19	0.14	0.51	0.04	0.50	0.06	0.68	0.02	
04/12/2024 23:15:00	0.69	0.05	0.06	0.03	0.19	0.19	0.14	0.51	0.04	0.50	0.06	0.68	0.02	
04/12/2024 23:30:00	0.70	0.05	0.06	0.03	0.20	0.19	0.14	0.51	0.04	0.51	0.07	0.69	0.01	
04/12/2024 23:45:00	0.70	0.05	0.06	0.03	0.20	0.19	0.14	0.51	0.03	0.51	0.05	0.70	0.01	
05/12/2024 00:00:00	0.71	0.05	0.06	0.03	0.20	0.19	0.15	0.50	0.03	0.51	0.05	0.70	0.02	
05/12/2024 00:15:00	0.71	0.06	0.06	0.03	0.20	0.19	0.15	0.50	0.04	0.52	0.06	0.71	0.02	
05/12/2024 00:30:00	0.72	0.05	0.06	0.03	0.20	0.19	0.14	0.50	0.04	0.52	0.07	0.71	0.01	
05/12/2024 00:45:00	0.72	0.06	0.06	0.03	0.20	0.19	0.15	0.50	0.04	0.52	0.06	0.72	0.01	
05/12/2024 01:00:00	0.73	0.06	0.06	0.03	0.20	0.19	0.15	0.50	0.04	0.52	0.06	0.72	0.01	
05/12/2024 01:15:00	0.73	0.05	0.06	0.03	0.20	0.19	0.15	0.50	0.04	0.53	0.05	0.72	0.02	
05/12/2024 01:30:00	0.73	0.04	0.06	0.03	0.20	0.19	0.14	0.50	0.04	0.53	0.06	0.73	0.02	
05/12/2024 01:45:00	0.74	0.05	0.06	0.03	0.20	0.19	0.14	0.49	0.03	0.53	0.05	0.73	0.02	
05/12/2024 02:00:00	0.74	0.06	0.06	0.03	0.19	0.19	0.14	0.49	0.03	0.53	0.05	0.72	0.03	
05/12/2024 02:15:00	0.74	0.05	0.06	0.03	0.19	0.19	0.14	0.49	0.03	0.54	0.03	0.69	0.07	
05/12/2024 02:30:00	0.74	0.07	0.06	0.03	0.19	0.19	0.14	0.49	0.03	0.54	0.04	0.66	0.08	
05/12/2024 02:45:00	0.74	0.07	0.06	0.03	0.20	0.19	0.15	0.49	0.03	0.54	0.04	0.63	0.10	
05/12/2024 03:00:00	0.73	0.08	0.06	0.03	0.20	0.19	0.15	0.49	0.02	0.54	0.03	0.61	0.10	
05/12/2024 03:15:00	0.72	0.08	0.06	0.03	0.20	0.19	0.14	0.49	0.01	0.54	0.04	0.59	0.09	
05/12/2024 03:30:00	0.72	0.08	0.06	0.03	0.20	0.19	0.14	0.49	0.00	0.54	0.03	0.57	0.09	
05/12/2024 03:45:00	0.71	0.08	0.06	0.03	0.20	0.19	0.14	0.49	0.00	0.53	0.04	0.55	0.13	
05/12/2024 04:00:00	0.71	0.09	0.06	0.03	0.20	0.19	0.14	0.49	0.03	0.53	0.06	0.53	0.11	
05/12/2024 04:15:00	0.70	0.07	0.06	0.03	0.19	0.19	0.14	0.49	0.03	0.53	0.04	0.52	0.10	
05/12/2024 04:30:00	0.69	0.09	0.06	0.03	0.19	0.19	0.14	0.49	0.03	0.52	0.04	0.51	0.11	
05/12/2024 04:45:00	0.69	0.09	0.06	0.03	0.19	0.19	0.14	0.49	0.03	0.52	0.04	0.50	0.09	
05/12/2024 05:00:00	0.68	0.09	0.05	0.02	0.19	0.19	0.14	0.49	0.03	0.52	0.05	0.49	0.11	
05/12/2024 05:15:00	0.68	0.08	0.06	0.03	0.19	0.19	0.14	0.49	0.04	0.52	0.05	0.49	0.11	
05/12/2024 05:30:00	0.67	0.07	0.06	0.03	0.19	0.19	0.14	0.50	0.04	0.51	0.06	0.48	0.10	
05/12/2024 05:45:00	0.67	0.09	0.06	0.03	0.19	0.19	0.14	0.52	0.05	0.51	0.05	0.47	0.10	
05/12/2024 06:00:00	0.66	0.08	0.06	0.03	0.20	0.19	0.14	0.54	0.05	0.51	0.04	0.47	0.12	
05/12/2024 06:15:00	0.66	0.10	0.05	0.02	0.20	0.19	0.14	0.55	0.04	0.51	0.06	0.46	0.10	
05/12/2024 06:30:00	0.65	0.10	0.06	0.03	0.20	0.19	0.15	0.56	0.04	0.51	0.09	0.46	0.11	
05/12/2024 06:45:00	0.65	0.08	0.06	0.03	0.20	0.20	0.15	0.58	0.06	0.51	0.07	0.45	0.10	
05/12/2024 07:00:00	0.65	0.08	0.06	0.03	0.20	0.20	0.15	0.59	0.04	0.51	0.07	0.45	0.10	
05/12/2024 07:15:00	0.64	0.10	0.06	0.03	0.21	0.20	0.16	0.59	0.05	0.51	0.06	0.44	0.12	
05/12/2024 07:30:00	0.64	0.10	0.06	0.03	0.21	0.20	0.17	0.59	0.04	0.51	0.07	0.44	0.12	
05/12/2024 07:45:00	0.64	0.10	0.07	0.03	0.22	0.20	0.18	0.59	0.04	0.51	0.08	0.43	0.08	
05/12/2024 08:00:00	0.63	0.08	0.07	0.04	0.23	0.21	0.19	0.59	0.04	0.51	0.10	0.43	0.11	
05/12/2024 08:15:00	0.63	0.10	0.07	0.04	0.24	0.21	0.19	0.59	0.04	0.51	0.07	0.43	0.12	
05/12/2024 08:30:00	0.63	0.11	0.08	0.04	0.24	0.21	0.20	0.58	0.04	0.51	0.08	0.42	0.09	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
05/12/2024 08:45:00	0.63	0.09	0.08	0.04	0.25	0.21	0.21	0.58	0.02	0.51	0.08	0.42	0.11	
05/12/2024 09:00:00	0.62	0.11	0.08	0.05	0.25	0.22	0.21	0.58	0.03	0.50	0.10	0.41	0.08	
05/12/2024 09:15:00	0.62	0.10	0.09	0.05	0.26	0.22	0.22	0.57	0.03	0.50	0.10	0.41	0.09	
05/12/2024 09:30:00	0.62	0.11	0.09	0.05	0.26	0.22	0.22	0.57	0.03	0.50	0.10	0.41	0.11	
05/12/2024 09:45:00	0.62	0.09	0.09	0.05	0.26	0.22	0.22	0.57	0.03	0.50	0.11	0.41	0.08	
05/12/2024 10:00:00	0.61	0.09	0.10	0.06	0.26	0.22	0.22	0.57	0.04	0.50	0.11	0.41	0.12	
05/12/2024 10:15:00	0.61	0.10	0.09	0.06	0.26	0.22	0.22	0.57	0.03	0.50	0.10	0.40	0.07	
05/12/2024 10:30:00	0.61	0.09	0.09	0.05	0.26	0.22	0.23	0.57	0.03	0.50	0.09	0.40	0.11	
05/12/2024 10:45:00	0.61	0.10	0.10	0.06	0.26	0.22	0.23	0.56	0.02	0.50	0.10	0.40	0.06	
05/12/2024 11:00:00	0.60	0.09	0.10	0.06	0.27	0.23	0.23	0.56	0.03	0.50	0.10	0.41	0.06	
05/12/2024 11:15:00	0.60	0.10	0.10	0.06	0.27	0.23	0.23	0.56	0.03	0.50	0.09	0.43	0.01	
05/12/2024 11:30:00	0.60	0.10	0.10	0.06	0.27	0.23	0.23	0.56	0.03	0.50	0.11	0.47	0.03	
05/12/2024 11:45:00	0.60	0.10	0.10	0.06	0.27	0.23	0.23	0.56	0.02	0.50	0.09	0.51	0.03	
05/12/2024 12:00:00	0.60	0.10	0.09	0.05	0.26	0.23	0.23	0.56	0.01	0.50	0.10	0.53	0.02	
05/12/2024 12:15:00	0.61	0.08	0.09	0.05	0.26	0.23	0.22	0.56	0.01	0.50	0.12	0.55	0.01	
05/12/2024 12:30:00	0.61	0.09	0.09	0.05	0.26	0.23	0.22	0.55	0.02	0.50	0.11	0.56	0.01	
05/12/2024 12:45:00	0.62	0.08	0.09	0.05	0.26	0.23	0.22	0.55	0.03	0.50	0.11	0.58	0.00	
05/12/2024 13:00:00	0.62	0.06	0.09	0.05	0.26	0.23	0.22	0.55	0.03	0.50	0.11	0.59	0.00	
05/12/2024 13:15:00	0.63	0.05	0.09	0.05	0.26	0.23	0.22	0.55	0.01	0.50	0.11	0.61	0.01	
05/12/2024 13:30:00	0.64	0.08	0.09	0.05	0.26	0.23	0.22	0.55	0.02	0.50	0.10	0.62	0.01	
05/12/2024 13:45:00	0.65	0.07	0.09	0.05	0.26	0.23	0.22	0.55	0.00	0.50	0.09	0.63	0.02	
05/12/2024 14:00:00	0.65	0.06	0.09	0.05	0.26	0.23	0.22	0.55	0.03	0.51	0.10	0.64	0.00	
05/12/2024 14:15:00	0.66	0.10	0.09	0.05	0.25	0.23	0.21	0.55	0.00	0.51	0.11	0.64	0.02	
05/12/2024 14:30:00	0.67	0.05	0.09	0.05	0.25	0.23	0.21	0.55	0.02	0.51	0.10	0.65	0.02	
05/12/2024 14:45:00	0.67	0.06	0.09	0.05	0.25	0.23	0.21	0.55	0.03	0.51	0.10	0.66	-0.01	
05/12/2024 15:00:00	0.68	0.04	0.09	0.05	0.25	0.23	0.21	0.55	0.02	0.52	0.10	0.67	0.01	
05/12/2024 15:15:00	0.69	0.06	0.09	0.05	0.25	0.23	0.21	0.55	0.01	0.52	0.09	0.67	0.01	
05/12/2024 15:30:00	0.69	0.05	0.09	0.05	0.25	0.23	0.21	0.55	0.02	0.52	0.09	0.68	0.01	
05/12/2024 15:45:00	0.70	0.05	0.09	0.05	0.25	0.23	0.21	0.55	0.02	0.52	0.10	0.69	0.01	
05/12/2024 16:00:00	0.70	0.03	0.09	0.05	0.25	0.23	0.21	0.55	0.02	0.53	0.10	0.69	0.01	
05/12/2024 16:15:00	0.71	0.05	0.08	0.05	0.25	0.23	0.21	0.55	0.03	0.53	0.07	0.70	-0.01	
05/12/2024 16:30:00	0.71	0.05	0.08	0.05	0.25	0.23	0.21	0.55	0.01	0.53	0.08	0.68	0.04	
05/12/2024 16:45:00	0.72	0.07	0.08	0.05	0.25	0.23	0.21	0.55	0.03	0.54	0.08	0.66	0.03	
05/12/2024 17:00:00	0.72	0.08	0.08	0.04	0.25	0.23	0.21	0.55	0.03	0.54	0.09	0.65	0.11	
05/12/2024 17:15:00	0.72	0.06	0.08	0.05	0.25	0.23	0.21	0.55	0.04	0.54	0.07	0.63	0.06	
05/12/2024 17:30:00	0.71	0.06	0.08	0.05	0.25	0.23	0.21	0.55	0.03	0.54	0.10	0.61	0.08	
05/12/2024 17:45:00	0.71	0.07	0.08	0.05	0.25	0.23	0.21	0.56	0.03	0.54	0.06	0.59	0.09	
05/12/2024 18:00:00	0.71	0.08	0.08	0.04	0.25	0.23	0.21	0.58	0.05	0.54	0.07	0.58	0.09	
05/12/2024 18:15:00	0.71	0.08	0.08	0.05	0.25	0.23	0.21	0.60	0.06	0.54	0.07	0.57	0.10	
05/12/2024 18:30:00	0.70	0.09	0.08	0.05	0.25	0.23	0.21	0.60	0.04	0.54	0.07	0.56	0.06	
05/12/2024 18:45:00	0.70	0.08	0.08	0.05	0.25	0.24	0.21	0.60	0.06	0.54	0.09	0.56	0.07	
05/12/2024 19:00:00	0.70	0.09	0.08	0.05	0.26	0.24	0.22	0.60	0.05	0.54	0.07	0.56	0.07	
05/12/2024 19:15:00	0.69	0.08	0.09	0.05	0.26	0.24	0.22	0.60	0.06	0.54	0.09	0.58	0.04	
05/12/2024 19:30:00	0.69	0.09	0.09	0.05	0.27	0.24	0.23	0.60	0.06	0.54	0.09	0.61	0.03	
05/12/2024 19:45:00	0.70	0.08	0.09	0.06	0.27	0.24	0.24	0.60	0.05	0.54	0.09	0.63	0.03	
05/12/2024 20:00:00	0.70	0.07	0.10	0.06	0.28	0.24	0.25	0.61	0.08	0.55	0.08	0.65	0.04	
05/12/2024 20:15:00	0.71	0.08	0.10	0.06	0.28	0.24	0.25	0.66	0.08	0.55	0.08	0.67	0.02	
05/12/2024 20:30:00	0.71	0.06	0.10	0.06	0.29	0.25	0.26	0.67	0.07	0.55	0.08	0.68	0.01	
05/12/2024 20:45:00	0.72	0.06	0.11	0.07	0.29	0.25	0.26	0.64	0.06	0.55	0.10	0.69	0.03	
05/12/2024 21:00:00	0.72	0.06	0.11	0.07	0.30	0.25	0.27	0.64	0.05	0.56	0.06	0.71	0.01	
05/12/2024 21:15:00	0.73	0.06	0.12	0.08	0.30	0.25	0.28	0.63	0.05	0.56	0.08	0.72	0.03	
05/12/2024 21:30:00	0.74	0.07	0.12	0.08	0.30	0.25	0.27	0.63	0.05	0.56	0.09	0.72	0.04	
05/12/2024 21:45:00	0.74	0.06	0.13	0.09	0.30	0.25	0.27	0.62	0.05	0.57	0.08	0.73	0.04	
05/12/2024 22:00:00	0.75	0.06	0.13	0.09	0.30	0.25	0.27	0.61	0.04	0.57	0.10	0.73	0.03	
05/12/2024 22:15:00	0.75	0.05	0.13	0.09	0.30	0.25	0.27	0.61	0.04	0.57	0.09	0.74	0.04	
05/12/2024 22:30:00	0.76	0.05	0.14	0.10	0.31	0.25	0.29	0.60	0.04	0.58	0.09	0.74	0.04	
05/12/2024 22:45:00	0.76	0.04	0.13	0.10	0.31	0.26	0.28	0.60	0.04	0.58	0.09	0.75	0.03	
05/12/2024 23:00:00	0.77	0.04	0.14	0.10	0.29	0.25	0.26	0.60	0.03	0.58	0.08	0.75	0.03	
05/12/2024 23:15:00	0.77	0.05	0.14	0.10	0.29	0.25	0.26	0.59	0.04	0.58	0.09	0.76	0.04	
05/12/2024 23:30:00	0.77	0.06	0.14	0.10	0.29	0.25	0.25	0.59	0.04	0.59	0.10	0.76	0.04	
05/12/2024 23:45:00	0.78	0.04	0.14	0.10	0.29	0.25	0.25	0.59	0.04	0.59	0.08	0.76	0.03	
06/12/2024 00:00:00	0.78	0.06	0.13	0.10	0.28	0.25	0.25	0.59	0.04	0.59	0.10	0.76	0.04	
06/12/2024 00:15:00	0.78	0.06	0.13	0.09	0.28	0.25	0.25	0.59	0.04	0.60	0.09	0.76	0.04	
06/12/2024 00:30:00	0.79	0.06	0.13	0.09	0.28	0.25	0.25	0.59	0.04	0.60	0.08	0.76	0.04	
06/12/2024 00:45:00	0.79	0.06	0.13	0.09	0.28	0.25	0.25	0.59	0.04	0.60	0.09	0.76	0.05	
06/12/2024 01:00:00	0.79	0.06	0.13	0.09	0.28	0.25	0.25	0.59	0.04	0.60	0.09	0.77	0.04	
06/12/2024 01:15:00	0.79	0.05	0.13	0.09	0.28	0.25	0.25	0.59	0.05	0.60	0.09	0.77	0.04	
06/12/2024 01:30:00	0.80	0.05	0.13	0.09	0.28	0.25	0.24	0.59	0.03	0.60	0.08	0.77	0.04	
06/12/2024 01:45:00	0.80	0.03	0.13	0.09	0.28	0.25	0.24	0.59	0.03	0.61	0.09	0.78	0.05	
06/12/2024 02:00:00	0.80	-0.04	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.61	0.09	0.78	0.04	
06/12/2024 02:15:00	0.80	0.03	0.13	0.09	0.28	0.24	0.24	0.59	0.03	0.61	0.08	0.78	0.04	
06/12/2024 02:30:00	0.80	0.05	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.61	0.09	0.78	0.05	
06/12/2024 02:45:00	0.80	0.03	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.61	0.10	0.78	0.03	
06/12/2024 03:00:00	0.81	-0.01	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.61	0.10	0.78	0.04	
06/12/2024 03:15:00	0.81	0.05	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.61	0.09	0.79	0.04	
06/12/2024 03:30:00	0.81	0.06	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.61	0.08	0.79	0.05	
06/12/2024 03:45:00	0.81	0.04	0.13	0.09	0.28	0.24	0.24	0.59	0.05	0.62	0.10	0.79	0.04	
06/12/2024 04:00:00	0.81	0.05	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.62	0.08	0.79	0.04	
06/12/2024 04:15:00	0.81	0.05	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.62	0.11	0.79	0.04	
06/12/2024 04:30:00	0.81	0.06	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.62	0.10	0.79	0.04	
06/12/2024 04:45:00	0.81	0.04	0.13	0.09	0.28	0.24	0.24	0.59	0.05	0.62	0.10	0.79	0.04	
06/12/2024 05:00:00	0.81	0.06	0.13	0.09	0.28	0.24	0.24	0.59	0.05	0.62	0.10	0.79	0.03	
06/12/2024 05:15:00	0.82	0.06	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.62	0.10	0.79	0.04	
06/12/2024 05:30:00	0.82	0.05	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.62	0.10	0.79	0.03	
06/12/2024 05:45:00	0.82	0.06	0.13	0.09	0.28	0.24	0.24	0.59	0.02	0.62	0.10	0.77	0.07	
06/12/2024 06:00:00	0.81	0.10	0.13	0.09	0.28	0.24	0.24	0.59	0.00	0.62	0.10	0.76	0.09	
06/12/2024 06:15:00	0.81	0.08	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.62	0.10	0.74	0.07	
06/12/2024 06:30:00	0.81	0.07	0.13	0.09	0.28	0.24	0.24	0.59	0.05	0.62	0.10	0.72	0.09	
06/12/2024 06:45:00	0.81	0.06	0.13	0.09	0.28	0.24	0.24	0.59	0.03	0.62	0.10	0.71	0.11	
06/12/2024 07:00:00	0.80	0.05	0.13	0.09	0.28	0.24	0.25	0.59	0.00	0.62	0.10	0.70	0.11	
06/12/2024 07:15:00	0.80	0.08	0.13	0.09	0.28	0.24	0.25	0.59	0.05	0.62	0.10	0.69	0.06	
06/12/2024 07:30:00	0.79	0.07	0.13	0.09	0.28	0.24	0.25	0.59	0.04	0.62	0.10	0.69	0.10	
06/12/2024 07:45:00	0.79	0.07	0.13	0.09	0.28	0.24	0.25	0.60	0.05	0.61	0.10	0.70	0.07	
06/12/2024 08:00:00	0.79	0.09	0.13	0.09	0.28	0.24	0.25	0.60	0.04	0.61	0.11	0.72	0.07	
06/12/2024 08:15:00	0.79	0.06	0.13	0.09	0.28	0.24	0.25	0.60	0.05	0.61	0.11	0.74	0.03	
06/12/2024 08:30:00	0.79	0.05	0.13	0.09	0.28	0.24	0.25	0.60	0.05	0.61	0.11	0.75	0.03	
06/12/2024 08:45:00	0.79	0.07	0.13	0.09	0.28	0.24	0.25	0.60	0.05	0.61	0.09	0.76	0.03	
06/12/2024 09:00:00	0.79	0.07	0.14	0.10	0.28	0.24	0.25	0.60	0.05	0.61	0.11	0.77	0.00	
06/12/2024 09:15:00	0.80	0.06	0.14	0.10	0.28	0.24	0.25	0.60	0.05	0.61	0.11	0.77	0.03	
06/12/2024 09:30:00	0.80	0.05	0.14	0.10	0.28	0.24	0.25	0.60	0.06	0.61	0.11	0.78	0.01	
06/12/2024 09:45:00	0.80	0.05	0.14	0.10	0.28	0.24	0.25	0.60	0.06	0.61	0.11	0.78	0.03	
06/12/2024 10:00:00	0.81	0.07	0.13	0.10	0.28	0.24	0.25	0.60	0.03	0.62	0.11	0.78	0.00	
06/12/2024 10:15:00	0.81	0.05	0.14	0.10	0.28	0.24	0.25	0.60	0.04	0.62	0.11	0.78	0.03	
06/12/2024 10:30:00	0.81	0.00	0.14	0.10	0.28	0.24	0.25	0.60	0.02	0.62	0.11	0.79	0.03	
06/12/2024 10:45:00	0.81	0.06	0.14	0.10	0.29	0.24	0.25	0.60	0.03	0.62	0.10	0.79	0.01	
06/12/2024 11:00:00	0.81	0.06	0.14	0.10	0.29	0.24	0.26	0.60	0.03	0.62	0.10	0.79	0.03	
06/12/2024 11:15:00	0.82	0.02	0.14	0.10	0.29	0.24	0.26	0.60	0.04	0.62	0.10	0.79	0.03	
06/12/2024 11:30:00	0.82	0.03	0.13	0.09	0.29	0.24	0.26	0.60	0.04	0.62	0.10	0.79	0.02	
06/12/2024 11:45:00	0.82	0.06	0.14	0.10	0.29	0.24	0.26	0.60	0.04	0.62	0.10	0.80	0.01	
06/12/2024 12:00:00	0.82	0.06	0.14	0.10	0.29	0.24	0.26	0.60	0.04	0.63	0.10	0.80	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
06/12/2024 12:15:00	0.82	0.00	0.14	0.10	0.29	0.24	0.25	0.60	0.05	0.63	0.10	0.80	0.01	
06/12/2024 12:30:00	0.82	0.00	0.14	0.10	0.29	0.24	0.25	0.60	0.06	0.63	0.10	0.80	0.04	
06/12/2024 12:45:00	0.83	0.05	0.14	0.10	0.29	0.24	0.25	0.60	0.06	0.63	0.10	0.81	0.00	
06/12/2024 13:00:00	0.83	0.06	0.14	0.10	0.29	0.24	0.25	0.60	0.06	0.63	0.10	0.81	0.01	
06/12/2024 13:15:00	0.83	0.04	0.14	0.10	0.29	0.24	0.25	0.60	0.06	0.63	0.09	0.81	0.00	
06/12/2024 13:30:00	0.83	0.05	0.14	0.10	0.29	0.24	0.25	0.60	0.04	0.63	0.09	0.81	-0.01	
06/12/2024 13:45:00	0.83	0.05	0.14	0.10	0.29	0.24	0.25	0.60	0.05	0.63	0.09	0.81	0.02	
06/12/2024 14:00:00	0.83	0.00	0.14	0.10	0.28	0.24	0.25	0.60	0.05	0.63	0.09	0.82	0.02	
06/12/2024 14:15:00	0.83	0.05	0.14	0.10	0.28	0.24	0.25	0.60	0.05	0.64	0.09	0.82	0.00	
06/12/2024 14:30:00	0.84	0.06	0.14	0.10	0.28	0.24	0.25	0.60	0.05	0.64	0.09	0.82	0.00	
06/12/2024 14:45:00	0.84	0.05	0.14	0.10	0.28	0.24	0.25	0.60	0.05	0.64	0.09	0.82	0.02	
06/12/2024 15:00:00	0.84	0.00	0.14	0.10	0.28	0.24	0.25	0.60	0.05	0.64	0.09	0.83	0.01	
06/12/2024 15:15:00	0.84	0.04	0.14	0.10	0.28	0.24	0.25	0.60	0.05	0.64	0.09	0.83	0.02	
06/12/2024 15:30:00	0.84	0.05	0.14	0.10	0.28	0.24	0.25	0.60	0.05	0.64	0.09	0.83	0.01	
06/12/2024 15:45:00	0.84	0.05	0.14	0.10	0.28	0.24	0.25	0.59	0.05	0.64	0.09	0.83	0.02	
06/12/2024 16:00:00	0.85	0.00	0.14	0.10	0.28	0.24	0.25	0.59	0.06	0.64	0.09	0.83	0.02	
06/12/2024 16:15:00	0.85	0.05	0.13	0.09	0.28	0.24	0.25	0.59	0.04	0.64	0.09	0.83	0.03	
06/12/2024 16:30:00	0.85	0.07	0.13	0.09	0.28	0.24	0.25	0.59	0.04	0.65	0.09	0.83	0.02	
06/12/2024 16:45:00	0.85	0.00	0.13	0.10	0.28	0.24	0.25	0.59	0.05	0.65	0.09	0.84	0.03	
06/12/2024 17:00:00	0.85	0.05	0.13	0.09	0.28	0.24	0.25	0.59	0.05	0.65	0.09	0.84	0.01	
06/12/2024 17:15:00	0.85	0.05	0.13	0.09	0.28	0.24	0.25	0.59	0.05	0.65	0.09	0.83	0.04	
06/12/2024 17:30:00	0.85	0.06	0.13	0.09	0.28	0.24	0.25	0.59	0.04	0.65	0.09	0.81	0.08	
06/12/2024 17:45:00	0.85	0.00	0.13	0.09	0.28	0.24	0.25	0.59	0.04	0.65	0.09	0.80	0.09	
06/12/2024 18:00:00	0.85	0.05	0.13	0.09	0.28	0.24	0.25	0.59	0.05	0.65	0.09	0.78	0.07	
06/12/2024 18:15:00	0.84	0.06	0.13	0.09	0.28	0.24	0.25	0.59	0.04	0.65	0.09	0.76	0.09	
06/12/2024 18:30:00	0.84	0.05	0.13	0.09	0.28	0.24	0.25	0.59	0.04	0.65	0.09	0.74	0.10	
06/12/2024 18:45:00	0.83	0.08	0.13	0.09	0.28	0.24	0.25	0.59	0.04	0.64	0.09	0.72	0.14	
06/12/2024 19:00:00	0.83	0.05	0.13	0.09	0.28	0.24	0.25	0.59	0.04	0.64	0.09	0.71	0.09	
06/12/2024 19:15:00	0.82	0.08	0.13	0.09	0.28	0.24	0.25	0.59	0.05	0.64	0.09	0.69	0.15	
06/12/2024 19:30:00	0.82	0.07	0.13	0.09	0.28	0.24	0.25	0.59	0.05	0.64	0.09	0.68	0.13	
06/12/2024 19:45:00	0.81	0.08	0.13	0.09	0.28	0.24	0.25	0.59	0.03	0.63	0.08	0.67	0.13	
06/12/2024 20:00:00	0.81	0.09	0.13	0.09	0.28	0.24	0.25	0.59	0.03	0.63	0.09	0.66	0.16	
06/12/2024 20:15:00	0.80	0.07	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.63	0.10	0.65	0.11	
06/12/2024 20:30:00	0.80	0.08	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.63	0.08	0.65	0.12	
06/12/2024 20:45:00	0.79	0.10	0.13	0.09	0.28	0.24	0.24	0.59	0.02	0.62	0.10	0.64	0.12	
06/12/2024 21:00:00	0.79	0.09	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.62	0.08	0.63	0.13	
06/12/2024 21:15:00	0.79	0.09	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.62	0.08	0.63	0.15	
06/12/2024 21:30:00	0.78	0.09	0.12	0.08	0.28	0.24	0.24	0.59	0.03	0.62	0.07	0.63	0.11	
06/12/2024 21:45:00	0.78	0.10	0.12	0.08	0.28	0.24	0.24	0.59	0.03	0.62	0.10	0.64	0.08	
06/12/2024 22:00:00	0.77	0.08	0.13	0.09	0.28	0.24	0.24	0.59	0.03	0.61	0.10	0.65	0.08	
06/12/2024 22:15:00	0.77	0.10	0.13	0.09	0.28	0.24	0.24	0.59	0.04	0.61	0.09	0.66	0.06	
06/12/2024 22:30:00	0.77	0.08	0.13	0.09	0.28	0.24	0.24	0.59	0.05	0.61	0.09	0.68	0.04	
06/12/2024 22:45:00	0.77	0.08	0.12	0.08	0.28	0.24	0.24	0.59	0.04	0.61	0.09	0.71	0.04	
06/12/2024 23:00:00	0.78	0.06	0.12	0.08	0.27	0.24	0.24	0.59	0.00	0.61	0.08	0.73	0.03	
06/12/2024 23:15:00	0.78	0.08	0.12	0.08	0.28	0.24	0.24	0.59	0.04	0.61	0.08	0.75	0.03	
06/12/2024 23:30:00	0.79	0.07	0.12	0.08	0.27	0.24	0.24	0.59	0.04	0.61	0.07	0.76	0.02	
06/12/2024 23:45:00	0.79	0.08	0.12	0.08	0.27	0.24	0.24	0.59	0.04	0.61	0.08	0.77	0.03	
07/12/2024 00:00:00	0.80	0.08	0.12	0.08	0.27	0.24	0.24	0.59	0.04	0.62	0.09	0.77	0.04	
07/12/2024 00:15:00	0.80	0.06	0.12	0.08	0.27	0.24	0.24	0.60	0.04	0.62	0.08	0.78	0.04	
07/12/2024 00:30:00	0.81	0.07	0.12	0.08	0.27	0.24	0.24	0.60	0.04	0.62	0.11	0.78	0.04	
07/12/2024 00:45:00	0.81	0.06	0.12	0.08	0.27	0.24	0.24	0.59	0.04	0.63	0.06	0.79	0.04	
07/12/2024 01:00:00	0.82	0.06	0.12	0.08	0.27	0.24	0.24	0.59	0.04	0.63	0.07	0.79	0.03	
07/12/2024 01:15:00	0.82	0.05	0.12	0.08	0.27	0.25	0.24	0.59	0.03	0.63	0.09	0.79	0.04	
07/12/2024 01:30:00	0.82	0.07	0.12	0.08	0.27	0.25	0.24	0.59	0.04	0.63	0.09	0.80	0.03	
07/12/2024 01:45:00	0.83	0.08	0.12	0.08	0.27	0.25	0.24	0.59	0.03	0.63	0.08	0.80	0.03	
07/12/2024 02:00:00	0.83	0.06	0.12	0.08	0.27	0.25	0.24	0.59	0.03	0.64	0.10	0.81	0.05	
07/12/2024 02:15:00	0.83	0.08	0.12	0.08	0.27	0.25	0.23	0.59	0.03	0.64	0.07	0.81	0.05	
07/12/2024 02:30:00	0.83	0.05	0.12	0.08	0.27	0.25	0.23	0.57	0.02	0.64	0.05	0.81	0.06	
07/12/2024 02:45:00	0.84	0.10	0.12	0.08	0.27	0.25	0.23	0.58	0.03	0.64	0.07	0.79	0.05	
07/12/2024 03:00:00	0.83	0.08	0.12	0.08	0.27	0.25	0.23	0.58	0.04	0.64	0.07	0.78	0.08	
07/12/2024 03:15:00	0.83	0.07	0.12	0.08	0.27	0.25	0.23	0.58	0.03	0.64	0.07	0.77	0.10	
07/12/2024 03:30:00	0.83	0.08	0.12	0.08	0.27	0.25	0.23	0.58	0.03	0.64	0.07	0.76	0.11	
07/12/2024 03:45:00	0.83	0.08	0.12	0.08	0.27	0.25	0.23	0.58	0.04	0.64	0.08	0.74	0.11	
07/12/2024 04:00:00	0.82	0.07	0.12	0.08	0.27	0.25	0.23	0.58	0.04	0.64	0.09	0.72	0.12	
07/12/2024 04:15:00	0.82	0.09	0.12	0.08	0.26	0.25	0.23	0.58	0.04	0.64	0.11	0.70	0.12	
07/12/2024 04:30:00	0.81	0.08	0.12	0.08	0.26	0.25	0.22	0.57	0.04	0.64	0.11	0.68	0.12	
07/12/2024 04:45:00	0.81	0.09	0.12	0.08	0.26	0.25	0.22	0.57	0.03	0.64	0.11	0.67	0.11	
07/12/2024 05:00:00	0.80	0.08	0.12	0.08	0.26	0.25	0.22	0.57	0.03	0.63	0.11	0.66	0.14	
07/12/2024 05:15:00	0.80	0.08	0.11	0.07	0.26	0.25	0.22	0.57	0.03	0.63	0.11	0.65	0.09	
07/12/2024 05:30:00	0.79	0.09	0.11	0.07	0.26	0.25	0.22	0.57	0.03	0.63	0.11	0.64	0.10	
07/12/2024 05:45:00	0.79	0.10	0.11	0.07	0.26	0.25	0.22	0.57	0.03	0.63	0.11	0.63	0.13	
07/12/2024 06:00:00	0.78	0.09	0.11	0.07	0.26	0.25	0.22	0.56	0.03	0.62	0.11	0.62	0.11	
07/12/2024 06:15:00	0.78	0.09	0.11	0.07	0.26	0.25	0.22	0.56	0.03	0.62	0.11	0.62	0.09	
07/12/2024 06:30:00	0.77	0.10	0.11	0.07	0.25	0.25	0.21	0.56	0.02	0.62	0.11	0.61	0.14	
07/12/2024 06:45:00	0.77	0.09	0.11	0.07	0.25	0.25	0.21	0.56	0.02	0.62	0.11	0.60	0.12	
07/12/2024 07:00:00	0.77	0.09	0.11	0.07	0.25	0.25	0.21	0.56	0.00	0.61	0.11	0.60	0.15	
07/12/2024 07:15:00	0.76	0.09	0.11	0.07	0.25	0.25	0.21	0.56	0.01	0.61	0.10	0.60	0.12	
07/12/2024 07:30:00	0.76	0.10	0.11	0.07	0.25	0.25	0.21	0.56	0.02	0.61	0.11	0.59	0.10	
07/12/2024 07:45:00	0.76	0.08	0.11	0.07	0.25	0.25	0.21	0.56	0.02	0.61	0.11	0.59	0.14	
07/12/2024 08:00:00	0.75	0.09	0.11	0.07	0.25	0.25	0.20	0.56	0.02	0.61	0.11	0.58	0.12	
07/12/2024 08:15:00	0.75	0.08	0.10	0.06	0.25	0.25	0.20	0.56	0.03	0.60	0.11	0.57	0.14	
07/12/2024 08:30:00	0.75	0.09	0.10	0.06	0.24	0.25	0.20	0.56	0.03	0.60	0.11	0.57	0.10	
07/12/2024 08:45:00	0.75	0.08	0.10	0.06	0.24	0.25	0.20	0.56	0.02	0.60	0.11	0.57	0.10	
07/12/2024 09:00:00	0.74	0.09	0.10	0.06	0.24	0.25	0.20	0.56	0.02	0.60	0.11	0.56	0.08	
07/12/2024 09:15:00	0.74	0.09	0.10	0.06	0.24	0.24	0.20	0.56	0.03	0.60	0.13	0.56	0.11	
07/12/2024 09:30:00	0.74	0.10	0.10	0.06	0.24	0.24	0.20	0.56	0.02	0.60	0.11	0.56	0.11	
07/12/2024 09:45:00	0.74	0.08	0.10	0.06	0.24	0.24	0.19	0.56	0.02	0.60	0.11	0.56	0.11	
07/12/2024 10:00:00	0.73	0.09	0.10	0.06	0.24	0.24	0.19	0.56	0.02	0.59	0.12	0.55	0.09	
07/12/2024 10:15:00	0.73	0.08	0.10	0.06	0.24	0.24	0.19	0.57	0.02	0.59	0.12	0.55	0.11	
07/12/2024 10:30:00	0.73	0.09	0.10	0.06	0.24	0.24	0.19	0.57	0.04	0.59	0.11	0.55	0.11	
07/12/2024 10:45:00	0.73	0.08	0.10	0.06	0.24	0.24	0.19	0.58	0.03	0.59	0.12	0.54	0.08	
07/12/2024 11:00:00	0.73	0.10	0.10	0.06	0.24	0.24	0.19	0.59	0.04	0.59	0.12	0.54	0.08	
07/12/2024 11:15:00	0.72	0.10	0.10	0.06	0.24	0.24	0.19	0.59	0.05	0.59	0.11	0.54	0.09	
07/12/2024 11:30:00	0.72	0.09	0.10	0.06	0.24	0.24	0.19	0.60	0.04	0.59	0.12	0.55	0.09	
07/12/2024 11:45:00	0.72	0.09	0.10	0.06	0.24	0.24	0.19	0.60	0.03	0.59	0.11	0.55	0.04	
07/12/2024 12:00:00	0.72	0.10	0.11	0.07	0.24	0.24	0.20	0.60	0.04	0.59	0.11	0.57	0.10	
07/12/2024 12:15:00	0.72	0.10	0.11	0.07	0.24	0.24	0.20	0.60	0.03	0.59	0.10	0.62	0.04	
07/12/2024 12:30:00	0.72	0.09	0.11	0.07	0.24	0.24	0.20	0.60	0.04	0.59	0.12	0.66	0.03	
07/12/2024 12:45:00	0.72	0.08	0.11	0.07	0.25	0.24	0.20	0.60	0.04	0.59	0.12	0.68	0.02	
07/12/2024 13:00:00	0.73	0.06	0.11	0.07	0.25	0.24	0.21	0.60	0.04	0.59	0.12	0.71	0.02	
07/12/2024 13:15:00	0.74	0.06	0.11	0.07	0.25	0.24	0.21	0.60	0.04	0.59	0.12	0.72	0.03	
07/12/2024 13:30:00	0.75	0.05	0.11	0.07	0.25	0.24	0.21	0.59	0.04	0.59	0.12	0.74	0.01	
07/12/2024 13:45:00	0.76	0.04	0.12	0.08	0.25	0.24	0.21	0.59	0.04	0.59	0.12	0.75	0.02	
07/12/2024 14:00:00	0.77	0.04	0.12	0.08	0.25	0.24	0.21	0.59	0.03	0.60	0.11	0.76	0.00	
07/12/2024 14:15:00	0.77	0.04	0.12	0.08	0.25	0.24	0.21	0.58	0.03	0.60	0.12	0.76	0.03	
07/12/2024 14:30:00	0.78	0.04	0.12	0.08	0.25	0.24	0.21	0.58	0.04	0.60	0.12	0.77	0.02	
07/12/2024 14:45:00	0.79	0.04	0.12	0.08	0.25	0.25	0.21	0.58	0.04	0.61	0.12	0.78	0.03	
07/12/2024 15:00:00	0.79	0.06	0.12	0.08	0.25	0.25	0.21	0.58	0.04	0.61	0.10	0.78	0.02	
07/12/2024 15:15:00	0.80	0.06	0.12	0.08	0.26	0.25	0.22	0.58	0.04	0.61	0.10	0.79	0.02	
07/12/2024 15:30:00	0.80	0.02	0.12	0.08	0.26	0.24	0.22	0.59	0.03	0.61	0.11	0.79	0.04	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
07/12/2024 15:45:00	0.81	0.04	0.12	0.08	0.26	0.24	0.21	0.59	0.04	0.62	0.10	0.80	0.04	
07/12/2024 16:00:00	0.81	0.04	0.12	0.08	0.26	0.24	0.21	0.59	0.04	0.62	0.12	0.80	0.03	
07/12/2024 16:15:00	0.81	0.04	0.12	0.08	0.26	0.24	0.21	0.59	0.04	0.62	0.12	0.80	0.04	
07/12/2024 16:30:00	0.81	0.03	0.12	0.08	0.26	0.24	0.22	0.59	0.03	0.62	0.11	0.80	0.03	
07/12/2024 16:45:00	0.82	0.04	0.12	0.08	0.26	0.24	0.22	0.59	0.03	0.63	0.11	0.80	0.03	
07/12/2024 17:00:00	0.82	0.05	0.12	0.08	0.26	0.24	0.22	0.58	0.03	0.63	0.10	0.81	0.02	
07/12/2024 17:15:00	0.82	0.06	0.12	0.08	0.26	0.24	0.22	0.58	0.03	0.63	0.10	0.81	0.02	
07/12/2024 17:30:00	0.82	0.04	0.12	0.08	0.26	0.24	0.22	0.58	0.04	0.63	0.10	0.81	0.04	
07/12/2024 17:45:00	0.83	0.04	0.12	0.08	0.26	0.24	0.22	0.58	0.02	0.63	0.11	0.81	0.01	
07/12/2024 18:00:00	0.83	0.03	0.12	0.08	0.26	0.24	0.22	0.57	0.03	0.63	0.10	0.81	0.03	
07/12/2024 18:15:00	0.83	0.03	0.12	0.08	0.26	0.24	0.22	0.57	0.03	0.63	0.10	0.81	0.02	
07/12/2024 18:30:00	0.83	0.06	0.12	0.08	0.26	0.24	0.22	0.57	0.03	0.64	0.09	0.81	0.05	
07/12/2024 18:45:00	0.83	0.02	0.12	0.08	0.26	0.24	0.22	0.57	0.02	0.64	0.10	0.80	0.07	
07/12/2024 19:00:00	0.83	0.02	0.12	0.08	0.26	0.24	0.21	0.57	0.04	0.64	0.08	0.79	0.08	
07/12/2024 19:15:00	0.83	0.06	0.12	0.08	0.26	0.24	0.21	0.57	0.03	0.64	0.09	0.78	0.06	
07/12/2024 19:30:00	0.83	0.05	0.12	0.08	0.25	0.24	0.21	0.57	0.04	0.64	0.09	0.77	0.06	
07/12/2024 19:45:00	0.82	0.04	0.12	0.08	0.25	0.24	0.21	0.56	0.04	0.64	0.09	0.76	0.09	
07/12/2024 20:00:00	0.82	0.06	0.12	0.08	0.25	0.24	0.21	0.56	0.03	0.63	0.10	0.75	0.09	
07/12/2024 20:15:00	0.82	0.02	0.12	0.08	0.25	0.24	0.21	0.56	0.03	0.63	0.10	0.75	0.07	
07/12/2024 20:30:00	0.82	0.04	0.12	0.08	0.25	0.24	0.21	0.56	0.03	0.63	0.10	0.76	0.04	
07/12/2024 20:45:00	0.81	0.03	0.12	0.08	0.25	0.24	0.21	0.57	0.03	0.63	0.10	0.77	0.04	
07/12/2024 21:00:00	0.82	0.05	0.12	0.08	0.25	0.24	0.21	0.57	0.04	0.63	0.10	0.78	0.05	
07/12/2024 21:15:00	0.82	0.06	0.12	0.08	0.25	0.24	0.21	0.57	0.04	0.63	0.09	0.80	0.04	
07/12/2024 21:30:00	0.82	0.05	0.12	0.08	0.25	0.24	0.21	0.57	0.03	0.63	0.10	0.80	0.01	
07/12/2024 21:45:00	0.82	0.05	0.12	0.08	0.25	0.24	0.21	0.57	0.03	0.63	0.10	0.81	0.03	
07/12/2024 22:00:00	0.83	0.06	0.12	0.08	0.25	0.24	0.21	0.57	0.04	0.63	0.11	0.81	0.03	
07/12/2024 22:15:00	0.83	0.05	0.12	0.08	0.25	0.24	0.21	0.58	0.05	0.63	0.11	0.82	0.04	
07/12/2024 22:30:00	0.83	0.05	0.12	0.08	0.25	0.24	0.21	0.58	0.04	0.64	0.10	0.82	0.02	
07/12/2024 22:45:00	0.83	0.05	0.12	0.08	0.25	0.24	0.21	0.58	0.03	0.64	0.09	0.82	0.03	
07/12/2024 23:00:00	0.83	0.04	0.12	0.08	0.25	0.24	0.21	0.57	0.03	0.64	0.10	0.82	0.02	
07/12/2024 23:15:00	0.84	0.05	0.12	0.08	0.25	0.24	0.21	0.57	0.03	0.64	0.10	0.82	0.04	
07/12/2024 23:30:00	0.84	0.05	0.12	0.08	0.25	0.23	0.21	0.57	0.03	0.64	0.09	0.83	0.02	
07/12/2024 23:45:00	0.84	0.06	0.12	0.08	0.25	0.24	0.21	0.56	0.03	0.64	0.09	0.83	0.02	
08/12/2024 00:00:00	0.84	0.03	0.12	0.08	0.25	0.24	0.21	0.56	0.03	0.64	0.09	0.83	0.03	
08/12/2024 00:15:00	0.84	0.05	0.12	0.08	0.25	0.24	0.21	0.56	0.03	0.64	0.10	0.83	0.04	
08/12/2024 00:30:00	0.85	0.04	0.12	0.08	0.25	0.24	0.21	0.55	0.02	0.64	0.10	0.83	0.02	
08/12/2024 00:45:00	0.85	0.04	0.12	0.08	0.25	0.23	0.21	0.55	0.02	0.65	0.10	0.84	0.04	
08/12/2024 01:00:00	0.85	0.04	0.12	0.08	0.25	0.23	0.21	0.55	0.02	0.65	0.10	0.84	0.04	
08/12/2024 01:15:00	0.85	-0.11	0.12	0.08	0.25	0.23	0.21	0.54	0.02	0.65	0.09	0.84	0.02	
08/12/2024 01:30:00	0.85	-0.02	0.12	0.08	0.25	0.23	0.21	0.54	0.02	0.65	0.09	0.84	0.02	
08/12/2024 01:45:00	0.85	0.05	0.12	0.08	0.25	0.23	0.20	0.54	0.02	0.65	0.09	0.85	0.03	
08/12/2024 02:00:00	0.86	0.04	0.12	0.08	0.25	0.23	0.20	0.54	0.02	0.65	0.09	0.85	0.04	
08/12/2024 02:15:00	0.86	0.05	0.11	0.07	0.25	0.23	0.20	0.54	0.03	0.65	0.09	0.85	0.04	
08/12/2024 02:30:00	0.86	0.00	0.12	0.08	0.25	0.23	0.20	0.55	0.03	0.66	0.08	0.85	0.04	
08/12/2024 02:45:00	0.86	0.05	0.11	0.07	0.24	0.23	0.20	0.57	0.04	0.66	0.08	0.86	0.03	
08/12/2024 03:00:00	0.86	-0.26	0.11	0.07	0.24	0.23	0.20	0.57	0.03	0.66	0.09	0.86	0.04	
08/12/2024 03:15:00	0.87	-0.28	0.11	0.07	0.24	0.23	0.20	0.58	0.05	0.66	0.09	0.86	0.03	
08/12/2024 03:30:00	0.87	-0.30	0.11	0.07	0.24	0.23	0.20	0.58	0.04	0.66	0.08	0.86	0.04	
08/12/2024 03:45:00	0.87	-0.33	0.11	0.07	0.25	0.23	0.20	0.58	0.04	0.66	0.09	0.86	0.03	
08/12/2024 04:00:00	0.87	0.06	0.11	0.07	0.25	0.23	0.20	0.59	0.04	0.66	0.08	0.86	0.03	
08/12/2024 04:15:00	0.87	-0.34	0.12	0.08	0.25	0.23	0.21	0.59	0.03	0.66	0.09	0.87	0.04	
08/12/2024 04:30:00	0.87	-0.28	0.12	0.08	0.25	0.23	0.21	0.59	0.03	0.66	0.09	0.87	0.03	
08/12/2024 04:45:00	0.87		0.12	0.08	0.25	0.24	0.21	0.58	0.03	0.67	0.08	0.87	0.04	
08/12/2024 05:00:00	0.87	-0.29	0.12	0.08	0.25	0.24	0.21	0.58	0.04	0.67	0.08	0.87	0.04	
08/12/2024 05:15:00	0.88	-0.29	0.12	0.08	0.26	0.24	0.22	0.58	0.04	0.67	0.08	0.87	0.04	
08/12/2024 05:30:00	0.88	-0.29	0.12	0.08	0.26	0.24	0.22	0.57	0.03	0.67	0.08	0.87	0.04	
08/12/2024 05:45:00	0.88	-0.34	0.13	0.09	0.26	0.24	0.22	0.57	0.02	0.67	0.08	0.87	0.04	
08/12/2024 06:00:00	0.88	-0.26	0.13	0.09	0.26	0.24	0.22	0.57	0.03	0.67	0.08	0.88	0.03	
08/12/2024 06:15:00	0.88		0.13	0.09	0.26	0.24	0.22	0.57	0.04	0.67	0.07	0.88	0.03	
08/12/2024 06:30:00	0.88	-0.34	0.12	0.08	0.26	0.24	0.22	0.57	0.04	0.67	0.08	0.88	0.03	
08/12/2024 06:45:00	0.88	-0.35	0.13	0.09	0.26	0.24	0.22	0.58	0.04	0.67	0.08	0.88	0.04	
08/12/2024 07:00:00	0.88	-0.37	0.13	0.09	0.26	0.24	0.22	0.58	0.04	0.67	0.08	0.88	0.04	
08/12/2024 07:15:00	0.88	-0.32	0.13	0.09	0.26	0.24	0.22	0.58	0.03	0.67	0.07	0.87	0.06	
08/12/2024 07:30:00	0.88	-0.32	0.13	0.09	0.26	0.24	0.22	0.58	0.03	0.68	0.07	0.85	0.07	
08/12/2024 07:45:00	0.88	-0.29	0.13	0.09	0.26	0.24	0.22	0.57	0.04	0.67	0.07	0.83	0.11	
08/12/2024 08:00:00	0.88	0.07	0.13	0.09	0.26	0.24	0.22	0.57	0.03	0.67	0.07	0.82	0.10	
08/12/2024 08:15:00	0.87	0.05	0.13	0.09	0.26	0.24	0.22	0.57	0.03	0.67	0.08	0.80	0.12	
08/12/2024 08:30:00	0.87	-0.30	0.13	0.09	0.26	0.24	0.22	0.57	0.03	0.67	0.08	0.79	0.13	
08/12/2024 08:45:00	0.86	0.06	0.13	0.09	0.26	0.24	0.22	0.57	0.03	0.67	0.08	0.77	0.12	
08/12/2024 09:00:00	0.86	0.06	0.13	0.09	0.26	0.24	0.22	0.57	0.04	0.66	0.08	0.76	0.12	
08/12/2024 09:15:00	0.85	-0.33	0.13	0.09	0.26	0.24	0.22	0.57	0.03	0.66	0.08	0.75	0.10	
08/12/2024 09:30:00	0.85	-0.32	0.13	0.09	0.26	0.24	0.22	0.57	0.03	0.66	0.09	0.74	0.10	
08/12/2024 09:45:00	0.84	-0.28	0.13	0.09	0.26	0.24	0.22	0.57	0.04	0.66	0.09	0.73	0.12	
08/12/2024 10:00:00	0.84	-0.29	0.13	0.09	0.26	0.24	0.22	0.57	0.04	0.65	0.10	0.72	0.11	
08/12/2024 10:15:00	0.83	-0.30	0.13	0.09	0.26	0.24	0.22	0.57	0.03	0.65	0.10	0.71	0.11	
08/12/2024 10:30:00	0.83	-0.30	0.13	0.09	0.26	0.24	0.22	0.57	0.03	0.65	0.09	0.71	0.13	
08/12/2024 10:45:00	0.82	-0.31	0.12	0.08	0.26	0.24	0.22	0.57	0.02	0.65	0.10	0.70	0.12	
08/12/2024 11:00:00	0.82	0.08	0.13	0.09	0.26	0.24	0.22	0.57	0.02	0.64	0.10	0.71	0.10	
08/12/2024 11:15:00	0.82	-0.28	0.13	0.09	0.26	0.24	0.22	0.57	0.02	0.64	0.10	0.71	0.09	
08/12/2024 11:30:00	0.81	-0.32	0.13	0.09	0.26	0.24	0.22	0.57	0.02	0.64	0.10	0.72	0.08	
08/12/2024 11:45:00	0.81	0.07	0.13	0.09	0.26	0.24	0.22	0.57	0.03	0.64	0.10	0.74	0.07	
08/12/2024 12:00:00	0.81	0.05	0.13	0.09	0.26	0.24	0.22	0.57	0.02	0.64	0.10	0.75	0.06	
08/12/2024 12:15:00	0.81	-0.27	0.13	0.09	0.26	0.24	0.22	0.57	0.01	0.64	0.11	0.77	0.03	
08/12/2024 12:30:00	0.82	-0.27	0.13	0.09	0.26	0.24	0.22	0.57	-0.01	0.63	0.11	0.79	0.02	
08/12/2024 12:45:00	0.82	-0.25	0.13	0.09	0.26	0.24	0.22	0.57	0.01	0.63	0.11	0.80	0.02	
08/12/2024 13:00:00	0.83	-0.24	0.13	0.09	0.26	0.24	0.22	0.57	0.04	0.64	0.11	0.81	0.03	
08/12/2024 13:15:00	0.83	-0.27	0.13	0.09	0.26	0.24	0.22	0.57	0.04	0.64	0.10	0.81	0.05	
08/12/2024 13:30:00	0.83	-0.29	0.13	0.09	0.26	0.24	0.22	0.57	0.05	0.64	0.11	0.82	0.02	
08/12/2024 13:45:00	0.83	-0.31	0.13	0.09	0.26	0.24	0.22	0.58	0.05	0.64	0.11	0.82	0.02	
08/12/2024 14:00:00	0.84	0.05	0.13	0.09	0.26	0.24	0.22	0.59	0.05	0.65	0.10	0.82	0.03	
08/12/2024 14:15:00	0.84	-0.29	0.13	0.09	0.26	0.24	0.22	0.59	0.05	0.65	0.10	0.82	0.03	
08/12/2024 14:30:00	0.84	0.03	0.13	0.09	0.26	0.24	0.23	0.59	0.05	0.65	0.10	0.83	0.01	
08/12/2024 14:45:00	0.85	-0.30	0.13	0.09	0.26	0.24	0.23	0.59	0.05	0.65	0.10	0.83	0.04	
08/12/2024 15:00:00	0.85	0.06	0.13	0.09	0.27	0.24	0.23	0.59	0.05	0.65	0.10	0.83	0.03	
08/12/2024 15:15:00	0.85	0.05	0.13	0.09	0.27	0.24	0.23	0.59	0.04	0.65	0.10	0.84	0.03	
08/12/2024 15:30:00	0.85	-0.29	0.13	0.09	0.27	0.24	0.23	0.60	0.04	0.66	0.10	0.84	0.04	
08/12/2024 15:45:00	0.86	-0.32	0.13	0.10	0.27	0.24	0.23	0.60	0.05	0.66	0.09	0.84	0.03	
08/12/2024 16:00:00	0.86	-0.33	0.13	0.10	0.27	0.24	0.23	0.59	0.04	0.66	0.09	0.84	0.05	
08/12/2024 16:15:00	0.86	-0.29	0.14	0.10	0.27	0.24	0.24	0.59	0.04	0.66	0.09	0.85	0.04	
08/12/2024 16:30:00	0.86	0.05	0.14	0.10	0.27	0.24	0.24	0.59	0.04	0.66	0.09	0.85	0.03	
08/12/2024 16:45:00	0.86	-0.26	0.14	0.10	0.27	0.25	0.24	0.59	0.04	0.66	0.09	0.85	0.04	
08/12/2024 17:00:00	0.86	-0.27	0.14	0.10	0.27	0.25	0.24	0.59	0.04	0.66	0.09	0.86	0.03	
08/12/2024 17:15:00	0.87	0.05	0.14	0.10	0.27	0.25	0.24	0.59	0.04	0.66	0.09	0.86	0.03	
08/12/2024 17:30:00	0.87	-0.30	0.14	0.10	0.27	0.25	0.24	0.59	0.04	0.67	0.09	0.86	0.02	
08/12/2024 17:45:00	0.87	0.02	0.14	0.10	0.28	0.25	0.24	0.59	0.04	0.67	0.09	0.86	0.03	
08/12/2024 18:00:00	0.87	-0.25	0.14	0.10	0.28	0.25	0.24	0.59	0.04	0.67	0.09	0.86	0.04	
08/12/2024 18:15:00	0.87	0.03	0.14	0.10	0.28	0.25	0.24	0.59	0.04	0.67	0.09	0.86	0.04	
08/12/2024 18:30:00	0.87	-0.28	0.14	0.10	0.28	0.25	0.24	0.58	0.04	0.67	0.08	0.85	0.06	
08/12/2024 18:45:00	0.87	-0.32	0.14	0.10	0.28	0.25	0.24	0.58	0.04	0.67	0.09	0.84	0.07	
08/12/2024 19:00:00	0.87	0.05	0.14	0.10	0.28	0.25	0.24	0.60	0.03	0.67	0.08	0.82	0.08	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
08/12/2024 19:15:00	0.87	0.04	0.14	0.10	0.28	0.25	0.24	0.60	0.04	0.67	0.09	0.81	0.07	
08/12/2024 19:30:00	0.86	0.04	0.14	0.10	0.28	0.25	0.24	0.60	0.03	0.67	0.09	0.80	0.11	
08/12/2024 19:45:00	0.86	0.08	0.14	0.10	0.28	0.25	0.24	0.60	0.03	0.67	0.08	0.78	0.11	
08/12/2024 20:00:00	0.86	0.06	0.14	0.10	0.28	0.25	0.25	0.60	0.02	0.67	0.09	0.77	0.10	
08/12/2024 20:15:00	0.85	0.07	0.14	0.10	0.28	0.25	0.25	0.60	0.01	0.67	0.09	0.76	0.10	
08/12/2024 20:30:00	0.85	0.07	0.14	0.11	0.28	0.25	0.25	0.60	0.02	0.66	0.09	0.75	0.11	
08/12/2024 20:45:00	0.85	0.08	0.14	0.11	0.28	0.25	0.25	0.60	0.03	0.66	0.10	0.74	0.09	
08/12/2024 21:00:00	0.84	0.05	0.15	0.11	0.28	0.25	0.25	0.60	0.01	0.66	0.10	0.73	0.09	
08/12/2024 21:15:00	0.84	0.06	0.15	0.11	0.28	0.25	0.25	0.60	0.02	0.66	0.10	0.72	0.12	
08/12/2024 21:30:00	0.84	0.06	0.15	0.11	0.28	0.25	0.25	0.60	0.01	0.66	0.09	0.72	0.12	
08/12/2024 21:45:00	0.83	0.06	0.15	0.11	0.28	0.25	0.25	0.59	0.00	0.66	0.10	0.71	0.12	
08/12/2024 22:00:00	0.83	0.09	0.15	0.11	0.28	0.25	0.25	0.59	0.02	0.65	0.10	0.70	0.07	
08/12/2024 22:15:00	0.82	0.05	0.15	0.11	0.28	0.25	0.25	0.59	0.02	0.65	0.10	0.70	0.10	
08/12/2024 22:30:00	0.82	0.07	0.15	0.11	0.28	0.25	0.25	0.59	0.02	0.65	0.11	0.69	0.11	
08/12/2024 22:45:00	0.82	0.10	0.15	0.11	0.28	0.25	0.25	0.59	0.02	0.65	0.11	0.69	0.11	
08/12/2024 23:00:00	0.81	0.07	0.15	0.11	0.28	0.25	0.25	0.60	0.02	0.65	0.10	0.69	0.10	
08/12/2024 23:15:00	0.81	0.09	0.15	0.11	0.28	0.25	0.25	0.60	0.02	0.64	0.11	0.69	0.11	
08/12/2024 23:30:00	0.81	0.08	0.15	0.11	0.28	0.25	0.25	0.59	0.02	0.64	0.11	0.69	0.12	
08/12/2024 23:45:00	0.80	0.07	0.15	0.11	0.28	0.25	0.25	0.59	0.02	0.64	0.11	0.69	0.10	
09/12/2024 00:00:00	0.80	0.08	0.14	0.11	0.28	0.25	0.25	0.59	0.02	0.64	0.11	0.70	0.08	
09/12/2024 00:15:00	0.80	0.07	0.15	0.11	0.28	0.25	0.25	0.59	0.02	0.64	0.11	0.71	0.09	
09/12/2024 00:30:00	0.80	0.07	0.14	0.11	0.28	0.25	0.24	0.59	0.02	0.64	0.11	0.72	0.06	
09/12/2024 00:45:00	0.80	0.07	0.14	0.11	0.28	0.25	0.24	0.59	0.02	0.64	0.12	0.75	0.05	
09/12/2024 01:00:00	0.81	0.05	0.14	0.11	0.28	0.25	0.24	0.59	0.02	0.64	0.12	0.76	0.04	
09/12/2024 01:15:00	0.81	0.07	0.14	0.11	0.28	0.25	0.24	0.59	0.02	0.64	0.12	0.78	0.03	
09/12/2024 01:30:00	0.82	0.06	0.14	0.11	0.28	0.25	0.24	0.60	0.02	0.64	0.12	0.80	0.03	
09/12/2024 01:45:00	0.82	0.05	0.14	0.11	0.28	0.25	0.24	0.60	0.02	0.64	0.12	0.80	0.03	
09/12/2024 02:00:00	0.83	0.06	0.14	0.11	0.28	0.25	0.24	0.60	0.02	0.64	0.12	0.81	0.04	
09/12/2024 02:15:00	0.83	-0.26	0.14	0.11	0.28	0.25	0.24	0.59		0.64	0.11	0.81	0.04	
09/12/2024 02:30:00	0.83	0.05	0.14	0.11	0.28	0.25	0.24	0.59		0.65	0.11	0.82	0.05	
09/12/2024 02:45:00	0.84	0.06	0.14	0.11	0.28	0.25	0.24	0.59		0.65	0.11	0.82	0.04	
09/12/2024 03:00:00	0.84	0.05	0.14	0.11	0.28	0.25	0.24	0.59		0.65	0.10	0.82	0.04	
09/12/2024 03:15:00	0.85	0.03	0.14	0.11	0.28	0.25	0.24	0.59		0.65	0.10	0.82	0.02	
09/12/2024 03:30:00	0.84	0.05	0.14	0.11	0.28	0.25	0.24	0.59		0.65	0.10	0.83	0.04	
09/12/2024 03:45:00	0.85	0.06	0.14	0.11	0.28	0.25	0.24	0.59		0.66	0.10	0.83	0.04	
09/12/2024 04:00:00	0.85	0.01	0.14	0.11	0.28	0.25	0.24	0.59		0.66	0.10	0.83	0.05	
09/12/2024 04:15:00	0.85	0.06	0.14	0.11	0.28	0.25	0.24	0.59		0.66	0.10	0.83	0.03	
09/12/2024 04:30:00	0.85	0.02	0.14	0.11	0.28	0.25	0.24	0.59		0.66	0.10	0.84	0.03	
09/12/2024 04:45:00	0.86	0.05	0.14	0.11	0.28	0.25	0.24	0.59		0.66	0.10	0.84	0.04	
09/12/2024 05:00:00	0.86	0.04	0.14	0.11	0.28	0.25	0.24	0.59		0.66	0.09	0.83	0.05	
09/12/2024 05:15:00	0.86	0.05	0.14	0.11	0.28	0.25	0.24	0.59		0.66	0.09	0.83	0.06	
09/12/2024 05:30:00	0.86	0.04	0.14	0.11	0.27	0.25	0.24	0.59		0.67	0.10	0.82	0.07	
09/12/2024 05:45:00	0.86	0.06	0.14	0.11	0.27	0.25	0.24	0.58		0.67	0.10	0.81	0.09	
09/12/2024 06:00:00	0.85	0.07	0.14	0.11	0.27	0.25	0.24	0.58		0.67	0.09	0.80	0.09	
09/12/2024 06:15:00	0.85	0.06	0.14	0.10	0.27	0.25	0.24	0.58		0.66	0.10	0.79	0.10	
09/12/2024 06:30:00	0.85	0.06	0.14	0.10	0.27	0.25	0.24	0.58		0.66	0.10	0.77	0.10	
09/12/2024 06:45:00	0.85	0.07	0.14	0.10	0.27	0.25	0.24	0.58		0.66	0.10	0.76	0.12	
09/12/2024 07:00:00	0.84	0.07	0.14	0.10	0.27	0.25	0.24	0.58		0.66	0.10	0.75	0.09	
09/12/2024 07:15:00	0.84	0.08	0.14	0.10	0.27	0.25	0.24	0.58		0.66	0.10	0.74	0.12	
09/12/2024 07:30:00	0.84	0.05	0.14	0.10	0.27	0.25	0.24	0.58		0.66	0.10	0.73	0.12	
09/12/2024 07:45:00	0.83	0.03	0.14	0.10	0.27	0.25	0.24	0.58	0.03	0.66	0.10	0.72	0.10	
09/12/2024 08:00:00	0.83	0.09	0.14	0.10	0.27	0.25	0.24	0.58		0.65	0.10	0.71	0.13	
09/12/2024 08:15:00	0.83	-0.30	0.14	0.10	0.27	0.25	0.23	0.58		0.65	0.10	0.70	0.11	
09/12/2024 08:30:00	0.82	-0.26	0.14	0.10	0.27	0.25	0.23	0.58		0.65	0.10	0.70	0.09	
09/12/2024 08:45:00	0.82	0.06	0.14	0.10	0.27	0.25	0.23	0.58		0.65	0.10	0.69	0.10	
09/12/2024 09:00:00	0.81	0.08	0.14	0.10	0.27	0.25	0.23	0.59		0.65	0.11	0.68	0.11	
09/12/2024 09:15:00	0.81	0.07	0.14	0.10	0.27	0.25	0.23	0.59		0.65	0.11	0.68	0.06	
09/12/2024 09:30:00	0.81	0.04	0.14	0.10	0.27	0.25	0.23	0.59		0.64	0.12	0.67	0.08	
09/12/2024 09:45:00	0.80	0.06	0.14	0.10	0.27	0.25	0.23	0.59		0.64	0.12	0.67	0.13	
09/12/2024 10:00:00	0.80	0.08	0.14	0.10	0.27	0.25	0.23	0.59		0.64	0.12	0.66	0.13	
09/12/2024 10:15:00	0.80	0.08	0.14	0.10	0.27	0.25	0.23	0.59		0.64	0.11	0.66	0.07	
09/12/2024 10:30:00	0.79	0.08	0.14	0.10	0.27	0.25	0.23	0.59		0.64	0.12	0.66	0.13	
09/12/2024 10:45:00	0.79	0.07	0.14	0.10	0.27	0.25	0.23	0.59		0.63	0.12	0.65	0.08	
09/12/2024 11:00:00	0.79	0.08	0.14	0.10	0.27	0.25	0.23	0.59		0.63	0.12	0.65	0.12	
09/12/2024 11:15:00	0.78	0.09	0.14	0.10	0.27	0.25	0.23	0.59		0.63	0.12	0.65	0.10	
09/12/2024 11:30:00	0.78	0.03	0.14	0.10	0.27	0.25	0.23	0.59		0.63	0.12	0.64	0.09	
09/12/2024 11:45:00	0.78	0.08	0.14	0.10	0.27	0.25	0.23	0.59		0.63	0.13	0.64	0.11	
09/12/2024 12:00:00	0.78	0.08	0.14	0.10	0.27	0.25	0.23	0.59		0.63	0.13	0.64	0.09	
09/12/2024 12:15:00	0.77	0.06	0.14	0.10	0.27	0.25	0.23	0.59		0.63	0.13	0.63	0.10	
09/12/2024 12:30:00	0.77	-0.28	0.14	0.10	0.27	0.25	0.23	0.59		0.62	0.13	0.63	0.10	
09/12/2024 12:45:00	0.77	0.08	0.14	0.10	0.27	0.25	0.23	0.59		0.62	0.14	0.63	0.07	
09/12/2024 13:00:00	0.77	0.08	0.14	0.10	0.27	0.25	0.23	0.58		0.62	0.14	0.63	0.07	
09/12/2024 13:15:00	0.77	-0.27	0.14	0.10	0.27	0.25	0.23	0.58		0.62	0.13	0.63	0.07	
09/12/2024 13:30:00	0.76	0.09	0.14	0.10	0.27	0.25	0.23	0.58		0.62	0.14	0.63	0.09	
09/12/2024 13:45:00	0.76	0.09	0.14	0.10	0.27	0.25	0.23	0.58		0.62	0.14	0.63	0.04	
09/12/2024 14:00:00	0.76	0.05	0.14	0.10	0.27	0.25	0.23	0.58		0.62	0.13	0.63	0.09	
09/12/2024 14:15:00	0.76	0.09	0.14	0.10	0.27	0.25	0.23	0.58		0.62	0.14	0.64	0.00	
09/12/2024 14:30:00	0.76	0.03	0.14	0.10	0.27	0.25	0.23	0.58		0.62	0.14	0.65	0.08	
09/12/2024 14:45:00	0.76	0.08	0.14	0.10	0.26	0.25	0.23	0.58	0.03	0.62	0.14	0.67	0.05	
09/12/2024 15:00:00	0.76	0.05	0.14	0.10	0.26	0.24	0.22	0.58		0.62	0.14	0.69	0.04	
09/12/2024 15:15:00	0.76	0.08	0.14	0.10	0.26	0.24	0.22	0.58		0.62	0.14	0.73	0.03	
09/12/2024 15:30:00	0.77	0.07	0.14	0.10	0.25	0.24	0.21	0.58		0.62	0.14	0.75	0.03	
09/12/2024 15:45:00	0.78	-0.30	0.14	0.10	0.25	0.24	0.21	0.58		0.62	0.13	0.77	0.07	
09/12/2024 16:00:00	0.79	-0.29	0.14	0.10	0.25	0.24	0.21	0.57		0.62	0.13	0.78	0.01	
09/12/2024 16:15:00	0.79	-0.32	0.13	0.10	0.25	0.24	0.21	0.57		0.62	0.13	0.79	0.01	
09/12/2024 16:30:00	0.80	-0.31	0.13	0.09	0.25	0.24	0.21	0.57		0.62	0.13	0.79	0.03	
09/12/2024 16:45:00	0.81	-0.29	0.13	0.09	0.25	0.24	0.21	0.57		0.63	0.13	0.80	0.03	
09/12/2024 17:00:00	0.81	-0.32	0.13	0.09	0.25	0.24	0.21	0.57		0.63	0.12	0.80	0.01	
09/12/2024 17:15:00	0.82	0.06	0.13	0.09	0.25	0.24	0.21	0.57		0.63	0.11	0.81	0.02	
09/12/2024 17:30:00	0.82	-0.30	0.13	0.09	0.25	0.24	0.21	0.57		0.64	0.11	0.81	0.03	
09/12/2024 17:45:00	0.82	-0.25	0.13	0.09	0.25	0.24	0.21	0.57	0.00	0.64	0.11	0.81	0.04	
09/12/2024 18:00:00	0.83	-0.29	0.13	0.09	0.25	0.24	0.21	0.57	0.02	0.64	0.11	0.82	0.03	
09/12/2024 18:15:00	0.83	0.05	0.13	0.09	0.25	0.24	0.21	0.57	0.02	0.64	0.10	0.82	0.02	
09/12/2024 18:30:00	0.83	0.02	0.13	0.09	0.25	0.23	0.21	0.57	0.02	0.64	0.11	0.82	0.03	
09/12/2024 18:45:00	0.83	0.04	0.13	0.09	0.25	0.24	0.20	0.57	0.02	0.65	0.11	0.82	0.04	
09/12/2024 19:00:00	0.84	0.06	0.13	0.09	0.25	0.23	0.20	0.57	0.01	0.65	0.11	0.83	0.03	
09/12/2024 19:15:00	0.84	0.05	0.13	0.09	0.25	0.23	0.20	0.57	0.01	0.65	0.11	0.82	0.07	
09/12/2024 19:30:00	0.84	0.05	0.13	0.09	0.25	0.23	0.20	0.57	0.01	0.65	0.11	0.80	0.07	
09/12/2024 19:45:00	0.84	0.07	0.13	0.09	0.25	0.23	0.20	0.57	0.00	0.65	0.11	0.79	0.07	
09/12/2024 20:00:00	0.84	0.05	0.13	0.09	0.25	0.23	0.20	0.57	0.00	0.65	0.10	0.78	0.09	
09/12/2024 20:15:00	0.83	0.05	0.13	0.09	0.25	0.23	0.20	0.57	0.00	0.65	0.11	0.77	0.11	
09/12/2024 20:30:00	0.83	0.06	0.13	0.09	0.24	0.23	0.20	0.57	0.00	0.65	0.11	0.75	0.10	
09/12/2024 20:45:00	0.83	0.08	0.13	0.09	0.24	0.23	0.20	0.57	0.00	0.65	0.11	0.74	0.12	
09/12/2024 21:00:00	0.83	-0.29	0.13	0.09	0.24	0.23	0.20	0.57	0.61	0.65	0.11	0.73	0.10	
09/12/2024 21:15:00	0.82	0.06	0.13	0.09	0.24	0.23	0.20	0.57	0.55	0.65	0.11	0.72	0.09	
09/12/2024 21:30:00	0.82	0.05	0.13	0.09	0.24	0.23	0.20	0.57	0.49	0.64	0.11	0.71	0.10	
09/12/2024 21:45:00	0.81	0.06	0.13	0.09	0.24	0.23	0.20	0.57	0.42	0.64	0.11	0.70	0.11	
09/12/2024 22:00:00	0.81	0.07	0.13	0.09	0.24	0.23	0.20	0.57	0.36	0.64	0.11	0.70	0.09	
09/12/2024 22:15:00	0.81	0.09	0.13	0.09	0.24	0.23	0.20	0.57	0.30	0.64	0.11	0.69	0.08	
09/12/2024 22:30:00	0.80	0.05	0.13	0.09	0.24	0.23	0.20	0.57	0.24	0.64	0.11	0.68	0.14	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
09/12/2024 22:45:00	0.80	0.08	0.13	0.09	0.24	0.23	0.20	0.56	0.18	0.64	0.11	0.68	0.10	
09/12/2024 23:00:00	0.79	0.06	0.12	0.08	0.24	0.23	0.20	0.56	0.12	0.63	0.11	0.67	0.11	
09/12/2024 23:15:00	0.79	0.08	0.13	0.09	0.24	0.23	0.20	0.56	0.65	0.63	0.11	0.67	0.13	
09/12/2024 23:30:00	0.79	0.07	0.12	0.08	0.24	0.23	0.20	0.56	0.44	0.63	0.12	0.66	0.09	
09/12/2024 23:45:00	0.78	0.08	0.12	0.08	0.24	0.23	0.20	0.56	0.22	0.63	0.11	0.66	0.09	
10/12/2024 00:00:00	0.78	0.08	0.12	0.08	0.24	0.23	0.20	0.56	0.00	0.63	0.12	0.66	0.10	
10/12/2024 00:15:00	0.78	0.06	0.12	0.08	0.24	0.23	0.20	0.56	0.00	0.63	0.13	0.65	0.10	
10/12/2024 00:30:00	0.78	0.07	0.12	0.08	0.24	0.23	0.20	0.56	0.00	0.62	0.13	0.65	0.11	
10/12/2024 00:45:00	0.77	0.08	0.12	0.08	0.24	0.23	0.20	0.55	0.00	0.62	0.13	0.66	0.09	
10/12/2024 01:00:00	0.77	0.08	0.12	0.08	0.24	0.23	0.20	0.55	0.00	0.62	0.13	0.66	0.09	
10/12/2024 01:15:00	0.77	0.07	0.12	0.08	0.24	0.23	0.20	0.55	0.00	0.62	0.13	0.67	0.05	
10/12/2024 01:30:00	0.77	0.07	0.12	0.08	0.24	0.23	0.19	0.55	0.59	0.62	0.13	0.68	0.06	
10/12/2024 01:45:00	0.77	0.06	0.12	0.08	0.24	0.23	0.19	0.55	0.40	0.62	0.14	0.70	0.06	
10/12/2024 02:00:00	0.77	0.08	0.12	0.08	0.24	0.23	0.19	0.55	0.20	0.62	0.14	0.72	0.05	
10/12/2024 02:15:00	0.77	0.06	0.12	0.08	0.24	0.23	0.19	0.55	0.00	0.62	0.14	0.74	0.03	
10/12/2024 02:30:00	0.78	0.04	0.12	0.08	0.24	0.23	0.19	0.55	0.00	0.62	0.13	0.76	0.01	
10/12/2024 02:45:00	0.79	0.04	0.12	0.08	0.24	0.23	0.19	0.55	0.00	0.62	0.14	0.78	0.02	
10/12/2024 03:00:00	0.79	0.05	0.12	0.08	0.24	0.23	0.19	0.55	0.00	0.62	0.14	0.79	0.01	
10/12/2024 03:15:00	0.80	0.00	0.12	0.08	0.23	0.23	0.19	0.54	0.00	0.62	0.13	0.80	0.01	
10/12/2024 03:30:00	0.81	0.05	0.11	0.07	0.23	0.22	0.19	0.54	0.00	0.63	0.12	0.80	0.04	
10/12/2024 03:45:00	0.81	0.05	0.11	0.07	0.23	0.22	0.19	0.54	0.00	0.63	0.13	0.81	0.02	
10/12/2024 04:00:00	0.82	0.05	0.11	0.07	0.23	0.22	0.19	0.54	0.00	0.63	0.12	0.81	0.00	
10/12/2024 04:15:00	0.82	0.05	0.11	0.07	0.23	0.22	0.19	0.54	0.00	0.64	0.12	0.81	0.03	
10/12/2024 04:30:00	0.83	0.06	0.11	0.07	0.23	0.22	0.19	0.54	0.00	0.64	0.12	0.82	0.03	
10/12/2024 04:45:00	0.83	0.05	0.11	0.07	0.23	0.22	0.19	0.53	0.00	0.64	0.11	0.82	0.02	
10/12/2024 05:00:00	0.83	0.05	0.11	0.07	0.23	0.22	0.18	0.53	0.65	0.64	0.11	0.82	0.02	
10/12/2024 05:15:00	0.83	0.05	0.11	0.07	0.23	0.22	0.18	0.53	0.49	0.64	0.11	0.82	0.03	
10/12/2024 05:30:00	0.84	0.04	0.11	0.07	0.23	0.22	0.18	0.53	0.33	0.65	0.11	0.83	0.04	
10/12/2024 05:45:00	0.84	0.04	0.11	0.07	0.23	0.22	0.18	0.53	0.16	0.65	0.11	0.83	0.03	
10/12/2024 06:00:00	0.84	0.04	0.11	0.07	0.23	0.22	0.18	0.53	0.00	0.65	0.10	0.83	0.03	
10/12/2024 06:15:00	0.84	0.06	0.11	0.07	0.23	0.22	0.18	0.53	0.00	0.65	0.10	0.83	0.03	
10/12/2024 06:30:00	0.85	0.02	0.11	0.07	0.23	0.22	0.18	0.52	0.64	0.65	0.11	0.84	0.03	
10/12/2024 06:45:00	0.85	0.04	0.11	0.07	0.23	0.22	0.18	0.52	0.54	0.65	0.11	0.83	0.05	
10/12/2024 07:00:00	0.85	0.00	0.11	0.07	0.23	0.22	0.18	0.52	0.45	0.65	0.11	0.82	0.06	
10/12/2024 07:15:00	0.84	0.06	0.10	0.06	0.22	0.22	0.18	0.52	0.36	0.65	0.10	0.80	0.09	
10/12/2024 07:30:00	0.84	0.06	0.10	0.06	0.22	0.22	0.18	0.52	0.27	0.65	0.10	0.79	0.11	
10/12/2024 07:45:00	0.84	0.07	0.10	0.06	0.22	0.21	0.17	0.52	0.18	0.65	0.10	0.78	0.08	
10/12/2024 08:00:00	0.84	0.08	0.10	0.06	0.22	0.21	0.17	0.52	0.09	0.65	0.10	0.77	0.10	
10/12/2024 08:15:00	0.83	0.05	0.10	0.06	0.22	0.21	0.17	0.52	0.00	0.65	0.10	0.75	0.11	
10/12/2024 08:30:00	0.83	0.08	0.10	0.06	0.22	0.21	0.17	0.52	0.00	0.65	0.10	0.74	0.10	
10/12/2024 08:45:00	0.82	0.06	0.10	0.06	0.22	0.21	0.17	0.52	0.00	0.65	0.10	0.73	0.09	
10/12/2024 09:00:00	0.82	0.06	0.10	0.06	0.22	0.21	0.17	0.53	0.23	0.65	0.10	0.72	0.10	
10/12/2024 09:15:00	0.82	0.07	0.10	0.06	0.22	0.21	0.17	0.53	0.15	0.64	0.11	0.71	0.14	
10/12/2024 09:30:00	0.81	0.07	0.10	0.06	0.22	0.21	0.17	0.53	0.08	0.64	0.11	0.70	0.15	
10/12/2024 09:45:00	0.81	0.05	0.10	0.06	0.22	0.21	0.17	0.53	0.00	0.64	0.10	0.69	0.11	
10/12/2024 10:00:00	0.80	0.08	0.10	0.06	0.22	0.21	0.17	0.53	0.00	0.64	0.10	0.69	0.14	
10/12/2024 10:15:00	0.80	0.05	0.10	0.06	0.22	0.21	0.17	0.53	0.00	0.63	0.11	0.68	0.13	
10/12/2024 10:30:00	0.79	0.05	0.10	0.06	0.22	0.21	0.17	0.53	0.00	0.63	0.10	0.67	0.10	
10/12/2024 10:45:00	0.79	0.08	0.10	0.06	0.22	0.21	0.17	0.53	0.00	0.63	0.11	0.67	0.13	
10/12/2024 11:00:00	0.79	0.05	0.10	0.06	0.22	0.21	0.17	0.53	0.00	0.63	0.11	0.66	0.11	
10/12/2024 11:15:00	0.78	0.08	0.10	0.06	0.22	0.21	0.17	0.53	0.00	0.63	0.12	0.66	0.08	
10/12/2024 11:30:00	0.78	0.08	0.10	0.06	0.22	0.21	0.17	0.52	0.00	0.62	0.11	0.65	0.12	
10/12/2024 11:45:00	0.78	0.05	0.10	0.06	0.22	0.21	0.17	0.52	0.00	0.62	0.12	0.65	0.07	
10/12/2024 12:00:00	0.77	0.08	0.10	0.06	0.22	0.21	0.17	0.52	0.00	0.62	0.12	0.64	0.11	
10/12/2024 12:15:00	0.77	0.07	0.10	0.06	0.22	0.21	0.17	0.52	0.00	0.62	0.12	0.64	0.11	
10/12/2024 12:30:00	0.77	0.07	0.10	0.06	0.21	0.21	0.17	0.52	0.00	0.62	0.12	0.64	0.09	
10/12/2024 12:45:00	0.76	0.08	0.10	0.06	0.21	0.21	0.17	0.52	0.00	0.61	0.12	0.63	0.07	
10/12/2024 13:00:00	0.76	0.06	0.10	0.06	0.21	0.21	0.17	0.52	0.00	0.61	0.13	0.63	0.13	
10/12/2024 13:15:00	0.76	0.08	0.10	0.06	0.21	0.21	0.16	0.52	0.00	0.61	0.13	0.63	0.11	
10/12/2024 13:30:00	0.76	0.08	0.10	0.06	0.21	0.21	0.16	0.52	0.00	0.61	0.13	0.62	0.11	
10/12/2024 13:45:00	0.75	0.08	0.09	0.06	0.21	0.21	0.16	0.51	0.00	0.61	0.13	0.62	0.12	
10/12/2024 14:00:00	0.75	0.05	0.09	0.05	0.21	0.21	0.16	0.51	0.00	0.61	0.13	0.62	0.12	
10/12/2024 14:15:00	0.75	0.10	0.09	0.05	0.21	0.21	0.16	0.51	0.00	0.61	0.13	0.62	0.09	
10/12/2024 14:30:00	0.75	0.10	0.09	0.05	0.21	0.21	0.16	0.51	0.00	0.60	0.13	0.62	0.06	
10/12/2024 14:45:00	0.74	0.10	0.09	0.05	0.21	0.21	0.16	0.51	0.00	0.60	0.12	0.62	0.09	
10/12/2024 15:00:00	0.74	0.09	0.09	0.05	0.21	0.20	0.16	0.51	0.64	0.60	0.13	0.62	0.07	
10/12/2024 15:15:00	0.74	0.08	0.09	0.05	0.21	0.20	0.16	0.51		0.60	0.12	0.63	0.05	
10/12/2024 15:30:00	0.74	0.07	0.09	0.05	0.21	0.20	0.16	0.51		0.60	0.13	0.64	0.04	
10/12/2024 15:45:00	0.74	0.08	0.09	0.05	0.21	0.20	0.16	0.51		0.60	0.13	0.67	0.03	
10/12/2024 16:00:00	0.74	0.08	0.09	0.05	0.21	0.20	0.16	0.51	0.03	0.60	0.12	0.70	0.02	
10/12/2024 16:15:00	0.75	0.07	0.09	0.05	0.21	0.20	0.16	0.51	0.03	0.60	0.13	0.73	0.01	
10/12/2024 16:30:00	0.76	0.05	0.09	0.05	0.21	0.20	0.16	0.51	0.01	0.60	0.12	0.75	0.00	
10/12/2024 16:45:00	0.77	0.04	0.09	0.05	0.21	0.20	0.16	0.51	0.01	0.60	0.11	0.77	0.00	
10/12/2024 17:00:00	0.78	0.00	0.09	0.05	0.21	0.20	0.16	0.51	0.01	0.60	0.13	0.78	0.00	
10/12/2024 17:15:00	0.78	0.03	0.09	0.05	0.20	0.20	0.15	0.51	0.01	0.61	0.12	0.79	0.02	
10/12/2024 17:30:00	0.79	0.04	0.09	0.05	0.20	0.20	0.15	0.51	0.02	0.61	0.11	0.79	0.01	
10/12/2024 17:45:00	0.80	0.05	0.09	0.05	0.20	0.20	0.15	0.51	0.03	0.61	0.11	0.80	0.01	
10/12/2024 18:00:00	0.80	0.02	0.09	0.05	0.20	0.20	0.15	0.51	0.01	0.62	0.12	0.80	0.03	
10/12/2024 18:15:00	0.81	0.04	0.09	0.05	0.20	0.20	0.15	0.51	0.01	0.62	0.12	0.81	0.02	
10/12/2024 18:30:00	0.81	0.06	0.09	0.05	0.20	0.20	0.15	0.51	0.03	0.62	0.11	0.81	0.02	
10/12/2024 18:45:00	0.82	0.04	0.09	0.05	0.20	0.20	0.15	0.51	0.03	0.63	0.11	0.81	0.03	
10/12/2024 19:00:00	0.82	0.04	0.08	0.05	0.20	0.20	0.15	0.51	0.03	0.63	0.11	0.81	0.03	
10/12/2024 19:15:00	0.82	0.04	0.08	0.05	0.20	0.20	0.15	0.51	0.03	0.63	0.11	0.82	0.03	
10/12/2024 19:30:00	0.82	0.05	0.08	0.05	0.20	0.20	0.15	0.51	0.03	0.63	0.10	0.82	0.02	
10/12/2024 19:45:00	0.83	0.04	0.08	0.04	0.20	0.20	0.15	0.51	0.03	0.63	0.09	0.82	0.02	
10/12/2024 20:00:00	0.83	0.05	0.08	0.05	0.20	0.20	0.15	0.51	0.03	0.64	0.09	0.82	0.02	
10/12/2024 20:15:00	0.83	0.03	0.08	0.05	0.20	0.20	0.15	0.51	0.03	0.64	0.09	0.82	0.02	
10/12/2024 20:30:00	0.83	0.04	0.08	0.05	0.20	0.20	0.15	0.51	0.03	0.64	0.10	0.82	0.03	
10/12/2024 20:45:00	0.83	0.03	0.08	0.05	0.20	0.20	0.15	0.51	0.02	0.64	0.10	0.81	0.06	
10/12/2024 21:00:00	0.83	0.01	0.08	0.04	0.20	0.20	0.15	0.51	0.02	0.64	0.10	0.79	0.08	
10/12/2024 21:15:00	0.83	0.05	0.08	0.04	0.20	0.20	0.15	0.51	0.01	0.64	0.10	0.78	0.09	
10/12/2024 21:30:00	0.83	0.06	0.08	0.04	0.20	0.20	0.15	0.51	0.02	0.64	0.09	0.76	0.08	
10/12/2024 21:45:00	0.82	0.06	0.08	0.04	0.20	0.20	0.15	0.51	0.02	0.64	0.10	0.75	0.07	
10/12/2024 22:00:00	0.82	0.05	0.08	0.04	0.20	0.20	0.15	0.51	0.02	0.64	0.10	0.74	0.10	
10/12/2024 22:15:00	0.81	0.06	0.08	0.04	0.20	0.20	0.15	0.51	0.02	0.64	0.10	0.73	0.10	
10/12/2024 22:30:00	0.81	0.06	0.08	0.04	0.20	0.20	0.15	0.51	0.03	0.63	0.10	0.72	0.12	
10/12/2024 22:45:00	0.81	0.09	0.08	0.04	0.20	0.20	0.15	0.51	0.03	0.63	0.11	0.70	0.11	
10/12/2024 23:00:00	0.80	0.05	0.08	0.04	0.20	0.20	0.15	0.51	0.03	0.63	0.11	0.70	0.11	
10/12/2024 23:15:00	0.80	0.05	0.08	0.04	0.20	0.20	0.15	0.51	0.03	0.63	0.11	0.69	0.11	
10/12/2024 23:30:00	0.79	0.07	0.08	0.04	0.20	0.20	0.15	0.51	0.02	0.62	0.11	0.68	0.11	
10/12/2024 23:45:00	0.79	0.08	0.08	0.04	0.20	0.20	0.15	0.50	0.02	0.62	0.11	0.67	0.12	
11/12/2024 00:00:00	0.78	0.08	0.08	0.04	0.20	0.20	0.15	0.50	0.02	0.62	0.11	0.67	0.09	
11/12/2024 00:15:00	0.78	0.07	0.08	0.04	0.20	0.20	0.15	0.50	0.02	0.62	0.11	0.66	0.12	
11/12/2024 00:30:00	0.77	0.06	0.08	0.04	0.20	0.20	0.15	0.50	0.02	0.62	0.12	0.65	0.09	
11/12/2024 00:45:00	0.77	0.07	0.08	0.04	0.20	0.20	0.15	0.50	0.02	0.61	0.11	0.65	0.12	
11/12/2024 01:00:00	0.77	0.06	0.08	0.04	0.20	0.20	0.14	0.50	0.02	0.61	0.11	0.64	0.10	
11/12/2024 01:15:00	0.76	0.07	0.08	0.04	0.20	0.20	0.14	0.50		0.61	0.12	0.64	0.09	
11/12/2024 01:30:00	0.76	0.09	0.08	0.04	0.20	0.20	0.14	0.49		0.61	0.11	0.64	0.10	
11/12/2024 01:45:00	0.76	0.10	0.08	0.04	0.20	0.19	0.14	0.49		0.61	0.11	0.65	0.08	
11/12/2024 02:00:00	0.76	0.06	0.08	0.04	0.20	0.19	0.14	0.49		0.60	0.11	0.65	0.09	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
11/12/2024 02:15:00	0.75	0.05	0.08	0.04	0.19	0.19	0.14	0.49		0.60	0.12	0.66	0.07	
11/12/2024 02:30:00	0.75	0.05	0.08	0.04	0.19	0.19	0.14	0.49		0.60	0.12	0.68	0.06	
11/12/2024 02:45:00	0.75	0.06	0.08	0.04	0.19	0.19	0.14	0.48		0.60	0.12	0.70	0.03	
11/12/2024 03:00:00	0.76	0.05	0.08	0.04	0.19	0.19	0.14	0.48		0.60	0.11	0.73	0.01	
11/12/2024 03:15:00	0.76	0.05	0.08	0.04	0.19	0.19	0.14	0.48		0.60	0.12	0.75	0.00	
11/12/2024 03:30:00	0.77	0.03	0.07	0.04	0.19	0.19	0.14	0.48		0.60	0.11	0.77	0.01	
11/12/2024 03:45:00	0.78	0.04	0.07	0.04	0.19	0.19	0.14	0.48		0.60	0.12	0.78	-0.01	
11/12/2024 04:00:00	0.79	0.04	0.07	0.04	0.19	0.19	0.14	0.48		0.60	0.11	0.79	0.01	
11/12/2024 04:15:00	0.79	0.05	0.07	0.04	0.19	0.19	0.14	0.48		0.61	0.11	0.79	0.00	
11/12/2024 04:30:00	0.80	0.03	0.07	0.04	0.19	0.19	0.14	0.48		0.61	0.12	0.80	0.01	
11/12/2024 04:45:00	0.80	0.05	0.07	0.04	0.19	0.19	0.14	0.48		0.62	0.11	0.80	0.01	
11/12/2024 05:00:00	0.81	0.01	0.07	0.04	0.19	0.19	0.13	0.48		0.62	0.11	0.81	0.02	
11/12/2024 05:15:00	0.81	0.04	0.07	0.04	0.19	0.19	0.13	0.47		0.62	0.11	0.81	0.01	
11/12/2024 05:30:00	0.82	0.03	0.07	0.04	0.19	0.19	0.13	0.47		0.62	0.11	0.81	0.00	
11/12/2024 05:45:00	0.82	0.05	0.07	0.03	0.19	0.19	0.13	0.47		0.63	0.10	0.82	0.03	
11/12/2024 06:00:00	0.82	0.05	0.07	0.03	0.18	0.19	0.13	0.47		0.63	0.10	0.82	0.00	
11/12/2024 06:15:00	0.83	0.04	0.07	0.03	0.18	0.19	0.13	0.47		0.63	0.10	0.82	0.02	
11/12/2024 06:30:00	0.83	0.05	0.06	0.03	0.18	0.19	0.13	0.47		0.63	0.10	0.82	0.02	
11/12/2024 06:45:00	0.83	0.03	0.06	0.03	0.18	0.18	0.13	0.47		0.63	0.09	0.82	0.02	
11/12/2024 07:00:00	0.83	0.04	0.06	0.03	0.18	0.18	0.13	0.47		0.63	0.09	0.83	-0.01	
11/12/2024 07:15:00	0.83	0.04	0.06	0.03	0.18	0.18	0.13	0.47		0.64	0.09	0.83	0.02	
11/12/2024 07:30:00	0.84	0.03	0.06	0.03	0.18	0.18	0.13	0.47		0.64	0.09	0.83	0.03	
11/12/2024 07:45:00	0.84	0.04	0.06	0.03	0.18	0.18	0.13	0.48		0.64	0.09	0.83	0.00	
11/12/2024 08:00:00	0.84	0.05	0.06	0.03	0.18	0.18	0.13	0.48	0.03	0.64	0.09	0.83	0.04	
11/12/2024 08:15:00	0.84	0.04	0.06	0.03	0.18	0.18	0.13	0.48	0.03	0.64	0.09	0.82	0.06	
11/12/2024 08:30:00	0.84	0.04	0.06	0.03	0.18	0.18	0.12	0.49	0.03	0.64	0.09	0.81	0.05	
11/12/2024 08:45:00	0.83	0.04	0.06	0.03	0.18	0.18	0.12	0.49	0.02	0.64	0.09	0.79	0.07	
11/12/2024 09:00:00	0.83	0.05	0.06	0.03	0.18	0.18	0.12	0.49	0.02	0.64	0.09	0.78	0.03	
11/12/2024 09:15:00	0.83	0.05	0.06	0.03	0.18	0.18	0.12	0.49	0.03	0.64	0.09	0.76	0.05	
11/12/2024 09:30:00	0.82	0.05	0.06	0.03	0.18	0.18	0.12	0.49	0.03	0.64	0.09	0.74	0.10	
11/12/2024 09:45:00	0.82	0.06	0.06	0.03	0.18	0.18	0.12	0.49	0.03	0.63	0.09	0.73	0.11	
11/12/2024 10:00:00	0.81	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.63	0.09	0.72	0.09	
11/12/2024 10:15:00	0.81	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.63	0.09	0.71	0.06	
11/12/2024 10:30:00	0.80	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.63	0.10	0.70	0.10	
11/12/2024 10:45:00	0.80	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.02	0.62	0.10	0.69	0.10	
11/12/2024 11:00:00	0.79	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.02	0.62	0.10	0.68	0.10	
11/12/2024 11:15:00	0.79	0.07	0.06	0.03	0.18	0.18	0.13	0.50	0.02	0.62	0.10	0.67	0.13	
11/12/2024 11:30:00	0.78	0.08	0.06	0.03	0.18	0.18	0.13	0.50	0.02	0.61	0.10	0.67	0.13	
11/12/2024 11:45:00	0.78	0.07	0.06	0.03	0.18	0.18	0.13	0.50	0.02	0.61	0.10	0.66	0.13	
11/12/2024 12:00:00	0.78	0.05	0.06	0.03	0.18	0.18	0.13	0.50	0.02	0.61	0.10	0.65	0.10	
11/12/2024 12:15:00	0.78	0.06	0.06	0.03	0.18	0.18	0.13	0.50	0.02	0.61	0.11	0.65	0.08	
11/12/2024 12:30:00	0.78	0.06	0.06	0.03	0.18	0.18	0.13	0.50	0.02	0.60	0.11	0.64	0.05	
11/12/2024 12:45:00	0.78	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.60	0.11	0.64	0.08	
11/12/2024 13:00:00	0.78	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.60	0.11	0.63	0.08	
11/12/2024 13:15:00	0.78	0.09	0.06	0.03	0.18	0.18	0.13	0.49	0.02	0.60	0.10	0.63	0.14	
11/12/2024 13:30:00	0.77	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.59	0.11	0.62	0.12	
11/12/2024 13:45:00	0.77	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.59	0.11	0.62	0.10	
11/12/2024 14:00:00	0.76	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.59	0.11	0.62	0.08	
11/12/2024 14:15:00	0.76	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.59	0.12	0.61	0.10	
11/12/2024 14:30:00	0.76	0.06	0.07	0.03	0.18	0.18	0.13	0.49	0.03	0.59	0.11	0.61	0.05	
11/12/2024 14:45:00	0.76	0.07	0.07	0.03	0.18	0.18	0.13	0.49	0.03	0.58	0.11	0.60	0.09	
11/12/2024 15:00:00	0.75	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.02	0.58	0.11	0.60	0.06	
11/12/2024 15:15:00	0.75	0.08	0.06	0.03	0.18	0.18	0.13	0.49	0.02	0.58	0.11	0.60	0.07	
11/12/2024 15:30:00	0.75	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.58	0.11	0.60	0.02	
11/12/2024 15:45:00	0.74	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.58	0.11	0.60	0.04	
11/12/2024 16:00:00	0.74	0.04	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.58	0.11	0.60	0.03	
11/12/2024 16:15:00	0.74	0.06	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.57	0.11	0.61	0.06	
11/12/2024 16:30:00	0.74	0.06	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.57	0.11	0.63	0.03	
11/12/2024 16:45:00	0.74	0.06	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.57	0.12	0.66	0.00	
11/12/2024 17:00:00	0.74	0.07	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.57	0.11	0.71	0.00	
11/12/2024 17:15:00	0.75	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.57	0.11	0.73	0.01	
11/12/2024 17:30:00	0.76	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.57	0.11	0.75	0.00	
11/12/2024 17:45:00	0.77	0.04	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.57	0.11	0.76	0.00	
11/12/2024 18:00:00	0.78	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.58	0.11	0.77	0.00	
11/12/2024 18:15:00	0.79	0.05	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.58	0.11	0.78	0.01	
11/12/2024 18:30:00	0.80	0.04	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.59	0.10	0.78	0.00	
11/12/2024 18:45:00	0.80	0.04	0.06	0.03	0.18	0.18	0.13	0.49	0.04	0.59	0.09	0.79	-0.03	
11/12/2024 19:00:00	0.81	0.04	0.06	0.03	0.18	0.18	0.13	0.49	0.01	0.59	0.10	0.79	0.01	
11/12/2024 19:15:00	0.82	0.03	0.06	0.03	0.18	0.18	0.13	0.49	0.04	0.60	0.09	0.80	0.02	
11/12/2024 19:30:00	0.82	0.04	0.06	0.03	0.18	0.18	0.13	0.49	0.03	0.60	0.09	0.80	0.01	
11/12/2024 19:45:00	0.82	0.00	0.06	0.03	0.18	0.18	0.13	0.49	0.04	0.60	0.08	0.81	0.02	
11/12/2024 20:00:00	0.83	0.04	0.06	0.03	0.18	0.18	0.13	0.50	0.04	0.61	0.08	0.81	0.04	
11/12/2024 20:15:00	0.83	0.05	0.06	0.03	0.18	0.18	0.13	0.50	0.04	0.61	0.08	0.81	0.01	
11/12/2024 20:30:00	0.83	0.04	0.06	0.03	0.18	0.18	0.13	0.50	0.03	0.61	0.08	0.81	0.02	
11/12/2024 20:45:00	0.84	0.04	0.06	0.03	0.18	0.18	0.13	0.50	0.03	0.61	0.08	0.81	0.02	
11/12/2024 21:00:00	0.84	0.04	0.06	0.03	0.18	0.18	0.13	0.50	0.03	0.62	0.08	0.82	0.02	
11/12/2024 21:15:00	0.84	0.00	0.06	0.03	0.18	0.18	0.13	0.50	0.02	0.62	0.07	0.82	0.02	
11/12/2024 21:30:00	0.84	0.00	0.06	0.03	0.18	0.18	0.13	0.50	0.03	0.62	0.07	0.82	0.02	
11/12/2024 21:45:00	0.84	0.05	0.06	0.03	0.18	0.18	0.13	0.50	0.03	0.62	0.07	0.80	0.06	
11/12/2024 22:00:00	0.84	0.06	0.07	0.03	0.18	0.18	0.13	0.50	0.03	0.62	0.08	0.78	0.07	
11/12/2024 22:15:00	0.84	0.06	0.07	0.03	0.18	0.18	0.13	0.50	0.03	0.62	0.07	0.77	0.06	
11/12/2024 22:30:00	0.83	0.07	0.07	0.03	0.18	0.18	0.13	0.50	0.03	0.62	0.08	0.75	0.06	
11/12/2024 22:45:00	0.83	0.06	0.07	0.03	0.18	0.18	0.13	0.50	0.03	0.62	0.08	0.73	0.08	
11/12/2024 23:00:00	0.82	0.07	0.07	0.03	0.18	0.18	0.13	0.50	0.03	0.61	0.08	0.72	0.12	
11/12/2024 23:15:00	0.82	0.07	0.07	0.03	0.18	0.18	0.13	0.50	0.04	0.61	0.08	0.70	0.07	
11/12/2024 23:30:00	0.81	0.06	0.07	0.03	0.18	0.18	0.13	0.50	0.03	0.61	0.09	0.69	0.11	
11/12/2024 23:45:00	0.81	0.07	0.07	0.03	0.18	0.18	0.13	0.50	0.03	0.61	0.10	0.68	0.10	
12/12/2024 00:00:00	0.80	0.07	0.07	0.03	0.18	0.18	0.13	0.50	0.03	0.60	0.09	0.67	0.09	
12/12/2024 00:15:00	0.80	0.06	0.07	0.03	0.18	0.18	0.13	0.49	0.03	0.60	0.09	0.66	0.11	
12/12/2024 00:30:00	0.79	0.08	0.07	0.03	0.18	0.18	0.13	0.49	0.03	0.60	0.09	0.65	0.08	
12/12/2024 00:45:00	0.79	0.07	0.07	0.04	0.18	0.18	0.13	0.49	0.03	0.59	0.09	0.65	0.10	
12/12/2024 01:00:00	0.78	0.07	0.07	0.04	0.18	0.18	0.13	0.49	0.02	0.59	0.10	0.64	0.09	
12/12/2024 01:15:00	0.78	0.07	0.07	0.04	0.18	0.18	0.13	0.49	0.03	0.59	0.10	0.63	0.07	
12/12/2024 01:30:00	0.77	0.07	0.07	0.04	0.18	0.18	0.13	0.49	0.03	0.59	0.10	0.63	0.11	
12/12/2024 01:45:00	0.77	0.09	0.07	0.04	0.18	0.18	0.13	0.48	0.04	0.58	0.10	0.62	0.11	
12/12/2024 02:00:00	0.76	0.08	0.07	0.03	0.18	0.18	0.13	0.48	0.03	0.58	0.11	0.62	0.12	
12/12/2024 02:15:00	0.76	0.08	0.07	0.03	0.18	0.18	0.13	0.48	0.03	0.58	0.11	0.61	0.13	
12/12/2024 02:30:00	0.76	0.09	0.07	0.03	0.18	0.18	0.13	0.48	0.02	0.58	0.11	0.61	0.09	
12/12/2024 02:45:00	0.75	0.10	0.07	0.03	0.18	0.18	0.13	0.48		0.57	0.11	0.61	0.12	
12/12/2024 03:00:00	0.75	0.09	0.07	0.03	0.18	0.18	0.13	0.48		0.57	0.11	0.62	0.05	
12/12/2024 03:15:00	0.75	0.08	0.07	0.03	0.18	0.18	0.13	0.48		0.57	0.11	0.63	0.06	
12/12/2024 03:30:00	0.74	0.07	0.06	0.03	0.18	0.18	0.12	0.47		0.57	0.11	0.65	0.05	
12/12/2024 03:45:00	0.74	0.08	0.06	0.03	0.18	0.18	0.12	0.47		0.57	0.11	0.68	0.01	
12/12/2024 04:00:00	0.75	0.06	0.06	0.03	0.18	0.18	0.12	0.47		0.56	0.11	0.72	0.03	
12/12/2024 04:15:00	0.76	0.05	0.06	0.03	0.18	0.18	0.12	0.47		0.56	0.11	0.74	0.01	
12/12/2024 04:30:00	0.76	0.04	0.06	0.03	0.18	0.18	0.12	0.47		0.57	0.11	0.75	-0.02	
12/12/2024 04:45:00	0.77	0.03	0.06	0.03	0.18	0.18	0.12	0.47		0.57	0.11	0.76	0.00	
12/12/2024 05:00:00	0.78	0.00	0.06	0.03	0.18	0.18	0.12	0.47		0.57	0.11	0.77	0.00	
12/12/2024 05:15:00	0.79	0.05	0.06	0.03	0.17	0.18	0.12	0.47		0.58	0.11	0.78	0.01	
12/12/2024 05:30:00	0.80	0.03	0.06	0.03	0.17	0.18	0.12	0.47		0.58	0.10	0.78	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
12/12/2024 05:45:00	0.80	0.05	0.06	0.03	0.17	0.18	0.12	0.47		0.59	0.09	0.79	0.01	
12/12/2024 06:00:00	0.81	0.04	0.06	0.03	0.17	0.18	0.12	0.47		0.59	0.09	0.79	0.02	
12/12/2024 06:15:00	0.81	0.02	0.06	0.03	0.17	0.18	0.12	0.47	0.03	0.59	0.08	0.80	0.02	
12/12/2024 06:30:00	0.82	0.04	0.06	0.03	0.17	0.18	0.12	0.47	0.03	0.60	0.08	0.80	0.02	
12/12/2024 06:45:00	0.82	-0.03	0.06	0.03	0.17	0.18	0.12	0.47	0.03	0.60	0.08	0.80	0.01	
12/12/2024 07:00:00	0.83	0.03	0.06	0.03	0.17	0.18	0.12	0.47	0.03	0.60	0.07	0.81	0.03	
12/12/2024 07:15:00	0.83	0.04	0.05	0.02	0.17	0.17	0.12	0.47	0.03	0.60	0.07	0.81	0.02	
12/12/2024 07:30:00	0.83	0.01	0.05	0.02	0.17	0.17	0.12	0.47	0.03	0.61	0.07	0.81	0.00	
12/12/2024 07:45:00	0.83	0.04	0.05	0.02	0.17	0.17	0.12	0.47	0.04	0.61	0.07	0.81	0.02	
12/12/2024 08:00:00	0.84	0.03	0.05	0.02	0.17	0.17	0.12	0.47	0.03	0.61	0.07	0.82	0.01	
12/12/2024 08:15:00	0.84	0.03	0.05	0.02	0.17	0.17	0.12	0.47	0.03	0.61	0.07	0.82	0.02	
12/12/2024 08:30:00	0.84	0.04	0.05	0.02	0.17	0.17	0.11	0.47	0.02	0.61	0.07	0.82	0.03	
12/12/2024 08:45:00	0.84	0.03	0.05	0.02	0.17	0.17	0.11	0.48	0.04	0.61	0.07	0.82	0.03	
12/12/2024 09:00:00	0.84	0.04	0.05	0.02	0.17	0.17	0.11	0.48	0.04	0.62	0.07	0.82	0.02	
12/12/2024 09:15:00	0.85	0.04	0.05	0.02	0.17	0.17	0.11	0.48	0.04	0.62	0.07	0.82	0.05	
12/12/2024 09:30:00	0.85	0.04	0.05	0.02	0.17	0.17	0.11	0.49	0.03	0.62	0.07	0.81	0.06	
12/12/2024 09:45:00	0.84	0.04	0.05	0.02	0.17	0.17	0.11	0.49	0.03	0.62	0.07	0.79	0.07	
12/12/2024 10:00:00	0.84	0.02	0.05	0.02	0.17	0.17	0.11	0.49	0.04	0.62	0.07	0.77	0.09	
12/12/2024 10:15:00	0.83	0.03	0.05	0.02	0.17	0.17	0.11	0.49	0.05	0.62	0.07	0.75	0.11	
12/12/2024 10:30:00	0.83	0.03	0.05	0.02	0.17	0.17	0.11	0.49	0.04	0.61	0.07	0.73	0.08	
12/12/2024 10:45:00	0.82	0.04	0.05	0.02	0.17	0.17	0.11	0.49	0.02	0.61	0.07	0.71	0.12	
12/12/2024 11:00:00	0.82	0.08	0.05	0.02	0.17	0.17	0.11	0.49	0.04	0.61	0.07	0.70	0.11	
12/12/2024 11:15:00	0.81	0.05	0.05	0.02	0.17	0.17	0.12	0.49	0.02	0.60	0.07	0.69	0.08	
12/12/2024 11:30:00	0.81	0.06	0.05	0.02	0.17	0.17	0.12	0.49	0.02	0.60	0.08	0.68	0.14	
12/12/2024 11:45:00	0.80	0.07	0.05	0.02	0.17	0.17	0.12	0.49	0.03	0.60	0.08	0.67	0.07	
12/12/2024 12:00:00	0.79	0.09	0.05	0.02	0.17	0.17	0.12	0.49	0.04	0.59	0.09	0.66	0.08	
12/12/2024 12:15:00	0.79	0.04	0.05	0.02	0.17	0.17	0.12	0.49	0.05	0.59	0.08	0.65	0.06	
12/12/2024 12:30:00	0.78	0.05	0.05	0.02	0.17	0.17	0.12	0.49	0.04	0.59	0.09	0.64	0.12	
12/12/2024 12:45:00	0.78	0.07	0.05	0.02	0.17	0.17	0.12	0.50	0.04	0.58	0.08	0.63	0.11	
12/12/2024 13:00:00	0.77	0.06	0.05	0.02	0.17	0.18	0.12	0.50	0.05	0.58	0.09	0.63	0.12	
12/12/2024 13:15:00	0.77	0.07	0.05	0.02	0.17	0.18	0.12	0.50	0.04	0.58	0.09	0.62	0.10	
12/12/2024 13:30:00	0.76	0.08	0.05	0.02	0.17	0.18	0.12	0.50	0.04	0.57	0.09	0.61	0.13	
12/12/2024 13:45:00	0.76	0.09	0.06	0.03	0.17	0.18	0.12	0.50	0.04	0.57	0.09	0.61	0.13	
12/12/2024 14:00:00	0.75	0.07	0.06	0.03	0.17	0.18	0.12	0.49	0.04	0.57	0.10	0.60	0.09	
12/12/2024 14:15:00	0.75	0.07	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.57	0.10	0.60	0.07	
12/12/2024 14:30:00	0.74	0.08	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.56	0.10	0.59	0.00	
12/12/2024 14:45:00	0.74	0.07	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.56	0.10	0.59	0.05	
12/12/2024 15:00:00	0.73	0.08	0.06	0.03	0.17	0.18	0.12	0.49	0.04	0.56	0.11	0.58	0.07	
12/12/2024 15:15:00	0.73	0.08	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.55	0.10	0.58	0.10	
12/12/2024 15:30:00	0.73	0.08	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.55	0.10	0.57	0.06	
12/12/2024 15:45:00	0.72	0.07	0.06	0.03	0.17	0.18	0.12	0.49	0.01	0.55	0.11	0.57	0.00	
12/12/2024 16:00:00	0.72	0.08	0.06	0.03	0.17	0.18	0.12	0.49	0.02	0.55	0.11	0.57	0.09	
12/12/2024 16:15:00	0.71	0.10	0.06	0.03	0.17	0.18	0.12	0.49	0.02	0.55	0.11	0.56	0.10	
12/12/2024 16:30:00	0.71	0.09	0.06	0.03	0.17	0.18	0.12	0.49	0.01	0.54	0.11	0.56	0.08	
12/12/2024 16:45:00	0.71	0.06	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.54	0.10	0.56	0.07	
12/12/2024 17:00:00	0.70	0.09	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.54	0.10	0.57	0.06	
12/12/2024 17:15:00	0.70	0.08	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.54	0.10	0.58	0.05	
12/12/2024 17:30:00	0.70	0.07	0.06	0.03	0.17	0.18	0.12	0.49	0.02	0.54	0.11	0.61	0.02	
12/12/2024 17:45:00	0.70	0.08	0.06	0.03	0.17	0.18	0.12	0.49	0.01	0.54	0.11	0.66	0.00	
12/12/2024 18:00:00	0.71	0.06	0.06	0.03	0.17	0.18	0.12	0.49	0.00	0.53	0.11	0.69	-0.01	
12/12/2024 18:15:00	0.72	0.04	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.54	0.11	0.71	-0.01	
12/12/2024 18:30:00	0.73	0.04	0.06	0.03	0.17	0.18	0.12	0.49	0.04	0.54	0.10	0.72	0.01	
12/12/2024 18:45:00	0.74	0.04	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.54	0.10	0.73	0.00	
12/12/2024 19:00:00	0.75	0.04	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.54	0.09	0.74	-0.01	
12/12/2024 19:15:00	0.76	0.04	0.06	0.03	0.17	0.18	0.12	0.49	0.03	0.55	0.09	0.75	-0.01	
12/12/2024 19:30:00	0.77	0.03	0.06	0.03	0.17	0.18	0.12	0.50	0.03	0.55	0.08	0.76	0.00	
12/12/2024 19:45:00	0.78	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.03	0.56	0.08	0.77	0.01	
12/12/2024 20:00:00	0.78	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.03	0.56	0.07	0.77	0.00	
12/12/2024 20:15:00	0.79	0.03	0.06	0.03	0.17	0.18	0.12	0.50	0.03	0.57	0.07	0.78	0.00	
12/12/2024 20:30:00	0.79	0.05	0.06	0.03	0.17	0.18	0.12	0.50	0.03	0.57	0.07	0.78	0.01	
12/12/2024 20:45:00	0.80	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.03	0.58	0.08	0.79	0.00	
12/12/2024 21:00:00	0.80	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.03	0.58	0.08	0.79	0.00	
12/12/2024 21:15:00	0.81	0.00	0.06	0.03	0.17	0.18	0.12	0.50	0.04	0.58	0.07	0.79	0.02	
12/12/2024 21:30:00	0.81	0.03	0.06	0.03	0.17	0.18	0.12	0.50	0.04	0.59	0.07	0.80	-0.01	
12/12/2024 21:45:00	0.81	0.03	0.06	0.03	0.17	0.18	0.12	0.50	0.04	0.59	0.06	0.80	-0.01	
12/12/2024 22:00:00	0.82	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.04	0.59	0.06	0.80	0.02	
12/12/2024 22:15:00	0.82	0.04	0.06	0.03	0.18	0.18	0.12	0.50	0.03	0.59	0.06	0.80	0.03	
12/12/2024 22:30:00	0.82	0.04	0.06	0.03	0.18	0.18	0.12	0.50	0.03	0.59	0.06	0.78	0.04	
12/12/2024 22:45:00	0.82	0.05	0.07	0.03	0.18	0.18	0.12	0.50		0.60	0.06	0.76	0.05	
12/12/2024 23:00:00	0.82	0.05	0.07	0.03	0.18	0.18	0.12	0.50		0.60	0.06	0.74	0.10	
12/12/2024 23:15:00	0.81	0.06	0.07	0.03	0.18	0.18	0.12	0.50		0.59	0.06	0.72	0.09	
12/12/2024 23:30:00	0.80	0.06	0.07	0.03	0.18	0.18	0.12	0.50		0.59	0.06	0.70	0.09	
12/12/2024 23:45:00	0.80	0.06	0.07	0.03	0.18	0.18	0.12	0.50		0.59	0.07	0.68	0.09	
13/12/2024 00:00:00	0.79	0.07	0.07	0.03	0.18	0.18	0.12	0.50		0.58	0.07	0.66	0.11	
13/12/2024 00:15:00	0.79	0.08	0.07	0.03	0.18	0.18	0.12	0.50		0.58	0.07	0.65	0.10	
13/12/2024 00:30:00	0.78	0.08	0.07	0.03	0.18	0.18	0.12	0.49		0.58	0.07	0.64	0.08	
13/12/2024 00:45:00	0.77	0.08	0.07	0.03	0.18	0.18	0.12	0.49		0.57	0.07	0.63	0.08	
13/12/2024 01:00:00	0.77	0.09	0.07	0.03	0.18	0.18	0.12	0.49		0.57	0.06	0.62	0.10	
13/12/2024 01:15:00	0.76	0.07	0.07	0.03	0.18	0.18	0.12	0.49		0.57	0.07	0.61	0.09	
13/12/2024 01:30:00	0.75	0.09	0.07	0.03	0.18	0.18	0.12	0.49		0.56	0.07	0.60	0.11	
13/12/2024 01:45:00	0.75	0.09	0.07	0.03	0.18	0.18	0.12	0.49		0.56	0.06	0.60	0.11	
13/12/2024 02:00:00	0.74	0.09	0.07	0.03	0.18	0.18	0.12	0.48		0.56	0.05	0.59	0.08	
13/12/2024 02:15:00	0.74	0.08	0.06	0.03	0.18	0.18	0.12	0.48		0.55	0.04	0.58	0.08	
13/12/2024 02:30:00	0.73	0.08	0.07	0.03	0.18	0.18	0.12	0.48		0.55	0.06	0.58	0.10	
13/12/2024 02:45:00	0.73	0.08	0.06	0.03	0.17	0.18	0.12	0.48		0.55	0.07	0.57	0.08	
13/12/2024 03:00:00	0.72	0.07	0.06	0.03	0.17	0.18	0.12	0.48		0.55	0.07	0.57	0.09	
13/12/2024 03:15:00	0.72	0.08	0.06	0.03	0.17	0.18	0.12	0.48		0.54	0.07	0.56	0.05	
13/12/2024 03:30:00	0.71	0.08	0.06	0.03	0.17	0.18	0.12	0.48		0.54	0.06	0.56	0.07	
13/12/2024 03:45:00	0.71	0.09	0.06	0.03	0.17	0.18	0.12	0.48		0.54	0.08	0.56	0.05	
13/12/2024 04:00:00	0.71	0.07	0.06	0.03	0.17	0.18	0.12	0.48		0.54	0.06	0.56	0.08	
13/12/2024 04:15:00	0.70	0.08	0.06	0.03	0.17	0.18	0.12	0.48		0.53	0.06	0.57	0.04	
13/12/2024 04:30:00	0.70	0.09	0.06	0.03	0.17	0.18	0.12	0.48		0.53	0.07	0.59	0.03	
13/12/2024 04:45:00	0.70	0.08	0.06	0.03	0.17	0.18	0.12	0.48		0.53	0.05	0.62	0.01	
13/12/2024 05:00:00	0.70	0.06	0.06	0.03	0.17	0.18	0.12	0.48		0.53	0.08	0.66	0.02	
13/12/2024 05:15:00	0.71	0.06	0.06	0.03	0.17	0.18	0.12	0.48		0.53	0.10	0.69	0.01	
13/12/2024 05:30:00	0.72	0.03	0.06	0.03	0.17	0.18	0.12	0.48		0.53	0.09	0.70	-0.02	
13/12/2024 05:45:00	0.73	0.04	0.06	0.03	0.17	0.18	0.12	0.48		0.53	0.09	0.72	0.02	
13/12/2024 06:00:00	0.74	0.05	0.05	0.02	0.17	0.18	0.12	0.48		0.53	0.08	0.73	-0.01	
13/12/2024 06:15:00	0.75	0.04	0.06	0.03	0.17	0.18	0.11	0.47		0.54	0.09	0.74	0.00	
13/12/2024 06:30:00	0.76	0.00	0.06	0.03	0.17	0.18	0.11	0.47		0.54	0.08	0.75	0.00	
13/12/2024 06:45:00	0.76	0.05	0.06	0.03	0.17	0.18	0.11	0.47		0.55	0.05	0.75	-0.01	
13/12/2024 07:00:00	0.77	0.04	0.06	0.03	0.17	0.17	0.11	0.47		0.55	0.07	0.76	0.01	
13/12/2024 07:15:00	0.78	0.00	0.05	0.02	0.17	0.17	0.11	0.47		0.56	0.04	0.77	0.04	
13/12/2024 07:30:00	0.78	0.04	0.05	0.02	0.17	0.17	0.11	0.47		0.56	0.06	0.77	-0.02	
13/12/2024 07:45:00	0.79	0.04	0.05	0.02	0.17	0.17	0.11	0.47		0.56	0.07	0.78	0.00	
13/12/2024 08:00:00	0.79	0.05	0.05	0.02	0.17	0.17	0.11	0.48	0.02	0.57	0.07	0.78	0.01	
13/12/2024 08:15:00	0.80	0.05	0.05	0.02	0.16	0.17	0.11	0.48	0.02	0.57	0.06	0.78	0.01	
13/12/2024 08:30:00	0.80	0.03	0.05	0.02	0.16	0.17	0.11	0.48	0.02	0.57	0.06	0.79	0.01	
13/12/2024 08:45:00	0.80	0.00	0.05	0.02	0.16	0.17	0.11	0.48	0.03	0.58	0.04	0.79	0.02	
13/12/2024 09:00:00	0.81	0.04	0.05	0.02	0.16	0.17	0.11	0.48	0.03	0.58	0.03	0.79	-0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
13/12/2024 09:15:00	0.81	0.03	0.05	0.02	0.16	0.17	0.11	0.48	0.03	0.58	0.03	0.79	0.01	
13/12/2024 09:30:00	0.81	0.00	0.05	0.02	0.16	0.17	0.11	0.49	0.04	0.58	0.03	0.80	0.00	
13/12/2024 09:45:00	0.81	0.04	0.05	0.02	0.16	0.17	0.11	0.49	0.04	0.59	0.03	0.80	0.01	
13/12/2024 10:00:00	0.82	0.00	0.05	0.02	0.16	0.17	0.11	0.49	0.04	0.59	0.04	0.80	0.00	
13/12/2024 10:15:00	0.82	0.00	0.05	0.02	0.16	0.17	0.11	0.49	0.04	0.59	0.03	0.80	0.04	
13/12/2024 10:30:00	0.82	0.04	0.05	0.02	0.16	0.17	0.11	0.49	0.04	0.59	0.03	0.78	0.02	
13/12/2024 10:45:00	0.82	0.05	0.05	0.02	0.16	0.17	0.11	0.49	0.04	0.59	0.05	0.76	0.03	
13/12/2024 11:00:00	0.81	0.04	0.05	0.02	0.16	0.17	0.11	0.49	0.03	0.59	0.05	0.74	0.05	
13/12/2024 11:15:00	0.81	0.04	0.05	0.02	0.16	0.17	0.11	0.49	0.02	0.59	0.05	0.71	0.16	
13/12/2024 11:30:00	0.80	0.05	0.05	0.02	0.17	0.17	0.11	0.49	0.03	0.59	0.05	0.69	0.13	
13/12/2024 11:45:00	0.79	0.04	0.05	0.02	0.17	0.17	0.11	0.49	0.03	0.58	0.05	0.67	0.08	
13/12/2024 12:00:00	0.79	0.08	0.05	0.02	0.17	0.17	0.11	0.49	0.02	0.58	0.06	0.66	0.12	
13/12/2024 12:15:00	0.78	0.08	0.05	0.02	0.17	0.17	0.11	0.49	0.01	0.57	0.06	0.64	0.13	
13/12/2024 12:30:00	0.77	0.08	0.05	0.02	0.17	0.17	0.11	0.49	0.00	0.57	0.07	0.63	0.08	
13/12/2024 12:45:00	0.76	0.08	0.05	0.02	0.17	0.18	0.11	0.50	0.01	0.57	0.07	0.62	0.13	
13/12/2024 13:00:00	0.76	0.07	0.06	0.03	0.17	0.18	0.11	0.50	0.02	0.56	0.08	0.61	0.08	
13/12/2024 13:15:00	0.75	0.08	0.06	0.03	0.17	0.18	0.11	0.50	0.03	0.56	0.07	0.60	0.01	
13/12/2024 13:30:00	0.74	0.07	0.06	0.03	0.17	0.18	0.11	0.50	0.03	0.55	0.04	0.59	0.07	
13/12/2024 13:45:00	0.74	0.08	0.06	0.03	0.17	0.18	0.11	0.50	0.02	0.55	0.08	0.58	0.09	
13/12/2024 14:00:00	0.73	0.08	0.06	0.03	0.17	0.18	0.11	0.50	0.03	0.55	0.07	0.58	0.11	
13/12/2024 14:15:00	0.73	0.07	0.06	0.03	0.17	0.18	0.11	0.50	0.02	0.54	0.10	0.57	0.10	
13/12/2024 14:30:00	0.72	0.08	0.06	0.03	0.17	0.18	0.11	0.50	0.01	0.54	0.09	0.56	0.10	
13/12/2024 14:45:00	0.71	0.09	0.06	0.03	0.17	0.18	0.12	0.49	0.01	0.53	0.09	0.56	0.11	
13/12/2024 15:00:00	0.71	0.08	0.06	0.03	0.17	0.18	0.12	0.49	0.01	0.53	0.09	0.55	0.07	
13/12/2024 15:15:00	0.70	0.07	0.06	0.03	0.17	0.18	0.12	0.49	0.00	0.53	0.10	0.54	0.09	
13/12/2024 15:30:00	0.70	0.08	0.06	0.03	0.17	0.18	0.12	0.49	0.00	0.53	0.09	0.54	0.11	
13/12/2024 15:45:00	0.69	0.09	0.06	0.03	0.17	0.18	0.12	0.49	0.00	0.53	0.09	0.53	0.08	
13/12/2024 16:00:00	0.69	0.08	0.06	0.03	0.17	0.18	0.12	0.49	0.00	0.52	0.09	0.53	0.10	
13/12/2024 16:15:00	0.68	0.08	0.06	0.03	0.17	0.18	0.12	0.49	-0.01	0.52	0.09	0.52	0.08	
13/12/2024 16:30:00	0.68	0.09	0.06	0.03	0.17	0.18	0.12	0.49	0.01	0.52	0.10	0.52	0.07	
13/12/2024 16:45:00	0.68	0.08	0.06	0.03	0.17	0.18	0.12	0.49		0.52	0.09	0.52	0.07	
13/12/2024 17:00:00	0.67	0.08	0.06	0.03	0.17	0.18	0.12	0.49		0.51	0.10	0.51	0.05	
13/12/2024 17:15:00	0.67	0.07	0.06	0.03	0.17	0.18	0.12	0.49		0.51	0.09	0.51	0.06	
13/12/2024 17:30:00	0.67	0.09	0.06	0.03	0.17	0.18	0.12	0.49		0.51	0.10	0.52	0.06	
13/12/2024 17:45:00	0.66	0.08	0.06	0.03	0.17	0.18	0.12	0.49		0.51	0.10	0.53	0.06	
13/12/2024 18:00:00	0.66	0.08	0.06	0.03	0.17	0.18	0.12	0.50		0.51	0.10	0.57	0.04	
13/12/2024 18:15:00	0.66	0.09	0.06	0.03	0.17	0.18	0.12	0.50		0.51	0.10	0.62	-0.01	
13/12/2024 18:30:00	0.67	0.07	0.06	0.03	0.17	0.18	0.11	0.50		0.51	0.10	0.65	-0.01	
13/12/2024 18:45:00	0.68	0.06	0.06	0.03	0.17	0.18	0.11	0.50		0.51	0.10	0.66	-0.01	
13/12/2024 19:00:00	0.69	0.04	0.06	0.03	0.17	0.18	0.11	0.50	0.03	0.51	0.10	0.68	0.00	
13/12/2024 19:15:00	0.70	0.03	0.06	0.03	0.17	0.18	0.12	0.50	0.00	0.51	0.10	0.69	-0.02	
13/12/2024 19:30:00	0.71	0.03	0.06	0.03	0.17	0.18	0.12	0.50	0.02	0.51	0.10	0.70	0.00	
13/12/2024 19:45:00	0.72	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.02	0.52	0.10	0.71	0.01	
13/12/2024 20:00:00	0.73	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.02	0.52	0.09	0.72	0.01	
13/12/2024 20:15:00	0.74	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.02	0.53	0.09	0.73	0.00	
13/12/2024 20:30:00	0.75	0.03	0.06	0.03	0.17	0.18	0.12	0.50	0.02	0.53	0.08	0.74	0.00	
13/12/2024 20:45:00	0.75	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.02	0.53	0.08	0.74	0.00	
13/12/2024 21:00:00	0.76	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.03	0.54	0.08	0.75	0.01	
13/12/2024 21:15:00	0.76	0.03	0.06	0.03	0.17	0.18	0.12	0.50	0.03	0.54	0.08	0.75	0.01	
13/12/2024 21:30:00	0.77	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.02	0.55	0.08	0.76	0.02	
13/12/2024 21:45:00	0.77	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.02	0.55	0.07	0.76	0.01	
13/12/2024 22:00:00	0.78	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.02	0.55	0.07	0.77	0.02	
13/12/2024 22:15:00	0.78	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.02	0.56	0.07	0.77	0.02	
13/12/2024 22:30:00	0.79	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.00	0.56	0.07	0.77	0.02	
13/12/2024 22:45:00	0.79	0.00	0.06	0.03	0.17	0.18	0.12	0.50	0.00	0.56	0.07	0.78	0.00	
13/12/2024 23:00:00	0.79	0.04	0.07	0.03	0.17	0.18	0.12	0.50	0.00	0.57	0.07	0.78	0.01	
13/12/2024 23:15:00	0.80	0.04	0.06	0.03	0.17	0.18	0.12	0.50	0.01	0.57	0.06	0.78	0.02	
13/12/2024 23:30:00	0.80	0.05	0.06	0.03	0.17	0.18	0.12	0.50	0.01	0.57	0.06	0.76	0.07	
13/12/2024 23:45:00	0.80	0.06	0.06	0.03	0.17	0.18	0.12	0.50	0.01	0.57	0.06	0.73	0.08	
14/12/2024 00:00:00	0.79	0.06	0.06	0.03	0.17	0.18	0.12	0.50		0.57	0.06	0.71	0.11	
14/12/2024 00:15:00	0.79	0.06	0.06	0.03	0.17	0.18	0.12	0.50		0.57	0.06	0.68	0.11	
14/12/2024 00:30:00	0.78	0.06	0.06	0.03	0.17	0.18	0.12	0.49		0.57	0.07	0.66	0.10	
14/12/2024 00:45:00	0.77	0.06	0.06	0.03	0.17	0.18	0.12	0.49		0.56	0.06	0.64	0.13	
14/12/2024 01:00:00	0.77	0.07	0.06	0.03	0.17	0.18	0.12	0.49		0.56	0.07	0.63	0.11	
14/12/2024 01:15:00	0.76	0.06	0.06	0.03	0.17	0.18	0.12	0.49		0.56	0.07	0.61	0.14	
14/12/2024 01:30:00	0.75	0.07	0.06	0.03	0.17	0.18	0.12	0.49		0.55	0.07	0.60	0.14	
14/12/2024 01:45:00	0.75	0.08	0.06	0.03	0.17	0.18	0.12	0.49		0.55	0.08	0.59	0.12	
14/12/2024 02:00:00	0.74	0.08	0.06	0.03	0.17	0.18	0.12	0.49		0.54	0.07	0.58	0.13	
14/12/2024 02:15:00	0.73	0.08	0.06	0.03	0.17	0.18	0.12	0.49		0.54	0.08	0.57	0.11	
14/12/2024 02:30:00	0.72	0.08	0.06	0.03	0.17	0.18	0.12	0.49		0.54	0.08	0.56	0.13	
14/12/2024 02:45:00	0.72	0.07	0.06	0.03	0.17	0.18	0.12	0.48		0.53	0.08	0.55	0.12	
14/12/2024 03:00:00	0.71	0.07	0.06	0.03	0.17	0.18	0.12	0.48		0.53	0.08	0.55	0.10	
14/12/2024 03:15:00	0.71	0.09	0.06	0.03	0.17	0.18	0.12	0.48		0.53	0.08	0.54	0.11	
14/12/2024 03:30:00	0.70	0.08	0.06	0.03	0.17	0.18	0.11	0.48		0.52	0.09	0.53	0.11	
14/12/2024 03:45:00	0.70	0.08	0.06	0.03	0.17	0.18	0.11	0.48		0.52	0.08	0.53	0.11	
14/12/2024 04:00:00	0.69	0.09	0.06	0.03	0.17	0.18	0.11	0.48		0.52	0.08	0.52	0.09	
14/12/2024 04:15:00	0.69	0.08	0.06	0.03	0.17	0.18	0.11	0.48		0.52	0.09	0.52	0.09	
14/12/2024 04:30:00	0.68	0.07	0.06	0.03	0.17	0.18	0.11	0.48		0.51	0.09	0.52	0.08	
14/12/2024 04:45:00	0.68	0.09	0.06	0.03	0.17	0.18	0.11	0.48		0.51	0.09	0.54	0.04	
14/12/2024 05:00:00	0.67	0.08	0.06	0.03	0.17	0.18	0.11	0.48		0.51	0.09	0.57	0.01	
14/12/2024 05:15:00	0.67	0.09	0.06	0.03	0.17	0.18	0.11	0.48		0.51	0.09	0.62	0.02	
14/12/2024 05:30:00	0.68	0.05	0.06	0.03	0.16	0.17	0.11	0.48		0.51	0.09	0.65	-0.01	
14/12/2024 05:45:00	0.68	0.05	0.06	0.03	0.16	0.17	0.11	0.48		0.50	0.10	0.67	-0.01	
14/12/2024 06:00:00	0.69	0.04	0.06	0.03	0.16	0.17	0.11	0.48		0.51	0.10	0.68	0.01	
14/12/2024 06:15:00	0.70	0.05	0.06	0.03	0.16	0.17	0.11	0.48		0.51	0.10	0.69	-0.01	
14/12/2024 06:30:00	0.71	0.03	0.06	0.03	0.16	0.17	0.11	0.48		0.51	0.09	0.70	0.00	
14/12/2024 06:45:00	0.72	0.03	0.06	0.03	0.16	0.17	0.11	0.48		0.51	0.09	0.71	0.00	
14/12/2024 07:00:00	0.73	0.03	0.06	0.03	0.16	0.17	0.11	0.48		0.52	0.08	0.72	-0.02	
14/12/2024 07:15:00	0.74	0.03	0.05	0.02	0.16	0.17	0.11	0.48		0.52	0.08	0.73	0.01	
14/12/2024 07:30:00	0.74	0.05	0.05	0.02	0.16	0.17	0.11	0.48		0.53	0.08	0.73	0.00	
14/12/2024 07:45:00	0.75	0.04	0.05	0.02	0.16	0.17	0.11	0.48		0.53	0.08	0.74	-0.01	
14/12/2024 08:00:00	0.75	0.04	0.05	0.02	0.16	0.17	0.11	0.48		0.53	0.07	0.74	-0.01	
14/12/2024 08:15:00	0.76	0.04	0.05	0.02	0.16	0.17	0.11	0.48		0.54	0.07	0.75	0.00	
14/12/2024 08:30:00	0.77	0.04	0.05	0.02	0.16	0.17	0.11	0.48	0.02	0.54	0.07	0.75	-0.03	
14/12/2024 08:45:00	0.77	0.04	0.05	0.02	0.16	0.17	0.11	0.48	0.01	0.55	0.07	0.76	0.01	
14/12/2024 09:00:00	0.77	0.04	0.05	0.02	0.16	0.17	0.11	0.48	0.01	0.55	0.07	0.76	-0.01	
14/12/2024 09:15:00	0.78	0.03	0.05	0.02	0.16	0.17	0.11	0.48	0.00	0.55	0.07	0.76	0.00	
14/12/2024 09:30:00	0.78	0.03	0.05	0.02	0.16	0.17	0.11	0.48	-0.01	0.56	0.07	0.77	-0.01	
14/12/2024 09:45:00	0.78	0.04	0.05	0.02	0.16	0.17	0.11	0.49	0.01	0.56	0.07	0.77	0.01	
14/12/2024 10:00:00	0.79	0.03	0.05	0.02	0.16	0.17	0.11	0.49	0.00	0.56	0.07	0.77	0.02	
14/12/2024 10:15:00	0.79	0.03	0.05	0.02	0.16	0.17	0.11	0.49	0.01	0.56	0.07	0.77	0.03	
14/12/2024 10:30:00	0.79	0.04	0.05	0.02	0.16	0.17	0.11	0.49	0.02	0.56	0.06	0.78	0.04	
14/12/2024 10:45:00	0.80	0.04	0.05	0.02	0.16	0.17	0.11	0.50	0.02	0.57	0.07	0.78	0.02	
14/12/2024 11:00:00	0.80	0.04	0.05	0.02	0.16	0.17	0.11	0.50	0.01	0.57	0.06	0.78	0.00	
14/12/2024 11:15:00	0.80	0.03	0.05	0.02	0.16	0.17	0.11	0.50	0.02	0.57	0.06	0.78	0.01	
14/12/2024 11:30:00	0.80	0.04	0.05	0.02	0.16	0.17	0.11	0.50	0.03	0.57	0.06	0.78	0.02	
14/12/2024 11:45:00	0.80	0.02	0.05	0.02	0.16	0.17	0.11	0.50	0.02	0.57	0.06	0.78	0.01	
14/12/2024 12:00:00	0.80	0.00	0.05	0.02	0.16	0.17	0.11	0.50	0.02	0.58	0.06	0.78	0.01	
14/12/2024 12:15:00	0.80	0.03	0.05	0.02	0.16	0.17	0.11	0.50	0.01	0.58	0.05	0.76	0.06	
14/12/2024 12:30:00	0.80	0.05	0.06	0.03	0.16	0.17	0.11	0.50	0.01	0.58	0.05	0.74	0.11	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
14/12/2024 12:45:00	0.80	0.05	0.06	0.03	0.16	0.17	0.11	0.50	0.01	0.57	0.06	0.71	0.13	
14/12/2024 13:00:00	0.79	0.06	0.06	0.03	0.16	0.17	0.11	0.50	0.01	0.57	0.06	0.68	0.08	
14/12/2024 13:15:00	0.78	0.07	0.06	0.03	0.16	0.17	0.11	0.50	0.02	0.57	0.06	0.66	0.12	
14/12/2024 13:30:00	0.78	0.07	0.06	0.03	0.16	0.17	0.11	0.50	0.02	0.56	0.06	0.64	0.13	
14/12/2024 13:45:00	0.77	0.08	0.06	0.03	0.16	0.17	0.11	0.50	0.02	0.56	0.06	0.63	0.09	
14/12/2024 14:00:00	0.76	0.08	0.06	0.03	0.17	0.17	0.11	0.50	0.02	0.56	0.07	0.62	0.16	
14/12/2024 14:15:00	0.75	0.08	0.06	0.03	0.17	0.17	0.11	0.50	0.02	0.55	0.07	0.61	0.14	
14/12/2024 14:30:00	0.75	0.08	0.06	0.03	0.17	0.17	0.11	0.50	0.02	0.55	0.07	0.59	0.09	
14/12/2024 14:45:00	0.74	0.08	0.06	0.03	0.17	0.17	0.11	0.50	0.01	0.54	0.07	0.58	0.09	
14/12/2024 15:00:00	0.73	0.09	0.06	0.03	0.17	0.17	0.11	0.50	0.01	0.54	0.07	0.57	0.05	
14/12/2024 15:15:00	0.73	0.06	0.06	0.03	0.17	0.17	0.11	0.50	0.01	0.54	0.08	0.56	0.13	
14/12/2024 15:30:00	0.72	0.09	0.06	0.03	0.17	0.17	0.11	0.50	0.01	0.53	0.08	0.56	0.13	
14/12/2024 15:45:00	0.71	0.09	0.07	0.03	0.17	0.17	0.11	0.50	0.01	0.53	0.08	0.55	0.09	
14/12/2024 16:00:00	0.71	0.08	0.07	0.03	0.17	0.18	0.11	0.50	0.01	0.53	0.08	0.54	0.10	
14/12/2024 16:15:00	0.70	0.06	0.07	0.03	0.17	0.18	0.11	0.50	0.01	0.52	0.07	0.53	0.10	
14/12/2024 16:30:00	0.69	0.08	0.07	0.03	0.17	0.18	0.11	0.50	0.00	0.52	0.08	0.53	0.07	
14/12/2024 16:45:00	0.69	0.09	0.07	0.03	0.17	0.18	0.11	0.50	0.00	0.52	0.09	0.52	0.09	
14/12/2024 17:00:00	0.68	0.07	0.07	0.03	0.17	0.18	0.11	0.49	0.00	0.51	0.09	0.52	0.10	
14/12/2024 17:15:00	0.68	0.09	0.07	0.03	0.17	0.18	0.11	0.49	0.00	0.51	0.09	0.52	0.09	
14/12/2024 17:30:00	0.67	0.10	0.07	0.03	0.17	0.18	0.11	0.49	0.01	0.51	0.09	0.52	0.07	
14/12/2024 17:45:00	0.67	0.09	0.07	0.03	0.17	0.18	0.11	0.49	0.00	0.51	0.09	0.54	0.05	
14/12/2024 18:00:00	0.67	0.09	0.07	0.03	0.17	0.17	0.11	0.49	0.00	0.50	0.09	0.58	0.05	
14/12/2024 18:15:00	0.67	0.08	0.07	0.03	0.17	0.17	0.11	0.49	0.00	0.50	0.10	0.62	0.00	
14/12/2024 18:30:00	0.67	0.06	0.07	0.03	0.17	0.17	0.11	0.49	0.00	0.50	0.10	0.65	0.02	
14/12/2024 18:45:00	0.68	0.06	0.07	0.03	0.17	0.17	0.11	0.49	0.01	0.50	0.10	0.66	0.00	
14/12/2024 19:00:00	0.69	0.04	0.06	0.03	0.17	0.17	0.11	0.50	0.01	0.50	0.10	0.68	0.00	
14/12/2024 19:15:00	0.70	0.04	0.07	0.03	0.17	0.17	0.11	0.50	0.01	0.50	0.09	0.69	0.00	
14/12/2024 19:30:00	0.71	0.03	0.07	0.03	0.17	0.17	0.11	0.50	0.01	0.50	0.09	0.70	-0.01	
14/12/2024 19:45:00	0.71	0.03	0.07	0.03	0.17	0.17	0.11	0.50	0.01	0.51	0.09	0.71	0.01	
14/12/2024 20:00:00	0.72	0.00	0.07	0.03	0.17	0.17	0.11	0.50	0.01	0.51	0.08	0.72	0.01	
14/12/2024 20:15:00	0.73	0.03	0.07	0.03	0.17	0.17	0.11	0.50	0.01	0.52	0.08	0.72	-0.02	
14/12/2024 20:30:00	0.74	0.04	0.07	0.03	0.17	0.17	0.11	0.50	0.01	0.52	0.08	0.73	0.01	
14/12/2024 20:45:00	0.74	0.03	0.07	0.03	0.17	0.17	0.11	0.50	0.00	0.52	0.07	0.73	0.01	
14/12/2024 21:00:00	0.75	0.04	0.07	0.03	0.17	0.17	0.11	0.50	0.00	0.53	0.07	0.74	0.01	
14/12/2024 21:15:00	0.75	0.04	0.07	0.03	0.17	0.17	0.11	0.49	0.00	0.53	0.07	0.74	0.00	
14/12/2024 21:30:00	0.76	0.04	0.07	0.03	0.17	0.17	0.11	0.49	0.00	0.53	0.07	0.75	0.00	
14/12/2024 21:45:00	0.76	0.05	0.07	0.03	0.17	0.17	0.11	0.49	0.00	0.54	0.07	0.75	0.01	
14/12/2024 22:00:00	0.76	0.04	0.07	0.03	0.17	0.17	0.11	0.50	0.01	0.54	0.07	0.75	0.01	
14/12/2024 22:15:00	0.77	0.04	0.07	0.03	0.17	0.17	0.11	0.50	0.01	0.54	0.07	0.76	0.02	
14/12/2024 22:30:00	0.77	0.04	0.07	0.03	0.17	0.17	0.11	0.50	0.01	0.55	0.07	0.76	0.01	
14/12/2024 22:45:00	0.78	0.04	0.07	0.03	0.17	0.17	0.11	0.50	0.02	0.55	0.07	0.76	0.02	
14/12/2024 23:00:00	0.78	0.04	0.07	0.03	0.17	0.17	0.11	0.50	0.02	0.55	0.07	0.77	0.00	
14/12/2024 23:15:00	0.78	0.03	0.07	0.03	0.17	0.17	0.11	0.50	0.02	0.55	0.07	0.77	0.02	
14/12/2024 23:30:00	0.78	0.04	0.07	0.03	0.17	0.17	0.11	0.50	0.02	0.56	0.06	0.77	0.02	
14/12/2024 23:45:00	0.79	0.05	0.07	0.03	0.17	0.17	0.11	0.49	0.02	0.56	0.06	0.77	0.00	
15/12/2024 00:00:00	0.79	0.04	0.07	0.03	0.17	0.17	0.11	0.49	0.02	0.56	0.06	0.77	0.01	
15/12/2024 00:15:00	0.79	0.04	0.07	0.03	0.17	0.17	0.11	0.49	0.02	0.56	0.06	0.77	0.00	
15/12/2024 00:30:00	0.79	0.05	0.07	0.03	0.17	0.17	0.11	0.49	0.02	0.56	0.06	0.75	0.08	
15/12/2024 00:45:00	0.79	0.06	0.07	0.03	0.17	0.17	0.11	0.49		0.56	0.06	0.73	0.08	
15/12/2024 01:00:00	0.78	0.06	0.06	0.03	0.17	0.17	0.11	0.49		0.56	0.06	0.70	0.08	
15/12/2024 01:15:00	0.78	0.07	0.07	0.03	0.17	0.17	0.11	0.49		0.56	0.06	0.68	0.12	
15/12/2024 01:30:00	0.77	0.07	0.07	0.03	0.17	0.17	0.11	0.49		0.56	0.06	0.65	0.08	
15/12/2024 01:45:00	0.76	0.05	0.07	0.03	0.17	0.17	0.11	0.48		0.55	0.06	0.63	0.15	
15/12/2024 02:00:00	0.76	0.06	0.07	0.03	0.17	0.17	0.11	0.48		0.55	0.07	0.62	0.13	
15/12/2024 02:15:00	0.75	0.07	0.06	0.03	0.17	0.17	0.11	0.48		0.55	0.07	0.60	0.13	
15/12/2024 02:30:00	0.74	0.07	0.06	0.03	0.17	0.17	0.11	0.48		0.54	0.07	0.59	0.13	
15/12/2024 02:45:00	0.73	0.07	0.07	0.03	0.17	0.17	0.11	0.48		0.54	0.07	0.58	0.12	
15/12/2024 03:00:00	0.73	0.09	0.07	0.03	0.17	0.17	0.11	0.48		0.53	0.07	0.57	0.13	
15/12/2024 03:15:00	0.72	0.08	0.06	0.03	0.17	0.17	0.11	0.48		0.53	0.07	0.56	0.10	
15/12/2024 03:30:00	0.71	0.08	0.06	0.03	0.16	0.17	0.11	0.48		0.53	0.07	0.55	0.11	
15/12/2024 03:45:00	0.70	0.07	0.06	0.03	0.16	0.17	0.11	0.47		0.52	0.08	0.54	0.11	
15/12/2024 04:00:00	0.70	0.09	0.06	0.03	0.16	0.17	0.11	0.47		0.52	0.09	0.53	0.11	
15/12/2024 04:15:00	0.69	0.08	0.06	0.03	0.16	0.17	0.11	0.47		0.51	0.12	0.52	0.12	
15/12/2024 04:30:00	0.69	0.09	0.06	0.03	0.16	0.17	0.11	0.47		0.51	0.10	0.52	0.10	
15/12/2024 04:45:00	0.68	0.08	0.06	0.03	0.16	0.17	0.11	0.47		0.51	0.08	0.51	0.13	
15/12/2024 05:00:00	0.67	0.07	0.06	0.03	0.16	0.17	0.11	0.47		0.51	0.09	0.50	0.09	
15/12/2024 05:15:00	0.67	0.09	0.06	0.03	0.16	0.17	0.11	0.47		0.50	0.09	0.50	0.09	
15/12/2024 05:30:00	0.66	0.08	0.06	0.03	0.16	0.17	0.11	0.47		0.50	0.09	0.49	0.08	
15/12/2024 05:45:00	0.66	0.07	0.06	0.03	0.16	0.17	0.11	0.47		0.50	0.11	0.50	0.05	
15/12/2024 06:00:00	0.65	0.07	0.06	0.03	0.16	0.17	0.11	0.47		0.49	0.09	0.50	0.07	
15/12/2024 06:15:00	0.65	0.09	0.06	0.03	0.16	0.17	0.11	0.47		0.49	0.09	0.52	0.06	
15/12/2024 06:30:00	0.65	0.06	0.06	0.03	0.16	0.17	0.11	0.47		0.49	0.09	0.55	0.03	
15/12/2024 06:45:00	0.64	0.07	0.06	0.03	0.16	0.17	0.10	0.47		0.49	0.10	0.59	0.01	
15/12/2024 07:00:00	0.65	0.06	0.06	0.03	0.16	0.17	0.10	0.47		0.49	0.09	0.62	0.01	
15/12/2024 07:15:00	0.65	0.05	0.06	0.03	0.16	0.17	0.10	0.47		0.49	0.10	0.64	-0.01	
15/12/2024 07:30:00	0.66	0.05	0.05	0.02	0.16	0.17	0.10	0.47		0.49	0.09	0.65	0.00	
15/12/2024 07:45:00	0.67	0.04	0.05	0.02	0.16	0.17	0.10	0.47		0.49	0.09	0.67	0.01	
15/12/2024 08:00:00	0.68	0.04	0.05	0.02	0.16	0.17	0.10	0.47	0.01	0.49	0.10	0.68	0.00	
15/12/2024 08:15:00	0.69	0.03	0.05	0.02	0.16	0.17	0.10	0.47	0.01	0.49	0.09	0.68	-0.01	
15/12/2024 08:30:00	0.70	0.03	0.05	0.02	0.16	0.17	0.10	0.47	0.01	0.50	0.09	0.69	0.01	
15/12/2024 08:45:00	0.71	0.03	0.05	0.02	0.16	0.16	0.10	0.47	0.01	0.50	0.08	0.70	0.00	
15/12/2024 09:00:00	0.72	0.03	0.05	0.02	0.16	0.16	0.10	0.47	0.01	0.50	0.08	0.71	-0.01	
15/12/2024 09:15:00	0.72	0.04	0.05	0.02	0.16	0.16	0.10	0.47	0.02	0.51	0.08	0.71	0.01	
15/12/2024 09:30:00	0.73	0.03	0.05	0.02	0.16	0.16	0.10	0.47	0.02	0.51	0.07	0.72	0.01	
15/12/2024 09:45:00	0.73	0.04	0.05	0.02	0.15	0.16	0.10	0.47	0.02	0.52	0.08	0.72	-0.01	
15/12/2024 10:00:00	0.74	0.04	0.05	0.02	0.15	0.16	0.10	0.47	0.02	0.52	0.08	0.73	0.00	
15/12/2024 10:15:00	0.74	0.04	0.05	0.02	0.15	0.16	0.10	0.48	0.02	0.52	0.07	0.73	-0.01	
15/12/2024 10:30:00	0.75	0.04	0.05	0.02	0.15	0.16	0.10	0.48	0.03	0.53	0.06	0.74	0.01	
15/12/2024 10:45:00	0.75	0.04	0.05	0.02	0.15	0.16	0.10	0.48	0.04	0.53	0.06	0.74	0.01	
15/12/2024 11:00:00	0.76	0.03	0.05	0.02	0.15	0.16	0.10	0.49	0.07	0.53	0.06	0.74	0.02	
15/12/2024 11:15:00	0.76	0.04	0.05	0.02	0.15	0.16	0.10	0.49	0.07	0.54	0.05	0.75	0.00	
15/12/2024 11:30:00	0.76	0.04	0.05	0.02	0.15	0.16	0.10	0.49	0.07	0.54	0.05	0.75	0.01	
15/12/2024 11:45:00	0.77	0.04	0.05	0.02	0.15	0.16	0.10	0.49	0.06	0.54	0.05	0.75	0.02	
15/12/2024 12:00:00	0.77	0.04	0.05	0.02	0.16	0.16	0.10	0.49	0.07	0.54	0.05	0.75	0.02	
15/12/2024 12:15:00	0.77	0.04	0.05	0.02	0.16	0.17	0.10	0.50	0.07	0.55	0.05	0.75	0.01	
15/12/2024 12:30:00	0.78	0.00	0.05	0.02	0.16	0.17	0.10	0.50	0.06	0.55	0.05	0.75	0.01	
15/12/2024 12:45:00	0.78	0.00	0.05	0.02	0.16	0.17	0.10	0.50	0.07	0.55	0.05	0.73	0.08	
15/12/2024 13:00:00	0.77	0.04	0.05	0.02	0.16	0.17	0.10	0.50	0.06	0.55	0.05	0.70	0.08	
15/12/2024 13:15:00	0.77	0.05	0.05	0.02	0.16	0.17	0.10	0.50	0.06	0.55	0.05	0.67	0.10	
15/12/2024 13:30:00	0.76	0.06	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.55	0.05	0.65	0.13	
15/12/2024 13:45:00	0.75	0.07	0.06	0.03	0.16	0.17	0.10	0.50	0.06	0.54	0.05	0.64	0.09	
15/12/2024 14:00:00	0.75	0.06	0.06	0.03	0.16	0.17	0.11	0.50	0.06	0.54	0.05	0.61	0.10	
15/12/2024 14:15:00	0.74	0.08	0.06	0.03	0.16	0.17	0.11	0.50	0.06	0.54	0.06	0.59	0.09	
15/12/2024 14:30:00	0.73	0.08	0.06	0.03	0.16	0.17	0.11	0.50	0.07	0.53	0.08	0.58	0.10	
15/12/2024 14:45:00	0.72	0.08	0.06	0.03	0.16	0.17	0.11	0.50	0.06	0.53	0.08	0.57	0.08	
15/12/2024 15:00:00	0.72	0.09	0.06	0.03	0.16	0.17	0.11	0.50	0.06	0.53	0.08	0.56	0.13	
15/12/2024 15:15:00	0.71	0.08	0.06	0.03	0.16	0.17	0.11	0.50	0.07	0.52	0.07	0.54	0.10	
15/12/2024 15:30:00	0.70	0.09	0.06	0.03	0.16	0.17	0.11	0.50	0.07	0.52	0.07	0.53	0.09	
15/12/2024 15:45:00	0.70	0.08	0.06	0.03	0.16	0.17	0.11	0.50	0.08	0.51	0.08	0.53	0.11	
15/12/2024 16:00:00	0.69	0.10	0.07	0.03	0.16	0.17	0.11	0.50	0.07	0.51	0.08	0.52	0.12	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
15/12/2024 16:15:00	0.68	0.08	0.06	0.03	0.16	0.17	0.11	0.50	0.07	0.51	0.08	0.51	0.13	
15/12/2024 16:30:00	0.68	0.08	0.06	0.03	0.16	0.17	0.11	0.51	0.07	0.50	0.09	0.50	0.11	
15/12/2024 16:45:00	0.67	0.09	0.06	0.03	0.17	0.17	0.11	0.51	0.08	0.50	0.09	0.50	0.12	
15/12/2024 17:00:00	0.66	0.07	0.06	0.03	0.17	0.17	0.11	0.51	0.07	0.50	0.09	0.49	0.09	
15/12/2024 17:15:00	0.66	0.08	0.07	0.03	0.17	0.17	0.11	0.51	0.06	0.50	0.09	0.48	0.09	
15/12/2024 17:30:00	0.65	0.06	0.07	0.03	0.17	0.17	0.11	0.50	0.06	0.49	0.09	0.48	0.11	
15/12/2024 17:45:00	0.65	0.10	0.07	0.03	0.17	0.18	0.11	0.50	0.06	0.49	0.09	0.48	0.06	
15/12/2024 18:00:00	0.64	0.09	0.07	0.03	0.17	0.18	0.11	0.50	0.06	0.49	0.09	0.48	0.05	
15/12/2024 18:15:00	0.64	0.09	0.07	0.03	0.17	0.18	0.11	0.50	0.06	0.49	0.09	0.49	0.09	
15/12/2024 18:30:00	0.63	0.09	0.07	0.03	0.17	0.18	0.11	0.50	0.05	0.48	0.09	0.52	0.04	
15/12/2024 18:45:00	0.63	0.08	0.07	0.03	0.17	0.18	0.11	0.50	0.05	0.48	0.08	0.56	0.02	
15/12/2024 19:00:00	0.63	0.07	0.07	0.04	0.17	0.18	0.12	0.50	0.05	0.48	0.10	0.59	0.01	
15/12/2024 19:15:00	0.64	0.05	0.07	0.04	0.17	0.18	0.11	0.50	0.06	0.48	0.08	0.61	0.00	
15/12/2024 19:30:00	0.64	0.05	0.07	0.03	0.17	0.18	0.12	0.50	0.07	0.48	0.10	0.63	0.01	
15/12/2024 19:45:00	0.65	0.05	0.07	0.03	0.17	0.18	0.12	0.50	0.06	0.48	0.10	0.64	0.01	
15/12/2024 20:00:00	0.66	0.05	0.07	0.04	0.17	0.18	0.12	0.50	0.00	0.48	0.09	0.65	0.01	
15/12/2024 20:15:00	0.67	0.04	0.07	0.04	0.17	0.18	0.12	0.50	0.06	0.48	0.10	0.66	-0.04	
15/12/2024 20:30:00	0.68	0.04	0.07	0.04	0.17	0.18	0.12	0.50	0.05	0.49	0.09	0.67	-0.01	
15/12/2024 20:45:00	0.69	0.04	0.07	0.04	0.17	0.18	0.12	0.50	0.06	0.49	0.09	0.68	0.01	
15/12/2024 21:00:00	0.70	0.04	0.07	0.04	0.17	0.18	0.12	0.50	0.06	0.49	0.09	0.69	0.00	
15/12/2024 21:15:00	0.70	0.04	0.07	0.04	0.17	0.18	0.12	0.50	0.05	0.50	0.08	0.69	0.01	
15/12/2024 21:30:00	0.71	0.04	0.07	0.04	0.17	0.18	0.12	0.50	0.05	0.50	0.08	0.70	0.00	
15/12/2024 21:45:00	0.72	0.02	0.07	0.04	0.17	0.18	0.12	0.50	0.05	0.50	0.08	0.70	0.01	
15/12/2024 22:00:00	0.72	0.04	0.07	0.04	0.17	0.18	0.12	0.50	0.05	0.51	0.08	0.71	-0.01	
15/12/2024 22:15:00	0.73	0.04	0.07	0.04	0.17	0.18	0.12	0.50	0.05	0.51	0.08	0.71	0.01	
15/12/2024 22:30:00	0.73	0.03	0.07	0.03	0.17	0.18	0.12	0.50	0.06	0.51	0.08	0.72	0.01	
15/12/2024 22:45:00	0.74	0.05	0.07	0.03	0.17	0.18	0.12	0.50	0.06	0.52	0.07	0.72	0.01	
15/12/2024 23:00:00	0.74	0.04	0.07	0.04	0.17	0.18	0.12	0.49	0.06	0.52	0.07	0.73	0.01	
15/12/2024 23:15:00	0.75	0.04	0.07	0.04	0.17	0.18	0.12	0.49	0.06	0.52	0.07	0.73	0.01	
15/12/2024 23:30:00	0.75	0.04	0.07	0.04	0.17	0.18	0.11	0.49	0.06	0.53	0.07	0.73	0.01	
15/12/2024 23:45:00	0.75	0.04	0.07	0.03	0.17	0.18	0.11	0.49	0.06	0.53	0.07	0.74	0.02	
16/12/2024 00:00:00	0.76	0.04	0.07	0.03	0.17	0.18	0.12	0.49	0.06	0.53	0.06	0.74	0.01	
16/12/2024 00:15:00	0.76	0.05	0.07	0.03	0.17	0.18	0.11	0.49	0.06	0.53	0.06	0.74	0.02	
16/12/2024 00:30:00	0.76	0.04	0.07	0.03	0.17	0.18	0.11	0.49	0.06	0.54	0.05	0.74	0.02	
16/12/2024 00:45:00	0.76	0.00	0.07	0.04	0.17	0.18	0.11	0.49	0.04	0.54	0.05	0.75	0.02	
16/12/2024 01:00:00	0.77	0.04	0.07	0.03	0.17	0.18	0.11	0.49	0.05	0.54	0.07	0.75	0.03	
16/12/2024 01:15:00	0.77	0.04	0.07	0.03	0.17	0.18	0.11	0.49	0.04	0.54	0.06	0.73	0.03	
16/12/2024 01:30:00	0.77	0.05	0.07	0.03	0.17	0.18	0.11	0.48	0.05	0.54	0.06	0.70	0.07	
16/12/2024 01:45:00	0.76	0.06	0.07	0.03	0.17	0.18	0.11	0.48	0.04	0.54	0.06	0.67	0.09	
16/12/2024 02:00:00	0.76	0.05	0.07	0.03	0.17	0.18	0.11	0.48	0.03	0.54	0.06	0.65	0.12	
16/12/2024 02:15:00	0.75	0.06	0.07	0.03	0.17	0.17	0.11	0.48	0.04	0.54	0.06	0.63	0.12	
16/12/2024 02:30:00	0.74	0.05	0.07	0.03	0.17	0.17	0.11	0.48	0.04	0.54	0.05	0.60	0.12	
16/12/2024 02:45:00	0.74	0.07	0.07	0.03	0.16	0.17	0.11	0.48	0.04	0.53	0.05	0.59	0.15	
16/12/2024 03:00:00	0.73	0.06	0.06	0.03	0.16	0.17	0.11	0.48	0.04	0.53	0.06	0.57	0.12	
16/12/2024 03:15:00	0.72	0.08	0.06	0.03	0.16	0.17	0.11	0.48	0.04	0.53	0.08	0.56	0.12	
16/12/2024 03:30:00	0.71	0.08	0.06	0.03	0.16	0.17	0.11	0.47	0.04	0.52	0.08	0.55	0.14	
16/12/2024 03:45:00	0.71	0.08	0.06	0.03	0.16	0.17	0.11	0.47	0.04	0.52	0.07	0.54	0.11	
16/12/2024 04:00:00	0.70	0.08	0.06	0.03	0.16	0.17	0.11	0.47	0.04	0.51	0.07	0.53	0.09	
16/12/2024 04:15:00	0.69	0.09	0.06	0.03	0.16	0.17	0.11	0.47	0.04	0.51	0.08	0.52	0.08	
16/12/2024 04:30:00	0.68	0.08	0.06	0.03	0.16	0.17	0.11	0.47	0.04	0.51	0.08	0.51	0.07	
16/12/2024 04:45:00	0.68	0.08	0.06	0.03	0.16	0.17	0.11	0.47	0.04	0.50	0.08	0.50	0.11	
16/12/2024 05:00:00	0.67	0.09	0.06	0.03	0.16	0.17	0.11	0.47	0.04	0.50	0.08	0.49	0.09	
16/12/2024 05:15:00	0.67	0.08	0.06	0.03	0.16	0.17	0.11	0.47	0.04	0.50	0.09	0.49	0.06	
16/12/2024 05:30:00	0.66	0.08	0.06	0.03	0.16	0.17	0.10	0.47	0.04	0.49	0.09	0.48	0.05	
16/12/2024 05:45:00	0.65	0.08	0.06	0.03	0.16	0.17	0.10	0.47	0.05	0.49	0.09	0.48	0.06	
16/12/2024 06:00:00	0.65	0.08	0.06	0.03	0.16	0.17	0.10	0.47	0.05	0.49	0.09	0.49	0.05	
16/12/2024 06:15:00	0.64	0.07	0.06	0.03	0.16	0.17	0.10	0.47	0.01	0.49	0.08	0.53	0.04	
16/12/2024 06:30:00	0.64	0.07	0.06	0.03	0.16	0.17	0.10	0.47	0.05	0.48	0.09	0.57	0.02	
16/12/2024 06:45:00	0.64	0.07	0.05	0.02	0.16	0.17	0.10	0.47	0.05	0.48	0.09	0.60	0.01	
16/12/2024 07:00:00	0.64	0.07	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.48	0.09	0.62	0.02	
16/12/2024 07:15:00	0.65	0.06	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.48	0.10	0.63	0.02	
16/12/2024 07:30:00	0.66	0.06	0.05	0.02	0.15	0.17	0.10	0.46	0.06	0.48	0.10	0.65	-0.02	
16/12/2024 07:45:00	0.67	0.04	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.48	0.09	0.66	0.00	
16/12/2024 08:00:00	0.68	0.03	0.05	0.02	0.15	0.16	0.10	0.47	0.06	0.48	0.09	0.67	0.02	
16/12/2024 08:15:00	0.68	0.03	0.05	0.02	0.15	0.17	0.10	0.47	0.05	0.49	0.09	0.67	0.00	
16/12/2024 08:30:00	0.69	0.04	0.05	0.02	0.15	0.16	0.10	0.47	0.06	0.49	0.09	0.68	0.00	
16/12/2024 08:45:00	0.70	0.04	0.05	0.02	0.15	0.16	0.10	0.47	0.05	0.49	0.08	0.69	-0.01	
16/12/2024 09:00:00	0.70	0.04	0.05	0.02	0.15	0.16	0.10	0.48	0.05	0.50	0.08	0.69	0.02	
16/12/2024 09:15:00	0.71	0.04	0.05	0.02	0.15	0.16	0.10	0.48	0.05	0.50	0.08	0.70	0.01	
16/12/2024 09:30:00	0.72	0.04	0.05	0.02	0.15	0.16	0.10	0.48	0.06	0.50	0.08	0.70	0.00	
16/12/2024 09:45:00	0.72	0.04	0.05	0.02	0.15	0.16	0.10	0.49	0.06	0.51	0.08	0.71	0.00	
16/12/2024 10:00:00	0.73	0.03	0.05	0.02	0.15	0.16	0.10	0.49	0.06	0.51	0.08	0.71	0.01	
16/12/2024 10:15:00	0.73	0.04	0.05	0.02	0.15	0.16	0.10	0.49	0.06	0.51		0.72	0.01	
16/12/2024 10:30:00	0.74	0.03	0.05	0.02	0.15	0.16	0.10	0.49	0.05	0.52		0.72	0.02	
16/12/2024 10:45:00	0.74	0.03	0.05	0.02	0.15	0.16	0.10	0.49	0.07	0.52		0.72	0.02	
16/12/2024 11:00:00	0.74	0.05	0.05	0.02	0.15	0.16	0.10	0.49	0.07	0.52		0.73	0.01	
16/12/2024 11:15:00	0.75	0.04	0.05	0.02	0.15	0.16	0.10	0.49	0.06	0.52		0.73	0.03	
16/12/2024 11:30:00	0.75	0.05	0.05	0.02	0.15	0.17	0.10	0.49	0.07	0.53		0.73	0.00	
16/12/2024 11:45:00	0.75	0.04	0.05	0.02	0.15	0.17	0.10	0.49	0.06	0.53		0.74	0.01	
16/12/2024 12:00:00	0.76	0.05	0.05	0.02	0.15	0.17	0.10	0.50	0.07	0.53		0.74	0.02	
16/12/2024 12:15:00	0.76	0.03	0.05	0.02	0.15	0.17	0.10	0.50	0.07	0.53	0.04	0.74	0.01	
16/12/2024 12:30:00	0.76	0.05	0.05	0.02	0.16	0.17	0.10	0.50	0.06	0.54	0.03	0.74	0.02	
16/12/2024 12:45:00	0.77	0.05	0.05	0.02	0.16	0.17	0.10	0.50	0.07	0.54	0.03	0.74	0.01	
16/12/2024 13:00:00	0.77	0.04	0.05	0.02	0.16	0.17	0.10	0.50	0.05	0.54	0.04	0.75	0.01	
16/12/2024 13:15:00	0.77	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.06	0.54	0.06	0.75	0.01	
16/12/2024 13:30:00	0.77	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.54	0.05	0.75	0.01	
16/12/2024 13:45:00	0.77	0.04	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.55	0.05	0.75	0.02	
16/12/2024 14:00:00	0.78	0.04	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.55	0.06	0.75	0.02	
16/12/2024 14:15:00	0.78	0.04	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.55	0.05	0.73	0.04	
16/12/2024 14:30:00	0.77	0.07	0.06	0.03	0.16	0.17	0.10	0.49	0.07	0.55	0.05	0.70	0.03	
16/12/2024 14:45:00	0.77	0.05	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.55	0.05	0.68	0.11	
16/12/2024 15:00:00	0.76	0.05	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.55	0.05	0.65	0.09	
16/12/2024 15:15:00	0.75	0.07	0.06	0.03	0.16	0.17	0.10	0.48	0.05	0.54	0.05	0.63	0.13	
16/12/2024 15:30:00	0.75	0.06	0.06	0.03	0.16	0.17	0.10	0.48	0.06	0.54	0.05	0.61	0.14	
16/12/2024 15:45:00	0.74	0.08	0.06	0.03	0.16	0.17	0.10	0.48	0.06	0.53	0.06	0.59	0.09	
16/12/2024 16:00:00	0.73	0.08	0.06	0.03	0.16	0.17	0.10	0.48	0.06	0.53	0.06	0.58	0.14	
16/12/2024 16:15:00	0.72	0.08	0.06	0.03	0.16	0.17	0.10	0.48	0.05	0.53	0.06	0.56	0.11	
16/12/2024 16:30:00	0.72	0.08	0.06	0.03	0.16	0.17	0.10	0.48	0.06	0.52	0.07	0.55	0.14	
16/12/2024 16:45:00	0.71	0.08	0.06	0.03	0.16	0.17	0.10	0.48	0.05	0.52	0.08	0.54	0.13	
16/12/2024 17:00:00	0.70	0.09	0.06	0.03	0.16	0.17	0.10	0.48	0.06	0.51	0.08	0.53	0.12	
16/12/2024 17:15:00	0.69	0.08	0.06	0.03	0.16	0.17	0.10	0.48	0.04	0.51	0.08	0.52	0.11	
16/12/2024 17:30:00	0.69	0.08	0.06	0.03	0.16	0.17	0.10	0.48	0.05	0.51	0.08	0.51	0.01	
16/12/2024 17:45:00	0.68	0.08	0.06	0.03	0.16	0.17	0.10	0.48	0.05	0.50	0.08	0.50	0.08	
16/12/2024 18:00:00	0.67	0.07	0.06	0.03	0.16	0.17	0.10	0.48	0.06	0.50	0.08	0.49	0.09	
16/12/2024 18:15:00	0.67	0.08	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.50	0.08	0.49	0.07	
16/12/2024 18:30:00	0.66	0.08	0.06	0.03	0.16	0.17	0.10	0.49	0.04	0.49	0.09	0.48	0.05	
16/12/2024 18:45:00	0.65	0.09	0.06	0.03	0.16	0.17	0.10	0.49	0.04	0.49	0.09	0.47	0.05	
16/12/2024 19:00:00	0.65	0.08	0.06	0.03	0.16	0.17	0.10	0.49	0.07	0.49	0.08	0.47	0.05	
16/12/2024 19:15:00	0.64	0.08	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.49	0.08	0.48	0.09	
16/12/2024 19:30:00	0.64	0.09	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.48	0.09	0.50	0.05	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
16/12/2024 19:45:00	0.63	0.08	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.48	0.09	0.53	0.03	
16/12/2024 20:00:00	0.63	0.10	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.48	0.08	0.57	0.02	
16/12/2024 20:15:00	0.63	0.08	0.06	0.03	0.16	0.17	0.10	0.50	0.06	0.48	0.09	0.59	0.01	
16/12/2024 20:30:00	0.64	0.07	0.06	0.03	0.16	0.17	0.10	0.50	0.06	0.48	0.09	0.61	0.02	
16/12/2024 20:45:00	0.65	0.06	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.48	0.10	0.63	-0.01	
16/12/2024 21:00:00	0.65	0.05	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.48	0.08	0.64	0.00	
16/12/2024 21:15:00	0.66	0.04	0.06	0.03	0.16	0.17	0.10	0.50	0.06	0.48	0.09	0.65	0.00	
16/12/2024 21:30:00	0.67	0.04	0.06	0.03	0.16	0.17	0.10	0.50	0.06	0.48	0.08	0.66	0.01	
16/12/2024 21:45:00	0.68	0.05	0.06	0.03	0.16	0.17	0.10	0.50	0.06	0.48	0.08	0.67	0.00	
16/12/2024 22:00:00	0.69	0.04	0.06	0.03	0.16	0.17	0.10	0.50	0.06	0.48	0.08	0.67	0.02	
16/12/2024 22:15:00	0.69	0.04	0.06	0.03	0.16	0.17	0.10	0.50	0.06	0.49	0.08	0.68	0.00	
16/12/2024 22:30:00	0.70	0.04	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.49	0.08	0.69	0.01	
16/12/2024 22:45:00	0.71	0.04	0.06	0.03	0.16	0.17	0.10	0.50	0.04	0.49	0.08	0.69	0.00	
16/12/2024 23:00:00	0.71	0.03	0.06	0.03	0.16	0.17	0.11	0.50	0.04	0.50	0.08	0.70	0.02	
16/12/2024 23:15:00	0.72	0.04	0.06	0.03	0.16	0.17	0.11	0.50	0.05	0.50	0.07	0.70	0.02	
16/12/2024 23:30:00	0.72	0.04	0.06	0.03	0.16	0.17	0.11	0.50	0.05	0.50	0.07	0.71	0.01	
16/12/2024 23:45:00	0.73	0.05	0.06	0.03	0.16	0.17	0.11	0.49	0.05	0.51	0.07	0.71	0.02	
17/12/2024 00:00:00	0.73	0.04	0.06	0.03	0.16	0.17	0.11	0.49	0.05	0.51	0.07	0.71	0.02	
17/12/2024 00:15:00	0.73	0.03	0.06	0.03	0.16	0.17	0.11	0.49	0.04	0.51	0.07	0.72	0.01	
17/12/2024 00:30:00	0.74	0.04	0.06	0.03	0.16	0.17	0.11	0.49	0.05	0.52	0.07	0.72	0.01	
17/12/2024 00:45:00	0.74	0.03	0.06	0.03	0.16	0.17	0.11	0.49	0.04	0.52	0.07	0.72	-0.01	
17/12/2024 01:00:00	0.74	0.01	0.06	0.03	0.16	0.17	0.11	0.49	0.00	0.52	0.06	0.73	0.01	
17/12/2024 01:15:00	0.75	0.00	0.06	0.03	0.16	0.17	0.11	0.49	0.04	0.52	0.06	0.73	0.01	
17/12/2024 01:30:00	0.75	0.00	0.06	0.03	0.16	0.17	0.11	0.49	0.05	0.53	0.06	0.73	0.01	
17/12/2024 01:45:00	0.75	0.00	0.06	0.03	0.16	0.17	0.11	0.48	0.06	0.53	0.06	0.74	0.03	
17/12/2024 02:00:00	0.75	0.00	0.06	0.03	0.16	0.17	0.11	0.48	0.04	0.53	0.06	0.71	0.06	
17/12/2024 02:15:00	0.75	0.00	0.06	0.03	0.16	0.17	0.11	0.48	0.06	0.53	0.06	0.68	0.09	
17/12/2024 02:30:00	0.75	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.04	0.53	0.06	0.65	0.08	
17/12/2024 02:45:00	0.74	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.02	0.53	0.06	0.63	0.03	
17/12/2024 03:00:00	0.73	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.03	0.53	0.06	0.61	0.10	
17/12/2024 03:15:00	0.73	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.03	0.52	0.06	0.59	0.06	
17/12/2024 03:30:00	0.72	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.03	0.52	0.07	0.57	0.10	
17/12/2024 03:45:00	0.71	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.03	0.51	0.07	0.56	0.03	
17/12/2024 04:00:00	0.70	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.02	0.51	0.07	0.54	0.06	
17/12/2024 04:15:00	0.69	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.01	0.51	0.08	0.53	0.02	
17/12/2024 04:30:00	0.69	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.01	0.50	0.08	0.52	0.05	
17/12/2024 04:45:00	0.68	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.00	0.50	0.08	0.51	0.08	
17/12/2024 05:00:00	0.67	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.03	0.50	0.08	0.50	0.05	
17/12/2024 05:15:00	0.66	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.02	0.49	0.08	0.49	0.06	
17/12/2024 05:30:00	0.66	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.03	0.49	0.08	0.48	0.07	
17/12/2024 05:45:00	0.65	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.03	0.49	0.08	0.47	0.06	
17/12/2024 06:00:00	0.64	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.04	0.48	0.09	0.47	0.02	
17/12/2024 06:15:00	0.64	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.06	0.48	0.09	0.46	0.05	
17/12/2024 06:30:00	0.63	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.04	0.48	0.09	0.45	0.03	
17/12/2024 06:45:00	0.63	0.00	0.05	0.02	0.15	0.16	0.10	0.46	0.07	0.47	0.08	0.45	0.04	
17/12/2024 07:00:00	0.62	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.05	0.47	0.08	0.44	0.03	
17/12/2024 07:15:00	0.61	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.06	0.47	0.08	0.44	0.04	
17/12/2024 07:30:00	0.61	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.05	0.47	0.08	0.44	0.04	
17/12/2024 07:45:00	0.60	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.05	0.47	0.08	0.45	0.04	
17/12/2024 08:00:00	0.60	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.05	0.47	0.09	0.47	0.00	
17/12/2024 08:15:00	0.60	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.05	0.46	0.09	0.50	0.01	
17/12/2024 08:30:00	0.59	0.00	0.05	0.02	0.15	0.16	0.09	0.47	0.06	0.46	0.09	0.54	0.00	
17/12/2024 08:45:00	0.60	0.00	0.05	0.02	0.15	0.16	0.09	0.48	0.05	0.46	0.09	0.56	0.02	
17/12/2024 09:00:00	0.60	0.00	0.05	0.02	0.15	0.16	0.09	0.48	0.05	0.46	0.09	0.58	-0.01	
17/12/2024 09:15:00	0.61	0.00	0.05	0.02	0.15	0.16	0.09	0.48	0.05	0.46	0.09	0.59	-0.02	
17/12/2024 09:30:00	0.62	0.00	0.04	0.02	0.15	0.16	0.09	0.49	0.05	0.46	0.09	0.60	0.00	
17/12/2024 09:45:00	0.62	0.00	0.04	0.02	0.15	0.16	0.09	0.49	0.05	0.46	0.09	0.61	0.00	
17/12/2024 10:00:00	0.63	0.00	0.05	0.02	0.15	0.16	0.09	0.49	0.05	0.46	0.09	0.62	0.00	
17/12/2024 10:15:00	0.64	0.00	0.05	0.02	0.15	0.16	0.09	0.49	0.05	0.46	0.08	0.63	0.00	
17/12/2024 10:30:00	0.65	0.00	0.05	0.02	0.15	0.16	0.10	0.49	0.05	0.47	0.08	0.63	0.00	
17/12/2024 10:45:00	0.66	0.00	0.05	0.02	0.15	0.16	0.10	0.50	0.06	0.47	0.08	0.64	0.00	
17/12/2024 11:00:00	0.66	0.00	0.05	0.02	0.15	0.16	0.10	0.51	0.07	0.47	0.08	0.65	0.01	
17/12/2024 11:15:00	0.67	0.00	0.05	0.02	0.15	0.16	0.10	0.51	0.06	0.47	0.08	0.65	0.00	
17/12/2024 11:30:00	0.68	0.00	0.05	0.02	0.15	0.16	0.10	0.51	0.04	0.48	0.07	0.66	0.01	
17/12/2024 11:45:00	0.68	0.00	0.05	0.02	0.15	0.16	0.10	0.51	0.05	0.48	0.07	0.66	0.01	
17/12/2024 12:00:00	0.69	0.00	0.05	0.02	0.15	0.16	0.10	0.51	0.05	0.48	0.07	0.67	0.01	
17/12/2024 12:15:00	0.69	0.00	0.05	0.02	0.15	0.17	0.10	0.50	0.05	0.48	0.08	0.68	0.00	
17/12/2024 12:30:00	0.70	0.00	0.05	0.02	0.15	0.17	0.10	0.50	0.06	0.49	0.07	0.68	0.00	
17/12/2024 12:45:00	0.70	0.00	0.06	0.03	0.15	0.17	0.10	0.50	0.05	0.49	0.06	0.69	0.00	
17/12/2024 13:00:00	0.71	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.49	0.07	0.69	0.01	
17/12/2024 13:15:00	0.71	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.50	0.07	0.69	0.01	
17/12/2024 13:30:00	0.72	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.04	0.50	0.07	0.70	0.00	
17/12/2024 13:45:00	0.72	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.50	0.06	0.70	0.01	
17/12/2024 14:00:00	0.72	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.50	0.06	0.70	0.01	
17/12/2024 14:15:00	0.73	0.00	0.06	0.03	0.16	0.17	0.11	0.50	0.05	0.51	0.06	0.71	0.01	
17/12/2024 14:30:00	0.73	0.00	0.06	0.03	0.16	0.17	0.11	0.50	0.05	0.51	0.06	0.70	0.04	
17/12/2024 14:45:00	0.73	0.00	0.06	0.03	0.16	0.17	0.11	0.50	0.05	0.51	0.06	0.67	0.05	
17/12/2024 15:00:00	0.73	0.00	0.06	0.03	0.16	0.17	0.11	0.50	0.05	0.51	0.02	0.64	0.06	
17/12/2024 15:15:00	0.72	0.00	0.06	0.03	0.16	0.17	0.11	0.50	0.05	0.51	0.02	0.61	0.11	
17/12/2024 15:30:00	0.71	0.00	0.06	0.03	0.16	0.17	0.11	0.49	0.05	0.51	0.00	0.59	0.08	
17/12/2024 15:45:00	0.71	0.00	0.06	0.03	0.16	0.17	0.11	0.49	0.05	0.51	0.00	0.58	0.12	
17/12/2024 16:00:00	0.70	0.00	0.06	0.03	0.16	0.17	0.11	0.49	0.05	0.50	0.02	0.55	0.06	
17/12/2024 16:15:00	0.69	0.00	0.06	0.03	0.16	0.17	0.11	0.49	0.06	0.50	0.03	0.53	0.11	
17/12/2024 16:30:00	0.69	0.00	0.06	0.03	0.16	0.17	0.11	0.49	0.05	0.50	0.04	0.52	0.10	
17/12/2024 16:45:00	0.68	0.00	0.06	0.03	0.16	0.17	0.11	0.49	0.05	0.49	0.05	0.51	0.08	
17/12/2024 17:00:00	0.67	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.49	0.06	0.50	0.10	
17/12/2024 17:15:00	0.66	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.49	0.06	0.49	0.09	
17/12/2024 17:30:00	0.66	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.48	0.06	0.48	0.06	
17/12/2024 17:45:00	0.65	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.48	0.05	0.47	0.05	
17/12/2024 18:00:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.48	0.07	0.46	0.05	
17/12/2024 18:15:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.48	0.06	0.45	0.07	
17/12/2024 18:30:00	0.63	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.47	0.06	0.44	0.07	
17/12/2024 18:45:00	0.62	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.47	0.07	0.44	0.06	
17/12/2024 19:00:00	0.62	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.47	0.06	0.43	0.06	
17/12/2024 19:15:00	0.61	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.47	0.06	0.42	0.06	
17/12/2024 19:30:00	0.61	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.04	0.47	0.07	0.42	0.05	
17/12/2024 19:45:00	0.60	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.06	0.47	0.07	0.42	0.04	
17/12/2024 20:00:00	0.60	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.46	0.08	0.43	0.03	
17/12/2024 20:15:00	0.59	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.46	0.08	0.45	0.03	
17/12/2024 20:30:00	0.59	0.00	0.06	0.03	0.16	0.17	0.10	0.51	0.05	0.46	0.08	0.48	0.02	
17/12/2024 20:45:00	0.59	0.00	0.06	0.03	0.16	0.17	0.10	0.51	0.03	0.46	0.08	0.51	0.02	
17/12/2024 21:00:00	0.59	0.07	0.06	0.03	0.16	0.17	0.10	0.51	0.01	0.46	0.08	0.54	0.00	
17/12/2024 21:15:00	0.60	0.06	0.06	0.03	0.16	0.17	0.10	0.51	0.05	0.46	0.08	0.55	0.02	
17/12/2024 21:30:00	0.61	0.04	0.06	0.03	0.16	0.17	0.10	0.51	0.05	0.46	0.08	0.57	0.02	
17/12/2024 21:45:00	0.61	0.02	0.06	0.03	0.16	0.17	0.10	0.51	0.05	0.46	0.08	0.58	0.01	
17/12/2024 22:00:00	0.62	0.00	0.06	0.03	0.16	0.17	0.10	0.51	0.05	0.46	0.06	0.59	0.01	
17/12/2024 22:15:00	0.63	0.00	0.06	0.03	0.16	0.17	0.10	0.51	0.05	0.46	0.05	0.60	0.02	
17/12/2024 22:30:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.51	0.05	0.46	0.05	0.61	0.02	
17/12/2024 22:45:00	0.64	0.00	0.06	0.03	0.16	0.17	0.11	0.51	0.05	0.47	0.08	0.62	0.00	
17/12/2024 23:00:00	0.65	0.00	0.06	0.03	0.16	0.17	0.11	0.51	0.06	0.47	0.07	0.63	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
17/12/2024 23:15:00	0.66	0.00	0.06	0.03	0.16	0.17	0.11	0.51	0.06	0.47	0.05	0.63	0.02	
17/12/2024 23:30:00	0.67	0.04	0.06	0.03	0.16	0.17	0.11	0.51	0.06	0.47	0.07	0.64	0.01	
17/12/2024 23:45:00	0.67	0.04	0.06	0.03	0.16	0.18	0.11	0.50	0.05	0.48	0.06	0.65	0.00	
18/12/2024 00:00:00	0.68	0.04	0.06	0.03	0.16	0.18	0.11	0.51	0.05	0.48	0.04	0.65	0.01	
18/12/2024 00:15:00	0.69	0.04	0.06	0.03	0.16	0.18	0.11	0.51	0.06	0.48	0.06	0.66	0.01	
18/12/2024 00:30:00	0.69	0.05	0.06	0.03	0.16	0.18	0.11	0.51	0.05	0.49	0.07	0.67	0.02	
18/12/2024 00:45:00	0.70	0.05	0.06	0.03	0.16	0.18	0.11	0.51	0.05	0.49	0.07	0.67	0.02	
18/12/2024 01:00:00	0.70	0.05	0.06	0.03	0.16	0.18	0.11	0.50	0.05	0.49	0.07	0.68	0.02	
18/12/2024 01:15:00	0.71	0.04	0.06	0.03	0.16	0.18	0.11	0.50	0.05	0.50	0.07	0.68	0.02	
18/12/2024 01:30:00	0.71	0.04	0.06	0.03	0.16	0.18	0.11	0.50	0.04	0.50	0.06	0.68	0.03	
18/12/2024 01:45:00	0.72	0.03	0.06	0.03	0.16	0.18	0.11	0.50	0.06	0.50	0.05	0.67	0.05	
18/12/2024 02:00:00	0.72	0.01	0.06	0.03	0.16	0.18	0.11	0.49	0.05	0.50	0.06	0.65	0.07	
18/12/2024 02:15:00	0.72	0.00	0.06	0.03	0.16	0.18	0.11	0.50	0.05	0.51	0.06	0.62	0.12	
18/12/2024 02:30:00	0.71	0.00	0.06	0.03	0.16	0.18	0.11	0.50	0.05	0.51	0.06	0.59	0.11	
18/12/2024 02:45:00	0.71	0.00	0.06	0.03	0.16	0.18	0.11	0.50	0.04	0.51	0.06	0.57	0.10	
18/12/2024 03:00:00	0.70	0.00	0.06	0.03	0.16	0.18	0.11	0.49	0.04	0.50	0.06	0.54	0.12	
18/12/2024 03:15:00	0.70	0.00	0.06	0.03	0.16	0.18	0.11	0.49	0.04	0.50	0.06	0.53	0.11	
18/12/2024 03:30:00	0.69	0.00	0.06	0.03	0.16	0.18	0.11	0.49	0.04	0.50	0.06	0.51	0.10	
18/12/2024 03:45:00	0.68	0.00	0.06	0.03	0.16	0.18	0.11	0.48	0.05	0.50	0.06	0.50	0.10	
18/12/2024 04:00:00	0.68	0.00	0.06	0.03	0.16	0.17	0.11	0.48	0.05	0.50	0.06	0.49	0.12	
18/12/2024 04:15:00	0.67	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.05	0.49	0.06	0.48	0.07	
18/12/2024 04:30:00	0.67	0.00	0.06	0.03	0.16	0.18	0.10	0.48	0.05	0.49	0.07	0.47	0.09	
18/12/2024 04:45:00	0.66	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.05	0.49	0.06	0.46	0.06	
18/12/2024 05:00:00	0.65	0.00	0.05	0.02	0.16	0.17	0.10	0.48	0.06	0.48	0.07	0.45	0.05	
18/12/2024 05:15:00	0.65	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.06	0.48	0.07	0.44	0.03	
18/12/2024 05:30:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.06	0.48	0.07	0.44	0.06	
18/12/2024 05:45:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.06	0.48	0.08	0.43	0.04	
18/12/2024 06:00:00	0.63	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.04	0.48	0.08	0.43	0.03	
18/12/2024 06:15:00	0.63	0.00	0.05	0.02	0.16	0.17	0.10	0.48	0.03	0.47	0.09	0.42	0.05	
18/12/2024 06:30:00	0.62	0.00	0.05	0.02	0.15	0.17	0.10	0.48	0.05	0.47	0.09	0.41	0.00	
18/12/2024 06:45:00	0.62	0.00	0.05	0.02	0.16	0.17	0.10	0.48	0.05	0.47	0.08	0.41	0.03	
18/12/2024 07:00:00	0.61	0.08	0.05	0.02	0.15	0.17	0.10	0.48	0.04	0.47	0.08	0.41	0.03	
18/12/2024 07:15:00	0.61	0.07	0.06	0.03	0.15	0.17	0.10	0.48	0.05	0.47	0.07	0.40	0.04	
18/12/2024 07:30:00	0.60	0.05	0.05	0.02	0.15	0.17	0.10	0.48	0.05	0.47	0.07	0.39	0.02	
18/12/2024 07:45:00	0.60	0.02	0.05	0.02	0.15	0.17	0.10	0.48	0.06	0.46	0.08	0.39	0.04	
18/12/2024 08:00:00	0.60	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.05	0.46	0.08	0.39	0.03	
18/12/2024 08:15:00	0.59	0.00	0.05	0.02	0.15	0.17	0.10	0.48	0.06	0.46	0.08	0.38	0.01	
18/12/2024 08:30:00	0.59	0.00	0.05	0.02	0.15	0.17	0.10	0.48	0.07	0.46	0.08	0.38	0.02	
18/12/2024 08:45:00	0.59	0.00	0.05	0.02	0.15	0.17	0.10	0.49	0.06	0.46	0.09	0.37	0.02	
18/12/2024 09:00:00	0.58	0.00	0.05	0.02	0.15	0.17	0.10	0.49	0.06	0.46	0.08	0.37	0.05	
18/12/2024 09:15:00	0.58	0.00	0.05	0.02	0.15	0.17	0.10	0.49	0.04	0.46	0.08	0.37	0.05	
18/12/2024 09:30:00	0.58	0.00	0.05	0.02	0.15	0.17	0.10	0.49	0.05	0.46	0.08	0.37	0.04	
18/12/2024 09:45:00	0.58	0.00	0.05	0.02	0.15	0.17	0.10	0.50	0.05	0.46	0.09	0.37	0.04	
18/12/2024 10:00:00	0.57	0.00	0.05	0.02	0.15	0.17	0.10	0.50	0.06	0.46	0.09	0.38	0.03	
18/12/2024 10:15:00	0.57	0.00	0.05	0.02	0.15	0.17	0.10	0.50	0.06	0.46	0.09	0.40	0.03	
18/12/2024 10:30:00	0.57	0.00	0.05	0.02	0.15	0.17	0.10	0.50	0.06	0.46	0.10	0.44	0.02	
18/12/2024 10:45:00	0.57	0.08	0.05	0.02	0.15	0.17	0.10	0.50	0.04	0.45	0.09	0.46	0.02	
18/12/2024 11:00:00	0.57	0.05	0.05	0.02	0.15	0.17	0.10	0.50	-0.02	0.45	0.09	0.49	0.03	
18/12/2024 11:15:00	0.57	0.03	0.06	0.03	0.15	0.17	0.10	0.50	-0.07	0.45	0.09	0.50	0.02	
18/12/2024 11:30:00	0.58	0.00	0.06	0.03	0.15	0.17	0.10	0.50	-0.06	0.45	0.09	0.52	0.02	
18/12/2024 11:45:00	0.58	0.00	0.06	0.03	0.15	0.17	0.10	0.50	-0.01	0.45	0.09	0.53	0.00	
18/12/2024 12:00:00	0.59	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.04	0.45	0.09	0.54	0.02	
18/12/2024 12:15:00	0.59	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.04	0.45	0.09	0.55	0.02	
18/12/2024 12:30:00	0.60	0.00	0.06	0.03	0.16	0.17	0.10	0.50	-0.08	0.45	0.08	0.56	0.02	
18/12/2024 12:45:00	0.60	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.01	0.46	0.09	0.57	0.02	
18/12/2024 13:00:00	0.61	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.04	0.46	0.10	0.58	0.01	
18/12/2024 13:15:00	0.62	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.04	0.46	0.09	0.59	0.00	
18/12/2024 13:30:00	0.62	0.00	0.06	0.03	0.16	0.17	0.10	0.50	-0.01	0.46	0.09	0.59	0.02	
18/12/2024 13:45:00	0.63	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.46	0.09	0.60	0.01	
18/12/2024 14:00:00	0.63	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.46	0.09	0.61	0.02	
18/12/2024 14:15:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.04	0.46	0.08	0.61	0.00	
18/12/2024 14:30:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.04	0.46	0.08	0.62	-0.01	
18/12/2024 14:45:00	0.65	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.46	0.09	0.62	0.04	
18/12/2024 15:00:00	0.65	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.47	0.08	0.60	0.07	
18/12/2024 15:15:00	0.65	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.47	0.08	0.57	0.07	
18/12/2024 15:30:00	0.65	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.47	0.08	0.55	0.03	
18/12/2024 15:45:00	0.65	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.47	0.08	0.53	0.08	
18/12/2024 16:00:00	0.65	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.47	0.08	0.52	0.09	
18/12/2024 16:15:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.47	0.08	0.50	0.07	
18/12/2024 16:30:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.47	0.08	0.48	0.05	
18/12/2024 16:45:00	0.63	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.47	0.08	0.47	0.03	
18/12/2024 17:00:00	0.63	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.47	0.07	0.45	0.07	
18/12/2024 17:15:00	0.62	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.04	0.47	0.08	0.44	0.06	
18/12/2024 17:30:00	0.62	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.46	0.08	0.43	0.02	
18/12/2024 17:45:00	0.61	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.05	0.46	0.08	0.42	0.04	
18/12/2024 18:00:00	0.61	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.46	0.08	0.41	0.03	
18/12/2024 18:15:00	0.60	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.46	0.08	0.40	0.01	
18/12/2024 18:30:00	0.60	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.46	0.08	0.40	0.01	
18/12/2024 18:45:00	0.59	0.00	0.06	0.03	0.16	0.17	0.10	0.50	0.05	0.46	0.08	0.39	0.03	
18/12/2024 19:00:00	0.59	0.00	0.06	0.03	0.16	0.18	0.10	0.50	0.05	0.46	0.07	0.39	0.02	
18/12/2024 19:15:00	0.59	0.00	0.05	0.02	0.16	0.18	0.10	0.50	0.04	0.46	0.08	0.41	0.03	
18/12/2024 19:30:00	0.58	0.10	0.06	0.03	0.16	0.18	0.10	0.50	0.01	0.45	0.08	0.45	0.03	
18/12/2024 19:45:00	0.58	0.08	0.06	0.03	0.16	0.18	0.10	0.50	0.05	0.45	0.08	0.47	0.04	
18/12/2024 20:00:00	0.58	0.08	0.06	0.03	0.16	0.18	0.10	0.51	0.07	0.45	0.08	0.49	0.05	
18/12/2024 20:15:00	0.58	0.07	0.06	0.03	0.16	0.18	0.10	0.51	0.06	0.45	0.07	0.51	0.02	
18/12/2024 20:30:00	0.58	0.07	0.06	0.03	0.16	0.18	0.10	0.51	0.05	0.45	0.08	0.52	0.02	
18/12/2024 20:45:00	0.59	0.07	0.06	0.03	0.16	0.18	0.11	0.51	0.02	0.45	0.09	0.54	0.03	
18/12/2024 21:00:00	0.59	0.07	0.06	0.03	0.16	0.18	0.11	0.51	0.05	0.45	0.07	0.55	0.02	
18/12/2024 21:15:00	0.60	0.06	0.06	0.03	0.16	0.18	0.11	0.51	0.05	0.45	0.08	0.56	0.02	
18/12/2024 21:30:00	0.61	0.06	0.06	0.03	0.16	0.18	0.11	0.51	0.05	0.45	0.07	0.56	0.01	
18/12/2024 21:45:00	0.61	0.06	0.06	0.03	0.16	0.18	0.11	0.51	0.04	0.45	0.06	0.57	0.02	
18/12/2024 22:00:00	0.62	0.05	0.06	0.03	0.16	0.18	0.11	0.51	0.05	0.45	0.05	0.58	0.02	
18/12/2024 22:15:00	0.62	0.05	0.06	0.03	0.16	0.18	0.11	0.49	0.06	0.46	0.05	0.59	0.02	
18/12/2024 22:30:00	0.63	0.06	0.06	0.03	0.16	0.18	0.11	0.49	0.04	0.46	0.05	0.59	0.02	
18/12/2024 22:45:00	0.63	0.05	0.06	0.03	0.16	0.18	0.11	0.49	0.04	0.46	0.05	0.60	0.02	
18/12/2024 23:00:00	0.64	0.06	0.06	0.03	0.16	0.18	0.11	0.49	0.03	0.46	0.08	0.61	0.02	
18/12/2024 23:15:00	0.65	0.06	0.06	0.03	0.16	0.18	0.11	0.49	0.03	0.46	0.05	0.61	0.03	
18/12/2024 23:30:00	0.65	0.04	0.07	0.03	0.16	0.18	0.11	0.49	0.04	0.46	0.06	0.62	0.02	
18/12/2024 23:45:00	0.66	0.02	0.07	0.03	0.17	0.19	0.11	0.49	0.04	0.47	0.07	0.62	-0.03	
19/12/2024 00:00:00	0.66	0.00	0.07	0.03	0.17	0.19	0.11	0.49	0.04	0.47	0.08	0.63	0.03	
19/12/2024 00:15:00	0.67	0.05	0.07	0.03	0.17	0.19	0.11	0.49	0.04	0.47	0.07	0.64	0.01	
19/12/2024 00:30:00	0.67	0.03	0.07	0.03	0.17	0.19	0.11	0.49	0.04	0.47	0.07	0.64	0.02	
19/12/2024 00:45:00	0.67	0.02	0.07	0.03	0.17	0.19	0.11	0.48	0.05	0.47	0.07	0.64	0.01	
19/12/2024 01:00:00	0.68	0.00	0.07	0.03	0.17	0.19	0.11	0.48	0.05	0.48	0.07	0.65	0.01	
19/12/2024 01:15:00	0.68	0.00	0.07	0.03	0.17	0.19	0.11	0.48	0.05	0.48	0.07	0.65	0.02	
19/12/2024 01:30:00	0.69	0.00	0.07	0.03	0.17	0.19	0.11	0.48	0.05	0.48	0.07	0.66	0.02	
19/12/2024 01:45:00	0.69	0.00	0.07	0.03	0.17	0.19	0.11	0.48	0.03	0.48	0.07	0.66	0.02	
19/12/2024 02:00:00	0.70	0.00	0.07	0.03	0.17	0.19	0.11	0.48	0.04	0.49	0.07	0.66	0.00	
19/12/2024 02:15:00	0.70	0.00	0.07	0.03	0.17	0.19	0.11	0.47	0.05	0.49	0.07	0.67	0.01	
19/12/2024 02:30:00	0.70	0.00	0.07	0.03	0.17	0.19	0.11	0.47	0.05	0.49	0.07	0.68	0.00	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
19/12/2024 02:45:00	0.71	0.00	0.07	0.03	0.17	0.19	0.11	0.47	0.05	0.49	0.07	0.68	0.02	
19/12/2024 03:00:00	0.71	0.00	0.07	0.03	0.17	0.19	0.11	0.47	0.06	0.49	0.07	0.68	0.03	
19/12/2024 03:15:00	0.71	0.04	0.08	0.04	0.16	0.18	0.11	0.46	0.06	0.50	0.05	0.70	0.03	
19/12/2024 03:30:00	0.72	0.04	0.08	0.04	0.16	0.18	0.11	0.44	0.05	0.50	0.07	0.70	-0.02	
19/12/2024 03:45:00	0.72	0.04	0.08	0.04	0.16	0.18	0.11	0.46	0.04	0.50	0.06	0.70	0.03	
19/12/2024 04:00:00	0.72	0.04	0.07	0.04	0.16	0.18	0.11	0.46	0.03	0.50	0.05	0.70	0.04	
19/12/2024 04:15:00	0.72	0.03	0.07	0.04	0.16	0.18	0.11	0.46	0.02	0.50	0.03	0.70	0.04	
19/12/2024 04:30:00	0.72	0.04	0.07	0.03	0.16	0.18	0.11	0.46	0.03	0.51	0.07	0.68	0.06	
19/12/2024 04:45:00	0.72	0.05	0.07	0.04	0.16	0.18	0.11	0.46	0.03	0.51	0.07	0.66	0.09	
19/12/2024 05:00:00	0.72	0.04	0.07	0.03	0.16	0.18	0.11	0.46	0.04	0.51	0.07	0.63	0.09	
19/12/2024 05:15:00	0.71	0.02	0.07	0.03	0.16	0.18	0.10	0.46	0.04	0.51	0.07	0.61	0.11	
19/12/2024 05:30:00	0.71	0.00	0.07	0.03	0.16	0.18	0.10	0.46	0.05	0.50	0.07	0.59	0.10	
19/12/2024 05:45:00	0.70	0.06	0.07	0.03	0.16	0.18	0.10	0.46	0.05	0.50	0.07	0.57	0.10	
19/12/2024 06:00:00	0.70	0.04	0.06	0.03	0.16	0.18	0.10	0.46	0.05	0.50	0.07	0.55	0.11	
19/12/2024 06:15:00	0.69	0.02	0.06	0.03	0.16	0.18	0.10	0.46	0.05	0.50	0.07	0.54	0.10	
19/12/2024 06:30:00	0.68	0.00	0.06	0.03	0.15	0.18	0.10	0.46	0.03	0.49	0.07	0.52	0.09	
19/12/2024 06:45:00	0.68	0.00	0.06	0.03	0.15	0.18	0.10	0.46	0.05	0.49	0.08	0.51	0.08	
19/12/2024 07:00:00	0.67	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.49	0.08	0.49	0.06	
19/12/2024 07:15:00	0.66	0.00	0.06	0.03	0.15	0.17	0.10	0.45	0.05	0.48	0.08	0.49	0.10	
19/12/2024 07:30:00	0.65	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.48	0.08	0.48	0.11	
19/12/2024 07:45:00	0.65	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.48	0.08	0.47	0.06	
19/12/2024 08:00:00	0.64	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.48	0.08	0.48	0.08	
19/12/2024 08:15:00	0.64	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.47	0.08	0.50	0.03	
19/12/2024 08:30:00	0.63	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.47	0.09	0.53	0.04	
19/12/2024 08:45:00	0.63	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.47	0.09	0.56	0.01	
19/12/2024 09:00:00	0.63	0.00	0.06	0.02	0.15	0.17	0.10	0.46	0.06	0.47	0.08	0.58	0.01	
19/12/2024 09:15:00	0.63	0.00	0.06	0.02	0.15	0.17	0.10	0.47	0.05	0.47	0.08	0.59	0.02	
19/12/2024 09:30:00	0.63	0.00	0.06	0.02	0.15	0.17	0.10	0.47	0.06	0.46	0.08	0.60	0.01	
19/12/2024 09:45:00	0.64	0.00	0.06	0.02	0.15	0.17	0.10	0.48	0.06	0.46	0.09	0.61	-0.01	
19/12/2024 10:00:00	0.64	0.00	0.05	0.02	0.15	0.17	0.10	0.48	0.05	0.46	0.09	0.62	0.02	
19/12/2024 10:15:00	0.65	0.00	0.05	0.02	0.15	0.17	0.10	0.48	0.06	0.46	0.09	0.63	0.02	
19/12/2024 10:30:00	0.65	0.00	0.05	0.02	0.15	0.17	0.10	0.48	0.05	0.47	0.08	0.63	-0.01	
19/12/2024 10:45:00	0.66	0.00	0.06	0.02	0.15	0.17	0.10	0.48	0.05	0.47	0.08	0.64	0.02	
19/12/2024 11:00:00	0.66	0.00	0.06	0.02	0.15	0.17	0.10	0.48	0.06	0.47	0.09	0.65	0.00	
19/12/2024 11:15:00	0.67	0.00	0.06	0.02	0.15	0.17	0.10	0.48	0.05	0.47	0.08	0.65	0.01	
19/12/2024 11:30:00	0.67	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.04	0.47	0.08	0.66	0.02	
19/12/2024 11:45:00	0.68	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.48	0.08	0.66	0.01	
19/12/2024 12:00:00	0.68	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.03	0.48	0.07	0.66	0.01	
19/12/2024 12:15:00	0.69	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.07	0.48	0.07	0.66	0.03	
19/12/2024 12:30:00	0.69	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.04	0.48	0.07	0.67	0.02	
19/12/2024 12:45:00	0.70	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.05	0.48	0.07	0.67	0.00	
19/12/2024 13:00:00	0.70	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.04	0.49	0.07	0.68	0.01	
19/12/2024 13:15:00	0.70	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.49	0.07	0.68	0.01	
19/12/2024 13:30:00	0.71	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.49	0.07	0.69	0.03	
19/12/2024 13:45:00	0.71	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.04	0.49	0.06	0.69	0.01	
19/12/2024 14:00:00	0.71	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.05	0.49	0.02	0.69	0.01	
19/12/2024 14:15:00	0.71	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.50	0.06	0.70	0.00	
19/12/2024 14:30:00	0.72	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.50	0.06	0.70	0.01	
19/12/2024 14:45:00	0.72	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.05	0.50	0.05	0.70	0.02	
19/12/2024 15:00:00	0.72	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.50	0.01	0.71	0.01	
19/12/2024 15:15:00	0.72	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.50	0.04	0.71	0.02	
19/12/2024 15:30:00	0.73	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.51	0.07	0.71	0.01	
19/12/2024 15:45:00	0.73	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.51	0.06	0.71	0.02	
19/12/2024 16:00:00	0.73	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.51	0.04	0.71	0.02	
19/12/2024 16:15:00	0.73	0.03	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.51	0.07	0.71	0.03	
19/12/2024 16:30:00	0.73	0.02	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.51	0.07	0.72	0.02	
19/12/2024 16:45:00	0.74	0.01	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.51	0.07	0.72	0.02	
19/12/2024 17:00:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.52	0.07	0.72	0.02	
19/12/2024 17:15:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.52	0.07	0.72	0.01	
19/12/2024 17:30:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.52	0.07	0.72	0.02	
19/12/2024 17:45:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.52	0.06	0.72	0.01	
19/12/2024 18:00:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.52	0.07	0.72	0.04	
19/12/2024 18:15:00	0.74	0.04	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.52	0.05	0.70	0.08	
19/12/2024 18:30:00	0.74	0.03	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.52	0.05	0.70	0.04	
19/12/2024 18:45:00	0.74	0.01	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.52	0.05	0.69	0.04	
19/12/2024 19:00:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.05	0.52	0.07	0.68	0.04	
19/12/2024 19:15:00	0.73	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.52	0.07	0.70	0.05	
19/12/2024 19:30:00	0.73	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.04	0.52	0.05	0.70	0.03	
19/12/2024 19:45:00	0.73	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.05	0.52	0.05	0.71	0.02	
19/12/2024 20:00:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.52	0.05	0.71	0.00	
19/12/2024 20:15:00	0.74	0.00	0.06	0.03	0.15	0.16	0.10	0.47	0.06	0.52	0.05	0.72	0.01	
19/12/2024 20:30:00	0.74	0.04	0.06	0.03	0.15	0.17	0.10	0.47	0.05	0.52	0.06	0.72	0.01	
19/12/2024 20:45:00	0.74	0.04	0.06	0.03	0.15	0.17	0.10	0.47	0.05	0.52	0.05	0.72	0.03	
19/12/2024 21:00:00	0.74	0.03	0.06	0.03	0.15	0.16	0.10	0.47	0.05	0.52	0.05	0.72	0.02	
19/12/2024 21:15:00	0.75	0.04	0.06	0.03	0.15	0.16	0.10	0.47	0.07	0.52	0.03	0.73	0.02	
19/12/2024 21:30:00	0.75	0.03	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.52	0.05	0.73	0.02	
19/12/2024 21:45:00	0.75	0.01	0.06	0.03	0.15	0.17	0.10	0.48	0.05	0.52	0.04	0.73	0.02	
19/12/2024 22:00:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.53	0.03	0.73	0.01	
19/12/2024 22:15:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.05	0.53	0.03	0.73	0.03	
19/12/2024 22:30:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.53	0.03	0.73	0.03	
19/12/2024 22:45:00	0.76	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.53	0.04	0.74	0.03	
19/12/2024 23:00:00	0.76	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.06	0.53	0.04	0.74	0.02	
19/12/2024 23:15:00	0.76	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.05	0.53	0.03	0.74	0.02	
19/12/2024 23:30:00	0.76	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.05	0.53	0.03	0.74	0.02	
19/12/2024 23:45:00	0.76	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.06	0.53	0.03	0.74	0.01	
20/12/2024 00:00:00	0.76	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.06	0.53	0.03	0.74	0.03	
20/12/2024 00:15:00	0.76	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.05	0.54	0.03	0.74	0.02	
20/12/2024 00:30:00	0.76	0.00	0.06	0.03	0.16	0.17	0.10	0.46	0.05	0.54	0.03	0.74	0.02	
20/12/2024 00:45:00	0.76	0.04	0.06	0.03	0.16	0.17	0.10	0.46	0.05	0.54		0.74	0.04	
20/12/2024 01:00:00	0.77	0.03	0.06	0.03	0.16	0.17	0.10	0.46	0.06	0.54		0.74	0.03	
20/12/2024 01:15:00	0.77	0.01	0.06	0.03	0.16	0.17	0.10	0.46	0.06	0.54		0.74	0.02	
20/12/2024 01:30:00	0.77	0.00	0.06	0.03	0.16	0.17	0.10	0.46	0.05	0.54		0.75	0.03	
20/12/2024 01:45:00	0.77	0.00	0.06	0.03	0.16	0.17	0.10	0.45	0.05	0.54		0.74	0.03	
20/12/2024 02:00:00	0.77	0.03	0.06	0.03	0.16	0.17	0.10	0.45	0.06	0.54		0.75	-0.01	
20/12/2024 02:15:00	0.77	0.03	0.06	0.03	0.15	0.17	0.10	0.45	0.05	0.54		0.75	0.03	
20/12/2024 02:30:00	0.77	0.03	0.06	0.03	0.15	0.17	0.10	0.45	0.04	0.54		0.75	0.03	
20/12/2024 02:45:00	0.77	0.03	0.06	0.03	0.15	0.17	0.10	0.45	0.05	0.54	0.04	0.75	0.03	
20/12/2024 03:00:00	0.77	0.03	0.06	0.03	0.15	0.17	0.10	0.45	0.06	0.54	0.04	0.75	0.02	
20/12/2024 03:15:00	0.77	0.02	0.06	0.03	0.15	0.16	0.10	0.45	0.05	0.54	0.04	0.75	0.02	
20/12/2024 03:30:00	0.77	0.01	0.06	0.03	0.15	0.16	0.10	0.45	0.05	0.55	0.04	0.75	0.02	
20/12/2024 03:45:00	0.77	0.00	0.06	0.02	0.15	0.16	0.10	0.45	0.06	0.55	0.04	0.75	0.03	
20/12/2024 04:00:00	0.78	0.00	0.06	0.03	0.15	0.16	0.10	0.44	0.05	0.55	0.04	0.75	0.02	
20/12/2024 04:15:00	0.78	0.00	0.06	0.03	0.15	0.16	0.10	0.44	0.04	0.55	0.04	0.75	0.08	
20/12/2024 04:30:00	0.78	0.00	0.05	0.02	0.15	0.16	0.10	0.44	0.05	0.55	0.04	0.75	0.03	
20/12/2024 04:45:00	0.78	0.00	0.05	0.02	0.15	0.16	0.10	0.44	0.04	0.55	0.04	0.74	0.04	
20/12/2024 05:00:00	0.78	0.05	0.05	0.02	0.15	0.16	0.10	0.44	0.05	0.55	0.04	0.71	0.06	
20/12/2024 05:15:00	0.77	0.03	0.05	0.02	0.15	0.16	0.09	0.44	0.05	0.55	0.04	0.69	0.14	
20/12/2024 05:30:00	0.76	0.02	0.05	0.02	0.15	0.16	0.09	0.44	0.05	0.54	0.04	0.66	0.12	
20/12/2024 05:45:00	0.76	0.00	0.05	0.02	0.15	0.16	0.09	0.44	0.05	0.54	0.04	0.64	0.13	
20/12/2024 06:00:00	0.75	0.00	0.05	0.02	0.15	0.16	0.09	0.44	0.05	0.54	0.04	0.62	0.13	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
20/12/2024 06:15:00	0.74	0.00	0.05	0.02	0.15	0.16	0.09	0.44	0.05	0.53	0.04	0.60	0.14	
20/12/2024 06:30:00	0.73	0.00	0.05	0.02	0.15	0.16	0.09	0.44	0.06	0.53	0.04	0.59	0.13	
20/12/2024 06:45:00	0.73	0.00	0.05	0.02	0.15	0.16	0.09	0.44	0.05	0.52	0.05	0.57	0.11	
20/12/2024 07:00:00	0.72	0.00	0.05	0.02	0.14	0.16	0.09	0.44	0.06	0.52	0.05	0.56	0.13	
20/12/2024 07:15:00	0.71	0.00	0.05	0.02	0.14	0.16	0.09	0.44	0.04	0.51	0.06	0.54	0.14	
20/12/2024 07:30:00	0.70	0.00	0.05	0.02	0.14	0.16	0.09	0.44	0.06	0.51	0.06	0.53	0.12	
20/12/2024 07:45:00	0.70	0.00	0.05	0.02	0.14	0.16	0.09	0.44	0.05	0.51	0.07	0.52	0.09	
20/12/2024 08:00:00	0.69	0.00	0.05	0.02	0.14	0.16	0.09	0.44	0.06	0.50	0.07	0.51	0.06	
20/12/2024 08:15:00	0.68	0.00	0.04	0.02	0.14	0.16	0.09	0.44	0.05	0.50	0.07	0.50	0.08	
20/12/2024 08:30:00	0.67	0.00	0.04	0.02	0.14	0.16	0.09	0.45	0.05	0.49	0.07	0.49	0.07	
20/12/2024 08:45:00	0.67	0.00	0.04	0.02	0.14	0.16	0.09	0.45	0.05	0.49	0.06	0.48	0.09	
20/12/2024 09:00:00	0.66	0.00	0.04	0.02	0.14	0.16	0.09	0.45	0.06	0.49	0.07	0.47	0.10	
20/12/2024 09:15:00	0.65	0.00	0.04	0.02	0.14	0.16	0.09	0.45	0.05	0.48	0.07	0.47	0.04	
20/12/2024 09:30:00	0.65	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.06	0.48	0.06	0.46	0.09	
20/12/2024 09:45:00	0.64	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.05	0.48	0.07	0.45	0.11	
20/12/2024 10:00:00	0.64	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.07	0.47	0.07	0.45	0.07	
20/12/2024 10:15:00	0.63	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.06	0.47	0.07	0.44	0.03	
20/12/2024 10:30:00	0.62	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.05	0.47	0.07	0.44	0.08	
20/12/2024 10:45:00	0.62	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.04	0.47	0.08	0.44	0.04	
20/12/2024 11:00:00	0.62	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.04	0.46	0.08	0.44	0.08	
20/12/2024 11:15:00	0.61	0.00	0.04	0.02	0.14	0.16	0.09	0.47	0.04	0.46	0.08	0.45	0.05	
20/12/2024 11:30:00	0.61	0.00	0.04	0.02	0.14	0.16	0.09	0.47	0.04	0.46	0.08	0.47	0.05	
20/12/2024 11:45:00	0.60	0.00	0.04	0.02	0.14	0.16	0.09	0.47	0.04	0.46	0.08	0.49	0.02	
20/12/2024 12:00:00	0.60	0.00	0.04	0.02	0.14	0.16	0.09	0.47	0.05	0.46	0.08	0.53	0.02	
20/12/2024 12:15:00	0.60	0.00	0.04	0.02	0.14	0.16	0.09	0.47	0.05	0.45	0.08	0.55	0.01	
20/12/2024 12:30:00	0.61	0.00	0.04	0.02	0.15	0.16	0.09	0.47	0.06	0.45	0.08	0.57	-0.03	
20/12/2024 12:45:00	0.61	0.00	0.05	0.02	0.15	0.16	0.09	0.47	0.07	0.45	0.09	0.59	0.00	
20/12/2024 13:00:00	0.62	0.00	0.05	0.02	0.15	0.16	0.09	0.47	0.07	0.45	0.09	0.61	0.01	
20/12/2024 13:15:00	0.63	0.00	0.05	0.02	0.15	0.16	0.09	0.47	0.05	0.45	0.09	0.61	0.00	
20/12/2024 13:30:00	0.64	0.00	0.05	0.02	0.15	0.16	0.09	0.47	0.07	0.45	0.08	0.62	0.02	
20/12/2024 13:45:00	0.65	0.00	0.05	0.02	0.15	0.16	0.09	0.48	0.06	0.46	0.08	0.63	0.00	
20/12/2024 14:00:00	0.65	0.00	0.05	0.02	0.15	0.16	0.09	0.48	0.06	0.46	0.08	0.64	0.02	
20/12/2024 14:15:00	0.66	0.00	0.05	0.02	0.15	0.16	0.09	0.47	0.06	0.46	0.08	0.64	0.00	
20/12/2024 14:30:00	0.67	0.00	0.05	0.02	0.15	0.16	0.09	0.47	0.07	0.46	0.08	0.65	0.00	
20/12/2024 14:45:00	0.67	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.06	0.47	0.07	0.65	0.00	
20/12/2024 15:00:00	0.68	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.05	0.47	0.08	0.66	0.00	
20/12/2024 15:15:00	0.68	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.05	0.47	0.07	0.67	0.01	
20/12/2024 15:30:00	0.69	0.00	0.05	0.02	0.15	0.16	0.10	0.47	0.07	0.48	0.08	0.67	0.00	
20/12/2024 15:45:00	0.69	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.48	0.07	0.68	0.01	
20/12/2024 16:00:00	0.70	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.48	0.07	0.66	0.06	
20/12/2024 16:15:00	0.70	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.49	0.07	0.63	0.07	
20/12/2024 16:30:00	0.70	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.49	0.07	0.60	0.07	
20/12/2024 16:45:00	0.69	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.49	0.07	0.58	0.07	
20/12/2024 17:00:00	0.69	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.49	0.07	0.55	0.12	
20/12/2024 17:15:00	0.68	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.49	0.07	0.54	0.08	
20/12/2024 17:30:00	0.68	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.48	0.07	0.52	0.11	
20/12/2024 17:45:00	0.67	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.07	0.48	0.07	0.50	0.08	
20/12/2024 18:00:00	0.66	0.07	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.48	0.07	0.49	0.08	
20/12/2024 18:15:00	0.66	0.08	0.05	0.02	0.15	0.17	0.10	0.47	0.07	0.48	0.07	0.48	0.09	
20/12/2024 18:30:00	0.65	0.08	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.47	0.07	0.47	0.08	
20/12/2024 18:45:00	0.64	0.05	0.05	0.02	0.15	0.17	0.10	0.47	0.07	0.47	0.07	0.46	0.12	
20/12/2024 19:00:00	0.64	0.03	0.05	0.02	0.15	0.17	0.10	0.47	0.06	0.47	0.07	0.45	0.10	
20/12/2024 19:15:00	0.63	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.05	0.46	0.07	0.44	0.07	
20/12/2024 19:30:00	0.63	0.00	0.05	0.02	0.15	0.17	0.10	0.47	0.05	0.46	0.07	0.43	0.06	
20/12/2024 19:45:00	0.62	0.00	0.05	0.02	0.15	0.17	0.10	0.48	0.05	0.46	0.08	0.43	0.11	
20/12/2024 20:00:00	0.61	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.05	0.46	0.07	0.42	0.09	
20/12/2024 20:15:00	0.61	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.05	0.46	0.08	0.41	0.08	
20/12/2024 20:30:00	0.60	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.45	0.08	0.41	0.08	
20/12/2024 20:45:00	0.60	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.07	0.45	0.08	0.40	0.06	
20/12/2024 21:00:00	0.59	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.45	0.07	0.40	0.06	
20/12/2024 21:15:00	0.59	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.45	0.08	0.40	0.05	
20/12/2024 21:30:00	0.58	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.45	0.08	0.39	0.06	
20/12/2024 21:45:00	0.58	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.07	0.45	0.08	0.40	0.03	
20/12/2024 22:00:00	0.58	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.06	0.44	0.08	0.41	0.04	
20/12/2024 22:15:00	0.57	0.00	0.06	0.03	0.16	0.17	0.10	0.48	0.05	0.44	0.07	0.44	0.03	
20/12/2024 22:30:00	0.57	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.06	0.44	0.08	0.47	0.02	
20/12/2024 22:45:00	0.57	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.06	0.44	0.08	0.50	0.01	
20/12/2024 23:00:00	0.57	0.00	0.06	0.03	0.16	0.17	0.10	0.47	0.06	0.44	0.08	0.52	0.00	
20/12/2024 23:15:00	0.58	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.44	0.08	0.54	0.00	
20/12/2024 23:30:00	0.58	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.07	0.44	0.09	0.55	0.01	
20/12/2024 23:45:00	0.59	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.44	0.08	0.56	0.02	
21/12/2024 00:00:00	0.59	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.05	0.44	0.08	0.57	0.03	
21/12/2024 00:15:00	0.60	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.44	0.08	0.58	0.00	
21/12/2024 00:30:00	0.61	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.44	0.08	0.58	0.02	
21/12/2024 00:45:00	0.61	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.44	0.08	0.59	0.02	
21/12/2024 01:00:00	0.62	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.44	0.09	0.60	0.01	
21/12/2024 01:15:00	0.62	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.45	0.09	0.60	0.02	
21/12/2024 01:30:00	0.63	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.45	0.08	0.61	0.02	
21/12/2024 01:45:00	0.64	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.45	0.08	0.61	0.02	
21/12/2024 02:00:00	0.64	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.45	0.08	0.62	0.03	
21/12/2024 02:15:00	0.65	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.07	0.45	0.08	0.62	0.00	
21/12/2024 02:30:00	0.65	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.46	0.08	0.63	0.02	
21/12/2024 02:45:00	0.66	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.46	0.07	0.63	0.03	
21/12/2024 03:00:00	0.66	0.00	0.06	0.03	0.15	0.17	0.10	0.45	0.07	0.46	0.08	0.64	0.00	
21/12/2024 03:15:00	0.67	0.00	0.06	0.03	0.15	0.17	0.10	0.45	0.06	0.46	0.07	0.64	0.02	
21/12/2024 03:30:00	0.67	0.00	0.06	0.03	0.15	0.17	0.10	0.45	0.06	0.47	0.07	0.65	0.03	
21/12/2024 03:45:00	0.67	0.00	0.05	0.02	0.15	0.17	0.10	0.45	0.06	0.47	0.07	0.65	0.02	
21/12/2024 04:00:00	0.68	0.00	0.05	0.02	0.15	0.17	0.10	0.45	0.07	0.47	0.07	0.65	0.03	
21/12/2024 04:15:00	0.68	0.00	0.05	0.02	0.15	0.17	0.10	0.45	0.06	0.47	0.08	0.66	0.02	
21/12/2024 04:30:00	0.69	0.00	0.05	0.02	0.15	0.17	0.10	0.45	0.05	0.47	0.07	0.66	0.02	
21/12/2024 04:45:00	0.69	0.00	0.05	0.02	0.15	0.17	0.10	0.45	0.05	0.48	0.07	0.66	0.01	
21/12/2024 05:00:00	0.69	0.00	0.05	0.02	0.15	0.17	0.10	0.45	0.05	0.48	0.06	0.67	0.00	
21/12/2024 05:15:00	0.70	0.00	0.05	0.02	0.15	0.17	0.09	0.45	0.05	0.48	0.07	0.66	0.04	
21/12/2024 05:30:00	0.70	0.00	0.05	0.02	0.15	0.16	0.09	0.45	0.05	0.48	0.06	0.64	0.07	
21/12/2024 05:45:00	0.70	0.00	0.05	0.02	0.15	0.16	0.09	0.45	0.06	0.48	0.06	0.61	0.09	
21/12/2024 06:00:00	0.69	0.00	0.05	0.02	0.15	0.16	0.09	0.46	0.05	0.49	0.06	0.59	0.08	
21/12/2024 06:15:00	0.69	0.00	0.05	0.02	0.15	0.16	0.09	0.45	0.05	0.48	0.07	0.57	0.11	
21/12/2024 06:30:00	0.68	0.00	0.05	0.02	0.15	0.16	0.09	0.45	0.04	0.48	0.06	0.55	0.12	
21/12/2024 06:45:00	0.68	0.00	0.05	0.02	0.15	0.16	0.09	0.45	0.05	0.48	0.06	0.53	0.10	
21/12/2024 07:00:00	0.67	0.00	0.05	0.02	0.15	0.16	0.09	0.45	0.06	0.48	0.06	0.51	0.12	
21/12/2024 07:15:00	0.66	0.00	0.05	0.02	0.15	0.16	0.09	0.45	0.06	0.48	0.07	0.49	0.09	
21/12/2024 07:30:00	0.66	0.00	0.05	0.02	0.15	0.16	0.09	0.45	0.06	0.47	0.07	0.48	0.03	
21/12/2024 07:45:00	0.65	0.00	0.05	0.02	0.15	0.16	0.09	0.45	0.05	0.47	0.07	0.47	0.00	
21/12/2024 08:00:00	0.64	0.00	0.05	0.02	0.14	0.16	0.09	0.45	0.05	0.47	0.07	0.46	0.00	
21/12/2024 08:15:00	0.64	0.00	0.05	0.02	0.14	0.16	0.09	0.45	0.07	0.46	0.07	0.45	0.01	
21/12/2024 08:30:00	0.63	0.00	0.05	0.02	0.14	0.16	0.09	0.45	0.06	0.46	0.07	0.44	0.03	
21/12/2024 08:45:00	0.62	0.00	0.05	0.02	0.14	0.16	0.09	0.45	0.06	0.46	0.07	0.43	0.00	
21/12/2024 09:00:00	0.62	0.00	0.04	0.02	0.14	0.16	0.09	0.45	0.06	0.46	0.08	0.42	0.01	
21/12/2024 09:15:00	0.61	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.06	0.45	0.08	0.41	0.03	
21/12/2024 09:30:00	0.61	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.07	0.45	0.08	0.41	0.00	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
21/12/2024 09:45:00	0.60	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.06	0.45	0.08	0.40	0.02	
21/12/2024 10:00:00	0.60	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.06	0.45	0.08	0.40	0.00	
21/12/2024 10:15:00	0.59	0.00	0.04	0.02	0.14	0.16	0.09	0.46	0.06	0.45	0.08	0.39	0.01	
21/12/2024 10:30:00	0.59	0.00	0.04	0.02	0.14	0.16	0.09	0.47	0.06	0.45	0.08	0.38	0.03	
21/12/2024 10:45:00	0.58	0.00	0.04	0.02	0.14	0.16	0.09	0.47	0.07	0.44	0.08	0.38	0.07	
21/12/2024 11:00:00	0.58	0.00	0.04	0.02	0.14	0.16	0.09	0.47	0.07	0.44	0.09	0.38	0.05	
21/12/2024 11:15:00	0.58	0.00	0.04	0.02	0.14	0.16	0.09	0.48	0.06	0.44	0.08	0.37	0.04	
21/12/2024 11:30:00	0.57	0.00	0.04	0.02	0.14	0.16	0.09	0.48	0.06	0.44	0.08	0.38	0.04	
21/12/2024 11:45:00	0.57	0.00	0.04	0.02	0.14	0.16	0.09	0.48	0.07	0.44	0.07	0.38	0.03	
21/12/2024 12:00:00	0.57	0.00	0.05	0.02	0.15	0.16	0.09	0.48	0.06	0.44	0.07	0.39	0.03	
21/12/2024 12:15:00	0.56	0.00	0.04	0.02	0.15	0.17	0.09	0.48	0.05	0.44	0.07	0.42	0.02	
21/12/2024 12:30:00	0.56	0.00	0.05	0.02	0.15	0.17	0.09	0.48	0.05	0.44	0.07	0.45	0.03	
21/12/2024 12:45:00	0.56	0.00	0.04	0.02	0.15	0.17	0.09	0.48	0.05	0.44	0.07	0.47	0.03	
21/12/2024 13:00:00	0.56	0.00	0.05	0.02	0.15	0.17	0.09	0.48	0.00	0.44	0.08	0.49	0.00	
21/12/2024 13:15:00	0.56	0.00	0.05	0.02	0.15	0.17	0.09	0.48	0.06	0.44	0.07	0.50	0.00	
21/12/2024 13:30:00	0.57	0.00	0.05	0.02	0.15	0.17	0.09	0.48	0.05	0.44	0.08	0.52	-0.01	
21/12/2024 13:45:00	0.57	0.06	0.05	0.02	0.15	0.17	0.10	0.48	0.05	0.44	0.08	0.53	0.00	
21/12/2024 14:00:00	0.58	0.04	0.05	0.02	0.15	0.17	0.10	0.48	0.06	0.44	0.08	0.54	0.01	
21/12/2024 14:15:00	0.58	0.02	0.05	0.02	0.15	0.17	0.10	0.48	0.07	0.44	0.08	0.55	0.01	
21/12/2024 14:30:00	0.59	0.00	0.05	0.02	0.15	0.17	0.10	0.48	0.07	0.44	0.07	0.55	0.01	
21/12/2024 14:45:00	0.59	0.00	0.05	0.02	0.15	0.17	0.10	0.48	0.05	0.44	0.08	0.56	0.00	
21/12/2024 15:00:00	0.60	0.07	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.44	0.08	0.57	-0.01	
21/12/2024 15:15:00	0.61	0.05	0.06	0.03	0.15	0.17	0.10	0.48	0.00	0.44	0.08	0.57	0.02	
21/12/2024 15:30:00	0.61	0.02	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.44	0.08	0.58	0.00	
21/12/2024 15:45:00	0.62	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.07	0.44	0.08	0.59	0.00	
21/12/2024 16:00:00	0.62	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.44	0.08	0.59	0.00	
21/12/2024 16:15:00	0.63	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.45	0.09	0.60	0.00	
21/12/2024 16:30:00	0.63	0.00	0.06	0.03	0.15	0.17	0.10	0.49	0.08	0.45	0.08	0.60	0.01	
21/12/2024 16:45:00	0.64	0.00	0.06	0.03	0.15	0.17	0.10	0.49	0.08	0.45	0.08	0.61	0.00	
21/12/2024 17:00:00	0.64	0.00	0.06	0.03	0.15	0.17	0.10	0.49	0.07	0.45	0.08	0.60	0.03	
21/12/2024 17:15:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.07	0.45	0.08	0.57	0.02	
21/12/2024 17:30:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.46	0.08	0.55	0.02	
21/12/2024 17:45:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.46	0.08	0.53	0.03	
21/12/2024 18:00:00	0.64	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.46	0.08	0.51	0.01	
21/12/2024 18:15:00	0.63	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.46	0.08	0.50	0.01	
21/12/2024 18:30:00	0.63	0.00	0.06	0.03	0.16	0.17	0.10	0.49	0.06	0.46	0.08	0.49	0.03	
21/12/2024 18:45:00	0.63	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.07	0.46	0.08	0.47	-0.01	
21/12/2024 19:00:00	0.62	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.06	0.45	0.08	0.46	0.01	
21/12/2024 19:15:00	0.62	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.05	0.45	0.08	0.45	0.00	
21/12/2024 19:30:00	0.61	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.05	0.45	0.08	0.44	0.01	
21/12/2024 19:45:00	0.61	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.06	0.45	0.08	0.43	0.02	
21/12/2024 20:00:00	0.60	0.00	0.06	0.03	0.16	0.18	0.10	0.49	-0.07	0.45	0.07	0.42	0.00	
21/12/2024 20:15:00	0.60	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.06	0.45	0.08	0.41	0.01	
21/12/2024 20:30:00	0.59	0.00	0.06	0.03	0.16	0.18	0.10	0.48	0.04	0.45	0.08	0.41	-0.01	
21/12/2024 20:45:00	0.59	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.06	0.45	0.08	0.41	-0.01	
21/12/2024 21:00:00	0.58	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.08	0.45	0.08	0.42	-0.01	
21/12/2024 21:15:00	0.58	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.05	0.44	0.08	0.45	0.01	
21/12/2024 21:30:00	0.58	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.07	0.44	0.08	0.47	0.01	
21/12/2024 21:45:00	0.58	0.00	0.06	0.03	0.16	0.18	0.11	0.49	0.06	0.44	0.09	0.49	0.00	
21/12/2024 22:00:00	0.58	0.00	0.06	0.03	0.16	0.18	0.10	0.49	0.06	0.44	0.08	0.51	0.01	
21/12/2024 22:15:00	0.58	0.00	0.06	0.03	0.16	0.18	0.11	0.49	0.06	0.44	0.09	0.52	0.02	
21/12/2024 22:30:00	0.58	0.00	0.06	0.03	0.16	0.18	0.11	0.49	-0.01	0.44	0.08	0.53	-0.01	
21/12/2024 22:45:00	0.59	0.00	0.06	0.03	0.16	0.18	0.11	0.48	0.07	0.44	0.08	0.54	0.01	
21/12/2024 23:00:00	0.59	0.00	0.06	0.03	0.16	0.18	0.11	0.48	0.06	0.44	0.08	0.55	0.02	
21/12/2024 23:15:00	0.60	0.00	0.07	0.03	0.16	0.18	0.11	0.48	0.07	0.44	0.08	0.56	0.02	
21/12/2024 23:30:00	0.60	0.00	0.07	0.03	0.16	0.18	0.11	0.48	0.07	0.44	0.08	0.57	0.01	
21/12/2024 23:45:00	0.61	0.00	0.06	0.03	0.16	0.18	0.11	0.48	0.07	0.44	0.09	0.57	0.01	
22/12/2024 00:00:00	0.61	0.00	0.06	0.03	0.16	0.18	0.11	0.48	0.07	0.44	0.08	0.58	0.00	
22/12/2024 00:15:00	0.62	0.00	0.06	0.03	0.16	0.18	0.10	0.48	0.07	0.45	0.08	0.59	0.00	
22/12/2024 00:30:00	0.62	0.00	0.06	0.03	0.16	0.18	0.10	0.48	0.07	0.45	0.08	0.59	0.00	
22/12/2024 00:45:00	0.63	0.00	0.06	0.03	0.16	0.18	0.10	0.48	0.07	0.45	0.08	0.60	0.00	
22/12/2024 01:00:00	0.63	0.00	0.06	0.03	0.16	0.18	0.10	0.48	0.06	0.45	0.08	0.60	0.00	
22/12/2024 01:15:00	0.63	0.00	0.06	0.03	0.16	0.18	0.10	0.47	0.06	0.45	0.07	0.61	0.00	
22/12/2024 01:30:00	0.64	0.00	0.06	0.03	0.16	0.18	0.10	0.47	0.05	0.45	0.08	0.61	0.00	
22/12/2024 01:45:00	0.64	0.00	0.06	0.03	0.16	0.18	0.10	0.47	0.05	0.45	0.07	0.61	0.00	
22/12/2024 02:00:00	0.65	0.00	0.06	0.03	0.16	0.18	0.10	0.47	0.06	0.46	0.08	0.62	0.01	
22/12/2024 02:15:00	0.65	0.00	0.06	0.03	0.16	0.18	0.10	0.47	0.05	0.46	0.08	0.62	0.02	
22/12/2024 02:30:00	0.66	0.00	0.06	0.03	0.15	0.18	0.10	0.47	0.05	0.46	0.08	0.63	0.00	
22/12/2024 02:45:00	0.66	0.00	0.06	0.03	0.15	0.18	0.10	0.47	0.05	0.46	0.08	0.63	0.01	
22/12/2024 03:00:00	0.66	0.05	0.06	0.03	0.15	0.18	0.10	0.47	0.05	0.46	0.08	0.63	0.00	
22/12/2024 03:15:00	0.67	0.03	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.47	0.08	0.64	0.01	
22/12/2024 03:30:00	0.67	0.02	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.47	0.08	0.64	0.01	
22/12/2024 03:45:00	0.67	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.47	0.07	0.64	0.01	
22/12/2024 04:00:00	0.68	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.47	0.07	0.65	0.00	
22/12/2024 04:15:00	0.68	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.47	0.07	0.65	0.01	
22/12/2024 04:30:00	0.68	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.06	0.48	0.07	0.65	0.01	
22/12/2024 04:45:00	0.69	0.03	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.48	0.08	0.66	0.02	
22/12/2024 05:00:00	0.69	0.02	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.48	0.07	0.67	0.01	
22/12/2024 05:15:00	0.69	0.01	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.48	0.07	0.67	0.04	
22/12/2024 05:30:00	0.70	0.00	0.06	0.03	0.15	0.17	0.09	0.46	0.05	0.48	0.08	0.67	0.03	
22/12/2024 05:45:00	0.70	0.00	0.05	0.02	0.15	0.17	0.09	0.46	0.05	0.49	0.08	0.67	0.01	
22/12/2024 06:00:00	0.70	0.00	0.05	0.02	0.15	0.17	0.09	0.46	0.06	0.49	0.07	0.68	0.02	
22/12/2024 06:15:00	0.70	0.04	0.05	0.02	0.15	0.17	0.09	0.46	0.05	0.49	0.07	0.68	0.02	
22/12/2024 06:30:00	0.71	0.04	0.05	0.02	0.15	0.17	0.09	0.45	0.06	0.49	0.07	0.68	0.01	
22/12/2024 06:45:00	0.71	0.03	0.05	0.02	0.15	0.17	0.09	0.45	0.06	0.49	0.07	0.68	0.02	
22/12/2024 07:00:00	0.71	0.01	0.05	0.02	0.15	0.17	0.09	0.45	0.05	0.49	0.06	0.69	0.00	
22/12/2024 07:15:00	0.71	0.00	0.05	0.02	0.14	0.17	0.09	0.45	0.05	0.50	0.07	0.69	0.00	
22/12/2024 07:30:00	0.72	0.00	0.05	0.02	0.14	0.17	0.09	0.45	0.06	0.50	0.07	0.68	0.03	
22/12/2024 07:45:00	0.72	0.00	0.05	0.02	0.14	0.17	0.09	0.45	0.05	0.50	0.06	0.67	0.05	
22/12/2024 08:00:00	0.72	0.00	0.05	0.02	0.14	0.17	0.09	0.45	0.05	0.50	0.06	0.65	0.06	
22/12/2024 08:15:00	0.71	0.00	0.05	0.02	0.14	0.17	0.09	0.45	0.05	0.50	0.06	0.64	0.04	
22/12/2024 08:30:00	0.71	0.00	0.05	0.02	0.14	0.17	0.09	0.45	0.04	0.50	0.06	0.63	0.05	
22/12/2024 08:45:00	0.71	0.00	0.05	0.02	0.14	0.17	0.09	0.45	0.03	0.50	0.06	0.61	0.10	
22/12/2024 09:00:00	0.70	0.00	0.05	0.02	0.14	0.16	0.09	0.45	0.01	0.50	0.07	0.60	0.07	
22/12/2024 09:15:00	0.70	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.00	0.49	0.07	0.60	0.04	
22/12/2024 09:30:00	0.69	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.00	0.49	0.07	0.60	0.06	
22/12/2024 09:45:00	0.69	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.00	0.49	0.08	0.59	0.05	
22/12/2024 10:00:00	0.68	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.00	0.49	0.08	0.61	0.03	
22/12/2024 10:15:00	0.68	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.00	0.48	0.08	0.62	0.03	
22/12/2024 10:30:00	0.68	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.00	0.48	0.08	0.63	0.03	
22/12/2024 10:45:00	0.68	0.00	0.04	0.02	0.14	0.16	0.09	0.47	0.00	0.48	0.07	0.64	0.02	
22/12/2024 11:00:00	0.68	0.00	0.05	0.02	0.14	0.16	0.09	0.47	0.51	0.48	0.03	0.65	0.03	
22/12/2024 11:15:00	0.69	0.00	0.04	0.02	0.14	0.16	0.09	0.47	0.05	0.48	0.08	0.66	0.01	
22/12/2024 11:30:00	0.69	0.00	0.05	0.02	0.14	0.16	0.09	0.48	0.05	0.48	0.08	0.66	0.01	
22/12/2024 11:45:00	0.69	0.00	0.05	0.02	0.14	0.16	0.09	0.48	0.05	0.48	0.06	0.67	0.01	
22/12/2024 12:00:00	0.70	0.00	0.05	0.02	0.14	0.16	0.09	0.48	0.04	0.48	0.08	0.67	0.02	
22/12/2024 12:15:00	0.70	0.00	0.05	0.02	0.14	0.16	0.09	0.48	0.02	0.49	0.03	0.67	0.01	
22/12/2024 12:30:00	0.70	0.00	0.05	0.02	0.14	0.16	0.09	0.48	0.02	0.49	0.02	0.68	0.01	
22/12/2024 12:45:00	0.71	0.00	0.05	0.02	0.14	0.16	0.09	0.48	0.01	0.49	0.03	0.68	0.03	
22/12/2024 13:00:00	0.71	0.00	0.05	0.02	0.14	0.16	0.09	0.49	0.00	0.49	0.07	0.68	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
22/12/2024 13:15:00	0.71	0.00	0.05	0.02	0.14	0.16	0.09	0.49	0.00	0.49	0.04	0.69	0.01	
22/12/2024 13:30:00	0.72	0.00	0.05	0.02	0.14	0.16	0.09	0.49	0.04	0.49	0.04	0.69	0.02	
22/12/2024 13:45:00	0.72	0.00	0.05	0.02	0.15	0.17	0.09	0.49	0.03	0.50	0.07	0.69	0.02	
22/12/2024 14:00:00	0.72	0.00	0.05	0.02	0.15	0.17	0.09	0.49	0.01	0.50	0.07	0.70	0.01	
22/12/2024 14:15:00	0.72	0.03	0.06	0.03	0.15	0.17	0.09	0.48	0.00	0.50	0.04	0.70	0.02	
22/12/2024 14:30:00	0.72	0.02	0.06	0.03	0.15	0.17	0.09	0.48	0.00	0.50	0.07	0.70	0.01	
22/12/2024 14:45:00	0.73	0.01	0.06	0.03	0.15	0.17	0.09	0.48	0.00	0.50	0.07	0.70	0.02	
22/12/2024 15:00:00	0.73	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.00	0.51	0.07	0.71	0.02	
22/12/2024 15:15:00	0.73	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.00	0.51	0.06	0.71	0.02	
22/12/2024 15:30:00	0.73	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.00	0.51	0.06	0.71	0.02	
22/12/2024 15:45:00	0.73	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.00	0.51	0.06	0.71	0.01	
22/12/2024 16:00:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.00	0.51	0.06	0.71	0.01	
22/12/2024 16:15:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.00	0.51	0.06	0.71	0.01	
22/12/2024 16:30:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.00	0.51	0.06	0.71	0.00	
22/12/2024 16:45:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.00	0.52	0.05	0.72	0.01	
22/12/2024 17:00:00	0.74	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.00	0.52	0.06	0.72	0.02	
22/12/2024 17:15:00	0.74	0.04	0.06	0.03	0.15	0.17	0.10	0.47	0.23	0.52	0.05	0.72	0.01	
22/12/2024 17:30:00	0.74	0.04	0.06	0.03	0.15	0.17	0.10	0.47	-0.05	0.52	0.05	0.72	0.03	
22/12/2024 17:45:00	0.75	0.03	0.06	0.03	0.15	0.17	0.10	0.47	0.05	0.52	0.05	0.72	0.01	
22/12/2024 18:00:00	0.75	0.02	0.06	0.03	0.15	0.17	0.10	0.47	0.04	0.52	0.05	0.72	0.02	
22/12/2024 18:15:00	0.75	0.01	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.52	0.06	0.72	0.02	
22/12/2024 18:30:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.06	0.52	0.05	0.73	0.02	
22/12/2024 18:45:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.47	0.05	0.53	0.04	0.73	0.01	
22/12/2024 19:00:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.05	0.53	0.05	0.73	0.02	
22/12/2024 19:15:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.05	0.53	0.05	0.72	0.04	
22/12/2024 19:30:00	0.76	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.53	0.02	0.73	0.03	
22/12/2024 19:45:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.05	0.53	0.04	0.72	0.04	
22/12/2024 20:00:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.07	0.53	0.04	0.71	0.05	
22/12/2024 20:15:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.53	0.02	0.72	0.05	
22/12/2024 20:30:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.07	0.53	0.00	0.71	0.07	
22/12/2024 20:45:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.53	0.04	0.70	0.04	
22/12/2024 21:00:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.07	0.53	0.01	0.71	0.03	
22/12/2024 21:15:00	0.75	0.00	0.07	0.03	0.15	0.17	0.10	0.48	0.06	0.53	0.01	0.72	0.01	
22/12/2024 21:30:00	0.75	0.00	0.06	0.03	0.15	0.17	0.10	0.48	0.06	0.53	0.00	0.72	0.02	
22/12/2024 21:45:00	0.75	0.00	0.07	0.03	0.15	0.17	0.10	0.48	0.06	0.53	0.03	0.73	0.03	
22/12/2024 22:00:00	0.75	0.00	0.07	0.03	0.15	0.17	0.10	0.48	0.06	0.53	-0.01	0.73	0.02	
22/12/2024 22:15:00	0.75	0.00	0.07	0.03	0.15	0.17	0.10	0.47	0.04	0.53	-0.01	0.73	0.01	
22/12/2024 22:30:00	0.75	0.00	0.07	0.03	0.15	0.17	0.10	0.47	0.06	0.53	-0.04	0.73	0.02	
22/12/2024 22:45:00	0.76	0.00	0.07	0.03	0.15	0.17	0.10	0.47	0.04	0.53	0.00	0.73	0.01	
22/12/2024 23:00:00	0.76	0.00	0.07	0.03	0.15	0.17	0.10	0.47	0.05	0.53	-0.01	0.73	0.02	
22/12/2024 23:15:00	0.76	0.04	0.07	0.03	0.15	0.17	0.10	0.47	0.05	0.53	0.00	0.73	0.02	
22/12/2024 23:30:00	0.76	0.02	0.07	0.03	0.15	0.17	0.10	0.47	0.04	0.53	-0.06	0.74	0.02	
22/12/2024 23:45:00	0.76	0.01	0.06	0.03	0.15	0.17	0.10	0.47	0.04	0.53	-0.03	0.74	0.02	
23/12/2024 00:00:00	0.76	0.01	0.07	0.03	0.15	0.17	0.10	0.47	0.05	0.53	-0.03	0.74	0.02	
23/12/2024 00:15:00	0.76	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.05	0.53	-0.02	0.74	0.03	
23/12/2024 00:30:00	0.76	0.00	0.06	0.03	0.15	0.17	0.10	0.46	0.04	0.53	-0.01	0.74	0.03	
23/12/2024 00:45:00	0.76	0.00	0.07	0.03	0.15	0.17	0.10	0.46	-0.06	0.54	-0.03	0.74	0.03	
23/12/2024 01:00:00	0.76	0.00	0.07	0.03	0.15	0.17	0.10	0.46	0.05	0.54	-0.02	0.74	0.03	
23/12/2024 01:15:00	0.76	0.00	0.07	0.03	0.15	0.17	0.10	0.46	0.05	0.54	-0.01	0.74	0.02	
23/12/2024 01:30:00	0.77	0.00	0.07	0.03	0.15	0.17	0.09	0.46	0.04	0.54	-0.01	0.75	0.03	
23/12/2024 01:45:00	0.77	0.00	0.06	0.03	0.15	0.17	0.09	0.45	0.05	0.54	-0.05	0.74	0.04	
23/12/2024 02:00:00	0.77	0.00	0.06	0.03	0.15	0.17	0.09	0.45	0.05	0.54	-0.01	0.75	0.02	
23/12/2024 02:15:00	0.77	0.00	0.06	0.03	0.15	0.16	0.09	0.45	0.05	0.54	0.00	0.74	0.02	
23/12/2024 02:30:00	0.77	0.00	0.06	0.03	0.15	0.16	0.09	0.45	0.05	0.54	-0.01	0.74	0.01	
23/12/2024 02:45:00	0.77	0.04	0.06	0.03	0.15	0.16	0.09	0.45	0.04	0.54	-0.01	0.75	0.02	
23/12/2024 03:00:00	0.77	0.02	0.06	0.03	0.14	0.16	0.09	0.45	0.05	0.54	0.02	0.75	0.03	
23/12/2024 03:15:00	0.77	0.01	0.06	0.03	0.14	0.16	0.09	0.45	0.06	0.54	0.04	0.75	0.02	
23/12/2024 03:30:00	0.77	0.00	0.06	0.03	0.14	0.16	0.09	0.45	0.06	0.54	0.03	0.75	0.01	
23/12/2024 03:45:00	0.77	0.00	0.06	0.03	0.14	0.16	0.09	0.45	0.04	0.54	0.00	0.75	0.01	
23/12/2024 04:00:00	0.77	0.00	0.06	0.03	0.14	0.16	0.09	0.45	0.05	0.54	0.01	0.75	0.02	
23/12/2024 04:15:00	0.77	0.00	0.06	0.03	0.14	0.16	0.09	0.45	0.05	0.54	0.01	0.75	0.03	
23/12/2024 04:30:00	0.78	0.00	0.06	0.03	0.14	0.16	0.09	0.45	0.05	0.55	0.02	0.75	0.02	
23/12/2024 04:45:00	0.77	0.00	0.06	0.03	0.14	0.16	0.09	0.45	0.05	0.55	0.04	0.75	0.01	
23/12/2024 05:00:00	0.78	0.00	0.06	0.03	0.14	0.16	0.09	0.44	0.05	0.55	0.03	0.75	0.03	
23/12/2024 05:15:00	0.78	0.00	0.06	0.03	0.14	0.16	0.09	0.44	0.05	0.55	0.02	0.76	0.03	
23/12/2024 05:30:00	0.78	0.00	0.06	0.03	0.14	0.16	0.09	0.44	0.06	0.55	0.02	0.76	0.03	
23/12/2024 05:45:00	0.78	0.00	0.05	0.02	0.14	0.16	0.09	0.44	0.05	0.55	0.00	0.76	0.01	
23/12/2024 06:00:00	0.78	0.00	0.05	0.02	0.14	0.16	0.09	0.44	0.05	0.55	0.03	0.76	0.03	
23/12/2024 06:15:00	0.78	0.00	0.05	0.02	0.14	0.16	0.08	0.44	0.04	0.55	0.01	0.76	0.02	
23/12/2024 06:30:00	0.78	0.00	0.05	0.02	0.14	0.16	0.08	0.44	0.03	0.55	0.01	0.76	0.02	
23/12/2024 06:45:00	0.78	0.00	0.05	0.02	0.14	0.16	0.08	0.44	0.02	0.55	0.01	0.76	0.03	
23/12/2024 07:00:00	0.78	0.00	0.05	0.02	0.14	0.16	0.08	0.44	0.01	0.55	0.05	0.76	0.03	
23/12/2024 07:15:00	0.78	0.00	0.05	0.02	0.14	0.15	0.08	0.44	0.00	0.55	0.01	0.76	0.03	
23/12/2024 07:30:00	0.78	0.00	0.05	0.02	0.14	0.15	0.08	0.44	0.42	0.55	0.02	0.76	0.03	
23/12/2024 07:45:00	0.78	0.00	0.05	0.02	0.14	0.15	0.08	0.44	0.05	0.55	0.05	0.75	0.06	
23/12/2024 08:00:00	0.78	0.03	0.05	0.02	0.13	0.15	0.08	0.43	0.05	0.55	0.03	0.74	0.07	
23/12/2024 08:15:00	0.78	0.02	0.05	0.02	0.13	0.15	0.08	0.44	0.05	0.55	0.04	0.71	0.07	
23/12/2024 08:30:00	0.77	0.01	0.05	0.02	0.13	0.15	0.08	0.44	0.06	0.55	0.04	0.69	0.11	
23/12/2024 08:45:00	0.77	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.05	0.55	0.04	0.67	0.10	
23/12/2024 09:00:00	0.76	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.05	0.54	0.04	0.65	0.13	
23/12/2024 09:15:00	0.75	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.05	0.54	0.04	0.63	0.14	
23/12/2024 09:30:00	0.75	0.00	0.04	0.02	0.13	0.15	0.08	0.45	0.07	0.53	0.04	0.62	0.11	
23/12/2024 09:45:00	0.74	0.00	0.04	0.02	0.13	0.15	0.08	0.45	0.00	0.53	0.02	0.60	0.11	
23/12/2024 10:00:00	0.73	0.00	0.05	0.02	0.13	0.15	0.08	0.45	0.06	0.52	0.03	0.59	0.13	
23/12/2024 10:15:00	0.72	0.00	0.04	0.02	0.13	0.15	0.08	0.45	0.00	0.52	0.04	0.57	0.15	
23/12/2024 10:30:00	0.72	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.05	0.51	0.05	0.55	0.13	
23/12/2024 10:45:00	0.71	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.04	0.51	0.06	0.55	0.16	
23/12/2024 11:00:00	0.70	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.04	0.51	0.07	0.54	0.13	
23/12/2024 11:15:00	0.70	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.05	0.50	0.06	0.53	0.09	
23/12/2024 11:30:00	0.69	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.05	0.50	0.08	0.52	0.14	
23/12/2024 11:45:00	0.68	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.06	0.49	0.08	0.51	0.07	
23/12/2024 12:00:00	0.68	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.06	0.49	0.08	0.51	0.08	
23/12/2024 12:15:00	0.67	0.00	0.05	0.02	0.13	0.15	0.08	0.46	0.06	0.48	0.08	0.50	0.11	
23/12/2024 12:30:00	0.66	0.00	0.04	0.02	0.14	0.15	0.08	0.46	0.05	0.48	0.08	0.50	0.10	
23/12/2024 12:45:00	0.66	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.48	0.08	0.50	0.02	
23/12/2024 13:00:00	0.65	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.47	0.08	0.50	0.06	
23/12/2024 13:15:00	0.65	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.47	0.09	0.52	0.04	
23/12/2024 13:30:00	0.64	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.47	0.08	0.54	0.03	
23/12/2024 13:45:00	0.64	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.47	0.08	0.57	0.01	
23/12/2024 14:00:00	0.64	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.46	0.08	0.59	0.03	
23/12/2024 14:15:00	0.64	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.46	0.08	0.61	0.01	
23/12/2024 14:30:00	0.65	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.46	0.08	0.63	0.00	
23/12/2024 14:45:00	0.66	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.46	0.08	0.64	0.02	
23/12/2024 15:00:00	0.66	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.46	0.08	0.65	0.01	
23/12/2024 15:15:00	0.67	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.47	0.08	0.66	0.02	
23/12/2024 15:30:00	0.68	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.47	0.08	0.66	0.02	
23/12/2024 15:45:00	0.68	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.05	0.47	0.08	0.67	0.02	
23/12/2024 16:00:00	0.69	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.47	0.08	0.67	0.02	
23/12/2024 16:15:00	0.69	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.05	0.48	0.07	0.68	0.02	
23/12/2024 16:30:00	0.70	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.48	0.08	0.68	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
23/12/2024 16:45:00	0.70	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.05	0.48	0.07	0.69	0.02	
23/12/2024 17:00:00	0.71	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.49	0.07	0.69	0.01	
23/12/2024 17:15:00	0.71	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.05	0.49	0.06	0.69	0.02	
23/12/2024 17:30:00	0.72	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.05	0.49	0.06	0.70	0.03	
23/12/2024 17:45:00	0.72	0.00	0.05	0.02	0.14	0.16	0.09	0.47	0.04	0.50	0.06	0.70	0.01	
23/12/2024 18:00:00	0.72	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.05	0.50	0.06	0.70	0.00	
23/12/2024 18:15:00	0.72	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.50	0.06	0.70	0.03	
23/12/2024 18:30:00	0.73	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.50	0.06	0.69	0.04	
23/12/2024 18:45:00	0.72	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.50	0.06	0.66	0.08	
23/12/2024 19:00:00	0.72	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.50	0.06	0.64	0.07	
23/12/2024 19:15:00	0.72	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.50	0.06	0.62	0.11	
23/12/2024 19:30:00	0.71	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.50	0.06	0.59	0.12	
23/12/2024 19:45:00	0.71	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.50	0.06	0.58	0.10	
23/12/2024 20:00:00	0.70	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.50	0.06	0.56	0.11	
23/12/2024 20:15:00	0.69	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.49	0.06	0.54	0.09	
23/12/2024 20:30:00	0.69	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.05	0.49	0.06	0.53	0.08	
23/12/2024 20:45:00	0.68	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.04	0.49	0.07	0.52	0.09	
23/12/2024 21:00:00	0.67	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.48	0.07	0.50	0.11	
23/12/2024 21:15:00	0.67	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.48	0.07	0.49	0.09	
23/12/2024 21:30:00	0.66	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.47	0.07	0.48	0.09	
23/12/2024 21:45:00	0.65	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.47	0.07	0.47	0.12	
23/12/2024 22:00:00	0.65	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.47	0.07	0.46	0.11	
23/12/2024 22:15:00	0.64	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.47	0.07	0.45	0.10	
23/12/2024 22:30:00	0.63	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.04	0.46	0.07	0.44	0.11	
23/12/2024 22:45:00	0.63	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.04	0.46	0.08	0.44	0.12	
23/12/2024 23:00:00	0.62	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.05	0.46	0.08	0.43	0.10	
23/12/2024 23:15:00	0.61	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.05	0.45	0.08	0.42	0.09	
23/12/2024 23:30:00	0.61	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.05	0.45	0.08	0.42	0.11	
23/12/2024 23:45:00	0.60	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.04	0.45	0.08	0.41	0.06	
24/12/2024 00:00:00	0.60	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.04	0.45	0.08	0.41	0.08	
24/12/2024 00:15:00	0.59	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.45	0.08	0.40	0.05	
24/12/2024 00:30:00	0.59	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.03	0.44	0.08	0.40	0.06	
24/12/2024 00:45:00	0.58	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.02	0.44	0.08	0.40	0.07	
24/12/2024 01:00:00	0.58	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.02	0.44	0.08	0.41	0.08	
24/12/2024 01:15:00	0.58	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.03	0.44	0.08	0.41	0.05	
24/12/2024 01:30:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.45	0.04	0.44	0.08	0.43	0.07	
24/12/2024 01:45:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.45	0.03	0.44	0.08	0.45	0.04	
24/12/2024 02:00:00	0.57	0.00	0.05	0.02	0.14	0.16	0.09	0.45	0.03	0.44	0.08	0.48	0.01	
24/12/2024 02:15:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.45	0.04	0.44	0.08	0.50	0.02	
24/12/2024 02:30:00	0.57	0.00	0.05	0.02	0.14	0.16	0.09	0.45	0.05	0.44	0.07	0.52	0.01	
24/12/2024 02:45:00	0.58	0.00	0.06	0.03	0.14	0.16	0.09	0.45	0.04	0.44	0.07	0.54	0.00	
24/12/2024 03:00:00	0.58	0.00	0.05	0.02	0.14	0.16	0.09	0.45	0.04	0.43	0.08	0.55	0.00	
24/12/2024 03:15:00	0.59	0.00	0.05	0.02	0.14	0.16	0.09	0.45	0.04	0.43	0.08	0.56	0.00	
24/12/2024 03:30:00	0.59	0.00	0.05	0.02	0.14	0.16	0.09	0.44		0.44	0.08	0.57	0.04	
24/12/2024 03:45:00	0.60	0.00	0.05	0.02	0.14	0.16	0.09	0.44		0.44	0.08	0.58	0.02	
24/12/2024 04:00:00	0.61	0.00	0.05	0.02	0.14	0.16	0.09	0.44		0.44	0.08	0.58	0.00	
24/12/2024 04:15:00	0.61	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.44	0.08	0.59	0.01	
24/12/2024 04:30:00	0.62	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.44	0.08	0.60	0.01	
24/12/2024 04:45:00	0.63	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.44	0.08	0.60	0.01	
24/12/2024 05:00:00	0.63	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.44	0.08	0.61	0.02	
24/12/2024 05:15:00	0.64	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.45	0.07	0.61	0.01	
24/12/2024 05:30:00	0.64	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.45	0.07	0.62	0.00	
24/12/2024 05:45:00	0.65	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.45	0.07	0.62	0.01	
24/12/2024 06:00:00	0.65	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.03	0.45	0.07	0.63	0.02	
24/12/2024 06:15:00	0.66	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.03	0.45	0.07	0.63	0.05	
24/12/2024 06:30:00	0.66	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.04	0.46	0.07	0.63	0.05	
24/12/2024 06:45:00	0.66	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.04	0.46	0.07	0.61	0.05	
24/12/2024 07:00:00	0.66	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.04	0.46	0.07	0.58	0.10	
24/12/2024 07:15:00	0.66	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.05	0.46	0.08	0.56	0.09	
24/12/2024 07:30:00	0.66	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.04	0.46	0.07	0.54	0.10	
24/12/2024 07:45:00	0.65	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.04	0.46	0.07	0.52	0.10	
24/12/2024 08:00:00	0.65	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.04	0.46	0.07	0.50	0.05	
24/12/2024 08:15:00	0.64	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.03	0.46	0.07	0.48	0.08	
24/12/2024 08:30:00	0.64	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.03	0.46	0.07	0.47	0.12	
24/12/2024 08:45:00	0.63	0.00	0.04	0.02	0.13	0.15	0.08	0.45	0.04	0.46	0.07	0.46	0.08	
24/12/2024 09:00:00	0.62	0.00	0.04	0.02	0.13	0.15	0.08	0.45	0.04	0.45	0.07	0.44	0.10	
24/12/2024 09:15:00	0.62	0.00	0.04	0.02	0.13	0.15	0.08	0.45	0.05	0.45	0.08	0.43	0.09	
24/12/2024 09:30:00	0.61	0.00	0.04	0.02	0.13	0.15	0.08	0.45	0.05	0.45	0.07	0.42	0.08	
24/12/2024 09:45:00	0.61	0.00	0.04	0.02	0.13	0.15	0.08	0.45	0.04	0.45	0.07	0.42	0.10	
24/12/2024 10:00:00	0.60	0.00	0.04	0.02	0.13	0.15	0.08	0.45	0.05	0.44	0.08	0.41	0.06	
24/12/2024 10:15:00	0.60	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.04	0.44	0.07	0.40	0.08	
24/12/2024 10:30:00	0.59	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.05	0.44	0.07	0.39	0.10	
24/12/2024 10:45:00	0.59	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.04	0.44	0.07	0.38	0.06	
24/12/2024 11:00:00	0.58	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.05	0.44	0.08	0.38	0.05	
24/12/2024 11:15:00	0.58	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.05	0.44	0.07	0.37	0.11	
24/12/2024 11:30:00	0.57	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.44	0.07	0.37	0.10	
24/12/2024 11:45:00	0.57	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.43	0.07	0.36	0.08	
24/12/2024 12:00:00	0.56	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.43	0.07	0.36	0.05	
24/12/2024 12:15:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.07	0.35	0.07	
24/12/2024 12:30:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.07	0.35	0.09	
24/12/2024 12:45:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.04	0.43	0.07	0.34	0.09	
24/12/2024 13:00:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.04	0.43	0.07	0.34	0.05	
24/12/2024 13:15:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.04	0.43	0.06	0.34	0.06	
24/12/2024 13:30:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.04	0.43	0.06	0.34	0.06	
24/12/2024 13:45:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.43	0.07	0.35	0.08	
24/12/2024 14:00:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.04	0.43	0.06	0.36	0.02	
24/12/2024 14:15:00	0.53	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.43	0.06	0.39	0.02	
24/12/2024 14:30:00	0.53	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.43	0.06	0.42	0.00	
24/12/2024 14:45:00	0.53	0.00	0.06	0.03	0.14	0.16	0.08	0.47	0.05	0.43	0.06	0.44	0.04	
24/12/2024 15:00:00	0.53	0.00	0.06	0.03	0.14	0.16	0.08	0.47	0.04	0.43	0.06	0.46	0.03	
24/12/2024 15:15:00	0.54	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.06	0.43	0.06	0.47	0.02	
24/12/2024 15:30:00	0.54	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.04	0.43	0.07	0.48	0.01	
24/12/2024 15:45:00	0.54	0.08	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.42	0.08	0.49	0.01	
24/12/2024 16:00:00	0.55	0.07	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.42	0.08	0.50	0.02	
24/12/2024 16:15:00	0.55	0.06	0.06	0.03	0.14	0.16	0.09	0.46	0.05	0.43	0.08	0.51	0.01	
24/12/2024 16:30:00	0.56	0.04	0.06	0.03	0.14	0.16	0.09	0.46	0.06	0.43	0.08	0.52	0.02	
24/12/2024 16:45:00	0.56	0.03	0.06	0.03	0.14	0.16	0.09	0.46	0.05	0.43	0.08	0.53	0.01	
24/12/2024 17:00:00	0.57	0.01	0.06	0.03	0.14	0.16	0.09	0.46	0.05	0.43	0.08	0.53	0.02	
24/12/2024 17:15:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.04	0.43	0.08	0.54	0.02	
24/12/2024 17:30:00	0.58	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.04	0.43	0.08	0.55	0.01	
24/12/2024 17:45:00	0.59	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.04	0.43	0.08	0.55	0.02	
24/12/2024 18:00:00	0.59	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.04	0.43	0.08	0.56	0.01	
24/12/2024 18:15:00	0.60	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.05	0.43	0.08	0.57	0.02	
24/12/2024 18:30:00	0.60	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.43	0.08	0.57	0.03	
24/12/2024 18:45:00	0.61	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.04	0.43	0.07	0.58	0.02	
24/12/2024 19:00:00	0.61	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.43	0.07	0.58	0.02	
24/12/2024 19:15:00	0.61	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.03	0.44	0.07	0.59	0.03	
24/12/2024 19:30:00	0.62	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.03	0.44	0.07	0.59	0.02	
24/12/2024 19:45:00	0.62	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.02	0.44	0.07	0.59	0.03	
24/12/2024 20:00:00	0.63	0.05	0.06	0.03	0.14	0.16	0.09	0.47	0.02	0.44	0.07	0.60	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
24/12/2024 20:15:00	0.63	0.03	0.06	0.03	0.14	0.16	0.09	0.47	0.02	0.44	0.07	0.60	0.03	
24/12/2024 20:30:00	0.64	0.02	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.44	0.07	0.61	0.01	
24/12/2024 20:45:00	0.64	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.44	0.07	0.61	0.02	
24/12/2024 21:00:00	0.64	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.45	0.07	0.60	0.03	
24/12/2024 21:15:00	0.64	0.05	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.45	0.07	0.58	0.08	
24/12/2024 21:30:00	0.64	0.04	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.45	0.07	0.55	0.08	
24/12/2024 21:45:00	0.64	0.02	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.45	0.07	0.53	0.10	
24/12/2024 22:00:00	0.64	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.05	0.45	0.07	0.51	0.09	
24/12/2024 22:15:00	0.63	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.04	0.45	0.07	0.50	0.10	
24/12/2024 22:30:00	0.63	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.04	0.45	0.07	0.49	0.08	
24/12/2024 22:45:00	0.62	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.03	0.45	0.06	0.47	0.10	
24/12/2024 23:00:00	0.62	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.03	0.45	0.07	0.45	0.12	
24/12/2024 23:15:00	0.61	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.03	0.44	0.07	0.44	0.11	
24/12/2024 23:30:00	0.61	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.03	0.44	0.07	0.43	0.09	
24/12/2024 23:45:00	0.60	0.00	0.06	0.03	0.14	0.16	0.09	0.47	0.03	0.44	0.07	0.42	0.09	
25/12/2024 00:00:00	0.60	0.00	0.06	0.03	0.14	0.16	0.09	0.46	0.03	0.44	0.07	0.41	0.08	
25/12/2024 00:15:00	0.59	0.00	0.06	0.03	0.14	0.16	0.09	0.46		0.44	0.07	0.41	0.06	
25/12/2024 00:30:00	0.59	0.00	0.06	0.03	0.14	0.16	0.09	0.46		0.44	0.07	0.40	0.08	
25/12/2024 00:45:00	0.58	0.00	0.06	0.03	0.14	0.16	0.09	0.46		0.44	0.07	0.40	0.07	
25/12/2024 01:00:00	0.58	0.00	0.06	0.03	0.14	0.16	0.09	0.46		0.43	0.07	0.40	0.06	
25/12/2024 01:15:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.46		0.43	0.08	0.41	0.06	
25/12/2024 01:30:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.46		0.43	0.07	0.42	0.05	
25/12/2024 01:45:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.46		0.43	0.07	0.45	0.03	
25/12/2024 02:00:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.45		0.43	0.07	0.47	0.03	
25/12/2024 02:15:00	0.56	0.00	0.06	0.03	0.14	0.16	0.09	0.45		0.43	0.07	0.49	0.02	
25/12/2024 02:30:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.45		0.43	0.07	0.50	0.02	
25/12/2024 02:45:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.45		0.43	0.08	0.51	0.03	
25/12/2024 03:00:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.45		0.43	0.08	0.52	0.01	
25/12/2024 03:15:00	0.57	0.00	0.06	0.03	0.14	0.16	0.09	0.45		0.43	0.07	0.53	0.01	
25/12/2024 03:30:00	0.58	0.00	0.06	0.03	0.14	0.16	0.09	0.45		0.43	0.08	0.54	0.02	
25/12/2024 03:45:00	0.58	0.00	0.06	0.03	0.14	0.16	0.09	0.44		0.43	0.07	0.55	0.02	
25/12/2024 04:00:00	0.59	0.00	0.06	0.03	0.14	0.16	0.08	0.44		0.43	0.07	0.56	0.02	
25/12/2024 04:15:00	0.59	0.00	0.06	0.03	0.14	0.16	0.08	0.44		0.43	0.07	0.56	0.01	
25/12/2024 04:30:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.43	0.07	0.57	0.01	
25/12/2024 04:45:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.43	0.07	0.57	0.02	
25/12/2024 05:00:00	0.61	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.43	0.07	0.58	0.03	
25/12/2024 05:15:00	0.61	0.00	0.05	0.02	0.14	0.16	0.08	0.44		0.43	0.07	0.58	0.03	
25/12/2024 05:30:00	0.62	0.00	0.05	0.02	0.13	0.16	0.08	0.44		0.44	0.07	0.59	0.02	
25/12/2024 05:45:00	0.62	0.00	0.05	0.02	0.13	0.16	0.08	0.44		0.44	0.06	0.59	0.01	
25/12/2024 06:00:00	0.62	0.00	0.05	0.02	0.13	0.16	0.08	0.44		0.44	0.07	0.60	0.02	
25/12/2024 06:15:00	0.63	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.00	0.44	0.06	0.60	0.02	
25/12/2024 06:30:00	0.63	0.00	0.05	0.02	0.13	0.16	0.08	0.43	0.01	0.44	0.07	0.60	0.03	
25/12/2024 06:45:00	0.64	0.00	0.05	0.02	0.13	0.16	0.08	0.43	0.03	0.44	0.07	0.61	0.02	
25/12/2024 07:00:00	0.64	0.00	0.05	0.02	0.13	0.16	0.08	0.43	0.04	0.44	0.07	0.61	0.01	
25/12/2024 07:15:00	0.64	0.00	0.05	0.02	0.13	0.15	0.08	0.43	0.04	0.45	0.07	0.62	0.03	
25/12/2024 07:30:00	0.65	0.00	0.05	0.02	0.13	0.15	0.08	0.43	0.05	0.45	0.07	0.62	0.01	
25/12/2024 07:45:00	0.65	0.00	0.05	0.02	0.13	0.15	0.08	0.43	0.04	0.45	0.07	0.62	0.03	
25/12/2024 08:00:00	0.65	0.00	0.05	0.02	0.13	0.15	0.08	0.43	0.04	0.45	0.07	0.63	0.01	
25/12/2024 08:15:00	0.66	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.03	0.45	0.07	0.63	0.01	
25/12/2024 08:30:00	0.66	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.03	0.46	0.07	0.63	-0.02	
25/12/2024 08:45:00	0.66	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.04	0.46	0.07	0.64	0.02	
25/12/2024 09:00:00	0.67	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.05	0.46	0.07	0.62	0.06	
25/12/2024 09:15:00	0.66	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.04	0.46	0.07	0.59	0.06	
25/12/2024 09:30:00	0.66	0.07	0.04	0.02	0.13	0.15	0.07	0.44	0.04	0.46	0.07	0.57	0.08	
25/12/2024 09:45:00	0.66	0.05	0.04	0.02	0.13	0.15	0.07	0.44	0.04	0.46	0.08	0.54	0.10	
25/12/2024 10:00:00	0.65	0.08	0.04	0.02	0.13	0.15	0.07	0.45	0.04	0.46	0.07	0.53	0.09	
25/12/2024 10:15:00	0.65	0.05	0.04	0.02	0.13	0.15	0.07	0.45	0.04	0.46	0.07	0.51	0.12	
25/12/2024 10:30:00	0.64	0.03	0.04	0.02	0.13	0.15	0.07	0.45	0.04	0.46	0.07	0.49	0.09	
25/12/2024 10:45:00	0.64	0.00	0.04	0.02	0.13	0.15	0.07	0.46	0.04	0.46	0.07	0.47	0.11	
25/12/2024 11:00:00	0.63	0.00	0.04	0.02	0.13	0.15	0.07	0.46	0.04	0.45	0.06	0.46	0.08	
25/12/2024 11:15:00	0.62	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.05	0.45	0.07	0.44	0.10	
25/12/2024 11:30:00	0.62	0.00	0.04	0.02	0.13	0.15	0.08	0.46	0.05	0.45	0.07	0.43	0.10	
25/12/2024 11:45:00	0.61	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.45	0.07	0.42	0.11	
25/12/2024 12:00:00	0.61	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.44	0.08	0.41	0.09	
25/12/2024 12:15:00	0.60	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.44	0.06	0.40	0.10	
25/12/2024 12:30:00	0.59	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.44	0.06	0.40	0.10	
25/12/2024 12:45:00	0.59	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.44	0.07	0.39	0.07	
25/12/2024 13:00:00	0.58	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.44	0.06	0.38	0.08	
25/12/2024 13:15:00	0.58	0.00	0.05	0.02	0.13	0.15	0.08	0.47	0.05	0.44	0.06	0.37	0.09	
25/12/2024 13:30:00	0.57	0.00	0.05	0.02	0.13	0.15	0.08	0.47	0.04	0.43	0.07	0.37	0.07	
25/12/2024 13:45:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.43	0.06	0.36	0.06	
25/12/2024 14:00:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.43	0.06	0.36	0.07	
25/12/2024 14:15:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.07	0.36	0.06	
25/12/2024 14:30:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.06	0.36	0.08	
25/12/2024 14:45:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.06	0.36	0.06	
25/12/2024 15:00:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.07	0.37	0.05	
25/12/2024 15:15:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.43	0.07	0.39	0.02	
25/12/2024 15:30:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.04	0.42	0.07	0.43	0.01	
25/12/2024 15:45:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.06	0.42	0.08	0.45	0.02	
25/12/2024 16:00:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.06	0.42	0.08	0.46	0.01	
25/12/2024 16:15:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.42	0.08	0.48	-0.01	
25/12/2024 16:30:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.42	0.08	0.49	0.02	
25/12/2024 16:45:00	0.55	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.42	0.08	0.50	0.01	
25/12/2024 17:00:00	0.55	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.42	0.08	0.51	0.03	
25/12/2024 17:15:00	0.56	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.05	0.42	0.07	0.52	0.01	
25/12/2024 17:30:00	0.56	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.04	0.42	0.07	0.52	0.02	
25/12/2024 17:45:00	0.57	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.04	0.42	0.07	0.53	0.01	
25/12/2024 18:00:00	0.57	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.42	0.07	0.54	0.00	
25/12/2024 18:15:00	0.58	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.43	0.07	0.54	0.02	
25/12/2024 18:30:00	0.58	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.43	0.08	0.55	0.01	
25/12/2024 18:45:00	0.59	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.43	0.07	0.55	0.02	
25/12/2024 19:00:00	0.59	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.43	0.08	0.56	0.02	
25/12/2024 19:15:00	0.60	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.04	0.43	0.07	0.56	0.01	
25/12/2024 19:30:00	0.60	0.00	0.05	0.02	0.14	0.16	0.09	0.46	0.05	0.43	0.07	0.57	0.02	
25/12/2024 19:45:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.07	0.57	0.02	
25/12/2024 20:00:00	0.61	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.07	0.58	0.03	
25/12/2024 20:15:00	0.61	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.07	0.58	0.02	
25/12/2024 20:30:00	0.62	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.07	0.59	0.02	
25/12/2024 20:45:00	0.62	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.44	0.07	0.59	0.00	
25/12/2024 21:00:00	0.62	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.03	0.44	0.07	0.60	0.01	
25/12/2024 21:15:00	0.63	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.03	0.44	0.07	0.60	0.02	
25/12/2024 21:30:00	0.63	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.44	0.07	0.59	0.05	
25/12/2024 21:45:00	0.63	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.44	0.07	0.57	0.06	
25/12/2024 22:00:00	0.63	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.44	0.07	0.54	0.06	
25/12/2024 22:15:00	0.63	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.44	0.07	0.52	0.05	
25/12/2024 22:30:00	0.63	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.44	0.07	0.51	0.10	
25/12/2024 22:45:00	0.62	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.44	0.07	0.49	0.11	
25/12/2024 23:00:00	0.62	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.44	0.07	0.47	0.08	
25/12/2024 23:15:00	0.61	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.03	0.44	0.07	0.46	0.10	
25/12/2024 23:30:00	0.61	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.03	0.44	0.07	0.44	0.10	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
25/12/2024 23:45:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.03	0.44	0.07	0.43	0.11	
26/12/2024 00:00:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.03	0.44	0.07	0.42	0.09	
26/12/2024 00:15:00	0.59	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.02	0.44	0.07	0.40	0.09	
26/12/2024 00:30:00	0.59	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.02	0.44	0.07	0.40	0.09	
26/12/2024 00:45:00	0.58	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.01	0.43	0.07	0.39	0.09	
26/12/2024 01:00:00	0.58	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.00	0.43	0.07	0.38	0.09	
26/12/2024 01:15:00	0.57	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.03	0.43	0.07	0.37	0.09	
26/12/2024 01:30:00	0.57	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.03	0.43	0.07	0.37	0.08	
26/12/2024 01:45:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.03	0.43	0.06	0.36	0.08	
26/12/2024 02:00:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.03	0.43	0.07	0.36	0.08	
26/12/2024 02:15:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.03	0.43	0.07	0.36	0.09	
26/12/2024 02:30:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.04	0.43	0.07	0.36	0.08	
26/12/2024 02:45:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.07	0.37	0.06	
26/12/2024 03:00:00	0.54	0.00	0.05	0.02	0.13	0.15	0.08	0.45		0.43	0.07	0.39	0.05	
26/12/2024 03:15:00	0.54	0.00	0.05	0.02	0.13	0.15	0.08	0.44		0.43	0.07	0.42	0.04	
26/12/2024 03:30:00	0.54	0.00	0.05	0.02	0.13	0.15	0.08	0.44		0.42	0.07	0.44	0.03	
26/12/2024 03:45:00	0.54	0.00	0.05	0.02	0.13	0.15	0.08	0.44		0.42	0.07	0.46	0.01	
26/12/2024 04:00:00	0.54	0.00	0.05	0.02	0.13	0.15	0.08	0.44		0.42	0.08	0.47	0.03	
26/12/2024 04:15:00	0.54	0.00	0.05	0.02	0.13	0.15	0.08	0.44		0.42	0.07	0.48	0.05	
26/12/2024 04:30:00	0.54	0.00	0.05	0.02	0.13	0.15	0.08	0.44		0.42	0.07	0.49	0.02	
26/12/2024 04:45:00	0.55	0.00	0.05	0.02	0.13	0.15	0.08	0.44		0.42	0.07	0.50	0.03	
26/12/2024 05:00:00	0.55	0.00	0.05	0.02	0.13	0.15	0.08	0.44		0.42	0.07	0.51	0.03	
26/12/2024 05:15:00	0.56	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.03	0.42	0.07	0.52	0.01	
26/12/2024 05:30:00	0.56	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.03	0.42	0.07	0.52	0.00	
26/12/2024 05:45:00	0.57	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.03	0.43	0.07	0.53	0.02	
26/12/2024 06:00:00	0.57	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.03	0.43	0.07	0.53	0.03	
26/12/2024 06:15:00	0.58	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.03	0.43	0.07	0.54	0.03	
26/12/2024 06:30:00	0.58	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.03	0.43	0.07	0.55	0.02	
26/12/2024 06:45:00	0.58	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.04	0.43	0.07	0.55	0.03	
26/12/2024 07:00:00	0.59	0.00	0.04	0.02	0.13	0.15	0.08	0.43	0.04	0.43	0.07	0.56	0.02	
26/12/2024 07:15:00	0.59	0.00	0.04	0.02	0.13	0.15	0.07	0.43	0.03	0.43	0.07	0.56	0.01	
26/12/2024 07:30:00	0.60	0.00	0.04	0.02	0.13	0.15	0.07	0.43	0.04	0.43	0.06	0.57	0.00	
26/12/2024 07:45:00	0.60	0.00	0.04	0.02	0.13	0.15	0.07	0.43	0.05	0.43	0.07	0.57	0.01	
26/12/2024 08:00:00	0.61	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.05	0.43	0.06	0.57	0.01	
26/12/2024 08:15:00	0.61	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.05	0.43	0.07	0.58	0.03	
26/12/2024 08:30:00	0.61	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.05	0.44	0.06	0.58	0.03	
26/12/2024 08:45:00	0.62	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.05	0.44	0.06	0.59	0.03	
26/12/2024 09:00:00	0.62	0.00	0.04	0.01	0.13	0.15	0.07	0.44	0.04	0.44	0.07	0.59	0.02	
26/12/2024 09:15:00	0.62	0.00	0.04	0.01	0.13	0.15	0.07	0.44	0.04	0.44	0.07	0.59	0.03	
26/12/2024 09:30:00	0.63	0.00	0.04	0.01	0.13	0.15	0.07	0.45	0.04	0.44	0.07	0.59	0.03	
26/12/2024 09:45:00	0.63	0.00	0.04	0.01	0.13	0.15	0.07	0.45	0.05	0.44	0.06	0.57	0.07	
26/12/2024 10:00:00	0.63	0.00	0.04	0.01	0.13	0.15	0.07	0.45	0.04	0.44	0.03	0.54	0.07	
26/12/2024 10:15:00	0.63	0.00	0.04	0.01	0.13	0.15	0.07	0.45	0.06	0.44		0.52	0.09	
26/12/2024 10:30:00	0.62	0.00	0.04	0.01	0.13	0.15	0.07	0.45	0.05	0.44		0.50	0.11	
26/12/2024 10:45:00	0.62	0.00	0.04	0.01	0.13	0.15	0.07	0.46	0.04	0.44		0.48	0.10	
26/12/2024 11:00:00	0.62	0.00	0.04	0.01	0.13	0.15	0.07	0.46	0.05	0.44		0.47	0.09	
26/12/2024 11:15:00	0.61	0.00	0.04	0.01	0.13	0.15	0.07	0.46	0.05	0.44		0.45	0.09	
26/12/2024 11:30:00	0.60	0.00	0.04	0.01	0.13	0.15	0.07	0.47	0.06	0.44		0.43	0.11	
26/12/2024 11:45:00	0.60	0.00	0.04	0.01	0.13	0.15	0.07	0.47	0.06	0.44		0.42	0.10	
26/12/2024 12:00:00	0.59	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.44		0.41	0.07	
26/12/2024 12:15:00	0.59	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.06	0.44		0.40	0.07	
26/12/2024 12:30:00	0.58	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.04	0.44		0.39	0.10	
26/12/2024 12:45:00	0.58	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.43		0.38	0.11	
26/12/2024 13:00:00	0.57	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.43		0.37	0.08	
26/12/2024 13:15:00	0.57	0.00	0.05	0.02	0.13	0.15	0.08	0.47	0.05	0.43		0.36	0.07	
26/12/2024 13:30:00	0.56	0.00	0.05	0.02	0.13	0.15	0.08	0.47	0.05	0.43		0.36	0.10	
26/12/2024 13:45:00	0.56	0.00	0.05	0.02	0.13	0.15	0.08	0.47	0.05	0.43		0.35	0.09	
26/12/2024 14:00:00	0.55	0.00	0.05	0.02	0.13	0.15	0.08	0.47	0.05	0.43	0.02	0.34	0.09	
26/12/2024 14:15:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.04	0.43	0.03	0.34	0.07	
26/12/2024 14:30:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.06	0.33	0.09	
26/12/2024 14:45:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.06	0.33	0.11	
26/12/2024 15:00:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.04	0.43	0.07	0.32	0.07	
26/12/2024 15:15:00	0.53	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.04	0.42	0.06	0.32	0.07	
26/12/2024 15:30:00	0.53	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.42	0.06	0.32	0.08	
26/12/2024 15:45:00	0.53	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.42	0.06	0.32	0.04	
26/12/2024 16:00:00	0.52	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.42	0.06	0.34	0.05	
26/12/2024 16:15:00	0.52	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.42	0.07	0.38	0.02	
26/12/2024 16:30:00	0.52	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.42	0.07	0.41	0.01	
26/12/2024 16:45:00	0.52	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.06	0.42	0.07	0.42	0.03	
26/12/2024 17:00:00	0.52	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.06	0.42	0.07	0.44	0.02	
26/12/2024 17:15:00	0.52	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.42	0.07	0.45	0.03	
26/12/2024 17:30:00	0.52	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.05	0.42	0.08	0.46	0.01	
26/12/2024 17:45:00	0.53	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.42	0.08	0.47	0.04	
26/12/2024 18:00:00	0.53	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.42	0.07	0.48	0.03	
26/12/2024 18:15:00	0.53	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.42	0.07	0.49	0.02	
26/12/2024 18:30:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.42	0.06	0.49	0.02	
26/12/2024 18:45:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.42	0.06	0.50	0.02	
26/12/2024 19:00:00	0.55	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.42	0.06	0.50	-0.01	
26/12/2024 19:15:00	0.55	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.42	0.06	0.51	0.02	
26/12/2024 19:30:00	0.56	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.06	0.42	0.07	0.52	0.02	
26/12/2024 19:45:00	0.56	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.42	0.07	0.52	0.01	
26/12/2024 20:00:00	0.56	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.01	0.42	0.07	0.53	0.02	
26/12/2024 20:15:00	0.57	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.43	0.07	0.53	0.01	
26/12/2024 20:30:00	0.57	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.06	0.43	0.07	0.54	0.00	
26/12/2024 20:45:00	0.58	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.43	0.07	0.54	0.01	
26/12/2024 21:00:00	0.58	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.43	0.07	0.55	0.01	
26/12/2024 21:15:00	0.59	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.43	0.07	0.55	0.03	
26/12/2024 21:30:00	0.59	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.07	0.56	0.00	
26/12/2024 21:45:00	0.59	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.07	0.56	0.00	
26/12/2024 22:00:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.43	0.07	0.56	0.01	
26/12/2024 22:15:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.43	0.06	0.57	0.02	
26/12/2024 22:30:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.43	0.06	0.55	0.03	
26/12/2024 22:45:00	0.61	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.06	0.43	0.07	0.53	0.07	
26/12/2024 23:00:00	0.61	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.43	0.06	0.51	0.08	
26/12/2024 23:15:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.44	0.07	0.49	0.08	
26/12/2024 23:30:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.44	0.07	0.47	0.09	
26/12/2024 23:45:00	0.60	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.44	0.07	0.45	0.08	
27/12/2024 00:00:00	0.59	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.44	0.06	0.44	0.10	
27/12/2024 00:15:00	0.59	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.43	0.06	0.42	0.09	
27/12/2024 00:30:00	0.58	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.06	0.41	0.08	
27/12/2024 00:45:00	0.58	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.07	0.40	0.10	
27/12/2024 01:00:00	0.57	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.07	0.39	0.09	
27/12/2024 01:15:00	0.57	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.08	0.37	0.11	
27/12/2024 01:30:00	0.56	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.04	0.43	0.07	0.36	0.10	
27/12/2024 01:45:00	0.56	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.04	0.43	0.07	0.36	0.10	
27/12/2024 02:00:00	0.55	0.00	0.05	0.02	0.14	0.16	0.08	0.45	0.04	0.43	0.07	0.35	0.11	
27/12/2024 02:15:00	0.55	0.00	0.05	0.02	0.14	0.16	0.08	0.45		0.43	0.07	0.34	0.11	
27/12/2024 02:30:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.45		0.43	0.08	0.34	0.09	
27/12/2024 02:45:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.45		0.43	0.07	0.33	0.10	
27/12/2024 03:00:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.45		0.43	0.08	0.32	0.08	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
27/12/2024 03:15:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.45		0.43	0.08	0.32	0.06	
27/12/2024 03:30:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.44		0.43	0.07	0.32	0.07	
27/12/2024 03:45:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44		0.43	0.07	0.32	0.07	
27/12/2024 04:00:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44		0.42	0.08	0.33	0.06	
27/12/2024 04:15:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44		0.42	0.07	0.36	0.03	
27/12/2024 04:30:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44		0.42	0.07	0.39	0.03	
27/12/2024 04:45:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.04	0.42	0.07	0.41	0.03	
27/12/2024 05:00:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.03	0.42	0.07	0.42	0.03	
27/12/2024 05:15:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.04	0.42	0.07	0.44	0.02	
27/12/2024 05:30:00	0.52	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.05	0.42	0.07	0.45	0.02	
27/12/2024 05:45:00	0.52	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.04	0.42	0.07	0.46	0.03	
27/12/2024 06:00:00	0.52	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.05	0.42	0.06	0.47	0.00	
27/12/2024 06:15:00	0.53	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.04	0.42	0.06	0.48	0.03	
27/12/2024 06:30:00	0.53	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.04	0.42	0.07	0.48	0.03	
27/12/2024 06:45:00	0.54	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.05	0.42	0.07	0.49	0.02	
27/12/2024 07:00:00	0.54	0.00	0.04	0.02	0.13	0.15	0.08	0.44	0.05	0.42	0.07	0.50	0.03	
27/12/2024 07:15:00	0.55	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.05	0.42	0.08	0.50	0.03	
27/12/2024 07:30:00	0.55	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.05	0.42	0.08	0.51	0.03	
27/12/2024 07:45:00	0.55	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.05	0.42	0.09	0.51	0.03	
27/12/2024 08:00:00	0.56	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.05	0.42	0.08	0.52	0.02	
27/12/2024 08:15:00	0.56	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.04	0.42	0.09	0.52	0.03	
27/12/2024 08:30:00	0.57	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.04	0.43	0.08	0.53	0.02	
27/12/2024 08:45:00	0.57	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.04	0.43	0.08	0.53	0.02	
27/12/2024 09:00:00	0.57	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.04	0.43	0.08	0.54	0.02	
27/12/2024 09:15:00	0.58	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.43	0.09	0.54	0.03	
27/12/2024 09:30:00	0.58	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.05	0.43	0.08	0.55	0.03	
27/12/2024 09:45:00	0.59	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.06	0.43	0.07	0.55	0.03	
27/12/2024 10:00:00	0.59	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.06	0.43	0.07	0.55	0.03	
27/12/2024 10:15:00	0.59	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.06	0.43	0.07	0.55	0.04	
27/12/2024 10:30:00	0.60	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.06	0.43	0.08	0.53	0.07	
27/12/2024 10:45:00	0.60	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.08	0.50	0.09	
27/12/2024 11:00:00	0.60	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.07	0.48	0.11	
27/12/2024 11:15:00	0.59	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.07	0.46	0.10	
27/12/2024 11:30:00	0.59	0.00	0.04	0.01	0.13	0.15	0.07	0.46	0.05	0.43	0.07	0.44	0.09	
27/12/2024 11:45:00	0.58	0.00	0.04	0.01	0.13	0.15	0.07	0.47	0.07	0.43	0.07	0.42	0.08	
27/12/2024 12:00:00	0.58	0.00	0.04	0.01	0.13	0.15	0.07	0.47	0.06	0.43	0.07	0.41	0.10	
27/12/2024 12:15:00	0.58	0.00	0.04	0.02	0.13	0.15	0.07	0.47	0.05	0.43	0.07	0.39	0.08	
27/12/2024 12:30:00	0.57	0.00	0.04	0.02	0.13	0.15	0.07	0.47	0.05	0.43	0.07	0.38	0.07	
27/12/2024 12:45:00	0.57	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.43	0.07	0.37	0.09	
27/12/2024 13:00:00	0.56	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.06	0.43	0.07	0.36	0.09	
27/12/2024 13:15:00	0.56	0.00	0.04	0.02	0.13	0.15	0.08	0.47	0.05	0.43	0.07	0.35	0.11	
27/12/2024 13:30:00	0.55	0.00	0.05	0.02	0.13	0.15	0.08	0.47	0.05	0.43	0.07	0.34	0.09	
27/12/2024 13:45:00	0.55	0.00	0.05	0.02	0.13	0.15	0.08	0.47	0.06	0.43	0.09	0.34	0.07	
27/12/2024 14:00:00	0.54	0.00	0.05	0.02	0.13	0.15	0.08	0.47	0.06	0.43	0.07	0.33	0.07	
27/12/2024 14:15:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.43	0.08	0.32	0.09	
27/12/2024 14:30:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.07	0.32	0.07	
27/12/2024 14:45:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.04	0.42	0.07	0.31	0.08	
27/12/2024 15:00:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.08	0.31	0.08	
27/12/2024 15:15:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.08	0.30	0.08	
27/12/2024 15:30:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.08	0.30	0.08	
27/12/2024 15:45:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.09	0.29	0.08	
27/12/2024 16:00:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.10	0.29	0.08	
27/12/2024 16:15:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.09	0.28	0.09	
27/12/2024 16:30:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.09	0.29	0.10	
27/12/2024 16:45:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.09	0.29	0.08	
27/12/2024 17:00:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.09	0.32	0.03	
27/12/2024 17:15:00	0.50	0.00	0.06	0.03	0.14	0.16	0.08	0.47	0.06	0.42	0.08	0.36	0.04	
27/12/2024 17:30:00	0.50	0.00	0.06	0.03	0.14	0.16	0.08	0.47	0.05	0.42	0.08	0.38	0.04	
27/12/2024 17:45:00	0.50	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.05	0.42	0.08	0.40	0.03	
27/12/2024 18:00:00	0.50	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.05	0.42	0.08	0.41	0.04	
27/12/2024 18:15:00	0.50	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.04	0.42	0.08	0.42	0.02	
27/12/2024 18:30:00	0.50	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.04	0.42	0.08	0.43	0.01	
27/12/2024 18:45:00	0.51	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.03	0.42	0.08	0.44	0.01	
27/12/2024 19:00:00	0.51	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.04	0.42	0.08	0.45	0.01	
27/12/2024 19:15:00	0.51	0.00	0.05	0.02	0.14	0.16	0.08	0.46	0.05	0.42	0.08	0.46	0.00	
27/12/2024 19:30:00	0.52	0.00	0.06	0.03	0.14	0.16	0.08	0.46	0.04	0.42	0.08	0.46	0.01	
27/12/2024 19:45:00	0.52	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.42	0.08	0.47	0.01	
27/12/2024 20:00:00	0.53	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.06	0.42	0.08	0.48	0.01	
27/12/2024 20:15:00	0.53	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.42	0.08	0.48	0.01	
27/12/2024 20:30:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.03	0.42	0.08	0.49	0.00	
27/12/2024 20:45:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.03	0.42	0.08	0.50	0.01	
27/12/2024 21:00:00	0.54	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.42	0.08	0.50	0.00	
27/12/2024 21:15:00	0.55	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.06	0.42	0.08	0.51	0.01	
27/12/2024 21:30:00	0.55	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.42	0.08	0.51	0.02	
27/12/2024 21:45:00	0.56	0.00	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.42	0.08	0.52	0.02	
27/12/2024 22:00:00	0.56	0.04	0.05	0.02	0.14	0.16	0.08	0.47	0.05	0.42	0.09	0.52	-0.01	
27/12/2024 22:15:00	0.57	0.03	0.06	0.03	0.14	0.16	0.08	0.46	0.05	0.42	0.08	0.53	0.02	
27/12/2024 22:30:00	0.57	0.01	0.06	0.03	0.14	0.16	0.08	0.46	0.05	0.43	0.08	0.53	0.00	
27/12/2024 22:45:00	0.57	0.00	0.06	0.03	0.13	0.16	0.08	0.46	0.04	0.43	0.08	0.53	0.01	
27/12/2024 23:00:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.04	0.43	0.08	0.54	0.02	
27/12/2024 23:15:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.08	0.54	0.02	
27/12/2024 23:30:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.08	0.52	0.07	
27/12/2024 23:45:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.04	0.43	0.08	0.50	0.08	
28/12/2024 00:00:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.08	0.48	0.06	
28/12/2024 00:15:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.08	0.46	0.08	
28/12/2024 00:30:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.08	0.44	0.07	
28/12/2024 00:45:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.08	0.42	0.08	
28/12/2024 01:00:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.41	0.08	
28/12/2024 01:15:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.04	0.43	0.08	0.39	0.10	
28/12/2024 01:30:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.04	0.43	0.07	0.38	0.10	
28/12/2024 01:45:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.04	0.43	0.08	0.37	0.08	
28/12/2024 02:00:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.08	0.36	0.09	
28/12/2024 02:15:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.09	0.35	0.10	
28/12/2024 02:30:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.09	0.34	0.07	
28/12/2024 02:45:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.08	0.33	0.09	
28/12/2024 03:00:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.08	0.32	0.10	
28/12/2024 03:15:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.08	0.32	0.11	
28/12/2024 03:30:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.42	0.07	0.31	0.08	
28/12/2024 03:45:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.06	0.42	0.08	0.30	0.11	
28/12/2024 04:00:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.05	0.42	0.08	0.30	0.10	
28/12/2024 04:15:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.03	0.42	0.08	0.30	0.10	
28/12/2024 04:30:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.05	0.42	0.09	0.30	0.07	
28/12/2024 04:45:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.00	0.42	0.08	0.31	0.05	
28/12/2024 05:00:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.05	0.42	0.08	0.33	0.01	
28/12/2024 05:15:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.05	0.42	0.08	0.36	0.04	
28/12/2024 05:30:00	0.51	0.00	0.05	0.02	0.13	0.15	0.08	0.44	0.05	0.42	0.08	0.38	0.01	
28/12/2024 05:45:00	0.51	0.00	0.05	0.02	0.13	0.15	0.07	0.44	0.05	0.42	0.08	0.40	0.03	
28/12/2024 06:00:00	0.51	0.00	0.05	0.02	0.13	0.15	0.07	0.44	0.05	0.42	0.08	0.41	0.03	
28/12/2024 06:15:00	0.51	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.05	0.42	0.08	0.42	0.03	
28/12/2024 06:30:00	0.51	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.05	0.42	0.08	0.44	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
28/12/2024 06:45:00	0.51	0.00	0.04	0.02	0.13	0.15	0.07	0.44	0.06	0.42	0.08	0.44	0.02	
28/12/2024 07:00:00	0.52	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.45	0.02	
28/12/2024 07:15:00	0.52	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.06	0.46	0.03	
28/12/2024 07:30:00	0.52	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.47	0.03	
28/12/2024 07:45:00	0.53	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.48	0.02	
28/12/2024 08:00:00	0.53	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.48	0.03	
28/12/2024 08:15:00	0.53	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.49	0.03	
28/12/2024 08:30:00	0.54	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.49	0.02	
28/12/2024 08:45:00	0.54	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.05	0.42	0.07	0.50	0.03	
28/12/2024 09:00:00	0.55	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.05	0.42	0.07	0.50	0.02	
28/12/2024 09:15:00	0.55	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.05	0.43	0.07	0.51	0.02	
28/12/2024 09:30:00	0.56	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.05	0.43	0.07	0.51	0.01	
28/12/2024 09:45:00	0.56	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.06	0.43	0.07	0.52	0.00	
28/12/2024 10:00:00	0.56	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.05	0.43	0.07	0.52	0.00	
28/12/2024 10:15:00	0.57	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.04	0.43	0.07	0.53	0.02	
28/12/2024 10:30:00	0.57	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.07	0.53	0.03	
28/12/2024 10:45:00	0.57	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.06	0.53	0.01	
28/12/2024 11:00:00	0.58	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.06	0.53	0.01	
28/12/2024 11:15:00	0.58	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.05	0.53	0.04	
28/12/2024 11:30:00	0.58	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.05	0.43	0.06	0.51	0.05	
28/12/2024 11:45:00	0.58	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.06	0.43	0.06	0.48	0.08	
28/12/2024 12:00:00	0.58	0.00	0.04	0.02	0.12	0.15	0.07	0.46	0.06	0.43	0.06	0.46	0.07	
28/12/2024 12:15:00	0.58	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.44	0.09	
28/12/2024 12:30:00	0.58	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.07	0.43	0.07	0.42	0.08	
28/12/2024 12:45:00	0.57	0.00	0.04	0.02	0.13	0.15	0.07	0.46	0.06	0.43	0.06	0.41	0.08	
28/12/2024 13:00:00	0.57	0.00	0.04	0.02	0.13	0.15	0.07	0.47	0.07	0.43	0.06	0.39	0.09	
28/12/2024 13:15:00	0.56	0.00	0.05	0.02	0.13	0.15	0.07	0.47	0.07	0.43	0.07	0.38	0.08	
28/12/2024 13:30:00	0.56	0.00	0.05	0.02	0.13	0.15	0.08	0.47	0.06	0.43	0.06	0.37	0.08	
28/12/2024 13:45:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.07	0.43	0.07	0.36	0.09	
28/12/2024 14:00:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.06	0.35	0.08	
28/12/2024 14:15:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.06	0.34	0.07	
28/12/2024 14:30:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.07	0.43	0.06	0.33	0.10	
28/12/2024 14:45:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.43	0.06	0.32	0.07	
28/12/2024 15:00:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.43	0.06	0.31	0.08	
28/12/2024 15:15:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.06	0.31	0.09	
28/12/2024 15:30:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.08	0.30	0.09	
28/12/2024 15:45:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.07	0.30	0.06	
28/12/2024 16:00:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.07	0.29	0.07	
28/12/2024 16:15:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.07	0.42	0.07	0.29	0.08	
28/12/2024 16:30:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.08	0.28	0.07	
28/12/2024 16:45:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.08	0.28	0.08	
28/12/2024 17:00:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.08	0.28	0.07	
28/12/2024 17:15:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.08	0.29	0.05	
28/12/2024 17:30:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.08	0.33	0.05	
28/12/2024 17:45:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.07	0.42	0.08	0.35	0.04	
28/12/2024 18:00:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.08	0.37	0.03	
28/12/2024 18:15:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.08	0.39	0.03	
28/12/2024 18:30:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.08	0.40	0.03	
28/12/2024 18:45:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.42	0.08	0.41	0.03	
28/12/2024 19:00:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.07	0.42	0.04	
28/12/2024 19:15:00	0.50	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.07	0.43	0.03	
28/12/2024 19:30:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.42	0.07	0.44	0.03	
28/12/2024 19:45:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.07	0.45	0.02	
28/12/2024 20:00:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.07	0.45	0.01	
28/12/2024 20:15:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.08	0.46	0.03	
28/12/2024 20:30:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.07	0.42	0.08	0.47	0.03	
28/12/2024 20:45:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.07	0.42	0.07	0.47	0.01	
28/12/2024 21:00:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.07	0.48	0.02	
28/12/2024 21:15:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.07	0.42	0.07	0.48	0.03	
28/12/2024 21:30:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.07	0.49	-0.01	
28/12/2024 21:45:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.07	0.49	0.02	
28/12/2024 22:00:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.07	0.50	0.00	
28/12/2024 22:15:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.07	0.50	0.02	
28/12/2024 22:30:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.42	0.08	0.51	0.03	
28/12/2024 22:45:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.07	0.51	0.01	
28/12/2024 23:00:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.07	0.52	0.02	
28/12/2024 23:15:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.52	0.03	
28/12/2024 23:30:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.07	0.53	0.03	
28/12/2024 23:45:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.53	0.03	
29/12/2024 00:00:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.04	0.43	0.07	0.53	0.02	
29/12/2024 00:15:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.03	0.43	0.06	0.52	0.05	
29/12/2024 00:30:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.04	0.43	0.07	0.50	0.07	
29/12/2024 00:45:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.48	0.06	
29/12/2024 01:00:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.07	0.46	0.07	
29/12/2024 01:15:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.07	0.43	0.07	0.44	0.08	
29/12/2024 01:30:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.04	0.43	0.07	0.42	0.08	
29/12/2024 01:45:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.07	0.43	0.08	0.40	0.07	
29/12/2024 02:00:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.07	0.39	0.08	
29/12/2024 02:15:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.07	0.43	0.07	0.38	0.08	
29/12/2024 02:30:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.07	0.36	0.10	
29/12/2024 02:45:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.06	0.43	0.07	0.35	0.06	
29/12/2024 03:00:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.07	0.43	0.07	0.34	0.09	
29/12/2024 03:15:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.06	0.43	0.07	0.33	0.09	
29/12/2024 03:30:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.07	0.33	0.07	
29/12/2024 03:45:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.06	0.43	0.07	0.32	0.08	
29/12/2024 04:00:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.06	0.43	0.07	0.31	0.10	
29/12/2024 04:15:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.06	0.43	0.07	0.30	0.08	
29/12/2024 04:30:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.05	0.42	0.07	0.30	0.09	
29/12/2024 04:45:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.05	0.42	0.07	0.30	0.06	
29/12/2024 05:00:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.05	0.42	0.07	0.31	0.07	
29/12/2024 05:15:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.44	0.06	0.42	0.07	0.33	0.05	
29/12/2024 05:30:00	0.51	0.00	0.05	0.02	0.13	0.16	0.07	0.44	0.07	0.42	0.07	0.37	0.04	
29/12/2024 05:45:00	0.51	0.00	0.05	0.02	0.13	0.15	0.07	0.44	0.06	0.42	0.08	0.39	0.05	
29/12/2024 06:00:00	0.51	0.00	0.05	0.02	0.13	0.15	0.07	0.44	0.05	0.42	0.09	0.40	0.04	
29/12/2024 06:15:00	0.51	0.00	0.05	0.02	0.13	0.15	0.07	0.44	0.05	0.42	0.08	0.42	0.03	
29/12/2024 06:30:00	0.51	0.00	0.05	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.43	0.03	
29/12/2024 06:45:00	0.51	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.04	0.42	0.07	0.44	0.03	
29/12/2024 07:00:00	0.52	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.04	0.42	0.08	0.45	0.03	
29/12/2024 07:15:00	0.52	0.00	0.05	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.45	0.03	
29/12/2024 07:30:00	0.52	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.46	0.01	
29/12/2024 07:45:00	0.53	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.04	0.42	0.08	0.47	0.03	
29/12/2024 08:00:00	0.53	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.06	0.42	0.07	0.47	0.03	
29/12/2024 08:15:00	0.53	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.48	0.02	
29/12/2024 08:30:00	0.54	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.04	0.42	0.08	0.49	0.01	
29/12/2024 08:45:00	0.54	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.04	0.42	0.07	0.49	-0.01	
29/12/2024 09:00:00	0.54	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.50	0.02	
29/12/2024 09:15:00	0.55	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.50	0.03	
29/12/2024 09:30:00	0.55	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.06	0.42	0.07	0.51	-0.01	
29/12/2024 09:45:00	0.56	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.06	0.42	0.07	0.51	0.01	
29/12/2024 10:00:00	0.56	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.06	0.42	0.07	0.51	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
29/12/2024 10:15:00	0.56	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.06	0.42	0.07	0.52	0.02	
29/12/2024 10:30:00	0.57	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.06	0.43	0.07	0.52	0.02	
29/12/2024 10:45:00	0.57	0.00	0.04	0.01	0.12	0.15	0.07	0.45	0.05	0.43	0.08	0.53	0.01	
29/12/2024 11:00:00	0.57	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.07	0.53	0.01	
29/12/2024 11:15:00	0.58	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.07	0.53	0.02	
29/12/2024 11:30:00	0.58	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.05	0.43	0.08	0.54	0.03	
29/12/2024 11:45:00	0.58	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.07	0.54	0.02	
29/12/2024 12:00:00	0.59	0.00	0.04	0.01	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.54	0.02	
29/12/2024 12:15:00	0.59	0.00	0.04	0.01	0.12	0.15	0.07	0.47	0.07	0.43	0.06	0.54	0.02	
29/12/2024 12:30:00	0.59	0.00	0.04	0.01	0.12	0.15	0.07	0.47	0.06	0.43	0.06	0.52	0.05	
29/12/2024 12:45:00	0.59	0.00	0.04	0.01	0.12	0.15	0.07	0.47	0.05	0.43	0.06	0.50	0.07	
29/12/2024 13:00:00	0.59	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.48	0.08	
29/12/2024 13:15:00	0.59	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.06	0.45	0.07	
29/12/2024 13:30:00	0.58	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.44	0.06	
29/12/2024 13:45:00	0.58	0.00	0.04	0.02	0.13	0.15	0.07	0.47	0.06	0.43	0.07	0.42	0.10	
29/12/2024 14:00:00	0.58	0.00	0.04	0.02	0.13	0.15	0.07	0.47	0.06	0.43	0.07	0.40	0.08	
29/12/2024 14:15:00	0.57	0.00	0.05	0.02	0.13	0.15	0.07	0.47	0.06	0.43	0.07	0.39	0.07	
29/12/2024 14:30:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.07	0.37	0.09	
29/12/2024 14:45:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.07	0.36	0.08	
29/12/2024 15:00:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.07	0.35	0.10	
29/12/2024 15:15:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.07	0.35	0.07	
29/12/2024 15:30:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.43	0.07	0.34	0.09	
29/12/2024 15:45:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.43	0.07	0.33	0.09	
29/12/2024 16:00:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.43	0.08	0.32	0.07	
29/12/2024 16:15:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.43	0.09	0.32	0.07	
29/12/2024 16:30:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.07	0.43	0.08	0.31	0.10	
29/12/2024 16:45:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.09	0.30	0.07	
29/12/2024 17:00:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.06	0.43	0.08	0.30	0.09	
29/12/2024 17:15:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.09	0.30	0.07	
29/12/2024 17:30:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.08	0.32	0.06	
29/12/2024 17:45:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.09	0.35	0.02	
29/12/2024 18:00:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.04	0.42	0.09	0.38	0.05	
29/12/2024 18:15:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.09	0.40	0.03	
29/12/2024 18:30:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.08	0.41	0.04	
29/12/2024 18:45:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.08	0.42	0.04	
29/12/2024 19:00:00	0.51	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.08	0.43	0.03	
29/12/2024 19:15:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.08	0.44	0.04	
29/12/2024 19:30:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.08	0.45	0.02	
29/12/2024 19:45:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.08	0.46	0.03	
29/12/2024 20:00:00	0.52	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.08	0.47	0.03	
29/12/2024 20:15:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.08	0.47	0.02	
29/12/2024 20:30:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.04	0.42	0.08	0.48	0.03	
29/12/2024 20:45:00	0.53	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.08	0.48	0.03	
29/12/2024 21:00:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.04	0.42	0.09	0.49	0.03	
29/12/2024 21:15:00	0.54	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.04	0.42	0.08	0.49	0.04	
29/12/2024 21:30:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.08	0.50	0.03	
29/12/2024 21:45:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.06	0.42	0.08	0.50	0.03	
29/12/2024 22:00:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.04	0.42	0.07	0.51	0.02	
29/12/2024 22:15:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.07	0.51	0.01	
29/12/2024 22:30:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.43	0.08	0.52	0.03	
29/12/2024 22:45:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.52	0.02	
29/12/2024 23:00:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.53	0.03	
29/12/2024 23:15:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.04	0.43	0.07	0.53	0.03	
29/12/2024 23:30:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.03	0.43	0.07	0.53	0.03	
29/12/2024 23:45:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.53	0.03	
30/12/2024 00:00:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.54	0.03	
30/12/2024 00:15:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.54	0.03	
30/12/2024 00:30:00	0.59	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.53	0.05	
30/12/2024 00:45:00	0.59	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.05	0.43	0.07	0.50	0.07	
30/12/2024 01:00:00	0.59	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.04	0.43	0.07	0.48	0.08	
30/12/2024 01:15:00	0.59	0.00	0.05	0.02	0.13	0.16	0.08	0.46	0.04	0.43	0.07	0.46	0.10	
30/12/2024 01:30:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.07	0.44	0.08	
30/12/2024 01:45:00	0.58	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.07	0.42	0.03	
30/12/2024 02:00:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.07	0.40	0.09	
30/12/2024 02:15:00	0.57	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.05	0.43	0.07	0.39	0.07	
30/12/2024 02:30:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.04	0.43	0.07	0.37	0.07	
30/12/2024 02:45:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.04	0.43	0.06	0.36	0.06	
30/12/2024 03:00:00	0.56	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.04	0.43	0.06	0.35	0.08	
30/12/2024 03:15:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.03	0.43	0.07	0.34	0.08	
30/12/2024 03:30:00	0.55	0.00	0.05	0.02	0.13	0.16	0.08	0.45	0.02	0.43	0.07	0.34	0.07	
30/12/2024 03:45:00	0.54	0.00	0.05	0.02	0.13	0.16	0.07	0.45	0.01	0.43	0.07	0.33	0.09	
30/12/2024 04:00:00	0.54	0.00	0.05	0.02	0.13	0.16	0.07	0.44		0.43	0.07	0.32	0.07	
30/12/2024 04:15:00	0.53	0.00	0.05	0.02	0.13	0.16	0.07	0.44		0.43	0.07	0.31	0.07	
30/12/2024 04:30:00	0.53	0.00	0.05	0.02	0.13	0.16	0.07	0.44		0.43	0.08	0.30	0.07	
30/12/2024 04:45:00	0.53	0.00	0.04	0.02	0.12	0.16	0.07	0.44		0.43	0.08	0.30	0.08	
30/12/2024 05:00:00	0.52	0.00	0.04	0.02	0.12	0.16	0.07	0.44		0.43	0.07	0.29	0.08	
30/12/2024 05:15:00	0.52	0.00	0.04	0.02	0.12	0.15	0.07	0.44		0.42	0.07	0.29	0.08	
30/12/2024 05:30:00	0.51	0.00	0.04	0.02	0.12	0.15	0.07	0.44		0.42	0.07	0.28	0.06	
30/12/2024 05:45:00	0.51	0.00	0.04	0.02	0.12	0.15	0.07	0.44		0.42	0.08	0.28	0.07	
30/12/2024 06:00:00	0.51	0.00	0.04	0.02	0.12	0.15	0.07	0.44		0.42	0.08	0.29	0.05	
30/12/2024 06:15:00	0.50	0.00	0.04	0.02	0.12	0.15	0.07	0.44		0.42	0.07	0.30	0.06	
30/12/2024 06:30:00	0.50	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.09	0.33	0.03	
30/12/2024 06:45:00	0.50	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.36	0.03	
30/12/2024 07:00:00	0.50	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.38	0.04	
30/12/2024 07:15:00	0.50	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.39	0.04	
30/12/2024 07:30:00	0.50	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.41	0.02	
30/12/2024 07:45:00	0.50	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.07	0.42	0.08	0.42	0.02	
30/12/2024 08:00:00	0.50	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.04	0.42	0.08	0.43	0.01	
30/12/2024 08:15:00	0.51	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.44	0.03	
30/12/2024 08:30:00	0.51	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.05	0.42	0.09	0.44	0.03	
30/12/2024 08:45:00	0.51	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.45	0.03	
30/12/2024 09:00:00	0.52	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.05	0.42	0.09	0.46	0.00	
30/12/2024 09:15:00	0.52	0.07	0.04	0.01	0.12	0.15	0.07	0.45	0.05	0.42	0.08	0.46	0.01	
30/12/2024 09:30:00	0.52	0.05	0.04	0.01	0.12	0.15	0.07	0.45	0.05	0.42	0.07	0.47	0.02	
30/12/2024 09:45:00	0.53	0.02	0.04	0.01	0.12	0.15	0.07	0.45	0.06	0.42	0.08	0.47	0.01	
30/12/2024 10:00:00	0.53	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.42	0.09	0.48	0.01	
30/12/2024 10:15:00	0.54	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.07	0.42	0.07	0.49	0.02	
30/12/2024 10:30:00	0.54	0.00	0.03	0.01	0.12	0.15	0.07	0.46	0.06	0.42	0.07	0.49	0.01	
30/12/2024 10:45:00	0.54	0.00	0.03	0.01	0.12	0.15	0.07	0.46	0.07	0.42	0.07	0.49	0.03	
30/12/2024 11:00:00	0.55	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.06	0.43	0.07	0.50	0.02	
30/12/2024 11:15:00	0.55	0.00	0.04	0.01	0.12	0.15	0.07	0.46	0.05	0.43	0.08	0.50	0.01	
30/12/2024 11:30:00	0.56	0.00	0.03	0.01	0.12	0.15	0.07	0.47	0.06	0.43	0.08	0.51	0.02	
30/12/2024 11:45:00	0.56	0.00	0.04	0.01	0.12	0.15	0.07	0.47	0.06	0.43	0.09	0.51	0.01	
30/12/2024 12:00:00	0.56	0.00	0.04	0.01	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.52	0.02	
30/12/2024 12:15:00	0.57	0.00	0.04	0.01	0.12	0.15	0.07	0.47	0.06	0.43	0.08	0.52	0.02	
30/12/2024 12:30:00	0.57	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.52	0.00	
30/12/2024 12:45:00	0.57	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.05	0.43	0.07	0.52	0.04	
30/12/2024 13:00:00	0.58	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.50	0.07	
30/12/2024 13:15:00	0.58	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.47	0.03	
30/12/2024 13:30:00	0.58	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.45	0.07	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
30/12/2024 13:45:00	0.57	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.43	0.10	
30/12/2024 14:00:00	0.57	0.00	0.04	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.07	0.41	0.06	
30/12/2024 14:15:00	0.57	0.00	0.05	0.02	0.12	0.15	0.07	0.47	0.05	0.43	0.06	0.39	0.08	
30/12/2024 14:30:00	0.56	0.00	0.05	0.02	0.12	0.15	0.07	0.47	0.06	0.43	0.06	0.38	0.10	
30/12/2024 14:45:00	0.56	0.00	0.05	0.02	0.12	0.16	0.07	0.47	0.06	0.43	0.06	0.37	0.06	
30/12/2024 15:00:00	0.55	0.00	0.05	0.02	0.12	0.16	0.07	0.47	0.05	0.43	0.06	0.36	0.05	
30/12/2024 15:15:00	0.55	0.00	0.05	0.02	0.12	0.16	0.07	0.47	0.06	0.43	0.07	0.35	0.06	
30/12/2024 15:30:00	0.54	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.06	0.43	0.07	0.34	0.04	
30/12/2024 15:45:00	0.54	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.07	0.43	0.06	0.33	0.08	
30/12/2024 16:00:00	0.53	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.06	0.43	0.08	0.32	0.08	
30/12/2024 16:15:00	0.53	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.06	0.43	0.08	0.31	0.07	
30/12/2024 16:30:00	0.53	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.06	0.43	0.09	0.31	0.06	
30/12/2024 16:45:00	0.52	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.43	0.09	0.30	0.07	
30/12/2024 17:00:00	0.52	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.06	0.43	0.08	0.29	0.06	
30/12/2024 17:15:00	0.51	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.09	0.29	0.08	
30/12/2024 17:30:00	0.51	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.09	0.28	0.07	
30/12/2024 17:45:00	0.51	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.08	0.27	0.06	
30/12/2024 18:00:00	0.50	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.05	0.42	0.09	0.27	0.06	
30/12/2024 18:15:00	0.50	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.09	0.28	0.06	
30/12/2024 18:30:00	0.50	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.09	0.29	0.04	
30/12/2024 18:45:00	0.50	0.10	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.08	0.32	0.05	
30/12/2024 19:00:00	0.49	0.09	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.08	0.34	0.03	
30/12/2024 19:15:00	0.49	0.09	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.09	0.36	0.04	
30/12/2024 19:30:00	0.49	0.06	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.09	0.38	0.03	
30/12/2024 19:45:00	0.49	0.03	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.09	0.39	0.05	
30/12/2024 20:00:00	0.49	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.42	0.09	0.40	0.01	
30/12/2024 20:15:00	0.50	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.42	0.08	0.41	0.03	
30/12/2024 20:30:00	0.50	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.42	0.08	0.42	0.03	
30/12/2024 20:45:00	0.50	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.42	0.08	0.43	0.03	
30/12/2024 21:00:00	0.51	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.42	0.08	0.44	0.03	
30/12/2024 21:15:00	0.51	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.06	0.42	0.08	0.44	0.02	
30/12/2024 21:30:00	0.51	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.42	0.09	0.45	0.04	
30/12/2024 21:45:00	0.52	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.06	0.42	0.08	0.46	0.03	
30/12/2024 22:00:00	0.52	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.06	0.42	0.08	0.46	0.03	
30/12/2024 22:15:00	0.52	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.06	0.42	0.08	0.47	0.01	
30/12/2024 22:30:00	0.53	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.42	0.08	0.47	0.03	
30/12/2024 22:45:00	0.53	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.04	0.42	0.09	0.48	0.02	
30/12/2024 23:00:00	0.53	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.04	0.42	0.08	0.48	0.02	
30/12/2024 23:15:00	0.54	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.04	0.42	0.08	0.49	0.02	
30/12/2024 23:30:00	0.54	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.05	0.42	0.07	0.49	0.02	
30/12/2024 23:45:00	0.55	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.05	0.42	0.07	0.50	0.01	
31/12/2024 00:00:00	0.55	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.06	0.42	0.08	0.50	0.02	
31/12/2024 00:15:00	0.55	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.05	0.42	0.07	0.51	0.03	
31/12/2024 00:30:00	0.56	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.05	0.42	0.07	0.51	0.02	
31/12/2024 00:45:00	0.56	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.04	0.43	0.07	0.51	0.03	
31/12/2024 01:00:00	0.56	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.04	0.43	0.08	0.52	0.03	
31/12/2024 01:15:00	0.57	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.04	0.43	0.07	0.52	0.02	
31/12/2024 01:30:00	0.57	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.04	0.43	0.08	0.51	0.04	
31/12/2024 01:45:00	0.57	0.00	0.05	0.02	0.13	0.16	0.07	0.46	0.04	0.43	0.07	0.48	0.05	
31/12/2024 02:00:00	0.57	0.00	0.05	0.02	0.13	0.16	0.07	0.45	0.04	0.43	0.07	0.46	0.06	
31/12/2024 02:15:00	0.57	0.00	0.05	0.02	0.13	0.16	0.07	0.45	0.05	0.43	0.08	0.44	0.07	
31/12/2024 02:30:00	0.57	0.00	0.05	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.07	0.42	0.08	
31/12/2024 02:45:00	0.56	0.00	0.05	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.07	0.40	0.08	
31/12/2024 03:00:00	0.56	0.00	0.05	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.07	0.38	0.08	
31/12/2024 03:15:00	0.56	0.00	0.05	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.08	0.37	0.05	
31/12/2024 03:30:00	0.55	0.00	0.04	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.07	0.36	0.08	
31/12/2024 03:45:00	0.55	0.00	0.04	0.02	0.12	0.16	0.07	0.45	0.04	0.43	0.07	0.35	0.07	
31/12/2024 04:00:00	0.54	0.00	0.04	0.02	0.12	0.16	0.07	0.45	0.04	0.43	0.07	0.34	0.06	
31/12/2024 04:15:00	0.54	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.04	0.43	0.07	0.33	0.07	
31/12/2024 04:30:00	0.53	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.04	0.43	0.07	0.32	0.06	
31/12/2024 04:45:00	0.53	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.04	0.43	0.07	0.31	0.07	
31/12/2024 05:00:00	0.53	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.04	0.43	0.08	0.30	0.05	
31/12/2024 05:15:00	0.52	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.04	0.43	0.07	0.30	0.06	
31/12/2024 05:30:00	0.52	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.04	0.42	0.07	0.29	0.08	
31/12/2024 05:45:00	0.51	0.00	0.04	0.02	0.12	0.15	0.07	0.45	0.04	0.42	0.07	0.28	0.06	
31/12/2024 06:00:00	0.51	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.04	0.42	0.07	0.28	0.07	
31/12/2024 06:15:00	0.51	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.04	0.42	0.07	0.27	0.06	
31/12/2024 06:30:00	0.50	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.27	0.05	
31/12/2024 06:45:00	0.50	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.28	0.07	
31/12/2024 07:00:00	0.50	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.30	0.06	
31/12/2024 07:15:00	0.50	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.32	0.04	
31/12/2024 07:30:00	0.49	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.04	0.42	0.07	0.34	0.03	
31/12/2024 07:45:00	0.49	0.00	0.04	0.02	0.12	0.15	0.07	0.44	0.06	0.42	0.08	0.36	0.02	
31/12/2024 08:00:00	0.49	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.38	0.02	
31/12/2024 08:15:00	0.49	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.05	0.42	0.08	0.39	0.02	
31/12/2024 08:30:00	0.50	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.04	0.42	0.07	0.40	0.02	
31/12/2024 08:45:00	0.50	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.05	0.42	0.07	0.41	0.03	
31/12/2024 09:00:00	0.50	0.00	0.04	0.01	0.12	0.15	0.07	0.44	0.04	0.42	0.08	0.42	0.00	
31/12/2024 09:15:00	0.50	0.00	0.04	0.01	0.12	0.15	0.06	0.45	0.05	0.42	0.06	0.43	0.02	
31/12/2024 09:30:00	0.51	0.00	0.04	0.01	0.12	0.15	0.06	0.45	0.05	0.42	0.06	0.43	0.01	
31/12/2024 09:45:00	0.51	0.00	0.04	0.01	0.12	0.15	0.06	0.45	0.05	0.42	0.06	0.44	0.02	
31/12/2024 10:00:00	0.51	0.00	0.04	0.01	0.12	0.15	0.06	0.45	0.05	0.42	0.06	0.45	0.02	
31/12/2024 10:15:00	0.52	0.00	0.03	0.01	0.12	0.15	0.06	0.45	0.06	0.42	0.06	0.45	0.00	
31/12/2024 10:30:00	0.52	0.00	0.03	0.01	0.11	0.15	0.06	0.46	0.06	0.42	0.07	0.46	0.03	
31/12/2024 10:45:00	0.53	0.00	0.03	0.01	0.11	0.15	0.06	0.46	0.00	0.42	0.07	0.47	0.00	
31/12/2024 11:00:00	0.53	0.00	0.03	0.01	0.11	0.15	0.06	0.46	0.06	0.42	0.07	0.47	0.01	
31/12/2024 11:15:00	0.53	0.00	0.03	0.01	0.12	0.15	0.07	0.47	0.04	0.42	0.07	0.48	0.00	
31/12/2024 11:30:00	0.54	0.00	0.03	0.01	0.12	0.15	0.07	0.47	0.05	0.42	0.06	0.48	0.02	
31/12/2024 11:45:00	0.54	0.00	0.03	0.01	0.12	0.15	0.07	0.47	0.05	0.42	0.07	0.48	0.00	
31/12/2024 12:00:00	0.54	0.00	0.04	0.01	0.12	0.15	0.07	0.47	0.05	0.42	0.06	0.49	0.00	
31/12/2024 12:15:00	0.55	0.00	0.04	0.01	0.12	0.15	0.07	0.47	0.06	0.42	0.08	0.49	0.01	
31/12/2024 12:30:00	0.55	0.07	0.04	0.01	0.12	0.15	0.07	0.47	0.05	0.42	0.06	0.50	0.03	
31/12/2024 12:45:00	0.56	0.06	0.04	0.01	0.12	0.15	0.07	0.47	0.06	0.43	0.06	0.50	0.03	
31/12/2024 13:00:00	0.56	0.06	0.04	0.01	0.12	0.15	0.07	0.47	0.05	0.43	0.07	0.49	0.05	
31/12/2024 13:15:00	0.56	0.06	0.04	0.01	0.12	0.15	0.07	0.47	0.06	0.42	0.07	0.46	0.05	
31/12/2024 13:30:00	0.56	0.06	0.04	0.02	0.12	0.16	0.07	0.47	0.05	0.43	0.06	0.44	0.07	
31/12/2024 13:45:00	0.56	0.07	0.04	0.02	0.12	0.16	0.07	0.47	0.06	0.43	0.07	0.42	0.07	
31/12/2024 14:00:00	0.56	0.05	0.04	0.02	0.12	0.16	0.07	0.47	0.06	0.43	0.07	0.40	0.09	
31/12/2024 14:15:00	0.55	0.02	0.04	0.02	0.12	0.16	0.07	0.47	0.06	0.43	0.06	0.38	0.06	
31/12/2024 14:30:00	0.55	0.00	0.04	0.02	0.12	0.16	0.07	0.47	0.06	0.43	0.07	0.36	0.08	
31/12/2024 14:45:00	0.55	0.10	0.04	0.02	0.12	0.16	0.07	0.47	0.05	0.43	0.06	0.35	0.05	
31/12/2024 15:00:00	0.54	0.08	0.05	0.02	0.12	0.16	0.07	0.47	0.06	0.43	0.08	0.34	0.03	
31/12/2024 15:15:00	0.54	0.10	0.05	0.02	0.12	0.16	0.07	0.47	0.06	0.43	0.06	0.33	0.04	
31/12/2024 15:30:00	0.53	0.07	0.05	0.02	0.12	0.16	0.07	0.47	0.06	0.43	0.07	0.32	0.11	
31/12/2024 15:45:00	0.53	0.03	0.05	0.02	0.12	0.16	0.07	0.47	0.05	0.43	0.08	0.31	0.05	
31/12/2024 16:00:00	0.53	0.00	0.05	0.02	0.12	0.16	0.07	0.47	0.04	0.43	0.06	0.30	0.06	
31/12/2024 16:15:00	0.52	0.00	0.05	0.02	0.12	0.16	0.07	0.47	0.04	0.43	0.08	0.29	0.07	
31/12/2024 16:30:00	0.52	0.00	0.05	0.02	0.12	0.16	0.07	0.47	0.05	0.42	0.09	0.29	0.05	
31/12/2024 16:45:00	0.51	0.00	0.05	0.02	0.12	0.16	0.07	0.47	0.05	0.42	0.09	0.28	0.07	
31/12/2024 17:00:00	0.51	0.00	0.05	0.02	0.12	0.16	0.07	0.47	0.04	0.42	0.09	0.28	0.08	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
31/12/2024 17:15:00	0.51	0.00	0.05	0.02	0.12	0.16	0.07	0.47	0.04	0.42	0.08	0.27	0.08	
31/12/2024 17:30:00	0.50	0.00	0.05	0.02	0.12	0.16	0.07	0.47	0.05	0.42	0.08	0.27	0.05	
31/12/2024 17:45:00	0.50	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.42	0.08	0.26	0.07	
31/12/2024 18:00:00	0.50	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.04	0.42	0.08	0.25	0.04	
31/12/2024 18:15:00	0.50	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.42	0.08	0.25	0.08	
31/12/2024 18:30:00	0.49	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.05	0.42	0.08	0.25	0.08	
31/12/2024 18:45:00	0.49	0.00	0.05	0.02	0.13	0.16	0.07	0.47	0.04	0.42	0.08	0.24	0.06	
31/12/2024 19:00:00	0.49	0.00	0.05	0.02	0.13	0.16	0.07	0.48	0.05	0.42	0.08	0.24	0.06	
31/12/2024 19:15:00	0.48	0.10	0.05	0.02	0.13	0.16	0.07	0.48	0.06	0.42	0.08	0.23	0.07	
31/12/2024 19:30:00	0.48	0.10	0.05	0.02	0.13	0.16	0.07	0.48	0.05	0.42	0.08	0.23	0.06	
31/12/2024 19:45:00	0.48	0.10	0.05	0.02	0.13	0.16	0.07	0.48	-0.07	0.42	0.08	0.23	0.06	
31/12/2024 20:00:00	0.48	0.10	0.05	0.02	0.13	0.16	0.07	0.48	0.05	0.42	0.08	0.23	0.07	
31/12/2024 20:15:00	0.48	0.10	0.05	0.02	0.13	0.16	0.07	0.48	0.06	0.42	0.08	0.24	0.06	
31/12/2024 20:30:00	0.48	0.09	0.05	0.02	0.13	0.16	0.08	0.48	0.05	0.42	0.08	0.24	0.06	
31/12/2024 20:45:00	0.47	0.09	0.05	0.02	0.13	0.16	0.08	0.48	0.05	0.42	0.08	0.26	0.05	
31/12/2024 21:00:00	0.47	0.09	0.05	0.02	0.13	0.16	0.08	0.48	0.04	0.42	0.08	0.29	0.04	
31/12/2024 21:15:00	0.47	0.09	0.05	0.02	0.13	0.16	0.08	0.48	-0.03	0.42	0.09	0.31	0.04	
31/12/2024 21:30:00	0.47	0.10	0.05	0.02	0.13	0.16	0.08	0.48	0.01	0.42	0.08	0.32	0.05	
31/12/2024 21:45:00	0.47	0.08	0.05	0.02	0.13	0.16	0.08	0.48	0.04	0.42	0.08	0.34	0.04	
31/12/2024 22:00:00	0.47	0.08	0.05	0.02	0.13	0.16	0.08	0.48	0.05	0.42	0.08	0.35	0.03	
31/12/2024 22:15:00	0.48	0.09	0.05	0.02	0.13	0.16	0.08	0.48	0.05	0.42	0.08	0.36	0.03	
31/12/2024 22:30:00	0.48	0.06	0.05	0.02	0.13	0.16	0.08	0.47	0.05	0.42	0.08	0.37	0.02	
31/12/2024 22:45:00	0.48	0.03	0.05	0.02	0.13	0.16	0.08	0.47	0.03	0.42	0.08	0.38	0.03	
31/12/2024 23:00:00	0.48	0.00	0.05	0.02	0.13	0.16	0.08	0.47	-0.01	0.42	0.07	0.39	0.03	
31/12/2024 23:15:00	0.49	0.00	0.05	0.02	0.13	0.17	0.08	0.47	0.05	0.42	0.07	0.40	0.03	
31/12/2024 23:30:00	0.49	0.09	0.05	0.02	0.13	0.17	0.08	0.47	0.04	0.42	0.07	0.41	0.03	
31/12/2024 23:45:00	0.50	0.08	0.05	0.02	0.13	0.17	0.08	0.47	0.05	0.42	0.07	0.42	0.03	
01/01/2025 00:00:00	0.50	0.08	0.05	0.02	0.13	0.17	0.08	0.47	-0.05	0.42	0.07	0.42	0.03	
01/01/2025 00:15:00	0.50	0.08	0.05	0.02	0.13	0.17	0.08	0.47	0.04	0.42	0.08	0.43	0.02	
01/01/2025 00:30:00	0.51	0.08	0.05	0.02	0.13	0.17	0.08	0.47	0.05	0.42	0.09	0.44	0.01	
01/01/2025 00:45:00	0.51	0.07	0.05	0.02	0.13	0.17	0.08	0.47	0.04	0.42	0.08	0.44	0.03	
01/01/2025 01:00:00	0.51	0.07	0.05	0.02	0.13	0.17	0.08	0.47	0.05	0.42	0.09	0.43	0.06	
01/01/2025 01:15:00	0.52	0.06	0.05	0.02	0.13	0.17	0.07	0.46	0.05	0.42	0.08	0.41	0.04	
01/01/2025 01:30:00	0.52	0.07	0.05	0.02	0.13	0.17	0.08	0.46	-0.07	0.42	0.08	0.39	0.07	
01/01/2025 01:45:00	0.52	0.04	0.05	0.02	0.13	0.17	0.07	0.46	-0.07	0.42	0.08	0.37	0.08	
01/01/2025 02:00:00	0.52	0.02	0.05	0.02	0.13	0.17	0.07	0.46	0.04	0.43	0.09	0.35	0.05	
01/01/2025 02:15:00	0.52	0.00	0.05	0.02	0.13	0.17	0.07	0.46	0.04	0.43	0.09	0.33	0.06	
01/01/2025 02:30:00	0.52	0.00	0.05	0.02	0.13	0.17	0.07	0.46	0.04	0.43	0.08	0.32	0.08	
01/01/2025 02:45:00	0.51	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.04	0.42	0.09	0.31	0.09	
01/01/2025 03:00:00	0.51	0.00	0.05	0.02	0.12	0.17	0.07	0.46	-0.02	0.43	0.08	0.29	0.06	
01/01/2025 03:15:00	0.51	0.00	0.05	0.02	0.12	0.17	0.07	0.46	-0.08	0.43	0.08	0.28	0.07	
01/01/2025 03:30:00	0.50	0.00	0.05	0.02	0.12	0.17	0.07	0.46	-0.06	0.43	0.09	0.27	0.05	
01/01/2025 03:45:00	0.50	0.00	0.05	0.02	0.12	0.17	0.07	0.46	-0.05	0.42	0.08	0.27	0.08	
01/01/2025 04:00:00	0.50	0.00	0.04	0.02	0.12	0.17	0.07	0.46	-0.03	0.43	0.08	0.26	0.08	
01/01/2025 04:15:00	0.50	0.00	0.04	0.02	0.12	0.17	0.07	0.45	0.04	0.43	0.08	0.25	0.07	
01/01/2025 04:30:00	0.49	0.00	0.04	0.02	0.12	0.17	0.07	0.46	0.01	0.43	0.09	0.25	0.07	
01/01/2025 04:45:00	0.49	0.00	0.04	0.02	0.12	0.17	0.07	0.46	-0.01	0.42	0.08	0.24	0.08	
01/01/2025 05:00:00	0.49	0.00	0.04	0.02	0.12	0.17	0.07	0.46	0.02	0.43	0.09	0.24	0.07	
01/01/2025 05:15:00	0.49	0.09	0.04	0.02	0.12	0.17	0.07	0.46	0.05	0.43	0.08	0.24	0.06	
01/01/2025 05:30:00	0.48	0.09	0.04	0.02	0.12	0.17	0.07	0.46	0.05	0.43	0.08	0.23	0.05	
01/01/2025 05:45:00	0.48	0.08	0.04	0.02	0.12	0.17	0.07	0.46	0.05	0.42	0.09	0.23	0.08	
01/01/2025 06:00:00	0.48	0.09	0.04	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.09	0.23	0.07	
01/01/2025 06:15:00	0.48	0.08	0.04	0.02	0.12	0.17	0.07	0.46	0.05	0.43	0.08	0.23	0.06	
01/01/2025 06:30:00	0.48	0.07	0.04	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.08	0.23	0.07	
01/01/2025 06:45:00	0.48	0.07	0.04	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.08	0.22	0.06	
01/01/2025 07:00:00	0.47	0.07	0.04	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.08	0.22	0.06	
01/01/2025 07:15:00	0.47	0.07	0.04	0.02	0.12	0.16	0.07	0.45	0.05	0.42	0.09	0.23	0.05	
01/01/2025 07:30:00	0.47	0.08	0.04	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.08	0.25	0.04	
01/01/2025 07:45:00	0.47	0.08	0.04	0.01	0.12	0.16	0.07	0.45	0.05	0.43	0.09	0.27	0.06	
01/01/2025 08:00:00	0.47	0.09	0.04	0.01	0.12	0.16	0.07	0.45	0.04	0.43	0.08	0.30	0.05	
01/01/2025 08:15:00	0.47	0.09	0.04	0.01	0.12	0.16	0.07	0.45	0.05	0.42	0.09	0.31	0.03	
01/01/2025 08:30:00	0.47	0.07	0.04	0.01	0.12	0.16	0.07	0.45	-0.01	0.43	0.09	0.33	0.04	
01/01/2025 08:45:00	0.47	0.08	0.04	0.02	0.12	0.16	0.07	0.45	0.04	0.43	0.08	0.34	0.03	
01/01/2025 09:00:00	0.47	0.08	0.04	0.01	0.12	0.16	0.07	0.45	0.04	0.42	0.09	0.35	0.03	
01/01/2025 09:15:00	0.47	0.07	0.04	0.02	0.12	0.16	0.07	0.45	0.01	0.43	0.09	0.36	0.03	
01/01/2025 09:30:00	0.48	0.07	0.04	0.02	0.12	0.16	0.07	0.45	0.05	0.43	0.09	0.37	0.01	
01/01/2025 09:45:00	0.48	0.07	0.04	0.01	0.11	0.16	0.06	0.46	0.05	0.43	0.08	0.38	0.01	
01/01/2025 10:00:00	0.48	0.07	0.04	0.01	0.11	0.16	0.06	0.46	0.05	0.43	0.09	0.39	0.01	
01/01/2025 10:15:00	0.48	0.08	0.04	0.01	0.11	0.16	0.06	0.46	0.05	0.43	0.09	0.40	0.01	
01/01/2025 10:30:00	0.49	0.07	0.04	0.01	0.11	0.16	0.06	0.46	0.05	0.43	0.09	0.40	0.04	
01/01/2025 10:45:00	0.49	0.07	0.04	0.01	0.11	0.16	0.06	0.46	0.02	0.43	0.08	0.41	0.02	
01/01/2025 11:00:00	0.50	0.08	0.03	0.01	0.12	0.16	0.07	0.46	0.05	0.43	0.08	0.41	0.02	
01/01/2025 11:15:00	0.50	0.09	0.03	0.01	0.11	0.16	0.06	0.46	0.05	0.43	0.08	0.42	0.02	
01/01/2025 11:30:00	0.51	0.08	0.03	0.01	0.11	0.16	0.06	0.47	-0.06	0.43	0.07	0.43	0.01	
01/01/2025 11:45:00	0.51	0.07	0.04	0.01	0.12	0.16	0.07	0.47	0.03	0.43	0.08	0.44	0.04	
01/01/2025 12:00:00	0.51	0.07	0.04	0.01	0.12	0.16	0.07	0.47	0.04	0.43	0.09	0.45	0.03	
01/01/2025 12:15:00	0.52	0.07	0.05	0.02	0.12	0.17	0.07	0.47	0.05	0.43	0.09	0.46	0.04	
01/01/2025 12:30:00	0.52	0.08	0.05	0.02	0.12	0.17	0.07	0.51	0.12	0.43	0.10	0.46	0.03	
01/01/2025 12:45:00	0.53	0.08	0.05	0.02	0.12	0.17	0.07	0.56	0.10	0.43	0.09	0.47	0.03	
01/01/2025 13:00:00	0.53	0.07	0.04	0.02	0.12	0.17	0.07	0.57	0.10	0.44	0.09	0.47	0.03	
01/01/2025 13:15:00	0.54	0.09	0.05	0.02	0.13	0.17	0.07	0.58	0.09	0.44	0.09	0.48	0.03	
01/01/2025 13:30:00	0.54	0.07	0.05	0.02	0.13	0.17	0.08	0.58	0.08	0.44	0.09	0.49	0.03	
01/01/2025 13:45:00	0.54	0.07	0.06	0.03	0.14	0.18	0.09	0.58	0.09	0.44	0.09	0.49	0.03	
01/01/2025 14:00:00	0.55	0.07	0.06	0.03	0.15	0.19	0.10	0.58	0.09	0.44	0.09	0.49	0.03	
01/01/2025 14:15:00	0.55	0.07	0.06	0.03	0.15	0.19	0.10	0.58	0.10	0.44	0.09	0.50	0.02	
01/01/2025 14:30:00	0.56	0.07	0.07	0.04	0.16	0.20	0.11	0.58	0.08	0.44	0.09	0.50	0.03	
01/01/2025 14:45:00	0.56	0.08	0.08	0.04	0.16	0.20	0.11	0.58	0.08	0.45	0.09	0.50	0.02	
01/01/2025 15:00:00	0.57	0.07	0.08	0.04	0.17	0.20	0.11	0.58	0.07	0.45	0.09	0.49	0.06	
01/01/2025 15:15:00	0.57	0.07	0.08	0.05	0.17	0.20	0.12	0.58	0.09	0.45	0.09	0.48	0.07	
01/01/2025 15:30:00	0.57	0.08	0.09	0.05	0.17	0.21	0.12	0.58	0.09	0.45	0.09	0.46	0.08	
01/01/2025 15:45:00	0.57	0.08	0.10	0.06	0.18	0.21	0.12	0.58	0.07	0.45	0.09	0.45	0.06	
01/01/2025 16:00:00	0.57	0.05	0.10	0.06	0.18	0.21	0.12	0.58	0.08	0.45	0.09	0.43	0.05	
01/01/2025 16:15:00	0.57	0.03	0.10	0.06	0.18	0.21	0.13	0.58	0.08	0.46	0.09	0.42	0.09	
01/01/2025 16:30:00	0.57	0.00	0.11	0.07	0.18	0.21	0.13	0.57	0.06	0.46	0.09	0.41	0.09	
01/01/2025 16:45:00	0.57	0.00	0.11	0.07	0.18	0.21	0.13	0.56	0.07	0.46	0.09	0.40	0.09	
01/01/2025 17:00:00	0.57	0.00	0.11	0.07	0.18	0.21	0.13	0.56	0.06	0.46	0.10	0.39	0.07	
01/01/2025 17:15:00	0.56	0.00	0.11	0.07	0.18	0.22	0.13	0.55	0.06	0.46	0.10	0.38	0.05	
01/01/2025 17:30:00	0.56	0.00	0.11	0.07	0.19	0.22	0.13	0.55	0.07	0.46	0.10	0.38	0.07	
01/01/2025 17:45:00	0.56	0.00	0.11	0.07	0.18	0.22	0.13	0.54	0.06	0.46	0.11	0.38	0.05	
01/01/2025 18:00:00	0.56	0.00	0.11	0.07	0.18	0.22	0.13	0.54	0.06	0.46	0.10	0.38	0.04	
01/01/2025 18:15:00	0.55	0.00	0.11	0.07	0.18	0.22	0.13	0.54	0.06	0.46	0.10	0.40	0.05	
01/01/2025 18:30:00	0.55	0.00	0.11	0.07	0.18	0.22	0.13	0.54	0.06	0.46	0.10	0.42	0.03	
01/01/2025 18:45:00	0.55	0.00	0.11	0.07	0.18	0.22	0.13	0.53	0.06	0.46	0.09	0.44	0.04	
01/01/2025 19:00:00	0.55	0.00	0.11	0.07	0.18	0.22	0.13	0.53	0.06	0.46	0.10	0.45	0.03	
01/01/2025 19:15:00	0.56	0.00	0.11	0.07	0.18	0.22	0.13	0.53	0.08	0.46	0.11	0.46	0.03	
01/01/2025 19:30:00	0.56	0.00	0.11	0.07	0.18	0.22	0.13	0.53	0.07	0.46	0.11	0.47	0.03	
01/01/2025 19:45:00	0.56	0.00	0.11	0.07	0.18	0.22	0.13	0.53	0.05	0.46	0.11	0.48	0.04	
01/01/2025 20:00:00	0.56	0.00	0.11	0.07	0.18	0.21	0.13	0.53	0.07	0.46	0.11	0.49	0.03	
01/01/2025 20:15:00	0.57	0.00	0.11	0.07	0.18	0.21	0.13	0.53	0.05	0.46	0.11	0.50	0.04	
01/01/2025 20:30:00	0.57	0.00	0.11	0.07	0.18	0.21	0.13	0.52	0.06	0.46	0.11	0.50	0.04	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
01/01/2025 20:45:00	0.57	0.00	0.10	0.06	0.18	0.21	0.13	0.52	0.06	0.46	0.10	0.51	0.03	
01/01/2025 21:00:00	0.58	0.00	0.11	0.07	0.18	0.21	0.12	0.52	0.04	0.46	0.11	0.52	0.03	
01/01/2025 21:15:00	0.58	0.00	0.11	0.07	0.18	0.21	0.12	0.52	0.05	0.46	0.11	0.52	0.04	
01/01/2025 21:30:00	0.59	0.00	0.10	0.06	0.18	0.21	0.12	0.52	0.06	0.46	0.11	0.53	0.04	
01/01/2025 21:45:00	0.59	0.00	0.10	0.06	0.18	0.21	0.12	0.52	0.06	0.47	0.11	0.53	0.04	
01/01/2025 22:00:00	0.59	0.00	0.10	0.06	0.17	0.21	0.12	0.51	0.07	0.47	0.11	0.54	0.04	
01/01/2025 22:15:00	0.60	0.00	0.10	0.06	0.17	0.21	0.12	0.52	0.06	0.47	0.11	0.54	0.04	
01/01/2025 22:30:00	0.60	0.00	0.10	0.06	0.17	0.21	0.12	0.51	0.06	0.47	0.11	0.55	0.04	
01/01/2025 22:45:00	0.60	0.00	0.10	0.06	0.17	0.21	0.12	0.51	0.06	0.47	0.11	0.55	0.04	
01/01/2025 23:00:00	0.61	0.00	0.10	0.06	0.17	0.21	0.12	0.51	0.06	0.47	0.11	0.56	0.05	
01/01/2025 23:15:00	0.61	0.00	0.10	0.06	0.17	0.21	0.12	0.51	0.06	0.47	0.11	0.56	0.04	
01/01/2025 23:30:00	0.62	0.00	0.10	0.06	0.17	0.21	0.12	0.51	0.06	0.48	0.11	0.57	0.03	
01/01/2025 23:45:00	0.62	0.00	0.10	0.06	0.17	0.21	0.11	0.51	0.06	0.48	0.11	0.57	0.04	
02/01/2025 00:00:00	0.62	0.00	0.09	0.05	0.17	0.21	0.11	0.51	0.06	0.48	0.11	0.57	0.03	
02/01/2025 00:15:00	0.63	0.00	0.09	0.05	0.17	0.21	0.11	0.51	0.06	0.48	0.11	0.57	0.04	
02/01/2025 00:30:00	0.63	0.00	0.09	0.05	0.17	0.20	0.11	0.51	0.06	0.48	0.12	0.58	0.04	
02/01/2025 00:45:00	0.63	0.00	0.09	0.05	0.17	0.20	0.11	0.51	0.06	0.48	0.11	0.58	0.04	
02/01/2025 01:00:00	0.64	0.00	0.09	0.05	0.17	0.20	0.11	0.51	0.06	0.48	0.11	0.59	0.04	
02/01/2025 01:15:00	0.64	0.00	0.09	0.05	0.16	0.20	0.11	0.50	0.06	0.48	0.11	0.59	0.04	
02/01/2025 01:30:00	0.65	0.00	0.09	0.05	0.16	0.20	0.11	0.50	0.06	0.49	0.12	0.59	0.04	
02/01/2025 01:45:00	0.65	0.00	0.09	0.05	0.16	0.20	0.11	0.50	0.06	0.49	0.11	0.60	0.04	
02/01/2025 02:00:00	0.65	0.00	0.09	0.05	0.16	0.20	0.11	0.50	0.06	0.49	0.10	0.60	0.04	
02/01/2025 02:15:00	0.66	0.00	0.09	0.05	0.16	0.20	0.11	0.50	0.06	0.49	0.10	0.61	0.04	
02/01/2025 02:30:00	0.66	0.00	0.09	0.05	0.16	0.20	0.11	0.50	0.06	0.49	0.11	0.61	0.04	
02/01/2025 02:45:00	0.66	0.00	0.09	0.05	0.16	0.20	0.11	0.50	0.06	0.49	0.11	0.61	0.03	
02/01/2025 03:00:00	0.66	0.00	0.08	0.05	0.16	0.20	0.11	0.50	0.06	0.49	0.11	0.62	0.03	
02/01/2025 03:15:00	0.67	0.00	0.08	0.05	0.16	0.20	0.11	0.50	0.05	0.49	0.11	0.62	0.05	
02/01/2025 03:30:00	0.67	0.00	0.08	0.05	0.16	0.20	0.10	0.49	0.06	0.50	0.11	0.59	0.08	
02/01/2025 03:45:00	0.67	0.00	0.08	0.04	0.16	0.20	0.10	0.49	0.06	0.50	0.11	0.57	0.09	
02/01/2025 04:00:00	0.67	0.00	0.08	0.04	0.16	0.20	0.10	0.49	0.06	0.50	0.11	0.54	0.09	
02/01/2025 04:15:00	0.67	0.00	0.08	0.04	0.16	0.20	0.10	0.49	0.06	0.50	0.11	0.52	0.09	
02/01/2025 04:30:00	0.66	0.00	0.08	0.04	0.16	0.20	0.10	0.49	0.06	0.50	0.10	0.50	0.11	
02/01/2025 04:45:00	0.66	0.00	0.08	0.04	0.15	0.20	0.10	0.49	0.06	0.50	0.11	0.49	0.10	
02/01/2025 05:00:00	0.65	0.00	0.08	0.04	0.15	0.20	0.10	0.49	0.05	0.50	0.11	0.47	0.07	
02/01/2025 05:15:00	0.65	0.00	0.08	0.04	0.15	0.19	0.10	0.49	0.07	0.50	0.11	0.46	0.11	
02/01/2025 05:30:00	0.64	0.00	0.08	0.04	0.15	0.19	0.10	0.49	0.06	0.49	0.11	0.45	0.11	
02/01/2025 05:45:00	0.64	0.00	0.08	0.04	0.15	0.19	0.10	0.49	0.05	0.49	0.11	0.44	0.10	
02/01/2025 06:00:00	0.63	0.00	0.08	0.04	0.15	0.19	0.10	0.49	0.05	0.49	0.11	0.43	0.07	
02/01/2025 06:15:00	0.63	0.00	0.08	0.04	0.15	0.19	0.10	0.49	0.06	0.49	0.12	0.42	0.09	
02/01/2025 06:30:00	0.62	0.00	0.08	0.04	0.15	0.19	0.10	0.49	0.05	0.49	0.11	0.41	0.10	
02/01/2025 06:45:00	0.62	0.00	0.08	0.04	0.15	0.19	0.10	0.49	0.05	0.49	0.11	0.41	0.11	
02/01/2025 07:00:00	0.61	0.00	0.08	0.04	0.15	0.19	0.10	0.49	0.06	0.49	0.12	0.40	0.10	
02/01/2025 07:15:00	0.61	0.00	0.07	0.04	0.15	0.19	0.10	0.49	0.06	0.49	0.10	0.40	0.09	
02/01/2025 07:30:00	0.60	0.00	0.07	0.04	0.15	0.19	0.10	0.49	0.06	0.49	0.10	0.39	0.11	
02/01/2025 07:45:00	0.60	0.00	0.07	0.04	0.15	0.19	0.09	0.48	0.06	0.48	0.10	0.40	0.07	
02/01/2025 08:00:00	0.60	0.00	0.07	0.04	0.15	0.19	0.09	0.48	0.05	0.48	0.11	0.42	0.06	
02/01/2025 08:15:00	0.59	0.00	0.07	0.04	0.15	0.19	0.09	0.48	0.06	0.48	0.10	0.45	0.04	
02/01/2025 08:30:00	0.59	0.00	0.07	0.04	0.15	0.19	0.09	0.48	0.06	0.48	0.09	0.47	0.02	
02/01/2025 08:45:00	0.59	0.00	0.07	0.04	0.15	0.19	0.09	0.48	0.06	0.48	0.11	0.49	0.04	
02/01/2025 09:00:00	0.59	0.00	0.07	0.04	0.15	0.19	0.09	0.48	0.06	0.48	0.11	0.50	0.02	
02/01/2025 09:15:00	0.59	0.00	0.07	0.04	0.15	0.19	0.09	0.49	0.06	0.48	0.11	0.51	0.02	
02/01/2025 09:30:00	0.60	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.06	0.48	0.10	0.52	0.00	
02/01/2025 09:45:00	0.60	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.05	0.48	0.11	0.53	0.01	
02/01/2025 10:00:00	0.60	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.05	0.48	0.11	0.54	0.02	
02/01/2025 10:15:00	0.61	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.05	0.48	0.10	0.55	0.01	
02/01/2025 10:30:00	0.61	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.06	0.48	0.10	0.56	0.02	
02/01/2025 10:45:00	0.62	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.05	0.48	0.09	0.56	0.02	
02/01/2025 11:00:00	0.62	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.05	0.48	0.10	0.57	0.02	
02/01/2025 11:15:00	0.63	0.00	0.07	0.04	0.14	0.19	0.09	0.50	0.06	0.48	0.11	0.57	0.02	
02/01/2025 11:30:00	0.63	0.00	0.07	0.03	0.14	0.19	0.09	0.50	0.05	0.48	0.10	0.58	0.02	
02/01/2025 11:45:00	0.63	0.00	0.07	0.03	0.14	0.19	0.09	0.49	0.06	0.48	0.11	0.59	0.02	
02/01/2025 12:00:00	0.64	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.04	0.49	0.10	0.59	0.01	
02/01/2025 12:15:00	0.64	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.04	0.49	0.11	0.60	0.02	
02/01/2025 12:30:00	0.65	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.05	0.49	0.11	0.60	0.02	
02/01/2025 12:45:00	0.65	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.05	0.49	0.11	0.61	0.02	
02/01/2025 13:00:00	0.66	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.06	0.49	0.10	0.61	0.01	
02/01/2025 13:15:00	0.66	0.00	0.07	0.04	0.14	0.19	0.09	0.49	0.05	0.49	0.11	0.62	0.03	
02/01/2025 13:30:00	0.66	0.00	0.07	0.04	0.14	0.19	0.09	0.48	0.06	0.49	0.09	0.62	0.01	
02/01/2025 13:45:00	0.67	0.00	0.07	0.04	0.14	0.19	0.09	0.48	0.06	0.49	0.10	0.62	0.04	
02/01/2025 14:00:00	0.67	0.00	0.07	0.04	0.14	0.19	0.09	0.48	0.05	0.49	0.09	0.63	0.02	
02/01/2025 14:15:00	0.67	0.00	0.07	0.04	0.14	0.19	0.09	0.48	0.05	0.50	0.11	0.63	0.02	
02/01/2025 14:30:00	0.68	0.00	0.07	0.04	0.14	0.19	0.09	0.48	0.06	0.50	0.12	0.64	0.02	
02/01/2025 14:45:00	0.68	0.00	0.07	0.04	0.14	0.19	0.09	0.47	0.06	0.50	0.12	0.64	0.03	
02/01/2025 15:00:00	0.69	0.00	0.07	0.04	0.14	0.19	0.09	0.47	0.06	0.50	0.11	0.64	0.03	
02/01/2025 15:15:00	0.69	0.00	0.07	0.04	0.14	0.18	0.09	0.47	0.06	0.50	0.11	0.65	0.03	
02/01/2025 15:30:00	0.69	0.00	0.07	0.04	0.14	0.18	0.09	0.47	0.06	0.50	0.09	0.64	0.02	
02/01/2025 15:45:00	0.69	0.00	0.07	0.04	0.14	0.18	0.09	0.47	0.06	0.50	0.08	0.62	0.06	
02/01/2025 16:00:00	0.69	0.00	0.07	0.04	0.14	0.18	0.09	0.47	0.06	0.51	0.10	0.60	0.07	
02/01/2025 16:15:00	0.69	0.00	0.07	0.04	0.14	0.18	0.09	0.47	0.06	0.51	0.10	0.58	0.08	
02/01/2025 16:30:00	0.69	0.00	0.07	0.03	0.14	0.18	0.09	0.47	0.05	0.51	0.08	0.55	0.09	
02/01/2025 16:45:00	0.68	0.00	0.07	0.03	0.14	0.18	0.09	0.47	0.06	0.51	0.10	0.54	0.09	
02/01/2025 17:00:00	0.68	0.00	0.07	0.03	0.14	0.18	0.08	0.47	0.06	0.51	0.08	0.52	0.13	
02/01/2025 17:15:00	0.67	0.00	0.06	0.03	0.14	0.18	0.08	0.46	0.05	0.50	0.10	0.50	0.09	
02/01/2025 17:30:00	0.67	0.00	0.06	0.03	0.14	0.18	0.08	0.46	0.06	0.50	0.10	0.49	0.15	
02/01/2025 17:45:00	0.66	0.00	0.06	0.03	0.14	0.18	0.08	0.46	0.06	0.50	0.10	0.48	0.11	
02/01/2025 18:00:00	0.66	0.00	0.06	0.03	0.14	0.18	0.08	0.47	0.06	0.50	0.10	0.47	0.10	
02/01/2025 18:15:00	0.65	0.00	0.06	0.03	0.13	0.18	0.08	0.47	0.06	0.50	0.11	0.46	0.10	
02/01/2025 18:30:00	0.65	0.00	0.06	0.03	0.13	0.18	0.08	0.47	0.06	0.50	0.10	0.45	0.11	
02/01/2025 18:45:00	0.64	0.00	0.06	0.03	0.13	0.18	0.08	0.47	0.06	0.49	0.10	0.44	0.10	
02/01/2025 19:00:00	0.64	0.00	0.06	0.03	0.13	0.18	0.08	0.47	0.06	0.49	0.09	0.44	0.09	
02/01/2025 19:15:00	0.63	0.00	0.06	0.03	0.13	0.18	0.08	0.47	0.05	0.49	0.10	0.45	0.08	
02/01/2025 19:30:00	0.63	0.00	0.06	0.03	0.13	0.18	0.08	0.47	0.05	0.49	0.09	0.48	0.06	
02/01/2025 19:45:00	0.62	0.00	0.06	0.03	0.13	0.18	0.08	0.47	0.06	0.49	0.10	0.51	0.06	
02/01/2025 20:00:00	0.62	0.00	0.06	0.03	0.13	0.18	0.08	0.47	0.06	0.49	0.11	0.53	0.04	
02/01/2025 20:15:00	0.62	0.00	0.06	0.03	0.13	0.18	0.08	0.47	0.06	0.48	0.11	0.55	0.04	
02/01/2025 20:30:00	0.63	0.00	0.06	0.03	0.13	0.18	0.08	0.47	0.06	0.48	0.10	0.56	0.04	
02/01/2025 20:45:00	0.63	0.00	0.06	0.03	0.13	0.17	0.08	0.47	0.06	0.48	0.10	0.57	0.03	
02/01/2025 21:00:00	0.63	0.00	0.06	0.03	0.13	0.17	0.08	0.47	0.07	0.48	0.10	0.58	0.03	
02/01/2025 21:15:00	0.64	0.00	0.06	0.03	0.13	0.17	0.08	0.47	0.06	0.48	0.10	0.59	0.03	
02/01/2025 21:30:00	0.64	0.00	0.06	0.03	0.13	0.17	0.08	0.47	0.06	0.48	0.10	0.59	0.02	
02/01/2025 21:45:00	0.65	0.00	0.06	0.03	0.13	0.17	0.08	0.47	0.06	0.48	0.10	0.60	0.02	
02/01/2025 22:00:00	0.65	0.00	0.06	0.03	0.13	0.17	0.08	0.47	0.05	0.48	0.10	0.61	0.03	
02/01/2025 22:15:00	0.65	0.00	0.06	0.03	0.13	0.17	0.08	0.47	0.05	0.49	0.10	0.61	0.03	
02/01/2025 22:30:00	0.66	0.00	0.06	0.03	0.13	0.17	0.08	0.47	0.05	0.49	0.09	0.62	0.03	
02/01/2025 22:45:00	0.66	0.00	0.06	0.03	0.13	0.17	0.08	0.46	0.05	0.49	0.09	0.62	0.03	
02/01/2025 23:00:00	0.67	0.00	0.06	0.03	0.13	0.17	0.08	0.46	0.06	0.49	0.09	0.63	0.03	
02/01/2025 23:15:00	0.67	0.00	0.06	0.03	0.13	0.17	0.08	0.46	0.06	0.49	0.09	0.64	0.03	
02/01/2025 23:30:00	0.68	0.00	0.06	0.03	0.13	0.17	0.08	0.46	0.05	0.49	0.09	0.64	0.03	
02/01/2025 23:45:00	0.68	0.00	0.06	0.03	0.13	0.17	0.08	0.46	0.05	0.49	0.09	0.64	0.02	
03/01/2025 00:00:00	0.68	0.00	0.06	0.03	0.13	0.17	0.08	0.46	0.05	0.49	0.09	0.65	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
03/01/2025 00:15:00	0.69	0.00	0.06	0.03	0.13	0.17	0.08	0.46	0.05	0.50	0.09	0.65	0.03	
03/01/2025 00:30:00	0.69	0.00	0.06	0.03	0.13	0.17	0.08	0.46	0.06	0.50	0.09	0.66	0.03	
03/01/2025 00:45:00	0.70	0.00	0.06	0.03	0.13	0.17	0.08	0.46	0.05	0.50	0.09	0.66	0.03	
03/01/2025 01:00:00	0.70	0.00	0.05	0.02	0.13	0.17	0.08	0.46	0.05	0.50	0.08	0.67	0.03	
03/01/2025 01:15:00	0.70	0.00	0.05	0.02	0.13	0.17	0.08	0.46	0.05	0.50	0.08	0.67	0.02	
03/01/2025 01:30:00	0.71	0.00	0.05	0.02	0.13	0.17	0.07	0.45	0.05	0.51	0.08	0.67	0.02	
03/01/2025 01:45:00	0.71	0.00	0.05	0.02	0.13	0.17	0.07	0.45	0.04	0.51	0.08	0.68	0.03	
03/01/2025 02:00:00	0.71	0.00	0.05	0.02	0.13	0.17	0.07	0.45	0.04	0.51	0.08	0.68	0.03	
03/01/2025 02:15:00	0.72	0.00	0.05	0.02	0.13	0.17	0.07	0.45	0.06	0.51	0.08	0.68	0.02	
03/01/2025 02:30:00	0.72	0.00	0.05	0.02	0.13	0.17	0.07	0.45	0.05	0.51	0.08	0.68	0.03	
03/01/2025 02:45:00	0.72	0.00	0.05	0.02	0.12	0.17	0.07	0.45	0.06	0.51	0.08	0.69	0.02	
03/01/2025 03:00:00	0.72	0.00	0.05	0.02	0.12	0.17	0.07	0.45	0.06	0.52	0.08	0.69	0.02	
03/01/2025 03:15:00	0.73	0.00	0.05	0.02	0.12	0.17	0.07	0.45	0.06	0.52	0.07	0.68	0.06	
03/01/2025 03:30:00	0.73	0.00	0.05	0.02	0.12	0.17	0.07	0.45	0.05	0.52	0.07	0.66	0.08	
03/01/2025 03:45:00	0.72	0.00	0.05	0.02	0.12	0.17	0.07	0.45	0.04	0.52	0.07	0.63	0.09	
03/01/2025 04:00:00	0.72	0.00	0.05	0.02	0.12	0.17	0.07	0.45	0.06	0.52	0.07	0.60	0.10	
03/01/2025 04:15:00	0.71	0.00	0.05	0.02	0.12	0.17	0.07	0.45	0.05	0.52	0.07	0.58	0.12	
03/01/2025 04:30:00	0.71	0.00	0.05	0.02	0.12	0.17	0.07	0.45	0.05	0.51	0.07	0.56	0.13	
03/01/2025 04:45:00	0.70	0.00	0.05	0.02	0.12	0.17	0.07	0.44	0.05	0.51	0.07	0.54	0.13	
03/01/2025 05:00:00	0.69	0.00	0.05	0.02	0.12	0.17	0.07	0.44	0.05	0.51	0.07	0.52	0.11	
03/01/2025 05:15:00	0.69	0.00	0.05	0.02	0.12	0.17	0.07	0.44	0.05	0.51	0.08	0.51	0.11	
03/01/2025 05:30:00	0.68	0.00	0.05	0.02	0.12	0.17	0.07	0.44	0.05	0.50	0.08	0.50	0.11	
03/01/2025 05:45:00	0.67	0.00	0.05	0.02	0.12	0.17	0.07	0.44	0.06	0.50	0.08	0.49	0.12	
03/01/2025 06:00:00	0.67	0.00	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.50	0.08	0.48	0.11	
03/01/2025 06:15:00	0.66	0.00	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.49	0.09	0.47	0.13	
03/01/2025 06:30:00	0.65	0.00	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.49	0.09	0.46	0.10	
03/01/2025 06:45:00	0.65	0.00	0.04	0.02	0.12	0.16	0.07	0.44	0.06	0.49	0.09	0.45	0.11	
03/01/2025 07:00:00	0.64	0.00	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.48	0.09	0.44	0.12	
03/01/2025 07:15:00	0.64	0.00	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.48	0.09	0.44	0.08	
03/01/2025 07:30:00	0.63	0.00	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.48	0.10	0.43	0.11	
03/01/2025 07:45:00	0.62	0.00	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.48	0.10	0.42	0.11	
03/01/2025 08:00:00	0.62	0.00	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.47	0.10	0.42	0.08	
03/01/2025 08:15:00	0.61	0.00	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.47	0.10	0.42	0.08	
03/01/2025 08:30:00	0.61	0.00	0.04	0.02	0.11	0.16	0.06	0.44	0.05	0.47	0.10	0.43	0.06	
03/01/2025 08:45:00	0.61	0.00	0.04	0.02	0.11	0.16	0.06	0.44	0.05	0.47	0.10	0.46	0.03	
03/01/2025 09:00:00	0.60	0.00	0.04	0.02	0.11	0.16	0.06	0.44	0.05	0.47	0.10	0.49	0.04	
03/01/2025 09:15:00	0.60	0.00	0.04	0.02	0.11	0.16	0.06	0.44	0.05	0.47	0.10	0.52	0.02	
03/01/2025 09:30:00	0.60	0.00	0.04	0.02	0.11	0.16	0.06	0.44	0.05	0.46	0.10	0.53	0.02	
03/01/2025 09:45:00	0.61	0.00	0.04	0.02	0.11	0.16	0.06	0.44	0.05	0.46	0.10	0.55	0.04	
03/01/2025 10:00:00	0.61	0.00	0.04	0.01	0.11	0.16	0.06	0.45	0.05	0.46	0.10	0.56	0.03	
03/01/2025 10:15:00	0.61	0.00	0.04	0.02	0.11	0.16	0.06	0.45	0.05	0.46	0.10	0.57	0.00	
03/01/2025 10:30:00	0.62	0.00	0.04	0.02	0.11	0.16	0.06	0.45	0.06	0.46	0.10	0.58	0.02	
03/01/2025 10:45:00	0.62	0.00	0.04	0.01	0.11	0.16	0.06	0.45	0.06	0.46	0.10	0.59	0.01	
03/01/2025 11:00:00	0.63	0.00	0.04	0.01	0.11	0.16	0.06	0.46	0.05	0.46	0.10	0.59	0.01	
03/01/2025 11:15:00	0.63	0.00	0.04	0.01	0.11	0.16	0.06	0.46	0.05	0.46	0.10	0.60	0.03	
03/01/2025 11:30:00	0.64	0.00	0.04	0.01	0.11	0.16	0.06	0.46	0.06	0.47	0.10	0.61	0.01	
03/01/2025 11:45:00	0.64	0.00	0.04	0.01	0.11	0.16	0.06	0.46	0.06	0.47	0.10	0.61	0.01	
03/01/2025 12:00:00	0.65	0.00	0.04	0.02	0.11	0.16	0.06	0.46	0.05	0.47	0.09	0.62	0.02	
03/01/2025 12:15:00	0.65	0.00	0.04	0.02	0.11	0.16	0.06	0.46	0.06	0.47	0.10	0.62	0.01	
03/01/2025 12:30:00	0.66	0.00	0.04	0.02	0.12	0.16	0.06	0.46	0.06	0.47	0.10	0.63	0.01	
03/01/2025 12:45:00	0.66	0.00	0.04	0.02	0.12	0.16	0.06	0.46	0.06	0.47	0.10	0.63	0.00	
03/01/2025 13:00:00	0.67	0.00	0.04	0.02	0.12	0.16	0.07	0.46	0.05	0.48	0.10	0.64	0.01	
03/01/2025 13:15:00	0.67	0.00	0.04	0.02	0.12	0.16	0.07	0.46	0.06	0.48	0.10	0.64	0.04	
03/01/2025 13:30:00	0.68	0.00	0.04	0.02	0.12	0.16	0.07	0.46	0.04	0.48	0.09	0.65	0.02	
03/01/2025 13:45:00	0.68	0.00	0.04	0.02	0.12	0.16	0.07	0.46	0.05	0.48	0.09	0.65	0.02	
03/01/2025 14:00:00	0.69	0.00	0.04	0.02	0.12	0.16	0.07	0.46	0.06	0.48	0.08	0.66	0.02	
03/01/2025 14:15:00	0.69	0.00	0.05	0.02	0.12	0.16	0.07	0.46	0.05	0.48	0.09	0.66	0.02	
03/01/2025 14:30:00	0.69	0.00	0.05	0.02	0.12	0.16	0.07	0.46	0.05	0.49	0.08	0.66	0.01	
03/01/2025 14:45:00	0.70	0.00	0.05	0.02	0.12	0.16	0.07	0.46	0.05	0.49	0.08	0.67	0.00	
03/01/2025 15:00:00	0.70	0.00	0.05	0.02	0.12	0.16	0.07	0.46	0.05	0.49	0.08	0.67	0.03	
03/01/2025 15:15:00	0.70	0.00	0.05	0.02	0.12	0.16	0.07	0.46	0.06	0.49	0.08	0.67	0.02	
03/01/2025 15:30:00	0.71	0.00	0.05	0.02	0.12	0.16	0.07	0.46	0.05	0.50	0.08	0.68	0.02	
03/01/2025 15:45:00	0.71	0.05	0.05	0.02	0.12	0.16	0.07	0.46	0.06	0.50	0.08	0.68	0.02	
03/01/2025 16:00:00	0.71	0.05	0.05	0.02	0.12	0.16	0.07	0.46	0.05	0.50	0.08	0.68	0.01	
03/01/2025 16:15:00	0.71	0.05	0.05	0.02	0.12	0.17	0.07	0.46	0.06	0.50	0.08	0.68	0.03	
03/01/2025 16:30:00	0.72	0.05	0.05	0.02	0.12	0.17	0.07	0.46	0.06	0.50	0.08	0.67	0.05	
03/01/2025 16:45:00	0.72	0.05	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.50	0.08	0.66	0.06	
03/01/2025 17:00:00	0.71	0.03	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.50	0.08	0.63	0.09	
03/01/2025 17:15:00	0.71	0.02	0.05	0.02	0.12	0.17	0.07	0.46	0.04	0.50	0.08	0.61	0.10	
03/01/2025 17:30:00	0.71	0.01	0.05	0.02	0.12	0.17	0.07	0.46	0.04	0.50	0.07	0.59	0.10	
03/01/2025 17:45:00	0.70	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.06	0.50	0.07	0.57	0.10	
03/01/2025 18:00:00	0.69	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.06	0.50	0.08	0.55	0.12	
03/01/2025 18:15:00	0.69	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.50	0.07	0.53	0.08	
03/01/2025 18:30:00	0.68	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.49	0.07	0.52	0.11	
03/01/2025 18:45:00	0.67	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.49	0.08	0.50	0.11	
03/01/2025 19:00:00	0.67	0.00	0.05	0.02	0.12	0.16	0.07	0.46	0.05	0.49	0.08	0.49	0.09	
03/01/2025 19:15:00	0.66	0.00	0.05	0.02	0.12	0.16	0.07	0.46	0.06	0.48	0.08	0.48	0.09	
03/01/2025 19:30:00	0.65	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.06	0.48	0.08	0.48	0.08	
03/01/2025 19:45:00	0.65	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.04	0.48	0.09	0.47	0.10	
03/01/2025 20:00:00	0.64	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.06	0.47	0.09	0.48	0.07	
03/01/2025 20:15:00	0.64	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.07	0.47	0.09	0.51	0.05	
03/01/2025 20:30:00	0.63	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.07	0.47	0.09	0.54	0.03	
03/01/2025 20:45:00	0.63	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.07	0.47	0.09	0.56	0.04	
03/01/2025 21:00:00	0.63	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.07	0.47	0.09	0.58	0.02	
03/01/2025 21:15:00	0.63	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.05	0.47	0.09	0.59	0.01	
03/01/2025 21:30:00	0.64	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.46	0.09	0.60	0.01	
03/01/2025 21:45:00	0.64	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.46	0.09	0.61	0.02	
03/01/2025 22:00:00	0.65	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.04	0.46	0.09	0.62	0.02	
03/01/2025 22:15:00	0.65	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.47	0.08	0.62	0.02	
03/01/2025 22:30:00	0.66	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.47	0.09	0.63	0.02	
03/01/2025 22:45:00	0.66	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.47	0.09	0.63	0.02	
03/01/2025 23:00:00	0.67	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.06	0.47	0.09	0.64	0.02	
03/01/2025 23:15:00	0.67	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.47	0.08	0.64	0.01	
03/01/2025 23:30:00	0.67	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.47	0.08	0.65	0.02	
03/01/2025 23:45:00	0.68	0.03	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.47	0.08	0.65	0.03	
04/01/2025 00:00:00	0.68	0.04	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.48	0.08	0.66	0.03	
04/01/2025 00:15:00	0.69	0.03	0.05	0.02	0.12	0.17	0.07	0.46	0.04	0.48	0.08	0.66	0.03	
04/01/2025 00:30:00	0.69	0.01	0.05	0.02	0.12	0.17	0.07	0.46	0.05	0.48	0.07	0.66	0.02	
04/01/2025 00:45:00	0.69	0.00	0.05	0.02	0.12	0.17	0.07	0.46	0.06	0.48	0.08	0.67	0.02	
04/01/2025 01:00:00	0.70	0.00	0.05	0.02	0.12	0.17	0.07	0.45	0.05	0.49	0.08	0.67	0.02	
04/01/2025 01:15:00	0.70	0.03	0.05	0.02	0.12	0.17	0.07	0.45	0.05	0.49	0.07	0.67	0.02	
04/01/2025 01:30:00	0.70	0.04	0.05	0.02	0.12	0.17	0.07	0.45	0.04	0.49	0.07	0.68	0.02	
04/01/2025 01:45:00	0.71	0.04	0.05	0.02	0.12	0.17	0.07	0.45	0.04	0.49	0.07	0.68	0.02	
04/01/2025 02:00:00	0.71	0.04	0.05	0.02	0.12	0.17	0.07	0.45	0.05	0.49	0.07	0.68	0.03	
04/01/2025 02:15:00	0.71	0.05	0.05	0.02	0.12	0.17	0.07	0.45	0.05	0.50	0.07	0.68	0.03	
04/01/2025 02:30:00	0.71	0.04	0.05	0.02	0.12	0.17	0.07	0.45	0.05	0.50	0.06	0.69	0.03	
04/01/2025 02:45:00	0.72	0.04	0.05	0.02	0.12	0.17	0.07	0.45	0.06	0.50	0.06	0.69	0.03	
04/01/2025 03:00:00	0.72	0.05	0.05	0.02	0.12	0.16	0.07	0.44	0.05	0.50	0.06	0.69	0.03	
04/01/2025 03:15:00	0.72	0.04	0.05	0.02	0.12	0.16	0.07	0.44	0.04	0.50	0.06	0.69	0.03	
04/01/2025 03:30:00	0.72	0.04	0.05	0.02	0.12	0.16	0.07	0.44	0.06	0.50	0.06	0.69	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
04/01/2025 03:45:00	0.72	0.04	0.05	0.02	0.12	0.16	0.07	0.44	0.04	0.50	0.06	0.68	0.08	
04/01/2025 04:00:00	0.72	0.05	0.05	0.02	0.12	0.16	0.07	0.44	0.05	0.51	0.06	0.65	0.09	
04/01/2025 04:15:00	0.72	0.05	0.05	0.02	0.12	0.16	0.07	0.44	0.05	0.51	0.06	0.62	0.10	
04/01/2025 04:30:00	0.71	0.05	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.50	0.06	0.59	0.11	
04/01/2025 04:45:00	0.71	0.03	0.04	0.02	0.12	0.16	0.07	0.44	0.05	0.50	0.05	0.57	0.11	
04/01/2025 05:00:00	0.70	0.02	0.04	0.02	0.12	0.16	0.07	0.44	0.06	0.50	0.06	0.55	0.12	
04/01/2025 05:15:00	0.69	0.00	0.04	0.02	0.11	0.16	0.06	0.44	0.05	0.49	0.07	0.53	0.11	
04/01/2025 05:30:00	0.68	0.00	0.04	0.02	0.11	0.16	0.06	0.44	0.04	0.49	0.07	0.52	0.11	
04/01/2025 05:45:00	0.68	0.00	0.04	0.02	0.11	0.16	0.06	0.44	0.05	0.49	0.07	0.50	0.08	
04/01/2025 06:00:00	0.67	0.00	0.04	0.02	0.11	0.16	0.06	0.44	0.05	0.48	0.07	0.49	0.09	
04/01/2025 06:15:00	0.66	0.00	0.04	0.02	0.11	0.16	0.06	0.43	0.05	0.48	0.07	0.48	0.10	
04/01/2025 06:30:00	0.66	0.00	0.04	0.02	0.11	0.16	0.06	0.43	0.05	0.48	0.07	0.47	0.11	
04/01/2025 06:45:00	0.65	0.00	0.04	0.01	0.11	0.16	0.06	0.43	0.05	0.47	0.08	0.46	0.10	
04/01/2025 07:00:00	0.64	0.00	0.04	0.01	0.11	0.16	0.06	0.43	0.05	0.47	0.08	0.45	0.11	
04/01/2025 07:15:00	0.63	0.00	0.04	0.01	0.11	0.16	0.06	0.43	0.05	0.47	0.08	0.44	0.09	
04/01/2025 07:30:00	0.63	0.00	0.04	0.01	0.11	0.16	0.06	0.43	0.05	0.46	0.08	0.44	0.07	
04/01/2025 07:45:00	0.62	0.00	0.04	0.01	0.11	0.16	0.06	0.43	0.05	0.46	0.08	0.43	0.08	
04/01/2025 08:00:00	0.62	0.00	0.04	0.01	0.11	0.16	0.06	0.43	0.06	0.46	0.08	0.42	0.10	
04/01/2025 08:15:00	0.61	0.00	0.04	0.01	0.11	0.16	0.06	0.43	0.05	0.46	0.08	0.41	0.07	
04/01/2025 08:30:00	0.61	0.00	0.04	0.01	0.11	0.16	0.06	0.44	0.05	0.45	0.09	0.41	0.08	
04/01/2025 08:45:00	0.60	0.00	0.04	0.01	0.11	0.16	0.06	0.44	0.04	0.45	0.09	0.40	0.08	
04/01/2025 09:00:00	0.59	0.00	0.03	0.01	0.11	0.16	0.06	0.44	0.05	0.45	0.09	0.40	0.10	
04/01/2025 09:15:00	0.59	0.00	0.03	0.01	0.11	0.16	0.06	0.44	0.05	0.45	0.09	0.39	0.06	
04/01/2025 09:30:00	0.58	0.00	0.03	0.01	0.11	0.16	0.06	0.44	0.05	0.45	0.09	0.39	0.08	
04/01/2025 09:45:00	0.58	0.00	0.03	0.01	0.11	0.16	0.06	0.44	0.05	0.44	0.09	0.38	0.10	
04/01/2025 10:00:00	0.58	0.00	0.03	0.01	0.11	0.16	0.06	0.45	0.06	0.44	0.09	0.38	0.07	
04/01/2025 10:15:00	0.57	0.00	0.03	0.01	0.11	0.16	0.06	0.45	0.06	0.44	0.09	0.38	0.07	
04/01/2025 10:30:00	0.57	0.00	0.03	0.01	0.11	0.16	0.06	0.45	0.06	0.44	0.09	0.38	0.05	
04/01/2025 10:45:00	0.56	0.00	0.03	0.01	0.11	0.16	0.06	0.45	0.06	0.44	0.08	0.39	0.05	
04/01/2025 11:00:00	0.56	0.00	0.03	0.01	0.11	0.16	0.06	0.46	0.06	0.44	0.09	0.42	0.03	
04/01/2025 11:15:00	0.56	0.00	0.03	0.01	0.11	0.16	0.06	0.46	0.06	0.44	0.09	0.45	0.02	
04/01/2025 11:30:00	0.56	0.00	0.03	0.01	0.11	0.16	0.06	0.46	0.05	0.44	0.09	0.48	0.02	
04/01/2025 11:45:00	0.56	0.00	0.03	0.01	0.11	0.16	0.06	0.46	0.06	0.44	0.10	0.50	0.01	
04/01/2025 12:00:00	0.56	0.00	0.03	0.01	0.11	0.16	0.06	0.46	0.07	0.44	0.09	0.51	-0.02	
04/01/2025 12:15:00	0.57	0.00	0.03	0.01	0.11	0.16	0.06	0.47	0.06	0.44	0.09	0.52	0.01	
04/01/2025 12:30:00	0.57	0.00	0.03	0.01	0.11	0.16	0.06	0.47	0.05	0.44	0.09	0.53	0.01	
04/01/2025 12:45:00	0.58	0.00	0.04	0.01	0.11	0.16	0.06	0.47	0.07	0.44	0.09	0.54	0.00	
04/01/2025 13:00:00	0.58	0.00	0.04	0.01	0.11	0.16	0.06	0.47	0.07	0.44	0.09	0.55	0.01	
04/01/2025 13:15:00	0.59	0.00	0.04	0.01	0.11	0.16	0.06	0.48	0.06	0.44	0.09	0.56	0.01	
04/01/2025 13:30:00	0.59	0.00	0.04	0.01	0.12	0.16	0.07	0.48	0.05	0.44	0.09	0.56	0.00	
04/01/2025 13:45:00	0.60	0.00	0.04	0.02	0.12	0.16	0.07	0.48	0.07	0.44	0.08	0.57	0.01	
04/01/2025 14:00:00	0.61	0.00	0.04	0.02	0.12	0.16	0.07	0.48	0.06	0.44	0.09	0.58	0.00	
04/01/2025 14:15:00	0.61	0.00	0.04	0.02	0.12	0.16	0.07	0.48	0.06	0.44	0.09	0.58	0.00	
04/01/2025 14:30:00	0.62	0.00	0.04	0.02	0.12	0.16	0.07	0.47	0.06	0.44	0.08	0.59	-0.02	
04/01/2025 14:45:00	0.62	0.00	0.04	0.02	0.12	0.17	0.07	0.47	0.06	0.44	0.08	0.59	-0.02	
04/01/2025 15:00:00	0.63	0.00	0.04	0.02	0.12	0.17	0.07	0.47	0.06	0.44	0.09	0.60	0.00	
04/01/2025 15:15:00	0.63	0.00	0.04	0.02	0.12	0.17	0.07	0.47	0.07	0.45	0.08	0.60	0.03	
04/01/2025 15:30:00	0.64	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.45	0.08	0.61	0.01	
04/01/2025 15:45:00	0.64	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.07	0.45	0.08	0.61	0.01	
04/01/2025 16:00:00	0.65	0.05	0.05	0.02	0.12	0.17	0.07	0.47	0.07	0.45	0.07	0.62	0.02	
04/01/2025 16:15:00	0.65	0.03	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.45	0.07	0.62	0.02	
04/01/2025 16:30:00	0.65	0.06	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.45	0.07	0.60	0.06	
04/01/2025 16:45:00	0.65	0.06	0.05	0.02	0.12	0.17	0.07	0.47	0.07	0.46	0.07	0.58	0.09	
04/01/2025 17:00:00	0.65	0.05	0.05	0.02	0.12	0.17	0.07	0.47	0.05	0.46	0.07	0.55	0.08	
04/01/2025 17:15:00	0.65	0.03	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.46	0.08	0.53	0.07	
04/01/2025 17:30:00	0.65	0.02	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.46	0.08	0.51	0.09	
04/01/2025 17:45:00	0.64	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.46	0.07	0.49	0.08	
04/01/2025 18:00:00	0.63	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.05	0.46	0.08	0.48	0.10	
04/01/2025 18:15:00	0.63	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.05	0.46	0.07	0.46	0.08	
04/01/2025 18:30:00	0.62	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.04	0.45	0.06	0.45	0.09	
04/01/2025 18:45:00	0.62	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.45	0.05	0.44	0.10	
04/01/2025 19:00:00	0.61	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.45	0.05	0.43	0.08	
04/01/2025 19:15:00	0.61	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.45	0.05	0.42	0.09	
04/01/2025 19:30:00	0.60	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.45	0.05	0.41	0.08	
04/01/2025 19:45:00	0.60	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.05	0.45	0.04	0.40	0.08	
04/01/2025 20:00:00	0.59	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.44	0.04	0.40	0.08	
04/01/2025 20:15:00	0.59	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.05	0.44	0.05	0.39	0.08	
04/01/2025 20:30:00	0.58	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.44	0.03	0.39	0.09	
04/01/2025 20:45:00	0.58	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.44	0.05	0.39	0.09	
04/01/2025 21:00:00	0.57	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.44	0.03	0.40	0.05	
04/01/2025 21:15:00	0.57	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.44	0.06	0.43	0.04	
04/01/2025 21:30:00	0.56	0.00	0.05	0.02	0.12	0.17	0.07	0.48	0.06	0.44	0.07	0.46	0.04	
04/01/2025 21:45:00	0.56	0.00	0.05	0.02	0.12	0.17	0.07	0.48	0.07	0.44	0.07	0.48	0.02	
04/01/2025 22:00:00	0.57	0.00	0.05	0.02	0.12	0.17	0.07	0.48	0.06	0.44	0.07	0.50	0.03	
04/01/2025 22:15:00	0.57	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.05	0.44	0.07	0.51	0.04	
04/01/2025 22:30:00	0.57	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.07	0.44	0.08	0.52	0.03	
04/01/2025 22:45:00	0.57	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.44	0.08	0.53	0.02	
04/01/2025 23:00:00	0.58	0.00	0.05	0.02	0.12	0.17	0.07	0.47	0.06	0.44	0.08	0.54	0.03	
04/01/2025 23:15:00	0.58	0.00	0.05	0.02	0.12	0.18	0.07	0.47	0.06	0.44	0.08	0.55	0.02	
04/01/2025 23:30:00	0.59	0.00	0.05	0.02	0.12	0.18	0.07	0.47	0.06	0.44	0.08	0.55	0.02	
04/01/2025 23:45:00	0.59	0.00	0.05	0.02	0.12	0.18	0.07	0.47	0.05	0.44	0.07	0.56	0.02	
05/01/2025 00:00:00	0.60	0.05	0.05	0.02	0.12	0.18	0.07	0.47	0.06	0.44	0.07	0.57	0.03	
05/01/2025 00:15:00	0.60	0.05	0.05	0.02	0.12	0.18	0.07	0.47	0.07	0.44	0.06	0.57	0.02	
05/01/2025 00:30:00	0.61	0.05	0.05	0.02	0.12	0.18	0.07	0.47	0.05	0.44	0.06	0.58	0.03	
05/01/2025 00:45:00	0.61	0.05	0.05	0.02	0.12	0.18	0.07	0.47	0.05	0.44	0.08	0.58	0.02	
05/01/2025 01:00:00	0.62	0.05	0.05	0.02	0.12	0.18	0.07	0.47	0.05	0.44	0.07	0.59	0.02	
05/01/2025 01:15:00	0.62	0.05	0.05	0.02	0.12	0.18	0.07	0.47	0.06	0.45	0.08	0.59	0.03	
05/01/2025 01:30:00	0.63	0.04	0.05	0.02	0.12	0.18	0.07	0.47	0.05	0.45	0.08	0.60	0.02	
05/01/2025 01:45:00	0.63	0.05	0.05	0.02	0.12	0.18	0.07	0.47	0.06	0.45	0.08	0.60	0.02	
05/01/2025 02:00:00	0.64	0.05	0.05	0.02	0.13	0.18	0.07	0.47	0.05	0.45	0.07	0.61	0.02	
05/01/2025 02:15:00	0.64	0.04	0.05	0.02	0.13	0.18	0.07	0.47	0.06	0.46	0.08	0.61	0.03	
05/01/2025 02:30:00	0.65	0.05	0.05	0.02	0.13	0.18	0.07	0.47	0.06	0.46	0.08	0.62	0.03	
05/01/2025 02:45:00	0.65	0.04	0.05	0.02	0.13	0.18	0.07	0.49	0.08	0.46	0.07	0.62	0.03	
05/01/2025 03:00:00	0.66	0.04	0.05	0.02	0.13	0.18	0.07	0.51	0.08	0.46	0.07	0.62	0.02	
05/01/2025 03:15:00	0.66	0.06	0.05	0.02	0.13	0.18	0.07	0.53	0.08	0.47	0.07	0.63	0.03	
05/01/2025 03:30:00	0.67	0.04	0.05	0.02	0.13	0.18	0.08	0.54	0.08	0.47	0.05	0.63	0.03	
05/01/2025 03:45:00	0.67	0.04	0.05	0.02	0.13	0.19	0.08	0.54	0.08	0.47	0.07	0.64	0.03	
05/01/2025 04:00:00	0.68	0.04	0.05	0.02	0.13	0.19	0.08	0.55	0.08	0.48	0.07	0.64	0.03	
05/01/2025 04:15:00	0.68	0.05	0.05	0.02	0.14	0.19	0.08	0.56	0.09	0.48	0.07	0.65	0.03	
05/01/2025 04:30:00	0.68	0.05	0.06	0.03	0.14	0.20	0.09	0.57	0.08	0.48	0.06	0.65	0.04	
05/01/2025 04:45:00	0.69	0.04	0.06	0.03	0.15	0.20	0.09	0.57	0.08	0.48	0.08	0.63	0.07	
05/01/2025 05:00:00	0.69	0.05	0.07	0.03	0.15	0.20	0.10	0.57	0.08	0.49	0.08	0.61	0.09	
05/01/2025 05:15:00	0.69	0.05	0.07	0.04	0.16	0.20	0.10	0.57	0.07	0.49	0.08	0.59	0.09	
05/01/2025 05:30:00	0.68	0.04	0.08	0.04	0.16	0.21	0.10	0.57	0.08	0.49	0.08	0.56	0.10	
05/01/2025 05:45:00	0.68	0.02	0.08	0.04	0.16	0.21	0.11	0.57	0.08	0.49	0.08	0.54	0.10	
05/01/2025 06:00:00	0.68	0.00	0.08	0.05	0.17	0.21	0.11	0.58	0.08	0.49	0.08	0.53	0.09	
05/01/2025 06:15:00	0.67	0.00	0.09	0.05	0.17	0.22	0.11	0.57	0.07	0.49	0.07	0.51	0.10	
05/01/2025 06:30:00	0.67	0.00	0.09	0.05	0.17	0.22	0.12	0.57	0.08	0.49	0.08	0.49	0.08	
05/01/2025 06:45:00	0.66	0.00	0.10	0.06	0.17	0.22	0.12	0.57	0.08	0.49	0.08	0.48	0.08	
05/01/2025 07:00:00	0.66	0.00	0.10	0.06	0.18	0.22	0.12	0.57	0.07	0.49	0.08	0.47	0.09	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
05/01/2025 07:15:00	0.65	0.00	0.10	0.06	0.18	0.22	0.12	0.56	0.07	0.49	0.08	0.46	0.09	
05/01/2025 07:30:00	0.65	0.00	0.10	0.06	0.18	0.23	0.13	0.56	0.07	0.48	0.09	0.45	0.10	
05/01/2025 07:45:00	0.64	0.00	0.11	0.07	0.18	0.23	0.13	0.55	0.08	0.48	0.09	0.44	0.09	
05/01/2025 08:00:00	0.64	0.00	0.11	0.07	0.18	0.22	0.13	0.55	0.06	0.48	0.10	0.43	0.09	
05/01/2025 08:15:00	0.63	0.00	0.11	0.07	0.18	0.22	0.13	0.55	0.08	0.48	0.10	0.43	0.07	
05/01/2025 08:30:00	0.63	0.00	0.11	0.07	0.18	0.22	0.13	0.55	0.07	0.48	0.10	0.42	0.08	
05/01/2025 08:45:00	0.63	0.00	0.11	0.07	0.18	0.22	0.13	0.54	0.06	0.48	0.10	0.42	0.08	
05/01/2025 09:00:00	0.62	0.00	0.11	0.07	0.18	0.22	0.13	0.54	0.07	0.48	0.10	0.41	0.09	
05/01/2025 09:15:00	0.62	0.00	0.11	0.07	0.18	0.22	0.13	0.55	0.09	0.48	0.08	0.41	0.07	
05/01/2025 09:30:00	0.62	0.10	0.11	0.07	0.18	0.22	0.13	0.56	0.09	0.48	0.09	0.40	0.07	
05/01/2025 09:45:00	0.61	0.07	0.11	0.07	0.18	0.23	0.13	0.56	0.08	0.48	0.09	0.40	0.07	
05/01/2025 10:00:00	0.61	0.05	0.11	0.07	0.18	0.23	0.13	0.56	0.07	0.48	0.10	0.40	0.10	
05/01/2025 10:15:00	0.61	0.02	0.11	0.07	0.18	0.23	0.13	0.56	0.09	0.48	0.11	0.39	0.07	
05/01/2025 10:30:00	0.60	0.00	0.11	0.07	0.18	0.23	0.13	0.57	0.09	0.48	0.11	0.39	0.09	
05/01/2025 10:45:00	0.60	0.08	0.11	0.07	0.18	0.23	0.13	0.57	0.06	0.48	0.11	0.40	0.04	
05/01/2025 11:00:00	0.60	0.09	0.11	0.07	0.18	0.23	0.13	0.57	0.06	0.48	0.11	0.41	0.07	
05/01/2025 11:15:00	0.60	0.08	0.11	0.07	0.19	0.23	0.13	0.57	0.09	0.48	0.11	0.43	0.06	
05/01/2025 11:30:00	0.60	0.09	0.11	0.07	0.19	0.23	0.13	0.59	0.10	0.48	0.12	0.46	0.05	
05/01/2025 11:45:00	0.60	0.10	0.12	0.08	0.19	0.24	0.14	0.60	0.11	0.48	0.12	0.49	0.04	
05/01/2025 12:00:00	0.61	0.08	0.12	0.08	0.19	0.24	0.14	0.61	0.10	0.49	0.12	0.50	0.04	
05/01/2025 12:15:00	0.61	0.08	0.12	0.08	0.19	0.24	0.14	0.61	0.08	0.49	0.12	0.52	0.04	
05/01/2025 12:30:00	0.62	0.08	0.12	0.08	0.20	0.23	0.14	0.60	0.09	0.49	0.12	0.54	0.04	
05/01/2025 12:45:00	0.62	0.08	0.13	0.09	0.20	0.23	0.15	0.60	0.09	0.49	0.12	0.55	0.02	
05/01/2025 13:00:00	0.63	0.08	0.13	0.09	0.20	0.23	0.15	0.60	0.09	0.50	0.12	0.56	0.03	
05/01/2025 13:15:00	0.64	0.08	0.13	0.09	0.20	0.24	0.15	0.60	0.10	0.50	0.12	0.57	0.03	
05/01/2025 13:30:00	0.65	0.07	0.13	0.09	0.20	0.24	0.15	0.60	0.10	0.50	0.12	0.58	0.02	
05/01/2025 13:45:00	0.65	0.05	0.14	0.10	0.20	0.24	0.15	0.60	0.09	0.51	0.12	0.59	0.02	
05/01/2025 14:00:00	0.66	0.02	0.14	0.10	0.20	0.24	0.15	0.60	0.09	0.51	0.11	0.60	0.01	
05/01/2025 14:15:00	0.67	0.00	0.14	0.10	0.21	0.24	0.15	0.60	0.10	0.51	0.11	0.61	0.03	
05/01/2025 14:30:00	0.67	0.00	0.14	0.10	0.21	0.24	0.15	0.60	0.10	0.52	0.11	0.62	0.03	
05/01/2025 14:45:00	0.68	0.00	0.14	0.10	0.21	0.24	0.15	0.59	0.10	0.52	0.12	0.63	0.02	
05/01/2025 15:00:00	0.69	0.00	0.14	0.10	0.21	0.24	0.16	0.59	0.09	0.52	0.11	0.63	0.04	
05/01/2025 15:15:00	0.70	0.04	0.14	0.10	0.21	0.25	0.16	0.59	0.09	0.53	0.11	0.64	0.03	
05/01/2025 15:30:00	0.70	0.03	0.14	0.10	0.21	0.24	0.16	0.59	0.09	0.53	0.11	0.65	0.03	
05/01/2025 15:45:00	0.71	0.01	0.14	0.10	0.21	0.25	0.16	0.59	0.10	0.53	0.11	0.66	0.02	
05/01/2025 16:00:00	0.72	0.00	0.14	0.10	0.20	0.25	0.15	0.59	0.09	0.54	0.11	0.66	0.03	
05/01/2025 16:15:00	0.72	0.00	0.14	0.10	0.20	0.25	0.15	0.60	0.09	0.54	0.11	0.67	0.03	
05/01/2025 16:30:00	0.73	0.06	0.14	0.10	0.20	0.25	0.15	0.60	0.09	0.54	0.10	0.67	0.04	
05/01/2025 16:45:00	0.73	0.05	0.14	0.10	0.20	0.25	0.15	0.60	0.10	0.55	0.11	0.68	0.04	
05/01/2025 17:00:00	0.74	0.04	0.14	0.10	0.20	0.25	0.15	0.60	0.09	0.55	0.11	0.68	0.04	
05/01/2025 17:15:00	0.74	0.02	0.14	0.10	0.21	0.25	0.16	0.60	0.10	0.55	0.11	0.66	0.07	
05/01/2025 17:30:00	0.74	0.00	0.14	0.10	0.21	0.25	0.16	0.60	0.10	0.56	0.11	0.64	0.09	
05/01/2025 17:45:00	0.74	0.00	0.14	0.10	0.21	0.25	0.16	0.61	0.09	0.56	0.11	0.62	0.11	
05/01/2025 18:00:00	0.74	0.09	0.14	0.10	0.21	0.25	0.16	0.61	0.10	0.56	0.11	0.60	0.10	
05/01/2025 18:15:00	0.74	0.06	0.14	0.10	0.21	0.25	0.16	0.61	0.11	0.56	0.10	0.59	0.11	
05/01/2025 18:30:00	0.74	0.03	0.14	0.10	0.21	0.25	0.16	0.61	0.10	0.56	0.10	0.57	0.12	
05/01/2025 18:45:00	0.74	0.00	0.14	0.10	0.21	0.25	0.16	0.61	0.09	0.56	0.11	0.56	0.12	
05/01/2025 19:00:00	0.73	0.00	0.14	0.11	0.21	0.25	0.16	0.61	0.09	0.56	0.11	0.55	0.11	
05/01/2025 19:15:00	0.73	0.00	0.15	0.11	0.21	0.25	0.16	0.61	0.10	0.56	0.12	0.54	0.10	
05/01/2025 19:30:00	0.73	0.00	0.14	0.10	0.21	0.25	0.16	0.61	0.09	0.56	0.11	0.54	0.13	
05/01/2025 19:45:00	0.72	0.00	0.14	0.10	0.21	0.25	0.16	0.61	0.10	0.56	0.12	0.53	0.12	
05/01/2025 20:00:00	0.72	0.00	0.14	0.10	0.21	0.25	0.16	0.61	0.10	0.56	0.12	0.52	0.13	
05/01/2025 20:15:00	0.72	0.00	0.14	0.10	0.21	0.25	0.16	0.61	0.09	0.56	0.13	0.52	0.10	
05/01/2025 20:30:00	0.72	0.00	0.14	0.10	0.21	0.25	0.16	0.61	0.09	0.56	0.12	0.52	0.09	
05/01/2025 20:45:00	0.71	0.00	0.14	0.10	0.21	0.25	0.16	0.61	0.09	0.56	0.12	0.51	0.10	
05/01/2025 21:00:00	0.71	0.00	0.14	0.10	0.21	0.25	0.16	0.62	0.09	0.56	0.13	0.51	0.09	
05/01/2025 21:15:00	0.71	0.09	0.14	0.11	0.21	0.25	0.16	0.62	0.10	0.56	0.12	0.51	0.09	
05/01/2025 21:30:00	0.71	0.09	0.14	0.11	0.21	0.25	0.16	0.62	0.09	0.56	0.11	0.52	0.09	
05/01/2025 21:45:00	0.71	0.08	0.15	0.11	0.21	0.25	0.16	0.62	0.10	0.56	0.13	0.54	0.06	
05/01/2025 22:00:00	0.71	0.08	0.15	0.11	0.21	0.25	0.16	0.62	0.10	0.57	0.13	0.57	0.06	
05/01/2025 22:15:00	0.71	0.09	0.15	0.11	0.21	0.25	0.16	0.63	0.09	0.56	0.12	0.59	0.06	
05/01/2025 22:30:00	0.72	0.07	0.15	0.11	0.21	0.25	0.16	0.64	0.09	0.56	0.14	0.61	0.04	
05/01/2025 22:45:00	0.72	0.07	0.15	0.11	0.21	0.26	0.16	0.64	0.09	0.57	0.13	0.63	0.04	
05/01/2025 23:00:00	0.72	0.07	0.15	0.11	0.21	0.26	0.16	0.64	0.10	0.57	0.12	0.64	0.05	
05/01/2025 23:15:00	0.73	0.07	0.15	0.11	0.21	0.26	0.17	0.64	0.10	0.57	0.11	0.66	0.05	
05/01/2025 23:30:00	0.74	0.06	0.15	0.12	0.22	0.26	0.17	0.64	0.09	0.57	0.13	0.67	0.05	
05/01/2025 23:45:00	0.74	0.06	0.15	0.12	0.22	0.26	0.17	0.64	0.09	0.58	0.12	0.68	0.03	
06/01/2025 00:00:00	0.75	0.07	0.15	0.12	0.22	0.26	0.17	0.64	0.09	0.58	0.11	0.69	0.04	
06/01/2025 00:15:00	0.76	0.05	0.16	0.12	0.22	0.26	0.17	0.64	0.09	0.58	0.13	0.70	0.04	
06/01/2025 00:30:00	0.76	0.02	0.16	0.12	0.22	0.25	0.17	0.64	0.08	0.58	0.13	0.70	0.04	
06/01/2025 00:45:00	0.77	0.00	0.16	0.12	0.22	0.26	0.17	0.64	0.10	0.59	0.11	0.71	0.03	
06/01/2025 01:00:00	0.77	0.06	0.16	0.12	0.22	0.26	0.17	0.64	0.09	0.59	0.12	0.72	0.04	
06/01/2025 01:15:00	0.78	0.05	0.16	0.12	0.22	0.26	0.17	0.64	0.09	0.59	0.12	0.72	0.04	
06/01/2025 01:30:00	0.78	0.06	0.16	0.12	0.22	0.26	0.17	0.64	0.09	0.60	0.10	0.73	0.04	
06/01/2025 01:45:00	0.79	0.06	0.16	0.12	0.22	0.26	0.17	0.64	0.08	0.60	0.10	0.73	0.04	
06/01/2025 02:00:00	0.79	0.06	0.16	0.12	0.22	0.26	0.17	0.64	0.09	0.60	0.09	0.74	0.03	
06/01/2025 02:15:00	0.80	0.06	0.16	0.12	0.22	0.26	0.17	0.64	0.09	0.60	0.07	0.74	0.04	
06/01/2025 02:30:00	0.80	0.07	0.16	0.12	0.22	0.26	0.17	0.64	0.09	0.61	0.09	0.75	0.04	
06/01/2025 02:45:00	0.81	0.06	0.16	0.12	0.22	0.26	0.17	0.64	0.09	0.61	0.08	0.75	0.03	
06/01/2025 03:00:00	0.81	0.05	0.16	0.12	0.22	0.27	0.17	0.64	0.09	0.61	0.10	0.76	0.04	
06/01/2025 03:15:00	0.81	0.07	0.16	0.12	0.22	0.27	0.17	0.64	0.09	0.61	0.05	0.76	0.04	
06/01/2025 03:30:00	0.82	0.08	0.16	0.12	0.22	0.25	0.17	0.64	0.09	0.62	0.11	0.77	0.04	
06/01/2025 03:45:00	0.82	0.06	0.16	0.12	0.22	0.26	0.17	0.64	0.09	0.62	0.07	0.77	0.05	
06/01/2025 04:00:00	0.82	0.07	0.16	0.12	0.22	0.26	0.17	0.64	0.10	0.62	0.08	0.77	0.04	
06/01/2025 04:15:00	0.83	0.07	0.16	0.12	0.22	0.26	0.17	0.64	0.10	0.62	0.06	0.78	0.04	
06/01/2025 04:30:00	0.83	0.07	0.16	0.12	0.24	0.24	0.19	0.64	0.09	0.63	0.07	0.78	0.04	
06/01/2025 04:45:00	0.83	0.08	0.16	0.12	0.27	0.24	0.24	0.64	0.08	0.63	0.08	0.78	0.04	
06/01/2025 05:00:00	0.84	0.07	0.16	0.13	0.29	0.24	0.26	0.64	0.09	0.63	0.07	0.78	0.06	
06/01/2025 05:15:00	0.84	0.06	0.16	0.13	0.30	0.24	0.27	0.64	0.10	0.63	0.08	0.76	0.10	
06/01/2025 05:30:00	0.84	0.07	0.17	0.13	0.30	0.24	0.27	0.64	0.10	0.63	0.07	0.73	0.09	
06/01/2025 05:45:00	0.83	0.08	0.17	0.13	0.30	0.24	0.28	0.64	0.11	0.64	0.08	0.71	0.11	
06/01/2025 06:00:00	0.83	0.10	0.17	0.13	0.31	0.24	0.28	0.64	0.09	0.63	0.09	0.69	0.13	
06/01/2025 06:15:00	0.83	0.11	0.17	0.13	0.31	0.24	0.28	0.65	0.09	0.63	0.08	0.68	0.13	
06/01/2025 06:30:00	0.82	0.07	0.17	0.13	0.31	0.24	0.29	0.65	0.10	0.63	0.08	0.67	0.09	
06/01/2025 06:45:00	0.82	0.09	0.17	0.13	0.31	0.24	0.29	0.64	0.09	0.63	0.09	0.66	0.13	
06/01/2025 07:00:00	0.81	0.10	0.17	0.14	0.31	0.24	0.29	0.64	0.08	0.63	0.10	0.65	0.12	
06/01/2025 07:15:00	0.81	0.09	0.17	0.14	0.31	0.24	0.29	0.64	0.08	0.62	0.10	0.64	0.14	
06/01/2025 07:30:00	0.80	0.09	0.17	0.14	0.31	0.24	0.29	0.64	0.09	0.62	0.12	0.63	0.10	
06/01/2025 07:45:00	0.80	0.08	0.17	0.14	0.31	0.24	0.29	0.64	0.09	0.62	0.11	0.62	0.12	
06/01/2025 08:00:00	0.80	0.10	0.17	0.14	0.32	0.24	0.30	0.64	0.09	0.62	0.11	0.62	0.12	
06/01/2025 08:15:00	0.79	0.09	0.17	0.14	0.32	0.24	0.30	0.64	0.10	0.62	0.13	0.61	0.12	
06/01/2025 08:30:00	0.79	0.09	0.17	0.14	0.32	0.24	0.30	0.64	0.10	0.62	0.13	0.61	0.12	
06/01/2025 08:45:00	0.79	0.10	0.17	0.14	0.32	0.24	0.30	0.64	0.09	0.62	0.11	0.60	0.11	
06/01/2025 09:00:00	0.79	0.08	0.17	0.14	0.32	0.24	0.30	0.63	0.08	0.62	0.13	0.60	0.10	
06/01/2025 09:15:00	0.78	0.11	0.17	0.14	0.32	0.24	0.30	0.63	0.10	0.61	0.11	0.60	0.11	
06/01/2025 09:30:00	0.78	0.09	0.17	0.14	0.32	0.24	0.30	0.63	0.11	0.61	0.14	0.59	0.12	
06/01/2025 09:45:00	0.78	0.10	0.17	0.14	0.32	0.24	0.30	0.63	0.09	0.61	0.13	0.59	0.13	
06/01/2025 10:00:00	0.78	0.09	0.17	0.14	0.32	0.24	0.30	0.63	0.09	0.61	0.14	0.59	0.12	
06/01/2025 10:15:00	0.77	0.08	0.17	0.14	0.32	0.24	0.30	0.63	0.09	0.61	0.14	0.59	0.11	
06/01/2025 10:30:00	0.77	0.08	0.18	0.15	0.32	0.24	0.30	0.63	0.11	0.61	0.14	0.58	0.13	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
06/01/2025 10:45:00	0.77	0.09	0.18	0.15	0.32	0.24	0.30	0.63	0.11	0.61	0.15	0.58	0.11	
06/01/2025 11:00:00	0.77	0.08	0.18	0.15	0.32	0.24	0.30	0.64	0.09	0.61	0.15	0.58	0.14	
06/01/2025 11:15:00	0.77	0.09	0.18	0.15	0.32	0.24	0.30	0.64	0.10	0.61	0.18	0.58	0.12	
06/01/2025 11:30:00	0.77	0.09	0.18	0.15	0.32	0.24	0.30	0.64	0.11	0.61	0.15	0.58	0.09	
06/01/2025 11:45:00	0.76	0.06	0.18	0.15	0.32	0.24	0.30	0.64	0.10	0.61	0.14	0.58	0.09	
06/01/2025 12:00:00	0.76	0.03	0.18	0.15	0.32	0.24	0.30	0.64	0.10	0.61	0.16	0.59	0.08	
06/01/2025 12:15:00	0.76	0.00	0.18	0.15	0.32	0.24	0.30	0.64	0.10	0.60	0.16	0.61	0.08	
06/01/2025 12:30:00	0.76	0.08	0.18	0.15	0.32	0.24	0.30	0.64	0.09	0.60	0.16	0.63	0.05	
06/01/2025 12:45:00	0.76	0.08	0.18	0.15	0.32	0.24	0.31	0.64	0.09	0.60	0.15	0.66	0.03	
06/01/2025 13:00:00	0.77	0.07	0.18	0.15	0.32	0.24	0.31	0.63	0.08	0.60	0.14	0.69	0.04	
06/01/2025 13:15:00	0.77	0.06	0.18	0.15	0.32	0.24	0.31	0.63	0.10	0.60	0.16	0.71	0.03	
06/01/2025 13:30:00	0.78	0.06	0.18	0.15	0.32	0.24	0.31	0.63	0.08	0.61	0.14	0.73	0.02	
06/01/2025 13:45:00	0.79	0.06	0.19	0.16	0.32	0.24	0.31	0.63	0.10	0.61	0.14	0.74	0.03	
06/01/2025 14:00:00	0.79	0.04	0.18	0.15	0.32	0.24	0.31	0.62	0.10	0.61	0.14	0.75	0.02	
06/01/2025 14:15:00	0.80	0.02	0.19	0.16	0.32	0.24	0.31	0.62	0.10	0.61	0.15	0.76	0.03	
06/01/2025 14:30:00	0.81	0.00	0.18	0.15	0.32	0.24	0.31	0.62	0.11	0.62	0.14	0.77	0.03	
06/01/2025 14:45:00	0.81	0.00	0.19	0.16	0.32	0.24	0.31	0.62	0.08	0.62	0.13	0.77	0.03	
06/01/2025 15:00:00	0.82	0.00	0.18	0.15	0.32	0.24	0.31	0.62	0.09	0.62	0.14	0.78	0.03	
06/01/2025 15:15:00	0.83	0.00	0.19	0.16	0.32	0.24	0.31	0.62	0.09	0.62	0.15	0.78	0.04	
06/01/2025 15:30:00	0.83	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.09	0.63	0.13	0.79	0.03	
06/01/2025 15:45:00	0.83	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.08	0.63	0.13	0.79	0.03	
06/01/2025 16:00:00	0.84	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.09	0.63	0.13	0.79	0.03	
06/01/2025 16:15:00	0.84	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.09	0.63	0.12	0.80	0.02	
06/01/2025 16:30:00	0.84	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.10	0.64	0.13	0.80	0.04	
06/01/2025 16:45:00	0.85	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.08	0.64	0.13	0.80	0.03	
06/01/2025 17:00:00	0.85	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.08	0.64	0.13	0.80	0.02	
06/01/2025 17:15:00	0.85	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.09	0.64	0.12	0.81	0.04	
06/01/2025 17:30:00	0.85	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.09	0.64	0.12	0.81	0.05	
06/01/2025 17:45:00	0.85	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.09	0.64	0.12	0.81	0.04	
06/01/2025 18:00:00	0.86	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.09	0.65	0.12	0.81	0.04	
06/01/2025 18:15:00	0.86	0.00	0.18	0.15	0.32	0.24	0.31	0.61	0.10	0.65	0.12	0.81	0.04	
06/01/2025 18:30:00	0.86	0.00	0.18	0.15	0.32	0.23	0.31	0.61	0.08	0.65	0.12	0.81	0.06	
06/01/2025 18:45:00	0.86	0.00	0.18	0.15	0.32	0.23	0.31	0.61	0.07	0.65	0.12	0.80	0.07	
06/01/2025 19:00:00	0.86	0.00	0.18	0.15	0.32	0.23	0.31	0.60	0.08	0.65	0.11	0.78	0.07	
06/01/2025 19:15:00	0.86	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.08	0.65	0.12	0.77	0.06	
06/01/2025 19:30:00	0.85	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.07	0.65	0.11	0.76	0.09	
06/01/2025 19:45:00	0.85	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.09	0.65	0.12	0.75	0.08	
06/01/2025 20:00:00	0.85	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.09	0.65	0.12	0.74	0.12	
06/01/2025 20:15:00	0.84	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.07	0.64	0.12	0.73	0.10	
06/01/2025 20:30:00	0.84	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.09	0.64	0.12	0.72	0.08	
06/01/2025 20:45:00	0.84	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.08	0.64	0.12	0.71	0.08	
06/01/2025 21:00:00	0.83	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.08	0.64	0.13	0.71	0.10	
06/01/2025 21:15:00	0.83	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.09	0.64	0.12	0.70	0.08	
06/01/2025 21:30:00	0.83	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.08	0.64	0.13	0.71	0.09	
06/01/2025 21:45:00	0.82	0.00	0.18	0.15	0.32	0.23	0.30	0.60	0.07	0.63	0.13	0.72	0.08	
06/01/2025 22:00:00	0.82	0.00	0.18	0.15	0.32	0.23	0.30	0.59	0.09	0.63	0.13	0.73	0.05	
06/01/2025 22:15:00	0.82	0.00	0.18	0.14	0.32	0.23	0.30	0.59	0.07	0.63	0.14	0.76	0.04	
06/01/2025 22:30:00	0.83	0.00	0.18	0.15	0.32	0.23	0.30	0.59	0.08	0.63	0.13	0.77	0.03	
06/01/2025 22:45:00	0.83	0.00	0.18	0.14	0.32	0.23	0.30	0.59	0.06	0.63	0.14	0.79	0.03	
06/01/2025 23:00:00	0.83	0.00	0.18	0.14	0.32	0.23	0.30	0.59	0.07	0.63	0.13	0.79	0.03	
06/01/2025 23:15:00	0.84	0.00	0.18	0.15	0.32	0.23	0.30	0.59	0.07	0.64	0.13	0.80	0.03	
06/01/2025 23:30:00	0.84	0.00	0.18	0.15	0.32	0.23	0.30	0.59	0.07	0.64	0.12	0.81	0.02	
06/01/2025 23:45:00	0.85	0.00	0.18	0.14	0.32	0.23	0.30	0.59	0.07	0.64	0.12	0.81	0.03	
07/01/2025 00:00:00	0.85	0.00	0.18	0.14	0.32	0.23	0.30	0.59	0.08	0.64	0.11	0.81	0.03	
07/01/2025 00:15:00	0.85	0.00	0.17	0.14	0.32	0.23	0.30	0.59	0.07	0.64	0.11	0.82	0.04	
07/01/2025 00:30:00	0.86	0.00	0.17	0.14	0.32	0.23	0.30	0.58	0.08	0.65	0.12	0.82	0.04	
07/01/2025 00:45:00	0.86	0.00	0.17	0.14	0.32	0.23	0.30	0.58	0.06	0.65	0.12	0.82	0.04	
07/01/2025 01:00:00	0.86	0.00	0.18	0.14	0.32	0.23	0.30	0.58	0.07	0.65	0.11	0.82	0.04	
07/01/2025 01:15:00	0.87	0.00	0.18	0.14	0.32	0.23	0.30	0.58	0.06	0.65	0.11	0.83	0.04	
07/01/2025 01:30:00	0.87	0.00	0.17	0.14	0.32	0.23	0.30	0.58	0.08	0.65	0.11	0.83	0.04	
07/01/2025 01:45:00	0.87	0.00	0.17	0.14	0.32	0.23	0.30	0.58	0.08	0.65	0.11	0.83	0.03	
07/01/2025 02:00:00	0.87	0.00	0.17	0.14	0.32	0.23	0.30	0.58	0.07	0.66	0.11	0.84	0.02	
07/01/2025 02:15:00	0.87	0.00	0.17	0.14	0.32	0.22	0.30	0.58	0.07	0.66	0.11	0.84	0.03	
07/01/2025 02:30:00	0.87	0.05	0.17	0.14	0.32	0.22	0.30	0.58	0.08	0.66	0.11	0.84	0.03	
07/01/2025 02:45:00	0.88	0.05	0.17	0.14	0.32	0.22	0.30	0.58	0.07	0.66	0.11	0.84	0.02	
07/01/2025 03:00:00	0.88	0.05	0.17	0.14	0.32	0.22	0.30	0.58	0.08	0.66	0.11	0.85	0.03	
07/01/2025 03:15:00	0.88	0.05	0.17	0.14	0.32	0.22	0.30	0.58	0.08	0.66	0.11	0.85	0.03	
07/01/2025 03:30:00	0.88	0.05	0.17	0.14	0.32	0.22	0.30	0.57	0.07	0.67	0.11	0.85	0.02	
07/01/2025 03:45:00	0.88	0.03	0.17	0.14	0.32	0.22	0.30	0.57	0.07	0.67	0.10	0.85	0.03	
07/01/2025 04:00:00	0.89	0.02	0.17	0.14	0.31	0.22	0.29	0.57	0.07	0.67	0.10	0.86	0.02	
07/01/2025 04:15:00	0.89	0.00	0.17	0.14	0.31	0.22	0.29	0.57	0.06	0.67	0.10	0.86	0.03	
07/01/2025 04:30:00	0.89	0.00	0.17	0.14	0.31	0.22	0.29	0.57	0.07	0.67	0.10	0.86	0.03	
07/01/2025 04:45:00	0.89	0.04	0.17	0.14	0.31	0.22	0.29	0.57	0.07	0.67	0.09	0.86	0.02	
07/01/2025 05:00:00	0.89	0.04	0.17	0.14	0.31	0.22	0.29	0.56	0.07	0.67	0.09	0.87	0.04	
07/01/2025 05:15:00	0.89	0.05	0.17	0.13	0.31	0.22	0.29	0.56	0.07	0.67	0.09	0.87	0.03	
07/01/2025 05:30:00	0.90	0.05	0.17	0.13	0.31	0.22	0.29	0.56	0.07	0.67	0.09	0.87	0.02	
07/01/2025 05:45:00	0.90	0.03	0.17	0.13	0.31	0.22	0.29	0.56	0.07	0.67	0.10	0.87	0.04	
07/01/2025 06:00:00	0.90	0.02	0.17	0.13	0.31	0.22	0.29	0.56	0.05	0.68	0.09	0.87	0.02	
07/01/2025 06:15:00	0.90	0.00	0.17	0.13	0.31	0.22	0.29	0.56	0.06	0.68	0.09	0.88	0.03	
07/01/2025 06:30:00	0.90	0.00	0.17	0.13	0.31	0.22	0.29	0.56	0.07	0.68	0.09	0.88	0.05	
07/01/2025 06:45:00	0.90	0.00	0.17	0.13	0.31	0.22	0.29	0.56	0.07	0.68	0.09	0.88	0.03	
07/01/2025 07:00:00	0.90	0.00	0.17	0.13	0.31	0.22	0.29	0.55	0.06	0.68	0.09	0.87	0.04	
07/01/2025 07:15:00	0.90	0.04	0.16	0.13	0.31	0.22	0.29	0.55	0.08	0.68	0.09	0.86	0.05	
07/01/2025 07:30:00	0.90	0.04	0.16	0.13	0.31	0.22	0.29	0.55	0.07	0.68	0.10	0.85	0.05	
07/01/2025 07:45:00	0.90	0.04	0.16	0.13	0.31	0.22	0.29	0.55	0.08	0.68	0.09	0.83	0.09	
07/01/2025 08:00:00	0.90	0.03	0.16	0.13	0.31	0.21	0.29	0.55	0.08	0.68	0.09	0.82	0.09	
07/01/2025 08:15:00	0.89	0.01	0.16	0.13	0.31	0.21	0.29	0.55	0.08	0.68	0.10	0.81	0.10	
07/01/2025 08:30:00	0.89	0.00	0.16	0.13	0.31	0.21	0.29	0.55	0.07	0.67	0.10	0.79	0.10	
07/01/2025 08:45:00	0.89	0.00	0.16	0.13	0.31	0.21	0.29	0.55	0.03	0.67	0.10	0.78	0.09	
07/01/2025 09:00:00	0.88	0.00	0.16	0.13	0.31	0.21	0.29	0.55	0.06	0.67	0.11	0.77	0.11	
07/01/2025 09:15:00	0.88	0.00	0.16	0.12	0.31	0.21	0.29	0.55	0.06	0.67	0.10	0.76	0.10	
07/01/2025 09:30:00	0.87	0.00	0.16	0.12	0.31	0.21	0.29	0.55	0.08	0.66	0.11	0.75	0.09	
07/01/2025 09:45:00	0.87	0.00	0.16	0.12	0.31	0.21	0.29	0.55	0.07	0.66	0.11	0.74	0.12	
07/01/2025 10:00:00	0.86	0.00	0.16	0.12	0.31	0.21	0.29	0.55	0.07	0.66	0.11	0.73	0.09	
07/01/2025 10:15:00	0.86	0.00	0.16	0.12	0.31	0.21	0.29	0.55	0.06	0.66	0.12	0.72	0.08	
07/01/2025 10:30:00	0.85	0.00	0.16	0.12	0.31	0.21	0.28	0.54	0.06	0.65	0.12	0.72	0.09	
07/01/2025 10:45:00	0.85	0.00	0.16	0.12	0.31	0.21	0.28	0.54	0.06	0.65	0.11	0.71	0.11	
07/01/2025 11:00:00	0.85	0.00	0.16	0.12	0.31	0.21	0.28	0.54	0.05	0.65	0.12	0.71	0.12	
07/01/2025 11:15:00	0.84	0.00	0.16	0.12	0.31	0.21	0.28	0.54	0.06	0.65	0.13	0.70	0.09	
07/01/2025 11:30:00	0.84	0.00	0.15	0.12	0.31	0.21	0.28	0.54	0.05	0.64	0.12	0.70	0.08	
07/01/2025 11:45:00	0.83	0.00	0.16	0.12	0.31	0.21	0.28	0.54	0.07	0.64	0.13	0.70	0.09	
07/01/2025 12:00:00	0.83	0.00	0.16	0.12	0.30	0.21	0.28	0.54	0.05	0.64	0.13	0.70	0.08	
07/01/2025 12:15:00	0.83	0.00	0.15	0.12	0.30	0.21	0.28	0.54	0.05	0.64	0.13	0.71	0.07	
07/01/2025 12:30:00	0.83	0.00	0.15	0.12	0.30	0.21	0.28	0.54	0.08	0.63	0.13	0.73	0.03	
07/01/2025 12:45:00	0.83	0.00	0.16	0.12	0.30	0.21	0.28	0.53	0.06	0.63	0.13	0.77	0.03	
07/01/2025 13:00:00	0.83	0.00	0.16	0.12	0.30	0.21	0.28	0.53	0.04	0.63	0.13	0.79	0.02	
07/01/2025 13:15:00	0.84	0.00	0.15	0.11	0.30	0.21	0.28	0.53	0.03	0.63	0.13	0.80	0.01	
07/01/2025 13:30:00	0.84	0.00	0.15	0.11	0.30	0.21	0.28	0.53	0.06	0.64	0.13	0.81	0.03	
07/01/2025 13:45:00	0.85	0.00	0.15	0.12	0.30	0.21	0.28	0.53	0.06	0.64	0.13	0.81	0.02	
07/01/2025 14:00:00	0.85	0.00	0.15	0.11	0.30	0.21	0.28	0.53	0.04	0.64	0.11	0.82	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
07/01/2025 14:15:00	0.86	0.00	0.15	0.11	0.30	0.21	0.27	0.53	0.05	0.64	0.11	0.82	0.02	
07/01/2025 14:30:00	0.86	0.00	0.15	0.11	0.30	0.21	0.27	0.52	0.06	0.64	0.11	0.82	0.02	
07/01/2025 14:45:00	0.86	0.00	0.15	0.11	0.30	0.20	0.27	0.52	0.06	0.65	0.11	0.83	0.04	
07/01/2025 15:00:00	0.86	0.00	0.15	0.11	0.30	0.20	0.27	0.52	0.06	0.65	0.10	0.83	0.02	
07/01/2025 15:15:00	0.87	0.00	0.15	0.11	0.30	0.20	0.27	0.52	0.04	0.65	0.10	0.83	0.02	
07/01/2025 15:30:00	0.87	0.00	0.15	0.11	0.30	0.20	0.27	0.51	0.05	0.65	0.10	0.84	0.02	
07/01/2025 15:45:00	0.87	0.00	0.15	0.11	0.30	0.20	0.27	0.51	0.05	0.65	0.10	0.84	0.03	
07/01/2025 16:00:00	0.87	0.00	0.15	0.11	0.30	0.20	0.27	0.51	0.05	0.65	0.10	0.84	0.02	
07/01/2025 16:15:00	0.87	0.00	0.15	0.11	0.29	0.20	0.27	0.51	0.06	0.65	0.10	0.84	0.02	
07/01/2025 16:30:00	0.88	0.00	0.15	0.11	0.29	0.20	0.27	0.51	0.05	0.66	0.10	0.85	0.02	
07/01/2025 16:45:00	0.88	0.00	0.14	0.10	0.29	0.20	0.27	0.51	0.06	0.66	0.10	0.85	0.01	
07/01/2025 17:00:00	0.88	0.00	0.14	0.10	0.29	0.20	0.26	0.50	0.05	0.66	0.10	0.85	0.03	
07/01/2025 17:15:00	0.88	0.00	0.14	0.10	0.29	0.20	0.26	0.50	0.06	0.66	0.10	0.86	0.03	
07/01/2025 17:30:00	0.88	0.00	0.14	0.10	0.29	0.20	0.26	0.50	0.06	0.66	0.09	0.86	0.03	
07/01/2025 17:45:00	0.89	0.00	0.14	0.10	0.29	0.20	0.26	0.50	0.06	0.66	0.09	0.86	0.02	
07/01/2025 18:00:00	0.89	0.00	0.14	0.10	0.29	0.20	0.26	0.50	0.05	0.66	0.09	0.87	0.01	
07/01/2025 18:15:00	0.89	0.00	0.14	0.10	0.29	0.20	0.26	0.50	0.05	0.67	0.09	0.87	0.02	
07/01/2025 18:30:00	0.89	0.00	0.14	0.10	0.29	0.20	0.26	0.50	0.05	0.67	0.09	0.87	0.03	
07/01/2025 18:45:00	0.89	0.00	0.14	0.10	0.29	0.20	0.26	0.51	0.04	0.67	0.09	0.87	0.02	
07/01/2025 19:00:00	0.90	0.00	0.14	0.10	0.29	0.20	0.26	0.51	0.05	0.67	0.08	0.87	0.04	
07/01/2025 19:15:00	0.90	0.00	0.14	0.10	0.29	0.19	0.26	0.51	0.06	0.67	0.08	0.86	0.03	
07/01/2025 19:30:00	0.90	0.00	0.13	0.09	0.29	0.19	0.26	0.51	0.07	0.67	0.08	0.86	0.04	
07/01/2025 19:45:00	0.89	0.00	0.13	0.09	0.29	0.19	0.26	0.51	0.05	0.67	0.08	0.84	0.06	
07/01/2025 20:00:00	0.89	0.00	0.13	0.09	0.29	0.19	0.26	0.51	0.05	0.67	0.08	0.83	0.07	
07/01/2025 20:15:00	0.89	0.00	0.13	0.09	0.29	0.19	0.26	0.51	0.07	0.67	0.08	0.82	0.07	
07/01/2025 20:30:00	0.88	0.00	0.13	0.09	0.29	0.19	0.26	0.51	0.04	0.67	0.09	0.80	0.06	
07/01/2025 20:45:00	0.88	0.00	0.13	0.09	0.29	0.19	0.26	0.51	0.06	0.66	0.09	0.79	0.08	
07/01/2025 21:00:00	0.88	0.00	0.13	0.09	0.29	0.19	0.26	0.51	0.04	0.66	0.09	0.78	0.09	
07/01/2025 21:15:00	0.87	0.00	0.13	0.09	0.29	0.19	0.26	0.51	0.06	0.66	0.09	0.77	0.10	
07/01/2025 21:30:00	0.87	0.00	0.13	0.09	0.29	0.19	0.26	0.50	0.05	0.66	0.10	0.76	0.12	
07/01/2025 21:45:00	0.86	0.00	0.13	0.09	0.29	0.19	0.26	0.50	0.06	0.65	0.10	0.75	0.09	
07/01/2025 22:00:00	0.86	0.00	0.13	0.09	0.29	0.19	0.26	0.50	0.05	0.65	0.10	0.74	0.11	
07/01/2025 22:15:00	0.85	0.00	0.13	0.09	0.29	0.19	0.26	0.50	0.06	0.65	0.10	0.74	0.10	
07/01/2025 22:30:00	0.85	0.00	0.13	0.09	0.29	0.19	0.26	0.50	0.05	0.65	0.11	0.73	0.09	
07/01/2025 22:45:00	0.85	0.00	0.13	0.09	0.29	0.19	0.25	0.50	0.05	0.64	0.11	0.73	0.09	
07/01/2025 23:00:00	0.84	0.00	0.13	0.09	0.29	0.19	0.25	0.49	0.07	0.64	0.10	0.74	0.06	
07/01/2025 23:15:00	0.84	0.00	0.13	0.09	0.29	0.19	0.25	0.49	0.05	0.64	0.10	0.75	0.06	
07/01/2025 23:30:00	0.84	0.00	0.13	0.09	0.28	0.19	0.25	0.49	0.05	0.64	0.11	0.77	0.06	
07/01/2025 23:45:00	0.84	0.00	0.13	0.09	0.28	0.19	0.25	0.49	0.06	0.63	0.11	0.79	0.04	
08/01/2025 00:00:00	0.84	0.00	0.13	0.09	0.28	0.19	0.25	0.49	0.05	0.63	0.11	0.81	0.04	
08/01/2025 00:15:00	0.85	0.00	0.13	0.09	0.28	0.19	0.25	0.49	0.05	0.64	0.11	0.82	0.02	
08/01/2025 00:30:00	0.85	0.00	0.13	0.09	0.28	0.19	0.25	0.49	0.06	0.64	0.12	0.82	0.03	
08/01/2025 00:45:00	0.86	0.00	0.13	0.09	0.28	0.19	0.25	0.48	0.06	0.64	0.11	0.83	0.03	
08/01/2025 01:00:00	0.86	0.00	0.13	0.09	0.28	0.19	0.25	0.48	0.06	0.64	0.11	0.83	0.03	
08/01/2025 01:15:00	0.86	0.00	0.13	0.09	0.28	0.19	0.25	0.48	0.04	0.64	0.10	0.83	0.02	
08/01/2025 01:30:00	0.87	0.00	0.13	0.09	0.28	0.19	0.25	0.48	0.05	0.65	0.10	0.83	0.02	
08/01/2025 01:45:00	0.87	0.00	0.13	0.09	0.28	0.19	0.25	0.48	0.04	0.65	0.10	0.84	0.02	
08/01/2025 02:00:00	0.87	0.00	0.13	0.09	0.28	0.19	0.25	0.47	0.05	0.65	0.09	0.84	0.02	
08/01/2025 02:15:00	0.87	0.00	0.12	0.08	0.28	0.19	0.25	0.47	0.04	0.65	0.09	0.84	0.03	
08/01/2025 02:30:00	0.87	0.00	0.12	0.08	0.28	0.19	0.24	0.47	0.04	0.65	0.09	0.85	0.03	
08/01/2025 02:45:00	0.87	0.00	0.12	0.08	0.28	0.19	0.24	0.47	0.04	0.65	0.09	0.85	0.03	
08/01/2025 03:00:00	0.88	0.00	0.12	0.08	0.28	0.18	0.24	0.47	0.01	0.65	0.08	0.85	0.02	
08/01/2025 03:15:00	0.88	0.00	0.12	0.08	0.28	0.18	0.24	0.47	0.06	0.65	0.08	0.86	0.03	
08/01/2025 03:30:00	0.88	0.00	0.12	0.08	0.28	0.18	0.24	0.47	0.05	0.66	0.08	0.86	0.01	
08/01/2025 03:45:00	0.88	0.00	0.12	0.08	0.28	0.18	0.24	0.46	0.05	0.66	0.08	0.86	0.02	
08/01/2025 04:00:00	0.88	0.00	0.12	0.07	0.27	0.18	0.24	0.46	0.04	0.66	0.08	0.86	0.00	
08/01/2025 04:15:00	0.89	0.00	0.11	0.07	0.27	0.18	0.24	0.46	0.04	0.66	0.08	0.87	0.02	
08/01/2025 04:30:00	0.89	0.00	0.11	0.07	0.27	0.18	0.24	0.46	0.03	0.66	0.08	0.87	0.01	
08/01/2025 04:45:00	0.89	0.00	0.11	0.07	0.27	0.18	0.24	0.46	0.03	0.66	0.08	0.87	0.02	
08/01/2025 05:00:00	0.89	0.00	0.11	0.07	0.27	0.18	0.24	0.46	0.03	0.66	0.08	0.87	0.01	
08/01/2025 05:15:00	0.89	0.00	0.11	0.07	0.27	0.18	0.23	0.46	0.03	0.67	0.07	0.88	0.01	
08/01/2025 05:30:00	0.90	0.00	0.11	0.07	0.27	0.18	0.23	0.46	0.04	0.67	0.07	0.88	0.02	
08/01/2025 05:45:00	0.90	0.00	0.11	0.07	0.27	0.18	0.23	0.46	0.05	0.67	0.08	0.88	0.01	
08/01/2025 06:00:00	0.90	0.00	0.11	0.07	0.27	0.18	0.23	0.46	0.03	0.67	0.07	0.88	0.02	
08/01/2025 06:15:00	0.90	0.00	0.11	0.07	0.27	0.18	0.23	0.46	0.00	0.67	0.07	0.88	0.01	
08/01/2025 06:30:00	0.90	0.00	0.11	0.07	0.27	0.18	0.23	0.46	0.06	0.67	0.06	0.89	0.01	
08/01/2025 06:45:00	0.90	0.00	0.11	0.07	0.26	0.18	0.23	0.46	0.04	0.67	0.06	0.89	0.02	
08/01/2025 07:00:00	0.91	0.00	0.10	0.06	0.26	0.18	0.23	0.45	0.06	0.67	0.06	0.89	0.01	
08/01/2025 07:15:00	0.91	0.00	0.10	0.06	0.26	0.18	0.23	0.45	0.06	0.67	0.06	0.89	0.01	
08/01/2025 07:30:00	0.91	0.00	0.10	0.06	0.26	0.18	0.22	0.45	0.05	0.68	0.06	0.89	0.03	
08/01/2025 07:45:00	0.91	0.00	0.10	0.06	0.26	0.18	0.22	0.45	0.05	0.68	0.06	0.88	0.03	
08/01/2025 08:00:00	0.91	0.00	0.10	0.06	0.26	0.17	0.22	0.46	0.06	0.68	0.06	0.87	0.05	
08/01/2025 08:15:00	0.90	0.00	0.10	0.06	0.26	0.17	0.22	0.46	0.06	0.68	0.06	0.85	0.05	
08/01/2025 08:30:00	0.90	0.00	0.10	0.06	0.26	0.17	0.22	0.46	0.06	0.67	0.06	0.84	0.08	
08/01/2025 08:45:00	0.90	0.00	0.10	0.06	0.26	0.17	0.22	0.46	0.05	0.67	0.07	0.82	0.09	
08/01/2025 09:00:00	0.89	0.00	0.10	0.06	0.26	0.17	0.22	0.46	0.06	0.67	0.08	0.81	0.10	
08/01/2025 09:15:00	0.89	0.00	0.10	0.06	0.26	0.17	0.22	0.47	0.06	0.67	0.08	0.79	0.08	
08/01/2025 09:30:00	0.88	0.00	0.10	0.06	0.26	0.17	0.22	0.47	0.06	0.66	0.08	0.78	0.08	
08/01/2025 09:45:00	0.88	0.00	0.10	0.06	0.26	0.17	0.22	0.47	0.05	0.66	0.07	0.77	0.07	
08/01/2025 10:00:00	0.87	0.00	0.10	0.06	0.26	0.17	0.22	0.47	0.05	0.66	0.08	0.76	0.09	
08/01/2025 10:15:00	0.86	0.00	0.10	0.06	0.26	0.17	0.22	0.47	0.07	0.65	0.09	0.75	0.08	
08/01/2025 10:30:00	0.86	0.00	0.10	0.06	0.26	0.17	0.22	0.48	0.06	0.65	0.09	0.74	0.09	
08/01/2025 10:45:00	0.85	0.00	0.10	0.06	0.26	0.17	0.22	0.48	0.05	0.65	0.09	0.73	0.08	
08/01/2025 11:00:00	0.85	0.00	0.10	0.06	0.26	0.17	0.22	0.48	0.05	0.64	0.10	0.73	0.11	
08/01/2025 11:15:00	0.85	0.00	0.10	0.06	0.26	0.17	0.22	0.48	0.05	0.64	0.09	0.72	0.08	
08/01/2025 11:30:00	0.84	0.00	0.10	0.06	0.26	0.17	0.22	0.48	0.05	0.63	0.10	0.71	0.09	
08/01/2025 11:45:00	0.84	0.00	0.10	0.06	0.26	0.17	0.23	0.48	0.05	0.63	0.10	0.71	0.10	
08/01/2025 12:00:00	0.83	0.00	0.10	0.06	0.27	0.17	0.23	0.48	0.07	0.63	0.10	0.70	0.08	
08/01/2025 12:15:00	0.83	0.00	0.10	0.06	0.27	0.17	0.23	0.48	0.06	0.62	0.11	0.69	0.10	
08/01/2025 12:30:00	0.82	0.00	0.10	0.06	0.27	0.17	0.23	0.48	0.07	0.62	0.11	0.69	0.10	
08/01/2025 12:45:00	0.82	0.00	0.10	0.06	0.27	0.17	0.23	0.48	0.07	0.62	0.11	0.69	0.06	
08/01/2025 13:00:00	0.81	0.00	0.10	0.06	0.27	0.17	0.23	0.48	0.06	0.62	0.11	0.69	0.06	
08/01/2025 13:15:00	0.81	0.00	0.10	0.06	0.27	0.17	0.23	0.48	0.04	0.61	0.11	0.69	0.08	
08/01/2025 13:30:00	0.81	0.00	0.10	0.06	0.27	0.17	0.23	0.48	0.06	0.61	0.10	0.70	0.06	
08/01/2025 13:45:00	0.81	0.00	0.11	0.06	0.27	0.18	0.23	0.48	0.06	0.61	0.11	0.72	0.04	
08/01/2025 14:00:00	0.81	0.00	0.10	0.06	0.27	0.18	0.23	0.48	0.05	0.61	0.11	0.75	0.02	
08/01/2025 14:15:00	0.81	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.05	0.61	0.11	0.78	0.01	
08/01/2025 14:30:00	0.82	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.61	0.11	0.79	0.01	
08/01/2025 14:45:00	0.82	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.61	0.11	0.80	0.03	
08/01/2025 15:00:00	0.83	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.07	0.61	0.10	0.81	0.01	
08/01/2025 15:15:00	0.84	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.07	0.62	0.09	0.81	0.02	
08/01/2025 15:30:00	0.84	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.62	0.09	0.81	0.02	
08/01/2025 15:45:00	0.84	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.62	0.09	0.82	0.03	
08/01/2025 16:00:00	0.85	0.02	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.62	0.08	0.82	0.03	
08/01/2025 16:15:00	0.85	0.04	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.63	0.08	0.82	0.04	
08/01/2025 16:30:00	0.85	0.04	0.11	0.07	0.27	0.18	0.24	0.47	0.06	0.63	0.08	0.83	0.02	
08/01/2025 16:45:00	0.85	0.04	0.11	0.07	0.27	0.18	0.24	0.47	0.05	0.63	0.08	0.83	0.02	
08/01/2025 17:00:00	0.86	0.05	0.11	0.07	0.27	0.18	0.24	0.47	0.06	0.63	0.07	0.83	0.02	
08/01/2025 17:15:00	0.86	0.02	0.11	0.07	0.27	0.18	0.24	0.47	0.06	0.63	0.08	0.83	0.02	
08/01/2025 17:30:00	0.86	0.03	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.63	0.07	0.84	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
08/01/2025 17:45:00	0.86	0.04	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.64	0.07	0.84	0.03	
08/01/2025 18:00:00	0.86	0.05	0.11	0.06	0.27	0.18	0.24	0.48	0.06	0.64	0.07	0.84	0.03	
08/01/2025 18:15:00	0.87	0.01	0.11	0.07	0.27	0.18	0.24	0.48	0.07	0.64	0.07	0.85	0.03	
08/01/2025 18:30:00	0.87	0.04	0.11	0.07	0.27	0.18	0.24	0.48	0.05	0.64	0.06	0.85	0.03	
08/01/2025 18:45:00	0.87	0.04	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.64	0.06	0.85	0.02	
08/01/2025 19:00:00	0.87	0.03	0.11	0.07	0.27	0.18	0.24	0.48	0.07	0.64	0.06	0.85	0.02	
08/01/2025 19:15:00	0.87	0.05	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.64	0.06	0.86	0.02	
08/01/2025 19:30:00	0.88	0.04	0.11	0.07	0.27	0.18	0.24	0.48	0.07	0.65	0.06	0.86	0.01	
08/01/2025 19:45:00	0.88	0.03	0.11	0.06	0.27	0.18	0.24	0.48	0.07	0.65	0.06	0.86	0.02	
08/01/2025 20:00:00	0.88	0.04	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.65	0.06	0.86	0.00	
08/01/2025 20:15:00	0.88	0.04	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.65	0.06	0.86	0.04	
08/01/2025 20:30:00	0.88	0.04	0.11	0.07	0.27	0.18	0.24	0.49	0.07	0.65	0.06	0.85	0.04	
08/01/2025 20:45:00	0.88	0.04	0.11	0.07	0.27	0.18	0.24	0.49	0.07	0.65	0.06	0.84	0.06	
08/01/2025 21:00:00	0.88	0.06	0.11	0.07	0.27	0.18	0.24	0.49	0.06	0.65	0.06	0.82	0.07	
08/01/2025 21:15:00	0.87	0.05	0.11	0.07	0.27	0.18	0.24	0.49	0.06	0.65	0.06	0.81	0.08	
08/01/2025 21:30:00	0.87	0.05	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.65	0.07	0.80	0.08	
08/01/2025 21:45:00	0.87	0.05	0.11	0.07	0.27	0.18	0.24	0.48	0.05	0.64	0.07	0.78	0.09	
08/01/2025 22:00:00	0.86	0.06	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.64	0.08	0.77	0.10	
08/01/2025 22:15:00	0.86	0.06	0.11	0.07	0.27	0.18	0.24	0.48	0.05	0.64	0.08	0.76	0.10	
08/01/2025 22:30:00	0.85	0.02	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.63	0.08	0.75	0.08	
08/01/2025 22:45:00	0.85	0.04	0.11	0.07	0.27	0.18	0.24	0.48	0.05	0.63	0.08	0.74	0.10	
08/01/2025 23:00:00	0.84	0.04	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.63	0.09	0.73	0.09	
08/01/2025 23:15:00	0.84	0.03	0.11	0.07	0.27	0.18	0.24	0.48	0.05	0.62	0.08	0.72	0.10	
08/01/2025 23:30:00	0.83	0.01	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.62	0.09	0.71	0.11	
08/01/2025 23:45:00	0.83	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.06	0.62	0.09	0.71	0.11	
09/01/2025 00:00:00	0.82	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.05	0.61	0.09	0.70	0.11	
09/01/2025 00:15:00	0.82	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.05	0.61	0.09	0.70	0.09	
09/01/2025 00:30:00	0.81	0.00	0.11	0.07	0.27	0.18	0.24	0.47	0.07	0.61	0.10	0.70	0.07	
09/01/2025 00:45:00	0.81	0.00	0.11	0.07	0.27	0.18	0.24	0.47	0.06	0.60	0.10	0.71	0.06	
09/01/2025 01:00:00	0.81	0.00	0.11	0.07	0.27	0.18	0.24	0.47	0.06	0.60	0.09	0.72	0.05	
09/01/2025 01:15:00	0.81	0.00	0.11	0.07	0.27	0.18	0.24	0.47	0.06	0.60	0.10	0.74	0.05	
09/01/2025 01:30:00	0.81	0.04	0.11	0.07	0.27	0.18	0.24	0.47	0.06	0.60	0.10	0.77	0.03	
09/01/2025 01:45:00	0.81	0.04	0.11	0.07	0.27	0.18	0.24	0.47	0.05	0.60	0.10	0.79	0.01	
09/01/2025 02:00:00	0.82	0.04	0.11	0.07	0.27	0.18	0.24	0.47	0.05	0.60	0.10	0.80	0.01	
09/01/2025 02:15:00	0.82	0.01	0.11	0.07	0.27	0.18	0.24	0.46	0.04	0.60	0.08	0.80	0.02	
09/01/2025 02:30:00	0.83	0.03	0.11	0.07	0.27	0.18	0.24	0.46	0.05	0.61	0.09	0.81	0.03	
09/01/2025 02:45:00	0.84	0.02	0.11	0.07	0.27	0.18	0.24	0.47	0.05	0.61	0.08	0.81	0.03	
09/01/2025 03:00:00	0.84	0.01	0.11	0.07	0.27	0.18	0.24	0.47	0.06	0.61	0.08	0.82	0.02	
09/01/2025 03:15:00	0.84	0.00	0.11	0.07	0.27	0.18	0.24	0.47	0.07	0.62	0.08	0.82	0.02	
09/01/2025 03:30:00	0.85	0.00	0.11	0.07	0.27	0.18	0.24	0.48	0.08	0.62	0.08	0.82	0.02	
09/01/2025 03:45:00	0.85	0.00	0.11	0.07	0.27	0.18	0.23	0.50	0.07	0.62	0.08	0.83	0.03	
09/01/2025 04:00:00	0.85	0.00	0.11	0.07	0.27	0.18	0.24	0.50	0.07	0.62	0.07	0.83	0.02	
09/01/2025 04:15:00	0.85	0.00	0.11	0.07	0.27	0.18	0.24	0.50	0.06	0.62	0.07	0.83	0.02	
09/01/2025 04:30:00	0.85	0.00	0.11	0.07	0.27	0.18	0.24	0.50	0.05	0.62	0.07	0.83	0.03	
09/01/2025 04:45:00	0.86	0.00	0.11	0.07	0.27	0.18	0.24	0.49	0.06	0.63	0.07	0.84	0.03	
09/01/2025 05:00:00	0.86	0.04	0.11	0.07	0.27	0.18	0.24	0.49	0.05	0.63	0.07	0.84	0.01	
09/01/2025 05:15:00	0.86	0.03	0.11	0.07	0.27	0.18	0.24	0.49	0.05	0.63	0.07	0.84	0.01	
09/01/2025 05:30:00	0.86	0.01	0.11	0.07	0.27	0.18	0.24	0.49	0.05	0.63	0.07	0.84	0.02	
09/01/2025 05:45:00	0.86	0.00	0.12	0.07	0.27	0.18	0.24	0.48	0.05	0.63	0.07	0.85	0.03	
09/01/2025 06:00:00	0.87	0.00	0.12	0.08	0.28	0.18	0.24	0.48	0.05	0.63	0.06	0.85	0.01	
09/01/2025 06:15:00	0.87	0.00	0.12	0.08	0.28	0.18	0.24	0.47	0.05	0.64	0.06	0.85	0.01	
09/01/2025 06:30:00	0.87	0.00	0.12	0.08	0.28	0.18	0.24	0.47	0.05	0.64	0.06	0.85	0.00	
09/01/2025 06:45:00	0.87	0.00	0.12	0.08	0.28	0.18	0.24	0.47	0.06	0.64	0.06	0.86	0.02	
09/01/2025 07:00:00	0.87	0.00	0.12	0.08	0.28	0.18	0.24	0.47	0.06	0.64	0.06	0.86	0.03	
09/01/2025 07:15:00	0.88	0.00	0.12	0.08	0.28	0.18	0.24	0.47	0.06	0.64	0.06	0.86	0.01	
09/01/2025 07:30:00	0.88	0.00	0.12	0.08	0.28	0.18	0.24	0.47	0.05	0.64	0.06	0.86	0.02	
09/01/2025 07:45:00	0.88	0.00	0.12	0.08	0.28	0.18	0.24	0.46	0.06	0.65	0.06	0.87	0.01	
09/01/2025 08:00:00	0.88	0.00	0.12	0.07	0.28	0.18	0.24	0.46	0.06	0.65	0.06	0.87	0.01	
09/01/2025 08:15:00	0.88	0.00	0.12	0.07	0.27	0.18	0.24	0.46	0.06	0.65	0.06	0.87	0.01	
09/01/2025 08:30:00	0.88	0.00	0.11	0.07	0.27	0.17	0.24	0.47	0.07	0.65	0.05	0.86	0.02	
09/01/2025 08:45:00	0.88	0.00	0.11	0.07	0.27	0.17	0.24	0.47	0.06	0.65	0.05	0.85	0.05	
09/01/2025 09:00:00	0.88	0.03	0.11	0.07	0.27	0.17	0.24	0.47	0.05	0.65	0.06	0.83	0.07	
09/01/2025 09:15:00	0.88	0.04	0.11	0.07	0.27	0.17	0.24	0.47	0.05	0.65	0.06	0.82	0.08	
09/01/2025 09:30:00	0.87	0.04	0.11	0.07	0.27	0.17	0.24	0.47	0.05	0.64	0.06	0.80	0.07	
09/01/2025 09:45:00	0.87	0.02	0.11	0.07	0.27	0.17	0.24	0.47	0.07	0.64	0.07	0.79	0.08	
09/01/2025 10:00:00	0.86	0.02	0.11	0.07	0.27	0.17	0.24	0.47	0.07	0.64	0.07	0.77	0.11	
09/01/2025 10:15:00	0.86	0.02	0.11	0.07	0.27	0.17	0.24	0.47	0.06	0.63	0.07	0.76	0.07	
09/01/2025 10:30:00	0.85	0.02	0.11	0.07	0.27	0.17	0.24	0.48	0.06	0.63	0.07	0.75	0.08	
09/01/2025 10:45:00	0.85	0.01	0.11	0.07	0.27	0.17	0.24	0.48	0.05	0.63	0.08	0.74	0.08	
09/01/2025 11:00:00	0.84	0.00	0.11	0.07	0.27	0.17	0.24	0.48	0.05	0.62	0.08	0.73	0.10	
09/01/2025 11:15:00	0.83	0.00	0.11	0.07	0.27	0.17	0.24	0.48	0.06	0.62	0.08	0.72	0.09	
09/01/2025 11:30:00	0.83	0.00	0.11	0.07	0.27	0.17	0.24	0.48	0.04	0.62	0.08	0.71	0.09	
09/01/2025 11:45:00	0.82	0.00	0.11	0.07	0.27	0.17	0.24	0.47	0.06	0.61	0.09	0.70	0.09	
09/01/2025 12:00:00	0.82	0.00	0.11	0.07	0.27	0.17	0.24	0.47	0.05	0.61	0.08	0.70	0.08	
09/01/2025 12:15:00	0.81	0.00	0.11	0.07	0.27	0.17	0.24	0.47	0.06	0.60	0.09	0.69	0.10	
09/01/2025 12:30:00	0.81	0.00	0.11	0.07	0.27	0.17	0.24	0.47	0.06	0.60	0.09	0.68	0.11	
09/01/2025 12:45:00	0.81	0.00	0.11	0.07	0.27	0.17	0.24	0.47	0.06	0.60	0.09	0.68	0.09	
09/01/2025 13:00:00	0.80	0.00	0.11	0.07	0.27	0.17	0.24	0.48	0.06	0.59	0.09	0.67	0.10	
09/01/2025 13:15:00	0.80	0.00	0.11	0.07	0.27	0.17	0.24	0.48	0.07	0.59	0.08	0.66	0.11	
09/01/2025 13:30:00	0.79	0.00	0.11	0.07	0.27	0.17	0.24	0.48	0.05	0.59	0.08	0.66	0.08	
09/01/2025 13:45:00	0.79	0.00	0.11	0.07	0.27	0.17	0.24	0.48	0.06	0.58	0.09	0.65	0.12	
09/01/2025 14:00:00	0.78	0.00	0.11	0.07	0.27	0.17	0.24	0.48	0.06	0.58	0.09	0.65	0.08	
09/01/2025 14:15:00	0.78	0.00	0.12	0.07	0.27	0.17	0.24	0.48	0.06	0.58	0.09	0.65	0.09	
09/01/2025 14:30:00	0.78	0.00	0.12	0.08	0.27	0.17	0.24	0.47	0.06	0.57	0.09	0.65	0.07	
09/01/2025 14:45:00	0.77	0.00	0.12	0.08	0.27	0.17	0.24	0.47	0.03	0.57	0.09	0.66	0.03	
09/01/2025 15:00:00	0.77	0.00	0.12	0.07	0.27	0.17	0.24	0.47	0.05	0.57	0.11	0.67	0.03	
09/01/2025 15:15:00	0.77	0.00	0.12	0.07	0.27	0.17	0.24	0.47	0.06	0.57	0.10	0.70	0.02	
09/01/2025 15:30:00	0.77	0.00	0.12	0.08	0.27	0.17	0.24	0.47	0.05	0.56	0.10	0.74	0.03	
09/01/2025 15:45:00	0.78	0.00	0.12	0.07	0.27	0.17	0.24	0.47	0.06	0.56	0.12	0.76	0.02	
09/01/2025 16:00:00	0.79	0.00	0.12	0.07	0.27	0.17	0.24	0.46	0.04	0.57	0.11	0.77	0.01	
09/01/2025 16:15:00	0.79	0.00	0.12	0.07	0.27	0.17	0.24	0.46	0.07	0.57	0.11	0.78	0.01	
09/01/2025 16:30:00	0.80	0.00	0.12	0.07	0.27	0.17	0.24	0.46	0.03	0.58	0.09	0.79	0.01	
09/01/2025 16:45:00	0.81	0.00	0.11	0.07	0.27	0.17	0.24	0.46	0.05	0.58	0.08	0.79	0.00	
09/01/2025 17:00:00	0.82	0.00	0.11	0.07	0.27	0.17	0.24	0.46	0.05	0.59	0.08	0.80	0.00	
09/01/2025 17:15:00	0.82	0.00	0.11	0.07	0.27	0.17	0.24	0.46	0.05	0.59	0.07	0.80	0.02	
09/01/2025 17:30:00	0.82	0.00	0.11	0.07	0.27	0.17	0.24	0.46	0.06	0.59	0.07	0.81	0.01	
09/01/2025 17:45:00	0.83	0.00	0.11	0.07	0.27	0.17	0.23	0.46	0.06	0.60	0.07	0.81	0.02	
09/01/2025 18:00:00	0.83	0.00	0.11	0.07	0.27	0.17	0.23	0.46	0.06	0.60	0.07	0.81	0.02	
09/01/2025 18:15:00	0.83	0.00	0.11	0.07	0.27	0.17	0.23	0.46	0.06	0.60	0.07	0.81	0.01	
09/01/2025 18:30:00	0.84	0.00	0.11	0.07	0.27	0.17	0.23	0.46	0.06	0.60	0.07	0.82	0.02	
09/01/2025 18:45:00	0.84	0.04	0.11	0.07	0.27	0.17	0.23	0.47	0.07	0.61	0.06	0.82	0.01	
09/01/2025 19:00:00	0.84	0.04	0.11	0.07	0.27	0.17	0.23	0.47	0.05	0.61	0.07	0.82	0.02	
09/01/2025 19:15:00	0.84	0.04	0.11	0.07	0.27	0.17	0.23	0.47	0.05	0.61	0.07	0.82	0.02	
09/01/2025 19:30:00	0.85	0.03	0.11	0.07	0.27	0.16	0.23	0.47	0.05	0.61	0.06	0.83	0.03	
09/01/2025 19:45:00	0.85	0.01	0.11	0.07	0.27	0.17	0.23	0.47	0.06	0.61	0.06	0.83	0.02	
09/01/2025 20:00:00	0.85	0.00	0.11	0.07	0.27	0.16	0.23	0.47	0.06	0.62	0.06	0.83	0.02	
09/01/2025 20:15:00	0.85	0.00	0.11	0.07	0.27	0.16	0.23	0.47	0.07	0.62	0.06	0.83	0.01	
09/01/2025 20:30:00	0.85	0.00	0.11	0.07	0.27	0.16	0.23	0.47	0.07	0.62	0.06	0.83	0.02	
09/01/2025 20:45:00	0.85	0.00	0.11	0.07	0.27	0.16	0.23	0.47	0.06	0.62	0.07	0.84	0.02	
09/01/2025 21:00:00	0.86	0.00	0.11	0.07	0.27	0.16	0.23	0.47	0.05	0.62	0.07	0.84	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
09/01/2025 21:15:00	0.86	0.00	0.11	0.07	0.27	0.16	0.23	0.47	0.06	0.62	0.06	0.84	0.02	
09/01/2025 21:30:00	0.86	-0.06	0.11	0.07	0.27	0.16	0.23	0.47	0.06	0.62	0.06	0.84	0.03	
09/01/2025 21:45:00	0.86	-0.04	0.11	0.07	0.27	0.16	0.23	0.47	0.06	0.63	0.06	0.85	0.03	
09/01/2025 22:00:00	0.86	-0.02	0.11	0.07	0.27	0.16	0.23	0.47	0.05	0.63	0.05	0.84	0.03	
09/01/2025 22:15:00	0.86	0.00	0.11	0.07	0.27	0.16	0.24	0.47	0.06	0.63	0.05	0.83	0.03	
09/01/2025 22:30:00	0.86	0.03	0.11	0.07	0.27	0.16	0.23	0.47	0.05	0.63	0.05	0.82	0.05	
09/01/2025 22:45:00	0.86	0.02	0.11	0.07	0.27	0.16	0.24	0.47	0.06	0.63	0.05	0.81	0.07	
09/01/2025 23:00:00	0.85	0.01	0.11	0.07	0.27	0.16	0.24	0.47	0.05	0.62	0.05	0.79	0.07	
09/01/2025 23:15:00	0.85	0.00	0.11	0.07	0.27	0.16	0.24	0.47	0.06	0.62	0.05	0.78	0.07	
09/01/2025 23:30:00	0.85	0.00	0.11	0.07	0.27	0.16	0.24	0.47	0.05	0.62	0.06	0.77	0.10	
09/01/2025 23:45:00	0.84	0.00	0.11	0.07	0.27	0.16	0.24	0.46	0.05	0.62	0.06	0.76	0.09	
10/01/2025 00:00:00	0.84	0.00	0.11	0.07	0.27	0.16	0.24	0.46	0.06	0.61	0.07	0.75	0.10	
10/01/2025 00:15:00	0.83	0.00	0.11	0.07	0.27	0.16	0.24	0.46	0.05	0.61	0.07	0.74	0.09	
10/01/2025 00:30:00	0.83	0.00	0.11	0.07	0.27	0.16	0.24	0.46	0.05	0.61	0.07	0.73	0.09	
10/01/2025 00:45:00	0.82	0.00	0.11	0.07	0.27	0.16	0.24	0.46	0.05	0.60	0.08	0.72	0.07	
10/01/2025 01:00:00	0.82	0.00	0.11	0.07	0.27	0.16	0.24	0.46	0.05	0.60	0.07	0.72	0.08	
10/01/2025 01:15:00	0.81	0.00	0.11	0.07	0.27	0.16	0.24	0.46	0.05	0.59	0.08	0.71	0.10	
10/01/2025 01:30:00	0.81	0.00	0.11	0.07	0.27	0.16	0.24	0.46	0.05	0.59	0.08	0.71	0.08	
10/01/2025 01:45:00	0.80	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.05	0.59	0.08	0.72	0.07	
10/01/2025 02:00:00	0.80	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.05	0.58	0.08	0.74	0.04	
10/01/2025 02:15:00	0.80	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.05	0.58	0.08	0.75	0.04	
10/01/2025 02:30:00	0.80	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.04	0.58	0.09	0.77	0.04	
10/01/2025 02:45:00	0.81	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.06	0.58	0.09	0.79	0.02	
10/01/2025 03:00:00	0.81	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.04	0.58	0.08	0.80	0.02	
10/01/2025 03:15:00	0.82	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.05	0.59	0.08	0.80	0.02	
10/01/2025 03:30:00	0.82	0.00	0.11	0.07	0.27	0.16	0.23	0.44	0.04	0.59	0.07	0.81	0.02	
10/01/2025 03:45:00	0.83	0.00	0.11	0.07	0.27	0.16	0.23	0.44	0.05	0.59	0.07	0.81	0.03	
10/01/2025 04:00:00	0.83	0.00	0.10	0.06	0.27	0.16	0.23	0.44	0.05	0.60	0.06	0.81	0.02	
10/01/2025 04:15:00	0.83	0.00	0.10	0.06	0.26	0.16	0.23	0.44	0.05	0.60	0.06	0.82	0.02	
10/01/2025 04:30:00	0.84	0.04	0.10	0.06	0.26	0.16	0.23	0.44	0.05	0.60	0.05	0.82	0.02	
10/01/2025 04:45:00	0.84	0.03	0.10	0.06	0.26	0.16	0.23	0.44	0.05	0.60	0.05	0.82	0.02	
10/01/2025 05:00:00	0.84	0.01	0.10	0.06	0.26	0.16	0.22	0.44	0.05	0.61	0.05	0.82	0.02	
10/01/2025 05:15:00	0.84	0.00	0.10	0.06	0.26	0.16	0.22	0.45	0.06	0.61	0.05	0.82	0.03	
10/01/2025 05:30:00	0.84	0.00	0.10	0.06	0.26	0.16	0.22	0.45	0.05	0.61	0.04	0.83	0.02	
10/01/2025 05:45:00	0.85	0.00	0.10	0.06	0.26	0.16	0.22	0.44	0.04	0.61	0.04	0.83	0.02	
10/01/2025 06:00:00	0.85	0.03	0.10	0.06	0.26	0.16	0.22	0.44	0.06	0.61	0.04	0.83	0.02	
10/01/2025 06:15:00	0.85	0.02	0.10	0.06	0.26	0.16	0.22	0.44	0.05	0.61	0.04	0.83	0.02	
10/01/2025 06:30:00	0.85	0.03	0.10	0.06	0.26	0.16	0.22	0.44	0.05	0.62	0.04	0.84	0.02	
10/01/2025 06:45:00	0.85	0.03	0.10	0.06	0.26	0.16	0.22	0.44	0.06	0.62	0.04	0.84	0.02	
10/01/2025 07:00:00	0.86	0.02	0.10	0.06	0.26	0.16	0.22	0.44	0.05	0.62	0.04	0.84	0.02	
10/01/2025 07:15:00	0.86	0.02	0.10	0.06	0.26	0.16	0.22	0.44	0.05	0.62	0.04	0.84	0.01	
10/01/2025 07:30:00	0.86	0.02	0.10	0.06	0.26	0.16	0.22	0.44	0.05	0.62	0.04	0.84	0.01	
10/01/2025 07:45:00	0.86	0.02	0.10	0.06	0.26	0.16	0.22	0.44	0.06	0.62	0.04	0.85	0.01	
10/01/2025 08:00:00	0.86	0.02	0.09	0.05	0.26	0.16	0.22	0.44	0.06	0.63	0.04	0.85	0.02	
10/01/2025 08:15:00	0.86	0.02	0.09	0.05	0.26	0.16	0.22	0.44	0.05	0.63	0.04	0.85	0.02	
10/01/2025 08:30:00	0.86	0.02	0.09	0.05	0.26	0.16	0.22	0.44	0.06	0.63	0.04	0.85	0.01	
10/01/2025 08:45:00	0.87	0.03	0.09	0.05	0.25	0.16	0.21	0.45	0.05	0.63	0.04	0.85	0.01	
10/01/2025 09:00:00	0.87	0.02	0.09	0.05	0.25	0.16	0.21	0.45	0.06	0.63	0.04	0.86	-0.01	
10/01/2025 09:15:00	0.87	0.03	0.09	0.05	0.25	0.16	0.21	0.45	0.06	0.63	0.04	0.86	0.02	
10/01/2025 09:30:00	0.87	0.00	0.09	0.05	0.25	0.16	0.21	0.45	0.06	0.63	0.03	0.86	0.02	
10/01/2025 09:45:00	0.87	0.02	0.09	0.05	0.25	0.16	0.21	0.46	0.06	0.63	0.03	0.85	0.03	
10/01/2025 10:00:00	0.87	0.03	0.09	0.05	0.25	0.16	0.21	0.46	0.06	0.63	0.03	0.83	0.05	
10/01/2025 10:15:00	0.87	0.04	0.09	0.05	0.25	0.15	0.21	0.46	0.06	0.63	0.04	0.82	0.08	
10/01/2025 10:30:00	0.86	0.03	0.09	0.05	0.25	0.15	0.21	0.46	0.06	0.63	0.04	0.80	0.08	
10/01/2025 10:45:00	0.86	0.04	0.09	0.05	0.25	0.15	0.21	0.46	0.05	0.63	0.05	0.78	0.06	
10/01/2025 11:00:00	0.85	0.04	0.09	0.05	0.25	0.15	0.21	0.46	0.05	0.62	0.05	0.77	0.08	
10/01/2025 11:15:00	0.84	0.04	0.09	0.05	0.25	0.15	0.21	0.46	0.07	0.62	0.05	0.76	0.10	
10/01/2025 11:30:00	0.84	0.04	0.09	0.05	0.26	0.15	0.22	0.46	0.05	0.61	0.06	0.74	0.09	
10/01/2025 11:45:00	0.83	0.04	0.09	0.05	0.26	0.15	0.22	0.46	0.04	0.61	0.06	0.73	0.08	
10/01/2025 12:00:00	0.83	0.05	0.09	0.05	0.26	0.15	0.22	0.46	0.05	0.61	0.07	0.72	0.09	
10/01/2025 12:15:00	0.82	0.05	0.09	0.05	0.26	0.15	0.22	0.46	0.05	0.60	0.08	0.71	0.08	
10/01/2025 12:30:00	0.81	0.05	0.10	0.06	0.26	0.15	0.22	0.46	0.06	0.60	0.07	0.70	0.09	
10/01/2025 12:45:00	0.81	0.06	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.59	0.07	0.69	0.11	
10/01/2025 13:00:00	0.80	0.06	0.10	0.06	0.26	0.15	0.22	0.46	0.06	0.59	0.07	0.68	0.09	
10/01/2025 13:15:00	0.80	0.06	0.10	0.06	0.26	0.15	0.22	0.46	0.06	0.58	0.09	0.67	0.09	
10/01/2025 13:30:00	0.79	0.05	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.58	0.07	0.66	0.10	
10/01/2025 13:45:00	0.78	0.03	0.10	0.06	0.26	0.16	0.22	0.46	0.05	0.57	0.09	0.66	0.11	
10/01/2025 14:00:00	0.78	0.02	0.10	0.06	0.26	0.16	0.22	0.46	0.05	0.57	0.08	0.65	0.09	
10/01/2025 14:15:00	0.77	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.56	0.08	0.64	0.10	
10/01/2025 14:30:00	0.77	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.05	0.56	0.08	0.64	0.10	
10/01/2025 14:45:00	0.76	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.05	0.56	0.08	0.63	0.10	
10/01/2025 15:00:00	0.76	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.55	0.09	0.63	0.10	
10/01/2025 15:15:00	0.75	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.55	0.09	0.62	0.10	
10/01/2025 15:30:00	0.75	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.54	0.09	0.62	0.10	
10/01/2025 15:45:00	0.75	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.07	0.54	0.09	0.62	0.07	
10/01/2025 16:00:00	0.74	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.54	0.09	0.62	0.02	
10/01/2025 16:15:00	0.74	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.53	0.10	0.63	0.01	
10/01/2025 16:30:00	0.74	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.07	0.53	0.08	0.66	0.04	
10/01/2025 16:45:00	0.74	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.53	0.08	0.70	0.01	
10/01/2025 17:00:00	0.74	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.53	0.09	0.72	0.01	
10/01/2025 17:15:00	0.75	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.53	0.09	0.74	0.00	
10/01/2025 17:30:00	0.76	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.05	0.53	0.08	0.75	0.00	
10/01/2025 17:45:00	0.77	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.07	0.54	0.08	0.76	0.02	
10/01/2025 18:00:00	0.78	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.55	0.08	0.77	0.01	
10/01/2025 18:15:00	0.79	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.07	0.55	0.07	0.78	0.02	
10/01/2025 18:30:00	0.79	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.56	0.07	0.78	0.01	
10/01/2025 18:45:00	0.80	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.07	0.56	0.06	0.79	0.02	
10/01/2025 19:00:00	0.80	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.57	0.06	0.79	0.02	
10/01/2025 19:15:00	0.81	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.57	0.05	0.79	0.01	
10/01/2025 19:30:00	0.81	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.57	0.05	0.79	0.02	
10/01/2025 19:45:00	0.81	0.00	0.10	0.06	0.26	0.16	0.22	0.46	0.06	0.58	0.05	0.80	0.02	
10/01/2025 20:00:00	0.81	0.00	0.10	0.06	0.26	0.16	0.22	0.47	0.06	0.58	0.05	0.80	0.02	
10/01/2025 20:15:00	0.82	0.00	0.10	0.06	0.26	0.16	0.22	0.47	0.06	0.58	0.05	0.80	0.03	
10/01/2025 20:30:00	0.82	0.00	0.10	0.06	0.26	0.16	0.22	0.47	0.07	0.58	0.05	0.80	0.02	
10/01/2025 20:45:00	0.82	0.00	0.10	0.06	0.26	0.15	0.23	0.47	0.07	0.59	0.05	0.80	0.02	
10/01/2025 21:00:00	0.82	0.00	0.10	0.06	0.26	0.16	0.23	0.47	0.07	0.59	0.05	0.81	0.02	
10/01/2025 21:15:00	0.82	0.00	0.11	0.07	0.26	0.16	0.23	0.47	0.07	0.59	0.05	0.81	0.03	
10/01/2025 21:30:00	0.83	0.00	0.10	0.06	0.27	0.16	0.23	0.47	0.06	0.59	0.05	0.81	0.02	
10/01/2025 21:45:00	0.83	0.04	0.11	0.07	0.26	0.16	0.23	0.47	0.06	0.59	0.05	0.81	0.02	
10/01/2025 22:00:00	0.83	0.02	0.11	0.07	0.27	0.16	0.23	0.47	0.06	0.59	0.05	0.81	0.01	
10/01/2025 22:15:00	0.83	0.01	0.11	0.07	0.27	0.16	0.23	0.47	0.05	0.60	0.04	0.81	0.04	
10/01/2025 22:30:00	0.83	0.00	0.11	0.07	0.27	0.16	0.23	0.47	0.06	0.60	0.04	0.79	0.07	
10/01/2025 22:45:00	0.83	0.00	0.11	0.07	0.27	0.16	0.23	0.47	0.06	0.59	0.04	0.77	0.07	
10/01/2025 23:00:00	0.82	0.00	0.11	0.07	0.27	0.16	0.23	0.47	0.06	0.59	0.05	0.76	0.10	
10/01/2025 23:15:00	0.82	0.00	0.11	0.07	0.27	0.16	0.23	0.46	0.06	0.59	0.05	0.74	0.09	
10/01/2025 23:30:00	0.81	0.00	0.11	0.07	0.27	0.16	0.23	0.46	0.06	0.59	0.06	0.73	0.11	
10/01/2025 23:45:00	0.81	0.00	0.11	0.07	0.27	0.16	0.23	0.46	0.06	0.58	0.05	0.71	0.10	
11/01/2025 00:00:00	0.80	0.00	0.11	0.07	0.27	0.16	0.23	0.46	0.06	0.58	0.06	0.70	0.10	
11/01/2025 00:15:00	0.79	0.00	0.11	0.07	0.27	0.16	0.23	0.46	0.06	0.57	0.06	0.68	0.12	
11/01/2025 00:30:00	0.79	0.00	0.11	0.07	0.27	0.16	0.23	0.46	0.05	0.57	0.07	0.67	0.10	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
11/01/2025 00:45:00	0.78	0.00	0.11	0.07	0.27	0.16	0.23	0.46	0.07	0.56	0.07	0.66	0.10	
11/01/2025 01:00:00	0.77	0.00	0.11	0.07	0.27	0.16	0.23	0.46	0.07	0.56	0.07	0.65	0.10	
11/01/2025 01:15:00	0.77	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.06	0.55	0.07	0.64	0.09	
11/01/2025 01:30:00	0.76	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.05	0.55	0.09	0.63	0.10	
11/01/2025 01:45:00	0.76	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.06	0.54	0.07	0.63	0.09	
11/01/2025 02:00:00	0.75	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.05	0.54	0.08	0.62	0.09	
11/01/2025 02:15:00	0.74	0.00	0.11	0.07	0.27	0.16	0.23	0.45	0.05	0.54	0.10	0.61	0.11	
11/01/2025 02:30:00	0.74	0.00	0.11	0.07	0.27	0.15	0.23	0.45	0.06	0.53	0.11	0.61	0.11	
11/01/2025 02:45:00	0.73	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.53	0.10	0.60	0.12	
11/01/2025 03:00:00	0.73	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.06	0.52	0.07	0.60	0.12	
11/01/2025 03:15:00	0.72	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.06	0.52	0.08	0.60	0.10	
11/01/2025 03:30:00	0.72	0.00	0.10	0.06	0.26	0.15	0.23	0.44	0.05	0.52	0.10	0.60	0.08	
11/01/2025 03:45:00	0.71	0.00	0.10	0.06	0.26	0.15	0.23	0.44	0.05	0.51	0.09	0.60	0.08	
11/01/2025 04:00:00	0.71	0.00	0.10	0.06	0.26	0.15	0.23	0.44	0.06	0.51	0.10	0.62	0.05	
11/01/2025 04:15:00	0.71	0.00	0.10	0.06	0.26	0.15	0.23	0.44	0.06	0.51	0.09	0.64	0.03	
11/01/2025 04:30:00	0.71	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.07	0.50	0.09	0.68	0.01	
11/01/2025 04:45:00	0.72	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.06	0.50	0.08	0.70	0.02	
11/01/2025 05:00:00	0.73	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.50		0.72	0.00	
11/01/2025 05:15:00	0.74	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.51		0.73	0.00	
11/01/2025 05:30:00	0.75	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.52		0.74	-0.01	
11/01/2025 05:45:00	0.76	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.05	0.52		0.75	0.01	
11/01/2025 06:00:00	0.76	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.06	0.53		0.76	0.00	
11/01/2025 06:15:00	0.77	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.05	0.54		0.76	0.01	
11/01/2025 06:30:00	0.78	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.05	0.54		0.77	0.01	
11/01/2025 06:45:00	0.78	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.05	0.55		0.77	0.02	
11/01/2025 07:00:00	0.79	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.05	0.55		0.78	0.02	
11/01/2025 07:15:00	0.79	0.00	0.09	0.06	0.26	0.15	0.22	0.43	0.05	0.55	0.05	0.78	0.02	
11/01/2025 07:30:00	0.79	0.00	0.09	0.05	0.26	0.15	0.22	0.43	0.05	0.56	0.04	0.78	0.01	
11/01/2025 07:45:00	0.80	0.00	0.09	0.05	0.25	0.15	0.21	0.43	0.05	0.56	0.04	0.78	0.01	
11/01/2025 08:00:00	0.80	0.00	0.09	0.05	0.25	0.15	0.21	0.43	0.05	0.56	0.04	0.79	0.01	
11/01/2025 08:15:00	0.80	0.00	0.09	0.05	0.25	0.15	0.21	0.43	0.05	0.57	0.04	0.79	0.02	
11/01/2025 08:30:00	0.80	0.00	0.09	0.05	0.25	0.15	0.21	0.43	0.06	0.57	0.04	0.79	0.02	
11/01/2025 08:45:00	0.81	0.00	0.09	0.05	0.25	0.15	0.21	0.43	0.06	0.57	0.04	0.79	0.02	
11/01/2025 09:00:00	0.81	0.00	0.09	0.05	0.25	0.15	0.21	0.44	0.06	0.57	0.04	0.79	0.02	
11/01/2025 09:15:00	0.81	0.00	0.09	0.05	0.25	0.15	0.21	0.44	0.06	0.57	0.04	0.79	0.01	
11/01/2025 09:30:00	0.81	0.03	0.09	0.05	0.25	0.15	0.21	0.44	0.06	0.58	0.04	0.80	0.01	
11/01/2025 09:45:00	0.81	0.02	0.09	0.05	0.25	0.15	0.21	0.44	0.07	0.58	0.04	0.80	0.01	
11/01/2025 10:00:00	0.82	0.01	0.09	0.05	0.25	0.15	0.21	0.44	0.06	0.58	0.05	0.80	0.01	
11/01/2025 10:15:00	0.82	0.00	0.09	0.05	0.25	0.15	0.21	0.45	0.06	0.58	0.04	0.80	0.01	
11/01/2025 10:30:00	0.82	0.00	0.09	0.05	0.25	0.15	0.21	0.45	0.06	0.58	0.04	0.80	0.01	
11/01/2025 10:45:00	0.82	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.06	0.58	0.04	0.79	0.04	
11/01/2025 11:00:00	0.82	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.06	0.58	0.04	0.78	0.06	
11/01/2025 11:15:00	0.81	0.00	0.09	0.05	0.25	0.15	0.21	0.45	0.07	0.58	0.04	0.76	0.07	
11/01/2025 11:30:00	0.81	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.07	0.58	0.05	0.74	0.08	
11/01/2025 11:45:00	0.80	0.00	0.09	0.05	0.26	0.14	0.21	0.46	0.07	0.57	0.05	0.72	0.10	
11/01/2025 12:00:00	0.80	0.00	0.09	0.05	0.26	0.14	0.21	0.46	0.07	0.57	0.05	0.70	0.11	
11/01/2025 12:15:00	0.79	0.00	0.09	0.05	0.26	0.14	0.22	0.46	0.07	0.57	0.06	0.69	0.11	
11/01/2025 12:30:00	0.78	0.00	0.09	0.05	0.26	0.15	0.22	0.46	0.07	0.56	0.06	0.67	0.10	
11/01/2025 12:45:00	0.78	0.00	0.09	0.05	0.26	0.15	0.22	0.47	0.06	0.56	0.06	0.66	0.10	
11/01/2025 13:00:00	0.77	0.00	0.09	0.05	0.26	0.15	0.22	0.47	0.07	0.55	0.07	0.65	0.10	
11/01/2025 13:15:00	0.76	0.00	0.09	0.05	0.26	0.15	0.22	0.47	0.06	0.55	0.07	0.64	0.11	
11/01/2025 13:30:00	0.76	0.00	0.09	0.06	0.26	0.15	0.22	0.47	0.07	0.54	0.07	0.63	0.10	
11/01/2025 13:45:00	0.75	0.00	0.10	0.06	0.26	0.15	0.22	0.47	0.06	0.54	0.07	0.62	0.11	
11/01/2025 14:00:00	0.74	0.00	0.10	0.06	0.26	0.15	0.22	0.47	0.06	0.53	0.07	0.61	0.10	
11/01/2025 14:15:00	0.74	0.00	0.10	0.06	0.26	0.15	0.23	0.47	0.06	0.53	0.06	0.60	0.08	
11/01/2025 14:30:00	0.73	0.00	0.10	0.06	0.26	0.15	0.23	0.47	0.07	0.52	0.09	0.60	0.09	
11/01/2025 14:45:00	0.73	0.00	0.10	0.06	0.27	0.15	0.23	0.46	0.06	0.52	0.08	0.59	0.10	
11/01/2025 15:00:00	0.72	0.00	0.10	0.06	0.27	0.15	0.23	0.46	0.06	0.51	0.09	0.58	0.10	
11/01/2025 15:15:00	0.71	0.00	0.10	0.06	0.27	0.15	0.23	0.46	0.06	0.51	0.09	0.58	0.08	
11/01/2025 15:30:00	0.71	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.07	0.50	0.09	0.57	0.06	
11/01/2025 15:45:00	0.70	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.50	0.08	0.57	0.09	
11/01/2025 16:00:00	0.70	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.50	0.08	0.56	0.08	
11/01/2025 16:15:00	0.69	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.49	0.08	0.56	0.08	
11/01/2025 16:30:00	0.69	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.49	0.08	0.55	0.08	
11/01/2025 16:45:00	0.68	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.07	0.49	0.08	0.56	0.07	
11/01/2025 17:00:00	0.68	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.48	0.09	0.56	0.07	
11/01/2025 17:15:00	0.67	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.48	0.09	0.58	0.05	
11/01/2025 17:30:00	0.67	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.47	0.08	0.61	0.02	
11/01/2025 17:45:00	0.67	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.47	0.10	0.65	0.00	
11/01/2025 18:00:00	0.68	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.47	0.09	0.67	0.00	
11/01/2025 18:15:00	0.69	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.47	0.09	0.69	0.00	
11/01/2025 18:30:00	0.70	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.48	0.09	0.70	-0.01	
11/01/2025 18:45:00	0.71	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.48	0.08	0.71	0.00	
11/01/2025 19:00:00	0.72	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.49	0.08	0.72	0.02	
11/01/2025 19:15:00	0.73	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.50	0.07	0.72	0.00	
11/01/2025 19:30:00	0.74	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.50	0.07	0.73	0.06	
11/01/2025 19:45:00	0.74	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.51	0.06	0.74	0.01	
11/01/2025 20:00:00	0.75	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.52	0.06	0.74	0.01	
11/01/2025 20:15:00	0.76	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.52	0.05	0.75	0.01	
11/01/2025 20:30:00	0.76	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.53	0.05	0.75	0.01	
11/01/2025 20:45:00	0.77	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.53	0.04	0.76	0.01	
11/01/2025 21:00:00	0.77	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.53	0.04	0.76	0.01	
11/01/2025 21:15:00	0.77	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.54	0.04	0.76	0.02	
11/01/2025 21:30:00	0.78	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.54	0.04	0.77	0.02	
11/01/2025 21:45:00	0.78	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.54	0.05	0.77	0.02	
11/01/2025 22:00:00	0.78	0.03	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.55	0.05	0.77	0.02	
11/01/2025 22:15:00	0.79	0.03	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.55	0.05	0.77	0.02	
11/01/2025 22:30:00	0.79	0.03	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.55	0.05	0.77	0.02	
11/01/2025 22:45:00	0.79	0.02	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.55	0.05	0.78	0.01	
11/01/2025 23:00:00	0.79	0.01	0.11	0.07	0.27	0.15	0.23	0.45	0.06	0.56	0.04	0.78	0.00	
11/01/2025 23:15:00	0.79	0.00	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.56	0.05	0.77	0.03	
11/01/2025 23:30:00	0.79	0.04	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.56	0.04	0.75	0.06	
11/01/2025 23:45:00	0.79	0.04	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.56	0.04	0.73	0.08	
12/01/2025 00:00:00	0.78	0.04	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.56	0.04	0.71	0.08	
12/01/2025 00:15:00	0.78	0.04	0.11	0.07	0.27	0.15	0.23	0.45	0.06	0.55	0.04	0.69	0.10	
12/01/2025 00:30:00	0.77	0.03	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.55	0.05	0.67	0.11	
12/01/2025 00:45:00	0.76	0.01	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.54	0.06	0.65	0.11	
12/01/2025 01:00:00	0.76	0.00	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.54	0.07	0.64	0.11	
12/01/2025 01:15:00	0.75	0.00	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.53	0.06	0.62	0.11	
12/01/2025 01:30:00	0.74	0.00	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.53	0.07	0.61	0.11	
12/01/2025 01:45:00	0.73	0.00	0.11	0.07	0.27	0.15	0.23	0.45	0.06	0.52	0.07	0.60	0.09	
12/01/2025 02:00:00	0.73	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.52	0.07	0.59	0.11	
12/01/2025 02:15:00	0.72	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.51	0.08	0.58	0.10	
12/01/2025 02:30:00	0.71	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.50	0.07	0.58	0.11	
12/01/2025 02:45:00	0.71	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.50	0.08	0.57	0.10	
12/01/2025 03:00:00	0.70	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.49	0.08	0.56	0.10	
12/01/2025 03:15:00	0.69	0.00	0.10	0.06	0.27	0.15	0.23	0.44	0.05	0.49	0.08	0.55	0.09	
12/01/2025 03:30:00	0.69	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.04	0.49	0.08	0.55	0.10	
12/01/2025 03:45:00	0.68	0.00	0.10	0.06	0.27	0.15	0.23	0.44	0.05	0.48	0.09	0.54	0.12	
12/01/2025 04:00:00	0.68	0.00	0.10	0.06	0.27	0.15	0.23	0.43	0.05	0.48	0.08	0.54	0.10	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
12/01/2025 04:15:00	0.67	0.00	0.10	0.06	0.27	0.15	0.23	0.43	0.06	0.47	0.09	0.53	0.09	
12/01/2025 04:30:00	0.67	0.00	0.10	0.06	0.27	0.15	0.23	0.43	0.04	0.47	0.09	0.53	0.09	
12/01/2025 04:45:00	0.66	0.00	0.10	0.06	0.26	0.15	0.23	0.43	0.06	0.47	0.08	0.53	0.08	
12/01/2025 05:00:00	0.66	0.00	0.10	0.06	0.26	0.15	0.23	0.44	0.06	0.46	0.08	0.53	0.07	
12/01/2025 05:15:00	0.65	0.00	0.10	0.06	0.26	0.15	0.23	0.44	0.05	0.46	0.08	0.54	0.08	
12/01/2025 05:30:00	0.65	0.00	0.10	0.06	0.26	0.15	0.23	0.44	0.05	0.46	0.08	0.55	0.06	
12/01/2025 05:45:00	0.65	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.45	0.08	0.58	0.01	
12/01/2025 06:00:00	0.65	0.00	0.10	0.06	0.26	0.14	0.22	0.44	0.05	0.45	0.07	0.63	0.02	
12/01/2025 06:15:00	0.66	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.45	0.08	0.64	-0.01	
12/01/2025 06:30:00	0.67	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.06	0.45	0.08	0.66	0.00	
12/01/2025 06:45:00	0.68	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.46	0.08	0.67	0.01	
12/01/2025 07:00:00	0.69	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.46	0.07	0.68	-0.01	
12/01/2025 07:15:00	0.70	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.47	0.07	0.69	0.02	
12/01/2025 07:30:00	0.71	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.47	0.07	0.70	0.00	
12/01/2025 07:45:00	0.71	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.48	0.07	0.71	0.00	
12/01/2025 08:00:00	0.72	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.49	0.07	0.71	0.02	
12/01/2025 08:15:00	0.73	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.49	0.06	0.72	0.01	
12/01/2025 08:30:00	0.73	0.00	0.09	0.05	0.26	0.14	0.22	0.43	0.05	0.50	0.06	0.72	0.01	
12/01/2025 08:45:00	0.74	0.00	0.09	0.05	0.26	0.14	0.22	0.43	0.05	0.50	0.06	0.73	0.02	
12/01/2025 09:00:00	0.74	0.00	0.09	0.05	0.26	0.14	0.22	0.43	0.06	0.51	0.05	0.73	0.02	
12/01/2025 09:15:00	0.75	0.00	0.09	0.05	0.26	0.14	0.22	0.43	0.05	0.51	0.05	0.74	0.01	
12/01/2025 09:30:00	0.75	0.00	0.09	0.05	0.26	0.14	0.22	0.43	0.05	0.52	0.04	0.74	0.01	
12/01/2025 09:45:00	0.76	0.00	0.09	0.05	0.26	0.14	0.22	0.43	0.05	0.52	0.04	0.74	0.01	
12/01/2025 10:00:00	0.76	0.00	0.09	0.05	0.26	0.14	0.22	0.44	0.06	0.52	0.04	0.75	0.02	
12/01/2025 10:15:00	0.76	0.00	0.09	0.05	0.26	0.14	0.22	0.44	0.05	0.53	0.04	0.75	0.02	
12/01/2025 10:30:00	0.77	0.00	0.09	0.05	0.26	0.14	0.22	0.44	0.06	0.53	0.04	0.75	0.01	
12/01/2025 10:45:00	0.77	0.00	0.09	0.05	0.26	0.14	0.22	0.44	0.06	0.53	0.04	0.76	0.02	
12/01/2025 11:00:00	0.77	0.00	0.09	0.05	0.26	0.14	0.22	0.45	0.06	0.53	0.03	0.76	0.01	
12/01/2025 11:15:00	0.77	0.00	0.09	0.05	0.26	0.14	0.22	0.45	0.06	0.54	0.03	0.76	0.01	
12/01/2025 11:30:00	0.78	0.00	0.09	0.05	0.26	0.14	0.22	0.45	0.06	0.54	0.04	0.76	0.04	
12/01/2025 11:45:00	0.78	0.00	0.09	0.05	0.26	0.14	0.22	0.45	0.06	0.54	0.04	0.74	0.07	
12/01/2025 12:00:00	0.77	0.00	0.09	0.05	0.26	0.14	0.22	0.46	0.06	0.54	0.04	0.71	0.08	
12/01/2025 12:15:00	0.77	0.00	0.09	0.05	0.26	0.14	0.22	0.46	0.06	0.54	0.05	0.69	0.07	
12/01/2025 12:30:00	0.76	0.00	0.09	0.05	0.26	0.14	0.22	0.46	0.06	0.54	0.04	0.67	0.10	
12/01/2025 12:45:00	0.75	0.00	0.09	0.06	0.26	0.14	0.22	0.46	0.06	0.53	0.04	0.65	0.09	
12/01/2025 13:00:00	0.75	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.05	0.53	0.04	0.63	0.10	
12/01/2025 13:15:00	0.74	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.52	0.05	0.62	0.09	
12/01/2025 13:30:00	0.73	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.07	0.52	0.07	0.60	0.10	
12/01/2025 13:45:00	0.72	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.07	0.51	0.07	0.59	0.12	
12/01/2025 14:00:00	0.72	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.51	0.07	0.58	0.12	
12/01/2025 14:15:00	0.71	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.50	0.06	0.57	0.12	
12/01/2025 14:30:00	0.70	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.07	0.49	0.07	0.56	0.10	
12/01/2025 14:45:00	0.70	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.05	0.49	0.07	0.55	0.10	
12/01/2025 15:00:00	0.69	0.00	0.10	0.06	0.26	0.14	0.23	0.46	0.06	0.48	0.08	0.54	0.11	
12/01/2025 15:15:00	0.68	0.00	0.10	0.06	0.26	0.14	0.23	0.46	0.06	0.48	0.08	0.54	0.09	
12/01/2025 15:30:00	0.68	0.00	0.11	0.07	0.26	0.14	0.23	0.46	0.06	0.47	0.08	0.53	0.07	
12/01/2025 15:45:00	0.67	0.00	0.11	0.07	0.27	0.14	0.23	0.46	0.06	0.47	0.07	0.52	0.09	
12/01/2025 16:00:00	0.67	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.47	0.08	0.52	0.08	
12/01/2025 16:15:00	0.66	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.46	0.08	0.51	0.09	
12/01/2025 16:30:00	0.65	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.46	0.08	0.51	0.11	
12/01/2025 16:45:00	0.65	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.46	0.08	0.50	0.09	
12/01/2025 17:00:00	0.64	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.45	0.08	0.50	0.09	
12/01/2025 17:15:00	0.64	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.45	0.09	0.49	0.09	
12/01/2025 17:30:00	0.63	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.45	0.08	0.49	0.08	
12/01/2025 17:45:00	0.63	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.44	0.07	0.49	0.08	
12/01/2025 18:00:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.44	0.08	0.50	0.06	
12/01/2025 18:15:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.44	0.08	0.51	0.05	
12/01/2025 18:30:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.44	0.08	0.53	0.03	
12/01/2025 18:45:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.43	0.09	0.57	0.02	
12/01/2025 19:00:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.43	0.08	0.59	0.01	
12/01/2025 19:15:00	0.63	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.43	0.08	0.61	0.00	
12/01/2025 19:30:00	0.64	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.43	0.09	0.63	0.01	
12/01/2025 19:45:00	0.65	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.43	0.08	0.64	0.00	
12/01/2025 20:00:00	0.66	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.44	0.08	0.65	0.00	
12/01/2025 20:15:00	0.67	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.44	0.07	0.66	0.00	
12/01/2025 20:30:00	0.68	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.45	0.08	0.67	0.01	
12/01/2025 20:45:00	0.68	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.46	0.07	0.68	0.01	
12/01/2025 21:00:00	0.69	0.03	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.46	0.06	0.68	0.00	
12/01/2025 21:15:00	0.70	0.04	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.47	0.06	0.69	0.02	
12/01/2025 21:30:00	0.71	0.03	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.47	0.06	0.70	-0.01	
12/01/2025 21:45:00	0.71	0.04	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.48	0.06	0.70	0.00	
12/01/2025 22:00:00	0.72	0.04	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.48	0.06	0.71	0.01	
12/01/2025 22:15:00	0.72	0.03	0.11	0.07	0.27	0.15	0.24	0.47	0.06	0.49	0.05	0.71	0.01	
12/01/2025 22:30:00	0.73	0.03	0.11	0.07	0.27	0.15	0.24	0.47	0.05	0.49	0.05	0.72	0.01	
12/01/2025 22:45:00	0.73	0.03	0.11	0.07	0.27	0.15	0.24	0.46	0.06	0.50	0.05	0.72	0.01	
12/01/2025 23:00:00	0.74	0.04	0.12	0.08	0.27	0.15	0.24	0.46	0.06	0.50	0.05	0.72	0.02	
12/01/2025 23:15:00	0.74	0.04	0.12	0.08	0.27	0.15	0.24	0.46	0.05	0.51	0.05	0.73	0.01	
12/01/2025 23:30:00	0.74	0.04	0.12	0.08	0.27	0.15	0.24	0.46	0.05	0.51	0.04	0.73	0.03	
12/01/2025 23:45:00	0.75	0.04	0.12	0.08	0.27	0.15	0.24	0.46	0.05	0.51	0.05	0.72	0.06	
13/01/2025 00:00:00	0.75	0.05	0.12	0.08	0.27	0.15	0.24	0.46	0.05	0.51	0.05	0.69	0.08	
13/01/2025 00:15:00	0.74	0.06	0.12	0.08	0.27	0.15	0.24	0.46	0.05	0.51	0.05	0.66	0.08	
13/01/2025 00:30:00	0.74	0.04	0.12	0.08	0.27	0.15	0.24	0.46	0.05	0.51	0.05	0.64	0.08	
13/01/2025 00:45:00	0.73	0.04	0.11	0.07	0.27	0.15	0.24	0.45	0.05	0.51	0.05	0.62	0.10	
13/01/2025 01:00:00	0.72	0.05	0.12	0.08	0.27	0.15	0.24	0.45	0.05	0.50	0.05	0.60	0.12	
13/01/2025 01:15:00	0.71	0.03	0.11	0.07	0.27	0.15	0.24	0.45	0.04	0.50	0.06	0.58	0.10	
13/01/2025 01:30:00	0.71	0.02	0.11	0.07	0.27	0.15	0.24	0.45	0.05	0.49	0.06	0.57	0.11	
13/01/2025 01:45:00	0.70	0.00	0.11	0.07	0.27	0.15	0.24	0.45	0.06	0.49	0.06	0.56	0.10	
13/01/2025 02:00:00	0.69	0.00	0.11	0.07	0.27	0.15	0.24	0.45	0.05	0.48	0.07	0.55	0.09	
13/01/2025 02:15:00	0.68	0.00	0.11	0.07	0.27	0.15	0.24	0.45	0.05	0.48	0.07	0.54	0.09	
13/01/2025 02:30:00	0.68	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.47	0.06	0.53	0.09	
13/01/2025 02:45:00	0.67	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.47	0.07	0.52	0.11	
13/01/2025 03:00:00	0.66	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.04	0.46	0.07	0.51	0.10	
13/01/2025 03:15:00	0.66	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.04	0.46	0.08	0.51	0.10	
13/01/2025 03:30:00	0.65	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.04	0.45	0.08	0.50	0.09	
13/01/2025 03:45:00	0.64	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.04	0.45	0.08	0.49	0.09	
13/01/2025 04:00:00	0.64	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.45	0.08	0.49	0.09	
13/01/2025 04:15:00	0.63	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.04	0.44	0.08	0.48	0.09	
13/01/2025 04:30:00	0.63	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.03	0.44	0.08	0.48	0.10	
13/01/2025 04:45:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.43	0.02	0.44	0.08	0.47	0.09	
13/01/2025 05:00:00	0.62	0.00	0.10	0.06	0.26	0.15	0.23	0.43	0.02	0.43	0.09	0.47	0.10	
13/01/2025 05:15:00	0.61	0.00	0.10	0.06	0.26	0.15	0.23	0.43	0.01	0.43	0.08	0.46	0.07	
13/01/2025 05:30:00	0.61	0.00	0.10	0.06	0.26	0.15	0.23	0.43	0.63	0.43	0.07	0.46	0.09	
13/01/2025 05:45:00	0.60	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.43	0.43	0.09	0.45	0.11	
13/01/2025 06:00:00	0.60	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.24	0.42	0.09	0.45	0.08	
13/01/2025 06:15:00	0.60	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.04	0.42	0.09	0.44	0.08	
13/01/2025 06:30:00	0.59	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.04	0.42	0.09	0.44	0.08	
13/01/2025 06:45:00	0.59	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.05	0.42	0.09	0.44	0.09	
13/01/2025 07:00:00	0.58	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.05	0.42	0.09	0.44	0.07	
13/01/2025 07:15:00	0.58	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.05	0.42	0.09	0.44	0.06	
13/01/2025 07:30:00	0.58	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.42	0.09	0.46	0.06	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
13/01/2025 07:45:00	0.58	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.41	0.09	0.48	0.03	
13/01/2025 08:00:00	0.58	0.00	0.10	0.06	0.26	0.14	0.22	0.43	0.05	0.41	0.08	0.52	0.02	
13/01/2025 08:15:00	0.58	0.00	0.09	0.06	0.26	0.14	0.22	0.44	0.05	0.41	0.09	0.55	0.01	
13/01/2025 08:30:00	0.59	0.00	0.09	0.06	0.26	0.14	0.22	0.44	0.05	0.41	0.08	0.57	0.01	
13/01/2025 08:45:00	0.59	0.00	0.09	0.05	0.26	0.14	0.22	0.44	0.07	0.41	0.08	0.58	0.01	
13/01/2025 09:00:00	0.60	0.00	0.09	0.05	0.26	0.14	0.22	0.44	0.06	0.41	0.08	0.59	-0.01	
13/01/2025 09:15:00	0.61	0.04	0.09	0.05	0.26	0.14	0.22	0.44	0.06	0.41	0.08	0.60	-0.01	
13/01/2025 09:30:00	0.62	0.04	0.09	0.05	0.26	0.14	0.22	0.45	0.07	0.42	0.08	0.61	0.01	
13/01/2025 09:45:00	0.63	0.04	0.09	0.05	0.26	0.14	0.22	0.45	0.05	0.42	0.08	0.62	-0.01	
13/01/2025 10:00:00	0.64	0.04	0.09	0.05	0.26	0.14	0.22	0.45	0.06	0.42	0.08	0.63	0.01	
13/01/2025 10:15:00	0.65	0.04	0.09	0.05	0.26	0.14	0.22	0.45	0.06	0.43	0.08	0.64	0.00	
13/01/2025 10:30:00	0.66	0.03	0.09	0.05	0.26	0.14	0.22	0.45	0.06	0.43	0.07	0.65	0.01	
13/01/2025 10:45:00	0.66	0.02	0.09	0.05	0.26	0.14	0.22	0.46	0.07	0.44	0.06	0.65	0.02	
13/01/2025 11:00:00	0.67	0.02	0.09	0.05	0.26	0.14	0.22	0.46	0.06	0.44	0.06	0.66	0.00	
13/01/2025 11:15:00	0.68	0.01	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.45	0.07	0.67	0.01	
13/01/2025 11:30:00	0.68	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.46	0.06	0.67	0.02	
13/01/2025 11:45:00	0.69	0.00	0.09	0.06	0.26	0.14	0.22	0.46	0.05	0.46	0.06	0.68	0.01	
13/01/2025 12:00:00	0.70	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.05	0.47	0.05	0.68	0.04	
13/01/2025 12:15:00	0.70	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.05	0.47	0.06	0.65	0.06	
13/01/2025 12:30:00	0.70	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.47	0.05	0.63	0.07	
13/01/2025 12:45:00	0.70	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.47	0.05	0.60	0.08	
13/01/2025 13:00:00	0.69	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.47	0.05	0.58	0.08	
13/01/2025 13:15:00	0.68	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.05	0.47	0.05	0.56	0.10	
13/01/2025 13:30:00	0.68	0.00	0.10	0.06	0.26	0.15	0.22	0.46	0.05	0.47	0.05	0.55	0.11	
13/01/2025 13:45:00	0.67	0.00	0.10	0.06	0.26	0.15	0.22	0.46	0.05	0.46	0.05	0.53	0.09	
13/01/2025 14:00:00	0.67	0.00	0.10	0.06	0.26	0.15	0.22	0.46	0.06	0.46	0.04	0.52	0.09	
13/01/2025 14:15:00	0.66	0.00	0.10	0.06	0.26	0.15	0.23	0.46	0.05	0.46	0.06	0.51	0.09	
13/01/2025 14:30:00	0.65	0.00	0.10	0.06	0.26	0.15	0.23	0.46	0.05	0.45	0.05	0.50	0.08	
13/01/2025 14:45:00	0.65	0.00	0.10	0.06	0.26	0.15	0.23	0.46	0.06	0.45	0.06	0.49	0.07	
13/01/2025 15:00:00	0.64	0.00	0.11	0.07	0.26	0.15	0.23	0.46	0.05	0.44	0.06	0.48	0.10	
13/01/2025 15:15:00	0.63	0.00	0.10	0.06	0.26	0.15	0.23	0.46	0.06	0.44	0.07	0.48	0.09	
13/01/2025 15:30:00	0.63	0.00	0.11	0.07	0.26	0.15	0.23	0.46	0.06	0.44	0.07	0.47	0.06	
13/01/2025 15:45:00	0.62	0.00	0.11	0.07	0.26	0.15	0.23	0.46	0.06	0.43	0.08	0.46	0.09	
13/01/2025 16:00:00	0.62	0.00	0.11	0.07	0.26	0.15	0.23	0.46	0.05	0.43	0.08	0.46	0.06	
13/01/2025 16:15:00	0.61	0.00	0.11	0.07	0.26	0.15	0.23	0.46	0.05	0.43	0.08	0.45	0.09	
13/01/2025 16:30:00	0.61	0.00	0.11	0.07	0.26	0.15	0.23	0.46	0.06	0.43	0.09	0.45	0.08	
13/01/2025 16:45:00	0.60	0.00	0.11	0.07	0.26	0.15	0.23	0.45	0.05	0.42	0.09	0.44	0.09	
13/01/2025 17:00:00	0.60	0.00	0.11	0.07	0.26	0.15	0.23	0.45	0.06	0.42	0.09	0.44	0.07	
13/01/2025 17:15:00	0.59	0.00	0.11	0.07	0.26	0.15	0.23	0.45	0.05	0.42	0.08	0.43	0.07	
13/01/2025 17:30:00	0.59	0.00	0.11	0.07	0.26	0.15	0.23	0.45	0.05	0.42	0.08	0.43	0.07	
13/01/2025 17:45:00	0.58	0.00	0.11	0.07	0.26	0.15	0.23	0.45	0.06	0.42	0.09	0.43	0.07	
13/01/2025 18:00:00	0.58	0.00	0.11	0.07	0.26	0.15	0.23	0.45	0.06	0.42	0.09	0.43	0.07	
13/01/2025 18:15:00	0.58	0.00	0.11	0.07	0.26	0.15	0.23	0.45	0.06	0.42	0.09	0.44	0.07	
13/01/2025 18:30:00	0.57	0.00	0.11	0.07	0.26	0.15	0.23	0.46	0.07	0.41	0.09	0.45	0.04	
13/01/2025 18:45:00	0.57	0.00	0.11	0.07	0.26	0.15	0.23	0.46	0.06	0.41	0.09	0.48	0.03	
13/01/2025 19:00:00	0.57	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.06	0.41	0.09	0.51	0.01	
13/01/2025 19:15:00	0.57	0.00	0.10	0.06	0.26	0.15	0.23	0.47	0.06	0.41	0.09	0.53	0.01	
13/01/2025 19:30:00	0.58	0.00	0.10	0.06	0.26	0.15	0.23	0.47	0.06	0.41	0.08	0.55	0.01	
13/01/2025 19:45:00	0.59	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.41	0.09	0.57	0.01	
13/01/2025 20:00:00	0.59	0.06	0.11	0.07	0.27	0.15	0.23	0.47	0.07	0.41	0.09	0.58	0.01	
13/01/2025 20:15:00	0.60	0.04	0.11	0.07	0.27	0.15	0.23	0.47	0.07	0.41	0.09	0.59	0.01	
13/01/2025 20:30:00	0.61	0.02	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.41	0.09	0.60	0.02	
13/01/2025 20:45:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.07	0.42	0.09	0.61	0.02	
13/01/2025 21:00:00	0.63	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.42	0.08	0.61	0.01	
13/01/2025 21:15:00	0.63	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.42	0.09	0.62	0.01	
13/01/2025 21:30:00	0.64	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.05	0.43	0.09	0.63	0.01	
13/01/2025 21:45:00	0.65	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.05	0.43	0.08	0.64	0.01	
13/01/2025 22:00:00	0.66	0.04	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.43	0.08	0.64	0.01	
13/01/2025 22:15:00	0.66	0.05	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.44	0.08	0.65	0.01	
13/01/2025 22:30:00	0.67	0.03	0.11	0.07	0.27	0.15	0.23	0.47	0.05	0.44	0.08	0.65	0.02	
13/01/2025 22:45:00	0.67	0.04	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.45	0.07	0.66	0.02	
13/01/2025 23:00:00	0.68	0.04	0.11	0.07	0.27	0.15	0.23	0.46	0.04	0.45	0.07	0.66	0.02	
13/01/2025 23:15:00	0.68	0.03	0.11	0.07	0.27	0.15	0.23	0.46	0.07	0.46	0.07	0.67	0.02	
13/01/2025 23:30:00	0.69	0.04	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.46	0.05	0.67	0.01	
13/01/2025 23:45:00	0.69	0.04	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.46	0.05	0.68	0.02	
14/01/2025 00:00:00	0.70	0.03	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.47	0.06	0.68	0.02	
14/01/2025 00:15:00	0.70	0.03	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.47	0.06	0.69	0.01	
14/01/2025 00:30:00	0.71	0.03	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.48	0.06	0.69	0.02	
14/01/2025 00:45:00	0.71	0.03	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.48	0.06	0.69	0.02	
14/01/2025 01:00:00	0.71	0.04	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.48	0.06	0.69	0.06	
14/01/2025 01:15:00	0.72	0.05	0.11	0.07	0.27	0.15	0.23	0.45	0.06	0.49	0.06	0.66	0.06	
14/01/2025 01:30:00	0.71	0.05	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.49	0.06	0.64	0.10	
14/01/2025 01:45:00	0.71	0.04	0.11	0.07	0.27	0.15	0.23	0.45	0.06	0.49	0.06	0.61	0.09	
14/01/2025 02:00:00	0.70	0.03	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.48	0.05	0.59	0.10	
14/01/2025 02:15:00	0.70	0.01	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.48	0.06	0.57	0.10	
14/01/2025 02:30:00	0.69	0.00	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.48	0.07	0.55	0.10	
14/01/2025 02:45:00	0.68	0.00	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.47	0.07	0.54	0.08	
14/01/2025 03:00:00	0.67	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.06	0.47	0.07	0.53	0.10	
14/01/2025 03:15:00	0.67	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.46	0.07	0.51	0.10	
14/01/2025 03:30:00	0.66	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.06	0.46	0.06	0.50	0.10	
14/01/2025 03:45:00	0.65	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.45	0.07	0.50	0.09	
14/01/2025 04:00:00	0.65	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.45	0.08	0.49	0.10	
14/01/2025 04:15:00	0.64	0.00	0.10	0.06	0.27	0.15	0.23	0.44	0.06	0.44	0.08	0.48	0.08	
14/01/2025 04:30:00	0.63	0.00	0.10	0.06	0.26	0.15	0.23	0.44	0.05	0.44	0.07	0.47	0.09	
14/01/2025 04:45:00	0.63	0.00	0.10	0.06	0.26	0.15	0.23	0.44	0.06	0.44	0.08	0.46	0.09	
14/01/2025 05:00:00	0.62	0.00	0.10	0.06	0.26	0.15	0.23	0.44	0.05	0.43	0.08	0.46	0.09	
14/01/2025 05:15:00	0.61	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.43	0.08	0.45	0.09	
14/01/2025 05:30:00	0.61	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.04	0.43	0.09	0.45	0.09	
14/01/2025 05:45:00	0.60	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.43	0.08	0.44	0.07	
14/01/2025 06:00:00	0.60	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.42	0.08	0.44	0.08	
14/01/2025 06:15:00	0.59	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.06	0.42	0.08	0.43	0.07	
14/01/2025 06:30:00	0.59	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.04	0.42	0.09	0.43	0.06	
14/01/2025 06:45:00	0.59	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.42	0.08	0.44	0.05	
14/01/2025 07:00:00	0.58	0.00	0.10	0.06	0.26	0.15	0.22	0.43	0.06	0.42	0.08	0.46	0.05	
14/01/2025 07:15:00	0.58	0.00	0.09	0.05	0.26	0.15	0.22	0.43	0.06	0.41	0.08	0.50	0.03	
14/01/2025 07:30:00	0.58	0.00	0.10	0.06	0.26	0.15	0.21	0.44	0.06	0.41	0.08	0.52	0.02	
14/01/2025 07:45:00	0.58	0.00	0.09	0.05	0.26	0.15	0.21	0.44	0.05	0.41	0.09	0.54	0.01	
14/01/2025 08:00:00	0.59	0.06	0.09	0.06	0.26	0.14	0.21	0.44	0.05	0.41	0.08	0.56	0.02	
14/01/2025 08:15:00	0.59	0.06	0.09	0.05	0.25	0.14	0.21	0.44	0.05	0.41	0.09	0.57	0.00	
14/01/2025 08:30:00	0.60	0.05	0.09	0.05	0.25	0.14	0.21	0.44	0.05	0.41	0.09	0.58	0.01	
14/01/2025 08:45:00	0.61	0.04	0.09	0.05	0.25	0.14	0.21	0.44	0.06	0.41	0.09	0.59	0.01	
14/01/2025 09:00:00	0.62	0.03	0.09	0.05	0.25	0.14	0.21	0.45	0.06	0.42	0.08	0.60	0.01	
14/01/2025 09:15:00	0.62	0.01	0.09	0.05	0.25	0.14	0.21	0.45	0.05	0.42	0.09	0.61	0.00	
14/01/2025 09:30:00	0.63	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.06	0.42	0.08	0.62	0.01	
14/01/2025 09:45:00	0.64	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.06	0.42	0.08	0.62	0.00	
14/01/2025 10:00:00	0.64	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.06	0.43	0.08	0.63	0.00	
14/01/2025 10:15:00	0.65	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.06	0.43	0.08	0.64	0.00	
14/01/2025 10:30:00	0.66	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.06	0.44	0.07	0.64	-0.01	
14/01/2025 10:45:00	0.66	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.06	0.44	0.07	0.65	0.01	
14/01/2025 11:00:00	0.67	0.05	0.09	0.05	0.25	0.14	0.21	0.47	0.06	0.44	0.07	0.65	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
14/01/2025 11:15:00	0.68	0.04	0.09	0.05	0.25	0.14	0.21	0.47	0.06	0.45	0.07	0.66	0.01	
14/01/2025 11:30:00	0.68	0.04	0.09	0.05	0.26	0.14	0.22	0.46	0.05	0.45	0.06	0.66	0.01	
14/01/2025 11:45:00	0.69	0.04	0.09	0.05	0.26	0.14	0.22	0.46	0.06	0.46	0.05	0.67	0.01	
14/01/2025 12:00:00	0.69	0.03	0.10	0.06	0.26	0.14	0.22	0.46	0.05	0.46	0.07	0.67	0.02	
14/01/2025 12:15:00	0.69	0.03	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.46	0.07	0.68	0.01	
14/01/2025 12:30:00	0.70	0.03	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.47	0.07	0.68	0.01	
14/01/2025 12:45:00	0.70	0.04	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.47	0.07	0.68	0.00	
14/01/2025 13:00:00	0.71	0.04	0.10	0.06	0.26	0.14	0.22	0.46	0.06	0.47	0.06	0.69	0.00	
14/01/2025 13:15:00	0.71	0.04	0.10	0.06	0.26	0.15	0.22	0.46	0.06	0.48	0.07	0.69	0.02	
14/01/2025 13:30:00	0.71	0.03	0.10	0.06	0.26	0.15	0.22	0.46	0.06	0.48	0.06	0.70	0.01	
14/01/2025 13:45:00	0.72	0.03	0.10	0.06	0.26	0.15	0.22	0.46	0.06	0.48	0.05	0.70	0.02	
14/01/2025 14:00:00	0.72	0.04	0.10	0.06	0.26	0.15	0.22	0.46	0.05	0.49	0.06	0.69	0.04	
14/01/2025 14:15:00	0.72	0.05	0.10	0.06	0.26	0.15	0.22	0.46	0.06	0.49	0.06	0.66	0.05	
14/01/2025 14:30:00	0.72	0.03	0.10	0.06	0.26	0.15	0.22	0.46	0.04	0.49	0.06	0.64	0.08	
14/01/2025 14:45:00	0.71	0.02	0.10	0.06	0.26	0.15	0.22	0.46	0.05	0.49	0.06	0.61	0.08	
14/01/2025 15:00:00	0.71	0.01	0.10	0.06	0.26	0.15	0.22	0.46	0.06	0.48	0.06	0.59	0.10	
14/01/2025 15:15:00	0.70	0.00	0.10	0.06	0.26	0.15	0.22	0.46	0.05	0.48	0.07	0.57	0.11	
14/01/2025 15:30:00	0.69	0.00	0.10	0.06	0.26	0.15	0.22	0.46	0.05	0.48	0.06	0.56	0.09	
14/01/2025 15:45:00	0.68	0.00	0.10	0.06	0.27	0.14	0.23	0.46	0.06	0.47	0.07	0.54	0.09	
14/01/2025 16:00:00	0.68	0.00	0.10	0.06	0.27	0.14	0.24	0.46	0.06	0.47	0.07	0.53	0.08	
14/01/2025 16:15:00	0.67	0.00	0.10	0.06	0.27	0.14	0.24	0.46	0.06	0.46	0.07	0.52	0.09	
14/01/2025 16:30:00	0.66	0.00	0.10	0.06	0.27	0.14	0.24	0.46	0.06	0.46	0.06	0.51	0.08	
14/01/2025 16:45:00	0.65	0.00	0.10	0.06	0.27	0.14	0.24	0.46	0.06	0.45	0.08	0.50	0.07	
14/01/2025 17:00:00	0.65	0.00	0.10	0.06	0.27	0.14	0.24	0.46	0.05	0.45	0.09	0.49	0.09	
14/01/2025 17:15:00	0.64	0.00	0.10	0.06	0.27	0.15	0.24	0.46	0.06	0.45	0.09	0.48	0.10	
14/01/2025 17:30:00	0.63	0.00	0.10	0.06	0.27	0.14	0.24	0.46	0.06	0.44	0.09	0.47	0.11	
14/01/2025 17:45:00	0.63	0.00	0.11	0.07	0.27	0.15	0.24	0.46	0.06	0.44	0.06	0.47	0.10	
14/01/2025 18:00:00	0.62	0.00	0.11	0.07	0.27	0.15	0.24	0.46	0.06	0.44	0.08	0.46	0.09	
14/01/2025 18:15:00	0.62	0.00	0.11	0.07	0.27	0.14	0.24	0.46	0.06	0.43	0.08	0.46	0.07	
14/01/2025 18:30:00	0.61	0.00	0.11	0.07	0.27	0.14	0.24	0.46	0.06	0.43	0.08	0.48	0.04	
14/01/2025 18:45:00	0.61	0.00	0.11	0.07	0.27	0.14	0.24	0.46	0.06	0.43	0.08	0.52	0.03	
14/01/2025 19:00:00	0.60	0.00	0.11	0.07	0.27	0.14	0.24	0.47	0.06	0.42	0.06	0.55	0.02	
14/01/2025 19:15:00	0.61	0.00	0.11	0.07	0.27	0.15	0.24	0.47	0.06	0.42	0.08	0.57	0.02	
14/01/2025 19:30:00	0.61	0.00	0.11	0.07	0.27	0.15	0.24	0.47	0.06	0.42	0.09	0.59	0.02	
14/01/2025 19:45:00	0.62	0.00	0.11	0.07	0.27	0.15	0.24	0.47	0.06	0.42	0.08	0.60	0.01	
14/01/2025 20:00:00	0.63	0.00	0.11	0.07	0.27	0.15	0.24	0.47	0.06	0.42	0.08	0.61	0.01	
14/01/2025 20:15:00	0.63	0.00	0.11	0.07	0.27	0.15	0.24	0.47	0.06	0.42	0.08	0.62	0.01	
14/01/2025 20:30:00	0.64	0.00	0.11	0.07	0.27	0.15	0.24	0.47	0.07	0.43	0.08	0.62	0.00	
14/01/2025 20:45:00	0.65	0.00	0.11	0.07	0.27	0.15	0.24	0.47	0.06	0.43	0.08	0.63	0.01	
14/01/2025 21:00:00	0.65	0.00	0.11	0.07	0.28	0.15	0.24	0.47	0.05	0.43	0.08	0.64	0.01	
14/01/2025 21:15:00	0.66	0.00	0.11	0.07	0.28	0.15	0.24	0.48	0.06	0.44	0.08	0.65	0.00	
14/01/2025 21:30:00	0.67	0.00	0.11	0.07	0.28	0.15	0.24	0.47	0.06	0.44	0.08	0.65	0.02	
14/01/2025 21:45:00	0.67	0.00	0.11	0.07	0.28	0.15	0.24	0.47	0.05	0.45	0.07	0.66	0.02	
14/01/2025 22:00:00	0.68	0.00	0.11	0.07	0.28	0.15	0.24	0.47	0.05	0.45	0.07	0.66	0.01	
14/01/2025 22:15:00	0.68	0.00	0.11	0.07	0.28	0.15	0.24	0.47	0.06	0.45	0.08	0.67	0.01	
14/01/2025 22:30:00	0.69	0.00	0.12	0.08	0.28	0.15	0.24	0.47	0.06	0.46	0.07	0.67	0.01	
14/01/2025 22:45:00	0.69	0.00	0.12	0.08	0.28	0.15	0.24	0.47	0.06	0.46	0.07	0.68	0.01	
14/01/2025 23:00:00	0.70	0.00	0.12	0.08	0.28	0.15	0.24	0.47	0.06	0.47	0.07	0.68	0.01	
14/01/2025 23:15:00	0.70	0.00	0.12	0.08	0.28	0.15	0.24	0.47	0.07	0.47	0.07	0.68	0.01	
14/01/2025 23:30:00	0.71	0.00	0.12	0.08	0.28	0.15	0.24	0.47	0.06	0.47	0.07	0.69	0.00	
14/01/2025 23:45:00	0.71	0.00	0.12	0.08	0.28	0.15	0.24	0.47	0.06	0.48	0.07	0.69	0.02	
15/01/2025 00:00:00	0.71	0.00	0.12	0.08	0.28	0.15	0.24	0.47	0.06	0.48	0.06	0.69	0.00	
15/01/2025 00:15:00	0.72	0.00	0.12	0.08	0.28	0.15	0.24	0.47	0.06	0.48	0.06	0.70	0.01	
15/01/2025 00:30:00	0.72	0.00	0.12	0.08	0.28	0.15	0.24	0.47	0.06	0.49	0.06	0.70	0.01	
15/01/2025 00:45:00	0.72	0.00	0.12	0.08	0.28	0.15	0.24	0.46	0.06	0.49	0.05	0.70	0.01	
15/01/2025 01:00:00	0.73	0.00	0.12	0.08	0.28	0.15	0.24	0.46	0.06	0.49	0.05	0.71	0.02	
15/01/2025 01:15:00	0.73	0.00	0.12	0.08	0.28	0.15	0.24	0.46	0.05	0.49	0.05	0.71	0.01	
15/01/2025 01:30:00	0.73	0.00	0.12	0.08	0.28	0.15	0.24	0.46	0.05	0.50	0.05	0.71	0.01	
15/01/2025 01:45:00	0.73	0.00	0.12	0.08	0.28	0.15	0.24	0.46	0.05	0.50	0.05	0.71	0.03	
15/01/2025 02:00:00	0.73	0.00	0.12	0.08	0.28	0.15	0.24	0.46	0.05	0.50	0.05	0.69	0.05	
15/01/2025 02:15:00	0.73	0.00	0.12	0.08	0.28	0.15	0.24	0.45	0.05	0.50	0.05	0.66	0.08	
15/01/2025 02:30:00	0.73	0.00	0.12	0.08	0.28	0.15	0.24	0.45	0.05	0.50	0.05	0.63	0.09	
15/01/2025 02:45:00	0.72	0.00	0.11	0.07	0.28	0.15	0.24	0.46	0.06	0.50	0.05	0.61	0.11	
15/01/2025 03:00:00	0.71	0.00	0.11	0.07	0.28	0.15	0.24	0.46	0.05	0.49	0.05	0.59	0.10	
15/01/2025 03:15:00	0.71	0.00	0.11	0.07	0.28	0.15	0.24	0.46	0.06	0.49	0.05	0.57	0.09	
15/01/2025 03:30:00	0.70	0.00	0.11	0.07	0.28	0.15	0.24	0.45	0.06	0.48	0.07	0.55	0.10	
15/01/2025 03:45:00	0.69	0.00	0.11	0.07	0.28	0.15	0.24	0.45	0.06	0.48	0.07	0.54	0.10	
15/01/2025 04:00:00	0.68	0.00	0.11	0.07	0.28	0.15	0.24	0.45	0.06	0.47	0.07	0.53	0.08	
15/01/2025 04:15:00	0.67	0.00	0.11	0.07	0.27	0.15	0.24	0.45	0.06	0.47	0.08	0.52	0.11	
15/01/2025 04:30:00	0.67	0.00	0.11	0.07	0.27	0.15	0.24	0.45	0.05	0.46	0.08	0.51	0.09	
15/01/2025 04:45:00	0.66	0.00	0.11	0.07	0.27	0.15	0.24	0.45	0.05	0.46	0.09	0.50	0.08	
15/01/2025 05:00:00	0.65	0.00	0.11	0.07	0.27	0.15	0.24	0.45	0.05	0.45	0.08	0.49	0.10	
15/01/2025 05:15:00	0.64	0.00	0.11	0.07	0.27	0.15	0.24	0.45	0.06	0.45	0.08	0.48	0.10	
15/01/2025 05:30:00	0.64	0.00	0.11	0.07	0.27	0.15	0.24	0.44	0.06	0.45	0.07	0.47	0.09	
15/01/2025 05:45:00	0.63	0.00	0.11	0.07	0.27	0.15	0.24	0.44	0.06	0.44	0.08	0.47	0.09	
15/01/2025 06:00:00	0.62	0.00	0.11	0.07	0.27	0.15	0.24	0.44	0.05	0.44	0.07	0.46	0.09	
15/01/2025 06:15:00	0.62	0.00	0.11	0.07	0.27	0.15	0.24	0.44	0.05	0.43	0.08	0.45	0.08	
15/01/2025 06:30:00	0.61	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.43	0.07	0.45	0.08	
15/01/2025 06:45:00	0.61	0.00	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.43	0.08	0.44	0.09	
15/01/2025 07:00:00	0.60	0.08	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.43	0.09	0.44	0.09	
15/01/2025 07:15:00	0.60	0.05	0.11	0.07	0.27	0.15	0.23	0.44	0.05	0.42	0.09	0.43	0.08	
15/01/2025 07:30:00	0.59	0.03	0.10	0.06	0.27	0.15	0.23	0.44	0.06	0.42	0.08	0.43	0.09	
15/01/2025 07:45:00	0.59	0.00	0.10	0.06	0.27	0.15	0.23	0.44	0.05	0.42	0.06	0.43	0.08	
15/01/2025 08:00:00	0.58	0.00	0.10	0.06	0.27	0.15	0.23	0.44	0.05	0.42	0.09	0.43	0.08	
15/01/2025 08:15:00	0.58	0.00	0.10	0.06	0.27	0.15	0.23	0.44	0.05	0.41	0.08	0.44	0.06	
15/01/2025 08:30:00	0.58	0.00	0.10	0.06	0.27	0.15	0.23	0.45	0.05	0.41	0.08	0.47	0.03	
15/01/2025 08:45:00	0.57	0.00	0.10	0.06	0.27	0.15	0.23	0.45	0.06	0.41	0.08	0.51	0.01	
15/01/2025 09:00:00	0.58	0.00	0.10	0.06	0.27	0.15	0.23	0.45	0.07	0.41	0.08	0.53	0.01	
15/01/2025 09:15:00	0.58	0.00	0.10	0.06	0.26	0.15	0.23	0.45	0.06	0.41	0.07	0.55	0.01	
15/01/2025 09:30:00	0.59	0.00	0.10	0.06	0.26	0.14	0.23	0.46	0.06	0.41	0.07	0.56	0.00	
15/01/2025 09:45:00	0.59	0.00	0.10	0.06	0.26	0.14	0.23	0.46	0.05	0.41	0.08	0.57	0.01	
15/01/2025 10:00:00	0.60	0.00	0.10	0.06	0.26	0.14	0.23	0.46	0.05	0.41	0.07	0.58	0.02	
15/01/2025 10:15:00	0.61	0.00	0.10	0.06	0.26	0.14	0.23	0.46	0.05	0.41	0.09	0.59	0.01	
15/01/2025 10:30:00	0.62	0.00	0.10	0.06	0.26	0.14	0.23	0.46	0.06	0.41	0.08	0.60	0.01	
15/01/2025 10:45:00	0.62	0.00	0.10	0.06	0.26	0.14	0.23	0.46	0.05	0.42	0.09	0.61	0.01	
15/01/2025 11:00:00	0.63	0.00	0.10	0.06	0.26	0.14	0.23	0.46	0.06	0.42	0.08	0.62	0.01	
15/01/2025 11:15:00	0.64	0.00	0.10	0.06	0.26	0.14	0.23	0.46	0.07	0.42	0.08	0.62	0.00	
15/01/2025 11:30:00	0.65	0.00	0.10	0.06	0.27	0.15	0.23	0.46	0.06	0.43	0.08	0.63	0.01	
15/01/2025 11:45:00	0.65	0.00	0.10	0.06	0.27	0.14	0.23	0.46	0.07	0.43	0.07	0.63	-0.01	
15/01/2025 12:00:00	0.66	0.00	0.10	0.06	0.27	0.14	0.23	0.46	0.06	0.43	0.07	0.64	0.00	
15/01/2025 12:15:00	0.66	0.00	0.10	0.06	0.27	0.15	0.23	0.46	0.06	0.44	0.07	0.65	0.02	
15/01/2025 12:30:00	0.67	0.00	0.10	0.06	0.27	0.15	0.23	0.47	0.07	0.44	0.07	0.65	0.00	
15/01/2025 12:45:00	0.67	0.00	0.10	0.06	0.27	0.14	0.23	0.47	0.07	0.45	0.07	0.66	0.01	
15/01/2025 13:00:00	0.68	0.00	0.10	0.06	0.27	0.15	0.23	0.47	0.06	0.45	0.07	0.66	0.01	
15/01/2025 13:15:00	0.68	0.00	0.10	0.06	0.27	0.15	0.23	0.47	0.05	0.45	0.06	0.66	-0.01	
15/01/2025 13:30:00	0.69	0.04	0.10	0.06	0.27	0.15	0.23	0.47	0.06	0.46	0.06	0.67	-0.01	
15/01/2025 13:45:00	0.69	0.04	0.10	0.06	0.27	0.15	0.23	0.47	0.06	0.46	0.06	0.67	-0.01	
15/01/2025 14:00:00	0.70	0.03	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.46	0.06	0.68	-0.01	
15/01/2025 14:15:00	0.70	0.04	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.47	0.06	0.68	0.00	
15/01/2025 14:30:00	0.70	0.04	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.47	0.06	0.66	0.04	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
15/01/2025 14:45:00	0.70	0.05	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.47	0.06	0.63	0.07	
15/01/2025 15:00:00	0.70	0.03	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.47	0.06	0.60	0.08	
15/01/2025 15:15:00	0.69	0.02	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.47	0.06	0.58	0.09	
15/01/2025 15:30:00	0.69	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.47	0.06	0.56	0.11	
15/01/2025 15:45:00	0.68	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.47	0.06	0.55	0.10	
15/01/2025 16:00:00	0.67	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.46	0.06	0.53	0.09	
15/01/2025 16:15:00	0.66	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.46	0.07	0.52	0.08	
15/01/2025 16:30:00	0.66	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.45	0.06	0.50	0.09	
15/01/2025 16:45:00	0.65	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.45	0.08	0.49	0.09	
15/01/2025 17:00:00	0.64	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.44	0.07	0.48	0.09	
15/01/2025 17:15:00	0.64	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.44	0.09	0.47	0.09	
15/01/2025 17:30:00	0.63	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.06	0.43	0.09	0.46	0.10	
15/01/2025 17:45:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.43	0.08	0.45	0.08	
15/01/2025 18:00:00	0.61	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.43	0.08	0.45	0.09	
15/01/2025 18:15:00	0.61	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.42	0.08	0.44	0.08	
15/01/2025 18:30:00	0.60	0.00	0.11	0.07	0.27	0.15	0.23	0.46	0.05	0.42	0.08	0.43	0.10	
15/01/2025 18:45:00	0.60	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.42	0.08	0.43	0.09	
15/01/2025 19:00:00	0.59	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.05	0.42	0.07	0.44	0.07	
15/01/2025 19:15:00	0.59	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.05	0.41	0.08	0.47	0.03	
15/01/2025 19:30:00	0.58	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.05	0.41	0.08	0.50	0.02	
15/01/2025 19:45:00	0.58	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.05	0.41	0.07	0.53	0.02	
15/01/2025 20:00:00	0.59	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.41	0.07	0.55	0.01	
15/01/2025 20:15:00	0.59	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.05	0.41	0.07	0.56	0.02	
15/01/2025 20:30:00	0.60	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.05	0.41	0.08	0.57	0.02	
15/01/2025 20:45:00	0.60	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.04	0.41	0.09	0.58	0.00	
15/01/2025 21:00:00	0.61	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.41	0.07	0.59	-0.01	
15/01/2025 21:15:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.47	0.06	0.41	0.07	0.60	-0.01	
15/01/2025 21:30:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.48	0.05	0.41	0.08	0.61	0.01	
15/01/2025 21:45:00	0.63	0.00	0.11	0.07	0.27	0.15	0.23	0.48	0.05	0.42	0.09	0.61	0.01	
15/01/2025 22:00:00	0.64	0.00	0.11	0.07	0.27	0.15	0.23	0.48	0.05	0.42	0.08	0.62	0.01	
15/01/2025 22:15:00	0.64	0.00	0.11	0.07	0.27	0.15	0.24	0.48	0.05	0.42	0.08	0.62	0.02	
15/01/2025 22:30:00	0.65	0.00	0.11	0.07	0.27	0.15	0.24	0.48	0.05	0.43	0.07	0.63	0.02	
15/01/2025 22:45:00	0.65	0.06	0.11	0.07	0.27	0.15	0.24	0.48	0.06	0.43	0.07	0.63	0.02	
15/01/2025 23:00:00	0.66	0.04	0.11	0.07	0.27	0.15	0.24	0.48	0.04	0.43	0.07	0.64	0.01	
15/01/2025 23:15:00	0.66	0.02	0.11	0.07	0.27	0.15	0.24	0.48	0.03	0.44	0.07	0.64	0.01	
15/01/2025 23:30:00	0.67	0.00	0.11	0.07	0.27	0.15	0.24	0.48	0.01	0.44	0.07	0.65	-0.01	
15/01/2025 23:45:00	0.67	0.00	0.11	0.07	0.27	0.15	0.24	0.48	0.20	0.44	0.07	0.65	0.01	
16/01/2025 00:00:00	0.68	0.00	0.11	0.07	0.27	0.15	0.24	0.47	0.13	0.45	0.07	0.66	0.02	
16/01/2025 00:15:00	0.68	0.00	0.12	0.08	0.27	0.15	0.24	0.47	0.05	0.45	0.07	0.66	0.01	
16/01/2025 00:30:00	0.69	0.00	0.12	0.08	0.27	0.15	0.24	0.47	0.06	0.46	0.07	0.67	0.01	
16/01/2025 00:45:00	0.69	0.03	0.12	0.08	0.27	0.15	0.24	0.47	0.06	0.46	0.07	0.67	0.01	
16/01/2025 01:00:00	0.69	0.02	0.12	0.08	0.27	0.15	0.24	0.47	0.05	0.46	0.07	0.67	0.01	
16/01/2025 01:15:00	0.70	0.01	0.12	0.08	0.27	0.15	0.24	0.46	0.05	0.46	0.06	0.68	0.01	
16/01/2025 01:30:00	0.70	0.00	0.12	0.08	0.27	0.15	0.24	0.46	0.05	0.47	0.06	0.68	0.01	
16/01/2025 01:45:00	0.70	0.00	0.12	0.08	0.27	0.15	0.24	0.46	0.05	0.47	0.06	0.68	0.02	
16/01/2025 02:00:00	0.71	0.00	0.12	0.08	0.27	0.15	0.24	0.46	0.04	0.47	0.06	0.68	0.02	
16/01/2025 02:15:00	0.71	0.00	0.11	0.07	0.27	0.15	0.24	0.46	0.05	0.48	0.06	0.69	0.01	
16/01/2025 02:30:00	0.71	0.03	0.11	0.07	0.27	0.15	0.24	0.45	0.05	0.48	0.05	0.69	0.04	
16/01/2025 02:45:00	0.71	0.04	0.11	0.07	0.27	0.15	0.24	0.45	0.05	0.48	0.05	0.66	0.07	
16/01/2025 03:00:00	0.71	0.05	0.11	0.07	0.27	0.15	0.24	0.45	0.05	0.48	0.06	0.63	0.09	
16/01/2025 03:15:00	0.71	0.05	0.11	0.07	0.27	0.15	0.23	0.45	0.06	0.48	0.06	0.61	0.08	
16/01/2025 03:30:00	0.70	0.06	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.48	0.06	0.58	0.09	
16/01/2025 03:45:00	0.69	0.06	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.47	0.07	0.56	0.11	
16/01/2025 04:00:00	0.68	0.04	0.11	0.07	0.27	0.15	0.23	0.45	0.06	0.47	0.07	0.54	0.11	
16/01/2025 04:15:00	0.68	0.02	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.46	0.07	0.53	0.09	
16/01/2025 04:30:00	0.67	0.00	0.11	0.07	0.27	0.15	0.23	0.45	0.05	0.46	0.07	0.51	0.08	
16/01/2025 04:45:00	0.66	0.00	0.11	0.07	0.26	0.15	0.23	0.44	0.04	0.46	0.07	0.50	0.10	
16/01/2025 05:00:00	0.65	0.00	0.11	0.07	0.26	0.15	0.23	0.44	0.05	0.45	0.08	0.49	0.10	
16/01/2025 05:15:00	0.64	0.00	0.11	0.07	0.26	0.15	0.23	0.44	0.04	0.45	0.07	0.48	0.08	
16/01/2025 05:30:00	0.64	0.00	0.11	0.07	0.26	0.15	0.22	0.44	0.04	0.44	0.07	0.47	0.11	
16/01/2025 05:45:00	0.63	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.44	0.08	0.46	0.09	
16/01/2025 06:00:00	0.62	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.43	0.07	0.46	0.10	
16/01/2025 06:15:00	0.62	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.43	0.08	0.45	0.09	
16/01/2025 06:30:00	0.61	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.43	0.08	0.44	0.09	
16/01/2025 06:45:00	0.60	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.42	0.06	0.43	0.09	
16/01/2025 07:00:00	0.60	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.06	0.42	0.08	0.43	0.09	
16/01/2025 07:15:00	0.59	0.00	0.10	0.06	0.26	0.15	0.22	0.44	0.05	0.42	0.08	0.42	0.09	
16/01/2025 07:30:00	0.59	0.00	0.10	0.06	0.26	0.14	0.22	0.44	0.04	0.41	0.06	0.41	0.09	
16/01/2025 07:45:00	0.58	0.00	0.10	0.06	0.26	0.14	0.22	0.44	0.05	0.41	0.07	0.41	0.09	
16/01/2025 08:00:00	0.58	0.00	0.10	0.06	0.26	0.14	0.22	0.44	0.05	0.41	0.08	0.40	0.07	
16/01/2025 08:15:00	0.57	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.05	0.41	0.07	0.40	0.08	
16/01/2025 08:30:00	0.57	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.05	0.41	0.07	0.41	0.07	
16/01/2025 08:45:00	0.56	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.06	0.41	0.07	0.42	0.07	
16/01/2025 09:00:00	0.56	0.00	0.09	0.06	0.26	0.14	0.22	0.45	0.05	0.40	0.07	0.45	0.04	
16/01/2025 09:15:00	0.56	0.00	0.09	0.05	0.26	0.14	0.22	0.45	0.05	0.40	0.07	0.49	0.01	
16/01/2025 09:30:00	0.56	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.05	0.40	0.08	0.51	0.02	
16/01/2025 09:45:00	0.56	0.00	0.10	0.06	0.25	0.14	0.21	0.46	0.05	0.40	0.07	0.52	-0.01	
16/01/2025 10:00:00	0.57	0.00	0.09	0.06	0.25	0.14	0.21	0.46	0.05	0.40	0.07	0.54	0.01	
16/01/2025 10:15:00	0.57	0.00	0.09	0.06	0.25	0.14	0.21	0.46	0.06	0.40	0.07	0.55	0.00	
16/01/2025 10:30:00	0.58	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.06	0.40	0.07	0.56	0.01	
16/01/2025 10:45:00	0.59	0.00	0.09	0.06	0.25	0.14	0.21	0.46	0.04	0.40	0.07	0.57	0.01	
16/01/2025 11:00:00	0.59	0.00	0.09	0.06	0.26	0.14	0.22	0.46	0.04	0.40	0.07	0.57	0.01	
16/01/2025 11:15:00	0.60	0.00	0.09	0.05	0.26	0.14	0.22	0.47	0.04	0.40	0.08	0.58	0.01	
16/01/2025 11:30:00	0.61	0.00	0.09	0.06	0.26	0.14	0.22	0.47	0.04	0.41	0.08	0.59	0.00	
16/01/2025 11:45:00	0.62	0.00	0.09	0.06	0.26	0.14	0.22	0.47	0.04	0.41	0.08	0.60	0.00	
16/01/2025 12:00:00	0.62	0.00	0.09	0.06	0.26	0.14	0.22	0.47	0.04	0.41	0.07	0.60	0.01	
16/01/2025 12:15:00	0.63	0.00	0.09	0.06	0.26	0.14	0.22	0.47	0.04	0.41	0.07	0.61	0.02	
16/01/2025 12:30:00	0.63	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.42	0.06	0.61	0.01	
16/01/2025 12:45:00	0.64	0.00	0.09	0.05	0.26	0.14	0.22	0.48	0.04	0.42	0.07	0.62	0.01	
16/01/2025 13:00:00	0.64	0.00	0.09	0.06	0.26	0.14	0.22	0.48	0.04	0.42	0.07	0.62	0.02	
16/01/2025 13:15:00	0.65	0.00	0.09	0.06	0.26	0.14	0.22	0.48	0.04	0.43	0.06	0.63	0.01	
16/01/2025 13:30:00	0.65	0.00	0.09	0.06	0.26	0.14	0.22	0.48	0.04	0.43	0.06	0.63	0.01	
16/01/2025 13:45:00	0.66	0.00	0.09	0.06	0.26	0.14	0.22	0.48	0.05	0.43	0.06	0.64	0.02	
16/01/2025 14:00:00	0.66	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.44	0.06	0.64	-0.01	
16/01/2025 14:15:00	0.67	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.44	0.06	0.64	0.01	
16/01/2025 14:30:00	0.67	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.44	0.06	0.65	-0.01	
16/01/2025 14:45:00	0.67	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.45	0.05	0.65	0.01	
16/01/2025 15:00:00	0.68	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.45	0.05	0.65	0.02	
16/01/2025 15:15:00	0.68	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.45	0.05	0.63	0.04	
16/01/2025 15:30:00	0.68	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.45	0.04	0.60	0.06	
16/01/2025 15:45:00	0.68	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.45	0.05	0.58	0.09	
16/01/2025 16:00:00	0.67	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.45	0.06	0.56	0.09	
16/01/2025 16:15:00	0.66	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.45	0.06	0.54	0.08	
16/01/2025 16:30:00	0.66	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.45	0.07	0.52	0.09	
16/01/2025 16:45:00	0.65	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.44	0.07	0.51	0.08	
16/01/2025 17:00:00	0.64	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.44	0.06	0.49	0.10	
16/01/2025 17:15:00	0.64	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.44	0.07	0.48	0.09	
16/01/2025 17:30:00	0.63	0.08	0.10	0.06	0.26	0.14	0.22	0.47	0.03	0.43	0.07	0.47	0.11	
16/01/2025 17:45:00	0.62	0.06	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.43	0.06	0.46	0.09	
16/01/2025 18:00:00	0.61	0.05	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.43	0.07	0.45	0.09	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
16/01/2025 18:15:00	0.61	0.03	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.42	0.06	0.44	0.08	
16/01/2025 18:30:00	0.60	0.02	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.42	0.07	0.43	0.09	
16/01/2025 18:45:00	0.59	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.42	0.06	0.42	0.09	
16/01/2025 19:00:00	0.59	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.41	0.07	0.42	0.09	
16/01/2025 19:15:00	0.58	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.41	0.08	0.41	0.09	
16/01/2025 19:30:00	0.58	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.41	0.07	0.40	0.08	
16/01/2025 19:45:00	0.57	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.41	0.08	0.40	0.08	
16/01/2025 20:00:00	0.57	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.41	0.07	0.41	0.05	
16/01/2025 20:15:00	0.56	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.40	0.07	0.45	0.03	
16/01/2025 20:30:00	0.56	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.04	0.40	0.08	0.48	0.04	
16/01/2025 20:45:00	0.56	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.40	0.08	0.50	0.02	
16/01/2025 21:00:00	0.56	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.40	0.07	0.52	0.01	
16/01/2025 21:15:00	0.57	0.06	0.11	0.07	0.26	0.14	0.22	0.48	0.04	0.40	0.08	0.53	0.02	
16/01/2025 21:30:00	0.57	0.05	0.11	0.07	0.26	0.14	0.22	0.48	0.05	0.40	0.07	0.54	0.01	
16/01/2025 21:45:00	0.58	0.04	0.11	0.07	0.26	0.14	0.22	0.48	0.05	0.40	0.07	0.55	0.01	
16/01/2025 22:00:00	0.58	0.05	0.11	0.07	0.26	0.14	0.22	0.48	0.05	0.40	0.07	0.56	0.01	
16/01/2025 22:15:00	0.59	0.05	0.11	0.07	0.26	0.14	0.22	0.48	0.05	0.40	0.07	0.57	0.02	
16/01/2025 22:30:00	0.60	0.05	0.11	0.07	0.26	0.14	0.22	0.48	0.04	0.40	0.07	0.57	0.01	
16/01/2025 22:45:00	0.60	0.05	0.11	0.07	0.26	0.14	0.23	0.48	0.05	0.40	0.07	0.58	0.01	
16/01/2025 23:00:00	0.61	0.03	0.11	0.07	0.26	0.14	0.23	0.48	0.05	0.41	0.08	0.59	0.01	
16/01/2025 23:15:00	0.61	0.02	0.11	0.07	0.27	0.14	0.23	0.48	0.05	0.41	0.08	0.59	0.02	
16/01/2025 23:30:00	0.62	0.00	0.11	0.07	0.27	0.14	0.23	0.48	0.05	0.41	0.07	0.60	0.02	
16/01/2025 23:45:00	0.62	0.00	0.11	0.07	0.27	0.15	0.23	0.48	0.05	0.41	0.07	0.60	0.02	
17/01/2025 00:00:00	0.63	0.00	0.11	0.07	0.27	0.15	0.23	0.48	0.04	0.42	0.07	0.61	0.01	
17/01/2025 00:15:00	0.63	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.05	0.42	0.07	0.61	0.01	
17/01/2025 00:30:00	0.64	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.42	0.07	0.62	0.02	
17/01/2025 00:45:00	0.64	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.42	0.07	0.62	0.01	
17/01/2025 01:00:00	0.65	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.43	0.06	0.63	0.02	
17/01/2025 01:15:00	0.65	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.43	0.05	0.63	0.02	
17/01/2025 01:30:00	0.66	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.43	0.04	0.63	0.02	
17/01/2025 01:45:00	0.66	0.04	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.44	0.04	0.64	0.02	
17/01/2025 02:00:00	0.66	0.04	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.44	0.05	0.64	0.02	
17/01/2025 02:15:00	0.67	0.04	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.44	0.06	0.64	0.02	
17/01/2025 02:30:00	0.67	0.04	0.11	0.07	0.26	0.15	0.23	0.46	0.04	0.44	0.06	0.65	0.01	
17/01/2025 02:45:00	0.67	0.05	0.11	0.07	0.26	0.15	0.23	0.46	0.04	0.45	0.07	0.65	0.02	
17/01/2025 03:00:00	0.68	0.03	0.11	0.07	0.26	0.15	0.22	0.46	0.04	0.45	0.06	0.64	0.05	
17/01/2025 03:15:00	0.68	0.02	0.11	0.07	0.26	0.14	0.22	0.46	0.04	0.45	0.07	0.61	0.07	
17/01/2025 03:30:00	0.68	0.00	0.11	0.07	0.26	0.14	0.22	0.46	0.04	0.45	0.07	0.59	0.09	
17/01/2025 03:45:00	0.67	0.00	0.11	0.07	0.26	0.14	0.22	0.46	0.04	0.45	0.06	0.56	0.09	
17/01/2025 04:00:00	0.66	0.00	0.11	0.07	0.26	0.14	0.22	0.46	0.04	0.45	0.06	0.54	0.09	
17/01/2025 04:15:00	0.66	0.07	0.11	0.07	0.26	0.14	0.22	0.46	0.04	0.45	0.06	0.52	0.10	
17/01/2025 04:30:00	0.65	0.04	0.10	0.06	0.26	0.14	0.22	0.46	0.03	0.44	0.07	0.50	0.09	
17/01/2025 04:45:00	0.64	0.02	0.10	0.06	0.26	0.14	0.22	0.46	0.03	0.44	0.07	0.49	0.11	
17/01/2025 05:00:00	0.64	0.00	0.10	0.06	0.26	0.14	0.22	0.46	0.03	0.44	0.07	0.48	0.08	
17/01/2025 05:15:00	0.63	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.03	0.43	0.07	0.47	0.09	
17/01/2025 05:30:00	0.62	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.03	0.43	0.08	0.45	0.09	
17/01/2025 05:45:00	0.61	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.02	0.42	0.08	0.45	0.10	
17/01/2025 06:00:00	0.61	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.01	0.42	0.08	0.44	0.10	
17/01/2025 06:15:00	0.60	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.01	0.42	0.08	0.43	0.08	
17/01/2025 06:30:00	0.59	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.00	0.42	0.07	0.42	0.09	
17/01/2025 06:45:00	0.59	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.04	0.41	0.07	0.41	0.08	
17/01/2025 07:00:00	0.58	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.41	0.07	0.41	0.09	
17/01/2025 07:15:00	0.57	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.41	0.08	0.40	0.08	
17/01/2025 07:30:00	0.57	0.00	0.10	0.06	0.25	0.14	0.21	0.46	0.04	0.41	0.08	0.39	0.07	
17/01/2025 07:45:00	0.56	0.00	0.10	0.06	0.25	0.14	0.21	0.46	0.05	0.40	0.07	0.39	0.09	
17/01/2025 08:00:00	0.56	0.08	0.10	0.06	0.25	0.14	0.21	0.46	0.05	0.40	0.07	0.38	0.07	
17/01/2025 08:15:00	0.55	0.06	0.10	0.06	0.25	0.14	0.21	0.46	0.04	0.40	0.07	0.38	0.10	
17/01/2025 08:30:00	0.55	0.03	0.09	0.05	0.25	0.14	0.21	0.46	0.04	0.40	0.08	0.37	0.07	
17/01/2025 08:45:00	0.54	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.04	0.40	0.07	0.37	0.08	
17/01/2025 09:00:00	0.54	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.04	0.40	0.07	0.36	0.06	
17/01/2025 09:15:00	0.53	0.00	0.10	0.06	0.25	0.14	0.21	0.47	0.04	0.40	0.08	0.36	0.04	
17/01/2025 09:30:00	0.53	0.00	0.09	0.05	0.25	0.14	0.21	0.47	0.04	0.40	0.07	0.37	0.05	
17/01/2025 09:45:00	0.53	0.00	0.10	0.06	0.25	0.14	0.21	0.47	0.04	0.40	0.07	0.38	0.01	
17/01/2025 10:00:00	0.52	0.00	0.10	0.06	0.25	0.14	0.21	0.47	0.44	0.40	0.07	0.41	0.01	
17/01/2025 10:15:00	0.52	0.00	0.10	0.06	0.25	0.14	0.21	0.47	0.40	0.39	0.08	0.44	0.02	
17/01/2025 10:30:00	0.52	0.00	0.10	0.06	0.25	0.14	0.21	0.47	0.35	0.39	0.07	0.46	0.00	
17/01/2025 10:45:00	0.53	0.00	0.10	0.06	0.25	0.14	0.21	0.47	0.04	0.39	0.07	0.48	0.01	
17/01/2025 11:00:00	0.53	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.39	0.07	0.49	0.01	
17/01/2025 11:15:00	0.54	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.39	0.08	0.50	0.01	
17/01/2025 11:30:00	0.54	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.39	0.08	0.51	0.01	
17/01/2025 11:45:00	0.55	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.39	0.07	0.52	0.01	
17/01/2025 12:00:00	0.55	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.39	0.07	0.53	-0.01	
17/01/2025 12:15:00	0.56	0.04	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.39	0.08	0.53	0.00	
17/01/2025 12:30:00	0.57	0.03	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.39	0.06	0.54	0.01	
17/01/2025 12:45:00	0.57	0.01	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.40	0.07	0.55	0.00	
17/01/2025 13:00:00	0.58	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.40	0.08	0.55	0.01	
17/01/2025 13:15:00	0.58	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.40	0.06	0.56	0.01	
17/01/2025 13:30:00	0.59	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.40	0.07	0.57	0.00	
17/01/2025 13:45:00	0.60	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.40	0.06	0.57	0.01	
17/01/2025 14:00:00	0.60	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.40	0.08	0.58	0.01	
17/01/2025 14:15:00	0.61	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.40	0.07	0.58	0.02	
17/01/2025 14:30:00	0.61	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.41	0.07	0.59	0.01	
17/01/2025 14:45:00	0.61	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.41	0.08	0.59	0.02	
17/01/2025 15:00:00	0.62	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.41	0.07	0.59	0.02	
17/01/2025 15:15:00	0.62	0.00	0.11	0.07	0.26	0.14	0.22	0.47	0.05	0.41	0.08	0.60	0.00	
17/01/2025 15:30:00	0.63	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.41	0.07	0.60	0.01	
17/01/2025 15:45:00	0.63	0.04	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.42	0.07	0.59	0.05	
17/01/2025 16:00:00	0.63	0.06	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.42	0.06	0.57	0.06	
17/01/2025 16:15:00	0.63	0.06	0.11	0.07	0.26	0.14	0.22	0.47	0.05	0.42	0.07	0.54	0.07	
17/01/2025 16:30:00	0.63	0.05	0.11	0.07	0.26	0.14	0.22	0.47	0.05	0.42	0.07	0.52	0.07	
17/01/2025 16:45:00	0.62	0.04	0.11	0.07	0.26	0.14	0.22	0.47	0.04	0.42	0.07	0.50	0.08	
17/01/2025 17:00:00	0.62	0.03	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.42	0.06	0.49	0.09	
17/01/2025 17:15:00	0.61	0.02	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.42	0.06	0.47	0.09	
17/01/2025 17:30:00	0.61	0.01	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.42	0.07	0.46	0.10	
17/01/2025 17:45:00	0.60	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.41	0.06	0.44	0.09	
17/01/2025 18:00:00	0.59	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.41	0.06	0.43	0.09	
17/01/2025 18:15:00	0.59	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.04	0.41	0.06	0.42	0.10	
17/01/2025 18:30:00	0.58	0.00	0.11	0.07	0.26	0.14	0.22	0.47	0.05	0.41	0.06	0.41	0.09	
17/01/2025 18:45:00	0.58	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.41	0.06	0.40	0.08	
17/01/2025 19:00:00	0.57	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.40	0.06	0.40	0.08	
17/01/2025 19:15:00	0.56	0.00	0.10	0.06	0.26	0.14	0.22	0.47	0.05	0.40	0.06	0.39	0.08	
17/01/2025 19:30:00	0.56	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.40	0.05	0.39	0.07	
17/01/2025 19:45:00	0.55	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.06	0.40	0.06	0.39	0.04	
17/01/2025 20:00:00	0.55	0.00	0.11	0.07	0.26	0.14	0.22	0.48	0.05	0.40	0.06	0.42	0.04	
17/01/2025 20:15:00	0.54	0.00	0.10	0.06	0.26	0.14	0.22	0.48	0.05	0.40	0.06	0.45	0.03	
17/01/2025 20:30:00	0.54	0.00	0.11	0.07	0.26	0.14	0.22	0.48	0.04	0.40	0.06	0.48	0.02	
17/01/2025 20:45:00	0.54	0.00	0.11	0.07	0.26	0.14	0.22	0.48	0.04	0.39	0.06	0.49	0.02	
17/01/2025 21:00:00	0.55	0.00	0.11	0.07	0.26	0.14	0.22	0.48	0.04	0.39	0.06	0.50	0.02	
17/01/2025 21:15:00	0.55	0.00	0.11	0.07	0.26	0.14	0.22	0.48	0.04	0.39	0.06	0.51	0.01	
17/01/2025 21:30:00	0.56	0.00	0.11	0.07	0.26	0.14	0.22	0.48	0.04	0.39	0.06	0.52	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
17/01/2025 21:45:00	0.56	0.00	0.11	0.07	0.26	0.14	0.22	0.48	0.04	0.39	0.06	0.53	0.01	
17/01/2025 22:00:00	0.57	0.00	0.11	0.07	0.26	0.14	0.22	0.48	0.05	0.39	0.06	0.54	0.01	
17/01/2025 22:15:00	0.57	0.04	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.39	0.06	0.55	0.01	
17/01/2025 22:30:00	0.58	0.04	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.40	0.06	0.55	0.01	
17/01/2025 22:45:00	0.58	0.04	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.40	0.06	0.56	0.02	
17/01/2025 23:00:00	0.59	0.04	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.40	0.06	0.56	0.01	
17/01/2025 23:15:00	0.59	0.02	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.40	0.07	0.57	0.01	
17/01/2025 23:30:00	0.60	0.01	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.40	0.06	0.57	0.02	
17/01/2025 23:45:00	0.60	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.40	0.06	0.58	0.02	
18/01/2025 00:00:00	0.61	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.05	0.40	0.07	0.58	0.02	
18/01/2025 00:15:00	0.61	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.41	0.06	0.59	0.02	
18/01/2025 00:30:00	0.62	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.41	0.06	0.59	0.02	
18/01/2025 00:45:00	0.62	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.03	0.41	0.08	0.59	0.02	
18/01/2025 01:00:00	0.62	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.04	0.41	0.07	0.60	0.02	
18/01/2025 01:15:00	0.63	0.00	0.11	0.07	0.26	0.15	0.23	0.47	0.05	0.41	0.08	0.60	0.01	
18/01/2025 01:30:00	0.63	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.03	0.42	0.07	0.61	0.02	
18/01/2025 01:45:00	0.64	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.03	0.42	0.06	0.61	0.01	
18/01/2025 02:00:00	0.64	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.03	0.42	0.07	0.61	0.02	
18/01/2025 02:15:00	0.64	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.04	0.42	0.07	0.62	0.01	
18/01/2025 02:30:00	0.64	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.03	0.42	0.07	0.62	0.00	
18/01/2025 02:45:00	0.65	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.03	0.43	0.07	0.62	0.01	
18/01/2025 03:00:00	0.65	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.04	0.43	0.07	0.63	0.02	
18/01/2025 03:15:00	0.65	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.04	0.43	0.06	0.63	0.00	
18/01/2025 03:30:00	0.66	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.04	0.43	0.07	0.63	0.01	
18/01/2025 03:45:00	0.66	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.05	0.44	0.06	0.64	0.01	
18/01/2025 04:00:00	0.66	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.63	0.44	0.06	0.63	0.03	
18/01/2025 04:15:00	0.66	0.00	0.10	0.06	0.26	0.15	0.22	0.45	0.54	0.44	0.06	0.61	0.05	
18/01/2025 04:30:00	0.66	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.45	0.44	0.06	0.58	0.08	
18/01/2025 04:45:00	0.66	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.36	0.44	0.06	0.55	0.09	
18/01/2025 05:00:00	0.65	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.27	0.44	0.08	0.53	0.10	
18/01/2025 05:15:00	0.65	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.18	0.44	0.07	0.51	0.08	
18/01/2025 05:30:00	0.64	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.08	0.44	0.07	0.49	0.09	
18/01/2025 05:45:00	0.63	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.07	0.43	0.07	0.48	0.08	
18/01/2025 06:00:00	0.62	0.00	0.10	0.06	0.26	0.14	0.22	0.45	0.05	0.43	0.07	0.47	0.09	
18/01/2025 06:15:00	0.62	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.42	0.07	0.45	0.08	
18/01/2025 06:30:00	0.61	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.42	0.07	0.44	0.09	
18/01/2025 06:45:00	0.60	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.42	0.07	0.43	0.09	
18/01/2025 07:00:00	0.60	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.42	0.07	0.42	0.09	
18/01/2025 07:15:00	0.59	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.41	0.06	0.42	0.07	
18/01/2025 07:30:00	0.58	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.41	0.06	0.41	0.08	
18/01/2025 07:45:00	0.58	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.41	0.06	0.40	0.10	
18/01/2025 08:00:00	0.57	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.41	0.06	0.39	0.08	
18/01/2025 08:15:00	0.56	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.40	0.07	0.39	0.07	
18/01/2025 08:30:00	0.56	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.40	0.07	0.38	0.07	
18/01/2025 08:45:00	0.55	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.40	0.07	0.37	0.08	
18/01/2025 09:00:00	0.55	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.40	0.07	0.37	0.08	
18/01/2025 09:15:00	0.54	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.03	0.40	0.06	0.36	0.06	
18/01/2025 09:30:00	0.54	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.40	0.06	0.36	0.06	
18/01/2025 09:45:00	0.53	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.04	0.39	0.06	0.35	0.08	
18/01/2025 10:00:00	0.53	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.04	0.39	0.05	0.35	0.06	
18/01/2025 10:15:00	0.52	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.04	0.39	0.06	0.34	0.05	
18/01/2025 10:30:00	0.52	0.00	0.09	0.05	0.25	0.14	0.21	0.46	0.04	0.39	0.07	0.35	0.05	
18/01/2025 10:45:00	0.52	0.00	0.09	0.05	0.25	0.14	0.21	0.47	0.04	0.39	0.07	0.36	0.04	
18/01/2025 11:00:00	0.51	0.00	0.09	0.05	0.25	0.14	0.21	0.47	0.04	0.39	0.05	0.39	0.01	
18/01/2025 11:15:00	0.51	0.00	0.09	0.05	0.25	0.14	0.21	0.47	0.04	0.39	0.06	0.42	0.03	
18/01/2025 11:30:00	0.51	0.00	0.09	0.05	0.25	0.14	0.21	0.47	0.04	0.39	0.06	0.44	0.01	
18/01/2025 11:45:00	0.51	0.00	0.09	0.05	0.25	0.14	0.21	0.47	0.04	0.39	0.06	0.46	0.01	
18/01/2025 12:00:00	0.52	0.00	0.09	0.05	0.25	0.14	0.21	0.48	0.04	0.39	0.06	0.47	0.00	
18/01/2025 12:15:00	0.52	0.00	0.09	0.05	0.25	0.14	0.21	0.48	0.05	0.39	0.06	0.48	0.00	
18/01/2025 12:30:00	0.53	0.00	0.09	0.05	0.25	0.14	0.21	0.48	0.05	0.39	0.06	0.49	0.02	
18/01/2025 12:45:00	0.53	0.00	0.09	0.05	0.25	0.14	0.21	0.48	0.05	0.39	0.05	0.50	0.00	
18/01/2025 13:00:00	0.54	0.00	0.10	0.06	0.25	0.14	0.21	0.49	0.05	0.39	0.06	0.51	-0.01	
18/01/2025 13:15:00	0.54	0.00	0.10	0.06	0.25	0.14	0.21	0.49	0.04	0.39	0.06	0.51	0.01	
18/01/2025 13:30:00	0.55	0.00	0.10	0.06	0.25	0.14	0.21	0.49	0.04	0.39	0.06	0.52	-0.01	
18/01/2025 13:45:00	0.56	0.00	0.10	0.06	0.26	0.14	0.21	0.49	0.04	0.39	0.06	0.53	0.01	
18/01/2025 14:00:00	0.56	0.00	0.10	0.06	0.26	0.14	0.21	0.49	0.04	0.39	0.06	0.53	0.01	
18/01/2025 14:15:00	0.57	0.06	0.10	0.06	0.26	0.14	0.22	0.49	0.04	0.39	0.06	0.54	0.00	
18/01/2025 14:30:00	0.57	0.05	0.10	0.06	0.26	0.15	0.22	0.48	0.04	0.39	0.06	0.54	0.00	
18/01/2025 14:45:00	0.58	0.05	0.10	0.06	0.26	0.15	0.22	0.48	0.05	0.39	0.06	0.55	-0.01	
18/01/2025 15:00:00	0.58	0.05	0.10	0.06	0.26	0.15	0.22	0.48	0.04	0.39	0.06	0.55	0.00	
18/01/2025 15:15:00	0.59	0.05	0.10	0.06	0.26	0.15	0.22	0.49	0.05	0.40	0.06	0.56	0.01	
18/01/2025 15:30:00	0.59	0.06	0.11	0.07	0.26	0.15	0.22	0.49	0.05	0.40	0.06	0.56	0.01	
18/01/2025 15:45:00	0.60	0.04	0.11	0.07	0.26	0.15	0.22	0.49	0.04	0.40	0.07	0.57	0.01	
18/01/2025 16:00:00	0.60	0.06	0.11	0.07	0.26	0.15	0.22	0.49	0.04	0.40	0.06	0.57	0.02	
18/01/2025 16:15:00	0.60	0.05	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.40	0.07	0.56	0.04	
18/01/2025 16:30:00	0.61	0.06	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.40	0.07	0.54	0.06	
18/01/2025 16:45:00	0.60	0.07	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.40	0.06	0.51	0.07	
18/01/2025 17:00:00	0.60	0.04	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.41	0.05	0.49	0.07	
18/01/2025 17:15:00	0.60	0.02	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.41	0.03	0.47	0.07	
18/01/2025 17:30:00	0.59	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.41	0.02	0.45	0.09	
18/01/2025 17:45:00	0.59	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.41	0.02	0.44	0.09	
18/01/2025 18:00:00	0.58	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.40	0.03	0.43	0.08	
18/01/2025 18:15:00	0.58	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.40	0.03	0.41	0.09	
18/01/2025 18:30:00	0.57	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.40	0.03	0.40	0.08	
18/01/2025 18:45:00	0.56	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.40	0.05	0.39	0.07	
18/01/2025 19:00:00	0.56	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.40	0.06	0.38	0.10	
18/01/2025 19:15:00	0.55	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.40	0.06	0.37	0.08	
18/01/2025 19:30:00	0.55	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.05	0.40	0.06	0.37	0.10	
18/01/2025 19:45:00	0.54	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.05	0.40	0.05	0.36	0.08	
18/01/2025 20:00:00	0.54	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.05	0.39	0.05	0.35	0.07	
18/01/2025 20:15:00	0.53	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.05	0.39	0.03	0.35	0.07	
18/01/2025 20:30:00	0.53	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.05	0.39	0.03	0.35	0.06	
18/01/2025 20:45:00	0.52	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.03	0.37	0.04	
18/01/2025 21:00:00	0.52	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.39	0.03	0.40	0.03	
18/01/2025 21:15:00	0.52	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.03	0.42	0.03	
18/01/2025 21:30:00	0.52	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.03	0.44	0.02	
18/01/2025 21:45:00	0.52	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.03	0.46	0.02	
18/01/2025 22:00:00	0.52	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.03	0.47	0.02	
18/01/2025 22:15:00	0.53	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.03	0.48	0.01	
18/01/2025 22:30:00	0.53	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.03	0.49	0.02	
18/01/2025 22:45:00	0.53	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.04	0.50	0.02	
18/01/2025 23:00:00	0.54	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.04	0.50	0.01	
18/01/2025 23:15:00	0.54	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.04	0.51	0.02	
18/01/2025 23:30:00	0.55	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.05	0.52	0.01	
18/01/2025 23:45:00	0.55	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.05	0.52	0.02	
19/01/2025 00:00:00	0.56	0.00	0.11	0.07	0.26	0.15	0.23	0.48	0.04	0.39	0.05	0.53	0.01	
19/01/2025 00:15:00	0.56	0.00	0.11	0.07	0.26	0.15	0.22	0.48	0.04	0.39	0.05	0.53	0.01	
19/01/2025 00:30:00	0.57	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.04	0.39	0.05	0.54	0.01	
19/01/2025 00:45:00	0.57	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.03	0.39	0.06	0.54	0.02	
19/01/2025 01:00:00	0.58	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.04	0.39	0.05	0.55	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
19/01/2025 01:15:00	0.58	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.04	0.40	0.05	0.55	0.02	
19/01/2025 01:30:00	0.59	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.04	0.40	0.06	0.56	0.01	
19/01/2025 01:45:00	0.59	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.04	0.40	0.06	0.56	0.02	
19/01/2025 02:00:00	0.60	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.04	0.40	0.06	0.57	0.02	
19/01/2025 02:15:00	0.60	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.04	0.40	0.06	0.57	0.02	
19/01/2025 02:30:00	0.60	0.00	0.11	0.07	0.26	0.15	0.22	0.47	0.04	0.40	0.06	0.57	0.01	
19/01/2025 02:45:00	0.61	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.04	0.40	0.06	0.58	0.02	
19/01/2025 03:00:00	0.61	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.04	0.41	0.06	0.58	0.02	
19/01/2025 03:15:00	0.61	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.04	0.41	0.06	0.58	0.02	
19/01/2025 03:30:00	0.62	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.03	0.41	0.06	0.59	0.02	
19/01/2025 03:45:00	0.62	0.00	0.11	0.07	0.26	0.15	0.22	0.46	0.04	0.41	0.06	0.59	0.00	
19/01/2025 04:00:00	0.62	0.05	0.11	0.07	0.26	0.15	0.22	0.46	0.04	0.41	0.06	0.59	0.02	
19/01/2025 04:15:00	0.63	0.04	0.10	0.06	0.26	0.15	0.22	0.46	0.04	0.41	0.06	0.60	0.02	
19/01/2025 04:30:00	0.63	0.04	0.10	0.06	0.26	0.15	0.22	0.46	0.04	0.42	0.07	0.60	0.03	
19/01/2025 04:45:00	0.63	0.04	0.10	0.06	0.26	0.15	0.22	0.46	0.04	0.42	0.07	0.58	0.07	
19/01/2025 05:00:00	0.63	0.06	0.10	0.06	0.26	0.15	0.22	0.46	0.04	0.42	0.07	0.55	0.08	
19/01/2025 05:15:00	0.63	0.04	0.10	0.06	0.26	0.15	0.22	0.46	0.04	0.42	0.07	0.53	0.09	
19/01/2025 05:30:00	0.62	0.02	0.10	0.06	0.25	0.15	0.21	0.46	0.04	0.42	0.06	0.51	0.09	
19/01/2025 05:45:00	0.62	0.00	0.10	0.06	0.25	0.15	0.21	0.46	0.04	0.42	0.06	0.48	0.07	
19/01/2025 06:00:00	0.61	0.00	0.10	0.06	0.25	0.15	0.21	0.45	0.04	0.42	0.07	0.47	0.09	
19/01/2025 06:15:00	0.61	0.00	0.10	0.06	0.25	0.15	0.21	0.45	0.04	0.42	0.06	0.45	0.09	
19/01/2025 06:30:00	0.60	0.00	0.10	0.06	0.25	0.15	0.21	0.45	0.03	0.41	0.06	0.44	0.10	
19/01/2025 06:45:00	0.59	0.00	0.10	0.06	0.25	0.15	0.21	0.45	0.04	0.41	0.07	0.43	0.09	
19/01/2025 07:00:00	0.59	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.41	0.06	0.42	0.08	
19/01/2025 07:15:00	0.58	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.04	0.41	0.07	0.41	0.07	
19/01/2025 07:30:00	0.57	0.00	0.10	0.06	0.25	0.14	0.21	0.45	0.28	0.40	0.06	0.40	0.09	
19/01/2025 07:45:00	0.57	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.40	0.06	0.39	0.10	
19/01/2025 08:00:00	0.56	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.40	0.06	0.38	0.06	
19/01/2025 08:15:00	0.55	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.40	0.06	0.37	0.09	
19/01/2025 08:30:00	0.55	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.40	0.06	0.37	0.08	
19/01/2025 08:45:00	0.54	0.00	0.09	0.05	0.25	0.14	0.21	0.45	0.04	0.40	0.05	0.36	0.07	
19/01/2025 09:00:00	0.54	0.00	0.09	0.05	0.25	0.14	0.20	0.45	0.04	0.40	0.06	0.35	0.09	
19/01/2025 09:15:00	0.53	0.00	0.09	0.05	0.25	0.14	0.20	0.45	0.04	0.39	0.06	0.35	0.07	
19/01/2025 09:30:00	0.53	0.00	0.09	0.05	0.25	0.14	0.20	0.46	0.04	0.39	0.06	0.34	0.08	
19/01/2025 09:45:00	0.52	0.00	0.09	0.05	0.25	0.14	0.20	0.46	0.05	0.39	0.05	0.34	0.06	
19/01/2025 10:00:00	0.52	0.00	0.09	0.05	0.25	0.14	0.20	0.46	0.05	0.39	0.05	0.33	0.06	
19/01/2025 10:15:00	0.51	0.00	0.09	0.05	0.25	0.14	0.20	0.46	0.05	0.39	0.05	0.34	0.05	
19/01/2025 10:30:00	0.51	0.00	0.09	0.05	0.25	0.14	0.20	0.47	0.05	0.39	0.05	0.34	0.05	
19/01/2025 10:45:00	0.51	0.00	0.09	0.05	0.25	0.14	0.20	0.47	0.05	0.39	0.04	0.36	0.02	
19/01/2025 11:00:00	0.50	0.00	0.09	0.05	0.25	0.14	0.20	0.47	0.05	0.39	0.05	0.40	0.04	
19/01/2025 11:15:00	0.50	0.00	0.09	0.05	0.25	0.14	0.20	0.47	0.05	0.39	0.07	0.42	0.02	
19/01/2025 11:30:00	0.51	0.00	0.09	0.05	0.25	0.14	0.20	0.48	0.06	0.39	0.05	0.44	0.01	
19/01/2025 11:45:00	0.51	0.00	0.09	0.05	0.25	0.14	0.20	0.48	0.06	0.39	0.05	0.45	0.03	
19/01/2025 12:00:00	0.51	0.00	0.09	0.05	0.25	0.14	0.21	0.48	0.06	0.39	0.04	0.46	0.02	
19/01/2025 12:15:00	0.52	0.00	0.09	0.05	0.25	0.14	0.21	0.48	0.05	0.39	0.06	0.47	0.02	
19/01/2025 12:30:00	0.52	0.00	0.09	0.05	0.25	0.14	0.21	0.48	0.05	0.39	0.06	0.48	0.01	
19/01/2025 12:45:00	0.53	0.00	0.10	0.06	0.25	0.14	0.21	0.48	0.05	0.39	0.06	0.49	0.01	
19/01/2025 13:00:00	0.53	0.00	0.10	0.06	0.25	0.14	0.21	0.48	0.05	0.39	0.06	0.49	0.01	
19/01/2025 13:15:00	0.54	0.00	0.10	0.06	0.25	0.14	0.21	0.49	0.05	0.39	0.07	0.50	0.01	
19/01/2025 13:30:00	0.54	0.00	0.10	0.06	0.25	0.14	0.21	0.49	0.06	0.39	0.06	0.51	0.01	
19/01/2025 13:45:00	0.55	0.00	0.10	0.06	0.25	0.16	0.21	0.49	0.05	0.39	0.07	0.51	0.01	
19/01/2025 14:00:00	0.55	0.00	0.10	0.06	0.26	0.16	0.21	0.49	0.06	0.39	0.06	0.52	0.00	
19/01/2025 14:15:00	0.56	0.00	0.10	0.06	0.26	0.16	0.22	0.49	0.05	0.39	0.07	0.52	0.00	
19/01/2025 14:30:00	0.56	0.00	0.10	0.06	0.26	0.16	0.22	0.49	0.05	0.39	0.07	0.53	0.02	
19/01/2025 14:45:00	0.57	0.00	0.10	0.06	0.26	0.16	0.22	0.49	0.05	0.39	0.07	0.53	0.02	
19/01/2025 15:00:00	0.57	0.00	0.11	0.07	0.26	0.16	0.22	0.49	0.05	0.39	0.06	0.54	0.01	
19/01/2025 15:15:00	0.57	0.00	0.11	0.07	0.26	0.16	0.22	0.48	0.05	0.39	0.06	0.54	0.02	
19/01/2025 15:30:00	0.58	0.00	0.11	0.07	0.26	0.16	0.22	0.48	0.05	0.39	0.06	0.55	0.03	
19/01/2025 15:45:00	0.58	0.00	0.11	0.07	0.26	0.16	0.22	0.48	0.05	0.40	0.06	0.55	0.01	
19/01/2025 16:00:00	0.59	0.00	0.11	0.07	0.26	0.16	0.22	0.48	0.05	0.40	0.06	0.56	0.02	
19/01/2025 16:15:00	0.59	0.00	0.11	0.07	0.26	0.16	0.22	0.48	0.05	0.40	0.06	0.56	0.01	
19/01/2025 16:30:00	0.59	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.05	0.40	0.06	0.56	0.02	
19/01/2025 16:45:00	0.60	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.04	0.40	0.06	0.57	0.02	
19/01/2025 17:00:00	0.60	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.04	0.40	0.06	0.57	0.03	
19/01/2025 17:15:00	0.60	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.05	0.40	0.07	0.55	0.04	
19/01/2025 17:30:00	0.60	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.05	0.41	0.07	0.53	0.08	
19/01/2025 17:45:00	0.60	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.05	0.41	0.06	0.50	0.07	
19/01/2025 18:00:00	0.60	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.05	0.41	0.06	0.49	0.08	
19/01/2025 18:15:00	0.59	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.05	0.41	0.07	0.47	0.07	
19/01/2025 18:30:00	0.59	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.05	0.41	0.07	0.45	0.09	
19/01/2025 18:45:00	0.58	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.05	0.41	0.07	0.44	0.08	
19/01/2025 19:00:00	0.58	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.05	0.40	0.07	0.42	0.10	
19/01/2025 19:15:00	0.57	0.00	0.11	0.07	0.26	0.16	0.23	0.48	0.05	0.40	0.07	0.41	0.08	
19/01/2025 19:30:00	0.57	0.00	0.11	0.07	0.27	0.16	0.23	0.48	0.05	0.40	0.07	0.40	0.08	
19/01/2025 19:45:00	0.56	0.00	0.11	0.07	0.27	0.16	0.23	0.49	0.04	0.40	0.08	0.39	0.08	
19/01/2025 20:00:00	0.56	0.00	0.11	0.07	0.27	0.16	0.23	0.49	0.05	0.40	0.07	0.38	0.07	
19/01/2025 20:15:00	0.55	0.00	0.12	0.07	0.27	0.16	0.23	0.49	0.05	0.40	0.08	0.37	0.09	
19/01/2025 20:30:00	0.54	0.00	0.12	0.07	0.27	0.16	0.23	0.49	0.05	0.40	0.08	0.36	0.09	
19/01/2025 20:45:00	0.54	0.00	0.12	0.07	0.27	0.16	0.23	0.49	0.04	0.40	0.07	0.36	0.09	
19/01/2025 21:00:00	0.53	0.00	0.12	0.07	0.27	0.16	0.23	0.49	0.05	0.39	0.08	0.35	0.09	
19/01/2025 21:15:00	0.53	0.00	0.12	0.08	0.27	0.17	0.23	0.49	0.05	0.39	0.07	0.35	0.06	
19/01/2025 21:30:00	0.52	0.00	0.12	0.08	0.27	0.16	0.23	0.49	0.05	0.39	0.07	0.38	0.04	
19/01/2025 21:45:00	0.52	0.00	0.12	0.08	0.27	0.16	0.23	0.49	0.05	0.39	0.06	0.41	0.04	
19/01/2025 22:00:00	0.52	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.05	0.39	0.06	0.43	0.03	
19/01/2025 22:15:00	0.52	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.05	0.39	0.06	0.45	0.03	
19/01/2025 22:30:00	0.52	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.05	0.39	0.06	0.46	0.03	
19/01/2025 22:45:00	0.52	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.04	0.39	0.06	0.47	0.03	
19/01/2025 23:00:00	0.53	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.04	0.39	0.06	0.48	0.02	
19/01/2025 23:15:00	0.53	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.04	0.39	0.06	0.49	0.02	
19/01/2025 23:30:00	0.54	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.05	0.39	0.06	0.50	0.02	
19/01/2025 23:45:00	0.54	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.05	0.39	0.06	0.50	0.02	
20/01/2025 00:00:00	0.55	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.05	0.39	0.06	0.51	0.03	
20/01/2025 00:15:00	0.55	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.04	0.39	0.06	0.52	0.02	
20/01/2025 00:30:00	0.55	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.04	0.39	0.06	0.52	0.02	
20/01/2025 00:45:00	0.56	0.00	0.12	0.08	0.27	0.17	0.23	0.48	0.04	0.39	0.06	0.53	0.02	
20/01/2025 01:00:00	0.56	0.00	0.12	0.08	0.26	0.17	0.23	0.47	0.04	0.39	0.06	0.53	0.02	
20/01/2025 01:15:00	0.57	0.00	0.12	0.08	0.26	0.17	0.23	0.47	0.04	0.39	0.06	0.54	0.02	
20/01/2025 01:30:00	0.57	0.00	0.12	0.08	0.26	0.17	0.23	0.47	0.04	0.39	0.07	0.54	0.02	
20/01/2025 01:45:00	0.58	0.00	0.12	0.07	0.26	0.17	0.23	0.47	0.04	0.39	0.07	0.55	0.02	
20/01/2025 02:00:00	0.58	0.00	0.12	0.07	0.26	0.17	0.23	0.47	0.04	0.40	0.06	0.55	0.02	
20/01/2025 02:15:00	0.58	0.00	0.12	0.07	0.26	0.17	0.23	0.47	0.02	0.40	0.07	0.55	0.02	
20/01/2025 02:30:00	0.59	0.00	0.11	0.07	0.26	0.17	0.22	0.47	0.03	0.40	0.07	0.56	0.02	
20/01/2025 02:45:00	0.59	0.00	0.11	0.07	0.26	0.17	0.22	0.46	0.04	0.40	0.06	0.56	0.02	
20/01/2025 03:00:00	0.60	0.00	0.11	0.07	0.26	0.16	0.22	0.46	0.05	0.40	0.06	0.56	0.03	
20/01/2025 03:15:00	0.60	0.00	0.11	0.07	0.26	0.16	0.22	0.46	0.04	0.40	0.06	0.57	0.02	
20/01/2025 03:30:00	0.60	0.00	0.11	0.07	0.26	0.17	0.22	0.46	0.04	0.40	0.06	0.57	0.02	
20/01/2025 03:45:00	0.61	0.00	0.11	0.07	0.26	0.16	0.22	0.46	0.04	0.40	0.07	0.57	0.01	
20/01/2025 04:00:00	0.61	0.00	0.11	0.07	0.26	0.16	0.22	0.46	0.04	0.41	0.07	0.58	0.02	
20/01/2025 04:15:00	0.61	0.00	0.11	0.07	0.26	0.16	0.22	0.46	0.04	0.41	0.07	0.58	0.03	
20/01/2025 04:30:00	0.62	0.00	0.11	0.07	0.26	0.16	0.22	0.46	0.03	0.41	0.07	0.58	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
20/01/2025 04:45:00	0.62	0.00	0.11	0.07	0.26	0.16	0.22	0.46	0.04	0.41	0.08	0.59	0.02	
20/01/2025 05:00:00	0.62	0.00	0.11	0.07	0.26	0.16	0.22	0.45	0.04	0.41	0.07	0.59	0.04	
20/01/2025 05:15:00	0.62	0.00	0.11	0.06	0.26	0.16	0.22	0.45	0.03	0.41	0.08	0.57	0.05	
20/01/2025 05:30:00	0.62	0.00	0.11	0.06	0.26	0.16	0.21	0.45	0.02	0.41	0.08	0.54	0.07	
20/01/2025 05:45:00	0.62	0.00	0.10	0.06	0.25	0.16	0.21	0.45	0.01	0.42	0.08	0.52	0.08	
20/01/2025 06:00:00	0.62	0.00	0.10	0.06	0.25	0.16	0.21	0.45	0.15	0.42	0.07	0.50	0.09	
20/01/2025 06:15:00	0.61	0.00	0.10	0.06	0.25	0.16	0.21	0.45	0.09	0.42	0.08	0.48	0.09	
20/01/2025 06:30:00	0.61	0.00	0.10	0.06	0.25	0.16	0.21	0.45	0.04	0.41	0.07	0.46	0.08	
20/01/2025 06:45:00	0.60	0.00	0.10	0.06	0.25	0.16	0.21	0.45	0.04	0.41	0.07	0.44	0.10	
20/01/2025 07:00:00	0.59	0.00	0.10	0.06	0.25	0.16	0.21	0.45	0.04	0.41	0.07	0.43	0.08	
20/01/2025 07:15:00	0.59	0.00	0.10	0.06	0.25	0.16	0.21	0.45	0.04	0.41	0.07	0.42	0.10	
20/01/2025 07:30:00	0.58	0.00	0.10	0.06	0.25	0.16	0.21	0.45	0.04	0.41	0.07	0.41	0.09	
20/01/2025 07:45:00	0.57	0.00	0.10	0.06	0.25	0.16	0.21	0.45	0.04	0.40	0.07	0.40	0.10	
20/01/2025 08:00:00	0.57	0.00	0.10	0.06	0.25	0.16	0.21	0.45	0.04	0.40	0.08	0.39	0.08	
20/01/2025 08:15:00	0.56	0.00	0.10	0.06	0.25	0.16	0.21	0.46	0.05	0.40	0.07	0.38	0.08	
20/01/2025 08:30:00	0.55	0.00	0.10	0.06	0.25	0.16	0.21	0.46	0.04	0.40	0.08	0.37	0.07	
20/01/2025 08:45:00	0.55	0.00	0.10	0.06	0.25	0.16	0.21	0.46	0.04	0.40	0.08	0.37	0.08	
20/01/2025 09:00:00	0.54	0.00	0.10	0.06	0.25	0.16	0.21	0.46	0.04	0.40	0.08	0.36	0.10	
20/01/2025 09:15:00	0.54	0.00	0.10	0.06	0.25	0.16	0.21	0.46	0.04	0.39	0.09	0.35	0.07	
20/01/2025 09:30:00	0.53	0.00	0.10	0.06	0.25	0.16	0.21	0.47	0.05	0.39	0.07	0.35	0.08	
20/01/2025 09:45:00	0.53	0.00	0.10	0.06	0.25	0.16	0.21	0.47	0.05	0.39	0.06	0.34	0.06	
20/01/2025 10:00:00	0.52	0.00	0.10	0.06	0.25	0.16	0.21	0.47	0.05	0.39	0.07	0.33	0.08	
20/01/2025 10:15:00	0.52	0.00	0.10	0.06	0.25	0.16	0.21	0.47	0.04	0.39	0.06	0.33	0.04	
20/01/2025 10:30:00	0.51	0.00	0.10	0.06	0.25	0.16	0.21	0.47	0.04	0.39	0.07	0.32	0.07	
20/01/2025 10:45:00	0.51	0.00	0.10	0.06	0.25	0.16	0.21	0.47	0.05	0.39	0.07	0.32	0.07	
20/01/2025 11:00:00	0.51	0.00	0.10	0.06	0.25	0.16	0.21	0.48	0.04	0.39	0.06	0.32	0.06	
20/01/2025 11:15:00	0.50	0.00	0.10	0.06	0.25	0.16	0.21	0.48	0.02	0.39	0.06	0.33	0.04	
20/01/2025 11:30:00	0.50	0.00	0.10	0.06	0.25	0.16	0.21	0.48	0.01	0.39	0.06	0.34	0.03	
20/01/2025 11:45:00	0.50	0.00	0.10	0.06	0.25	0.16	0.21	0.48	0.00	0.39	0.06	0.38	0.02	
20/01/2025 12:00:00	0.50	0.00	0.10	0.06	0.25	0.16	0.21	0.48	0.28	0.39	0.07	0.40	0.01	
20/01/2025 12:15:00	0.50	0.08	0.10	0.06	0.25	0.16	0.21	0.48	0.05	0.39	0.06	0.42	0.02	
20/01/2025 12:30:00	0.50	0.05	0.10	0.06	0.25	0.16	0.21	0.48	0.05	0.39	0.06	0.43	0.00	
20/01/2025 12:45:00	0.50	0.03	0.10	0.06	0.25	0.16	0.21	0.48	0.05	0.39	0.06	0.44	0.00	
20/01/2025 13:00:00	0.51	0.00	0.10	0.06	0.25	0.16	0.21	0.48	0.04	0.39	0.06	0.45	0.02	
20/01/2025 13:15:00	0.51	0.00	0.10	0.06	0.25	0.16	0.21	0.48	0.03	0.39	0.06	0.46	0.01	
20/01/2025 13:30:00	0.51	0.00	0.10	0.06	0.25	0.16	0.21	0.48	0.02	0.39	0.07	0.47	0.02	
20/01/2025 13:45:00	0.52	0.00	0.10	0.06	0.25	0.17	0.20	0.48	0.01	0.39	0.06	0.48	0.02	
20/01/2025 14:00:00	0.52	0.00	0.10	0.06	0.24	0.17	0.19	0.48	0.00	0.39	0.06	0.48	-0.01	
20/01/2025 14:15:00	0.53	0.00	0.10	0.06	0.23	0.17	0.19	0.48	0.00	0.39	0.06	0.49	0.01	
20/01/2025 14:30:00	0.53	0.00	0.10	0.06	0.23	0.17	0.19	0.48	0.00	0.39	0.06	0.50	0.01	
20/01/2025 14:45:00	0.54	0.00	0.10	0.06	0.23	0.17	0.19	0.48	0.00	0.39	0.06	0.50	0.00	
20/01/2025 15:00:00	0.54	0.00	0.10	0.06	0.23	0.17	0.19	0.48	0.48	0.39	0.05	0.51	0.01	
20/01/2025 15:15:00	0.55	0.00	0.10	0.06	0.23	0.17	0.19	0.48	0.04	0.39	0.06	0.51	0.00	
20/01/2025 15:30:00	0.55	0.00	0.10	0.06	0.23	0.17	0.19	0.48	0.05	0.39	0.06	0.52	0.02	
20/01/2025 15:45:00	0.56	0.00	0.10	0.06	0.23	0.17	0.18	0.48	0.04	0.39	0.06	0.52	0.01	
20/01/2025 16:00:00	0.56	0.00	0.10	0.06	0.23	0.17	0.18	0.48	0.04	0.39	0.07	0.53	0.00	
20/01/2025 16:15:00	0.57	0.00	0.10	0.06	0.23	0.17	0.18	0.48	0.04	0.39	0.07	0.53	0.00	
20/01/2025 16:30:00	0.57	0.00	0.10	0.06	0.23	0.17	0.18	0.48	0.05	0.39	0.07	0.54	0.01	
20/01/2025 16:45:00	0.57	0.00	0.09	0.05	0.23	0.17	0.18	0.48	0.04	0.39	0.06	0.54	0.03	
20/01/2025 17:00:00	0.58	0.00	0.09	0.05	0.23	0.17	0.18	0.48	0.05	0.39	0.06	0.54	0.03	
20/01/2025 17:15:00	0.58	0.00	0.09	0.05	0.23	0.17	0.18	0.48	0.05	0.40	0.06	0.55	0.02	
20/01/2025 17:30:00	0.58	0.00	0.09	0.05	0.23	0.17	0.18	0.48	0.05	0.40	0.06	0.55	0.03	
20/01/2025 17:45:00	0.59	0.00	0.09	0.05	0.23	0.17	0.18	0.48	0.04	0.40	0.07	0.54	0.05	
20/01/2025 18:00:00	0.59	0.00	0.09	0.05	0.22	0.17	0.18	0.48	0.04	0.40	0.07	0.52	0.05	
20/01/2025 18:15:00	0.59	0.00	0.09	0.05	0.22	0.17	0.18	0.48	0.04	0.40	0.06	0.50	0.07	
20/01/2025 18:30:00	0.59	0.00	0.09	0.05	0.22	0.17	0.18	0.48	0.04	0.40	0.07	0.48	0.08	
20/01/2025 18:45:00	0.58	0.00	0.09	0.05	0.22	0.17	0.17	0.48	0.04	0.40	0.07	0.46	0.08	
20/01/2025 19:00:00	0.58	0.00	0.09	0.05	0.22	0.17	0.17	0.48	0.04	0.40	0.07	0.44	0.09	
20/01/2025 19:15:00	0.57	0.00	0.09	0.05	0.22	0.17	0.17	0.48	0.05	0.40	0.07	0.43	0.08	
20/01/2025 19:30:00	0.57	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.04	0.40	0.07	0.41	0.08	
20/01/2025 19:45:00	0.56	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.04	0.40	0.06	0.40	0.10	
20/01/2025 20:00:00	0.56	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.04	0.40	0.07	0.39	0.09	
20/01/2025 20:15:00	0.55	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.04	0.40	0.07	0.38	0.09	
20/01/2025 20:30:00	0.55	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.03	0.40	0.07	0.37	0.09	
20/01/2025 20:45:00	0.54	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.05	0.40	0.07	0.36	0.08	
20/01/2025 21:00:00	0.54	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.03	0.39	0.07	0.35	0.07	
20/01/2025 21:15:00	0.53	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.02	0.39	0.07	0.35	0.08	
20/01/2025 21:30:00	0.53	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.00	0.39	0.06	0.34	0.08	
20/01/2025 21:45:00	0.52	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.00	0.39	0.07	0.35	0.07	
20/01/2025 22:00:00	0.52	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.53	0.39	0.07	0.36	0.04	
20/01/2025 22:15:00	0.51	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.46	0.39	0.06	0.39	0.05	
20/01/2025 22:30:00	0.51	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.38	0.39	0.07	0.41	0.03	
20/01/2025 22:45:00	0.51	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.30	0.39	0.06	0.43	0.02	
20/01/2025 23:00:00	0.51	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.23	0.39	0.07	0.44	0.02	
20/01/2025 23:15:00	0.51	0.00	0.09	0.05	0.22	0.17	0.17	0.49	0.15	0.39	0.06	0.45	0.02	
20/01/2025 23:30:00	0.52	0.00	0.09	0.05	0.22	0.17	0.17	0.48	0.08	0.39	0.07	0.46	0.03	
20/01/2025 23:45:00	0.52	0.00	0.09	0.05	0.22	0.17	0.17	0.48		0.39	0.06	0.47	0.03	
21/01/2025 00:00:00	0.53	0.00	0.09	0.05	0.22	0.17	0.17	0.48		0.39	0.06	0.48	0.02	
21/01/2025 00:15:00	0.53	0.00	0.09	0.05	0.21	0.17	0.17	0.48		0.39	0.07	0.49	0.01	
21/01/2025 00:30:00	0.53	0.00	0.09	0.05	0.22	0.17	0.17	0.48		0.39	0.08	0.49	0.02	
21/01/2025 00:45:00	0.54	0.00	0.09	0.05	0.22	0.17	0.17	0.48		0.39	0.06	0.50	0.01	
21/01/2025 01:00:00	0.54	0.00	0.09	0.05	0.22	0.17	0.17	0.47		0.39	0.07	0.51	0.02	
21/01/2025 01:15:00	0.55	0.00	0.09	0.05	0.22	0.17	0.17	0.46		0.39	0.07	0.51	0.01	
21/01/2025 01:30:00	0.55	0.00	0.09	0.05	0.22	0.17	0.17	0.46		0.39	0.06	0.52	0.02	
21/01/2025 01:45:00	0.56	0.00	0.09	0.05	0.22	0.17	0.17	0.46		0.39	0.07	0.52	0.01	
21/01/2025 02:00:00	0.56	0.00	0.09	0.05	0.22	0.17	0.17	0.46		0.39	0.06	0.52	0.02	
21/01/2025 02:15:00	0.56	0.00	0.09	0.05	0.22	0.17	0.17	0.46		0.39	0.06	0.53	0.02	
21/01/2025 02:30:00	0.57	0.00	0.09	0.05	0.22	0.17	0.17	0.46		0.39	0.07	0.53	0.02	
21/01/2025 02:45:00	0.57	0.00	0.09	0.05	0.22	0.17	0.17	0.46		0.39	0.07	0.54	0.03	
21/01/2025 03:00:00	0.58	0.00	0.09	0.05	0.21	0.17	0.17	0.46		0.40	0.08	0.54	0.03	
21/01/2025 03:15:00	0.58	0.00	0.09	0.05	0.21	0.17	0.16	0.46		0.40	0.07	0.54	0.02	
21/01/2025 03:30:00	0.58	0.00	0.08	0.05	0.21	0.17	0.16	0.46		0.40	0.08	0.55	0.03	
21/01/2025 03:45:00	0.59	0.00	0.08	0.05	0.21	0.17	0.16	0.46		0.40	0.06	0.55	0.03	
21/01/2025 04:00:00	0.59	0.05	0.08	0.04	0.21	0.17	0.16	0.46		0.40	0.07	0.56	0.03	
21/01/2025 04:15:00	0.59	0.04	0.08	0.04	0.21	0.17	0.16	0.45		0.40	0.06	0.56	0.03	
21/01/2025 04:30:00	0.60	0.05	0.08	0.04	0.21	0.17	0.16	0.45		0.40	0.07	0.56	0.03	
21/01/2025 04:45:00	0.60	0.05	0.08	0.04	0.21	0.17	0.16	0.45		0.40	0.07	0.57	0.02	
21/01/2025 05:00:00	0.60	0.05	0.08	0.04	0.21	0.17	0.16	0.45		0.40	0.07	0.57	0.03	
21/01/2025 05:15:00	0.60	0.05	0.08	0.04	0.21	0.17	0.16	0.45		0.41	0.07	0.57	0.02	
21/01/2025 05:30:00	0.61	0.03	0.08	0.04	0.21	0.17	0.16	0.45		0.41	0.07	0.57	0.03	
21/01/2025 05:45:00	0.61	0.02	0.08	0.04	0.21	0.17	0.16	0.45		0.41	0.07	0.58	0.03	
21/01/2025 06:00:00	0.61	0.00	0.08	0.04	0.21	0.17	0.16	0.45		0.41	0.07	0.56	0.07	
21/01/2025 06:15:00	0.61	0.00	0.08	0.04	0.21	0.16	0.15	0.45		0.41	0.07	0.54	0.08	
21/01/2025 06:30:00	0.61	0.00	0.07	0.04	0.20	0.16	0.15	0.45		0.41	0.07	0.51	0.09	
21/01/2025 06:45:00	0.61	0.00	0.07	0.04	0.20	0.16	0.15	0.45		0.41	0.08	0.49	0.09	
21/01/2025 07:00:00	0.60	0.00	0.07	0.04	0.20	0.16	0.15	0.45		0.41	0.07	0.47	0.08	
21/01/2025 07:15:00	0.60	0.00	0.07	0.04	0.20	0.16	0.15	0.45		0.41	0.09	0.45	0.09	
21/01/2025 07:30:00	0.59	0.00	0.07	0.04	0.20	0.16	0.15	0.45		0.41	0.08	0.44	0.10	
21/01/2025 07:45:00	0.59	0.00	0.07	0.04	0.20	0.16	0.15	0.45		0.41	0.08	0.42	0.09	
21/01/2025 08:00:00	0.58	0.00	0.07	0.04	0.20	0.16	0.15	0.45		0.41	0.07	0.41	0.08	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
21/01/2025 08:15:00	0.57	0.00	0.07	0.04	0.20	0.16	0.15	0.45		0.40	0.08	0.40	0.09	
21/01/2025 08:30:00	0.57	0.00	0.07	0.03	0.20	0.16	0.15	0.46		0.40	0.08	0.39	0.09	
21/01/2025 08:45:00	0.56	0.00	0.07	0.03	0.20	0.16	0.15	0.46		0.40	0.09	0.38	0.07	
21/01/2025 09:00:00	0.55	0.00	0.07	0.03				0.47		0.40	0.08	0.37	0.07	
21/01/2025 09:15:00	0.55	0.00	0.06	0.03	0.17	0.15		0.47		0.40	0.07	0.36	0.09	
21/01/2025 09:30:00	0.54	0.00	0.06	0.03	0.16	0.15		0.47		0.40	0.07	0.36	0.07	
21/01/2025 09:45:00	0.54	0.00	0.06	0.03	0.16	0.15		0.47		0.40	0.06	0.35	0.07	
21/01/2025 10:00:00	0.53	0.00	0.06		0.16	0.15		0.47		0.40	0.07	0.34	0.07	
21/01/2025 10:15:00	0.53	0.00	0.06		0.16	0.15		0.47		0.39	0.07	0.34	0.07	
21/01/2025 10:30:00	0.52	0.00	0.06		0.16	0.15		0.48	0.05	0.39	0.08	0.33	0.08	
21/01/2025 10:45:00	0.52	0.00	0.05		0.16	0.15		0.47	0.00	0.39	0.07	0.33	0.08	
21/01/2025 11:00:00	0.51	0.00	0.05		0.16	0.15		0.47	0.00	0.39	0.06	0.32	0.06	
21/01/2025 11:15:00	0.51	0.00	0.05		0.16	0.15		0.47	0.00	0.39	0.07	0.31	0.04	
21/01/2025 11:30:00	0.51	0.00	0.05		0.16	0.15		0.47	0.00	0.39	0.06	0.31	0.05	
21/01/2025 11:45:00	0.50	0.00	0.05		0.16	0.15		0.47	0.00	0.39	0.06	0.31	0.04	
21/01/2025 12:00:00	0.50	0.00	0.05		0.16	0.15		0.47	0.00	0.39	0.05	0.32	0.05	
21/01/2025 12:15:00	0.49	0.00	0.05		0.16	0.15		0.47	0.00	0.39	0.06	0.33	0.03	
21/01/2025 12:30:00	0.49	0.00	0.05		0.16	0.15		0.47	0.00	0.39	0.06	0.37	0.03	
21/01/2025 12:45:00	0.49	0.00	0.05		0.16	0.15		0.47	0.00	0.39	-0.05	0.39	0.04	
21/01/2025 13:00:00	0.49	0.00	0.05		0.16	0.15		0.47	0.00	0.39	0.06	0.41	0.02	
21/01/2025 13:15:00	0.49	0.00	0.04		0.15	0.15		0.47	0.00	0.39	0.06	0.42	-0.01	
21/01/2025 13:30:00	0.50	0.07	0.04		0.15	0.15		0.45	0.00	0.39	0.06	0.43	0.01	
21/01/2025 13:45:00			0.04		0.15	0.15		0.47	0.00	0.39	0.06	0.44	0.00	
21/01/2025 14:00:00			0.04		0.15	0.15		0.47	0.00	0.39	0.06	0.45	0.02	
21/01/2025 14:15:00			0.04		0.15	0.15		0.47	0.00	0.39	0.07	0.46	0.02	
21/01/2025 14:30:00			0.04		0.15	0.15		0.46	0.00	0.39	0.06	0.47	0.02	
21/01/2025 14:45:00			0.04		0.15	0.15		0.46	0.00	0.39	0.06	0.47	0.02	
21/01/2025 15:00:00			0.04		0.15	0.15		0.46	0.00	0.39	0.05	0.48	0.02	
21/01/2025 15:15:00			0.04		0.15	0.15		0.47	0.00	0.39	0.05	0.49	0.03	
21/01/2025 15:30:00			0.04		0.15	0.15		0.47	0.00	0.39	0.05	0.49	0.02	
21/01/2025 15:45:00			0.04		0.15	0.15		0.47	0.00	0.39	0.05	0.50	0.01	
21/01/2025 16:00:00			0.04		0.15	0.14		0.48	0.00	0.39	0.07	0.50	0.00	
21/01/2025 16:15:00			0.03		0.15	0.14		0.48	0.00	0.39	0.05	0.51	0.02	
21/01/2025 16:30:00			0.03		0.15	0.14		0.48	0.00	0.39	0.05	0.51	0.02	
21/01/2025 16:45:00			0.03		0.15	0.14		0.48	0.00	0.40	0.06	0.52	0.01	
21/01/2025 17:00:00			0.03		0.15	0.14		0.48	0.00	0.40	0.06	0.52	0.01	
21/01/2025 17:15:00			0.03		0.15	0.14		0.48	0.00	0.40	0.06	0.52	0.02	
21/01/2025 17:30:00			0.03		0.15	0.14		0.48	0.00	0.40	0.05	0.53	0.02	
21/01/2025 17:45:00			0.03		0.15	0.14		0.48	0.00	0.40	0.06	0.53	0.02	
21/01/2025 18:00:00			0.03		0.14	0.14		0.48	0.00	0.40	0.06	0.54	0.03	
21/01/2025 18:15:00			0.03		0.14	0.14		0.48	0.00	0.40	0.06	0.54	0.04	
21/01/2025 18:30:00			0.03		0.14	0.14		0.48	0.00	0.40	0.05	0.52	0.04	
21/01/2025 18:45:00			0.03		0.14	0.14		0.48	0.00	0.40	0.05	0.50	0.06	
21/01/2025 19:00:00			0.03		0.14	0.14		0.49	0.00	0.40	0.05	0.49	0.07	
21/01/2025 19:15:00			0.03		0.14	0.14		0.49	0.00	0.40	0.05	0.47	0.07	
21/01/2025 19:30:00			0.03		0.14	0.14		0.49	0.00	0.40	0.05	0.45	0.09	
21/01/2025 19:45:00			0.03		0.14	0.14		0.49	0.00	0.40	0.05	0.44	0.07	
21/01/2025 20:00:00			0.03		0.14	0.14		0.49	0.00	0.40	0.06	0.42	0.08	
21/01/2025 20:15:00			0.03		0.15	0.14		0.49	0.00	0.40	0.06	0.41	0.09	
21/01/2025 20:30:00			0.03		0.15	0.14		0.49	0.00	0.40	0.06	0.40	0.10	
21/01/2025 20:45:00			0.03		0.15	0.14		0.49	0.00	0.40	0.07	0.38	0.10	
21/01/2025 21:00:00			0.03		0.15	0.14		0.49	0.00	0.40	0.06	0.37	0.08	
21/01/2025 21:15:00			0.03		0.15	0.14		0.49	0.00	0.40	0.06	0.37	0.06	
21/01/2025 21:30:00			0.03		0.15	0.14		0.49	0.00	0.40	0.06	0.36	0.08	
21/01/2025 21:45:00			0.03		0.15	0.14		0.49	0.00	0.40	0.06	0.35	0.08	
21/01/2025 22:00:00			0.04		0.15	0.14		0.49	0.00	0.40	0.07	0.35	0.08	
21/01/2025 22:15:00			0.04		0.15	0.14		0.49	0.00	0.40	0.07	0.34	0.06	
21/01/2025 22:30:00			0.04		0.15	0.14		0.49	0.00	0.40	0.07	0.35	0.06	
21/01/2025 22:45:00			0.04		0.15	0.14		0.49	0.00	0.40	0.07	0.37	0.04	
21/01/2025 23:00:00			0.04		0.15	0.14		0.49	0.00	0.40	0.07	0.40	0.02	
21/01/2025 23:15:00			0.04		0.15	0.14		0.49	0.00	0.40	0.07	0.42	0.04	
21/01/2025 23:30:00			0.04		0.15	0.15		0.49	0.00	0.40	0.08	0.44	0.03	
21/01/2025 23:45:00			0.04		0.15	0.15		0.49	0.00	0.40	0.07	0.45	0.02	
22/01/2025 00:00:00			0.04		0.15	0.15		0.48	0.00	0.40	0.07	0.46	0.02	
22/01/2025 00:15:00			0.04		0.15	0.14		0.48	0.00	0.40	0.06	0.47	0.02	
22/01/2025 00:30:00			0.04		0.15	0.15		0.48	0.00	0.40	0.07	0.47	0.03	
22/01/2025 00:45:00			0.04		0.15	0.15		0.49	0.00	0.40	0.07	0.48	0.03	
22/01/2025 01:00:00			0.04		0.15	0.15		0.49	0.00	0.40	0.06	0.49	0.02	
22/01/2025 01:15:00			0.04		0.15	0.15		0.49	0.00	0.40	0.06	0.49	0.03	
22/01/2025 01:30:00			0.04		0.15	0.15		0.49	0.00	0.40	0.06	0.50	0.03	
22/01/2025 01:45:00			0.04		0.15	0.15		0.48	0.00	0.40	0.05	0.50	0.02	
22/01/2025 02:00:00			0.04		0.15	0.15		0.48	0.00	0.40	0.05	0.51	0.02	
22/01/2025 02:15:00			0.04		0.15	0.15		0.48	0.00	0.40	0.07	0.51	0.02	
22/01/2025 02:30:00			0.04		0.15	0.15		0.48	0.00	0.40	0.07	0.52	0.02	
22/01/2025 02:45:00			0.04		0.15	0.14		0.47	0.00	0.40	0.06	0.52	0.03	
22/01/2025 03:00:00			0.04		0.15	0.14		0.47	0.00	0.40	0.05	0.53	0.03	
22/01/2025 03:15:00			0.04		0.15	0.14		0.47	0.00	0.40	0.06	0.53	0.03	
22/01/2025 03:30:00			0.04		0.15	0.14		0.47	0.00	0.40	0.06	0.53	0.03	
22/01/2025 03:45:00			0.04		0.15	0.14		0.47	0.00	0.40	0.06	0.54	0.03	
22/01/2025 04:00:00			0.03		0.15	0.14		0.47	0.00	0.40	0.06	0.54	0.02	
22/01/2025 04:15:00			0.03		0.14	0.14		0.47	0.00	0.40	0.06	0.55	0.03	
22/01/2025 04:30:00			0.03		0.14	0.14		0.47	0.00	0.40	0.06	0.55	0.03	
22/01/2025 04:45:00			0.03		0.14	0.14		0.47	0.00	0.41	0.07	0.55	0.03	
22/01/2025 05:00:00			0.03		0.14	0.14		0.46	0.00	0.41	0.07	0.56	0.02	
22/01/2025 05:15:00			0.03		0.14	0.14		0.47	0.00	0.41	0.07	0.56	0.01	
22/01/2025 05:30:00			0.03		0.14	0.14		0.46	0.00	0.41	0.07	0.56	0.03	
22/01/2025 05:45:00			0.03		0.14	0.14		0.46	0.00	0.41	0.06	0.57	0.03	
22/01/2025 06:00:00			0.03		0.14	0.13		0.46	0.00	0.41	0.06	0.57	0.02	
22/01/2025 06:15:00			0.03		0.14	0.14		0.46	0.00	0.41	0.07	0.57	0.01	
22/01/2025 06:30:00			0.03		0.14	0.14		0.46	0.00	0.41	0.07	0.58	0.03	
22/01/2025 06:45:00			0.03		0.14	0.14		0.46	0.00	0.41	0.07	0.57	0.05	
22/01/2025 07:00:00			0.03		0.14	0.14		0.46	0.00	0.42	0.07	0.55	0.06	
22/01/2025 07:15:00			0.03		0.14	0.14		0.46	0.00	0.42	0.07	0.53	0.07	
22/01/2025 07:30:00			0.02		0.14	0.14		0.46	0.00	0.42	0.07	0.51	0.08	
22/01/2025 07:45:00			0.02		0.14	0.14		0.47	0.00	0.42	0.07	0.49	0.07	
22/01/2025 08:00:00			0.02		0.14	0.14		0.47	0.00	0.42	0.07	0.47	0.08	
22/01/2025 08:15:00			0.02		0.14	0.14		0.47	0.00	0.42	0.07	0.45	0.09	
22/01/2025 08:30:00			0.02		0.14	0.14		0.47	0.00	0.41	0.07	0.44	0.09	
22/01/2025 08:45:00			0.02		0.14	0.14		0.48	0.00	0.41	0.07	0.42	0.09	
22/01/2025 09:00:00			0.02		0.14	0.14		0.48	0.00	0.41	0.07	0.41	0.08	
22/01/2025 09:15:00			0.02		0.14	0.14		0.48	0.00	0.41	0.07	0.40	0.09	
22/01/2025 09:30:00			0.02		0.14	0.14		0.48	0.00	0.41	0.07	0.40	0.09	
22/01/2025 09:45:00			0.02		0.14	0.14		0.48	0.00	0.41	0.07	0.39	0.07	
22/01/2025 10:00:00			0.02		0.14	0.14		0.49	0.00	0.41	0.07	0.38	0.08	
22/01/2025 10:15:00			0.02		0.14	0.14		0.49	0.00	0.40	0.07	0.37	0.08	
22/01/2025 10:30:00			0.02		0.14	0.14		0.49	0.00	0.40	0.07	0.36	0.08	
22/01/2025 10:45:00			0.02		0.14	0.14		0.49	0.00	0.40	0.07	0.36	0.09	
22/01/2025 11:00:00			0.02		0.14	0.14		0.49	0.00	0.40	0.06	0.35	0.08	
22/01/2025 11:15:00			0.02		0.14	0.14		0.49	0.00	0.40	0.06	0.34	0.06	
22/01/2025 11:30:00			0.02		0.14	0.14		0.49	0.00	0.40	0.07	0.34	0.07	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
22/01/2025 11:45:00			0.02		0.14	0.14		0.49	0.00	0.40	0.07	0.34	0.07	
22/01/2025 12:00:00			0.03		0.14	0.14		0.49	0.00	0.40	0.07	0.33	0.07	
22/01/2025 12:15:00			0.03		0.14	0.14		0.49	0.00	0.40	0.07	0.33	0.06	
22/01/2025 12:30:00			0.03		0.14	0.14		0.49	0.00	0.40	0.07	0.34	0.04	
22/01/2025 12:45:00			0.03		0.14	0.14		0.49	0.00	0.40	0.07	0.35	0.04	
22/01/2025 13:00:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.38	0.03	
22/01/2025 13:15:00			0.03		0.14	0.14		0.49	0.00	0.40	0.07	0.41	0.03	
22/01/2025 13:30:00			0.03		0.14	0.14		0.49	0.00	0.40	0.07	0.42	0.02	
22/01/2025 13:45:00			0.03		0.14	0.14		0.49	0.00	0.40	0.09	0.44	0.03	
22/01/2025 14:00:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.45	0.02	
22/01/2025 14:15:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.46	0.02	
22/01/2025 14:30:00			0.03		0.14	0.14		0.48	0.00	0.40	0.07	0.47	0.01	
22/01/2025 14:45:00			0.03		0.14	0.14		0.48	0.00	0.40	0.07	0.47	0.03	
22/01/2025 15:00:00			0.03		0.14	0.14		0.48	0.00	0.40	0.07	0.48	0.02	
22/01/2025 15:15:00			0.03		0.14	0.14		0.48	0.00	0.40	0.07	0.49	0.00	
22/01/2025 15:30:00			0.03		0.14	0.14		0.48	0.00	0.40	0.07	0.49	0.00	
22/01/2025 15:45:00			0.03		0.14	0.14		0.48	0.00	0.40	0.07	0.50	0.00	
22/01/2025 16:00:00			0.03		0.14	0.14		0.48	0.00	0.40	0.07	0.50	0.01	
22/01/2025 16:15:00			0.03		0.14	0.14		0.48	0.00	0.40	0.07	0.51	0.02	
22/01/2025 16:30:00			0.03		0.14	0.14		0.49	0.00	0.40	0.09	0.52	0.01	
22/01/2025 16:45:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.52	0.00	
22/01/2025 17:00:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.52	0.00	
22/01/2025 17:15:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.53	0.00	
22/01/2025 17:30:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.53	0.02	
22/01/2025 17:45:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.54	0.03	
22/01/2025 18:00:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.54	0.03	
22/01/2025 18:15:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.54	0.02	
22/01/2025 18:30:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.55	0.03	
22/01/2025 18:45:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.55	0.03	
22/01/2025 19:00:00			0.03		0.14	0.14		0.49	0.00	0.40	0.08	0.55	0.03	
22/01/2025 19:15:00			0.03		0.14	0.14		0.50	0.00	0.41	0.08	0.56	0.02	
22/01/2025 19:30:00			0.03		0.14	0.14		0.50	0.00	0.41	0.08	0.56	0.02	
22/01/2025 19:45:00			0.03		0.14	0.14		0.50	0.00	0.41	0.07	0.55	0.03	
22/01/2025 20:00:00			0.03		0.14	0.14		0.50	0.00	0.41	0.08	0.53	0.04	
22/01/2025 20:15:00			0.03		0.14	0.14		0.50	0.00	0.41	0.09	0.52	0.04	
22/01/2025 20:30:00			0.03		0.14	0.14		0.50	0.00	0.41	0.09	0.50	0.04	
22/01/2025 20:45:00			0.03		0.14	0.14		0.50	0.00	0.41	0.09	0.48	0.06	
22/01/2025 21:00:00			0.03		0.14	0.14		0.51	0.00	0.41	0.08	0.47	0.06	
22/01/2025 21:15:00			0.03		0.14	0.14		0.51	0.00	0.41	0.08	0.45	0.07	
22/01/2025 21:30:00			0.03		0.14	0.14		0.51	0.00	0.41	0.08	0.44	0.09	
22/01/2025 21:45:00			0.03		0.14	0.14		0.50	0.00	0.41	0.09	0.43	0.09	
22/01/2025 22:00:00			0.03		0.14	0.14		0.50	0.00	0.41	0.08	0.42	0.09	
22/01/2025 22:15:00			0.04		0.14	0.14		0.50	0.00	0.41	0.11	0.41	0.10	
22/01/2025 22:30:00			0.04		0.15	0.14		0.50	0.00	0.40	0.08	0.40	0.10	
22/01/2025 22:45:00			0.04		0.15	0.14		0.50	0.00	0.40	0.09	0.40	0.08	
22/01/2025 23:00:00			0.04		0.15	0.14		0.50	0.00	0.40	0.09	0.40	0.07	
22/01/2025 23:15:00			0.04		0.15	0.14		0.49	0.00	0.40	0.09	0.40	0.07	
22/01/2025 23:30:00			0.04		0.15	0.14		0.49	0.00	0.40	0.08	0.42	0.05	
22/01/2025 23:45:00			0.04		0.15	0.14		0.49	0.00	0.40	0.09	0.43	0.05	
23/01/2025 00:00:00			0.04		0.15	0.14		0.49	0.00	0.40	0.09	0.46	0.04	
23/01/2025 00:15:00			0.04		0.15	0.14		0.49	0.00	0.40	0.09	0.47	0.03	
23/01/2025 00:30:00			0.04		0.15	0.14		0.49	0.00	0.40	0.08	0.48	0.03	
23/01/2025 00:45:00			0.04		0.15	0.14		0.49	0.00	0.40	0.08	0.49	0.03	
23/01/2025 01:00:00			0.04		0.15	0.14		0.49	0.00	0.40	0.08	0.50	0.03	
23/01/2025 01:15:00			0.04		0.15	0.14		0.49	0.00	0.40	0.09	0.51	0.03	
23/01/2025 01:30:00			0.04		0.15	0.14		0.48	0.00	0.40	0.09	0.51	0.02	
23/01/2025 01:45:00			0.04		0.15	0.14		0.48	0.00	0.40	0.08	0.52	0.01	
23/01/2025 02:00:00			0.04		0.15	0.14		0.48	0.00	0.40	0.08	0.52	0.02	
23/01/2025 02:15:00			0.04		0.15	0.14		0.48	0.00	0.40	0.08	0.53	0.02	
23/01/2025 02:30:00			0.04		0.15	0.14		0.48	0.00	0.40	0.08	0.53	0.02	
23/01/2025 02:45:00			0.04		0.15	0.14		0.47	0.00	0.40	0.08	0.54	0.01	
23/01/2025 03:00:00			0.04		0.15	0.14		0.47	0.00	0.40	0.08	0.54	0.02	
23/01/2025 03:15:00			0.04		0.14	0.14		0.47	0.00	0.40	0.08	0.55	0.02	
23/01/2025 03:30:00			0.04		0.14	0.14		0.47	0.00	0.40	0.07	0.55	0.01	
23/01/2025 03:45:00			0.04		0.14	0.14		0.47	0.00	0.40	0.07	0.55	0.02	
23/01/2025 04:00:00			0.03		0.14	0.14		0.47	0.00	0.40	0.07	0.56	0.03	
23/01/2025 04:15:00			0.03		0.14	0.14		0.47	0.00	0.41	0.08	0.56	0.02	
23/01/2025 04:30:00			0.03		0.14	0.14		0.47	0.00	0.41	0.07	0.56	0.03	
23/01/2025 04:45:00			0.03		0.14	0.14		0.47	0.00	0.41	0.08	0.57	0.02	
23/01/2025 05:00:00			0.03		0.14	0.14		0.47	0.00	0.41	0.08	0.57	0.02	
23/01/2025 05:15:00			0.03		0.14	0.14		0.46	0.00	0.41	0.08	0.57	0.01	
23/01/2025 05:30:00			0.03		0.14	0.14		0.46	0.00	0.41	0.08	0.58	0.02	
23/01/2025 05:45:00			0.03		0.14	0.14		0.46	0.00	0.41	0.07	0.58	0.00	
23/01/2025 06:00:00			0.03		0.14	0.14		0.46	0.00	0.41	0.08	0.58	0.00	
23/01/2025 06:15:00			0.03		0.14	0.13		0.46	0.00	0.41	0.08	0.59	0.02	
23/01/2025 06:30:00			0.03		0.14	0.13		0.46	0.00	0.42	0.06	0.59	0.02	
23/01/2025 06:45:00			0.03		0.14	0.13		0.46	0.00	0.42	0.08	0.59	0.02	
23/01/2025 07:00:00			0.03		0.14	0.13		0.46	0.00	0.42	0.09	0.60	0.02	
23/01/2025 07:15:00			0.02		0.14	0.13		0.46	0.00	0.42	0.09	0.60	0.02	
23/01/2025 07:30:00			0.02		0.14	0.13		0.46	0.00	0.42	0.07	0.60	0.03	
23/01/2025 07:45:00			0.02		0.13	0.13		0.46	0.00	0.42	0.07	0.59	0.02	
23/01/2025 08:00:00			0.02		0.13	0.13		0.46	0.00	0.42	0.08	0.58	0.03	
23/01/2025 08:15:00			0.02		0.13	0.13		0.46	0.00	0.42	0.07	0.56	0.06	
23/01/2025 08:30:00			0.02		0.13	0.13		0.47	0.00	0.42	0.07	0.53	0.06	
23/01/2025 08:45:00			0.02		0.13	0.13		0.47	0.00	0.42	0.08	0.51	0.08	
23/01/2025 09:00:00			0.02		0.13	0.13		0.47	0.00	0.42	0.08	0.50	0.07	
23/01/2025 09:15:00			0.02		0.13	0.13		0.47	0.00	0.42	0.08	0.48	0.08	
23/01/2025 09:30:00			0.02		0.13	0.13		0.48	0.00	0.42	0.08	0.46	0.08	
23/01/2025 09:45:00			0.02		0.13	0.13		0.48	0.00	0.42	0.08	0.45	0.08	
23/01/2025 10:00:00			0.02		0.13	0.13		0.48	0.00	0.42	0.08	0.43	0.10	
23/01/2025 10:15:00			0.02		0.13	0.13		0.48	0.00	0.41	0.07	0.42	0.10	
23/01/2025 10:30:00			0.02		0.13	0.13		0.48	0.00	0.41	0.08	0.41	0.10	
23/01/2025 10:45:00			0.02		0.13	0.13		0.48	0.00	0.41	0.08	0.40	0.10	
23/01/2025 11:00:00			0.02		0.13	0.13		0.49	0.00	0.41	0.08	0.39	0.08	
23/01/2025 11:15:00			0.02		0.13	0.13		0.49	0.00	0.41	0.07	0.38	0.08	
23/01/2025 11:30:00			0.02		0.14	0.13		0.49	0.00	0.41	0.07	0.38	0.08	
23/01/2025 11:45:00			0.02		0.14	0.13		0.49	0.00	0.41	0.08	0.37	0.08	
23/01/2025 12:00:00			0.02		0.14	0.13		0.49	0.00	0.40	0.08	0.36	0.08	
23/01/2025 12:15:00			0.02		0.14	0.13		0.49	0.00	0.40	0.08	0.36	0.07	
23/01/2025 12:30:00			0.02		0.14	0.14		0.49	0.00	0.40	0.08	0.35	0.07	
23/01/2025 12:45:00			0.02		0.14	0.14		0.49	0.00	0.40	0.08	0.35	0.09	
23/01/2025 13:00:00			0.02		0.14	0.14		0.50	0.00	0.40	0.07	0.34	0.08	
23/01/2025 13:15:00			0.02		0.14	0.14		0.50	0.00	0.40	0.07	0.34	0.08	
23/01/2025 13:30:00			0.03		0.14	0.14		0.51	0.00	0.40	0.08	0.35	0.04	
23/01/2025 13:45:00			0.03		0.14	0.14		0.51	0.00	0.40	0.08	0.36	0.05	
23/01/2025 14:00:00			0.03		0.14	0.14		0.51	0.00	0.40	0.08	0.39	0.05	
23/01/2025 14:15:00			0.03		0.14	0.14		0.51	0.00	0.40	0.07	0.41	0.03	
23/01/2025 14:30:00			0.03		0.14	0.14		0.49	0.00	0.40	0.07	0.43	0.03	
23/01/2025 14:45:00			0.03		0.14	0.14		0.51	0.00	0.40	0.07	0.45	0.03	
23/01/2025 15:00:00			0.03		0.14	0.14		0.52	0.00	0.40	0.06	0.46	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
23/01/2025 15:15:00			0.03		0.15	0.14		0.52	0.00	0.40	0.06	0.47	0.03	
23/01/2025 15:30:00			0.04		0.15	0.14		0.53	0.00	0.40	0.05	0.48	0.03	
23/01/2025 15:45:00			0.04		0.15	0.14		0.53	0.00	0.40	0.07	0.49	0.02	
23/01/2025 16:00:00			0.04		0.15	0.15		0.53	0.00	0.40	0.07	0.49	0.02	
23/01/2025 16:15:00			0.04		0.15	0.15		0.53	0.00	0.40	0.07	0.50	0.02	
23/01/2025 16:30:00			0.05		0.15	0.15		0.54	0.00	0.41	0.09	0.51	0.02	
23/01/2025 16:45:00			0.05		0.16	0.15		0.54	0.00	0.41	0.09	0.52	0.02	
23/01/2025 17:00:00			0.05		0.16	0.15		0.55	0.00	0.41	0.09	0.52	0.02	
23/01/2025 17:15:00			0.05		0.16	0.15		0.55	0.00	0.41	0.09	0.53	0.02	
23/01/2025 17:30:00			0.06		0.16	0.15		0.55	0.00	0.41	0.08	0.53	0.02	
23/01/2025 17:45:00			0.06		0.16	0.15		0.55	0.00	0.41	0.08	0.54	0.02	
23/01/2025 18:00:00			0.06		0.17	0.16		0.55	0.00	0.41	0.09	0.54	0.02	
23/01/2025 18:15:00			0.07		0.17	0.16		0.54	0.00	0.41	0.09	0.55	0.02	
23/01/2025 18:30:00			0.07		0.17	0.16		0.54	0.00	0.41	0.08	0.55	0.02	
23/01/2025 18:45:00			0.07		0.17	0.16		0.54	0.00	0.41	0.08	0.55	0.02	
23/01/2025 19:00:00			0.07		0.17	0.16		0.53	0.00	0.42	0.08	0.56	0.02	
23/01/2025 19:15:00			0.07		0.17	0.16		0.53	0.00	0.42	0.09	0.56	0.03	
23/01/2025 19:30:00			0.08		0.18	0.16		0.53	0.00	0.42	0.09	0.57	0.03	
23/01/2025 19:45:00			0.08		0.18	0.16		0.53	0.00	0.42	0.10	0.57	0.03	
23/01/2025 20:00:00			0.08		0.18	0.16		0.52	0.00	0.42	0.09	0.55	0.03	
23/01/2025 20:15:00			0.08		0.18	0.16		0.52	0.00	0.42	0.09	0.53	0.06	
23/01/2025 20:30:00			0.08		0.18	0.16		0.52	0.00	0.42	0.10	0.51	0.06	
23/01/2025 20:45:00			0.08		0.18	0.16		0.52	0.00	0.42	0.10	0.50	0.07	
23/01/2025 21:00:00			0.08		0.18	0.16		0.52	0.00	0.42	0.10	0.49	0.06	
23/01/2025 21:15:00			0.08		0.18	0.16		0.52	0.00	0.42	0.09	0.47	0.07	
23/01/2025 21:30:00			0.08		0.18	0.16		0.52	0.00	0.42	0.09	0.46	0.08	
23/01/2025 21:45:00			0.08		0.18	0.16		0.52	0.00	0.42	0.09	0.45	0.08	
23/01/2025 22:00:00			0.08		0.18	0.16		0.51	0.00	0.42	0.09	0.44	0.06	
23/01/2025 22:15:00			0.08		0.18	0.16		0.51	0.00	0.42	0.09	0.43	0.07	
23/01/2025 22:30:00			0.08		0.17	0.16		0.51	0.00	0.42	0.09	0.42	0.08	
23/01/2025 22:45:00			0.08		0.17	0.16		0.51	0.00	0.42	0.09	0.41	0.08	
23/01/2025 23:00:00			0.08		0.17	0.16		0.51	0.00	0.42	0.09	0.40	0.10	
23/01/2025 23:15:00			0.07		0.17	0.16		0.51	0.00	0.42	0.09	0.39	0.10	
23/01/2025 23:30:00			0.07		0.17	0.16		0.51	0.00	0.41	0.08	0.38	0.07	
23/01/2025 23:45:00			0.07		0.17	0.16		0.51	0.00	0.41	0.08	0.38	0.07	
24/01/2025 00:00:00			0.07		0.17	0.16		0.50	0.00	0.41	0.08	0.38	0.07	
24/01/2025 00:15:00			0.07		0.17	0.16		0.50	0.00	0.41	0.09	0.37	0.07	
24/01/2025 00:30:00			0.07		0.17	0.16		0.50	0.00	0.41	0.09	0.37	0.07	
24/01/2025 00:45:00			0.07		0.17	0.16		0.48	0.00	0.41	0.09	0.37	0.06	
24/01/2025 01:00:00			0.07		0.17	0.16		0.46	0.00	0.41	0.09	0.38	0.05	
24/01/2025 01:15:00			0.07		0.17	0.16		0.47	0.00	0.41	0.09	0.38	0.04	
24/01/2025 01:30:00			0.07		0.17	0.16		0.48	0.00	0.41	0.08	0.40	0.04	
24/01/2025 01:45:00			0.07		0.17	0.16		0.46	0.00	0.41	0.09	0.42	0.04	
24/01/2025 02:00:00			0.07		0.17	0.16		0.48	0.00	0.41	0.09	0.44	0.03	
24/01/2025 02:15:00			0.06		0.17	0.16		0.49	0.00	0.41	0.09	0.45	0.03	
24/01/2025 02:30:00			0.06		0.17	0.16		0.48	0.00	0.41	0.08	0.47	0.02	
24/01/2025 02:45:00			0.06		0.17	0.16		0.48	0.00	0.41	0.08	0.48	0.02	
24/01/2025 03:00:00			0.06		0.16	0.16		0.49	0.00	0.41	0.08	0.48	0.02	
24/01/2025 03:15:00			0.06		0.16	0.16		0.49	0.00	0.41	0.03	0.49	0.02	
24/01/2025 03:30:00			0.06		0.16	0.16		0.49	0.00	0.41	0.04	0.50	0.03	
24/01/2025 03:45:00			0.05		0.16	0.16		0.49	0.00	0.41	0.04	0.51	0.03	
24/01/2025 04:00:00			0.05		0.16	0.16		0.48	0.00	0.41	0.03	0.51	0.02	
24/01/2025 04:15:00			0.05		0.16	0.15		0.49	0.00	0.41	0.03	0.52	0.02	
24/01/2025 04:30:00			0.05		0.16	0.15		0.46	0.00	0.41	0.06	0.52	0.02	
24/01/2025 04:45:00			0.05		0.16	0.15		0.48	0.00	0.41	0.06	0.53	0.02	
24/01/2025 05:00:00			0.05		0.16	0.15		0.48	0.00	0.41	0.07	0.53	0.02	
24/01/2025 05:15:00			0.05		0.16	0.15		0.48	0.00	0.41	0.08	0.54	0.02	
24/01/2025 05:30:00			0.05		0.16	0.15		0.48	0.00	0.42	0.08	0.54	0.02	
24/01/2025 05:45:00			0.05		0.16	0.15		0.48	0.00	0.42	0.07	0.55	0.02	
24/01/2025 06:00:00			0.05		0.15	0.15		0.48	0.00	0.42	0.09	0.55	0.02	
24/01/2025 06:15:00			0.05		0.15	0.15		0.48	0.00	0.42	0.09	0.56	0.03	
24/01/2025 06:30:00			0.05		0.15	0.15		0.48	0.00	0.42	0.05	0.56	0.03	
24/01/2025 06:45:00			0.04		0.15	0.15		0.48	0.00	0.42	0.09	0.57	0.03	
24/01/2025 07:00:00			0.04		0.15	0.15		0.49	0.00	0.42	0.07	0.57	0.03	
24/01/2025 07:15:00			0.04		0.15	0.15		0.49	0.00	0.42	0.06	0.57	0.03	
24/01/2025 07:30:00			0.04		0.15	0.15		0.50	0.00	0.43	0.06	0.58	0.03	
24/01/2025 07:45:00			0.04		0.15	0.15		0.50	0.00	0.43	0.07	0.57	0.03	
24/01/2025 08:00:00			0.04		0.15	0.15		0.50	0.00	0.43	0.05	0.55	0.05	
24/01/2025 08:15:00			0.04		0.15	0.15		0.51	0.00	0.43	0.06	0.53	0.06	
24/01/2025 08:30:00			0.04		0.15	0.14		0.51	0.00	0.43	0.05	0.51	0.06	
24/01/2025 08:45:00			0.04		0.15	0.14		0.51	0.00	0.43	0.05	0.50	0.07	
24/01/2025 09:00:00			0.04		0.15	0.15		0.51	0.00	0.43	0.06	0.48	0.07	
24/01/2025 09:15:00			0.04		0.15	0.15		0.51	0.00	0.43	0.06	0.47	0.07	
24/01/2025 09:30:00			0.04		0.15	0.15		0.51	0.00	0.43	0.06	0.45	0.07	
24/01/2025 09:45:00			0.04		0.15	0.14		0.51	0.00	0.43	0.06	0.44	0.07	
24/01/2025 10:00:00			0.05		0.15	0.15		0.51	0.00	0.43	0.06	0.43	0.09	
24/01/2025 10:15:00			0.05		0.15	0.15		0.51	0.00	0.43	0.07	0.42	0.08	
24/01/2025 10:30:00			0.05		0.15	0.15		0.52	0.00	0.43	0.07	0.41	0.09	
24/01/2025 10:45:00			0.05		0.15	0.15		0.53	0.00	0.43	0.08	0.40	0.09	
24/01/2025 11:00:00			0.05		0.15	0.15		0.53	0.00	0.43	0.10	0.39	0.08	
24/01/2025 11:15:00			0.05		0.15	0.15		0.54	0.00	0.43	0.09	0.38	0.10	
24/01/2025 11:30:00			0.05		0.16	0.15		0.54	0.00	0.43	0.10	0.37	0.09	
24/01/2025 11:45:00			0.05		0.16	0.15		0.53	0.00	0.43	0.10	0.37	0.08	
24/01/2025 12:00:00			0.05		0.16	0.15		0.53	0.00	0.43	0.09	0.36	0.07	
24/01/2025 12:15:00			0.06		0.16	0.15		0.53	0.00	0.42	0.09	0.36	0.07	
24/01/2025 12:30:00			0.06		0.16	0.15		0.53	0.00	0.42	0.09	0.35	0.09	
24/01/2025 12:45:00			0.06		0.16	0.15		0.53	0.00	0.42	0.09	0.35	0.09	
24/01/2025 13:00:00			0.06		0.16	0.15		0.53	0.00	0.42	0.09	0.34	0.08	
24/01/2025 13:15:00			0.06		0.16	0.15		0.52	0.00	0.42	0.09	0.34	0.08	
24/01/2025 13:30:00			0.07		0.16	0.15		0.52	0.00	0.42	0.09	0.33	0.08	
24/01/2025 13:45:00			0.07		0.16	0.15		0.52	0.00	0.42	0.09	0.33	0.07	
24/01/2025 14:00:00			0.07		0.17	0.15		0.52	0.00	0.42	0.09	0.32	0.07	
24/01/2025 14:15:00			0.07		0.17	0.15		0.52	0.00	0.42	0.10	0.32	0.08	
24/01/2025 14:30:00			0.07		0.17	0.16		0.51	0.00	0.42	0.10	0.32	0.07	
24/01/2025 14:45:00			0.07		0.17	0.16		0.51	0.00	0.42	0.10	0.31	0.06	
24/01/2025 15:00:00			0.07		0.17	0.16		0.51	0.00	0.42	0.10	0.31	0.08	
24/01/2025 15:15:00			0.07		0.17	0.16		0.51	0.00	0.42	0.10	0.31	0.08	
24/01/2025 15:30:00			0.07		0.17	0.16		0.51	0.00	0.42	0.11	0.32	0.09	
24/01/2025 15:45:00			0.07		0.17	0.15		0.51	0.00	0.42	0.11	0.33	0.08	
24/01/2025 16:00:00			0.07		0.16	0.15		0.51	0.00	0.42	0.09	0.35	0.05	
24/01/2025 16:15:00			0.07		0.16	0.15		0.51	0.00	0.42	0.09	0.36	0.05	
24/01/2025 16:30:00			0.07		0.16	0.15		0.51	0.00	0.42	0.10	0.38	0.04	
24/01/2025 16:45:00			0.06		0.16	0.15		0.51	0.00	0.42	0.10	0.40	0.04	
24/01/2025 17:00:00			0.07		0.16	0.15		0.50	0.00	0.42	0.11	0.41	0.03	
24/01/2025 17:15:00			0.06		0.16	0.15		0.50	0.00	0.42	0.11	0.42	0.03	
24/01/2025 17:30:00			0.06		0.16	0.15		0.50	0.00	0.42	0.09	0.44	0.04	
24/01/2025 17:45:00			0.06		0.16	0.15		0.50	0.00	0.42	0.10	0.45	0.04	
24/01/2025 18:00:00			0.06		0.16	0.15		0.50	0.00	0.42	0.09	0.45	0.03	
24/01/2025 18:15:00			0.06		0.16	0.15		0.50	0.00	0.42	0.09	0.46	0.03	
24/01/2025 18:30:00			0.06		0.16	0.15		0.50	0.00	0.42	0.11	0.47	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
24/01/2025 18:45:00			0.06		0.16	0.15		0.50	0.00	0.42	0.10	0.48	0.03	
24/01/2025 19:00:00			0.06		0.16	0.15		0.50	0.00	0.42	0.10	0.47	0.03	
24/01/2025 19:15:00			0.06		0.16	0.15		0.50	0.00	0.42	0.09	0.46	0.04	
24/01/2025 19:30:00			0.06		0.16	0.15		0.50	0.00	0.42	0.09	0.45	0.05	
24/01/2025 19:45:00			0.06		0.16	0.15		0.50	0.00	0.42	0.09	0.43	0.06	
24/01/2025 20:00:00			0.05		0.16	0.15		0.50	0.00	0.42	0.09	0.41	0.06	
24/01/2025 20:15:00			0.06		0.16	0.15		0.50	0.00	0.42	0.09	0.40	0.07	
24/01/2025 20:30:00			0.05		0.16	0.15		0.50	0.00	0.42	0.09	0.39	0.07	
24/01/2025 20:45:00			0.05		0.16	0.15		0.50	0.00	0.42	0.09	0.37	0.07	
24/01/2025 21:00:00			0.05		0.16	0.15		0.50	0.00	0.42	0.10	0.36	0.06	
24/01/2025 21:15:00			0.05		0.16	0.15		0.50	0.00	0.42	0.10	0.35	0.09	
24/01/2025 21:30:00			0.05		0.15	0.15		0.50	0.00	0.42	0.10	0.34	0.07	
24/01/2025 21:45:00			0.05		0.16	0.15		0.50	0.00	0.42	0.10	0.33	0.09	
24/01/2025 22:00:00			0.05		0.15	0.15		0.50	0.00	0.42	0.10	0.32	0.09	
24/01/2025 22:15:00			0.05		0.15	0.15		0.50	0.00	0.42	0.09	0.32	0.08	
24/01/2025 22:30:00			0.05		0.15	0.15		0.50	0.00	0.42	0.09	0.31	0.09	
24/01/2025 22:45:00			0.05		0.15	0.15		0.50	0.00	0.41	0.09	0.31	0.08	
24/01/2025 23:00:00			0.05		0.15	0.15		0.50	0.00	0.41	0.09	0.30	0.07	
24/01/2025 23:15:00			0.05		0.15	0.15		0.50	0.00	0.41	0.08	0.30	0.07	
24/01/2025 23:30:00			0.05		0.15	0.15		0.50	0.00	0.41	0.09	0.29	0.08	
24/01/2025 23:45:00			0.05		0.15	0.15		0.50	0.00	0.41	0.09	0.29	0.06	
25/01/2025 00:00:00			0.05		0.15	0.15		0.50	0.00	0.41	0.09	0.29	0.07	
25/01/2025 00:15:00			0.05		0.15	0.15		0.49	0.00	0.41	0.08	0.28	0.06	
25/01/2025 00:30:00			0.05		0.15	0.15		0.49	0.00	0.41	0.09	0.28	0.06	
25/01/2025 00:45:00			0.05		0.15	0.15		0.49	0.00	0.41	0.09	0.28	0.06	
25/01/2025 01:00:00			0.05		0.15	0.14		0.49	0.00	0.41	0.08	0.28	0.07	
25/01/2025 01:15:00			0.05		0.15	0.14		0.49	0.00	0.41	0.09	0.27	0.05	
25/01/2025 01:30:00			0.05		0.15	0.14		0.49	0.00	0.41	0.09	0.27	0.07	
25/01/2025 01:45:00			0.05		0.15	0.14		0.49	0.00	0.41	0.08	0.27	0.08	
25/01/2025 02:00:00			0.05		0.15	0.14		0.49	0.00	0.41	0.08	0.27	0.08	
25/01/2025 02:15:00			0.05		0.15	0.14		0.49	0.00	0.41	0.09	0.26	0.08	
25/01/2025 02:30:00			0.04		0.15	0.14		0.49	0.00	0.41	0.08	0.26	0.05	
25/01/2025 02:45:00			0.04		0.15	0.14		0.48	0.00	0.41	0.08	0.26	0.07	
25/01/2025 03:00:00			0.04		0.15	0.14		0.48	0.00	0.41	0.08	0.26	0.07	
25/01/2025 03:15:00			0.04		0.15	0.14		0.48	0.00	0.41	0.08	0.26	0.06	
25/01/2025 03:30:00			0.04		0.15	0.14		0.48	0.00	0.41	0.09	0.28	0.07	
25/01/2025 03:45:00			0.04		0.15	0.14		0.48	0.00	0.41	0.09	0.30	0.06	
25/01/2025 04:00:00			0.04		0.15	0.14		0.48	0.00	0.41	0.09	0.32	0.04	
25/01/2025 04:15:00			0.04		0.15	0.14		0.48	0.00	0.41	0.09	0.33	0.05	
25/01/2025 04:30:00			0.04		0.14	0.14		0.48	0.00	0.41	0.09	0.35	0.04	
25/01/2025 04:45:00			0.04		0.14	0.14		0.47	0.00	0.41	0.09	0.36	0.04	
25/01/2025 05:00:00			0.04		0.14	0.14		0.47	0.00	0.41	0.09	0.38	0.04	
25/01/2025 05:15:00			0.04		0.14	0.14		0.47	0.00	0.41	0.08	0.39	0.04	
25/01/2025 05:30:00			0.04		0.14	0.14		0.47	0.00	0.41	0.09	0.40	0.03	
25/01/2025 05:45:00			0.04		0.14	0.14		0.48	0.00	0.41	0.09	0.41	0.03	
25/01/2025 06:00:00			0.04		0.14	0.14		0.49	0.00	0.41	0.09	0.42	0.03	
25/01/2025 06:15:00			0.04		0.14	0.14		0.50	0.00	0.41	0.09	0.42	0.03	
25/01/2025 06:30:00			0.04		0.14	0.14		0.51	0.00	0.41	0.10	0.43	0.03	
25/01/2025 06:45:00			0.04		0.14	0.14		0.52	0.00	0.41	0.09	0.44	0.03	
25/01/2025 07:00:00			0.04		0.14	0.14		0.52	0.00	0.41	0.08	0.45	0.03	
25/01/2025 07:15:00			0.04		0.14	0.14		0.52	0.00	0.41	0.09	0.45	0.03	
25/01/2025 07:30:00			0.04		0.14	0.14		0.52	0.00	0.41	0.09	0.46	0.03	
25/01/2025 07:45:00			0.04		0.14	0.14		0.52	0.00	0.41	0.09	0.46	0.03	
25/01/2025 08:00:00			0.04		0.15	0.14		0.52	0.00	0.41	0.08	0.47	0.02	
25/01/2025 08:15:00			0.04		0.15	0.14		0.51	0.00	0.41	0.09	0.47	0.03	
25/01/2025 08:30:00			0.05		0.15	0.14		0.51	0.00	0.41	0.09	0.48	0.03	
25/01/2025 08:45:00			0.05		0.15	0.14		0.51	0.00	0.41	0.09	0.49	0.02	
25/01/2025 09:00:00			0.05		0.15	0.14		0.51	0.00	0.41	0.09	0.49	0.03	
25/01/2025 09:15:00			0.05		0.15	0.14		0.50	0.00	0.41	0.09	0.49	0.02	
25/01/2025 09:30:00			0.05		0.15	0.14		0.50	0.00	0.41	0.09	0.50	0.02	
25/01/2025 09:45:00			0.05		0.15	0.14		0.50	0.00	0.41	0.09	0.50	0.02	
25/01/2025 10:00:00			0.06		0.15	0.14		0.50	0.00	0.41	0.09	0.51	0.02	
25/01/2025 10:15:00			0.05		0.15	0.14		0.50	0.00	0.41	0.09	0.51	0.02	
25/01/2025 10:30:00			0.06		0.15	0.14		0.50	0.00	0.41	0.08	0.52	0.02	
25/01/2025 10:45:00			0.05		0.15	0.14		0.50	0.00	0.41	0.09	0.52	0.02	
25/01/2025 11:00:00			0.05		0.15	0.14		0.50	0.00	0.42	0.09	0.53	0.02	
25/01/2025 11:15:00			0.06		0.15	0.14		0.50	0.00	0.42	0.09	0.53	0.02	
25/01/2025 11:30:00			0.06		0.15	0.14		0.50	0.00	0.42	0.09	0.53	0.02	
25/01/2025 11:45:00			0.05		0.15	0.14		0.51	0.00	0.42	0.09	0.54	0.02	
25/01/2025 12:00:00			0.06		0.15	0.14		0.51	0.00	0.42	0.09	0.54	0.01	
25/01/2025 12:15:00			0.06		0.15	0.14		0.51	0.00	0.42	0.09	0.54	0.02	
25/01/2025 12:30:00			0.06		0.16	0.15		0.51	0.00	0.42	0.09	0.55	0.02	
25/01/2025 12:45:00			0.06		0.16	0.15		0.50	0.00	0.42	0.09	0.55	0.01	
25/01/2025 13:00:00			0.06		0.16	0.15		0.50	0.00	0.42	0.09	0.55	0.01	
25/01/2025 13:15:00			0.06		0.16	0.15		0.50	0.00	0.42	0.08	0.56	0.02	
25/01/2025 13:30:00			0.06		0.16	0.15		0.50	0.00	0.42	0.08	0.56	0.02	
25/01/2025 13:45:00			0.06		0.16	0.15		0.50	0.00	0.42	0.08	0.57	0.02	
25/01/2025 14:00:00			0.06		0.16	0.15		0.50	0.00	0.42	0.08	0.57	0.03	
25/01/2025 14:15:00			0.06		0.16	0.15		0.50	0.00	0.42	0.09	0.57	0.01	
25/01/2025 14:30:00			0.06		0.16	0.15		0.50	0.00	0.42	0.08	0.58	0.01	
25/01/2025 14:45:00			0.06		0.16	0.15		0.50	0.00	0.42	0.08	0.58	0.01	
25/01/2025 15:00:00			0.06		0.16	0.15		0.50	0.00	0.43	0.09	0.58	0.01	
25/01/2025 15:15:00			0.05		0.16	0.15		0.50	0.00	0.43	0.09	0.59	0.01	
25/01/2025 15:30:00			0.06		0.16	0.15		0.50	0.00	0.43	0.08	0.59	0.01	
25/01/2025 15:45:00			0.05		0.16	0.15		0.50	0.00	0.43	0.08	0.59	0.02	
25/01/2025 16:00:00			0.05		0.16	0.15		0.50	0.00	0.43	0.08	0.59	0.02	
25/01/2025 16:15:00			0.05		0.16	0.15		0.49	0.00	0.43	0.08	0.60	0.02	
25/01/2025 16:30:00			0.06		0.15	0.15		0.49	0.00	0.43	0.08	0.60	0.02	
25/01/2025 16:45:00			0.05		0.15	0.15		0.49	0.00	0.43	0.08	0.60	0.02	
25/01/2025 17:00:00			0.05		0.15	0.14		0.49	0.00	0.43	0.08	0.61	0.01	
25/01/2025 17:15:00			0.05		0.15	0.15		0.49	0.00	0.43	0.08	0.61	0.01	
25/01/2025 17:30:00			0.05		0.15	0.14		0.49	0.00	0.44	0.08	0.61	0.02	
25/01/2025 17:45:00			0.05		0.15	0.14		0.49	0.00	0.44	0.08	0.62	0.03	
25/01/2025 18:00:00			0.05		0.15	0.14		0.49	0.00	0.44	0.08	0.62	0.03	
25/01/2025 18:15:00			0.05		0.15	0.14		0.49	0.00	0.44	0.07	0.62	0.03	
25/01/2025 18:30:00			0.05		0.15	0.14		0.49	0.00	0.44	0.07	0.62	0.03	
25/01/2025 18:45:00			0.05		0.15	0.14		0.49	0.00	0.44	0.07	0.63	0.02	
25/01/2025 19:00:00			0.05		0.15	0.14		0.49	0.00	0.44	0.07	0.63	0.02	
25/01/2025 19:15:00			0.05		0.15	0.14		0.49	0.00	0.44	0.07	0.63	0.02	
25/01/2025 19:30:00			0.05		0.15	0.14		0.49	0.00	0.45	0.07	0.63	0.03	
25/01/2025 19:45:00			0.05		0.15	0.14		0.50	0.00	0.45	0.07	0.64	0.03	
25/01/2025 20:00:00			0.05		0.15	0.14		0.50	0.00	0.45	0.07	0.64	0.03	
25/01/2025 20:15:00			0.05		0.15	0.14		0.50	0.00	0.45	0.07	0.64	0.02	
25/01/2025 20:30:00			0.04		0.15	0.14		0.50	0.00	0.45	0.07	0.65	0.03	
25/01/2025 20:45:00			0.05		0.15	0.14		0.50	0.00	0.45	0.07	0.65	0.02	
25/01/2025 21:00:00			0.04		0.15	0.14		0.50	0.00	0.45	0.07	0.65	0.03	
25/01/2025 21:15:00			0.04		0.15	0.14		0.50	0.00	0.46	0.07	0.65	0.03	
25/01/2025 21:30:00			0.04		0.15	0.14		0.50	0.00	0.46	0.08	0.66	0.03	
25/01/2025 21:45:00			0.04		0.15	0.14		0.50	0.00	0.46	0.07	0.66	0.03	
25/01/2025 22:00:00			0.04		0.15	0.14		0.50	0.00	0.46	0.07	0.66	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
25/01/2025 22:15:00			0.04		0.15	0.14		0.50	0.00	0.46	0.07	0.66	0.03	
25/01/2025 22:30:00			0.05		0.15	0.14		0.50	0.00	0.46	0.07	0.66	0.01	
25/01/2025 22:45:00			0.04		0.15	0.14		0.50	0.00	0.47	0.07	0.67	0.02	
25/01/2025 23:00:00			0.04		0.15	0.14		0.50	0.00	0.47	0.07	0.67	0.02	
25/01/2025 23:15:00			0.04		0.15	0.14		0.50	0.00	0.47	0.07	0.67	0.02	
25/01/2025 23:30:00			0.05		0.15	0.14		0.50	0.00	0.47	0.07	0.67	0.03	
25/01/2025 23:45:00			0.04		0.15	0.14		0.50	0.00	0.47	0.07	0.68	0.02	
26/01/2025 00:00:00			0.05		0.15	0.14		0.49	0.00	0.47	0.06	0.68	0.03	
26/01/2025 00:15:00			0.04		0.15	0.14		0.49	0.00	0.47	0.06	0.68	0.02	
26/01/2025 00:30:00			0.05		0.15	0.14		0.49	0.00	0.47	0.06	0.67	0.03	
26/01/2025 00:45:00			0.04		0.15	0.14		0.49	0.00	0.48	0.06	0.65	0.03	
26/01/2025 01:00:00			0.04		0.15	0.14		0.49	0.00	0.48	0.07	0.63	0.05	
26/01/2025 01:15:00			0.04		0.15	0.14		0.49	0.00	0.47	0.06	0.61	0.06	
26/01/2025 01:30:00			0.04		0.15	0.14		0.49	0.00	0.47	0.06	0.60	0.08	
26/01/2025 01:45:00			0.04		0.15	0.14		0.49	0.00	0.47	0.06	0.58	0.08	
26/01/2025 02:00:00			0.04		0.15	0.14		0.48	0.00	0.47	0.07	0.58	0.08	
26/01/2025 02:15:00			0.04		0.14	0.14		0.48	0.00	0.46	0.06	0.57	0.07	
26/01/2025 02:30:00			0.04		0.14	0.14		0.48	0.00	0.46	0.07	0.56	0.06	
26/01/2025 02:45:00			0.04		0.14	0.14		0.48	0.00	0.46	0.07	0.55	0.06	
26/01/2025 03:00:00			0.04		0.14	0.14		0.48	0.00	0.45	0.07	0.54	0.07	
26/01/2025 03:15:00			0.04		0.14	0.14		0.48	0.00	0.45	0.07	0.53	0.07	
26/01/2025 03:30:00			0.04		0.14	0.14		0.48	0.00	0.45	0.07	0.53	0.06	
26/01/2025 03:45:00			0.04		0.14	0.14		0.48	0.00	0.44	0.07	0.53	0.06	
26/01/2025 04:00:00			0.04		0.14	0.14		0.48	0.00	0.44	0.07	0.54	0.07	
26/01/2025 04:15:00			0.04		0.14	0.14		0.47	0.00	0.44	0.07	0.55	0.07	
26/01/2025 04:30:00			0.04		0.14	0.14		0.47	0.00	0.43	0.07	0.58	0.04	
26/01/2025 04:45:00			0.04		0.14	0.14		0.47	0.00	0.43	0.07	0.59	0.03	
26/01/2025 05:00:00			0.04		0.14	0.13		0.47	0.00	0.43	0.07	0.60	0.02	
26/01/2025 05:15:00			0.04		0.14	0.13		0.47	0.00	0.43	0.08	0.61	0.02	
26/01/2025 05:30:00			0.03		0.14	0.13		0.47	0.00	0.43	0.08	0.61	0.02	
26/01/2025 05:45:00			0.03		0.14	0.13		0.47	0.00	0.43	0.07	0.62	0.02	
26/01/2025 06:00:00			0.03		0.14	0.13		0.47	0.00	0.43	0.07	0.62	0.02	
26/01/2025 06:15:00			0.03		0.14	0.13		0.47	0.00	0.44	0.07	0.63	0.01	
26/01/2025 06:30:00			0.03		0.14	0.13		0.47	0.00	0.44	0.07	0.63	0.02	
26/01/2025 06:45:00			0.03		0.14	0.13		0.47	0.00	0.44	0.07	0.64	0.02	
26/01/2025 07:00:00			0.03		0.14	0.13		0.47	0.00	0.44	0.07	0.64	0.02	
26/01/2025 07:15:00			0.03		0.14	0.13		0.47	0.00	0.44	0.07	0.64	0.02	
26/01/2025 07:30:00			0.03		0.14	0.13		0.47	0.00	0.44	0.07	0.65	0.02	
26/01/2025 07:45:00			0.03		0.14	0.13		0.47	0.00	0.45	0.07	0.65	0.02	
26/01/2025 08:00:00			0.03		0.14	0.13		0.47	0.00	0.45	0.07	0.65	0.02	
26/01/2025 08:15:00			0.02		0.13	0.13		0.47	0.00	0.45	0.06	0.65	0.02	
26/01/2025 08:30:00			0.02		0.13	0.13		0.47	0.00	0.45	0.04	0.66	0.02	
26/01/2025 08:45:00			0.02		0.13	0.13		0.47	0.00	0.46	0.04	0.66	0.02	
26/01/2025 09:00:00			0.02		0.13	0.13		0.47	0.00	0.46	0.05	0.66	0.02	
26/01/2025 09:15:00			0.02		0.13	0.13		0.48	0.00	0.46	0.05	0.67	0.02	
26/01/2025 09:30:00			0.02		0.13	0.13		0.48	0.00	0.46	0.05	0.67	0.01	
26/01/2025 09:45:00			0.02		0.13	0.13		0.48	0.00	0.46	0.08	0.66	0.03	
26/01/2025 10:00:00			0.02		0.13	0.13		0.48	0.00	0.47	0.07	0.64	0.04	
26/01/2025 10:15:00			0.02		0.13	0.13		0.49	0.00	0.47	0.07	0.61	0.07	
26/01/2025 10:30:00			0.02		0.13	0.13		0.49	0.00	0.46	0.07	0.59	0.08	
26/01/2025 10:45:00			0.02		0.13	0.13		0.49	0.00	0.46	0.07	0.57	0.09	
26/01/2025 11:00:00			0.02		0.13	0.13		0.49	0.00	0.46	0.07	0.55	0.10	
26/01/2025 11:15:00			0.02		0.13	0.13		0.50	0.00	0.46	0.07	0.53	0.09	
26/01/2025 11:30:00			0.02		0.13	0.13		0.50	0.00	0.45	0.08	0.52	0.09	
26/01/2025 11:45:00			0.02		0.13	0.13		0.50	0.00	0.45	0.08	0.50	0.09	
26/01/2025 12:00:00			0.02		0.13	0.13		0.50	0.00	0.45	0.07	0.49	0.10	
26/01/2025 12:15:00			0.02		0.13	0.13		0.51	0.00	0.44	0.07	0.48	0.10	
26/01/2025 12:30:00			0.02		0.13	0.13		0.51	0.00	0.44	0.07	0.46	0.10	
26/01/2025 12:45:00			0.02		0.14	0.13		0.51	0.00	0.44	0.06	0.45	0.10	
26/01/2025 13:00:00			0.02		0.14	0.13		0.51	0.00	0.43	0.08	0.44	0.10	
26/01/2025 13:15:00			0.02		0.14	0.13		0.51	0.00	0.43	0.08	0.44	0.10	
26/01/2025 13:30:00			0.02		0.14	0.13		0.51	0.00	0.43	0.08	0.43	0.08	
26/01/2025 13:45:00			0.02		0.14	0.13		0.51	0.00	0.43	0.07	0.42	0.08	
26/01/2025 14:00:00			0.03		0.14	0.13		0.52	0.00	0.42	0.07	0.41	0.09	
26/01/2025 14:15:00			0.03		0.14	0.13		0.52	0.00	0.42	0.07	0.41	0.09	
26/01/2025 14:30:00			0.03		0.14	0.13		0.52	0.00	0.42	0.07	0.40	0.09	
26/01/2025 14:45:00			0.03		0.14	0.14		0.52	0.00	0.42	0.03	0.39	0.08	
26/01/2025 15:00:00			0.03		0.14	0.14		0.52	0.00	0.42	0.03	0.39	0.09	
26/01/2025 15:15:00			0.03		0.14	0.14		0.52	0.00	0.42	0.09	0.38	0.08	
26/01/2025 15:30:00			0.03		0.14	0.14		0.51	0.00	0.42	0.09	0.38	0.08	
26/01/2025 15:45:00			0.03		0.15	0.14		0.52	0.00	0.42	0.07	0.37	0.08	
26/01/2025 16:00:00			0.03		0.14	0.14		0.52	0.00	0.42	0.07	0.37	0.08	
26/01/2025 16:15:00			0.04		0.15	0.14		0.52	0.00	0.41	0.07	0.36	0.08	
26/01/2025 16:30:00			0.04		0.15	0.14		0.52	0.00	0.41	0.07	0.36	0.07	
26/01/2025 16:45:00			0.04		0.15	0.14		0.53	0.00	0.42	0.05	0.36	0.09	
26/01/2025 17:00:00			0.04		0.15	0.14		0.53	0.00	0.42	0.07	0.36	0.07	
26/01/2025 17:15:00			0.04		0.15	0.14		0.54	0.00	0.42	0.07	0.36	0.07	
26/01/2025 17:30:00			0.04		0.15	0.14		0.55	0.00	0.42	0.07	0.37	0.07	
26/01/2025 17:45:00			0.04		0.15	0.15		0.57	0.00	0.42	0.07	0.38	0.07	
26/01/2025 18:00:00			0.04		0.15	0.15		0.57	0.00	0.42	0.07	0.40	0.05	
26/01/2025 18:15:00			0.05		0.15	0.15		0.58	0.00	0.42	0.07	0.43	0.05	
26/01/2025 18:30:00			0.05		0.16	0.15		0.58	0.00	0.42	0.07	0.45	0.04	
26/01/2025 18:45:00			0.05		0.16	0.15		0.58	0.00	0.42	0.07	0.47	0.03	
26/01/2025 19:00:00			0.06		0.16	0.16		0.58	0.00	0.42	0.07	0.48	0.03	
26/01/2025 19:15:00			0.06		0.17	0.16		0.58	0.00	0.42	0.09	0.49	0.03	
26/01/2025 19:30:00			0.06		0.17	0.16		0.58	0.00	0.42	0.09	0.50	0.03	
26/01/2025 19:45:00			0.07		0.17	0.16		0.58	0.00	0.42	0.10	0.51	0.02	
26/01/2025 20:00:00			0.07		0.18	0.16		0.57	0.00	0.42	0.09	0.52	0.02	
26/01/2025 20:15:00			0.08		0.18	0.16		0.57	0.00	0.42	0.08	0.53	0.02	
26/01/2025 20:30:00			0.08		0.18	0.16		0.56	0.00	0.42	0.08	0.53	0.02	
26/01/2025 20:45:00			0.08		0.18	0.16		0.56	0.00	0.42	0.09	0.54	0.02	
26/01/2025 21:00:00			0.09		0.18	0.17		0.56	0.00	0.42	0.07	0.55	0.02	
26/01/2025 21:15:00			0.09		0.18	0.17		0.56	0.00	0.43	0.07	0.55	0.02	
26/01/2025 21:30:00			0.09		0.18	0.17		0.55	0.00	0.43	0.07	0.56	0.02	
26/01/2025 21:45:00			0.09		0.18	0.17		0.55	0.00	0.43	0.07	0.56	0.02	
26/01/2025 22:00:00			0.09		0.18	0.17		0.55	0.00	0.43	0.07	0.57	0.02	
26/01/2025 22:15:00			0.09		0.18	0.17		0.55	0.00	0.43	0.07	0.57	0.02	
26/01/2025 22:30:00			0.09		0.18	0.17		0.55	0.00	0.43	0.08	0.57	0.02	
26/01/2025 22:45:00			0.09		0.18	0.17		0.55	0.00	0.43	0.08	0.56	0.04	
26/01/2025 23:00:00			0.09		0.18	0.17		0.55	0.00	0.43	0.08	0.54	0.04	
26/01/2025 23:15:00			0.09		0.18	0.17		0.55	0.00	0.44	0.08	0.53	0.06	
26/01/2025 23:30:00			0.09		0.18	0.17		0.55	0.00	0.44	0.06	0.51	0.07	
26/01/2025 23:45:00			0.09		0.18	0.17		0.55	0.00	0.44	0.09	0.49	0.07	
27/01/2025 00:00:00			0.09		0.18	0.17		0.55	0.00	0.44	0.08	0.48	0.09	
27/01/2025 00:15:00			0.08		0.18	0.17		0.55	0.00	0.44	0.08	0.47	0.08	
27/01/2025 00:30:00			0.08		0.18	0.17		0.54	0.00	0.44	0.08	0.45	0.08	
27/01/2025 00:45:00			0.08		0.18	0.17		0.55	0.00	0.44	0.09	0.44	0.09	
27/01/2025 01:00:00			0.08		0.18	0.17		0.55	0.00	0.44	0.09	0.43	0.09	
27/01/2025 01:15:00			0.08		0.18	0.17		0.56	0.00	0.44	0.09	0.42	0.07	
27/01/2025 01:30:00			0.08		0.18	0.17		0.59	0.00	0.44	0.09	0.42	0.08	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
27/01/2025 01:45:00			0.08		0.18	0.17		0.61	0.00	0.44	0.09	0.41	0.08	
27/01/2025 02:00:00			0.08		0.18	0.17		0.61	0.00	0.44	0.09	0.40	0.09	
27/01/2025 02:15:00			0.09		0.19	0.17		0.62	0.00	0.44	0.09	0.40	0.08	
27/01/2025 02:30:00			0.09		0.19	0.17		0.62	0.00	0.44	0.10	0.39	0.07	
27/01/2025 02:45:00			0.10		0.19	0.17		0.62	0.00	0.44	0.09	0.39	0.09	
27/01/2025 03:00:00			0.10		0.20	0.17		0.62	0.00	0.44	0.09	0.38	0.09	
27/01/2025 03:15:00			0.11		0.20	0.18		0.61	0.00	0.44	0.09	0.38	0.07	
27/01/2025 03:30:00			0.11		0.20	0.18		0.61	0.00	0.44	0.10	0.38	0.07	
27/01/2025 03:45:00			0.12		0.20	0.18		0.60	0.00	0.44	0.09	0.37	0.07	
27/01/2025 04:00:00			0.12		0.20	0.18		0.60	0.00	0.44	0.10	0.37	0.07	
27/01/2025 04:15:00			0.12		0.21	0.18		0.59	0.00	0.44	0.11	0.37	0.07	
27/01/2025 04:30:00			0.12		0.21	0.18		0.59	0.00	0.44	0.11	0.37	0.07	
27/01/2025 04:45:00			0.13		0.21	0.18		0.58	0.00	0.44	0.11	0.37	0.07	
27/01/2025 05:00:00			0.12		0.21	0.18		0.58	0.00	0.44	0.13	0.37	0.07	
27/01/2025 05:15:00			0.13		0.21	0.18		0.57	0.00	0.44	0.13	0.38	0.07	
27/01/2025 05:30:00			0.12		0.21	0.18		0.57	0.00	0.44	0.12	0.39	0.05	
27/01/2025 05:45:00			0.12		0.21	0.18		0.57	0.00	0.44	0.11	0.42	0.05	
27/01/2025 06:00:00			0.12		0.21	0.18		0.57	0.00	0.44	0.11	0.44	0.05	
27/01/2025 06:15:00			0.12		0.21	0.18		0.57	0.00	0.44	0.10	0.46	0.05	
27/01/2025 06:30:00			0.12		0.20	0.18		0.57	0.00	0.44	0.13	0.47	0.05	
27/01/2025 06:45:00			0.12		0.20	0.18		0.58	0.00	0.44	0.13	0.49	0.04	
27/01/2025 07:00:00			0.12		0.20	0.18		0.58	0.00	0.44	0.11	0.50	0.03	
27/01/2025 07:15:00			0.12		0.23	0.18		0.58	0.00	0.44	0.11	0.51	0.03	
27/01/2025 07:30:00			0.12		0.23	0.18		0.58	0.00	0.44	0.10	0.52	0.02	
27/01/2025 07:45:00			0.12		0.23	0.18		0.59	0.00	0.44	0.10	0.53	0.03	
27/01/2025 08:00:00			0.12		0.23	0.18		0.59	0.00	0.45	0.11	0.54	0.03	
27/01/2025 08:15:00			0.13		0.23	0.18		0.59	0.00	0.45	0.11	0.54	0.02	
27/01/2025 08:30:00			0.13		0.23	0.18		0.59	0.00	0.45	0.11	0.55	0.03	
27/01/2025 08:45:00			0.13		0.23	0.18		0.60	0.00	0.45	0.11	0.56	0.03	
27/01/2025 09:00:00			0.13		0.23	0.18		0.60	0.00	0.45	0.11	0.56	0.02	
27/01/2025 09:15:00			0.13		0.23	0.18		0.60	0.00	0.45	0.13	0.57	0.03	
27/01/2025 09:30:00			0.13		0.23	0.18		0.60	0.00	0.45	0.12	0.58	0.03	
27/01/2025 09:45:00			0.13		0.23	0.18		0.60	0.00	0.45	0.12	0.58	0.03	
27/01/2025 10:00:00			0.14		0.24	0.18		0.60	0.00	0.45	0.11	0.59	0.02	
27/01/2025 10:15:00			0.14		0.24	0.18		0.60	0.00	0.46	0.11	0.60	0.03	
27/01/2025 10:30:00			0.14		0.24	0.18		0.60	0.00	0.46	0.11	0.60	0.03	
27/01/2025 10:45:00			0.14		0.24	0.18		0.60	0.00	0.46	0.13	0.61	0.02	
27/01/2025 11:00:00			0.14		0.24	0.18		0.60	0.00	0.46	0.11	0.61	0.03	
27/01/2025 11:15:00			0.14		0.24	0.19		0.61	0.00	0.46	0.13	0.62	0.03	
27/01/2025 11:30:00			0.14		0.24	0.19		0.60	0.00	0.47	0.11	0.62	0.03	
27/01/2025 11:45:00			0.14		0.25	0.18		0.60	0.00	0.47	0.12	0.61	0.04	
27/01/2025 12:00:00			0.14		0.25	0.19		0.60	0.00	0.47	0.12	0.59	0.04	
27/01/2025 12:15:00			0.14		0.24	0.19		0.60	0.00	0.47	0.12	0.57	0.07	
27/01/2025 12:30:00			0.14		0.24	0.19		0.60	0.00	0.47	0.12	0.56	0.07	
27/01/2025 12:45:00			0.14		0.22	0.20		0.60	0.00	0.47	0.12	0.55	0.08	
27/01/2025 13:00:00			0.14		0.22	0.19		0.60	0.00	0.47	0.12	0.53	0.08	
27/01/2025 13:15:00			0.14		0.22	0.20		0.61	0.00	0.47	0.10	0.52	0.08	
27/01/2025 13:30:00			0.14		0.22	0.19		0.60	0.00	0.47	0.10	0.52	0.08	
27/01/2025 13:45:00			0.14		0.22	0.19		0.61	0.00	0.47	0.07	0.51	0.09	
27/01/2025 14:00:00			0.14		0.22	0.20		0.61	0.00	0.47	0.09	0.50	0.09	
27/01/2025 14:15:00			0.13		0.22	0.19		0.61	0.00	0.47	0.09	0.50	0.08	
27/01/2025 14:30:00			0.14		0.22	0.19		0.61	0.00	0.47	0.11	0.49	0.08	
27/01/2025 14:45:00			0.14		0.22	0.19		0.61	0.00	0.46	0.09	0.48	0.09	
27/01/2025 15:00:00			0.14		0.22	0.19		0.60	0.00	0.46	0.09	0.48	0.08	
27/01/2025 15:15:00			0.14		0.22	0.19		0.60	0.00	0.46	0.11	0.48	0.07	
27/01/2025 15:30:00			0.14		0.22	0.19		0.60	0.00	0.46	0.12	0.47	0.07	
27/01/2025 15:45:00			0.14		0.22	0.19		0.60	0.00	0.46	0.12	0.47	0.08	
27/01/2025 16:00:00			0.13		0.22	0.19		0.60	0.00	0.46	0.13	0.47	0.09	
27/01/2025 16:15:00			0.13		0.22	0.19		0.61	0.00	0.46	0.15	0.46	0.09	
27/01/2025 16:30:00			0.13		0.22	0.19		0.62	0.00	0.46	0.11	0.46	0.07	
27/01/2025 16:45:00			0.13		0.22	0.19		0.62	0.00	0.46	0.11	0.46	0.07	
27/01/2025 17:00:00			0.13		0.22	0.19		0.62	0.00	0.46	0.11	0.46	0.08	
27/01/2025 17:15:00			0.13		0.22	0.19		0.62	0.00	0.46	0.11	0.46	0.09	
27/01/2025 17:30:00			0.13		0.22	0.19		0.61	0.00	0.46	0.12	0.48	0.09	
27/01/2025 17:45:00			0.14		0.22	0.19		0.61	0.00	0.46	0.10	0.51	0.05	
27/01/2025 18:00:00			0.14		0.22	0.19		0.61	0.00	0.46	0.10	0.53	0.04	
27/01/2025 18:15:00			0.14		0.22	0.19		0.61	0.00	0.46	0.13	0.55	0.04	
27/01/2025 18:30:00			0.14		0.22	0.19		0.61	0.00	0.46	0.09	0.56	0.04	
27/01/2025 18:45:00			0.14		0.22	0.19		0.61	0.00	0.46	0.09	0.57	0.02	
27/01/2025 19:00:00			0.14		0.22	0.19		0.61	0.00	0.46	0.13	0.59	0.03	
27/01/2025 19:15:00			0.14		0.22	0.19		0.60	0.00	0.46	0.11	0.60	0.03	
27/01/2025 19:30:00			0.14		0.22	0.19		0.60	0.00	0.47	0.11	0.61	0.02	
27/01/2025 19:45:00			0.13		0.22	0.19		0.60	0.00	0.47	0.11	0.62	0.02	
27/01/2025 20:00:00			0.13		0.22	0.19		0.60	0.00	0.47	0.10	0.63	0.02	
27/01/2025 20:15:00			0.13		0.22	0.19		0.60	0.00	0.47	0.10	0.63	0.02	
27/01/2025 20:30:00			0.13		0.22	0.19		0.60	0.00	0.48	0.10	0.64	0.02	
27/01/2025 20:45:00			0.13		0.22	0.19		0.60	0.00	0.48	0.10	0.65	0.02	
27/01/2025 21:00:00			0.13		0.22	0.19		0.60	0.00	0.48	0.09	0.66	0.02	
27/01/2025 21:15:00			0.13		0.22	0.19		0.60	0.00	0.48	0.09	0.67	0.02	
27/01/2025 21:30:00			0.13		0.22	0.19		0.60	0.00	0.49	0.11	0.68	0.01	
27/01/2025 21:45:00			0.13		0.22	0.19		0.60	0.00	0.49	0.08	0.68	0.02	
27/01/2025 22:00:00			0.13		0.22	0.19		0.59	0.00	0.50	0.10	0.69	0.02	
27/01/2025 22:15:00			0.13		0.22	0.19		0.59	0.00	0.50	0.10	0.70	0.01	
27/01/2025 22:30:00			0.13		0.22	0.19		0.59	0.00	0.50	0.09	0.70	0.01	
27/01/2025 22:45:00			0.13		0.22	0.19		0.59	0.00	0.51	0.09	0.71	0.01	
27/01/2025 23:00:00			0.13		0.21	0.19		0.59	0.00	0.51	0.10	0.72	0.02	
27/01/2025 23:15:00			0.13		0.21	0.19		0.59	0.00	0.52	0.10	0.72	0.02	
27/01/2025 23:30:00			0.13		0.21	0.19		0.59	0.00	0.52	0.09	0.73	0.02	
27/01/2025 23:45:00			0.13		0.21	0.19		0.59	0.00	0.52	0.09	0.73	0.02	
28/01/2025 00:00:00			0.13		0.21	0.19		0.59	0.00	0.53	0.09	0.74	0.02	
28/01/2025 00:15:00			0.13		0.21	0.19		0.58	0.00	0.53	0.07	0.74	0.02	
28/01/2025 00:30:00			0.13		0.21	0.19		0.58	0.00	0.53	0.07	0.72	0.03	
28/01/2025 00:45:00			0.13		0.21	0.19		0.58	0.00	0.54	0.05	0.71	0.05	
28/01/2025 01:00:00			0.12		0.21	0.19		0.58	0.00	0.54	0.05	0.69	0.06	
28/01/2025 01:15:00			0.12		0.21	0.19		0.58	0.00	0.54	0.04	0.67	0.06	
28/01/2025 01:30:00			0.12		0.21	0.19		0.58	0.00	0.54	0.05	0.65	0.10	
28/01/2025 01:45:00			0.12		0.21	0.19		0.58	0.00	0.53	0.05	0.64	0.10	
28/01/2025 02:00:00			0.12		0.21	0.19		0.58	0.00	0.53	0.07	0.62	0.10	
28/01/2025 02:15:00			0.12		0.21	0.19		0.58	0.00	0.53	0.06	0.61	0.08	
28/01/2025 02:30:00			0.12		0.21	0.19		0.58	0.00	0.52	0.06	0.60	0.08	
28/01/2025 02:45:00			0.12		0.21	0.19		0.58	0.00	0.52	0.08	0.59	0.07	
28/01/2025 03:00:00			0.12		0.21	0.19		0.58	0.00	0.52	0.08	0.59	0.08	
28/01/2025 03:15:00			0.12		0.21	0.19		0.57	0.00	0.52	0.06	0.58	0.11	
28/01/2025 03:30:00			0.12		0.21	0.19		0.57	0.00	0.51	0.07	0.57	0.09	
28/01/2025 03:45:00			0.12		0.21	0.19		0.57	0.00	0.51	0.07	0.57	0.09	
28/01/2025 04:00:00			0.12		0.21	0.19		0.57	0.00	0.51	0.10	0.56	0.08	
28/01/2025 04:15:00			0.12		0.21	0.19		0.57	0.00	0.51	0.06	0.56	0.09	
28/01/2025 04:30:00			0.12		0.20	0.19		0.57	0.00	0.50	0.10	0.56	0.08	
28/01/2025 04:45:00			0.11		0.20	0.18		0.56	0.00	0.50	0.10	0.56	0.08	
28/01/2025 05:00:00			0.11		0.20	0.18		0.56	0.00	0.50	0.09	0.56	0.09	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
28/01/2025 05:15:00			0.11		0.20	0.18		0.56	0.00	0.50	0.09	0.58	0.07	
28/01/2025 05:30:00			0.11		0.20	0.18		0.56	0.00	0.50	0.11	0.60	0.06	
28/01/2025 05:45:00			0.11		0.20	0.18		0.55	0.00	0.50	0.10	0.63	0.03	
28/01/2025 06:00:00			0.11		0.20	0.18		0.55	0.00	0.49	0.11	0.65	0.03	
28/01/2025 06:15:00			0.11		0.20	0.18		0.55	0.00	0.50	0.09	0.67	0.02	
28/01/2025 06:30:00			0.11		0.20	0.18		0.54	0.00	0.50	0.10	0.68	0.01	
28/01/2025 06:45:00			0.11		0.20	0.18		0.54	0.00	0.50	0.08	0.69	0.01	
28/01/2025 07:00:00			0.10		0.20	0.18		0.54	0.00	0.50	0.08	0.71	0.00	
28/01/2025 07:15:00			0.10		0.20	0.18		0.54	0.00	0.51	0.08	0.71	0.00	
28/01/2025 07:30:00			0.10		0.19	0.18		0.54	0.00	0.51	0.10	0.72	0.00	
28/01/2025 07:45:00			0.10		0.19	0.18		0.54	0.00	0.52	0.09	0.73	0.00	
28/01/2025 08:00:00			0.10		0.19	0.18		0.54	0.00	0.52	0.08	0.74	0.01	
28/01/2025 08:15:00			0.10		0.19	0.18		0.54	0.00	0.53	0.08	0.74	0.01	
28/01/2025 08:30:00			0.10		0.19	0.18		0.54	0.00	0.53	0.09	0.75	0.01	
28/01/2025 08:45:00			0.10		0.19	0.17		0.54	0.00	0.54	0.09	0.75	0.01	
28/01/2025 09:00:00			0.09		0.19	0.17		0.55	0.00	0.54	0.10	0.76	0.01	
28/01/2025 09:15:00			0.09		0.19	0.17		0.55	0.00	0.55	0.10	0.76	0.01	
28/01/2025 09:30:00			0.09		0.19	0.17		0.56	0.00	0.55	0.07	0.77	0.01	
28/01/2025 09:45:00			0.09		0.19	0.17		0.56	0.00	0.55	0.07	0.77	0.02	
28/01/2025 10:00:00			0.09		0.19	0.17		0.56	0.00	0.56	0.07	0.78	0.01	
28/01/2025 10:15:00			0.09		0.19	0.17		0.56	0.00	0.56	0.09	0.78	0.02	
28/01/2025 10:30:00			0.09		0.19	0.17		0.56	0.00	0.56	0.09	0.78	0.01	
28/01/2025 10:45:00			0.09		0.19	0.17		0.56	0.00	0.57	0.09	0.78	0.01	
28/01/2025 11:00:00			0.09		0.19	0.17		0.56	0.00	0.57	0.06	0.79	0.01	
28/01/2025 11:15:00			0.09		0.19	0.17		0.56	0.00	0.57	0.08	0.79	0.02	
28/01/2025 11:30:00			0.09		0.19	0.17		0.56	0.00	0.57	0.09	0.79	0.02	
28/01/2025 11:45:00			0.09		0.19	0.17		0.56	0.00	0.57	0.08	0.79	0.02	
28/01/2025 12:00:00			0.09		0.19	0.17		0.56	0.00	0.58	0.07	0.79	0.02	
28/01/2025 12:15:00			0.09		0.19	0.17		0.56	0.00	0.58	0.08	0.80	0.02	
28/01/2025 12:30:00			0.09		0.19	0.17		0.56	0.00	0.58	0.08	0.80	0.02	
28/01/2025 12:45:00			0.09		0.19	0.17		0.56	0.00	0.58	0.08	0.78	0.04	
28/01/2025 13:00:00			0.09		0.18	0.17		0.56	0.00	0.58	0.08	0.76	0.04	
28/01/2025 13:15:00			0.09		0.18	0.17		0.56	0.00	0.58	0.08	0.74	0.06	
28/01/2025 13:30:00			0.09		0.18	0.17		0.56	0.00	0.58	0.02	0.73	0.06	
28/01/2025 13:45:00			0.09		0.18	0.17		0.56	0.00	0.58	0.05	0.71	0.08	
28/01/2025 14:00:00			0.09		0.18	0.17		0.56	0.00	0.57	0.04	0.70	0.08	
28/01/2025 14:15:00			0.08		0.18	0.17		0.56	0.00	0.57	0.04	0.68	0.08	
28/01/2025 14:30:00			0.09		0.18	0.17		0.55	0.00	0.56	0.04	0.67	0.08	
28/01/2025 14:45:00			0.09		0.18	0.17		0.55	0.00	0.56	0.04	0.66	0.08	
28/01/2025 15:00:00			0.08		0.18	0.17		0.55	0.00	0.55	0.07	0.64	0.09	
28/01/2025 15:15:00			0.08		0.18	0.17		0.55	0.00	0.55	0.07	0.63	0.09	
28/01/2025 15:30:00			0.08		0.18	0.17		0.55	0.00	0.54	0.08	0.62	0.08	
28/01/2025 15:45:00			0.08		0.18	0.17		0.55	0.00	0.54	0.11	0.61	0.08	
28/01/2025 16:00:00			0.08		0.18	0.17		0.55	0.00	0.54	0.11	0.61	0.10	
28/01/2025 16:15:00			0.08		0.18	0.17		0.55	0.00	0.53	0.10	0.60	0.10	
28/01/2025 16:30:00			0.08		0.18	0.17		0.55	0.00	0.53	0.12	0.59	0.09	
28/01/2025 16:45:00			0.08		0.18	0.17		0.54	0.00	0.53	0.13	0.59	0.08	
28/01/2025 17:00:00			0.08		0.18	0.17		0.54	0.00	0.52	0.13	0.59	0.08	
28/01/2025 17:15:00			0.08		0.18	0.17		0.54	0.00	0.52	0.10	0.58	0.08	
28/01/2025 17:30:00			0.08		0.18	0.17		0.54	0.00	0.52	0.14	0.59	0.07	
28/01/2025 17:45:00			0.08		0.18	0.17		0.54	0.00	0.51	0.13	0.61	0.07	
28/01/2025 18:00:00			0.08		0.18	0.17		0.54	0.00	0.51	0.14	0.64	0.06	
28/01/2025 18:15:00			0.08		0.18	0.17		0.54	0.00	0.51	0.13	0.68	0.06	
28/01/2025 18:30:00			0.08		0.18	0.17		0.57	0.00	0.51	0.14	0.70	0.01	
28/01/2025 18:45:00			0.08		0.18	0.17		0.60	0.00	0.51	0.14	0.71	0.01	
28/01/2025 19:00:00			0.08		0.18	0.17		0.62	0.00	0.52	0.14	0.72	0.01	
28/01/2025 19:15:00			0.08		0.18	0.17		0.62	0.00	0.52	0.11	0.73	0.01	
28/01/2025 19:30:00			0.09		0.18	0.17		0.61	0.00	0.53	0.11	0.74	0.01	
28/01/2025 19:45:00			0.09		0.19	0.17		0.61	0.00	0.53	0.11	0.75	0.01	
28/01/2025 20:00:00			0.10		0.19	0.17		0.61	0.00	0.54	0.11	0.76	0.00	
28/01/2025 20:15:00			0.10		0.19	0.17		0.61	0.00	0.54	0.13	0.76	0.00	
28/01/2025 20:30:00			0.11		0.19	0.18		0.61	0.00	0.55	0.13	0.77	0.01	
28/01/2025 20:45:00			0.11		0.20	0.18		0.61	0.00	0.55	0.11	0.77	0.02	
28/01/2025 21:00:00			0.11		0.20	0.18		0.61	0.00	0.56	0.11	0.78	0.01	
28/01/2025 21:15:00			0.12		0.20	0.18		0.61	0.00	0.56	0.09	0.78	0.01	
28/01/2025 21:30:00			0.12		0.20	0.18		0.61	0.00	0.56	0.09	0.78	0.02	
28/01/2025 21:45:00			0.12		0.20	0.18		0.61	0.00	0.57	0.10	0.79	0.02	
28/01/2025 22:00:00			0.13		0.21	0.18		0.61	0.00	0.57	0.10	0.79	0.02	
28/01/2025 22:15:00			0.13		0.21	0.18		0.60	0.00	0.57	0.11	0.79	0.01	
28/01/2025 22:30:00			0.13		0.21	0.19		0.60	0.00	0.58	0.11	0.80	0.02	
28/01/2025 22:45:00			0.13		0.21	0.19		0.60	0.00	0.58	0.10	0.80	0.02	
28/01/2025 23:00:00			0.13		0.21	0.19		0.60	0.00	0.58	0.10	0.80	0.02	
28/01/2025 23:15:00			0.13		0.21	0.19		0.60	0.00	0.58	0.09	0.80	0.02	
28/01/2025 23:30:00			0.14		0.21	0.19		0.60	0.00	0.58	0.10	0.80	0.03	
28/01/2025 23:45:00			0.14		0.21	0.19		0.60	0.00	0.59	0.10	0.81	0.02	
29/01/2025 00:00:00			0.14		0.21	0.19		0.60	0.00	0.59	0.10	0.81	0.02	
29/01/2025 00:15:00			0.14		0.22	0.19		0.60	0.00	0.59	0.11	0.81	0.02	
29/01/2025 00:30:00			0.14		0.22	0.19		0.60	0.00	0.59	0.11	0.81	0.02	
29/01/2025 00:45:00			0.14		0.22	0.19		0.60	0.00	0.59	0.09	0.80	0.03	
29/01/2025 01:00:00			0.14		0.22	0.19		0.60	0.00	0.59	0.09	0.78	0.03	
29/01/2025 01:15:00			0.14		0.22	0.19		0.60	0.00	0.59	0.11	0.76	0.06	
29/01/2025 01:30:00			0.14		0.22	0.19		0.60	0.00	0.59	0.09	0.74	0.08	
29/01/2025 01:45:00			0.14		0.22	0.20		0.60	0.00	0.59	0.10	0.72	0.10	
29/01/2025 02:00:00			0.14		0.22	0.20		0.60	0.00	0.58	0.09	0.70	0.10	
29/01/2025 02:15:00			0.14		0.22	0.20		0.60	0.00	0.58	0.09	0.69	0.10	
29/01/2025 02:30:00			0.14		0.22	0.20		0.60	0.00	0.57	0.11	0.68	0.10	
29/01/2025 02:45:00			0.14		0.22	0.20		0.60	0.00	0.57	0.10	0.67	0.10	
29/01/2025 03:00:00			0.14		0.22	0.20		0.60	0.00	0.57	0.11	0.66	0.09	
29/01/2025 03:15:00			0.14		0.22	0.20		0.60	0.00	0.56	0.11	0.65	0.09	
29/01/2025 03:30:00			0.14		0.22	0.20		0.60	0.00	0.56	0.11	0.64	0.08	
29/01/2025 03:45:00			0.14		0.22	0.20		0.60	0.00	0.55	0.11	0.63	0.08	
29/01/2025 04:00:00			0.14		0.22	0.20		0.60	0.00	0.55	0.12	0.63	0.10	
29/01/2025 04:15:00			0.14		0.22	0.20		0.60	0.00	0.55	0.13	0.62	0.10	
29/01/2025 04:30:00			0.14		0.23	0.20		0.60	0.00	0.54	0.13	0.61	0.09	
29/01/2025 04:45:00			0.14		0.23	0.20		0.60	0.00	0.54	0.13	0.61	0.09	
29/01/2025 05:00:00			0.14		0.23	0.20		0.60	0.00	0.54	0.14	0.60	0.10	
29/01/2025 05:15:00			0.14		0.23	0.20		0.60	0.00	0.53	0.14	0.60	0.09	
29/01/2025 05:30:00			0.14		0.23	0.20		0.60	0.00	0.53	0.12	0.59	0.09	
29/01/2025 05:45:00			0.14		0.23	0.20		0.60	0.00	0.53	0.12	0.59	0.08	
29/01/2025 06:00:00			0.14		0.23	0.20		0.60	0.00	0.53	0.11	0.59	0.09	
29/01/2025 06:15:00			0.14		0.23	0.20		0.60	0.00	0.52	0.13	0.58	0.09	
29/01/2025 06:30:00			0.14		0.23	0.20		0.60	0.00	0.52	0.13	0.59	0.10	
29/01/2025 06:45:00			0.14		0.23	0.20		0.60	0.00	0.52	0.13	0.59	0.09	
29/01/2025 07:00:00			0.14		0.23	0.20		0.60	0.00	0.52	0.12	0.61	0.09	
29/01/2025 07:15:00			0.15		0.23	0.20		0.60	0.00	0.52	0.13	0.65	0.06	
29/01/2025 07:30:00			0.15		0.23	0.20		0.60	0.00	0.51	0.12	0.68	0.05	
29/01/2025 07:45:00			0.14		0.23	0.20		0.60	0.00	0.51	0.14	0.70	0.01	
29/01/2025 08:00:00			0.14		0.23	0.20		0.60	0.00	0.52	0.13	0.72	0.01	
29/01/2025 08:15:00			0.15		0.23	0.20		0.60	0.00	0.52	0.16	0.73	0.00	
29/01/2025 08:30:00			0.15		0.23	0.20		0.60	0.00	0.53	0.13	0.74	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
29/01/2025 08:45:00			0.15		0.23	0.20		0.60	0.00	0.53	0.11	0.75	0.01	
29/01/2025 09:00:00			0.15		0.23	0.20		0.60	0.00	0.54	0.12	0.75	0.01	
29/01/2025 09:15:00			0.15		0.23	0.21		0.60	0.00	0.54	0.12	0.76	0.01	
29/01/2025 09:30:00			0.15		0.23	0.21		0.60	0.00	0.55	0.12	0.77	0.02	
29/01/2025 09:45:00			0.15		0.23	0.21		0.60	0.00	0.55	0.12	0.77	0.01	
29/01/2025 10:00:00			0.15		0.23	0.21		0.60	0.00	0.56	0.12	0.78	0.01	
29/01/2025 10:15:00			0.15		0.23	0.20		0.60	0.00	0.56	0.12	0.78	0.01	
29/01/2025 10:30:00			0.14		0.23	0.20		0.60	0.00	0.57	0.12	0.79	0.01	
29/01/2025 10:45:00			0.14		0.23	0.20		0.59	0.00	0.57	0.11	0.79	0.01	
29/01/2025 11:00:00			0.14		0.23	0.21		0.60	0.00	0.57	0.11	0.79	0.01	
29/01/2025 11:15:00			0.14		0.23	0.21		0.60	0.00	0.58	0.11	0.80	0.01	
29/01/2025 11:30:00			0.14		0.23	0.21		0.60	0.00	0.58	0.11	0.80	0.02	
29/01/2025 11:45:00			0.14		0.23	0.21		0.60	0.00	0.58	0.11	0.80	0.02	
29/01/2025 12:00:00			0.14		0.23	0.21		0.60	0.00	0.58	0.11	0.80	0.01	
29/01/2025 12:15:00			0.14		0.23	0.21		0.60	0.00	0.59	0.11	0.81	0.01	
29/01/2025 12:30:00			0.14		0.23	0.20		0.59	0.00	0.59	0.11	0.81	0.01	
29/01/2025 12:45:00			0.14		0.23	0.20		0.60	0.00	0.59	0.11	0.81	0.01	
29/01/2025 13:00:00			0.14		0.23	0.20		0.59	0.00	0.59	0.11	0.81	0.00	
29/01/2025 13:15:00			0.14		0.23	0.20		0.59	0.00	0.59	0.11	0.81	0.00	
29/01/2025 13:30:00			0.14		0.23	0.20		0.59	0.00	0.60	0.10	0.79	0.02	
29/01/2025 13:45:00			0.14		0.23	0.20		0.59	0.00	0.60	0.10	0.78	0.06	
29/01/2025 14:00:00			0.14		0.23	0.20		0.59	0.00	0.59	0.10	0.76	0.06	
29/01/2025 14:15:00			0.14		0.23	0.20		0.59	0.00	0.59	0.10	0.74	0.07	
29/01/2025 14:30:00			0.14		0.23	0.20		0.59	0.00	0.59	0.10	0.73	0.07	
29/01/2025 14:45:00			0.14		0.23	0.20		0.59	0.00	0.58	0.11	0.71	0.08	
29/01/2025 15:00:00			0.14		0.22	0.20		0.59	0.00	0.58	0.11	0.70	0.08	
29/01/2025 15:15:00			0.14		0.22	0.20		0.59	0.00	0.58	0.12	0.69	0.08	
29/01/2025 15:30:00			0.14		0.22	0.20		0.59	0.00	0.57	0.12	0.68	0.08	
29/01/2025 15:45:00			0.14		0.22	0.20		0.58	0.00	0.57	0.12	0.68	0.10	
29/01/2025 16:00:00			0.14		0.22	0.20		0.58	0.00	0.57	0.12	0.67	0.09	
29/01/2025 16:15:00			0.14		0.22	0.20		0.58	0.00	0.56	0.11	0.66	0.07	
29/01/2025 16:30:00			0.13		0.22	0.20		0.58	0.00	0.56	0.12	0.65	0.06	
29/01/2025 16:45:00			0.13		0.22	0.20		0.58	0.00	0.55	0.12	0.65	0.07	
29/01/2025 17:00:00			0.13		0.22	0.20		0.58	0.00	0.55	0.12	0.64	0.08	
29/01/2025 17:15:00			0.13		0.22	0.20		0.58	0.00	0.55	0.14	0.64	0.08	
29/01/2025 17:30:00			0.13		0.22	0.20		0.58	0.00	0.55	0.13	0.63	0.10	
29/01/2025 17:45:00			0.13		0.22	0.20		0.58	0.00	0.54	0.14	0.63	0.10	
29/01/2025 18:00:00			0.13		0.22	0.20		0.57	0.00	0.54	0.12	0.63	0.08	
29/01/2025 18:15:00			0.13		0.22	0.20		0.57	0.00	0.54	0.13	0.64	0.08	
29/01/2025 18:30:00			0.13		0.22	0.20		0.57	0.00	0.53	0.13	0.66	0.06	
29/01/2025 18:45:00			0.13		0.22	0.19		0.57	0.00	0.53	0.14	0.69	0.04	
29/01/2025 19:00:00			0.13		0.22	0.19		0.57	0.00	0.53	0.13	0.72	0.02	
29/01/2025 19:15:00			0.13		0.22	0.19		0.57	0.00	0.53	0.12	0.74	0.00	
29/01/2025 19:30:00			0.13		0.22	0.19		0.56	0.00	0.54	0.13	0.75	0.00	
29/01/2025 19:45:00			0.13		0.21	0.19		0.56	0.00	0.54	0.13	0.76	0.01	
29/01/2025 20:00:00			0.13		0.21	0.19		0.56	0.00	0.55	0.12	0.77	0.02	
29/01/2025 20:15:00			0.13		0.21	0.19		0.56	0.00	0.55	0.13	0.77	0.01	
29/01/2025 20:30:00			0.12		0.21	0.19		0.56	0.00	0.56	0.13	0.78	0.01	
29/01/2025 20:45:00			0.12		0.21	0.19		0.56	0.00	0.56	0.13	0.79	0.01	
29/01/2025 21:00:00			0.12		0.21	0.19		0.56	0.00	0.57	0.12	0.79	0.02	
29/01/2025 21:15:00			0.12		0.21	0.19		0.56	0.00	0.57	0.12	0.79	0.02	
29/01/2025 21:30:00			0.12		0.21	0.19		0.56	0.00	0.58	0.12	0.80	0.01	
29/01/2025 21:45:00			0.12		0.21	0.19		0.55	0.00	0.58	0.11	0.80	0.01	
29/01/2025 22:00:00			0.12		0.21	0.19		0.55	0.00	0.58	0.11	0.80	0.01	
29/01/2025 22:15:00			0.12		0.21	0.19		0.55	0.00	0.58	0.10	0.81	0.02	
29/01/2025 22:30:00			0.12		0.21	0.19		0.55	0.00	0.59	0.09	0.81	0.01	
29/01/2025 22:45:00			0.12		0.21	0.19		0.55	0.00	0.59	0.09	0.81	0.01	
29/01/2025 23:00:00			0.12		0.21	0.19		0.55	0.00	0.59	0.09	0.81	0.01	
29/01/2025 23:15:00			0.12		0.21	0.19		0.55	0.00	0.59	0.09	0.82	0.01	
29/01/2025 23:30:00			0.12		0.21	0.19		0.54	0.00	0.60	0.09	0.82	0.02	
29/01/2025 23:45:00			0.11		0.20	0.19		0.54	0.00	0.60	0.09	0.82	0.02	
30/01/2025 00:00:00			0.11		0.20	0.19		0.54	0.00	0.60	0.09	0.82	0.01	
30/01/2025 00:15:00			0.11		0.20	0.18		0.54	0.00	0.60	0.09	0.83	0.01	
30/01/2025 00:30:00			0.11		0.20	0.18		0.53	0.00	0.60	0.09	0.83	0.02	
30/01/2025 00:45:00			0.11		0.20	0.18		0.53	0.00	0.61	0.09	0.83	0.02	
30/01/2025 01:00:00			0.11		0.20	0.18		0.53	0.00	0.61	0.09	0.84	0.02	
30/01/2025 01:15:00			0.11		0.20	0.18		0.52	0.00	0.61	0.09	0.84	0.02	
30/01/2025 01:30:00			0.11		0.20	0.18		0.52	0.00	0.61	0.09	0.84	0.00	
30/01/2025 01:45:00			0.11		0.20	0.18		0.52	0.00	0.61	0.09	0.84	0.01	
30/01/2025 02:00:00			0.11		0.20	0.18		0.52	0.00	0.62	0.09	0.82	0.03	
30/01/2025 02:15:00			0.11		0.20	0.18		0.51	0.00	0.62	0.09	0.80	0.04	
30/01/2025 02:30:00			0.10		0.20	0.18		0.51	0.00	0.61	0.09	0.79	0.07	
30/01/2025 02:45:00			0.10		0.20	0.18		0.51	0.00	0.61	0.09	0.77	0.08	
30/01/2025 03:00:00			0.10		0.19	0.18		0.50	0.00	0.61	0.10	0.76	0.08	
30/01/2025 03:15:00			0.10		0.19	0.18		0.50	0.00	0.60	0.11	0.74	0.10	
30/01/2025 03:30:00			0.10		0.19	0.18		0.50	0.00	0.60	0.11	0.73	0.10	
30/01/2025 03:45:00			0.10		0.19	0.18		0.50	0.00	0.59	0.12	0.72	0.09	
30/01/2025 04:00:00			0.09		0.19	0.17		0.50	0.00	0.59	0.10	0.71	0.07	
30/01/2025 04:15:00			0.09		0.19	0.17		0.49	0.00	0.58	0.11	0.70	0.08	
30/01/2025 04:30:00			0.09		0.19	0.17		0.49	0.00	0.58	0.12	0.69	0.09	
30/01/2025 04:45:00			0.09		0.19	0.17		0.49	0.00	0.58	0.12	0.68	0.09	
30/01/2025 05:00:00			0.09		0.19	0.17		0.49	0.00	0.57	0.12	0.67	0.07	
30/01/2025 05:15:00			0.09		0.18	0.17		0.49	0.00	0.57	0.11	0.67	0.08	
30/01/2025 05:30:00			0.08		0.18	0.17		0.48	0.00	0.56	0.11	0.66	0.08	
30/01/2025 05:45:00			0.08		0.18	0.17		0.48	0.00	0.56	0.12	0.65	0.09	
30/01/2025 06:00:00			0.08		0.18	0.17		0.48	0.00	0.56	0.12	0.65	0.10	
30/01/2025 06:15:00			0.08		0.18	0.17		0.48	0.00	0.55	0.13	0.64	0.08	
30/01/2025 06:30:00			0.08		0.18	0.16		0.48	0.00	0.55	0.13	0.64	0.10	
30/01/2025 06:45:00			0.08		0.18	0.16		0.48	0.00	0.54	0.13	0.63	0.08	
30/01/2025 07:00:00			0.07		0.18	0.16		0.48	0.00	0.54	0.14	0.63	0.08	
30/01/2025 07:15:00			0.07		0.17	0.16		0.48	0.00	0.54	0.12	0.64	0.08	
30/01/2025 07:30:00			0.07		0.17	0.16		0.48	0.00	0.54	0.13	0.66	0.06	
30/01/2025 07:45:00			0.07		0.17	0.16		0.48	0.00	0.53	0.13	0.69	0.06	
30/01/2025 08:00:00			0.07		0.17	0.16		0.48	0.00	0.53	0.11	0.73	0.01	
30/01/2025 08:15:00			0.07		0.17	0.16		0.48	0.00	0.53	0.11	0.74	0.01	
30/01/2025 08:30:00			0.07		0.17	0.16		0.48	0.00	0.54	0.11	0.76	0.01	
30/01/2025 08:45:00			0.06		0.17	0.16		0.48	0.00	0.54	0.09	0.77	0.01	
30/01/2025 09:00:00			0.06		0.17	0.15		0.48	0.00	0.55	0.09	0.77	0.00	
30/01/2025 09:15:00			0.06		0.17	0.15		0.48	0.00	0.55	0.11	0.78	0.00	
30/01/2025 09:30:00			0.06		0.17	0.15		0.48	0.00	0.56	0.11	0.78	0.03	
30/01/2025 09:45:00			0.06		0.17	0.15		0.49	0.00	0.56	0.12	0.79	0.01	
30/01/2025 10:00:00			0.06		0.16	0.15		0.49	0.00	0.57	0.10	0.79	0.02	
30/01/2025 10:15:00			0.06		0.16	0.15		0.49	0.00	0.57	0.09	0.80	0.01	
30/01/2025 10:30:00			0.05		0.16	0.15		0.49	0.00	0.58	0.09	0.80	0.01	
30/01/2025 10:45:00			0.05		0.16	0.15		0.49	0.00	0.58	0.10	0.80	0.01	
30/01/2025 11:00:00			0.05		0.16	0.15		0.49	0.00	0.58	0.10	0.81	0.01	
30/01/2025 11:15:00			0.06		0.16	0.15		0.49	0.00	0.58	0.10	0.81	0.00	
30/01/2025 11:30:00			0.05		0.16	0.15		0.49	0.00	0.59	0.09	0.81	0.00	
30/01/2025 11:45:00			0.05		0.16	0.15		0.49	0.00	0.59	0.09	0.82	0.01	
30/01/2025 12:00:00			0.05		0.16	0.15		0.49	0.00	0.59	0.10	0.82	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
30/01/2025 12:15:00			0.05		0.16	0.15		0.49	0.00	0.59	0.09	0.82	0.01	
30/01/2025 12:30:00			0.05		0.16	0.15		0.49	0.00	0.59	0.09	0.82	0.01	
30/01/2025 12:45:00			0.05		0.16	0.15		0.49	0.00	0.60	0.09	0.83	0.02	
30/01/2025 13:00:00			0.05		0.16	0.15		0.49	0.00	0.60	0.08	0.83	0.02	
30/01/2025 13:15:00			0.05		0.16	0.15		0.49	0.00	0.60	0.09	0.83	0.00	
30/01/2025 13:30:00			0.05		0.16	0.15		0.49	0.00	0.60	0.09	0.83	0.01	
30/01/2025 13:45:00			0.05		0.16	0.15		0.49	0.00	0.60	0.08	0.84	0.00	
30/01/2025 14:00:00			0.05		0.16	0.15		0.49	0.00	0.61	0.07	0.84	0.00	
30/01/2025 14:15:00			0.05		0.16	0.15		0.49	0.00	0.61	0.07	0.83	0.01	
30/01/2025 14:30:00			0.05		0.16	0.15		0.49	0.00	0.61	0.10	0.82	0.02	
30/01/2025 14:45:00			0.05		0.16	0.15		0.49	0.00	0.61	0.09	0.80	0.03	
30/01/2025 15:00:00			0.05		0.16	0.15		0.49	0.00	0.60	0.10	0.78	0.03	
30/01/2025 15:15:00			0.05		0.16	0.15		0.49	0.00	0.60	0.10	0.77	0.05	
30/01/2025 15:30:00			0.05		0.16	0.14		0.49	0.00	0.60	0.10	0.75	0.09	
30/01/2025 15:45:00			0.05		0.16	0.14		0.49	0.00	0.59	0.09	0.74	0.07	
30/01/2025 16:00:00			0.05		0.16	0.14		0.49	0.00	0.59	0.09	0.72	0.07	
30/01/2025 16:15:00			0.05		0.16	0.14		0.49	0.00	0.58	0.09	0.71	0.07	
30/01/2025 16:30:00			0.05		0.16	0.14		0.49	0.00	0.58	0.09	0.70	0.07	
30/01/2025 16:45:00			0.05		0.16	0.14		0.49	0.00	0.57	0.10	0.69	0.08	
30/01/2025 17:00:00			0.05		0.16	0.14		0.49	0.00	0.57	0.10	0.68	0.08	
30/01/2025 17:15:00			0.05		0.16	0.14		0.49	0.00	0.57	0.11	0.67	0.06	
30/01/2025 17:30:00			0.05		0.16	0.14		0.48	0.00	0.56	0.11	0.66	0.08	
30/01/2025 17:45:00			0.05		0.16	0.14		0.48	0.00	0.56	0.10	0.66	0.08	
30/01/2025 18:00:00			0.05		0.16	0.14		0.48	0.00	0.55	0.11	0.65	0.10	
30/01/2025 18:15:00			0.05		0.15	0.14		0.48	0.00	0.55	0.11	0.64	0.10	
30/01/2025 18:30:00			0.05		0.15	0.14		0.49	0.00	0.54	0.11	0.64	0.10	
30/01/2025 18:45:00			0.05		0.15	0.14		0.49	0.00	0.54	0.11	0.64	0.09	
30/01/2025 19:00:00			0.05		0.15	0.14		0.49	0.00	0.54	0.11	0.66	0.08	
30/01/2025 19:15:00			0.05		0.15	0.14		0.49	0.00	0.53	0.12	0.69	0.05	
30/01/2025 19:30:00			0.05		0.15	0.14		0.49	0.00	0.53	0.12	0.73	0.05	
30/01/2025 19:45:00			0.05		0.15	0.14		0.49	0.00	0.53	0.12	0.74	0.04	
30/01/2025 20:00:00			0.05		0.15	0.14		0.49	0.00	0.53	0.12	0.76	0.00	
30/01/2025 20:15:00			0.05		0.15	0.14		0.49	0.00	0.54	0.12	0.77	0.00	
30/01/2025 20:30:00			0.05		0.15	0.14		0.49	0.00	0.55	0.12	0.77	0.01	
30/01/2025 20:45:00			0.04		0.15	0.14		0.49	0.00	0.55	0.10	0.78	0.01	
30/01/2025 21:00:00			0.05		0.15	0.14		0.49	0.00	0.56	0.10	0.78	0.01	
30/01/2025 21:15:00			0.05		0.15	0.14		0.49	0.00	0.56	0.09	0.79	0.01	
30/01/2025 21:30:00			0.05		0.15	0.14		0.49	0.00	0.56	0.09	0.79	0.01	
30/01/2025 21:45:00			0.05		0.15	0.14		0.49	0.00	0.57	0.08	0.80	0.01	
30/01/2025 22:00:00			0.05		0.15	0.14		0.49	0.00	0.57	0.08	0.80	0.01	
30/01/2025 22:15:00			0.05		0.15	0.14		0.49	0.00	0.57	0.08	0.80	0.00	
30/01/2025 22:30:00			0.05		0.15	0.14		0.49	0.00	0.58	0.07	0.81	0.00	
30/01/2025 22:45:00			0.05		0.15	0.14		0.49	0.00	0.58	0.07	0.81	0.01	
30/01/2025 23:00:00			0.05		0.15	0.14		0.49	0.00	0.58	0.07	0.81	0.00	
30/01/2025 23:15:00			0.05		0.15	0.14		0.49	0.00	0.58	0.07	0.81	0.01	
30/01/2025 23:30:00			0.05		0.16	0.14		0.49	0.00	0.59	0.06	0.82	0.01	
30/01/2025 23:45:00			0.05		0.16	0.14		0.49	0.00	0.59	0.06	0.82	0.01	
31/01/2025 00:00:00			0.05		0.16	0.14		0.48	0.00	0.59	0.06	0.82	0.01	
31/01/2025 00:15:00			0.05		0.16	0.14		0.48	0.00	0.59	0.07	0.82	0.02	
31/01/2025 00:30:00			0.05		0.16	0.14		0.48	0.00	0.59	0.06	0.83	0.01	
31/01/2025 00:45:00			0.05		0.16	0.14		0.48	0.00	0.60	0.06	0.83	0.01	
31/01/2025 01:00:00			0.05		0.16	0.14		0.48	0.00	0.60	0.06	0.83	0.01	
31/01/2025 01:15:00			0.05		0.16	0.14		0.48	0.00	0.60	0.06	0.83	0.00	
31/01/2025 01:30:00			0.05		0.16	0.14		0.47	0.00	0.60	0.06	0.83	0.01	
31/01/2025 01:45:00			0.05		0.15	0.14		0.47	0.00	0.60	0.06	0.84	0.01	
31/01/2025 02:00:00			0.05		0.15	0.14		0.47	0.00	0.60	0.06	0.82	0.01	
31/01/2025 02:15:00			0.05		0.15	0.14		0.47	0.00	0.60	0.05	0.81	0.01	
31/01/2025 02:30:00			0.05		0.15	0.14		0.47	0.00	0.60	0.05	0.79	0.06	
31/01/2025 02:45:00			0.05		0.15	0.14		0.47	0.00	0.60	0.05	0.77	0.05	
31/01/2025 03:00:00			0.05		0.15	0.14		0.47	0.00	0.59	0.06	0.75	0.05	
31/01/2025 03:15:00			0.04		0.15	0.14		0.46	0.00	0.59	0.06	0.73	0.09	
31/01/2025 03:30:00			0.04		0.15	0.14		0.46	0.00	0.58	0.08	0.72	0.09	
31/01/2025 03:45:00			0.04		0.15	0.14		0.46	0.00	0.58	0.08	0.71	0.09	
31/01/2025 04:00:00			0.04		0.15	0.14		0.46	0.00	0.57	0.08	0.70	0.07	
31/01/2025 04:15:00			0.04		0.15	0.14		0.46	0.00	0.57	0.08	0.69	0.08	
31/01/2025 04:30:00			0.04		0.15	0.14		0.46	0.00	0.56	0.08	0.68	0.07	
31/01/2025 04:45:00			0.04		0.15	0.14		0.46	0.00	0.56	0.08	0.67	0.07	
31/01/2025 05:00:00			0.04		0.15	0.14		0.46	0.00	0.55	0.09	0.66	0.09	
31/01/2025 05:15:00			0.04		0.15	0.14		0.46	0.00	0.55	0.09	0.65	0.10	
31/01/2025 05:30:00			0.04		0.15	0.13		0.46	0.00	0.54	0.10	0.64	0.09	
31/01/2025 05:45:00			0.04		0.15	0.13		0.45	0.00	0.54	0.10	0.64	0.11	
31/01/2025 06:00:00			0.04		0.15	0.13		0.45	0.00	0.53	0.11	0.63	0.10	
31/01/2025 06:15:00			0.04		0.15	0.13		0.45	0.00	0.53	0.11	0.62	0.10	
31/01/2025 06:30:00			0.03		0.15	0.13		0.45	0.00	0.53	0.11	0.61	0.10	
31/01/2025 06:45:00			0.03		0.15	0.13		0.45	0.00	0.52	0.12	0.61	0.08	
31/01/2025 07:00:00			0.03		0.15	0.13		0.45	0.00	0.52	0.11	0.60	0.09	
31/01/2025 07:15:00			0.03		0.15	0.13		0.45	0.00	0.51	0.11	0.60	0.10	
31/01/2025 07:30:00			0.03		0.14	0.13		0.45	0.00	0.51	0.12	0.59	0.06	
31/01/2025 07:45:00			0.03		0.14	0.13		0.46	0.00	0.51	0.11	0.59	0.09	
31/01/2025 08:00:00			0.03		0.14	0.13		0.46	0.00	0.50	0.11	0.58	0.08	
31/01/2025 08:15:00			0.03		0.14	0.13		0.46	0.00	0.50	0.11	0.58	0.08	
31/01/2025 08:30:00			0.03		0.14	0.13		0.47	0.00	0.50	0.11	0.58	0.09	
31/01/2025 08:45:00			0.03		0.14	0.13		0.47	0.00	0.49	0.11	0.59	0.08	
31/01/2025 09:00:00			0.03		0.14	0.13		0.47	0.00	0.49	0.10	0.61	0.07	
31/01/2025 09:15:00			0.03		0.14	0.13		0.47	0.00	0.49	0.09	0.66	0.07	
31/01/2025 09:30:00			0.03		0.14	0.13		0.47	0.00	0.49	0.12	0.69	0.01	
31/01/2025 09:45:00			0.03		0.14	0.13		0.48	0.00	0.49	0.10	0.70	0.00	
31/01/2025 10:00:00			0.03		0.14	0.13		0.48	0.00	0.49	0.10	0.72	0.00	
31/01/2025 10:15:00			0.03		0.14	0.13		0.48	0.00	0.50	0.10	0.73	0.01	
31/01/2025 10:30:00			0.03		0.14	0.13		0.48	0.00	0.51	0.07	0.74	0.01	
31/01/2025 10:45:00			0.03		0.14	0.13		0.48	0.00	0.52	0.07	0.75	0.01	
31/01/2025 11:00:00			0.03		0.14	0.13		0.48	0.00	0.52	0.05	0.75	0.01	
31/01/2025 11:15:00			0.03		0.14	0.13		0.48	0.00	0.53	0.05	0.76	0.01	
31/01/2025 11:30:00			0.03		0.14	0.13		0.48	0.00	0.53	0.06	0.77	0.01	
31/01/2025 11:45:00			0.03		0.15	0.13		0.49	0.00	0.54	0.04	0.77	0.01	
31/01/2025 12:00:00			0.03		0.15	0.13		0.49	0.00	0.54	0.05	0.78	0.01	
31/01/2025 12:15:00			0.03		0.15	0.13		0.50	0.00	0.55	0.05	0.78	0.01	
31/01/2025 12:30:00			0.03		0.15	0.13		0.51	0.00	0.55	0.03	0.78	0.01	
31/01/2025 12:45:00			0.04		0.15	0.13		0.51	0.00	0.55	0.01	0.79	0.01	
31/01/2025 13:00:00			0.04		0.15	0.13		0.52	0.00	0.56	0.01	0.79	0.02	
31/01/2025 13:15:00			0.04		0.15	0.14		0.51	0.00	0.56	0.02	0.79	0.02	
31/01/2025 13:30:00			0.04		0.15	0.14		0.51	0.00	0.56	0.02	0.79	0.00	
31/01/2025 13:45:00			0.04		0.15	0.14		0.51	0.00	0.57	0.02	0.80	0.03	
31/01/2025 14:00:00			0.04		0.15	0.14		0.51	0.00	0.57	0.02	0.80	0.01	
31/01/2025 14:15:00			0.05		0.15	0.14		0.51	0.00	0.57	0.02	0.80	0.02	
31/01/2025 14:30:00			0.05		0.15	0.14		0.50	0.00	0.57	0.02	0.79	0.02	
31/01/2025 14:45:00			0.05		0.16	0.14		0.50	0.00	0.57	0.03	0.77	0.04	
31/01/2025 15:00:00			0.05		0.16	0.14		0.50	0.00	0.57	0.04	0.74	0.05	
31/01/2025 15:15:00			0.05		0.16	0.14		0.50	0.00	0.57	0.04	0.72	0.05	
31/01/2025 15:30:00			0.05		0.16	0.14		0.49	0.00	0.56	0.03	0.71	0.07	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
31/01/2025 15:45:00			0.05		0.16	0.14		0.49	0.00	0.56	0.04	0.69	0.08	
31/01/2025 16:00:00			0.06		0.16	0.14		0.49	0.00	0.55	0.04	0.68	0.08	
31/01/2025 16:15:00			0.05		0.16	0.14		0.49	0.00	0.55	0.08	0.66	0.09	
31/01/2025 16:30:00			0.05		0.16	0.14		0.49	0.00	0.54	0.08	0.65	0.07	
31/01/2025 16:45:00			0.06		0.16	0.14		0.49	0.00	0.54	0.09	0.64	0.07	
31/01/2025 17:00:00			0.05		0.16	0.14		0.49	0.00	0.53	0.09	0.63	0.07	
31/01/2025 17:15:00			0.05		0.16	0.14		0.48	0.00	0.53	0.10	0.62	0.08	
31/01/2025 17:30:00			0.05		0.16	0.14		0.48	0.00	0.52	0.10	0.61	0.08	
31/01/2025 17:45:00			0.05		0.16	0.14		0.48	0.00	0.52	0.10	0.61	0.09	
31/01/2025 18:00:00			0.05		0.16	0.14		0.48	0.00	0.51	0.10	0.60	0.08	
31/01/2025 18:15:00			0.05		0.16	0.14		0.48	0.00	0.51	0.10	0.59	0.08	
31/01/2025 18:30:00			0.05		0.16	0.14		0.48	0.00	0.51	0.11	0.59	0.07	
31/01/2025 18:45:00			0.05		0.16	0.14		0.48	0.00	0.50	0.11	0.58	0.07	
31/01/2025 19:00:00			0.05		0.16	0.14		0.48	0.00	0.50	0.10	0.57	0.09	
31/01/2025 19:15:00			0.05		0.16	0.14		0.48	0.00	0.49	0.12	0.57	0.09	
31/01/2025 19:30:00			0.05		0.16	0.14		0.49	0.00	0.49	0.12	0.57	0.09	
31/01/2025 19:45:00			0.05		0.15	0.14		0.49	0.00	0.49	0.11	0.58	0.06	
31/01/2025 20:00:00			0.05		0.15	0.14		0.49	0.00	0.48	0.11	0.59	0.06	
31/01/2025 20:15:00			0.05		0.15	0.14		0.49	0.00	0.48	0.11	0.63	0.04	
31/01/2025 20:30:00			0.05		0.15	0.14		0.49	0.00	0.48	0.11	0.66	0.04	
31/01/2025 20:45:00			0.05		0.15	0.14		0.49	0.00	0.48	0.12	0.69	0.01	
31/01/2025 21:00:00			0.05		0.15	0.14		0.49	0.00	0.48	0.11	0.70	0.00	
31/01/2025 21:15:00			0.05		0.15	0.14		0.49	0.00	0.49	0.12	0.71	0.00	
31/01/2025 21:30:00			0.05		0.15	0.14		0.49	0.00	0.49	0.12	0.72	0.00	
31/01/2025 21:45:00			0.05		0.15	0.14		0.49	0.00	0.50	0.11	0.73	0.00	
31/01/2025 22:00:00			0.05		0.15	0.14		0.48	0.00	0.51	0.09	0.74	0.01	
31/01/2025 22:15:00			0.05		0.15	0.14		0.48	0.00	0.51	0.08	0.75	0.01	
31/01/2025 22:30:00			0.05		0.15	0.14		0.49	0.00	0.52	0.08	0.75	0.01	
31/01/2025 22:45:00			0.05		0.15	0.14		0.49	0.00	0.52	0.08	0.76	0.01	
31/01/2025 23:00:00			0.05		0.15	0.14		0.49	0.00	0.53	0.07	0.76	0.01	
31/01/2025 23:15:00			0.05		0.15	0.14		0.49	0.00	0.53	0.07	0.76	0.01	
31/01/2025 23:30:00			0.05		0.15	0.14		0.49	0.00	0.54	0.07	0.77	0.00	
31/01/2025 23:45:00			0.05		0.15	0.14		0.48	0.00	0.54	0.06	0.77	0.02	
01/02/2025 00:00:00			0.05		0.15	0.14		0.48	0.00	0.54	0.06	0.77	0.02	
01/02/2025 00:15:00			0.05		0.15	0.14		0.48	0.00	0.55	0.06	0.78	0.02	
01/02/2025 00:30:00			0.05		0.15	0.14		0.48	0.00	0.55	0.06	0.78	0.02	
01/02/2025 00:45:00			0.05		0.15	0.14		0.48	0.00	0.55	0.06	0.78	0.01	
01/02/2025 01:00:00			0.05		0.15	0.14		0.48	0.00	0.55	0.06	0.78	0.01	
01/02/2025 01:15:00			0.05		0.15	0.14		0.47	0.00	0.56	0.05	0.78	0.00	
01/02/2025 01:30:00			0.05		0.15	0.14		0.47	0.00	0.56	0.05	0.79	0.01	
01/02/2025 01:45:00			0.05		0.15	0.14		0.47	0.00	0.56	0.05	0.79	0.00	
01/02/2025 02:00:00			0.05		0.15	0.14		0.47	0.00	0.56	0.05	0.79	0.01	
01/02/2025 02:15:00			0.05		0.15	0.14		0.47	0.00	0.56	0.05	0.79	0.02	
01/02/2025 02:30:00			0.05		0.15	0.14		0.47	0.00	0.56	0.05	0.78	0.01	
01/02/2025 02:45:00			0.05		0.15	0.14		0.47	0.00	0.56	0.04	0.76	0.01	
01/02/2025 03:00:00			0.04		0.15	0.14		0.47	0.00	0.56	0.04	0.73	0.07	
01/02/2025 03:15:00			0.05		0.15	0.14		0.46	0.00	0.56	0.04	0.71	0.09	
01/02/2025 03:30:00			0.04		0.15	0.14		0.46	0.00	0.55	0.05	0.69	0.09	
01/02/2025 03:45:00			0.04		0.15	0.13		0.46	0.00	0.55	0.06	0.67	0.10	
01/02/2025 04:00:00			0.04		0.15	0.13		0.46	0.00	0.54	0.06	0.66	0.09	
01/02/2025 04:15:00			0.04		0.15	0.13		0.46	0.00	0.54	0.08	0.65	0.09	
01/02/2025 04:30:00			0.04		0.15	0.13		0.46	0.00	0.53	0.09	0.63	0.08	
01/02/2025 04:45:00			0.04		0.14	0.13		0.46	0.00	0.53	0.10	0.62	0.08	
01/02/2025 05:00:00			0.04		0.14	0.13		0.46	0.00	0.52	0.09	0.61	0.08	
01/02/2025 05:15:00			0.04		0.14	0.13		0.46	0.00	0.51	0.10	0.60	0.08	
01/02/2025 05:30:00			0.04		0.14	0.13		0.45	0.00	0.51	0.10	0.60	0.12	
01/02/2025 05:45:00			0.04		0.14	0.13		0.45	0.00	0.50	0.10	0.59	0.08	
01/02/2025 06:00:00			0.04		0.14	0.13		0.45	0.00	0.50	0.10	0.58	0.09	
01/02/2025 06:15:00			0.03		0.14	0.13		0.45	0.00	0.50	0.10	0.57	0.09	
01/02/2025 06:30:00			0.03		0.14	0.13		0.45	0.00	0.49	0.11	0.57	0.07	
01/02/2025 06:45:00			0.03		0.14	0.13		0.45	0.00	0.49	0.11	0.56	0.07	
01/02/2025 07:00:00			0.03		0.14	0.13		0.45	0.00	0.48	0.11	0.55	0.07	
01/02/2025 07:15:00			0.03		0.14	0.13		0.45	0.00	0.48	0.12	0.55	0.10	
01/02/2025 07:30:00			0.03		0.14	0.13		0.45	0.00	0.48	0.11	0.54	0.09	
01/02/2025 07:45:00			0.03		0.14	0.13		0.45	0.00	0.47	0.11	0.54	0.09	
01/02/2025 08:00:00			0.03		0.14	0.13		0.45	0.00	0.47	0.11	0.53	0.09	
01/02/2025 08:15:00			0.03		0.14	0.13		0.45	0.00	0.47	0.11	0.53	0.09	
01/02/2025 08:30:00			0.03		0.14	0.13		0.45	0.00	0.46	0.11	0.52	0.09	
01/02/2025 08:45:00			0.03		0.14	0.13		0.45	0.00	0.46	0.10	0.52	0.10	
01/02/2025 09:00:00			0.03		0.14	0.13		0.45	0.00	0.46	0.10	0.52	0.10	
01/02/2025 09:15:00			0.02		0.14	0.13		0.46	0.00	0.45	0.10	0.51	0.09	
01/02/2025 09:30:00			0.02		0.14	0.12		0.46	0.00	0.45	0.11	0.52	0.09	
01/02/2025 09:45:00			0.02		0.14	0.12		0.46	0.00	0.45	0.11	0.53	0.09	
01/02/2025 10:00:00			0.02		0.14	0.12		0.47	0.00	0.45	0.11	0.56	0.04	
01/02/2025 10:15:00			0.02		0.14	0.12		0.47	0.00	0.45	0.10	0.60	0.04	
01/02/2025 10:30:00			0.02		0.14	0.12		0.47	0.00	0.44	0.11	0.63	0.00	
01/02/2025 10:45:00			0.02		0.14	0.12		0.47	0.00	0.44	0.10	0.64	0.00	
01/02/2025 11:00:00			0.02		0.14	0.12		0.48	0.00	0.45	0.10	0.66	0.01	
01/02/2025 11:15:00			0.02		0.14	0.12		0.48	0.00	0.45	0.10	0.67	0.00	
01/02/2025 11:30:00			0.02		0.14	0.12		0.48	0.00	0.46	0.10	0.68	0.00	
01/02/2025 11:45:00			0.02		0.14	0.12		0.48	0.00	0.46	0.09	0.69	0.00	
01/02/2025 12:00:00			0.03		0.14	0.12		0.48	0.00	0.47	0.08	0.70	0.00	
01/02/2025 12:15:00			0.03		0.14	0.12		0.49	0.00	0.48	0.08	0.70	0.02	
01/02/2025 12:30:00			0.03		0.14	0.13		0.49	0.00	0.48	0.06	0.71	0.00	
01/02/2025 12:45:00			0.03		0.14	0.13		0.49	0.00	0.49	0.06	0.72	0.02	
01/02/2025 13:00:00			0.03		0.14	0.13		0.49	0.00	0.49	0.04	0.72	0.00	
01/02/2025 13:15:00			0.03		0.14	0.13		0.49	0.00	0.50	0.05	0.73	0.00	
01/02/2025 13:30:00			0.03		0.14	0.13		0.49	0.00	0.50	0.08	0.73	0.00	
01/02/2025 13:45:00			0.03		0.14	0.13		0.49	0.00	0.51	0.03	0.74	0.00	
01/02/2025 14:00:00			0.03		0.14	0.13		0.49	0.00	0.51	0.06	0.74	0.00	
01/02/2025 14:15:00			0.03		0.14	0.13		0.49	0.00	0.51	0.06	0.75	0.02	
01/02/2025 14:30:00			0.03		0.14	0.13		0.49	0.00	0.52	0.06	0.75	0.02	
01/02/2025 14:45:00			0.04		0.14	0.13		0.49	0.00	0.52	0.02	0.74	0.01	
01/02/2025 15:00:00			0.04		0.14	0.13		0.49	0.00	0.52	0.05	0.72	0.01	
01/02/2025 15:15:00			0.04		0.14	0.13		0.49	0.00	0.52	0.04	0.69	0.05	
01/02/2025 15:30:00			0.04		0.14	0.13		0.49	0.00	0.52	0.04	0.67	0.06	
01/02/2025 15:45:00			0.04		0.14	0.13		0.49	0.00	0.52	0.03	0.64	0.06	
01/02/2025 16:00:00			0.04		0.14	0.13		0.49	0.00	0.51	0.05	0.63	0.08	
01/02/2025 16:15:00			0.04		0.15	0.13		0.49	0.00	0.51	0.05	0.61	0.08	
01/02/2025 16:30:00			0.04		0.15	0.13		0.49	0.00	0.50	0.06	0.60	0.09	
01/02/2025 16:45:00			0.04		0.14	0.13		0.49	0.00	0.50	0.10	0.59	0.09	
01/02/2025 17:00:00			0.04		0.14	0.13		0.49	0.00	0.49	0.10	0.57	0.09	
01/02/2025 17:15:00			0.04		0.14	0.13		0.49	0.00	0.49	0.10	0.57	0.08	
01/02/2025 17:30:00			0.04		0.15	0.13		0.49	0.00	0.48	0.11	0.56	0.09	
01/02/2025 17:45:00			0.04		0.15	0.13		0.49	0.00	0.48	0.11	0.55	0.09	
01/02/2025 18:00:00			0.04		0.15	0.13		0.49	0.00	0.47	0.11	0.54	0.09	
01/02/2025 18:15:00			0.04		0.15	0.13		0.49	0.00	0.47	0.10	0.53	0.09	
01/02/2025 18:30:00			0.04		0.15	0.13		0.49	0.00	0.46	0.11	0.53	0.08	
01/02/2025 18:45:00			0.04		0.15	0.13		0.49	0.00	0.46	0.11	0.52	0.10	
01/02/2025 19:00:00			0.04		0.15	0.13		0.49	0.00	0.46	0.10	0.51	0.08	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
01/02/2025 19:15:00			0.04		0.15	0.13		0.49	0.00	0.45	0.10	0.51	0.08	
01/02/2025 19:30:00			0.04		0.15	0.13		0.49	0.00	0.45	0.11	0.50	0.10	
01/02/2025 19:45:00			0.04		0.15	0.13		0.49	0.00	0.45	0.11	0.50	0.09	
01/02/2025 20:00:00			0.04		0.15	0.13		0.49	0.00	0.44	0.12	0.49	0.08	
01/02/2025 20:15:00			0.04		0.15	0.13		0.49	0.00	0.44	0.11	0.49	0.10	
01/02/2025 20:30:00			0.04		0.15	0.13		0.49	0.00	0.44	0.10	0.49	0.09	
01/02/2025 20:45:00			0.04		0.15	0.13		0.49	0.00	0.44	0.10	0.49	0.09	
01/02/2025 21:00:00			0.04		0.15	0.13		0.49	0.00	0.43	0.09	0.51	0.06	
01/02/2025 21:15:00			0.04		0.15	0.13		0.49	0.00	0.43	0.09	0.54	0.05	
01/02/2025 21:30:00			0.04		0.15	0.13		0.49	0.00	0.43	0.09	0.58	0.02	
01/02/2025 21:45:00			0.04		0.15	0.13		0.49	0.00	0.43	0.09	0.60	0.00	
01/02/2025 22:00:00			0.04		0.15	0.13		0.49	0.00	0.43	0.09	0.61	0.00	
01/02/2025 22:15:00			0.04		0.15	0.13		0.49	0.00	0.43	0.08	0.63	0.00	
01/02/2025 22:30:00			0.04		0.15	0.13		0.49	0.00	0.43	0.09	0.64	0.00	
01/02/2025 22:45:00			0.04		0.15	0.13		0.49	0.00	0.44	0.08	0.65	0.00	
01/02/2025 23:00:00			0.04		0.15	0.13		0.48	0.00	0.44	0.08	0.66	0.00	
01/02/2025 23:15:00			0.04		0.15	0.13		0.48	0.00	0.45	0.08	0.66	0.00	
01/02/2025 23:30:00			0.04		0.15	0.13		0.48	0.00	0.45	0.06	0.67	0.00	
01/02/2025 23:45:00			0.04		0.15	0.13		0.48	0.00	0.46	0.06	0.68	0.00	
02/02/2025 00:00:00			0.04		0.15	0.13		0.48	0.00	0.46	0.06	0.69	0.01	
02/02/2025 00:15:00			0.04		0.15	0.13		0.48	0.00	0.47	0.04	0.69	0.01	
02/02/2025 00:30:00			0.04		0.15	0.13		0.48	0.00	0.47	0.04	0.70	0.02	
02/02/2025 00:45:00			0.04		0.15	0.13		0.48	0.00	0.48	0.04	0.70	0.02	
02/02/2025 01:00:00			0.04		0.15	0.13		0.48	0.00	0.48	0.04	0.71	0.01	
02/02/2025 01:15:00			0.04		0.14	0.13		0.48	0.00	0.49	0.04	0.71	0.01	
02/02/2025 01:30:00			0.04		0.14	0.13		0.48	0.00	0.49	0.04	0.72	0.01	
02/02/2025 01:45:00			0.04		0.14	0.13		0.48	0.00	0.49	0.04	0.72	0.02	
02/02/2025 02:00:00			0.04		0.14	0.13		0.47	0.00	0.50	0.04	0.73	0.02	
02/02/2025 02:15:00			0.04		0.14	0.13		0.47	0.00	0.50	0.05	0.73	0.00	
02/02/2025 02:30:00			0.04		0.14	0.13		0.47	0.00	0.50	0.06	0.73	0.00	
02/02/2025 02:45:00			0.04		0.14	0.13		0.47	0.00	0.51	0.07	0.74	0.00	
02/02/2025 03:00:00			0.04		0.14	0.13		0.47	0.00	0.51	0.07	0.72	0.06	
02/02/2025 03:15:00			0.04		0.14	0.13		0.47	0.00	0.51	0.07	0.69	0.06	
02/02/2025 03:30:00			0.04		0.14	0.13		0.47	0.00	0.51	0.06	0.66	0.05	
02/02/2025 03:45:00			0.04		0.14	0.13		0.46	0.00	0.51	0.06	0.63	0.07	
02/02/2025 04:00:00			0.04		0.14	0.13		0.46	0.00	0.50	0.07	0.61	0.10	
02/02/2025 04:15:00			0.04		0.14	0.13		0.46	0.00	0.50	0.07	0.60	0.10	
02/02/2025 04:30:00			0.03		0.14	0.13		0.46	0.00	0.49	0.07	0.58	0.09	
02/02/2025 04:45:00			0.03		0.14	0.13		0.46	0.00	0.49	0.08	0.57	0.10	
02/02/2025 05:00:00			0.03		0.14	0.13		0.46	0.00	0.48	0.08	0.56	0.10	
02/02/2025 05:15:00			0.03		0.14	0.13		0.46	0.00	0.48	0.09	0.55	0.10	
02/02/2025 05:30:00			0.03		0.14	0.13		0.46	0.00	0.47	0.09	0.54	0.10	
02/02/2025 05:45:00			0.03		0.14	0.13		0.46	0.00	0.47	0.09	0.53	0.10	
02/02/2025 06:00:00			0.03		0.14	0.12		0.46	0.00	0.46	0.09	0.52	0.09	
02/02/2025 06:15:00			0.03		0.14	0.12		0.46	0.00	0.46	0.09	0.52	0.10	
02/02/2025 06:30:00			0.03		0.14	0.12		0.46	0.00	0.45	0.08	0.51	0.09	
02/02/2025 06:45:00			0.03		0.14	0.12		0.46	0.00	0.45	0.11	0.50	0.09	
02/02/2025 07:00:00			0.03		0.14	0.12		0.46	0.00	0.45	0.10	0.49	0.09	
02/02/2025 07:15:00			0.03		0.13	0.12		0.45	0.00	0.44	0.10	0.49	0.09	
02/02/2025 07:30:00			0.03		0.13	0.12		0.45	0.00	0.44	0.09	0.48	0.08	
02/02/2025 07:45:00			0.03		0.13	0.12		0.45	0.00	0.44	0.09	0.48	0.08	
02/02/2025 08:00:00			0.03		0.13	0.12		0.45	0.00	0.43	0.09	0.47	0.09	
02/02/2025 08:15:00			0.03		0.13	0.12		0.45	0.00	0.43	0.08	0.47	0.07	
02/02/2025 08:30:00			0.03		0.13	0.12		0.45	0.00	0.43	0.08	0.46	0.06	
02/02/2025 08:45:00			0.02		0.13	0.12		0.45	0.00	0.43	0.09	0.46	0.06	
02/02/2025 09:00:00			0.03		0.13	0.12		0.45	0.00	0.42	0.09	0.45	0.06	
02/02/2025 09:15:00			0.02		0.13	0.12		0.46	0.00	0.42	0.09	0.45	0.08	
02/02/2025 09:30:00			0.02		0.13	0.12		0.46	0.00	0.42	0.09	0.44	0.07	
02/02/2025 09:45:00			0.02		0.13	0.12		0.47	0.00	0.42	0.09	0.44	0.09	
02/02/2025 10:00:00			0.02		0.13	0.12		0.47	0.00	0.42	0.09	0.44	0.05	
02/02/2025 10:15:00			0.02		0.13	0.12		0.47	0.00	0.42	0.09	0.44	0.05	
02/02/2025 10:30:00			0.02		0.13	0.12		0.47	0.00	0.41	0.09	0.44	0.05	
02/02/2025 10:45:00			0.02		0.13	0.12		0.48	0.00	0.41	0.09	0.47	0.04	
02/02/2025 11:00:00			0.02		0.13	0.12		0.48	0.00	0.41	0.09	0.51	0.02	
02/02/2025 11:15:00			0.02		0.13	0.12		0.48	0.00	0.41	0.08	0.54	0.00	
02/02/2025 11:30:00			0.02		0.13	0.12		0.49	0.00	0.41	0.09	0.56	0.01	
02/02/2025 11:45:00			0.02		0.13	0.12		0.49	0.00	0.41	0.09	0.57	0.01	
02/02/2025 12:00:00			0.02		0.13	0.12		0.49	0.00	0.41	0.09	0.58	0.01	
02/02/2025 12:15:00			0.03		0.13	0.12		0.49	0.00	0.41	0.09	0.59	0.01	
02/02/2025 12:30:00			0.03		0.13	0.12		0.49	0.00	0.41	0.09	0.60	0.00	
02/02/2025 12:45:00			0.03		0.13	0.12		0.49	0.00	0.42	0.09	0.61	0.01	
02/02/2025 13:00:00			0.03		0.13	0.12		0.49	0.00	0.42	0.08	0.62	0.00	
02/02/2025 13:15:00			0.03		0.14	0.12		0.50	0.00	0.42	0.08	0.63	0.00	
02/02/2025 13:30:00			0.03		0.14	0.12		0.50	0.00	0.43	0.07	0.64	0.00	
02/02/2025 13:45:00			0.03		0.14	0.12		0.50	0.00	0.43	0.07	0.64	0.00	
02/02/2025 14:00:00			0.03		0.14	0.12		0.50	0.00	0.43	0.07	0.65	0.01	
02/02/2025 14:15:00			0.03		0.14	0.13		0.50	0.00	0.44	0.07	0.66	0.01	
02/02/2025 14:30:00			0.03		0.14	0.13		0.50	0.00	0.44	0.07	0.66	0.01	
02/02/2025 14:45:00			0.04		0.14	0.13		0.50	0.00	0.45	0.07	0.67	0.00	
02/02/2025 15:00:00			0.04		0.14	0.13		0.50	0.00	0.45	0.07	0.67	0.00	
02/02/2025 15:15:00			0.04		0.14	0.13		0.50	0.00	0.46	0.08	0.68	0.01	
02/02/2025 15:30:00			0.04		0.14	0.13		0.50	0.00	0.46	0.07	0.68	0.01	
02/02/2025 15:45:00			0.04		0.14	0.13		0.50	0.00	0.46	0.07	0.68	0.01	
02/02/2025 16:00:00			0.04		0.14	0.13		0.49	0.00	0.47	0.05	0.66	0.01	
02/02/2025 16:15:00			0.04		0.14	0.13		0.49	0.00	0.47	0.05	0.63	0.03	
02/02/2025 16:30:00			0.04		0.14	0.13		0.49	0.00	0.47	0.05	0.61	0.03	
02/02/2025 16:45:00			0.04		0.14	0.13		0.49	0.00	0.47	0.06	0.58	0.09	
02/02/2025 17:00:00			0.04		0.14	0.13		0.49	0.00	0.46	0.07	0.57	0.08	
02/02/2025 17:15:00			0.04		0.14	0.13		0.49	0.00	0.46	0.07	0.55	0.07	
02/02/2025 17:30:00			0.04		0.14	0.13		0.49	0.00	0.46	0.07	0.54	0.07	
02/02/2025 17:45:00			0.04		0.14	0.13		0.49	0.00	0.45	0.07	0.53	0.09	
02/02/2025 18:00:00			0.04		0.14	0.13		0.49	0.00	0.45	0.08	0.52	0.08	
02/02/2025 18:15:00			0.04		0.14	0.13		0.49	0.00	0.44	0.08	0.51	0.07	
02/02/2025 18:30:00			0.04		0.14	0.13		0.49	0.00	0.44	0.08	0.50	0.09	
02/02/2025 18:45:00			0.04		0.14	0.13		0.50	0.00	0.44	0.09	0.49	0.08	
02/02/2025 19:00:00			0.04		0.14	0.13		0.50	0.00	0.43	0.09	0.48	0.08	
02/02/2025 19:15:00			0.04		0.14	0.13		0.50	0.00	0.43	0.09	0.47	0.08	
02/02/2025 19:30:00			0.04		0.14	0.13		0.50	0.00	0.43	0.09	0.47	0.09	
02/02/2025 19:45:00			0.04		0.14	0.13		0.50	0.00	0.42	0.09	0.46	0.08	
02/02/2025 20:00:00			0.04		0.14	0.13		0.50	0.00	0.42	0.10	0.45	0.09	
02/02/2025 20:15:00			0.04		0.14	0.13		0.50	0.00	0.42	0.10	0.45	0.08	
02/02/2025 20:30:00			0.04		0.14	0.13		0.50	0.00	0.42	0.09	0.45	0.08	
02/02/2025 20:45:00			0.04		0.14	0.13		0.50	0.00	0.41	0.09	0.46	0.07	
02/02/2025 21:00:00			0.04		0.14	0.13		0.50	0.00	0.41	0.09	0.49	0.05	
02/02/2025 21:15:00			0.04		0.14	0.13		0.50	0.00	0.41	0.08	0.53	0.03	
02/02/2025 21:30:00			0.04		0.14	0.13		0.50	0.00	0.41	0.08	0.55	0.02	
02/02/2025 21:45:00			0.04		0.14	0.13		0.50	0.00	0.41	0.10	0.56	0.01	
02/02/2025 22:00:00			0.05		0.14	0.13		0.50	0.00	0.41	0.10	0.58	0.01	
02/02/2025 22:15:00			0.05		0.14	0.13		0.50	0.00	0.41	0.10	0.59	0.01	
02/02/2025 22:30:00			0.05		0.14	0.13		0.50	0.00	0.41	0.10	0.60	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
02/02/2025 22:45:00			0.05		0.14	0.13		0.50	0.00	0.41	0.09	0.60	0.00	
02/02/2025 23:00:00			0.05		0.14	0.13		0.49	0.00	0.41	0.09	0.61	0.01	
02/02/2025 23:15:00			0.05		0.14	0.13		0.49	0.00	0.42	0.09	0.62	0.01	
02/02/2025 23:30:00			0.05		0.14	0.13		0.49	0.00	0.42	0.09	0.63	0.01	
02/02/2025 23:45:00			0.05		0.14	0.13		0.49	0.00	0.42	0.10	0.63	0.00	
03/02/2025 00:00:00			0.05		0.14	0.13		0.49	0.00	0.43	0.08	0.64	0.00	
03/02/2025 00:15:00			0.05		0.14	0.13		0.49	0.00	0.43	0.08	0.65	0.00	
03/02/2025 00:30:00			0.05		0.14	0.13		0.49	0.00	0.43	0.08	0.65	0.00	
03/02/2025 00:45:00			0.05		0.14	0.13		0.48	0.00	0.44	0.08	0.66	0.01	
03/02/2025 01:00:00			0.05		0.14	0.13		0.48	0.00	0.44	0.07	0.66	0.01	
03/02/2025 01:15:00			0.05		0.14	0.13		0.48	0.00	0.45	0.08	0.67	0.01	
03/02/2025 01:30:00			0.05		0.14	0.13		0.48	0.00	0.45	0.07	0.67	0.01	
03/02/2025 01:45:00			0.05		0.14	0.13		0.48	0.00	0.45	0.06	0.68	0.02	
03/02/2025 02:00:00			0.05		0.14	0.13		0.47	0.00	0.46	0.06	0.68	0.02	
03/02/2025 02:15:00			0.05		0.14	0.13		0.47	0.00	0.46	0.06	0.69	0.02	
03/02/2025 02:30:00			0.04		0.14	0.13		0.47	0.00	0.47	0.06	0.69	0.02	
03/02/2025 02:45:00			0.04		0.14	0.13		0.47	0.00	0.47	0.06	0.69	0.01	
03/02/2025 03:00:00			0.04		0.14	0.13		0.47	0.00	0.47	0.06	0.70	0.01	
03/02/2025 03:15:00			0.04		0.14	0.13		0.47	0.00	0.48	0.06	0.70	0.01	
03/02/2025 03:30:00			0.04		0.14	0.12		0.46	0.00	0.48	0.06	0.70	0.01	
03/02/2025 03:45:00			0.04		0.14	0.12		0.46	0.00	0.48	0.06	0.70	0.01	
03/02/2025 04:00:00			0.04		0.14	0.12		0.46	0.00	0.48	0.06	0.71	0.02	
03/02/2025 04:15:00			0.04		0.14	0.12		0.46	0.00	0.49	0.06	0.68	0.01	
03/02/2025 04:30:00			0.04		0.14	0.12		0.46	0.00	0.49	0.06	0.65	0.06	
03/02/2025 04:45:00			0.04		0.14	0.12		0.46	0.00	0.48	0.06	0.62	0.08	
03/02/2025 05:00:00			0.04		0.14	0.12		0.46	0.00	0.48	0.06	0.60	0.08	
03/02/2025 05:15:00			0.04		0.13	0.12		0.46	0.00	0.48	0.06	0.58	0.09	
03/02/2025 05:30:00			0.04		0.13	0.12		0.46	0.00	0.47	0.06	0.57	0.10	
03/02/2025 05:45:00			0.03		0.13	0.12		0.46	0.00	0.47	0.06	0.55	0.11	
03/02/2025 06:00:00			0.03		0.13	0.12		0.45	0.00	0.46	0.08	0.54	0.10	
03/02/2025 06:15:00			0.03		0.13	0.12		0.45	0.00	0.46	0.08	0.53	0.11	
03/02/2025 06:30:00			0.03		0.13	0.12		0.45	0.00	0.45	0.08	0.52	0.09	
03/02/2025 06:45:00			0.03		0.13	0.12		0.45	0.00	0.45	0.08	0.51	0.08	
03/02/2025 07:00:00			0.03		0.13	0.12		0.45	0.00	0.44	0.08	0.50	0.09	
03/02/2025 07:15:00			0.03		0.13	0.12		0.45	0.00	0.44	0.08	0.49	0.10	
03/02/2025 07:30:00			0.03		0.13	0.12		0.45	0.00	0.43	0.08	0.48	0.08	
03/02/2025 07:45:00			0.03		0.13	0.12		0.45	0.00	0.43	0.08	0.47	0.09	
03/02/2025 08:00:00			0.03		0.13	0.12		0.46	0.00	0.42	0.08	0.47	0.09	
03/02/2025 08:15:00			0.03		0.13	0.12		0.46	0.00	0.42	0.08	0.46	0.09	
03/02/2025 08:30:00			0.03		0.13	0.11		0.46	0.00	0.42	0.09	0.45	0.10	
03/02/2025 08:45:00			0.03		0.13	0.11		0.46	0.00	0.41	0.09	0.45	0.09	
03/02/2025 09:00:00			0.02		0.13	0.11		0.47	0.00	0.41	0.09	0.44	0.07	
03/02/2025 09:15:00			0.02		0.13	0.11		0.47	0.00	0.41	0.09	0.44	0.07	
03/02/2025 09:30:00			0.02		0.13	0.11		0.47	0.00	0.41	0.09	0.43	0.09	
03/02/2025 09:45:00			0.02		0.13	0.11		0.47	0.00	0.40	0.09	0.43	0.09	
03/02/2025 10:00:00			0.02		0.13	0.11		0.48	0.00	0.40	0.09	0.42	0.07	
03/02/2025 10:15:00			0.02		0.13	0.11		0.48	0.00	0.40	0.09	0.42	0.07	
03/02/2025 10:30:00			0.02		0.13	0.11		0.48	0.00	0.40	0.10	0.41	0.08	
03/02/2025 10:45:00			0.02		0.13	0.11		0.48	0.00	0.40	0.09	0.42	0.07	
03/02/2025 11:00:00			0.02		0.13	0.11		0.48	0.00	0.40	0.09	0.43	0.05	
03/02/2025 11:15:00			0.02		0.13	0.12		0.48	0.00	0.40	0.08	0.47	0.04	
03/02/2025 11:30:00			0.03		0.13	0.12		0.48	0.00	0.40	0.08	0.50	0.02	
03/02/2025 11:45:00			0.03		0.13	0.12		0.49	0.00	0.40	0.09	0.52	0.01	
03/02/2025 12:00:00			0.03		0.13	0.12		0.49	0.00	0.40	0.09	0.53	0.00	
03/02/2025 12:15:00			0.03		0.13	0.12		0.49	0.00	0.40	0.09	0.54	0.01	
03/02/2025 12:30:00			0.03		0.13	0.12		0.49	0.00	0.40	0.10	0.56	0.00	
03/02/2025 12:45:00			0.03		0.13	0.12		0.49	0.00	0.40	0.09	0.57	0.00	
03/02/2025 13:00:00			0.03		0.13	0.12		0.49	0.00	0.40	0.09	0.57	0.00	
03/02/2025 13:15:00			0.03		0.13	0.12		0.49	0.00	0.40	0.09	0.58	0.00	
03/02/2025 13:30:00			0.03		0.13	0.12		0.49	0.00	0.40	0.09	0.59	0.00	
03/02/2025 13:45:00			0.03		0.13	0.12		0.49	0.00	0.40	0.09	0.60	0.00	
03/02/2025 14:00:00			0.03		0.13	0.12		0.49	0.00	0.41	0.09	0.60	0.00	
03/02/2025 14:15:00			0.03		0.13	0.12		0.49	0.00	0.41	0.08	0.61	0.01	
03/02/2025 14:30:00			0.03		0.13	0.12		0.49	0.00	0.41	0.08	0.62	0.01	
03/02/2025 14:45:00			0.03		0.14	0.12		0.49	0.00	0.41	0.07	0.62	0.01	
03/02/2025 15:00:00			0.04		0.14	0.12		0.49	0.00	0.42	0.08	0.63	0.00	
03/02/2025 15:15:00			0.03		0.14	0.12		0.49	0.00	0.42	0.08	0.63	0.00	
03/02/2025 15:30:00			0.04		0.14	0.12		0.49	0.00	0.42	0.08	0.64	0.02	
03/02/2025 15:45:00			0.04		0.14	0.12		0.49	0.00	0.43	0.08	0.64	0.00	
03/02/2025 16:00:00			0.04		0.14	0.12		0.49	0.00	0.43	0.08	0.65	0.00	
03/02/2025 16:15:00			0.04		0.14	0.12		0.48	0.00	0.43	0.08	0.65	0.00	
03/02/2025 16:30:00			0.04		0.14	0.12		0.49	0.00	0.43	0.07	0.64	0.00	
03/02/2025 16:45:00			0.04		0.14	0.12		0.48	0.00	0.44	0.06	0.62	0.02	
03/02/2025 17:00:00			0.04		0.14	0.12		0.49	0.00	0.44	0.06	0.59	0.04	
03/02/2025 17:15:00			0.04		0.14	0.12		0.49	0.00	0.44	0.07	0.57	0.04	
03/02/2025 17:30:00			0.04		0.14	0.12		0.49	0.00	0.44	0.07	0.55	0.06	
03/02/2025 17:45:00			0.04		0.14	0.12		0.49	0.00	0.43	0.07	0.53	0.08	
03/02/2025 18:00:00			0.04		0.14	0.12		0.49	0.00	0.43	0.07	0.51	0.08	
03/02/2025 18:15:00			0.03		0.14	0.12		0.49	0.00	0.43	0.07	0.50	0.08	
03/02/2025 18:30:00			0.04		0.14	0.12		0.49	0.00	0.42	0.07	0.49	0.08	
03/02/2025 18:45:00			0.03		0.14	0.12		0.49	0.00	0.42	0.08	0.48	0.08	
03/02/2025 19:00:00			0.03		0.14	0.12		0.49	0.00	0.42	0.08	0.47	0.09	
03/02/2025 19:15:00			0.03		0.14	0.12		0.49	0.00	0.41	0.07	0.46	0.08	
03/02/2025 19:30:00			0.03		0.14	0.12		0.49	0.00	0.41	0.08	0.45	0.08	
03/02/2025 19:45:00			0.03		0.14	0.12		0.49	0.00	0.41	0.07	0.44	0.07	
03/02/2025 20:00:00			0.03		0.14	0.12		0.50	0.00	0.41	0.08	0.43	0.08	
03/02/2025 20:15:00			0.04		0.14	0.12		0.50	0.00	0.40	0.07	0.43	0.07	
03/02/2025 20:30:00			0.04		0.14	0.12		0.50	0.00	0.40	0.08	0.42	0.09	
03/02/2025 20:45:00			0.04		0.14	0.12		0.50	0.00	0.40	0.08	0.42	0.07	
03/02/2025 21:00:00			0.04		0.14	0.12		0.50	0.00	0.40	0.08	0.41	0.07	
03/02/2025 21:15:00			0.04		0.14	0.12		0.50	0.00	0.40	0.08	0.42	0.08	
03/02/2025 21:30:00			0.04		0.14	0.12		0.50	0.00	0.39	0.08	0.44	0.06	
03/02/2025 21:45:00			0.04		0.14	0.12		0.50	0.00	0.39	0.08	0.48	0.04	
03/02/2025 22:00:00			0.04		0.14	0.12		0.50	0.00	0.39	0.09	0.50	0.02	
03/02/2025 22:15:00			0.04		0.14	0.12		0.50	0.00	0.39	0.09	0.52	0.02	
03/02/2025 22:30:00			0.04		0.14	0.12		0.50	0.00	0.39	0.09	0.53	0.01	
03/02/2025 22:45:00			0.04		0.14	0.12		0.50	0.00	0.39	0.08	0.54	0.01	
03/02/2025 23:00:00			0.04		0.14	0.12		0.50	0.00	0.39	0.09	0.55	0.01	
03/02/2025 23:15:00			0.04		0.14	0.12		0.49	0.00	0.39	0.09	0.56	0.01	
03/02/2025 23:30:00			0.04		0.14	0.12		0.49	0.00	0.39	0.09	0.57	0.01	
03/02/2025 23:45:00			0.04		0.14	0.12		0.49	0.00	0.39	0.09	0.58	0.01	
04/02/2025 00:00:00			0.04		0.14	0.12		0.49	0.00	0.40	0.08	0.58	0.01	
04/02/2025 00:15:00			0.04		0.14	0.12		0.49	0.00	0.40	0.09	0.59	0.00	
04/02/2025 00:30:00			0.04		0.14	0.12		0.49	0.00	0.40	0.08	0.60	0.00	
04/02/2025 00:45:00			0.04		0.14	0.13		0.49	0.00	0.40	0.08	0.60	0.00	
04/02/2025 01:00:00			0.04		0.14	0.13		0.48	0.00	0.41	0.08	0.61	0.01	
04/02/2025 01:15:00			0.04		0.14	0.12		0.48	0.00	0.41	0.08	0.61	0.01	
04/02/2025 01:30:00			0.04		0.14	0.12		0.48	0.00	0.41	0.08	0.62	0.01	
04/02/2025 01:45:00			0.04		0.14	0.12		0.48	0.00	0.42	0.07	0.62	0.00	
04/02/2025 02:00:00			0.04		0.14	0.12		0.48	0.00	0.42	0.07	0.63	0.00	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
04/02/2025 02:15:00			0.04		0.14	0.12		0.48	0.00	0.42	0.07	0.63	0.00	
04/02/2025 02:30:00			0.04		0.14	0.12		0.47	0.00	0.43	0.07	0.64	0.00	
04/02/2025 02:45:00			0.04		0.14	0.12		0.47	0.00	0.43	0.07	0.64	0.01	
04/02/2025 03:00:00			0.04		0.14	0.12		0.47	0.00	0.43	0.07	0.65	0.01	
04/02/2025 03:15:00			0.04		0.14	0.12		0.47	0.00	0.43	0.07	0.65	0.01	
04/02/2025 03:30:00			0.04		0.14	0.12		0.47	0.00	0.44	0.07	0.65	0.02	
04/02/2025 03:45:00			0.04		0.14	0.12		0.47	0.00	0.44	0.07	0.66	0.01	
04/02/2025 04:00:00			0.04		0.13	0.12		0.46	0.00	0.44	0.07	0.66	0.01	
04/02/2025 04:15:00			0.04		0.13	0.12		0.46	0.00	0.45	0.06	0.66	0.01	
04/02/2025 04:30:00			0.04		0.13	0.12		0.46	0.00	0.45	0.07	0.67	0.02	
04/02/2025 04:45:00			0.03		0.13	0.12		0.46	0.00	0.45	0.07	0.67	0.01	
04/02/2025 05:00:00			0.03		0.13	0.12		0.47	0.00	0.45	0.05	0.65	0.02	
04/02/2025 05:15:00			0.03		0.13	0.12		0.47	0.00	0.46	0.05	0.63	0.02	
04/02/2025 05:30:00			0.03		0.13	0.12		0.47	0.00	0.46	0.06	0.60	0.06	
04/02/2025 05:45:00			0.03		0.13	0.12		0.47	0.00	0.45	0.06	0.57	0.07	
04/02/2025 06:00:00			0.03		0.13	0.12		0.46	0.00	0.45	0.06	0.55	0.08	
04/02/2025 06:15:00			0.03		0.13	0.12		0.46	0.00	0.45	0.06	0.54	0.08	
04/02/2025 06:30:00			0.03		0.13	0.12		0.46	0.00	0.44	0.08	0.52	0.09	
04/02/2025 06:45:00			0.03		0.13	0.12		0.46	0.00	0.44	0.06	0.51	0.09	
04/02/2025 07:00:00			0.03		0.13	0.12		0.46	0.00	0.43	0.06	0.50	0.09	
04/02/2025 07:15:00			0.03		0.13	0.12		0.46	0.00	0.43	0.06	0.49	0.10	
04/02/2025 07:30:00			0.03		0.13	0.12		0.46	0.00	0.42	0.07	0.48	0.10	
04/02/2025 07:45:00			0.03		0.13	0.12		0.46	0.00	0.42	0.08	0.47	0.10	
04/02/2025 08:00:00			0.03		0.13	0.12		0.46	0.00	0.42	0.08	0.46	0.07	
04/02/2025 08:15:00			0.03		0.13	0.12		0.46	0.00	0.41	0.08	0.45	0.07	
04/02/2025 08:30:00			0.03		0.13	0.12		0.47	0.00	0.41	0.08	0.44	0.08	
04/02/2025 08:45:00			0.03		0.13	0.12		0.47	0.00	0.41	0.07	0.44	0.08	
04/02/2025 09:00:00			0.03		0.13	0.12		0.47	0.00	0.41	0.07	0.43	0.08	
04/02/2025 09:15:00			0.03		0.13	0.12		0.47	0.00	0.40	0.07	0.42	0.08	
04/02/2025 09:30:00			0.02		0.13	0.12		0.48	0.00	0.40	0.07	0.42	0.08	
04/02/2025 09:45:00			0.02		0.13	0.12		0.48	0.00	0.40	0.08	0.41	0.08	
04/02/2025 10:00:00			0.02		0.13	0.12		0.48	0.00	0.40	0.08	0.41	0.06	
04/02/2025 10:15:00			0.02		0.13	0.12		0.48	0.00	0.40	0.08	0.40	0.08	
04/02/2025 10:30:00			0.02		0.13	0.11		0.48	0.00	0.39	0.08	0.40	0.05	
04/02/2025 10:45:00			0.02		0.13	0.12		0.48	0.00	0.39	0.09	0.39	0.05	
04/02/2025 11:00:00			0.02		0.13	0.12		0.48	0.00	0.39	0.09	0.39	0.07	
04/02/2025 11:15:00			0.02		0.13	0.12		0.49	0.00	0.39	0.09	0.39	0.08	
04/02/2025 11:30:00			0.03		0.13	0.12		0.49	0.00	0.39	0.08	0.39	0.06	
04/02/2025 11:45:00			0.03		0.13	0.12		0.49	0.00	0.39	0.09	0.40	0.06	
04/02/2025 12:00:00			0.03		0.13	0.12		0.49	0.00	0.39	0.09	0.43	0.04	
04/02/2025 12:15:00			0.03		0.13	0.12		0.49	0.00	0.39	0.08	0.46	0.03	
04/02/2025 12:30:00			0.03		0.13	0.12		0.49	0.00	0.39	0.08	0.48	0.02	
04/02/2025 12:45:00			0.03		0.13	0.12		0.49	0.00	0.39	0.09	0.50	0.01	
04/02/2025 13:00:00			0.03		0.13	0.12		0.49	0.00	0.39	0.09	0.51	0.01	
04/02/2025 13:15:00			0.03		0.13	0.12		0.49	0.00	0.39	0.08	0.52	0.01	
04/02/2025 13:30:00			0.03		0.13	0.12		0.49	0.00	0.39	0.08	0.53	0.01	
04/02/2025 13:45:00			0.03		0.13	0.12		0.49	0.00	0.39	0.08	0.54	0.01	
04/02/2025 14:00:00			0.03		0.13	0.12		0.49	0.00	0.39	0.08	0.55	0.01	
04/02/2025 14:15:00			0.03		0.13	0.12		0.49	0.00	0.39	0.08	0.55	0.00	
04/02/2025 14:30:00			0.03		0.13	0.12		0.49	0.00	0.39	0.08	0.56	0.01	
04/02/2025 14:45:00			0.03		0.13	0.12		0.49	0.00	0.39	0.09	0.56	0.00	
04/02/2025 15:00:00			0.03		0.13	0.12		0.49	0.00	0.39	0.09	0.57	0.00	
04/02/2025 15:15:00			0.03		0.13	0.12		0.49	0.00	0.39	0.09	0.57	0.01	
04/02/2025 15:30:00			0.03		0.13	0.12		0.49	0.00	0.39	0.06	0.58	0.00	
04/02/2025 15:45:00			0.02		0.13	0.12		0.49	0.00	0.40	0.06	0.59	0.00	
04/02/2025 16:00:00			0.02		0.13	0.12		0.49	0.00	0.40	0.05	0.59	0.01	
04/02/2025 16:15:00			0.02		0.13	0.12		0.49	0.00	0.41	0.05	0.60	0.01	
04/02/2025 16:30:00			0.02		0.12	0.12		0.49	0.00	0.41	0.06	0.61	0.01	
04/02/2025 16:45:00			0.02		0.12	0.12		0.49	0.00	0.41	0.04	0.60	0.00	
04/02/2025 17:00:00			0.02		0.12	0.12		0.49	0.00	0.42	0.04	0.58	0.03	
04/02/2025 17:15:00			0.01		0.12	0.11		0.49	0.00	0.42	0.05	0.55	0.05	
04/02/2025 17:30:00			0.01		0.12	0.11		0.49	0.00	0.42	0.05	0.52	0.07	
04/02/2025 17:45:00			0.01		0.12	0.11		0.49	0.00	0.42	0.04	0.50	0.07	
04/02/2025 18:00:00			0.01		0.12	0.11		0.49	0.00	0.42	0.04	0.49	0.09	
04/02/2025 18:15:00			0.01		0.12	0.11		0.49	0.00	0.42	0.06	0.47	0.10	
04/02/2025 18:30:00			0.01		0.12	0.11		0.49	0.00	0.41	0.06	0.45	0.09	
04/02/2025 18:45:00			0.01		0.12	0.11		0.49	0.00	0.41	0.06	0.44	0.10	
04/02/2025 19:00:00			0.01		0.12	0.11		0.49	0.00	0.41	0.06	0.43	0.10	
04/02/2025 19:15:00			0.00		0.12	0.11		0.49	0.00	0.41	0.06	0.42	0.10	
04/02/2025 19:30:00			0.00		0.12	0.11		0.49	0.00	0.40	0.07	0.41	0.09	
04/02/2025 19:45:00			0.00		0.12	0.11		0.49	0.00	0.40	0.07	0.40	0.09	
04/02/2025 20:00:00			0.00		0.12	0.11		0.49	0.00	0.40	0.07	0.39	0.08	
04/02/2025 20:15:00			0.00		0.11	0.11		0.50	0.00	0.40	0.07	0.39	0.08	
04/02/2025 20:30:00			0.00		0.11	0.11		0.50	0.00	0.40	0.08	0.38	0.10	
04/02/2025 20:45:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.37	0.10	
04/02/2025 21:00:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.37	0.07	
04/02/2025 21:15:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.36	0.07	
04/02/2025 21:30:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.35	0.07	
04/02/2025 21:45:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.35	0.07	
04/02/2025 22:00:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.34	0.07	
04/02/2025 22:15:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.34	0.07	
04/02/2025 22:30:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.35	0.07	
04/02/2025 22:45:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.38	0.06	
04/02/2025 23:00:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.42	0.05	
04/02/2025 23:15:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.44	0.03	
04/02/2025 23:30:00			0.00		0.11	0.11		0.50	0.00	0.39	0.08	0.46	0.02	
04/02/2025 23:45:00			0.00		0.11	0.11		0.49	0.00	0.39	0.08	0.47	0.02	
05/02/2025 00:00:00			0.00		0.11	0.11		0.49	0.00	0.38	0.09	0.48	0.02	
05/02/2025 00:15:00			0.00		0.11	0.11		0.49	0.00	0.38	0.08	0.50	0.02	
05/02/2025 00:30:00			-0.01		0.11	0.11		0.49	0.00	0.38	0.08	0.50	0.01	
05/02/2025 00:45:00			-0.01		0.11	0.11		0.49	0.00	0.39	0.09	0.51	0.01	
05/02/2025 01:00:00			-0.01		0.11	0.11		0.48	0.00	0.39	0.09	0.52	0.01	
05/02/2025 01:15:00			-0.01		0.11	0.11		0.48	0.00	0.39	0.09	0.53	0.01	
05/02/2025 01:30:00			-0.01		0.11	0.11		0.48	0.00	0.39	0.09	0.54	0.01	
05/02/2025 01:45:00			-0.01		0.11	0.10		0.48	0.00	0.39	0.07	0.54	0.01	
05/02/2025 02:00:00			-0.01		0.11	0.10		0.47	0.00	0.39	0.07	0.55	0.00	
05/02/2025 02:15:00			-0.01		0.11	0.10		0.47	0.00	0.39	0.08	0.56	0.02	
05/02/2025 02:30:00			-0.01		0.11	0.10		0.47	0.00	0.39	0.08	0.56	0.01	
05/02/2025 02:45:00			-0.01		0.11	0.10		0.47	0.00	0.39	0.08	0.57	0.00	
05/02/2025 03:00:00			-0.01		0.11	0.10		0.46	0.00	0.39	0.08	0.57	0.01	
05/02/2025 03:15:00			-0.01		0.11	0.10		0.46	0.00	0.40	0.08	0.58	0.01	
05/02/2025 03:30:00			-0.01		0.11	0.10		0.46	0.00	0.40	0.08	0.58	0.01	
05/02/2025 03:45:00			-0.01		0.11	0.10		0.46	0.00	0.40	0.08	0.59	0.01	
05/02/2025 04:00:00			-0.01		0.11	0.10		0.46	0.00	0.40	0.08	0.59	0.02	
05/02/2025 04:15:00			-0.01		0.11	0.10		0.46	0.00	0.40	0.08	0.59	0.02	
05/02/2025 04:30:00			-0.01		0.11	0.10		0.46	0.00	0.41	0.08	0.60	0.02	
05/02/2025 04:45:00			-0.01		0.10	0.10		0.45	0.00	0.41	0.08	0.60	0.01	
05/02/2025 05:00:00			-0.01		0.10	0.10		0.45	0.00	0.41	0.07	0.61	0.01	
05/02/2025 05:15:00			-0.01		0.10	0.10		0.45	0.00	0.41	0.07	0.61	0.01	
05/02/2025 05:30:00			-0.01		0.10	0.10		0.45	0.00	0.41	0.09	0.61	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
05/02/2025 05:45:00			-0.01		0.10	0.09		0.45	0.00	0.42	0.09	0.62	0.01	
05/02/2025 06:00:00			-0.01		0.10	0.09		0.45	0.00	0.42	0.07	0.62	0.02	
05/02/2025 06:15:00			-0.01		0.10	0.09		0.45	0.00	0.42	0.08	0.60	0.02	
05/02/2025 06:30:00			-0.01		0.10	0.09		0.45	0.00	0.42	0.08	0.57	0.04	
05/02/2025 06:45:00			-0.01		0.10	0.09		0.45	0.00	0.42	0.07	0.54	0.04	
05/02/2025 07:00:00			-0.01		0.10	0.09		0.45	0.00	0.42	0.07	0.52	0.07	
05/02/2025 07:15:00			-0.01		0.10	0.09		0.45	0.00	0.42	0.07	0.50	0.09	
05/02/2025 07:30:00			-0.01		0.10	0.09		0.45	0.00	0.42	0.07	0.48	0.09	
05/02/2025 07:45:00			-0.01		0.10	0.09		0.45	0.00	0.42	0.07	0.47	0.10	
05/02/2025 08:00:00			-0.01		0.10	0.09		0.45	0.00	0.41	0.07	0.45	0.09	
05/02/2025 08:15:00			-0.02		0.10	0.09		0.45	0.00	0.41	0.07	0.44	0.09	
05/02/2025 08:30:00			-0.02		0.10	0.09		0.45	0.00	0.41	0.07	0.43	0.11	
05/02/2025 08:45:00			-0.02		0.10	0.09		0.46	0.00	0.40	0.07	0.42	0.10	
05/02/2025 09:00:00			-0.02		0.09	0.09		0.46	0.00	0.40	0.07	0.41	0.07	
05/02/2025 09:15:00			-0.02		0.09	0.09		0.46	0.00	0.40	0.06	0.40	0.10	
05/02/2025 09:30:00			-0.02		0.09	0.09		0.46	0.00	0.40	0.07	0.39	0.09	
05/02/2025 09:45:00			-0.02		0.09	0.09		0.47	0.00	0.39	0.07	0.38	0.10	
05/02/2025 10:00:00			-0.02		0.09	0.09		0.47	0.00	0.39	0.07	0.38	0.09	
05/02/2025 10:15:00			-0.02		0.10	0.09		0.47	0.00	0.39	0.07	0.37	0.08	
05/02/2025 10:30:00			-0.02		0.10	0.09		0.47	0.00	0.39	0.07	0.36	0.06	
05/02/2025 10:45:00			-0.02		0.10	0.09		0.47	0.00	0.39	0.07	0.36	0.06	
05/02/2025 11:00:00			-0.02		0.10	0.09		0.47	0.00	0.39	0.07	0.35	0.08	
05/02/2025 11:15:00			-0.02		0.10	0.09		0.47	0.00	0.38	0.07	0.35	0.09	
05/02/2025 11:30:00			-0.02		0.10	0.09		0.47	0.00	0.38	0.07	0.35	0.07	
05/02/2025 11:45:00			-0.02		0.10	0.09		0.47	0.00	0.38	0.07	0.35	0.06	
05/02/2025 12:00:00			-0.02		0.10	0.09		0.47	0.00	0.38	0.08	0.36	0.06	
05/02/2025 12:15:00			-0.02		0.10	0.09		0.47	0.00	0.38	0.08	0.40	0.05	
05/02/2025 12:30:00			-0.02		0.10	0.09		0.47	0.00	0.38	0.06	0.46	0.05	
05/02/2025 12:45:00			-0.02		0.10	0.09		0.47	0.00	0.38	0.06	0.47	0.01	
05/02/2025 13:00:00			-0.02		0.10	0.09		0.48	0.00	0.38	0.07	0.48	0.02	
05/02/2025 13:15:00			-0.02		0.10	0.09		0.48	0.00	0.38	0.07	0.49	0.02	
05/02/2025 13:30:00			-0.02		0.10	0.09		0.48	0.00	0.38	0.07	0.50	0.01	
05/02/2025 13:45:00			-0.02		0.10	0.09		0.47	0.00	0.38	0.07	0.51	0.01	
05/02/2025 14:00:00			-0.02		0.10	0.09		0.47	0.00	0.38	0.07	0.52	0.01	
05/02/2025 14:15:00			-0.02		0.10	0.09		0.47	0.00	0.38	0.08	0.52	0.01	
05/02/2025 14:30:00			-0.01		0.11	0.09		0.47	0.00	0.38	0.08	0.53	0.01	
05/02/2025 14:45:00			-0.01		0.11	0.09		0.48	0.00	0.38	0.07	0.54	0.01	
05/02/2025 15:00:00			-0.01		0.11	0.09		0.48	0.00	0.38	0.07	0.54	0.00	
05/02/2025 15:15:00			-0.01		0.11	0.09		0.48	0.00	0.38	0.07	0.55	0.01	
05/02/2025 15:30:00			0.00		0.11	0.09		0.47	0.00	0.38	0.06	0.56	0.01	
05/02/2025 15:45:00			0.00		0.11	0.10		0.48	0.00	0.39	0.06	0.56	0.01	
05/02/2025 16:00:00			0.00		0.11	0.10		0.48	0.00	0.39	0.05	0.56	0.01	
05/02/2025 16:15:00			0.00		0.11	0.10		0.48	0.00	0.39	0.08	0.57	0.01	
05/02/2025 16:30:00			0.00		0.11	0.10		0.48	0.00	0.39	0.06	0.57	0.00	
05/02/2025 16:45:00			0.00		0.11	0.10		0.48	0.00	0.39	0.06	0.58	0.01	
05/02/2025 17:00:00			0.01		0.11	0.10		0.48	0.00	0.39	0.06	0.58	0.01	
05/02/2025 17:15:00			0.01		0.11	0.10		0.48	0.00	0.39	0.06	0.59	0.01	
05/02/2025 17:30:00			0.01		0.11	0.10		0.48	0.00	0.40	0.07	0.59	0.01	
05/02/2025 17:45:00			0.01		0.11	0.10		0.48	0.00	0.40	0.07	0.59	0.01	
05/02/2025 18:00:00			0.01		0.11	0.10		0.48	0.00	0.40	0.07	0.60	0.01	
05/02/2025 18:15:00			0.01		0.11	0.10		0.48	0.00	0.40	0.08	0.60	0.01	
05/02/2025 18:30:00			0.01		0.11	0.10		0.48	0.00	0.40	0.06	0.60	0.01	
05/02/2025 18:45:00			0.01		0.11	0.10		0.48	0.00	0.41	0.06	0.58	0.03	
05/02/2025 19:00:00			0.01		0.11	0.10		0.48	0.00	0.41	0.07	0.56	0.06	
05/02/2025 19:15:00			0.01		0.12	0.10		0.48	0.00	0.41	0.07	0.53	0.08	
05/02/2025 19:30:00			0.01		0.12	0.10		0.48	0.00	0.41	0.07	0.51	0.09	
05/02/2025 19:45:00			0.01		0.12	0.10		0.49	0.00	0.41	0.07	0.49	0.07	
05/02/2025 20:00:00			0.02		0.12	0.10		0.49	0.00	0.41	0.06	0.48	0.10	
05/02/2025 20:15:00			0.02		0.12	0.10		0.49	0.00	0.40	0.07	0.46	0.09	
05/02/2025 20:30:00			0.02		0.12	0.10		0.49	0.00	0.40	0.06	0.45	0.10	
05/02/2025 20:45:00			0.02		0.12	0.10		0.49	0.00	0.40	0.06	0.43	0.08	
05/02/2025 21:00:00			0.02		0.12	0.10		0.49	0.00	0.40	0.07	0.42	0.09	
05/02/2025 21:15:00			0.02		0.12	0.10		0.49	0.00	0.39	0.07	0.41	0.10	
05/02/2025 21:30:00			0.02		0.12	0.10		0.49	0.00	0.39	0.06	0.40	0.10	
05/02/2025 21:45:00			0.02		0.12	0.10		0.49	0.00	0.39	0.07	0.39	0.08	
05/02/2025 22:00:00			0.02		0.12	0.10		0.49	0.00	0.39	0.07	0.38	0.07	
05/02/2025 22:15:00			0.02		0.12	0.10		0.49	0.00	0.38	0.07	0.37	0.07	
05/02/2025 22:30:00			0.02		0.12	0.10		0.49	0.00	0.38	0.06	0.37	0.10	
05/02/2025 22:45:00			0.02		0.12	0.10		0.49	0.00	0.38	0.07	0.37	0.08	
05/02/2025 23:00:00			0.02		0.12	0.10		0.48	0.00	0.38	0.07	0.38	0.08	
05/02/2025 23:15:00			0.02		0.12	0.10		0.48	0.00	0.38	0.06	0.43	0.05	
05/02/2025 23:30:00			0.03		0.12	0.10		0.48	0.00	0.38	0.06	0.47	0.01	
05/02/2025 23:45:00			0.03		0.12	0.10		0.48	0.00	0.38	0.07	0.50	0.01	
06/02/2025 00:00:00			0.03		0.12	0.10		0.48	0.00	0.38	0.07	0.50	0.02	
06/02/2025 00:15:00			0.03		0.12	0.10		0.48	0.00	0.38	0.07	0.51	0.02	
06/02/2025 00:30:00			0.03		0.12	0.10		0.48	0.00	0.38	0.07	0.52	0.00	
06/02/2025 00:45:00			0.03		0.12	0.10		0.47	0.00	0.38	0.06	0.53	0.00	
06/02/2025 01:00:00			0.03		0.12	0.10		0.47	0.00	0.38	0.06	0.53	0.00	
06/02/2025 01:15:00			0.03		0.12	0.10		0.47	0.00	0.38	0.06	0.54	0.01	
06/02/2025 01:30:00			0.03		0.12	0.10		0.47	0.00	0.38	0.06	0.54	0.00	
06/02/2025 01:45:00			0.03		0.12	0.10		0.47	0.00	0.38	0.06	0.55	0.01	
06/02/2025 02:00:00			0.03		0.12	0.10		0.46	0.00	0.38	0.06	0.55	0.02	
06/02/2025 02:15:00			0.03		0.12	0.10		0.46	0.00	0.38	0.06	0.56	0.01	
06/02/2025 02:30:00			0.03		0.12	0.10		0.46	0.00	0.38	0.06	0.56	0.01	
06/02/2025 02:45:00			0.03		0.12	0.10		0.46	0.00	0.38	0.06	0.57	0.01	
06/02/2025 03:00:00			0.03		0.12	0.10		0.46	0.00	0.39	0.07	0.57	0.01	
06/02/2025 03:15:00			0.02		0.12	0.10		0.46	0.00	0.39	0.06	0.58	0.01	
06/02/2025 03:30:00			0.03		0.12	0.10		0.45	0.00	0.39	0.07	0.58	0.01	
06/02/2025 03:45:00			0.03		0.12	0.10		0.45	0.00	0.39	0.06	0.59	0.00	
06/02/2025 04:00:00			0.02		0.12	0.10		0.45	0.00	0.39	0.06	0.59	0.00	
06/02/2025 04:15:00			0.02		0.12	0.10		0.45	0.00	0.39	0.06	0.59	0.00	
06/02/2025 04:30:00			0.02		0.12	0.10		0.45	0.00	0.40	0.06	0.60	0.01	
06/02/2025 04:45:00			0.02		0.12	0.10		0.45	0.00	0.40	0.06	0.60	0.00	
06/02/2025 05:00:00			0.02		0.12	0.10		0.45	0.00	0.40	0.06	0.60	0.02	
06/02/2025 05:15:00			0.02		0.12	0.10		0.44	0.00	0.40	0.06	0.61	0.01	
06/02/2025 05:30:00			0.02		0.12	0.10		0.44	0.00	0.40	0.06	0.61	0.02	
06/02/2025 05:45:00			0.02		0.12	0.10		0.44	0.00	0.41	0.06	0.61	0.02	
06/02/2025 06:00:00			0.02		0.12	0.10		0.44	0.00	0.41	0.06	0.62	0.02	
06/02/2025 06:15:00			0.02		0.11	0.10		0.44	0.00	0.41	0.06	0.62	0.02	
06/02/2025 06:30:00			0.02		0.11	0.10		0.44	0.00	0.41	0.06	0.61	0.01	
06/02/2025 06:45:00			0.02		0.11	0.10		0.44	0.00	0.41	0.06	0.58	0.02	
06/02/2025 07:00:00			0.02		0.11	0.10		0.44	0.00	0.42	0.06	0.55	0.02	
06/02/2025 07:15:00			0.02		0.11	0.10		0.44	0.00	0.42	0.06	0.53	0.08	
06/02/2025 07:30:00			0.02		0.11	0.10		0.44	0.00	0.41	0.06	0.51	0.08	
06/02/2025 07:45:00			0.02		0.11	0.09		0.44	0.00	0.41	0.06	0.49	0.09	
06/02/2025 08:00:00			0.02		0.11	0.09		0.44	0.00	0.41	0.06	0.47	0.08	
06/02/2025 08:15:00			0.02		0.11	0.09		0.45	0.00	0.40	0.06	0.46	0.08	
06/02/2025 08:30:00			0.02		0.11	0.09		0.45	0.00	0.40	0.06	0.44	0.10	
06/02/2025 08:45:00			0.01		0.11	0.09		0.46	0.00	0.40	0.07	0.43	0.09	
06/02/2025 09:00:00			0.01		0.11	0.09		0.46	0.00	0.40	0.07	0.42	0.09	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
06/02/2025 09:15:00			0.01		0.11	0.09		0.46	0.00	0.39	0.06	0.41	0.09	
06/02/2025 09:30:00			0.01		0.11	0.09		0.47	0.00	0.39	0.05	0.40	0.09	
06/02/2025 09:45:00			0.01		0.11	0.09		0.47	0.00	0.39	0.06	0.39	0.08	
06/02/2025 10:00:00			0.01		0.11	0.09		0.47	0.00	0.39	0.06	0.38	0.10	
06/02/2025 10:15:00			0.01		0.11	0.09		0.47	0.00	0.38	0.06	0.37	0.09	
06/02/2025 10:30:00			0.01		0.11	0.09		0.47	0.00	0.38	0.06	0.37	0.09	
06/02/2025 10:45:00			0.01		0.11	0.10		0.47	0.00	0.38	0.06	0.36	0.09	
06/02/2025 11:00:00			0.02		0.11	0.10		0.47	0.00	0.38	0.06	0.35	0.09	
06/02/2025 11:15:00			0.01		0.11	0.10		0.47	0.00	0.38	0.07	0.35	0.08	
06/02/2025 11:30:00			0.01		0.11	0.10		0.48	0.00	0.38	0.05	0.34	0.08	
06/02/2025 11:45:00			0.02		0.11	0.10		0.48	0.00	0.38	0.05	0.33	0.08	
06/02/2025 12:00:00			0.02		0.11	0.10		0.48	0.00	0.38	0.05	0.33	0.07	
06/02/2025 12:15:00			0.02		0.12	0.10		0.48	0.00	0.38	0.05	0.32	0.06	
06/02/2025 12:30:00			0.02		0.12	0.10		0.48	0.00	0.38	0.05	0.31	0.08	
06/02/2025 12:45:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.31	0.08	
06/02/2025 13:00:00			0.02		0.12	0.10		0.48	0.00	0.37	0.06	0.31	0.07	
06/02/2025 13:15:00			0.02		0.12	0.10		0.48	0.00	0.37	0.06	0.30	0.06	
06/02/2025 13:30:00			0.02		0.12	0.10		0.48	0.00	0.37	0.06	0.31	0.05	
06/02/2025 13:45:00			0.02		0.12	0.10		0.48	0.00	0.37	0.06	0.32	0.05	
06/02/2025 14:00:00			0.02		0.12	0.10		0.48	0.00	0.37	0.06	0.34	0.05	
06/02/2025 14:15:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.39	0.04	
06/02/2025 14:30:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.42	0.01	
06/02/2025 14:45:00			0.02		0.12	0.10		0.48	0.00	0.37	0.06	0.43	0.01	
06/02/2025 15:00:00			0.03		0.12	0.10		0.48	0.00	0.37	0.06	0.44	0.02	
06/02/2025 15:15:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.45	0.02	
06/02/2025 15:30:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.46	0.01	
06/02/2025 15:45:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.47	0.00	
06/02/2025 16:00:00			0.03		0.12	0.10		0.48	0.00	0.37	0.06	0.48	0.00	
06/02/2025 16:15:00			0.03		0.12	0.10		0.48	0.00	0.37	0.06	0.49	0.01	
06/02/2025 16:30:00			0.03		0.12	0.10		0.48	0.00	0.37	0.07	0.49	0.02	
06/02/2025 16:45:00			0.03		0.12	0.10		0.48	0.00	0.37	0.07	0.50	0.01	
06/02/2025 17:00:00			0.03		0.12	0.10		0.48	0.00	0.37	0.07	0.51	0.01	
06/02/2025 17:15:00			0.02		0.12	0.10		0.48	0.00	0.37	0.07	0.51	0.02	
06/02/2025 17:30:00			0.03		0.12	0.10		0.48	0.00	0.38	0.07	0.52	0.01	
06/02/2025 17:45:00			0.03		0.12	0.10		0.48	0.00	0.38	0.07	0.53	0.02	
06/02/2025 18:00:00			0.03		0.12	0.10		0.48	0.00	0.38	0.07	0.53	0.00	
06/02/2025 18:15:00			0.03		0.12	0.10		0.48	0.00	0.38	0.07	0.54	0.01	
06/02/2025 18:30:00			0.03		0.12	0.10		0.48	0.00	0.38	0.07	0.54	0.02	
06/02/2025 18:45:00			0.03		0.12	0.10		0.48	0.00	0.38	0.07	0.55	0.01	
06/02/2025 19:00:00			0.03		0.12	0.10		0.49	0.00	0.38	0.07	0.55	0.01	
06/02/2025 19:15:00			0.03		0.12	0.10		0.49	0.00	0.38	0.07	0.55	0.01	
06/02/2025 19:30:00			0.03		0.12	0.10		0.49	0.00	0.39	0.07	0.53	0.02	
06/02/2025 19:45:00			0.03		0.12	0.10		0.49	0.00	0.39	0.06	0.51	0.04	
06/02/2025 20:00:00			0.03		0.12	0.10		0.49	0.00	0.39	0.06	0.49	0.07	
06/02/2025 20:15:00			0.03		0.12	0.10		0.49	0.00	0.39	0.06	0.47	0.07	
06/02/2025 20:30:00			0.03		0.12	0.11		0.49	0.00	0.39	0.06	0.45	0.07	
06/02/2025 20:45:00			0.03		0.12	0.11		0.49	0.00	0.39	0.06	0.44	0.07	
06/02/2025 21:00:00			0.03		0.12	0.11		0.49	0.00	0.39	0.06	0.42	0.09	
06/02/2025 21:15:00			0.03		0.12	0.11		0.49	0.00	0.39	0.06	0.41	0.09	
06/02/2025 21:30:00			0.03		0.12	0.11		0.49	0.00	0.39	0.06	0.39	0.09	
06/02/2025 21:45:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.38	0.07	
06/02/2025 22:00:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.37	0.07	
06/02/2025 22:15:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.36	0.08	
06/02/2025 22:30:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.35	0.08	
06/02/2025 22:45:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.34	0.08	
06/02/2025 23:00:00			0.03		0.13	0.11		0.49	0.00	0.38	0.06	0.34	0.09	
06/02/2025 23:15:00			0.03		0.13	0.11		0.49	0.00	0.38	0.06	0.33	0.09	
06/02/2025 23:30:00			0.03		0.13	0.11		0.49	0.00	0.38	0.06	0.32	0.08	
06/02/2025 23:45:00			0.03		0.13	0.11		0.49	0.00	0.38	0.06	0.32	0.07	
07/02/2025 00:00:00			0.03		0.13	0.11		0.49	0.00	0.38	0.06	0.32	0.07	
07/02/2025 00:15:00			0.03		0.13	0.11		0.49	0.00	0.38	0.06	0.32	0.07	
07/02/2025 00:30:00			0.03		0.13	0.11		0.49	0.00	0.38	0.06	0.34	0.06	
07/02/2025 00:45:00			0.03		0.13	0.11		0.49	0.00	0.37	0.06	0.36	0.06	
07/02/2025 01:00:00			0.03		0.13	0.11		0.49	0.00	0.37	0.06	0.39	0.04	
07/02/2025 01:15:00			0.03		0.13	0.11		0.49	0.00	0.37	0.06	0.41	0.04	
07/02/2025 01:30:00			0.03		0.13	0.11		0.48	0.00	0.37	0.06	0.42	0.04	
07/02/2025 01:45:00			0.03		0.13	0.11		0.48	0.00	0.37	0.06	0.44	0.02	
07/02/2025 02:00:00			0.03		0.13	0.11		0.48	0.00	0.37	0.07	0.45	0.02	
07/02/2025 02:15:00			0.03		0.13	0.11		0.48	0.00	0.37	0.06	0.46	0.02	
07/02/2025 02:30:00			0.03		0.13	0.11		0.47	0.00	0.37	0.06	0.46	0.01	
07/02/2025 02:45:00			0.03		0.13	0.11		0.47	0.00	0.37	0.06	0.47	0.02	
07/02/2025 03:00:00			0.03		0.12	0.11		0.47	0.00	0.37	0.06	0.48	0.02	
07/02/2025 03:15:00			0.03		0.12	0.11		0.47	0.00	0.37	0.06	0.49	0.01	
07/02/2025 03:30:00			0.03		0.12	0.11		0.47	0.00	0.37	0.06	0.49	0.01	
07/02/2025 03:45:00			0.03		0.12	0.11		0.47	0.00	0.37	0.06	0.50	0.02	
07/02/2025 04:00:00			0.03		0.12	0.11		0.46	0.00	0.37	0.06	0.50	0.02	
07/02/2025 04:15:00			0.03		0.12	0.11		0.46	0.00	0.37	0.03	0.51	0.01	
07/02/2025 04:30:00			0.03		0.12	0.11		0.46	0.00	0.38	0.07	0.52	0.01	
07/02/2025 04:45:00			0.03		0.12	0.11		0.46	0.00	0.38	0.07	0.52	0.02	
07/02/2025 05:00:00			0.03		0.12	0.11		0.46	0.00	0.38	0.02	0.53	0.02	
07/02/2025 05:15:00			0.03		0.12	0.11		0.46	0.00	0.38	0.05	0.53	0.02	
07/02/2025 05:30:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.53	0.02	
07/02/2025 05:45:00			0.03		0.12	0.11		0.46	0.00	0.38	0.07	0.54	0.02	
07/02/2025 06:00:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.54	0.02	
07/02/2025 06:15:00			0.03		0.12	0.10		0.46	0.00	0.38	0.05	0.55	0.02	
07/02/2025 06:30:00			0.03		0.12	0.10		0.45	0.00	0.38	0.05	0.55	0.02	
07/02/2025 06:45:00			0.02		0.12	0.10		0.45	0.00	0.38	0.06	0.55	0.02	
07/02/2025 07:00:00			0.02		0.12	0.10		0.45	0.00	0.38	0.05	0.56	0.02	
07/02/2025 07:15:00			0.02		0.12	0.10		0.45	0.00	0.39	0.05	0.56	0.02	
07/02/2025 07:30:00			0.02		0.12	0.10		0.45	0.00	0.39	0.04	0.56	0.02	
07/02/2025 07:45:00			0.02		0.12	0.10		0.46	0.00	0.39	0.06	0.57	0.02	
07/02/2025 08:00:00			0.02		0.12	0.10		0.46	0.00	0.39	0.06	0.57	0.02	
07/02/2025 08:15:00			0.02		0.12	0.10		0.46	0.00	0.39	0.06	0.56	0.03	
07/02/2025 08:30:00			0.02		0.12	0.10		0.46	0.00	0.39	0.06	0.54	0.04	
07/02/2025 08:45:00			0.02		0.12	0.10		0.46	0.00	0.39	0.05	0.52	0.05	
07/02/2025 09:00:00			0.02		0.11	0.10		0.46	0.00	0.39	0.05	0.50	0.06	
07/02/2025 09:15:00			0.02		0.11	0.10		0.47	0.00	0.39	0.04	0.48	0.08	
07/02/2025 09:30:00			0.02		0.11	0.10		0.47	0.00	0.39	0.04	0.46	0.07	
07/02/2025 09:45:00			0.02		0.11	0.10		0.47	0.00	0.39	0.04	0.45	0.08	
07/02/2025 10:00:00			0.02		0.12	0.10		0.48	0.00	0.39	0.03	0.43	0.08	
07/02/2025 10:15:00			0.02		0.12	0.10		0.48	0.00	0.39	0.03	0.41	0.09	
07/02/2025 10:30:00			0.02		0.12	0.10		0.48	0.00	0.39	0.04	0.40	0.09	
07/02/2025 10:45:00			0.02		0.12	0.10		0.48	0.00	0.39	0.04	0.39	0.09	
07/02/2025 11:00:00			0.02		0.12	0.10		0.48	0.00	0.38	0.04	0.38	0.09	
07/02/2025 11:15:00			0.02		0.12	0.10		0.48	0.00	0.38	0.04	0.37	0.07	
07/02/2025 11:30:00			0.02		0.12	0.10		0.48	0.00	0.38	0.03	0.36	0.09	
07/02/2025 11:45:00			0.02		0.12	0.10		0.48	0.00	0.38	0.03	0.35	0.07	
07/02/2025 12:00:00			0.02		0.12	0.10		0.48	0.00	0.38	0.04	0.34	0.09	
07/02/2025 12:15:00			0.02		0.12	0.10		0.48	0.00	0.38	0.04	0.33	0.07	
07/02/2025 12:30:00			0.02		0.12	0.10		0.48	0.00	0.38	0.04	0.33	0.07	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
07/02/2025 12:45:00			0.02		0.12	0.10		0.48	0.00	0.37	0.04	0.32	0.07	
07/02/2025 13:00:00			0.02		0.12	0.10		0.48	0.00	0.37	0.04	0.32	0.07	
07/02/2025 13:15:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.31	0.07	
07/02/2025 13:30:00			0.02		0.12	0.10		0.48	0.00	0.37	0.04	0.31	0.08	
07/02/2025 13:45:00			0.02		0.12	0.10		0.48	0.00	0.37	0.04	0.31	0.08	
07/02/2025 14:00:00			0.02		0.12	0.10		0.48	0.00	0.37	0.04	0.31	0.06	
07/02/2025 14:15:00			0.03		0.12	0.10		0.48	0.00	0.37	0.04	0.33	0.06	
07/02/2025 14:30:00			0.02		0.12	0.11		0.48	0.00	0.37	0.03	0.34	0.05	
07/02/2025 14:45:00			0.03		0.12	0.11		0.48	0.00	0.37	0.03	0.36	0.04	
07/02/2025 15:00:00			0.03		0.12	0.11		0.47	0.00	0.37	0.03	0.38	0.04	
07/02/2025 15:15:00			0.03		0.12	0.11		0.48	0.00	0.37	0.03	0.40	0.03	
07/02/2025 15:30:00			0.03		0.12	0.11		0.47	0.00	0.37	0.03	0.41	0.02	
07/02/2025 15:45:00			0.02		0.12	0.10		0.47	0.00	0.37	0.03	0.43	0.02	
07/02/2025 16:00:00			0.03		0.12	0.11		0.47	0.00	0.37	0.03	0.44	0.02	
07/02/2025 16:15:00			0.03		0.12	0.10		0.48	0.00	0.37	0.04	0.45	0.02	
07/02/2025 16:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.02	0.45	0.02	
07/02/2025 16:45:00			0.03		0.12	0.10		0.47	0.00	0.37	0.03	0.46	0.02	
07/02/2025 17:00:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.47	0.02	
07/02/2025 17:15:00			0.03		0.12	0.10		0.48	0.00	0.37	0.05	0.48	0.02	
07/02/2025 17:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.48	0.02	
07/02/2025 17:45:00			0.03		0.12	0.10		0.49	0.00	0.37	0.04	0.49	0.02	
07/02/2025 18:00:00			0.03		0.12	0.11		0.49	0.00	0.37	0.05	0.50	0.01	
07/02/2025 18:15:00			0.03		0.12	0.11		0.49	0.00	0.37	0.04	0.50	0.01	
07/02/2025 18:30:00			0.03		0.12	0.11		0.49	0.00	0.37	0.04	0.51	0.02	
07/02/2025 18:45:00			0.03		0.12	0.11		0.49	0.00	0.37	0.04	0.51	0.02	
07/02/2025 19:00:00			0.03		0.12	0.11		0.49	0.00	0.37	0.04	0.51	0.02	
07/02/2025 19:15:00			0.03		0.12	0.11		0.49	0.00	0.37	0.04	0.52	0.02	
07/02/2025 19:30:00			0.03		0.12	0.11		0.49	0.00	0.38	0.04	0.52	0.02	
07/02/2025 19:45:00			0.03		0.12	0.11		0.50	0.00	0.38	0.03	0.53	0.02	
07/02/2025 20:00:00			0.03		0.12	0.11		0.50	0.00	0.38	0.03	0.53	0.02	
07/02/2025 20:15:00			0.03		0.12	0.11		0.50	0.00	0.38	0.03	0.54	0.02	
07/02/2025 20:30:00			0.03		0.12	0.11		0.50	0.00	0.38	0.03	0.53	0.02	
07/02/2025 20:45:00			0.03		0.12	0.11		0.50	0.00	0.38	0.02	0.52	0.02	
07/02/2025 21:00:00			0.03		0.12	0.11		0.50	0.00	0.38	0.03	0.50	0.03	
07/02/2025 21:15:00			0.03		0.13	0.11		0.50	0.00	0.38	0.03	0.48	0.04	
07/02/2025 21:30:00			0.03		0.13	0.11		0.50	0.00	0.38	0.03	0.47	0.06	
07/02/2025 21:45:00			0.03		0.13	0.11		0.50	0.00	0.38	0.03	0.45	0.06	
07/02/2025 22:00:00			0.04		0.13	0.11		0.50	0.00	0.38	0.05	0.43	0.07	
07/02/2025 22:15:00			0.04		0.13	0.11		0.50	0.00	0.38	0.03	0.42	0.08	
07/02/2025 22:30:00			0.04		0.13	0.11		0.50	0.00	0.38	0.04	0.40	0.09	
07/02/2025 22:45:00			0.04		0.13	0.11		0.50	0.00	0.38	0.02	0.39	0.09	
07/02/2025 23:00:00			0.04		0.13	0.11		0.50	0.00	0.38	0.02	0.38	0.09	
07/02/2025 23:15:00			0.04		0.13	0.11		0.50	0.00	0.38	0.03	0.37	0.08	
07/02/2025 23:30:00			0.04		0.13	0.11		0.50	0.00	0.38	0.03	0.36	0.09	
07/02/2025 23:45:00			0.04		0.13	0.11		0.50	0.00	0.38	0.03	0.35	0.09	
08/02/2025 00:00:00			0.04		0.13	0.11		0.50	0.00	0.38	0.03	0.34	0.09	
08/02/2025 00:15:00			0.04		0.13	0.11		0.50	0.00	0.38	0.03	0.33	0.08	
08/02/2025 00:30:00			0.04		0.13	0.11		0.50	0.00	0.38	0.03	0.32	0.07	
08/02/2025 00:45:00			0.04		0.13	0.11		0.50	0.00	0.38	0.02	0.32	0.07	
08/02/2025 01:00:00			0.04		0.13	0.11		0.50	0.00	0.38	0.03	0.31	0.06	
08/02/2025 01:15:00			0.04		0.13	0.12		0.49	0.00	0.38	0.04	0.31	0.08	
08/02/2025 01:30:00			0.04		0.13	0.11		0.49	0.00	0.37	0.04	0.30	0.07	
08/02/2025 01:45:00			0.04		0.13	0.12		0.49	0.00	0.37	0.03	0.30	0.08	
08/02/2025 02:00:00			0.04		0.13	0.12		0.49	0.00	0.37	0.03	0.31	0.07	
08/02/2025 02:15:00			0.04		0.13	0.12		0.49	0.00	0.37	0.05	0.31	0.07	
08/02/2025 02:30:00			0.04		0.13	0.12		0.49	0.00	0.37	0.06	0.34	0.07	
08/02/2025 02:45:00			0.04		0.13	0.12		0.49	0.00	0.37	0.06	0.36	0.05	
08/02/2025 03:00:00			0.04		0.13	0.12		0.48	0.00	0.37	0.06	0.38	0.04	
08/02/2025 03:15:00			0.04		0.13	0.12		0.48	0.00	0.37	0.06	0.40	0.03	
08/02/2025 03:30:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.41	0.03	
08/02/2025 03:45:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.43	0.03	
08/02/2025 04:00:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.44	0.02	
08/02/2025 04:15:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.45	0.02	
08/02/2025 04:30:00			0.04		0.13	0.11		0.47	0.00	0.37	0.06	0.46	0.02	
08/02/2025 04:45:00			0.04		0.13	0.11		0.47	0.00	0.37	0.06	0.46	0.02	
08/02/2025 05:00:00			0.04		0.13	0.11		0.47	0.00	0.37	0.06	0.47	0.02	
08/02/2025 05:15:00			0.04		0.13	0.11		0.47	0.00	0.37	0.05	0.48	0.02	
08/02/2025 05:30:00			0.04		0.13	0.11		0.47	0.00	0.37	0.05	0.48	0.02	
08/02/2025 05:45:00			0.03		0.13	0.11		0.47	0.00	0.37	0.06	0.49	0.02	
08/02/2025 06:00:00			0.03		0.13	0.11		0.47	0.00	0.37	0.05	0.50	0.02	
08/02/2025 06:15:00			0.03		0.13	0.11		0.47	0.00	0.37	0.06	0.50	0.03	
08/02/2025 06:30:00			0.03		0.13	0.11		0.46	0.00	0.38	0.06	0.51	0.02	
08/02/2025 06:45:00			0.03		0.12	0.11		0.46	0.00	0.38	0.05	0.51	0.03	
08/02/2025 07:00:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.52	0.02	
08/02/2025 07:15:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.52	0.02	
08/02/2025 07:30:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.53	0.02	
08/02/2025 07:45:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.53	0.01	
08/02/2025 08:00:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.53	0.01	
08/02/2025 08:15:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.54	0.01	
08/02/2025 08:30:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.54	0.02	
08/02/2025 08:45:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.55	0.03	
08/02/2025 09:00:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.55	0.03	
08/02/2025 09:15:00			0.03		0.12	0.11		0.46	0.00	0.39	0.06	0.54	0.01	
08/02/2025 09:30:00			0.03		0.12	0.11		0.46	0.00	0.39	0.05	0.52	0.03	
08/02/2025 09:45:00			0.02		0.12	0.10		0.47	0.00	0.39	0.05	0.50	0.06	
08/02/2025 10:00:00			0.03		0.12	0.10		0.47	0.00	0.39	0.05	0.48	0.06	
08/02/2025 10:15:00			0.03		0.12	0.10		0.47	0.00	0.39	0.05	0.46	0.07	
08/02/2025 10:30:00			0.02		0.12	0.10		0.47	0.00	0.39	0.05	0.44	0.08	
08/02/2025 10:45:00			0.02		0.12	0.10		0.48	0.00	0.39	0.06	0.43	0.08	
08/02/2025 11:00:00			0.02		0.12	0.10		0.48	0.00	0.39	0.06	0.41	0.10	
08/02/2025 11:15:00			0.02		0.12	0.10		0.49	0.00	0.38	0.06	0.40	0.09	
08/02/2025 11:30:00			0.02		0.12	0.10		0.49	0.00	0.38	0.06	0.39	0.09	
08/02/2025 11:45:00			0.03		0.12	0.10		0.49	0.00	0.38	0.05	0.38	0.08	
08/02/2025 12:00:00			0.03		0.12	0.10		0.49	0.00	0.38	0.05	0.37	0.08	
08/02/2025 12:15:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.36	0.08	
08/02/2025 12:30:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.35	0.09	
08/02/2025 12:45:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.34	0.06	
08/02/2025 13:00:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.33	0.09	
08/02/2025 13:15:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.32	0.09	
08/02/2025 13:30:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.32	0.09	
08/02/2025 13:45:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.31	0.08	
08/02/2025 14:00:00			0.03		0.12	0.11		0.49	0.00	0.38	0.06	0.31	0.07	
08/02/2025 14:15:00			0.03		0.13	0.11		0.49	0.00	0.38	0.06	0.30	0.08	
08/02/2025 14:30:00			0.03		0.13	0.11		0.49	0.00	0.37	0.07	0.30	0.08	
08/02/2025 14:45:00			0.04		0.13	0.11		0.49	0.00	0.37	0.07	0.29	0.08	
08/02/2025 15:00:00			0.04		0.13	0.11		0.49	0.00	0.37	0.06	0.29	0.09	
08/02/2025 15:15:00			0.03		0.13	0.11		0.49	0.00	0.37	0.05	0.29	0.08	
08/02/2025 15:30:00			0.04		0.13	0.11		0.49	0.00	0.37	0.06	0.29	0.05	
08/02/2025 15:45:00			0.04		0.13	0.11		0.49	0.00	0.37	0.06	0.29	0.05	
08/02/2025 16:00:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.31	0.05	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
08/02/2025 16:15:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.34	0.06	
08/02/2025 16:30:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.37	0.03	
08/02/2025 16:45:00			0.04		0.13	0.11		0.48	0.00	0.37	0.05	0.38	0.03	
08/02/2025 17:00:00			0.04		0.13	0.11		0.48	0.00	0.37	0.05	0.40	0.02	
08/02/2025 17:15:00			0.04		0.13	0.11		0.48	0.00	0.37	0.05	0.41	0.02	
08/02/2025 17:30:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.42	0.01	
08/02/2025 17:45:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.43	0.00	
08/02/2025 18:00:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.44	0.00	
08/02/2025 18:15:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.45	0.02	
08/02/2025 18:30:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.46	0.01	
08/02/2025 18:45:00			0.03		0.13	0.11		0.48	0.00	0.37	0.06	0.47	0.01	
08/02/2025 19:00:00			0.04		0.13	0.11		0.48	0.00	0.37	0.06	0.47	0.00	
08/02/2025 19:15:00			0.03		0.13	0.11		0.48	0.00	0.37	0.06	0.48	0.02	
08/02/2025 19:30:00			0.03		0.13	0.11		0.48	0.00	0.37	0.06	0.48	0.02	
08/02/2025 19:45:00			0.03		0.13	0.11		0.48	0.00	0.37	0.05	0.49	0.03	
08/02/2025 20:00:00			0.03		0.13	0.11		0.48	0.00	0.37	0.06	0.50	0.01	
08/02/2025 20:15:00			0.03		0.13	0.11		0.48	0.00	0.37	0.06	0.50	0.01	
08/02/2025 20:30:00			0.03		0.13	0.11		0.48	0.00	0.37	0.06	0.51	0.02	
08/02/2025 20:45:00			0.03		0.13	0.11		0.48	0.00	0.37	0.06	0.51	0.01	
08/02/2025 21:00:00			0.03		0.13	0.11		0.48	0.00	0.37	0.07	0.52	0.01	
08/02/2025 21:15:00			0.03		0.13	0.11		0.48	0.00	0.37	0.07	0.52	0.02	
08/02/2025 21:30:00			0.03		0.13	0.11		0.48	0.00	0.37	0.07	0.52	0.02	
08/02/2025 21:45:00			0.03		0.13	0.11		0.48	0.00	0.38	0.07	0.53	0.03	
08/02/2025 22:00:00			0.03		0.13	0.11		0.48	0.00	0.38	0.06	0.53	0.02	
08/02/2025 22:15:00			0.03		0.13	0.11		0.48	0.00	0.38	0.07	0.52	0.01	
08/02/2025 22:30:00			0.03		0.13	0.11		0.48	0.00	0.38	0.07	0.50	0.01	
08/02/2025 22:45:00			0.03		0.13	0.11		0.48	0.00	0.38	0.06	0.48	0.04	
08/02/2025 23:00:00			0.03		0.13	0.11		0.48	0.00	0.38	0.07	0.46	0.08	
08/02/2025 23:15:00			0.03		0.13	0.11		0.48	0.00	0.38	0.07	0.44	0.08	
08/02/2025 23:30:00			0.03		0.13	0.11		0.47	0.00	0.38	0.06	0.42	0.08	
08/02/2025 23:45:00			0.03		0.13	0.11		0.47	0.00	0.38	0.06	0.40	0.08	
09/02/2025 00:00:00			0.03		0.13	0.11		0.47	0.00	0.38	0.06	0.39	0.09	
09/02/2025 00:15:00			0.03		0.13	0.11		0.47	0.00	0.38	0.07	0.38	0.07	
09/02/2025 00:30:00			0.03		0.13	0.11		0.47	0.00	0.38	0.07	0.36	0.07	
09/02/2025 00:45:00			0.03		0.13	0.11		0.47	0.00	0.38	0.07	0.35	0.07	
09/02/2025 01:00:00			0.03		0.13	0.11		0.47	0.00	0.38	0.07	0.35	0.09	
09/02/2025 01:15:00			0.03		0.13	0.11		0.47	0.00	0.38	0.07	0.34	0.09	
09/02/2025 01:30:00			0.03		0.13	0.11		0.47	0.00	0.37	0.07	0.33	0.08	
09/02/2025 01:45:00			0.03		0.13	0.11		0.46	0.00	0.37	0.07	0.32	0.09	
09/02/2025 02:00:00			0.03		0.13	0.11		0.46	0.00	0.37	0.07	0.31	0.08	
09/02/2025 02:15:00			0.03		0.13	0.11		0.46	0.00	0.37	0.07	0.31	0.09	
09/02/2025 02:30:00			0.03		0.13	0.11		0.46	0.00	0.37	0.07	0.30	0.09	
09/02/2025 02:45:00			0.03		0.13	0.11		0.46	0.00	0.37	0.07	0.30	0.08	
09/02/2025 03:00:00			0.03		0.13	0.11		0.46	0.00	0.37	0.07	0.29	0.08	
09/02/2025 03:15:00			0.03		0.13	0.11		0.46	0.00	0.37	0.06	0.29	0.08	
09/02/2025 03:30:00			0.03		0.13	0.11		0.46	0.00	0.37	0.06	0.29	0.09	
09/02/2025 03:45:00			0.03		0.13	0.11		0.46	0.00	0.37	0.06	0.29	0.07	
09/02/2025 04:00:00			0.03		0.13	0.11		0.46	0.00	0.37	0.06	0.30	0.07	
09/02/2025 04:15:00			0.03		0.12	0.11		0.45	0.00	0.37	0.06	0.33	0.06	
09/02/2025 04:30:00			0.03		0.12	0.11		0.45	0.00	0.37	0.07	0.38	0.03	
09/02/2025 04:45:00			0.03		0.12	0.11		0.46	0.00	0.37	0.07	0.40	0.01	
09/02/2025 05:00:00			0.03		0.12	0.11		0.46	0.00	0.37	0.08	0.41	0.03	
09/02/2025 05:15:00			0.03		0.12	0.11		0.46	0.00	0.37	0.07	0.42	0.03	
09/02/2025 05:30:00			0.03		0.12	0.11		0.46	0.00	0.37	0.07	0.43	0.03	
09/02/2025 05:45:00			0.03		0.12	0.11		0.46	0.00	0.37	0.07	0.44	0.02	
09/02/2025 06:00:00			0.02		0.12	0.11		0.46	0.00	0.37	0.07	0.45	0.02	
09/02/2025 06:15:00			0.02		0.12	0.11		0.46	0.00	0.37	0.07	0.45	0.02	
09/02/2025 06:30:00			0.02		0.12	0.11		0.46	0.00	0.37	0.08	0.46	0.02	
09/02/2025 06:45:00			0.03		0.12	0.11		0.46	0.00	0.37	0.08	0.47	0.02	
09/02/2025 07:00:00			0.02		0.12	0.11		0.46	0.00	0.37	0.08	0.48	0.00	
09/02/2025 07:15:00			0.02		0.12	0.11		0.45	0.00	0.37	0.08	0.48	0.03	
09/02/2025 07:30:00			0.03		0.12	0.11		0.45	0.00	0.37	0.07	0.49	0.03	
09/02/2025 07:45:00			0.02		0.12	0.11		0.45	0.00	0.37	0.08	0.49	0.02	
09/02/2025 08:00:00			0.03		0.12	0.11		0.45	0.00	0.37	0.08	0.50	0.02	
09/02/2025 08:15:00			0.02		0.12	0.10		0.45	0.00	0.37	0.07	0.50	0.01	
09/02/2025 08:30:00			0.02		0.12	0.10		0.45	0.00	0.37	0.07	0.51	0.02	
09/02/2025 08:45:00			0.02		0.12	0.10		0.45	0.00	0.37	0.07	0.51	0.01	
09/02/2025 09:00:00			0.02		0.12	0.10		0.45	0.00	0.37	0.06	0.52	0.01	
09/02/2025 09:15:00			0.02		0.12	0.10		0.45	0.00	0.38	0.07	0.52	0.01	
09/02/2025 09:30:00			0.02		0.12	0.10		0.45	0.00	0.38	0.07	0.52	0.01	
09/02/2025 09:45:00			0.02		0.12	0.10		0.45	0.00	0.38	0.07	0.53	0.01	
09/02/2025 10:00:00			0.02		0.12	0.10		0.46	0.00	0.38	0.05	0.53	0.01	
09/02/2025 10:15:00			0.02		0.12	0.10		0.46	0.00	0.38	0.06	0.54	0.02	
09/02/2025 10:30:00			0.02		0.12	0.10		0.46	0.00	0.38	0.06	0.54	0.01	
09/02/2025 10:45:00			0.02		0.12	0.10		0.46	0.00	0.38	0.06	0.54	0.01	
09/02/2025 11:00:00			0.02		0.12	0.10		0.46	0.00	0.38	0.06	0.55	0.02	
09/02/2025 11:15:00			0.02		0.12	0.10		0.47	0.00	0.38	0.05	0.54	0.01	
09/02/2025 11:30:00			0.02		0.12	0.10		0.47	0.00	0.38	0.05	0.52	0.05	
09/02/2025 11:45:00			0.02		0.12	0.10		0.47	0.00	0.38	0.05	0.50	0.03	
09/02/2025 12:00:00			0.02		0.12	0.10		0.47	0.00	0.38	0.05	0.47	0.06	
09/02/2025 12:15:00			0.02		0.12	0.10		0.47	0.00	0.38	0.05	0.46	0.06	
09/02/2025 12:30:00			0.02		0.12	0.10		0.47	0.00	0.38	0.05	0.44	0.06	
09/02/2025 12:45:00			0.02		0.12	0.10		0.48	0.00	0.38	0.05	0.42	0.08	
09/02/2025 13:00:00			0.02		0.12	0.10		0.48	0.00	0.38	0.06	0.41	0.06	
09/02/2025 13:15:00			0.02		0.12	0.10		0.48	0.00	0.38	0.05	0.39	0.06	
09/02/2025 13:30:00			0.02		0.12	0.11		0.48	0.00	0.38	0.05	0.38	0.09	
09/02/2025 13:45:00			0.03		0.12	0.10		0.48	0.00	0.38	0.06	0.37	0.09	
09/02/2025 14:00:00			0.03		0.12	0.11		0.48	0.00	0.38	0.06	0.36	0.09	
09/02/2025 14:15:00			0.03		0.12	0.10		0.48	0.00	0.38	0.05	0.35	0.09	
09/02/2025 14:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.34	0.09	
09/02/2025 14:45:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.33	0.09	
09/02/2025 15:00:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.33	0.07	
09/02/2025 15:15:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.32	0.06	
09/02/2025 15:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.31	0.08	
09/02/2025 15:45:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.31	0.06	
09/02/2025 16:00:00			0.03		0.12	0.11		0.48	0.00	0.37	0.04	0.30	0.07	
09/02/2025 16:15:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.30	0.06	
09/02/2025 16:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.04	0.30	0.07	
09/02/2025 16:45:00			0.03		0.12	0.11		0.48	0.00	0.37	0.04	0.30	0.06	
09/02/2025 17:00:00			0.03		0.12	0.11		0.48	0.00	0.37	0.04	0.33	0.05	
09/02/2025 17:15:00			0.03		0.12	0.11		0.48	0.00	0.37	0.04	0.37	0.04	
09/02/2025 17:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.04	0.40	0.02	
09/02/2025 17:45:00			0.03		0.12	0.11		0.48	0.00	0.37	0.06	0.41	0.03	
09/02/2025 18:00:00			0.03		0.12	0.11		0.48	0.00	0.37	0.06	0.42	0.02	
09/02/2025 18:15:00			0.03		0.12	0.11		0.48	0.00	0.37	0.07	0.43	0.03	
09/02/2025 18:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.06	0.44	0.02	
09/02/2025 18:45:00			0.03		0.12	0.11		0.48	0.00	0.37	0.06	0.45	0.03	
09/02/2025 19:00:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.46	0.03	
09/02/2025 19:15:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.46	0.02	
09/02/2025 19:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.05	0.47	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
09/02/2025 19:45:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.48	0.03	
09/02/2025 20:00:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.48	0.02	
09/02/2025 20:15:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.49	0.03	
09/02/2025 20:30:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.49	0.02	
09/02/2025 20:45:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.50	0.03	
09/02/2025 21:00:00			0.03		0.12	0.11		0.49	0.00	0.37	0.05	0.50	0.01	
09/02/2025 21:15:00			0.03		0.12	0.11		0.49	0.00	0.37	0.05	0.51	0.02	
09/02/2025 21:30:00			0.03		0.12	0.11		0.49	0.00	0.37	0.05	0.51	0.02	
09/02/2025 21:45:00			0.03		0.12	0.11		0.49	0.00	0.37	0.05	0.52	0.02	
09/02/2025 22:00:00			0.03		0.13	0.11		0.49	0.00	0.37	0.05	0.52	0.02	
09/02/2025 22:15:00			0.04		0.13	0.11		0.48	0.00	0.37	0.05	0.52	0.02	
09/02/2025 22:30:00			0.03		0.13	0.11		0.48	0.00	0.37	0.05	0.53	0.01	
09/02/2025 22:45:00			0.04		0.13	0.11		0.48	0.00	0.37	0.05	0.53	0.02	
09/02/2025 23:00:00			0.04		0.13	0.11		0.49	0.00	0.37	0.05	0.53	0.01	
09/02/2025 23:15:00			0.04		0.13	0.11		0.49	0.00	0.37	0.05	0.53	0.02	
09/02/2025 23:30:00			0.04		0.13	0.11		0.49	0.00	0.37	0.05	0.51	0.03	
09/02/2025 23:45:00			0.04		0.13	0.11		0.49	0.00	0.38	0.05	0.49	0.06	
10/02/2025 00:00:00			0.04		0.13	0.11		0.48	0.00	0.38	0.05	0.47	0.07	
10/02/2025 00:15:00			0.04		0.13	0.11		0.48	0.00	0.38	0.05	0.45	0.07	
10/02/2025 00:30:00			0.04		0.13	0.11		0.48	0.00	0.38	0.06	0.43	0.07	
10/02/2025 00:45:00			0.04		0.13	0.11		0.48	0.00	0.38	0.05	0.41	0.09	
10/02/2025 01:00:00			0.04		0.13	0.11		0.48	0.00	0.38	0.05	0.40	0.09	
10/02/2025 01:15:00			0.04		0.13	0.11		0.47	0.00	0.38	0.06	0.38	0.08	
10/02/2025 01:30:00			0.04		0.13	0.11		0.47	0.00	0.37	0.05	0.37	0.08	
10/02/2025 01:45:00			0.04		0.13	0.11		0.47	0.00	0.37	0.05	0.36	0.09	
10/02/2025 02:00:00			0.04		0.13	0.11		0.47	0.00	0.37	0.05	0.35	0.09	
10/02/2025 02:15:00			0.04		0.13	0.11		0.47	0.00	0.37	0.05	0.34	0.09	
10/02/2025 02:30:00			0.03		0.13	0.11		0.46	0.00	0.37	0.05	0.33	0.08	
10/02/2025 02:45:00			0.03		0.12	0.11		0.46	0.00	0.37	0.06	0.32	0.08	
10/02/2025 03:00:00			0.03		0.12	0.11		0.46	0.00	0.37	0.06	0.31	0.08	
10/02/2025 03:15:00			0.03		0.12	0.11		0.46	0.00	0.37	0.05	0.31	0.08	
10/02/2025 03:30:00			0.03		0.12	0.11		0.46	0.00	0.37	0.05	0.30	0.08	
10/02/2025 03:45:00			0.03		0.12	0.11		0.46	0.00	0.37	0.05	0.29	0.08	
10/02/2025 04:00:00			0.03		0.12	0.11		0.46	0.00	0.37	0.05	0.29	0.09	
10/02/2025 04:15:00			0.03		0.12	0.11		0.46	0.00	0.37	0.05	0.28	0.09	
10/02/2025 04:30:00			0.03		0.12	0.11		0.45	0.00	0.37	0.06	0.28	0.09	
10/02/2025 04:45:00			0.03		0.12	0.11		0.45	0.00	0.37	0.06	0.27	0.07	
10/02/2025 05:00:00			0.03		0.12	0.10		0.45	0.00	0.37	0.05	0.27	0.07	
10/02/2025 05:15:00			0.03		0.12	0.10		0.45	0.00	0.36	0.05	0.27	0.06	
10/02/2025 05:30:00			0.03		0.12	0.10		0.45	0.00	0.37	0.05	0.28	0.07	
10/02/2025 05:45:00			0.03		0.12	0.10		0.45	0.00	0.36	0.06	0.31	0.06	
10/02/2025 06:00:00			0.03		0.12	0.10		0.45	0.00	0.36	0.06	0.34	0.04	
10/02/2025 06:15:00			0.02		0.12	0.10		0.45	0.00	0.36	0.06	0.36	0.04	
10/02/2025 06:30:00			0.02		0.12	0.10		0.45	0.00	0.36	0.05	0.37	0.04	
10/02/2025 06:45:00			0.02		0.12	0.10		0.45	0.00	0.36	0.05	0.39	0.02	
10/02/2025 07:00:00			0.02		0.12	0.10		0.45	0.00	0.36	0.05	0.40	0.02	
10/02/2025 07:15:00			0.02		0.11	0.10		0.45	0.00	0.36	0.06	0.41	0.02	
10/02/2025 07:30:00			0.02		0.11	0.10		0.45	0.00	0.36	0.06	0.42	0.02	
10/02/2025 07:45:00			0.02		0.11	0.10		0.45	0.00	0.36	0.06	0.43	0.02	
10/02/2025 08:00:00			0.02		0.11	0.10		0.45	0.00	0.36	0.06	0.43	0.02	
10/02/2025 08:15:00			0.02		0.11	0.10		0.45	0.00	0.36	0.06	0.44	0.02	
10/02/2025 08:30:00			0.02		0.11	0.10		0.45	0.00	0.36	0.06	0.45	0.02	
10/02/2025 08:45:00			0.02		0.11	0.10		0.46	0.00	0.36	0.06	0.45	0.01	
10/02/2025 09:00:00			0.02		0.11	0.10		0.46	0.00	0.36	0.07	0.46	0.02	
10/02/2025 09:15:00			0.02		0.11	0.10		0.46	0.00	0.36	0.06	0.47	0.02	
10/02/2025 09:30:00			0.02		0.11	0.10		0.46	0.00	0.36	0.06	0.47	0.01	
10/02/2025 09:45:00			0.02		0.11	0.10		0.47	0.00	0.37	0.06	0.48	0.02	
10/02/2025 10:00:00			0.02		0.11	0.10		0.47	0.00	0.37	0.06	0.48	0.02	
10/02/2025 10:15:00			0.02		0.11	0.10		0.47	0.00	0.37	0.06	0.49	0.04	
10/02/2025 10:30:00			0.02		0.11	0.10		0.47	0.00	0.37	0.06	0.49	0.02	
10/02/2025 10:45:00			0.02		0.11	0.10		0.47	0.00	0.37	0.01	0.49	0.03	
10/02/2025 11:00:00			0.02		0.11	0.10		0.47	0.00	0.37	0.01	0.50	0.02	
10/02/2025 11:15:00			0.02		0.11	0.10		0.47	0.00	0.37	0.01	0.50	0.02	
10/02/2025 11:30:00			0.02		0.11	0.10		0.47	0.00	0.37	0.02	0.51	0.02	
10/02/2025 11:45:00			0.02		0.11	0.10		0.47	0.00	0.37	0.03	0.51	0.02	
10/02/2025 12:00:00			0.02		0.11	0.10		0.48	0.00	0.37	0.04	0.51	0.02	
10/02/2025 12:15:00			0.02		0.11	0.10		0.48	0.00	0.37	0.04	0.50	0.03	
10/02/2025 12:30:00			0.02		0.11	0.10		0.48	0.00	0.37	0.05	0.48	0.03	
10/02/2025 12:45:00			0.02		0.11	0.10		0.48	0.00	0.37	0.05	0.45	0.05	
10/02/2025 13:00:00			0.02		0.11	0.10		0.48	0.00	0.37	0.05	0.44	0.06	
10/02/2025 13:15:00			0.02		0.11	0.10		0.48	0.00	0.37	0.04	0.42	0.06	
10/02/2025 13:30:00			0.02		0.11	0.10		0.48	0.00	0.37	0.04	0.40	0.07	
10/02/2025 13:45:00			0.02		0.12	0.10		0.48	0.00	0.37	0.04	0.39	0.08	
10/02/2025 14:00:00			0.02		0.12	0.10		0.48	0.00	0.37	0.03	0.37	0.08	
10/02/2025 14:15:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.36	0.09	
10/02/2025 14:30:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.35	0.09	
10/02/2025 14:45:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.34	0.09	
10/02/2025 15:00:00			0.02		0.12	0.10		0.48	0.00	0.37	0.04	0.33	0.09	
10/02/2025 15:15:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.32	0.08	
10/02/2025 15:30:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.31	0.08	
10/02/2025 15:45:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.30	0.08	
10/02/2025 16:00:00			0.02		0.12	0.10		0.48	0.00	0.37	0.05	0.29	0.08	
10/02/2025 16:15:00			0.03		0.12	0.10		0.48	0.00	0.37	0.05	0.29	0.08	
10/02/2025 16:30:00			0.03		0.12	0.10		0.48	0.00	0.37	0.05	0.28	0.07	
10/02/2025 16:45:00			0.03		0.12	0.10		0.48	0.00	0.37	0.06	0.28	0.08	
10/02/2025 17:00:00			0.03		0.12	0.10		0.49	0.00	0.37	0.06	0.28	0.08	
10/02/2025 17:15:00			0.03		0.12	0.10		0.50	0.00	0.37	0.06	0.28	0.06	
10/02/2025 17:30:00			0.03		0.12	0.11		0.51	0.00	0.37	0.06	0.30	0.06	
10/02/2025 17:45:00			0.03		0.12	0.11		0.52	0.00	0.37	0.06	0.32	0.06	
10/02/2025 18:00:00			0.03		0.12	0.11		0.53	0.00	0.37	0.06	0.34	0.05	
10/02/2025 18:15:00			0.03		0.12	0.11		0.54	0.00	0.37	0.06	0.36	0.04	
10/02/2025 18:30:00			0.03		0.12	0.11		0.54	0.00	0.37	0.05	0.38	0.04	
10/02/2025 18:45:00			0.03		0.13	0.11		0.54	0.00	0.37	0.06	0.39	0.03	
10/02/2025 19:00:00			0.04		0.13	0.11		0.54	0.00	0.37	0.06	0.41	0.03	
10/02/2025 19:15:00			0.04		0.13	0.12		0.54	0.00	0.37	0.06	0.42	0.03	
10/02/2025 19:30:00			0.04		0.14	0.12		0.54	0.00	0.37	0.06	0.42	0.02	
10/02/2025 19:45:00			0.05		0.14	0.12		0.54	0.00	0.37	0.06	0.43	0.02	
10/02/2025 20:00:00			0.05		0.14	0.12		0.55	0.00	0.37	0.06	0.44	0.02	
10/02/2025 20:15:00			0.05		0.14	0.12		0.55	0.00	0.37	0.06	0.45	0.02	
10/02/2025 20:30:00			0.06		0.15	0.13		0.56	0.00	0.37	0.06	0.46	0.02	
10/02/2025 20:45:00			0.06		0.15	0.13		0.56	0.00	0.37	0.06	0.46	0.02	
10/02/2025 21:00:00			0.06		0.15	0.13		0.56	0.00	0.37	0.06	0.47	0.02	
10/02/2025 21:15:00			0.06		0.15	0.13		0.57	0.00	0.37	0.06	0.48	0.02	
10/02/2025 21:30:00			0.07		0.15	0.14		0.57	0.00	0.37	0.06	0.48	0.02	
10/02/2025 21:45:00			0.07		0.16	0.14		0.57	0.00	0.37	0.06	0.49	0.03	
10/02/2025 22:00:00			0.07		0.16	0.14		0.57	0.00	0.37	0.06	0.49	0.02	
10/02/2025 22:15:00			0.08		0.16	0.14		0.57	0.00	0.37	0.06	0.50	0.02	
10/02/2025 22:30:00			0.08		0.16	0.14		0.57	0.00	0.37	0.06	0.50	0.02	
10/02/2025 22:45:00			0.08		0.17	0.14		0.57	0.00	0.38	0.06	0.51	0.02	
10/02/2025 23:00:00			0.08		0.17	0.15		0.56	0.00	0.38	0.07	0.51	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
10/02/2025 23:15:00			0.09		0.17	0.15		0.56	0.00	0.38	0.06	0.52	0.02	
10/02/2025 23:30:00			0.09		0.17	0.15		0.55	0.00	0.38	0.06	0.52	0.02	
10/02/2025 23:45:00			0.09		0.17	0.15		0.55	0.00	0.38	0.06	0.53	0.02	
11/02/2025 00:00:00			0.09		0.17	0.15		0.55	0.00	0.38	0.06	0.53	0.02	
11/02/2025 00:15:00			0.09		0.17	0.15		0.55	0.00	0.38	0.06	0.51	0.03	
11/02/2025 00:30:00			0.09		0.17	0.15		0.54	0.00	0.38	0.06	0.49	0.05	
11/02/2025 00:45:00			0.09		0.17	0.15		0.54	0.00	0.38	0.06	0.46	0.06	
11/02/2025 01:00:00			0.09		0.17	0.15		0.54	0.00	0.38	0.07	0.44	0.06	
11/02/2025 01:15:00			0.09		0.17	0.15		0.54	0.00	0.39	0.07	0.43	0.07	
11/02/2025 01:30:00			0.09		0.17	0.15		0.53	0.00	0.39	0.06	0.41	0.07	
11/02/2025 01:45:00			0.09		0.17	0.15		0.53	0.00	0.39	0.06	0.39	0.08	
11/02/2025 02:00:00			0.08		0.17	0.15		0.53	0.00	0.38	0.06	0.38	0.08	
11/02/2025 02:15:00			0.08		0.17	0.15		0.53	0.00	0.38	0.07	0.37	0.09	
11/02/2025 02:30:00			0.08		0.17	0.15		0.53	0.00	0.38	0.07	0.36	0.10	
11/02/2025 02:45:00			0.08		0.17	0.15		0.53	0.00	0.38	0.06	0.35	0.10	
11/02/2025 03:00:00			0.08		0.17	0.15		0.53	0.00	0.38	0.06	0.34	0.08	
11/02/2025 03:15:00			0.08		0.16	0.15		0.52	0.00	0.38	0.07	0.34	0.09	
11/02/2025 03:30:00			0.08		0.16	0.15		0.52	0.00	0.38	0.07	0.33	0.09	
11/02/2025 03:45:00			0.08		0.16	0.15		0.52	0.00	0.38	0.07	0.32	0.10	
11/02/2025 04:00:00			0.08		0.16	0.14		0.52	0.00	0.38	0.07	0.32	0.08	
11/02/2025 04:15:00			0.08		0.16	0.14		0.53	0.00	0.38	0.07	0.31	0.08	
11/02/2025 04:30:00			0.08		0.16	0.14		0.53	0.00	0.38	0.07	0.30	0.09	
11/02/2025 04:45:00			0.08		0.16	0.14		0.53	0.00	0.38	0.07	0.30	0.09	
11/02/2025 05:00:00			0.07		0.16	0.14		0.53	0.00	0.38	0.07	0.29	0.07	
11/02/2025 05:15:00			0.07		0.16	0.14		0.53	0.00	0.38	0.07	0.29	0.08	
11/02/2025 05:30:00			0.07		0.16	0.14		0.53	0.00	0.38	0.07	0.29	0.08	
11/02/2025 05:45:00			0.07		0.16	0.14		0.53	0.00	0.38	0.06	0.28	0.10	
11/02/2025 06:00:00			0.08		0.16	0.14		0.53	0.00	0.38	0.08	0.28	0.10	
11/02/2025 06:15:00			0.07		0.16	0.14		0.53	0.00	0.38	0.08	0.28	0.09	
11/02/2025 06:30:00			0.07		0.16	0.14		0.53	0.00	0.38	0.08	0.29	0.09	
11/02/2025 06:45:00			0.07		0.16	0.14						0.31	0.07	
11/02/2025 07:00:00			0.07		0.16	0.14						0.34	0.07	
11/02/2025 07:15:00			0.07		0.16	0.14						0.36	0.07	
11/02/2025 07:30:00			0.07		0.16	0.14						0.38	0.05	
11/02/2025 07:45:00			0.07		0.16	0.14						0.39	0.04	
11/02/2025 08:00:00			0.07		0.16	0.14						0.41	0.04	
11/02/2025 08:15:00			0.07		0.16	0.14						0.42	0.03	
11/02/2025 08:30:00			0.07		0.16	0.14								
11/02/2025 08:45:00			0.07		0.16	0.14								
11/02/2025 09:00:00			0.07		0.16	0.14				0.38	0.08			
11/02/2025 09:15:00			0.07		0.16	0.14				0.38	0.08			
11/02/2025 09:30:00			0.07		0.16	0.14				0.38	0.08			
11/02/2025 09:45:00			0.07		0.16	0.14				0.38	0.08			
11/02/2025 10:00:00			0.07		0.16	0.14				0.38	0.08			
11/02/2025 10:15:00			0.07		0.16	0.14				0.38	0.07	0.48	0.03	
11/02/2025 10:30:00			0.07		0.16	0.14				0.39	0.07	0.49	0.01	
11/02/2025 10:45:00			0.07		0.16	0.14				0.39	0.08	0.50	0.02	
11/02/2025 11:00:00			0.08		0.16	0.14				0.39	0.08	0.50	0.02	
11/02/2025 11:15:00			0.08		0.16	0.14				0.39	0.06	0.51	0.03	
11/02/2025 11:30:00			0.08		0.17	0.14				0.39	0.08	0.51	0.02	
11/02/2025 11:45:00			0.08		0.16	0.14				0.39	0.08	0.52	0.02	
11/02/2025 12:00:00			0.08		0.16	0.14				0.39	0.08	0.53	0.02	
11/02/2025 12:15:00			0.08		0.16	0.14				0.39	0.08	0.53	0.03	
11/02/2025 12:30:00			0.07		0.16	0.14				0.40	0.09	0.54	0.03	
11/02/2025 12:45:00			0.07		0.16	0.14				0.40	0.09	0.51	0.03	
11/02/2025 13:00:00			0.07		0.16	0.14		0.51	0.00	0.40	0.08	0.49	0.03	
11/02/2025 13:15:00			0.07		0.16	0.14		0.51	0.00	0.40	0.08	0.47	0.06	
11/02/2025 13:30:00			0.07		0.16	0.14		0.50	0.00	0.40	0.08	0.45	0.06	
11/02/2025 13:45:00			0.07		0.16	0.14		0.50	0.00	0.40	0.08	0.43	0.08	
11/02/2025 14:00:00			0.07		0.16	0.14		0.50	0.00	0.40	0.08	0.42	0.09	
11/02/2025 14:15:00			0.07		0.16	0.14		0.50	0.00	0.40	0.08	0.40	0.07	
11/02/2025 14:30:00			0.07		0.16	0.14		0.50	0.00	0.40	0.08	0.39	0.09	
11/02/2025 14:45:00			0.07		0.16	0.14		0.51	0.00	0.40	0.08	0.38	0.09	
11/02/2025 15:00:00			0.07		0.16	0.14		0.51	0.00	0.40	0.08	0.37	0.10	
11/02/2025 15:15:00			0.07		0.16	0.14		0.50	0.00	0.40	0.07	0.36	0.08	
11/02/2025 15:30:00			0.07		0.16	0.14		0.50	0.00	0.40	0.08	0.36	0.10	
11/02/2025 15:45:00			0.07		0.16	0.14		0.50	0.00	0.40	0.07	0.35	0.10	
11/02/2025 16:00:00			0.07		0.16	0.14		0.50	0.00	0.39	0.07	0.34	0.08	
11/02/2025 16:15:00			0.07		0.16	0.14		0.50	0.00	0.39	0.08	0.34	0.10	
11/02/2025 16:30:00			0.07		0.16	0.14		0.50	0.00	0.39	0.08	0.33	0.10	
11/02/2025 16:45:00			0.07		0.16	0.14		0.50	0.00	0.39	0.08	0.33	0.08	
11/02/2025 17:00:00			0.06		0.16	0.14		0.50	0.00	0.39	0.08	0.32	0.10	
11/02/2025 17:15:00			0.06		0.16	0.14		0.50	0.00	0.39	0.08	0.32	0.10	
11/02/2025 17:30:00			0.06		0.16	0.14		0.50	0.00	0.39	0.07	0.31	0.09	
11/02/2025 17:45:00			0.06		0.15	0.14		0.49	0.00	0.39	0.07	0.31	0.09	
11/02/2025 18:00:00			0.06		0.15	0.14		0.50	0.00	0.39	0.08	0.31	0.08	
11/02/2025 18:15:00			0.06		0.15	0.13		0.50	0.00	0.39	0.09	0.32	0.08	
11/02/2025 18:30:00			0.06		0.15	0.13		0.50	0.00	0.39	0.09	0.34	0.08	
11/02/2025 18:45:00			0.06		0.15	0.13		0.50	0.00	0.39	0.08	0.37	0.07	
11/02/2025 19:00:00			0.06		0.15	0.13		0.50	0.00	0.39	0.08	0.39	0.07	
11/02/2025 19:15:00			0.06		0.15	0.13		0.50	0.00	0.39	0.08	0.41	0.05	
11/02/2025 19:30:00			0.06		0.15	0.13		0.50	0.00	0.39	0.08	0.43	0.04	
11/02/2025 19:45:00			0.06		0.15	0.13		0.50	0.00	0.39	0.08	0.44	0.03	
11/02/2025 20:00:00			0.06		0.15	0.13		0.50	0.00	0.39	0.08	0.45	0.03	
11/02/2025 20:15:00			0.06		0.15	0.13		0.50	0.00	0.39	0.09	0.47	0.03	
11/02/2025 20:30:00			0.06		0.15	0.13		0.50	0.00	0.39	0.09	0.48	0.02	
11/02/2025 20:45:00			0.06		0.15	0.13		0.50	0.00	0.39	0.09	0.49	0.02	
11/02/2025 21:00:00			0.06		0.15	0.13		0.50	0.00	0.39	0.08	0.50	0.03	
11/02/2025 21:15:00			0.06		0.15	0.13		0.50	0.00	0.39	0.08	0.50	0.02	
11/02/2025 21:30:00			0.06		0.15	0.13		0.50	0.00	0.39	0.09	0.51	0.02	
11/02/2025 21:45:00			0.06		0.15	0.13		0.50	0.00	0.39	0.09	0.52	0.02	
11/02/2025 22:00:00			0.06		0.15	0.13		0.50	0.00	0.39	0.08	0.53	0.03	
11/02/2025 22:15:00			0.06		0.15	0.13		0.50	0.00	0.39	0.09	0.53	0.03	
11/02/2025 22:30:00			0.06		0.15	0.13		0.50	0.00	0.39	0.08	0.54	0.01	
11/02/2025 22:45:00			0.06		0.15	0.13		0.50	0.00	0.40	0.08	0.55	0.03	
11/02/2025 23:00:00			0.06		0.15	0.13		0.50	0.00	0.40	0.09	0.55	0.03	
11/02/2025 23:15:00			0.06		0.15	0.13		0.50	0.00	0.40	0.09	0.56	0.02	
11/02/2025 23:30:00			0.06		0.15	0.13		0.50	0.00	0.40	0.09	0.57	0.02	
11/02/2025 23:45:00			0.06		0.15	0.13		0.50	0.00	0.40	0.09	0.57	0.02	
12/02/2025 00:00:00			0.06		0.15	0.13		0.49	0.00	0.40	0.09	0.58	0.03	
12/02/2025 00:15:00			0.06		0.15	0.13		0.49	0.00	0.41	0.08	0.58	0.02	
12/02/2025 00:30:00			0.06		0.15	0.13		0.49	0.00	0.41	0.08	0.58	0.03	
12/02/2025 00:45:00			0.06		0.15	0.13		0.49	0.00	0.41	0.09	0.56	0.05	
12/02/2025 01:00:00			0.06		0.15	0.13		0.49	0.00	0.41	0.09	0.53	0.05	
12/02/2025 01:15:00			0.06		0.15	0.13		0.49	0.00	0.42	0.09	0.50	0.08	
12/02/2025 01:30:00			0.06		0.15	0.13		0.48	0.00	0.42	0.09	0.48	0.08	
12/02/2025 01:45:00			0.06		0.15	0.13		0.48	0.00	0.42	0.08	0.46	0.09	
12/02/2025 02:00:00			0.06		0.15	0.13		0.48	0.00	0.41	0.09	0.45	0.08	
12/02/2025 02:15:00			0.06		0.15	0.13		0.48	0.00	0.41	0.08	0.43	0.10	
12/02/2025 02:30:00			0.06		0.15	0.13		0.48	0.00	0.41	0.08	0.42	0.08	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
12/02/2025 02:45:00			0.06		0.15	0.13		0.47	0.00	0.41	0.09	0.41	0.08	
12/02/2025 03:00:00			0.06		0.15	0.13		0.47	0.00	0.41	0.08	0.40	0.09	
12/02/2025 03:15:00			0.05		0.15	0.13		0.47	0.00	0.40	0.08	0.39	0.09	
12/02/2025 03:30:00			0.05		0.15	0.13		0.47	0.00	0.40	0.08	0.39	0.09	
12/02/2025 03:45:00			0.05		0.14	0.13		0.47	0.00	0.40	0.08	0.38	0.09	
12/02/2025 04:00:00			0.05		0.14	0.13		0.47	0.00	0.40	0.09	0.37	0.09	
12/02/2025 04:15:00			0.05		0.14	0.13		0.47	0.00	0.40	0.07	0.37	0.09	
12/02/2025 04:30:00			0.05		0.14	0.13		0.47	0.00	0.40	0.08	0.36	0.09	
12/02/2025 04:45:00			0.05		0.14	0.13		0.47	0.00	0.39	0.08	0.35	0.09	
12/02/2025 05:00:00			0.05		0.14	0.12		0.46	0.00	0.39	0.08	0.35	0.10	
12/02/2025 05:15:00			0.05		0.14	0.12		0.46	0.00	0.39	0.08	0.34	0.09	
12/02/2025 05:30:00			0.05		0.14	0.12		0.46	0.00	0.39	0.08	0.34	0.09	
12/02/2025 05:45:00			0.05		0.14	0.12		0.46	0.00	0.39	0.08	0.33	0.09	
12/02/2025 06:00:00			0.05		0.14	0.12		0.46	0.00	0.39	0.08	0.33	0.09	
12/02/2025 06:15:00			0.04		0.14	0.12		0.46	0.00	0.39	0.08	0.32	0.10	
12/02/2025 06:30:00			0.04		0.14	0.12		0.46	0.00	0.39	0.08	0.32	0.10	
12/02/2025 06:45:00			0.04		0.14	0.12		0.46	0.00	0.39	0.07	0.31	0.08	
12/02/2025 07:00:00			0.04		0.14	0.12		0.46	0.00	0.39	0.08	0.31	0.09	
12/02/2025 07:15:00			0.04		0.13	0.12		0.46	0.00	0.39	0.08	0.31	0.09	
12/02/2025 07:30:00			0.04		0.13	0.12		0.46	0.00	0.39	0.08	0.31	0.07	
12/02/2025 07:45:00			0.04		0.13	0.12		0.46	0.00	0.38	0.09	0.33	0.07	
12/02/2025 08:00:00			0.04		0.13	0.12		0.46	0.00	0.38	0.09	0.36	0.06	
12/02/2025 08:15:00			0.04					0.47	0.00	0.38	0.09	0.39	0.04	
12/02/2025 08:30:00			0.04					0.47	0.00	0.38	0.08	0.41	0.04	
12/02/2025 08:45:00			0.04		0.13	0.13		0.47	0.00	0.38	0.08	0.43	0.03	
12/02/2025 09:00:00			0.04		0.13	0.13		0.47	0.00	0.38	0.07	0.45	0.03	
12/02/2025 09:15:00			0.04		0.13	0.13		0.48	0.00	0.38	0.08	0.46	0.03	
12/02/2025 09:30:00			0.04		0.13	0.13		0.48	0.00	0.38	0.08	0.48	0.01	
12/02/2025 09:45:00			0.04		0.13	0.13		0.48	0.00	0.38	0.08	0.49	0.02	
12/02/2025 10:00:00			0.04		0.13	0.13		0.48	0.00	0.38	0.08	0.50	0.02	
12/02/2025 10:15:00			0.04		0.13	0.13		0.48	0.00	0.38	0.07	0.51	0.02	
12/02/2025 10:30:00			0.04		0.13	0.13		0.48	0.00	0.38	0.07	0.52	0.02	
12/02/2025 10:45:00			0.04		0.13	0.13		0.48	0.00	0.39	0.07	0.53	0.02	
12/02/2025 11:00:00			0.04		0.13	0.13		0.48	0.00	0.39	0.07	0.53	0.02	
12/02/2025 11:15:00			0.04		0.13	0.13		0.48	0.00	0.39	0.08	0.54	0.02	
12/02/2025 11:30:00			0.04		0.13	0.13		0.49	0.00	0.39	0.08	0.55	0.02	
12/02/2025 11:45:00			0.04		0.13	0.13		0.49	0.00	0.39	0.08	0.55	0.01	
12/02/2025 12:00:00			0.04		0.13	0.13		0.49	0.00	0.39	0.09	0.56	0.01	
12/02/2025 12:15:00			0.04		0.13	0.13		0.50	0.00	0.39	0.08	0.57	0.02	
12/02/2025 12:30:00			0.04		0.13	0.13		0.50	0.00	0.40	0.08	0.57	0.02	
12/02/2025 12:45:00			0.04		0.13	0.13		0.50	0.00	0.40	0.07	0.58	0.01	
12/02/2025 13:00:00			0.04		0.13	0.13		0.50	0.00	0.40	0.08	0.59	0.02	
12/02/2025 13:15:00			0.05		0.13	0.13		0.50	0.00	0.40	0.08	0.59	0.02	
12/02/2025 13:30:00			0.05		0.14	0.13		0.50	0.00	0.41	0.07	0.57	0.02	
12/02/2025 13:45:00			0.05		0.14	0.13		0.51	0.00	0.41	0.07	0.55	0.04	
12/02/2025 14:00:00			0.05		0.14	0.13		0.51	0.00	0.41	0.08	0.52	0.06	
12/02/2025 14:15:00			0.05		0.14	0.13		0.51	0.00	0.41	0.08	0.50	0.06	
12/02/2025 14:30:00			0.05		0.14	0.13		0.51	0.00	0.41	0.07	0.48	0.07	
12/02/2025 14:45:00			0.05		0.14	0.13		0.51	0.00	0.41	0.06	0.47	0.07	
12/02/2025 15:00:00			0.05		0.14	0.13		0.51	0.00	0.41	0.06	0.45	0.08	
12/02/2025 15:15:00			0.05		0.14	0.13		0.51	0.00	0.41	0.07	0.44	0.09	
12/02/2025 15:30:00			0.05		0.14	0.13		0.51	0.00	0.40	0.07	0.42	0.09	
12/02/2025 15:45:00			0.05		0.14	0.13		0.51	0.00	0.40	0.07	0.41	0.08	
12/02/2025 16:00:00			0.06		0.14	0.13		0.51	0.00	0.40	0.07	0.40	0.08	
12/02/2025 16:15:00			0.06		0.14	0.13		0.50	0.00	0.40	0.07	0.39	0.08	
12/02/2025 16:30:00			0.06		0.14	0.13		0.50	0.00	0.40	0.07	0.39	0.08	
12/02/2025 16:45:00			0.06		0.14	0.13		0.50	0.00	0.39	0.07	0.38	0.08	
12/02/2025 17:00:00			0.06		0.14	0.13		0.49	0.00	0.39	0.07	0.37	0.09	
12/02/2025 17:15:00			0.06		0.14	0.13		0.49	0.00	0.39	0.07	0.36	0.09	
12/02/2025 17:30:00			0.06		0.14	0.13		0.49	0.00	0.39	0.07	0.36	0.09	
12/02/2025 17:45:00			0.06		0.14	0.13		0.49	0.00	0.39	0.07	0.35	0.09	
12/02/2025 18:00:00			0.06		0.14	0.13		0.49	0.00	0.39	0.07	0.35	0.09	
12/02/2025 18:15:00			0.06		0.14	0.13		0.49	0.00	0.38	0.07	0.35	0.08	
12/02/2025 18:30:00			0.06		0.14	0.13		0.49	0.00	0.38	0.07	0.36	0.08	
12/02/2025 18:45:00			0.06		0.14	0.13		0.49	0.00	0.38	0.07	0.39	0.07	
12/02/2025 19:00:00			0.05		0.14	0.13		0.49	0.00	0.38	0.07	0.43	0.07	
12/02/2025 19:15:00			0.05		0.14	0.13		0.49	0.00	0.38	0.08	0.45	0.03	
12/02/2025 19:30:00			0.05		0.14	0.13		0.49	0.00	0.38	0.07	0.47	0.03	
12/02/2025 19:45:00			0.05		0.14	0.13		0.49	0.00	0.38	0.07	0.48	0.03	
12/02/2025 20:00:00			0.05		0.14	0.13		0.49	0.00	0.38	0.08	0.49	0.02	
12/02/2025 20:15:00			0.05		0.14	0.13		0.48	0.00	0.38	0.08	0.51	0.01	
12/02/2025 20:30:00			0.05		0.14	0.13		0.48	0.00	0.38	0.07	0.52	0.02	
12/02/2025 20:45:00			0.05		0.14	0.13		0.49	0.00	0.38	0.07	0.53	0.02	
12/02/2025 21:00:00			0.05		0.14	0.13		0.49	0.00	0.38	0.07	0.53	0.02	
12/02/2025 21:15:00			0.05		0.14	0.13		0.49	0.00	0.38	0.07	0.54	0.00	
12/02/2025 21:30:00			0.05		0.14	0.13		0.49	0.00	0.38	0.07	0.55	0.02	
12/02/2025 21:45:00			0.05		0.14	0.13		0.49	0.00	0.39	0.08	0.56	0.02	
12/02/2025 22:00:00			0.05		0.14	0.13		0.49	0.00	0.39	0.07	0.56	0.01	
12/02/2025 22:15:00			0.05		0.14	0.13		0.49	0.00	0.39	0.08	0.57	0.01	
12/02/2025 22:30:00			0.05		0.14	0.13		0.49	0.00	0.39	0.08	0.58	0.01	
12/02/2025 22:45:00			0.05		0.14	0.13		0.49	0.00	0.40	0.07	0.58	0.01	
12/02/2025 23:00:00			0.05		0.14	0.13		0.48	0.00	0.40	0.07	0.59	0.01	
12/02/2025 23:15:00			0.05		0.14	0.13		0.48	0.00	0.40	0.07	0.59	0.01	
12/02/2025 23:30:00			0.05		0.14	0.13		0.48	0.00	0.40	0.08	0.60	0.01	
12/02/2025 23:45:00			0.05		0.13	0.13		0.47	0.00	0.41	0.07	0.60	0.01	
13/02/2025 00:00:00			0.05		0.13	0.13		0.48	0.00	0.41	0.07	0.61	0.01	
13/02/2025 00:15:00			0.05		0.13	0.13		0.48	0.00	0.41	0.08	0.61	0.01	
13/02/2025 00:30:00			0.05		0.13	0.13		0.48	0.00	0.42	0.07	0.62	0.01	
13/02/2025 00:45:00			0.05		0.13	0.13		0.48	0.00	0.42	0.07	0.62	0.01	
13/02/2025 01:00:00			0.05		0.13	0.13		0.48	0.00	0.42	0.07	0.63	0.01	
13/02/2025 01:15:00			0.05		0.13	0.13		0.48	0.00	0.43	0.07	0.63	0.00	
13/02/2025 01:30:00			0.05		0.13	0.13		0.48	0.00	0.43	0.06	0.62	0.02	
13/02/2025 01:45:00			0.05		0.13	0.13		0.48	0.00	0.43	0.07	0.59	0.03	
13/02/2025 02:00:00			0.05		0.13	0.13		0.48	0.00	0.43	0.03	0.56	0.03	
13/02/2025 02:15:00			0.05		0.13	0.13		0.47	0.00	0.43	0.03	0.54	0.07	
13/02/2025 02:30:00			0.05		0.13	0.13		0.47	0.00	0.43	0.05	0.52	0.07	
13/02/2025 02:45:00			0.05		0.13	0.13		0.47	0.00	0.43	0.05	0.50	0.10	
13/02/2025 03:00:00			0.05		0.13	0.12		0.47	0.00	0.42	0.06	0.48	0.10	
13/02/2025 03:15:00			0.05		0.13	0.12		0.47	0.00	0.42	0.06	0.47	0.09	
13/02/2025 03:30:00			0.05		0.13	0.12		0.46	0.00	0.42	0.06	0.45	0.08	
13/02/2025 03:45:00			0.04		0.13	0.12		0.46	0.00	0.41	0.06	0.44	0.07	
13/02/2025 04:00:00			0.04		0.13	0.12		0.46	0.00	0.41	0.07	0.43	0.08	
13/02/2025 04:15:00			0.04		0.13	0.12		0.46	0.00	0.41	0.06	0.42	0.09	
13/02/2025 04:30:00			0.04		0.13	0.12		0.46	0.00	0.40	0.07	0.41	0.09	
13/02/2025 04:45:00			0.04		0.13	0.12		0.46	0.00	0.40	0.07	0.40	0.09	
13/02/2025 05:00:00			0.04		0.13	0.12		0.45	0.00	0.40	0.06	0.39	0.10	
13/02/2025 05:15:00			0.04		0.13	0.12		0.45	0.00	0.39	0.06	0.39	0.10	
13/02/2025 05:30:00			0.04		0.13	0.12		0.45	0.00	0.39	0.07	0.38	0.09	
13/02/2025 05:45:00			0.04		0.13	0.12		0.45	0.00	0.39	0.06	0.37	0.09	
13/02/2025 06:00:00			0.04		0.12	0.12		0.45	0.00	0.39	0.06	0.37	0.09	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
13/02/2025 06:15:00			0.04		0.12	0.12		0.45	0.00	0.39	0.06	0.36	0.10	
13/02/2025 06:30:00			0.04		0.12	0.12		0.45	0.00	0.38	0.06	0.35	0.08	
13/02/2025 06:45:00			0.04		0.12	0.12		0.45	0.00	0.38	0.06	0.35	0.09	
13/02/2025 07:00:00			0.03		0.12	0.12		0.45	0.00	0.38	0.06	0.34	0.10	
13/02/2025 07:15:00			0.03		0.12	0.12		0.45	0.00	0.38	0.06	0.34	0.09	
13/02/2025 07:30:00			0.03		0.12	0.12		0.45	0.00	0.38	0.06	0.35	0.09	
13/02/2025 07:45:00			0.03		0.12	0.11		0.45	0.00	0.38	0.07	0.36	0.09	
13/02/2025 08:00:00			0.03		0.12	0.11		0.45	0.00	0.38	0.07	0.39	0.08	
13/02/2025 08:15:00			0.03		0.12	0.11		0.45	0.00	0.38	0.06	0.42	0.08	
13/02/2025 08:30:00			0.03		0.12	0.11		0.45	0.00	0.38	0.06	0.44	0.03	
13/02/2025 08:45:00			0.03		0.12	0.11		0.45	0.00	0.37	0.07	0.46	0.03	
13/02/2025 09:00:00			0.03		0.12	0.11		0.46	0.00	0.37	0.07	0.48	0.03	
13/02/2025 09:15:00			0.03		0.12	0.11		0.46	0.00	0.37	0.07	0.49	0.03	
13/02/2025 09:30:00			0.03		0.12	0.11		0.46	0.00	0.37	0.07	0.50	0.02	
13/02/2025 09:45:00			0.03		0.12	0.11		0.46	0.00	0.37	0.07	0.51	0.01	
13/02/2025 10:00:00			0.03		0.12	0.11		0.47	0.00	0.37	0.06	0.52	0.02	
13/02/2025 10:15:00			0.03		0.12	0.11		0.47	0.00	0.37	0.06	0.53	0.02	
13/02/2025 10:30:00			0.03		0.12	0.11		0.47	0.00	0.38	0.06	0.53	0.01	
13/02/2025 10:45:00			0.03		0.12	0.11		0.47	0.00	0.38	0.06	0.54	0.01	
13/02/2025 11:00:00			0.03		0.12	0.11		0.47	0.00	0.38	0.06	0.55	0.01	
13/02/2025 11:15:00			0.03		0.12	0.11		0.47	0.00	0.38	0.06	0.55	0.01	
13/02/2025 11:30:00			0.03		0.12	0.11		0.48	0.00	0.38	0.06	0.56	0.02	
13/02/2025 11:45:00			0.03		0.12	0.11		0.48	0.00	0.38	0.06	0.57	0.01	
13/02/2025 12:00:00			0.03		0.12	0.11		0.48	0.00	0.39	0.06	0.57	0.01	
13/02/2025 12:15:00			0.03		0.12	0.11		0.48	0.00	0.39	0.06	0.58	0.02	
13/02/2025 12:30:00			0.03		0.12	0.11		0.48	0.00	0.39	0.06	0.58	0.01	
13/02/2025 12:45:00			0.03		0.12	0.11		0.48	0.00	0.39	0.06	0.59	0.01	
13/02/2025 13:00:00			0.03		0.12	0.11		0.48	0.00	0.40	0.07	0.59	0.01	
13/02/2025 13:15:00			0.03		0.12	0.11		0.48	0.00	0.40	0.06	0.60	0.01	
13/02/2025 13:30:00			0.03		0.12	0.11		0.48	0.00	0.40	0.06	0.60	0.00	
13/02/2025 13:45:00			0.03		0.12	0.11		0.48	0.00	0.41	0.06	0.61	0.00	
13/02/2025 14:00:00			0.03		0.12	0.11		0.48	0.00	0.41	0.06	0.61	0.00	
13/02/2025 14:15:00			0.03		0.12	0.11		0.48	0.00	0.41	0.05	0.60	0.02	
13/02/2025 14:30:00			0.03		0.12	0.11		0.48	0.00	0.41	0.05	0.57	0.04	
13/02/2025 14:45:00			0.03		0.12	0.11		0.48	0.00	0.42	0.05	0.55	0.05	
13/02/2025 15:00:00			0.03		0.12	0.11		0.48	0.00	0.42	0.05	0.52	0.08	
13/02/2025 15:15:00			0.03		0.12	0.11		0.48	0.00	0.41	0.05	0.50	0.07	
13/02/2025 15:30:00			0.03		0.12	0.11		0.48	0.00	0.41	0.05	0.48	0.07	
13/02/2025 15:45:00			0.03		0.12	0.11		0.48	0.00	0.41	0.06	0.47	0.08	
13/02/2025 16:00:00			0.03		0.12	0.11		0.48	0.00	0.41	0.05	0.45	0.09	
13/02/2025 16:15:00			0.03		0.12	0.11		0.48	0.00	0.40	0.05	0.44	0.09	
13/02/2025 16:30:00			0.03		0.12	0.11		0.47	0.00	0.40	0.04	0.43	0.07	
13/02/2025 16:45:00			0.03		0.12	0.11		0.47	0.00	0.40	0.06	0.42	0.09	
13/02/2025 17:00:00			0.03		0.12	0.11		0.47	0.00	0.39	0.06	0.41	0.09	
13/02/2025 17:15:00			0.03		0.12	0.11		0.47	0.00	0.39	0.06	0.40	0.09	
13/02/2025 17:30:00			0.03		0.12	0.11		0.47	0.00	0.39	0.07	0.39	0.11	
13/02/2025 17:45:00			0.03		0.12	0.11		0.47	0.00	0.39	0.07	0.38	0.08	
13/02/2025 18:00:00			0.03		0.12	0.11		0.48	0.00	0.38	0.07	0.37	0.07	
13/02/2025 18:15:00			0.03		0.12	0.11		0.48	0.00	0.38	0.07	0.37	0.08	
13/02/2025 18:30:00			0.03		0.12	0.11		0.48	0.00	0.38	0.07	0.36	0.08	
13/02/2025 18:45:00			0.03		0.12	0.11		0.48	0.00	0.38	0.06	0.36	0.08	
13/02/2025 19:00:00			0.03		0.12	0.11		0.48	0.00	0.38	0.06	0.39	0.08	
13/02/2025 19:15:00			0.03		0.12	0.11		0.49	0.00	0.37	0.07	0.44	0.08	
13/02/2025 19:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.06	0.46	0.01	
13/02/2025 19:45:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.48	0.01	
13/02/2025 20:00:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.49	0.02	
13/02/2025 20:15:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.50	0.02	
13/02/2025 20:30:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.51	0.02	
13/02/2025 20:45:00			0.03		0.12	0.11		0.49	0.00	0.37	0.07	0.52	0.01	
13/02/2025 21:00:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.53	0.01	
13/02/2025 21:15:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.54	0.00	
13/02/2025 21:30:00			0.03		0.12	0.11		0.49	0.00	0.37	0.06	0.54	0.02	
13/02/2025 21:45:00			0.04		0.12	0.11		0.49	0.00	0.37	0.06	0.55	0.00	
13/02/2025 22:00:00			0.04		0.12	0.12		0.49	0.00	0.38	0.06	0.56	0.01	
13/02/2025 22:15:00			0.04		0.12	0.11		0.48	0.00	0.38	0.06	0.56	0.01	
13/02/2025 22:30:00			0.04		0.12	0.11		0.48	0.00	0.38	0.06	0.57	0.01	
13/02/2025 22:45:00			0.04		0.12	0.11		0.48	0.00	0.38	0.06	0.57	0.01	
13/02/2025 23:00:00			0.04		0.12	0.11		0.48	0.00	0.38	0.05	0.58	0.01	
13/02/2025 23:15:00			0.04		0.12	0.12		0.48	0.00	0.39	0.05	0.58	0.00	
13/02/2025 23:30:00			0.04		0.12	0.12		0.48	0.00	0.39	0.06	0.59	0.01	
13/02/2025 23:45:00			0.04		0.12	0.12		0.48	0.00	0.39	0.06	0.59	0.02	
14/02/2025 00:00:00			0.04		0.12	0.12		0.48	0.00	0.40	0.06	0.60	0.02	
14/02/2025 00:15:00			0.04		0.12	0.12		0.48	0.00	0.40	0.05	0.60	0.01	
14/02/2025 00:30:00			0.04		0.12	0.12		0.48	0.00	0.40	0.05	0.60	0.01	
14/02/2025 00:45:00			0.04		0.12	0.12		0.47	0.00	0.40	0.05	0.61	0.00	
14/02/2025 01:00:00			0.04		0.12	0.12		0.47	0.00	0.41	0.05	0.61	0.02	
14/02/2025 01:15:00			0.04		0.12	0.12		0.47	0.00	0.41	0.05	0.62	0.02	
14/02/2025 01:30:00			0.04		0.12	0.12		0.47	0.00	0.41	0.04	0.62	0.01	
14/02/2025 01:45:00			0.04		0.12	0.12		0.47	0.00	0.42	0.04	0.62	0.01	
14/02/2025 02:00:00			0.04		0.12	0.12		0.46	0.00	0.42	0.04	0.63	0.01	
14/02/2025 02:15:00			0.04		0.12	0.12		0.46	0.00	0.42	0.05	0.60	0.01	
14/02/2025 02:30:00			0.04		0.12	0.11		0.46	0.00	0.42	0.05	0.57	0.02	
14/02/2025 02:45:00			0.04		0.12	0.11		0.46	0.00	0.42	0.04	0.54	0.06	
14/02/2025 03:00:00			0.04		0.12	0.11		0.45	0.00	0.42	0.03	0.52	0.08	
14/02/2025 03:15:00			0.04		0.12	0.11		0.45	0.00	0.42	0.04	0.50	0.09	
14/02/2025 03:30:00			0.04		0.12	0.11		0.45	0.00	0.42	0.05	0.48	0.09	
14/02/2025 03:45:00			0.03		0.12	0.11		0.45	0.00	0.41	0.05	0.46	0.08	
14/02/2025 04:00:00			0.03		0.12	0.11		0.45	0.00	0.41	0.05	0.45	0.08	
14/02/2025 04:15:00			0.03		0.12	0.11		0.45	0.00	0.40	0.05	0.44	0.09	
14/02/2025 04:30:00			0.03		0.12	0.11		0.45	0.00	0.40	0.05	0.43	0.09	
14/02/2025 04:45:00			0.03		0.12	0.11		0.45	0.00	0.40	0.06	0.41	0.09	
14/02/2025 05:00:00			0.03		0.12	0.11		0.45	0.00	0.39	0.05	0.41	0.08	
14/02/2025 05:15:00			0.03		0.12	0.11		0.45	0.00	0.39	0.05	0.40	0.09	
14/02/2025 05:30:00			0.03		0.12	0.11		0.45	0.00	0.39	0.05	0.39	0.09	
14/02/2025 05:45:00			0.03		0.12	0.11		0.45	0.00	0.38	0.05	0.38	0.08	
14/02/2025 06:00:00			0.03		0.12	0.11		0.44	0.00	0.38	0.05	0.37	0.08	
14/02/2025 06:15:00			0.03		0.12	0.11		0.44	0.00	0.38	0.06	0.37	0.08	
14/02/2025 06:30:00			0.03		0.12	0.11		0.44	0.00	0.38	0.05	0.36	0.08	
14/02/2025 06:45:00			0.03		0.11	0.11		0.44	0.00	0.37	0.05	0.35	0.08	
14/02/2025 07:00:00			0.03		0.11	0.11		0.44	0.00	0.37	0.05	0.35	0.08	
14/02/2025 07:15:00			0.03		0.11	0.11		0.44	0.00	0.37	0.05	0.34	0.08	
14/02/2025 07:30:00			0.03		0.11	0.11		0.44	0.00	0.37	0.05	0.33	0.08	
14/02/2025 07:45:00			0.02		0.11	0.11		0.44	0.00	0.37	0.05	0.33	0.08	
14/02/2025 08:00:00			0.02		0.11	0.11		0.44	0.00	0.37	0.06	0.32	0.08	
14/02/2025 08:15:00			0.02		0.11	0.11		0.44	0.00	0.37	0.06	0.32	0.07	
14/02/2025 08:30:00			0.02		0.11	0.10		0.44	0.00	0.37	0.05	0.32	0.08	
14/02/2025 08:45:00			0.02		0.11	0.10		0.45	0.00	0.37	0.04	0.33	0.08	
14/02/2025 09:00:00			0.02		0.11	0.10		0.45	0.00	0.37	0.03	0.36	0.07	
14/02/2025 09:15:00			0.02		0.11	0.10		0.46	0.00	0.36	0.02	0.41	0.07	
14/02/2025 09:30:00			0.02		0.11	0.10		0.46	0.00	0.36	0.02	0.43	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
14/02/2025 09:45:00			0.02		0.11	0.10		0.46	0.00	0.36	0.02	0.44	0.02	
14/02/2025 10:00:00			0.02		0.11	0.10		0.46	0.00	0.36	0.03	0.45	0.02	
14/02/2025 10:15:00			0.02		0.11	0.10		0.46	0.00	0.36	0.03	0.47	0.02	
14/02/2025 10:30:00			0.02		0.11	0.10		0.46	0.00	0.36	0.02	0.48	0.01	
14/02/2025 10:45:00			0.02		0.11	0.10		0.46	0.00	0.36	0.02	0.49	0.01	
14/02/2025 11:00:00			0.02		0.11	0.10		0.46	0.00	0.36	0.02	0.49	0.01	
14/02/2025 11:15:00			0.02		0.11	0.10		0.46	0.00	0.36	0.01	0.50	0.01	
14/02/2025 11:30:00			0.02		0.11	0.10		0.47	0.00	0.36	0.01	0.51	0.01	
14/02/2025 11:45:00			0.02		0.11	0.10		0.47	0.00	0.37	0.01	0.52	0.01	
14/02/2025 12:00:00			0.03		0.11	0.11		0.47	0.00	0.37	0.01	0.52	0.01	
14/02/2025 12:15:00			0.02		0.11	0.11		0.47	0.00	0.37	0.02	0.53	0.01	
14/02/2025 12:30:00			0.02		0.11	0.11		0.48	0.00	0.37	0.02	0.53	0.01	
14/02/2025 12:45:00			0.03		0.11	0.11		0.48	0.00	0.37	0.01	0.54	0.01	
14/02/2025 13:00:00			0.03		0.11	0.11		0.48	0.00	0.37	0.01	0.55	0.02	
14/02/2025 13:15:00			0.03		0.11	0.11		0.48	0.00	0.37	0.01	0.55	0.01	
14/02/2025 13:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.02	0.56	0.00	
14/02/2025 13:45:00			0.03		0.12	0.11		0.48	0.00	0.38	0.02	0.56	0.01	
14/02/2025 14:00:00			0.03		0.12	0.11		0.48	0.00	0.38	0.02	0.57	0.02	
14/02/2025 14:15:00			0.03		0.12	0.11		0.48	0.00	0.38	0.00	0.57	0.02	
14/02/2025 14:30:00			0.03		0.12	0.11		0.48	0.00	0.38	0.01	0.55	0.01	
14/02/2025 14:45:00			0.03		0.12	0.11		0.48	0.00	0.38	0.01	0.52	0.01	
14/02/2025 15:00:00			0.03		0.12	0.11		0.48	0.00	0.39	0.01	0.50	0.05	
14/02/2025 15:15:00			0.03		0.12	0.11		0.48	0.00	0.39	0.01	0.47	0.07	
14/02/2025 15:30:00			0.03		0.12	0.11		0.48	0.00	0.39	0.01	0.45	0.07	
14/02/2025 15:45:00			0.04		0.12	0.11		0.48	0.00	0.38	0.01	0.44	0.10	
14/02/2025 16:00:00			0.04		0.12	0.11		0.48	0.00	0.38	0.02	0.42	0.10	
14/02/2025 16:15:00			0.04		0.12	0.11		0.48	0.00	0.38	0.03	0.41	0.09	
14/02/2025 16:30:00			0.03		0.12	0.11		0.48	0.00	0.38	0.03	0.39	0.08	
14/02/2025 16:45:00			0.04		0.12	0.11		0.48	0.00	0.38	0.03	0.38	0.08	
14/02/2025 17:00:00			0.04		0.12	0.11		0.48	0.00	0.37	0.03	0.37	0.09	
14/02/2025 17:15:00			0.04		0.12	0.11		0.48	0.00	0.37	0.04	0.36	0.08	
14/02/2025 17:30:00			0.04		0.12	0.11		0.48	0.00	0.37	0.04	0.35	0.10	
14/02/2025 17:45:00			0.04		0.12	0.11		0.47	0.00	0.37	0.04	0.35	0.09	
14/02/2025 18:00:00			0.04		0.12	0.11		0.47	0.00	0.37	0.05	0.34	0.08	
14/02/2025 18:15:00			0.04		0.12	0.11		0.47	0.00	0.37	0.05	0.33	0.08	
14/02/2025 18:30:00			0.04		0.12	0.11		0.47	0.00	0.37	0.03	0.33	0.09	
14/02/2025 18:45:00			0.04		0.12	0.11		0.47	0.00	0.36	0.03	0.32	0.09	
14/02/2025 19:00:00			0.04		0.12	0.11		0.47	0.00	0.36	0.04	0.31	0.09	
14/02/2025 19:15:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.31	0.08	
14/02/2025 19:30:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.31	0.08	
14/02/2025 19:45:00			0.04		0.12	0.11		0.48	0.00	0.36	0.02	0.31	0.08	
14/02/2025 20:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.02	0.33	0.05	
14/02/2025 20:15:00			0.04		0.12	0.11		0.48	0.00	0.36	0.02	0.38	0.05	
14/02/2025 20:30:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.41	0.02	
14/02/2025 20:45:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.42	0.02	
14/02/2025 21:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.03	0.43	0.02	
14/02/2025 21:15:00			0.04		0.12	0.11		0.48	0.00	0.36	0.03	0.45	0.02	
14/02/2025 21:30:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.46	0.02	
14/02/2025 21:45:00			0.04		0.12	0.11		0.47	0.00	0.36	0.04	0.46	0.03	
14/02/2025 22:00:00			0.04		0.12	0.11		0.47	0.00	0.36	0.03	0.47	0.02	
14/02/2025 22:15:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.48	0.02	
14/02/2025 22:30:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.49	0.01	
14/02/2025 22:45:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.49	0.02	
14/02/2025 23:00:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.50	0.02	
14/02/2025 23:15:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.51	0.02	
14/02/2025 23:30:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.51	0.01	
14/02/2025 23:45:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.52	0.02	
15/02/2025 00:00:00			0.04		0.12	0.11		0.47	0.00	0.36	0.03	0.52	0.01	
15/02/2025 00:15:00			0.04		0.12	0.11		0.47	0.00	0.37	0.03	0.53	0.01	
15/02/2025 00:30:00			0.04		0.12	0.11		0.47	0.00	0.37	0.04	0.53	0.03	
15/02/2025 00:45:00			0.04		0.12	0.11		0.47	0.00	0.37	0.04	0.54	0.03	
15/02/2025 01:00:00			0.04		0.12	0.11		0.47	0.00	0.37	0.04	0.54	0.02	
15/02/2025 01:15:00			0.04		0.12	0.11		0.46	0.00	0.37	0.04	0.55	0.02	
15/02/2025 01:30:00			0.03		0.12	0.11		0.46	0.00	0.37	0.04	0.55	0.02	
15/02/2025 01:45:00			0.04		0.12	0.11		0.46	0.00	0.37	0.04	0.55	0.00	
15/02/2025 02:00:00			0.03		0.12	0.11		0.46	0.00	0.37	0.04	0.56	0.01	
15/02/2025 02:15:00			0.03		0.12	0.11		0.46	0.00	0.38	0.04	0.56	0.02	
15/02/2025 02:30:00			0.03		0.12	0.11		0.46	0.00	0.38	0.04	0.56	0.02	
15/02/2025 02:45:00			0.03		0.12	0.11		0.46	0.00	0.38	0.04	0.53	0.02	
15/02/2025 03:00:00			0.03		0.12	0.11		0.46	0.00	0.38	0.04	0.50	0.02	
15/02/2025 03:15:00			0.03		0.12	0.11		0.45	0.00	0.38	0.04	0.48	0.06	
15/02/2025 03:30:00			0.03		0.12	0.11		0.45	0.00	0.38	0.04	0.45	0.07	
15/02/2025 03:45:00			0.03		0.12	0.11		0.45	0.00	0.38	0.03	0.44	0.08	
15/02/2025 04:00:00			0.03		0.12	0.11		0.45	0.00	0.38	0.03	0.42	0.08	
15/02/2025 04:15:00			0.03		0.12	0.11		0.45	0.00	0.38	0.01	0.40	0.09	
15/02/2025 04:30:00			0.03		0.12	0.11		0.45	0.00	0.37	0.01	0.39	0.08	
15/02/2025 04:45:00			0.03		0.12	0.11		0.45	0.00	0.37	0.02	0.38	0.08	
15/02/2025 05:00:00			0.03		0.12	0.11		0.45	0.00	0.37	0.02	0.37	0.08	
15/02/2025 05:15:00			0.03		0.11	0.11		0.44	0.00	0.37	0.02	0.36	0.08	
15/02/2025 05:30:00			0.03		0.11	0.11		0.44	0.00	0.37	0.02	0.35	0.09	
15/02/2025 05:45:00			0.03		0.11	0.11		0.44	0.00	0.37	0.02	0.34	0.09	
15/02/2025 06:00:00			0.03		0.11	0.11		0.44	0.00	0.37	0.02	0.34	0.09	
15/02/2025 06:15:00			0.03		0.11	0.11		0.44	0.00	0.36	0.03	0.33	0.08	
15/02/2025 06:30:00			0.02		0.11	0.11		0.44	0.00	0.36	0.02	0.32	0.08	
15/02/2025 06:45:00			0.02		0.11	0.11		0.44	0.00	0.36	0.02	0.31	0.08	
15/02/2025 07:00:00			0.02		0.11	0.11		0.44	0.00	0.36	0.02	0.31	0.08	
15/02/2025 07:15:00			0.02		0.11	0.11		0.44	0.00	0.36	0.05	0.30	0.07	
15/02/2025 07:30:00			0.02		0.11	0.10		0.44	0.00	0.36	0.02	0.30	0.08	
15/02/2025 07:45:00			0.02		0.11	0.10		0.44	0.00	0.36	0.02	0.29	0.08	
15/02/2025 08:00:00			0.02		0.11	0.10		0.44	0.00	0.36	0.02	0.28	0.08	
15/02/2025 08:15:00			0.02		0.11	0.10		0.44	0.00	0.36	0.02	0.28	0.08	
15/02/2025 08:30:00			0.02		0.11	0.10		0.44	0.00	0.36	0.02	0.28	0.08	
15/02/2025 08:45:00			0.02		0.11	0.10		0.44	0.00	0.36	0.02	0.28	0.08	
15/02/2025 09:00:00			0.02		0.11	0.10		0.44	0.00	0.36	0.01	0.29	0.08	
15/02/2025 09:15:00			0.02		0.11	0.10		0.45	0.00	0.36	0.01	0.31	0.08	
15/02/2025 09:30:00			0.02		0.11	0.10		0.45	0.00	0.36	0.01	0.36	0.04	
15/02/2025 09:45:00			0.02		0.11	0.10		0.46	0.00	0.36	0.01	0.39	0.03	
15/02/2025 10:00:00			0.02		0.11	0.10		0.46	0.00	0.36	0.01	0.40	0.03	
15/02/2025 10:15:00			0.02		0.11	0.10		0.46	0.00	0.36	0.01	0.41	0.02	
15/02/2025 10:30:00			0.02		0.11	0.10		0.46	0.00	0.36	0.01	0.42	0.02	
15/02/2025 10:45:00			0.02		0.11	0.10		0.47	0.00	0.36	0.01	0.43	0.02	
15/02/2025 11:00:00			0.02		0.11	0.10		0.47	0.00	0.36	0.02	0.44	0.02	
15/02/2025 11:15:00			0.02		0.11	0.10		0.47	0.00	0.36	0.03	0.45	0.02	
15/02/2025 11:30:00			0.02		0.11	0.10		0.47	0.00	0.36	0.03	0.45	0.02	
15/02/2025 11:45:00			0.02		0.11	0.10		0.48	0.00	0.36	0.04	0.46	0.01	
15/02/2025 12:00:00			0.02		0.11	0.10		0.48	0.00	0.36	0.03	0.47	0.02	
15/02/2025 12:15:00			0.02		0.11	0.11		0.48	0.00	0.36	0.02	0.47	0.02	
15/02/2025 12:30:00			0.02		0.11	0.11		0.48	0.00	0.36	0.02	0.48	0.02	
15/02/2025 12:45:00			0.02		0.11	0.11		0.48	0.00	0.36	0.04	0.49	0.01	
15/02/2025 13:00:00			0.02		0.11	0.11		0.48	0.00	0.36	0.05	0.49	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
15/02/2025 13:15:00			0.03		0.11	0.11		0.48	0.00	0.36	0.02	0.50	0.01	
15/02/2025 13:30:00			0.03		0.11	0.11		0.48	0.00	0.36	0.01	0.50	0.02	
15/02/2025 13:45:00			0.03		0.11	0.11		0.48	0.00	0.36	0.01	0.51	0.00	
15/02/2025 14:00:00			0.03		0.12	0.11		0.48	0.00	0.36	0.02	0.51	0.00	
15/02/2025 14:15:00			0.03		0.12	0.11		0.48	0.00	0.36	0.01	0.52	0.02	
15/02/2025 14:30:00			0.03		0.12	0.11		0.48	0.00	0.36	0.01	0.52	0.02	
15/02/2025 14:45:00			0.03		0.12	0.11		0.48	0.00	0.36	0.00	0.53	0.02	
15/02/2025 15:00:00			0.03		0.12	0.11		0.48	0.00	0.36	0.01	0.52	0.02	
15/02/2025 15:15:00			0.03		0.12	0.11		0.48	0.00	0.37	0.01	0.50	0.03	
15/02/2025 15:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.01	0.47	0.03	
15/02/2025 15:45:00			0.03		0.12	0.11		0.48	0.00	0.37	0.01	0.45	0.04	
15/02/2025 16:00:00			0.03		0.12	0.11		0.48	0.00	0.37	0.01	0.43	0.06	
15/02/2025 16:15:00			0.03		0.12	0.11		0.48	0.00	0.37	0.01	0.41	0.06	
15/02/2025 16:30:00			0.03		0.12	0.11		0.48	0.00	0.37	0.01	0.39	0.06	
15/02/2025 16:45:00			0.03		0.12	0.11		0.48	0.00	0.37	0.01	0.38	0.07	
15/02/2025 17:00:00			0.03		0.12	0.11		0.47	0.00	0.37	0.03	0.36	0.06	
15/02/2025 17:15:00			0.03		0.12	0.11		0.47	0.00	0.36	0.03	0.35	0.08	
15/02/2025 17:30:00			0.03		0.12	0.11		0.47	0.00	0.36	0.02	0.34	0.08	
15/02/2025 17:45:00			0.03		0.12	0.11		0.47	0.00	0.36	0.02	0.33	0.08	
15/02/2025 18:00:00			0.03		0.12	0.11		0.48	0.00	0.36	0.03	0.33	0.08	
15/02/2025 18:15:00			0.03		0.12	0.11		0.48	0.00	0.36	0.03	0.32	0.08	
15/02/2025 18:30:00			0.03		0.12	0.11		0.48	0.00	0.36	0.03	0.31	0.08	
15/02/2025 18:45:00			0.03		0.12	0.11		0.48	0.00	0.36	0.04	0.30	0.09	
15/02/2025 19:00:00			0.03		0.12	0.11		0.49	0.00	0.36	0.02	0.30	0.08	
15/02/2025 19:15:00			0.03		0.12	0.11		0.50	0.00	0.36	0.02	0.29	0.09	
15/02/2025 19:30:00			0.03		0.12	0.11		0.51	0.00	0.36	0.02	0.28	0.08	
15/02/2025 19:45:00			0.04		0.12	0.11		0.51	0.00	0.36	0.04	0.28	0.07	
15/02/2025 20:00:00			0.04		0.12	0.12		0.52	0.00	0.36	0.05	0.30	0.07	
15/02/2025 20:15:00			0.04		0.12	0.12		0.52	0.00	0.36	0.05	0.34	0.06	
15/02/2025 20:30:00			0.04		0.12	0.12		0.52	0.00	0.36	0.03	0.39	0.04	
15/02/2025 20:45:00			0.04		0.13	0.12		0.53	0.00	0.36	0.03	0.40	0.04	
15/02/2025 21:00:00			0.04		0.13	0.12		0.53	0.00	0.36	0.03	0.41	0.02	
15/02/2025 21:15:00			0.05		0.13	0.12		0.53	0.00	0.36	0.03	0.42	0.02	
15/02/2025 21:30:00			0.05		0.13	0.13		0.53	0.00	0.36	0.03	0.43	0.02	
15/02/2025 21:45:00			0.05		0.14	0.13		0.53	0.00	0.36	0.03	0.44	0.02	
15/02/2025 22:00:00			0.05		0.14	0.13		0.53	0.00	0.36	0.03	0.45	0.02	
15/02/2025 22:15:00			0.06		0.14	0.13		0.53	0.00	0.36	0.03	0.46	0.01	
15/02/2025 22:30:00			0.06		0.14	0.13		0.53	0.00	0.36	0.03	0.46	0.01	
15/02/2025 22:45:00			0.06		0.14	0.14		0.52	0.00	0.36	0.03	0.47	0.02	
15/02/2025 23:00:00			0.06		0.14	0.14		0.52	0.00	0.36	0.03	0.48	0.02	
15/02/2025 23:15:00			0.07		0.14	0.14		0.52	0.00	0.36	0.02	0.48	0.02	
15/02/2025 23:30:00			0.07		0.14	0.14		0.52	0.00	0.36	0.02	0.49	0.02	
15/02/2025 23:45:00			0.07		0.15	0.14		0.52	0.00	0.36	0.02	0.49	0.01	
16/02/2025 00:00:00			0.07		0.15	0.14		0.52	0.00	0.36	0.03	0.50	0.02	
16/02/2025 00:15:00			0.07		0.15	0.14		0.51	0.00	0.36	0.03	0.50	0.01	
16/02/2025 00:30:00			0.07		0.15	0.14		0.51	0.00	0.36	0.03	0.51	0.02	
16/02/2025 00:45:00			0.07		0.15	0.14		0.51	0.00	0.36	0.03	0.51	0.02	
16/02/2025 01:00:00			0.07		0.15	0.14		0.50	0.00	0.36	0.03	0.52	0.02	
16/02/2025 01:15:00			0.07		0.15	0.14		0.50	0.00	0.37	0.03	0.52	0.02	
16/02/2025 01:30:00			0.07		0.15	0.14		0.50	0.00	0.37	0.03	0.53	0.02	
16/02/2025 01:45:00			0.07		0.15	0.14		0.49	0.00	0.37	0.03	0.53	0.02	
16/02/2025 02:00:00			0.07		0.15	0.14		0.49	0.00	0.37	0.03	0.53	0.03	
16/02/2025 02:15:00			0.07		0.15	0.14		0.49	0.00	0.37	0.04	0.54	0.01	
16/02/2025 02:30:00			0.07		0.14	0.14		0.49	0.00	0.37	0.03	0.54	0.01	
16/02/2025 02:45:00			0.07		0.14	0.14		0.48	0.00	0.37	0.03	0.55	0.01	
16/02/2025 03:00:00			0.07		0.14	0.14		0.48	0.00	0.37	0.00	0.55	0.02	
16/02/2025 03:15:00			0.06		0.14	0.13		0.48	0.00	0.37	0.00	0.54	0.02	
16/02/2025 03:30:00			0.06		0.14	0.13		0.48	0.00	0.38	0.00	0.52	0.03	
16/02/2025 03:45:00			0.06		0.14	0.13		0.47	0.00	0.38	0.01	0.49	0.06	
16/02/2025 04:00:00			0.06		0.14	0.13		0.47	0.00	0.38	0.02	0.47	0.06	
16/02/2025 04:15:00			0.06		0.14	0.13		0.47	0.00	0.38	0.02	0.45	0.06	
16/02/2025 04:30:00			0.06		0.14	0.13		0.47	0.00	0.38	0.02	0.43	0.08	
16/02/2025 04:45:00			0.06		0.14	0.13		0.46	0.00	0.38	0.02	0.41	0.08	
16/02/2025 05:00:00			0.06		0.13	0.13		0.46	0.00	0.37	0.03	0.40	0.07	
16/02/2025 05:15:00			0.05		0.13	0.13		0.46	0.00	0.37	0.03	0.38	0.07	
16/02/2025 05:30:00			0.05		0.13	0.13		0.46	0.00	0.37	0.03	0.37	0.08	
16/02/2025 05:45:00			0.05		0.13	0.13		0.46	0.00	0.37	0.03	0.36	0.07	
16/02/2025 06:00:00			0.05		0.13	0.12		0.46	0.00	0.37	0.03	0.35	0.08	
16/02/2025 06:15:00			0.05		0.13	0.12		0.46	0.00	0.37	0.03	0.34	0.09	
16/02/2025 06:30:00			0.05		0.13	0.12		0.46	0.00	0.37	0.03	0.34	0.08	
16/02/2025 06:45:00			0.05		0.13	0.12		0.45	0.00	0.37	0.04	0.33	0.08	
16/02/2025 07:00:00			0.05		0.13	0.12		0.45	0.00	0.37	0.04	0.32	0.09	
16/02/2025 07:15:00			0.04		0.13	0.12		0.45	0.00	0.36	0.04	0.31	0.08	
16/02/2025 07:30:00			0.04		0.12	0.12		0.45	0.00	0.36	0.05	0.31	0.08	
16/02/2025 07:45:00			0.04		0.12	0.12		0.45	0.00	0.36	0.05	0.30	0.08	
16/02/2025 08:00:00			0.04		0.12	0.12		0.45	0.00	0.36	0.04	0.30	0.08	
16/02/2025 08:15:00			0.04		0.12	0.12		0.45	0.00	0.36	0.04	0.29	0.08	
16/02/2025 08:30:00			0.04		0.12	0.12		0.45	0.00	0.36	0.04	0.28	0.09	
16/02/2025 08:45:00			0.04		0.12	0.12		0.45	0.00	0.36	0.04	0.28	0.09	
16/02/2025 09:00:00			0.04		0.12	0.12		0.45	0.00	0.36	0.04	0.27	0.08	
16/02/2025 09:15:00			0.04		0.12	0.11		0.45	0.00	0.36	0.04	0.27	0.07	
16/02/2025 09:30:00			0.04		0.12	0.11		0.45	0.00	0.36	0.04	0.27	0.07	
16/02/2025 09:45:00			0.03		0.12	0.11		0.45	0.00	0.36	0.04	0.27	0.07	
16/02/2025 10:00:00			0.03		0.12	0.11		0.46	0.00	0.36	0.04	0.28	0.06	
16/02/2025 10:15:00			0.03		0.12	0.11		0.46	0.00	0.36	0.02	0.30	0.07	
16/02/2025 10:30:00			0.03		0.12	0.11		0.46	0.00	0.36	0.02	0.34	0.05	
16/02/2025 10:45:00			0.03		0.12	0.11		0.46	0.00	0.36	0.02	0.37	0.03	
16/02/2025 11:00:00			0.03		0.12	0.11		0.47	0.00	0.36	0.02	0.38	0.03	
16/02/2025 11:15:00			0.03		0.12	0.11		0.47	0.00	0.36	0.02	0.39	0.03	
16/02/2025 11:30:00			0.03		0.12	0.11		0.47	0.00	0.36	0.02	0.40	0.02	
16/02/2025 11:45:00			0.03		0.12	0.11		0.47	0.00	0.36	0.03	0.41	0.01	
16/02/2025 12:00:00			0.03		0.12	0.11		0.48	0.00	0.36	0.03	0.42	0.02	
16/02/2025 12:15:00			0.03		0.12	0.11		0.48	0.00	0.36	0.03	0.43	0.02	
16/02/2025 12:30:00			0.03		0.12	0.11		0.48	0.00	0.36	0.03	0.44	0.00	
16/02/2025 12:45:00			0.03		0.12	0.11		0.48	0.00	0.36	0.04	0.45	0.00	
16/02/2025 13:00:00			0.03		0.12	0.11		0.48	0.00	0.36	0.04	0.45	0.01	
16/02/2025 13:15:00			0.03		0.12	0.11		0.48	0.00	0.36	0.05	0.46	0.00	
16/02/2025 13:30:00			0.03		0.12	0.11		0.48	0.00	0.36	0.05	0.46	0.02	
16/02/2025 13:45:00			0.03		0.12	0.11		0.48	0.00	0.36	0.05	0.47	0.02	
16/02/2025 14:00:00			0.03		0.12	0.11		0.48	0.00	0.36	0.04	0.48	0.02	
16/02/2025 14:15:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.48	0.00	
16/02/2025 14:30:00			0.03		0.12	0.11		0.48	0.00	0.36	0.04	0.49	0.02	
16/02/2025 14:45:00			0.03		0.12	0.11		0.48	0.00	0.36	0.04	0.49	0.01	
16/02/2025 15:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.50	0.01	
16/02/2025 15:15:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.48	0.02	
16/02/2025 15:30:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.45	0.04	
16/02/2025 15:45:00			0.04		0.12	0.12		0.48	0.00	0.36	0.05	0.43	0.03	
16/02/2025 16:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.41	0.04	
16/02/2025 16:15:00			0.04		0.12	0.12		0.48	0.00	0.36	0.04	0.39	0.05	
16/02/2025 16:30:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.37	0.05	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
16/02/2025 16:45:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.36	0.08	
16/02/2025 17:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.34	0.07	
16/02/2025 17:15:00			0.04		0.12	0.11		0.48	0.00	0.36	0.05	0.33	0.07	
16/02/2025 17:30:00			0.04		0.12	0.11		0.48	0.00	0.36	0.05	0.32	0.08	
16/02/2025 17:45:00			0.04		0.12	0.11		0.48	0.00	0.36	0.05	0.31	0.09	
16/02/2025 18:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.05	0.30	0.09	
16/02/2025 18:15:00			0.04		0.12	0.11		0.48	0.00	0.36	0.05	0.29	0.08	
16/02/2025 18:30:00			0.04		0.12	0.11		0.48	0.00	0.36	0.05	0.28	0.09	
16/02/2025 18:45:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.28	0.09	
16/02/2025 19:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.27	0.07	
16/02/2025 19:15:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.26	0.08	
16/02/2025 19:30:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.26	0.08	
16/02/2025 19:45:00			0.04		0.12	0.12		0.48	0.00	0.36	0.04	0.25	0.09	
16/02/2025 20:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.25	0.09	
16/02/2025 20:15:00			0.04		0.12	0.12		0.48	0.00	0.36	0.04	0.24	0.06	
16/02/2025 20:30:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.24	0.08	
16/02/2025 20:45:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.24	0.08	
16/02/2025 21:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.03	0.26	0.08	
16/02/2025 21:15:00			0.04		0.12	0.12		0.48	0.00	0.36	0.03	0.28	0.05	
16/02/2025 21:30:00			0.04		0.12	0.11		0.48	0.00	0.36	0.03	0.33	0.04	
16/02/2025 21:45:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.35	0.04	
16/02/2025 22:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.03	0.36	0.03	
16/02/2025 22:15:00			0.04		0.12	0.11		0.48	0.00	0.36	0.03	0.37	0.02	
16/02/2025 22:30:00			0.04		0.12	0.11		0.48	0.00	0.36	0.03	0.39	0.02	
16/02/2025 22:45:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.39	0.02	
16/02/2025 23:00:00			0.04		0.12	0.11		0.48	0.00	0.36	0.04	0.40	0.02	
16/02/2025 23:15:00			0.04		0.12	0.11		0.47	0.00	0.36	0.01	0.41	0.02	
16/02/2025 23:30:00			0.04		0.12	0.12		0.47	0.00	0.36	0.03	0.42	0.02	
16/02/2025 23:45:00			0.04		0.12	0.11		0.47	0.00	0.36	0.03	0.43	0.02	
17/02/2025 00:00:00			0.04		0.12	0.11		0.47	0.00	0.36	0.03	0.43	0.02	
17/02/2025 00:15:00			0.04		0.12	0.11		0.47	0.00	0.36	0.03	0.44	0.02	
17/02/2025 00:30:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.45	0.02	
17/02/2025 00:45:00			0.04		0.12	0.11		0.47	0.00	0.36	0.03	0.45	0.02	
17/02/2025 01:00:00			0.04		0.12	0.11		0.47	0.00	0.36	0.02	0.46	0.01	
17/02/2025 01:15:00			0.04		0.12	0.11		0.46	0.00	0.36	0.02	0.46	0.02	
17/02/2025 01:30:00			0.04		0.12	0.11		0.46	0.00	0.36	0.02	0.47	0.02	
17/02/2025 01:45:00			0.04		0.12	0.11		0.46	0.00	0.36	0.02	0.47	0.02	
17/02/2025 02:00:00			0.04		0.12	0.11		0.46	0.00	0.36	0.03	0.48	0.02	
17/02/2025 02:15:00			0.04		0.12	0.11		0.46	0.00	0.36	0.03	0.48	0.01	
17/02/2025 02:30:00			0.04		0.12	0.11		0.46	0.00	0.36	0.02	0.49	0.02	
17/02/2025 02:45:00			0.04		0.12	0.11		0.45	0.00	0.36	0.02	0.49	0.02	
17/02/2025 03:00:00			0.04		0.12	0.11		0.45	0.00	0.36	0.03	0.50	0.02	
17/02/2025 03:15:00			0.04		0.12	0.11		0.45	0.00	0.36	0.03	0.50	0.02	
17/02/2025 03:30:00			0.04		0.12	0.11		0.45	0.00	0.36	0.03	0.50	0.02	
17/02/2025 03:45:00			0.04		0.12	0.11		0.45	0.00	0.36	0.02	0.49	0.01	
17/02/2025 04:00:00			0.04		0.12	0.11		0.45	0.00	0.36	0.02	0.46	0.01	
17/02/2025 04:15:00			0.04		0.12	0.11		0.45	0.00	0.36	0.02	0.44	0.05	
17/02/2025 04:30:00			0.03		0.12	0.11		0.44	0.00	0.36	0.03	0.42	0.06	
17/02/2025 04:45:00			0.03		0.12	0.11		0.44	0.00	0.36	0.02	0.40	0.06	
17/02/2025 05:00:00			0.03		0.12	0.11		0.44	0.00	0.36	0.02	0.38	0.08	
17/02/2025 05:15:00			0.03		0.11	0.11		0.44	0.00	0.36	0.02	0.36	0.08	
17/02/2025 05:30:00			0.03		0.11	0.11		0.44	0.00	0.36	0.02	0.35	0.09	
17/02/2025 05:45:00			0.03		0.11	0.11		0.44	0.00	0.36	0.02	0.34	0.08	
17/02/2025 06:00:00			0.03		0.11	0.11		0.44	0.00	0.36	0.03	0.32	0.08	
17/02/2025 06:15:00			0.03		0.11	0.11		0.44	0.00	0.36	0.03	0.32	0.08	
17/02/2025 06:30:00			0.03		0.11	0.11		0.44	0.00	0.36	0.03	0.31	0.09	
17/02/2025 06:45:00			0.03		0.11	0.11		0.44	0.00	0.36	0.03	0.30	0.09	
17/02/2025 07:00:00			0.03		0.11	0.10		0.44	0.00	0.36	0.04	0.29	0.09	
17/02/2025 07:15:00			0.03		0.11	0.10		0.44	0.00	0.36	0.04	0.28	0.07	
17/02/2025 07:30:00			0.03		0.11	0.10		0.44	0.00	0.36	0.04	0.27	0.08	
17/02/2025 07:45:00			0.03		0.11	0.10		0.44	0.00	0.36	0.05	0.27	0.08	
17/02/2025 08:00:00			0.03		0.11	0.10		0.44	0.00	0.36	0.05	0.26	0.08	
17/02/2025 08:15:00			0.02		0.11	0.10		0.44	0.00	0.36	0.05	0.25	0.08	
17/02/2025 08:30:00			0.02		0.11	0.10		0.44	0.00	0.36	0.05	0.25	0.07	
17/02/2025 08:45:00			0.02		0.11	0.10		0.44	0.00	0.36	0.05	0.24	0.07	
17/02/2025 09:00:00			0.02		0.11	0.10		0.44	0.00	0.36	0.06	0.24	0.05	
17/02/2025 09:15:00			0.02		0.11	0.10		0.45	0.00	0.36	0.05	0.24	0.07	
17/02/2025 09:30:00			0.02		0.11	0.10		0.45	0.00	0.36	0.03	0.23	0.08	
17/02/2025 09:45:00			0.02		0.11	0.10		0.46	0.00	0.36	0.03	0.23	0.07	
17/02/2025 10:00:00			0.02		0.11	0.10		0.46	0.00	0.36	0.04	0.24	0.07	
17/02/2025 10:15:00			0.02		0.11	0.10		0.46	0.00	0.36	0.04	0.26	0.07	
17/02/2025 10:30:00			0.02		0.11	0.10		0.46	0.00	0.36	0.04	0.29	0.05	
17/02/2025 10:45:00			0.02		0.11	0.10		0.46	0.00	0.36	0.04	0.34	0.03	
17/02/2025 11:00:00			0.02		0.11	0.10		0.46	0.00	0.36	0.04	0.35	0.02	
17/02/2025 11:15:00			0.02		0.11	0.10		0.47	0.00	0.36	0.04	0.37	0.02	
17/02/2025 11:30:00			0.02		0.11	0.10		0.47	0.00	0.35	0.04	0.38	0.02	
17/02/2025 11:45:00			0.02		0.11	0.10		0.47	0.00	0.35	0.03	0.39	0.01	
17/02/2025 12:00:00			0.02		0.11	0.10		0.47	0.00	0.35	0.03	0.40	0.02	
17/02/2025 12:15:00			0.02		0.11	0.10		0.47	0.00	0.35	0.03	0.40	0.02	
17/02/2025 12:30:00			0.02		0.11	0.10		0.48	0.00	0.36	0.03	0.41	0.02	
17/02/2025 12:45:00			0.02		0.11	0.10		0.48	0.00	0.35	0.03	0.42	0.01	
17/02/2025 13:00:00			0.02		0.11	0.10		0.48	0.00	0.35	0.03	0.42	0.02	
17/02/2025 13:15:00			0.03		0.11	0.11		0.48	0.00	0.35	0.03	0.43	0.00	
17/02/2025 13:30:00			0.03		0.11	0.11		0.48	0.00	0.35	0.03	0.44	0.01	
17/02/2025 13:45:00			0.03		0.11	0.11		0.48	0.00	0.35	0.03	0.44	0.01	
17/02/2025 14:00:00			0.03		0.11	0.11		0.48	0.00	0.36	0.03	0.45	0.02	
17/02/2025 14:15:00			0.03		0.11	0.11		0.48	0.00	0.35	0.04	0.45	0.01	
17/02/2025 14:30:00			0.03		0.11	0.11		0.47	0.00	0.36	0.04	0.46	0.01	
17/02/2025 14:45:00			0.03		0.11	0.11		0.47	0.00	0.36	0.04	0.46	0.02	
17/02/2025 15:00:00			0.03		0.11	0.11		0.47	0.00	0.36	0.04	0.47	0.02	
17/02/2025 15:15:00			0.03		0.11	0.11		0.47	0.00	0.36	0.04	0.47	0.00	
17/02/2025 15:30:00			0.03		0.12	0.11		0.47	0.00	0.36	0.04	0.48	0.01	
17/02/2025 15:45:00			0.03		0.11	0.11		0.47	0.00	0.36	0.04	0.48	0.03	
17/02/2025 16:00:00			0.03		0.11	0.11		0.47	0.00	0.36	0.03	0.48	0.01	
17/02/2025 16:15:00			0.03		0.11	0.11		0.47	0.00	0.36	0.03	0.46	0.03	
17/02/2025 16:30:00			0.03		0.11	0.11		0.47	0.00	0.36	0.03	0.44	0.05	
17/02/2025 16:45:00			0.03		0.11	0.11		0.47	0.00	0.36	0.03	0.42	0.05	
17/02/2025 17:00:00			0.03		0.11	0.11		0.47	0.00	0.36	0.05	0.40	0.06	
17/02/2025 17:15:00			0.03		0.11	0.11		0.47	0.00	0.36	0.05	0.38	0.06	
17/02/2025 17:30:00			0.03		0.11	0.11		0.47	0.00	0.36	0.06	0.36	0.07	
17/02/2025 17:45:00			0.03		0.11	0.11		0.47	0.00	0.36	0.06	0.35	0.07	
17/02/2025 18:00:00			0.03		0.11	0.11		0.47	0.00	0.36	0.05	0.33	0.07	
17/02/2025 18:15:00			0.03		0.11	0.11		0.47	0.00	0.36	0.05	0.32	0.07	
17/02/2025 18:30:00			0.03		0.11	0.11		0.47	0.00	0.36	0.05	0.31	0.07	
17/02/2025 18:45:00			0.03		0.11	0.11		0.47	0.00	0.36	0.05	0.30	0.09	
17/02/2025 19:00:00			0.03		0.11	0.11		0.47	0.00	0.36	0.06	0.29	0.08	
17/02/2025 19:15:00			0.03		0.11	0.11		0.47	0.00	0.36	0.05	0.28	0.08	
17/02/2025 19:30:00			0.03		0.11	0.11		0.47	0.00	0.35	0.05	0.27	0.09	
17/02/2025 19:45:00			0.03		0.11	0.11		0.47	0.00	0.35	0.06	0.27	0.08	
17/02/2025 20:00:00			0.03		0.11	0.11		0.47	0.00	0.35	0.05	0.26	0.09	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
17/02/2025 20:15:00			0.03		0.11	0.11		0.48	0.00	0.35	0.06	0.25	0.08	
17/02/2025 20:30:00			0.03		0.11	0.11		0.48	0.00	0.35	0.06	0.25	0.08	
17/02/2025 20:45:00			0.03		0.11	0.11		0.48	0.00	0.35	0.05	0.25	0.08	
17/02/2025 21:00:00			0.03		0.11	0.11		0.48	0.00	0.35	0.05	0.25	0.08	
17/02/2025 21:15:00			0.03		0.11	0.11		0.48	0.00	0.35	0.06	0.29	0.06	
17/02/2025 21:30:00			0.03		0.11	0.11		0.48	0.00	0.35	0.05	0.33	0.04	
17/02/2025 21:45:00			0.03		0.11	0.11		0.48	0.00	0.35	0.05	0.38	0.02	
17/02/2025 22:00:00			0.04		0.11	0.11		0.47	0.00	0.35	0.05	0.39	0.01	
17/02/2025 22:15:00			0.03		0.11	0.11		0.47	0.00	0.35	0.05	0.39	0.02	
17/02/2025 22:30:00			0.03		0.11	0.11		0.47	0.00	0.35	0.06	0.40	0.02	
17/02/2025 22:45:00			0.03		0.12	0.11		0.47	0.00	0.35	0.05	0.41	0.02	
17/02/2025 23:00:00			0.04		0.12	0.11		0.47	0.00	0.35	0.04	0.42	0.02	
17/02/2025 23:15:00			0.04		0.12	0.11		0.47	0.00	0.35	0.03	0.42	0.02	
17/02/2025 23:30:00			0.04		0.11	0.11		0.47	0.00	0.35	0.02	0.43	0.02	
17/02/2025 23:45:00			0.04		0.12	0.11		0.47	0.00	0.35	0.03	0.43	0.02	
18/02/2025 00:00:00			0.04		0.12	0.11		0.47	0.00	0.35	0.02	0.44	0.01	
18/02/2025 00:15:00			0.03		0.12	0.11		0.47	0.00	0.35	0.02	0.45	0.01	
18/02/2025 00:30:00			0.04		0.11	0.11		0.47	0.00	0.35	0.02	0.45	0.02	
18/02/2025 00:45:00			0.04		0.11	0.11		0.46	0.00	0.35	0.02	0.46	0.02	
18/02/2025 01:00:00			0.04		0.11	0.11		0.46	0.00	0.35	0.02	0.46	0.02	
18/02/2025 01:15:00			0.04		0.11	0.11		0.46	0.00	0.35	0.03	0.47	0.02	
18/02/2025 01:30:00			0.04		0.11	0.11		0.46	0.00	0.35	0.03	0.47	0.01	
18/02/2025 01:45:00			0.04		0.11	0.11		0.46	0.00	0.36	0.03	0.47	0.02	
18/02/2025 02:00:00			0.03		0.11	0.11		0.46	0.00	0.36	0.03	0.48	0.02	
18/02/2025 02:15:00			0.03		0.11	0.11		0.46	0.00	0.36	0.03	0.48	0.02	
18/02/2025 02:30:00			0.03		0.11	0.11		0.45	0.00	0.36	0.02	0.49	0.02	
18/02/2025 02:45:00			0.03		0.11	0.11		0.45	0.00	0.36	0.02	0.49	0.02	
18/02/2025 03:00:00			0.03		0.11	0.11		0.45	0.00	0.36	0.02	0.49	0.02	
18/02/2025 03:15:00			0.03		0.11	0.11		0.45	0.00	0.36	0.03	0.50	0.02	
18/02/2025 03:30:00			0.03		0.11	0.10		0.45	0.00	0.36	0.03	0.50	0.02	
18/02/2025 03:45:00			0.03		0.11	0.10		0.45	0.00	0.36	0.03	0.50	0.02	
18/02/2025 04:00:00			0.03		0.11	0.10		0.44	0.00	0.36	0.02	0.51	0.02	
18/02/2025 04:15:00			0.03		0.11	0.10		0.44	0.00	0.36	0.02	0.50	0.02	
18/02/2025 04:30:00			0.03		0.11	0.10		0.44	0.00	0.36	0.03	0.48	0.03	
18/02/2025 04:45:00			0.03		0.11	0.10		0.44	0.00	0.36	0.03	0.46	0.05	
18/02/2025 05:00:00			0.03		0.11	0.10		0.44	0.00	0.36	0.03	0.44	0.05	
18/02/2025 05:15:00			0.03		0.11	0.10		0.44	0.00	0.36	0.03	0.42	0.06	
18/02/2025 05:30:00			0.03		0.11	0.10		0.44	0.00	0.36	0.02	0.40	0.07	
18/02/2025 05:45:00			0.03		0.11	0.10		0.44	0.00	0.36	0.02	0.38	0.07	
18/02/2025 06:00:00			0.03		0.11	0.10		0.44	0.00	0.36	0.02	0.37	0.08	
18/02/2025 06:15:00			0.03		0.11	0.10		0.44	0.00	0.36	0.02	0.35	0.08	
18/02/2025 06:30:00			0.03		0.11	0.10		0.44	0.00	0.36	0.02	0.34	0.07	
18/02/2025 06:45:00			0.03		0.11	0.10		0.44	0.00	0.36	0.02	0.33	0.08	
18/02/2025 07:00:00			0.03		0.11	0.10		0.43	0.00	0.36	0.02	0.32	0.08	
18/02/2025 07:15:00			0.02		0.11	0.10		0.43	0.00	0.36	0.02	0.31	0.09	
18/02/2025 07:30:00			0.02		0.11	0.10		0.43	0.00	0.36	0.03	0.30	0.09	
18/02/2025 07:45:00			0.02		0.11	0.10		0.43	0.00	0.36	0.03	0.29	0.07	
18/02/2025 08:00:00			0.02		0.11	0.10		0.44	0.00	0.36	0.03	0.28	0.08	
18/02/2025 08:15:00			0.02		0.10	0.10		0.44	0.00	0.36	0.02	0.28	0.08	
18/02/2025 08:30:00			0.02		0.10	0.10		0.44	0.00	0.35	0.02	0.27	0.07	
18/02/2025 08:45:00			0.02		0.10	0.10		0.45	0.00	0.35	0.02	0.26	0.07	
18/02/2025 09:00:00			0.02		0.10	0.10		0.45	0.00	0.35	0.01	0.26	0.08	
18/02/2025 09:15:00			0.02		0.10	0.10		0.45	0.00	0.35	0.01	0.25	0.08	
18/02/2025 09:30:00			0.02		0.11	0.10		0.45	0.00	0.35	0.01	0.24	0.08	
18/02/2025 09:45:00			0.02		0.10	0.10		0.45	0.00	0.35	-0.01	0.24	0.07	
18/02/2025 10:00:00			0.02		0.10	0.10		0.45	0.00	0.35	-0.01	0.23	0.08	
18/02/2025 10:15:00			0.02		0.11	0.10		0.45	0.00	0.35	-0.01	0.23	0.07	
18/02/2025 10:30:00			0.02		0.11	0.10		0.45	0.00	0.35	0.01	0.23	0.07	
18/02/2025 10:45:00			0.02		0.11	0.10		0.46	0.00	0.35	0.02	0.23	0.08	
18/02/2025 11:00:00			0.02		0.11	0.10		0.46	0.00	0.35	0.01	0.24	0.07	
18/02/2025 11:15:00			0.02		0.11	0.10		0.46	0.00	0.35	0.01	0.26	0.06	
18/02/2025 11:30:00			0.02		0.11	0.10		0.46	0.00	0.35	0.01	0.30	0.05	
18/02/2025 11:45:00			0.02		0.11	0.10		0.47	0.00	0.35	0.03	0.34	0.05	
18/02/2025 12:00:00			0.02		0.11	0.10		0.47	0.00	0.35	0.00	0.35	0.02	
18/02/2025 12:15:00			0.02		0.11	0.10		0.47	0.00	0.35	0.03	0.36	0.02	
18/02/2025 12:30:00			0.02		0.11	0.10		0.47	0.00	0.35	0.03	0.37	0.02	
18/02/2025 12:45:00			0.02		0.11	0.10		0.47	0.00	0.35	0.05	0.38	0.02	
18/02/2025 13:00:00			0.02		0.11	0.10		0.47	0.00	0.35	0.05	0.39	0.01	
18/02/2025 13:15:00			0.02		0.11	0.10		0.47	0.00	0.35	0.05	0.40	0.03	
18/02/2025 13:30:00			0.02		0.11	0.10		0.47	0.00	0.35	0.05	0.40	0.03	
18/02/2025 13:45:00			0.02		0.11	0.10		0.47	0.00	0.35	0.04	0.41	0.01	
18/02/2025 14:00:00			0.02		0.11	0.10		0.47	0.00	0.35	0.05	0.42	0.01	
18/02/2025 14:15:00			0.03		0.11	0.10		0.47	0.00	0.35	0.05	0.42	0.01	
18/02/2025 14:30:00			0.03		0.11	0.10		0.47	0.00	0.35	0.05	0.43	0.01	
18/02/2025 14:45:00			0.03		0.11	0.10		0.47	0.00	0.35	0.05	0.43	0.02	
18/02/2025 15:00:00			0.03		0.11	0.10		0.47	0.00	0.35	0.02	0.44	0.02	
18/02/2025 15:15:00			0.03		0.11	0.10		0.47	0.00	0.35	0.02	0.44	0.02	
18/02/2025 15:30:00			0.03		0.11	0.10		0.47	0.00	0.35	0.02	0.45	0.01	
18/02/2025 15:45:00			0.03		0.11	0.10		0.47	0.00	0.35	0.00	0.45	0.01	
18/02/2025 16:00:00			0.03		0.12	0.10		0.47	0.00	0.35	0.00	0.46	0.01	
18/02/2025 16:15:00			0.03		0.11	0.10		0.47	0.00	0.35	0.02	0.45	0.01	
18/02/2025 16:30:00			0.03		0.11	0.10		0.46	0.00	0.35	0.02	0.42	0.02	
18/02/2025 16:45:00			0.03		0.11	0.10		0.47	0.00	0.35	0.00	0.40	0.04	
18/02/2025 17:00:00			0.03		0.12	0.10		0.47	0.00	0.35	0.01	0.38	0.06	
18/02/2025 17:15:00			0.03		0.11	0.10		0.47	0.00	0.35	0.03	0.36	0.06	
18/02/2025 17:30:00			0.03		0.11	0.10		0.46	0.00	0.35	0.04	0.35	0.06	
18/02/2025 17:45:00			0.03		0.11	0.10		0.46	0.00	0.35	0.04	0.33	0.07	
18/02/2025 18:00:00			0.03		0.11	0.10		0.46	0.00	0.35	0.03	0.31	0.07	
18/02/2025 18:15:00			0.03		0.11	0.10		0.46	0.00	0.35	0.03	0.30	0.07	
18/02/2025 18:30:00			0.03		0.11	0.10		0.46	0.00	0.35	0.02	0.29	0.06	
18/02/2025 18:45:00			0.03		0.11	0.10		0.47	0.00	0.35	0.02	0.28	0.08	
18/02/2025 19:00:00			0.03		0.11	0.10		0.47	0.00	0.35	0.04	0.27	0.07	
18/02/2025 19:15:00			0.03		0.11	0.10		0.47	0.00	0.35	0.02	0.26	0.08	
18/02/2025 19:30:00			0.03		0.11	0.10		0.47	0.00	0.35	0.02	0.25	0.08	
18/02/2025 19:45:00			0.03		0.11	0.10		0.47	0.00	0.35	0.04	0.25	0.08	
18/02/2025 20:00:00			0.03		0.11	0.10		0.47	0.00	0.35	0.04	0.24	0.08	
18/02/2025 20:15:00			0.03		0.11	0.10		0.47	0.00	0.35	0.04	0.23	0.07	
18/02/2025 20:30:00			0.03		0.11	0.10		0.47	0.00	0.35	0.04	0.23	0.09	
18/02/2025 20:45:00			0.03		0.11	0.10		0.47	0.00	0.35	0.03	0.22	0.07	
18/02/2025 21:00:00			0.03		0.11	0.10		0.48	0.00	0.35	0.03	0.22	0.08	
18/02/2025 21:15:00			0.03		0.11	0.10		0.48	0.00	0.35	0.03	0.21	0.08	
18/02/2025 21:30:00			0.03		0.11	0.10		0.48	0.00	0.35	0.02	0.21	0.07	
18/02/2025 21:45:00			0.03		0.11	0.10		0.48	0.00	0.35	0.02	0.21	0.07	
18/02/2025 22:00:00			0.03		0.11	0.10		0.48	0.00	0.35	0.05	0.22	0.07	
18/02/2025 22:15:00			0.03		0.11	0.10		0.47	0.00	0.35	0.05	0.23	0.07	
18/02/2025 22:30:00			0.03		0.11	0.10		0.47	0.00	0.35	0.05	0.25	0.06	
18/02/2025 22:45:00			0.03		0.11	0.10		0.47	0.00	0.35	0.05	0.27	0.06	
18/02/2025 23:00:00			0.03		0.11	0.10		0.47	0.00	0.35	0.03	0.29	0.05	
18/02/2025 23:15:00			0.03		0.11	0.10		0.47	0.00	0.35	0.03	0.31	0.04	
18/02/2025 23:30:00			0.03		0.11	0.10		0.47	0.00	0.35	0.05	0.32	0.03	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
18/02/2025 23:45:00			0.03		0.11	0.10		0.47	0.00	0.35	0.05	0.33	0.03	
19/02/2025 00:00:00			0.03		0.11	0.10		0.47	0.00	0.35	0.06	0.34	0.02	
19/02/2025 00:15:00			0.03		0.11	0.10		0.47	0.00	0.35	0.04	0.35	0.02	
19/02/2025 00:30:00			0.03		0.11	0.10		0.47	0.00	0.35	0.05	0.36	0.02	
19/02/2025 00:45:00			0.03		0.11	0.10		0.47	0.00	0.35	0.05	0.37	0.01	
19/02/2025 01:00:00			0.03		0.11	0.10		0.46	0.00	0.35	0.05	0.38	0.02	
19/02/2025 01:15:00			0.03		0.11	0.10		0.46	0.00	0.35	0.05	0.39	0.02	
19/02/2025 01:30:00			0.03		0.11	0.10		0.46	0.00	0.35	0.06	0.39	0.02	
19/02/2025 01:45:00			0.03		0.11	0.10		0.46	0.00	0.35	0.05	0.40	0.02	
19/02/2025 02:00:00			0.03		0.11	0.10		0.46	0.00	0.35	0.05	0.41	0.02	
19/02/2025 02:15:00			0.03		0.11	0.10		0.46	0.00	0.35	0.04	0.41	0.02	
19/02/2025 02:30:00			0.03		0.11	0.10		0.45	0.00	0.35	0.05	0.42	0.01	
19/02/2025 02:45:00			0.03		0.11	0.10		0.45	0.00	0.35	0.05	0.42	0.01	
19/02/2025 03:00:00			0.03		0.11	0.10		0.45	0.00	0.35	0.04	0.43	0.02	
19/02/2025 03:15:00			0.03		0.11	0.10		0.45	0.00	0.35	0.05	0.43	0.02	
19/02/2025 03:30:00			0.03		0.11	0.10		0.45	0.00	0.35	0.02	0.44	0.02	
19/02/2025 03:45:00			0.03		0.11	0.10		0.45	0.00	0.35	0.02	0.44	0.02	
19/02/2025 04:00:00			0.03		0.11	0.10		0.45	0.00	0.35	0.02	0.45	0.02	
19/02/2025 04:15:00			0.03		0.11	0.10		0.45	0.00	0.35	0.05	0.45	0.02	
19/02/2025 04:30:00			0.03		0.11	0.10		0.44	0.00	0.35	0.01	0.45	0.01	
19/02/2025 04:45:00			0.03		0.11	0.10		0.44	0.00	0.35	0.02	0.43	0.03	
19/02/2025 05:00:00			0.03		0.11	0.10		0.44	0.00	0.35	0.02	0.41	0.04	
19/02/2025 05:15:00			0.03		0.11	0.10		0.45	0.00	0.35	0.04	0.39	0.06	
19/02/2025 05:30:00			0.03		0.11	0.10		0.45	0.00	0.35	0.04	0.37	0.06	
19/02/2025 05:45:00			0.03		0.10	0.10		0.45	0.00	0.35	0.04	0.35	0.07	
19/02/2025 06:00:00			0.03		0.10	0.10		0.45	0.00	0.35	0.04	0.33	0.07	
19/02/2025 06:15:00			0.03		0.10	0.10		0.45	0.00	0.35	0.04	0.32	0.07	
19/02/2025 06:30:00			0.03		0.10	0.10		0.45	0.00	0.35	0.05	0.31	0.07	
19/02/2025 06:45:00			0.03		0.10	0.09		0.44	0.00	0.35	0.05	0.29	0.07	
19/02/2025 07:00:00			0.03		0.10	0.09		0.44	0.00	0.35	0.05	0.28	0.08	
19/02/2025 07:15:00			0.03		0.10	0.09		0.44	0.00	0.35	0.05	0.27	0.08	
19/02/2025 07:30:00			0.02		0.10	0.09		0.44	0.00	0.35	0.05	0.26	0.07	
19/02/2025 07:45:00			0.02		0.10	0.09		0.44	0.00	0.35	0.06	0.26	0.07	
19/02/2025 08:00:00			0.02		0.10	0.09		0.44	0.00	0.35	0.05	0.25	0.08	
19/02/2025 08:15:00			0.02		0.10	0.09		0.45	0.00	0.35	0.05	0.24	0.08	
19/02/2025 08:30:00			0.02		0.10	0.09		0.45	0.00	0.35	0.05	0.23	0.09	
19/02/2025 08:45:00			0.02		0.10	0.09		0.45	0.00	0.35	0.06	0.23	0.09	
19/02/2025 09:00:00			0.02		0.10	0.09		0.45	0.00	0.35	0.06	0.22	0.09	
19/02/2025 09:15:00			0.02		0.10	0.09		0.45	0.00	0.35	0.06	0.22	0.08	
19/02/2025 09:30:00			0.02		0.10	0.09		0.45	0.00	0.35	0.06	0.21	0.08	
19/02/2025 09:45:00			0.02		0.10	0.09		0.45	0.00	0.35	0.06	0.21	0.08	
19/02/2025 10:00:00			0.02		0.10	0.09		0.46	0.00	0.35	0.06	0.21	0.08	
19/02/2025 10:15:00			0.02		0.10	0.09		0.46	0.00	0.35	0.06	0.20	0.08	
19/02/2025 10:30:00			0.02		0.10	0.09		0.46	0.00	0.35	0.06	0.20	0.07	
19/02/2025 10:45:00			0.02		0.10	0.09		0.46	0.00	0.35	0.06	0.20	0.09	
19/02/2025 11:00:00			0.02		0.10	0.09		0.46	0.00	0.35	0.06	0.20	0.09	
19/02/2025 11:15:00			0.02		0.10	0.09		0.47	0.00	0.35	0.07	0.19	0.06	
19/02/2025 11:30:00			0.02		0.10	0.09		0.47	0.00	0.35	0.07	0.19	0.06	
19/02/2025 11:45:00			0.02		0.10	0.09		0.47	0.00	0.35	0.07	0.20	0.06	
19/02/2025 12:00:00			0.02		0.10	0.09		0.47	0.00	0.35	0.07	0.20	0.07	
19/02/2025 12:15:00			0.02		0.10	0.09		0.47	0.00	0.35	0.04	0.22	0.08	
19/02/2025 12:30:00			0.02		0.10	0.09		0.47	0.00	0.35	0.00	0.25	0.05	
19/02/2025 12:45:00			0.02		0.10	0.09		0.47	0.00	0.35	0.00	0.26	0.05	
19/02/2025 13:00:00			0.02		0.10	0.09		0.47	0.00	0.35	0.04	0.28	0.05	
19/02/2025 13:15:00			0.03		0.10	0.09		0.47	0.00	0.35	0.02	0.29	0.05	
19/02/2025 13:30:00			0.03		0.10	0.09		0.47	0.00	0.35	0.02	0.31	0.04	
19/02/2025 13:45:00			0.02		0.10	0.09		0.47	0.00	0.35	0.01	0.32	0.03	
19/02/2025 14:00:00			0.03		0.10	0.09		0.47	0.00	0.35	0.01	0.33	0.03	
19/02/2025 14:15:00			0.03		0.10	0.09		0.47	0.00	0.35	0.00	0.34	0.03	
19/02/2025 14:30:00			0.03		0.10	0.09		0.47	0.00	0.35	0.00	0.35	0.03	
19/02/2025 14:45:00			0.03		0.10	0.09		0.47	0.00	0.35	0.00	0.36	0.03	
19/02/2025 15:00:00			0.03		0.10	0.10		0.47	0.00	0.35	-0.01	0.36	0.02	
19/02/2025 15:15:00			0.03		0.10	0.10		0.47	0.00	0.35	0.00	0.37	0.02	
19/02/2025 15:30:00			0.02		0.10	0.09		0.47	0.00	0.35	0.01	0.38	0.02	
19/02/2025 15:45:00			0.02		0.10	0.09		0.47	0.00	0.35	0.01	0.38	0.01	
19/02/2025 16:00:00			0.02		0.10	0.09		0.47	0.00	0.35	0.00	0.39	0.02	
19/02/2025 16:15:00			0.02		0.10	0.09		0.47	0.00	0.35	0.00	0.40	0.01	
19/02/2025 16:30:00			0.02		0.10	0.09		0.47	0.00	0.35	0.01	0.38	0.03	
19/02/2025 16:45:00			0.02		0.10	0.09		0.47	0.00	0.35	0.01	0.36	0.04	
19/02/2025 17:00:00			0.02		0.10	0.09		0.47	0.00	0.35	0.02	0.34	0.06	
19/02/2025 17:15:00			0.02		0.10	0.09		0.47	0.00	0.35	0.02	0.32	0.06	
19/02/2025 17:30:00			0.02		0.10	0.09		0.47	0.00	0.35	0.05	0.30	0.06	
19/02/2025 17:45:00			0.02		0.10	0.09		0.47	0.00	0.35	0.04	0.28	0.07	
19/02/2025 18:00:00			0.02		0.10	0.09		0.47	0.00	0.35	0.04	0.27	0.06	
19/02/2025 18:15:00			0.02		0.10	0.09		0.47	0.00	0.35	0.02	0.26	0.06	
19/02/2025 18:30:00			0.02		0.10	0.09		0.47	0.00	0.35	0.02	0.25	0.07	
19/02/2025 18:45:00			0.01		0.10	0.09		0.47	0.00	0.35	0.01	0.24	0.07	
19/02/2025 19:00:00			0.01		0.10	0.09		0.47	0.00	0.35	0.02	0.23	0.07	
19/02/2025 19:15:00			0.01		0.10	0.09		0.47	0.00	0.35	0.02	0.22	0.08	
19/02/2025 19:30:00			0.01		0.10	0.09		0.48	0.00	0.35	0.02	0.22	0.06	
19/02/2025 19:45:00			0.01		0.10	0.09		0.48	0.00	0.35	0.02	0.21	0.06	
19/02/2025 20:00:00			0.01		0.10	0.09		0.48	0.00	0.35	0.01	0.21	0.07	
19/02/2025 20:15:00			0.01		0.10	0.09		0.48	0.00	0.35	0.02	0.20	0.06	
19/02/2025 20:30:00			0.01		0.10	0.09		0.48	0.00	0.35	0.02	0.20	0.07	
19/02/2025 20:45:00			0.01		0.10	0.09		0.48	0.00	0.35	0.01	0.19	0.09	
19/02/2025 21:00:00			0.01		0.10	0.09		0.48	0.00	0.35	0.01	0.19	0.07	
19/02/2025 21:15:00			0.01		0.10	0.09		0.48	0.00	0.35	0.01	0.19	0.07	
19/02/2025 21:30:00			0.01		0.10	0.09		0.48	0.00	0.35	0.01	0.19	0.05	
19/02/2025 21:45:00			0.02		0.10	0.09		0.48	0.00	0.35	0.02	0.18	0.07	
19/02/2025 22:00:00			0.02		0.10	0.09		0.48	0.00	0.35	0.04	0.18	0.07	
19/02/2025 22:15:00			0.02		0.10	0.09		0.48	0.00	0.35	0.03	0.18	0.07	
19/02/2025 22:30:00			0.02		0.10	0.09		0.48	0.00	0.35	0.03	0.18	0.08	
19/02/2025 22:45:00			0.02		0.10	0.09		0.48	0.00	0.35	0.03	0.18	0.07	
19/02/2025 23:00:00			0.02		0.10	0.09		0.48	0.00	0.35	0.04	0.18	0.07	
19/02/2025 23:15:00			0.02		0.10	0.09		0.48	0.00	0.35	0.03	0.19	0.06	
19/02/2025 23:30:00			0.02		0.10	0.09		0.48	0.00	0.35	0.03	0.20	0.06	
19/02/2025 23:45:00			0.02		0.10	0.09		0.48	0.00	0.35	0.04	0.23	0.06	
20/02/2025 00:00:00			0.02		0.10	0.09		0.48	0.00	0.35	0.04	0.27	0.04	
20/02/2025 00:15:00			0.02		0.10	0.09		0.48	0.00	0.35	0.04	0.30	0.03	
20/02/2025 00:30:00			0.02		0.10	0.09		0.48	0.00	0.35	0.04	0.31	0.03	
20/02/2025 00:45:00			0.02		0.10	0.09		0.47	0.00	0.35	0.04	0.32	0.04	
20/02/2025 01:00:00			0.02		0.10	0.09		0.47	0.00	0.35	0.04	0.32	0.03	
20/02/2025 01:15:00			0.02		0.10	0.09		0.47	0.00	0.35	0.04	0.33	0.03	
20/02/2025 01:30:00			0.02		0.10	0.09		0.47	0.00	0.35	0.04	0.34	0.03	
20/02/2025 01:45:00			0.02		0.10	0.09		0.47	0.00	0.35	0.03	0.35	0.02	
20/02/2025 02:00:00			0.02		0.10	0.09		0.47	0.00	0.35	0.03	0.35	0.02	
20/02/2025 02:15:00			0.02		0.10	0.09		0.46	0.00	0.35	0.03	0.36	0.01	
20/02/2025 02:30:00			0.02		0.10	0.09		0.46	0.00	0.35	0.03	0.37	0.02	
20/02/2025 02:45:00			0.02		0.10	0.09		0.46	0.00	0.35	0.04	0.37	0.02	
20/02/2025 03:00:00			0.02		0.10	0.09		0.46	0.00	0.35	0.03	0.38	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
20/02/2025 03:15:00			0.02		0.10	0.09		0.46	0.00	0.35	0.03	0.39	0.02	
20/02/2025 03:30:00			0.02		0.10	0.09		0.46	0.00	0.35	0.03	0.39	0.03	
20/02/2025 03:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.40	0.02	
20/02/2025 04:00:00			0.02		0.10	0.09		0.45	0.00	0.35	0.04	0.40	0.02	
20/02/2025 04:15:00			0.01		0.10	0.09		0.45	0.00	0.35	0.03	0.41	0.02	
20/02/2025 04:30:00			0.01		0.10	0.09		0.45	0.00	0.35	0.02	0.41	0.02	
20/02/2025 04:45:00			0.01		0.10	0.09		0.45	0.00	0.35	0.03	0.42	0.02	
20/02/2025 05:00:00			0.01		0.10	0.09		0.45	0.00	0.35	0.03	0.41	0.02	
20/02/2025 05:15:00			0.01		0.09	0.09		0.45	0.00	0.35	0.01	0.39	0.03	
20/02/2025 05:30:00			0.01		0.09	0.09		0.45	0.00	0.35	0.02	0.37	0.03	
20/02/2025 05:45:00			0.01		0.09	0.09		0.45	0.00	0.35	0.02	0.35	0.03	
20/02/2025 06:00:00			0.01		0.09	0.09		0.44	0.00	0.35	0.02	0.33	0.06	
20/02/2025 06:15:00			0.01		0.09	0.09		0.45	0.00	0.35	0.02	0.31	0.07	
20/02/2025 06:30:00			0.01		0.09	0.09		0.45	0.00	0.35	0.02	0.30	0.07	
20/02/2025 06:45:00			0.01		0.09	0.09		0.45	0.00	0.35	0.03	0.28	0.08	
20/02/2025 07:00:00			0.01		0.09	0.09		0.45	0.00	0.35	0.03	0.27	0.07	
20/02/2025 07:15:00			0.01		0.09	0.09		0.45	0.00	0.35	0.02	0.26	0.07	
20/02/2025 07:30:00			0.01		0.09	0.08		0.45	0.00	0.35	0.02	0.25	0.07	
20/02/2025 07:45:00			0.01		0.09	0.08		0.45	0.00	0.35	0.04	0.24	0.08	
20/02/2025 08:00:00			0.01		0.09	0.08		0.45	0.00	0.35	0.03	0.23	0.07	
20/02/2025 08:15:00			0.01		0.09	0.08		0.45	0.00	0.35	0.03	0.23	0.07	
20/02/2025 08:30:00			0.01		0.09	0.08		0.45	0.00	0.35	0.04	0.22	0.07	
20/02/2025 08:45:00			0.01		0.09	0.08		0.45	0.00	0.35	0.04	0.22	0.08	
20/02/2025 09:00:00			0.01		0.09	0.08		0.46	0.00	0.35	0.04	0.21	0.07	
20/02/2025 09:15:00			0.01		0.09	0.08		0.46	0.00	0.35	0.05	0.21	0.07	
20/02/2025 09:30:00			0.01		0.09	0.08		0.46	0.00	0.35	0.05	0.20	0.08	
20/02/2025 09:45:00			0.01		0.09	0.08		0.46	0.00	0.35	0.04	0.20	0.07	
20/02/2025 10:00:00			0.01		0.09	0.08		0.46	0.00	0.35	0.05	0.20	0.07	
20/02/2025 10:15:00			0.01		0.09	0.08		0.47	0.00	0.35	0.05	0.20	0.08	
20/02/2025 10:30:00			0.01		0.09	0.08		0.47	0.00	0.35	0.04	0.19	0.08	
20/02/2025 10:45:00			0.01		0.09	0.08		0.47	0.00	0.34	0.03	0.19	0.08	
20/02/2025 11:00:00			0.01		0.09	0.08		0.47	0.00	0.35	0.03	0.19	0.07	
20/02/2025 11:15:00			0.01		0.09	0.08		0.47	0.00	0.35	0.03	0.19	0.07	
20/02/2025 11:30:00			0.01		0.09	0.08		0.47	0.00	0.34	0.03	0.18	0.07	
20/02/2025 11:45:00			0.01		0.09	0.08		0.48	0.00	0.34	0.03	0.18	0.06	
20/02/2025 12:00:00			0.01		0.09	0.09		0.48	0.00	0.34	0.03	0.18	0.07	
20/02/2025 12:15:00			0.00		0.09	0.09		0.48	0.00	0.35	0.00	0.18	0.06	
20/02/2025 12:30:00			0.01		0.09	0.09		0.48	0.00	0.35	0.00	0.19	0.05	
20/02/2025 12:45:00			0.01		0.09	0.09		0.48	0.00	0.35	0.01	0.22	0.06	
20/02/2025 13:00:00			0.01		0.10	0.09		0.48	0.00	0.35	0.02	0.27	0.05	
20/02/2025 13:15:00			0.01		0.10	0.09		0.48	0.00	0.35	0.02	0.31	0.03	
20/02/2025 13:30:00			0.01		0.10	0.09		0.47	0.00	0.35	0.03	0.33	0.03	
20/02/2025 13:45:00			0.01		0.10	0.09		0.45	0.00	0.35	0.02	0.33	0.03	
20/02/2025 14:00:00			0.01		0.10	0.09		0.46	0.00	0.35	0.01	0.34	0.03	
20/02/2025 14:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.02	0.34	0.03	
20/02/2025 14:30:00			0.01		0.10	0.09		0.46	0.00	0.35	0.02	0.35	0.03	
20/02/2025 14:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.03	0.36	0.03	
20/02/2025 15:00:00			0.01		0.10	0.09		0.46	0.00	0.35	0.03	0.36	0.02	
20/02/2025 15:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.37	0.02	
20/02/2025 15:30:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.38	0.03	
20/02/2025 15:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.38	0.03	
20/02/2025 16:00:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.39	0.02	
20/02/2025 16:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.03	0.39	0.02	
20/02/2025 16:30:00			0.01		0.10	0.09		0.45	0.00	0.35	0.03	0.40	0.03	
20/02/2025 16:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.03	0.40	0.02	
20/02/2025 17:00:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.41	0.02	
20/02/2025 17:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.40	0.02	
20/02/2025 17:30:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.38	0.03	
20/02/2025 17:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.36	0.04	
20/02/2025 18:00:00			0.01		0.10	0.09		0.45	0.00	0.35	0.06	0.34	0.05	
20/02/2025 18:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.06	0.33	0.05	
20/02/2025 18:30:00			0.01		0.10	0.09		0.46	0.00	0.35	0.06	0.31	0.06	
20/02/2025 18:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.30	0.06	
20/02/2025 19:00:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.28	0.07	
20/02/2025 19:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.06	0.27	0.08	
20/02/2025 19:30:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.26	0.08	
20/02/2025 19:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.25	0.07	
20/02/2025 20:00:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.24	0.06	
20/02/2025 20:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.23	0.06	
20/02/2025 20:30:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.23	0.07	
20/02/2025 20:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.22	0.07	
20/02/2025 21:00:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.22	0.07	
20/02/2025 21:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.21	0.06	
20/02/2025 21:30:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.21	0.06	
20/02/2025 21:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.20	0.06	
20/02/2025 22:00:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.20	0.06	
20/02/2025 22:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.20	0.07	
20/02/2025 22:30:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.19	0.07	
20/02/2025 22:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.20	0.07	
20/02/2025 23:00:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.20	0.07	
20/02/2025 23:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.22	0.06	
20/02/2025 23:30:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.26	0.06	
20/02/2025 23:45:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.30	0.04	
21/02/2025 00:00:00			0.01		0.10	0.09		0.46	0.00	0.35	0.04	0.34	0.02	
21/02/2025 00:15:00			0.01		0.10	0.09		0.46	0.00	0.35	0.05	0.34	0.03	
21/02/2025 00:30:00			0.01		0.10	0.09		0.45	0.00	0.35	0.05	0.35	0.03	
21/02/2025 00:45:00			0.01		0.10	0.09		0.45	0.00	0.35	0.05	0.35	0.03	
21/02/2025 01:00:00			0.01		0.10	0.09		0.45	0.00	0.35	0.05	0.36	0.03	
21/02/2025 01:15:00			0.01		0.10	0.09		0.45	0.00	0.35	0.05	0.36	0.03	
21/02/2025 01:30:00			0.01		0.10	0.09		0.45	0.00	0.35	0.05	0.37	0.02	
21/02/2025 01:45:00			0.01		0.10	0.09		0.45	0.00	0.35	0.05	0.38	0.02	
21/02/2025 02:00:00			0.01		0.10	0.09		0.45	0.00	0.35	0.05	0.38	0.01	
21/02/2025 02:15:00			0.01		0.10	0.09		0.45	0.00	0.35	0.04	0.39	0.02	
21/02/2025 02:30:00			0.01		0.10	0.09		0.44	0.00	0.35	0.05	0.39	0.02	
21/02/2025 02:45:00			0.01		0.10	0.09		0.44	0.00	0.35	0.04	0.40	0.03	
21/02/2025 03:00:00			0.01		0.10	0.09		0.44	0.00	0.35	0.03	0.40	0.01	
21/02/2025 03:15:00			0.01		0.10	0.09		0.44	0.00	0.35	0.03	0.41	0.01	
21/02/2025 03:30:00			0.01		0.10	0.09		0.44	0.00	0.35	0.03	0.41	0.03	
21/02/2025 03:45:00			0.01		0.10	0.09		0.44	0.00	0.35	0.03	0.42	0.03	
21/02/2025 04:00:00			0.01		0.10	0.09		0.44	0.00	0.35	0.02	0.42	0.02	
21/02/2025 04:15:00			0.01		0.10	0.09		0.44	0.00	0.35	0.03	0.43	0.03	
21/02/2025 04:30:00			0.01		0.10	0.09		0.43	0.00	0.35	0.03	0.43	0.02	
21/02/2025 04:45:00			0.01					0.44	0.00	0.35	0.03	0.44	0.02	
21/02/2025 05:00:00			0.01					0.44	0.00	0.35	0.05			
21/02/2025 05:15:00			0.01					0.44	0.00	0.35	0.03			
21/02/2025 05:30:00			0.01					0.44	0.00	0.35	0.04			
21/02/2025 05:45:00								0.44	0.00	0.35	0.04			
21/02/2025 06:00:00								0.44	0.00	0.35	0.05			
21/02/2025 06:15:00								0.44	0.00					
21/02/2025 06:30:00								0.44	0.00					

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
														Data Missing from all locations
23/02/2025 00:00:00			0.05		0.14	0.13		0.49	0.00	0.41	0.07	0.47	0.07	
23/02/2025 00:15:00			0.05		0.14	0.13		0.49	0.00	0.41	0.08	0.47	0.07	
23/02/2025 00:30:00			0.05		0.14	0.13		0.49	0.00	0.40	0.07	0.46	0.07	
23/02/2025 00:45:00			0.05		0.14	0.13		0.49	0.00	0.40	0.07	0.46	0.06	
23/02/2025 01:00:00			0.05		0.14	0.13		0.48	0.00	0.40	0.08	0.46	0.06	
23/02/2025 01:15:00			0.05		0.14	0.13		0.48	0.00	0.40	0.08	0.47	0.05	
23/02/2025 01:30:00			0.05		0.14	0.13		0.48	0.00	0.39	0.08	0.49	0.05	
23/02/2025 01:45:00			0.05		0.14	0.13		0.48	0.00	0.39	0.08	0.53	0.04	
23/02/2025 02:00:00			0.05		0.14	0.13		0.48	0.00	0.39	0.08	0.55	0.02	
23/02/2025 02:15:00			0.05		0.14	0.13		0.48	0.00	0.39	0.07	0.57	0.02	
23/02/2025 02:30:00			0.05		0.13	0.13		0.48	0.00	0.39	0.08	0.57	0.01	
23/02/2025 02:45:00			0.05		0.13	0.13		0.48	0.00	0.39	0.08	0.58	0.01	
23/02/2025 03:00:00			0.05		0.13	0.13		0.48	0.00	0.40	0.08	0.58	0.02	
23/02/2025 03:15:00			0.05		0.13	0.13		0.48	0.00	0.40	0.08	0.59	0.02	
23/02/2025 03:30:00			0.05		0.13	0.13		0.48	0.00	0.40	0.08	0.59	0.01	
23/02/2025 03:45:00			0.05		0.13	0.13		0.47	0.00	0.41	0.08	0.60	0.02	
23/02/2025 04:00:00			0.04		0.13	0.12		0.47	0.00	0.41	0.08	0.60	0.02	
23/02/2025 04:15:00			0.04		0.13	0.12		0.47	0.00	0.41	0.08	0.61	0.02	
23/02/2025 04:30:00			0.04		0.13	0.12		0.47	0.00	0.41	0.07	0.61	0.02	
23/02/2025 04:45:00			0.04		0.13	0.12		0.47	0.00	0.42	0.07	0.62	0.02	
23/02/2025 05:00:00			0.04		0.13	0.12		0.46	0.00	0.42	0.07	0.62	0.02	
23/02/2025 05:15:00			0.04		0.13	0.12		0.46	0.00	0.42	0.07	0.63	0.02	
23/02/2025 05:30:00			0.04		0.13	0.12		0.47	0.00	0.43	0.06	0.63	0.01	
23/02/2025 05:45:00			0.04		0.13	0.12		0.47	0.00	0.43	0.07	0.64	0.01	
23/02/2025 06:00:00			0.04		0.13	0.12		0.47	0.00	0.43	0.07	0.64	0.02	
23/02/2025 06:15:00			0.04		0.13	0.12		0.47	0.00	0.44	0.07	0.64	0.01	
23/02/2025 06:30:00			0.04		0.13	0.12		0.47	0.00	0.44	0.07	0.65	0.02	
23/02/2025 06:45:00			0.04		0.13	0.12		0.47	0.00	0.44	0.07	0.65	0.02	
23/02/2025 07:00:00			0.04		0.13	0.12		0.47	0.00	0.45	0.07	0.66	0.02	
23/02/2025 07:15:00			0.04		0.13	0.12		0.47	0.00	0.45	0.06	0.66	0.03	
23/02/2025 07:30:00			0.04		0.13	0.12		0.46	0.00	0.45	0.04	0.66	0.02	
23/02/2025 07:45:00			0.04		0.13	0.12		0.46	0.00	0.45	0.06	0.67	0.02	
23/02/2025 08:00:00			0.04		0.13	0.12		0.46	0.00	0.46	0.03	0.67	0.02	
23/02/2025 08:15:00			0.04		0.13	0.12		0.46	0.00	0.46	0.00	0.67	0.03	
23/02/2025 08:30:00			0.04		0.13	0.12		0.46	0.00	0.46	0.00	0.67	0.02	
23/02/2025 08:45:00			0.04		0.12	0.12		0.45	0.00	0.47	0.00	0.67	0.02	
23/02/2025 09:00:00			0.04		0.12	0.12		0.45	0.00	0.47	0.01	0.66	0.02	
23/02/2025 09:15:00			0.04		0.12	0.12		0.45	0.00	0.47	0.05	0.64	0.05	
23/02/2025 09:30:00			0.04		0.12	0.12		0.45	0.00	0.47	0.03	0.62	0.06	
23/02/2025 09:45:00			0.04		0.12	0.12		0.45	0.00	0.46	0.05	0.60	0.07	
23/02/2025 10:00:00			0.03		0.12	0.12		0.46	0.00	0.46	0.06	0.58	0.07	
23/02/2025 10:15:00			0.03		0.12	0.11		0.46	0.00	0.46	0.06	0.56	0.09	
23/02/2025 10:30:00			0.03		0.12	0.11		0.46	0.00	0.45	0.03	0.54	0.09	
23/02/2025 10:45:00			0.03		0.12	0.11		0.47	0.00	0.45	0.05	0.53	0.09	
23/02/2025 11:00:00			0.03		0.12	0.11		0.47	0.00	0.44	0.06	0.51	0.09	
23/02/2025 11:15:00			0.03		0.12	0.11		0.46	0.00	0.44	0.06	0.50	0.08	
23/02/2025 11:30:00			0.03		0.12	0.11		0.47	0.00	0.43	0.02	0.49	0.08	
23/02/2025 11:45:00			0.03		0.12	0.11		0.47	0.00	0.43	0.05	0.47	0.08	
23/02/2025 12:00:00			0.03		0.12	0.11		0.47	0.00	0.42	0.06	0.46	0.08	
23/02/2025 12:15:00			0.03		0.12	0.11		0.47	0.00	0.42	0.06	0.45	0.09	
23/02/2025 12:30:00			0.03		0.12	0.11		0.47	0.00	0.41	0.03	0.44	0.08	
23/02/2025 12:45:00			0.03		0.12	0.11		0.47	0.00	0.41	0.04	0.43	0.08	
23/02/2025 13:00:00			0.03		0.12	0.12		0.47	0.00	0.41	0.04	0.43	0.10	
23/02/2025 13:15:00			0.03		0.12	0.12		0.47	0.00	0.40	0.04	0.42	0.09	
23/02/2025 13:30:00			0.03		0.12	0.12		0.47	0.00	0.40	0.03	0.41	0.09	
23/02/2025 13:45:00			0.03		0.12	0.12		0.47	0.00	0.40	0.02	0.40	0.09	
23/02/2025 14:00:00			0.03		0.12	0.11		0.47	0.00	0.39	0.03	0.39	0.09	
23/02/2025 14:15:00			0.03		0.12	0.12		0.47	0.00	0.39	0.03	0.39	0.10	
23/02/2025 14:30:00			0.03		0.12	0.11		0.47	0.00	0.39	0.05	0.38	0.08	
23/02/2025 14:45:00			0.03		0.12	0.12		0.47	0.00	0.39	0.05	0.38	0.08	
23/02/2025 15:00:00			0.03		0.12	0.12		0.46	0.00	0.39	0.04	0.37	0.08	
23/02/2025 15:15:00			0.03		0.12	0.12		0.46	0.00	0.39	0.04	0.36	0.09	
23/02/2025 15:30:00			0.03		0.12	0.12		0.46	0.00	0.38	0.06	0.36	0.07	
23/02/2025 15:45:00			0.03		0.12	0.12		0.46	0.00	0.38	0.07	0.36	0.07	
23/02/2025 16:00:00			0.03		0.12	0.11		0.46	0.00	0.38	0.05	0.35	0.08	
23/02/2025 16:15:00			0.03		0.12	0.11		0.46	0.00	0.38	0.05	0.35	0.07	
23/02/2025 16:30:00			0.03		0.12	0.11		0.46	0.00	0.38	0.05	0.35	0.07	
23/02/2025 16:45:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.36	0.08	
23/02/2025 17:00:00			0.03		0.12	0.11		0.46	0.00	0.38	0.07	0.36	0.07	
23/02/2025 17:15:00			0.03		0.12	0.11		0.46	0.00	0.38	0.07	0.37	0.07	
23/02/2025 17:30:00			0.03		0.12	0.11		0.46	0.00	0.38	0.05	0.38	0.06	
23/02/2025 17:45:00			0.03		0.12	0.11		0.46	0.00	0.38	0.05	0.38	0.06	
23/02/2025 18:00:00			0.03		0.12	0.11		0.46	0.00	0.38	0.05	0.39	0.06	
23/02/2025 18:15:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.40	0.06	
23/02/2025 18:30:00			0.03		0.12	0.11		0.46	0.00	0.38	0.06	0.41	0.06	
23/02/2025 18:45:00			0.03		0.12	0.11		0.46	0.00	0.38	0.05	0.41	0.04	
23/02/2025 19:00:00			0.03		0.12	0.11		0.46	0.00	0.38	0.04	0.41	0.04	
23/02/2025 19:15:00			0.03		0.12	0.11		0.46	0.00	0.38	0.04	0.40	0.06	
23/02/2025 19:30:00			0.03		0.11	0.11		0.46	0.00	0.38	0.04	0.40	0.06	
23/02/2025 19:45:00			0.03		0.11	0.11		0.46	0.00	0.38	0.05	0.39	0.06	
23/02/2025 20:00:00			0.03		0.11	0.11		0.46	0.00	0.38	0.05	0.38	0.06	
23/02/2025 20:15:00			0.03		0.11	0.11		0.46	0.00	0.38	0.05	0.38	0.07	
23/02/2025 20:30:00			0.02		0.11	0.11		0.47	0.00	0.38	0.05	0.37	0.07	
23/02/2025 20:45:00			0.03		0.11	0.11		0.47	0.00	0.38	0.04	0.35	0.07	
23/02/2025 21:00:00			0.03		0.11	0.11		0.46	0.00	0.38	0.03	0.34	0.07	
23/02/2025 21:15:00			0.02		0.11	0.11		0.47	0.00	0.38	0.05	0.33	0.07	
23/02/2025 21:30:00			0.03		0.11	0.11		0.47	0.00	0.37	0.06	0.32	0.08	
23/02/2025 21:45:00			0.03		0.11	0.11		0.47	0.00	0.38	0.05	0.32	0.08	
23/02/2025 22:00:00			0.03		0.11	0.11		0.46	0.00	0.38	0.05	0.31	0.08	
23/02/2025 22:15:00			0.03		0.12	0.11		0.46	0.00	0.37	0.05	0.30	0.08	
23/02/2025 22:30:00			0.03		0.11	0.11		0.46	0.00	0.37	0.06	0.30	0.09	
23/02/2025 22:45:00			0.03		0.11	0.11		0.46	0.00	0.37	0.06	0.29	0.07	
23/02/2025 23:00:00			0.03		0.11	0.11		0.46	0.00	0.37	0.06	0.29	0.07	
23/02/2025 23:15:00			0.03		0.11	0.11		0.46	0.00	0.37	0.06	0.28	0.08	
23/02/2025 23:30:00			0.03		0.11	0.11		0.46	0.00	0.37	0.06	0.28	0.07	
23/02/2025 23:45:00			0.03		0.11	0.11		0.46	0.00	0.37	0.06	0.27	0.07	
24/02/2025 00:00:00			0.02		0.11	0.11		0.45	0.00	0.37	0.06	0.27	0.09	
24/02/2025 00:15:00			0.02		0.11	0.11		0.45	0.00	0.37	0.05	0.27	0.07	
24/02/2025 00:30:00			0.03		0.11	0.11		0.45	0.00	0.37	0.05	0.26	0.08	
24/02/2025 00:45:00			0.02		0.11	0.11		0.45	0.00	0.37	0.06	0.26	0.07	
24/02/2025 01:00:00			0.02		0.11	0.11		0.45	0.00	0.37	0.06	0.26	0.07	
24/02/2025 01:15:00			0.02		0.11	0.11		0.45	0.00	0.37	0.06	0.26	0.08	
24/02/2025 01:30:00			0.02		0.11	0.11		0.44	0.00	0.37	0.06	0.25	0.07	
24/02/2025 01:45:00			0.02		0.11	0.11		0.44	0.00	0.37	0.06	0.25	0.06	
24/02/2025 02:00:00			0.02		0.11	0.11		0.44	0.00	0.37	0.08	0.25	0.07	
24/02/2025 02:15:00			0.02		0.11	0.11		0.44	0.00	0.37	0.06	0.25	0.08	
24/02/2025 02:30:00			0.02		0.11	0.11		0.44	0.00	0.37	0.06	0.24	0.08	
24/02/2025 02:45:00			0.02		0.11	0.11		0.43	0.00	0.37	0.06	0.24	0.08	
24/02/2025 03:00:00			0.02		0.11	0.11		0.44	0.00	0.37	0.06	0.24	0.08	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
24/02/2025 03:15:00			0.02		0.11	0.11		0.44	0.00	0.37	0.06	0.24	0.08	
24/02/2025 03:30:00			0.02		0.11	0.11		0.44	0.00	0.37	0.06	0.24	0.07	
24/02/2025 03:45:00			0.02		0.11	0.10		0.44	0.00	0.37	0.07	0.24	0.08	
24/02/2025 04:00:00			0.02		0.11	0.10		0.44	0.00	0.37	0.06	0.24	0.08	
24/02/2025 04:15:00			0.02		0.11	0.10		0.43	0.00	0.37	0.05	0.24	0.07	
24/02/2025 04:30:00			0.02		0.11	0.10		0.43	0.00	0.37	0.05	0.25	0.07	
24/02/2025 04:45:00			0.02		0.11	0.10		0.43	0.00	0.37	0.06	0.28	0.07	
24/02/2025 05:00:00			0.02		0.11	0.10		0.43	0.00	0.37	0.06	0.32	0.04	
24/02/2025 05:15:00			0.02		0.11	0.10		0.43	0.00	0.37	0.07	0.34	0.04	
24/02/2025 05:30:00			0.02		0.11	0.10		0.43	0.00	0.37	0.07	0.36	0.04	
24/02/2025 05:45:00			0.02		0.11	0.10		0.43	0.00	0.37	0.07	0.38	0.03	
24/02/2025 06:00:00			0.02		0.11	0.10		0.43	0.00	0.37	0.06	0.40	0.03	
24/02/2025 06:15:00			0.02		0.10	0.10		0.43	0.00	0.37	0.06	0.41	0.03	
24/02/2025 06:30:00			0.02		0.10	0.10		0.43	0.00	0.37	0.07	0.42	0.02	
24/02/2025 06:45:00			0.01		0.10	0.10		0.43	0.00	0.37	0.07	0.43	0.02	
24/02/2025 07:00:00			0.01		0.10	0.10		0.43	0.00	0.37	0.07	0.44	0.02	
24/02/2025 07:15:00			0.01		0.10	0.10		0.43	0.00	0.37	0.07	0.45	0.02	
24/02/2025 07:30:00			0.01		0.10	0.10		0.43	0.00	0.37	0.08	0.46	0.02	
24/02/2025 07:45:00			0.01		0.10	0.10		0.44	0.00	0.37	0.08	0.47	0.02	
24/02/2025 08:00:00			0.01		0.10	0.10		0.45	0.00	0.37	0.07	0.48	0.02	
24/02/2025 08:15:00			0.01		0.10	0.10		0.47	0.00	0.37	0.08	0.49	0.02	
24/02/2025 08:30:00			0.01		0.10	0.10		0.48	0.00	0.37	0.08	0.49	0.02	
24/02/2025 08:45:00			0.01		0.10	0.10		0.49	0.00	0.37	0.07	0.50	0.02	
24/02/2025 09:00:00			0.01		0.11	0.10		0.49	0.00	0.37	0.08	0.51	0.02	
24/02/2025 09:15:00			0.02		0.11	0.10		0.50	0.00	0.38	0.08	0.52	0.02	
24/02/2025 09:30:00			0.02		0.11	0.11		0.51	0.00	0.38	0.07	0.52	0.03	
24/02/2025 09:45:00			0.02		0.11	0.11		0.52	0.00	0.38	0.09	0.53	0.03	
24/02/2025 10:00:00			0.02		0.12	0.11		0.52	0.00	0.38	0.09	0.53	0.02	
24/02/2025 10:15:00			0.03		0.12	0.11		0.53	0.00	0.38	0.09	0.54	0.03	
24/02/2025 10:30:00			0.03		0.12	0.12		0.53	0.00	0.38	0.08	0.55	0.02	
24/02/2025 10:45:00			0.03		0.12	0.12		0.53	0.00	0.39	0.09	0.55	0.02	
24/02/2025 11:00:00			0.03		0.13	0.12		0.53	0.00	0.39	0.09	0.56	0.02	
24/02/2025 11:15:00			0.04		0.13	0.12		0.53	0.00	0.39	0.09	0.56	0.02	
24/02/2025 11:30:00			0.04		0.13	0.13		0.53	0.00	0.39	0.08	0.57	0.02	
24/02/2025 11:45:00			0.05		0.13	0.13		0.53	0.00	0.39	0.08	0.57	0.02	
24/02/2025 12:00:00			0.05		0.14	0.13		0.53	0.00	0.40	0.08	0.58	0.02	
24/02/2025 12:15:00			0.05		0.14	0.13		0.52	0.00	0.40	0.08	0.58	0.02	
24/02/2025 12:30:00			0.05		0.14	0.13		0.52	0.00	0.40	0.08	0.58	0.02	
24/02/2025 12:45:00			0.06		0.14	0.13		0.51	0.00	0.40	0.08	0.59	0.02	
24/02/2025 13:00:00			0.06		0.14	0.14		0.51	0.00	0.40	0.08	0.59	0.02	
24/02/2025 13:15:00			0.06		0.14	0.13		0.50	0.00	0.41	0.08	0.58	0.03	
24/02/2025 13:30:00			0.06		0.14	0.14		0.50	0.00	0.41	0.07	0.57	0.03	
24/02/2025 13:45:00			0.06		0.14	0.13		0.50	0.00	0.41	0.07	0.57	0.05	
24/02/2025 14:00:00			0.06		0.14	0.13		0.50	0.00	0.41	0.07	0.58	0.04	
24/02/2025 14:15:00			0.06		0.14	0.13		0.50	0.00	0.41	0.07	0.58	0.04	
24/02/2025 14:30:00			0.05		0.14	0.13		0.49	0.00	0.41	0.05	0.59	0.03	
24/02/2025 14:45:00			0.06		0.14	0.13		0.49	0.00	0.41	0.05	0.61	0.02	
24/02/2025 15:00:00			0.05		0.14	0.13		0.49	0.00	0.41	0.06	0.63	0.01	
24/02/2025 15:15:00			0.05		0.14	0.13		0.49	0.00	0.42	0.07	0.64	0.01	
24/02/2025 15:30:00			0.05		0.14	0.13		0.49	0.00	0.42	0.07	0.63	0.01	
24/02/2025 15:45:00			0.05		0.14	0.13		0.49	0.00	0.42	0.06	0.63	0.01	
24/02/2025 16:00:00			0.05		0.13	0.13		0.49	0.00	0.43	0.05	0.64	0.02	
24/02/2025 16:15:00			0.05		0.13	0.13		0.49	0.00	0.43	0.05	0.64	0.02	
24/02/2025 16:30:00			0.05		0.13	0.13		0.49	0.00	0.43	0.05	0.64	0.02	
24/02/2025 16:45:00			0.05		0.13	0.13		0.49	0.00	0.44	0.06	0.65	0.02	
24/02/2025 17:00:00			0.05		0.13	0.13		0.49	0.00	0.44	0.06	0.65	0.02	
24/02/2025 17:15:00			0.04		0.13	0.13		0.49	0.00	0.44	0.06	0.65	0.02	
24/02/2025 17:30:00			0.04		0.13	0.13		0.49	0.00	0.45	0.06	0.66	0.02	
24/02/2025 17:45:00			0.04		0.13	0.13		0.49	0.00	0.45	0.06	0.66	0.02	
24/02/2025 18:00:00			0.04		0.13	0.13		0.49	0.00	0.45	0.04	0.66	0.02	
24/02/2025 18:15:00			0.04		0.13	0.13		0.49	0.00	0.45	0.05	0.67	0.02	
24/02/2025 18:30:00			0.04		0.13	0.13		0.49	0.00	0.46	0.05	0.67	0.02	
24/02/2025 18:45:00			0.04		0.13	0.13		0.50	0.00	0.46	0.07	0.67	0.02	
24/02/2025 19:00:00			0.04		0.13	0.13		0.50	0.00	0.46	0.07	0.67	0.02	
24/02/2025 19:15:00			0.04		0.13	0.12		0.50	0.00	0.46	0.06	0.68	0.03	
24/02/2025 19:30:00			0.04		0.13	0.12		0.50	0.00	0.46	0.06	0.68	0.02	
24/02/2025 19:45:00			0.04		0.13	0.13		0.50	0.00	0.47	0.06	0.68	0.02	
24/02/2025 20:00:00			0.04		0.13	0.12		0.50	0.00	0.47	0.06	0.68	0.02	
24/02/2025 20:15:00			0.04		0.13	0.12		0.50	0.00	0.47	0.06	0.69	0.02	
24/02/2025 20:30:00			0.04		0.13	0.13		0.50	0.00	0.47	0.06	0.69	0.02	
24/02/2025 20:45:00			0.04		0.13	0.13		0.50	0.00	0.47	0.06	0.69	0.02	
24/02/2025 21:00:00			0.04		0.13	0.13		0.50	0.00	0.48	0.06	0.69	0.02	
24/02/2025 21:15:00			0.04		0.13	0.13		0.50	0.00	0.48	0.06	0.69	0.02	
24/02/2025 21:30:00			0.04		0.13	0.13		0.50	0.00	0.48	0.06	0.70	0.02	
24/02/2025 21:45:00			0.05		0.13	0.13		0.50	0.00	0.48	0.06	0.70	0.02	
24/02/2025 22:00:00			0.04		0.13	0.13		0.50	0.00	0.48	0.06	0.70	0.02	
24/02/2025 22:15:00			0.04		0.13	0.13		0.50	0.00	0.48	0.06	0.70	0.02	
24/02/2025 22:30:00			0.04		0.13	0.13		0.50	0.00	0.49	0.06	0.70	0.01	
24/02/2025 22:45:00			0.05		0.13	0.13		0.50	0.00	0.49	0.05	0.71	0.01	
24/02/2025 23:00:00			0.05		0.13	0.13		0.49	0.00	0.49	0.04	0.71	0.02	
24/02/2025 23:15:00			0.04		0.13	0.13		0.49	0.00	0.49	0.05	0.71	0.02	
24/02/2025 23:30:00			0.05		0.13	0.13		0.49	0.00	0.49	0.05	0.71	0.01	
24/02/2025 23:45:00			0.05		0.13	0.13		0.49	0.00	0.49	0.05	0.71	0.02	
25/02/2025 00:00:00			0.04		0.13	0.13		0.49	0.00	0.50	0.04	0.69	0.02	
25/02/2025 00:15:00			0.05		0.13	0.13		0.49	0.00	0.49	0.05	0.67	0.04	
25/02/2025 00:30:00			0.05		0.13	0.12		0.49	0.00	0.49	0.05	0.65	0.05	
25/02/2025 00:45:00			0.04		0.13	0.12		0.49	0.00	0.49	0.05	0.63	0.08	
25/02/2025 01:00:00			0.05		0.13	0.12		0.48	0.00	0.48	0.05	0.61	0.06	
25/02/2025 01:15:00			0.04		0.13	0.12		0.48	0.00	0.48	0.06	0.59	0.08	
25/02/2025 01:30:00			0.04		0.13	0.12		0.48	0.00	0.47	0.07	0.58	0.08	
25/02/2025 01:45:00			0.04		0.13	0.12		0.48	0.00	0.47	0.07	0.57	0.08	
25/02/2025 02:00:00			0.04		0.13	0.12		0.48	0.00	0.46	0.07	0.55	0.07	
25/02/2025 02:15:00			0.04		0.13	0.12		0.48	0.00	0.45	0.07	0.54	0.10	
25/02/2025 02:30:00			0.04		0.13	0.12		0.48	0.00	0.45	0.07	0.53	0.10	
25/02/2025 02:45:00			0.04		0.13	0.12		0.47	0.00	0.44	0.08	0.52	0.10	
25/02/2025 03:00:00			0.04		0.13	0.12		0.47	0.00	0.44	0.08	0.51	0.08	
25/02/2025 03:15:00			0.04		0.13	0.12		0.47	0.00	0.43	0.08	0.51	0.09	
25/02/2025 03:30:00			0.04		0.13	0.12		0.47	0.00	0.43	0.08	0.51	0.08	
25/02/2025 03:45:00			0.04		0.13	0.12		0.46	0.00	0.42	0.08	0.51	0.07	
25/02/2025 04:00:00			0.04		0.12	0.12		0.46	0.00	0.42	0.08	0.53	0.07	
25/02/2025 04:15:00			0.04		0.12	0.12		0.46	0.00	0.42	0.08	0.57	0.05	
25/02/2025 04:30:00			0.04		0.12	0.12		0.46	0.00	0.41	0.07	0.61	0.02	
25/02/2025 04:45:00			0.04		0.12	0.12		0.46	0.00	0.41	0.08	0.62	0.02	
25/02/2025 05:00:00			0.04		0.12	0.12		0.46	0.00	0.41	0.07	0.63	0.00	
25/02/2025 05:15:00			0.03		0.12	0.12		0.46	0.00	0.42	0.07	0.63	0.00	
25/02/2025 05:30:00			0.03		0.12	0.12		0.45	0.00	0.42	0.07	0.64	0.01	
25/02/2025 05:45:00			0.03		0.12	0.12		0.45	0.00	0.43	0.07	0.65	0.02	
25/02/2025 06:00:00			0.03		0.12	0.11		0.45	0.00	0.43	0.08	0.65	0.01	
25/02/2025 06:15:00			0.03		0.12	0.11		0.45	0.00	0.44	0.08	0.66	0.01	
25/02/2025 06:30:00			0.03		0.12	0.11		0.45	0.00	0.44	0.07	0.67	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
25/02/2025 06:45:00			0.03		0.12	0.11		0.45	0.00	0.45	0.07	0.67	0.01	
25/02/2025 07:00:00			0.03		0.12	0.11		0.45	0.00	0.45	0.07	0.68	0.01	
25/02/2025 07:15:00			0.03		0.12	0.11		0.45	0.00	0.46	0.07	0.68	0.01	
25/02/2025 07:30:00			0.03		0.12	0.11		0.45	0.00	0.46	0.07	0.69	0.02	
25/02/2025 07:45:00			0.03		0.11	0.11		0.45	0.00	0.47	0.06	0.69	0.02	
25/02/2025 08:00:00			0.03		0.11	0.11		0.45	0.00	0.47	0.06	0.69	0.02	
25/02/2025 08:15:00			0.03		0.11	0.11		0.45	0.00	0.47	0.05	0.70	0.02	
25/02/2025 08:30:00			0.02		0.11	0.11		0.45	0.00	0.48	0.05	0.70	0.02	
25/02/2025 08:45:00			0.02		0.11	0.11		0.46	0.00	0.48	0.06	0.70	0.00	
25/02/2025 09:00:00			0.02		0.11	0.11		0.46	0.00	0.48	0.05	0.71	0.01	
25/02/2025 09:15:00			0.02		0.11	0.11		0.46	0.00	0.49	0.05	0.71	0.01	
25/02/2025 09:30:00			0.02		0.11	0.11		0.46	0.00	0.49	0.05	0.72	0.01	
25/02/2025 09:45:00			0.02		0.11	0.11		0.46	0.00	0.49	0.05	0.72	0.01	
25/02/2025 10:00:00			0.02		0.11	0.11		0.47	0.00	0.50	0.05	0.72	0.02	
25/02/2025 10:15:00			0.02		0.11	0.11		0.47	0.00	0.50	0.05	0.72	0.02	
25/02/2025 10:30:00			0.02		0.11	0.11		0.47	0.00	0.50	0.05	0.73	0.01	
25/02/2025 10:45:00			0.02		0.11	0.11		0.47	0.00	0.50	0.05	0.73	0.02	
25/02/2025 11:00:00			0.02		0.11	0.11		0.47	0.00	0.50	0.05	0.73	0.02	
25/02/2025 11:15:00			0.02		0.11	0.11		0.47	0.00	0.51	0.05	0.73	0.01	
25/02/2025 11:30:00			0.02		0.11	0.11		0.47	0.00	0.51	0.05	0.74	0.01	
25/02/2025 11:45:00			0.02		0.11	0.11		0.47	0.00	0.51	0.05	0.74	0.02	
25/02/2025 12:00:00			0.02		0.11	0.11		0.47	0.00	0.51	0.06	0.72	0.02	
25/02/2025 12:15:00			0.02		0.11	0.11		0.47	0.00	0.51	0.05	0.69	0.06	
25/02/2025 12:30:00			0.02		0.11	0.11		0.47	0.00	0.51	0.05	0.67	0.06	
25/02/2025 12:45:00			0.02		0.12	0.11		0.47	0.00	0.50	0.05	0.65	0.06	
25/02/2025 13:00:00			0.03		0.12	0.11		0.47	0.00	0.50	0.06	0.63	0.06	
25/02/2025 13:15:00			0.02		0.12	0.11		0.47	0.00	0.49	0.06	0.61	0.09	
25/02/2025 13:30:00			0.02		0.12	0.11		0.47	0.00	0.48	0.06	0.59	0.09	
25/02/2025 13:45:00			0.02		0.12	0.11		0.47	0.00	0.48	0.06	0.58	0.07	
25/02/2025 14:00:00			0.03		0.12	0.11		0.47	0.00	0.47	0.07	0.57	0.07	
25/02/2025 14:15:00			0.03		0.12	0.11		0.47	0.00	0.46	0.06	0.55	0.08	
25/02/2025 14:30:00			0.03		0.12	0.11		0.46	0.00	0.46	0.06	0.54	0.08	
25/02/2025 14:45:00			0.03		0.12	0.11		0.46	0.00	0.45	0.06	0.53	0.09	
25/02/2025 15:00:00			0.02		0.11	0.11		0.46	0.00	0.45	0.07	0.52	0.09	
25/02/2025 15:15:00			0.03		0.11	0.11		0.46	0.00	0.44	0.07	0.51	0.09	
25/02/2025 15:30:00			0.02		0.11	0.11		0.46	0.00	0.43	0.08	0.50	0.08	
25/02/2025 15:45:00			0.03		0.11	0.11		0.46	0.00	0.43	0.08	0.49	0.09	
25/02/2025 16:00:00			0.03		0.11	0.11		0.46	0.00	0.42	0.08	0.49	0.09	
25/02/2025 16:15:00			0.02		0.11	0.11		0.46	0.00	0.42	0.08	0.48	0.08	
25/02/2025 16:30:00			0.02		0.11	0.11		0.46	0.00	0.41	0.09	0.48	0.08	
25/02/2025 16:45:00			0.02		0.11	0.11		0.46	0.00	0.41	0.08	0.48	0.08	
25/02/2025 17:00:00			0.02		0.11	0.11		0.46	0.00	0.41	0.08	0.48	0.08	
25/02/2025 17:15:00			0.02		0.11	0.11		0.46	0.00	0.40	0.08	0.50	0.06	
25/02/2025 17:30:00			0.02		0.11	0.11		0.46	0.00	0.40	0.08	0.53	0.04	
25/02/2025 17:45:00			0.02		0.11	0.11		0.46	0.00	0.40	0.08	0.58	0.04	
25/02/2025 18:00:00			0.02		0.11	0.11		0.46	0.00	0.40	0.08	0.62	0.00	
25/02/2025 18:15:00			0.02		0.11	0.10		0.46	0.00	0.40	0.06	0.62	0.00	
25/02/2025 18:30:00			0.02		0.11	0.10		0.46	0.00	0.40	0.07	0.63	0.00	
25/02/2025 18:45:00			0.02		0.11	0.10		0.46	0.00	0.41	0.07	0.64	0.00	
25/02/2025 19:00:00			0.02		0.11	0.10		0.46	0.00	0.42	0.07	0.65	0.00	
25/02/2025 19:15:00			0.02		0.11	0.10		0.46	0.00	0.43	0.07	0.66	0.00	
25/02/2025 19:30:00			0.02		0.11	0.10		0.47	0.00	0.43	0.06	0.67	0.00	
25/02/2025 19:45:00			0.02		0.11	0.10		0.47	0.00	0.44	0.06	0.68	0.00	
25/02/2025 20:00:00			0.02		0.11	0.10		0.47	0.00	0.45	0.06	0.68	0.00	
25/02/2025 20:15:00			0.02		0.11	0.10		0.47	0.00	0.46	0.06	0.69	0.00	
25/02/2025 20:30:00			0.02		0.11	0.10		0.47	0.00	0.46	0.06	0.70	0.00	
25/02/2025 20:45:00			0.02		0.11	0.10		0.47	0.00	0.47	0.06	0.70	0.00	
25/02/2025 21:00:00			0.02		0.11	0.10		0.47	0.00	0.47	0.05	0.71	0.01	
25/02/2025 21:15:00			0.02		0.11	0.10		0.47	0.00	0.48	0.05	0.71	0.00	
25/02/2025 21:30:00			0.02		0.11	0.10		0.47	0.00	0.48	0.05	0.72	0.00	
25/02/2025 21:45:00			0.02		0.11	0.10		0.47	0.00	0.49	0.04	0.72	0.00	
25/02/2025 22:00:00			0.02		0.11	0.10		0.47	0.00	0.49	0.05	0.72	0.00	
25/02/2025 22:15:00			0.02		0.11	0.10		0.47	0.00	0.50	0.05	0.73	0.01	
25/02/2025 22:30:00			0.02		0.11	0.10		0.47	0.00	0.50	0.04	0.73	0.01	
25/02/2025 22:45:00			0.02		0.11	0.10		0.47	0.00	0.50	0.04	0.73	0.01	
25/02/2025 23:00:00			0.02		0.11	0.10		0.46	0.00	0.50	0.04	0.74	0.00	
25/02/2025 23:15:00			0.02		0.11	0.10		0.46	0.00	0.51	0.04	0.74	0.01	
25/02/2025 23:30:00			0.02		0.11	0.10		0.46	0.00	0.51	0.04	0.74	0.01	
25/02/2025 23:45:00			0.02		0.11	0.10		0.46	0.00	0.51	0.03	0.72	0.01	
26/02/2025 00:00:00			0.02		0.11	0.10		0.46	0.00	0.51	0.03	0.70	0.02	
26/02/2025 00:15:00			0.02		0.11	0.10		0.45	0.00	0.51	0.04	0.67	0.06	
26/02/2025 00:30:00			0.02		0.11	0.10		0.45	0.00	0.50	0.05	0.65	0.07	
26/02/2025 00:45:00			0.02		0.11	0.10		0.45	0.00	0.50	0.05	0.63	0.07	
26/02/2025 01:00:00			0.02		0.11	0.10		0.45	0.00	0.49	0.06	0.61	0.09	
26/02/2025 01:15:00			0.02		0.11	0.10		0.45	0.00	0.48	0.06	0.59	0.09	
26/02/2025 01:30:00			0.02		0.11	0.10		0.45	0.00	0.48	0.06	0.58	0.10	
26/02/2025 01:45:00			0.02		0.11	0.10		0.44	0.00	0.47	0.07	0.56	0.10	
26/02/2025 02:00:00			0.02		0.11	0.10		0.44	0.00	0.46	0.07	0.55	0.08	
26/02/2025 02:15:00			0.02		0.11	0.10		0.44	0.00	0.45	0.08	0.54	0.08	
26/02/2025 02:30:00			0.02		0.11	0.10		0.44	0.00	0.45	0.08	0.53	0.10	
26/02/2025 02:45:00			0.02		0.11	0.10		0.44	0.00	0.44	0.06	0.52	0.10	
26/02/2025 03:00:00			0.02		0.11	0.10		0.43	0.00	0.43	0.08	0.51	0.10	
26/02/2025 03:15:00			0.02		0.10	0.10		0.43	0.00	0.43	0.08	0.50	0.10	
26/02/2025 03:30:00			0.02		0.10	0.10		0.43	0.00	0.42	0.07	0.49	0.08	
26/02/2025 03:45:00			0.02		0.10	0.10		0.43	0.00	0.42	0.07	0.48	0.08	
26/02/2025 04:00:00			0.02		0.10	0.10		0.43	0.00	0.41	0.08	0.47	0.09	
26/02/2025 04:15:00			0.02		0.10	0.10		0.43	0.00	0.41	0.08	0.46	0.09	
26/02/2025 04:30:00			0.02		0.10	0.09		0.43	0.00	0.40	0.07	0.46	0.09	
26/02/2025 04:45:00			0.02		0.10	0.09		0.42	0.00	0.40	0.07	0.45	0.08	
26/02/2025 05:00:00			0.01		0.10	0.09		0.42	0.00	0.40	0.07	0.45	0.08	
26/02/2025 05:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.45	0.08	
26/02/2025 05:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.45	0.08	
26/02/2025 05:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.47	0.06	
26/02/2025 06:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.51	0.05	
26/02/2025 06:15:00			0.01		0.10	0.09		0.42	0.00	0.38	0.07	0.56	0.03	
26/02/2025 06:30:00			0.01		0.10	0.09		0.42	0.00	0.38	0.07	0.60	0.00	
26/02/2025 06:45:00			0.01		0.10	0.09		0.42	0.00	0.38	0.07	0.61	0.00	
26/02/2025 07:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.61	0.00	
26/02/2025 07:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.62	0.00	
26/02/2025 07:30:00			0.01		0.10	0.09		0.42	0.00	0.40	0.07	0.63	0.00	
26/02/2025 07:45:00			0.01		0.10	0.09		0.42	0.00	0.41	0.06	0.64	0.00	
26/02/2025 08:00:00			0.01		0.10	0.09		0.42	0.00	0.42	0.06	0.65	0.00	
26/02/2025 08:15:00			0.01		0.10	0.09		0.43	0.00	0.43	0.05	0.66	0.01	
26/02/2025 08:30:00			0.01		0.10	0.09		0.43	0.00	0.43	0.05	0.67	0.01	
26/02/2025 08:45:00			0.01		0.10	0.09		0.43	0.00	0.44	0.06	0.67	0.00	
26/02/2025 09:00:00			0.01		0.10	0.09		0.43	0.00	0.45	0.06	0.68	0.02	
26/02/2025 09:15:00			0.01		0.10	0.09		0.44	0.00	0.45	0.05	0.69	0.00	
26/02/2025 09:30:00			0.00		0.10	0.09		0.44	0.00	0.46	0.06	0.69	0.01	
26/02/2025 09:45:00			0.00		0.10	0.09		0.44	0.00	0.46	0.06	0.70	0.00	
26/02/2025 10:00:00			0.00		0.10	0.09		0.44	0.00	0.47	0.06	0.70	0.00	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
26/02/2025 10:15:00			0.01		0.10	0.09		0.45	0.00	0.47	0.03	0.71	0.00	
26/02/2025 10:30:00			0.00		0.10	0.09		0.45	0.00	0.48	0.03	0.71	0.00	
26/02/2025 10:45:00			0.01		0.10	0.09		0.45	0.00	0.48	0.02	0.71	0.01	
26/02/2025 11:00:00			0.01		0.10	0.09		0.45	0.00	0.48	0.02	0.72	0.01	
26/02/2025 11:15:00			0.01		0.10	0.09		0.45	0.00	0.49	0.03	0.72	0.01	
26/02/2025 11:30:00			0.01		0.10	0.09		0.45	0.00	0.49	0.03	0.73	0.00	
26/02/2025 11:45:00			0.01		0.10	0.09		0.45	0.00	0.50	0.02	0.73	0.01	
26/02/2025 12:00:00			0.01		0.10	0.09		0.45	0.00	0.50	0.02	0.73	0.01	
26/02/2025 12:15:00			0.01		0.10	0.09		0.45	0.00	0.50	0.02	0.71	0.01	
26/02/2025 12:30:00			0.01		0.10	0.09		0.45	0.00	0.50	0.04	0.69	0.04	
26/02/2025 12:45:00			0.01		0.10	0.09		0.45	0.00	0.50	0.05	0.66	0.06	
26/02/2025 13:00:00			0.01		0.10	0.09		0.45	0.00	0.49	0.05	0.64	0.06	
26/02/2025 13:15:00			0.01		0.10	0.09		0.46	0.00	0.49	0.04	0.62	0.07	
26/02/2025 13:30:00			0.01		0.10	0.09		0.46	0.00	0.48	0.04	0.60	0.09	
26/02/2025 13:45:00			0.01		0.10	0.10		0.47	0.00	0.48	0.04	0.58	0.11	
26/02/2025 14:00:00			0.01		0.10	0.10		0.48	0.00	0.47	0.04	0.57	0.10	
26/02/2025 14:15:00			0.01		0.11	0.10		0.49	0.00	0.46	0.04	0.56	0.07	
26/02/2025 14:30:00			0.01		0.11	0.10		0.51	0.00	0.46	0.05	0.54	0.08	
26/02/2025 14:45:00			0.02		0.11	0.10		0.51	0.00	0.45	0.05	0.53	0.08	
26/02/2025 15:00:00			0.02		0.11	0.10		0.52	0.00	0.44	0.05	0.52	0.10	
26/02/2025 15:15:00			0.01		0.11	0.10		0.52	0.00	0.44	0.08	0.51	0.08	
26/02/2025 15:30:00			0.02		0.11	0.11		0.52	0.00	0.43	0.11	0.50	0.08	
26/02/2025 15:45:00			0.02		0.12	0.11		0.52	0.00	0.42	0.10	0.49	0.08	
26/02/2025 16:00:00			0.03		0.12	0.11		0.52	0.00	0.42	0.06	0.48	0.09	
26/02/2025 16:15:00			0.03		0.12	0.11		0.52	0.00	0.42	0.06	0.47	0.09	
26/02/2025 16:30:00			0.03		0.13	0.11		0.51	0.00	0.41	0.06	0.46	0.09	
26/02/2025 16:45:00			0.04		0.13	0.12		0.51	0.00	0.41	0.06	0.46	0.09	
26/02/2025 17:00:00			0.04		0.13	0.12		0.50	0.00	0.40	0.06	0.45	0.08	
26/02/2025 17:15:00			0.04		0.13	0.12		0.50	0.00	0.40	0.06	0.45	0.10	
26/02/2025 17:30:00			0.04		0.13	0.12		0.50	0.00	0.40	0.06	0.45	0.07	
26/02/2025 17:45:00			0.04		0.13	0.12		0.49	0.00	0.39	0.06	0.45	0.07	
26/02/2025 18:00:00			0.04		0.13	0.12		0.49	0.00	0.39	0.06	0.47	0.07	
26/02/2025 18:15:00			0.04		0.13	0.12		0.49	0.00	0.39	0.06	0.50	0.05	
26/02/2025 18:30:00			0.04		0.13	0.12		0.49	0.00	0.39	0.07	0.55	0.03	
26/02/2025 18:45:00			0.04		0.13	0.12		0.49	0.00	0.39	0.06	0.58	0.03	
26/02/2025 19:00:00			0.04		0.13	0.12		0.49	0.00	0.39	0.06	0.60	0.00	
26/02/2025 19:15:00			0.04		0.13	0.12		0.48	0.00	0.39	0.07	0.61	0.00	
26/02/2025 19:30:00			0.04		0.13	0.12		0.48	0.00	0.39	0.06	0.62	0.00	
26/02/2025 19:45:00			0.04		0.13	0.12		0.48	0.00	0.40	0.08	0.63	0.01	
26/02/2025 20:00:00			0.04		0.13	0.12		0.48	0.00	0.41	0.07	0.64	0.00	
26/02/2025 20:15:00			0.04		0.13	0.12		0.48	0.00	0.41	0.07	0.64	0.00	
26/02/2025 20:30:00			0.04		0.13	0.12		0.48	0.00	0.42	0.07	0.65	0.00	
26/02/2025 20:45:00			0.04		0.13	0.12		0.48	0.00	0.43	0.07	0.66	0.00	
26/02/2025 21:00:00			0.04		0.13	0.12		0.48	0.00	0.44	0.08	0.67	0.00	
26/02/2025 21:15:00			0.04		0.12	0.12		0.48	0.00	0.44	0.08	0.67	0.00	
26/02/2025 21:30:00			0.04		0.12	0.12		0.48	0.00	0.45	0.06	0.68	0.00	
26/02/2025 21:45:00			0.04		0.12	0.12		0.48	0.00	0.45	0.06	0.68	0.00	
26/02/2025 22:00:00			0.04		0.12	0.12		0.47	0.00	0.46	0.06	0.69	0.00	
26/02/2025 22:15:00			0.04		0.12	0.12		0.47	0.00	0.46	0.06	0.69	0.01	
26/02/2025 22:30:00			0.04		0.12	0.11		0.47	0.00	0.47	0.06	0.70	0.01	
26/02/2025 22:45:00			0.04		0.12	0.11		0.47	0.00	0.47	0.06	0.70	0.00	
26/02/2025 23:00:00			0.04		0.12	0.11		0.47	0.00	0.48	0.07	0.71	0.00	
26/02/2025 23:15:00			0.04		0.12	0.11		0.47	0.00	0.48	0.07	0.71	0.01	
26/02/2025 23:30:00			0.03		0.12	0.11		0.47	0.00	0.48	0.07	0.71	0.07	
26/02/2025 23:45:00			0.04		0.12	0.11		0.47	0.00	0.49	0.07	0.72	0.00	
27/02/2025 00:00:00			0.04		0.12	0.11		0.47	0.00	0.49	0.06	0.72	0.00	
27/02/2025 00:15:00			0.04		0.12	0.11		0.47	0.00	0.49	0.06	0.70	0.01	
27/02/2025 00:30:00			0.04		0.12	0.11		0.47	0.00	0.49	0.05	0.68	0.04	
27/02/2025 00:45:00			0.03		0.12	0.11		0.46	0.00	0.49	0.05	0.65	0.04	
27/02/2025 01:00:00			0.03		0.12	0.11		0.46	0.00	0.49	0.05	0.62	0.06	
27/02/2025 01:15:00			0.03		0.12	0.11		0.46	0.00	0.48	0.05	0.60	0.07	
27/02/2025 01:30:00			0.03		0.12	0.11		0.46	0.00	0.47	0.07	0.58	0.09	
27/02/2025 01:45:00			0.03		0.12	0.11		0.46	0.00	0.47	0.08	0.57	0.09	
27/02/2025 02:00:00			0.03		0.12	0.11		0.45	0.00	0.46	0.08	0.55	0.09	
27/02/2025 02:15:00			0.03		0.12	0.11		0.45	0.00	0.45	0.08	0.54	0.08	
27/02/2025 02:30:00			0.03		0.12	0.11		0.45	0.00	0.45	0.07	0.52	0.08	
27/02/2025 02:45:00			0.03		0.12	0.11		0.44	0.00	0.44	0.08	0.51	0.09	
27/02/2025 03:00:00			0.03		0.12	0.11		0.44	0.00	0.43	0.08	0.50	0.09	
27/02/2025 03:15:00			0.03		0.12	0.11		0.44	0.00	0.43	0.08	0.49	0.11	
27/02/2025 03:30:00			0.03		0.12	0.11		0.44	0.00	0.42	0.08	0.48	0.09	
27/02/2025 03:45:00			0.03		0.11	0.11		0.44	0.00	0.42	0.07	0.47	0.09	
27/02/2025 04:00:00			0.03		0.11	0.11		0.44	0.00	0.41	0.07	0.46	0.09	
27/02/2025 04:15:00			0.03		0.11	0.11		0.44	0.00	0.41	0.07	0.45	0.07	
27/02/2025 04:30:00			0.03		0.11	0.10		0.43	0.00	0.40	0.07	0.45	0.07	
27/02/2025 04:45:00			0.03		0.11	0.10		0.43	0.00	0.40	0.08	0.44	0.08	
27/02/2025 05:00:00			0.03		0.11	0.10		0.43	0.00	0.40	0.08	0.43	0.08	
27/02/2025 05:15:00			0.02		0.11	0.10		0.43	0.00	0.39	0.08	0.43	0.08	
27/02/2025 05:30:00			0.02		0.11	0.10		0.43	0.00	0.39	0.07	0.42	0.08	
27/02/2025 05:45:00			0.02		0.11	0.10		0.42	0.00	0.39	0.07	0.42	0.06	
27/02/2025 06:00:00			0.02		0.11	0.10		0.42	0.00	0.38	0.07	0.42	0.08	
27/02/2025 06:15:00			0.02		0.11	0.10		0.42	0.00	0.38	0.09	0.43	0.08	
27/02/2025 06:30:00			0.02		0.11	0.10		0.42	0.00	0.38	0.09	0.46	0.06	
27/02/2025 06:45:00			0.02		0.11	0.10		0.42	0.00	0.38	0.08	0.51	0.06	
27/02/2025 07:00:00			0.02		0.11	0.10		0.42	0.00	0.38	0.09	0.56	0.00	
27/02/2025 07:15:00			0.02		0.10	0.10		0.42	0.00	0.38	0.08	0.57	0.00	
27/02/2025 07:30:00			0.02		0.10	0.10		0.42	0.00	0.38	0.08	0.58	0.00	
27/02/2025 07:45:00			0.02		0.10	0.10		0.42	0.00	0.38	0.09	0.59	0.00	
27/02/2025 08:00:00			0.02		0.10	0.09		0.42	0.00	0.38	0.08	0.60	0.00	
27/02/2025 08:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.61	0.00	
27/02/2025 08:30:00			0.01		0.10	0.09		0.42	0.00	0.40	0.08	0.62	0.01	
27/02/2025 08:45:00			0.01		0.10	0.09		0.42	0.00	0.40	0.08	0.63	0.00	
27/02/2025 09:00:00			0.01		0.10	0.09		0.43	0.00	0.41	0.08	0.63	0.00	
27/02/2025 09:15:00			0.01		0.10	0.09		0.43	0.00	0.41	0.08	0.64	0.01	
27/02/2025 09:30:00			0.01		0.10	0.09		0.43	0.00	0.42	0.07	0.65	0.01	
27/02/2025 09:45:00			0.01		0.10	0.09		0.43	0.00	0.43	0.08	0.66	0.00	
27/02/2025 10:00:00			0.01		0.10	0.09		0.44	0.00	0.43	0.08	0.66	0.00	
27/02/2025 10:15:00			0.01		0.10	0.09		0.44	0.00	0.44	0.08	0.67	0.01	
27/02/2025 10:30:00			0.01		0.10	0.09		0.44	0.00	0.44	0.08	0.67	0.01	
27/02/2025 10:45:00			0.01		0.10	0.09		0.44	0.00	0.45	0.08	0.68	0.01	
27/02/2025 11:00:00			0.01		0.10	0.09		0.44	0.00	0.45	0.07	0.68	0.01	
27/02/2025 11:15:00			0.01		0.10	0.09		0.44	0.00	0.46	0.07	0.69	0.01	
27/02/2025 11:30:00			0.01		0.10	0.09		0.44	0.00	0.46	0.07	0.69	0.02	
27/02/2025 11:45:00			0.01		0.10	0.09		0.44	0.00	0.46	0.10	0.69	0.02	
27/02/2025 12:00:00			0.01		0.10	0.09		0.44	0.00	0.47	0.10	0.70	0.01	
27/02/2025 12:15:00			0.01		0.10	0.09		0.44	0.00	0.47	0.07	0.70	0.01	
27/02/2025 12:30:00			0.01		0.10	0.09		0.44	0.00	0.48	0.07	0.70	0.01	
27/02/2025 12:45:00			0.01		0.10	0.09		0.44	0.00	0.48	0.08	0.71	0.01	
27/02/2025 13:00:00			0.01		0.10	0.09		0.44	0.00	0.48	0.07	0.71	0.01	
27/02/2025 13:15:00			0.01		0.10	0.09		0.44	0.00	0.48	0.07	0.70	0.01	
27/02/2025 13:30:00			0.01		0.10	0.09		0.44	0.00	0.49	0.08	0.68	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
27/02/2025 13:45:00			0.01		0.10	0.09		0.44	0.00	0.49	0.08	0.65	0.05	
27/02/2025 14:00:00			0.01		0.10	0.09		0.44	0.00	0.48	0.08	0.63	0.06	
27/02/2025 14:15:00			0.01		0.10	0.09		0.44	0.00	0.47	0.08	0.60	0.08	
27/02/2025 14:30:00			0.02		0.10	0.09		0.44	0.00	0.47	0.02	0.58	0.08	
27/02/2025 14:45:00			0.02		0.10	0.09		0.44	0.00	0.46	0.02	0.57	0.08	
27/02/2025 15:00:00			0.02		0.10	0.09		0.44	0.00	0.45	0.03	0.55	0.08	
27/02/2025 15:15:00			0.01		0.10	0.09		0.44	0.00	0.45	0.11	0.54	0.08	
27/02/2025 15:30:00			0.02		0.10	0.09		0.43	0.00	0.44	0.11	0.52	0.09	
27/02/2025 15:45:00			0.02		0.10	0.09		0.43	0.00	0.43	0.06	0.51	0.09	
27/02/2025 16:00:00			0.01		0.10	0.09		0.43	0.00	0.43	0.07	0.50	0.09	
27/02/2025 16:15:00			0.02		0.10	0.09		0.43	0.00	0.42	0.07	0.49	0.06	
27/02/2025 16:30:00			0.01		0.10	0.09		0.43	0.00	0.42	0.06	0.48	0.07	
27/02/2025 16:45:00			0.01		0.10	0.09		0.43	0.00	0.41	0.07	0.47	0.09	
27/02/2025 17:00:00			0.01		0.10	0.09		0.43	0.00	0.41	0.06	0.46	0.10	
27/02/2025 17:15:00			0.01		0.10	0.09		0.43	0.00	0.40	0.06	0.45	0.07	
27/02/2025 17:30:00			0.02		0.10	0.09		0.43	0.00	0.40	0.07	0.45	0.07	
27/02/2025 17:45:00			0.02		0.10	0.09		0.43	0.00	0.39	0.06	0.46	0.06	
27/02/2025 18:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.06	0.49	0.06	
27/02/2025 18:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.05	0.54	0.04	
27/02/2025 18:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.58	0.00	
27/02/2025 18:45:00			0.01		0.10	0.09		0.44	0.00	0.38	0.07	0.59	0.01	
27/02/2025 19:00:00			0.01		0.10	0.09		0.44	0.00	0.39	0.07	0.60	0.01	
27/02/2025 19:15:00			0.01		0.10	0.09		0.44	0.00	0.39	0.05	0.61	0.00	
27/02/2025 19:30:00			0.01		0.10	0.09		0.44	0.00	0.39	0.05	0.62	0.01	
27/02/2025 19:45:00			0.01		0.10	0.09		0.44	0.00	0.40	0.05	0.63	0.01	
27/02/2025 20:00:00			0.01		0.10	0.09		0.44	0.00	0.41	0.05	0.63	0.01	
27/02/2025 20:15:00			0.01		0.10	0.09		0.44	0.00	0.41	0.07	0.64	0.01	
27/02/2025 20:30:00			0.01		0.10	0.09		0.45	0.00	0.42	0.07	0.65	0.00	
27/02/2025 20:45:00			0.01		0.10	0.09		0.45	0.00	0.42	0.07	0.66	0.00	
27/02/2025 21:00:00			0.01		0.10	0.09		0.45	0.00	0.43	0.06	0.66	0.00	
27/02/2025 21:15:00			0.01		0.10	0.09		0.45	0.00	0.44	0.06	0.67	0.00	
27/02/2025 21:30:00			0.01		0.10	0.09		0.45	0.00	0.44	0.06	0.67	0.02	
27/02/2025 21:45:00			0.02		0.10	0.09		0.45	0.00	0.45	0.06	0.68	0.02	
27/02/2025 22:00:00			0.02		0.10	0.09		0.45	0.00	0.45	0.06	0.68	0.01	
27/02/2025 22:15:00			0.02		0.10	0.09		0.45	0.00	0.46	0.06	0.69	0.01	
27/02/2025 22:30:00			0.02		0.10	0.09		0.44	0.00	0.46	0.06	0.69	0.01	
27/02/2025 22:45:00			0.02		0.10	0.09		0.44	0.00	0.47	0.07	0.69	0.01	
27/02/2025 23:00:00			0.02		0.10	0.09		0.44	0.00	0.47	0.07	0.70	0.01	
27/02/2025 23:15:00			0.02		0.10	0.09		0.44	0.00	0.47	0.07	0.70	0.01	
27/02/2025 23:30:00			0.02		0.10	0.09		0.44	0.00	0.48	0.07	0.70	0.01	
27/02/2025 23:45:00			0.02		0.10	0.09		0.44	0.00	0.48	0.07	0.71	0.02	
28/02/2025 00:00:00			0.02		0.10	0.09		0.44	0.00	0.48	0.07	0.71	0.01	
28/02/2025 00:15:00			0.02		0.10	0.09		0.43	0.00	0.48	0.07	0.71	0.02	
28/02/2025 00:30:00			0.02		0.10	0.09		0.43	0.00	0.49	0.06	0.71	0.02	
28/02/2025 00:45:00			0.02		0.10	0.09		0.43	0.00	0.49	0.06	0.72	0.01	
28/02/2025 01:00:00			0.02		0.10	0.09		0.43	0.00	0.49	0.06	0.70	0.00	
28/02/2025 01:15:00			0.02		0.10	0.09		0.43	0.00	0.49	0.06	0.67	0.00	
28/02/2025 01:30:00			0.02		0.10	0.09		0.43	0.00	0.49	0.06	0.64	0.04	
28/02/2025 01:45:00			0.02		0.10	0.09		0.42	0.00	0.48	0.06	0.61	0.07	
28/02/2025 02:00:00			0.02		0.10	0.09		0.42	0.00	0.47	0.06	0.59	0.10	
28/02/2025 02:15:00			0.02		0.10	0.09		0.42	0.00	0.47	0.06	0.57	0.09	
28/02/2025 02:30:00			0.02		0.10	0.09		0.42	0.00	0.46	0.06	0.56	0.09	
28/02/2025 02:45:00			0.02		0.10	0.09		0.42	0.00	0.45	0.07	0.54	0.09	
28/02/2025 03:00:00			0.01		0.10	0.09		0.41	0.00	0.44	0.08	0.53	0.07	
28/02/2025 03:15:00			0.01		0.10	0.09		0.41	0.00	0.44	0.08	0.51	0.07	
28/02/2025 03:30:00			0.01		0.10	0.09		0.41	0.00	0.43	0.08	0.50	0.09	
28/02/2025 03:45:00			0.01		0.10	0.09		0.41	0.00	0.42	0.08	0.49	0.09	
28/02/2025 04:00:00			0.01		0.10	0.09		0.41	0.00	0.42	0.07	0.48	0.08	
28/02/2025 04:15:00			0.01		0.10	0.09		0.41	0.00	0.41	0.07	0.47	0.08	
28/02/2025 04:30:00			0.01		0.10	0.09		0.41	0.00	0.41	0.08	0.46	0.09	
28/02/2025 04:45:00			0.01		0.10	0.09		0.41	0.00	0.40	0.08	0.45	0.09	
28/02/2025 05:00:00			0.01		0.09	0.09		0.40	0.00	0.40	0.07	0.45	0.09	
28/02/2025 05:15:00			0.01		0.09	0.09		0.40	0.00	0.39	0.07	0.44	0.09	
28/02/2025 05:30:00			0.01		0.09	0.09		0.40	0.00	0.39	0.07	0.43	0.08	
28/02/2025 05:45:00			0.01		0.09	0.08		0.40	0.00	0.39	0.07	0.42	0.08	
28/02/2025 06:00:00			0.01		0.09	0.08		0.40	0.00	0.38	0.07	0.42	0.08	
28/02/2025 06:15:00			0.01		0.09	0.08		0.40	0.00	0.38	0.08	0.41	0.07	
28/02/2025 06:30:00			0.01		0.09	0.08		0.40	0.00	0.38	0.08	0.40	0.07	
28/02/2025 06:45:00			0.01		0.09	0.08		0.40	0.00	0.37	0.07	0.40	0.09	
28/02/2025 07:00:00			0.01		0.09	0.08		0.40	0.00	0.37	0.07	0.39	0.09	
28/02/2025 07:15:00			0.01		0.09	0.08		0.40	0.00	0.37	0.07	0.39	0.06	
28/02/2025 07:30:00			0.01		0.09	0.08		0.40	0.00	0.37	0.07	0.40	0.06	
28/02/2025 07:45:00			0.01		0.09	0.08		0.40	0.00	0.37	0.07	0.42	0.06	
28/02/2025 08:00:00			0.01		0.09	0.08		0.41	0.00	0.37	0.06	0.47	0.03	
28/02/2025 08:15:00			0.00		0.09	0.08		0.41	0.00	0.37	0.06	0.52	0.03	
28/02/2025 08:30:00			0.00		0.09	0.08		0.41	0.00	0.36	0.06	0.53	0.00	
28/02/2025 08:45:00			0.00		0.09	0.08		0.41	0.00	0.36	0.07	0.54	0.00	
28/02/2025 09:00:00			0.00		0.09	0.08		0.42	0.00	0.37	0.06	0.55	0.00	
28/02/2025 09:15:00			0.00		0.09	0.08		0.42	0.00	0.37	0.08	0.57	0.00	
28/02/2025 09:30:00			0.00		0.09	0.08		0.42	0.00	0.37	0.08	0.58	0.01	
28/02/2025 09:45:00			0.00		0.09	0.08		0.42	0.00	0.37	0.06	0.59	0.01	
28/02/2025 10:00:00			0.00		0.09	0.08		0.43	0.00	0.38	0.06	0.59	0.00	
28/02/2025 10:15:00			0.00		0.09	0.08		0.43	0.00	0.38	0.06	0.60	0.04	
28/02/2025 10:30:00			0.00		0.09	0.08		0.43	0.00	0.39	0.06	0.61	0.00	
28/02/2025 10:45:00			0.00		0.09	0.08		0.43	0.00	0.39	0.06	0.62	0.00	
28/02/2025 11:00:00			0.00		0.09	0.08		0.43	0.00	0.40	0.07	0.62	0.00	
28/02/2025 11:15:00			0.00		0.09	0.08		0.43	0.00	0.40	0.06	0.63	0.00	
28/02/2025 11:30:00			0.00		0.09	0.08		0.43	0.00	0.41	0.06	0.64	0.01	
28/02/2025 11:45:00			0.00		0.09	0.08		0.43	0.00	0.42	0.06	0.64	0.01	
28/02/2025 12:00:00			0.00		0.09	0.08		0.43	0.00	0.42	0.06	0.65	0.01	
28/02/2025 12:15:00			0.00		0.09	0.08		0.43	0.00	0.42	0.05	0.65	0.01	
28/02/2025 12:30:00			0.01		0.09	0.08		0.43	0.00	0.43	0.05	0.66	0.02	
28/02/2025 12:45:00			0.01		0.09	0.08		0.43	0.00	0.43	0.05	0.66	0.01	
28/02/2025 13:00:00			0.01		0.09	0.08		0.43	0.00	0.44	0.04	0.67	0.01	
28/02/2025 13:15:00			0.01		0.10	0.08		0.43	0.00	0.44	0.04	0.67	0.01	
28/02/2025 13:30:00			0.01		0.10	0.08		0.43	0.00	0.45	0.02	0.67	0.01	
28/02/2025 13:45:00			0.01		0.10	0.08		0.43	0.00	0.45	0.03	0.65	0.02	
28/02/2025 14:00:00			0.01		0.10	0.08		0.44	0.00	0.45	0.03	0.61	0.05	
28/02/2025 14:15:00			0.01		0.10	0.08		0.44	0.00	0.45	0.03	0.59	0.05	
28/02/2025 14:30:00			0.01		0.10	0.08		0.44	0.00	0.44	0.03	0.57	0.05	
28/02/2025 14:45:00			0.01		0.10	0.09		0.44	0.00	0.44	0.04	0.55	0.06	
28/02/2025 15:00:00			0.01		0.10	0.09		0.44	0.00	0.43	0.04	0.53	0.08	
28/02/2025 15:15:00			0.01		0.10	0.09		0.44	0.00	0.42	0.05	0.51	0.08	
28/02/2025 15:30:00			0.01		0.10	0.09		0.43	0.00	0.42	0.05	0.50	0.07	
28/02/2025 15:45:00			0.01		0.10	0.09		0.43	0.00	0.41	0.04	0.48	0.07	
28/02/2025 16:00:00			0.01		0.10	0.09		0.43	0.00	0.41	0.04	0.47	0.07	
28/02/2025 16:15:00			0.01		0.10	0.09		0.43	0.00	0.40	0.04	0.46	0.08	
28/02/2025 16:30:00			0.01		0.10	0.09		0.42	0.00	0.40	0.04	0.45	0.09	
28/02/2025 16:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.44	0.08	
28/02/2025 17:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.43	0.07	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
28/02/2025 17:15:00			0.01		0.10	0.09		0.42	0.00	0.38	0.05	0.42	0.07	
28/02/2025 17:30:00			0.01		0.10	0.09		0.42	0.00	0.38	0.05	0.41	0.09	
28/02/2025 17:45:00			0.01		0.10	0.09		0.42	0.00	0.38	0.04	0.40	0.08	
28/02/2025 18:00:00			0.01		0.10	0.09		0.42	0.00	0.37	0.07	0.40	0.08	
28/02/2025 18:15:00			0.01		0.10	0.09		0.42	0.00	0.37	0.07	0.39	0.07	
28/02/2025 18:30:00			0.01		0.10	0.09		0.42	0.00	0.37	0.07	0.40	0.08	
28/02/2025 18:45:00			0.01		0.10	0.09		0.42	0.00	0.37	0.07	0.42	0.07	
28/02/2025 19:00:00			0.01		0.09	0.09		0.42	0.00	0.37	0.03	0.47	0.04	
28/02/2025 19:15:00			0.01		0.09	0.09		0.42	0.00	0.36	0.06	0.52	0.04	
28/02/2025 19:30:00			0.01		0.09	0.09		0.42	0.00	0.36	0.05	0.53	0.00	
28/02/2025 19:45:00			0.01		0.09	0.08		0.42	0.00	0.36	0.05	0.54	0.00	
28/02/2025 20:00:00			0.01		0.09	0.08		0.42	0.00	0.36	0.04	0.55	0.01	
28/02/2025 20:15:00			0.01		0.09	0.08		0.42	0.00	0.36	0.04	0.56	0.01	
28/02/2025 20:30:00			0.01		0.09	0.08		0.43	0.00	0.37	0.04	0.57	0.01	
28/02/2025 20:45:00			0.01		0.10	0.09		0.43	0.00	0.37	0.04	0.57	0.01	
28/02/2025 21:00:00			0.01		0.10	0.09		0.43	0.00	0.37	0.06	0.58	0.00	
28/02/2025 21:15:00			0.01		0.10	0.09		0.43	0.00	0.37	0.04	0.59	0.00	
28/02/2025 21:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.60	0.00	
28/02/2025 21:45:00			0.01		0.10	0.09		0.42	0.00	0.38	0.06	0.60	0.00	
28/02/2025 22:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.05	0.61	0.00	
28/02/2025 22:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.62	0.00	
28/02/2025 22:30:00			0.01		0.10	0.09		0.42	0.00	0.40	0.06	0.62	0.00	
28/02/2025 22:45:00			0.01		0.10	0.09		0.42	0.00	0.40	0.05	0.63	0.01	
28/02/2025 23:00:00			0.01		0.10	0.09		0.42	0.00	0.41	0.05	0.63	0.01	
28/02/2025 23:15:00			0.01		0.10	0.09		0.42	0.00	0.41	0.05	0.64	0.02	
28/02/2025 23:30:00			0.01		0.10	0.09		0.42	0.00	0.42	0.05	0.64	0.01	
28/02/2025 23:45:00			0.01		0.10	0.09		0.42	0.00	0.42	0.05	0.65	0.01	
01/03/2025 00:00:00			0.01		0.10	0.09		0.42	0.00	0.42	0.05	0.65	0.01	
01/03/2025 00:15:00			0.01		0.10	0.09		0.42	0.00	0.43	0.05	0.65	0.01	
01/03/2025 00:30:00			0.01		0.10	0.09		0.42	0.00	0.43	0.05	0.66	0.01	
01/03/2025 00:45:00			0.01		0.10	0.09		0.42	0.00	0.44	0.05	0.66	0.01	
01/03/2025 01:00:00			0.01		0.10	0.09		0.41	0.00	0.44	0.05	0.67	0.00	
01/03/2025 01:15:00			0.01		0.10	0.09		0.41	0.00	0.44	0.05	0.67	0.00	
01/03/2025 01:30:00			0.01		0.10	0.09		0.41	0.00	0.45	0.04	0.66	0.00	
01/03/2025 01:45:00			0.01		0.10	0.09		0.41	0.00	0.45	0.04	0.63	0.02	
01/03/2025 02:00:00			0.01		0.09	0.09		0.41	0.00	0.45	0.04	0.60	0.02	
01/03/2025 02:15:00			0.01		0.09	0.08		0.41	0.00	0.44	0.05	0.58	0.07	
01/03/2025 02:30:00			0.01		0.09	0.08		0.41	0.00	0.44	0.05	0.55	0.08	
01/03/2025 02:45:00			0.01		0.09	0.08		0.41	0.00	0.43	0.05	0.53	0.08	
01/03/2025 03:00:00			0.01		0.09	0.08		0.40	0.00	0.43	0.05	0.52	0.11	
01/03/2025 03:15:00			0.01		0.09	0.08		0.40	0.00	0.42	0.05	0.50	0.11	
01/03/2025 03:30:00			0.01		0.09	0.08		0.40	0.00	0.41	0.05	0.49	0.07	
01/03/2025 03:45:00			0.01		0.09	0.08		0.40	0.00	0.41	0.06	0.47	0.07	
01/03/2025 04:00:00			0.01		0.09	0.08		0.40	0.00	0.40	0.06	0.46	0.09	
01/03/2025 04:15:00			0.01		0.09	0.08		0.40	0.00	0.40	0.05	0.45	0.10	
01/03/2025 04:30:00			0.01		0.09	0.08		0.40	0.00	0.39	0.07	0.44	0.10	
01/03/2025 04:45:00			0.01		0.09	0.08		0.40	0.00	0.39	0.07	0.43	0.08	
01/03/2025 05:00:00			0.01		0.09	0.08		0.40	0.00	0.38	0.06	0.42	0.06	
01/03/2025 05:15:00			0.01		0.09	0.08		0.40	0.00	0.38	0.06	0.41	0.07	
01/03/2025 05:30:00			0.01		0.09	0.08		0.40	0.00	0.37	0.06	0.40	0.08	
01/03/2025 05:45:00			0.00		0.09	0.08		0.40	0.00	0.37	0.06	0.39	0.08	
01/03/2025 06:00:00			0.00		0.09	0.08		0.40	0.00	0.37	0.06	0.39	0.08	
01/03/2025 06:15:00			0.00		0.09	0.08		0.40	0.00	0.37	0.07	0.38	0.08	
01/03/2025 06:30:00			0.00		0.09	0.08		0.39	0.00	0.36	0.07	0.37	0.08	
01/03/2025 06:45:00			0.00		0.09	0.08		0.39	0.00	0.36	0.07	0.37	0.08	
01/03/2025 07:00:00			0.00		0.09	0.08		0.39	0.00	0.36	0.06	0.36	0.08	
01/03/2025 07:15:00			0.00		0.09	0.08		0.39	0.00	0.36	0.07	0.35	0.06	
01/03/2025 07:30:00			0.00		0.09	0.08		0.39	0.00	0.36	0.07	0.35	0.08	
01/03/2025 07:45:00			0.00		0.09	0.08		0.40	0.00	0.36	0.06	0.34	0.07	
01/03/2025 08:00:00			0.00		0.09	0.08		0.40	0.00	0.36	0.05	0.35	0.08	
01/03/2025 08:15:00			0.00		0.09	0.08		0.40	0.00	0.36	0.07	0.36	0.06	
01/03/2025 08:30:00			0.00		0.09	0.08		0.40	0.00	0.35	0.06	0.40	0.04	
01/03/2025 08:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.46	0.02	
01/03/2025 09:00:00			0.00		0.09	0.08		0.41	0.00	0.35	0.08	0.47	0.00	
01/03/2025 09:15:00			0.00		0.09	0.08		0.41	0.00	0.35	0.08	0.48	0.01	
01/03/2025 09:30:00			0.00		0.09	0.08		0.41	0.00	0.35	0.08	0.50	0.01	
01/03/2025 09:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.07	0.51	0.01	
01/03/2025 10:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.07	0.51	0.00	
01/03/2025 10:15:00			0.00		0.09	0.08		0.42	0.00	0.35	0.07	0.52	0.00	
01/03/2025 10:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.07	0.53	0.00	
01/03/2025 10:45:00			0.00		0.09	0.08		0.43	0.00	0.36	0.07	0.54	0.00	
01/03/2025 11:00:00			0.00		0.09	0.08		0.43	0.00	0.36	0.07	0.55	0.00	
01/03/2025 11:15:00			0.00		0.09	0.08		0.43	0.00	0.36	0.07	0.56	0.00	
01/03/2025 11:30:00			0.00		0.09	0.08		0.43	0.00	0.36	0.07	0.56	0.00	
01/03/2025 11:45:00			0.00		0.09	0.08		0.43	0.00	0.36	0.07	0.57	0.00	
01/03/2025 12:00:00			0.00		0.09	0.08		0.43	0.00	0.37	0.07	0.57	0.01	
01/03/2025 12:15:00			0.00		0.09	0.08		0.43	0.00	0.37	0.07	0.58	0.01	
01/03/2025 12:30:00			0.00		0.09	0.08		0.43	0.00	0.37	0.06	0.59	0.00	
01/03/2025 12:45:00			0.00		0.09	0.08		0.43	0.00	0.38	0.06	0.59	0.01	
01/03/2025 13:00:00			0.01		0.09	0.08		0.43	0.00	0.38	0.06	0.60	0.01	
01/03/2025 13:15:00			0.01		0.09	0.08		0.44	0.00	0.38	0.06	0.60	0.01	
01/03/2025 13:30:00			0.01		0.10	0.08		0.44	0.00	0.39	0.06	0.61	0.00	
01/03/2025 13:45:00			0.01		0.10	0.08		0.44	0.00	0.39	0.04	0.61	0.02	
01/03/2025 14:00:00			0.01		0.10	0.08		0.43	0.00	0.40	0.05	0.62	0.02	
01/03/2025 14:15:00			0.01		0.10	0.08		0.43	0.00	0.40	0.04	0.61	0.01	
01/03/2025 14:30:00			0.01		0.10	0.08		0.43	0.00	0.40	0.04	0.58	0.03	
01/03/2025 14:45:00			0.01		0.10	0.08		0.43	0.00	0.40	0.05	0.56	0.04	
01/03/2025 15:00:00			0.01		0.10	0.08		0.43	0.00	0.40	0.05	0.53	0.05	
01/03/2025 15:15:00			0.01		0.10	0.08		0.43	0.00	0.40	0.05	0.51	0.05	
01/03/2025 15:30:00			0.01		0.10	0.08		0.43	0.00	0.40	0.05	0.49	0.05	
01/03/2025 15:45:00			0.01		0.10	0.08		0.43	0.00	0.39	0.04	0.47	0.07	
01/03/2025 16:00:00			0.01		0.10	0.08		0.43	0.00	0.39	0.05	0.46	0.07	
01/03/2025 16:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.04	0.44	0.07	
01/03/2025 16:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.43	0.06	
01/03/2025 16:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.42	0.08	
01/03/2025 17:00:00			0.01		0.10	0.09		0.43	0.00	0.37	0.05	0.41	0.05	
01/03/2025 17:15:00			0.01		0.10	0.09		0.42	0.00	0.37	0.06	0.40	0.08	
01/03/2025 17:30:00			0.01		0.10	0.09		0.42	0.00	0.37	0.06	0.39	0.08	
01/03/2025 17:45:00			0.01		0.10	0.09		0.42	0.00	0.36	0.06	0.38	0.08	
01/03/2025 18:00:00			0.01		0.10	0.09		0.42	0.00	0.36	0.06	0.37	0.08	
01/03/2025 18:15:00			0.01		0.10	0.09		0.42	0.00	0.36	0.06	0.36	0.06	
01/03/2025 18:30:00			0.01		0.10	0.09		0.42	0.00	0.36	0.05	0.35	0.07	
01/03/2025 18:45:00			0.01		0.10	0.09		0.42	0.00	0.36	0.05	0.35	0.06	
01/03/2025 19:00:00			0.01		0.10	0.09		0.42	0.00	0.36	0.05	0.36	0.08	
01/03/2025 19:15:00			0.01		0.10	0.08		0.43	0.00	0.35	0.05	0.42	0.05	
01/03/2025 19:30:00			0.01		0.10	0.08		0.43	0.00	0.35	0.06	0.46	0.02	
01/03/2025 19:45:00			0.01		0.10	0.08		0.43	0.00	0.35	0.06	0.48	0.01	
01/03/2025 20:00:00			0.01		0.10	0.08		0.43	0.00	0.35	0.06	0.49	0.01	
01/03/2025 20:15:00			0.01		0.10	0.08		0.43	0.00	0.35	0.06	0.50	0.02	
01/03/2025 20:30:00			0.01		0.10	0.08		0.43	0.00	0.35	0.07	0.51	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
01/03/2025 20:45:00			0.01		0.10	0.08		0.42	0.00	0.35	0.07	0.52	0.00	
01/03/2025 21:00:00			0.01		0.10	0.08		0.43	0.00	0.35	0.07	0.52	0.00	
01/03/2025 21:15:00			0.01		0.10	0.08		0.42	0.00	0.35	0.07	0.53	0.00	
01/03/2025 21:30:00			0.01		0.10	0.08		0.43	0.00	0.35	0.06	0.54	0.00	
01/03/2025 21:45:00			0.01		0.09	0.08		0.42	0.00	0.36	0.06	0.54	0.00	
01/03/2025 22:00:00			0.01		0.10	0.08		0.43	0.00	0.36	0.05	0.55	0.00	
01/03/2025 22:15:00			0.01		0.09	0.08		0.42	0.00	0.36	0.05	0.56	0.00	
01/03/2025 22:30:00			0.01		0.10	0.08		0.42	0.00	0.36	0.05	0.56	0.00	
01/03/2025 22:45:00			0.01		0.09	0.08		0.42	0.00	0.36	0.05	0.57	0.02	
01/03/2025 23:00:00			0.01		0.09	0.08		0.42	0.00	0.37	0.04	0.57	0.01	
01/03/2025 23:15:00			0.01		0.10	0.08		0.42	0.00	0.37	0.05	0.58	0.01	
01/03/2025 23:30:00			0.01		0.10	0.08		0.42	0.00	0.37	0.05	0.58	0.01	
01/03/2025 23:45:00			0.01		0.09	0.08		0.42	0.00	0.38	0.04	0.59	0.00	
02/03/2025 00:00:00			0.01		0.10	0.08		0.42	0.00	0.38	0.06	0.59	0.00	
02/03/2025 00:15:00			0.01		0.09	0.08		0.42	0.00	0.38	0.05	0.60	0.01	
02/03/2025 00:30:00			0.01		0.10	0.08		0.42	0.00	0.39	0.05	0.60	0.02	
02/03/2025 00:45:00			0.01		0.10	0.08		0.42	0.00	0.39	0.04	0.61	0.02	
02/03/2025 01:00:00			0.01		0.09	0.08		0.41	0.00	0.39	0.05	0.61	0.01	
02/03/2025 01:15:00			0.01		0.09	0.08		0.41	0.00	0.40	0.05	0.61	0.01	
02/03/2025 01:30:00			0.01		0.09	0.08		0.41	0.00	0.40	0.05	0.62	0.00	
02/03/2025 01:45:00			0.01		0.09	0.08		0.42	0.00	0.40	0.05	0.62	0.01	
02/03/2025 02:00:00			0.01		0.09	0.08		0.42	0.00	0.40	0.05	0.62	0.01	
02/03/2025 02:15:00			0.01		0.09	0.08		0.42	0.00	0.41	0.04	0.63	0.02	
02/03/2025 02:30:00			0.01		0.09	0.08		0.41	0.00	0.41	0.04	0.61	0.02	
02/03/2025 02:45:00			0.01		0.09	0.08		0.41	0.00	0.41	0.05	0.57	0.02	
02/03/2025 03:00:00			0.01		0.09	0.08		0.41	0.00	0.41	0.05	0.55	0.04	
02/03/2025 03:15:00			0.01		0.09	0.08		0.41	0.00	0.41	0.05	0.52	0.07	
02/03/2025 03:30:00			0.01		0.09	0.08		0.41	0.00	0.40	0.05	0.50	0.09	
02/03/2025 03:45:00			0.01		0.09	0.08		0.40	0.00	0.40	0.06	0.48	0.10	
02/03/2025 04:00:00			0.01		0.09	0.08		0.40	0.00	0.39	0.06	0.47	0.09	
02/03/2025 04:15:00			0.01		0.09	0.08		0.40	0.00	0.39	0.06	0.45	0.09	
02/03/2025 04:30:00			0.01		0.09	0.08		0.40	0.00	0.38	0.06	0.44	0.08	
02/03/2025 04:45:00			0.01		0.09	0.08		0.40	0.00	0.38	0.06	0.43	0.08	
02/03/2025 05:00:00			0.01		0.09	0.08		0.40	0.00	0.38	0.05	0.41	0.09	
02/03/2025 05:15:00			0.01		0.09	0.08		0.40	0.00	0.37	0.05	0.40	0.09	
02/03/2025 05:30:00			0.01		0.09	0.08		0.40	0.00	0.37	0.05	0.39	0.09	
02/03/2025 05:45:00			0.01		0.09	0.08		0.40	0.00	0.37	0.05	0.38	0.09	
02/03/2025 06:00:00			0.01		0.09	0.08		0.39	0.00	0.36	0.05	0.38	0.09	
02/03/2025 06:15:00			0.00		0.09	0.08		0.39	0.00	0.36	0.05	0.37	0.08	
02/03/2025 06:30:00			0.00		0.09	0.08		0.39	0.00	0.36	0.06	0.36	0.07	
02/03/2025 06:45:00			0.00		0.09	0.08		0.39	0.00	0.36	0.06	0.35	0.09	
02/03/2025 07:00:00			0.00		0.09	0.08		0.39	0.00	0.36	0.07	0.34	0.08	
02/03/2025 07:15:00			0.00		0.09	0.08		0.39	0.00	0.35	0.07	0.34	0.08	
02/03/2025 07:30:00			0.00		0.09	0.08		0.39	0.00	0.35	0.07	0.33	0.07	
02/03/2025 07:45:00			0.00		0.09	0.08		0.39	0.00	0.35	0.07	0.32	0.06	
02/03/2025 08:00:00			0.00		0.09	0.08		0.39	0.00	0.35	0.08	0.32	0.08	
02/03/2025 08:15:00			0.00		0.09	0.08		0.39	0.00	0.35	0.08	0.31	0.07	
02/03/2025 08:30:00			0.00		0.09	0.07		0.39	0.00	0.35	0.07	0.31	0.07	
02/03/2025 08:45:00			0.00		0.09	0.07		0.39	0.00	0.35	0.07	0.32	0.07	
02/03/2025 09:00:00			0.00		0.09	0.07		0.40	0.00	0.35	0.08	0.35	0.06	
02/03/2025 09:15:00			0.00		0.09	0.07		0.40	0.00	0.35	0.07	0.41	0.03	
02/03/2025 09:30:00			0.00		0.09	0.07		0.40	0.00	0.35	0.07	0.44	0.00	
02/03/2025 09:45:00			0.00		0.09	0.07		0.40	0.00	0.35	0.08	0.45	0.01	
02/03/2025 10:00:00			0.00		0.09	0.07		0.41	0.00	0.35	0.07	0.46	0.00	
02/03/2025 10:15:00			0.00		0.09	0.07		0.41	0.00	0.35	0.07	0.47	0.00	
02/03/2025 10:30:00			0.00		0.09	0.07		0.42	0.00	0.35	0.07	0.48	0.01	
02/03/2025 10:45:00			0.00		0.09	0.07		0.42	0.00	0.35	0.07	0.49	0.01	
02/03/2025 11:00:00			0.00		0.09	0.07		0.42	0.00	0.35	0.07	0.49	0.01	
02/03/2025 11:15:00			0.00		0.09	0.07		0.42	0.00	0.35	0.07	0.50	0.00	
02/03/2025 11:30:00			0.00		0.09	0.07		0.43	0.00	0.35	0.05	0.51	0.02	
02/03/2025 11:45:00			0.00		0.09	0.08		0.43	0.00	0.35	0.04	0.51	0.00	
02/03/2025 12:00:00			0.00		0.09	0.08		0.43	0.00	0.35	0.03	0.52	0.01	
02/03/2025 12:15:00			0.00		0.09	0.08		0.43	0.00	0.35	0.03	0.53	0.02	
02/03/2025 12:30:00			0.00		0.09	0.08		0.43	0.00	0.35	0.02	0.53	0.02	
02/03/2025 12:45:00			0.00		0.09	0.08		0.43	0.00	0.35	0.03	0.54	0.01	
02/03/2025 13:00:00			0.00		0.09	0.08		0.43	0.00	0.36	0.04	0.54	0.01	
02/03/2025 13:15:00			0.00		0.09	0.08		0.43	0.00	0.36	0.02	0.55	0.01	
02/03/2025 13:30:00			0.00		0.09	0.08		0.43	0.00	0.36	0.03	0.55	0.01	
02/03/2025 13:45:00			0.00		0.09	0.08		0.43	0.00	0.36	0.01	0.56	0.01	
02/03/2025 14:00:00			0.00		0.09	0.08		0.43	0.00	0.36	0.03	0.56	0.01	
02/03/2025 14:15:00			0.01		0.09	0.08		0.44	0.00	0.37	0.02	0.57	0.01	
02/03/2025 14:30:00			0.01		0.09	0.08		0.44	0.00	0.37	0.04	0.57	0.00	
02/03/2025 14:45:00			0.01		0.09	0.08		0.44	0.00	0.37	0.02	0.57	0.01	
02/03/2025 15:00:00			0.01		0.10	0.08		0.44	0.00	0.37	0.02	0.56	0.01	
02/03/2025 15:15:00			0.01		0.10	0.08		0.44	0.00	0.37	0.03	0.53	0.01	
02/03/2025 15:30:00			0.01		0.10	0.08		0.44	0.00	0.37	0.02	0.50	0.03	
02/03/2025 15:45:00			0.01		0.10	0.08		0.44	0.00	0.37	0.02	0.48	0.06	
02/03/2025 16:00:00			0.01		0.10	0.08		0.43	0.00	0.37	0.02	0.46	0.07	
02/03/2025 16:15:00			0.01		0.10	0.08		0.43	0.00	0.37	0.02	0.44	0.07	
02/03/2025 16:30:00			0.01		0.10	0.09		0.43	0.00	0.37	0.02	0.42	0.09	
02/03/2025 16:45:00			0.01		0.10	0.09		0.43	0.00	0.37	0.02	0.41	0.09	
02/03/2025 17:00:00			0.01		0.10	0.09		0.43	0.00	0.36	0.02	0.40	0.08	
02/03/2025 17:15:00			0.01		0.10	0.09		0.43	0.00	0.36	0.02	0.38	0.09	
02/03/2025 17:30:00			0.01		0.10	0.09		0.43	0.00	0.36	0.04	0.37	0.07	
02/03/2025 17:45:00			0.01		0.10	0.09		0.44	0.00	0.36	0.03	0.36	0.07	
02/03/2025 18:00:00			0.01		0.10	0.09		0.44	0.00	0.36	0.03	0.35	0.08	
02/03/2025 18:15:00			0.01		0.10	0.09		0.44	0.00	0.35	0.04	0.34	0.08	
02/03/2025 18:30:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.34	0.07	
02/03/2025 18:45:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.33	0.08	
02/03/2025 19:00:00			0.01		0.10	0.09		0.44	0.00	0.35	0.05	0.32	0.08	
02/03/2025 19:15:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.31	0.08	
02/03/2025 19:30:00			0.01		0.10	0.09		0.44	0.00	0.35	0.05	0.31	0.08	
02/03/2025 19:45:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.32	0.07	
02/03/2025 20:00:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.37	0.07	
02/03/2025 20:15:00			0.01		0.10	0.09		0.44	0.00	0.35	0.05	0.43	0.02	
02/03/2025 20:30:00			0.01		0.10	0.09		0.44	0.00	0.35	0.05	0.44	0.00	
02/03/2025 20:45:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.45	0.01	
02/03/2025 21:00:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.46	0.01	
02/03/2025 21:15:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.47	0.00	
02/03/2025 21:30:00			0.01		0.10	0.09		0.44	0.00	0.35	0.05	0.47	0.01	
02/03/2025 21:45:00			0.01		0.10	0.09		0.44	0.00	0.35	0.05	0.48	0.02	
02/03/2025 22:00:00			0.01		0.10	0.09		0.44	0.00	0.35	0.05	0.49	0.00	
02/03/2025 22:15:00			0.01		0.10	0.09		0.44	0.00	0.35	0.07	0.49	0.00	
02/03/2025 22:30:00			0.01		0.10	0.09		0.44	0.00	0.35	0.07	0.50	0.00	
02/03/2025 22:45:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.51	0.00	
02/03/2025 23:00:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.51	0.01	
02/03/2025 23:15:00			0.01		0.10	0.09		0.44	0.00	0.35	0.06	0.52	0.01	
02/03/2025 23:30:00			0.01		0.10	0.09		0.43	0.00	0.35	0.06	0.52	0.01	
02/03/2025 23:45:00			0.02		0.10	0.09		0.43	0.00	0.35	0.05	0.53	0.01	
03/03/2025 00:00:00			0.01		0.10	0.09		0.43	0.00	0.35	0.05	0.53	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
03/03/2025 00:15:00			0.02		0.10	0.09		0.43	0.00	0.35	0.05	0.54	0.01	
03/03/2025 00:30:00			0.02		0.10	0.09		0.43	0.00	0.35	0.06	0.54	0.01	
03/03/2025 00:45:00			0.01		0.10	0.09		0.43	0.00	0.36	0.06	0.55	0.02	
03/03/2025 01:00:00			0.01		0.10	0.09		0.42	0.00	0.36	0.06	0.55	0.01	
03/03/2025 01:15:00			0.01		0.10	0.09		0.42	0.00	0.36	0.05	0.55	0.01	
03/03/2025 01:30:00			0.01		0.10	0.09		0.42	0.00	0.36	0.05	0.56	0.02	
03/03/2025 01:45:00			0.01		0.10	0.09		0.42	0.00	0.36	0.06	0.56	0.02	
03/03/2025 02:00:00			0.01		0.10	0.09		0.42	0.00	0.37	0.05	0.57	0.02	
03/03/2025 02:15:00			0.01		0.10	0.09		0.41	0.00	0.37	0.04	0.57	0.00	
03/03/2025 02:30:00			0.01		0.10	0.08		0.41	0.00	0.37	0.05	0.57	0.00	
03/03/2025 02:45:00			0.01		0.09	0.08		0.41	0.00	0.37	0.05	0.58	0.01	
03/03/2025 03:00:00			0.01		0.09	0.08		0.41	0.00	0.37	0.04	0.58	0.02	
03/03/2025 03:15:00			0.01		0.09	0.08		0.41	0.00	0.38	0.06	0.56	0.01	
03/03/2025 03:30:00			0.01		0.09	0.08		0.41	0.00	0.38	0.05	0.53	0.05	
03/03/2025 03:45:00			0.01		0.09	0.08		0.40	0.00	0.38	0.05	0.50	0.06	
03/03/2025 04:00:00			0.01		0.09	0.08		0.40	0.00	0.38	0.05	0.48	0.06	
03/03/2025 04:15:00			0.01		0.09	0.08		0.40	0.00	0.37	0.06	0.46	0.08	
03/03/2025 04:30:00			0.01		0.09	0.08		0.40	0.00	0.37	0.06	0.44	0.08	
03/03/2025 04:45:00			0.01		0.09	0.08		0.40	0.00	0.37	0.06	0.42	0.08	
03/03/2025 05:00:00			0.01		0.09	0.08		0.40	0.00	0.37	0.05	0.41	0.07	
03/03/2025 05:15:00			0.01		0.09	0.08		0.40	0.00	0.36	0.05	0.39	0.08	
03/03/2025 05:30:00			0.01		0.09	0.08		0.40	0.00	0.36	0.05	0.38	0.09	
03/03/2025 05:45:00			0.01		0.09	0.08		0.40	0.00	0.36	0.06	0.37	0.10	
03/03/2025 06:00:00			0.01		0.09	0.08		0.40	0.00	0.36	0.05	0.36	0.08	
03/03/2025 06:15:00			0.01		0.09	0.08		0.40	0.00	0.36	0.05	0.35	0.08	
03/03/2025 06:30:00			0.01		0.09	0.08		0.40	0.00	0.35	0.06	0.34	0.08	
03/03/2025 06:45:00			0.01		0.09	0.08		0.40	0.00	0.35	0.06	0.34	0.08	
03/03/2025 07:00:00			0.00		0.09	0.08		0.40	0.00	0.35	0.07	0.33	0.07	
03/03/2025 07:15:00			0.00		0.09	0.08		0.40	0.00	0.35	0.07	0.32	0.08	
03/03/2025 07:30:00			0.00		0.08	0.08		0.40	0.00	0.35	0.08	0.31	0.08	
03/03/2025 07:45:00			0.00		0.08	0.07		0.40	0.00	0.35	0.08	0.31	0.09	
03/03/2025 08:00:00			0.00		0.08	0.07		0.40	0.00	0.35	0.07	0.30	0.09	
03/03/2025 08:15:00			0.00		0.08	0.07		0.40	0.00	0.35	0.07	0.29	0.08	
03/03/2025 08:30:00			0.00		0.08	0.07		0.40	0.00	0.35	0.07	0.29	0.09	
03/03/2025 08:45:00			0.00		0.08	0.07		0.41	0.00	0.35	0.07	0.28	0.07	
03/03/2025 09:00:00			0.00		0.08	0.07		0.41	0.00	0.35	0.08	0.28	0.07	
03/03/2025 09:15:00			0.00		0.09	0.07		0.41	0.00	0.35	0.05	0.29	0.05	
03/03/2025 09:30:00			0.00		0.08	0.07		0.41	0.00	0.35	0.05	0.33	0.06	
03/03/2025 09:45:00			0.00		0.09	0.07		0.42	0.00	0.35	0.05	0.38	0.03	
03/03/2025 10:00:00			0.00		0.09	0.07		0.42	0.00	0.35	0.06	0.42	0.01	
03/03/2025 10:15:00			0.00		0.09	0.07		0.43	0.00	0.35	0.05	0.42	0.01	
03/03/2025 10:30:00			0.00		0.09	0.07		0.43	0.00	0.35	0.06	0.43	0.00	
03/03/2025 10:45:00			0.00		0.09	0.07		0.43	0.00	0.35	0.05	0.44	0.00	
03/03/2025 11:00:00			0.00		0.09	0.07		0.43	0.00	0.35	0.07	0.45	0.00	
03/03/2025 11:15:00			0.00		0.09	0.08		0.43	0.00	0.35	0.06	0.46	0.01	
03/03/2025 11:30:00			-0.01		0.09	0.08		0.43	0.00	0.35	0.07	0.46	0.01	
03/03/2025 11:45:00			-0.01		0.09	0.08		0.43	0.00	0.35	0.05	0.47	0.01	
03/03/2025 12:00:00			-0.01		0.09	0.08		0.42	0.00	0.35	0.05	0.48	0.01	
03/03/2025 12:15:00			-0.01		0.09	0.08		0.42	0.00	0.35	0.03	0.48	0.01	
03/03/2025 12:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.03	0.49	0.01	
03/03/2025 12:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.03	0.49	0.01	
03/03/2025 13:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.03	0.50	0.02	
03/03/2025 13:15:00			0.00		0.09	0.08		0.42	0.00	0.35	0.03	0.50	0.02	
03/03/2025 13:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.05	0.51	0.01	
03/03/2025 13:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.03	0.51	0.01	
03/03/2025 14:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.02	0.52	0.02	
03/03/2025 14:15:00			0.00		0.09	0.08		0.41	0.00	0.35	0.03	0.52	0.02	
03/03/2025 14:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.03	0.53	0.02	
03/03/2025 14:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.02	0.53	0.02	
03/03/2025 15:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.02	0.53	0.02	
03/03/2025 15:15:00			0.00		0.09	0.08		0.42	0.00	0.35	0.02	0.54	0.02	
03/03/2025 15:30:00			0.00		0.09	0.08		0.42	0.00	0.36	0.02	0.54	0.01	
03/03/2025 15:45:00			0.00		0.09	0.08		0.42	0.00	0.36	0.02	0.54	0.00	
03/03/2025 16:00:00			0.01		0.09	0.08		0.41	0.00	0.36	0.02	0.52	0.01	
03/03/2025 16:15:00			0.00		0.09	0.08		0.41	0.00	0.36	0.02	0.49	0.04	
03/03/2025 16:30:00			0.00		0.09	0.08		0.41	0.00	0.36	0.02	0.47	0.04	
03/03/2025 16:45:00			0.00		0.09	0.08		0.41	0.00	0.36	0.04	0.45	0.07	
03/03/2025 17:00:00			0.00		0.09	0.08		0.41	0.00	0.36	0.03	0.42	0.07	
03/03/2025 17:15:00			0.00		0.09	0.08		0.41	0.00	0.36	0.03	0.41	0.07	
03/03/2025 17:30:00			0.00		0.09	0.08		0.41	0.00	0.36	0.05	0.39	0.08	
03/03/2025 17:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.05	0.37	0.07	
03/03/2025 18:00:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.36	0.07	
03/03/2025 18:15:00			0.00		0.09	0.07		0.41	0.00	0.35	0.05	0.35	0.08	
03/03/2025 18:30:00			0.00		0.09	0.07		0.41	0.00	0.35	0.06	0.34	0.07	
03/03/2025 18:45:00			0.00		0.09	0.07		0.41	0.00	0.35	0.07	0.33	0.07	
03/03/2025 19:00:00			0.00		0.09	0.07		0.41	0.00	0.35	0.07	0.32	0.07	
03/03/2025 19:15:00			0.00		0.09	0.07		0.41	0.00	0.35	0.05	0.31	0.07	
03/03/2025 19:30:00			0.00		0.09	0.07		0.41	0.00	0.35	0.04	0.30	0.08	
03/03/2025 19:45:00			0.00		0.09	0.07		0.41	0.00	0.35	0.06	0.29	0.07	
03/03/2025 20:00:00			0.00		0.09	0.07		0.41	0.00	0.35	0.06	0.28	0.08	
03/03/2025 20:15:00			0.00		0.09	0.07		0.42	0.00	0.35	0.05	0.29	0.06	
03/03/2025 20:30:00			0.00		0.09	0.07		0.42	0.00	0.35	0.07	0.36	0.05	
03/03/2025 20:45:00			0.00		0.09	0.07		0.42	0.00	0.35	0.07	0.41	0.01	
03/03/2025 21:00:00			0.00		0.09	0.07		0.42	0.00	0.35	0.04	0.41	0.01	
03/03/2025 21:15:00			0.00		0.09	0.07		0.42	0.00	0.35	0.05	0.42	0.00	
03/03/2025 21:30:00			0.00		0.09	0.07		0.42	0.00	0.35	0.06	0.43	0.01	
03/03/2025 21:45:00			0.00		0.09	0.07		0.42	0.00	0.35	0.06	0.44	0.01	
03/03/2025 22:00:00			0.00		0.09	0.07		0.42	0.00	0.35	0.07	0.45	0.01	
03/03/2025 22:15:00			0.00		0.09	0.07		0.42	0.00	0.35	0.07	0.45	0.01	
03/03/2025 22:30:00			0.00		0.09	0.07		0.42	0.00	0.35	0.04	0.46	0.01	
03/03/2025 22:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.04	0.47	0.01	
03/03/2025 23:00:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.47	0.01	
03/03/2025 23:15:00			0.00		0.09	0.08		0.41	0.00	0.35	0.04	0.48	0.01	
03/03/2025 23:30:00			0.00		0.09	0.08		0.41	0.00	0.35	0.04	0.48	0.00	
03/03/2025 23:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.04	0.49	0.00	
04/03/2025 00:00:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.49	0.01	
04/03/2025 00:15:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.50	0.00	
04/03/2025 00:30:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.50	0.01	
04/03/2025 00:45:00			0.00		0.09	0.07		0.40	0.00	0.35	0.06	0.51	0.00	
04/03/2025 01:00:00			0.00		0.09	0.07		0.40	0.00	0.35	0.06	0.51	0.00	
04/03/2025 01:15:00			0.00		0.09	0.07		0.40	0.00	0.35	0.04	0.52	0.01	
04/03/2025 01:30:00			0.00		0.09	0.07		0.40	0.00	0.35	0.06	0.52	0.01	
04/03/2025 01:45:00			0.00		0.09	0.07		0.40	0.00	0.35	0.05	0.52	0.01	
04/03/2025 02:00:00			0.00		0.09	0.07		0.40	0.00	0.35	0.05	0.53	0.01	
04/03/2025 02:15:00			0.00		0.08	0.07		0.39	0.00	0.35	0.05	0.53	0.01	
04/03/2025 02:30:00			0.00		0.08	0.07		0.39	0.00	0.35	0.05	0.53	0.01	
04/03/2025 02:45:00			0.00		0.08	0.07		0.39	0.00	0.35	0.06	0.54	0.01	
04/03/2025 03:00:00			0.00		0.08	0.07		0.39	0.00	0.36	0.05	0.54	0.01	
04/03/2025 03:15:00			0.00		0.08	0.07		0.39	0.00	0.36	0.05	0.54	0.02	
04/03/2025 03:30:00			0.00		0.08	0.07		0.39	0.00	0.36	0.05	0.55	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
04/03/2025 03:45:00			0.00		0.08	0.07		0.39	0.00	0.36	0.07	0.55	0.01	
04/03/2025 04:00:00			0.00		0.08	0.07		0.38	0.00	0.36	0.07	0.55	0.02	
04/03/2025 04:15:00			0.00		0.08	0.07		0.38	0.00	0.36	0.06	0.52	0.03	
04/03/2025 04:30:00			0.00		0.08	0.07		0.38	0.00	0.36	0.05	0.49	0.05	
04/03/2025 04:45:00			0.00		0.08	0.07		0.39	0.00	0.36	0.04	0.47	0.05	
04/03/2025 05:00:00			0.00		0.08	0.07		0.39	0.00	0.36	0.06	0.44	0.08	
04/03/2025 05:15:00			0.00		0.08	0.07		0.39	0.00	0.36	0.06	0.42	0.07	
04/03/2025 05:30:00			0.00		0.08	0.07		0.39	0.00	0.36	0.05	0.41	0.09	
04/03/2025 05:45:00			0.00		0.08	0.07		0.39	0.00	0.36	0.05	0.39	0.09	
04/03/2025 06:00:00			0.00		0.08	0.07		0.39	0.00	0.36	0.06	0.38	0.08	
04/03/2025 06:15:00			-0.01		0.08	0.07		0.38	0.00	0.36	0.06	0.36	0.08	
04/03/2025 06:30:00			0.00		0.08	0.07		0.38	0.00	0.35	0.06	0.35	0.08	
04/03/2025 06:45:00			0.00		0.08	0.07		0.38	0.00	0.35	0.07	0.34	0.08	
04/03/2025 07:00:00			-0.01		0.08	0.07		0.38	0.00	0.35	0.07	0.33	0.07	
04/03/2025 07:15:00			-0.01		0.08	0.07		0.38	0.00	0.35	0.07	0.32	0.07	
04/03/2025 07:30:00			-0.01		0.08	0.07		0.38	0.00	0.35	0.07	0.31	0.08	
04/03/2025 07:45:00			-0.01		0.08	0.07		0.38	0.00	0.35	0.06	0.31	0.07	
04/03/2025 08:00:00			-0.01		0.08	0.07		0.39	0.00	0.35	0.04	0.30	0.07	
04/03/2025 08:15:00			-0.01		0.08	0.07		0.39	0.00	0.35	0.04	0.29	0.08	
04/03/2025 08:30:00			-0.01		0.08	0.07		0.39	0.00	0.35	0.05	0.28	0.08	
04/03/2025 08:45:00			-0.01		0.08	0.07		0.39	0.00	0.35	0.06	0.27	0.08	
04/03/2025 09:00:00			-0.01		0.08	0.07		0.39	0.00	0.35	0.06	0.27	0.06	
04/03/2025 09:15:00			-0.01		0.08	0.07		0.40	0.00	0.35	0.05	0.26	0.05	
04/03/2025 09:30:00			-0.01		0.08	0.07		0.40	0.00	0.35	0.04	0.25	0.06	
04/03/2025 09:45:00			-0.01		0.08	0.07		0.40	0.00	0.35	0.04	0.25	0.06	
04/03/2025 10:00:00			-0.01		0.08	0.07		0.41	0.00	0.35	0.04	0.26	0.05	
04/03/2025 10:15:00			-0.01		0.08	0.07		0.41	0.00	0.35	0.05	0.28	0.03	
04/03/2025 10:30:00			-0.01		0.08	0.07		0.41	0.00	0.34	0.05	0.34	0.03	
04/03/2025 10:45:00			-0.01		0.08	0.07		0.41	0.00	0.34	0.08	0.38	0.03	
04/03/2025 11:00:00			-0.01		0.08	0.07		0.41	0.00	0.34	0.06	0.39	0.01	
04/03/2025 11:15:00			-0.01		0.08	0.07		0.41	0.00	0.34	0.07	0.40	0.00	
04/03/2025 11:30:00			-0.01		0.08	0.07		0.41	0.00	0.34	0.07	0.40	0.00	
04/03/2025 11:45:00			-0.01		0.08	0.07		0.41	0.00	0.34	0.06	0.41	0.01	
04/03/2025 12:00:00			-0.01		0.08	0.07		0.41	0.00	0.34	0.05	0.42	0.01	
04/03/2025 12:15:00			-0.01		0.08	0.07		0.41	0.00	0.34	0.05	0.43	0.01	
04/03/2025 12:30:00			-0.01		0.08	0.07		0.41	0.00	0.35	0.07	0.43	0.01	
04/03/2025 12:45:00			-0.01		0.08	0.07		0.41	0.00	0.35	0.07	0.44	0.01	
04/03/2025 13:00:00			0.00		0.09	0.07		0.41	0.00	0.35	0.02	0.44	0.01	
04/03/2025 13:15:00			0.00		0.09	0.07		0.41	0.00	0.35	0.02	0.45	0.01	
04/03/2025 13:30:00			-0.01		0.09	0.07		0.41	0.00	0.35	0.02	0.45	0.01	
04/03/2025 13:45:00			0.00		0.09	0.07		0.41	0.00	0.35	0.02	0.45	0.01	
04/03/2025 14:00:00			0.00		0.09	0.07		0.41	0.00	0.35	0.05	0.46	0.01	
04/03/2025 14:15:00			0.00		0.09	0.07		0.41	0.00	0.35	0.02	0.46	0.01	
04/03/2025 14:30:00			0.00		0.09	0.08		0.41	0.00	0.35	0.02	0.47	0.01	
04/03/2025 14:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.02	0.47	0.01	
04/03/2025 15:00:00			0.00		0.09	0.08		0.41	0.00	0.35	0.02	0.48	0.01	
04/03/2025 15:15:00			0.00		0.09	0.08		0.41	0.00	0.35	0.02	0.48	0.01	
04/03/2025 15:30:00			0.00		0.09	0.08		0.41	0.00	0.35	0.02	0.48	0.01	
04/03/2025 15:45:00			0.00		0.09	0.08		0.39	0.00	0.35	0.02	0.49	0.01	
04/03/2025 16:00:00			0.00		0.09	0.08		0.40	0.00	0.35	0.02	0.49	0.01	
04/03/2025 16:15:00			0.00		0.09	0.08		0.40	0.00	0.35	0.05	0.49	0.00	
04/03/2025 16:30:00			0.00		0.09	0.08		0.40	0.00	0.35	0.04	0.46	0.02	
04/03/2025 16:45:00			0.00		0.09	0.08		0.40	0.00	0.35	0.04	0.43	0.06	
04/03/2025 17:00:00			0.00		0.09	0.08		0.40	0.00	0.35	0.04	0.41	0.05	
04/03/2025 17:15:00			0.00		0.09	0.08		0.41	0.00	0.35	0.04	0.38	0.05	
04/03/2025 17:30:00			0.00		0.09	0.08		0.41	0.00	0.35	0.04	0.36	0.03	
04/03/2025 17:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.05	0.35	0.04	
04/03/2025 18:00:00			0.00		0.09	0.08		0.41	0.00	0.35	0.04	0.33	0.06	
04/03/2025 18:15:00			0.00		0.09	0.08		0.41	0.00	0.35	0.05	0.32	0.07	
04/03/2025 18:30:00			0.00		0.09	0.08		0.41	0.00	0.35	0.05	0.31	0.07	
04/03/2025 18:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.05	0.29	0.08	
04/03/2025 19:00:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.28	0.08	
04/03/2025 19:15:00			0.00		0.09	0.08		0.41	0.00	0.35	0.05	0.27	0.08	
04/03/2025 19:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.05	0.26	0.08	
04/03/2025 19:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.26	0.07	
04/03/2025 20:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.25	0.07	
04/03/2025 20:15:00			0.00		0.09	0.08		0.42	0.00	0.35	0.05	0.24	0.07	
04/03/2025 20:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.23	0.06	
04/03/2025 20:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.05	0.22	0.06	
04/03/2025 21:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.04	0.22	0.07	
04/03/2025 21:15:00			0.00		0.09	0.08		0.42	0.00	0.35	0.05	0.24	0.07	
04/03/2025 21:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.05	0.29	0.02	
04/03/2025 21:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.05	0.34	0.01	
04/03/2025 22:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.36	0.00	
04/03/2025 22:15:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.36	0.01	
04/03/2025 22:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.05	0.37	0.00	
04/03/2025 22:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.04	0.38	0.00	
04/03/2025 23:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.04	0.38	0.00	
04/03/2025 23:15:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.39	0.00	
04/03/2025 23:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.05	0.39	0.00	
04/03/2025 23:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.05	0.40	0.00	
05/03/2025 00:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.04	0.41	0.00	
05/03/2025 00:15:00			0.00		0.09	0.08		0.42	0.00	0.35	0.04	0.41	0.00	
05/03/2025 00:30:00			0.00		0.09	0.08		0.41	0.00	0.35	0.04	0.42	0.00	
05/03/2025 00:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.42	0.00	
05/03/2025 01:00:00			0.00		0.09	0.08		0.41	0.00	0.35	0.05	0.43	0.01	
05/03/2025 01:15:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.43	0.00	
05/03/2025 01:30:00			0.00		0.09	0.08		0.41	0.00	0.35	0.07	0.43	0.01	
05/03/2025 01:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.07	0.44	0.01	
05/03/2025 02:00:00			0.00		0.09	0.08		0.40	0.00	0.35	0.06	0.44	0.01	
05/03/2025 02:15:00			0.00		0.09	0.08		0.40	0.00	0.35	0.05	0.45	0.00	
05/03/2025 02:30:00			0.00		0.09	0.08		0.40	0.00	0.35	0.05	0.45	0.00	
05/03/2025 02:45:00			0.00		0.09	0.08		0.40	0.00	0.35	0.05	0.45	0.01	
05/03/2025 03:00:00			0.01		0.09	0.08		0.40	0.00	0.35	0.06	0.46	0.01	
05/03/2025 03:15:00			0.00		0.09	0.08		0.40	0.00	0.35	0.06	0.46	0.01	
05/03/2025 03:30:00			0.00		0.09	0.08		0.40	0.00	0.35	0.04	0.46	0.00	
05/03/2025 03:45:00			0.00		0.09	0.08		0.40	0.00	0.35	0.04	0.47	0.00	
05/03/2025 04:00:00			0.00		0.09	0.08		0.40	0.00	0.35	0.06	0.47	0.01	
05/03/2025 04:15:00			0.00		0.09	0.08		0.40	0.00	0.35	0.05	0.47	0.00	
05/03/2025 04:30:00			0.00		0.09	0.08		0.40	0.00	0.35	0.06	0.48	0.00	
05/03/2025 04:45:00			0.00		0.09	0.08		0.40	0.00	0.35	0.06	0.48	0.01	
05/03/2025 05:00:00			0.00		0.09	0.08		0.40	0.00	0.35	0.05	0.47	0.01	
05/03/2025 05:15:00			0.00		0.09	0.08		0.40	0.00	0.35	0.06	0.45	0.05	
05/03/2025 05:30:00			0.00		0.09	0.08		0.40	0.00	0.35	0.06	0.42	0.03	
05/03/2025 05:45:00			0.00		0.09	0.08		0.40	0.00	0.35	0.06	0.40	0.05	
05/03/2025 06:00:00			0.00		0.09	0.08		0.39	0.00	0.35	0.06	0.37	0.06	
05/03/2025 06:15:00			0.00		0.09	0.08		0.39	0.00	0.35	0.06	0.35	0.06	
05/03/2025 06:30:00			0.00		0.08	0.08		0.39	0.00	0.35	0.05	0.33	0.07	
05/03/2025 06:45:00			0.00		0.08	0.08		0.39	0.00	0.35	0.04	0.32	0.07	
05/03/2025 07:00:00			0.00		0.08	0.08		0.39	0.00	0.35	0.04	0.30	0.07	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
05/03/2025 07:15:00			0.00		0.08	0.08		0.39	0.00	0.35	0.04	0.29	0.07	
05/03/2025 07:30:00			0.00		0.08	0.08		0.39	0.00	0.35	0.04	0.28	0.05	
05/03/2025 07:45:00			0.00		0.08	0.08		0.39	0.00	0.35	0.04	0.27	0.05	
05/03/2025 08:00:00			0.00		0.08	0.08		0.40	0.00	0.35	0.05	0.25	0.07	
05/03/2025 08:15:00			0.00		0.08	0.08		0.40	0.00	0.35	0.07	0.24	0.05	
05/03/2025 08:30:00			0.00		0.08	0.07		0.40	0.00	0.35	0.06	0.23	0.06	
05/03/2025 08:45:00			0.00		0.08	0.07		0.40	0.00	0.35	0.05	0.22	0.06	
05/03/2025 09:00:00			0.00		0.08	0.08		0.40	0.00	0.35	0.05	0.22	0.06	
05/03/2025 09:15:00			0.00		0.08	0.08		0.41	0.00	0.35	0.05	0.21	0.03	
05/03/2025 09:30:00			0.00		0.08	0.08		0.41	0.00	0.35	0.05	0.20	0.06	
05/03/2025 09:45:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.19	0.05	
05/03/2025 10:00:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.19	0.05	
05/03/2025 10:15:00			0.00		0.09	0.08		0.41	0.00	0.35	0.06	0.19	0.06	
05/03/2025 10:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.21	0.03	
05/03/2025 10:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.26	0.03	
05/03/2025 11:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.30	0.03	
05/03/2025 11:15:00			0.00		0.09	0.08		0.42	0.00	0.35	0.07	0.34	0.01	
05/03/2025 11:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.07	0.34	0.02	
05/03/2025 11:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.34	0.00	
05/03/2025 12:00:00			0.00		0.09	0.08		0.43	0.00	0.35	0.08	0.35	0.00	
05/03/2025 12:15:00			0.00		0.09	0.08		0.43	0.00	0.35	0.08	0.36	0.00	
05/03/2025 12:30:00			0.00		0.09	0.08		0.43	0.00	0.35	0.08	0.36	0.00	
05/03/2025 12:45:00			0.00		0.09	0.08		0.43	0.00	0.35	0.08	0.37	0.01	
05/03/2025 13:00:00			0.00		0.09	0.08		0.43	0.00	0.35	0.08	0.38	0.00	
05/03/2025 13:15:00			0.00		0.09	0.08		0.43	0.00	0.35	0.07	0.38	0.00	
05/03/2025 13:30:00			0.00		0.09	0.08		0.43	0.00	0.35	0.07	0.39	0.01	
05/03/2025 13:45:00			0.00		0.09	0.08		0.42	0.00	0.35	0.07	0.39	0.01	
05/03/2025 14:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.07	0.40	0.01	
05/03/2025 14:15:00			0.00		0.09	0.08		0.42	0.00	0.35	0.07	0.40	0.01	
05/03/2025 14:30:00			0.00		0.09	0.08		0.42	0.00	0.35	0.07	0.41	0.01	
05/03/2025 14:45:00			0.01		0.09	0.08		0.42	0.00	0.35	0.06	0.41	0.01	
05/03/2025 15:00:00			0.00		0.09	0.08		0.42	0.00	0.35	0.06	0.42	0.01	
05/03/2025 15:15:00			0.01		0.09	0.08		0.42	0.00	0.35	0.05	0.42	0.00	
05/03/2025 15:30:00			0.01		0.09	0.08		0.42	0.00	0.35	0.05	0.43	0.01	
05/03/2025 15:45:00			0.01		0.10	0.08		0.42	0.00	0.35	0.04	0.43	0.01	
05/03/2025 16:00:00			0.01		0.10	0.09		0.42	0.00	0.35	0.05	0.43	0.00	
05/03/2025 16:15:00			0.01		0.10	0.09		0.42	0.00	0.35	0.05	0.44	0.00	
05/03/2025 16:30:00			0.01		0.10	0.09		0.42	0.00	0.35	0.04	0.44	0.04	
05/03/2025 16:45:00			0.01		0.10	0.09		0.42	0.00	0.35	0.04	0.44	0.01	
05/03/2025 17:00:00			0.01		0.10	0.09		0.42	0.00	0.36	0.04	0.45	0.01	
05/03/2025 17:15:00			0.01		0.10	0.09		0.42	0.00	0.36	0.03	0.43	0.01	
05/03/2025 17:30:00			0.01		0.09	0.09		0.42	0.00	0.36	0.06	0.40	0.01	
05/03/2025 17:45:00			0.01		0.09	0.09		0.42	0.00	0.36	0.05	0.38	0.04	
05/03/2025 18:00:00			0.01		0.09	0.08		0.42	0.00	0.36	0.05	0.36	0.05	
05/03/2025 18:15:00			0.01		0.09	0.09		0.42	0.00	0.36	0.07	0.34	0.06	
05/03/2025 18:30:00			0.00		0.09	0.09		0.42	0.00	0.36	0.06	0.32	0.06	
05/03/2025 18:45:00			0.00		0.09	0.09		0.43	0.00	0.36	0.06	0.30	0.06	
05/03/2025 19:00:00			0.01		0.09	0.09		0.43	0.00	0.36	0.08	0.28	0.06	
05/03/2025 19:15:00			0.00		0.09	0.09		0.43	0.00	0.36	0.08	0.27	0.06	
05/03/2025 19:30:00			0.00		0.09	0.09		0.43	0.00	0.36	0.06	0.26	0.07	
05/03/2025 19:45:00			0.00		0.09	0.09		0.43	0.00	0.36	0.06	0.24	0.07	
05/03/2025 20:00:00			0.00		0.09	0.09		0.43	0.00	0.36	0.05	0.23	0.06	
05/03/2025 20:15:00			0.01		0.10	0.09		0.43	0.00	0.36	0.05	0.22	0.06	
05/03/2025 20:30:00			0.01		0.10	0.09		0.44	0.00	0.36	0.06	0.21	0.07	
05/03/2025 20:45:00			0.01		0.10	0.09		0.44	0.00	0.36	0.05	0.20	0.06	
05/03/2025 21:00:00			0.01		0.10	0.09		0.44	0.00	0.36	0.04	0.19	0.06	
05/03/2025 21:15:00			0.01		0.10	0.09		0.44	0.00	0.36	0.06	0.19	0.06	
05/03/2025 21:30:00			0.01		0.10	0.09		0.44	0.00	0.36	0.06	0.18	0.06	
05/03/2025 21:45:00			0.01		0.10	0.09		0.44	0.00	0.36	0.06	0.20	0.06	
05/03/2025 22:00:00			0.01		0.10	0.09		0.44	0.00	0.36	0.05	0.26	0.03	
05/03/2025 22:15:00			0.01		0.10	0.09		0.44	0.00	0.36	0.05	0.31	0.00	
05/03/2025 22:30:00			0.01		0.10	0.09		0.44	0.00	0.36	0.05	0.32	0.00	
05/03/2025 22:45:00			0.01		0.10	0.09		0.44	0.00	0.36	0.05	0.33	0.00	
05/03/2025 23:00:00			0.01		0.10	0.09		0.43	0.00	0.36	0.05	0.34	0.00	
05/03/2025 23:15:00			0.01		0.10	0.09		0.43	0.00	0.36	0.05	0.34	0.00	
05/03/2025 23:30:00			0.01		0.10	0.09		0.43	0.00	0.36	0.05	0.35	0.00	
05/03/2025 23:45:00			0.01		0.10	0.09		0.43	0.00	0.36	0.06	0.36	0.00	
06/03/2025 00:00:00			0.01		0.10	0.09		0.43	0.00	0.36	0.07	0.36	0.00	
06/03/2025 00:15:00			0.01		0.10	0.09		0.43	0.00	0.36	0.06	0.37	0.00	
06/03/2025 00:30:00			0.01		0.10	0.09		0.43	0.00	0.36	0.08	0.37	0.00	
06/03/2025 00:45:00			0.01		0.10	0.09		0.43	0.00	0.36	0.06	0.38	0.02	
06/03/2025 01:00:00			0.01		0.10	0.09		0.42	0.00	0.36	0.06	0.38	0.02	
06/03/2025 01:15:00			0.01		0.10	0.09		0.42	0.00	0.36	0.08	0.39	0.00	
06/03/2025 01:30:00			0.01		0.10	0.09		0.42	0.00	0.36	0.07	0.39	0.00	
06/03/2025 01:45:00			0.01		0.10	0.09		0.41	0.00	0.36	0.06	0.40	0.01	
06/03/2025 02:00:00			0.01		0.10	0.09		0.41	0.00	0.36	0.06	0.40	0.01	
06/03/2025 02:15:00			0.01		0.10	0.09		0.41	0.00	0.36	0.06	0.41	0.00	
06/03/2025 02:30:00			0.01		0.10	0.09		0.41	0.00	0.36	0.07	0.41	0.00	
06/03/2025 02:45:00			0.01		0.10	0.09		0.39	0.00	0.36	0.06	0.41	0.01	
06/03/2025 03:00:00			0.01		0.10	0.09		0.40	0.00	0.36	0.07	0.42	0.01	
06/03/2025 03:15:00			0.01		0.09	0.09		0.41	0.00	0.36	0.07	0.42	0.01	
06/03/2025 03:30:00			0.01		0.09	0.09		0.41	0.00	0.36	0.07	0.43	0.00	
06/03/2025 03:45:00			0.01		0.09	0.09		0.40	0.00	0.36	0.07	0.43	0.01	
06/03/2025 04:00:00			0.01		0.09	0.09		0.40	0.00	0.36	0.06	0.43	0.01	
06/03/2025 04:15:00			0.01		0.09	0.09		0.40	0.00	0.37	0.06	0.44	0.00	
06/03/2025 04:30:00			0.01		0.09	0.09		0.40	0.00	0.37	0.06	0.44	0.00	
06/03/2025 04:45:00			0.01		0.09	0.09		0.40	0.00	0.37	0.08	0.44	0.01	
06/03/2025 05:00:00			0.01		0.09	0.08		0.40	0.00	0.37	0.08	0.45	0.01	
06/03/2025 05:15:00			0.00		0.09	0.08		0.40	0.00	0.37	0.07	0.45	0.01	
06/03/2025 05:30:00			0.00		0.09	0.08		0.40	0.00	0.37	0.07	0.45	0.00	
06/03/2025 05:45:00			0.00		0.09	0.08		0.40	0.00	0.37	0.07	0.46	0.00	
06/03/2025 06:00:00			0.00		0.09	0.08		0.40	0.00	0.37	0.07	0.46	0.01	
06/03/2025 06:15:00			0.00		0.09	0.08		0.40	0.00	0.37	0.08	0.46	0.01	
06/03/2025 06:30:00			0.00		0.09	0.08		0.40	0.00	0.37	0.07	0.45	0.01	
06/03/2025 06:45:00			0.00		0.09	0.08		0.40	0.00	0.37	0.07	0.43	0.03	
06/03/2025 07:00:00			0.00		0.09	0.08		0.40	0.00	0.37	0.08	0.41	0.03	
06/03/2025 07:15:00			0.00		0.09	0.08		0.40	0.00	0.37	0.07	0.38	0.06	
06/03/2025 07:30:00			0.00		0.09	0.08		0.40	0.00	0.37	0.07	0.36	0.06	
06/03/2025 07:45:00			0.00		0.09	0.08		0.40	0.00	0.37	0.07	0.34	0.08	
06/03/2025 08:00:00			0.00		0.09	0.08		0.40	0.00	0.37	0.08	0.32	0.06	
06/03/2025 08:15:00			0.00		0.09	0.08		0.40	0.00	0.37	0.09	0.31	0.06	
06/03/2025 08:30:00			0.00		0.09	0.08		0.41	0.00	0.37	0.09	0.29	0.07	
06/03/2025 08:45:00			0.00		0.09	0.08		0.41	0.00	0.37	0.09	0.28	0.08	
06/03/2025 09:00:00			0.00		0.09	0.08		0.41	0.00	0.37	0.07	0.27	0.08	
06/03/2025 09:15:00			0.00		0.09	0.08		0.42	0.00	0.37	0.07	0.25	0.06	
06/03/2025 09:30:00			0.00		0.09	0.08		0.42	0.00	0.37	0.08	0.24	0.07	
06/03/2025 09:45:00			0.00		0.09	0.08		0.42	0.00	0.37	0.07	0.24	0.07	
06/03/2025 10:00:00			0.00		0.09	0.08		0.42	0.00	0.37	0.08	0.24	0.06	
06/03/2025 10:15:00			0.00		0.09	0.08		0.43	0.00	0.37	0.07	0.26	0.05	
06/03/2025 10:30:00			0.00		0.09	0.08		0.43	0.00	0.37	0.07	0.31	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
06/03/2025 10:45:00			0.00		0.09	0.08		0.43	0.00	0.37	0.07	0.35	0.00	
06/03/2025 11:00:00			0.00		0.09	0.08		0.43	0.00	0.37	0.07	0.36	0.00	
06/03/2025 11:15:00			0.00		0.09	0.08		0.43	0.00	0.37	0.07	0.37	0.00	
06/03/2025 11:30:00			0.00		0.09	0.08		0.43	0.00	0.37	0.07	0.37	0.00	
06/03/2025 11:45:00			0.00		0.09	0.08		0.43	0.00	0.37	0.07	0.38	0.00	
06/03/2025 12:00:00			0.00		0.10	0.09		0.43	0.00	0.37	0.08	0.39	0.00	
06/03/2025 12:15:00			0.00		0.10	0.09		0.43	0.00	0.37	0.07	0.39	0.01	
06/03/2025 12:30:00			0.00		0.10	0.09		0.43	0.00	0.37	0.06	0.40	0.01	
06/03/2025 12:45:00			0.00		0.10	0.09		0.43	0.00	0.37	0.06	0.40	0.01	
06/03/2025 13:00:00			0.00		0.10	0.09		0.44	0.00	0.37	0.06	0.41	0.01	
06/03/2025 13:15:00			0.00		0.10	0.09		0.43	0.00	0.37	0.06	0.41	0.01	
06/03/2025 13:30:00			0.01		0.10	0.09		0.44	0.00	0.37	0.06	0.42	0.01	
06/03/2025 13:45:00			0.01		0.10	0.09		0.44	0.00	0.37	0.05	0.42	0.01	
06/03/2025 14:00:00			0.01		0.10	0.09		0.44	0.00	0.37	0.05	0.43	0.01	
06/03/2025 14:15:00			0.01		0.10	0.09		0.44	0.00	0.37	0.05	0.43	0.01	
06/03/2025 14:30:00			0.01		0.10	0.09		0.44	0.00	0.37	0.05	0.44	0.01	
06/03/2025 14:45:00			0.01		0.10	0.09		0.44	0.00	0.37	0.04	0.44	0.01	
06/03/2025 15:00:00			0.01		0.10	0.09		0.44	0.00	0.38	0.03	0.45	0.02	
06/03/2025 15:15:00			0.01		0.10	0.09		0.44	0.00	0.38	0.05	0.45	0.01	
06/03/2025 15:30:00			0.01		0.10	0.09		0.44	0.00	0.38	0.03	0.45	0.02	
06/03/2025 15:45:00			0.01		0.10	0.09		0.44	0.00	0.38	0.03	0.46	0.02	
06/03/2025 16:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.03	0.46	0.01	
06/03/2025 16:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.04	0.47	0.01	
06/03/2025 16:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.47	0.01	
06/03/2025 16:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.06	0.48	0.01	
06/03/2025 17:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.06	0.48	0.01	
06/03/2025 17:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.49	0.02	
06/03/2025 17:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.49	0.02	
06/03/2025 17:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.49	0.02	
06/03/2025 18:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.50	0.02	
06/03/2025 18:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.48	0.02	
06/03/2025 18:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.45	0.04	
06/03/2025 18:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.09	0.43	0.06	
06/03/2025 19:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.09	0.41	0.05	
06/03/2025 19:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.08	0.39	0.08	
06/03/2025 19:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.08	0.37	0.08	
06/03/2025 19:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.08	0.35	0.09	
06/03/2025 20:00:00			0.01		0.10	0.09		0.44	0.00	0.38	0.07	0.33	0.08	
06/03/2025 20:15:00			0.01		0.10	0.09		0.44	0.00	0.38	0.06	0.32	0.08	
06/03/2025 20:30:00			0.01		0.10	0.09		0.44	0.00	0.38	0.06	0.31	0.07	
06/03/2025 20:45:00			0.01		0.10	0.09		0.44	0.00	0.38	0.06	0.29	0.08	
06/03/2025 21:00:00			0.01		0.10	0.09		0.44	0.00	0.38	0.06	0.28	0.08	
06/03/2025 21:15:00			0.01		0.10	0.09		0.44	0.00	0.38	0.07	0.27	0.07	
06/03/2025 21:30:00			0.01		0.10	0.09		0.44	0.00	0.38	0.07	0.26	0.07	
06/03/2025 21:45:00			0.01		0.11	0.09		0.44	0.00	0.38	0.07	0.25	0.06	
06/03/2025 22:00:00			0.01		0.11	0.09		0.44	0.00	0.38	0.07	0.24	0.05	
06/03/2025 22:15:00			0.01		0.10	0.09		0.44	0.00	0.38	0.07	0.23	0.06	
06/03/2025 22:30:00			0.01		0.10	0.09		0.44	0.00	0.38	0.08	0.23	0.06	
06/03/2025 22:45:00			0.01		0.11	0.09		0.44	0.00	0.38	0.08	0.22	0.07	
06/03/2025 23:00:00			0.01		0.11	0.09		0.44	0.00	0.38	0.09	0.21	0.07	
06/03/2025 23:15:00			0.01		0.11	0.09		0.43	0.00	0.38	0.09	0.21	0.07	
06/03/2025 23:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.09	0.21	0.06	
06/03/2025 23:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.09	0.22	0.05	
07/03/2025 00:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.09	0.25	0.04	
07/03/2025 00:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.09	0.30	0.02	
07/03/2025 00:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.09	0.34	0.02	
07/03/2025 00:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.09	0.35	0.01	
07/03/2025 01:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.09	0.36	0.00	
07/03/2025 01:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.08	0.37	0.00	
07/03/2025 01:30:00			0.01		0.10	0.09		0.42	0.00	0.38	0.08	0.37	0.01	
07/03/2025 01:45:00			0.01		0.10	0.09		0.42	0.00	0.38	0.08	0.38	0.01	
07/03/2025 02:00:00			0.01		0.10	0.09		0.42	0.00	0.38	0.09	0.39	0.00	
07/03/2025 02:15:00			0.01		0.10	0.09		0.42	0.00	0.38	0.09	0.39	0.01	
07/03/2025 02:30:00			0.01		0.10	0.09		0.42	0.00	0.38	0.09	0.40	0.01	
07/03/2025 02:45:00			0.01		0.10	0.09		0.41	0.00	0.38	0.09	0.41	0.01	
07/03/2025 03:00:00			0.01		0.10	0.09		0.41	0.00	0.38	0.09	0.41	0.00	
07/03/2025 03:15:00			0.01		0.10	0.09		0.41	0.00	0.38	0.09	0.42	0.02	
07/03/2025 03:30:00			0.01		0.10	0.09		0.41	0.00	0.38	0.09	0.42	0.02	
07/03/2025 03:45:00			0.01		0.10	0.09		0.41	0.00	0.38	0.09	0.43	0.02	
07/03/2025 04:00:00			0.01		0.10	0.09		0.41	0.00	0.38	0.09	0.43	0.01	
07/03/2025 04:15:00			0.01		0.10	0.09		0.41	0.00	0.38	0.09	0.44	0.02	
07/03/2025 04:30:00			0.01		0.10	0.09		0.41	0.00	0.38	0.09	0.44	0.01	
07/03/2025 04:45:00			0.01		0.10	0.09		0.40	0.00	0.39	0.09	0.44	0.01	
07/03/2025 05:00:00			0.01		0.10	0.09		0.40	0.00	0.39	0.09	0.45	0.02	
07/03/2025 05:15:00			0.01		0.10	0.09		0.40	0.00	0.39	0.09	0.45	0.01	
07/03/2025 05:30:00			0.00		0.10	0.09		0.40	0.00	0.39	0.09	0.46	0.02	
07/03/2025 05:45:00			0.00		0.10	0.09		0.40	0.00	0.39	0.09	0.46	0.01	
07/03/2025 06:00:00			0.00		0.10	0.09		0.40	0.00	0.39	0.09	0.46	0.01	
07/03/2025 06:15:00			0.00		0.10	0.09		0.40	0.00	0.39	0.09	0.47	0.01	
07/03/2025 06:30:00			0.00		0.10	0.09		0.40	0.00	0.39	0.10	0.47	0.01	
07/03/2025 06:45:00			0.00		0.09	0.09		0.40	0.00	0.39	0.09	0.47	0.01	
07/03/2025 07:00:00			0.00		0.09	0.08		0.40	0.00	0.39	0.09	0.46	0.02	
07/03/2025 07:15:00			0.00		0.09	0.08		0.40	0.00	0.39	0.09	0.44	0.02	
07/03/2025 07:30:00			0.00		0.09	0.08		0.41	0.00	0.39	0.09	0.42	0.02	
07/03/2025 07:45:00			0.00		0.09	0.08		0.41	0.00	0.39	0.09	0.40	0.06	
07/03/2025 08:00:00			0.00		0.09	0.08		0.41	0.00	0.39	0.09	0.38	0.06	
07/03/2025 08:15:00			0.00		0.09	0.08		0.41	0.00	0.39	0.09	0.36	0.06	
07/03/2025 08:30:00			0.00		0.09	0.08		0.41	0.00	0.39	0.09	0.34	0.07	
07/03/2025 08:45:00			0.00		0.09	0.08		0.42	0.00	0.39	0.09	0.33	0.08	
07/03/2025 09:00:00			0.00		0.09	0.08		0.42	0.00	0.39	0.09	0.31	0.06	
07/03/2025 09:15:00			0.00		0.10	0.08		0.42	0.00	0.39	0.08	0.30	0.06	
07/03/2025 09:30:00			0.00		0.10	0.08		0.43	0.00	0.39	0.07	0.29	0.06	
07/03/2025 09:45:00			0.00		0.10	0.08		0.43	0.00	0.39	0.07	0.28	0.05	
07/03/2025 10:00:00			0.00		0.10	0.08		0.43	0.00	0.39	0.07	0.27	0.08	
07/03/2025 10:15:00			0.00		0.10	0.09		0.43	0.00	0.39	0.07	0.26	0.07	
07/03/2025 10:30:00			0.00		0.10	0.09		0.43	0.00	0.39	0.07	0.25	0.07	
07/03/2025 10:45:00			0.00		0.10	0.09		0.43	0.00	0.39	0.06	0.24	0.06	
07/03/2025 11:00:00			0.00		0.10	0.09		0.43	0.00	0.39	0.05	0.24	0.06	
07/03/2025 11:15:00			0.00		0.10	0.09		0.43	0.00	0.39	0.04	0.24	0.06	
07/03/2025 11:30:00			0.00		0.10	0.09		0.43	0.00	0.39	0.03	0.25	0.06	
07/03/2025 11:45:00			0.00		0.10	0.09		0.43	0.00	0.39	0.03	0.27	0.04	
07/03/2025 12:00:00			0.00		0.10	0.09		0.44	0.00	0.39	0.04	0.31	0.04	
07/03/2025 12:15:00			0.00		0.10	0.09		0.44	0.00	0.39	0.04	0.35	0.02	
07/03/2025 12:30:00			0.00		0.10	0.09		0.44	0.00	0.39	0.04	0.39	0.02	
07/03/2025 12:45:00			0.00		0.10	0.09		0.43	0.00	0.39	0.04	0.39	0.00	
07/03/2025 13:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.04	0.39	0.01	
07/03/2025 13:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.04	0.40	0.01	
07/03/2025 13:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.04	0.40	0.01	
07/03/2025 13:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.04	0.41	0.02	
07/03/2025 14:00:00			0.01		0.11	0.09		0.43	0.00	0.39	0.04	0.41	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
07/03/2025 14:15:00			0.01		0.11	0.09		0.43	0.00	0.39	0.04	0.42	0.02	
07/03/2025 14:30:00			0.01		0.11	0.09		0.43	0.00	0.39	0.04	0.42	0.02	
07/03/2025 14:45:00			0.01		0.11	0.09		0.43	0.00	0.39	0.05	0.43	0.02	
07/03/2025 15:00:00			0.01		0.11	0.09		0.43	0.00	0.39	0.04	0.43	0.01	
07/03/2025 15:15:00			0.01		0.11	0.09		0.43	0.00	0.39	0.03	0.44	0.02	
07/03/2025 15:30:00			0.01		0.11	0.09		0.43	0.00	0.39	0.04	0.44	0.02	
07/03/2025 15:45:00			0.01		0.11	0.09		0.43	0.00	0.39	0.04	0.45	0.02	
07/03/2025 16:00:00			0.01		0.11	0.09		0.42	0.00	0.39	0.04	0.45	0.02	
07/03/2025 16:15:00			0.01		0.11	0.09		0.42	0.00	0.39	0.04	0.45	0.01	
07/03/2025 16:30:00			0.01		0.11	0.09		0.42	0.00	0.39	0.04	0.46	0.01	
07/03/2025 16:45:00			0.01		0.11	0.09		0.42	0.00	0.39	0.04	0.46	0.02	
07/03/2025 17:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.05	0.47	0.02	
07/03/2025 17:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.05	0.47	0.01	
07/03/2025 17:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.05	0.47	0.01	
07/03/2025 17:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.05	0.48	0.02	
07/03/2025 18:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.05	0.48	0.01	
07/03/2025 18:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.05	0.48	0.02	
07/03/2025 18:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.49	0.02	
07/03/2025 18:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.49	0.01	
07/03/2025 19:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.49	0.01	
07/03/2025 19:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.49	0.02	
07/03/2025 19:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.50	0.01	
07/03/2025 19:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.50	0.01	
07/03/2025 20:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.06	0.50	0.02	
07/03/2025 20:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.06	0.50	0.02	
07/03/2025 20:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.48	0.02	
07/03/2025 20:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.47	0.03	
07/03/2025 21:00:00			0.01		0.10	0.09		0.43	0.00	0.40	0.07	0.45	0.04	
07/03/2025 21:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.05	0.43	0.05	
07/03/2025 21:30:00			0.01		0.10	0.09		0.43	0.00	0.40	0.05	0.41	0.06	
07/03/2025 21:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.40	0.06	
07/03/2025 22:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.38	0.06	
07/03/2025 22:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.37	0.07	
07/03/2025 22:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.05	0.35	0.07	
07/03/2025 22:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.05	0.34	0.07	
07/03/2025 23:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.04	0.33	0.07	
07/03/2025 23:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.04	0.33	0.07	
07/03/2025 23:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.32	0.08	
07/03/2025 23:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.32	0.08	
08/03/2025 00:00:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.32	0.05	
08/03/2025 00:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.33	0.05	
08/03/2025 00:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.34	0.04	
08/03/2025 00:45:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.38	0.04	
08/03/2025 01:00:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.42	0.04	
08/03/2025 01:15:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.43	0.00	
08/03/2025 01:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.44	0.00	
08/03/2025 01:45:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.44	0.00	
08/03/2025 02:00:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.45	0.00	
08/03/2025 02:15:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.45	0.02	
08/03/2025 02:30:00			0.01		0.10	0.09		0.41	0.00	0.39	0.08	0.45	0.02	
08/03/2025 02:45:00			0.01		0.10	0.09		0.41	0.00	0.39	0.08	0.46	0.02	
08/03/2025 03:00:00			0.01		0.10	0.09		0.41	0.00	0.39	0.08	0.46	0.02	
08/03/2025 03:15:00			0.01		0.10	0.09		0.41	0.00	0.39	0.08	0.47	0.01	
08/03/2025 03:30:00			0.01		0.10	0.09		0.40	0.00	0.39	0.08	0.47	0.01	
08/03/2025 03:45:00			0.01		0.10	0.09		0.40	0.00	0.39	0.08	0.48	0.01	
08/03/2025 04:00:00			0.01		0.10	0.09		0.40	0.00	0.39	0.08	0.48	0.02	
08/03/2025 04:15:00			0.01		0.10	0.09		0.40	0.00	0.39	0.08	0.48	0.02	
08/03/2025 04:30:00			0.01		0.10	0.09		0.40	0.00	0.39	0.08	0.49	0.01	
08/03/2025 04:45:00			0.01		0.10	0.09		0.40	0.00	0.39	0.07	0.49	0.02	
08/03/2025 05:00:00			0.00		0.10	0.09		0.40	0.00	0.39	0.07	0.49	0.02	
08/03/2025 05:15:00			0.00		0.10	0.09		0.39	0.00	0.39	0.08	0.50	0.02	
08/03/2025 05:30:00			0.00		0.10	0.09		0.39	0.00	0.39	0.07	0.50	0.02	
08/03/2025 05:45:00			0.00		0.10	0.09		0.40	0.00	0.39	0.08	0.50	0.02	
08/03/2025 06:00:00			0.00		0.09	0.09		0.40	0.00	0.39	0.07	0.51	0.02	
08/03/2025 06:15:00			0.00		0.09	0.09		0.40	0.00	0.39	0.08	0.51	0.01	
08/03/2025 06:30:00			0.00		0.09	0.09		0.40	0.00	0.40	0.08	0.51	0.02	
08/03/2025 06:45:00			0.00		0.09	0.09		0.40	0.00	0.40	0.08	0.52	0.02	
08/03/2025 07:00:00			0.00		0.09	0.09		0.40	0.00	0.40	0.08	0.52	0.02	
08/03/2025 07:15:00			0.00		0.09	0.08		0.39	0.00	0.40	0.08	0.52	0.02	
08/03/2025 07:30:00			0.00		0.09	0.08		0.40	0.00	0.40	0.08	0.52	0.02	
08/03/2025 07:45:00			0.00		0.09	0.08		0.40	0.00	0.40	0.08	0.53	0.02	
08/03/2025 08:00:00			0.00		0.09	0.08		0.39	0.00	0.40	0.07	0.51	0.02	
08/03/2025 08:15:00			0.00		0.09	0.08		0.40	0.00	0.40	0.07	0.49	0.02	
08/03/2025 08:30:00			0.00		0.09	0.08		0.40	0.00	0.40	0.07	0.47	0.03	
08/03/2025 08:45:00			0.00		0.09	0.08		0.40	0.00	0.40	0.07	0.45	0.07	
08/03/2025 09:00:00			0.00		0.09	0.08		0.40	0.00	0.40	0.07	0.43	0.07	
08/03/2025 09:15:00			0.00		0.09	0.08		0.40	0.00	0.40	0.07	0.41	0.07	
08/03/2025 09:30:00			0.00		0.10	0.08		0.41	0.00	0.40	0.07	0.40	0.08	
08/03/2025 09:45:00			0.00		0.10	0.08		0.41	0.00	0.40	0.07	0.38	0.05	
08/03/2025 10:00:00			0.00		0.10	0.08		0.42	0.00	0.40	0.07	0.37	0.07	
08/03/2025 10:15:00			0.00		0.10	0.08		0.42	0.00	0.39	0.07	0.35	0.07	
08/03/2025 10:30:00			-0.01		0.10	0.08		0.42	0.00	0.39	0.06	0.34	0.07	
08/03/2025 10:45:00			0.00		0.10	0.08		0.43	0.00	0.39	0.06	0.33	0.08	
08/03/2025 11:00:00			0.00		0.10	0.08		0.43	0.00	0.39	0.08	0.32	0.07	
08/03/2025 11:15:00			0.00		0.10	0.09		0.43	0.00	0.39	0.07	0.31	0.07	
08/03/2025 11:30:00			0.00		0.10	0.09		0.43	0.00	0.39	0.07	0.30	0.06	
08/03/2025 11:45:00			0.00		0.10	0.09		0.43	0.00	0.39	0.08	0.29	0.06	
08/03/2025 12:00:00			0.00		0.10	0.09		0.43	0.00	0.39	0.08	0.28	0.06	
08/03/2025 12:15:00			0.00		0.10	0.09		0.43	0.00	0.39	0.08	0.27	0.06	
08/03/2025 12:30:00			0.00		0.10	0.09		0.44	0.00	0.39	0.08	0.26	0.07	
08/03/2025 12:45:00			0.00		0.10	0.09		0.44	0.00	0.39	0.08	0.26	0.07	
08/03/2025 13:00:00			0.00		0.10	0.09		0.43	0.00	0.39	0.08	0.25	0.07	
08/03/2025 13:15:00			0.00		0.10	0.09		0.44	0.00	0.39	0.08	0.25	0.07	
08/03/2025 13:30:00			0.00		0.10	0.09		0.44	0.00	0.39	0.08	0.24	0.06	
08/03/2025 13:45:00			0.00		0.11	0.09		0.44	0.00	0.39	0.09	0.25	0.06	
08/03/2025 14:00:00			0.00		0.11	0.09		0.43	0.00	0.39	0.08	0.27	0.05	
08/03/2025 14:15:00			0.00		0.11	0.09		0.43	0.00	0.39	0.08	0.32	0.05	
08/03/2025 14:30:00			0.01		0.11	0.09		0.43	0.00	0.39	0.09	0.36	0.02	
08/03/2025 14:45:00			0.01		0.11	0.09		0.43	0.00	0.39	0.09	0.38	0.02	
08/03/2025 15:00:00			0.01		0.11	0.09		0.43	0.00	0.39	0.09	0.39	0.00	
08/03/2025 15:15:00			0.01		0.11	0.09		0.43	0.00	0.39	0.08	0.39	0.01	
08/03/2025 15:30:00			0.01		0.11	0.09		0.43	0.00	0.39	0.08	0.40	0.01	
08/03/2025 15:45:00			0.01		0.11	0.09		0.43	0.00	0.39	0.06	0.41	0.01	
08/03/2025 16:00:00			0.01		0.11	0.10		0.43	0.00	0.39	0.08	0.41	0.01	
08/03/2025 16:15:00			0.01		0.11	0.10		0.43	0.00	0.39	0.06	0.42	0.01	
08/03/2025 16:30:00			0.01		0.11	0.10		0.43	0.00	0.39	0.06	0.42	0.01	
08/03/2025 16:45:00			0.01		0.11	0.10		0.43	0.00	0.39	0.07	0.43	0.01	
08/03/2025 17:00:00			0.01		0.11	0.10		0.43	0.00	0.39	0.07	0.44	0.01	
08/03/2025 17:15:00			0.01		0.11	0.10		0.43	0.00	0.39	0.06	0.44	0.02	
08/03/2025 17:30:00			0.01		0.11	0.10		0.43	0.00	0.39	0.07	0.45	0.02	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
08/03/2025 17:45:00			0.01		0.11	0.10		0.43	0.00	0.39	0.07	0.45	0.01	
08/03/2025 18:00:00			0.01		0.11	0.10		0.43	0.00	0.39	0.06	0.46	0.00	
08/03/2025 18:15:00			0.01		0.11	0.10		0.43	0.00	0.39	0.08	0.46	0.02	
08/03/2025 18:30:00			0.01		0.11	0.10		0.43	0.00	0.39	0.05	0.46	0.02	
08/03/2025 18:45:00			0.01		0.11	0.10		0.43	0.00	0.39	0.05	0.47	0.02	
08/03/2025 19:00:00			0.01		0.11	0.10		0.43	0.00	0.39	0.06	0.47	0.01	
08/03/2025 19:15:00			0.01		0.11	0.10		0.43	0.00	0.39	0.05	0.48	0.01	
08/03/2025 19:30:00			0.01		0.11	0.10		0.43	0.00	0.39	0.05	0.48	0.01	
08/03/2025 19:45:00			0.01		0.11	0.10		0.43	0.00	0.39	0.05	0.48	0.01	
08/03/2025 20:00:00			0.01		0.11	0.10		0.43	0.00	0.39	0.05	0.49	0.01	
08/03/2025 20:15:00			0.01		0.11	0.10		0.43	0.00	0.39	0.03	0.49	0.01	
08/03/2025 20:30:00			0.01		0.11	0.10		0.43	0.00	0.39	0.03	0.49	0.01	
08/03/2025 20:45:00			0.01		0.11	0.10		0.43	0.00	0.39	0.06	0.48	0.01	
08/03/2025 21:00:00			0.01		0.11	0.10		0.43	0.00	0.39	0.08	0.46	0.03	
08/03/2025 21:15:00			0.01		0.11	0.09		0.43	0.00	0.39	0.08	0.44	0.03	
08/03/2025 21:30:00			0.01		0.11	0.09		0.43	0.00	0.39	0.07	0.42	0.05	
08/03/2025 21:45:00			0.01		0.11	0.09		0.43	0.00	0.39	0.06	0.40	0.05	
08/03/2025 22:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.38	0.05	
08/03/2025 22:15:00			0.01		0.11	0.09		0.43	0.00	0.39	0.07	0.37	0.07	
08/03/2025 22:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.06	0.35	0.08	
08/03/2025 22:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.06	0.34	0.08	
08/03/2025 23:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.06	0.32	0.07	
08/03/2025 23:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.31	0.07	
08/03/2025 23:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.30	0.07	
08/03/2025 23:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.29	0.07	
09/03/2025 00:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.28	0.07	
09/03/2025 00:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.27	0.06	
09/03/2025 00:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.26	0.06	
09/03/2025 00:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.26	0.07	
09/03/2025 01:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.09	0.25	0.07	
09/03/2025 01:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.24	0.08	
09/03/2025 01:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.23	0.08	
09/03/2025 01:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.09	0.23	0.07	
09/03/2025 02:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.09	0.22	0.07	
09/03/2025 02:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.22	0.07	
09/03/2025 02:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.22	0.07	
09/03/2025 02:45:00			0.01		0.10	0.09		0.41	0.00	0.39	0.08	0.25	0.06	
09/03/2025 03:00:00			0.00		0.10	0.09		0.41	0.00	0.39	0.09	0.30	0.06	
09/03/2025 03:15:00			0.01		0.10	0.09		0.41	0.00	0.39	0.09	0.35	0.01	
09/03/2025 03:30:00			0.01		0.10	0.09		0.41	0.00	0.39	0.09	0.37	0.02	
09/03/2025 03:45:00			0.01		0.10	0.09		0.41	0.00	0.39	0.09	0.37	0.01	
09/03/2025 04:00:00			0.01		0.10	0.09		0.41	0.00	0.39	0.08	0.38	0.02	
09/03/2025 04:15:00			0.00		0.10	0.09		0.41	0.00	0.39	0.08	0.39	0.01	
09/03/2025 04:30:00			0.00		0.10	0.09		0.41	0.00	0.39	0.09	0.39	0.00	
09/03/2025 04:45:00			0.00		0.10	0.09		0.41	0.00	0.39	0.08	0.40	0.01	
09/03/2025 05:00:00			0.00		0.10	0.09		0.41	0.00	0.39	0.08	0.41	0.02	
09/03/2025 05:15:00			0.00		0.10	0.09		0.40	0.00	0.39	0.09	0.41	0.02	
09/03/2025 05:30:00			0.00		0.10	0.09		0.40	0.00	0.39	0.10	0.42	0.00	
09/03/2025 05:45:00			0.00		0.10	0.09		0.40	0.00	0.39	0.10	0.42	0.01	
09/03/2025 06:00:00			0.00		0.10	0.09		0.40	0.00	0.39	0.09	0.43	0.02	
09/03/2025 06:15:00			0.00		0.10	0.09		0.40	0.00	0.39	0.09	0.44	0.02	
09/03/2025 06:30:00			0.00		0.10	0.09		0.40	0.00	0.39	0.09	0.44	0.02	
09/03/2025 06:45:00			0.00		0.09	0.09		0.40	0.00	0.39	0.09	0.44	0.02	
09/03/2025 07:00:00			0.00		0.09	0.09		0.40	0.00	0.39	0.09	0.45	0.02	
09/03/2025 07:15:00			0.00		0.09	0.09		0.40	0.00	0.39	0.09	0.45	0.02	
09/03/2025 07:30:00			0.00		0.09	0.08		0.40	0.00	0.39	0.09	0.46	0.02	
09/03/2025 07:45:00			0.00		0.09	0.08		0.40	0.00	0.39	0.10	0.46	0.01	
09/03/2025 08:00:00			0.00		0.09	0.08		0.40	0.00	0.39	0.10	0.47	0.01	
09/03/2025 08:15:00			0.00		0.09	0.08		0.40	0.00	0.39	0.09	0.47	0.01	
09/03/2025 08:30:00			0.00		0.09	0.08		0.40	0.00	0.39	0.09	0.47	0.02	
09/03/2025 08:45:00			0.00		0.09	0.08		0.40	0.00	0.39	0.09	0.48	0.02	
09/03/2025 09:00:00			0.00		0.09	0.08		0.40	0.00	0.39	0.09	0.48	0.02	
09/03/2025 09:15:00			0.00		0.09	0.08		0.41	0.00	0.39	0.09	0.48	0.02	
09/03/2025 09:30:00			0.00		0.09	0.08		0.41	0.00	0.39	0.09	0.49	0.02	
09/03/2025 09:45:00			0.00		0.09	0.08		0.41	0.00	0.39	0.09	0.49	0.02	
09/03/2025 10:00:00			0.00		0.09	0.08		0.42	0.00	0.39	0.09	0.49	0.01	
09/03/2025 10:15:00			-0.01		0.10	0.08		0.42	0.00	0.39	0.09	0.50	0.02	
09/03/2025 10:30:00			-0.01		0.10	0.08		0.43	0.00	0.39	0.09	0.50	0.03	
09/03/2025 10:45:00			-0.01		0.10	0.08		0.43	0.00	0.39	0.09	0.50	0.03	
09/03/2025 11:00:00			0.00		0.10	0.08		0.44	0.00	0.39	0.09	0.48	0.04	
09/03/2025 11:15:00			0.00		0.10	0.09		0.44	0.00	0.39	0.09	0.46	0.05	
09/03/2025 11:30:00			0.00		0.10	0.09		0.44	0.00	0.39	0.09	0.44	0.06	
09/03/2025 11:45:00			0.00		0.10	0.09		0.44	0.00	0.39	0.09	0.43	0.06	
09/03/2025 12:00:00			0.00		0.10	0.09		0.44	0.00	0.39	0.09	0.41	0.06	
09/03/2025 12:15:00			0.00		0.10	0.09		0.44	0.00	0.39	0.09	0.39	0.07	
09/03/2025 12:30:00			0.00		0.10	0.09		0.44	0.00	0.39	0.09	0.38	0.07	
09/03/2025 12:45:00			0.00		0.10	0.09		0.45	0.00	0.39	0.09	0.37	0.07	
09/03/2025 13:00:00			0.00		0.10	0.10		0.45	0.00	0.39	0.09	0.35	0.07	
09/03/2025 13:15:00			0.00		0.10	0.10		0.45	0.00	0.39	0.09	0.34	0.07	
09/03/2025 13:30:00			0.00		0.11	0.10		0.45	0.00	0.39	0.09	0.33	0.08	
09/03/2025 13:45:00			0.00		0.11	0.10		0.44	0.00	0.39	0.09	0.32	0.07	
09/03/2025 14:00:00			0.01		0.11	0.10		0.44	0.00	0.39	0.09	0.32	0.08	
09/03/2025 14:15:00			0.01		0.11	0.10		0.44	0.00	0.39	0.09	0.31	0.08	
09/03/2025 14:30:00			0.01		0.11	0.10		0.44	0.00	0.39	0.09	0.31	0.06	
09/03/2025 14:45:00			0.01		0.11	0.10		0.44	0.00	0.39	0.09	0.32	0.06	
09/03/2025 15:00:00			0.01		0.11	0.10		0.44	0.00	0.39	0.08	0.33	0.06	
09/03/2025 15:15:00			0.01		0.11	0.10		0.44	0.00	0.39	0.07	0.38	0.06	
09/03/2025 15:30:00			0.01		0.11	0.10		0.44	0.00	0.39	0.08	0.41	0.04	
09/03/2025 15:45:00			0.01		0.11	0.10		0.44	0.00	0.39	0.08	0.43	0.00	
09/03/2025 16:00:00			0.01		0.11	0.10		0.44	0.00	0.39	0.08	0.43	0.01	
09/03/2025 16:15:00			0.01		0.11	0.10		0.44	0.00	0.39	0.08	0.44	0.01	
09/03/2025 16:30:00			0.01		0.11	0.10		0.44	0.00	0.39	0.08	0.44	0.02	
09/03/2025 16:45:00			0.01		0.11	0.10		0.44	0.00	0.39	0.04	0.45	0.01	
09/03/2025 17:00:00			0.01		0.11	0.10		0.44	0.00	0.39	0.04	0.45	0.01	
09/03/2025 17:15:00			0.01		0.11	0.10		0.44	0.00	0.39	0.06	0.46	0.01	
09/03/2025 17:30:00			0.01		0.11	0.10		0.44	0.00	0.39	0.04	0.46	0.01	
09/03/2025 17:45:00			0.01		0.11	0.10		0.44	0.00	0.39	0.04	0.47	0.01	
09/03/2025 18:00:00			0.01		0.11	0.10		0.43	0.00	0.39	0.06	0.47	0.02	
09/03/2025 18:15:00			0.01		0.11	0.10		0.43	0.00	0.39	0.06	0.47	0.02	
09/03/2025 18:30:00			0.01		0.11	0.10		0.44	0.00	0.39	0.05	0.48	0.02	
09/03/2025 18:45:00			0.01		0.11	0.10		0.43	0.00	0.39	0.05	0.48	0.01	
09/03/2025 19:00:00			0.01		0.11	0.10		0.44	0.00	0.39	0.04	0.48	0.02	
09/03/2025 19:15:00			0.01		0.11	0.10		0.44	0.00	0.39	0.05	0.49	0.01	
09/03/2025 19:30:00			0.01		0.11	0.10		0.44	0.00	0.39	0.08	0.49	0.01	
09/03/2025 19:45:00			0.01		0.11	0.10		0.44	0.00	0.39	0.07	0.49	0.02	
09/03/2025 20:00:00			0.01		0.11	0.10		0.44	0.00	0.39	0.06	0.50	0.02	
09/03/2025 20:15:00			0.01		0.11	0.10		0.44	0.00	0.39	0.08	0.50	0.02	
09/03/2025 20:30:00			0.01		0.11	0.10		0.44	0.00	0.39	0.08	0.50	0.02	
09/03/2025 20:45:00			0.01		0.11	0.10		0.44	0.00	0.39	0.06	0.51	0.02	
09/03/2025 21:00:00			0.01		0.11	0.10		0.44	0.00	0.39	0.07	0.51	0.01	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
09/03/2025 21:15:00			0.01		0.11	0.10		0.44	0.00	0.39	0.07	0.51	0.01	
09/03/2025 21:30:00			0.01		0.11	0.10		0.44	0.00	0.40	0.07	0.52	0.01	
09/03/2025 21:45:00			0.01		0.11	0.10		0.44	0.00	0.40	0.08	0.52	0.02	
09/03/2025 22:00:00			0.01		0.11	0.10		0.44	0.00	0.40	0.08	0.52	0.03	
09/03/2025 22:15:00			0.01		0.11	0.10		0.44	0.00	0.40	0.09	0.52	0.03	
09/03/2025 22:30:00			0.01		0.11	0.10		0.44	0.00	0.40	0.09	0.50	0.02	
09/03/2025 22:45:00			0.01		0.11	0.10		0.44	0.00	0.40	0.08	0.48	0.04	
09/03/2025 23:00:00			0.01		0.11	0.10		0.44	0.00	0.40	0.08	0.46	0.03	
09/03/2025 23:15:00			0.01		0.11	0.10		0.43	0.00	0.40	0.08	0.44	0.05	
09/03/2025 23:30:00			0.01		0.11	0.10		0.43	0.00	0.40	0.09	0.42	0.05	
09/03/2025 23:45:00			0.01		0.11	0.10		0.43	0.00	0.40	0.09	0.41	0.05	
10/03/2025 00:00:00			0.01		0.11	0.10		0.43	0.00	0.39	0.06	0.39	0.07	
10/03/2025 00:15:00			0.01		0.10	0.10		0.43	0.00	0.39	0.08	0.37	0.07	
10/03/2025 00:30:00			0.01		0.10	0.10		0.43	0.00	0.39	0.08	0.36	0.07	
10/03/2025 00:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.35	0.07	
10/03/2025 01:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.33	0.07	
10/03/2025 01:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.32	0.06	
10/03/2025 01:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.31	0.06	
10/03/2025 01:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.30	0.06	
10/03/2025 02:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.30	0.05	
10/03/2025 02:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.29	0.07	
10/03/2025 02:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.28	0.06	
10/03/2025 02:45:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.27	0.06	
10/03/2025 03:00:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.26	0.06	
10/03/2025 03:15:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.26	0.06	
10/03/2025 03:30:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.25	0.06	
10/03/2025 03:45:00			0.01		0.10	0.09		0.41	0.00	0.39	0.08	0.25	0.06	
10/03/2025 04:00:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.26	0.05	
10/03/2025 04:15:00			0.01		0.10	0.09		0.41	0.00	0.39	0.08	0.29	0.04	
10/03/2025 04:30:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.35	0.04	
10/03/2025 04:45:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.39	0.02	
10/03/2025 05:00:00			0.00		0.10	0.09		0.41	0.00	0.39	0.07	0.40	0.00	
10/03/2025 05:15:00			0.00		0.10	0.09		0.41	0.00	0.38	0.07	0.40	0.01	
10/03/2025 05:30:00			0.00		0.10	0.09		0.41	0.00	0.38	0.09	0.41	0.01	
10/03/2025 05:45:00			0.00		0.10	0.09		0.41	0.00	0.38	0.09	0.42	0.01	
10/03/2025 06:00:00			0.00		0.10	0.09		0.41	0.00	0.38	0.08	0.42	0.02	
10/03/2025 06:15:00			0.00		0.10	0.09		0.40	0.00	0.38	0.08	0.43	0.01	
10/03/2025 06:30:00			0.00		0.10	0.09		0.40	0.00	0.38	0.09	0.43	0.01	
10/03/2025 06:45:00			0.00		0.10	0.09		0.40	0.00	0.38	0.09	0.44	0.01	
10/03/2025 07:00:00			0.00		0.09	0.09		0.40	0.00	0.38	0.08	0.44	0.02	
10/03/2025 07:15:00			0.00		0.09	0.09		0.40	0.00	0.38	0.08	0.45	0.01	
10/03/2025 07:30:00			0.00		0.09	0.09		0.40	0.00	0.38	0.08	0.45	0.01	
10/03/2025 07:45:00			0.00		0.09	0.09		0.40	0.00	0.38	0.08	0.46	0.00	
10/03/2025 08:00:00			0.00		0.10	0.09		0.41	0.00	0.38	0.07	0.46	0.01	
10/03/2025 08:15:00			0.00		0.10	0.08		0.41	0.00	0.38	0.07	0.46	0.00	
10/03/2025 08:30:00			0.00		0.10	0.08		0.41	0.00	0.38	0.07	0.47	0.01	
10/03/2025 08:45:00			0.00		0.10	0.08		0.41	0.00	0.39	0.08	0.47	0.01	
10/03/2025 09:00:00			0.00		0.10	0.08		0.41	0.00	0.39	0.08	0.48	0.01	
10/03/2025 09:15:00			0.00		0.10	0.08		0.42	0.00	0.39	0.08	0.48	0.02	
10/03/2025 09:30:00			0.00		0.10	0.08		0.42	0.00	0.39	0.07	0.48	0.01	
10/03/2025 09:45:00			0.00		0.10	0.08		0.42	0.00	0.39	0.08	0.49	0.02	
10/03/2025 10:00:00			0.00		0.10	0.08		0.42	0.00	0.39	0.08	0.49	0.02	
10/03/2025 10:15:00			0.00		0.10	0.08		0.42	0.00	0.39	0.08	0.49	0.02	
10/03/2025 10:30:00			0.00		0.10	0.08		0.43	0.00	0.39	0.08	0.50	0.02	
10/03/2025 10:45:00			0.00		0.10	0.09		0.43	0.00	0.39	0.07	0.50	0.02	
10/03/2025 11:00:00			0.00		0.10	0.09		0.44	0.00	0.39	0.08	0.50	0.03	
10/03/2025 11:15:00			0.00		0.10	0.09		0.44	0.00	0.39	0.08	0.51	0.01	
10/03/2025 11:30:00			0.00		0.10	0.09		0.44	0.00	0.39	0.08	0.51	0.01	
10/03/2025 11:45:00			0.00		0.10	0.09		0.44	0.00	0.39	0.09	0.51	0.01	
10/03/2025 12:00:00			0.00		0.10	0.09		0.44	0.00	0.39	0.08	0.51	0.02	
10/03/2025 12:15:00			0.00		0.10	0.09		0.44	0.00	0.39	0.09	0.49	0.03	
10/03/2025 12:30:00			0.00		0.10	0.09		0.43	0.00	0.39	0.09	0.47	0.04	
10/03/2025 12:45:00			0.00		0.10	0.09		0.43	0.00	0.39	0.08	0.45	0.04	
10/03/2025 13:00:00			0.00		0.10	0.09		0.43	0.00	0.39	0.08	0.43	0.04	
10/03/2025 13:15:00			0.00		0.10	0.09		0.43	0.00	0.39	0.08	0.41	0.04	
10/03/2025 13:30:00			0.00		0.10	0.09		0.43	0.00	0.39	0.07	0.40	0.06	
10/03/2025 13:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.38	0.06	
10/03/2025 14:00:00			0.00		0.10	0.09		0.43	0.00	0.39	0.07	0.37	0.07	
10/03/2025 14:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.35	0.06	
10/03/2025 14:30:00			0.01		0.11	0.09		0.43	0.00	0.39	0.07	0.34	0.06	
10/03/2025 14:45:00			0.01		0.11	0.09		0.43	0.00	0.38	0.07	0.33	0.06	
10/03/2025 15:00:00			0.01		0.11	0.09		0.43	0.00	0.38	0.07	0.32	0.06	
10/03/2025 15:15:00			0.01		0.11	0.09		0.43	0.00	0.38	0.06	0.31	0.07	
10/03/2025 15:30:00			0.01		0.11	0.09		0.43	0.00	0.38	0.06	0.31	0.07	
10/03/2025 15:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.06	0.30	0.06	
10/03/2025 16:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.31	0.05	
10/03/2025 16:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.34	0.05	
10/03/2025 16:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.06	0.38	0.02	
10/03/2025 16:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.03	0.42	0.01	
10/03/2025 17:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.03	0.42	0.00	
10/03/2025 17:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.04	0.43	0.01	
10/03/2025 17:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.06	0.43	0.01	
10/03/2025 17:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.44	0.01	
10/03/2025 18:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.06	0.44	0.01	
10/03/2025 18:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.45	0.01	
10/03/2025 18:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.04	0.45	0.01	
10/03/2025 18:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.46	0.01	
10/03/2025 19:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.46	0.01	
10/03/2025 19:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.04	0.46	0.01	
10/03/2025 19:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.08	0.47	0.01	
10/03/2025 19:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.47	0.02	
10/03/2025 20:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.03	0.47	0.01	
10/03/2025 20:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.03	0.48	0.01	
10/03/2025 20:30:00			0.01		0.10	0.09		0.44	0.00	0.38	0.07	0.48	0.01	
10/03/2025 20:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.48	0.02	
10/03/2025 21:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.03	0.49	0.01	
10/03/2025 21:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.04	0.49	0.01	
10/03/2025 21:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.04	0.49	0.01	
10/03/2025 21:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.04	0.50	0.02	
10/03/2025 22:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.04	0.50	0.02	
10/03/2025 22:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.04	0.50	0.02	
10/03/2025 22:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.50	0.03	
10/03/2025 22:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.51	0.03	
10/03/2025 23:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.51	0.02	
10/03/2025 23:15:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.51	0.03	
10/03/2025 23:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.06	0.52	0.03	
10/03/2025 23:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.06	0.52	0.02	
11/03/2025 00:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.50	0.02	
11/03/2025 00:15:00			0.01		0.10	0.09		0.42	0.00	0.38	0.07	0.48	0.03	
11/03/2025 00:30:00			0.01		0.10	0.09		0.42	0.00	0.38	0.07	0.46	0.04	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
11/03/2025 00:45:00			0.01		0.10	0.09		0.42	0.00	0.38	0.06	0.44	0.05	
11/03/2025 01:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.42	0.06	
11/03/2025 01:15:00			0.01		0.10	0.09		0.42	0.00	0.38	0.06	0.40	0.07	
11/03/2025 01:30:00			0.01		0.10	0.09		0.42	0.00	0.38	0.08	0.38	0.06	
11/03/2025 01:45:00			0.01		0.10	0.09		0.41	0.00	0.38	0.08	0.37	0.07	
11/03/2025 02:00:00			0.01		0.10	0.09		0.41	0.00	0.38	0.07	0.35	0.06	
11/03/2025 02:15:00			0.01		0.10	0.09		0.41	0.00	0.38	0.07	0.34	0.07	
11/03/2025 02:30:00			0.01		0.10	0.09		0.41	0.00	0.38	0.07	0.33	0.06	
11/03/2025 02:45:00			0.01		0.10	0.09		0.41	0.00	0.38	0.07	0.31	0.06	
11/03/2025 03:00:00			0.01		0.10	0.09		0.41	0.00	0.38	0.07	0.30	0.06	
11/03/2025 03:15:00			0.01		0.10	0.09		0.40	0.00	0.38	0.08	0.29	0.06	
11/03/2025 03:30:00			0.01		0.10	0.09		0.40	0.00	0.38	0.08	0.29	0.07	
11/03/2025 03:45:00			0.01		0.10	0.09		0.40	0.00	0.38	0.07	0.28	0.07	
11/03/2025 04:00:00			0.01		0.10	0.09		0.40	0.00	0.38	0.08	0.27	0.07	
11/03/2025 04:15:00			0.01		0.10	0.09		0.40	0.00	0.38	0.08	0.27	0.07	
11/03/2025 04:30:00			0.00		0.10	0.09		0.40	0.00	0.38	0.08	0.27	0.06	
11/03/2025 04:45:00			0.00		0.10	0.09		0.40	0.00	0.38	0.08	0.29	0.05	
11/03/2025 05:00:00			0.00		0.10	0.09		0.40	0.00	0.38	0.08	0.34	0.04	
11/03/2025 05:15:00			0.00		0.10	0.09		0.40	0.00	0.38	0.06	0.37	0.04	
11/03/2025 05:30:00			0.00		0.09	0.09		0.40	0.00	0.38	0.07	0.38	0.02	
11/03/2025 05:45:00			0.00		0.09	0.08		0.40	0.00	0.38	0.07	0.39	0.01	
11/03/2025 06:00:00			0.00		0.09	0.08		0.40	0.00	0.38	0.07	0.40	0.00	
11/03/2025 06:15:00			0.00		0.09	0.08		0.40	0.00	0.38	0.08	0.40	0.01	
11/03/2025 06:30:00			0.00		0.09	0.08		0.40	0.00	0.38	0.08	0.41	0.01	
11/03/2025 06:45:00			0.00		0.09	0.08		0.39	0.00	0.38	0.07	0.42	0.01	
11/03/2025 07:00:00			0.00		0.09	0.08		0.40	0.00	0.38	0.07	0.42	0.01	
11/03/2025 07:15:00			0.00		0.09	0.08		0.40	0.00	0.38	0.07	0.43	0.01	
11/03/2025 07:30:00			0.00		0.09	0.08		0.40	0.00	0.38	0.07	0.43	0.01	
11/03/2025 07:45:00			0.00		0.09	0.08		0.40	0.00	0.38	0.07	0.44	0.01	
11/03/2025 08:00:00			0.00		0.09	0.08		0.40	0.00	0.38	0.08	0.44	0.01	
11/03/2025 08:15:00			0.00		0.09	0.08		0.40	0.00	0.38	0.08	0.45	0.01	
11/03/2025 08:30:00			0.00		0.09	0.08		0.40	0.00	0.38	0.08	0.45	0.01	
11/03/2025 08:45:00			0.00		0.09	0.08		0.40	0.00	0.38	0.08	0.46	0.02	
11/03/2025 09:00:00			0.00		0.09	0.08		0.41	0.00	0.38	0.08	0.46	0.01	
11/03/2025 09:15:00			0.00		0.09	0.08		0.41	0.00	0.38	0.07	0.46	0.01	
11/03/2025 09:30:00			0.00		0.09	0.08		0.41	0.00	0.38	0.07	0.47	0.01	
11/03/2025 09:45:00			0.00		0.09	0.08		0.41	0.00	0.38	0.07	0.47	0.02	
11/03/2025 10:00:00			0.00		0.09	0.08		0.42	0.00	0.38	0.08	0.47	0.02	
11/03/2025 10:15:00			0.00		0.09	0.08		0.42	0.00	0.38	0.08	0.48	0.02	
11/03/2025 10:30:00			-0.01		0.09	0.08		0.43	0.00	0.38	0.08	0.48	0.02	
11/03/2025 10:45:00			-0.01		0.09	0.08		0.43	0.00	0.38	0.08	0.48	0.02	
11/03/2025 11:00:00			0.00		0.09	0.08		0.43	0.00	0.38	0.07	0.48	0.02	
11/03/2025 11:15:00			0.00		0.09	0.08		0.43	0.00	0.38	0.07	0.49	0.03	
11/03/2025 11:30:00			0.00		0.09	0.08		0.43	0.00	0.38	0.08	0.49	0.02	
11/03/2025 11:45:00			0.00		0.09	0.08		0.43	0.00	0.38	0.07	0.49	0.02	
11/03/2025 12:00:00			0.00		0.10	0.08		0.43	0.00	0.38	0.07	0.49	0.02	
11/03/2025 12:15:00			0.00		0.10	0.08		0.43	0.00	0.38	0.08	0.50	0.03	
11/03/2025 12:30:00			0.00		0.10	0.08		0.43	0.00	0.38	0.07	0.50	0.03	
11/03/2025 12:45:00			0.00		0.10	0.09		0.43	0.00	0.38	0.07	0.50	0.02	
11/03/2025 13:00:00			0.00		0.10	0.09		0.43	0.00	0.38	0.07	0.50	0.03	
11/03/2025 13:15:00			0.00		0.10	0.09		0.43	0.00	0.38	0.07	0.50	0.02	
11/03/2025 13:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.48	0.03	
11/03/2025 13:45:00			0.00		0.10	0.09		0.43	0.00	0.38	0.08	0.45	0.03	
11/03/2025 14:00:00			0.00		0.10	0.09		0.43	0.00	0.38	0.06	0.44	0.03	
11/03/2025 14:15:00			0.00		0.10	0.09		0.43	0.00	0.38	0.06	0.42	0.05	
11/03/2025 14:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.06	0.40	0.06	
11/03/2025 14:45:00			0.00		0.10	0.09		0.43	0.00	0.38	0.06	0.38	0.06	
11/03/2025 15:00:00			0.00		0.10	0.09		0.43	0.00	0.38	0.05	0.37	0.04	
11/03/2025 15:15:00			0.00		0.10	0.09		0.43	0.00	0.38	0.05	0.36	0.05	
11/03/2025 15:30:00			0.01		0.10	0.09		0.43	0.00	0.38	0.05	0.35	0.06	
11/03/2025 15:45:00			0.00		0.10	0.09		0.43	0.00	0.38	0.05	0.34	0.06	
11/03/2025 16:00:00			0.01		0.10	0.09		0.42	0.00	0.38	0.03	0.35	0.05	
11/03/2025 16:15:00			0.01		0.10	0.09		0.42	0.00	0.38	0.03	0.36	0.05	
11/03/2025 16:30:00			0.01		0.10	0.09		0.42	0.00	0.38	0.06	0.39	0.02	
11/03/2025 16:45:00			0.01		0.10	0.09		0.42	0.00	0.38	0.06	0.41	0.02	
11/03/2025 17:00:00			0.01		0.10	0.09		0.42	0.00	0.38	0.05	0.42	0.01	
11/03/2025 17:15:00			0.01		0.10	0.09		0.42	0.00	0.38	0.05	0.43	0.01	
11/03/2025 17:30:00			0.00		0.10	0.09		0.42	0.00	0.38	0.02	0.44	0.00	
11/03/2025 17:45:00			0.00		0.10	0.09		0.42	0.00	0.38	0.02	0.44	0.01	
11/03/2025 18:00:00			0.00		0.10	0.09		0.42	0.00	0.38	0.02	0.45	0.00	
11/03/2025 18:15:00			0.00		0.10	0.09		0.42	0.00	0.38	0.04	0.45	0.01	
11/03/2025 18:30:00			0.00		0.10	0.09		0.42	0.00	0.38	0.06	0.46	0.00	
11/03/2025 18:45:00			0.00		0.10	0.09		0.42	0.00	0.38	0.06	0.46	0.01	
11/03/2025 19:00:00			0.00		0.10	0.09		0.43	0.00	0.38	0.07	0.47	0.01	
11/03/2025 19:15:00			0.00		0.10	0.09		0.43	0.00	0.38	0.07	0.47	0.01	
11/03/2025 19:30:00			0.00		0.10	0.09		0.43	0.00	0.38	0.05	0.47	0.02	
11/03/2025 19:45:00			0.00		0.10	0.09		0.43	0.00	0.38	0.05	0.48	0.02	
11/03/2025 20:00:00			0.00		0.10	0.09		0.43	0.00	0.38	0.07	0.48	0.02	
11/03/2025 20:15:00			0.00		0.10	0.09		0.43	0.00	0.38	0.07	0.48	0.01	
11/03/2025 20:30:00			0.00		0.10	0.09		0.43	0.00	0.38	0.03	0.49	0.01	
11/03/2025 20:45:00			0.00		0.10	0.09		0.43	0.00	0.38	0.06	0.49	0.01	
11/03/2025 21:00:00			0.00		0.10	0.09		0.43	0.00	0.38	0.04	0.49	0.01	
11/03/2025 21:15:00			0.00		0.10	0.09		0.44	0.00	0.38	0.06	0.50	0.01	
11/03/2025 21:30:00			0.01		0.10	0.09		0.44	0.00	0.38	0.06	0.50	0.01	
11/03/2025 21:45:00			0.01		0.10	0.09		0.44	0.00	0.38	0.05	0.50	0.01	
11/03/2025 22:00:00			0.01		0.10	0.09		0.44	0.00	0.38	0.04	0.50	0.02	
11/03/2025 22:15:00			0.01		0.10	0.09		0.44	0.00	0.38	0.04	0.51	0.01	
11/03/2025 22:30:00			0.01		0.10	0.09		0.44	0.00	0.38	0.07	0.51	0.02	
11/03/2025 22:45:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.51	0.01	
11/03/2025 23:00:00			0.01		0.10	0.09		0.43	0.00	0.38	0.07	0.51	0.01	
11/03/2025 23:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.52	0.02	
11/03/2025 23:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.06	0.52	0.01	
11/03/2025 23:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.06	0.52	0.01	
12/03/2025 00:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.52	0.00	
12/03/2025 00:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.53	0.00	
12/03/2025 00:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.06	0.52	0.02	
12/03/2025 00:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.50	0.03	
12/03/2025 01:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.47	0.04	
12/03/2025 01:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.05	0.45	0.04	
12/03/2025 01:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.43	0.04	
12/03/2025 01:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.06	0.41	0.04	
12/03/2025 02:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.07	0.39	0.06	
12/03/2025 02:15:00			0.01		0.10	0.09		0.41	0.00	0.39	0.08	0.38	0.06	
12/03/2025 02:30:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.36	0.06	
12/03/2025 02:45:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.35	0.06	
12/03/2025 03:00:00			0.01		0.10	0.09		0.41	0.00	0.39	0.09	0.34	0.05	
12/03/2025 03:15:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.32	0.04	
12/03/2025 03:30:00			0.01		0.10	0.09		0.41	0.00	0.39	0.08	0.31	0.05	
12/03/2025 03:45:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.30	0.05	
12/03/2025 04:00:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.30	0.07	

	G1 Stage	G1 Velocity	G3 Stage	G3 Discharge	G4 US Stage	G4 DS Stage	G4 Discharge	G5 Stage	G5 Velocity	G6 Stage	G6 Velocity	G8 Stage	G8 Velocity	Comments
Top of well Level (mOD)														
Units	m	(m/S)	m	(m3/S)	m	m	m3/s	m	m/s	m	m/s	m	m/s	
12/03/2025 04:15:00			0.01		0.10	0.09		0.41	0.00	0.39	0.07	0.29	0.06	
12/03/2025 04:30:00			0.00		0.10	0.09		0.41	0.00	0.39	0.07	0.28	0.06	
12/03/2025 04:45:00			0.00		0.10	0.09		0.41	0.00	0.39	0.07	0.27	0.06	
12/03/2025 05:00:00			0.00		0.10	0.09		0.41	0.00	0.39	0.08	0.27	0.06	
12/03/2025 05:15:00			0.00		0.10	0.09		0.40	0.00	0.39	0.08	0.26	0.06	
12/03/2025 05:30:00			0.00		0.10	0.09		0.40	0.00	0.39	0.07	0.27	0.06	
12/03/2025 05:45:00			0.00		0.10	0.09		0.40	0.00	0.39	0.07	0.30	0.04	
12/03/2025 06:00:00			0.00		0.09	0.09		0.40	0.00	0.39	0.07	0.35	0.01	
12/03/2025 06:15:00			0.00		0.09	0.09		0.40	0.00	0.39	0.07	0.36	0.01	
12/03/2025 06:30:00			0.00		0.09	0.09		0.40	0.00	0.39	0.07	0.38	0.02	
12/03/2025 06:45:00			0.00		0.09	0.09		0.40	0.00	0.39	0.07	0.39	0.01	
12/03/2025 07:00:00			0.00		0.09	0.09		0.40	0.00	0.39	0.09	0.39	0.01	
12/03/2025 07:15:00			0.00		0.09	0.09		0.40	0.00	0.39	0.09	0.40	0.01	
12/03/2025 07:30:00			0.00		0.09	0.09		0.40	0.00	0.39	0.09	0.41	0.01	
12/03/2025 07:45:00			0.00		0.09	0.09		0.40	0.00	0.39	0.09	0.42	0.02	
12/03/2025 08:00:00			0.00		0.09	0.08		0.40	0.00	0.39	0.09	0.42	0.01	
12/03/2025 08:15:00			0.00		0.09	0.08		0.41	0.00	0.39	0.08	0.43	0.02	
12/03/2025 08:30:00			0.00		0.09	0.08		0.41	0.00	0.39	0.08	0.43	0.01	
12/03/2025 08:45:00			0.00		0.09	0.08		0.41	0.00	0.39	0.07	0.44	0.01	
12/03/2025 09:00:00			0.00		0.09	0.08		0.41	0.00	0.39	0.08	0.44	0.02	
12/03/2025 09:15:00			0.00		0.09	0.08		0.42	0.00	0.39	0.08	0.45	0.01	
12/03/2025 09:30:00			0.00		0.09	0.08		0.42	0.00	0.39	0.10	0.45	0.02	
12/03/2025 09:45:00			0.00		0.09	0.08		0.42	0.00	0.39	0.08	0.46	0.02	
12/03/2025 10:00:00			0.00		0.09	0.08		0.42	0.00	0.39	0.07	0.46	0.02	
12/03/2025 10:15:00			0.00		0.09	0.08		0.42	0.00	0.39	0.07	0.46	0.02	
12/03/2025 10:30:00			0.00		0.10	0.09		0.43	0.00	0.39	0.10	0.47	0.02	
12/03/2025 10:45:00			0.00		0.10	0.09		0.43	0.00	0.39	0.08	0.47	0.02	
12/03/2025 11:00:00			0.00		0.10	0.09		0.43	0.00	0.39	0.10	0.47	0.02	
12/03/2025 11:15:00			0.00		0.10	0.09		0.43	0.00	0.39	0.10	0.48	0.02	
12/03/2025 11:30:00			0.00		0.10	0.09		0.43	0.00	0.39	0.07	0.48	0.03	
12/03/2025 11:45:00			0.00		0.10	0.09		0.43	0.00	0.39	0.07	0.48	0.03	
12/03/2025 12:00:00			0.00		0.10	0.09		0.44	0.00	0.39	0.10	0.49	0.03	
12/03/2025 12:15:00			0.00		0.10	0.09		0.44	0.00	0.39	0.06	0.49	0.02	
12/03/2025 12:30:00			0.00		0.10	0.09		0.44	0.00	0.39	0.10	0.49	0.02	
12/03/2025 12:45:00			0.00		0.10	0.09		0.44	0.00	0.39	0.10	0.49	0.02	
12/03/2025 13:00:00			0.00		0.10	0.09		0.44	0.00	0.39	0.09	0.50	0.02	
12/03/2025 13:15:00			0.00		0.10	0.09		0.44	0.00	0.39	0.10	0.50	0.02	
12/03/2025 13:30:00			0.00		0.10	0.09		0.44	0.00	0.39	0.10	0.50	0.02	
12/03/2025 13:45:00			0.00		0.10	0.09		0.44	0.00	0.39	0.08	0.49	0.02	
12/03/2025 14:00:00			0.00		0.10	0.09		0.44	0.00	0.39	0.09	0.47	0.03	
12/03/2025 14:15:00			0.01		0.10	0.09		0.44	0.00	0.39	0.06	0.45	0.04	
12/03/2025 14:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.43	0.04	
12/03/2025 14:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.06	0.41	0.04	
12/03/2025 15:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.09	0.39	0.07	
12/03/2025 15:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.37	0.06	
12/03/2025 15:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.36	0.06	
12/03/2025 15:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.35	0.05	
12/03/2025 16:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.33	0.05	
12/03/2025 16:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.32	0.04	
12/03/2025 16:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.32	0.04	
12/03/2025 16:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.04	0.32	0.05	
12/03/2025 17:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.09	0.35	0.04	
12/03/2025 17:15:00			0.01		0.10	0.09		0.42	0.00	0.39	0.09	0.39	0.01	
12/03/2025 17:30:00			0.01		0.10	0.09		0.42	0.00	0.39	0.10	0.40	0.02	
12/03/2025 17:45:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.41	0.00	
12/03/2025 18:00:00			0.01		0.10	0.09		0.42	0.00	0.39	0.08	0.42	0.01	
12/03/2025 18:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.42	0.02	
12/03/2025 18:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.43	0.01	
12/03/2025 18:45:00			0.01		0.10	0.09		0.43	0.00	0.39	0.09	0.43	0.01	
12/03/2025 19:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.09	0.44	0.00	
12/03/2025 19:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.44	0.01	
12/03/2025 19:30:00			0.01		0.10	0.09		0.43	0.00	0.39	0.07	0.44	0.00	
12/03/2025 19:45:00			0.00		0.10	0.09		0.43	0.00	0.39	0.05	0.45	0.01	
12/03/2025 20:00:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.45	0.01	
12/03/2025 20:15:00			0.01		0.10	0.09		0.43	0.00	0.39	0.08	0.45	0.00	
12/03/2025 20:30:00			0.01		0.10	0.09		0.44	0.00	0.39	0.07	0.45	0.00	
12/03/2025 20:45:00			0.01		0.10	0.09		0.44	0.00	0.39	0.07	0.46	0.00	
12/03/2025 21:00:00			0.01		0.10	0.09		0.44	0.00	0.39	0.07	0.46	0.00	
12/03/2025 21:15:00			0.01		0.10	0.09		0.44	0.00	0.39	0.08	0.46	0.01	
12/03/2025 21:30:00			0.01		0.10	0.09		0.44	0.00	0.39	0.09	0.46	0.00	
12/03/2025 21:45:00			0.01		0.10	0.09		0.44	0.00	0.39	0.09	0.47	0.00	
12/03/2025 22:00:00			0.01		0.10	0.09		0.44	0.00	0.39	0.09	0.47	0.00	
12/03/2025 22:15:00			0.01		0.10	0.10		0.44	0.00	0.39	0.09	0.47	0.01	
12/03/2025 22:30:00			0.01		0.10	0.10		0.43	0.00	0.39	0.09	0.47	0.01	
12/03/2025 22:45:00			0.01		0.10	0.10		0.43	0.00	0.39	0.09	0.48	0.01	
12/03/2025 23:00:00			0.01		0.10	0.10		0.43	0.00	0.39	0.09	0.48	0.01	
12/03/2025 23:15:00			0.01		0.10	0.10		0.43	0.00	0.39	0.10	0.48	0.01	
12/03/2025 23:30:00			0.01		0.10	0.10		0.43	0.00	0.39	0.10	0.48	0.01	
12/03/2025 23:45:00			0.01		0.10	0.10		0.43	0.00	0.39	0.09	0.49	0.01	
13/03/2025 00:00:00			0.01		0.10	0.10		0.43	0.00	0.39	0.10	0.49	0.01	
13/03/2025 00:15:00			0.01		0.10	0.10		0.43	0.00	0.39	0.11	0.49	0.01	
13/03/2025 00:30:00			0.01		0.10	0.10		0.43	0.00	0.39	0.11	0.49	0.01	
13/03/2025 00:45:00			0.01		0.10	0.10		0.42	0.00	0.39	0.11	0.49	0.01	
13/03/2025 01:00:00			0.01		0.10	0.10		0.42	0.00	0.39	0.11	0.50	0.00	
13/03/2025 01:15:00			0.01		0.10	0.10		0.42	0.00	0.39	0.10	0.48	0.00	
13/03/2025 01:30:00			0.01		0.10	0.10		0.42	0.00	0.40	0.10	0.46	0.00	
13/03/2025 01:45:00			0.01		0.10	0.10		0.42	0.00	0.40	0.11	0.44	0.04	
13/03/2025 02:00:00			0.01		0.10	0.10		0.42	0.00	0.40	0.10	0.41	0.04	
13/03/2025 02:15:00			0.01		0.10	0.10		0.41	0.00	0.40	0.10	0.39	0.04	
13/03/2025 02:30:00			0.01		0.10	0.10		0.41	0.00	0.40	0.10	0.37	0.05	
13/03/2025 02:45:00			0.01		0.10	0.10		0.41	0.00	0.40	0.09	0.35	0.06	
13/03/2025 03:00:00			0.01		0.10	0.10		0.41	0.00	0.40	0.09	0.34	0.05	
13/03/2025 03:15:00			0.01		0.10	0.10		0.41	0.00	0.40	0.09	0.32	0.05	
13/03/2025 03:30:00			0.01		0.10	0.10		0.41	0.00	0.40	0.10	0.31	0.05	
13/03/2025 03:45:00			0.01		0.10	0.10		0.41	0.00	0.40	0.10	0.30	0.05	
13/03/2025 04:00:00			0.01		0.10	0.10		0.40	0.00	0.40	0.10	0.29	0.06	
13/03/2025 04:15:00			0.01		0.10	0.10		0.40	0.00	0.40	0.10	0.28	0.06	
13/03/2025 04:30:00			0.01		0.10	0.10		0.40	0.00	0.40	0.10	0.27	0.05	
13/03/2025 04:45:00			0.01					0.41	0.00	0.40	0.10	0.26	0.06	
13/03/2025 05:00:00			0.01					0.41	0.00	0.40	0.10			
13/03/2025 05:15:00			0.01					0.40	0.00	0.40	0.10			
13/03/2025 05:30:00			0.00					0.40	0.00	0.40	0.11			
13/03/2025 05:45:00								0.40	0.00	0.40	0.10			
13/03/2025 06:00:00								0.40	0.00	0.40	0.11			
13/03/2025 06:15:00								0.40	0.00	0.40	0.11			
13/03/2025 06:30:00								0.40	0.00	0.40	0.11			

APPENDIX F: WATER SAMPLE CERTIFICATES

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	06 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250224-30
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758210
Order Number:	55778

We received 5 samples on Monday February 24, 2025 and 5 of these samples were scheduled for analysis which was completed on Thursday March 06, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:

Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250224-30 **Report Number:** 758210 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31121266	SZC TCA PT		39.00 - 39.00	20/02/2025
31121283	SZC TCA PT		39.00 - 39.00	20/02/2025
31121451	SZC TCA PT		39.00 - 39.00	20/02/2025
31121490	SZC TCA PT		39.00 - 39.00	20/02/2025
31121534	SZC TCA PT		39.00 - 39.00	20/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250224-30 **Report Number:** 758210 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

			Lab Sample No(s)	31121266	31121283	31121451	31121490
			Customer Sample Reference	SZC TCA PT	SZC TCA PT	SZC TCA PT	SZC TCA PT
			AGS Reference				
			Depth (m)	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00
			Container	500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)	500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)	500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)	500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)
			Sample Type	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 5			X					X					X					X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 5	X					X					X					X					
Anions by Kone (w)	All	NDPs: 0 Tests: 5	X					X					X					X					
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 5			X					X					X					X			
Low Level Cyanide (W)	All	NDPs: 0 Tests: 5					X					X					X						
Mercury Dissolved	All	NDPs: 0 Tests: 5			X					X					X					X			
pH Value	All	NDPs: 0 Tests: 5	X					X					X					X					
Phosphate by Kone (w)	All	NDPs: 0 Tests: 5	X					X					X					X					
Suspended Solids	All	NDPs: 0 Tests: 5	X					X					X					X					
Total Metals by ICP-MS	All	NDPs: 0 Tests: 5				X					X					X							X
Total Nitrogen	All	NDPs: 0 Tests: 5	X					X					X					X					

31121534	SZC TCA PT		39.00 - 39.00	NaOH (ALE245)	GW
				HNO3 Unfiltered (ALE204)	GW
				HNO3 Filtered (ALE204)	GW
				H2SO4 (ALE244)	GW
				500ml Plastic (ALE208)	GW
31121490	SZC TCA PT		39.00 - 39.00	NaOH (ALE245)	GW
					X
				X	
					X
					X
				X	
					X
X					
				X	
					X
					X
					X
			X		
					X

CERTIFICATE OF ANALYSIS

SDG: 250224-30 **Report Number:** 758210 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4+§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	SZC TCA PT	SZC TCA PT	SZC TCA PT	SZC TCA PT	SZC TCA PT
			Depth (m)	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00
			Sample Type	Ground Water (GW)	Ground Water (GW)	Ground Water (GW)	Ground Water (GW)	Ground Water (GW)
			Date Sampled	20/02/2025	20/02/2025	20/02/2025	20/02/2025	20/02/2025
			Sample Time	14:00:00	10:00:00	12:00:00	16:00:00	08:00:00
			Date Received	24/02/2025	24/02/2025	24/02/2025	24/02/2025	24/02/2025
			SDG Ref	250224-30	250224-30	250224-30	250224-30	250224-30
			Lab Sample No.(s)	31121266	31121283	31121451	31121490	31121534
			AGS Reference					
Suspended solids, Total	<2 mg/l	TM022		<2 #	<2 #	<2	<2 #	362 #
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099		0.018 #	<0.01 #	<0.01	<0.01 #	0.026 #
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099		0.0231 #	<0.01 #	<0.01	<0.01 #	0.0334 #
Arsenic (diss.filt)	<0.5 µg/l	TM152		1.76 #	2.29 #	1.87	1.78 #	1.53 #
Arsenic (tot.unfilt)	<2 µg/l	TM152		<2 #	2.16 #	<2	<2 #	<2 #
Boron (diss.filt)	<10 µg/l	TM152		29.2 #	34.8 #	30.2	28.7 #	25.9 #
Boron (tot.unfilt)	<20 µg/l	TM152		38.8 #	35.6 #	31.8	32 #	29.1 #
Cadmium (diss.filt)	<0.08 µg/l	TM152		<0.08 #	<0.08 #	<0.08	<0.08 #	<0.08 #
Cadmium (tot.unfilt)	<0.5 µg/l	TM152		<0.5 #	<0.5 #	<0.5	<0.5 #	<0.5 #
Chromium (tot.unfilt)	<3 µg/l	TM152		<3 #	<3 #	<3	<3 #	<3 #
Chromium (diss.filt)	<1 µg/l	TM152		<1 #	<1 #	<1	<1 #	<1 #
Copper (tot.unfilt)	<1 µg/l	TM152		1.3 #	8.52 #	5.52	<1 #	18.5 #
Lead (tot.unfilt)	<1 µg/l	TM152		<1 #	1.5 #	1.14	<1 #	8.51 #
Copper (diss.filt)	<0.3 µg/l	TM152		<0.3 #	4.86 #	2.23	0.432 #	1.96 #
Manganese (tot.unfilt)	<1 µg/l	TM152		173 #	149 #	158	173 #	182 #
Lead (diss.filt)	<0.2 µg/l	TM152		<0.2 #	0.362 #	0.242	<0.2 #	0.5 #
Nickel (tot.unfilt)	<1 µg/l	TM152		3.05 #	9.84 #	7.15	2.4 #	8.65 #
Manganese (diss.filt)	<3 µg/l	TM152		162 #	147 #	151	167 #	170 #
Nickel (diss.filt)	<0.4 µg/l	TM152		2.58 #	9.41 #	6.38	2.41 #	3.55 #
Phosphorus (diss.filt)	<10 µg/l	TM152		<10 #	10.8 #	11.4	<10 #	<10 #
Zinc (tot.unfilt)	<5 µg/l	TM152		10.8 #	84.8 #	50.8	8.2 #	92.4 #
Zinc (diss.filt)	<1 µg/l	TM152		9.83 #	81 #	48	9.81 #	30 #
Sodium (Dis.Filt)	<0.076 mg/l	TM152		20.4 #	22.9 #	20.7	20.8 #	19.3 #
Magnesium (Dis.Filt)	<0.036 mg/l	TM152		8.23 #	9.04 #	8.26	8.25 #	6.9 #
Potassium (Dis.Filt)	<0.2 mg/l	TM152		2.08 #	2.32 #	2.19	2.11 #	1.78 #
Calcium (Dis.Filt)	<0.2 mg/l	TM152		160 #	169 #	160	161 #	159 #
Iron (Dis.Filt)	<0.019 mg/l	TM152		0.95 #	0.643 #	0.765	1.04 #	0.205 #
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152		21.4 #	21.9 #	21.4	21.7 #	21.7 #
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152		8.63 #	8.59 #	8.54	8.69 #	7.35 #
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152		2.18 #	2.31 #	2.27	2.13 #	2.58 #
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152		166 #	166 #	166	166 #	166 #
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152		1.03 #	0.725 #	0.831	1.08 #	0.446 #
Mercury (diss.filt)	<0.01 µg/l	TM183		<0.01 #	<0.01 #	<0.01	<0.01 #	<0.01 #

CERTIFICATE OF ANALYSIS

SDG: 250224-30 **Report Number:** 758210 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	SZC TCA PT	SZC TCA PT	SZC TCA PT	SZC TCA PT	SZC TCA PT	
			Depth (m)	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00	
			Sample Type	Ground Water (GW)	Ground Water (GW)	Ground Water (GW)	Ground Water (GW)	Ground Water (GW)	
			Date Sampled	20/02/2025	20/02/2025	20/02/2025	20/02/2025	20/02/2025	
			Sample Time	14:00:00	10:00:00	12:00:00	16:00:00	08:00:00	
			Date Received	24/02/2025	24/02/2025	24/02/2025	24/02/2025	24/02/2025	
			SDG Ref	250224-30	250224-30	250224-30	250224-30	250224-30	
			Lab Sample No.(s)	31121266	31121283	31121451	31121490	31121534	
			AGS Reference						
Phosphate (Ortho as P)	<0.02 mg/l	TM184		<0.02 #	<0.02 #	<0.02	<0.02 #	<0.02 #	
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184		7.3 #	7.38 #	7.27	7.18 #	10.1 #	
Nitrogen, Total	<1 mg/l	TM212		7.77 #	7.51 #	7.48	7.36 #	10.8 #	
Chloride	<0.08 mg/l	TM226		61 #	63.3 #	60.6	60.9 #	64 #	
Nitrite as N	<0.01 mg/l	TM226		0.0265 @ #	0.0298 @ #	0.0402 @	0.038 @ #	0.0593 @ #	
Nitrate as N	<0.02 mg/l	TM226		7.26 #	7.35 #	7.3	7.18 #	10.3 #	
Sulphate as S	<0.04 mg/l	TM226		27.8 #	28.1 #	27.8	28.2 #	28.2 #	
pH	<1 pH Units	TM256		7.45 #	7.54 #	7.65	7.5 #	7.53 #	
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256		0.887 #	0.883 #	0.877	0.886 #	0.881 #	
Alkalinity, Total as CaCO3	<3 mg/l	TM256		326 #	321 #	322	328 #	302 #	
Cyanide, Free (low level)	<2.5 µg/l	TM279		<2.5 #	<2.5 #	<2.5	<2.5 #	<2.5 #	

Table of Results - Appendix

Method No	Description
TM226	Determination of Anions in Waters using Ion Chromatography
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250224-30 **Report Number:** 758210 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31121266	31121283	31121451	31121490	31121534
Customer Sample Ref.	SZC TCA PT	SZC TCA PT	SZC TCA PT	SZC TCA PT	SZC TCA PT
AGS Ref.					
Depth	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00	39.00 - 39.00
Type	Ground Water	Ground Water	Ground Water	Ground Water	Ground Water
Ammonium Low	26-Feb-2025	26-Feb-2025	26-Feb-2025	26-Feb-2025	26-Feb-2025
Anions by ion Chromatography	28-Feb-2025	28-Feb-2025	28-Feb-2025	28-Feb-2025	28-Feb-2025
Anions by Kone (w)	26-Feb-2025	26-Feb-2025	26-Feb-2025	26-Feb-2025	26-Feb-2025
Dissolved Metals by ICP-MS	27-Feb-2025	27-Feb-2025	27-Feb-2025	27-Feb-2025	27-Feb-2025
Low Level Cyanide (W)	03-Mar-2025	03-Mar-2025	03-Mar-2025	03-Mar-2025	03-Mar-2025
Mercury Dissolved	03-Mar-2025	03-Mar-2025	03-Mar-2025	03-Mar-2025	03-Mar-2025
pH Value	28-Feb-2025	28-Feb-2025	28-Feb-2025	28-Feb-2025	28-Feb-2025
Phosphate by Kone (w)	26-Feb-2025	26-Feb-2025	26-Feb-2025	26-Feb-2025	26-Feb-2025
Suspended Solids	03-Mar-2025	04-Mar-2025	04-Mar-2025	03-Mar-2025	03-Mar-2025
Total Metals by ICP-MS	27-Feb-2025	27-Feb-2025	27-Feb-2025	27-Feb-2025	27-Feb-2025
Total Nitrogen	05-Mar-2025	05-Mar-2025	06-Mar-2025	05-Mar-2025	05-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3193	QC 3182
Ammoniacal Nitrogen as N	TM099	**103.6** 88.00 : 112.00	**104.4** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3126
Bromide (W)	TM226	**99.17** 95.10 : 103.12
Chloride (W)	TM226	**100.65** 97.34 : 104.29
Fluoride (W)	TM226	**100.83** 96.73 : 103.12
Nitrate (W)	TM226	**99.17** 96.03 : 104.08
Nitrite (W)	TM226	**100.0** 91.30 : 103.05
Phosphate (W)	TM226	**100.0** 96.81 : 103.22
Sulphate (W)	TM226	**100.62** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3112
Sulphate (soluble)	TM184	**100.8** 94.30 : 107.93
TON as NO3	TM184	**103.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3117	QC 3106
Aluminium	TM152	**103.33** 96.29 : 111.36	**103.67** 95.67 : 113.25
Antimony	TM152	**103.83** 95.87 : 111.07	**105.67** 96.18 : 111.18
Arsenic	TM152	**102.83** 97.55 : 110.65	**102.83** 94.27 : 111.07
Barium	TM152	**106.17** 95.20 : 110.50	**104.83** 91.84 : 114.42
Beryllium	TM152	**107.5** 96.85 : 112.45	**105.33** 94.83 : 116.93
Bismuth	TM152	**106.83** 97.83 : 111.23	**105.17** 95.88 : 111.08
Borate	TM152	**108.64** 88.00 : 112.00	
Boron	TM152	**108.33** 92.57 : 115.00	**111.0** 92.42 : 121.06

Dissolved Metals by ICP-MS

		QC 3117	QC 3106
Cadmium	TM152	**107.0** 97.48 : 110.88	**104.83** 95.98 : 111.88
Calcium	TM152	**105.33** 97.68 : 109.38	**103.33** 96.22 : 109.10
Chromium	TM152	**101.33** 96.27 : 109.04	**100.83** 95.22 : 109.76
Cobalt	TM152	**100.83** 92.39 : 111.11	**101.17** 94.47 : 110.94
Copper	TM152	**101.83** 97.35 : 110.57	**100.5** 94.81 : 112.13
Iron	TM152	**100.67** 97.26 : 109.03	**101.33** 95.43 : 109.98
Lead	TM152	**101.83** 94.28 : 110.83	**105.0** 95.87 : 112.11
Lithium	TM152	**106.83** 93.83 : 112.33	**104.83** 93.93 : 115.73
Magnesium	TM152	**100.67** 95.15 : 108.57	**101.33** 93.91 : 108.37
Manganese	TM152	**101.83** 97.38 : 109.22	**101.17** 95.66 : 110.12
Molybdenum	TM152	**101.67** 96.03 : 108.83	**101.83** 93.76 : 109.43
Nickel	TM152	**100.67** 97.74 : 109.83	**100.5** 95.01 : 111.19
Phosphorus	TM152	**104.67** 96.19 : 110.42	**100.67** 93.82 : 109.72
Potassium	TM152	**103.33** 97.69 : 109.01	**102.67** 95.38 : 108.95
Selenium	TM152	**103.33** 97.20 : 112.90	**104.17** 94.20 : 113.10
Silver	TM152	**102.5** 92.98 : 113.08	**101.5** 94.95 : 112.75
Sodium	TM152	**100.67** 94.87 : 108.38	**100.67** 92.99 : 108.70
Strontium	TM152	**103.67** 98.04 : 109.54	**103.0** 95.55 : 111.45
Tellurium	TM152	**107.33** 96.08 : 114.68	**107.17** 95.38 : 114.78
Thallium	TM152	**94.83** 77.38 : 126.18	**96.17** 75.83 : 123.93
Tin	TM152	**103.67** 94.83 : 110.56	**105.33** 96.86 : 110.37
Titanium	TM152	**101.17** 95.20 : 111.60	**104.83** 95.88 : 112.88
Tungsten	TM152	**104.83** 93.93 : 109.73	**104.5** 95.38 : 109.38
Uranium	TM152	**107.67** 93.52 : 111.02	**104.33** 95.05 : 110.65
Vanadium	TM152	**102.5** 93.39 : 111.02	**103.83** 93.43 : 110.79
Zinc	TM152	**103.33** 98.01 : 111.94	**103.33** 95.71 : 112.92

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3176
Free Cyanide - Low Level	TM279	**108.0** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**105.5** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3190
Mercury Dissolved (CVAF)	TM183	**82.0** 74.00 : 116.00

pH Value

Component	Method Code	QC 3153	QC 3161	QC 3157
Alk QC	TM256	**102.26** 95.60 : 104.93	**100.89** 95.60 : 104.93	**101.33** 95.60 : 104.93
EC QC	TM256	**103.96** 102.40 : 109.21	**104.37** 102.40 : 109.21	**104.37** 102.40 : 109.21
pH	TM256	**100.0** 98.26 : 103.07	**100.8** 98.26 : 103.07	**100.4** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3140	QC 3161
Phosphate (Ortho as PO4)	TM184	**102.0** 98.80 : 106.00	**103.2** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3164	QC 3159
Total Suspended Solids	TM022	**101.33** 94.28 : 106.07	**102.39** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3199
Aluminium	TM152	**106.67** 94.84 : 115.96
Antimony	TM152	**105.33** 96.45 : 113.65
Arsenic	TM152	**103.0** 95.62 : 113.52
Barium	TM152	**106.83** 92.82 : 115.88

Total Metals by ICP-MS

		QC 3199
Beryllium	TM152	**108.5** 94.17 : 119.27
Bismuth	TM152	**107.17** 95.43 : 114.33
Boron	TM152	**113.33** 90.50 : 124.05
Cadmium	TM152	**105.5** 95.83 : 114.63
Calcium	TM152	**104.0** 95.58 : 111.65
Chromium	TM152	**100.83** 95.53 : 111.72
Cobalt	TM152	**100.33** 94.51 : 113.34
Copper	TM152	**101.0** 95.21 : 114.14
Iron	TM152	**101.33** 95.43 : 112.35
Lead	TM152	**107.17** 96.24 : 114.78
Lithium	TM152	**107.67** 92.20 : 118.90
Magnesium	TM152	**102.67** 92.81 : 111.36
Manganese	TM152	**102.0** 95.44 : 112.83
Molybdenum	TM152	**102.0** 94.01 : 111.95
Nickel	TM152	**101.0** 95.20 : 113.35
Phosphorus	TM152	**100.33** 93.52 : 112.60
Potassium	TM152	**104.0** 94.95 : 112.01
Selenium	TM152	**106.0** 94.42 : 115.72
Silver	TM152	**102.83** 95.57 : 114.47
Sodium	TM152	**102.0** 92.16 : 111.44
Strontium	TM152	**105.33** 96.40 : 113.75
Tellurium	TM152	**109.17** 96.40 : 116.80
Thallium	TM152	**98.67** 77.82 : 118.92
Tin	TM152	**107.0** 97.32 : 112.45
Titanium	TM152	**105.33** 95.67 : 114.57
Uranium	TM152	**106.5** 95.20 : 112.90
Vanadium	TM152	**104.0** 93.73 : 113.12

Total Metals by ICP-MS

		QC 3199
Zinc	TM152	**105.0** 96.64 : 114.64

Total Nitrogen

Component	Method Code	QC 3111	QC 3196	QC 3199
Total Nitrogen	TM212	**88.34** 86.08 : 109.68	**86.69** 86.08 : 109.68	**88.85** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	05 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250226-20
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758123
Order Number:	55778

We received 1 sample on Tuesday February 25, 2025 and 1 of these samples were scheduled for analysis which was completed on Wednesday March 05, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:



Justin Keeton
Business Unit Leader - Land

1291

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31127573	SZC TCA PT		39.00 - 39.00	21/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250226-20 **Report Number:** 758123 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31127573					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250226-20 **Report Number:** 758123 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4+§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.					
			SZC TCA PT					
Depth (m)			39.00 - 39.00					
Sample Type			Ground Water (GW)					
Date Sampled			21/02/2025					
Sample Time			08:00:00					
Date Received			25/02/2025					
SDG Ref			250226-20					
Lab Sample No.(s)			31127573					
AGS Reference								
Suspended solids, Total	<2 mg/l	TM022	4.3 #					
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	<0.01 #					
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	<0.01 #					
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.87 #					
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #					
Boron (diss.filt)	<10 µg/l	TM152	32.6 #					
Boron (tot.unfilt)	<20 µg/l	TM152	28.9 #					
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #					
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #					
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #					
Chromium (diss.filt)	<1 µg/l	TM152	<1 #					
Copper (tot.unfilt)	<1 µg/l	TM152	1.57 #					
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #					
Copper (diss.filt)	<0.3 µg/l	TM152	0.393 #					
Manganese (tot.unfilt)	<1 µg/l	TM152	181 #					
Lead (diss.filt)	<0.2 µg/l	TM152	<0.2 #					
Nickel (tot.unfilt)	<1 µg/l	TM152	1.82 #					
Manganese (diss.filt)	<3 µg/l	TM152	184 #					
Nickel (diss.filt)	<0.4 µg/l	TM152	1.66 #					
Phosphorus (diss.filt)	<10 µg/l	TM152	14.2 #					
Zinc (tot.unfilt)	<5 µg/l	TM152	7.4 #					
Zinc (diss.filt)	<1 µg/l	TM152	8.76 #					
Sodium (Dis.Filt)	<0.076 mg/l	TM152	23.8 #					
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	9.73 #					
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.16 #					
Calcium (Dis.Filt)	<0.2 mg/l	TM152	178 #					
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.09 #					
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	21.3 #					
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	8.72 #					
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.04 #					
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	167 #					
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.04 #					
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #					

CERTIFICATE OF ANALYSIS

SDG: 250226-20 **Report Number:** 758123 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4	Sample deviation (see appendix)
§	
@	

Component	LOD/Units	Method	Customer Sample Ref.	Depth (m)	Sample Type	Date Sampled	Sample Time	Date Received	SDG Ref	Lab Sample No.(s)	AGS Reference
			SZC TCA PT	39.00 - 39.00	Ground Water (GW)	21/02/2025	08:00:00	25/02/2025	250226-20	31127573	
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #								
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	6.98 #								
Nitrogen, Total	<1 mg/l	TM212	7.45 #								
Chloride	<0.08 mg/l	TM226	60.5 #								
Nitrite as N	<0.01 mg/l	TM226	0.0173 @ #								
Nitrate as N	<0.02 mg/l	TM226	6.87 #								
Sulphate as S	<0.04 mg/l	TM226	28 #								
pH	<1 pH Units	TM256	7.49 #								
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.899 #								
Alkalinity, Total as CaCO3	<3 mg/l	TM256	327 #								
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 @ #								

Table of Results - Appendix

Method No	Description
TM226	Determination of Anions in Waters using Ion Chromatography
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250226-20 **Report Number:** 758123 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31127573
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	02-Mar-2025
Anions by ion Chromatography	03-Mar-2025
Anions by Kone (w)	28-Feb-2025
Dissolved Metals by ICP-MS	04-Mar-2025
Low Level Cyanide (W)	05-Mar-2025
Mercury Dissolved	05-Mar-2025
pH Value	03-Mar-2025
Phosphate by Kone (w)	28-Feb-2025
Suspended Solids	05-Mar-2025
Total Metals by ICP-MS	03-Mar-2025
Total Nitrogen	05-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3127
Ammoniacal Nitrogen as N	TM099	**100.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3149
Bromide (W)	TM226	**99.17** 95.10 : 103.12
Chloride (W)	TM226	**100.65** 97.34 : 104.29
Fluoride (W)	TM226	**100.0** 96.73 : 103.12
Nitrate (W)	TM226	**99.17** 96.03 : 104.08
Nitrite (W)	TM226	**100.0** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**100.62** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3140
Sulphate (soluble)	TM184	**100.8** 94.30 : 107.93
TON as NO3	TM184	**100.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3151	QC 3114
Aluminium	TM152	**108.0** 96.29 : 111.36	**104.0** 95.24 : 111.40
Antimony	TM152	**107.67** 95.87 : 111.07	**104.67** 94.33 : 112.23
Arsenic	TM152	**102.17** 97.55 : 110.65	**104.5** 94.83 : 110.43
Barium	TM152	**107.33** 95.20 : 110.50	**100.83** 93.82 : 113.06
Beryllium	TM152	**110.5** 96.85 : 112.45	**105.0** 94.87 : 113.47
Bismuth	TM152	**109.0** 97.83 : 111.23	**104.0** 95.28 : 111.68
Borate	TM152	**118.52** 88.00 : 112.00	**105.56** 88.00 : 112.00
Boron	TM152	**118.33** 92.57 : 115.00	**105.33** 91.82 : 118.71

Dissolved Metals by ICP-MS

		QC 3151	QC 3114
Cadmium	TM152	**107.17** 97.48 : 110.88	**106.67** 93.90 : 112.50
Calcium	TM152	**106.67** 97.68 : 109.38	**102.67** 94.54 : 110.75
Chromium	TM152	**102.17** 96.27 : 109.04	**104.67** 94.18 : 109.80
Cobalt	TM152	**102.33** 92.39 : 111.11	**105.67** 93.95 : 109.53
Copper	TM152	**102.17** 97.35 : 110.57	**106.17** 93.88 : 110.94
Iron	TM152	**102.67** 97.26 : 109.03	**104.67** 95.31 : 109.92
Lead	TM152	**105.5** 94.28 : 110.83	**101.67** 94.24 : 111.99
Lithium	TM152	**109.33** 93.83 : 112.33	**104.83** 94.28 : 113.28
Magnesium	TM152	**105.33** 95.15 : 108.57	**102.67** 93.45 : 108.63
Manganese	TM152	**103.33** 97.38 : 109.22	**105.17** 95.81 : 110.44
Molybdenum	TM152	**103.17** 96.03 : 108.83	**105.67** 93.46 : 109.15
Nickel	TM152	**101.33** 97.74 : 109.83	**106.0** 92.80 : 111.23
Phosphorus	TM152	**106.83** 96.19 : 110.42	**102.17** 93.78 : 110.72
Potassium	TM152	**106.0** 97.69 : 109.01	**102.0** 95.43 : 111.23
Selenium	TM152	**108.17** 97.20 : 112.90	**103.5** 94.10 : 113.00
Silver	TM152	**102.67** 92.98 : 113.08	**105.17** 91.22 : 112.22
Sodium	TM152	**105.33** 94.87 : 108.38	**102.0** 93.17 : 108.57
Strontium	TM152	**105.33** 98.04 : 109.54	**103.33** 95.28 : 111.33
Tellurium	TM152	**108.33** 96.08 : 114.68	**106.83** 95.60 : 115.20
Thallium	TM152	**97.17** 77.38 : 126.18	**105.33** 73.68 : 123.18
Tin	TM152	**106.33** 94.83 : 110.56	**105.5** 93.06 : 109.94
Titanium	TM152	**107.67** 95.20 : 111.60	**105.0** 94.67 : 110.97
Tungsten	TM152	**104.33** 93.93 : 109.73	**100.67** 93.55 : 109.35
Uranium	TM152	**109.17** 93.52 : 111.02	**103.83** 93.98 : 110.48
Vanadium	TM152	**103.5** 93.39 : 111.02	**101.5** 92.88 : 110.53
Zinc	TM152	**104.33** 98.01 : 111.94	**106.33** 96.14 : 111.23

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3199
Free Cyanide - Low Level	TM279	**109.33** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**104.0** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3141
Mercury Dissolved (CVAF)	TM183	**91.7** 67.00 : 121.00

pH Value

Component	Method Code	QC 3176
Alk QC	TM256	**101.49** 95.60 : 104.93
EC QC	TM256	**104.51** 102.40 : 109.21
pH	TM256	**99.73** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3175
Phosphate (Ortho as PO4)	TM184	**101.6** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3179
Total Suspended Solids	TM022	**100.8** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3159
Aluminium	TM152	**106.0** 94.84 : 115.96
Antimony	TM152	**105.5** 96.45 : 113.65
Arsenic	TM152	**103.0** 95.62 : 113.52
Barium	TM152	**105.17** 92.82 : 115.88

Total Metals by ICP-MS

		QC 3159
Beryllium	TM152	**107.67** 94.17 : 119.27
Bismuth	TM152	**104.0** 95.43 : 114.33
Boron	TM152	**116.0** 90.50 : 124.05
Cadmium	TM152	**107.5** 95.83 : 114.63
Calcium	TM152	**101.33** 95.58 : 111.65
Chromium	TM152	**101.83** 95.53 : 111.72
Cobalt	TM152	**101.5** 94.51 : 113.34
Copper	TM152	**102.0** 95.21 : 114.14
Iron	TM152	**101.33** 95.43 : 112.35
Lead	TM152	**105.0** 96.24 : 114.78
Lithium	TM152	**104.33** 92.20 : 118.90
Magnesium	TM152	**100.67** 92.81 : 111.36
Manganese	TM152	**101.83** 95.44 : 112.83
Molybdenum	TM152	**103.0** 94.01 : 111.95
Nickel	TM152	**101.33** 95.20 : 113.35
Phosphorus	TM152	**99.17** 93.52 : 112.60
Potassium	TM152	**102.0** 94.95 : 112.01
Selenium	TM152	**105.17** 94.42 : 115.72
Silver	TM152	**102.5** 95.57 : 114.47
Sodium	TM152	**100.0** 92.16 : 111.44
Strontium	TM152	**104.0** 96.40 : 113.75
Tellurium	TM152	**108.67** 96.40 : 116.80
Thallium	TM152	**96.0** 77.82 : 118.92
Tin	TM152	**105.83** 97.32 : 112.45
Titanium	TM152	**105.5** 95.67 : 114.57
Uranium	TM152	**104.67** 95.20 : 112.90
Vanadium	TM152	**105.0** 93.73 : 113.12

Total Metals by ICP-MS

		QC 3159
Zinc	TM152	**104.33** 96.64 : 114.64

Total Nitrogen

Component	Method Code	QC 3181
Total Nitrogen	TM212	**90.87** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	06 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250226-21
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758160
Order Number:	55778

We received 1 sample on Tuesday February 25, 2025 and 1 of these samples were scheduled for analysis which was completed on Thursday March 06, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:



Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250226-21 **Report Number:** 758160 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31127595	SZC TCA PT		39.00 - 39.00	21/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250226-21 **Report Number:** 758160 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31127595					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250226-21 **Report Number:** 758160 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.					
			SZC TCA PT					
			Depth (m)	39.00 - 39.00				
			Sample Type	Ground Water (GW)				
			Date Sampled	21/02/2025				
			Sample Time	17:00:00				
			Date Received	25/02/2025				
			SDG Ref	250226-21				
			Lab Sample No.(s)	31127595				
			AGS Reference					
Suspended solids, Total	<2 mg/l	TM022	4.6 #					
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	0.01 #					
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	0.0129 #					
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.79 #					
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #					
Boron (diss.filt)	<10 µg/l	TM152	30.4 #					
Boron (tot.unfilt)	<20 µg/l	TM152	34.9 #					
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #					
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #					
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #					
Chromium (diss.filt)	<1 µg/l	TM152	<1 #					
Copper (tot.unfilt)	<1 µg/l	TM152	2.5 #					
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #					
Copper (diss.filt)	<0.3 µg/l	TM152	1.68 #					
Manganese (tot.unfilt)	<1 µg/l	TM152	182 #					
Lead (diss.filt)	<0.2 µg/l	TM152	0.432 #					
Nickel (tot.unfilt)	<1 µg/l	TM152	2.23 #					
Manganese (diss.filt)	<3 µg/l	TM152	179 #					
Nickel (diss.filt)	<0.4 µg/l	TM152	2.18 #					
Phosphorus (diss.filt)	<10 µg/l	TM152	10.6 #					
Zinc (tot.unfilt)	<5 µg/l	TM152	12.9 #					
Zinc (diss.filt)	<1 µg/l	TM152	29.6 #					
Sodium (Dis.Filt)	<0.076 mg/l	TM152	23.2 #					
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	9.57 #					
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.19 #					
Calcium (Dis.Filt)	<0.2 mg/l	TM152	174 #					
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.27 #					
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	21.8 #					
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	8.78 #					
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.08 #					
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	168 #					
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.24 #					
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #					

CERTIFICATE OF ANALYSIS

SDG: 250226-21 **Report Number:** 758160 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4+§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref. SZC TCA PT				
			Depth (m) 39.00 - 39.00				
			Sample Type Ground Water (GW)				
			Date Sampled 21/02/2025				
			Sample Time 17:00:00				
			Date Received 25/02/2025				
			SDG Ref 250226-21				
			Lab Sample No.(s) 31127595				
			AGS Reference				
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #				
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	6.99 #				
Nitrogen, Total	<1 mg/l	TM212	7.39 #				
Chloride	<0.08 mg/l	TM226	60.4 #				
Nitrite as N	<0.01 mg/l	TM226	<0.01 @ #				
Nitrate as N	<0.02 mg/l	TM226	6.89 #				
Sulphate as S	<0.04 mg/l	TM226	28.1 #				
pH	<1 pH Units	TM256	7.59 #				
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.898 #				
Alkalinity, Total as CaCO3	<3 mg/l	TM256	329 #				
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #				

Table of Results - Appendix

Method No	Description
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM226	Determination of Anions in Waters using Ion Chromatography
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250226-21 **Report Number:** 758160 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31127595
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	02-Mar-2025
Anions by ion Chromatography	03-Mar-2025
Anions by Kone (w)	28-Feb-2025
Dissolved Metals by ICP-MS	04-Mar-2025
Low Level Cyanide (W)	03-Mar-2025
Mercury Dissolved	06-Mar-2025
pH Value	03-Mar-2025
Phosphate by Kone (w)	28-Feb-2025
Suspended Solids	05-Mar-2025
Total Metals by ICP-MS	03-Mar-2025
Total Nitrogen	05-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3127
Ammoniacal Nitrogen as N	TM099	**100.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3149
Bromide (W)	TM226	**99.17** 95.10 : 103.12
Chloride (W)	TM226	**100.65** 97.34 : 104.29
Fluoride (W)	TM226	**100.0** 96.73 : 103.12
Nitrate (W)	TM226	**99.17** 96.03 : 104.08
Nitrite (W)	TM226	**100.0** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**100.62** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3140
Sulphate (soluble)	TM184	**100.8** 94.30 : 107.93
TON as NO3	TM184	**100.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3151	QC 3114
Aluminium	TM152	**108.0** 96.29 : 111.36	**104.0** 95.24 : 111.40
Antimony	TM152	**107.67** 95.87 : 111.07	**104.67** 94.33 : 112.23
Arsenic	TM152	**102.17** 97.55 : 110.65	**104.5** 94.83 : 110.43
Barium	TM152	**107.33** 95.20 : 110.50	**100.83** 93.82 : 113.06
Beryllium	TM152	**110.5** 96.85 : 112.45	**105.0** 94.87 : 113.47
Bismuth	TM152	**109.0** 97.83 : 111.23	**104.0** 95.28 : 111.68
Borate	TM152	**118.52** 88.00 : 112.00	**105.56** 88.00 : 112.00
Boron	TM152	**118.33** 92.57 : 115.00	**105.33** 91.82 : 118.71

Dissolved Metals by ICP-MS

		QC 3151	QC 3114
Cadmium	TM152	**107.17** 97.48 : 110.88	**106.67** 93.90 : 112.50
Calcium	TM152	**106.67** 97.68 : 109.38	**102.67** 94.54 : 110.75
Chromium	TM152	**102.17** 96.27 : 109.04	**104.67** 94.18 : 109.80
Cobalt	TM152	**102.33** 92.39 : 111.11	**105.67** 93.95 : 109.53
Copper	TM152	**102.17** 97.35 : 110.57	**106.17** 93.88 : 110.94
Iron	TM152	**102.67** 97.26 : 109.03	**104.67** 95.31 : 109.92
Lead	TM152	**105.5** 94.28 : 110.83	**101.67** 94.24 : 111.99
Lithium	TM152	**109.33** 93.83 : 112.33	**104.83** 94.28 : 113.28
Magnesium	TM152	**105.33** 95.15 : 108.57	**102.67** 93.45 : 108.63
Manganese	TM152	**103.33** 97.38 : 109.22	**105.17** 95.81 : 110.44
Molybdenum	TM152	**103.17** 96.03 : 108.83	**105.67** 93.46 : 109.15
Nickel	TM152	**101.33** 97.74 : 109.83	**106.0** 92.80 : 111.23
Phosphorus	TM152	**106.83** 96.19 : 110.42	**102.17** 93.78 : 110.72
Potassium	TM152	**106.0** 97.69 : 109.01	**102.0** 95.43 : 111.23
Selenium	TM152	**108.17** 97.20 : 112.90	**103.5** 94.10 : 113.00
Silver	TM152	**102.67** 92.98 : 113.08	**105.17** 91.22 : 112.22
Sodium	TM152	**105.33** 94.87 : 108.38	**102.0** 93.17 : 108.57
Strontium	TM152	**105.33** 98.04 : 109.54	**103.33** 95.28 : 111.33
Tellurium	TM152	**108.33** 96.08 : 114.68	**106.83** 95.60 : 115.20
Thallium	TM152	**97.17** 77.38 : 126.18	**105.33** 73.68 : 123.18
Tin	TM152	**106.33** 94.83 : 110.56	**105.5** 93.06 : 109.94
Titanium	TM152	**107.67** 95.20 : 111.60	**105.0** 94.67 : 110.97
Tungsten	TM152	**104.33** 93.93 : 109.73	**100.67** 93.55 : 109.35
Uranium	TM152	**109.17** 93.52 : 111.02	**103.83** 93.98 : 110.48
Vanadium	TM152	**103.5** 93.39 : 111.02	**101.5** 92.88 : 110.53
Zinc	TM152	**104.33** 98.01 : 111.94	**106.33** 96.14 : 111.23

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3176
Free Cyanide - Low Level	TM279	**108.0** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**105.5** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3149
Mercury Dissolved (CVAF)	TM183	**84.0** 67.00 : 121.00

pH Value

Component	Method Code	QC 3184
Alk QC	TM256	**100.53** 95.60 : 104.93
EC QC	TM256	**104.65** 102.40 : 109.21
pH	TM256	**100.67** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3175
Phosphate (Ortho as PO4)	TM184	**101.6** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3179
Total Suspended Solids	TM022	**100.8** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3159
Aluminium	TM152	**106.0** 94.84 : 115.96
Antimony	TM152	**105.5** 96.45 : 113.65
Arsenic	TM152	**103.0** 95.62 : 113.52
Barium	TM152	**105.17** 92.82 : 115.88

Total Metals by ICP-MS

		QC 3159
Beryllium	TM152	**107.67** 94.17 : 119.27
Bismuth	TM152	**104.0** 95.43 : 114.33
Boron	TM152	**116.0** 90.50 : 124.05
Cadmium	TM152	**107.5** 95.83 : 114.63
Calcium	TM152	**101.33** 95.58 : 111.65
Chromium	TM152	**101.83** 95.53 : 111.72
Cobalt	TM152	**101.5** 94.51 : 113.34
Copper	TM152	**102.0** 95.21 : 114.14
Iron	TM152	**101.33** 95.43 : 112.35
Lead	TM152	**105.0** 96.24 : 114.78
Lithium	TM152	**104.33** 92.20 : 118.90
Magnesium	TM152	**100.67** 92.81 : 111.36
Manganese	TM152	**101.83** 95.44 : 112.83
Molybdenum	TM152	**103.0** 94.01 : 111.95
Nickel	TM152	**101.33** 95.20 : 113.35
Phosphorus	TM152	**99.17** 93.52 : 112.60
Potassium	TM152	**102.0** 94.95 : 112.01
Selenium	TM152	**105.17** 94.42 : 115.72
Silver	TM152	**102.5** 95.57 : 114.47
Sodium	TM152	**100.0** 92.16 : 111.44
Strontium	TM152	**104.0** 96.40 : 113.75
Tellurium	TM152	**108.67** 96.40 : 116.80
Thallium	TM152	**96.0** 77.82 : 118.92
Tin	TM152	**105.83** 97.32 : 112.45
Titanium	TM152	**105.5** 95.67 : 114.57
Uranium	TM152	**104.67** 95.20 : 112.90
Vanadium	TM152	**105.0** 93.73 : 113.12

Total Metals by ICP-MS

		QC 3159
Zinc	TM152	**104.33** 96.64 : 114.64

Total Nitrogen

Component	Method Code	QC 3181
Total Nitrogen	TM212	**90.87** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	06 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250226-22
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758161
Order Number:	55778

We received 1 sample on Tuesday February 25, 2025 and 1 of these samples were scheduled for analysis which was completed on Thursday March 06, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:



Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250226-22 **Report Number:** 758161 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31127601	SZC TCA PT		39.00 - 39.00	22/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250226-22 **Report Number:** 758161 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31127601					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250226-22 **Report Number:** 758161 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref. / Depth (m) / Sample Type / Date Sampled / Sample Time / Date Received / SDG Ref / Lab Sample No.(s) / AGS Reference					
			SZC TCA PT 39.00 - 39.00 Ground Water (GW) 22/02/2025 08:00:00 25/02/2025 250226-22 31127601					
Suspended solids, Total	<2 mg/l	TM022	7.1 #					
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	0.027 #					
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	0.0347 #					
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.7 #					
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #					
Boron (diss.filt)	<10 µg/l	TM152	28.9 #					
Boron (tot.unfilt)	<20 µg/l	TM152	27.8 #					
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #					
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #					
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #					
Chromium (diss.filt)	<1 µg/l	TM152	<1 #					
Copper (tot.unfilt)	<1 µg/l	TM152	<1 #					
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #					
Copper (diss.filt)	<0.3 µg/l	TM152	<0.3 #					
Manganese (tot.unfilt)	<1 µg/l	TM152	171 #					
Lead (diss.filt)	<0.2 µg/l	TM152	<0.2 #					
Nickel (tot.unfilt)	<1 µg/l	TM152	2.7 #					
Manganese (diss.filt)	<3 µg/l	TM152	171 #					
Nickel (diss.filt)	<0.4 µg/l	TM152	2.66 #					
Phosphorus (diss.filt)	<10 µg/l	TM152	16.7 #					
Zinc (tot.unfilt)	<5 µg/l	TM152	8.24 #					
Zinc (diss.filt)	<1 µg/l	TM152	8.05 #					
Sodium (Dis.Filt)	<0.076 mg/l	TM152	23.4 #					
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	9.67 #					
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.15 #					
Calcium (Dis.Filt)	<0.2 mg/l	TM152	178 #					
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.53 #					
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	21.3 #					
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	8.64 #					
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.05 #					
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	167 #					
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.51 #					
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #					

CERTIFICATE OF ANALYSIS

SDG: 250226-22 **Report Number:** 758161 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4+§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	Depth (m)	Sample Type	Date Sampled	Sample Time	Date Received	SDG Ref	Lab Sample No.(s)	AGS Reference
			SZC TCA PT	39.00 - 39.00	Ground Water (GW)	22/02/2025	08:00:00	25/02/2025	250226-22	31127601	
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #								
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.28 #								
Nitrogen, Total	<1 mg/l	TM212	7.56 #								
Chloride	<0.08 mg/l	TM226	60.4 #								
Nitrite as N	<0.01 mg/l	TM226	<0.01 @ #								
Nitrate as N	<0.02 mg/l	TM226	7.01 #								
Sulphate as S	<0.04 mg/l	TM226	28.3 #								
pH	<1 pH Units	TM256	7.5 #								
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.894 #								
Alkalinity, Total as CaCO3	<3 mg/l	TM256	329 #								
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 @ #								

Table of Results - Appendix

Method No	Description
TM226	Determination of Anions in Waters using Ion Chromatography
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250226-22 **Report Number:** 758161 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31127601
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	02-Mar-2025
Anions by ion Chromatography	03-Mar-2025
Anions by Kone (w)	28-Feb-2025
Dissolved Metals by ICP-MS	04-Mar-2025
Low Level Cyanide (W)	05-Mar-2025
Mercury Dissolved	06-Mar-2025
pH Value	03-Mar-2025
Phosphate by Kone (w)	28-Feb-2025
Suspended Solids	05-Mar-2025
Total Metals by ICP-MS	03-Mar-2025
Total Nitrogen	05-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3127
Ammoniacal Nitrogen as N	TM099	**100.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3149
Bromide (W)	TM226	**99.17** 95.10 : 103.12
Chloride (W)	TM226	**100.65** 97.34 : 104.29
Fluoride (W)	TM226	**100.0** 96.73 : 103.12
Nitrate (W)	TM226	**99.17** 96.03 : 104.08
Nitrite (W)	TM226	**100.0** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**100.62** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3140
Sulphate (soluble)	TM184	**100.8** 94.30 : 107.93
TON as NO3	TM184	**100.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3151	QC 3114
Aluminium	TM152	**108.0** 96.29 : 111.36	**104.0** 95.24 : 111.40
Antimony	TM152	**107.67** 95.87 : 111.07	**104.67** 94.33 : 112.23
Arsenic	TM152	**102.17** 97.55 : 110.65	**104.5** 94.83 : 110.43
Barium	TM152	**107.33** 95.20 : 110.50	**100.83** 93.82 : 113.06
Beryllium	TM152	**110.5** 96.85 : 112.45	**105.0** 94.87 : 113.47
Bismuth	TM152	**109.0** 97.83 : 111.23	**104.0** 95.28 : 111.68
Borate	TM152	**118.52** 88.00 : 112.00	**105.56** 88.00 : 112.00
Boron	TM152	**118.33** 92.57 : 115.00	**105.33** 91.82 : 118.71

Dissolved Metals by ICP-MS

		QC 3151	QC 3114
Cadmium	TM152	**107.17** 97.48 : 110.88	**106.67** 93.90 : 112.50
Calcium	TM152	**106.67** 97.68 : 109.38	**102.67** 94.54 : 110.75
Chromium	TM152	**102.17** 96.27 : 109.04	**104.67** 94.18 : 109.80
Cobalt	TM152	**102.33** 92.39 : 111.11	**105.67** 93.95 : 109.53
Copper	TM152	**102.17** 97.35 : 110.57	**106.17** 93.88 : 110.94
Iron	TM152	**102.67** 97.26 : 109.03	**104.67** 95.31 : 109.92
Lead	TM152	**105.5** 94.28 : 110.83	**101.67** 94.24 : 111.99
Lithium	TM152	**109.33** 93.83 : 112.33	**104.83** 94.28 : 113.28
Magnesium	TM152	**105.33** 95.15 : 108.57	**102.67** 93.45 : 108.63
Manganese	TM152	**103.33** 97.38 : 109.22	**105.17** 95.81 : 110.44
Molybdenum	TM152	**103.17** 96.03 : 108.83	**105.67** 93.46 : 109.15
Nickel	TM152	**101.33** 97.74 : 109.83	**106.0** 92.80 : 111.23
Phosphorus	TM152	**106.83** 96.19 : 110.42	**102.17** 93.78 : 110.72
Potassium	TM152	**106.0** 97.69 : 109.01	**102.0** 95.43 : 111.23
Selenium	TM152	**108.17** 97.20 : 112.90	**103.5** 94.10 : 113.00
Silver	TM152	**102.67** 92.98 : 113.08	**105.17** 91.22 : 112.22
Sodium	TM152	**105.33** 94.87 : 108.38	**102.0** 93.17 : 108.57
Strontium	TM152	**105.33** 98.04 : 109.54	**103.33** 95.28 : 111.33
Tellurium	TM152	**108.33** 96.08 : 114.68	**106.83** 95.60 : 115.20
Thallium	TM152	**97.17** 77.38 : 126.18	**105.33** 73.68 : 123.18
Tin	TM152	**106.33** 94.83 : 110.56	**105.5** 93.06 : 109.94
Titanium	TM152	**107.67** 95.20 : 111.60	**105.0** 94.67 : 110.97
Tungsten	TM152	**104.33** 93.93 : 109.73	**100.67** 93.55 : 109.35
Uranium	TM152	**109.17** 93.52 : 111.02	**103.83** 93.98 : 110.48
Vanadium	TM152	**103.5** 93.39 : 111.02	**101.5** 92.88 : 110.53
Zinc	TM152	**104.33** 98.01 : 111.94	**106.33** 96.14 : 111.23

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3199
Free Cyanide - Low Level	TM279	**109.33** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**104.0** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3149
Mercury Dissolved (CVAF)	TM183	**84.0** 67.00 : 121.00

pH Value

Component	Method Code	QC 3184
Alk QC	TM256	**100.53** 95.60 : 104.93
EC QC	TM256	**104.65** 102.40 : 109.21
pH	TM256	**100.67** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3175
Phosphate (Ortho as PO4)	TM184	**101.6** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3179
Total Suspended Solids	TM022	**100.8** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3159
Aluminium	TM152	**106.0** 94.84 : 115.96
Antimony	TM152	**105.5** 96.45 : 113.65
Arsenic	TM152	**103.0** 95.62 : 113.52
Barium	TM152	**105.17** 92.82 : 115.88

Total Metals by ICP-MS

		QC 3159
Beryllium	TM152	**107.67** 94.17 : 119.27
Bismuth	TM152	**104.0** 95.43 : 114.33
Boron	TM152	**116.0** 90.50 : 124.05
Cadmium	TM152	**107.5** 95.83 : 114.63
Calcium	TM152	**101.33** 95.58 : 111.65
Chromium	TM152	**101.83** 95.53 : 111.72
Cobalt	TM152	**101.5** 94.51 : 113.34
Copper	TM152	**102.0** 95.21 : 114.14
Iron	TM152	**101.33** 95.43 : 112.35
Lead	TM152	**105.0** 96.24 : 114.78
Lithium	TM152	**104.33** 92.20 : 118.90
Magnesium	TM152	**100.67** 92.81 : 111.36
Manganese	TM152	**101.83** 95.44 : 112.83
Molybdenum	TM152	**103.0** 94.01 : 111.95
Nickel	TM152	**101.33** 95.20 : 113.35
Phosphorus	TM152	**99.17** 93.52 : 112.60
Potassium	TM152	**102.0** 94.95 : 112.01
Selenium	TM152	**105.17** 94.42 : 115.72
Silver	TM152	**102.5** 95.57 : 114.47
Sodium	TM152	**100.0** 92.16 : 111.44
Strontium	TM152	**104.0** 96.40 : 113.75
Tellurium	TM152	**108.67** 96.40 : 116.80
Thallium	TM152	**96.0** 77.82 : 118.92
Tin	TM152	**105.83** 97.32 : 112.45
Titanium	TM152	**105.5** 95.67 : 114.57
Uranium	TM152	**104.67** 95.20 : 112.90
Vanadium	TM152	**105.0** 93.73 : 113.12

Total Metals by ICP-MS

		QC 3159
Zinc	TM152	**104.33** 96.64 : 114.64

Total Nitrogen

Component	Method Code	QC 3181
Total Nitrogen	TM212	**90.87** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	06 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250226-23
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758162
Order Number:	55778

We received 1 sample on Tuesday February 25, 2025 and 1 of these samples were scheduled for analysis which was completed on Thursday March 06, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:



Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250226-23 **Report Number:** 758162 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31127622	SZC TCA PT		39.00 - 39.00	22/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250226-23 **Report Number:** 758162 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31127622					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250226-23 **Report Number:** 758162 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.					
			SZC TCA PT					
Depth (m)			39.00 - 39.00					
Sample Type			Ground Water (GW)					
Date Sampled			22/02/2025					
Sample Time			17:00:00					
Date Received			25/02/2025					
SDG Ref			250226-23					
Lab Sample No.(s)			31127622					
AGS Reference								
Suspended solids, Total	<2 mg/l	TM022	5.05 #					
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	<0.01 #					
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	<0.01 #					
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.72 #					
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #					
Boron (diss.filt)	<10 µg/l	TM152	29.1 #					
Boron (tot.unfilt)	<20 µg/l	TM152	29.6 #					
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #					
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #					
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #					
Chromium (diss.filt)	<1 µg/l	TM152	<1 #					
Copper (tot.unfilt)	<1 µg/l	TM152	3.69 #					
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #					
Copper (diss.filt)	<0.3 µg/l	TM152	0.749 #					
Manganese (tot.unfilt)	<1 µg/l	TM152	169 #					
Lead (diss.filt)	<0.2 µg/l	TM152	0.209 #					
Nickel (tot.unfilt)	<1 µg/l	TM152	22.5 #					
Manganese (diss.filt)	<3 µg/l	TM152	167 #					
Nickel (diss.filt)	<0.4 µg/l	TM152	22.6 #					
Phosphorus (diss.filt)	<10 µg/l	TM152	19.6 #					
Zinc (tot.unfilt)	<5 µg/l	TM152	72.6 #					
Zinc (diss.filt)	<1 µg/l	TM152	73.2 #					
Sodium (Dis.Filt)	<0.076 mg/l	TM152	23.8 #					
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	9.82 #					
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.19 #					
Calcium (Dis.Filt)	<0.2 mg/l	TM152	176 #					
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.55 #					
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	21.4 #					
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	8.69 #					
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.06 #					
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	167 #					
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.56 #					
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #					

CERTIFICATE OF ANALYSIS

SDG: 250226-23 **Report Number:** 758162 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4+§@ Sample deviation (see appendix)

	Customer Sample Ref.	SZC TCA PT
	Depth (m)	39.00 - 39.00
	Sample Type	Ground Water (GW)
	Date Sampled	22/02/2025
	Sample Time	17:00:00
	Date Received	25/02/2025
	SDG Ref	250226-23
	Lab Sample No.(s)	31127622
	AGS Reference	

Component	LOD/Units	Method	
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.08 #
Nitrogen, Total	<1 mg/l	TM212	7.5 #
Chloride	<0.08 mg/l	TM226	60.6 #
Nitrite as N	<0.01 mg/l	TM226	<0.01 @ #
Nitrate as N	<0.02 mg/l	TM226	6.96 #
Sulphate as S	<0.04 mg/l	TM226	28.4 #
pH	<1 pH Units	TM256	7.46 #
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.898 #
Alkalinity, Total as CaCO3	<3 mg/l	TM256	329 #
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #

Table of Results - Appendix

Method No	Description
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM226	Determination of Anions in Waters using Ion Chromatography
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

Test Completion Dates

Lab Sample No(s)	31127622
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	02-Mar-2025
Anions by ion Chromatography	03-Mar-2025
Anions by Kone (w)	28-Feb-2025
Dissolved Metals by ICP-MS	04-Mar-2025
Low Level Cyanide (W)	03-Mar-2025
Mercury Dissolved	06-Mar-2025
pH Value	03-Mar-2025
Phosphate by Kone (w)	28-Feb-2025
Suspended Solids	05-Mar-2025
Total Metals by ICP-MS	03-Mar-2025
Total Nitrogen	05-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3127
Ammoniacal Nitrogen as N	TM099	**100.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3149
Bromide (W)	TM226	**99.17** 95.10 : 103.12
Chloride (W)	TM226	**100.65** 97.34 : 104.29
Fluoride (W)	TM226	**100.0** 96.73 : 103.12
Nitrate (W)	TM226	**99.17** 96.03 : 104.08
Nitrite (W)	TM226	**100.0** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**100.62** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3140
Sulphate (soluble)	TM184	**100.8** 94.30 : 107.93
TON as NO3	TM184	**100.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3151	QC 3114
Aluminium	TM152	**108.0** 96.29 : 111.36	**104.0** 95.24 : 111.40
Antimony	TM152	**107.67** 95.87 : 111.07	**104.67** 94.33 : 112.23
Arsenic	TM152	**102.17** 97.55 : 110.65	**104.5** 94.83 : 110.43
Barium	TM152	**107.33** 95.20 : 110.50	**100.83** 93.82 : 113.06
Beryllium	TM152	**110.5** 96.85 : 112.45	**105.0** 94.87 : 113.47
Bismuth	TM152	**109.0** 97.83 : 111.23	**104.0** 95.28 : 111.68
Borate	TM152	**118.52** 88.00 : 112.00	**105.56** 88.00 : 112.00
Boron	TM152	**118.33** 92.57 : 115.00	**105.33** 91.82 : 118.71

Dissolved Metals by ICP-MS

		QC 3151	QC 3114
Cadmium	TM152	**107.17** 97.48 : 110.88	**106.67** 93.90 : 112.50
Calcium	TM152	**106.67** 97.68 : 109.38	**102.67** 94.54 : 110.75
Chromium	TM152	**102.17** 96.27 : 109.04	**104.67** 94.18 : 109.80
Cobalt	TM152	**102.33** 92.39 : 111.11	**105.67** 93.95 : 109.53
Copper	TM152	**102.17** 97.35 : 110.57	**106.17** 93.88 : 110.94
Iron	TM152	**102.67** 97.26 : 109.03	**104.67** 95.31 : 109.92
Lead	TM152	**105.5** 94.28 : 110.83	**101.67** 94.24 : 111.99
Lithium	TM152	**109.33** 93.83 : 112.33	**104.83** 94.28 : 113.28
Magnesium	TM152	**105.33** 95.15 : 108.57	**102.67** 93.45 : 108.63
Manganese	TM152	**103.33** 97.38 : 109.22	**105.17** 95.81 : 110.44
Molybdenum	TM152	**103.17** 96.03 : 108.83	**105.67** 93.46 : 109.15
Nickel	TM152	**101.33** 97.74 : 109.83	**106.0** 92.80 : 111.23
Phosphorus	TM152	**106.83** 96.19 : 110.42	**102.17** 93.78 : 110.72
Potassium	TM152	**106.0** 97.69 : 109.01	**102.0** 95.43 : 111.23
Selenium	TM152	**108.17** 97.20 : 112.90	**103.5** 94.10 : 113.00
Silver	TM152	**102.67** 92.98 : 113.08	**105.17** 91.22 : 112.22
Sodium	TM152	**105.33** 94.87 : 108.38	**102.0** 93.17 : 108.57
Strontium	TM152	**105.33** 98.04 : 109.54	**103.33** 95.28 : 111.33
Tellurium	TM152	**108.33** 96.08 : 114.68	**106.83** 95.60 : 115.20
Thallium	TM152	**97.17** 77.38 : 126.18	**105.33** 73.68 : 123.18
Tin	TM152	**106.33** 94.83 : 110.56	**105.5** 93.06 : 109.94
Titanium	TM152	**107.67** 95.20 : 111.60	**105.0** 94.67 : 110.97
Tungsten	TM152	**104.33** 93.93 : 109.73	**100.67** 93.55 : 109.35
Uranium	TM152	**109.17** 93.52 : 111.02	**103.83** 93.98 : 110.48
Vanadium	TM152	**103.5** 93.39 : 111.02	**101.5** 92.88 : 110.53
Zinc	TM152	**104.33** 98.01 : 111.94	**106.33** 96.14 : 111.23

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3176
Free Cyanide - Low Level	TM279	**108.0** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**105.5** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3149
Mercury Dissolved (CVAF)	TM183	**84.0** 67.00 : 121.00

pH Value

Component	Method Code	QC 3176
Alk QC	TM256	**101.49** 95.60 : 104.93
EC QC	TM256	**104.51** 102.40 : 109.21
pH	TM256	**99.73** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3175
Phosphate (Ortho as PO4)	TM184	**101.6** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3179
Total Suspended Solids	TM022	**100.8** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3159
Aluminium	TM152	**106.0** 94.84 : 115.96
Antimony	TM152	**105.5** 96.45 : 113.65
Arsenic	TM152	**103.0** 95.62 : 113.52
Barium	TM152	**105.17** 92.82 : 115.88

Total Metals by ICP-MS

		QC 3159
Beryllium	TM152	**107.67** 94.17 : 119.27
Bismuth	TM152	**104.0** 95.43 : 114.33
Boron	TM152	**116.0** 90.50 : 124.05
Cadmium	TM152	**107.5** 95.83 : 114.63
Calcium	TM152	**101.33** 95.58 : 111.65
Chromium	TM152	**101.83** 95.53 : 111.72
Cobalt	TM152	**101.5** 94.51 : 113.34
Copper	TM152	**102.0** 95.21 : 114.14
Iron	TM152	**101.33** 95.43 : 112.35
Lead	TM152	**105.0** 96.24 : 114.78
Lithium	TM152	**104.33** 92.20 : 118.90
Magnesium	TM152	**100.67** 92.81 : 111.36
Manganese	TM152	**101.83** 95.44 : 112.83
Molybdenum	TM152	**103.0** 94.01 : 111.95
Nickel	TM152	**101.33** 95.20 : 113.35
Phosphorus	TM152	**99.17** 93.52 : 112.60
Potassium	TM152	**102.0** 94.95 : 112.01
Selenium	TM152	**105.17** 94.42 : 115.72
Silver	TM152	**102.5** 95.57 : 114.47
Sodium	TM152	**100.0** 92.16 : 111.44
Strontium	TM152	**104.0** 96.40 : 113.75
Tellurium	TM152	**108.67** 96.40 : 116.80
Thallium	TM152	**96.0** 77.82 : 118.92
Tin	TM152	**105.83** 97.32 : 112.45
Titanium	TM152	**105.5** 95.67 : 114.57
Uranium	TM152	**104.67** 95.20 : 112.90
Vanadium	TM152	**105.0** 93.73 : 113.12

Total Metals by ICP-MS

		QC 3159
Zinc	TM152	**104.33** 96.64 : 114.64

Total Nitrogen

Component	Method Code	QC 3181
Total Nitrogen	TM212	**90.87** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	06 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250226-24
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758163
Order Number:	55778

We received 1 sample on Tuesday February 25, 2025 and 1 of these samples were scheduled for analysis which was completed on Thursday March 06, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:

Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250226-24 **Report Number:** 758163 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31127634	SZC TCA PT		39.00 - 39.00	23/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250226-24 **Report Number:** 758163 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31127634					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250226-24 **Report Number:** 758163 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4+§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	
			Depth (m)	39.00 - 39.00
			Sample Type	Ground Water (GW)
			Date Sampled	23/02/2025
			Sample Time	08:00:00
			Date Received	25/02/2025
			SDG Ref	250226-24
			Lab Sample No.(s)	31127634
			AGS Reference	SZC TCA PT
Suspended solids, Total	<2 mg/l	TM022	7.8 #	
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	0.058 #	
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	0.0746 #	
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.76 #	
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #	
Boron (diss.filt)	<10 µg/l	TM152	36.2 #	
Boron (tot.unfilt)	<20 µg/l	TM152	30.1 #	
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #	
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #	
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #	
Chromium (diss.filt)	<1 µg/l	TM152	<1 #	
Copper (tot.unfilt)	<1 µg/l	TM152	<1 #	
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #	
Copper (diss.filt)	<0.3 µg/l	TM152	0.824 #	
Manganese (tot.unfilt)	<1 µg/l	TM152	166 #	
Lead (diss.filt)	<0.2 µg/l	TM152	<0.2 #	
Nickel (tot.unfilt)	<1 µg/l	TM152	<1 #	
Manganese (diss.filt)	<3 µg/l	TM152	169 #	
Nickel (diss.filt)	<0.4 µg/l	TM152	1.05 #	
Phosphorus (diss.filt)	<10 µg/l	TM152	1140 #	
Zinc (tot.unfilt)	<5 µg/l	TM152	15.8 #	
Zinc (diss.filt)	<1 µg/l	TM152	17.1 #	
Sodium (Dis.Filt)	<0.076 mg/l	TM152	25.2 #	
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	9.69 #	
Potassium (Dis.Filt)	<0.2 mg/l	TM152	3.34 #	
Calcium (Dis.Filt)	<0.2 mg/l	TM152	175 #	
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.58 #	
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	22.9 #	
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	8.69 #	
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	3.14 #	
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	164 #	
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.59 #	
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #	

CERTIFICATE OF ANALYSIS

SDG: 250226-24 **Report Number:** 758163 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4+§@ Sample deviation (see appendix)

	Customer Sample Ref.	SZC TCA PT
	Depth (m)	39.00 - 39.00
	Sample Type	Ground Water (GW)
	Date Sampled	23/02/2025
	Sample Time	08:00:00
	Date Received	25/02/2025
	SDG Ref	250226-24
	Lab Sample No.(s)	31127634
	AGS Reference	

Component	LOD/Units	Method	
Phosphate (Ortho as P)	<0.02 mg/l	TM184	0.0884 #
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.27 #
Nitrogen, Total	<1 mg/l	TM212	7.65 #
Chloride	<0.08 mg/l	TM226	61.1 #
Nitrite as N	<0.01 mg/l	TM226	<0.01 @ #
Nitrate as N	<0.02 mg/l	TM226	7.04 #
Sulphate as S	<0.04 mg/l	TM226	28.2 #
pH	<1 pH Units	TM256	7.61 #
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.901 #
Alkalinity, Total as CaCO3	<3 mg/l	TM256	330 #
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #

Table of Results - Appendix

Method No	Description
TM226	Determination of Anions in Waters using Ion Chromatography
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

Test Completion Dates

Lab Sample No(s)	31127634
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	02-Mar-2025
Anions by ion Chromatography	03-Mar-2025
Anions by Kone (w)	28-Feb-2025
Dissolved Metals by ICP-MS	04-Mar-2025
Low Level Cyanide (W)	03-Mar-2025
Mercury Dissolved	06-Mar-2025
pH Value	03-Mar-2025
Phosphate by Kone (w)	28-Feb-2025
Suspended Solids	05-Mar-2025
Total Metals by ICP-MS	03-Mar-2025
Total Nitrogen	05-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3127
Ammoniacal Nitrogen as N	TM099	**100.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3149
Bromide (W)	TM226	**99.17** 95.10 : 103.12
Chloride (W)	TM226	**100.65** 97.34 : 104.29
Fluoride (W)	TM226	**100.0** 96.73 : 103.12
Nitrate (W)	TM226	**99.17** 96.03 : 104.08
Nitrite (W)	TM226	**100.0** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**100.62** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3160
Sulphate (soluble)	TM184	**100.4** 94.30 : 107.93
TON as NO3	TM184	**100.5** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3151	QC 3114
Aluminium	TM152	**108.0** 96.29 : 111.36	**104.0** 95.24 : 111.40
Antimony	TM152	**107.67** 95.87 : 111.07	**104.67** 94.33 : 112.23
Arsenic	TM152	**102.17** 97.55 : 110.65	**104.5** 94.83 : 110.43
Barium	TM152	**107.33** 95.20 : 110.50	**100.83** 93.82 : 113.06
Beryllium	TM152	**110.5** 96.85 : 112.45	**105.0** 94.87 : 113.47
Bismuth	TM152	**109.0** 97.83 : 111.23	**104.0** 95.28 : 111.68
Borate	TM152	**118.52** 88.00 : 112.00	**105.56** 88.00 : 112.00
Boron	TM152	**118.33** 92.57 : 115.00	**105.33** 91.82 : 118.71

Dissolved Metals by ICP-MS

		QC 3151	QC 3114
Cadmium	TM152	**107.17** 97.48 : 110.88	**106.67** 93.90 : 112.50
Calcium	TM152	**106.67** 97.68 : 109.38	**102.67** 94.54 : 110.75
Chromium	TM152	**102.17** 96.27 : 109.04	**104.67** 94.18 : 109.80
Cobalt	TM152	**102.33** 92.39 : 111.11	**105.67** 93.95 : 109.53
Copper	TM152	**102.17** 97.35 : 110.57	**106.17** 93.88 : 110.94
Iron	TM152	**102.67** 97.26 : 109.03	**104.67** 95.31 : 109.92
Lead	TM152	**105.5** 94.28 : 110.83	**101.67** 94.24 : 111.99
Lithium	TM152	**109.33** 93.83 : 112.33	**104.83** 94.28 : 113.28
Magnesium	TM152	**105.33** 95.15 : 108.57	**102.67** 93.45 : 108.63
Manganese	TM152	**103.33** 97.38 : 109.22	**105.17** 95.81 : 110.44
Molybdenum	TM152	**103.17** 96.03 : 108.83	**105.67** 93.46 : 109.15
Nickel	TM152	**101.33** 97.74 : 109.83	**106.0** 92.80 : 111.23
Phosphorus	TM152	**106.83** 96.19 : 110.42	**102.17** 93.78 : 110.72
Potassium	TM152	**106.0** 97.69 : 109.01	**102.0** 95.43 : 111.23
Selenium	TM152	**108.17** 97.20 : 112.90	**103.5** 94.10 : 113.00
Silver	TM152	**102.67** 92.98 : 113.08	**105.17** 91.22 : 112.22
Sodium	TM152	**105.33** 94.87 : 108.38	**102.0** 93.17 : 108.57
Strontium	TM152	**105.33** 98.04 : 109.54	**103.33** 95.28 : 111.33
Tellurium	TM152	**108.33** 96.08 : 114.68	**106.83** 95.60 : 115.20
Thallium	TM152	**97.17** 77.38 : 126.18	**105.33** 73.68 : 123.18
Tin	TM152	**106.33** 94.83 : 110.56	**105.5** 93.06 : 109.94
Titanium	TM152	**107.67** 95.20 : 111.60	**105.0** 94.67 : 110.97
Tungsten	TM152	**104.33** 93.93 : 109.73	**100.67** 93.55 : 109.35
Uranium	TM152	**109.17** 93.52 : 111.02	**103.83** 93.98 : 110.48
Vanadium	TM152	**103.5** 93.39 : 111.02	**101.5** 92.88 : 110.53
Zinc	TM152	**104.33** 98.01 : 111.94	**106.33** 96.14 : 111.23

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3176
Free Cyanide - Low Level	TM279	**108.0** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**105.5** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3149
Mercury Dissolved (CVAF)	TM183	**84.0** 67.00 : 121.00

pH Value

Component	Method Code	QC 3184
Alk QC	TM256	**100.53** 95.60 : 104.93
EC QC	TM256	**104.65** 102.40 : 109.21
pH	TM256	**100.67** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3175
Phosphate (Ortho as PO4)	TM184	**101.6** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3179
Total Suspended Solids	TM022	**100.8** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3159
Aluminium	TM152	**106.0** 94.84 : 115.96
Antimony	TM152	**105.5** 96.45 : 113.65
Arsenic	TM152	**103.0** 95.62 : 113.52
Barium	TM152	**105.17** 92.82 : 115.88

Total Metals by ICP-MS

		QC 3159
Beryllium	TM152	**107.67** 94.17 : 119.27
Bismuth	TM152	**104.0** 95.43 : 114.33
Boron	TM152	**116.0** 90.50 : 124.05
Cadmium	TM152	**107.5** 95.83 : 114.63
Calcium	TM152	**101.33** 95.58 : 111.65
Chromium	TM152	**101.83** 95.53 : 111.72
Cobalt	TM152	**101.5** 94.51 : 113.34
Copper	TM152	**102.0** 95.21 : 114.14
Iron	TM152	**101.33** 95.43 : 112.35
Lead	TM152	**105.0** 96.24 : 114.78
Lithium	TM152	**104.33** 92.20 : 118.90
Magnesium	TM152	**100.67** 92.81 : 111.36
Manganese	TM152	**101.83** 95.44 : 112.83
Molybdenum	TM152	**103.0** 94.01 : 111.95
Nickel	TM152	**101.33** 95.20 : 113.35
Phosphorus	TM152	**99.17** 93.52 : 112.60
Potassium	TM152	**102.0** 94.95 : 112.01
Selenium	TM152	**105.17** 94.42 : 115.72
Silver	TM152	**102.5** 95.57 : 114.47
Sodium	TM152	**100.0** 92.16 : 111.44
Strontium	TM152	**104.0** 96.40 : 113.75
Tellurium	TM152	**108.67** 96.40 : 116.80
Thallium	TM152	**96.0** 77.82 : 118.92
Tin	TM152	**105.83** 97.32 : 112.45
Titanium	TM152	**105.5** 95.67 : 114.57
Uranium	TM152	**104.67** 95.20 : 112.90
Vanadium	TM152	**105.0** 93.73 : 113.12

Total Metals by ICP-MS

		QC 3159
Zinc	TM152	**104.33** 96.64 : 114.64

Total Nitrogen

Component	Method Code	QC 3181
Total Nitrogen	TM212	**90.87** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests.
We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	06 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250226-25
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758164
Order Number:	55778

We received 1 sample on Tuesday February 25, 2025 and 1 of these samples were scheduled for analysis which was completed on Thursday March 06, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:



Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250226-25 **Report Number:** 758164 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31127640	SZC TCA PT		39.00 - 39.00	23/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250226-25 **Report Number:** 758164 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31127640					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250226-25 **Report Number:** 758164 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4+§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.					
			SZC TCA PT					
Depth (m)			39.00 - 39.00					
Sample Type			Ground Water (GW)					
Date Sampled			23/02/2025					
Sample Time			17:00:00					
Date Received			25/02/2025					
SDG Ref			250226-25					
Lab Sample No.(s)			31127640					
AGS Reference								
Suspended solids, Total	<2 mg/l	TM022	5.5 #					
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	<0.01 #					
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	<0.01 #					
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.56 #					
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #					
Boron (diss.filt)	<10 µg/l	TM152	29.5 #					
Boron (tot.unfilt)	<20 µg/l	TM152	31.3 #					
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #					
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #					
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #					
Chromium (diss.filt)	<1 µg/l	TM152	<1 #					
Copper (tot.unfilt)	<1 µg/l	TM152	3.62 #					
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #					
Copper (diss.filt)	<0.3 µg/l	TM152	0.424 #					
Manganese (tot.unfilt)	<1 µg/l	TM152	170 #					
Lead (diss.filt)	<0.2 µg/l	TM152	<0.2 #					
Nickel (tot.unfilt)	<1 µg/l	TM152	18.3 #					
Manganese (diss.filt)	<3 µg/l	TM152	170 #					
Nickel (diss.filt)	<0.4 µg/l	TM152	17.8 #					
Phosphorus (diss.filt)	<10 µg/l	TM152	<10 #					
Zinc (tot.unfilt)	<5 µg/l	TM152	46 #					
Zinc (diss.filt)	<1 µg/l	TM152	42.7 #					
Sodium (Dis.Filt)	<0.076 mg/l	TM152	23.4 #					
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	9.66 #					
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.12 #					
Calcium (Dis.Filt)	<0.2 mg/l	TM152	176 #					
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.58 #					
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	21.6 #					
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	8.83 #					
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.07 #					
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	167 #					
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.65 #					
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #					

CERTIFICATE OF ANALYSIS

SDG: 250226-25 **Report Number:** 758164 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Customer Sample Ref.	SZC TCA PT
Depth (m)	39.00 - 39.00
Sample Type	Ground Water (GW)
Date Sampled	23/02/2025
Sample Time	17:00:00
Date Received	25/02/2025
SDG Ref	250226-25
Lab Sample No.(s)	31127640
AGS Reference	

Component	LOD/Units	Method	
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.22 #
Nitrogen, Total	<1 mg/l	TM212	7.82 #
Chloride	<0.08 mg/l	TM226	60.3 #
Nitrite as N	<0.01 mg/l	TM226	<0.01 @ #
Nitrate as N	<0.02 mg/l	TM226	7.12 #
Sulphate as S	<0.04 mg/l	TM226	28.3 #
pH	<1 pH Units	TM256	7.48 #
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.896 #
Alkalinity, Total as CaCO3	<3 mg/l	TM256	329 #
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #

Table of Results - Appendix

Method No	Description
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM226	Determination of Anions in Waters using Ion Chromatography
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250226-25 **Report Number:** 758164 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31127640
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	02-Mar-2025
Anions by ion Chromatography	03-Mar-2025
Anions by Kone (w)	28-Feb-2025
Dissolved Metals by ICP-MS	04-Mar-2025
Low Level Cyanide (W)	03-Mar-2025
Mercury Dissolved	06-Mar-2025
pH Value	03-Mar-2025
Phosphate by Kone (w)	28-Feb-2025
Suspended Solids	05-Mar-2025
Total Metals by ICP-MS	03-Mar-2025
Total Nitrogen	05-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3127
Ammoniacal Nitrogen as N	TM099	**100.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3149
Bromide (W)	TM226	**99.17** 95.10 : 103.12
Chloride (W)	TM226	**100.65** 97.34 : 104.29
Fluoride (W)	TM226	**100.0** 96.73 : 103.12
Nitrate (W)	TM226	**99.17** 96.03 : 104.08
Nitrite (W)	TM226	**100.0** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**100.62** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3160
Sulphate (soluble)	TM184	**100.4** 94.30 : 107.93
TON as NO3	TM184	**100.5** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3151	QC 3114
Aluminium	TM152	**108.0** 96.29 : 111.36	**104.0** 95.24 : 111.40
Antimony	TM152	**107.67** 95.87 : 111.07	**104.67** 94.33 : 112.23
Arsenic	TM152	**102.17** 97.55 : 110.65	**104.5** 94.83 : 110.43
Barium	TM152	**107.33** 95.20 : 110.50	**100.83** 93.82 : 113.06
Beryllium	TM152	**110.5** 96.85 : 112.45	**105.0** 94.87 : 113.47
Bismuth	TM152	**109.0** 97.83 : 111.23	**104.0** 95.28 : 111.68
Borate	TM152	**118.52** 88.00 : 112.00	**105.56** 88.00 : 112.00
Boron	TM152	**118.33** 92.57 : 115.00	**105.33** 91.82 : 118.71

Dissolved Metals by ICP-MS

		QC 3151	QC 3114
Cadmium	TM152	**107.17** 97.48 : 110.88	**106.67** 93.90 : 112.50
Calcium	TM152	**106.67** 97.68 : 109.38	**102.67** 94.54 : 110.75
Chromium	TM152	**102.17** 96.27 : 109.04	**104.67** 94.18 : 109.80
Cobalt	TM152	**102.33** 92.39 : 111.11	**105.67** 93.95 : 109.53
Copper	TM152	**102.17** 97.35 : 110.57	**106.17** 93.88 : 110.94
Iron	TM152	**102.67** 97.26 : 109.03	**104.67** 95.31 : 109.92
Lead	TM152	**105.5** 94.28 : 110.83	**101.67** 94.24 : 111.99
Lithium	TM152	**109.33** 93.83 : 112.33	**104.83** 94.28 : 113.28
Magnesium	TM152	**105.33** 95.15 : 108.57	**102.67** 93.45 : 108.63
Manganese	TM152	**103.33** 97.38 : 109.22	**105.17** 95.81 : 110.44
Molybdenum	TM152	**103.17** 96.03 : 108.83	**105.67** 93.46 : 109.15
Nickel	TM152	**101.33** 97.74 : 109.83	**106.0** 92.80 : 111.23
Phosphorus	TM152	**106.83** 96.19 : 110.42	**102.17** 93.78 : 110.72
Potassium	TM152	**106.0** 97.69 : 109.01	**102.0** 95.43 : 111.23
Selenium	TM152	**108.17** 97.20 : 112.90	**103.5** 94.10 : 113.00
Silver	TM152	**102.67** 92.98 : 113.08	**105.17** 91.22 : 112.22
Sodium	TM152	**105.33** 94.87 : 108.38	**102.0** 93.17 : 108.57
Strontium	TM152	**105.33** 98.04 : 109.54	**103.33** 95.28 : 111.33
Tellurium	TM152	**108.33** 96.08 : 114.68	**106.83** 95.60 : 115.20
Thallium	TM152	**97.17** 77.38 : 126.18	**105.33** 73.68 : 123.18
Tin	TM152	**106.33** 94.83 : 110.56	**105.5** 93.06 : 109.94
Titanium	TM152	**107.67** 95.20 : 111.60	**105.0** 94.67 : 110.97
Tungsten	TM152	**104.33** 93.93 : 109.73	**100.67** 93.55 : 109.35
Uranium	TM152	**109.17** 93.52 : 111.02	**103.83** 93.98 : 110.48
Vanadium	TM152	**103.5** 93.39 : 111.02	**101.5** 92.88 : 110.53
Zinc	TM152	**104.33** 98.01 : 111.94	**106.33** 96.14 : 111.23

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3176
Free Cyanide - Low Level	TM279	**108.0** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**105.5** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3149
Mercury Dissolved (CVAF)	TM183	**84.0** 67.00 : 121.00

pH Value

Component	Method Code	QC 3176
Alk QC	TM256	**101.49** 95.60 : 104.93
EC QC	TM256	**104.51** 102.40 : 109.21
pH	TM256	**99.73** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3175
Phosphate (Ortho as PO4)	TM184	**101.6** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3179
Total Suspended Solids	TM022	**100.8** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3159
Aluminium	TM152	**106.0** 94.84 : 115.96
Antimony	TM152	**105.5** 96.45 : 113.65
Arsenic	TM152	**103.0** 95.62 : 113.52
Barium	TM152	**105.17** 92.82 : 115.88

Total Metals by ICP-MS

		QC 3159
Beryllium	TM152	**107.67** 94.17 : 119.27
Bismuth	TM152	**104.0** 95.43 : 114.33
Boron	TM152	**116.0** 90.50 : 124.05
Cadmium	TM152	**107.5** 95.83 : 114.63
Calcium	TM152	**101.33** 95.58 : 111.65
Chromium	TM152	**101.83** 95.53 : 111.72
Cobalt	TM152	**101.5** 94.51 : 113.34
Copper	TM152	**102.0** 95.21 : 114.14
Iron	TM152	**101.33** 95.43 : 112.35
Lead	TM152	**105.0** 96.24 : 114.78
Lithium	TM152	**104.33** 92.20 : 118.90
Magnesium	TM152	**100.67** 92.81 : 111.36
Manganese	TM152	**101.83** 95.44 : 112.83
Molybdenum	TM152	**103.0** 94.01 : 111.95
Nickel	TM152	**101.33** 95.20 : 113.35
Phosphorus	TM152	**99.17** 93.52 : 112.60
Potassium	TM152	**102.0** 94.95 : 112.01
Selenium	TM152	**105.17** 94.42 : 115.72
Silver	TM152	**102.5** 95.57 : 114.47
Sodium	TM152	**100.0** 92.16 : 111.44
Strontium	TM152	**104.0** 96.40 : 113.75
Tellurium	TM152	**108.67** 96.40 : 116.80
Thallium	TM152	**96.0** 77.82 : 118.92
Tin	TM152	**105.83** 97.32 : 112.45
Titanium	TM152	**105.5** 95.67 : 114.57
Uranium	TM152	**104.67** 95.20 : 112.90
Vanadium	TM152	**105.0** 93.73 : 113.12

Total Metals by ICP-MS

		QC 3159
Zinc	TM152	**104.33** 96.64 : 114.64

Total Nitrogen

Component	Method Code	QC 3181
Total Nitrogen	TM212	**90.87** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests.
We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	06 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250226-35
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758212
Order Number:	55778

We received 1 sample on Wednesday February 26, 2025 and 1 of these samples were scheduled for analysis which was completed on Thursday March 06, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:



Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250226-35 **Report Number:** 758212 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31127930	SZC TCA PT		39.00 - 39.00	24/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250226-35 **Report Number:** 758212 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31127930					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250226-35 **Report Number:** 758212 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.				
			SZC TCA PT				
Depth (m)			39.00 - 39.00				
Sample Type			Ground Water (GW)				
Date Sampled			24/02/2025				
Sample Time			08:00:00				
Date Received			26/02/2025				
SDG Ref			250226-35				
Lab Sample No.(s)			31127930				
AGS Reference							
Suspended solids, Total	<2 mg/l	TM022	5.7 #				
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	<0.01 #				
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	<0.01 #				
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.63 #				
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #				
Boron (diss.filt)	<10 µg/l	TM152	33.2 #				
Boron (tot.unfilt)	<20 µg/l	TM152	27.8 #				
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #				
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #				
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #				
Chromium (diss.filt)	<1 µg/l	TM152	<1 #				
Copper (tot.unfilt)	<1 µg/l	TM152	2.86 #				
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #				
Copper (diss.filt)	<0.3 µg/l	TM152	0.506 #				
Manganese (tot.unfilt)	<1 µg/l	TM152	168 #				
Lead (diss.filt)	<0.2 µg/l	TM152	0.219 #				
Nickel (tot.unfilt)	<1 µg/l	TM152	4.07 #				
Manganese (diss.filt)	<3 µg/l	TM152	176 #				
Nickel (diss.filt)	<0.4 µg/l	TM152	3.56 #				
Phosphorus (diss.filt)	<10 µg/l	TM152	23.1 #				
Zinc (tot.unfilt)	<5 µg/l	TM152	14.9 #				
Zinc (diss.filt)	<1 µg/l	TM152	11.4 #				
Sodium (Dis.Filt)	<0.076 mg/l	TM152	23.1 #				
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	9.59 #				
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.16 #				
Calcium (Dis.Filt)	<0.2 mg/l	TM152	173 #				
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.79 #				
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	22.5 #				
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	8.93 #				
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.15 #				
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	170 #				
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.75 #				
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #				

CERTIFICATE OF ANALYSIS

SDG: 250226-35 **Report Number:** 758212 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4♦§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref. SZC TCA PT				
			Depth (m) 39.00 - 39.00				
			Sample Type Ground Water (GW)				
			Date Sampled 24/02/2025				
			Sample Time 08:00:00				
			Date Received 26/02/2025				
			SDG Ref 250226-35				
			Lab Sample No.(s) 31127930				
			AGS Reference				
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #				
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.28 #				
Nitrogen, Total	<1 mg/l	TM212	7.69 #				
Chloride	<0.08 mg/l	TM226	60.4 #				
Nitrite as N	<0.01 mg/l	TM226	0.0207 ♦ #				
Nitrate as N	<0.02 mg/l	TM226	7.16 #				
Sulphate as S	<0.04 mg/l	TM226	28.4 #				
pH	<1 pH Units	TM256	7.47 #				
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.9 #				
Alkalinity, Total as CaCO3	<3 mg/l	TM256	327 #				
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #				

Table of Results - Appendix

Method No	Description
TM226	Determination of Anions in Waters using Ion Chromatography
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250226-35 **Report Number:** 758212 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31127930
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	02-Mar-2025
Anions by ion Chromatography	28-Feb-2025
Anions by Kone (w)	28-Feb-2025
Dissolved Metals by ICP-MS	28-Feb-2025
Low Level Cyanide (W)	05-Mar-2025
Mercury Dissolved	05-Mar-2025
pH Value	03-Mar-2025
Phosphate by Kone (w)	27-Feb-2025
Suspended Solids	05-Mar-2025
Total Metals by ICP-MS	28-Feb-2025
Total Nitrogen	06-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3127
Ammoniacal Nitrogen as N	TM099	**100.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3121
Bromide (W)	TM226	**98.33** 95.10 : 103.12
Chloride (W)	TM226	**100.0** 97.34 : 104.29
Fluoride (W)	TM226	**100.0** 96.73 : 103.12
Nitrate (W)	TM226	**98.33** 96.03 : 104.08
Nitrite (W)	TM226	**99.17** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**99.38** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3160
Sulphate (soluble)	TM184	**100.4** 94.30 : 107.93
TON as NO3	TM184	**100.5** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3180
Aluminium	TM152	**105.33** 96.29 : 111.36
Antimony	TM152	**110.0** 95.87 : 111.07
Arsenic	TM152	**105.83** 97.55 : 110.65
Barium	TM152	**107.0** 95.20 : 110.50
Beryllium	TM152	**107.33** 96.85 : 112.45
Bismuth	TM152	**108.5** 97.83 : 111.23
Borate	TM152	**109.88** 88.00 : 112.00
Boron	TM152	**109.67** 92.57 : 115.00

Dissolved Metals by ICP-MS

		QC 3180
Cadmium	TM152	**106.83** 97.48 : 110.88
Calcium	TM152	**106.67** 97.68 : 109.38
Chromium	TM152	**105.83** 96.27 : 109.04
Cobalt	TM152	**106.17** 92.39 : 111.11
Copper	TM152	**107.67** 97.35 : 110.57
Iron	TM152	**105.33** 97.26 : 109.03
Lead	TM152	**104.17** 94.28 : 110.83
Lithium	TM152	**107.33** 93.83 : 112.33
Magnesium	TM152	**104.67** 95.15 : 108.57
Manganese	TM152	**104.83** 97.38 : 109.22
Molybdenum	TM152	**104.5** 96.03 : 108.83
Nickel	TM152	**106.83** 97.74 : 109.83
Phosphorus	TM152	**105.17** 96.19 : 110.42
Potassium	TM152	**105.33** 97.69 : 109.01
Selenium	TM152	**107.33** 97.20 : 112.90
Silver	TM152	**106.33** 92.98 : 113.08
Sodium	TM152	**104.0** 94.87 : 108.38
Strontium	TM152	**103.33** 98.04 : 109.54
Tellurium	TM152	**106.83** 96.08 : 114.68
Thallium	TM152	**89.83** 77.38 : 126.18
Tin	TM152	**106.5** 94.83 : 110.56
Titanium	TM152	**107.83** 95.20 : 111.60
Tungsten	TM152	**104.17** 93.93 : 109.73
Uranium	TM152	**105.5** 93.52 : 111.02
Vanadium	TM152	**106.5** 93.39 : 111.02
Zinc	TM152	**107.67** 98.01 : 111.94

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3199
Free Cyanide - Low Level	TM279	**109.33** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**104.0** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3141
Mercury Dissolved (CVAF)	TM183	**91.7** 67.00 : 121.00

pH Value

Component	Method Code	QC 3180
Alk QC	TM256	**100.65** 95.60 : 104.93
EC QC	TM256	**104.37** 102.40 : 109.21
pH	TM256	**100.27** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3190
Phosphate (Ortho as PO4)	TM184	**101.6** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3179
Total Suspended Solids	TM022	**100.8** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3136
Aluminium	TM152	**108.0** 94.84 : 115.96
Antimony	TM152	**104.17** 96.45 : 113.65
Arsenic	TM152	**103.67** 95.62 : 113.52
Barium	TM152	**104.67** 92.82 : 115.88

Total Metals by ICP-MS

		QC 3136
Beryllium	TM152	**108.5** 94.17 : 119.27
Bismuth	TM152	**104.33** 95.43 : 114.33
Boron	TM152	**112.33** 90.50 : 124.05
Cadmium	TM152	**105.67** 95.83 : 114.63
Calcium	TM152	**105.33** 95.58 : 111.65
Chromium	TM152	**103.67** 95.53 : 111.72
Cobalt	TM152	**103.5** 94.51 : 113.34
Copper	TM152	**104.33** 95.21 : 114.14
Iron	TM152	**103.33** 95.43 : 112.35
Lead	TM152	**105.33** 96.24 : 114.78
Lithium	TM152	**108.0** 92.20 : 118.90
Magnesium	TM152	**103.33** 92.81 : 111.36
Manganese	TM152	**104.17** 95.44 : 112.83
Molybdenum	TM152	**103.33** 94.01 : 111.95
Nickel	TM152	**104.0** 95.20 : 113.35
Phosphorus	TM152	**102.33** 93.52 : 112.60
Potassium	TM152	**105.33** 94.95 : 112.01
Selenium	TM152	**107.0** 94.42 : 115.72
Silver	TM152	**103.5** 95.57 : 114.47
Sodium	TM152	**104.0** 92.16 : 111.44
Strontium	TM152	**105.0** 96.40 : 113.75
Tellurium	TM152	**108.0** 96.40 : 116.80
Thallium	TM152	**100.17** 77.82 : 118.92
Tin	TM152	**104.33** 97.32 : 112.45
Titanium	TM152	**108.0** 95.67 : 114.57
Uranium	TM152	**104.83** 95.20 : 112.90
Vanadium	TM152	**102.67** 93.73 : 113.12

Total Metals by ICP-MS

		QC 3136
Zinc	TM152	**106.33** 96.64 : 114.64

Total Nitrogen

Component	Method Code	QC 3111
Total Nitrogen	TM212	**88.34** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	06 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250226-38
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758213
Order Number:	55778

We received 1 sample on Wednesday February 26, 2025 and 1 of these samples were scheduled for analysis which was completed on Thursday March 06, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:



Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250226-38 **Report Number:** 758213 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31128013	SZC TCA PT		39.00 - 39.00	24/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250226-38 **Report Number:** 758213 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31128013					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250226-38 **Report Number:** 758213 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4+§@	Sample deviation (see appendix)

Customer Sample Ref.	SZC TCA PT
Depth (m)	39.00 - 39.00
Sample Type	Ground Water (GW)
Date Sampled	24/02/2025
Sample Time	17:00:00
Date Received	26/02/2025
SDG Ref	250226-38
Lab Sample No.(s)	31128013
AGS Reference	

Component	LOD/Units	Method	
Suspended solids, Total	<2 mg/l	TM022	2.6 #
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	0.011 #
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	0.0141 #
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.46 #
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #
Boron (diss.filt)	<10 µg/l	TM152	34.3 #
Boron (tot.unfilt)	<20 µg/l	TM152	29.3 #
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #
Chromium (diss.filt)	<1 µg/l	TM152	<1 #
Copper (tot.unfilt)	<1 µg/l	TM152	2.82 #
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #
Copper (diss.filt)	<0.3 µg/l	TM152	<0.3 #
Manganese (tot.unfilt)	<1 µg/l	TM152	171 #
Lead (diss.filt)	<0.2 µg/l	TM152	<0.2 #
Nickel (tot.unfilt)	<1 µg/l	TM152	2.3 #
Manganese (diss.filt)	<3 µg/l	TM152	181 #
Nickel (diss.filt)	<0.4 µg/l	TM152	1.66 #
Phosphorus (diss.filt)	<10 µg/l	TM152	28.5 #
Zinc (tot.unfilt)	<5 µg/l	TM152	12.4 #
Zinc (diss.filt)	<1 µg/l	TM152	5.94 #
Sodium (Dis.Filt)	<0.076 mg/l	TM152	23.1 #
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	9.6 #
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.08 #
Calcium (Dis.Filt)	<0.2 mg/l	TM152	174 #
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.8 #
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	22.3 #
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	8.97 #
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.14 #
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	170 #
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.77 #
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #

CERTIFICATE OF ANALYSIS

SDG: 250226-38 **Report Number:** 758213 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4♦§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref. SZC TCA PT
			Depth (m) 39.00 - 39.00
			Sample Type Ground Water (GW)
			Date Sampled 24/02/2025
			Sample Time 17:00:00
			Date Received 26/02/2025
			SDG Ref 250226-38
			Lab Sample No.(s) 31128013
			AGS Reference
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.45 #
Nitrogen, Total	<1 mg/l	TM212	7.63 #
Chloride	<0.08 mg/l	TM226	60 #
Nitrite as N	<0.01 mg/l	TM226	0.0259 ♦ #
Nitrate as N	<0.02 mg/l	TM226	7.18 #
Sulphate as S	<0.04 mg/l	TM226	28.3 #
pH	<1 pH Units	TM256	7.5 #
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.898 #
Alkalinity, Total as CaCO3	<3 mg/l	TM256	327 #
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #

Table of Results - Appendix

Method No	Description
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM226	Determination of Anions in Waters using Ion Chromatography
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250226-38 **Report Number:** 758213 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31128013
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	02-Mar-2025
Anions by ion Chromatography	28-Feb-2025
Anions by Kone (w)	28-Feb-2025
Dissolved Metals by ICP-MS	28-Feb-2025
Low Level Cyanide (W)	05-Mar-2025
Mercury Dissolved	05-Mar-2025
pH Value	03-Mar-2025
Phosphate by Kone (w)	27-Feb-2025
Suspended Solids	05-Mar-2025
Total Metals by ICP-MS	28-Feb-2025
Total Nitrogen	06-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3133
Ammoniacal Nitrogen as N	TM099	**106.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3121
Bromide (W)	TM226	**98.33** 95.10 : 103.12
Chloride (W)	TM226	**100.0** 97.34 : 104.29
Fluoride (W)	TM226	**100.0** 96.73 : 103.12
Nitrate (W)	TM226	**98.33** 96.03 : 104.08
Nitrite (W)	TM226	**99.17** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**99.38** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3150
Sulphate (soluble)	TM184	**98.8** 94.30 : 107.93
TON as NO3	TM184	**100.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3180
Aluminium	TM152	**105.33** 96.29 : 111.36
Antimony	TM152	**110.0** 95.87 : 111.07
Arsenic	TM152	**105.83** 97.55 : 110.65
Barium	TM152	**107.0** 95.20 : 110.50
Beryllium	TM152	**107.33** 96.85 : 112.45
Bismuth	TM152	**108.5** 97.83 : 111.23
Borate	TM152	**109.88** 88.00 : 112.00
Boron	TM152	**109.67** 92.57 : 115.00

Dissolved Metals by ICP-MS

		QC 3180
Cadmium	TM152	**106.83** 97.48 : 110.88
Calcium	TM152	**106.67** 97.68 : 109.38
Chromium	TM152	**105.83** 96.27 : 109.04
Cobalt	TM152	**106.17** 92.39 : 111.11
Copper	TM152	**107.67** 97.35 : 110.57
Iron	TM152	**105.33** 97.26 : 109.03
Lead	TM152	**104.17** 94.28 : 110.83
Lithium	TM152	**107.33** 93.83 : 112.33
Magnesium	TM152	**104.67** 95.15 : 108.57
Manganese	TM152	**104.83** 97.38 : 109.22
Molybdenum	TM152	**104.5** 96.03 : 108.83
Nickel	TM152	**106.83** 97.74 : 109.83
Phosphorus	TM152	**105.17** 96.19 : 110.42
Potassium	TM152	**105.33** 97.69 : 109.01
Selenium	TM152	**107.33** 97.20 : 112.90
Silver	TM152	**106.33** 92.98 : 113.08
Sodium	TM152	**104.0** 94.87 : 108.38
Strontium	TM152	**103.33** 98.04 : 109.54
Tellurium	TM152	**106.83** 96.08 : 114.68
Thallium	TM152	**89.83** 77.38 : 126.18
Tin	TM152	**106.5** 94.83 : 110.56
Titanium	TM152	**107.83** 95.20 : 111.60
Tungsten	TM152	**104.17** 93.93 : 109.73
Uranium	TM152	**105.5** 93.52 : 111.02
Vanadium	TM152	**106.5** 93.39 : 111.02
Zinc	TM152	**107.67** 98.01 : 111.94

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3199
Free Cyanide - Low Level	TM279	**109.33** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**104.0** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3141
Mercury Dissolved (CVAF)	TM183	**91.7** 67.00 : 121.00

pH Value

Component	Method Code	QC 3180
Alk QC	TM256	**100.65** 95.60 : 104.93
EC QC	TM256	**104.37** 102.40 : 109.21
pH	TM256	**100.27** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3190
Phosphate (Ortho as PO4)	TM184	**101.6** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3133
Total Suspended Solids	TM022	**103.98** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3136
Aluminium	TM152	**108.0** 94.84 : 115.96
Antimony	TM152	**104.17** 96.45 : 113.65
Arsenic	TM152	**103.67** 95.62 : 113.52
Barium	TM152	**104.67** 92.82 : 115.88

Total Metals by ICP-MS

		QC 3136
Beryllium	TM152	**108.5** 94.17 : 119.27
Bismuth	TM152	**104.33** 95.43 : 114.33
Boron	TM152	**112.33** 90.50 : 124.05
Cadmium	TM152	**105.67** 95.83 : 114.63
Calcium	TM152	**105.33** 95.58 : 111.65
Chromium	TM152	**103.67** 95.53 : 111.72
Cobalt	TM152	**103.5** 94.51 : 113.34
Copper	TM152	**104.33** 95.21 : 114.14
Iron	TM152	**103.33** 95.43 : 112.35
Lead	TM152	**105.33** 96.24 : 114.78
Lithium	TM152	**108.0** 92.20 : 118.90
Magnesium	TM152	**103.33** 92.81 : 111.36
Manganese	TM152	**104.17** 95.44 : 112.83
Molybdenum	TM152	**103.33** 94.01 : 111.95
Nickel	TM152	**104.0** 95.20 : 113.35
Phosphorus	TM152	**102.33** 93.52 : 112.60
Potassium	TM152	**105.33** 94.95 : 112.01
Selenium	TM152	**107.0** 94.42 : 115.72
Silver	TM152	**103.5** 95.57 : 114.47
Sodium	TM152	**104.0** 92.16 : 111.44
Strontium	TM152	**105.0** 96.40 : 113.75
Tellurium	TM152	**108.0** 96.40 : 116.80
Thallium	TM152	**100.17** 77.82 : 118.92
Tin	TM152	**104.33** 97.32 : 112.45
Titanium	TM152	**108.0** 95.67 : 114.57
Uranium	TM152	**104.83** 95.20 : 112.90
Vanadium	TM152	**102.67** 93.73 : 113.12

Total Metals by ICP-MS

		QC 3136
Zinc	TM152	**106.33** 96.64 : 114.64

Total Nitrogen

Component	Method Code	QC 3111
Total Nitrogen	TM212	**88.34** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	06 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250227-43
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758246
Order Number:	55778

We received 1 sample on Thursday February 27, 2025 and 1 of these samples were scheduled for analysis which was completed on Thursday March 06, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:

Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250227-43 **Report Number:** 758246 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31133791	SZC TCA PT		39.00 - 39.00	25/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250227-43 **Report Number:** 758246 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31133791					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250227-43 **Report Number:** 758246 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4+§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	Depth (m)	Sample Type	Date Sampled	Sample Time	Date Received	SDG Ref	Lab Sample No.(s)	AGS Reference
			SZC TCA PT	39.00 - 39.00	Ground Water (GW)	25/02/2025	17:00:00	27/02/2025	250227-43	31133791	
Suspended solids, Total	<2 mg/l	TM022	5.7 #								
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	0.027 #								
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	0.0347 #								
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.37 #								
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #								
Boron (diss.filt)	<10 µg/l	TM152	32.8 #								
Boron (tot.unfilt)	<20 µg/l	TM152	33.9 #								
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #								
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #								
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #								
Chromium (diss.filt)	<1 µg/l	TM152	<1 #								
Copper (tot.unfilt)	<1 µg/l	TM152	5.84 #								
Lead (tot.unfilt)	<1 µg/l	TM152	1.32 #								
Copper (diss.filt)	<0.3 µg/l	TM152	0.478 #								
Manganese (tot.unfilt)	<1 µg/l	TM152	174 #								
Lead (diss.filt)	<0.2 µg/l	TM152	0.391 #								
Nickel (tot.unfilt)	<1 µg/l	TM152	101 #								
Manganese (diss.filt)	<3 µg/l	TM152	172 #								
Nickel (diss.filt)	<0.4 µg/l	TM152	101 #								
Phosphorus (diss.filt)	<10 µg/l	TM152	28.6 #								
Zinc (tot.unfilt)	<5 µg/l	TM152	167 #								
Zinc (diss.filt)	<1 µg/l	TM152	147 #								
Sodium (Dis.Filt)	<0.076 mg/l	TM152	23.3 #								
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	9.71 #								
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.1 #								
Calcium (Dis.Filt)	<0.2 mg/l	TM152	175 #								
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.72 #								
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	23.2 #								
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	9.68 #								
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.36 #								
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	176 #								
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	3.06 #								
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #								

CERTIFICATE OF ANALYSIS

SDG: 250227-43 **Report Number:** 758246 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4♦§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref. SZC TCA PT				
			Depth (m) 39.00 - 39.00				
			Sample Type Ground Water (GW)				
			Date Sampled 25/02/2025				
			Sample Time 17:00:00				
			Date Received 27/02/2025				
			SDG Ref 250227-43				
			Lab Sample No.(s) 31133791				
			AGS Reference				
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #				
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.37 #				
Nitrogen, Total	<1 mg/l	TM212	7.44 #				
Chloride	<0.08 mg/l	TM226	59.7 #				
Nitrite as N	<0.01 mg/l	TM226	0.0441 ♦ #				
Nitrate as N	<0.02 mg/l	TM226	7.13 #				
Sulphate as S	<0.04 mg/l	TM226	28.2 #				
pH	<1 pH Units	TM256	7.47 #				
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.899 #				
Alkalinity, Total as CaCO3	<3 mg/l	TM256	327 #				
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #				

Table of Results - Appendix

Method No	Description
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM226	Determination of Anions in Waters using Ion Chromatography
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250227-43 **Report Number:** 758246 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31133791
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	02-Mar-2025
Anions by ion Chromatography	28-Feb-2025
Anions by Kone (w)	28-Feb-2025
Dissolved Metals by ICP-MS	28-Feb-2025
Low Level Cyanide (W)	05-Mar-2025
Mercury Dissolved	06-Mar-2025
pH Value	03-Mar-2025
Phosphate by Kone (w)	28-Feb-2025
Suspended Solids	06-Mar-2025
Total Metals by ICP-MS	03-Mar-2025
Total Nitrogen	06-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3127
Ammoniacal Nitrogen as N	TM099	**100.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3121
Bromide (W)	TM226	**98.33** 95.10 : 103.12
Chloride (W)	TM226	**100.0** 97.34 : 104.29
Fluoride (W)	TM226	**100.0** 96.73 : 103.12
Nitrate (W)	TM226	**98.33** 96.03 : 104.08
Nitrite (W)	TM226	**99.17** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**99.38** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3137
TON as NO3	TM184	**102.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3180
Aluminium	TM152	**105.33** 96.29 : 111.36
Antimony	TM152	**110.0** 95.87 : 111.07
Arsenic	TM152	**105.83** 97.55 : 110.65
Barium	TM152	**107.0** 95.20 : 110.50
Beryllium	TM152	**107.33** 96.85 : 112.45
Bismuth	TM152	**108.5** 97.83 : 111.23
Borate	TM152	**109.88** 88.00 : 112.00
Boron	TM152	**109.67** 92.57 : 115.00

Dissolved Metals by ICP-MS

		QC 3180
Cadmium	TM152	**106.83** 97.48 : 110.88
Calcium	TM152	**106.67** 97.68 : 109.38
Chromium	TM152	**105.83** 96.27 : 109.04
Cobalt	TM152	**106.17** 92.39 : 111.11
Copper	TM152	**107.67** 97.35 : 110.57
Iron	TM152	**105.33** 97.26 : 109.03
Lead	TM152	**104.17** 94.28 : 110.83
Lithium	TM152	**107.33** 93.83 : 112.33
Magnesium	TM152	**104.67** 95.15 : 108.57
Manganese	TM152	**104.83** 97.38 : 109.22
Molybdenum	TM152	**104.5** 96.03 : 108.83
Nickel	TM152	**106.83** 97.74 : 109.83
Phosphorus	TM152	**105.17** 96.19 : 110.42
Potassium	TM152	**105.33** 97.69 : 109.01
Selenium	TM152	**107.33** 97.20 : 112.90
Silver	TM152	**106.33** 92.98 : 113.08
Sodium	TM152	**104.0** 94.87 : 108.38
Strontium	TM152	**103.33** 98.04 : 109.54
Tellurium	TM152	**106.83** 96.08 : 114.68
Thallium	TM152	**89.83** 77.38 : 126.18
Tin	TM152	**106.5** 94.83 : 110.56
Titanium	TM152	**107.83** 95.20 : 111.60
Tungsten	TM152	**104.17** 93.93 : 109.73
Uranium	TM152	**105.5** 93.52 : 111.02
Vanadium	TM152	**106.5** 93.39 : 111.02
Zinc	TM152	**107.67** 98.01 : 111.94

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3199
Free Cyanide - Low Level	TM279	**109.33** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**104.0** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3126
Mercury Dissolved (CVAF)	TM183	**92.9** 67.00 : 121.00

pH Value

Component	Method Code	QC 3180
Alk QC	TM256	**100.65** 95.60 : 104.93
EC QC	TM256	**104.37** 102.40 : 109.21
pH	TM256	**100.27** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3193
Phosphate (Ortho as PO4)	TM184	**100.8** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3155
Total Suspended Solids	TM022	**99.2** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3167
Aluminium	TM152	**108.33** 96.33 : 113.92
Antimony	TM152	**106.83** 96.72 : 113.02
Arsenic	TM152	**108.83** 99.03 : 112.93
Barium	TM152	**105.83** 96.25 : 112.47

Total Metals by ICP-MS

		QC 3167
Beryllium	TM152	**107.17** 96.97 : 114.57
Bismuth	TM152	**107.0** 98.03 : 113.23
Boron	TM152	**117.33** 93.02 : 118.94
Cadmium	TM152	**106.67** 97.52 : 113.52
Calcium	TM152	**105.33** 96.89 : 111.51
Chromium	TM152	**105.33** 94.35 : 111.51
Cobalt	TM152	**105.67** 94.01 : 112.73
Copper	TM152	**107.83** 98.87 : 112.32
Iron	TM152	**106.0** 95.16 : 111.53
Lead	TM152	**103.83** 98.77 : 111.72
Lithium	TM152	**108.17** 94.55 : 114.95
Magnesium	TM152	**106.0** 95.02 : 111.04
Manganese	TM152	**105.83** 98.09 : 111.48
Molybdenum	TM152	**105.17** 96.83 : 111.30
Nickel	TM152	**107.5** 95.54 : 112.62
Phosphorus	TM152	**106.0** 96.93 : 112.34
Potassium	TM152	**106.67** 97.28 : 111.48
Selenium	TM152	**108.5** 98.23 : 114.73
Silver	TM152	**106.17** 93.73 : 114.93
Sodium	TM152	**105.33** 94.65 : 111.16
Strontium	TM152	**104.33** 94.82 : 112.81
Tellurium	TM152	**105.0** 96.90 : 117.40
Thallium	TM152	**94.33** 80.90 : 121.20
Tin	TM152	**105.83** 95.52 : 112.96
Titanium	TM152	**106.0** 95.47 : 113.37
Uranium	TM152	**103.5** 97.53 : 111.13
Vanadium	TM152	**106.17** 93.91 : 113.24

Total Metals by ICP-MS

		QC 3167
Zinc	TM152	**108.33** 99.32 : 113.74

Total Nitrogen

Component	Method Code	QC 3105
Total Nitrogen	TM212	**82.76** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests.
We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	06 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250227-45
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758255
Order Number:	55778

We received 1 sample on Thursday February 27, 2025 and 1 of these samples were scheduled for analysis which was completed on Thursday March 06, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:

Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250227-45 **Report Number:** 758255 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31133814	SZC TCA PT		39.00 - 39.00	25/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250227-45 **Report Number:** 758255 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31133814					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250227-45 **Report Number:** 758255 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend	
#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4+§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	SZC TCA PT
			Depth (m)	39.00 - 39.00
			Sample Type	Ground Water (GW)
			Date Sampled	25/02/2025
			Sample Time	08:00:00
			Date Received	27/02/2025
			SDG Ref	250227-45
			Lab Sample No.(s)	31133814
			AGS Reference	
Suspended solids, Total	<2 mg/l	TM022		4.5 #
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099		0.011 #
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099		0.0141 #
Arsenic (diss.filt)	<0.5 µg/l	TM152		1.42 #
Arsenic (tot.unfilt)	<2 µg/l	TM152		<2 #
Boron (diss.filt)	<10 µg/l	TM152		31.7 #
Boron (tot.unfilt)	<20 µg/l	TM152		32.3 #
Cadmium (diss.filt)	<0.08 µg/l	TM152		<0.08 #
Cadmium (tot.unfilt)	<0.5 µg/l	TM152		<0.5 #
Chromium (tot.unfilt)	<3 µg/l	TM152		<3 #
Chromium (diss.filt)	<1 µg/l	TM152		<1 #
Copper (tot.unfilt)	<1 µg/l	TM152		3.09 #
Lead (tot.unfilt)	<1 µg/l	TM152		<1 #
Copper (diss.filt)	<0.3 µg/l	TM152		0.777 #
Manganese (tot.unfilt)	<1 µg/l	TM152		172 #
Lead (diss.filt)	<0.2 µg/l	TM152		0.223 #
Nickel (tot.unfilt)	<1 µg/l	TM152		20.3 #
Manganese (diss.filt)	<3 µg/l	TM152		170 #
Nickel (diss.filt)	<0.4 µg/l	TM152		102 #
Phosphorus (diss.filt)	<10 µg/l	TM152		23.6 #
Zinc (tot.unfilt)	<5 µg/l	TM152		43 #
Zinc (diss.filt)	<1 µg/l	TM152		147 #
Sodium (Dis.Filt)	<0.076 mg/l	TM152		23.4 #
Magnesium (Dis.Filt)	<0.036 mg/l	TM152		9.66 #
Potassium (Dis.Filt)	<0.2 mg/l	TM152		2.16 #
Calcium (Dis.Filt)	<0.2 mg/l	TM152		174 #
Iron (Dis.Filt)	<0.019 mg/l	TM152		2.72 #
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152		23.3 #
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152		9.64 #
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152		2.16 #
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152		176 #
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152		3.12 #
Mercury (diss.filt)	<0.01 µg/l	TM183		<0.01 #

CERTIFICATE OF ANALYSIS

SDG: 250227-45 **Report Number:** 758255 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4♦§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref. SZC TCA PT				
			Depth (m) 39.00 - 39.00				
			Sample Type Ground Water (GW)				
			Date Sampled 25/02/2025				
			Sample Time 08:00:00				
			Date Received 27/02/2025				
			SDG Ref 250227-45				
			Lab Sample No.(s) 31133814				
			AGS Reference				
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #				
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.34 #				
Nitrogen, Total	<1 mg/l	TM212	7.84 #				
Chloride	<0.08 mg/l	TM226	59.7 #				
Nitrite as N	<0.01 mg/l	TM226	0.0359 ♦ #				
Nitrate as N	<0.02 mg/l	TM226	7.08 #				
Sulphate as S	<0.04 mg/l	TM226	28.1 #				
pH	<1 pH Units	TM256	7.53 #				
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.9 #				
Alkalinity, Total as CaCO3	<3 mg/l	TM256	326 #				
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #				

Table of Results - Appendix

Method No	Description
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM226	Determination of Anions in Waters using Ion Chromatography

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

Test Completion Dates

Lab Sample No(s)	31133814
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	02-Mar-2025
Anions by ion Chromatography	28-Feb-2025
Anions by Kone (w)	28-Feb-2025
Dissolved Metals by ICP-MS	28-Feb-2025
Low Level Cyanide (W)	05-Mar-2025
Mercury Dissolved	06-Mar-2025
pH Value	03-Mar-2025
Phosphate by Kone (w)	27-Feb-2025
Suspended Solids	06-Mar-2025
Total Metals by ICP-MS	03-Mar-2025
Total Nitrogen	06-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3127
Ammoniacal Nitrogen as N	TM099	**100.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3121
Bromide (W)	TM226	**98.33** 95.10 : 103.12
Chloride (W)	TM226	**100.0** 97.34 : 104.29
Fluoride (W)	TM226	**100.0** 96.73 : 103.12
Nitrate (W)	TM226	**98.33** 96.03 : 104.08
Nitrite (W)	TM226	**99.17** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**99.38** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3137
TON as NO3	TM184	**102.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3180
Aluminium	TM152	**105.33** 96.29 : 111.36
Antimony	TM152	**110.0** 95.87 : 111.07
Arsenic	TM152	**105.83** 97.55 : 110.65
Barium	TM152	**107.0** 95.20 : 110.50
Beryllium	TM152	**107.33** 96.85 : 112.45
Bismuth	TM152	**108.5** 97.83 : 111.23
Borate	TM152	**109.88** 88.00 : 112.00
Boron	TM152	**109.67** 92.57 : 115.00

Dissolved Metals by ICP-MS

		QC 3180
Cadmium	TM152	**106.83** 97.48 : 110.88
Calcium	TM152	**106.67** 97.68 : 109.38
Chromium	TM152	**105.83** 96.27 : 109.04
Cobalt	TM152	**106.17** 92.39 : 111.11
Copper	TM152	**107.67** 97.35 : 110.57
Iron	TM152	**105.33** 97.26 : 109.03
Lead	TM152	**104.17** 94.28 : 110.83
Lithium	TM152	**107.33** 93.83 : 112.33
Magnesium	TM152	**104.67** 95.15 : 108.57
Manganese	TM152	**104.83** 97.38 : 109.22
Molybdenum	TM152	**104.5** 96.03 : 108.83
Nickel	TM152	**106.83** 97.74 : 109.83
Phosphorus	TM152	**105.17** 96.19 : 110.42
Potassium	TM152	**105.33** 97.69 : 109.01
Selenium	TM152	**107.33** 97.20 : 112.90
Silver	TM152	**106.33** 92.98 : 113.08
Sodium	TM152	**104.0** 94.87 : 108.38
Strontium	TM152	**103.33** 98.04 : 109.54
Tellurium	TM152	**106.83** 96.08 : 114.68
Thallium	TM152	**89.83** 77.38 : 126.18
Tin	TM152	**106.5** 94.83 : 110.56
Titanium	TM152	**107.83** 95.20 : 111.60
Tungsten	TM152	**104.17** 93.93 : 109.73
Uranium	TM152	**105.5** 93.52 : 111.02
Vanadium	TM152	**106.5** 93.39 : 111.02
Zinc	TM152	**107.67** 98.01 : 111.94

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3199
Free Cyanide - Low Level	TM279	**109.33** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**104.0** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3126
Mercury Dissolved (CVAF)	TM183	**92.9** 67.00 : 121.00

pH Value

Component	Method Code	QC 3184
Alk QC	TM256	**100.53** 95.60 : 104.93
EC QC	TM256	**104.65** 102.40 : 109.21
pH	TM256	**100.67** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3180
Phosphate (Ortho as PO4)	TM184	**101.2** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3179
Total Suspended Solids	TM022	**96.29** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3167
Aluminium	TM152	**108.33** 96.33 : 113.92
Antimony	TM152	**106.83** 96.72 : 113.02
Arsenic	TM152	**108.83** 99.03 : 112.93
Barium	TM152	**105.83** 96.25 : 112.47

Total Metals by ICP-MS

		QC 3167
Beryllium	TM152	**107.17** 96.97 : 114.57
Bismuth	TM152	**107.0** 98.03 : 113.23
Boron	TM152	**117.33** 93.02 : 118.94
Cadmium	TM152	**106.67** 97.52 : 113.52
Calcium	TM152	**105.33** 96.89 : 111.51
Chromium	TM152	**105.33** 94.35 : 111.51
Cobalt	TM152	**105.67** 94.01 : 112.73
Copper	TM152	**107.83** 98.87 : 112.32
Iron	TM152	**106.0** 95.16 : 111.53
Lead	TM152	**103.83** 98.77 : 111.72
Lithium	TM152	**108.17** 94.55 : 114.95
Magnesium	TM152	**106.0** 95.02 : 111.04
Manganese	TM152	**105.83** 98.09 : 111.48
Molybdenum	TM152	**105.17** 96.83 : 111.30
Nickel	TM152	**107.5** 95.54 : 112.62
Phosphorus	TM152	**106.0** 96.93 : 112.34
Potassium	TM152	**106.67** 97.28 : 111.48
Selenium	TM152	**108.5** 98.23 : 114.73
Silver	TM152	**106.17** 93.73 : 114.93
Sodium	TM152	**105.33** 94.65 : 111.16
Strontium	TM152	**104.33** 94.82 : 112.81
Tellurium	TM152	**105.0** 96.90 : 117.40
Thallium	TM152	**94.33** 80.90 : 121.20
Tin	TM152	**105.83** 95.52 : 112.96
Titanium	TM152	**106.0** 95.47 : 113.37
Uranium	TM152	**103.5** 97.53 : 111.13
Vanadium	TM152	**106.17** 93.91 : 113.24

CERTIFICATE OF ANALYSIS

SDG: 250227-45 **Report Number:** 758255 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Total Metals by ICP-MS

		QC 3167
Zinc	TM152	**108.33** 99.32 : 113.74

Total Nitrogen

Component	Method Code	QC 3144
Total Nitrogen	TM212	**90.37** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	07 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250228-43
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758412
Order Number:	55778

We received 1 sample on Friday February 28, 2025 and 1 of these samples were scheduled for analysis which was completed on Friday March 07, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:

Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250228-43 **Report Number:** 758412 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31140475	SZC TCA PT		39.00 - 39.00	26/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250228-43 **Report Number:** 758412 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31140475					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250228-43 **Report Number:** 758412 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	Depth (m)	Sample Type	Date Sampled	Sample Time	Date Received	SDG Ref	Lab Sample No.(s)	AGS Reference
			SZC TCA PT	39.00 - 39.00	Ground Water (GW)	26/02/2025	17:00:00	28/02/2025	250228-43	31140475	
Suspended solids, Total	<2 mg/l	TM022	3.7 #								
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	0.013 #								
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	0.0167 #								
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.32 #								
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #								
Boron (diss.filt)	<10 µg/l	TM152	27.2 #								
Boron (tot.unfilt)	<20 µg/l	TM152	35.2 #								
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #								
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #								
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #								
Chromium (diss.filt)	<1 µg/l	TM152	<1 #								
Copper (tot.unfilt)	<1 µg/l	TM152	4.69 #								
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #								
Copper (diss.filt)	<0.3 µg/l	TM152	<0.3 #								
Manganese (tot.unfilt)	<1 µg/l	TM152	175 #								
Lead (diss.filt)	<0.2 µg/l	TM152	<0.2 #								
Nickel (tot.unfilt)	<1 µg/l	TM152	46 #								
Manganese (diss.filt)	<3 µg/l	TM152	168 #								
Nickel (diss.filt)	<0.4 µg/l	TM152	42.7 #								
Phosphorus (diss.filt)	<10 µg/l	TM152	34.9 #								
Zinc (tot.unfilt)	<5 µg/l	TM152	56.5 #								
Zinc (diss.filt)	<1 µg/l	TM152	44.5 #								
Sodium (Dis.Filt)	<0.076 mg/l	TM152	23.2 #								
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	8.87 #								
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.04 #								
Calcium (Dis.Filt)	<0.2 mg/l	TM152	171 #								
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.66 #								
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	24.3 #								
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	10.2 #								
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.21 #								
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	179 #								
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.85 #								
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #								

CERTIFICATE OF ANALYSIS

SDG: 250228-43 **Report Number:** 758412 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Customer Sample Ref.	SZC TCA PT
Depth (m)	39.00 - 39.00
Sample Type	Ground Water (GW)
Date Sampled	26/02/2025
Sample Time	17:00:00
Date Received	28/02/2025
SDG Ref	250228-43
Lab Sample No.(s)	31140475
AGS Reference	

Component	LOD/Units	Method	
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.54 #
Nitrogen, Total	<1 mg/l	TM212	8.29 #
Chloride	<0.08 mg/l	TM226	60.5 #
Nitrite as N	<0.01 mg/l	TM226	0.088 ♦ #
Nitrate as N	<0.02 mg/l	TM226	7.26 #
Sulphate as S	<0.04 mg/l	TM226	28.5 #
pH	<1 pH Units	TM256	7.42 #
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.893 #
Alkalinity, Total as CaCO3	<3 mg/l	TM256	330 #
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #

Table of Results - Appendix

Method No	Description
TM226	Determination of Anions in Waters using Ion Chromatography
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250228-43 **Report Number:** 758412 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31140475
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	04-Mar-2025
Anions by ion Chromatography	06-Mar-2025
Anions by Kone (w)	03-Mar-2025
Dissolved Metals by ICP-MS	04-Mar-2025
Low Level Cyanide (W)	05-Mar-2025
Mercury Dissolved	07-Mar-2025
pH Value	05-Mar-2025
Phosphate by Kone (w)	04-Mar-2025
Suspended Solids	07-Mar-2025
Total Metals by ICP-MS	04-Mar-2025
Total Nitrogen	07-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3191
Ammoniacal Nitrogen as N	TM099	**103.2** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3193
Bromide (W)	TM226	**100.0** 95.10 : 103.12
Chloride (W)	TM226	**101.29** 97.34 : 104.29
Fluoride (W)	TM226	**100.83** 96.73 : 103.12
Nitrate (W)	TM226	**100.0** 96.03 : 104.08
Nitrite (W)	TM226	**100.83** 91.30 : 103.05
Phosphate (W)	TM226	**100.0** 96.81 : 103.22
Sulphate (W)	TM226	**101.23** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3152
TON as NO3	TM184	**101.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3110
Aluminium	TM152	**104.33** 95.24 : 111.40
Antimony	TM152	**104.67** 94.33 : 112.23
Arsenic	TM152	**103.17** 94.83 : 110.43
Barium	TM152	**100.83** 93.82 : 113.06
Beryllium	TM152	**103.67** 94.87 : 113.47
Bismuth	TM152	**104.83** 95.28 : 111.68
Borate	TM152	**103.7** 88.00 : 112.00
Boron	TM152	**103.67** 91.82 : 118.71

Dissolved Metals by ICP-MS

		QC 3110
Cadmium	TM152	**104.67** 93.90 : 112.50
Calcium	TM152	**104.67** 94.54 : 110.75
Chromium	TM152	**104.83** 94.18 : 109.80
Cobalt	TM152	**104.83** 93.95 : 109.53
Copper	TM152	**106.5** 93.88 : 110.94
Iron	TM152	**104.0** 95.31 : 109.92
Lead	TM152	**103.0** 94.24 : 111.99
Lithium	TM152	**103.5** 94.28 : 113.28
Magnesium	TM152	**103.33** 93.45 : 108.63
Manganese	TM152	**105.5** 95.81 : 110.44
Molybdenum	TM152	**104.0** 93.46 : 109.15
Nickel	TM152	**105.0** 92.80 : 111.23
Phosphorus	TM152	**102.83** 93.78 : 110.72
Potassium	TM152	**104.67** 95.43 : 111.23
Selenium	TM152	**105.0** 94.10 : 113.00
Silver	TM152	**104.83** 91.22 : 112.22
Sodium	TM152	**103.33** 93.17 : 108.57
Strontium	TM152	**104.33** 95.28 : 111.33
Tellurium	TM152	**106.5** 95.60 : 115.20
Thallium	TM152	**105.67** 73.68 : 123.18
Tin	TM152	**104.83** 93.06 : 109.94
Titanium	TM152	**105.0** 94.67 : 110.97
Tungsten	TM152	**100.33** 93.55 : 109.35
Uranium	TM152	**103.17** 93.98 : 110.48
Vanadium	TM152	**105.5** 92.88 : 110.53
Zinc	TM152	**106.67** 96.14 : 111.23

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3194
Free Cyanide - Low Level	TM279	**107.67** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**101.75** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3100
Mercury Dissolved (CVAF)	TM183	**81.6** 67.00 : 121.00

pH Value

Component	Method Code	QC 3119
Alk QC	TM256	**102.22** 95.60 : 104.93
EC QC	TM256	**104.1** 102.40 : 109.21
pH	TM256	**99.87** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3127
Phosphate (Ortho as PO4)	TM184	**102.8** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3142
Total Suspended Solids	TM022	**102.12** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3134
Aluminium	TM152	**107.0** 96.33 : 113.92
Antimony	TM152	**105.5** 96.72 : 113.02
Arsenic	TM152	**107.33** 99.03 : 112.93
Barium	TM152	**105.67** 96.25 : 112.47

Total Metals by ICP-MS

		QC 3134
Beryllium	TM152	**108.0** 96.97 : 114.57
Bismuth	TM152	**108.83** 98.03 : 113.23
Boron	TM152	**106.67** 93.02 : 118.94
Cadmium	TM152	**107.5** 97.52 : 113.52
Calcium	TM152	**107.33** 96.89 : 111.51
Chromium	TM152	**106.0** 94.35 : 111.51
Cobalt	TM152	**106.83** 94.01 : 112.73
Copper	TM152	**107.33** 98.87 : 112.32
Iron	TM152	**106.67** 95.16 : 111.53
Lead	TM152	**104.83** 98.77 : 111.72
Lithium	TM152	**108.67** 94.55 : 114.95
Magnesium	TM152	**108.67** 95.02 : 111.04
Manganese	TM152	**106.17** 98.09 : 111.48
Molybdenum	TM152	**104.0** 96.83 : 111.30
Nickel	TM152	**107.17** 95.54 : 112.62
Phosphorus	TM152	**106.67** 96.93 : 112.34
Potassium	TM152	**106.67** 97.28 : 111.48
Selenium	TM152	**109.0** 98.23 : 114.73
Silver	TM152	**105.33** 93.73 : 114.93
Sodium	TM152	**108.0** 94.65 : 111.16
Strontium	TM152	**106.33** 94.82 : 112.81
Tellurium	TM152	**106.17** 96.90 : 117.40
Thallium	TM152	**122.0** 80.90 : 121.20
Tin	TM152	**106.17** 95.52 : 112.96
Titanium	TM152	**106.67** 95.47 : 113.37
Uranium	TM152	**106.17** 97.53 : 111.13
Vanadium	TM152	**104.33** 93.91 : 113.24

Total Metals by ICP-MS

		QC 3134
Zinc	TM152	**107.33** 99.32 : 113.74

Total Nitrogen

Component	Method Code	QC 3109
Total Nitrogen	TM212	**88.09** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	07 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250228-45
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758408
Order Number:	55778

We received 1 sample on Friday February 28, 2025 and 1 of these samples were scheduled for analysis which was completed on Friday March 07, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:

Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250228-45 **Report Number:** 758408 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31140588	SZC TCA PT		39.00 - 39.00	26/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250228-45 **Report Number:** 758408 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31140588					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250228-45 **Report Number:** 758408 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.					
			SZC TCA PT					
Depth (m)			39.00 - 39.00					
Sample Type			Ground Water (GW)					
Date Sampled			26/02/2025					
Sample Time			08:00:00					
Date Received			28/02/2025					
SDG Ref			250228-45					
Lab Sample No.(s)			31140588					
AGS Reference								
Suspended solids, Total	<2 mg/l	TM022	4.8 #					
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	0.019 #					
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	0.0244 #					
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.37 #					
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #					
Boron (diss.filt)	<10 µg/l	TM152	25.7 #					
Boron (tot.unfilt)	<20 µg/l	TM152	40.7 #					
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #					
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #					
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #					
Chromium (diss.filt)	<1 µg/l	TM152	<1 #					
Copper (tot.unfilt)	<1 µg/l	TM152	1.51 #					
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #					
Copper (diss.filt)	<0.3 µg/l	TM152	<0.3 #					
Manganese (tot.unfilt)	<1 µg/l	TM152	174 #					
Lead (diss.filt)	<0.2 µg/l	TM152	<0.2 #					
Nickel (tot.unfilt)	<1 µg/l	TM152	2.24 #					
Manganese (diss.filt)	<3 µg/l	TM152	164 #					
Nickel (diss.filt)	<0.4 µg/l	TM152	1.18 #					
Phosphorus (diss.filt)	<10 µg/l	TM152	28.1 #					
Zinc (tot.unfilt)	<5 µg/l	TM152	7.83 #					
Zinc (diss.filt)	<1 µg/l	TM152	4.02 #					
Sodium (Dis.Filt)	<0.076 mg/l	TM152	22.2 #					
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	8.74 #					
Potassium (Dis.Filt)	<0.2 mg/l	TM152	1.98 #					
Calcium (Dis.Filt)	<0.2 mg/l	TM152	169 #					
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.64 #					
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	24.2 #					
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	10.1 #					
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.23 #					
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	181 #					
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.79 #					
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #					

CERTIFICATE OF ANALYSIS

SDG: 250228-45 **Report Number:** 758408 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4♦§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref. SZC TCA PT				
			Depth (m) 39.00 - 39.00				
			Sample Type Ground Water (GW)				
			Date Sampled 26/02/2025				
			Sample Time 08:00:00				
			Date Received 28/02/2025				
			SDG Ref 250228-45				
			Lab Sample No.(s) 31140588				
			AGS Reference				
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #				
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.57 #				
Nitrogen, Total	<1 mg/l	TM212	8.39 #				
Chloride	<0.08 mg/l	TM226	60.4 #				
Nitrite as N	<0.01 mg/l	TM226	0.0819 ♦ #				
Nitrate as N	<0.02 mg/l	TM226	7.32 #				
Sulphate as S	<0.04 mg/l	TM226	28.5 #				
pH	<1 pH Units	TM256	7.39 #				
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.893 #				
Alkalinity, Total as CaCO3	<3 mg/l	TM256	331 #				
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #				

Table of Results - Appendix

Method No	Description
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM226	Determination of Anions in Waters using Ion Chromatography
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250228-45 **Report Number:** 758408 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31140588
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	04-Mar-2025
Anions by ion Chromatography	06-Mar-2025
Anions by Kone (w)	03-Mar-2025
Dissolved Metals by ICP-MS	04-Mar-2025
Low Level Cyanide (W)	05-Mar-2025
Mercury Dissolved	07-Mar-2025
pH Value	05-Mar-2025
Phosphate by Kone (w)	03-Mar-2025
Suspended Solids	07-Mar-2025
Total Metals by ICP-MS	04-Mar-2025
Total Nitrogen	07-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3173
Ammoniacal Nitrogen as N	TM099	**103.6** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3193
Bromide (W)	TM226	**100.0** 95.10 : 103.12
Chloride (W)	TM226	**101.29** 97.34 : 104.29
Fluoride (W)	TM226	**100.83** 96.73 : 103.12
Nitrate (W)	TM226	**100.0** 96.03 : 104.08
Nitrite (W)	TM226	**100.83** 91.30 : 103.05
Phosphate (W)	TM226	**100.0** 96.81 : 103.22
Sulphate (W)	TM226	**101.23** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3152
TON as NO3	TM184	**101.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3110
Aluminium	TM152	**104.33** 95.24 : 111.40
Antimony	TM152	**104.67** 94.33 : 112.23
Arsenic	TM152	**103.17** 94.83 : 110.43
Barium	TM152	**100.83** 93.82 : 113.06
Beryllium	TM152	**103.67** 94.87 : 113.47
Bismuth	TM152	**104.83** 95.28 : 111.68
Borate	TM152	**103.7** 88.00 : 112.00
Boron	TM152	**103.67** 91.82 : 118.71

Dissolved Metals by ICP-MS

		QC 3110
Cadmium	TM152	**104.67** 93.90 : 112.50
Calcium	TM152	**104.67** 94.54 : 110.75
Chromium	TM152	**104.83** 94.18 : 109.80
Cobalt	TM152	**104.83** 93.95 : 109.53
Copper	TM152	**106.5** 93.88 : 110.94
Iron	TM152	**104.0** 95.31 : 109.92
Lead	TM152	**103.0** 94.24 : 111.99
Lithium	TM152	**103.5** 94.28 : 113.28
Magnesium	TM152	**103.33** 93.45 : 108.63
Manganese	TM152	**105.5** 95.81 : 110.44
Molybdenum	TM152	**104.0** 93.46 : 109.15
Nickel	TM152	**105.0** 92.80 : 111.23
Phosphorus	TM152	**102.83** 93.78 : 110.72
Potassium	TM152	**104.67** 95.43 : 111.23
Selenium	TM152	**105.0** 94.10 : 113.00
Silver	TM152	**104.83** 91.22 : 112.22
Sodium	TM152	**103.33** 93.17 : 108.57
Strontium	TM152	**104.33** 95.28 : 111.33
Tellurium	TM152	**106.5** 95.60 : 115.20
Thallium	TM152	**105.67** 73.68 : 123.18
Tin	TM152	**104.83** 93.06 : 109.94
Titanium	TM152	**105.0** 94.67 : 110.97
Tungsten	TM152	**100.33** 93.55 : 109.35
Uranium	TM152	**103.17** 93.98 : 110.48
Vanadium	TM152	**105.5** 92.88 : 110.53
Zinc	TM152	**106.67** 96.14 : 111.23

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3194
Free Cyanide - Low Level	TM279	**107.67** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**101.75** 88.41 : 112.57

Mercury Dissolved

Component	Method Code	QC 3100
Mercury Dissolved (CVAF)	TM183	**81.6** 67.00 : 121.00

pH Value

Component	Method Code	QC 3119
Alk QC	TM256	**102.22** 95.60 : 104.93
EC QC	TM256	**104.1** 102.40 : 109.21
pH	TM256	**99.87** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3190
Phosphate (Ortho as PO4)	TM184	**104.4** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3106
Total Suspended Solids	TM022	**102.92** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3134
Aluminium	TM152	**107.0** 96.33 : 113.92
Antimony	TM152	**105.5** 96.72 : 113.02
Arsenic	TM152	**107.33** 99.03 : 112.93
Barium	TM152	**105.67** 96.25 : 112.47

Total Metals by ICP-MS

		QC 3134
Beryllium	TM152	**108.0** 96.97 : 114.57
Bismuth	TM152	**108.83** 98.03 : 113.23
Boron	TM152	**106.67** 93.02 : 118.94
Cadmium	TM152	**107.5** 97.52 : 113.52
Calcium	TM152	**107.33** 96.89 : 111.51
Chromium	TM152	**106.0** 94.35 : 111.51
Cobalt	TM152	**106.83** 94.01 : 112.73
Copper	TM152	**107.33** 98.87 : 112.32
Iron	TM152	**106.67** 95.16 : 111.53
Lead	TM152	**104.83** 98.77 : 111.72
Lithium	TM152	**108.67** 94.55 : 114.95
Magnesium	TM152	**108.67** 95.02 : 111.04
Manganese	TM152	**106.17** 98.09 : 111.48
Molybdenum	TM152	**104.0** 96.83 : 111.30
Nickel	TM152	**107.17** 95.54 : 112.62
Phosphorus	TM152	**106.67** 96.93 : 112.34
Potassium	TM152	**106.67** 97.28 : 111.48
Selenium	TM152	**109.0** 98.23 : 114.73
Silver	TM152	**105.33** 93.73 : 114.93
Sodium	TM152	**108.0** 94.65 : 111.16
Strontium	TM152	**106.33** 94.82 : 112.81
Tellurium	TM152	**106.17** 96.90 : 117.40
Thallium	TM152	**122.0** 80.90 : 121.20
Tin	TM152	**106.17** 95.52 : 112.96
Titanium	TM152	**106.67** 95.47 : 113.37
Uranium	TM152	**106.17** 97.53 : 111.13
Vanadium	TM152	**104.33** 93.91 : 113.24

Total Metals by ICP-MS

		QC 3134
Zinc	TM152	**107.33** 99.32 : 113.74

Total Nitrogen

Component	Method Code	QC 3109
Total Nitrogen	TM212	**88.09** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	10 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250303-7
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758604
Order Number:	55778

We received 1 sample on Monday March 03, 2025 and 1 of these samples were scheduled for analysis which was completed on Monday March 10, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:

Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250303-7 **Report Number:** 758604 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31151176	SZL TCA PT		39.00 - 39.00	27/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250303-7 **Report Number:** 758604 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31151176					
Customer Sample Reference			SZL TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250303-7 **Report Number:** 758604 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4+§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	
			Depth (m)	39.00 - 39.00
			Sample Type	Ground Water (GW)
			Date Sampled	27/02/2025
			Sample Time	17:00:00
			Date Received	03/03/2025
			SDG Ref	250303-7
			Lab Sample No.(s)	31151176
			AGS Reference	67981
Suspended solids, Total	<2 mg/l	TM022		5.3 #
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099		0.01 #
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099		0.0129 #
Arsenic (diss.filt)	<0.5 µg/l	TM152		1.14 #
Arsenic (tot.unfilt)	<2 µg/l	TM152		<2 #
Boron (diss.filt)	<10 µg/l	TM152		29.9 #
Boron (tot.unfilt)	<20 µg/l	TM152		29.4 #
Cadmium (diss.filt)	<0.08 µg/l	TM152		<0.08 #
Cadmium (tot.unfilt)	<0.5 µg/l	TM152		<0.5 #
Chromium (tot.unfilt)	<3 µg/l	TM152		<3 #
Chromium (diss.filt)	<1 µg/l	TM152		<1 #
Copper (tot.unfilt)	<1 µg/l	TM152		3.13 #
Lead (tot.unfilt)	<1 µg/l	TM152		<1 #
Copper (diss.filt)	<0.3 µg/l	TM152		<0.3 #
Manganese (tot.unfilt)	<1 µg/l	TM152		170 #
Lead (diss.filt)	<0.2 µg/l	TM152		<0.2 #
Nickel (tot.unfilt)	<1 µg/l	TM152		43.7 #
Manganese (diss.filt)	<3 µg/l	TM152		166 #
Nickel (diss.filt)	<0.4 µg/l	TM152		40.1 #
Phosphorus (diss.filt)	<10 µg/l	TM152		37 #
Zinc (tot.unfilt)	<5 µg/l	TM152		42.8 #
Zinc (diss.filt)	<1 µg/l	TM152		40.3 #
Sodium (Dis.Filt)	<0.076 mg/l	TM152		22.4 #
Magnesium (Dis.Filt)	<0.036 mg/l	TM152		9.08 #
Potassium (Dis.Filt)	<0.2 mg/l	TM152		2.04 #
Calcium (Dis.Filt)	<0.2 mg/l	TM152		167 #
Iron (Dis.Filt)	<0.019 mg/l	TM152		2.53 #
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152		24.4 #
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152		9.3 #
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152		2.09 #
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152		177 #
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152		2.85 #
Mercury (diss.filt)	<0.01 µg/l	TM183		<0.01 #

CERTIFICATE OF ANALYSIS

SDG: 250303-7 **Report Number:** 758604 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4♦§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref. SZL TCA PT Depth (m) 39.00 - 39.00 Sample Type Ground Water (GW) Date Sampled 27/02/2025 Sample Time 17:00:00 Date Received 03/03/2025 SDG Ref 250303-7 Lab Sample No.(s) 31151176 AGS Reference 67981
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.54 #
Nitrogen, Total	<1 mg/l	TM212	8.17 #
Chloride	<0.08 mg/l	TM226	62.3 #
Nitrite as N	<0.01 mg/l	TM226	0.116 @ #
Nitrate as N	<0.02 mg/l	TM226	7.48 #
Sulphate as S	<0.04 mg/l	TM226	29.3 #
pH	<1 pH Units	TM256	7.36 #
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.896 #
Alkalinity, Total as CaCO3	<3 mg/l	TM256	335 #
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #

Table of Results - Appendix

Method No	Description
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser
TM226	Determination of Anions in Waters using Ion Chromatography
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250303-7 **Report Number:** 758604 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31151176
Customer Sample Ref.	SZL TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	05-Mar-2025
Anions by ion Chromatography	07-Mar-2025
Anions by Kone (w)	05-Mar-2025
Dissolved Metals by ICP-MS	06-Mar-2025
Low Level Cyanide (W)	07-Mar-2025
Mercury Dissolved	10-Mar-2025
pH Value	07-Mar-2025
Phosphate by Kone (w)	05-Mar-2025
Suspended Solids	10-Mar-2025
Total Metals by ICP-MS	07-Mar-2025
Total Nitrogen	07-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3176
Ammoniacal Nitrogen as N	TM099	**102.0** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3199
Bromide (W)	TM226	**100.0** 95.10 : 103.12
Chloride (W)	TM226	**101.29** 97.34 : 104.29
Fluoride (W)	TM226	**100.83** 96.73 : 103.12
Nitrate (W)	TM226	**100.0** 96.03 : 104.08
Nitrite (W)	TM226	**100.83** 91.30 : 103.05
Phosphate (W)	TM226	**100.83** 96.81 : 103.22
Sulphate (W)	TM226	**101.23** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3120
TON as NO3	TM184	**100.5** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3146
Aluminium	TM152	**104.67** 95.67 : 113.25
Antimony	TM152	**109.0** 96.18 : 111.18
Arsenic	TM152	**104.5** 94.27 : 111.07
Barium	TM152	**108.5** 91.84 : 114.42
Beryllium	TM152	**109.0** 94.83 : 116.93
Bismuth	TM152	**110.5** 95.88 : 111.08
Boron	TM152	**109.0** 92.42 : 121.06
Cadmium	TM152	**109.67** 95.98 : 111.88

Dissolved Metals by ICP-MS

		QC 3146
Calcium	TM152	**104.67** 96.22 : 109.10
Chromium	TM152	**103.5** 95.22 : 109.76
Cobalt	TM152	**102.67** 94.47 : 110.94
Copper	TM152	**104.67** 94.81 : 112.13
Iron	TM152	**103.33** 95.43 : 109.98
Lead	TM152	**108.83** 95.87 : 112.11
Lithium	TM152	**108.0** 93.93 : 115.73
Magnesium	TM152	**104.0** 93.91 : 108.37
Manganese	TM152	**104.67** 95.66 : 110.12
Molybdenum	TM152	**104.33** 93.76 : 109.43
Nickel	TM152	**103.67** 95.01 : 111.19
Phosphorus	TM152	**103.0** 93.82 : 109.72
Potassium	TM152	**104.67** 95.38 : 108.95
Selenium	TM152	**107.0** 94.20 : 113.10
Silver	TM152	**104.5** 94.95 : 112.75
Sodium	TM152	**103.33** 92.99 : 108.70
Strontium	TM152	**107.33** 95.55 : 111.45
Tellurium	TM152	**112.17** 95.38 : 114.78
Thallium	TM152	**124.5** 75.83 : 123.93
Tin	TM152	**108.5** 96.86 : 110.37
Titanium	TM152	**107.17** 95.88 : 112.88
Tungsten	TM152	**105.83** 95.38 : 109.38
Uranium	TM152	**110.17** 95.05 : 110.65
Vanadium	TM152	**108.17** 93.43 : 110.79
Zinc	TM152	**107.0** 95.71 : 112.92

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3105
Free Cyanide - Low Level	TM279	**108.67** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**103.25** 88.41 : 112.57

pH Value

Component	Method Code	QC 3155
Alk QC	TM256	**102.59** 95.60 : 104.93
EC QC	TM256	**105.13** 102.40 : 109.21
pH	TM256	**99.87** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3198
Phosphate (Ortho as PO4)	TM184	**104.0** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3144
Total Suspended Solids	TM022	**101.33** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3198
Aluminium	TM152	**105.33** 96.59 : 112.04
Antimony	TM152	**105.67** 94.33 : 113.73
Arsenic	TM152	**106.33** 95.50 : 114.00
Barium	TM152	**100.67** 93.83 : 113.74
Beryllium	TM152	**107.0** 95.57 : 114.47
Bismuth	TM152	**105.17** 94.38 : 113.78
Boron	TM152	**106.0** 92.64 : 120.37
Cadmium	TM152	**107.5** 94.02 : 114.42

Total Metals by ICP-MS

		QC 3198
Calcium	TM152	**106.67** 95.77 : 111.23
Chromium	TM152	**106.17** 95.30 : 112.48
Cobalt	TM152	**107.0** 93.97 : 111.98
Copper	TM152	**107.67** 95.12 : 113.65
Iron	TM152	**106.0** 95.35 : 111.21
Lead	TM152	**103.67** 96.21 : 112.53
Lithium	TM152	**106.67** 94.18 : 114.18
Magnesium	TM152	**106.0** 93.51 : 110.80
Manganese	TM152	**106.83** 95.89 : 111.89
Molybdenum	TM152	**105.0** 92.74 : 112.14
Nickel	TM152	**107.17** 95.26 : 113.51
Phosphorus	TM152	**104.67** 94.68 : 112.17
Potassium	TM152	**106.67** 96.27 : 111.80
Selenium	TM152	**106.83** 95.18 : 114.88
Silver	TM152	**104.67** 93.47 : 114.17
Sodium	TM152	**105.33** 93.24 : 111.28
Strontium	TM152	**101.67** 95.20 : 113.53
Tellurium	TM152	**106.83** 95.58 : 117.68
Thallium	TM152	**107.17** 77.37 : 120.07
Tin	TM152	**105.17** 95.74 : 111.26
Titanium	TM152	**106.33** 95.58 : 112.18
Uranium	TM152	**104.83** 93.55 : 111.95
Vanadium	TM152	**104.83** 93.41 : 112.78
Zinc	TM152	**107.67** 96.32 : 114.36

Total Nitrogen

Total Nitrogen

Component	Method Code	QC 3118
Total Nitrogen	TM212	**89.73** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	10 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250303-8
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758591
Order Number:	55778

We received 1 sample on Monday March 03, 2025 and 1 of these samples were scheduled for analysis which was completed on Monday March 10, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:

Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250303-8 **Report Number:** 758591 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31151220	SZC TCA PT		39.00 - 39.00	27/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250303-8 **Report Number:** 758591 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31151220					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250303-8 **Report Number:** 758591 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.					
			SZC TCA PT					
Depth (m)			39.00 - 39.00					
Sample Type			Ground Water (GW)					
Date Sampled			27/02/2025					
Sample Time			08:00:00					
Date Received			03/03/2025					
SDG Ref			250303-8					
Lab Sample No.(s)			31151220					
AGS Reference			67981					
Suspended solids, Total	<2 mg/l	TM022	6.75 #					
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	0.016 #					
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	0.0206 #					
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.17 #					
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #					
Boron (diss.filt)	<10 µg/l	TM152	29.2 #					
Boron (tot.unfilt)	<20 µg/l	TM152	28.7 #					
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #					
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #					
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #					
Chromium (diss.filt)	<1 µg/l	TM152	<1 #					
Copper (tot.unfilt)	<1 µg/l	TM152	2.49 #					
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #					
Copper (diss.filt)	<0.3 µg/l	TM152	<0.3 #					
Manganese (tot.unfilt)	<1 µg/l	TM152	167 #					
Lead (diss.filt)	<0.2 µg/l	TM152	<0.2 #					
Nickel (tot.unfilt)	<1 µg/l	TM152	2.98 #					
Manganese (diss.filt)	<3 µg/l	TM152	163 #					
Nickel (diss.filt)	<0.4 µg/l	TM152	2.27 #					
Phosphorus (diss.filt)	<10 µg/l	TM152	25.7 #					
Zinc (tot.unfilt)	<5 µg/l	TM152	12.4 #					
Zinc (diss.filt)	<1 µg/l	TM152	4.76 #					
Sodium (Dis.Filt)	<0.076 mg/l	TM152	22.2 #					
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	9.03 #					
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2 #					
Calcium (Dis.Filt)	<0.2 mg/l	TM152	165 #					
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.52 #					
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	24.1 #					
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	9.29 #					
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.09 #					
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	175 #					
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	4.21 #					
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #					

CERTIFICATE OF ANALYSIS

SDG: 250303-8 **Report Number:** 758591 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Customer Sample Ref.	SZC TCA PT
Depth (m)	39.00 - 39.00
Sample Type	Ground Water (GW)
Date Sampled	27/02/2025
Sample Time	08:00:00
Date Received	03/03/2025
SDG Ref	250303-8
Lab Sample No.(s)	31151220
AGS Reference	67981

Component	LOD/Units	Method	
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.63 #
Nitrogen, Total	<1 mg/l	TM212	7.96 #
Chloride	<0.08 mg/l	TM226	62.4 #
Nitrite as N	<0.01 mg/l	TM226	0.106 @ #
Nitrate as N	<0.02 mg/l	TM226	7.53 #
Sulphate as S	<0.04 mg/l	TM226	29.4 #
pH	<1 pH Units	TM256	7.4 #
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.896 #
Alkalinity, Total as CaCO3	<3 mg/l	TM256	335 #
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #

Table of Results - Appendix

Method No	Description
TM226	Determination of Anions in Waters using Ion Chromatography
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250303-8 **Report Number:** 758591 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31151220
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	05-Mar-2025
Anions by ion Chromatography	07-Mar-2025
Anions by Kone (w)	05-Mar-2025
Dissolved Metals by ICP-MS	06-Mar-2025
Low Level Cyanide (W)	07-Mar-2025
Mercury Dissolved	10-Mar-2025
pH Value	07-Mar-2025
Phosphate by Kone (w)	05-Mar-2025
Suspended Solids	10-Mar-2025
Total Metals by ICP-MS	07-Mar-2025
Total Nitrogen	07-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3176
Ammoniacal Nitrogen as N	TM099	**102.0** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3199
Bromide (W)	TM226	**100.0** 95.10 : 103.12
Chloride (W)	TM226	**101.29** 97.34 : 104.29
Fluoride (W)	TM226	**100.83** 96.73 : 103.12
Nitrate (W)	TM226	**100.0** 96.03 : 104.08
Nitrite (W)	TM226	**100.83** 91.30 : 103.05
Phosphate (W)	TM226	**100.83** 96.81 : 103.22
Sulphate (W)	TM226	**101.23** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3120
TON as NO3	TM184	**100.5** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3146
Aluminium	TM152	**104.67** 95.67 : 113.25
Antimony	TM152	**109.0** 96.18 : 111.18
Arsenic	TM152	**104.5** 94.27 : 111.07
Barium	TM152	**108.5** 91.84 : 114.42
Beryllium	TM152	**109.0** 94.83 : 116.93
Bismuth	TM152	**110.5** 95.88 : 111.08
Boron	TM152	**109.0** 92.42 : 121.06
Cadmium	TM152	**109.67** 95.98 : 111.88

Dissolved Metals by ICP-MS

		QC 3146
Calcium	TM152	**104.67** 96.22 : 109.10
Chromium	TM152	**103.5** 95.22 : 109.76
Cobalt	TM152	**102.67** 94.47 : 110.94
Copper	TM152	**104.67** 94.81 : 112.13
Iron	TM152	**103.33** 95.43 : 109.98
Lead	TM152	**108.83** 95.87 : 112.11
Lithium	TM152	**108.0** 93.93 : 115.73
Magnesium	TM152	**104.0** 93.91 : 108.37
Manganese	TM152	**104.67** 95.66 : 110.12
Molybdenum	TM152	**104.33** 93.76 : 109.43
Nickel	TM152	**103.67** 95.01 : 111.19
Phosphorus	TM152	**103.0** 93.82 : 109.72
Potassium	TM152	**104.67** 95.38 : 108.95
Selenium	TM152	**107.0** 94.20 : 113.10
Silver	TM152	**104.5** 94.95 : 112.75
Sodium	TM152	**103.33** 92.99 : 108.70
Strontium	TM152	**107.33** 95.55 : 111.45
Tellurium	TM152	**112.17** 95.38 : 114.78
Thallium	TM152	**124.5** 75.83 : 123.93
Tin	TM152	**108.5** 96.86 : 110.37
Titanium	TM152	**107.17** 95.88 : 112.88
Tungsten	TM152	**105.83** 95.38 : 109.38
Uranium	TM152	**110.17** 95.05 : 110.65
Vanadium	TM152	**108.17** 93.43 : 110.79
Zinc	TM152	**107.0** 95.71 : 112.92

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3105
Free Cyanide - Low Level	TM279	**108.67** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**103.25** 88.41 : 112.57

pH Value

Component	Method Code	QC 3155
Alk QC	TM256	**102.59** 95.60 : 104.93
EC QC	TM256	**105.13** 102.40 : 109.21
pH	TM256	**99.87** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3198
Phosphate (Ortho as PO4)	TM184	**104.0** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3139
Total Suspended Solids	TM022	**101.86** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3198
Aluminium	TM152	**105.33** 96.59 : 112.04
Antimony	TM152	**105.67** 94.33 : 113.73
Arsenic	TM152	**106.33** 95.50 : 114.00
Barium	TM152	**100.67** 93.83 : 113.74
Beryllium	TM152	**107.0** 95.57 : 114.47
Bismuth	TM152	**105.17** 94.38 : 113.78
Boron	TM152	**106.0** 92.64 : 120.37
Cadmium	TM152	**107.5** 94.02 : 114.42

Total Metals by ICP-MS

		QC 3198
Calcium	TM152	**106.67** 95.77 : 111.23
Chromium	TM152	**106.17** 95.30 : 112.48
Cobalt	TM152	**107.0** 93.97 : 111.98
Copper	TM152	**107.67** 95.12 : 113.65
Iron	TM152	**106.0** 95.35 : 111.21
Lead	TM152	**103.67** 96.21 : 112.53
Lithium	TM152	**106.67** 94.18 : 114.18
Magnesium	TM152	**106.0** 93.51 : 110.80
Manganese	TM152	**106.83** 95.89 : 111.89
Molybdenum	TM152	**105.0** 92.74 : 112.14
Nickel	TM152	**107.17** 95.26 : 113.51
Phosphorus	TM152	**104.67** 94.68 : 112.17
Potassium	TM152	**106.67** 96.27 : 111.80
Selenium	TM152	**106.83** 95.18 : 114.88
Silver	TM152	**104.67** 93.47 : 114.17
Sodium	TM152	**105.33** 93.24 : 111.28
Strontium	TM152	**101.67** 95.20 : 113.53
Tellurium	TM152	**106.83** 95.58 : 117.68
Thallium	TM152	**107.17** 77.37 : 120.07
Tin	TM152	**105.17** 95.74 : 111.26
Titanium	TM152	**106.33** 95.58 : 112.18
Uranium	TM152	**104.83** 93.55 : 111.95
Vanadium	TM152	**104.83** 93.41 : 112.78
Zinc	TM152	**107.67** 96.32 : 114.36

Total Nitrogen

Total Nitrogen

Component	Method Code	QC 3118
Total Nitrogen	TM212	**89.73** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	12 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250304-31
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758753
Order Number:	55778

We received 2 samples on Tuesday March 04, 2025 and 2 of these samples were scheduled for analysis which was completed on Wednesday March 12, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:



Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250304-31 **Report Number:** 758753 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31156912	SZC TCA PT		39.00 - 39.00	01/03/2025
31157043	SZC TCA PT		39.00 - 39.00	01/03/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250304-31 **Report Number:** 758753 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)							31156912				31157043	
Customer Sample Reference							SZC TCA PT				SZC TCA PT	
AGS Reference												
Depth (m)							39.00 - 39.00				39.00 - 39.00	
Container							500ml Plastic (ALE208)	H2SO4 (ALE244)	NaOH (ALE245)	500ml Plastic (ALE208)	H2SO4 (ALE244)	NaOH (ALE245)
Sample Type							GW	GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 2						X			X	
Anions by ion Chromatography	All	NDPs: 0 Tests: 2					X			X		
Anions by Kone (w)	All	NDPs: 0 Tests: 2					X			X		
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 2					X			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 2							X			X
Mercury Dissolved	All	NDPs: 0 Tests: 2					X			X		
pH Value	All	NDPs: 0 Tests: 2					X			X		
Phosphate by Kone (w)	All	NDPs: 0 Tests: 2					X			X		
Suspended Solids	All	NDPs: 0 Tests: 2					X			X		
Total Metals by ICP-MS	All	NDPs: 0 Tests: 2					X			X		
Total Nitrogen	All	NDPs: 0 Tests: 2					X			X		

CERTIFICATE OF ANALYSIS

SDG: 250304-31 **Report Number:** 758753 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4+§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	SZC TCA PT	SZC TCA PT				
			Depth (m)	39.00 - 39.00	39.00 - 39.00				
			Sample Type	Ground Water (GW)	Ground Water (GW)				
			Date Sampled	01/03/2025	01/03/2025				
			Sample Time	16:00:00	09:00:00				
			Date Received	04/03/2025	04/03/2025				
			SDG Ref	250304-31	250304-31				
			Lab Sample No.(s)	31156912	31157043				
			AGS Reference						
Suspended solids, Total	<2 mg/l	TM022		8.55 #	5.1 #				
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099		0.027 #	0.015 #				
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099		0.0347 #	0.0193 #				
Arsenic (diss.filt)	<0.5 µg/l	TM152		<0.5 2 #	<0.5 2 #				
Arsenic (tot.unfilt)	<2 µg/l	TM152		<2 2 #	<2 2 #				
Boron (diss.filt)	<10 µg/l	TM152		28.7 2 #	28.7 2 #				
Boron (tot.unfilt)	<20 µg/l	TM152		27.6 2 #	31.1 2 #				
Cadmium (diss.filt)	<0.08 µg/l	TM152		<0.08 2 #	<0.08 2 #				
Cadmium (tot.unfilt)	<0.5 µg/l	TM152		<0.5 2 #	<0.5 2 #				
Chromium (tot.unfilt)	<3 µg/l	TM152		<3 2 #	<3 2 #				
Chromium (diss.filt)	<1 µg/l	TM152		<1 2 #	<1 2 #				
Copper (tot.unfilt)	<1 µg/l	TM152		1 2 #	1.47 2 #				
Lead (tot.unfilt)	<1 µg/l	TM152		<1 2 #	<1 2 #				
Copper (diss.filt)	<0.3 µg/l	TM152		<0.3 2 #	0.473 2 #				
Manganese (tot.unfilt)	<1 µg/l	TM152		167 2 #	175 2 #				
Lead (diss.filt)	<0.2 µg/l	TM152		<0.2 2 #	0.33 2 #				
Nickel (tot.unfilt)	<1 µg/l	TM152		2.69 2 #	214 2 #				
Manganese (diss.filt)	<3 µg/l	TM152		158 2 #	164 2 #				
Nickel (diss.filt)	<0.4 µg/l	TM152		2.18 2 #	194 2 #				
Phosphorus (diss.filt)	<10 µg/l	TM152		<10 2 #	<10 2 #				
Zinc (tot.unfilt)	<5 µg/l	TM152		7.12 2 #	76.5 2 #				
Zinc (diss.filt)	<1 µg/l	TM152		6.12 2 #	64.5 2 #				
Sodium (Dis.Filt)	<0.076 mg/l	TM152		22.9 2 #	22.5 2 #				
Magnesium (Dis.Filt)	<0.036 mg/l	TM152		8.9 2 #	9.12 2 #				
Potassium (Dis.Filt)	<0.2 mg/l	TM152		2.04 2 #	2.04 2 #				
Calcium (Dis.Filt)	<0.2 mg/l	TM152		175 2 #	177 2 #				
Iron (Dis.Filt)	<0.019 mg/l	TM152		<0.019 2 #	<0.019 2 #				
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152		23.9 2 #	24.5 2 #				
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152		9.17 2 #	9.36 2 #				
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152		2.04 2 #	2.08 2 #				
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152		177 2 #	180 2 #				
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152		4.22 2 #	2.7 2 #				
Mercury (diss.filt)	<0.01 µg/l	TM183		<0.01 2 #	<0.01 2 #				

CERTIFICATE OF ANALYSIS

SDG: 250304-31 **Report Number:** 758753 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4♦§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	SZC TCA PT	SZC TCA PT				
			Depth (m)	39.00 - 39.00	39.00 - 39.00				
			Sample Type	Ground Water (GW)	Ground Water (GW)				
			Date Sampled	01/03/2025	01/03/2025				
			Sample Time	16:00:00	09:00:00				
			Date Received	04/03/2025	04/03/2025				
			SDG Ref	250304-31	250304-31				
			Lab Sample No.(s)	31156912	31157043				
			AGS Reference						
Phosphate (Ortho as P)	<0.02 mg/l	TM184		<0.02 #	<0.02 #				
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184		7.67 #	7.61 #				
Nitrogen, Total	<1 mg/l	TM212		8.1 #	8.07 #				
Chloride	<0.08 mg/l	TM226		61.6 #	62.3 #				
Nitrite as N	<0.01 mg/l	TM226		0.213 @ #	0.225 @ #				
Nitrate as N	<0.02 mg/l	TM226		7.39 #	7.44 #				
Sulphate as S	<0.04 mg/l	TM226		28.9 #	29.1 #				
pH	<1 pH Units	TM256		7.37 #	7.34 #				
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256		0.895 #	0.895 #				
Alkalinity, Total as CaCO3	<3 mg/l	TM256		332 #	330 #				
Cyanide, Free (low level)	<2.5 µg/l	TM279		<2.5 #	<2.5 #				

Table of Results - Appendix

Method No	Description
TM226	Determination of Anions in Waters using Ion Chromatography
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250304-31 **Report Number:** 758753 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31156912	31157043
Customer Sample Ref.	SZC TCA PT	SZC TCA PT
AGS Ref.		
Depth	39.00 - 39.00	39.00 - 39.00
Type	Ground Water	Ground Water
Ammonium Low	09-Mar-2025	09-Mar-2025
Anions by ion Chromatography	12-Mar-2025	12-Mar-2025
Anions by Kone (w)	05-Mar-2025	05-Mar-2025
Dissolved Metals by ICP-MS	06-Mar-2025	06-Mar-2025
Low Level Cyanide (W)	07-Mar-2025	07-Mar-2025
Mercury Dissolved	10-Mar-2025	10-Mar-2025
pH Value	07-Mar-2025	07-Mar-2025
Phosphate by Kone (w)	06-Mar-2025	06-Mar-2025
Suspended Solids	11-Mar-2025	11-Mar-2025
Total Metals by ICP-MS	07-Mar-2025	07-Mar-2025
Total Nitrogen	10-Mar-2025	10-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3153
Ammoniacal Nitrogen as N	TM099	**102.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3123
Bromide (W)	TM226	**99.17** 95.10 : 103.12
Chloride (W)	TM226	**101.29** 97.34 : 104.29
Fluoride (W)	TM226	**100.83** 96.73 : 103.12
Nitrate (W)	TM226	**99.17** 96.03 : 104.08
Nitrite (W)	TM226	**100.0** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**100.62** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3143
Sulphate (soluble)	TM184	**100.4** 94.30 : 107.93
TON as NO3	TM184	**101.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3158	QC 3150
Aluminium	TM152	**108.0** 95.24 : 111.40	**108.0** 95.24 : 111.40
Antimony	TM152	**107.83** 94.33 : 112.23	**108.33** 94.33 : 112.23
Arsenic	TM152	**104.17** 94.83 : 110.43	**104.5** 94.83 : 110.43
Barium	TM152	**104.17** 93.82 : 113.06	**102.67** 93.82 : 113.06
Beryllium	TM152	**113.17** 94.87 : 113.47	**113.0** 94.87 : 113.47
Bismuth	TM152	**109.33** 95.28 : 111.68	**109.5** 95.28 : 111.68
Borate	TM152	**109.26** 88.00 : 112.00	**109.26** 88.00 : 112.00
Boron	TM152	**109.33** 91.82 : 118.71	**109.67** 91.82 : 118.71

Dissolved Metals by ICP-MS

		QC 3158	QC 3150
Cadmium	TM152	**109.17** 93.90 : 112.50	**109.67** 93.90 : 112.50
Calcium	TM152	**108.0** 94.54 : 110.75	**108.0** 94.54 : 110.75
Chromium	TM152	**102.17** 94.18 : 109.80	**102.17** 94.18 : 109.80
Cobalt	TM152	**100.5** 93.95 : 109.53	**101.5** 93.95 : 109.53
Copper	TM152	**101.5** 93.88 : 110.94	**102.0** 93.88 : 110.94
Iron	TM152	**102.0** 95.31 : 109.92	**102.0** 95.31 : 109.92
Lead	TM152	**105.67** 94.24 : 111.99	**105.67** 94.24 : 111.99
Lithium	TM152	**111.67** 94.28 : 113.28	**112.5** 94.28 : 113.28
Magnesium	TM152	**106.0** 93.45 : 108.63	**106.67** 93.45 : 108.63
Manganese	TM152	**102.5** 95.81 : 110.44	**103.5** 95.81 : 110.44
Molybdenum	TM152	**102.17** 93.46 : 109.15	**103.0** 93.46 : 109.15
Nickel	TM152	**100.83** 92.80 : 111.23	**101.5** 92.80 : 111.23
Phosphorus	TM152	**110.17** 93.78 : 110.72	**109.0** 93.78 : 110.72
Potassium	TM152	**107.33** 95.43 : 111.23	**106.0** 95.43 : 111.23
Selenium	TM152	**110.83** 94.10 : 113.00	**109.67** 94.10 : 113.00
Silver	TM152	**101.67** 91.22 : 112.22	**103.17** 91.22 : 112.22
Sodium	TM152	**104.0** 93.17 : 108.57	**104.0** 93.17 : 108.57
Strontium	TM152	**109.0** 95.28 : 111.33	**104.33** 95.28 : 111.33
Tellurium	TM152	**114.83** 95.60 : 115.20	**113.67** 95.60 : 115.20
Thallium	TM152	**110.67** 73.68 : 123.18	**106.83** 73.68 : 123.18
Tin	TM152	**107.5** 93.06 : 109.94	**107.33** 93.06 : 109.94
Titanium	TM152	**109.0** 94.67 : 110.97	**108.83** 94.67 : 110.97
Tungsten	TM152	**103.83** 93.55 : 109.35	**103.5** 93.55 : 109.35
Uranium	TM152	**107.33** 93.98 : 110.48	**107.17** 93.98 : 110.48
Vanadium	TM152	**101.83** 92.88 : 110.53	**100.5** 92.88 : 110.53
Zinc	TM152	**105.0** 96.14 : 111.23	**105.0** 96.14 : 111.23

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3116
Free Cyanide - Low Level	TM279	**108.33** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**105.0** 88.41 : 112.57

pH Value

Component	Method Code	QC 3159	QC 3155
Alk QC	TM256	**102.06** 95.60 : 104.93	**102.59** 95.60 : 104.93
EC QC	TM256	**104.92** 102.40 : 109.21	**105.13** 102.40 : 109.21
pH	TM256	**100.4** 98.26 : 103.07	**99.87** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3155
Phosphate (Ortho as PO4)	TM184	**103.2** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3140
Total Suspended Solids	TM022	**97.88** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3110	QC 3198
Aluminium	TM152	**106.67** 96.59 : 112.04	**105.33** 96.59 : 112.04
Antimony	TM152	**106.67** 94.33 : 113.73	**105.67** 94.33 : 113.73
Arsenic	TM152	**106.83** 95.50 : 114.00	**106.33** 95.50 : 114.00
Barium	TM152	**102.5** 93.83 : 113.74	**100.67** 93.83 : 113.74
Beryllium	TM152	**109.33** 95.57 : 114.47	**107.0** 95.57 : 114.47
Bismuth	TM152	**106.5** 94.38 : 113.78	**105.17** 94.38 : 113.78
Boron	TM152	**107.67** 92.64 : 120.37	**106.0** 92.64 : 120.37
Cadmium	TM152	**109.17** 94.02 : 114.42	**107.5** 94.02 : 114.42

Total Metals by ICP-MS

		QC 3110	QC 3198
Calcium	TM152	**106.0** 95.77 : 111.23	**106.67** 95.77 : 111.23
Chromium	TM152	**107.17** 95.30 : 112.48	**106.17** 95.30 : 112.48
Cobalt	TM152	**107.67** 93.97 : 111.98	**107.0** 93.97 : 111.98
Copper	TM152	**108.5** 95.12 : 113.65	**107.67** 95.12 : 113.65
Iron	TM152	**107.33** 95.35 : 111.21	**106.0** 95.35 : 111.21
Lead	TM152	**105.67** 96.21 : 112.53	**103.67** 96.21 : 112.53
Lithium	TM152	**107.5** 94.18 : 114.18	**106.67** 94.18 : 114.18
Magnesium	TM152	**106.0** 93.51 : 110.80	**106.0** 93.51 : 110.80
Manganese	TM152	**108.5** 95.89 : 111.89	**106.83** 95.89 : 111.89
Molybdenum	TM152	**107.17** 92.74 : 112.14	**105.0** 92.74 : 112.14
Nickel	TM152	**108.5** 95.26 : 113.51	**107.17** 95.26 : 113.51
Phosphorus	TM152	**104.0** 94.68 : 112.17	**104.67** 94.68 : 112.17
Potassium	TM152	**105.33** 96.27 : 111.80	**106.67** 96.27 : 111.80
Selenium	TM152	**106.17** 95.18 : 114.88	**106.83** 95.18 : 114.88
Silver	TM152	**106.67** 93.47 : 114.17	**104.67** 93.47 : 114.17
Sodium	TM152	**106.67** 93.24 : 111.28	**105.33** 93.24 : 111.28
Strontium	TM152	**100.67** 95.20 : 113.53	**101.67** 95.20 : 113.53
Tellurium	TM152	**110.0** 95.58 : 117.68	**106.83** 95.58 : 117.68
Thallium	TM152	**108.5** 77.37 : 120.07	**107.17** 77.37 : 120.07
Tin	TM152	**107.33** 95.74 : 111.26	**105.17** 95.74 : 111.26
Titanium	TM152	**107.5** 95.58 : 112.18	**106.33** 95.58 : 112.18
Uranium	TM152	**106.0** 93.55 : 111.95	**104.83** 93.55 : 111.95
Vanadium	TM152	**104.33** 93.41 : 112.78	**104.83** 93.41 : 112.78
Zinc	TM152	**109.33** 96.32 : 114.36	**107.67** 96.32 : 114.36

Total Nitrogen

Total Nitrogen

Component	Method Code	QC 3130	QC 3144
Total Nitrogen	TM212	**88.21** 86.08 : 109.68	**89.48** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	12 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250304-32
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758754
Order Number:	55778

We received 1 sample on Tuesday March 04, 2025 and 1 of these samples were scheduled for analysis which was completed on Wednesday March 12, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:



Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250304-32 **Report Number:** 758754 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31156935	SZC TCA PT		39.00 - 39.00	28/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250304-32 **Report Number:** 758754 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31156935					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250304-32 **Report Number:** 758754 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4+§@ Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	
			SZC TCA PT	
			Depth (m)	39.00 - 39.00
			Sample Type	Ground Water (GW)
			Date Sampled	28/02/2025
			Sample Time	08:00:00
			Date Received	04/03/2025
			SDG Ref	250304-32
			Lab Sample No.(s)	31156935
			AGS Reference	
Suspended solids, Total	<2 mg/l	TM022	4.55 #	
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	0.017 #	
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	0.0219 #	
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.45 #	
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #	
Boron (diss.filt)	<10 µg/l	TM152	29.4 #	
Boron (tot.unfilt)	<20 µg/l	TM152	33.8 #	
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #	
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #	
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #	
Chromium (diss.filt)	<1 µg/l	TM152	<1 #	
Copper (tot.unfilt)	<1 µg/l	TM152	1.51 #	
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #	
Copper (diss.filt)	<0.3 µg/l	TM152	<0.3 #	
Manganese (tot.unfilt)	<1 µg/l	TM152	172 #	
Lead (diss.filt)	<0.2 µg/l	TM152	<0.2 #	
Nickel (tot.unfilt)	<1 µg/l	TM152	2.57 #	
Manganese (diss.filt)	<3 µg/l	TM152	168 #	
Nickel (diss.filt)	<0.4 µg/l	TM152	2.11 #	
Phosphorus (diss.filt)	<10 µg/l	TM152	27.1 #	
Zinc (tot.unfilt)	<5 µg/l	TM152	9.77 #	
Zinc (diss.filt)	<1 µg/l	TM152	7.91 #	
Sodium (Dis.Filt)	<0.076 mg/l	TM152	22.3 #	
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	8.93 #	
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.12 #	
Calcium (Dis.Filt)	<0.2 mg/l	TM152	181 #	
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.64 #	
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	22.9 #	
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	9.24 #	
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.12 #	
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	170 #	
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.62 #	
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #	

CERTIFICATE OF ANALYSIS

SDG: 250304-32 **Report Number:** 758754 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4+§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	Depth (m)	Sample Type	Date Sampled	Sample Time	Date Received	SDG Ref	Lab Sample No.(s)	AGS Reference
			SZC TCA PT	39.00 - 39.00	Ground Water (GW)	28/02/2025	08:00:00	04/03/2025	250304-32	31156935	
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #								
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.65 #								
Nitrogen, Total	<1 mg/l	TM212	7.92 #								
Chloride	<0.08 mg/l	TM226	61.7 #								
Nitrite as N	<0.01 mg/l	TM226	0.159 @ #								
Nitrate as N	<0.02 mg/l	TM226	7.49 #								
Sulphate as S	<0.04 mg/l	TM226	28.9 #								
pH	<1 pH Units	TM256	7.49 #								
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.894 #								
Alkalinity, Total as CaCO3	<3 mg/l	TM256	329 #								
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #								

Table of Results - Appendix

Method No	Description
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM226	Determination of Anions in Waters using Ion Chromatography
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250304-32 **Report Number:** 758754 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31156935
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	09-Mar-2025
Anions by ion Chromatography	12-Mar-2025
Anions by Kone (w)	06-Mar-2025
Dissolved Metals by ICP-MS	07-Mar-2025
Low Level Cyanide (W)	07-Mar-2025
Mercury Dissolved	10-Mar-2025
pH Value	07-Mar-2025
Phosphate by Kone (w)	06-Mar-2025
Suspended Solids	11-Mar-2025
Total Metals by ICP-MS	07-Mar-2025
Total Nitrogen	10-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3153
Ammoniacal Nitrogen as N	TM099	**102.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3123
Bromide (W)	TM226	**99.17** 95.10 : 103.12
Chloride (W)	TM226	**101.29** 97.34 : 104.29
Fluoride (W)	TM226	**100.83** 96.73 : 103.12
Nitrate (W)	TM226	**99.17** 96.03 : 104.08
Nitrite (W)	TM226	**100.0** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**100.62** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3191
Chloride	TM184	**103.0** 96.61 : 106.93
Sulphate (soluble)	TM184	**100.4** 94.30 : 107.93
TON as NO3	TM184	**102.5** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3153
Aluminium	TM152	**105.67** 96.29 : 111.36
Antimony	TM152	**108.0** 95.87 : 111.07
Arsenic	TM152	**104.67** 97.55 : 110.65
Barium	TM152	**108.67** 95.20 : 110.50
Beryllium	TM152	**108.83** 96.85 : 112.45
Bismuth	TM152	**110.0** 97.83 : 111.23
Borate	TM152	**109.26** 88.00 : 112.00
Boron	TM152	**109.33** 92.57 : 115.00

Dissolved Metals by ICP-MS

		QC 3153
Cadmium	TM152	**107.83** 97.48 : 110.88
Calcium	TM152	**106.0** 97.68 : 109.38
Chromium	TM152	**101.17** 96.27 : 109.04
Cobalt	TM152	**105.17** 92.39 : 111.11
Copper	TM152	**101.83** 97.35 : 110.57
Iron	TM152	**104.0** 97.26 : 109.03
Lead	TM152	**109.67** 94.28 : 110.83
Lithium	TM152	**106.5** 93.83 : 112.33
Magnesium	TM152	**103.33** 95.15 : 108.57
Manganese	TM152	**102.67** 97.38 : 109.22
Molybdenum	TM152	**101.33** 96.03 : 108.83
Nickel	TM152	**101.33** 97.74 : 109.83
Phosphorus	TM152	**104.83** 96.19 : 110.42
Potassium	TM152	**106.0** 97.69 : 109.01
Selenium	TM152	**108.17** 97.20 : 112.90
Silver	TM152	**102.33** 92.98 : 113.08
Sodium	TM152	**102.0** 94.87 : 108.38
Strontium	TM152	**107.67** 98.04 : 109.54
Tellurium	TM152	**110.83** 96.08 : 114.68
Thallium	TM152	**96.5** 77.38 : 126.18
Tin	TM152	**106.83** 94.83 : 110.56
Titanium	TM152	**104.67** 95.20 : 111.60
Tungsten	TM152	**102.67** 93.93 : 109.73
Uranium	TM152	**107.17** 93.52 : 111.02
Vanadium	TM152	**101.17** 93.39 : 111.02
Zinc	TM152	**106.0** 98.01 : 111.94

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3116
Free Cyanide - Low Level	TM279	**108.33** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**105.0** 88.41 : 112.57

pH Value

Component	Method Code	QC 3163
Alk QC	TM256	**101.21** 95.60 : 104.93
EC QC	TM256	**104.92** 102.40 : 109.21
pH	TM256	**100.8** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3168
Phosphate (Ortho as PO4)	TM184	**104.0** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3140
Total Suspended Solids	TM022	**97.88** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3118
Aluminium	TM152	**108.67** 94.84 : 115.96
Antimony	TM152	**105.5** 96.45 : 113.65
Arsenic	TM152	**103.33** 95.62 : 113.52
Barium	TM152	**105.0** 92.82 : 115.88
Beryllium	TM152	**113.17** 94.17 : 119.27
Bismuth	TM152	**107.33** 95.43 : 114.33
Boron	TM152	**111.67** 90.50 : 124.05
Cadmium	TM152	**107.5** 95.83 : 114.63

Total Metals by ICP-MS

		QC 3118
Calcium	TM152	**106.67** 95.58 : 111.65
Chromium	TM152	**105.0** 95.53 : 111.72
Cobalt	TM152	**104.33** 94.51 : 113.34
Copper	TM152	**104.83** 95.21 : 114.14
Iron	TM152	**104.0** 95.43 : 112.35
Lead	TM152	**111.5** 96.24 : 114.78
Lithium	TM152	**114.17** 92.20 : 118.90
Magnesium	TM152	**106.0** 92.81 : 111.36
Manganese	TM152	**105.33** 95.44 : 112.83
Molybdenum	TM152	**105.17** 94.01 : 111.95
Nickel	TM152	**104.5** 95.20 : 113.35
Phosphorus	TM152	**104.0** 93.52 : 112.60
Potassium	TM152	**105.33** 94.95 : 112.01
Selenium	TM152	**106.33** 94.42 : 115.72
Silver	TM152	**105.33** 95.57 : 114.47
Sodium	TM152	**106.0** 92.16 : 111.44
Strontium	TM152	**105.33** 96.40 : 113.75
Tellurium	TM152	**108.0** 96.40 : 116.80
Thallium	TM152	**102.5** 77.82 : 118.92
Tin	TM152	**106.5** 97.32 : 112.45
Titanium	TM152	**106.83** 95.67 : 114.57
Uranium	TM152	**108.0** 95.20 : 112.90
Vanadium	TM152	**106.0** 93.73 : 113.12
Zinc	TM152	**107.33** 96.64 : 114.64

Total Nitrogen

Total Nitrogen

Component	Method Code	QC 3130
Total Nitrogen	TM212	**88.21** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests.
We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

Unit 7-8 Hawarden Business Park
Manor Road (off Manor Lane)
Hawarden
Deeside
CH5 3US
Tel: (01244) 528777
email: hawardencustomerservices@alsglobal.com
Website: www.alsenvironmental.co.uk

WJ Groundwater Ltd
Unit 5
Abbotts Business Park
Primrose Hill
Kings Langley
Hertfordshire
WD4 8FR

Attention: Emily Riley

CERTIFICATE OF ANALYSIS

Date of report Generation:	12 March 2025
Customer:	WJ Groundwater Ltd
Sample Delivery Group (SDG):	250304-33
Your Reference:	SZC TCA PT
Location:	Sizewell IP16 4LL
Report No:	758755
Order Number:	55778

We received 1 sample on Tuesday March 04, 2025 and 1 of these samples were scheduled for analysis which was completed on Wednesday March 12, 2025. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden.

All sample data is provided by the customer. The reported results relate to the sample supplied, and on the basis that this data is correct.
Incorrect sampling dates and/or sample information will affect the validity of results.
The customer is not permitted to reproduce this report except in full without the approval of the laboratory.

Approved By:

Justin Keeton
Business Unit Leader - Land

1291

CERTIFICATE OF ANALYSIS

SDG: 250304-33 **Report Number:** 758755 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
31156958	SZC TCA PT		39.00 - 39.00	28/02/2025

Only received samples which have had analysis scheduled will be shown on the following pages.

CERTIFICATE OF ANALYSIS

SDG: 250304-33 **Report Number:** 758755 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

X Test

N No Determination Possible

Sample Types -
S - Soil/Solid
UNS - Unspecified Solid
GW - Ground Water
SW - Surface Water
LE - Land Leachate
PL - Prepared Leachate
PR - Process Water
SA - Saline Water
TE - Trade Effluent
TS - Treated Sewage
US - Untreated Sewage
RE - Recreational Water
DW - Drinking Water
Non-regulatory
UNL - Unspecified Liquid
SL - Sludge
G - Gas
OTH - Other

Lab Sample No(s)			31156958					
Customer Sample Reference			SZC TCA PT					
AGS Reference								
Depth (m)			39.00 - 39.00					
Container			500ml Plastic (ALE208)	H2SO4 (ALE244)	HNO3 Filtered (ALE204)	HNO3 Unfiltered (ALE204)	NaOH (ALE245)
Sample Type			GW	GW	GW	GW	GW
Ammonium Low	All	NDPs: 0 Tests: 1		X			
Anions by ion Chromatography	All	NDPs: 0 Tests: 1	X				
Anions by Kone (w)	All	NDPs: 0 Tests: 1	X				
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 1			X		
Low Level Cyanide (W)	All	NDPs: 0 Tests: 1					X
Mercury Dissolved	All	NDPs: 0 Tests: 1			X		
pH Value	All	NDPs: 0 Tests: 1	X				
Phosphate by Kone (w)	All	NDPs: 0 Tests: 1	X				
Suspended Solids	All	NDPs: 0 Tests: 1	X				
Total Metals by ICP-MS	All	NDPs: 0 Tests: 1				X	
Total Nitrogen	All	NDPs: 0 Tests: 1	X				

CERTIFICATE OF ANALYSIS

SDG: 250304-33 **Report Number:** 758755 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend

#	ISO17025 accredited.
M	mCERTS accredited.
aq	Aqueous / settled sample.
diss.filt	Dissolved / filtered sample.
tot.unfilt	Total / unfiltered sample.
*	Subcontracted - refer to subcontractor report for accreditation status.
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
***	6:2 FTAB (see appendix)
1-4+§@	Sample deviation (see appendix)

Component	LOD/Units	Method	Customer Sample Ref.	Depth (m)	Sample Type	Date Sampled	Sample Time	Date Received	SDG Ref	Lab Sample No.(s)	AGS Reference
			SZC TCA PT	39.00 - 39.00	Ground Water (GW)	28/02/2025	17:00:00	04/03/2025	250304-33	31156958	
Suspended solids, Total	<2 mg/l	TM022	3.55 #								
Ammoniacal Nitrogen as N (low level)	<0.01 mg/l	TM099	0.025 #								
Ammoniacal Nitrogen Low as NH4	<0.01 mg/l	TM099	0.0321 #								
Arsenic (diss.filt)	<0.5 µg/l	TM152	1.3 #								
Arsenic (tot.unfilt)	<2 µg/l	TM152	<2 #								
Boron (diss.filt)	<10 µg/l	TM152	28.3 #								
Boron (tot.unfilt)	<20 µg/l	TM152	33.9 #								
Cadmium (diss.filt)	<0.08 µg/l	TM152	<0.08 #								
Cadmium (tot.unfilt)	<0.5 µg/l	TM152	<0.5 #								
Chromium (tot.unfilt)	<3 µg/l	TM152	<3 #								
Chromium (diss.filt)	<1 µg/l	TM152	<1 #								
Copper (tot.unfilt)	<1 µg/l	TM152	2.14 #								
Lead (tot.unfilt)	<1 µg/l	TM152	<1 #								
Copper (diss.filt)	<0.3 µg/l	TM152	<0.3 #								
Manganese (tot.unfilt)	<1 µg/l	TM152	173 #								
Lead (diss.filt)	<0.2 µg/l	TM152	<0.2 #								
Nickel (tot.unfilt)	<1 µg/l	TM152	107 #								
Manganese (diss.filt)	<3 µg/l	TM152	167 #								
Nickel (diss.filt)	<0.4 µg/l	TM152	102 #								
Phosphorus (diss.filt)	<10 µg/l	TM152	23.9 #								
Zinc (tot.unfilt)	<5 µg/l	TM152	50.9 #								
Zinc (diss.filt)	<1 µg/l	TM152	51.1 #								
Sodium (Dis.Filt)	<0.076 mg/l	TM152	22.1 #								
Magnesium (Dis.Filt)	<0.036 mg/l	TM152	8.86 #								
Potassium (Dis.Filt)	<0.2 mg/l	TM152	2.1 #								
Calcium (Dis.Filt)	<0.2 mg/l	TM152	181 #								
Iron (Dis.Filt)	<0.019 mg/l	TM152	2.41 #								
Sodium (Tot. Unfilt.)	<0.047 mg/l	TM152	22.8 #								
Magnesium (Tot. Unfilt.)	<0.05 mg/l	TM152	9.31 #								
Potassium (Tot. Unfilt.)	<0.2 mg/l	TM152	2.11 #								
Calcium (Tot. Unfilt.)	<0.057 mg/l	TM152	171 #								
Iron (Tot. Unfilt.)	<0.024 mg/l	TM152	2.85 #								
Mercury (diss.filt)	<0.01 µg/l	TM183	<0.01 #								

CERTIFICATE OF ANALYSIS

SDG: 250304-33 **Report Number:** 758755 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Results Legend
- # ISO17025 accredited.
- M mCERTS accredited.
- aq Aqueous / settled sample.
- diss.filt Dissolved / filtered sample.
- tot.unfilt Total / unfiltered sample.
- * Subcontracted - refer to subcontractor report for accreditation status.
- ** % recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery
- *** 6:2 FTAB (see appendix)
- 1-4+§@ Sample deviation (see appendix)

			Customer Sample Ref.					
			SZC TCA PT					
			Depth (m)	39.00 - 39.00				
			Sample Type	Ground Water (GW)				
			Date Sampled	28/02/2025				
			Sample Time	17:00:00				
			Date Received	04/03/2025				
			SDG Ref	250304-33				
			Lab Sample No.(s)	31156958				
			AGS Reference					
Component	**LOD/Units**	**Method**						
Phosphate (Ortho as P)	<0.02 mg/l	TM184	<0.02 #					
Total Oxidised Nitrogen as N	<0.1 mg/l	TM184	7.62 #					
Nitrogen, Total	<1 mg/l	TM212	7.8 #					
Chloride	<0.08 mg/l	TM226	61.6 #					
Nitrite as N	<0.01 mg/l	TM226	0.187 @ #					
Nitrate as N	<0.02 mg/l	TM226	7.37 #					
Sulphate as S	<0.04 mg/l	TM226	28.7 #					
pH	<1 pH Units	TM256	7.45 #					
Conductivity @ 20 deg.C	<0.02 mS/cm	TM256	0.893 #					
Alkalinity, Total as CaCO3	<3 mg/l	TM256	329 #					
Cyanide, Free (low level)	<2.5 µg/l	TM279	<2.5 #					

Table of Results - Appendix

Method No	Description
TM022	Determination of total suspended solids in waters
TM099	Determination of Ammonium in Water Samples using the Kone Analyser
TM226	Determination of Anions in Waters using Ion Chromatography
TM183	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry
TM184	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers
TM212	Determination of Total Nitrogen by High Temperature Catalytic Oxidation followed by Chemiluminescence Detection
TM152	Analysis of Aqueous Samples by ICP-MS
TM256	Determination of pH, EC, TDS and Alkalinity in Aqueous samples
TM279	Determination of Low Level Easily Liberatable (Free) Cyanides and Total Cyanides in Waters using the Skalar SANS+ System Segmented Flow Analyser

NA = not applicable.
Chemical testing (unless subcontracted) performed at ALS Laboratories (UK) Limited Hawarden (Method codes TM).

CERTIFICATE OF ANALYSIS

SDG: 250304-33 **Report Number:** 758755 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Test Completion Dates

Lab Sample No(s)	31156958
Customer Sample Ref.	SZC TCA PT
AGS Ref.	
Depth	39.00 - 39.00
Type	Ground Water
Ammonium Low	09-Mar-2025
Anions by ion Chromatography	12-Mar-2025
Anions by Kone (w)	05-Mar-2025
Dissolved Metals by ICP-MS	07-Mar-2025
Low Level Cyanide (W)	07-Mar-2025
Mercury Dissolved	10-Mar-2025
pH Value	07-Mar-2025
Phosphate by Kone (w)	06-Mar-2025
Suspended Solids	11-Mar-2025
Total Metals by ICP-MS	07-Mar-2025
Total Nitrogen	10-Mar-2025

ASSOCIATED AQC DATA

Ammonium Low

Component	Method Code	QC 3153
Ammoniacal Nitrogen as N	TM099	**102.8** 88.00 : 112.00

Anions by ion Chromatography

Component	Method Code	QC 3123
Bromide (W)	TM226	**99.17** 95.10 : 103.12
Chloride (W)	TM226	**101.29** 97.34 : 104.29
Fluoride (W)	TM226	**100.83** 96.73 : 103.12
Nitrate (W)	TM226	**99.17** 96.03 : 104.08
Nitrite (W)	TM226	**100.0** 91.30 : 103.05
Phosphate (W)	TM226	**99.17** 96.81 : 103.22
Sulphate (W)	TM226	**100.62** 97.16 : 102.42

Anions by Kone (w)

Component	Method Code	QC 3143
Sulphate (soluble)	TM184	**100.4** 94.30 : 107.93
TON as NO3	TM184	**101.0** 94.45 : 107.35

Dissolved Metals by ICP-MS

Component	Method Code	QC 3153
Aluminium	TM152	**105.67** 96.29 : 111.36
Antimony	TM152	**108.0** 95.87 : 111.07
Arsenic	TM152	**104.67** 97.55 : 110.65
Barium	TM152	**108.67** 95.20 : 110.50
Beryllium	TM152	**108.83** 96.85 : 112.45
Bismuth	TM152	**110.0** 97.83 : 111.23
Borate	TM152	**109.26** 88.00 : 112.00
Boron	TM152	**109.33** 92.57 : 115.00

Dissolved Metals by ICP-MS

		QC 3153
Cadmium	TM152	**107.83** 97.48 : 110.88
Calcium	TM152	**106.0** 97.68 : 109.38
Chromium	TM152	**101.17** 96.27 : 109.04
Cobalt	TM152	**105.17** 92.39 : 111.11
Copper	TM152	**101.83** 97.35 : 110.57
Iron	TM152	**104.0** 97.26 : 109.03
Lead	TM152	**109.67** 94.28 : 110.83
Lithium	TM152	**106.5** 93.83 : 112.33
Magnesium	TM152	**103.33** 95.15 : 108.57
Manganese	TM152	**102.67** 97.38 : 109.22
Molybdenum	TM152	**101.33** 96.03 : 108.83
Nickel	TM152	**101.33** 97.74 : 109.83
Phosphorus	TM152	**104.83** 96.19 : 110.42
Potassium	TM152	**106.0** 97.69 : 109.01
Selenium	TM152	**108.17** 97.20 : 112.90
Silver	TM152	**102.33** 92.98 : 113.08
Sodium	TM152	**102.0** 94.87 : 108.38
Strontium	TM152	**107.67** 98.04 : 109.54
Tellurium	TM152	**110.83** 96.08 : 114.68
Thallium	TM152	**96.5** 77.38 : 126.18
Tin	TM152	**106.83** 94.83 : 110.56
Titanium	TM152	**104.67** 95.20 : 111.60
Tungsten	TM152	**102.67** 93.93 : 109.73
Uranium	TM152	**107.17** 93.52 : 111.02
Vanadium	TM152	**101.17** 93.39 : 111.02
Zinc	TM152	**106.0** 98.01 : 111.94

Low Level Cyanide (W)

Low Level Cyanide (W)

Component	Method Code	QC 3116
Free Cyanide - Low Level	TM279	**108.33** 94.98 : 118.26
Total Cyanide - Low Level	TM279	**105.0** 88.41 : 112.57

pH Value

Component	Method Code	QC 3163
Alk QC	TM256	**101.21** 95.60 : 104.93
EC QC	TM256	**104.92** 102.40 : 109.21
pH	TM256	**100.8** 98.26 : 103.07

Phosphate by Kone (w)

Component	Method Code	QC 3155
Phosphate (Ortho as PO4)	TM184	**103.2** 98.80 : 106.00

Suspended Solids

Component	Method Code	QC 3140
Total Suspended Solids	TM022	**97.88** 94.28 : 106.07

Total Metals by ICP-MS

Component	Method Code	QC 3118
Aluminium	TM152	**108.67** 94.84 : 115.96
Antimony	TM152	**105.5** 96.45 : 113.65
Arsenic	TM152	**103.33** 95.62 : 113.52
Barium	TM152	**105.0** 92.82 : 115.88
Beryllium	TM152	**113.17** 94.17 : 119.27
Bismuth	TM152	**107.33** 95.43 : 114.33
Boron	TM152	**111.67** 90.50 : 124.05
Cadmium	TM152	**107.5** 95.83 : 114.63

Total Metals by ICP-MS

		QC 3118
Calcium	TM152	**106.67** 95.58 : 111.65
Chromium	TM152	**105.0** 95.53 : 111.72
Cobalt	TM152	**104.33** 94.51 : 113.34
Copper	TM152	**104.83** 95.21 : 114.14
Iron	TM152	**104.0** 95.43 : 112.35
Lead	TM152	**111.5** 96.24 : 114.78
Lithium	TM152	**114.17** 92.20 : 118.90
Magnesium	TM152	**106.0** 92.81 : 111.36
Manganese	TM152	**105.33** 95.44 : 112.83
Molybdenum	TM152	**105.17** 94.01 : 111.95
Nickel	TM152	**104.5** 95.20 : 113.35
Phosphorus	TM152	**104.0** 93.52 : 112.60
Potassium	TM152	**105.33** 94.95 : 112.01
Selenium	TM152	**106.33** 94.42 : 115.72
Silver	TM152	**105.33** 95.57 : 114.47
Sodium	TM152	**106.0** 92.16 : 111.44
Strontium	TM152	**105.33** 96.40 : 113.75
Tellurium	TM152	**108.0** 96.40 : 116.80
Thallium	TM152	**102.5** 77.82 : 118.92
Tin	TM152	**106.5** 97.32 : 112.45
Titanium	TM152	**106.83** 95.67 : 114.57
Uranium	TM152	**108.0** 95.20 : 112.90
Vanadium	TM152	**106.0** 93.73 : 113.12
Zinc	TM152	**107.33** 96.64 : 114.64

Total Nitrogen

CERTIFICATE OF ANALYSIS

SDG: 250304-33 **Report Number:** 758755 **Superseded Report:**
Client Ref.: SZC TCA PT **Location:** Sizewell IP16 4LL

Total Nitrogen

Component	Method Code	QC 3114
Total Nitrogen	TM212	**87.96** 86.08 : 109.68

The above information details the reference name of the analytical quality control sample (AQC) that has been run with the samples contained in this report for the different methods of analysis.
The figure detailed is the percentage recovery result for the AQC.
The subscript numbers below are the percentage recovery lower control limit (LCL) and the upper control limit (UCL). The percentage recovery result for the AQC should be between these limits to be statistically in control.

Appendix

General

1. Results are expressed on a dry weight basis (dried at 35ºC) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.

2. If sufficient sample is received a sub sample will be retained free of charge for 15 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of 15 days after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALS reserve the right to charge for samples received and stored but not analysed.

3. With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.

4. We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.

5. If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised.
This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.

6. NDP - No determination possible due to insufficient/unsuitable sample.

7. Results relate only to the items tested.

8. LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.

9. **Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.

10. Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.

11. In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.

12. For dried and crushed preparations of soils volatile loss may occur -
e.g volatile mercury.

13. For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.

14. For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests.
We therefore cannot carry out any unfiltered analysis.
The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.

15. Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l.
Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only.
It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.

16. We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.

17 Data retention. All records, communications and reports pertaining to the analysis are archived for seven years from the date of issue of the final report.

18. **Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as “mixed hydrocarbons”. Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

19. **Sample Deviations**

If a sample is classed as deviated then the associated results may be compromised.

1	**Container with Headspace provided for volatiles analysis**
2	**Incorrect container received**
3	**Deviation from method**
4	**Matrix interference**
♦	**Sample holding time exceeded in laboratory**
@	**Sample holding time exceeded due to late arrival of instructions or samples**
§	**Sampled on date not provided**

20. **Asbestos**

When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2021), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as “Not detected”. If no asbestos fibre types are found all will be reported as “Not detected” and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.

If during the search of the two ‘pinch’ samples by PLM only 1 or 2 fibres or fibre bundles are seen and identified as asbestos, the term ‘trace asbestos identified’ is reported.

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials and soils are obtained from supplied bulk materials and soils which have been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2021).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALS (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining.

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Respirable Fibres

Respirable fibres are defined as fibres of <3 µm diameter, longer than 5 µm and with aspect ratios of at least 3:1 that can be inhaled into the lower regions of the lung and are generally acknowledged to be most important predictor of hazard and risk for cancers of the lung.
Potentially respirable fibres are identified by using a Phase Contrast Microscope.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.
The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

21. 6:2 FTAB

Recovery of 6:2 FTAB in the quality control samples has been observed to be <50% of the target value. Please note the 6:2 FTAB result is supplied as indicative only.

TCA/WRA/16 - Supporting Information

Annexure D – HRA/CRoW Assessment

Sizewell C
The power of good for Britain

Sizewell C Project

Appendix C: Package to Inform Countryside Rights of Way (CRoW) Act Assessment and Habitats Regulations Assessment

Permit TCA/WRA/16

© Copyright 2024 Sizewell C Limited. All rights reserved.

DOCUMENT CONTROL

This document is stored and approved in the Electronic Document and Records Management System (EDRMS).

Prepared by:	[redacted] Graduate Ecologist
Verified by:	[redacted] Technical Director (Ecology)
Approved by:	[redacted]

REVISION HISTORY

Rev	Status	Amendment	Prepared By	Date
01	Draft	Drafting initial document	[redacted]	05/03/25
02	Final	Final document following SZC and Environment Agency comments	[redacted]	31/03/25

CONTENTS

1 INTRODUCTION 5

1.1 Overview 5

1.2 Key Definitions 5

1.3 References 6

1.4 Permit Details 6

1.5 SSSI and Habitat Sites 7

2 TECHNICAL INFORMATION 8

2.1 Permit TCA/WRA/16 8

2.1.1 Details of abstraction method; pump type and location (including national grid references), borehole specifics etc 8

2.1.2 Fish screening details; type, size, etc 8

2.1.3 Groundwater investigation consent details if applicable 8

2.1.4 Pump test results if applicable 8

2.1.5 Groundwater modelling if applicable 8

2.1.6 Surface water modelling if applicable 10

2.1.7 Impoundment details and details of intended operation of impoundment structure 11

2.1.8 Maps and drawings 11

2.1.9 Fish pass detail; type, size, any action being taken to enable fish utilisation 11

2.1.10 Non-native invasive species surveys 11

2.1.11 Protected species surveys 11

2.1.12 Estimation of any habitat loss 11

2.1.13 Details of proposed quantities and abstraction period 12

2.1.14 Hydrological impact assessment if applicable 12

2.1.15 Details of any water level/flow monitoring undertaken including location(s) of monitoring, frequency and data acquired 12

2.1.16 Details of water quality of any water intending to be discharged as part of a dewatering operation 13

2.1.17 Details/assessment of prevailing environmental conditions 13

2.1.18 Details of any mitigation 14

3 INFORMATION TO INFORM THE IN-COMBINATION ASSESSMENT 15

3.1 Other plans and projects 15

4 APPENDICES 21

EA RISKS RELEVANT TO PERMIT TCA/WRA/16 22

EA Risks Relevant to Sizewell Marshes SSSI 22

A.1 EA Risks Relevant to Permit TCA/WRA/16 and Sizewell Marshes SSSI 22

EA Risks Relevant to Minsmere to Walberswick Heaths and Marshes SSSI 24

A.2 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere to Walberswick Heaths and Marshes SSSI 24

EA Risks Relevant to Minsmere to Walberswick Heaths and Marshes SAC 25

A.3 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere to Walberswick Heaths and Marshes SAC 25

EA Risks Relevant to Minsmere-Walberswick SPA 26

A.4 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere-Walberswick SPA 26

EA Risks Relevant to Minsmere-Walberswick Ramsar 28

A.5 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere-Walberswick Ramsar 28

1 INTRODUCTION

1.1 Overview

1.1.1.1 The Sizewell C Project ('SZC Project') is a proposed nuclear power station in respect of which certain planning permission has been granted via The Sizewell C (Nuclear Generating Station) Order 2022 (the "DCO") [1]. The SZC Project will comprise two UK European Pressurised Reactors™ located north of the existing Sizewell B power station in Suffolk. The DCO was made and came into force in 2022 [2]. The DCO was granted based on assessment work (underpinned by extensive baseline surveys and studies) submitted to the Secretary of State. The Secretary of State's (SoS) Habitats Regulations Assessment (HRA) (hereafter referred to as the 'SoS HRA') [3] records his decision on the potential for adverse effects on the integrity of habitat sites as a result of the SZC Project.

1.1.1.2 The SZC Project is currently preparing construction permit applications. These permits are required for several of the works and construction activities. Through the EA Screening Tool, a risk has been identified to Sizewell Marshes SSSI and Minsmere to Walberswick Heath and Marshes SSSI from permit TCA/WRA/16. A risk has also been identified to Minsmere to Walberswick Heaths & Marshes Special Area of Conservation (SAC) and Minsmere-Walberswick Special Protection Area (SPA) and Ramsar site. Therefore, this package has been put together to aid the EA in completing their HRA and CRoW assessments for this permit.

1.2 Key Definitions

Term / Abbreviation	Definition
AOD	Above Ordnance Datum
CRoW	Countryside and Rights of Way Act
DCO	The Sizewell C (Nuclear Generating Station) Order 2022
EA	Environment Agency
ES	Environmental Statement
HRA	Habitats Regulations Assessment
MCA	Main Construction Area
MDS	Main Development Site
mm	Millimetre
NGR	National Grid Reference
SAC	Special Area of Conservation
SoS	Secretary of State
SPA	Special Protection Area
SSSI	Site of Special Scientific Interest
SZC Project	The Sizewell C Project
TCA	Temporary Construction Area
WRAL	Water Resource Abstraction Licence
ZoI	Zone of Influence

1.3 References

Ref	Title	Location	Document No. / Link
[1]	The Sizewell C (Nuclear Generating Station) Order 2022	Online	https://www.legislation.gov.uk/uksi/2022/853/contents/made
[2]	The Sizewell C (Nuclear Generating Station) Order 2022. Made 20th July 2022, Coming into force 11th August 2022	Online	https://infrastructure.planninginspectorate.gov.uk/wp-content/ipc/uploads/projects/EN010012/EN010012-011165-SZC-DCO.pdf
[3]	Secretary of State (Department for Business, Energy and Industrial Strategy) (2022). Habitats Regulations Assessment for an Application Under the Planning Act 2008: Sizewell C New Nuclear Power Station	Online	https://infrastructure.planninginspectorate.gov.uk/wp-content/ipc/uploads/projects/EN010012/EN010012-011167-SZC-HRA.pdf
[4]	Draft Water Monitoring and Management Plan (September 2021)	Online	https://infrastructure.planninginspectorate.gov.uk/wp-content/ipc/uploads/projects/EN010012/EN010012-007610-Sizewell%20C%20Project%20-%20Other-%20SZC%20Bk9%209.87(A)%20Draft%20Water%20Monitoring%20and%20Management%20Plan%20Clean%20Version.pdf
[5]	Environment Agency – Statement of Common Ground (October 2018)	Online	https://infrastructure.planninginspectorate.gov.uk/wp-content/ipc/uploads/projects/EN010012/EN010012-008186-Sizewell%20C%20Project%20-%20Final%20SoCG%2027.pdf#page=13
[6]	Atkins, Hyder, Royal Haskoning DHV. 2015. Sizewell C SSSI Crossings: Environmental appraisal of options under consideration. November 2015	Unpublished but available on request	Unpublished but available on request
[7]	The Sizewell C Project 6.3 Main Development Site Terrestrial Ecology and Ornithology Appendix 14B1 – Plants and Habitats Synthesis Report, Revision 1.0, May 2020, DCO Examination Library Reference APP-250	Online	EN010012-001871-SZC_Bk6_ES_V2_Ch14_Terrestrial_Ecology_Ornithology_Appx14B1_Plants_Habitats_Synthesis.pdf (planninginspectorate.gov.uk)
[8]	Groundwater and surface water DCO ES chapter	Online	EN010012-001912-SZC_Bk6_ES_V2_Ch19_Groundwater_and_Surface_Water.pdf (planninginspectorate.gov.uk)
[9]	Sizewell C, Comments on Written Representations – Appendices, June 2021	Online	EN010012-005470-D3 - The Sizewell C Project - Comments on WRs Appendices.pdf (planninginspectorate.gov.uk)

1.4 Permit Details

1.4.1.1 The permit application with reference number TCA/WRA/16 is an application for a Water Resource Abstraction Licence (WRAL), proposed to enable the abstraction of groundwater through a borehole within

the temporary construction area. This abstracted water is then to be utilised for process water and dust suppression.

1.5 SSSI and Habitat Sites

1.5.1.1 The following SSSI, SACs, SPAs and Ramsar sites have the potential to be affected by the EA's pre-identified risks according to initial EA screening.

Table 1.1 Sensitive Receptor Sites

Sensitive Receptor Site	Distance from Permit location
Sizewell Marshes SSSI	Permit activities are located circa 0.7km northwest of this SSSI
Minsmere to Walberswick SSSI	Permit activities are located circa 2.1km west of this SSSI. The Leiston Drain flows through the SSSI.
Minsmere to Walberswick Heaths and Marshes SAC	Permit activities are located circa 2.2km west of this SAC. The Leiston Drain flows through the SAC.
Minsmere-Walberswick SPA	Permit activities are located circa 2.2km west of this SPA. The Leiston Drain flows through the SPA.
Minsmere-Walberswick Ramsar site	Permit activities are located circa 2.2km west of this Ramsar site. The Leiston Drain flows through the Ramsar site.

2 TECHNICAL INFORMATION

2.1 Permit TCA/WRA/16

2.1.1 Details of abstraction method; pump type and location (including national grid references), borehole specifics etc

2.1.1.1 The proposed methodology is to abstract groundwater from the Crag formation. This abstraction will take place via a borehole to be located at TM 4601264982.

2.1.1.2 The abstraction point is a 300mm diameter borehole screened to allow abstraction of groundwater from the Crag. The daily limit for abstraction is 0.6Ml, with abstraction taking place throughout the year.

2.1.1.3 The maximum yearly abstraction is to be 219Ml, with a maximum hourly abstraction of 50m^3. The maximum flow rate for this abstraction is to be 14 litres per second.

2.1.1.4 The borehole is to be 40 metres deep with an HDPE plastic liner. Figures 1 and 2 in the Appendix show the borehole within the context of designated sites, Wild Aldhurst and the Marsh Harrier Compensation Area for the Sizewell C DCO.

2.1.2 Fish screening details; type, size, etc

2.1.2.1 No fish screening required as the abstractions will not be from a watercourse but from groundwater within the Crag formation.

2.1.3 Groundwater investigation consent details if applicable

2.1.3.1 Ground Investigation Consent (GIC) No. 7/35/3 SZC Crag Borehole (Plan B) V.4 (updated monitoring) has been obtained in accordance with the received pre-application advice AN/035/0003/016 (dated 09/02/2024). The outcome of the GIC is presented in TCA/WRA/16 - Supporting Information (TC 101439918) enclosed as part of this application.

2.1.4 Pump test results if applicable

2.1.4.1 A constant rate test of 11 days was undertaken. A steady flow rate of 7l/s (equivalent to 0.6Ml/d) was maintained during the test and monitoring of water levels showed a maximum drawdown of 0.75m in the pumped well. Following an initially rapid change in water level within the pumped borehole, related to wellbore storage effects, the water level stabilised within 2 hours of the start of pumping and showed little variation for the remainder of the pumping stage of the test. None of the observation points showed an observable response to the pumping. Water levels in the pumped well recovered almost fully within minutes of the cessation of pumping. This is considered to be a function of well loss induced drawdown during the pumping rather than a reflection of water levels in the Crag immediately outside the pumped well. Groundwater levels within the pumped well continued to recover to be in line with pre-test readings by with a difference of 5 cm.

2.1.4.2 The pumping tests confirmed that the real-world response is less than that predicted by either numerical model. It is considered appropriate to use the predicted changes in the numerical models to assess potential impacts as they are more conservative than the results of the pumping test. Full results of the pumping tests are included in Annexure C of the Supporting Information Document included with this permit application.

2.1.5 Groundwater modelling if applicable

2.1.5.1 The impact of this abstraction has been assessed using results from the two available numerical groundwater models in the area, which are the Environment Agency's NEAC model and the SZC-specific groundwater model developed for the DCO. The EA NEAC model is a regional model, but the DCO model is a site-specific groundwater model specifically created to assess the impacts at the area near the proposed works. It is therefore the most detailed model to apply.

2.1.5.2 Abstraction is anticipated to occur from September 1st 2025 to 31st March 2028; however, modelling under the DCO model was conducted for each of the four years following the start of abstraction (with year 2 including the Main Development Site Cut-off Wall and year 3 being the start of Main Development Site dewatering). The data presented are for the locations requested by the EA, located at the edge of the SSSIs in the vicinity of the abstraction (names north, east and south).

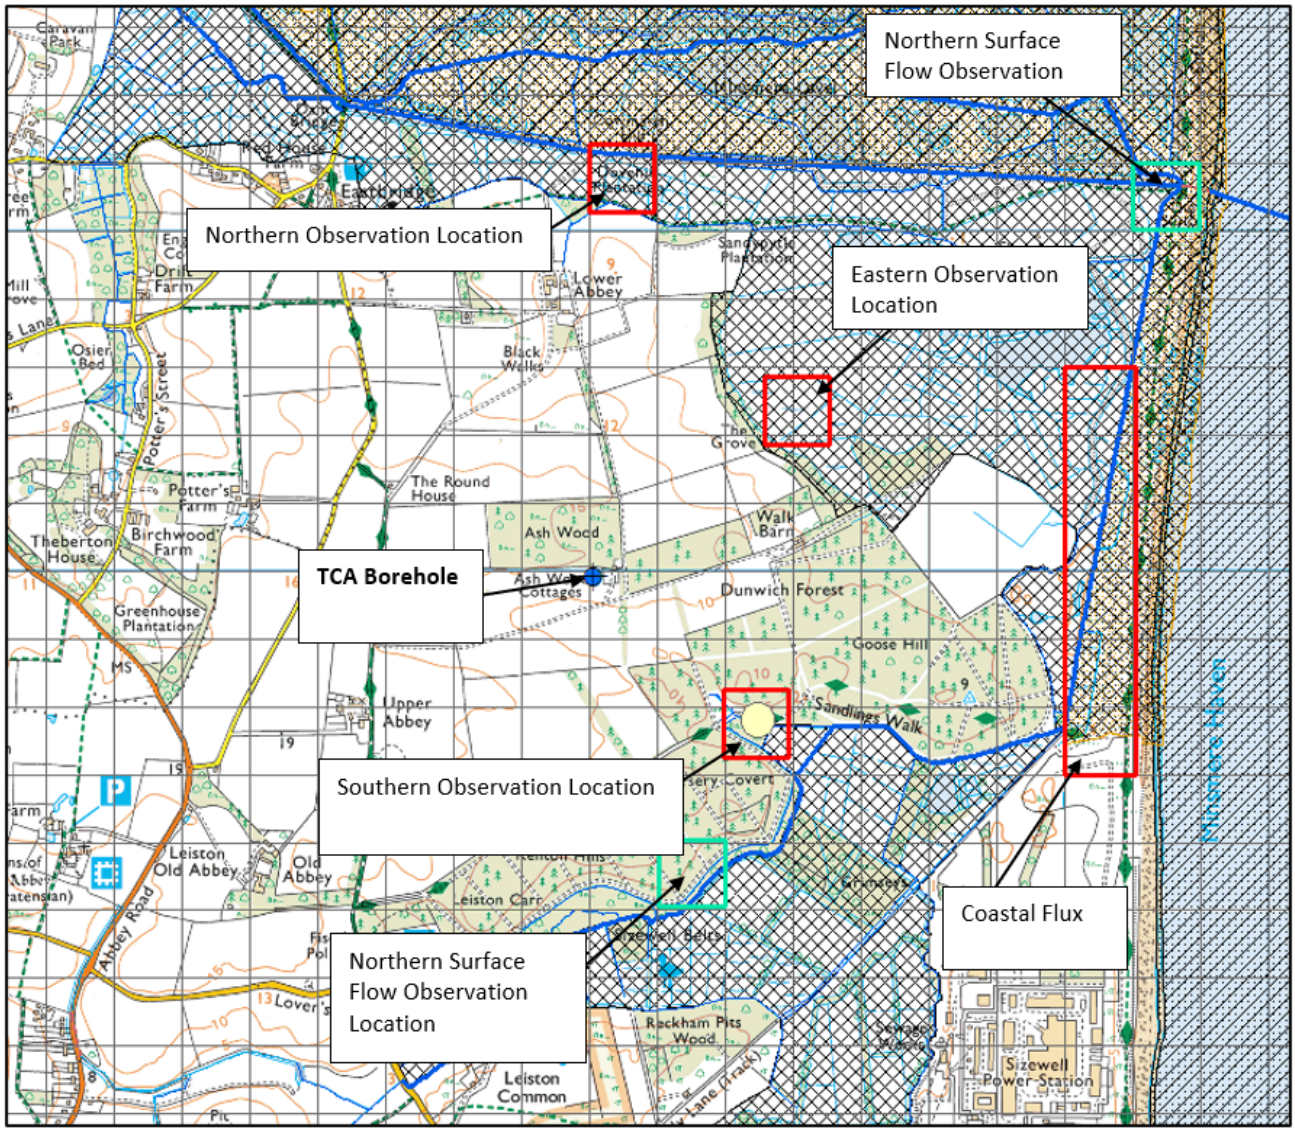


Figure 1 – Model assessment point locations

2.1.5.3 The modelling data shows that the drawdown at the location of abstraction is generally stable between 0.59 m and 0.63 m in the Crag at the four reported model times. The modelled drawdown at the three observation locations, in the Peat, is lower than the drawdown reported at the abstraction location. The

maximum drawdown in the peat after four years of abstraction is 0.12 m at the eastern observation location, 0.09 m at the northern observation location and 0.13 m at the southern observation location.

2.1.5.4 Comparison of modelled values show that the dewatering of the Main Development Site has a limited combined impact on the eastern and northern observation locations with a minor increase in drawdown of 0.02 and 0.01 m respectively. The drawdown at the abstraction location itself is also generally similar with a maximum increase of 0.03 m.

2.1.5.5 The southern observation location reports the largest increase with the Peat reporting a difference of 0.06 m and the Crag (top and bottom) reporting a 0.1 m increase. The southern observation location is the closest observation location to the Main Development Site dewatering, located on the edge of the Sizewell Marshes, and so has the most potential for combined interaction with the dewatering. The final drawdown plot (Year 4 with the impact of the dewatering included) shows that the drawdown across the Peat of the Sizewell Marshes SSSI generally remains below 0.1 m with a small number of highly localised islands with drawdown above 0.1m yet still below 0.2m. These islands may reflect a model artefact rather than acting as a specific predictor of locations where drawdown will exceed 0.1m. This is comparable to the distribution of drawdowns reported in the baseline DCO modelling across the Sizewell Marshes.

2.1.5.6 Further details of the groundwater modelling is included in section 3.1 of the supporting information document included with this permit application.

2.1.6 Surface water modelling if applicable

2.1.6.1 The surface flow/groundwater interaction data has been modelled and analysed and is summarised in Table 2, below.

Table 2 - Surface Flow Data

Discharge Parameter (m^3/s unless specified)	Northern Surface Flow Observation Location		Southern Surface Flow Observation Location	
	DCO	Proposed Abstraction	DCO	Proposed Abstraction
Q95^	0.002	0.00078	0.025	0.025
Q95^ (Ml/d)	0.173	0.067	2.177	2.143
Minimum	-0.26	-0.27	-0.07	-0.06
Maximum	0.46	0.46	0.34	0.35
Total Discharge*	527.42	517.45	475.47	472.61
Total Positive Discharge*	546.71	537.65	475.72	472.96
Total Negative Discharge*	-19.29	-20.19	-0.25	-0.35

^Q95 for dry model run (4 years).
*Total discharge is the cumulative discharge (m^3/s) across the four years of model run
Negative discharge values indicate modelled periods of reversed, upstream, flow at the selected location. These may occur due to e.g. sea level change and inundation or storm events.

2.1.6.2 The modelled Q95 values are not directly comparable to assessment values provided by the EA, because of the location of measurement points, the nature of the model setup (running of a dry model scenario) and associated model calibration and constraints. The original model objectives were not to model flow rates within surface water courses and, whilst calibration of such was undertaken, they could be subject to

significant errors (as discussed in the 2020 numerical modelling report *Atkins Limited. March 2020*[1]). As such, a comparison between the baseline (DCO) and scenario (DCO plus proposed abstraction) model has been undertaken. The modelled data indicates that the abstraction will have little impact on surface water-groundwater interaction at the Sizewell Marshes SSSI.

2.1.6.3 The observation locations discussed below are the locations of the green squares as requested by the EA (see Figure 1, in section 2.1.5 of this document). The reported data and calculated Q95 show that the proposed abstraction will have little impact on the southern surface flow observation location (Leiston Drain, located in the Sizewell Marshes SSSI) with the data suggesting almost no change in Q95 and similar minimum and maximum flow values. The northern surface water flow observation location (representing the confluence of the Leiston Drain and Minsmere New Cut) reports a slightly greater change with a slight reduction in the calculated Q95. However, the minimum and maximum flow rates at the northern location remain similar.

2.1.6.4 The northern location is considered less representative of the area in the vicinity of the Main Development Site and is likely to be less well represented in the model as it is close to/at the northern edge of the model domain. This northern location is therefore less likely to be a reliable representation of flow, as was acknowledged in the 2020 numerical modelling report[1]. The Minsmere River and its flow is not included in the model and the model boundary conditions may have a large impact on the conditions at this location.

2.1.6.5 As stated above, the modelled data indicates that the abstraction will have little impact on surface water-groundwater interaction at the Sizewell Marshes SSSI, which is considered to be the more reliable and representative data point for the purposes of this assessment.

2.1.7 Impoundment details and details of intended operation of impoundment structure

2.1.7.1 There is no anticipated impoundment of water resources that will take place under this permit.

2.1.8 Maps and drawings

2.1.8.1 The abstraction point is to be located as shown on Figure 1, in section 2.1.5 of this document.

2.1.9 Fish pass detail; type, size, any action being taken to enable fish utilisation

2.1.9.1 No fish pass is required since there is no impoundment of any watercourse.

2.1.10 Non-native invasive species surveys

2.1.10.1 No non-native invasive species surveys have been undertaken for the abstraction and none are relevant since the abstraction will take place entirely from groundwater.

2.1.11 Protected species surveys

2.1.11.1 Protected species surveys are not relevant to this abstraction application, or to the assessment of abstraction impacts on designated sites.

2.1.12 Estimation of any habitat loss

[1] *Sizewell C Numerical Modelling Report, R04 (Volume 2, Chapter 19 Appendix A, Groundwater and Surface water: Numerical Modelling Report*

2.1.12.1 Limited temporary habitat loss is anticipated as part of the overall TCA works but there will be no loss within Sizewell Marshes SSSI or from Wild Aldhurst; moreover, abstraction works form a limited part of the overall scheme.

2.1.13 Details of proposed quantities and abstraction period

2.1.13.1 Estimated abstraction volumes are a maximum value of 0.6Ml/day. The maximum yearly abstraction is to be 219Ml, with a maximum hourly abstraction of 50m^3. The maximum flow rate for this abstraction is to be 14 litres per second. Abstraction will occur year-round. Abstraction is expected to take place from September 1st 2025 to 31st March 2028.

2.1.13.2 The maximum value is calculated based on the water supply strategy.

2.1.14 Hydrological impact assessment if applicable

2.1.14.1 A full hydrological impact assessment is included within the supporting information document supplied with this permit application. It's conclusions regarding potential effects at receptors are reproduced below

2.1.14.2 Given the small magnitude of change predicted outside the abstraction borehole it is not considered that there is a mechanism for impact on any of the identified receptors. The DCO modelling indicated that the expected drawdown within the Crag resulting from a maximum abstraction rate of 0.6Ml/d in the TCA borehole would result in a drawdown of less than 0.1m at all existing licenced abstractions except for 7/35/03/*G/0045 and 7/35/03/*G/0051 where the maximum drawdown would be between 0.1m and 0.2m.

2.1.14.3 The EA numerical modelling also indicates that there is no potential impact on surface water.

2.1.14.4 Given the magnitude of the drawdown in both the Crag and the overlying Peat designated sites, as well as the nearby surface water bodies, are not likely to be significantly affected by the abstraction at the new TCA borehole. Additionally, the operation of the TCA borehole is anticipated to be limited to a few years, from September 1st 2025 to 31st March 2028, after which a new desalination plant will be used to supply industrial process water.

2.1.14.5 Taking into account the small magnitude of change predicted outside the abstraction borehole, it is not considered that there is a credible mechanism for effect at any of the identified receptors.

2.1.15 Details of any water level/flow monitoring undertaken including location(s) of monitoring, frequency and data acquired

2.1.15.1 In support of the DCO a numerical model was developed to represent the groundwater and surface water regime in the area of the Sizewell C development. The area covered by the model domain is approximately 60 km2. The numerical model was based on a robust conceptual understanding of the groundwater and surface water flow regimes based on extensive ground investigation and monitoring data. The SZC model was developed to allow appropriate interface with the Environment Agency's regional model (the NEAC model). This meant that suitable boundary conditions could be determined, and model predictions validated against the NEAC model, particularly within the Sizewell Marshes SSSI. Within the domain of the SZC model the grid was refined around areas of interest to allow greater resolution in assessing change. In the Sizewell Marshes SSSI grid cells reduce to be less than 1m in scale. The model includes a coupled representation of groundwater and surface water in the Sizewell Marshes SSSI, which allows change in the interaction between groundwater and surface water to be assessed at each timestep in the model runs.

2.1.15.2 The numerical model was calibrated against real world monitoring data to demonstrate that there is a high degree of correlation between the model behaviour and observed groundwater and surface water responses. Once the baseline model had been developed and validated against real world data as being

suitably representative a series of model runs were undertaken to allow the change associated with individual aspects of the Sizewell C project to be assessed.

2.1.15.3 During the DCO Examination period the Environment Agency set out in their Statement of Common Ground [5] that:

- The SZC numerical model was an appropriate tool to use in assessing change resulting from the construction and operation of Sizewell C (MDS_GW1)
- The groundwater conceptualisation on which the numerical model was based is appropriate (MDS_GW2)
- The surface water conceptualisation on which the numerical model was based is appropriate (MDS_GW3)
- The assessment of predicted impacts is appropriate (MDS_GW6)
- The proposed Water Monitoring and Management Plan (WMMP) (which includes the control structure on the realigned stretch of Sizewell Drain) is appropriate (MDS_GW8)
- The proposed terrestrial ecology assessment methodology, identified impacts, and mitigations is appropriate.

2.1.15.4 The Draft Water Monitoring and Management Plan [4] outlined existing monitoring efforts, consisting of 86 borehole locations to monitor groundwater, Velocity and stage monitoring at 7 locations to monitor surface water and a weather station to monitor rainfall. This plan also sets out further monitoring locations as detailed in plate and table 6.1. This draft was agreed with the EA in the Statement of Common Ground (MDS_GW8).

2.1.15.5 Subsequent to the DCO monitoring of water levels and flows within the Sizewell Marshes has continued. During the revision of the Water Monitoring and Management Plan, more recent (post-DCO) monitoring data was compared to that used during the DCO assessments. This comparison showed that the characterisation of baseline conditions in the Sizewell Marshes SSSI established prior to the DCO remains valid, with no significant deviation in monitoring data. This is set out in para. 4.2.11 of the WMMP recently approved to discharge Requirement 11 of the DCO.

2.1.16 Details of water quality of any water intending to be discharged as part of a dewatering operation

2.1.16.1 Groundwater abstracted under this permit is not being abstracted as part of a dewatering operation. The water abstracted is to be used as process water and dust suppression.

2.1.17 Details/assessment of prevailing environmental conditions

2.1.17.1 During the DCO Examination a note was produced [16] that sets out the water balance in the Sizewell Marshes. Paras. 1.4.14-15 of this note state that (in summary) the majority of the surface water levels and flows within the Sizewell Marshes are comparable between baseline and development model runs through the year. The exception is in the Sizewell Drain at the downstream end of the Sizewell Marshes. Here, there is a small increase in the maximum predicted flow rate, and the frequency at which it occurs. This is

associated with the realigned Sizewell Drain. There is little or no change predicted in the Leiston Drain, downstream of the SSSI.

2.1.17.2 The assessment made during the DCO was based on data and evidence collected prior to submission of the DCO and supporting documentation. This included the draft Water Monitoring and Management Plan [4]. This draft was agreed with the EA in the Statement of Common Ground (MDS_GW8).

2.1.17.3 Subsequent to the DCO monitoring of water levels and flows within the Sizewell Marshes has continued. During the recent revision of the Water Monitoring and Management Plan more recent (post-DCO) monitoring data was compared to that used during the DCO assessments. This comparison showed that the characterisation of baseline conditions in the Sizewell Marshes SSSI established prior to the DCO remains valid, with no significant deviation in monitoring data.

2.1.18 Details of any mitigation

2.1.18.1 Measures are being implemented to address the impacts of the overall project (e.g. via the DCO). No mitigation is proposed regarding protecting SSSIs or designated habitat sites.

2.1.18.2 To avoid undue harm to the groundwater supply, this abstraction is to trade abstraction rights with local farmers to ensure the overall level of abstraction is not increased. This measure is not implemented to specifically mitigate impacts on SSSI, SAC, SPA and Ramsar sites as the shift in abstraction location could still lead to localised changes.

2.1.18.3 Agreement has been reached with the existing licence holders to enter into a trading arrangement starting on September 1st 2025. The end date for the licence trades will be 31 March 2027. The new abstraction in the TCA is downgradient from the location of the donor licences meaning that for the period of the trade there will be no abstraction from these licences offering benefit to the upstream environment. Information regarding the license trading is included in section 2 of the Supporting information document and in the table below.

Table 3 – Licence trading

Licence Reference	Licence Details	Licence Purpose	Licence Limit (m3/yr)	Recent Actual Abstraction (m^3/yr)	Trade Type
7/35/03/*G/0052	N J Bacon Farms	Spray irrigation	107,900	77,392.66	Temporary
7/35/03/*G/0073	Theberton Grange	Spray irrigation	45,640	14,582	Temporary
7/35/3/GS/51	J R Poll	Spray irrigation	47,600	9,520.8	Temporary

2.1.18.4 It is proposed to use existing monitoring infrastructure within the Sizewell Marshes SSSI to identify whether there is any unanticipated change in water levels outside the abstraction borehole Monitoring of water levels is currently undertaken in accordance with the Water Monitoring and Management Plan (WMMP), secured under Requirement 11 of the DCO, which was discharged on 09/04/24. Water levels are monitored at 15-minute intervals at several locations across the Sizewell Marshes SSSI as set out in the WMMP. The scope of this ongoing monitoring is overseen by the Water Management Working Group, which includes representation from the Environment Agency. Following initiation of abstraction, water level monitoring data from the locations identified in the WMMP will be reviewed to identify any deviation from baseline pre-abstraction conditions.

3 INFORMATION TO INFORM THE IN-COMBINATION ASSESSMENT

3.1 Other plans and projects

3.1.1.1 The permit has the potential to interact in combination with other aspects of the Sizewell C project. However, for key risks this has been factored into the overall assessment work undertaken for the DCO. For example:

- offsetting habitat creation for habitat loss in the Sizewell Marshes SSSI from Sizewell C as a whole has already been undertaken at Aldhurst Farm, through the fen meadow plan, and in an area of wet woodland to the west of the Grove through the wet woodland plan. There is no significant habitat loss under this permit which will therefore not affect the plant, invertebrate or bird interest features of the SSSI.
- the Environmental Appraisal of the SSSI crossing options [6] (summarised in Appendix 14B1 – Plants and Habitat Synthesis paragraph 1.3.104 and 1.3.105 [7]), details a modelling exercise that was undertaken to assess the predicted changes in water levels within Leiston Drain as a result of actually constructing the SSSI crossing. This modelling predicted only a very small, highly localised effect, such that during construction, there would be a temporary 2cm reduction in water levels to the east of the crossing and a 1cm reduction to the west. This effect would rapidly diminish over distance, not being apparent beyond a radius of 90m. During the operational phase, water levels would stabilise, and long-term changes are predicted to be less than a 1cm increase in levels to the west of the crossing (i.e. up-gradient), with a corresponding reduction to the east, with no change apparent 60m from the SSSI crossing on both sides; and
- the construction of the Main Construction Area platform (including excavating the temporary ditch diversion and infilling the existing ditch, stockpiling arisings, installation of sheet piles, and improvement for the approach embankment) would result in a loss of part of the existing functional floodplain associated with Sizewell Marshes SSSI. However, compensatory flood storage has already been created, and advice from the EA in the DCO Environmental Statement when this was considered alongside floodplain loss due to the Main Construction Area identifies that when comparing the maximum water levels for the baseline with the development scheme scenarios, the loss contributes to a maximum relative difference of less than 15mm across the floodplain. As such, compensation would not be required due to the small magnitude, and as floodplain connectivity will not be at risk (Paragraph 19.6.70 Sizewell C ES Volume 2, Chapter 19 Groundwater and Surface Water [8]).

3.1.1.2 A summary of related permits granted and sought in respect of the SZC Project is provided below.

Table 3.1 Other related SZC MDS permits, licences and consents

Permit type	SZC permit application reference	Regulator	Regulator permit reference	Activities covered	Status	Location	Timing	Further information
Construction Water Discharge Activity (CWDA)	MDS/CWDA/90	EA	EPR/DB3946KP/A001	Water discharge from three outfall linked in the Temporary Construction Area (TCA) of the Main Development Site.	In determination	TM 47217 64922 TM 46876 64559 TM 46556 64549	October 2025 – end TCA construction	The need for each outfall will be intermittent over this period depending on rainfall and sequencing of work. The EA will be kept updated of any changes to the planned discharge durations.
CWDA	MDS/CWDA/89	EA	EPR/WB3145KB	Discharge of rainfall dependant surface water during the construction of the Sizewell Link Road (SLR). The permit covers 24 outfall locations.	In determination	March 2025 – October 2027	TM 38582 67084 to TM 44494 64905	Construction Water Discharge Activity (CWDA)
FRAP	MDS/FRA/61	EA	EPR/TB3157GQ	Installation of security fencing for the foreshore	Obtained	TM 476 640 to TM 476 637	Now implemented	To facilitate subsequent foreshore and marine consents
FRAP (variation)	MDS/FRA/91	EA	EPR/TB3157GQ/V001	Variation for EPR/TB3157GQ.	Obtained	N/a	Now implemented	N/A – Admin change only
FRAP	MDS/FRA/50	EA	EPR/BB3590JX	Construction of temporary site access tracks for SSSI vegetation clearance (including tree stump removal). Erection of fencing (security and ecological), water voles habitat destruction, including vegetation clearance	Obtained and being implemented	Centroid of MDS: TM473640 SSSI Clearance within the 'SSSI triangle' corners: TM 46972 64083 TM 46996 64446 TM 47392 64532 Water Vole displacement area: Upstream- TM 47298 64506 Downstream- TM 47339 64518	Now implemented	This is to facilitate the SSSI crossing works and ensures that the vegetation within the footprint of the crossing has already been cleared.
FRAP	MCA/FRA/12	EA	EPR/DB3147LF	Construction of the temporary sea defence (TSD) within the main construction area (MCA) of the SZC project. Works include vegetation removal, topsoil stripping, construction of a piling platform and piling of the TSD.	In determination	Construction - January 2025 to end of Q1 2027. Decommission Q4 2034	TM 47627 64317 to TM 47581 63701	
FRAP (variation)	MDS/FRA/73	EA	EPR/BB3590JX/V001	Variation for BB3590JX for name change from NNB Generation Company (SZC) Limited to Sizewell C Limited.	Obtained	N/A	N/A	N/A – Admin change only
FRAP	MCA/FRA/53	EA	EPR/BB3590JX/V002	Variation for SSSI vegetation clearance consent	Obtained	TM 47298 64506 to TM 47339 64518	Now implemented	This is to facilitate the SSSI crossing works and ensures that the vegetation within the

Permit type	SZC permit application reference	Regulator	Regulator permit reference	Activities covered	Status	Location	Timing	Further information
				(EPR_BB3590JX), extension of water vole clearance dates				footprint of the crossing has already been cleared.
FRAP (Variation)	MDS/FRA/56	EA	EPR/BB3590JX/V003	SSSI UXO and vegetation clearance	Obtained and being implemented	Centroid of MDS: TM473640	Now implemented	This is to facilitate the SSSI crossing works and ensures that the vegetation within the footprint of the crossing has already been cleared.
LDC	MDS/LDC/21 MDS/LDC/40 MDS/LDC/41 MDS/LDC/42	ESWMB	22_07411_C 22_07412_C 22_07413_C 22_07414_C 22_07415_C 23_07743_C 23_23639_C 23_23643_C 23_24431_C 23_24434_C 24_26691_C	Mink trapping and monitoring raft. Installing culverts for access. Erection of fencing (security and ecology). Retainment of existing culvert. Installation of silt curtains.	Obtained	MDS/LDC/21 SSSI Clearance within the 'SSSI triangle' corners: TM 46972 64083, TM 46996 64446, TM 47392 64532 Also around Drain Realignment area: Upstream- TM 46972 64083, Downstream- TM 47003 63625 Water Vole displacement area: Upstream- TM 49695 64071, Downstream- TM 47395 64529 MDS/LDC/40 647071 264181 +/- 10m 647178 264299 647033 263738 or 647017 263722 MDS/LDC/41 From 646954 263284 to 647400 264541 MDS/LDC/42 From 646954 263284 to 647400 to 647400 264541	Now implemented	This is to facilitate the SSSI crossing works and ensures that the vegetation within the footprint of the crossing has already been cleared.
FRAP	MCA/FRA/2	EA	To be confirmed – application not yet submitted	Construction of SSSI Crossing including bridge over Leiston Drain and temporary realignment of Leiston Drain.	Obtained	southern end: TM 47339 64432; northern end: TM 47296 64563.	January to March 2025	Similar water quality protection measures will be implemented as standard for the Sizewell C project. Clear span bridge avoiding works within the Leiston Drain.
Water Resources Abstraction (WRA)	MCA/WRA/7	EA	To be confirmed – application not yet submitted	Construction of SSSI Crossing – including bridge over Leiston Drain. Dewatering for piling headscap, to create foundation for the new bridge structures to build upon.	Submitted	**Crossing:** southern end: TM 47339 64432;	Winter 2024/2025	Dewatering of the cofferdams for installation of the pile caps on the SSSI bridge abutments is integral to delivering the SSSI Crossing and will be undertaken simultaneously.

Permit type	SZC permit application reference	Regulator	Regulator permit reference	Activities covered	Status	Location	Timing	Further information
				Sheet piling driven in to the ground, concrete piling used for trench in between.		northern end: TM 47296 64563. **<u>Corners of cofferdams to be dewatered:</u>** Northern cofferdam: 47283 54512, 47284 64508, 47351 64534, 47353 64530 Southern cofferdam: 47293 64482, 47294 64477, 47361 64504, 47363 64500 **<u>Water course activities:</u>** upstream point: TM 47281 64500; downstream point: TM 47347 64522.		
LDC	MCA/LDC/1	ESWMB	ESWMB-SZC-21832Y	SSSI Crossing - Temporary diversion and infilling of former course of Sizewell Drain to facilitate SSSI Crossing earthworks Installation of temporary construction access culverts.	In determination	Winter 2024/25	NGR of upstream connection with Sizewell Drain: TM 47293 64503 NGR of downstream connection with Leiston Drain: TM 47295 264427 NGR of culvert crossings: Point 3.1 TM 47019 64123 Point 3.2 TM 47202 64332 Point 3.3 TM 47319 64464 Eastings and Northings of isolation points at Sizewell Drain to allow permanent realignment construction: 2A Easting – 647378.334 Northing – 264516.957 2B Easting – 647294.163 Northing – 264430.150	LDC

Permit type	SZC permit application reference	Regulator	Regulator permit reference	Activities covered	Status	Location	Timing	Further information
Construction Water Discharge Activity (CWDA)	MDS/CWDA/18	EA	EPR/RP3820SH	Early site drainage, surface water discharges from MCA/TCA/ACA.	In determination	E01 NGR: TM 47654 64054 DW01 NGR: TM 47349 64530 O5 NGR: TM 46463 65940 O7 NGR: TM 46528 63491 O6a NGR: TM 45443 63501 O6b NGR: TM 45442 63495 O6c NGR: TM 45474 63488 O8a NGR: TM 44614 64000 O8 NGR: TM 44466 63737	Estimated from October 2024 to December 2036	
Flood Risk Activity (FRA)	MCA/FRA/8	EA	To be confirmed - application not yet submitted	Sizewell Drain realignment – connection into Leiston Drain including headwall installation and works in/ loss of floodplain due to installation of MCA environmental sheet pile barrier	In preparation	NGR for the reach of Sizewell Drain being realigned: from TM 47021 63731 to TM 47394 64540. NGR for new connection point of Sizewell Drain into Leiston Drain: TM 47038 64437.	Winter 2024/25	Permanent connection to Leiston Drain following realignment will replace the temporary connection created for the SSSI Crossing and will be undertaken later (not simultaneously).
Land Drainage Consent (LDC)	MCA/LDC/5	ESWMB	To be confirmed - application not yet submitted	Sizewell Drain realignment	In preparation	NGR for the reach of Sizewell Drain being realigned: from TM 47021 63731 to TM 47394 64540. NGR for new connection point of Sizewell Drain into Leiston Drain: TM 47038 64437.	Winter 2024/25	Permanent connection to Leiston Drain following realignment will replace the temporary connection created for the SSSI Crossing and will be undertaken later (not simultaneously).
Fish Pass Approval (FPA)	MCA/FPA/1	EA	To be confirmed – application not yet submitted	Sizewell Drain realignment – fish/eel pass	In preparation	NGR for the reach of Sizewell Drain being	Winter 2024/25	Fish pass is ecologically positive and will not have negative effects in combination with

Permit type	SZC permit application reference	Regulator	Regulator permit reference	Activities covered	Status	Location	Timing	Further information
						realigned from TM 47021 63731 to TM 47394 64540.		other works (which will not involve any in channel works).
Water Resources Impoundment Licence (WRIL)	MCA/WRIL/2	EA	To be confirmed – application not yet submitted	Sizewell Drain realignment – permanent level control structure -– weir and control structures on connecting lateral drains	In preparation	Approx NGR: TM 47392 64524.	Winter 2024/2025	The structure is proposed to be set back from the confluence of Sizewell Drain and Leiston Drain by a short distance (ideally by 5 m to 10 m up Sizewell Drain). This weir is being included as a positive structure to enable better control of flows in the Sizewell Drain when and if desired. It is therefore environmentally positive. Blocking of lateral drains being undertaken to enable Sizewell Drain permanent realignment and to prevent hydrological or water quality impacts on Sizewell Marshes SSSI (and thus its role as supporting habitat for birds of Minsmere-Walberswick SPA). These works will therefore work to avoid adverse effects. Hydrological modelling of the straightening of the Sizewell Drain itself (which will be subject to a Land Drainage Consent application) was undertaken for the DCO and will be discussed and presented in the permit to be submitted for the permanent realignment. Modelling confirmed no impact on water quality or hydrology in Sizewell Marshes following drain realignment. Therefore no in combination effects. Similar water quality protection measures will be implemented as standard for the Sizewell C project.
Flood Risk Activity (FRA)	AD6/FRA/1	EA	To be confirmed – application not yet submitted	Construction of crossing of Leiston Drain including works within the floodplain (e.g. mammal tunnel) for bridleway AD6	In preparation	Approximately TM 45444 63497	January to February 2025 then resuming in September 2025 to avoid bird nesting season.	Will be undertaken over the same timescale to the dewatering works covered by this permit and is directly linked as the dewatering is for the pile caps for the bridleway crossing of Leiston Drain. Similar water quality protection measures will be implemented as standard for the Sizewell C project. Clear span bridge avoiding works within the Leiston Drain.

4 APPENDICES

4.1.1.1 The following appendices set out Sizewell C Limited's assessment of EA risks for each permit for each SSSI or Habitat site.

EA RISKS RELEVANT TO PERMIT TCA/WRA/16

EA Risks Relevant to Sizewell Marshes SSSI

A.1 EA Risks Relevant to Permit TCA/WRA/16 and Sizewell Marshes SSSI

EA Risk	Assemblage of breeding and wintering birds	Ditches	Floodplain fen and lowland mire	Invertebrate assemblages [2]	Lowland mire grassland and rush pasture	Vascular plants	Justification
Reduced dilution capacity	**X**	**X**	**X**	**X**	**X**	**X**	Changes in the flow or the velocity regime of a watercourse, or in groundwater levels, could result in an inability to dilute and manage discharges into the same habitat. Reduced dilution capacity could have a direct effect on some of the interest features for which the SSSI is partly designated (notably the ditch habitat and invertebrate populations) as well as indirectly on other SSSI features through potential effects on prey fish and invertebrates, although the Leiston Drain is only one of many watercourses within the foraging distances of relevant SSSI birds. Abstraction of groundwater related to this permit application have been shown to have minimal impact on water levels and quality in surface water flows and thus won't affect dilution capacity. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. There will be no effects on the SSSI habitats, plants or invertebrates.
Habitat Loss	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not cause habitat loss in Leiston Drain or elsewhere in the SSSI (i.e. through drying out of fen and mire) due to the small drawdown levels. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. As a result, there will be no drying out of SSSI habitats or those that support SSSI plants or invertebrate species, or fish on which some SSSI birds feed.
Entrapment/ impingement	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction from ground will not result in any entrapment or impingement of fish species on which SSSI birds might prey and would therefore have no indirect effect on the ability of the SSSI to meet its conservation objectives.
Changes in water levels or table	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not cause reduction in water levels in SSSI fen or mire habitats due to the small drawdown in water levels. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. As a result there will be no change in water levels in Leiston Drain or other SSSI features and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which some SSSI birds feed. There will be no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in flow or velocity regime	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not cause any change in the flow or velocity regime in Leiston Drain, or other SSSI watercourse, due to the small drawdown in water levels. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI below this and with minimal change to

[2] W211 – Open water on disturbed sediments and W314 reed-fen & pools

EA Risk	Assemblage of breeding and wintering birds	Ditches	Floodplain fen and lowland mire	Invertebrate assemblages [2]	Lowland mire grassland and rush pasture	Vascular plants	Justification
							surface water flows. As a result there will be no change in flow or velocity in Leiston Drain and therefore no effect on SSSI habitats, plants or fauna dependent on flows in Leiston Drain or Sizewell Drain.
Changes in surface water flooding	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not cause any change in surface water flooding within Sizewell Marshes SSSI due to the small drawdown in water levels. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. As a result there will be no change in flooding in the SSSI and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed, or habitats on which SSSI birds might roost in the SSSI. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in water chemistry	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not affect water chemistry in the surrounding area or Leiston Drain. As a result, there will be no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed, or habitats on which SSSI birds might roost in the SSSI. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in salinity regime	**X**	**X**	**X**	**X**	**X**	**X**	Abstraction will not cause any change in the salinity regime in Leiston Drain or other watercourses in the SSSI due to the small drawdown in water levels and the fact that groundwater and surface water are in continuity. Results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. As a result, there will be no change in salinity regime in SSSI watercourses.
Change in freshwater flows to estuary	**X**	**X**	**X**	**X**	**X**	**X**	The abstraction will not significantly affect flows in the Leiston Drain as results of modelling at the nearest point of Sizewell Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.10m in year 1 and less in following years, with drawdowns over much of the SSSI being below this and with minimal change to surface water flows. Additionally, there is no estuarine component to Sizewell Marshes SSSI.

A.2 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere to Walberswick Heaths and Marshes SSSI

EA Risk	Aggregations of breeding and non-breeding birds[3]	Habitats[4]	Invertebrate assemblages[5]	Botanical interest and vascular plant assemblage[6]	Justification
Reduced dilution capacity	**X**	**X**	**X**	**X**	Changes in the flow or the velocity regime of a watercourse could result in an inability to dilute and manage discharges into the same habitat. Reduced dilution capacity could have an indirect effect on some of the interest features for which the SSSI is partly designated through potential effects on prey fish and invertebrates, although the Leiston Drain is only one of many watercourses within the foraging distances of relevant SSSI birds. Abstraction of ground water related to this permit application have been shown to have minimal on water levels and quality in surface water flows and thus won't affect dilution capacity. Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. There will be no effects on the SSSI habitats, plants or invertebrates.
Habitat Loss	**X**	**X**	**X**	**X**	Abstraction will not cause habitat loss due to the small drawdown levels. Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. As a result there will be no drying out of habitats that would support wetland fish or invertebrate species, or aquatic plants, on which some SSSI birds feed. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Entrapment/impingement	**X**	**X**	**X**	**X**	Abstraction from ground will not result in any entrapment or impingement of fish species on which SSSI birds might prey and would therefore have no indirect effect on the ability of the SSSI to meet its conservation objectives. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Changes in water levels or table	**X**	**X**	**X**	**X**	Abstraction will not cause reduction in water levels in Leiston Drain due to the small drawdown in water levels and the fact that groundwater and surface water are in continuity. Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. As a result there will be no change in water levels in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which some SSSI birds feed. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in flow or velocity regime	**X**	**X**	**X**	**X**	Abstraction will not cause any change in the flow or velocity regime in Leiston Drain due to the small drawdown in water levels outside the sheet piling retaining wall and the fact that groundwater and surface water are in continuity Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. As a result there will be no change in flow or velocity in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.

[3] See section 3.3 for the full list of avian features
[4] See section 3.3 for the full list of designated habitats
[5] See section 3.3 for the full list of invertebrate assemblage features
[6] See section 3.3 for the full list of designated botanical interest features, including vascular plant assemblage.

EA Risk	Aggregations of breeding and non-breeding birds[3]	Habitats[4]	Invertebrate assemblages[5]	Botanical interest and vascular plant assemblage[6]	Justification
Changes in surface water flooding					Abstraction will not cause any change in surface water flooding within Sizewell Marshes SSSI due to the small drawdown in water levels Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. As a result there will be no change in flooding in the SSSI and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed, or habitats on which SSSI birds might roost in the SSSI. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in water chemistry	**X**	**X**	**X**	**X**	Abstraction will not affect water chemistry in the surrounding area or Leiston Drain. As a result there will be no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed, or habitats on which SSSI birds might roost in the SSSI. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in salinity regime					Abstraction will not cause any change in the salinity regime in Leiston Drain due to the small drawdown in water levels Results of modelling within Minsmere to Walberswick Heaths and Marshes SSSI indicate that the drawdowns in the peat would be a maximum of 0.12m, with minimal change to surface water flows. As a result there will be no change in salinity regime in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SSSI birds feed. There will be no direct effects on the SSSI itself and no direct or indirect effects on SSSI habitats, plants or invertebrates.
Change in freshwater flows to estuary	**X**	**X**	**X**	**X**	The abstraction will not substantially affect flows in the Leiston Drain. There is no estuary that would be affected by abstraction or discharges via Leiston Drain. The Leiston Drain ultimately drains to the sea via a control structure on Minsmere New Cut. Therefore there will be no change in freshwater flows to sea.

EA Risks Relevant to Minsmere to Walberswick Heaths and Marshes SAC

A.3 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere to Walberswick Heaths and Marshes SAC

EA Risk	Annual vegetation of drift lines	European dry heaths	Perennial vegetation on stony banks	Justification
Reduced dilution capacity	**X**	**X**	**X**	All three SAC habitats are dry habitats that rely on freely draining substrates and are not dependent on flowing or standing water, or a high-water table.
Habita Loss	**X**	**X**	**X**	
Entrapment/impingement	**X**	**X**	**X**	
Changes in water levels or table	**X**	**X**	**X**	

EA Risk	Annual vegetation of drift lines	European dry heaths	Perennial vegetation on stony banks	Justification
Change in flow or velocity regime	**X**	**X**	**X**	
Changes in surface water flooding	**X**	**X**	**X**	
Change in water chemistry	**X**	**X**	**X**	
Change in salinity regime	**X**	**X**	**X**	
Change in freshwater flows to estuary	**X**	**X**	**X**	

EA Risks Relevant to Minsmere-Walberswick SPA

A.4 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere-Walberswick SPA

EA Risk	Aggregations of breeding and non-breeding birds[7]	Justification
Reduced dilution capacity	**X**	Changes in the flow or the velocity regime of a watercourse could result in an inability to dilute and manage discharges into the same habitat. Reduced dilution capacity could have an indirect effect on some of the interest features for which the SPA is designated through potential effects on prey fish and invertebrates, although the Leiston Drain is only one of many watercourses within the foraging distances of relevant SPA birds. Drawdown won't affect levels in Leiston drain and thus won't affect dilution capacity, as groundwater is in hydraulic continuity with the Leiston Drain and water will be returned to the drain. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows.
Habitat Loss	**X**	Abstraction will not cause habitat loss in Leiston Drain due to the small drawdown levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no drying out of habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed. There will be no direct effects on the SPA itself.
Entrapment/impingement	**X**	Since it is abstraction from groundwater and will result in negligible change in water levels or flows, abstraction will not result in any entrapment or impingement of fish species on which SPA birds might prey and would therefore have no indirect effect on the ability of the SPA to meet its conservation objectives. There will be no direct effects on the SPA itself.
Changes in water levels or table	**X**	Abstraction will not cause reduction in water levels in Leiston Drain due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows.

[7] See section 3.5 for the full list of avian features

EA Risk	Aggregations of breeding and non-breeding birds[7]	Justification
		As a result there will be no change in water levels in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed. There will be no direct effects on the SPA itself.
Change in flow or velocity regime	**X**	Abstraction will not cause any change in the flow or velocity regime in Leiston Drain due to the small drawdown in water levels outside the sheet piling retaining wall , Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no significant change in flow or velocity in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed. There will be no direct effects on the SPA itself.
Changes in surface water flooding	**X**	Abstraction will not cause any change in surface water flooding within Sizewell Marshes SSSI due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in flooding in the SSSI and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed, or habitats on which SPA birds might roost in the SSSI. There will be no direct effects on the SPA itself.
Change in water chemistry	**X**	Abstraction will not affect water chemistry in the surrounding area or Leiston Drain. As a result there will be no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed, or habitats on which SPA birds might roost in the SSSI. There will be no direct effects on the SPA itself.
Change in salinity regime	**X**	Abstraction will not cause any change in the salinity regime in Leiston Drain due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in salinity regime in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which SPA birds feed. There will be no direct effects on the SPA itself.
Change in freshwater flows to estuary	**X**	The abstraction will not affect flows in the Leiston Drain. There is no estuary that would be affected by abstraction or discharges via Leiston Drain. The Leiston Drain ultimately drains to the sea via a control structure on Minsmere New Cut. Therefore there will be no change in freshwater flows to sea.


A.5 EA Risks Relevant to Permit TCA/WRA/16 and Minsmere-Walberswick Ramsar

EA Risk	Criterion 1 (habitats[8])	Criterion 2 (plants, breeding birds and invertebrates[9])	Justification
Reduced dilution capacity	**X**	**X**	Changes in the flow or the velocity regime of a watercourse could result in an inability to dilute and manage discharges into the same habitat. Reduced dilution capacity could have an indirect effect on some of the interest features for which the Ramsar is partly designated through potential effects on prey fish and invertebrates, although the Leiston Drain is only one of many watercourses within the foraging distances of relevant Ramsar birds. Drawdown won't affect levels in Leiston drain and thus won't affect dilution capacity, as groundwater is in hydraulic continuity with the Leiston Drain and water will be returned to the drain. Moreover, a sheet piling retaining wall will be in place to limit hydraulic connection to the wider groundwater body. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Habitat Loss	**X**	**X**	Abstraction will not cause habitat loss in Leiston Drain due to the small drawdown levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no drying out of habitats that would support wetland fish or invertebrate species, or aquatic plants, on which some Ramsar birds feed. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Entrapment/impingement	**X**	**X**	Since it is abstraction of groundwater and will result in negligible change in water levels or flows, abstraction will not result in any entrapment or impingement of fish species on which Ramsar birds might prey and would therefore have no indirect effect on the ability of the Ramsar to meet its conservation objectives. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Changes in water levels or table	**X**	**X**	Abstraction will not cause reduction in water levels in Leiston Drain due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in water levels in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which some Ramsar birds feed. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Change in flow or velocity regime	**X**	**X**	Abstraction will not cause any change in the flow or velocity regime in Leiston Drain due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result, there will be no change in flow or velocity in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which Ramsar birds feed. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Changes in surface water flooding	**X**	**X**	Abstraction will not cause any change in surface water flooding within Sizewell Marshes SSSI due to the small drawdown in water levels. Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in flooding in the SSSI and therefore no effect on habitats that would support

[8] Ramsar Criterion 1: The site contains a mosaic of marine, freshwater, marshland and associated habitats, complete with transition areas in between. Contains the largest continuous stand of reedbeds in England and Wales and rare transition in grazing marsh ditch plants from brackish to fresh water.
[9] Ramsar Criterion 2: This site supports nine nationally scarce plants and at least 26 red data book invertebrates. Supports a population of the mollusc *Vertigo angustior* (Habitats Directive Annex II; British Red Data Book Endangered), recently discovered on the Blyth estuary river walls. An important assemblage of rare breeding birds associated with marshland and reedbeds including: *Botaurus stellaris, Anas strepera, Anas crecca, Anas clypeata, Circus aeruginosus, Recurvirostra avosetta, Panurus biarmicus*

EA Risk	Criterion 1 (habitats[8])	Criterion 2 (plants, breeding birds and invertebrates[9])	Justification
			wetland fish or invertebrate species, or aquatic plants, on which Ramsar birds feed, or habitats on which Ramsar birds might roost in the SSSI. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Change in water chemistry	**X**	**X**	Abstraction will not affect water chemistry in the surrounding area or Leiston Drain. As a result there will be no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which Ramsar birds feed, or habitats on which Ramsar birds might roost in the SSSI. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Change in salinity regime	**X**	**X**	Abstraction will not cause any change in the salinity regime in Leiston Drain due to the small drawdown in water levels Results of modelling at the nearest point of the habitat site to the abstraction indicate that the drawdowns in the peat would be a maximum of 0.09m in year 2 with drawdowns of 0.01 in other years, with minimal change to surface water flows. As a result there will be no change in salinity regime in Leiston Drain and therefore no effect on habitats that would support wetland fish or invertebrate species, or aquatic plants, on which Ramsar birds feed. There will be no direct effects on the Ramsar itself and no direct or indirect effects on Ramsar habitats, plants or invertebrates.
Change in freshwater flows to estuary	**X**	**X**	The abstraction will not affect flows in the Leiston Drain. There is no estuary that would be affected by abstraction or discharges via Leiston Drain. The Leiston Drain ultimately drains to the sea via a control structure on Minsmere New Cut. Therefore there will be no change in freshwater flows to sea.

Filename: \\ra.aecomnet.com\lfs\EMEA\Basingstoke-UKBAS1\Legacy\UKBAS1PFILW001\4400 - Management Services\5004 - Information Systems\60568834_SizewellC\Planning Application 2024_2025\02_Maps\SZC_TCA_Borehole_Figures\SZC_TCA_Borehole_Fig1.mxd Revision: 0 Drawn: JA Checked: KH Approved: SK Date: 2025-04-01

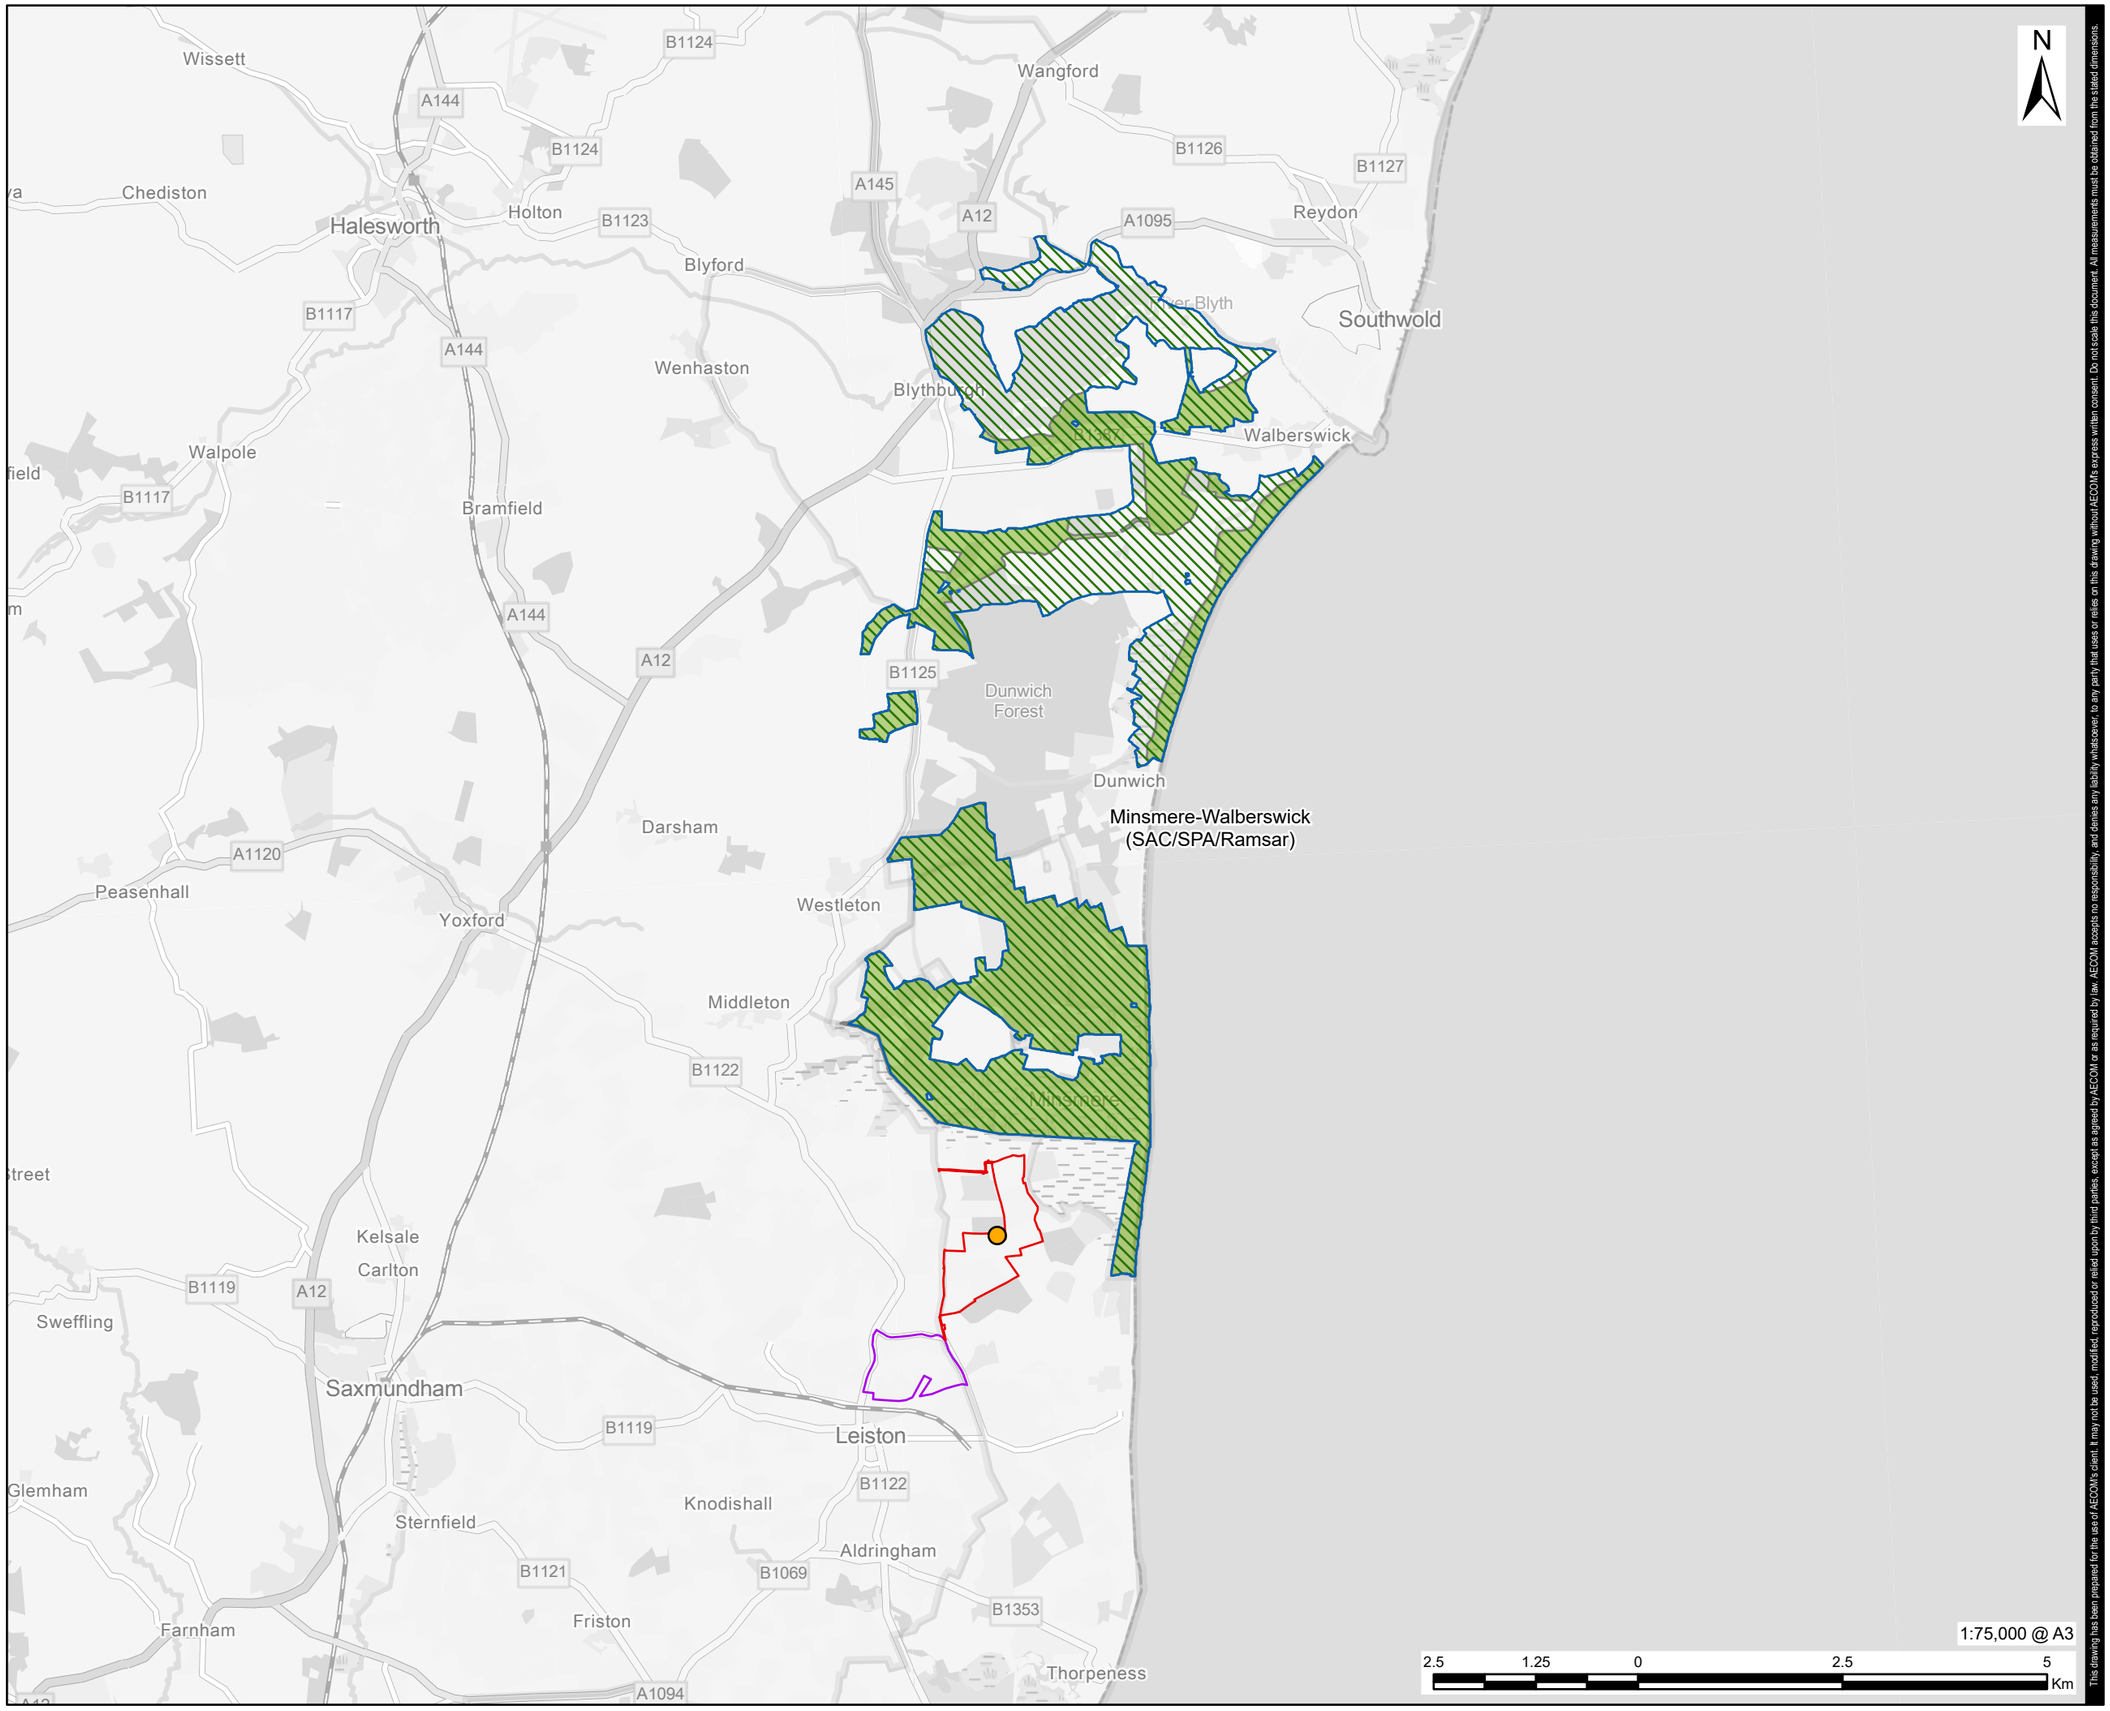

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT
Sizewell C

CLIENT
Sizewell C

CONSULTANT
AECOM Limited
One Temple Quay,
Temple Back East,
Bristol, BS1 6DZ
www.aecom.com

LEGEND
- TCA Borehole
- Marsh Harrier Compensation Area
- Wild Aldhurst
- Special Areas of Conservation (SAC)
- Special Protection Areas (SPA)
- Ramsar

NOTES
1: Basemapping: Map data © OpenStreetMap contributors, Microsoft, Facebook, Inc. and its affiliates, Esri Community Maps contributors, Map layer by Esri
2: © Natural England material is reproduced with the permission of Natural England [2025].


ISSUE PURPOSE
FOR INFORMATION

PROJECT NUMBER
60679030

FIGURE TITLE
Map showing TCA borehole location in relation to SPA, SAC and Ramsar sites

FIGURE NUMBER
Figure 1

Filename: \\na.aecomnet.com\ifs\EMEA\Basingstoke-UKBAS1\Legacy\UKBAS1PFILW0014400 - Management Services\5004 - Information Systems\60568834_SizewellC\Planning Application 2024_2025\02_Maps\SZC_TCA_Borehole_Figures\SZC_TCA_Borehole_Fig2.mxd Revision: 0 Drawn: JA Checked: KH Approved: SK Date: 2025-04-01

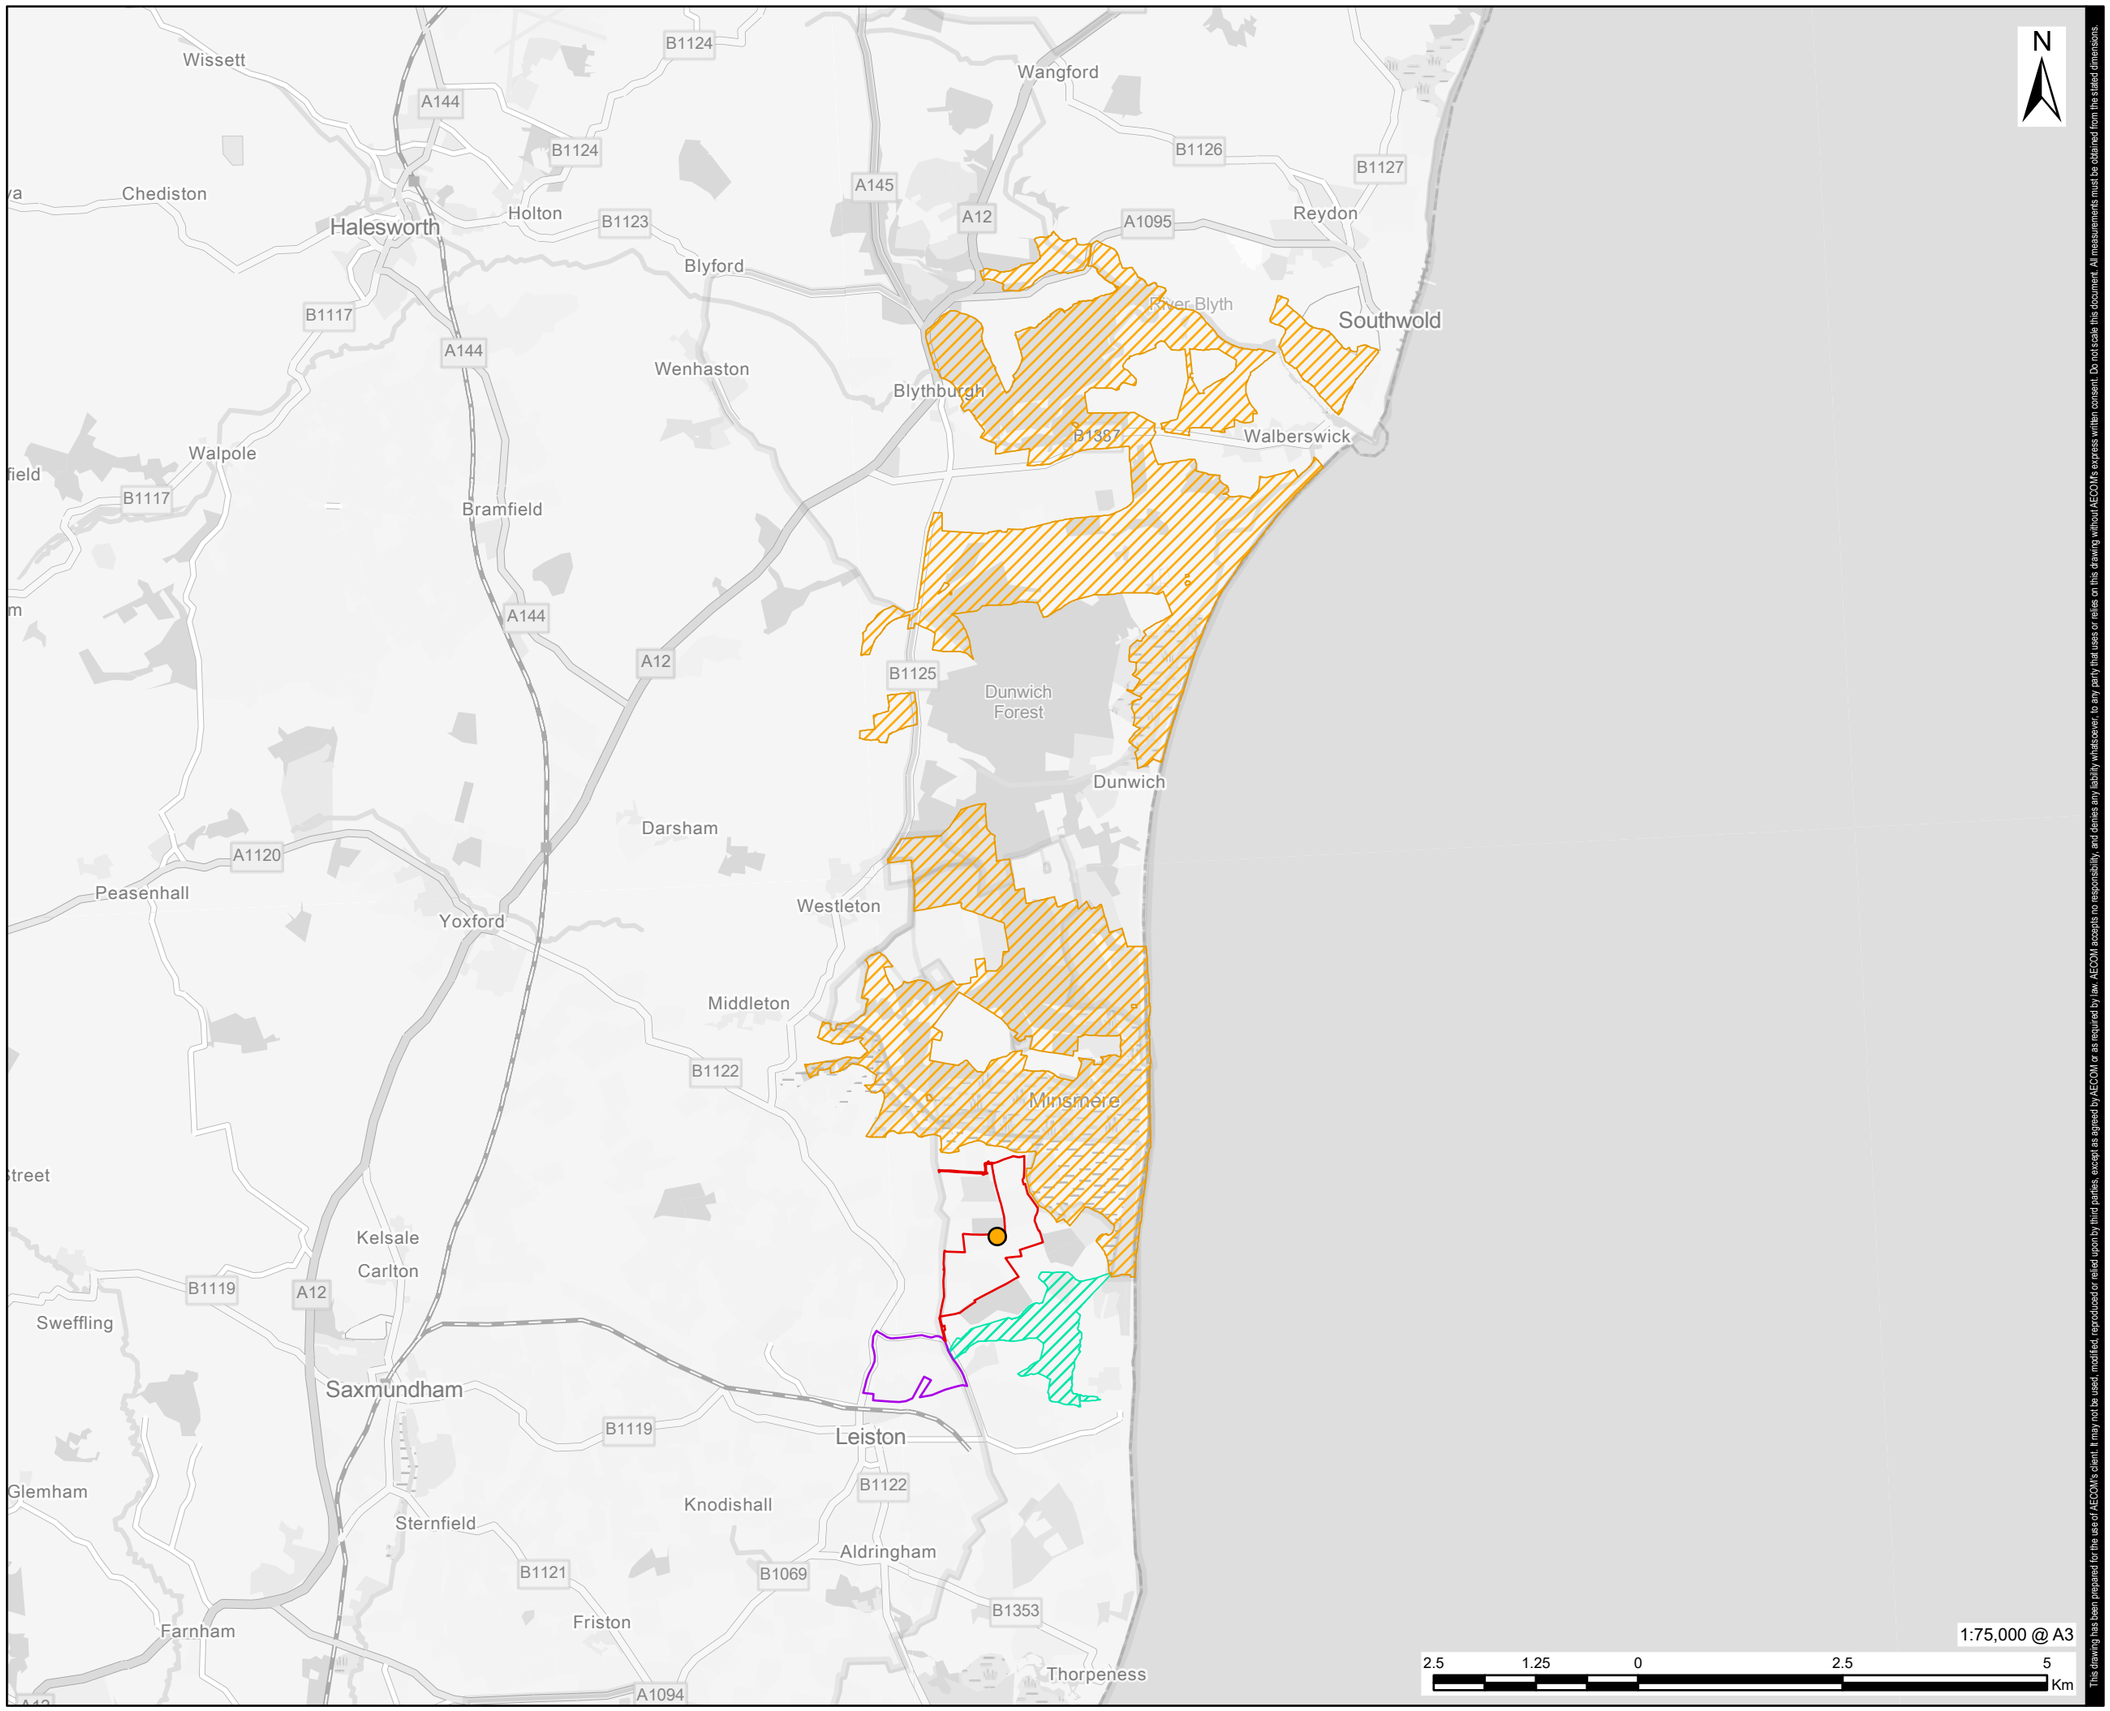

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT
Sizewell C

CLIENT
Sizewell C

CONSULTANT
AECOM Limited
One Temple Quay,
Temple Back East,
Bristol, BS1 6DZ
www.aecom.com

LEGEND
- TCA Borehole
- Marsh Harrier Compensation Area
- Wild Aldhurst

Sites of Special Scientific Interest (SSSI)
- Minsmere-Walberswick Heaths and Marshes
- Sizewell Marshes

NOTES
1: Basemapping: Map data © OpenStreetMap contributors, Microsoft, Facebook, Inc. and its affiliates, Esri Community Maps contributors, Map layer by Esri
2: © Natural England material is reproduced with the permission of Natural England [2025].

ISSUE PURPOSE
FOR INFORMATION

PROJECT NUMBER
60679030

FIGURE TITLE
Map showing TCA borehole location in relation to SSSI sites

FIGURE NUMBER
Figure 2

101739946
Revision 01

Sizewell C
The power of good for Britain

Sizewell C Project

TCA/WRA/39 Borehole Abstraction Licence Variation – Technical Note

© Copyright 2026 Sizewell C Limited. All rights reserved.

Sizewell C Limited. Registered in England and Wales. Registered No. 09284825. Registered Office: 25 Copthall Avenue, London EC2R 7BP

Template No: SZC-SZ0000-XX-000-TEM-100000
Template Revision: 02

DOCUMENT CONTROL

This document is stored and approved in the Electronic Document and Records Management System (EDRMS).

Prepared by:	[redacted] Water Resources Specialist
Verified by:	[redacted] Water Resources Lead
Reviewed by:	[redacted] Environmental Permitting Delivery Lead
Approved by:	[redacted] Environment Manager – Construction Permits and Consents

REVISION HISTORY

Rev	Status	Amendment	Prepared By	Date
01	Final	Initial issue – annual abstraction limit increase at 600 m^3/d	[redacted]	25/03/2026

CONTENTS

1 INTRODUCTION 4
1.1 Purpose 4
1.2 Scope 4
1.3 Definitions 4
1.4 References 4
2 EXISTING ABSTRACTION ARRANGEMENT 6
2.1 Current Licence Basis 6
3 PROPOSED LICENCE VARIATION 7
3.1 Description of Proposed Change 7
3.2 Evidence Base 7
3.2.1 Demand Profile 8
3.2.2 Numerical Modelling 8
3.2.3 Pumping Test 9
3.2.4 Hydrogeological Impact Assessment (HIA) 9
3.2.5 HRA Package 9
3.3 Monitoring Provision 9
4 SUMMARY AND CONCLUSIONS 11

1 INTRODUCTION

1.1 Purpose

The purpose of this Technical Note is to support an application to vary the existing Temporary Construction Area (TCA) borehole abstraction licence (AN/035/0003/016) to increase the annual licensed abstraction limit, while retaining the existing daily abstraction limit of 600 m³/d.

The proposed variation would allow abstraction at 600 m³/d for a full calendar year i.e. 365 days.

1.2 Scope

The scope of this Technical Note applies only to the TCA borehole abstraction licence AN/035/0003/016 and addresses the following:

- The existing licenced abstraction;
- The basis for increasing the annual abstraction limit only;
- The proposed use of existing numerical modelling outputs, impact assessments, and Habitats Regulations Assessment (HRA) information package to support licence determination; and
- The use of existing licence conditions that define monitoring requirements to demonstrate there is adequate provision to ensure there is no increased risk to the water environment from an uplifted annual abstraction limit.

1.3 Definitions

Term / Abbreviation	Definition
SZC	Sizewell C Limited
EA	Environment Agency
TCA	Temporary Construction Area
HIA	Hydrogeological Impact Assessment
HRA	Habitats Regulations Assessment
EDRMS	Electronic Document and Records Management System

1.4 References

Ref	Title	Location	Document No.
1	Full Licence to Abstract Water AN/035/0003/016	EDRMS	101624631
2	TCA/WRA/16 Water Monitoring Technical Note	EDRMS	101572347
3	TCA/WRA/16 Monitoring Location Plan	EDRMS	101572348
4	Package to Inform Countryside Rights of Way (CRoW) Act Assessment and Habitats Regulations Assessment TCA/WRA/16	EDRMS	101497983
5	Early Years Water Demand and Supply TCA Borehole	EDRMS	101582372
6	TCA/WRA/16 Supporting Information	EDRMS	101439918

Ref	Title	Location	Document No.
7	Water Resources Licence Part A (Form WR328)	EDRMS	101739965
8	Water Resources Licence Part B (Form WR330)	EDRMS	101739938
9	Water Resources Licence Part C (Form WR332)	EDRMS	101739967
10	Water Resources Licence Part E (Form WR390)	EDRMS	101739944

2 EXISTING ABSTRACTION ARRANGEMENT

2.1 Current Licence Basis

The existing SZC TCA borehole abstraction licence (Ref. 1) is based on traded licences from local landowners. The licence includes conditions requiring monitoring at specified observation boreholes to demonstrate no significant effect on designated sites.

The current licence permits abstraction at a daily rate of up to 600 m^3/d, with an associated annual abstraction limit of 101,495 m^3 derived from recent actual usage data rather than the full licenced potential of the traded licences.

The abstraction is located in an area defined as having no water available for new abstraction by the Environment Agency. The initial licence application was therefore submitted on the basis of trading water abstraction rights with existing licence holders. The annual limit was set in line with the Environment Agency's policy on licence trading i.e. trades limited to reflect recent actual abstraction.

3 PROPOSED LICENCE VARIATION

3.1 Description of Proposed Change

Section 3.2 of the Environment Agency's Abstraction Licensing Strategy states that applicants can provide evidence and data to show that new consumptive water could be licenced where it can be shown there is no deterioration or impact to the environment. An extract of the Environment Agency's Abstraction Licensing Strategy is included in Appendix A.

It is on this basis that SZC seeks a variation to increase the annual licensed abstraction volume to allow abstraction at 600 m³/d throughout the year. This would require an increase in the annual limit to 219,000 m^3.

No other changes to the licence conditions are being sought as part of this application.

This Technical Note sets out the evidence to demonstrate that a variation to the licence for new non-traded consumptive abstraction would meet the requirements set out in the Environment Agency's Abstraction Licensing Strategy i.e. no deterioration or impact to the environment.

This evidence was not previously available as a new abstraction borehole would not have been permitted without securing licence trades to allow pumping tests and monitoring to be carried out.

3.2 Evidence Base

The following information was submitted to support the original licence application:

- Demand profile justifying need for water (Ref. 5);
- Predictive numerical modelling of the TCA borehole which included continuous operation at 600m^3/d;
- Results of a pumping test during which the TCA borehole was operated continuously for 11 days;
- HIA which considered the impact of continuous operation of the TCA borehole at 600m^3/d, including abstraction occurring in conjunction with the start of dewatering of the MCA; and
- Supporting information for HRA that was based on the above (Ref. 6).

When the original application was submitted a conservative approach to assessment was taken. This included assessing potential impacts from continuous operation of the TCA borehole, rather than limiting the number of operating days to be in line with the annual volume available through licence trading. This approach was taken as it was considered precautionary and allowed operational flexibility, i.e. not imposing seasonal limits by only considering abstraction in winter or summer months.

Although the current licence has an annual limit that would not allow continuous operation of the borehole at the maximum rate of 600m^3/d, the evidence used to assess the impact to the water environment and supported habitats was based on continuous operation being the case.

The variation being sought is to bring the annual limit on the abstraction licence in line with the operational scenario considered in the original supporting assessments.

A brief summary of each of the above items of supporting information is presented below.

3.2.1 Demand Profile

The demand profile submitted to support the original application comprised a total forecast water need, and a breakdown of activities the water could be used for. The principal use of water from the TCA borehole is in the production of construction materials e.g. bentonite, concrete. The demand profile shows that the requirement for water to meet the needs of the SZC construction programme is greater than 600m^3/d for a longer period of the year than could be met with traded volumes. The original application needed to justify an annual limit in line with water available through licence trading.

There is also provision for use of water from the TCA borehole for dust suppression. This is to provide resilience during summer months when the other local sources of abstraction may be constrained by Hands-Off Flow conditions on their abstraction licences. This demand was not quantified in the original demand profile as the annual total for production of construction materials was already greater than the volume available through trading.

The demand profile has been updated to include additional demand data. This additional demand data was originally excluded as it was not necessary to support the original licence application. This revised demand profile demonstrates there is a requirement for at least 600m^3/d throughout the year. The revised demand information is included as Appendix B. and it is considered to be suitable justification for the need to abstract additional water as there is still as shortfall between the daily, and annual, forecast demand and the abstraction limits being sought. In addition, we are seeking the increase in the annual limit to prevent us being unable to meet the demand for water for use in the purposes stated on the licence after 169 days of operation. This would lead to an alternative supply (by tankering) being required for the remaining 196 days of the year, which would be detrimental to the environment.

3.2.2 Numerical Modelling

The predictive numerical modelling included a number of conservative assumptions including the following:

- Continuous operation of the borehole with an abstraction rate of 600m^3/d for a period of 4 years to allow long term impacts to be assessed;
- All existing licences in the area were considered to be abstracting at their maximum licenced limit including those being traded, which will not be operating at the same time as the TCA borehole; and
- In-combination effects of dewatering in the MCA and continued operation of the TCA borehole, which is not currently shown in the project programme due to the anticipated commissioning of the desalination plant which will remove the need for the TCA borehole.

Despite the multiple conservative assumptions included in the numerical modelling there was not considered to be an unacceptable change shown at any of the assessment points agreed with the Environment Agency. While the modelling showed a small potential risk from change in position of the saline interface but this was within the model error range and considered to be a function of the proximity of the assessment point to the model boundary. It was agreed with the Environment Agency that the apparent risk could be managed through the monitoring provisions included on the licence.

It is not proposed to undertake any additional predictive modelling to support the application to increase the annual licence limit. The existing modelling already represents continuous operation of the TCA borehole throughout the year so is considered representative of the variation being sought.

3.2.3 Pumping Test

An eleven day constant rate pumping test was carried out between February 20th and March 3rd 2025. During the constant rate test water levels within the pumped well fell by less than 1m, and there was no observable change at monitoring points between the point of abstraction and sensitive receptors.

Steady state conditions were achieved within one day of abstraction commencing, with minimal change recorded in the closest observation points to the pumped well over the remainder of the constant rate test. Drawdown in the pumped well was 0.47m, and the radius of influence at the end of the test was less than 200m. No abstraction related drawdown was observed at monitoring point BP23, which is approximately 250m from the nearest receptor.

While this application seeks to increase the annual licence limit from 101,495m^3 to 219,000m^3, which is an increase of 117,505m^3, the daily abstraction limit will remain at 600m^3. It is not proposed to undertake any additional pumping tests to support the request to increase the annual limit as the current constant rate test results showed stable conditions had been established with continuous abstraction at 600m3/d over an eleven day period.

3.2.4 Hydrogeological Impact Assessment (HIA)

The HIA prepared to support the original application considered the effects of operating the TCA borehole continuously with an abstraction rate of 600m^3/d, which is the current daily limit on the abstraction licence granted. It took into account both the predictive modelling and pumping test results set out above.

While the HIA did not identify any unacceptable change to the water environment from operating the TCA borehole with an abstraction rate of 600m^3/d for 365 days per year it did acknowledge that the licence would only permit abstraction at this rate for approximately half a year, or continuous operation throughout the year at a reduced daily rate. This reflected the annual volume available through licence trading at recent actual abstraction rates.

The existing HIA is therefore considered an appropriate basis to assess the application to vary the annual licence limit.

3.2.5 HRA Package

The HRA package (Ref. 4) prepared to support the original application was based on the HIA, which considered the effects of operating the TCA borehole continuously with an abstraction rate of 600m^3/d. The HRA undertaken as part of the determination of the original licence application considered the annual volume available by licence trading i.e. 101,495m^3.

The variation being sought is to increase the number of days where abstraction occurs in a year to 365, thereby increasing the annual limit to 219,000m^3. The information provided in the HRA package produced to support the original licence application already considered this higher annual volume and is therefore considered appropriate to allow an updated HRA to be produced for the application to vary the licence.

3.3 Monitoring Provision

The current abstraction licence for the TCA borehole includes defined monitoring requirements, and associated triggers for intervention. The trigger values were set at the 70th centile of the long term monitoring record for boreholes located between the abstraction point and sensitive receptors agreed with the Environment Agency. These sensitive receptors include formally designated sites, features which will be designated in future (Marsh Harrier lagoon), and the position of the saline interface in

the Crag. The trigger levels relate to changes in the Crag water level, rather than overlying feature of interest, making them more protective of groundwater dependent terrestrial ecosystems than direct measurement of water levels in the feature itself.

The trigger values on the licence are stringent and ensure any effects of abstraction would be identified early should they occur. An escalation process is included in the licence conditions to ensure that, should the abstraction be shown to be causing unacceptable drawdown at any monitoring point then pumping must cease. This ensures there is real time assessment of change in the water environment and a mechanism to determine whether the effect of abstraction is extending to sensitive receptors, and intervene if necessary.

While the location of monitoring points and selection of trigger levels for intervention took into account the results of the HIA, including predictive numerical modelling and pumping test results, they were ultimately defined to provide direct evidence for any influence from abstraction reaching a sensitive receptor during operation of the TCA borehole. The full rationale for selection of the monitoring locations and trigger levels is set out in (Ref. 2), submitted with the original licence application.

It is considered that these monitoring controls remaining on the licence will continue to provide an equivalent level of ongoing protection during the operation of the TCA borehole with an increased annual limit.

4 SUMMARY AND CONCLUSIONS

SZC is seeking to vary the existing abstraction licence AN/035/0003/016 for the TCA borehole to increase the annual limit to 219,000m^3. No other changes to AN/035/0003/016 are being sought at this time.

The original application, submitted on April 7th 2025, included a number of packages of supporting information. Due to the conservative approach taken in assessing the potential impact of abstraction from the TCA borehole in the original submission we consider that there is no need for further technical supporting documentation to be produced.

Additionally the current licence includes monitoring requirements that provide a mechanism to control and mitigate any influence from the abstraction before it can cause detrimental effects at sensitive receptors.

The approach we propose in this application and its enclosed documents would enable efficient use of licenced abstraction while maintaining environmental safeguards and regulatory oversight.

Appendix A text – Extract from EA Abstraction Licence Strategy

We cannot allow the impact of groundwater abstraction on surface water flows to increase. In the majority of catchments low flows may not support good ecology. In AP2 – the River Wang, and in some coastal catchments, low flows are sufficient to support good ecology. These catchments are also underlain by a thick layer of London Clay. This means shallow groundwater abstractions do not impact the Chalk aquifer. We may grant a new groundwater licence in these locations if:

- it is not possible for the applicant to apply for a surface water abstraction - this may be due to a lack of access to a river or tributaries
- the abstraction is close to and in direct hydraulic continuity with the surface water body and impacts on flows would be seen with limited delay
- we would apply a HoF condition to protect flows in the surface water body
- the surface water body flows are monitored via a gauging station supporting the enforcement of the HoF condition
- the groundwater abstraction is for the winter period only - this will protect summer surface water flows and is in line with the constraints we would apply to a new surface water abstraction
- the abstraction is not close to the boundary or in the headwaters of the surface water catchment - this is to avoid causing an impact in neighbouring surface water catchments
- the abstraction will not cause or increase the risk of saline intrusion - this may reduce the likelihood of a new abstraction in coastal catchments
- abstraction for the purpose of spray irrigation may be subject to restrictions under Section 57 of the Water Resources Act 1991 - we may restrict abstraction during prolonged periods of exceptional shortage of rain or other emergencies to protect the environment
- We will assess each proposal on a case-by-case basis. We will consider the impact of the proposal on:
- the environment
- protected sites
- other abstractors

We may need groundwater modelling to be undertaken at the cost of the applicant in order to determine if the proposal is acceptable.