

Fire Prevention Plan

Prepared on Behalf of:
Swindon Metal Recycling Limited

Site Name:

Marshgate Works

Unit B Marshgate

Swindon

Wiltshire

SN1 2PA

Environmental Permit:

GB403TV

Version 1.1 (Submission Version)

DOCUMENT CONTROL SHEET

Site:	Unit B Marshgate
Project:	Bespoke Permit Variation Application
Title	Fire Prevention Plan
Issue	1.1
Date	10.09.25
Status	Submission Version
Author	<i>Shane Ronald Tasker AssocMCIWM PIEMA EA (IEMA Qualified Auditor)</i>

Distribution List

Environment Agency

Table of Contents

1	Introduction	2
2	Fire Prevention Plan	2
3	Fire Risk Scoping Exercise	2
4	Fire Risk Assessment	3
5	Preventing Fires.....	6
6	Detecting & Suppressing Fires.....	10
7	Fire Prevention Equipment Inventory and Procedure	13
8	Material Storage & Management.....	14
9	Combustible Material Storage Arrangements.....	17
10	End of Day Operations	20
11	Fire Water & Containment	21
12	Contingency Planning.....	24
13	Fire Alert Procedures.....	25
14	Post-Incident Procedures.....	25
15	Periodic Review	26
	<u>Appendix FPP1: Leakage/Spillage Response Procedure.....</u>	<u>27</u>
	<u>Appendix FPP2: Site Layout Plan</u>	<u>28</u>
	<u>Appendix FPP3: Site Drainage Plan.....</u>	<u>29</u>
	<u>Appendix FPP4: Hydrant Map</u>	<u>30</u>
	<u>Appendix FPP5: Receptor Location Plan (Smoke & Fire Spreading) Scaled @ 1:25,000 (1KM Buffer).</u>	<u>31</u>
	<u>Appendix FPP6: Receptors Identified Contact Details (If Applicable).</u>	<u>32</u>
	<u>Appendix FPP7: Waste Acceptance Procedures (Extracted from EMS)</u>	<u>33</u>

1 Introduction

- 1.1.1 This Fire Prevention Plan explains how operational procedures laid out in this Fire Prevention Plan ensures that the risk of fire is minimised, and any outbreaks are effectively controlled.
- 1.1.2 This document is separate to any documentation intended to meet the Health & Safety obligations associated with the Regulatory Reform (Fire Safety) Order 2005.

1.2 Interpretation

- 1.2.1 'Responsible Person' refers to any person trained and responsible for monitoring and reporting as detailed in this Plan i.e., Senior Management (Director, Technically Competent Manager, the Site Manager and any Supervisors).
- 1.2.2 'Fire Warden', relates to any person appointed & sufficiently trained with specific responsibilities in the event of a fire.
- 1.2.3 'Operative', relates general yard staff.

2 Fire Prevention Plan

- 2.1.1 This Plan has been prepared with reference to the following documents:
 - Fire Prevention Plans: Environmental Permits Environment Agency Guidance.

3 Fire Risk Scoping Exercise

- 3.1.1 The controls and measures are aimed at reducing:
 - 1) Minimising the likelihood of a fire happening;
 - 2) Aiming for a fire to be extinguished within 4 hours;
 - 3) Minimise the spread of a fire within the site and to neighbouring sites.
- 3.1.2 The Risk Assessment presented in Section 4 Table 1 underpins the measures adopted.

4 Fire Risk Assessment

Table 1: Possible Causes of Fires as identified within the Fire Prevention Plan Guidance 2021

Potential Source of Ignition	Prevention/Management
Arson;	Enclosed site perimeter Security cameras (24-hour operation), with an enclosed site perimeter. Location remote from centre of population and access difficult due to condition of surrounding land. Potentially combustible materials stored at a distance of over 6 metres from the main site entrance.
Self combustion	Self-combustion addressed in Section 5.2 of FPP Document.
Plant or equipment failure	Daily inspection of all equipment/machinery by operatives, conducted at the beginning of the working day. Full annual inspection of all equipment/service contracts (LOLER/PUWER). End of Day Procedures Fuel storage tanks provide 110% secondary containment (over 6 metres from combustible material accumulations).
Plant or equipment operation	Inspection procedures as detailed above. Reliance will be placed on Fire Fighting Equipment and the planned preventative maintenance schedule as detailed.
Electrical faults or damaged/ exposed electrical cables	Preventative maintenance via weekly inspections of all electrical equipment to ensure that any obvious signs of damage or deterioration do not go undetected. A qualified electrician will install all electrical supplies & PAT testing is completed annually.
Naked (hot) light fixtures	No naked sources of ignition are within 6 metres of combustible or flammable materials.
Discarded smoking materials	Designated smoking areas.
Hot works e.g., welding, cutting	Only trained operatives are authorised to conduct operations involving hot cutting equipment. Activities will not take place with 6 metres of any risk materials. End of Day Procedures. Cutting and burning equipment isolated other than when in use.
Industrial heaters	No industrial heaters are currently used onsite.
Hot exhausts	Equipment is parked at a safe distance of at least 1 metre from accumulation of risk materials. End of Day Procedures.
Open burning onsite	No open burning takes place onsite.
Incompatible materials	All materials are stored within designated areas. Detailed waste acceptance procedures are followed by all Operatives
Neighbouring site activities	Adjacent site is not sensitive in nature and is commercial and industrial.
Hot loads deposited at the site	Hot loads are not accepted. Monitoring for hot loads takes place as loads arrive at site with procedures to manage materials. Separation, isolation & storage of combustible materials within identified storage bays or containers.
Weather, e.g., lightning strikes	Naturally occurring and uncontrollable.

Location: Unit B Marshgate

Project: Bespoke Permit Variation Application

Document Title: Fire Prevention Plan v1.0 Submission Version 10.09.25

Page 3 of 34

4.1 Operational Flow Diagrams (Combustible Materials).

4.1.1 The operation is summarised in the Operational Flow Diagrams below:

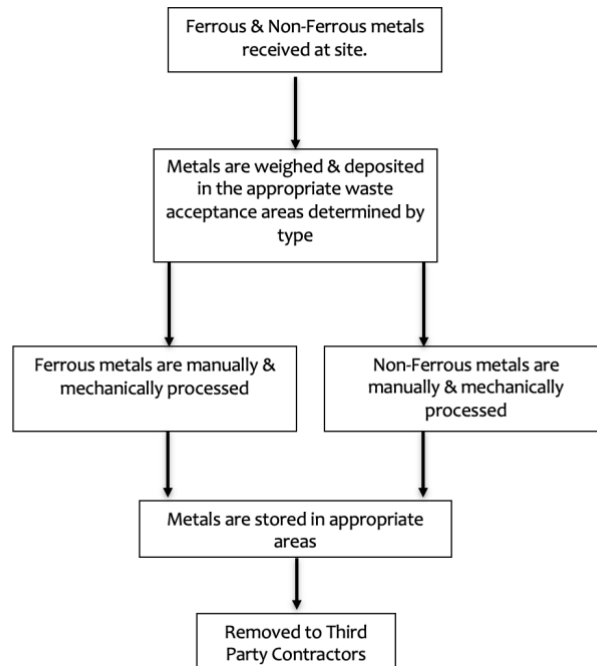


Figure 1: Operational Flow Diagram (MRS)

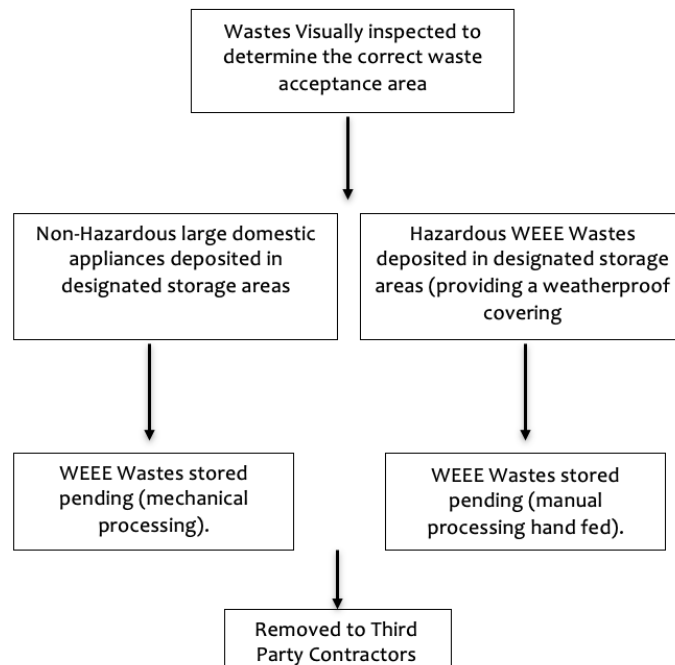


Figure 2: Operational Flow Diagram (WEEE ATF)

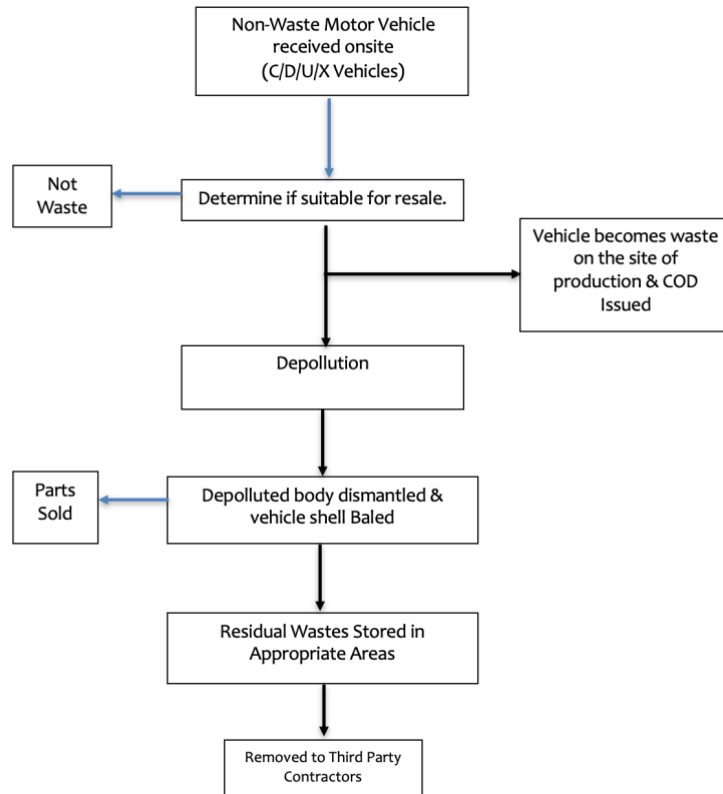


Figure 3: Operational Flow Diagram (ELV ATF)

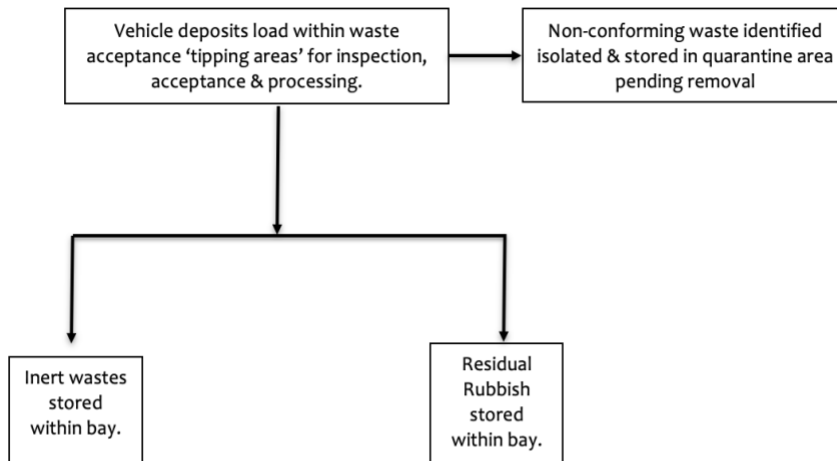


Figure 4: Operational Flow Diagram (HCI)

5 Preventing Fires

- 5.1.1 Swindon Metal Recycling Limited operates a Metal Recycling Site, WEEE ATF, ELV ATF and HCI Transfer Station at their site at Marshgate Works, Unit B Marshgate, Swindon, Wiltshire, SN1 2PA
- 5.1.2 The site will receive between 100-150 tonnes of material each day.
- 5.1.3 All drivers are instructed to inspect loads prior to collection to ensure any potential sources of ignition are not present and will adhere to strict waste acceptance procedures that form part of the site Environmental Management System (as detailed in [Appendix FPP7](#)).
- 5.1.4 Vehicles are inspected prior to purchasing to ensure no concealed items are present, such as canisters/hypodermic needles/wastes or any other items that should not be present. In the event of these items being discovered during the inspection process the vehicles will be rejected and the vehicle will not be purchased.
- 5.1.5 Non-waste motor vehicles are assessed for resale suitability; if the vehicles are not suitable for resale, they become waste on the site of production and will be transferred to the area benefitting from an impermeable concrete surfacing for processing.
- 5.1.6 Materials will be unloaded in designated 'tipping areas' and inspected for the presence of any fire risks (e.g., glowing embers or explosive materials or signs of flammable liquids), which will be moved to the quarantine area and extinguished.
- 5.1.7 Extinguished material will be monitored prior to isolation in a designated skip/container, which will be brought forward as necessary & removed within seven working days.
- 5.1.8 Acceptable materials are stored in areas/bays/skips around the facility dependant on type & composition, as shown on the Site Layout Plan within [Appendix FPP2](#). Combustible materials will be removed from site within one month of acceptance.
- 5.1.9 A Fire Quarantine Area of at least 100m² (10m x 10m) is available at all times, which benefits from concrete retaining walls (0.8metres thick) and so a 6-metre buffer zone is not required. The area will accommodate over 50% of the single largest accumulation of combustible waste, equating to 400m³ of waste (stored to a height of 4 metres), which supports the largest single accumulation. The fire quarantine area is located on an impermeable concrete surface benefitting from a sealed drainage system as shown on the Site Layout Plan in [Appendix FPP2](#).
- 5.1.10 The Responsible Person will ensure that a suitable fire quarantine area is available at all times and will conduct a visual check at the commencement of daily

Location: Unit B Marshgate

Project: Bespoke Permit Variation Application

Document Title: Fire Prevention Plan v1.0 Submission Version 10.09.25

Page 6 of 34

operations and throughout the day (fire watch). All staff members will be made aware that an area is to be kept clear for this purpose & its importance.

- 5.1.11 Potentially explosive & flammable fuels/oils (non-waste materials fuels & lubricating oils/grease) are stored over 6 metres from any accumulations of wastes.
- 5.1.12 Batteries will be disconnected or removed from vehicles before they are stockpiled for depollution (i.e., once they become waste).
- 5.1.13 ELVs will be limited to two vehicles deep and three vehicles high.
- 5.1.14 Smoking is only permitted in designated areas.
- 5.1.15 Only Competent Persons that have completed training will be authorised to perform 'hot work' activities, which are approved by Responsible Persons. If necessary two operatives will complete 'hot work' activities, which will allow one person to complete necessary works & the other to supervise and tackle any sparks generated (this may include a member of the site office watching via CCTV). Fire extinguishers will be kept at hand all times 'hot works' are undertaken. All hot work activities will be undertaken at least 6 metres from any accumulation of combustible materials.
- 5.1.16 Materials will be stored in their largest form & pile sizes will be minimised wherever possible, according to operational need.
- 5.1.17 Fire Watch Procedure (During Working Day) Conducted by Operatives every hour:
 - 1. That all mobile plant is parked at a distance from any combustible material (minimum 1 metres) and that there is no trapped debris located within the vicinity of exhausts.
 - 2. That no material is trapped within static plant.
 - 3. That no debris has settled onto hot exhausts and engine parts.
 - 4. That a suitable fire quarantine area is available at all times.
- 5.1.18 A fire watch will be conducted at the end of the working day as part of the site's End of Day Procedures, as detailed at [Section 10](#). In the event of hot work activities being conducted an inspection of the area/material will be conducted every 15 minutes for at least 1-2 hours.
- 5.1.19 A Responsible Person will carry out a detailed weekly inspection of all onsite equipment.
- 5.1.20 Plant & equipment is subject to manufacturers maintenance. Driver inspection/defect sheets are completed prior to use. Defects are reported to fleet & logged for our contractors to address & repair, once completed the jobs are signed off by Fleet on completion. Records for each plant item contained with Fleet.

- 5.1.21 Maintenance completed is recorded. All maintenance records will be kept within the Site Office and any necessary maintenance recorded on the appropriate documentation & logged. All faulty equipment will be isolated pending repair.
- 5.1.22 Operatives inspect all machinery/equipment on a daily basis to ensure that no leakages are apparent; any leakage/spillages will be rectified. Site staff will be alert to any such leakages or trails that might develop during the day and in the event that such is detected the site leakages/spillage response procedures presented in Appendix FPP1 will be actioned.
- 5.1.23 In the event of a fault with equipment that may pose a risk of fire being discovered the following procedure will be followed: -
1. Switch off the equipment immediately if safe to do so
 2. Isolate the equipment; and
 3. Report the fault to a Responsible Person. A Responsible Person will inspect the equipment, records the fault in the Defect Sheets & will contact the internal engineers to complete necessary repairs.
- 5.1.24 Fire extinguishers are strategically located throughout the site. All static plant, mobile plant & vehicles will have fire extinguishers installed. A Responsible Person inspects all extinguishers on a weekly basis, and they are serviced annually. Spent extinguishers are replaced as soon as identified.
- 5.1.25 A Responsible Person on a monthly basis inspects electrical equipment and any defects (loose cables, deterioration or wear) are rectified. Only a qualified electrician will be instructed to assess & complete necessary repairs.
- 5.1.26 All Portable Electrical Equipment is inspected annually (PAT Testing).
- 5.1.27 The whole site is under the control of the operator and can only be accessed through the main entrance gate, thereby ensuring that unauthorised access to the site is prevented at all times.
- 5.1.28 The whole site is security controlled by CCTV to reduce the risk of accidental or deliberate ignition (arson).
- 5.1.29 Operatives conduct routine housekeeping activities (i.e., cleaning & tidying) as necessary and as a minimum on a weekly basis (including all treatment equipment/electrical areas if the Responsible Person deems it necessary during the course of weekly inspections). Cleaning/tidying will include but not limited to pressuring washing/sweeping.

5.2 Self-Combustion

- 5.2.1 Certain materials can self-combust under certain conditions as a result of: -
1. A physical reaction such as fine materials with large surface areas prone to friction; and/or
 2. A biological reaction through degradation processes; and/or
 3. A chemical reaction if coming into contact with corrosive substance such as strong acids and bases.
- 5.2.2 Self-combustion is most possible during hot conditions or where waste is left to stagnate for extended periods or items exist within the waste that cause combustion over a period of time. The likelihood of self-combustion occurring has been assessed as low, as the waste is rotated on a first in first out basis precipitated by frequent emptying of the storage areas/containers/bays. During extreme hot weather water hoses will be deployed to dampen down accumulations of materials to reduce the likelihood of hot spots forming as deemed necessary by a Responsible Person.
- 5.2.3 Material Management & Mitigation Measure Procedures: -
1. Operatives throughout the working day will monitor each bay/ container holding combustible materials. If the monitoring indicates any evidence of a 'hot spot' forming (such as visible steam, discolouring or odour i.e., indicating degradation) a Responsible Person will be notified, and Condition 1 of Table 2 will be implemented immediately.

6 Detecting & Suppressing Fires

- 6.1.1 All staff members undergo fire training as part of their induction with refreshers as required (every three years for Fire Warden for example). Staff members will be trained on the contents of this Fire Prevention Plan, which is accessible at all times for them to refer to if needed.
- 6.1.2 Staff awareness is maintained by regular (as deemed necessary by Management to maintain understand and competency in the requirements of this document) 'Toolbox Talks' that form part of a programme of appropriate regular refresher training and the induction process.
- 6.1.3 All fire-fighting equipment is checked/inspected weekly by a Responsible Person.
- 6.1.4 All fire drills are recorded on the sites Fire Safety Logbook in accordance with the applicable legislation.
- 6.1.5 Fire Drill Procedure:
 - 1. A fire drill is carried out annually to confirm that the facilities, procedures and this FPP are effective and that everyone understands what they should do in the event of a fire, and how to evacuate the site.
 - 2. Records must be kept regarding each drill. Special attention should be given if the drill was slow or incomplete
 - 3. All fire points should be checked once a year
- 6.1.6 All training records are kept in the Offices.
- 6.1.7 Reliance will be placed on strategically positioned CCTV monitoring system (including 13 cameras, which have thermal imaging, smoke detection and movement detection and full alert coverage) as detailed in [Appendix FPP2](#) so in the unlikely event of a fire occurring, it would be identified at the earliest opportunity, via employees and the Site Office during operational hours and via the monitoring system/alert system during non-operational hours. Reliance will be placed on the below provisions as detailed in [Paragraph 6.1.8](#) to combat and extinguish a fire.
- 6.1.8 Equipment available to tackle a fire:
 - 1. Portable fire extinguishers located as shown on the Site Layout Plan in [Appendix FPP2](#).
 - 2. Fire Hose located as shown on the Site Layout Plan in [Appendix FPP2](#).
 - 3. Fire Hydrant located as shown on the Hydrant Map in [Appendix FPP4](#).

6.2 Detection Out of Hours

- 6.2.1 In the event of a fire during non-operational hours Responsible Persons will be alerted via a message alert in the event of one of the trigger beams being broken/interrupted (i.e., via motion detection/heat detection/smoke detection), which will also alert the monitoring company who will be able to access the cameras, access the emergency and contact the emergency services, as well as notifying the Responsible Person to the incident once the emergency services have been contacted. It should take approximately 15-20 minutes for a responsible person to arrive onsite, as minimum two Responsible Persons will arrive onsite to investigate and enact the FPP procedures and will be fully aware of the requirements of this FPP.
- 6.2.2 Location of the CCTV Camera is shown on the Site Layout Plan ([Appendix FPP2](#)).
- 6.2.3 Responsible Persons can monitor the site during non-operational via the internet on mobile telephones or laptops.

6.3 Fire Conditions

Table 2: Fire Fighting Conditions

Alert Condition	Characteristics	Action	Preparation	Resources Available
Condition 1	Materials Smoking	Operatives will turn the material stockpiles utilising mechanical equipment to enable any trapped heat to be released.	Fire extinguishers ready for deployment. Be prepared to initiate fire procedures (Section 13) Responsible Person to be notified if not already present.	Operating Hours Responsible Persons available Closed Responsible Persons available to attend site
Condition 2	Visible Flame	Raise the site fire alarm immediately & initiate Fire Procedures detailed at <u>Sections 13</u> If safe to do so tackle the blaze utilising onsite fire-fighting provisions including: - <ul style="list-style-type: none"> • Fire Extinguishers (Deploy on small scale fires) • Fire Reel Hoses • Alert FRS Deploy sandbags across designated areas.	Prepare the fire quarantine area & water provisions for deployment.	Operating Hours Responsible Persons available to deploy equipment. Closed Responsible Persons available to attend site to deploy equipment.
Condition 3	Full Fire Established	Remove materials ablaze to the quarantine area or drag containers and deposit them in the fire quarantine area if safe to do so, so extinguishing/suppressing/tackling can take place, location shown on the Site Layout Plan in <u>Appendix FPP2</u> . On arrival of the FRS the appointed Fire Warden will transfer control of the incident over to the Incident Commander who will direct site operatives accordingly.	Prepare for the arrival of the FRS and follow all instructions.	Operating Hours Mechanical Equipment (material handler) Responsible Persons available to deploy equipment. Closed Responsible Persons available to attend site to deploy equipment and operate mechanical Equipment (material handler)

6.3.1 These provisions aim as far as reasonability possible to ensure that if a fire were to break out it would be extinguished within 4 hours.

6.3.2 The internal site layout is such that FRS can access all areas of the site at all times and HGVs are able to enter and turn around without obstruction. It is therefore, considered that there is suitable access for fire tenders to manoeuvre freely around the site should a fire break out.

7 Fire Prevention Equipment Inventory and Procedure

Table 3: Fire Equipment Inventory

Material	Procedure	Storage	Trained User	Location
Personal Protection Equipment	Full range of PPE readily available for use.	N/A	All staff are issued with PPE.	Provisions are contained within the Site Office.
Fire Extinguishers	Fire Extinguishers are used in the event of fires.	Stored in designated location when ready for deployment. Spent extinguishers are isolated and stored pending recharge/removal.	All staff are trained on how, when & what types of Fire Extinguishers should be used in the event of a fire depending on the composition of the material ablaze.	At locations throughout the site- as shown on the Site Layout Plan (Appendix FPP2).
Water Hoses	Hoses used in the event of a fire.	Stored in designated location and secured via the reel provided.	Staff are trained on how and when to use the hoses.	At locations throughout the site- as shown on the Site Layout Plan (Appendix FPP2).
Fire Hydrant	Hydrant used in the event of a fire.	N/A	Staff are trained on how and when to use the hydrant.	Location as shown on the Hydrant Map (Appendix FPP4).

7.1.1 Firefighting equipment is inspected on a weekly basis by a Responsible Persons to ensure it is present, functional, and well maintained. Firefighting provisions are inspected on an annual basis by a competent person.

8 Material Storage & Management

- 8.1.1 Concrete retaining walls are positioned around the whole and used as dividing bay walls (where required) as detailed in Section 9 Table 4 & as shown on the Site Layout Plan in Appendix FPP2.
- 8.1.2 Concrete can provide up to 4 hours (240 minutes) fire resistance (radiation & spreading), which meet the A1 class fire resistance standard (DIN EN 13501-1). Concrete is a non-combustible material and has a slow rate of heat transfer that provides shielding from heat and enables natural cooling. It is accepted in the industry that concrete “can be described as virtually fireproof”¹. The concrete retaining walls will prevent any sparks escaping.
- 8.1.3 End of Life Vehicles are stored in designated area with a suitable separation distance from other accumulations as detailed in Section 9 Table 4 & as shown on the Site Layout Plan in Appendix FPP2 (Reference 35/36/37/38/39/40/41/42/43).
- 8.1.4 End of Life Vehicles are depolluted within designated areas of the site as detailed in Section 9 Table 4 & as shown on the Site Layout Plan in Appendix FPP2 (Reference 11/12).
- 8.1.5 End of Life Vehicles are dismantled in designated areas as detailed in Section 9 Table 4 & as shown on the Site Layout Plan in Appendix FPP2 (Reference 23).
- 8.1.6 Non-waste parts are stored in designated bays as detailed in Section 9 Table 4 & as shown on the Site Layout Plan in Appendix FPP2 (Reference 17/19/20/22/24/25/27).
- 8.1.7 Scrap Metals are stored in designated bays depending on grade and composition with an appropriate separation distance implemented between other accumulations and the site boundary as detailed in Section 9 Table 4 & as shown on the Site Layout Plan in Appendix FPP2 (Reference 32/33/34).
- 8.1.8 Scrap Metals are stored in a variety of skips/containers as detailed in Section 9 Table 4 & as shown on the Site Layout Plan in Appendix FPP2 (Reference 3/4/5/14/18/28/29/30).
- 8.1.9 Batteries are stored in designated stillages with an appropriate separation distance implemented between other accumulations as detailed in Section 9 Table 4 & as shown on the Site Layout Plan in Appendix FPP2 (Reference 10).
- 8.1.10 Tyres are stored in designated areas/containers with an appropriate separation distance implemented between other accumulations as detailed in Section 9 Table 4 & as shown on the Site Layout Plan in Appendix FPP2 (Reference 8/15).
- 8.1.11 The Waste Industry Safety & Health Forum (WISH) guidance Waste 28 Reducing Fire Risk At Waste Management Sites (Issue 2 April 2017), confirms the suitability of steel as a material for use in fire breaks (See page 47). The Chief Fire Officers

¹ [http://www.concretecentre.com/Performance-Sustainability-\(1\)/Fire-Resistance.aspx](http://www.concretecentre.com/Performance-Sustainability-(1)/Fire-Resistance.aspx)

Association amongst other bodies has endorsed this guidance. A report by the British Constructional Steelwork Association identified 550 Celsius as the limiting temperature for a steel structure with four sides such as a skip container to maintain its stability². The risk associated with steel is melting, which happens at around 1365 Celsius.

- 8.1.12 Inert Wastes and HCl Wastes are stored in designated concrete bays with an appropriate separation distance implemented between other accumulations as detailed in Section 9 Table 4 & as shown on the Site Layout Plan in Appendix FPP2.
- 8.1.13 Skip/Container Isolation Procedure
 - A. Operatives on identification of a fire within a skip will enact procedures as detailed at Table 2.
 - B. Each skip/container will, if safe to do so be moved utilising the 360 grab machines (by connecting the grab head to the lip of the container) & dragged to the fire quarantine area, after which extinguishing (smothering/burying or deployment of water) will be attempted pending FRS arrival.
- 8.1.14 Containment in identified bays/areas or skips (as shown on the Site Layout Plan in Appendix FPP2) ensures materials are isolated from potential sources of ignition and from environmental elements such as wind (fanning). The storage bays or containers will ensure that materials are well ventilated and able to cool naturally, whilst providing a thermal barrier.
- 8.1.15 During extreme hot weather the fire hoses will be deployed to dampen down accumulations of combustible wastes to reduce the likelihood of self-combustion, if deemed necessary by a responsible person (i.e., extreme heat wave).
- 8.1.16 At least once every quarter, the storage bays will be emptied, cleaned, and inspected for damage and repaired as needed as part of the preventative maintenance regime.
- 8.1.17 The site will turn over materials as quickly as practicably possible, operating a 'first in first out' policy, as detailed in the procedure in Section 8.1.17. Materials will be kept onsite until sufficient quantities have accumulated to constitute an economic onward load, or the maximum storage limits detailed at Table 4 have been reached.
- 8.1.18 Stock Rotation Procedure (Operatives):
 - 1. Operatives will deposit all 'new' incoming wastes at the front of any accumulation within a pile.

²http://www.tatasteelconstruction.com/file_source/StaticFiles/Construction/supplements/Fire_Protection_Supplement.pdf

2. Operatives must load all collection vehicles with the oldest materials first (accumulations at rear of pile), therefore materials at the back of a pile will be loaded in the first instance (i.e., a first in first out policy);
3. Once loading is completed Operatives will utilise mechanical machinery to manoeuvre the accumulations of waste to the back of the pile.

8.1.19 A freeboard space of no less than 0.5 metres will be maintained between the apex of materials stored within a bay and the top of the dividing walls, which will create over a 1 metre freeboard space between both the piles apex's as well as the thickness of any dividing bay walls. Responsible Persons will ensure the stated freeboard and distance is maintained at all times.

8.1.20 Due to the separation distances maintained onsite it is considered that the risk of bridging is very low.

9 Combustible Material Storage Arrangements

Table 4: Combustible Materials Storage Arrangements

Reference Point Site Layout Plan Appendix FPP2.	Combustible Material	Storage Arrangements	Width Maximum (metres)	Depth Maximum (metres)	Height Maximum (metres)	Volume Maximum (metres cubed)	Minimum Separation Distance From Other Loose Combustible Waste (metres)	Storage Time Onsite (Working Hours/Days)
1	Site Office	-	-	-	-	-	-	-
2	Weighbridge	-	-	-	-	-	-	-
3	Scrap Metal	Stored loose in skip.	1.8	4.5	2	16.2	0.5	3 Months
4	Scrap Metal	Stored loose in skip.	1.8	4.5	2	16.2	0.5	3 Months
5	Scrap Metal	Stored loose in skip.	1.8	4.5	2	16.2	0.5	3 Months
6	Parking Area	-	-	-	-	-	-	-
7	Welfare Area	-	-	-	-	-	-	-
8	Tyres	Stored loose in area	12	4	3	144	1	3 Months
9	Scrap Metal	Stored loose in containers	12	2	3	72	1	3 Months
10	Scrap Metal (Including Batteries)	Stored loose in containers	12	2	3	72	1	3 Months
11	Depollution Stand	Stored loose on stand	4.5	1.5	1.8	12.15	6	3 Months
12	Depollution Stand	Stored loose on stand	4.5	1.5	1.8	12.15	6	3 Months

Location: Unit B Marshgate

Project: Bespoke Permit Variation Application

Document Title: Fire Prevention Plan v1.0 Submission Version 10.09.25

Page 17 of 34

13	Scales	-	-	-	-	-	-	-
14	Scrap Metals	Stored loose in bins	2	1	2	4	0.5	3 Months
15	Tyres	Stored loose in container.	6	2.5	2	30	0.5	3 Months
16	Scrap Metal	Stored loose in container.	2	2.5	3	15	0.5	3 Months
17	Parts	Stored loose in area	3	3	3	27	-	-
18	Scrap Metal	Stored loose in skip.	1.8	4.5	2	16.2	0.5	3 Months
19	Parts	Stored loose in areas	4	4	4	64	-	-
20	Parts Storage Area	Stored loose on racking	25	0.5	4	50	-	-
21	Tank Farm	-	-	-	-	-	-	-
22	Parts	Stored loose in container.	6	2.5	2	30	-	-
23	Inert Waste	Stored loose in bay	3.2	10	3.5	112	0.8	3 Months
24	Mixed Waste Bay HCl	Stored loose in bay	12.5	10	3.5	437.5	0.8	3 Months
25	Parts	Stored loose in container	4	2.5	3	30	-	-
26	Scrap Metal	Stored loose in skip.	1.8	4.5	2	16.2	0.5	3 Months
27	Scrap Metal	Stored loose in skip.	1.8	4.5	2	16.2	0.5	3 Months
28	Scrap Metal	Stored loose in skip.	1.8	4.5	2	16.2	0.5	3 Months
29	Baler/Shear	-	-	-	-	-	-	-
30	Scrap Metal	Stored loose in bay	20	10	4	800	0.8	3 Months
31	Scrap Metal	Stored loose in bay	20	10	4	800	0.8	3 Months

Location: Unit B Marshgate

Project: Bespoke Permit Variation Application

Document Title: Fire Prevention Plan v1.0 Submission Version 10.09.25

Page 18 of 34

32	Scrap Metal	Stored loose in bay	20	8	4	640	0.8	3 Months
33	End of Life Vehicles	Stored loose on racking	3	31.5	5.4	510.3	6	3 Months
34	End of Life Vehicles	Stored loose in area	3	31.5	1.8	170.1	6	3 Months
35	End of Life Vehicles	Stored loose in area	3	27	1.8	145.8	6	3 Months
36	End of Life Vehicles	Stored loose in area	3	27	1.8	145.8	6	3 Months
37	End of Life Vehicles	Stored loose in area	3	22.5	1.8	121.5	6	3 Months
38	End of Life Vehicles	Stored loose in area	3	22.5	1.8	121.5	6	3 Months
39	End of Life Vehicles	Stored loose in area	3	22.5	1.8	121.5	6	3 Months
40	End of Life Vehicles	Stored loose in area	3	22.5	1.8	121.5	6	3 Months
41	End of Life Vehicles	Stored loose in area	3	22.5	1.8	121.5	6	3 Months
42	Diesel Tank	-	-	-	-	-	-	-
Grand Total:						5,044.7m ³		

Location: Unit B Marshgate

Project: Bespoke Permit Variation Application

Document Title: Fire Prevention Plan v1.0 Submission Version 10.09.25

Page 19 of 34

10 End of Day Operations

- 10.1.1 All operatives conduct an end of day inspection on all mobile equipment once parked to ensure that no trapped debris is located in the vicinity of the exhausts.
- 10.1.2 A Responsible Person is notified after mobile equipment has been parked and inspections conducted.
- 10.1.3 A Responsible Person conducts a final end of day inspection prior to closure to ensure: -
 - 1. All mobile plant is parked in the designated parking area over 1 metre away from accumulations of combustible wastes.
 - 2. Whenever possible no material will be left uninspected in any 'tipping area'.
 - 3. No material is trapped within static plant.
 - 4. No debris has settled onto hot exhausts and engine parts (Fire-watch).
 - 5. Everything is switched off.
 - 6. No visible signs of flames or embers are present
 - 7. The security system is activated.
 - 8. No one remain within the yard after closure

11 Fire Water & Containment

11.1.1 As required by the Fire Prevention Plan Guidance, a minimum water supply of at least 2,000 litres/min for a minimum of 3 hours is required for a 300 cubic metres pile of combustible material. This equates to 6.6 l/min (2000/300) per cubic metre of combustible material. At least 964,800 litres of water (6.7 l/min x 800 = 5,360 l/min x 180 minutes) would be required were the complete contents of the single latest accumulation ablaze. Reliance will be placed on the fire fighting provisions as detailed at Table 5 below.

Table 5: Fire Fighting Provisions

Fire Suppression Provisions & Water Delivery Systems	Specification	Cumulative Supply l/mins	Total Volume m ³ Available (for up to 180 mins)
Primary Suppression Equipment (Non-water Provisions)			
Fire Extinguishers (Powder/Foam/Co2)	An array of Portable Fire Extinguishers suitable for tackling a range of fires.	-	-
Secondary Suppression Equipment (Water Provisions)			
Fire Hose (45 Metres)	100 l/min connected directly to mains water supply.	100	18,000
Hydrant	75l/second delivering 4000l/min (approximately)	4,100	738,000
Hydrant	75l/second delivering 4000l/min (approximately)	8,200	1,476,000
Grand Total		8,200	1,476,000
Tertiary Suppression Equipment (Water Provisions)			
Fire Tender	45mm standard jet capable of delivering 220 l/min (approximately 6,000 litres)	220	6,000
Grand Total		220	6,000

11.2 End of Life Vehicles Fire Fighting Water

11.2.1 The Fire Prevention Plan Guidance Document states that if you are storing ELVs, you will need to have 1800 litres of water to extinguish each vehicle. We would note that the site is capable of generated 1,476,000 litres of water every 180 minutes, which would enable 820 vehicles to be stored onsite.

11.3 Fire Fighting Water

11.3.1 In the event of water being required the following provisions are available:

- Fire Hoses:

A fixed hoses are installed throughout the site, which are connected directly to the mains water supply. Each hose is capable of delivering 100 l/min each, locations as shown on the Site Layout Plan within [Appendix FPP2](#). In the event of deployment, the fire procedures detailed at [Table 2](#) and in [Section 13](#) will be implemented.

- Hydrant:

Two hydrants are capable of delivering 4,000 l/min each, which are situated on the main access road for easy access by the FRS to the site as shown on the Hydrant Map within [Appendix FPP4](#).

11.3.2 Once the FRS have arrived onsite & connected to the hydrant the use of onsite water-based fire-fighting provisions will only be deployed on FRS instruction.

11.3.3 Furthermore, a Fire Tender is capable of delivering up to 6,000 litres of water at 220 l/min in a single load (through a 45mm standard jet). While the supply of water on the tender may not be available for the whole 180 minutes, on arrival onsite it will make an important contribution in the early stages of fire fighting prior to hydrant connection.

11.3.4 The provisions detailed at [Table 5](#) are capable of delivering the required 5,360 l/min as per the EA Fire Prevention Plan Guidance.

11.4 Firewater Containment

- 11.4.1 Resultant firewater will be contained within the permitted area via the retaining walls and the deployment of sandbags across a 8 metre line (approximately 0.2 metres high), as well as the activation of the drainage isolation valve so that all water will back up onto the site surfaces to prevent any water leaving the site (Locations as shown on the Site Layout Plan Appendix FPP2 & Site Drainage Plan Appendix FPP3).
- 11.4.2 On average a 15kg sandbag is 0.8m wide x 0.77m length x 0.2m high, so 22 sandbags in all would be deployed to build a wall across the site entrance totalling 8 metres long x 0.2 metres high (11 sandbags end to end, stacked two high). It is anticipated that it would take 5-10 minutes to construct the sandbag wall. A supply of at least 22 full and 22 empty sandbags will be kept onsite at all times. Sandbags are stored in IBCs for rapid deployment. The location of sandbags and the deployment lines is details on the Site Layout Plan Appendix FPP2.
- 11.4.3 Given the floor area of the site is over 5837.4m² and the height of 0.2m, up to 1,167,480 litres (5837.4 x 0.2 = 11,67.48m³) of firewater would be retained within the site if required. This does not account for evaporation, which will occur to some degree (25% allowance). Overall, the onsite provisions for firewater containment are more than sufficient to the anticipated 964,800 litres of water stated in Paragraph 11.1.1, which does not account for the drainage capacity of the drainage system.
- 11.4.4 Operatives will be instructed by a Responsible Person (Senior Management) on when to construct a sandbag wall, which will depend on real time events onsite.
- 11.4.5 Sandbag Monitoring & Replacement Procedures
1. Sandbags will be stacked & covered with a lid ready for deployment; a Responsible Person will monitor these bags. If necessary, sandbags will be rotated (i.e., those sandbags at the bottom of the stack will be placed at the top of the stack during the course of the inspection).
 2. Sandbags will be replaced as necessary as determined by the ongoing inspections.

12 Contingency Planning

Table 6: Contingency Plans

Eventuality	Procedures/Measures
Contingency Planning in the event of a fire	<p><u>Measures could include:</u> -</p> <ol style="list-style-type: none"> 1. The site will cease all operations and will not accept any further waste material (contact appropriate customers/contractors if necessary) until FRS arrives. 2. Employees will be advised of the situation. 3. Enact fire procedures as detailed within <u>Sections 13</u> of this FPP. 4. The site will only reopen once FRS has advised it is safe to do so. 5. Fire damaged waste will be processed as appropriate or removed as deemed necessary.
Accident	<p><u>Measures may include:</u> -</p> <ol style="list-style-type: none"> 1. The affected area will be isolated and an appointed 'first aider' will be contacted to attend to any injured party. 2. If necessary, the emergency services will be contacted. 3. A Responsible Person will decide on a case-by-case basis if cessation of operations around the affected area and reception of waste is necessary until the appropriate emergency services have arrived. 4. A Responsible Person will complete an Accident Investigation Report.
Seasonality (Including Transportation Shortages)	<p><u>Measures could include:</u> -</p> <ol style="list-style-type: none"> 1. Confirm current storage times for materials accumulated onsite. 2. Contact outlets for the specified stream and arrange transportation. 3. Transport all waste accumulated within a designated container, even if it may be economically undesirable to do so, i.e., the container for transportation is not full. 4. In the event of no outlet being viable a last resort would be to transport the specified material to a landfill site via a third-party haulier to ensure that the storage limit maxima are not exceeded.
Supply Chain Failure (Including Transportation Shortages)	<p><u>Measures could include:</u> -</p> <ol style="list-style-type: none"> 1. Confirm current storage times for materials accumulated onsite. 2. Increase monitoring of material stockpiles onsite. 3. Contact outlets for the specified stream and arrange transportation. 4. If the outlet is not receiving the specified waste stream, contact other outlets. 5. Conduct investigations into potential alternative outlets if potential outlets are not accepting specified streams. 6. Seek advice from EA.
Breakdowns (Mechanical Equipment)	<p><u>Measures could include:</u> -</p> <ol style="list-style-type: none"> 1. Immediate isolation of the affected machinery. 2. External contractors notified to complete repairs 3. Hire in relief equipment in interim if needed. 4. Reschedule material despatch to align with scheduled repairs and or relief machinery availability.
Site Closure	<p><u>Measures could include:</u> -</p> <ol style="list-style-type: none"> 1. Appropriate signage will be erected notifying any visitors that operations have been suspended. 2. Advise customers of the situation. 3. No more wastes will be accepted on to site. 4. Contact all potential outlets to ensure that all waste material is managed in accordance with the waste hierarchy where possible. 5. Notify EA that customers & receiving outlets have been contacted and provide scheduled dates for material removal. 6. Notify EA once stockpiles have been reduced to acceptable level

13 Fire Alert Procedures

Procedure in Event of Fire on the site

- i. There must be no hesitation in raising the alarm. Any person discovering a fire must immediately operate the fire alarm, or (where an alarm is not provided) shout 'FIRE' to warn others in the vicinity. Fire alarms must not be used for any purpose other than as a signal for fire action or pre-arranged fire drills.
- ii. Everyone must immediately leave the site and proceed directly to the designated assembly area upon hearing the alarm. The mobile plant/machine operators are, if possible, to remove their machines from the fire vicinity at that time; park and turn off their machines at a safe distance from the fire without blocking any Emergency access routes. No one is to return to the affected part of the site until it is confirmed safe to do so by the Responsible Person in charge of the premises.
- iii. The Responsible Person in control of the site must check that FRS has been called and that a delegated member of staff knows where to direct FRS. In addition, the Responsible Person in control must check that occupants of adjacent units have been notified.
- iv. The Responsible Person in control of the site must ensure that the site has been evacuated and in particular: -
 1. Supervise the orderly evacuation of visitors and staff.
 2. Supervise roll calls and collect and collate information, e.g., persons not at the assembly point. Collect information about the fire location and source.
 3. Ensure first aid is given if required.
- v. On arrival FRS will take charge, and the Responsible Person must co-operate with the FRS Officers. See Fire Service Act 2004 Sect. 45 for Fire Service Powers of entry.
- vi. Contact neighbouring identified receptors within proximity to the site on identification of a fire & those that are contactable within a 1km radius of the facility as detailed in Appendix FPP5 & 6 if instructed to do so by FRS (Major Incident).

14 Post-Incident Procedures

1. If required clean up contractors will pump out & remove all accumulations of firewater run off from wherever required onsite, but if deemed suitable any firewater run off can be discharged into the foul sewer under the sites discharge consent.
2. Inspection of all equipment to be conducted prior to reinstating.
3. All burnt material to be removed to an appropriately licenced disposal site.
4. Post incident reports and enquiries.
5. Review and update this Fire Prevention Plan in light of incident & provide a copy to any key stakeholders (EA/FRS).

15 Periodic Review


15.1.1 The adequacy of this Fire Prevention Plan will be reviewed as necessary or on an annual basis as a minimum.

Appendix FPP1: Leakage/Spillage Response Procedure

On identification of a Leak or Spillage the following procedure is to be followed to:

1. Prevent unauthorised access to the affected area
2. Prevent uncontrolled escape of potentially contaminating liquids using supply of absorbent materials to control the flow of liquids.
3. If safe to do so, isolate source of leak/spillage to prevent further losses, which may involve switching off a particular piece of machinery & deploying a containment vessel (i.e., drip trays) underneath the affected area.
4. If necessary, initiate controlled evacuation of the site.
5. If the leak/spillage is battery acid, apply a neutralising agent hydrated lime or similar. (Please note that water in a large quantity will only dilute the acidity & will not neutralise it) on the affected areas (Operatives must use appropriate PPE; gloves, face masks & goggles, whilst handling hydrated limes).
6. All contaminated absorbents must be placed in a leak proof container, which is labelled & stored pending removal.
7. Seek specialist advice on decontamination of the site surfaces if necessary
8. Complete an Environmental Incident Record Form (See Appendix EMS2)
9. Any actions taken will be recorded on the Site Diary.
10. Written confirmation of any actual or potential pollution incidents must be submitted to the Environment Agency via the sites Permitting Office within 24 hours.
11. Confirm site clean up with the Environment Agency.
12. Replenish supplies of absorbent materials.

Appendix FPP2: Site Layout Plan

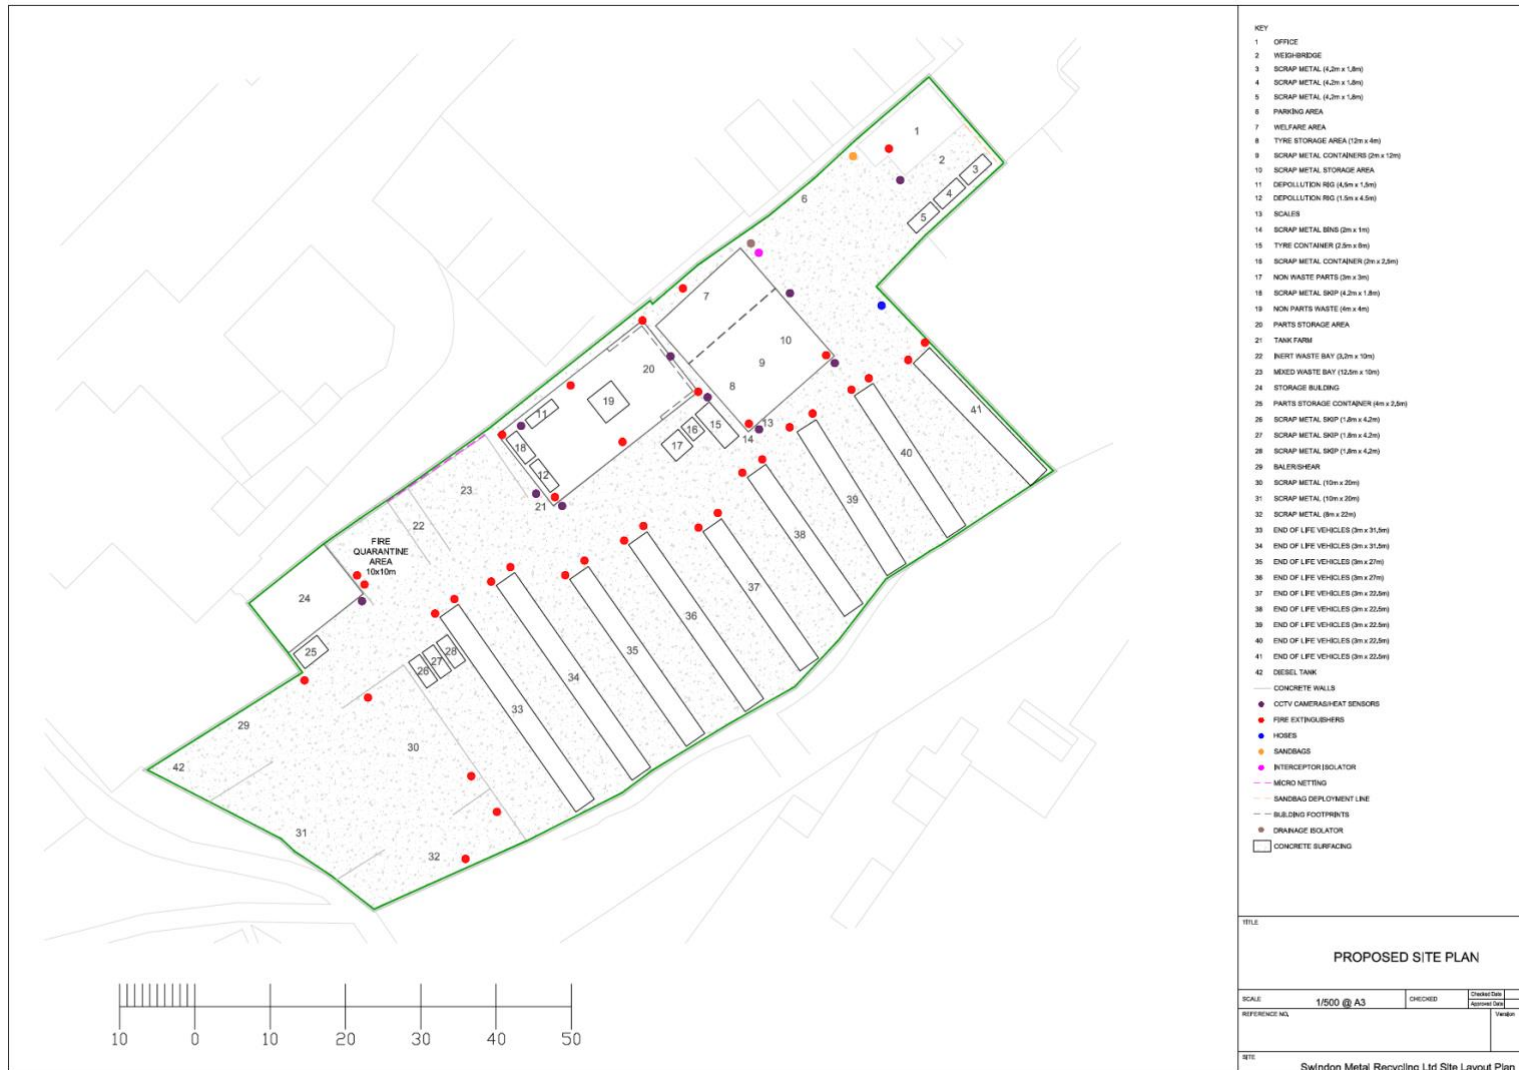


Location: Unit B Marshgate

Project: Bespoke Permit Variation Application

Document Title: Fire Prevention Plan v1.0 Submission Version 10.09.25

Page 28 of 34

Appendix FPP3: Site Drainage Plan

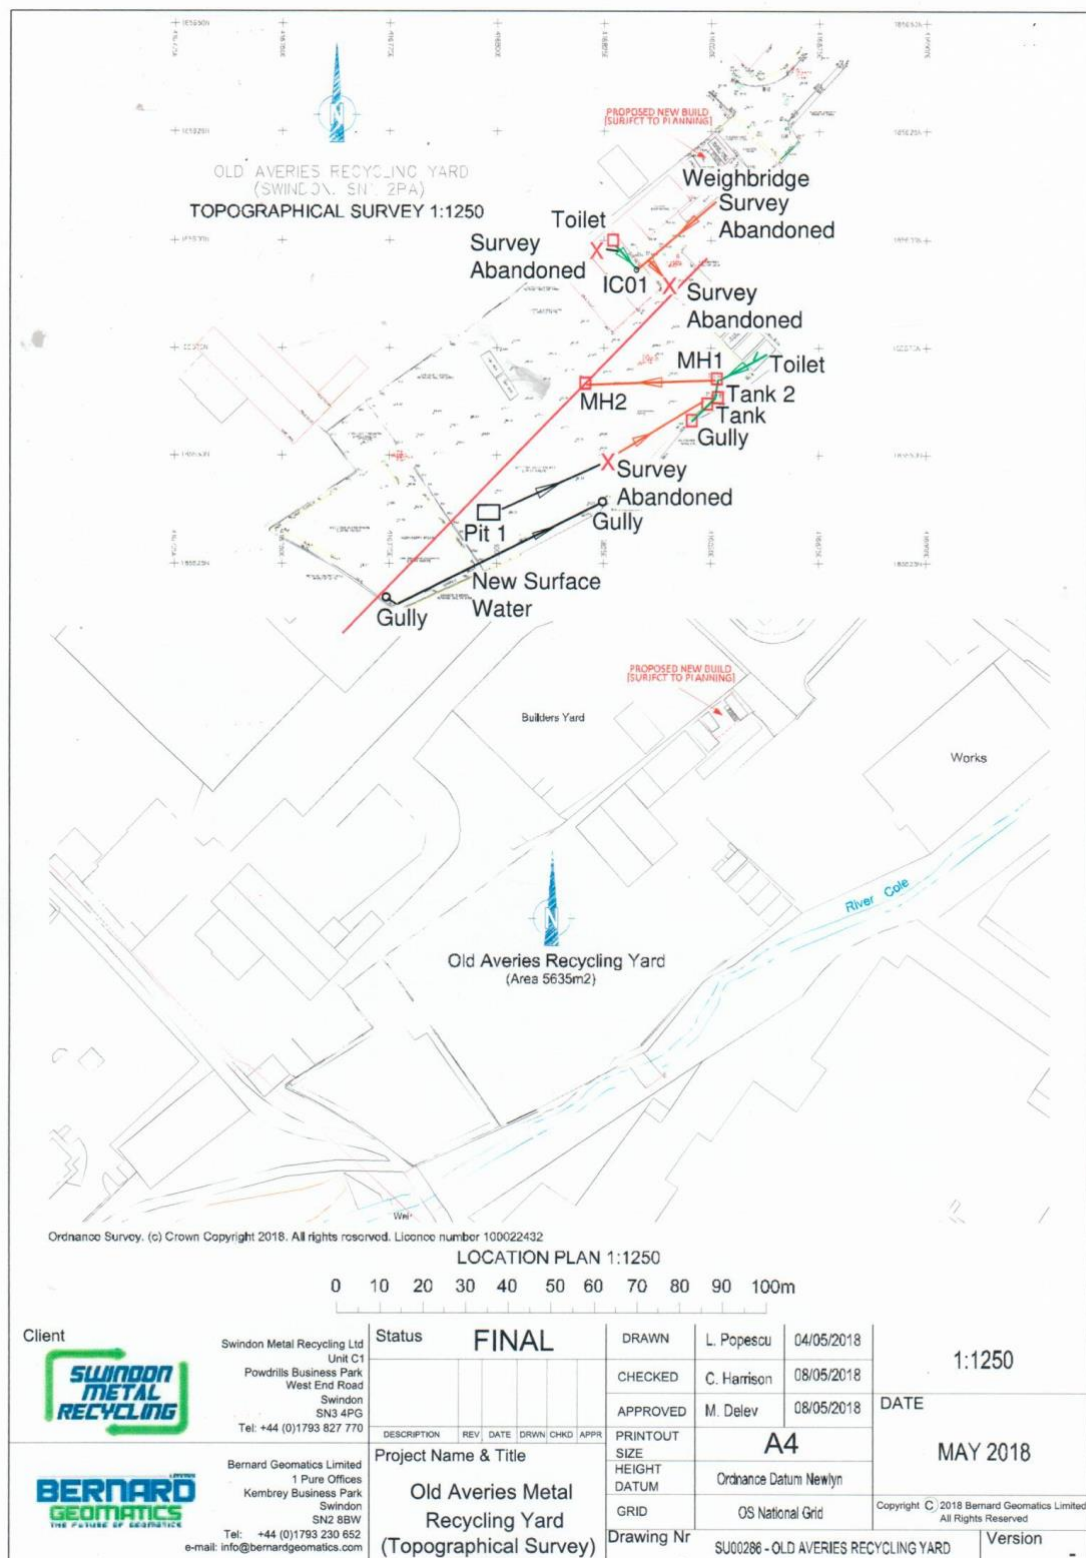


Location: Unit B Marshgate

Project: Bespoke Permit Variation Application

Document Title: Fire Prevention Plan v1.0 Submission Version 10.09.25

Page 29 of 34

Appendix FPP4: Hydrant Map

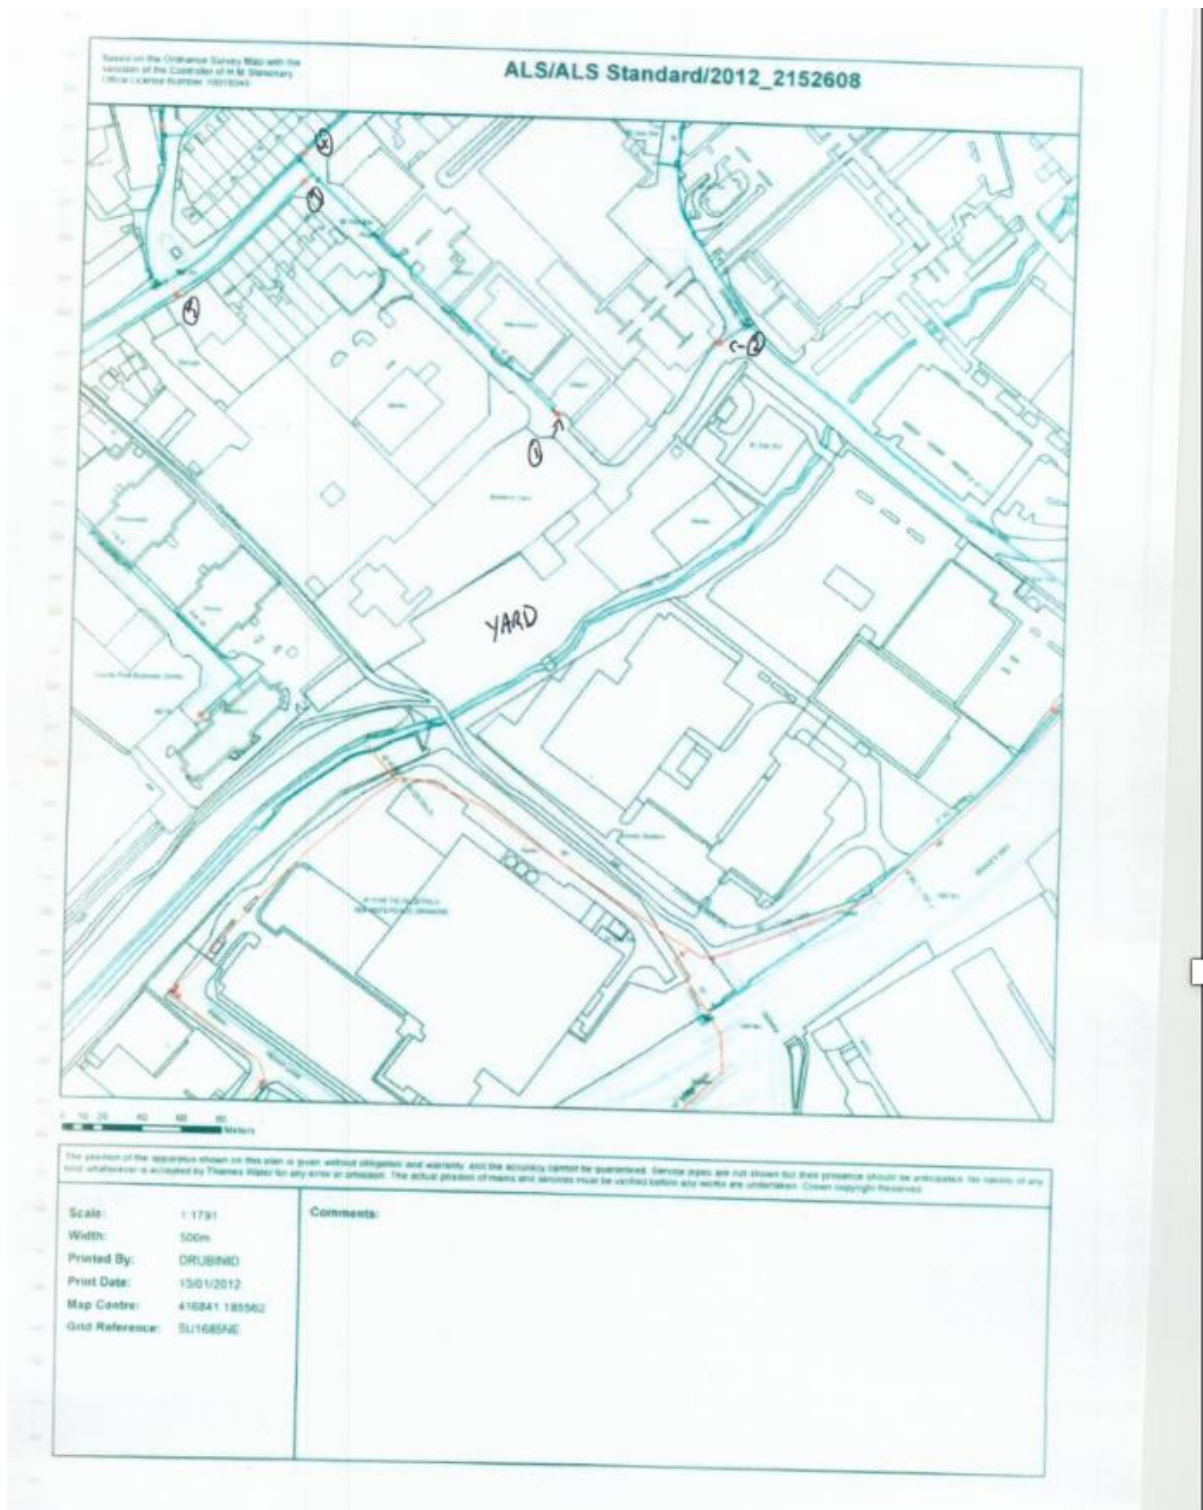


Location: Unit B Marshgate

Project: Bespoke Permit Variation Application

Document Title: Fire Prevention Plan v1.0 Submission Version 10.09.25

Page 30 of 34

Appendix FPP5: Receptor Location Plan (Smoke & Fire Spreading) Scaled @ 1:25,000 (1KM Buffer).

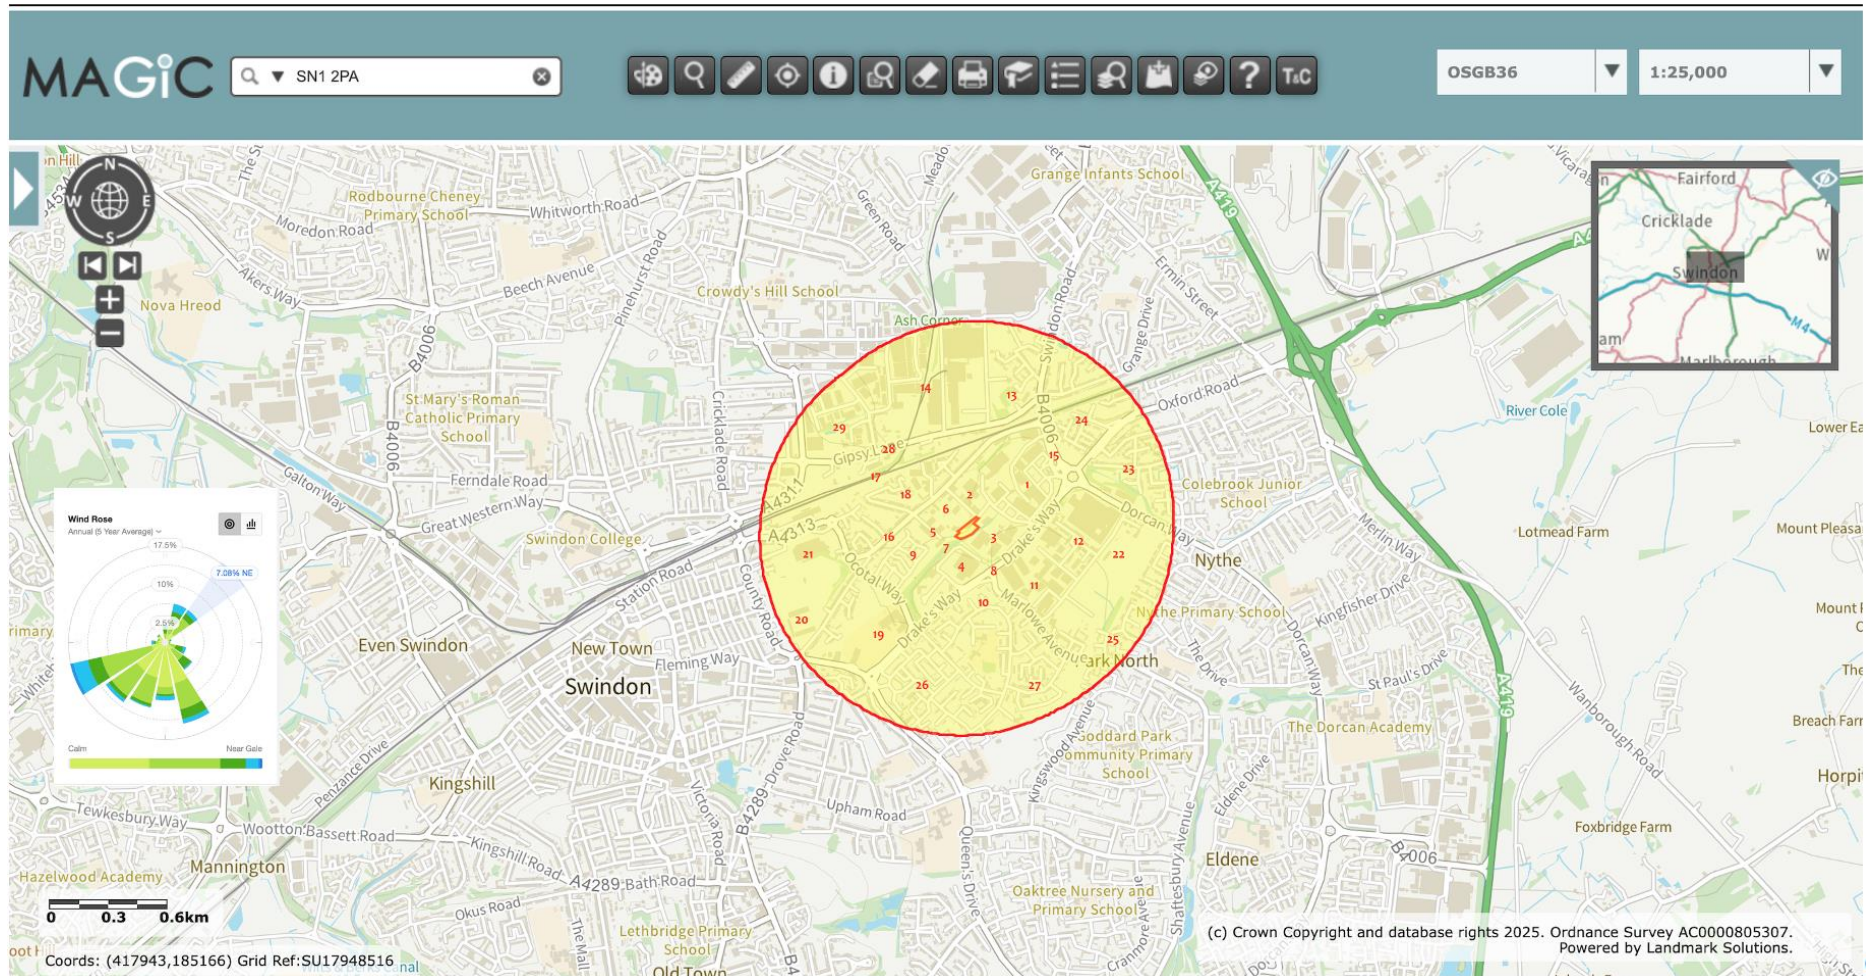

Location: Unit B Marshgate

Project: Bespoke Permit Variation Application

Document Title: Fire Prevention Plan v1.0 Submission Version 10.09.25

Page 31 of 34

Appendix FPP6: Receptors Identified Contact Details (If Applicable).

Receptor Reference	Receptor Description	Direction From Site	Wind Directional Travel Percentage % (Overall Meteorological Office Figures)	Approximate Distance From Site Boundary (Metres)
1	Commercial & Industrial	North East	13	371
2	Commercial & Industrial	North	10.30	90.3
3	Commercial & Industrial	South East	1.80	110
4	Commercial & Industrial	South	3.07	145
5	Commercial & Industrial	West	0.92	156
6	Commercial & Industrial	North West	5.93	125
7	River Cole	South	3.07	80
8	Road Infrastructure	South East	1.80	271
9	Residential	South West	7.08	150
10	Residential	South	3.07	266
11	Commercial & Industrial	South East	1.80	316
12	Commercial & Industrial	East	2.43	481
13	Residential	North East	13	732
14	Commercial & Industrial	North West	5.93	690
15	Road Infrastructure	North East	13	543
16	Road Infrastructure	West	0.92	232
17	Railway Infrastructure	North West	5.93	495
18	Commercial & Industrial	North West	5.93	312
19	St Joseph's Roman Catholic College	South West	7.08	489
20	Swindon Football Club	South West	7.08	885
21	Foundation Park	West	0.92	713
22	Rugby Club	South East	1.80	765
23	Residential	East	2.43	850
24	Residential	North East	13	676
25	Residential	South East	1.80	942
26	Residential	South West	7.08	748
27	Residential	South East	1.80	824
28	Road Infrastructure	North West	5.93	817
29	Gorse Hill School and Children Centre	North West	5.93	976

Risk-Assessment: -

The prevailing wind direction is from the West South-Westerly direction so any smoke generated would be blown in a North North-Easterly direction

Location: Unit B Marshgate

Project: Bespoke Permit Variation Application

Document Title: Fire Prevention Plan v1.0 Submission Version 10.09.25

Page 32 of 34

Appendix FPP7: Waste Acceptance Procedures (Extracted from EMS)

15.1.2 Compliance with the permitted waste types is assured by the following measures:

1. When a skip/container is hired prohibited material is clearly stated and reflected in terms & conditions of hire;
2. When collecting the full skip/container the driver will inspect and check to see if any prohibited material is present. If it is, the customer will be notified and advised of the following courses of action available:
 - a) Removed and left at the customers premises
 - b) Accepted and disposed of directly to a site permitted to accept the waste
3. On delivery to site the driver will hand all paper copies of any Duty of Care Documentation to the Weighbridge Office; and
4. Once all Duty of Care Documentation has been approved the wastes will be deposited in the Waste Acceptance Area for inspection, acceptance & processing (machine operatives will spread out the loads to aid the visual inspection process).

15.1.3 If any prohibited materials are present the following course of action will be taken:

- a) Require the individual to load the non-permitted materials back onto the delivery vehicle; or
- b) Accept, isolate & arrange for removal to an authorised waste management facility.
- c) Under no circumstances will non-permitted wastes be retained on site and dealt with as if it is permitted.
- d) The Agency will be notified if a delivery is rejected.

15.1.4 If the prohibited material becomes apparent only after the above waste acceptance checks have been completed the following action will be taken:

- a) The load will be isolated within the isolation facility (appropriate PPE will be worn if necessary) and removed from site to a suitably permitted facility at the earliest opportunity.
- b) In each case, the incident will be recorded in the Site Diary (taking note of the vehicle registration, date & time of the incident). If identifiable the individual will be notified of the event and reminded of the terms on which waste is accepted onto site. (It will be at the discretion of the Management Team if they wish to ban an individual/company following an incident).

- c) Under no circumstances will prohibited waste be retained on site and dealt with as if it is permitted.
- d) The Agency will be notified if a delivery is rejected.

15.2 Rejection Procedure

15.2.1 Any wastes identified as being unsuitable for disposal at the site will be rejected & recorded on the Weekly Compliance Inspection Check Sheet.

15.2.2 A record will be kept of the following pieces of information:

- a) Date & time
- b) Person rejecting the waste(s)
- c) Haulier/customer name and address including carriers' number
- d) Vehicle registration number
- e) Procedure name and address
- f) EWC number
- g) Transfer Note Number
- h) Waste Description