



NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES. ALL LEVELS ARE IN METRES ABOVE ORDNANCE DATUM. BURIED SERVICES SHOWN ON THIS DRAWING ARE INDICATIVE ONLY. THEY HAVE BEEN IDENTIFIED AND POSITIONED FROM VARIOUS HISTORICAL ARE DIAGRAMMATIC ONLY.
2. OTHER BURIED SERVICES FOR WHICH NO RECORD DRAWINGS OR INFORMATION IS AVAILABLE FROM THE RECORDS OF THE LOCAL AUTHORITY OR OTHERWISE OBTAINABLE, MAY BE SHOWN BURIED SERVICES MAY BE ACTIVE OR ABANDONED. THESE BURIED SERVICES INCLUDE, BUT ARE NOT LIMITED TO, THE FOLLOWING:
 - LOW VOLTAGE ELECTRIC CABLES.
 - HIGH VOLTAGE ELECTRIC CABLES.
 - SEPARATE SYSTEMS, 1 LINE AND 2 ABANDONED).
 - RISING MAINS.
 - INSTRUMENT AND CONTROL CABLES.
 - TELEPHONE AND TELEVISION CABLES.
 - LAND DRAINS.
 - OTHER SURFACE WATER AND FOUL DRAINS.
 - CATHODIC PROTECTION.


GRID RESIDUAL RISKS
 1. SITE USE AS PERMITTED AND UNCHANGED
 2. UNDERGROUND SERVICES (SEE NOTES 1 AND 2)
 3. CONTAMINATION, PARTICULARLY HYDROCARBON AND ASBESTOS CONTAMINATION, MAY BE PRESENT.

UNDERGROUND SERVICES KEY

- 100 — EXISTING FLOWLINE No. 1 10"
- 100 — EXISTING BRUNNALL/BACKCROFT FLOWLINE 10"
- 100 — EXISTING FLOWLINE No. 2 10"
- 100 — EXISTING FLOWLINE No. 3 10"
- 100 — EXISTING FLOWLINE No. 4 10"
- 100 — EXISTING FLOWLINE No. 5 10"
- 100 — EXISTING FLOWLINE No. 6 10"
- 100 — EXISTING FLOWLINE No. 7 10"
- 100 — EXISTING FLOWLINE No. 8 10"
- 100 — EXISTING FLOWLINE No. 9 10"
- 100 — EXISTING FLOWLINE No. 10 10"
- 100 — EXISTING FLOWLINE No. 11 10"
- 100 — EXISTING FLOWLINE No. 12 10"
- 100 — EXISTING FLOWLINE No. 13 10"
- 100 — EXISTING FLOWLINE No. 14 10"
- 100 — EXISTING FLOWLINE No. 15 10"
- 100 — EXISTING FLOWLINE No. 16 10"
- 100 — EXISTING FLOWLINE No. 17 10"
- 100 — EXISTING FLOWLINE No. 18 10"
- 100 — EXISTING FLOWLINE No. 19 10"
- 100 — EXISTING FLOWLINE No. 20 10"
- 100 — EXISTING FLOWLINE No. 21 10"
- 100 — EXISTING FLOWLINE No. 22 10"
- 100 — EXISTING FLOWLINE No. 23 10"
- 100 — EXISTING FLOWLINE No. 24 10"
- 100 — EXISTING FLOWLINE No. 25 10"
- 100 — EXISTING FLOWLINE No. 26 10"
- 100 — EXISTING FLOWLINE No. 27 10"
- 100 — EXISTING FLOWLINE No. 28 10"
- 100 — EXISTING FLOWLINE No. 29 10"
- 100 — EXISTING FLOWLINE No. 30 10"
- 100 — EXISTING FLOWLINE No. 31 10"
- 100 — EXISTING FLOWLINE No. 32 10"
- 100 — EXISTING FLOWLINE No. 33 10"
- 100 — EXISTING FLOWLINE No. 34 10"
- 100 — EXISTING FLOWLINE No. 35 10"
- 100 — EXISTING FLOWLINE No. 36 10"
- 100 — EXISTING FLOWLINE No. 37 10"
- 100 — EXISTING FLOWLINE No. 38 10"
- 100 — EXISTING FLOWLINE No. 39 10"
- 100 — EXISTING FLOWLINE No. 40 10"
- 100 — EXISTING FLOWLINE No. 41 10"
- 100 — EXISTING FLOWLINE No. 42 10"
- 100 — EXISTING FLOWLINE No. 43 10"
- 100 — EXISTING FLOWLINE No. 44 10"
- 100 — EXISTING FLOWLINE No. 45 10"
- 100 — EXISTING FLOWLINE No. 46 10"
- 100 — EXISTING FLOWLINE No. 47 10"
- 100 — EXISTING FLOWLINE No. 48 10"
- 100 — EXISTING FLOWLINE No. 49 10"
- 100 — EXISTING FLOWLINE No. 50 10"
- 100 — EXISTING FLOWLINE No. 51 10"
- 100 — EXISTING FLOWLINE No. 52 10"
- 100 — EXISTING FLOWLINE No. 53 10"
- 100 — EXISTING FLOWLINE No. 54 10"
- 100 — EXISTING FLOWLINE No. 55 10"
- 100 — EXISTING FLOWLINE No. 56 10"
- 100 — EXISTING FLOWLINE No. 57 10"
- 100 — EXISTING FLOWLINE No. 58 10"
- 100 — EXISTING FLOWLINE No. 59 10"
- 100 — EXISTING FLOWLINE No. 60 10"
- 100 — EXISTING FLOWLINE No. 61 10"
- 100 — EXISTING FLOWLINE No. 62 10"
- 100 — EXISTING FLOWLINE No. 63 10"
- 100 — EXISTING FLOWLINE No. 64 10"
- 100 — EXISTING FLOWLINE No. 65 10"
- 100 — EXISTING FLOWLINE No. 66 10"
- 100 — EXISTING FLOWLINE No. 67 10"
- 100 — EXISTING FLOWLINE No. 68 10"
- 100 — EXISTING FLOWLINE No. 69 10"
- 100 — EXISTING FLOWLINE No. 70 10"
- 100 — EXISTING FLOWLINE No. 71 10"
- 100 — EXISTING FLOWLINE No. 72 10"
- 100 — EXISTING FLOWLINE No. 73 10"
- 100 — EXISTING FLOWLINE No. 74 10"
- 100 — EXISTING FLOWLINE No. 75 10"
- 100 — EXISTING FLOWLINE No. 76 10"
- 100 — EXISTING FLOWLINE No. 77 10"
- 100 — EXISTING FLOWLINE No. 78 10"
- 100 — EXISTING FLOWLINE No. 79 10"
- 100 — EXISTING FLOWLINE No. 80 10"
- 100 — EXISTING FLOWLINE No. 81 10"
- 100 — EXISTING FLOWLINE No. 82 10"
- 100 — EXISTING FLOWLINE No. 83 10"
- 100 — EXISTING FLOWLINE No. 84 10"
- 100 — EXISTING FLOWLINE No. 85 10"
- 100 — EXISTING FLOWLINE No. 86 10"
- 100 — EXISTING FLOWLINE No. 87 10"
- 100 — EXISTING FLOWLINE No. 88 10"
- 100 — EXISTING FLOWLINE No. 89 10"
- 100 — EXISTING FLOWLINE No. 90 10"
- 100 — EXISTING FLOWLINE No. 91 10"
- 100 — EXISTING FLOWLINE No. 92 10"
- 100 — EXISTING FLOWLINE No. 93 10"
- 100 — EXISTING FLOWLINE No. 94 10"
- 100 — EXISTING FLOWLINE No. 95 10"
- 100 — EXISTING FLOWLINE No. 96 10"
- 100 — EXISTING FLOWLINE No. 97 10"
- 100 — EXISTING FLOWLINE No. 98 10"
- 100 — EXISTING FLOWLINE No. 99 10"
- 100 — EXISTING FLOWLINE No. 100 10"

HOLD LIST

△ HOLD FOR COMPLETION OF EXISTING UNDERGROUND CABLE

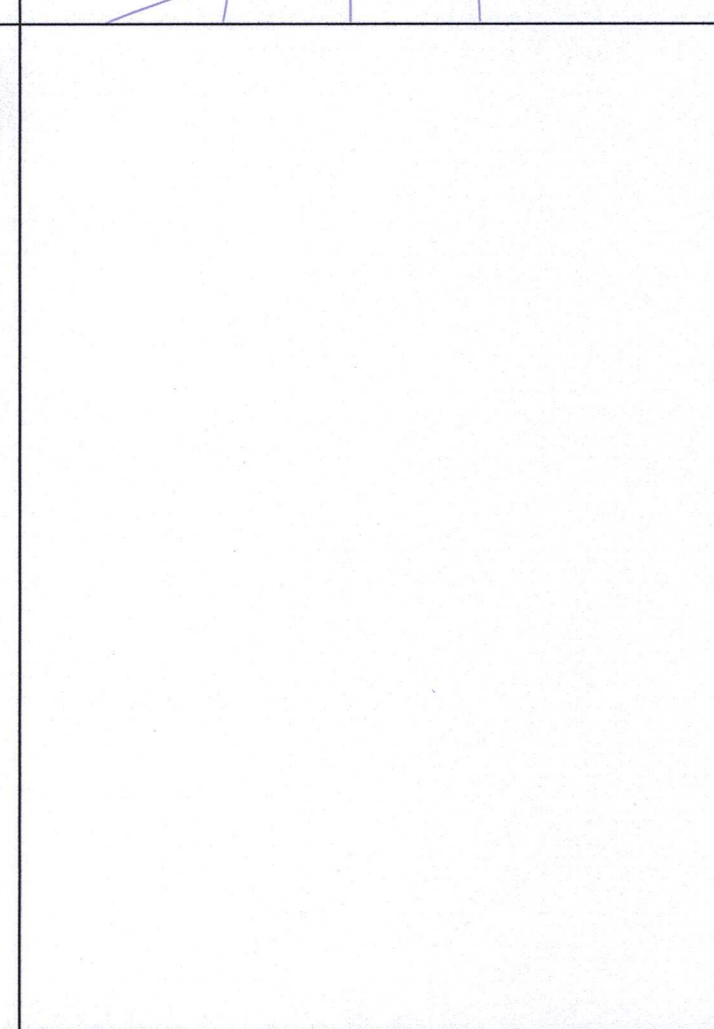

REV	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED	CUSTOMER	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED	CUSTOMER	DATE	DESCRIPTION
0	16/12/2013	DRAWING TITLE REVERSED ISSUED FOR USE	DLA	RA	MR	MR			DLA	RA	MR	MR		

REV	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED	CUSTOMER	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED	CUSTOMER	DATE	DESCRIPTION

REV	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED	CUSTOMER	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED	CUSTOMER	DATE	DESCRIPTION

REV	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED	CUSTOMER	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED	CUSTOMER	DATE	DESCRIPTION