


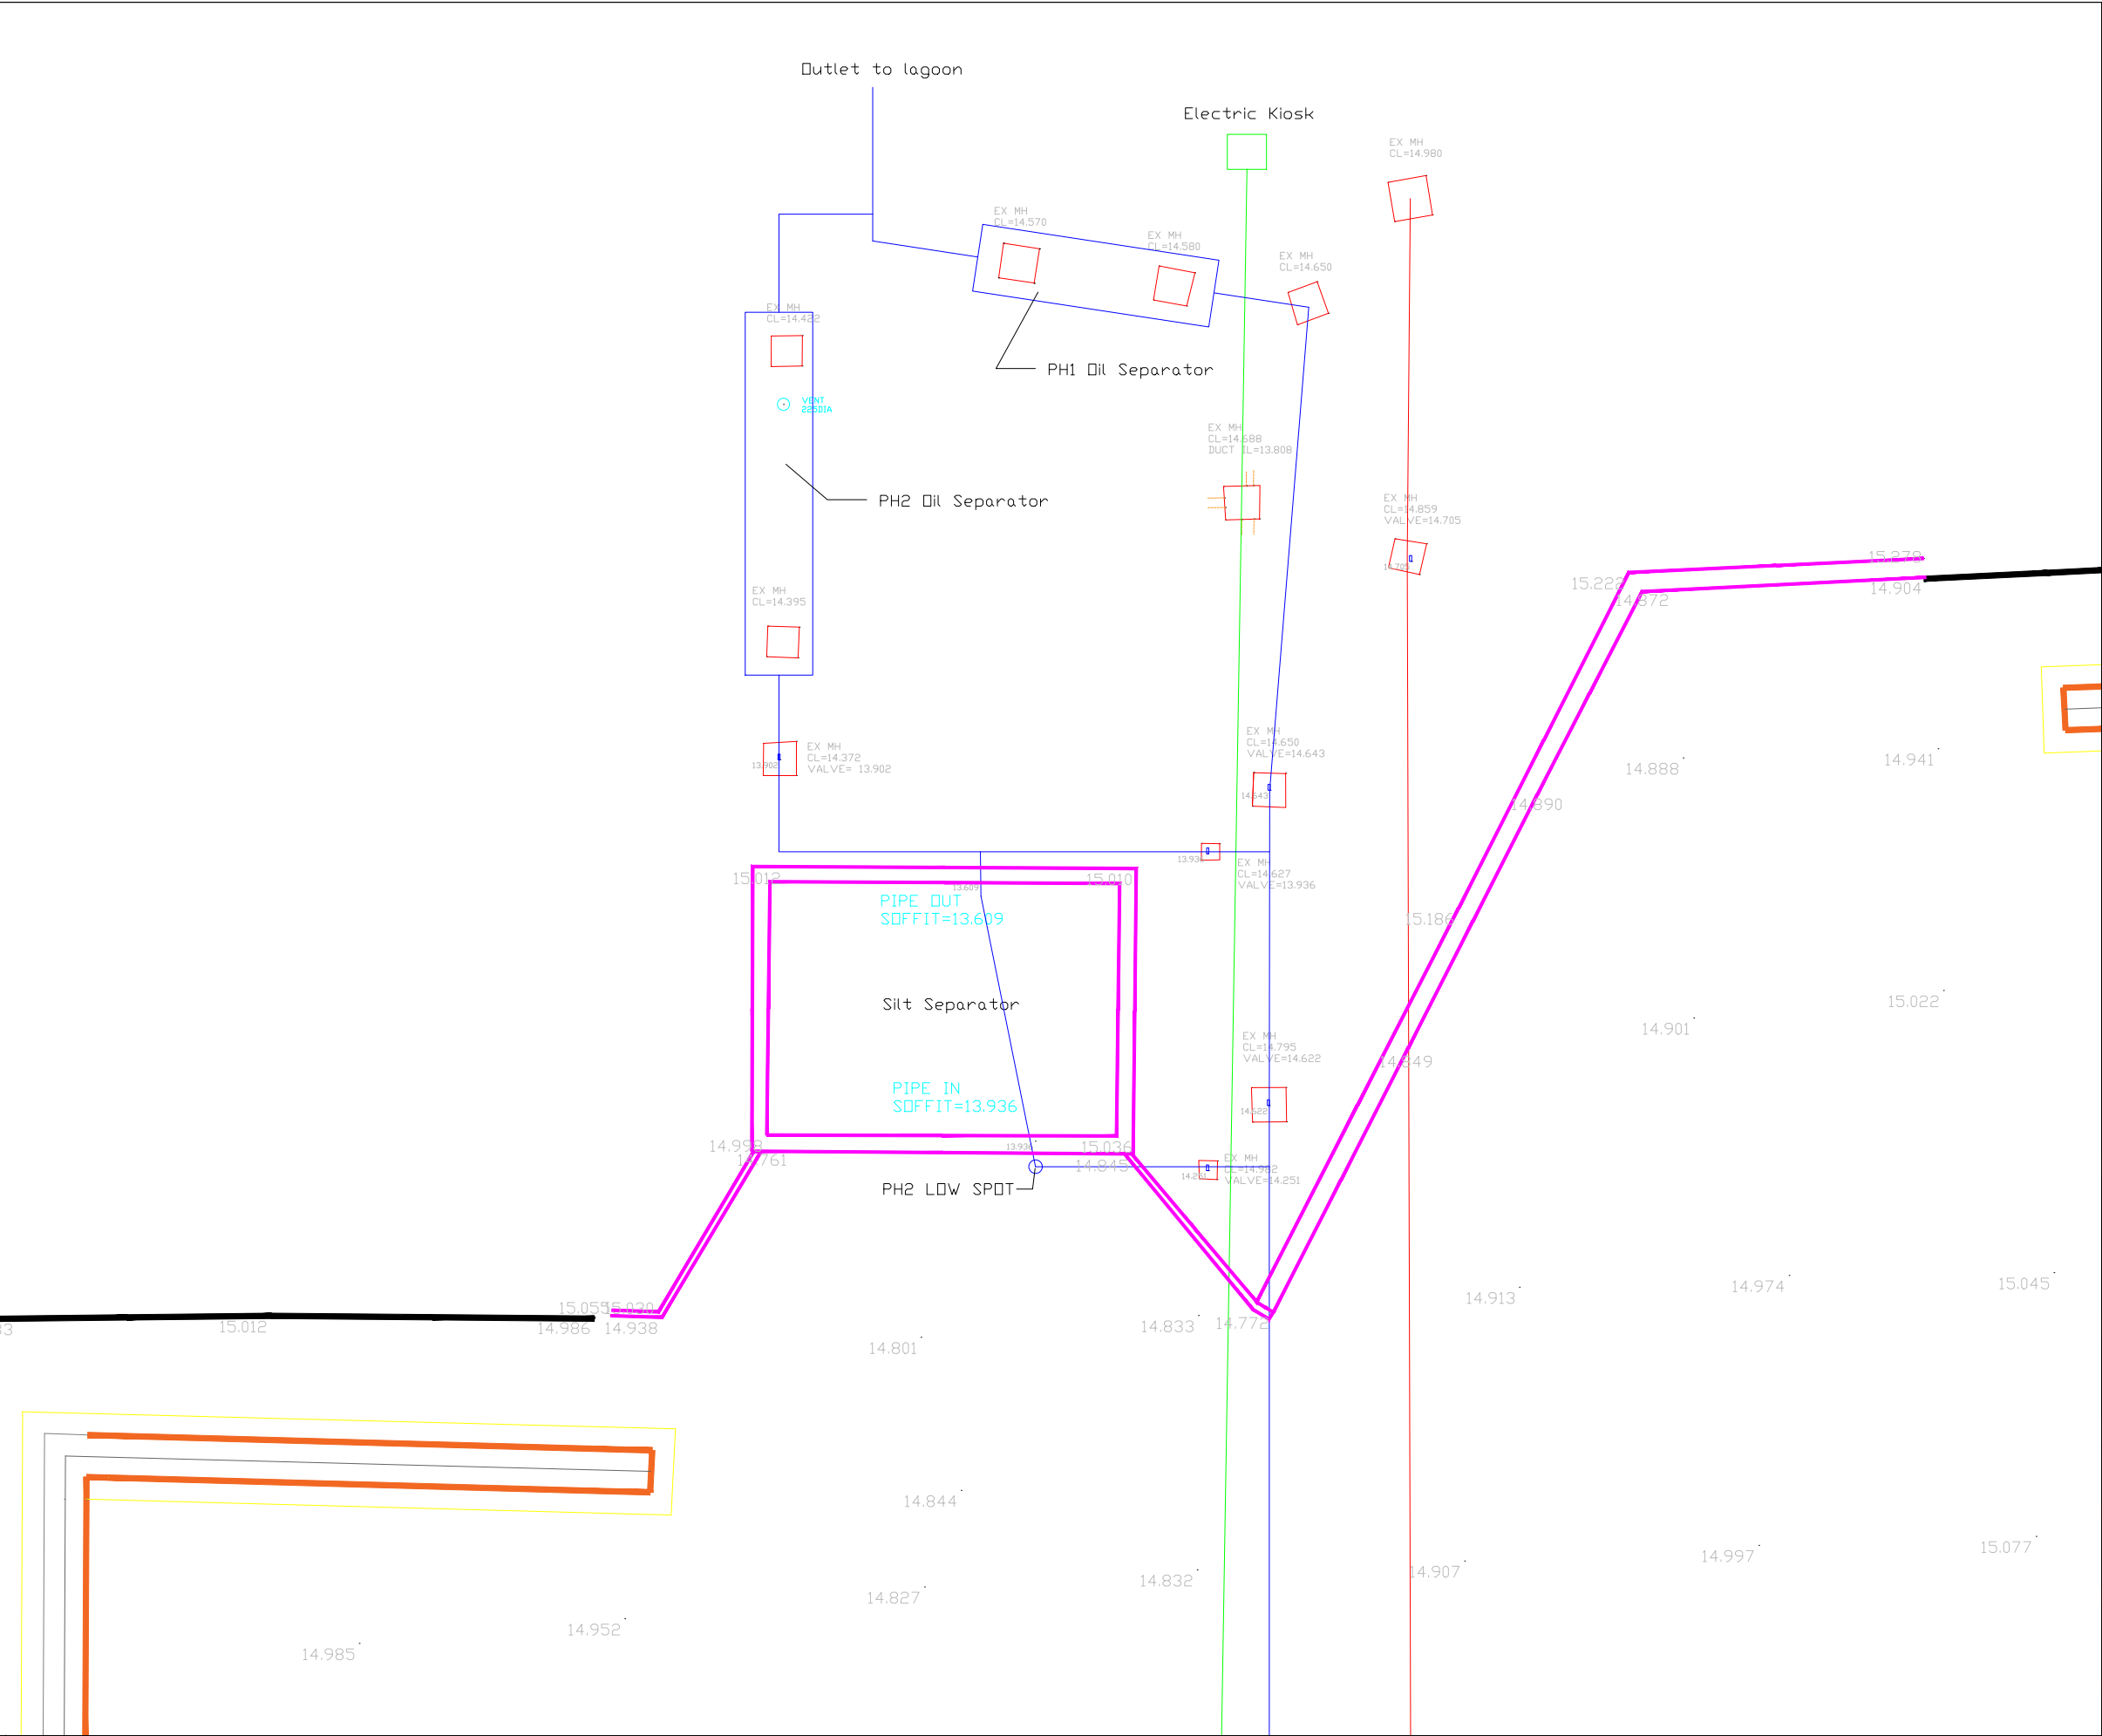

Notes:

All measurements are taken from surface & are approx.

The pit base was inaccessible on the day & we couldn't get an accurate diameter of the inlet/outlet pipe.

All services shown are indicative & for reference only.

- Key:**
- Fire Mains
 - Electric
 - Surface Water Drains
 - Surveyed Blockwork
 - Blockwork Base - Not Surveyed Points
 - Blockwork C/L & Blockwork Extension - Not Surveyed Points

ATLAS
SITE ENGINEERING

Sarscow Farm, Sarscow Lane,
Leyland, PR26 8LS

REVISIONS			
B	26.03.24	BASES FOR BLOCKWORK FOR REF	D.A
A	29.01.24	SERVICES SHOWN FOR REFERENCE	D.A
REV	DATE	DESCRIPTION	APPROVED
ENGINEER		DRAUGHTSMAN	
APPROVED		DRAWN	
		A.P	
AUTHORISED SIGNATURE		DATE	
D.A		14.12.23	
DATE		SCALE	
14.12.23		NTS@A3	
PROJECT			
RUNCORN PHASE 2 SECTION 1			
CLIENT			
ECK CIVIL ENGINEERING			
DRAWING NUMBER		REVISION	
AT/23-163-1		B	