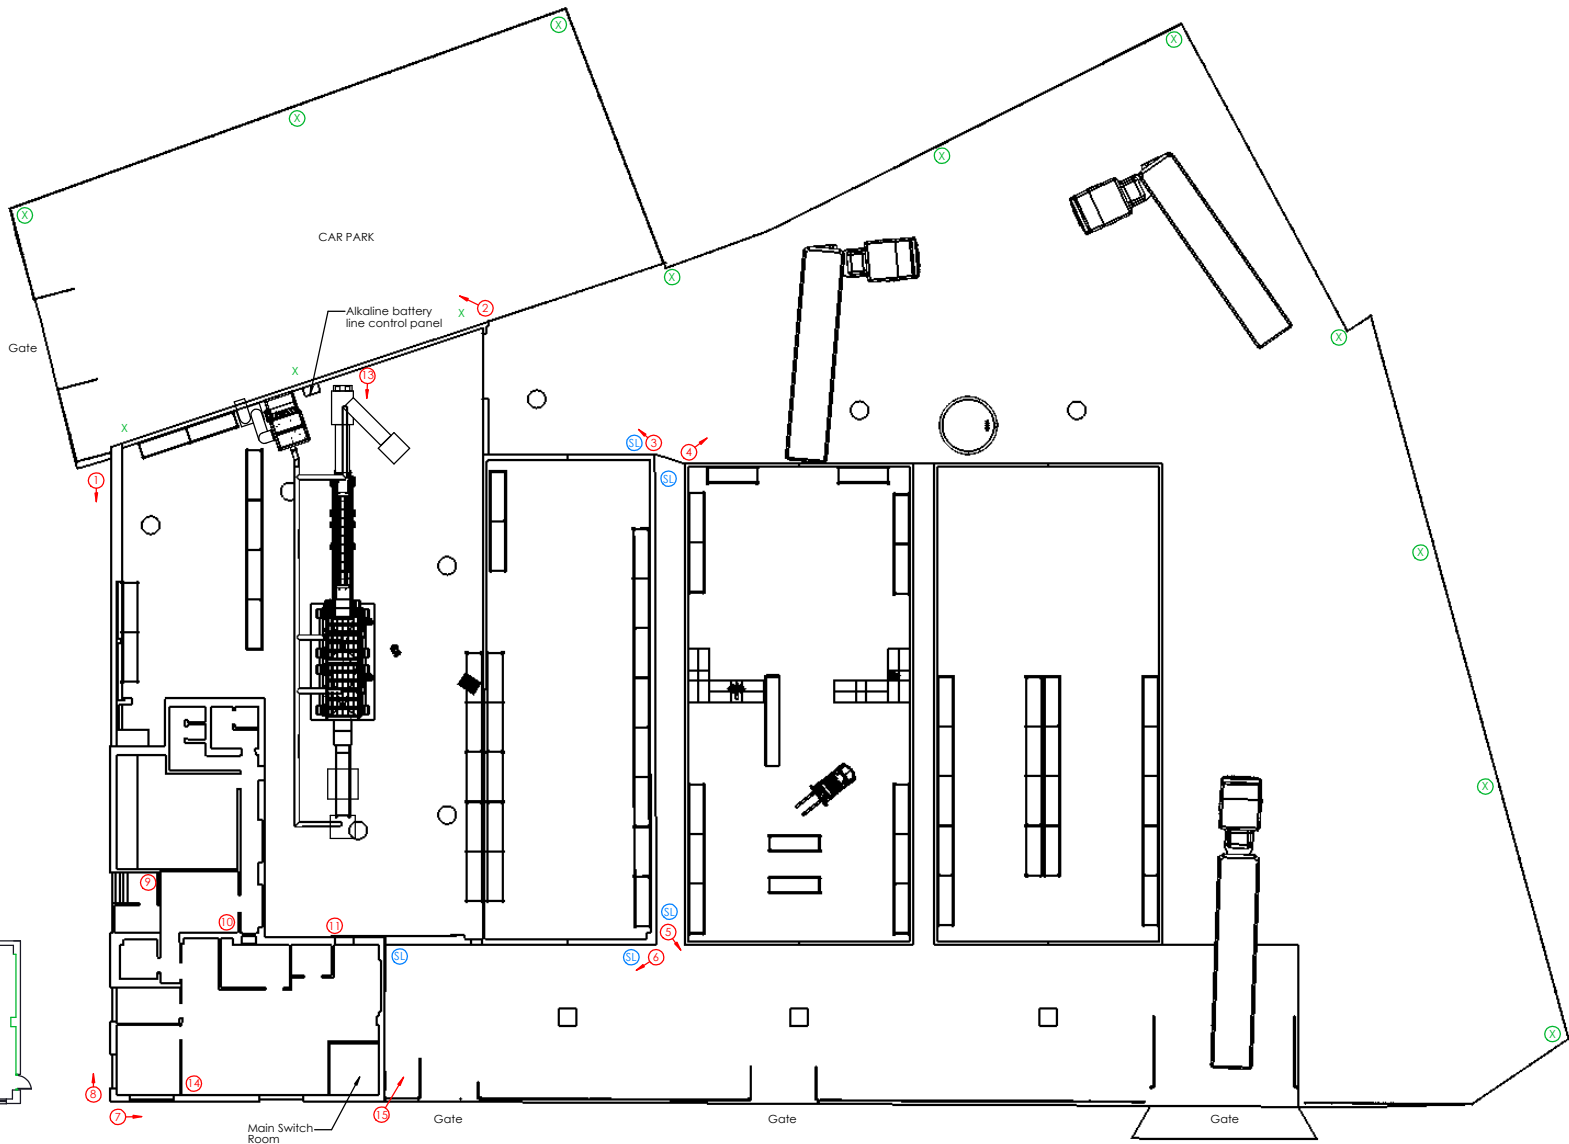

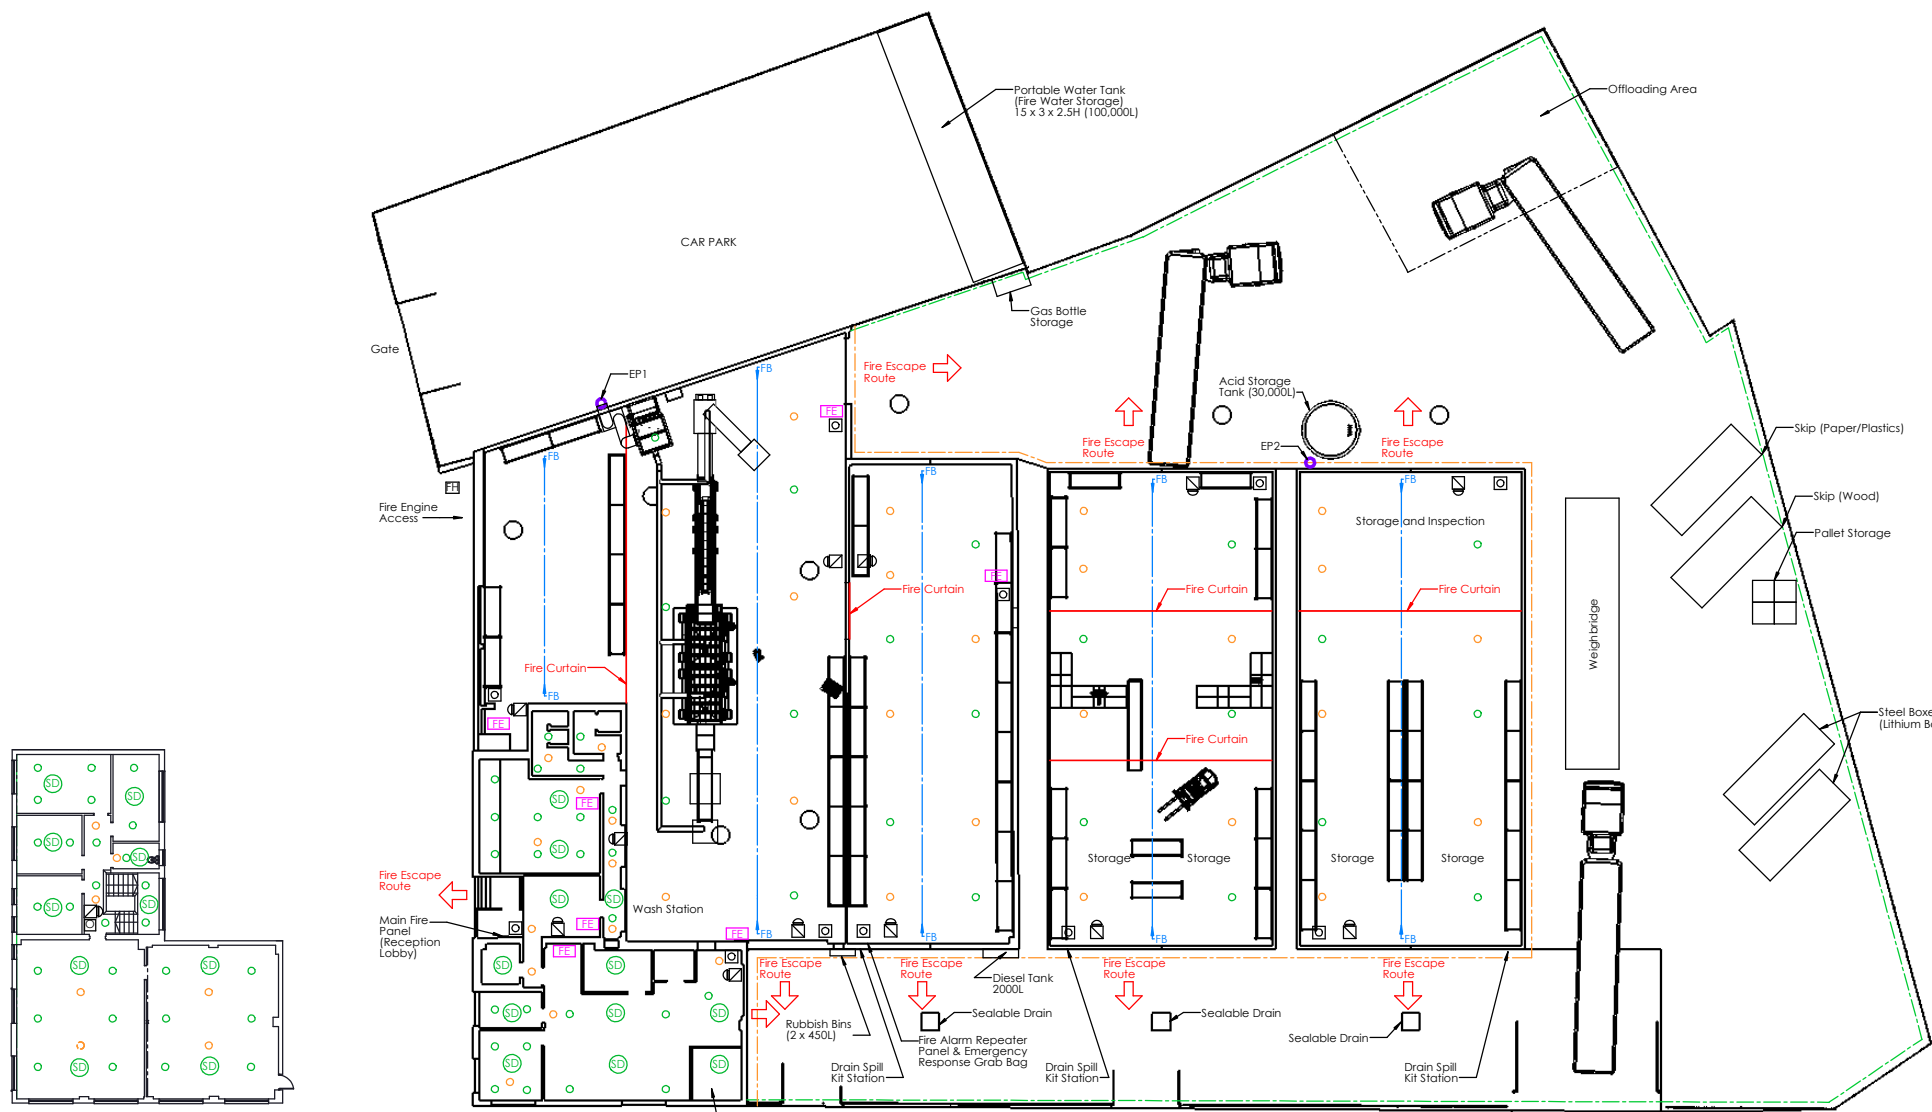


FIRST FLOOR



Key	Facility
① →	Camera/Direction (Monitored 24 Hours)
Ⓛ	Security Light
Ⓧ	Flood Light - Columb Mounted
x	Flood Light - Wall Mounted

<small>FIELD OBSERVERS SPECIFIED: DIMENSIONS ARE IN MILLIMETRES TOLERANCE: UNLESS OTHERWISE SPECIFIED FINISH</small>		<small>DO NOT SCALE DRAWING</small>	<small>REVISION: 01 Preliminary</small>
<small>DRAWN: [] NAME [] SIGNATURE [] DATE []</small>		<small>DRWG NO. ER0004</small>	<small>PROJECT: Roundcraft Plant phase 1 Security & CCTV</small>
<small>CHK'D: []</small> <small>APP'D: []</small> <small>DATE: []</small>	<small>MATERIAL:</small>		
<small>WEIGHT:</small>		<small>SCALE: 1:500</small>	<small>SHEET 1 OF 3</small>



FIRST FLOOR

Key	Facility
FB	Fire Beam (Monitored 24 Hours)
MC	Manual Call Point
SD	Smoke Detection (Monitored 24 Hours)
FB	Fire Bell
FE	Fire Extinguisher
○	Lighting
○	Emergency Lighting
FI	Fire Hydrant
—	100mm Bunding around building
- - -	200mm Bunding Around Perimeter
EP	Emissions Plant

Fire Assembly Point c/w Emergency Response Grab Bag

THESE DRAWINGS PREPARED BY: DRAWN: GA CHECKED: NG APPROVED: MP DATE: 18/05/21	THESE DRAWINGS PREPARED BY: DRAWN: GA CHECKED: NG APPROVED: MP DATE: 18/05/21	TITLE: Roundcraft Plant phase 1: Fire Detection and emergency use/fitting SCALE: 1:100 SHEET 2 OF 3	DO NOT SCALE DRAWING REVISION: 01 - Preliminary ERO004
---	---	---	--